

0 2" 4" 8" SCALE: 3" = 1'-0"

0 4" 8" 1'-4" SCALE: 1 1/2" = 1'-0"

0 6" 1' 1'-6" SCALE: 1" = 1'-0"


0 8" 1'-4" 2'-8" SCALE: 3/4" = 1'-0"

0 1' 2' 4' SCALE: 1/2" = 1'-0"

0 2' 4' 8' SCALE: 1/4" = 1'-0"

0 4' 8' 16' SCALE: 1/8" = 1'-0"


0 10' 20' 40' SCALE: 1" = 20'-0"

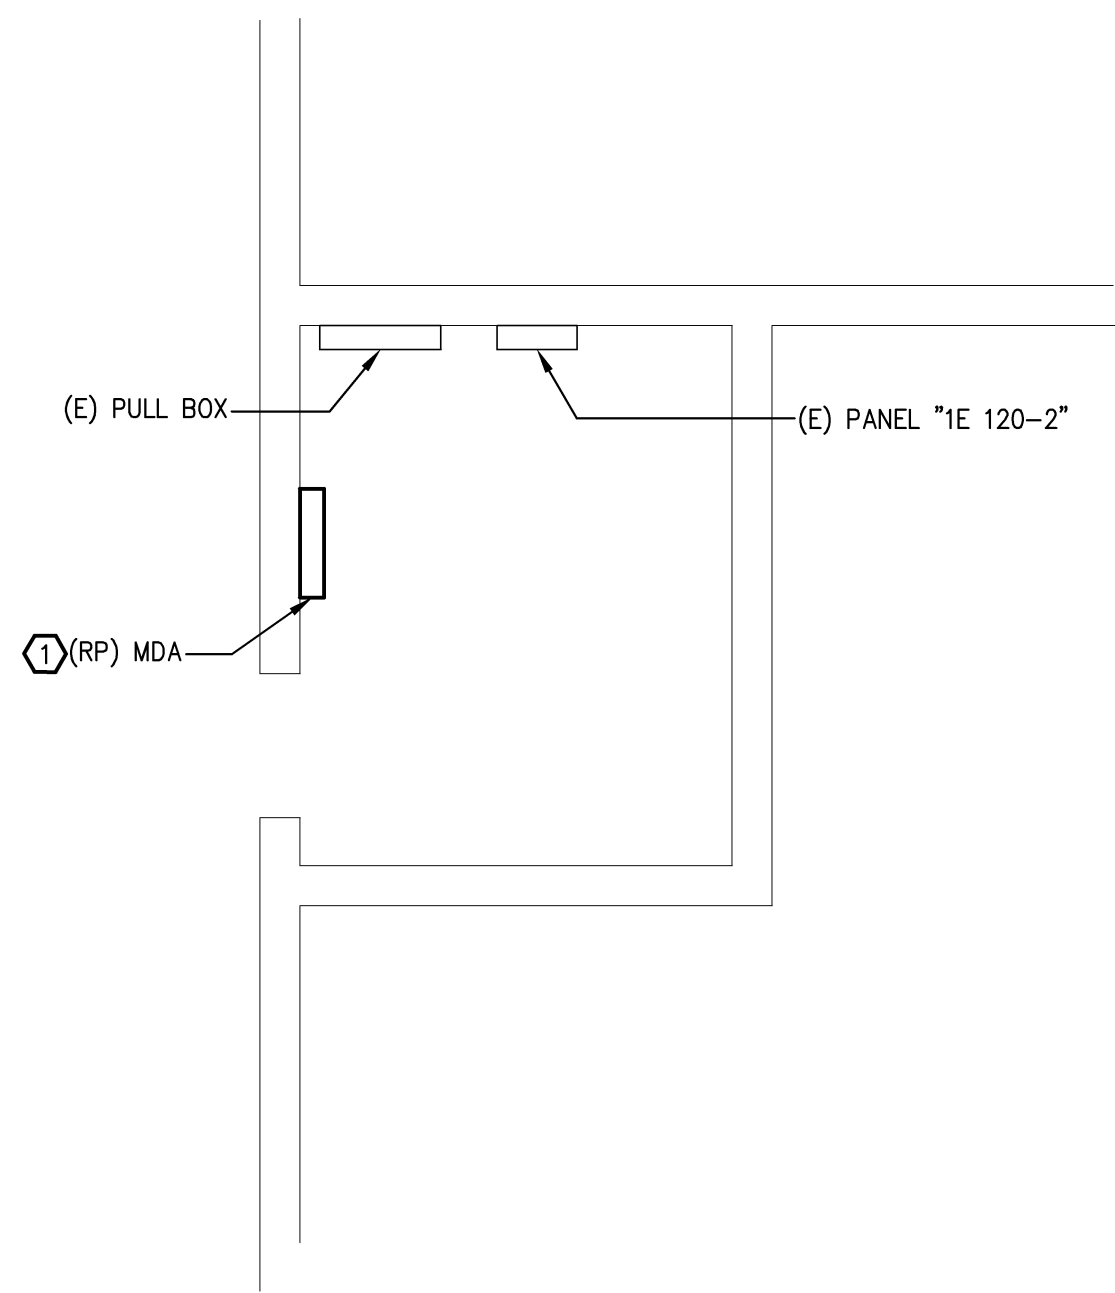

1 BUILDING No.17 - ELECTRICAL ROOM

SCALE: 1/4"=1'-0"

BUILDING No.17 - ELECTRICAL ROOM NOTES:
① REPLACE MDA AT SAME LOCATION.

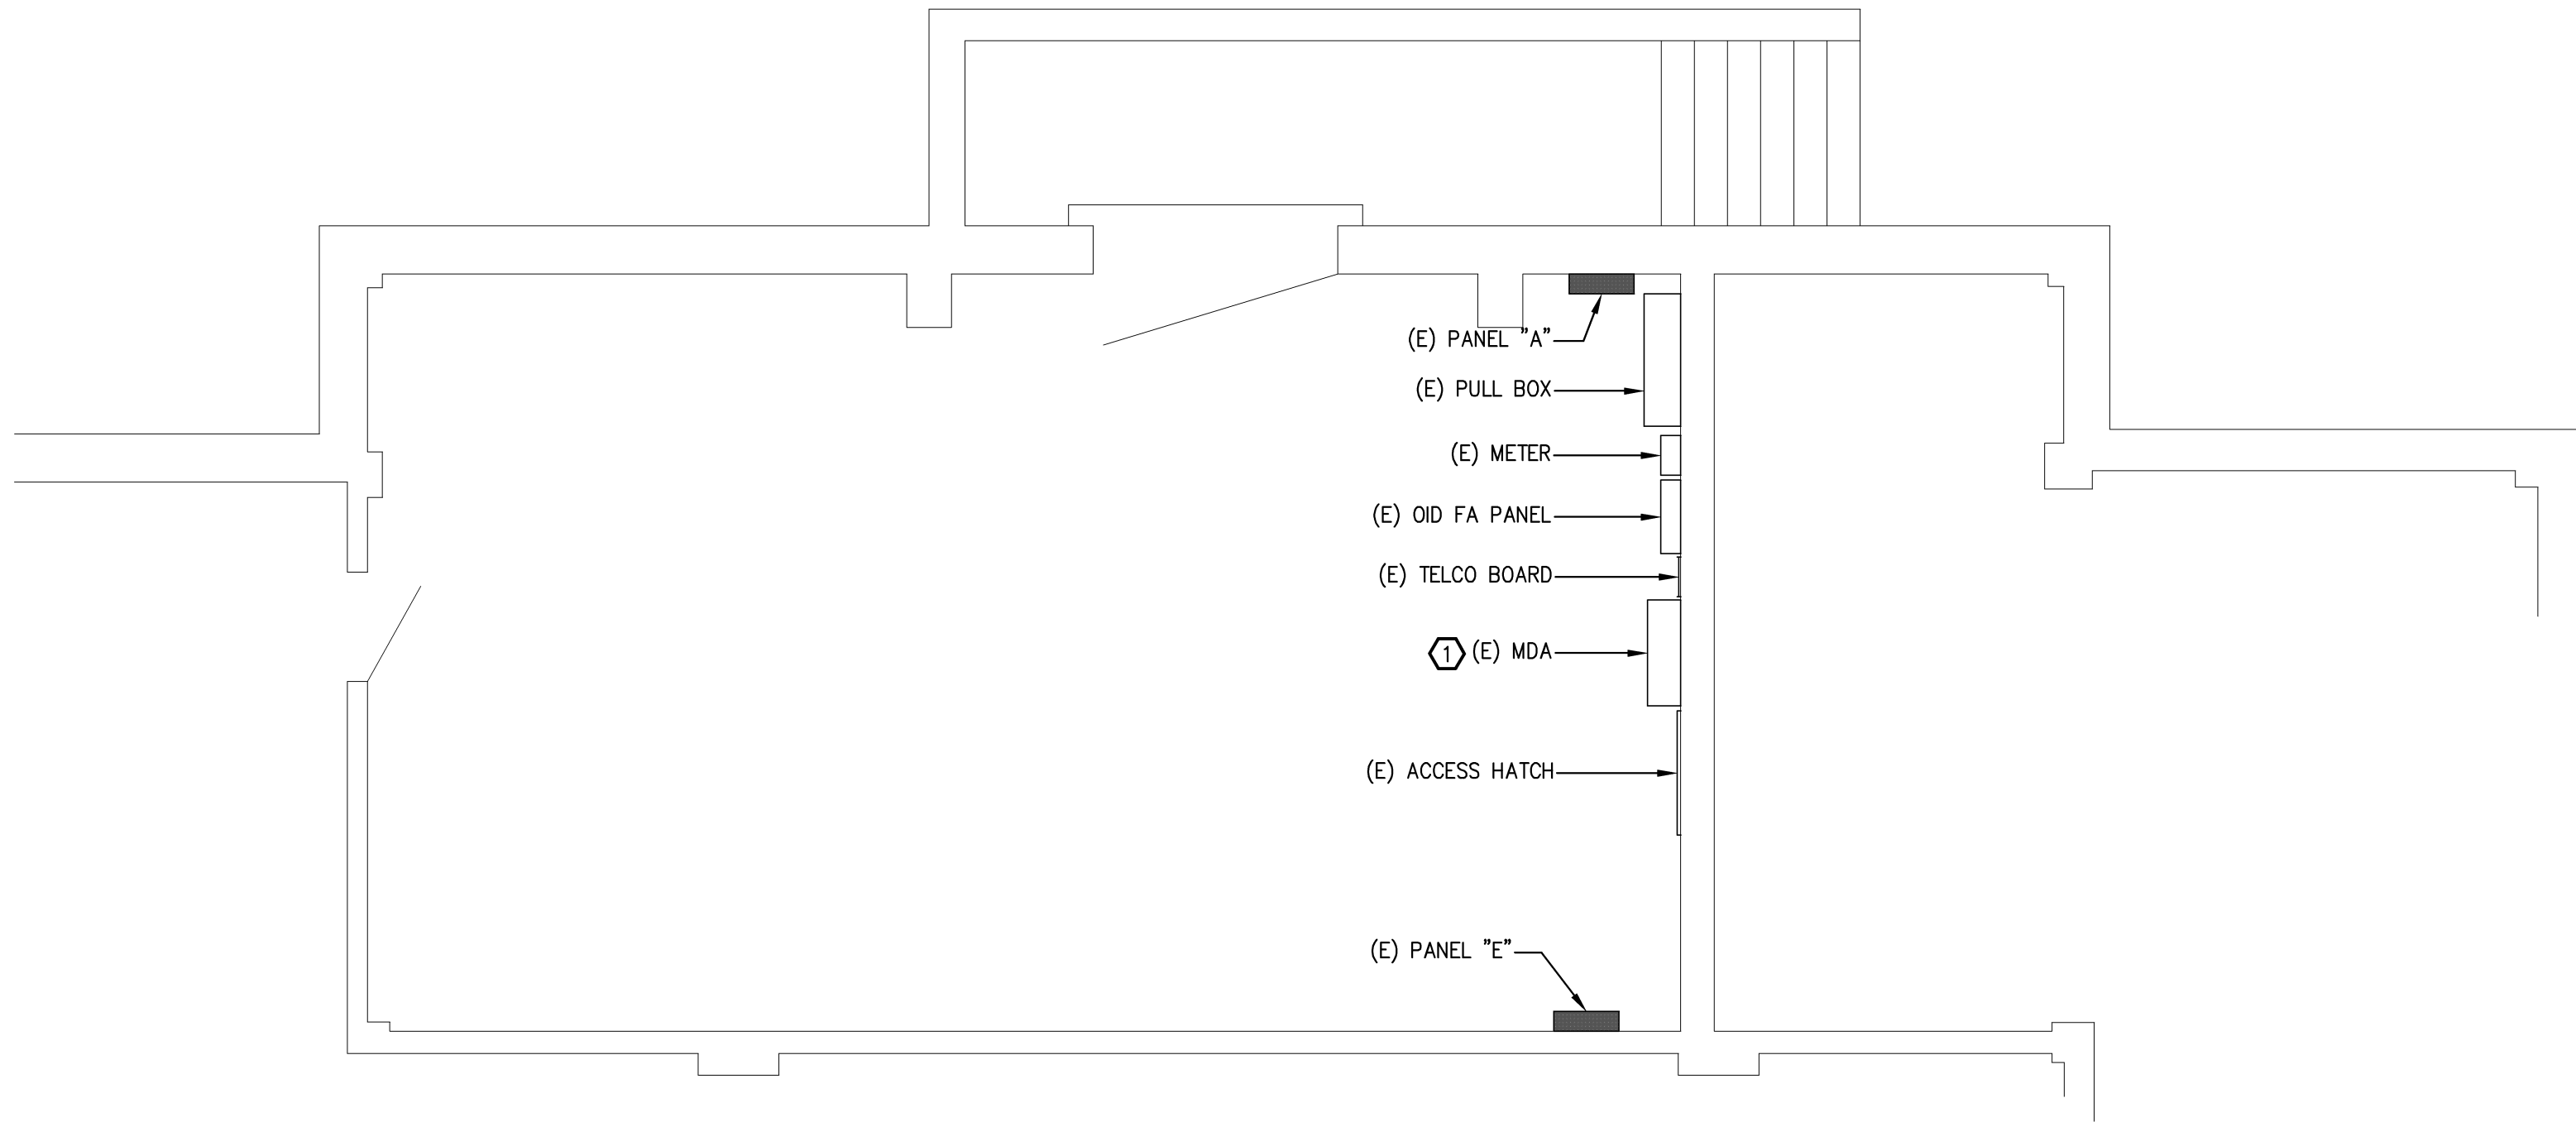

2 BUILDING No.16 - ELECTRICAL ROOM



SCALE: 1/4"=1'-0"

BUILDING No.16 - ELECTRICAL ROOM NOTES:
① REPLACE MDA AT SAME LOCATION.

PANEL SCHEDULE									
PANEL: BLDG 17 MDP				TYPE: NEMA 1		AMPS: 400		DATE: December 19, 2012	
VOLTS: 120/208				PHASE: 3		WIRE: 4		PROJECT:	
LOCATION: MAIN ELECTRICAL ROOM				MAIN: 400					
MOUNTING: SURFACE									
NOTES: PROVIDE MINIMUM 22KA RATING FOR BUSS AND BREAKERS.									
				LOAD CLASS		Conn. VA		Demand Factor	
				LIGHTING		0		125%	
				OUTLETS		0		*	
				MOTOR LOADS		0		**	
				RESISTANCE LOADS		0		100%	
				SUBFEED		0		100%	
				MISC. LOADS		0		100%	
				SUBFEED BREAKER		0		0	
				TOTAL VOLT-AMPS		Connected		Demand	
				MAXIMUM PHASE AMPS		0.0		0.0	
BREAKER A		P	DESCRIPTION	WATTS	CIR. NO.	PHASE	CIR. NO.	WATTS	DESCRIPTION
125			BLDG T12		1	A	2		SINGLE PHASE PANEL BLDG 7
					3	B	4		
					5	C	6		
200			BLDG 17 SINGLE PHASE PANEL		7	A	8		PNL 1E-108-1
					9	B	10		
					11	C	12		
200			BLDG 58		13	A	14		PNL AC COURTYARD
					15	B	16		
					17	C	18		
125			BLDG T3		19	A	20		SPARE
					21	B	22		
					23	C	24		
					25	A	26		
					27	B	28		
					29	C	30		
					31	A	32		
					33	B	34		
					35	C	36		
					37	A	38		
					39	B	40		
					41	C	42		
PHASE TOTALS					A	B	C	* 10kVA at 100%, remainder at 50%	
Connected VA					0	0	0	** 100% plus 25% of the largest Motor	
Demand VA					0	0	0		
Connected Amps					0.0	0.0	0.0		
Demand Amps					0.0	0.0	0.0		

PANEL SCHEDULE									
PANEL: BLDG16 - MDP				TYPE: NEMA 1		AMPS: 600		DATE: December 19, 2012	
VOLTS: 120/208				PHASE: 3		WIRE: 4		PROJECT:	
LOCATION: ELECTRICAL ROOM				MAIN: 600					
MOUNTING: SURFACE									
NOTES: PROVIDE MINIMUM 22KA RATING FOR BUSS AND BREAKERS.									

REVISIONS	DATE

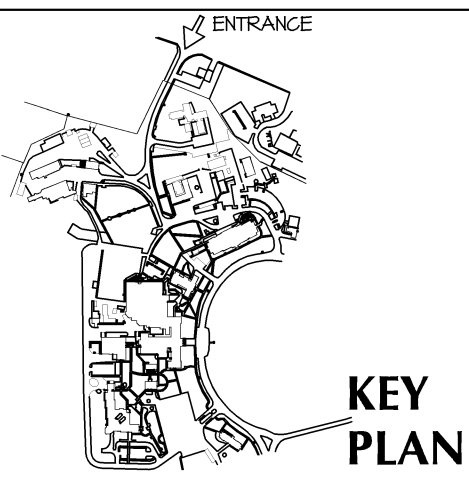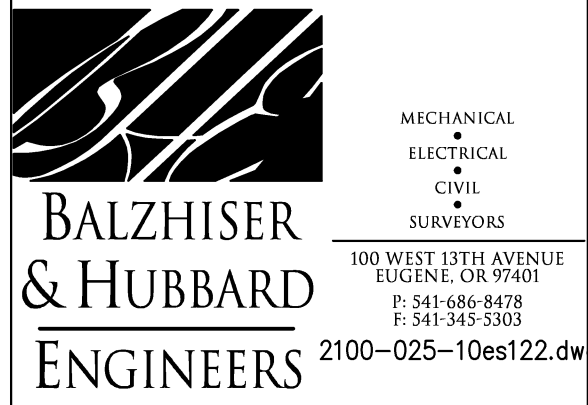

DEPARTMENT OF VETERANS AFFAIRS
ROSEBURG HEALTH CARE SYSTEM
913 NW GARDEN VALLEY BLVD
ROSEBURG, OREGON 97470

DRAWING TITLE: BUILDINGS No. 3, 16 & 17 ELECTRICAL ROOMS ,BUILDING 1 - PANEL SCHEDULES		
DESIGNER:	SAFETY MANAGER:	SERVICE CHIEF:
CHIEF ENGINEERING:		VAMC DIRECTOR:

PROJECT TITLE: ELECTRICAL DEFICIENCY CORRECTIONS		
BUILDING NO.: B1	CHECKED: KMW	DRAWN: JSQ
LOCATION: ROSEBURG, OREGON		

DATE: 12-19-12
VA PROJECT NO.: 653-10-531
DRAWING NO.: ES122
DWG: OF

