

**KEYED NOTES:**


- 1 SURFACE MOUNT THE MANUAL PULL STATION ON THE GLASS FRAME AT THE EDGE OF THE DOOR. UTILIZE SURFACE RACEWAY AND PAINT TO MATCH THE FRAME.
- 2 SURFACE MOUNT THE NOTIFICATION DEVICE IN THE HARD CEILING. CONCEAL THE WIRE/CONDUIT ABOVE THE CEILING. UTILIZE THE ACCESS PANEL AS REQUIRED.
- 3 SURFACE MOUNT THE SMOKE DETECTOR. CONCEAL THE WIRE IN SURFACE RACEWAY. PAINT THE SURFACE RACEWAY TO MATCH THE CEILING.
- 4 FIELD COORDINATE THE LOCATION OF THE SMOKE DETECTOR. CENTER THE DEVICE IN THE CEILING TILE. THE DETECTOR SHALL BE INSTALLED IN ACCORDANCE WITH NFPA 72. ENSURE THE DETECTOR IS INSTALLED AT LEAST 3' FROM A DIFFUSER OR RETURN GRILLE.
- 5 SURFACE MOUNT THE SMOKE DETECTOR AND NOTIFICATION DEVICE. FIELD COORDINATE THE DEVICES AND ADJUST THE CANDELA RATING AS REQUIRED. UTILIZE SURFACE RACEWAY AND PAINT THE RACEWAY TO MATCH THE CEILING.
- 6 SURFACE MOUNT THE NOTIFICATION DEVICE. UTILIZE SURFACE RACEWAY TO CONCEAL THE WIRE. PAINT THE SURFACE RACEWAY TO MATCH THE CEILING. FIELD COORDINATE THE DEVICE LOCATION AND ADJUST THE CANDELA RATING AS REQUIRED.
- 7 INSTALL THE NEW FIRE ALARM PANEL AT THE EXISTING LOCATION. THE EXISTING SYSTEM MUST REMAIN ACTIVE UNTIL THE NEW SYSTEM IS INSTALLED. THE EXISTING FIRE ALARM PANEL SHALL BE REMOVED AND THE NEW ONE INSTALLED OVER A WEEKEND. COORDINATE WITH THE OWNER AS REQUIRED.
- 8 PROVIDE A SURFACE RACEWAY ON TOP OF THE BULKHEAD THAT CONCEALS THE DUCT. COORDINATE SIZE AND PARTITIONING WITH SECURITY NEEDS.
- 9 INSTALL THE CONDUIT/WIRE ABOVE THE HARD CEILING. UTILIZE THE ACCESS PANEL AS REQUIRED.
- 10 INSTALL THE SURFACE RACEWAY/WIRE TO THE DEVICE PERPENDICULAR FROM THE WALL AT COLUMN LINE B. TIE INTO SURFACE RACEWAY INDICATED IN KEYED NOTE 9.
- 11 PROVIDE FINAL POWER CONNECTION TO FIRE ALARM PANEL. EXTEND 2 #12 AND 1 #12 GROUND IN 3/4" CONDUIT FROM NEW 20A, 1P CIRCUIT BREAKER IN CLOSET 120V PANEL WITH SPACE.

**GENERAL NOTES:**

1. DEVICES THAT ARE INSTALLED IN GRIDDED CEILINGS SHALL BE CENTERED IN THE CEILING TILE.

**1 FIRST FLOOR PLAN - ADMINISTRATION BUILDING - NEW WORK - FIRE ALARM**  
 FA-1 - SCALE: 3/16" = 1'-0" NTS

NOTE:  
 CONTRACTOR SHALL CHECK &  
 VERIFY ALL DIMENSIONS &  
 EXISTING CONDITIONS AT SITE.

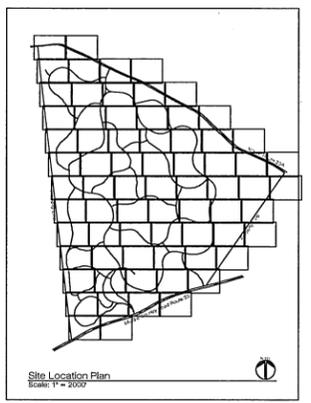

 <b>STOP!</b> CALL BEFORE YOU DIG! 1-800-272-4480	 <b>BRINJAC ENGINEERING, INC.</b> IRON RUN CORPORATE CENTER - Suite 130 7248 Pightstown Street, Allentown, PA 18106 Phone: (610) 336-0432 FAX: (610) 336-0434 www.brinjac.com	 <b>SPILLMAN FARMER</b> architects 1720 SPILLMAN DRIVE, SUITE 200, BETHLEHEM, PA 18015-2169 TEL: (610) 861-5421 FAX: (610) 861-5328 WWW.SPILLMANFARMER.COM	 <b>Storr Tractor Company</b> Municipal - Turf - Irrigation Equip. & Supplies 3181 US HIGHWAY 22 - BRANCHBURG, N.J. 08876 PHONE: (908) 722-4800 - FAX: (908) 722-8947 - WEB: WWW.S11011TRCTOR.COM	 <b>CVDA</b> Landscape Architects/Planners 40 Garden Alley Doylestown, Pennsylvania 18001-4266 Voice: 215 345 5053 Fax: 215 345 4324 Web: www.CVDA.com	Drawing Title <b>100% CONSTRUCTION DOCUMENTS</b> FIRST FLOOR PLAN - ADMIN BUILDING - FIRE ALARM	Project Title Calverton National Cemetery Gravesite Expansion & Site Improvements	Date <b>AUG. 1, 2011</b> Project No. <b>805CM2030</b> Drawing No. <b>FA-1</b> Dwg X of 49	
Approved: Division Chief		Building Number		Checked MJB		Drawn RJJ		Department of Veterans Affairs
Approved: Service Director		Location Calverton National Cemetery Calverton, New York						