




1 BUILDING 4 FIRST FLOOR / SITE PLAN  
1/8"=1'-0"

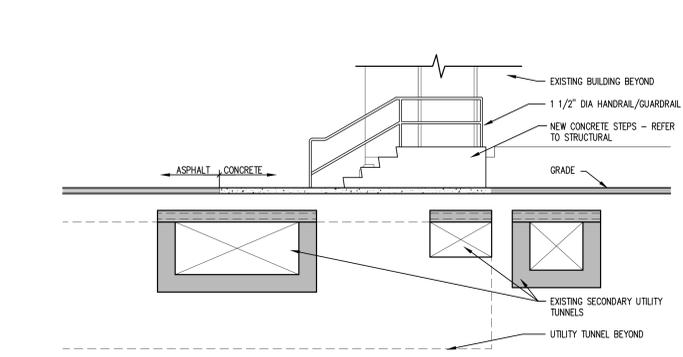


2 PARTIAL SITE SECTION  
1/4"=1'-0"

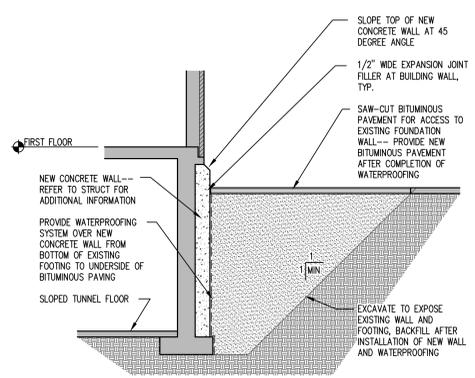


3 PARTIAL SITE SECTION  
1/4"=1'-0"




4 STAIR PLAN  
1/4"=1'-0"

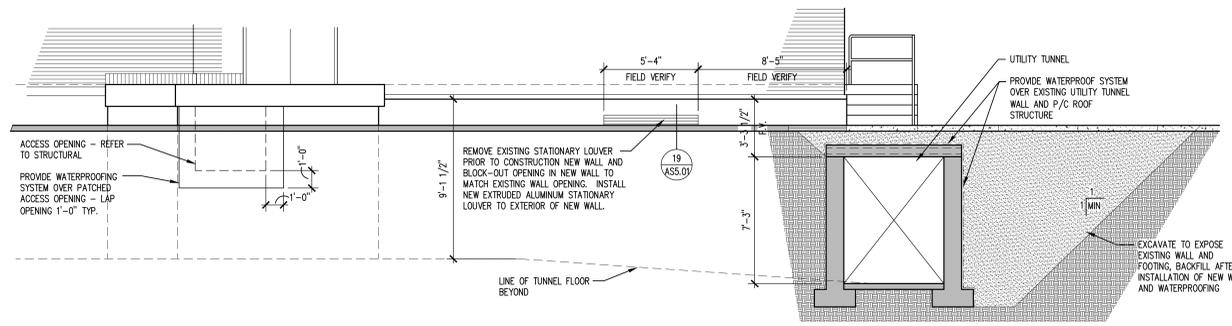


5 PARTIAL SITE SECTION  
1/4"=1'-0"

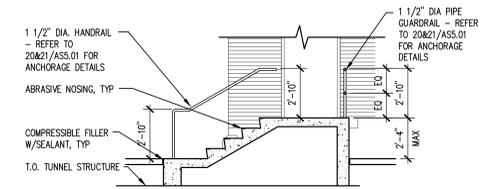


6 STAIR SECTION  
1/4"=1'-0"

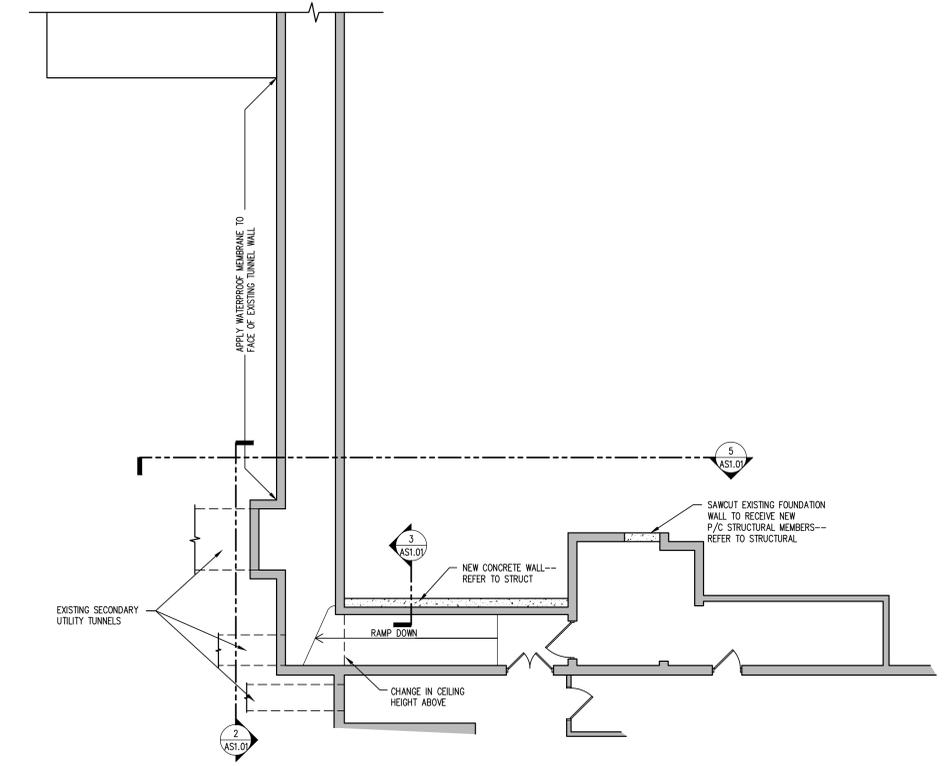

7 BUILDING 4 TUNNEL LEVEL PLAN  
1/8"=1'-0"

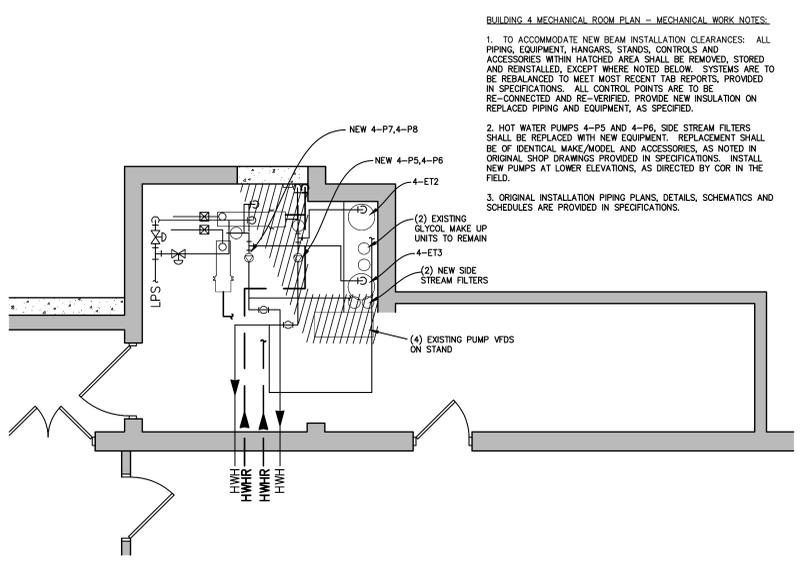

8 BUILDING 4 MECHANICAL ROOM PLAN - MECHANICAL WORK  
1/4"=1'-0"

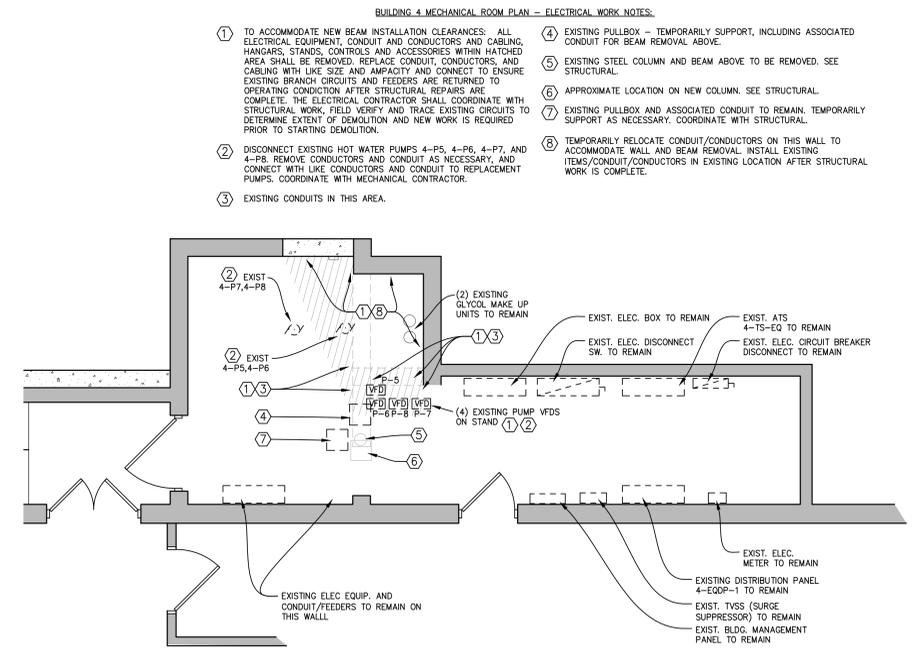

9 BUILDING 4 MECHANICAL ROOM PLAN - ELECTRICAL WORK  
1/4"=1'-0"

**BUILDING 4 MECHANICAL ROOM PLAN - MECHANICAL WORK NOTES:**

1. TO ACCOMMODATE NEW BEAM INSTALLATION CLEARANCES: ALL PIPING, EQUIPMENT, HANGARS, STANDS, CONTROLS AND ACCESSORIES WITHIN HATCHED AREA SHALL BE REMOVED, STORED AND REINSTALLED, EXCEPT WHERE NOTED BELOW. SYSTEMS ARE TO BE REBALANCED TO MEET MOST RECENT TAB REPORTS, PROVIDED IN SPECIFICATIONS. ALL CONTROL POINTS ARE TO BE RE-CONNECTED AND RE-VERIFIED. PROVIDE NEW INSULATION ON REPLACED PIPING AND EQUIPMENT, AS SPECIFIED.
2. HOT WATER PUMPS 4-P5 AND 4-P6, SIDE STREAM FILTERS SHALL BE REPLACED WITH NEW EQUIPMENT. REPLACEMENT SHALL BE OF IDENTICAL MAKE/MODEL AND ACCESSORIES, AS NOTED IN ORIGINAL SHOP DRAWINGS PROVIDED IN SPECIFICATIONS. INSTALL NEW PUMPS AT LOWER ELEVATIONS, AS DIRECTED BY COR IN THE FIELD.
3. ORIGINAL INSTALLATION PIPING PLANS, DETAILS, SCHEMATICS AND SCHEDULES ARE PROVIDED IN SPECIFICATIONS.

**BUILDING 4 MECHANICAL ROOM PLAN - ELECTRICAL WORK NOTES:**

1. TO ACCOMMODATE NEW BEAM INSTALLATION CLEARANCES: ALL ELECTRICAL EQUIPMENT, CONDUIT AND CONDUCTORS AND CABLING, HANGARS, STANDS, CONTROLS AND ACCESSORIES WITHIN HATCHED AREA SHALL BE REMOVED, REPLACE CONDUIT, CONDUCTORS, AND CABLING WITH LIKE SIZE AND AMPLACITY AND CONNECT TO ENSURE EXISTING BRANCH CIRCUITS AND FEEDERS ARE RETURNED TO OPERATING CONDITION AFTER STRUCTURAL REPAIRS ARE COMPLETE. THE ELECTRICAL CONTRACTOR SHALL COORDINATE WITH STRUCTURAL WORK, FIELD VERIFY AND TRACE EXISTING CIRCUITS TO DETERMINE EXTENT OF DEMOLITION AND NEW WORK IS REQUIRED PRIOR TO STARTING DEMOLITION.
2. DISCONNECT EXISTING HOT WATER PUMPS 4-P5, 4-P6, 4-P7, AND 4-P8. REMOVE CONDUCTORS AND CONDUIT AS NECESSARY, AND CONNECT WITH LIKE CONDUCTORS AND CONDUIT TO REPLACEMENT PUMPS, COORDINATE WITH MECHANICAL CONTRACTOR.
3. EXISTING CONDUITS IN THIS AREA.
4. EXISTING PULLBOX - TEMPORARILY SUPPORT, INCLUDING ASSOCIATED CONDUIT FOR BEAM REMOVAL ABOVE.
5. EXISTING STEEL COLUMN AND BEAM ABOVE TO BE REMOVED. SEE STRUCTURAL.
6. APPROXIMATE LOCATION ON NEW COLUMN. SEE STRUCTURAL.
7. EXISTING PULLBOX AND ASSOCIATED CONDUIT TO REMAIN. TEMPORARILY SUPPORT AS NECESSARY. COORDINATE WITH STRUCTURAL.
8. TEMPORARILY RELOCATE CONDUIT/CONDUCTORS ON THIS WALL TO ACCOMMODATE WALL AND BEAM REMOVAL. INSTALL EXISTING ITEMS/CONDUIT/CONDUCTORS IN EXISTING LOCATION AFTER STRUCTURAL WORK IS COMPLETE.

No.	REVISION	DATE



TECHNICAL SERVICES AND CONSULTING  
1225 TOWER AVE  
SUPERIOR, WI 54880  
715-392-1879

I HEREBY CERTIFY that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly Licensed Architect under the laws of the State of Minnesota.  
SIGNATURE: *Evan Aljan*  
TYPED OR PRINTED NAME: Evan Aljan  
DATE: 1/23/15 REG. NO: 22927

APPROVED: SERVICE LINE DIRECTOR	DATE:	APPROVED: INJECTION CONTROL NUMBER	DATE:
APPROVED: GEMS COORDINATOR	DATE:	APPROVED: PATIENT SAFETY	DATE:
APPROVED: PROJECTS SECTION MANAGER	DATE:	APPROVED: CHIEF OF POLICE	DATE:
APPROVED: DIRECTOR TMS	DATE:	APPROVED: SAFETY MANAGER	DATE:

DRAWING TITLE BUILDING 4 ARCHITECTURAL PLANS, SECTIONS, DETAILS	PROJECT TITLE 844-14-247 BEAM FOUNDATIONS BUILDINGS 4, 7, 59 St. Cloud VA Health Care System Main Campus, St. Cloud, Minnesota
APPROVED: ASSOCIATE HEALTH CARE SYSTEM DIRECTOR	DATE:
APPROVED: CHIEF OF STAFF	DATE:
APPROVED: HEALTH CARE SYSTEM DIRECTOR	DATE:

PROJECT NO.	
PROF SCALE AS NOTED	
BUILDING No.	4
CHECKED BY	ECA
DESIGNED BY	NRP
DRAWING NO.	AS1.01 DWG 4 OF 13

