



- CEILING PLAN KEYED NOTES**
- PATCH CEILING TO MATCH ADJACENT PLASTER CEILING-- PAINT TO MATCH.
 - EXISTING ACUSTICAL CEILING SYSTEM TO REMAIN. REMOVE AND SALVAGE EXISTING TILE AND GRID AS NECESSARY TO PERFORM STRUCTURAL REPAIR WORK ABOVE. RE-INSTALL TILE AND GRID AFTER COMPLETION OF STRUCTURAL REPAIRS.

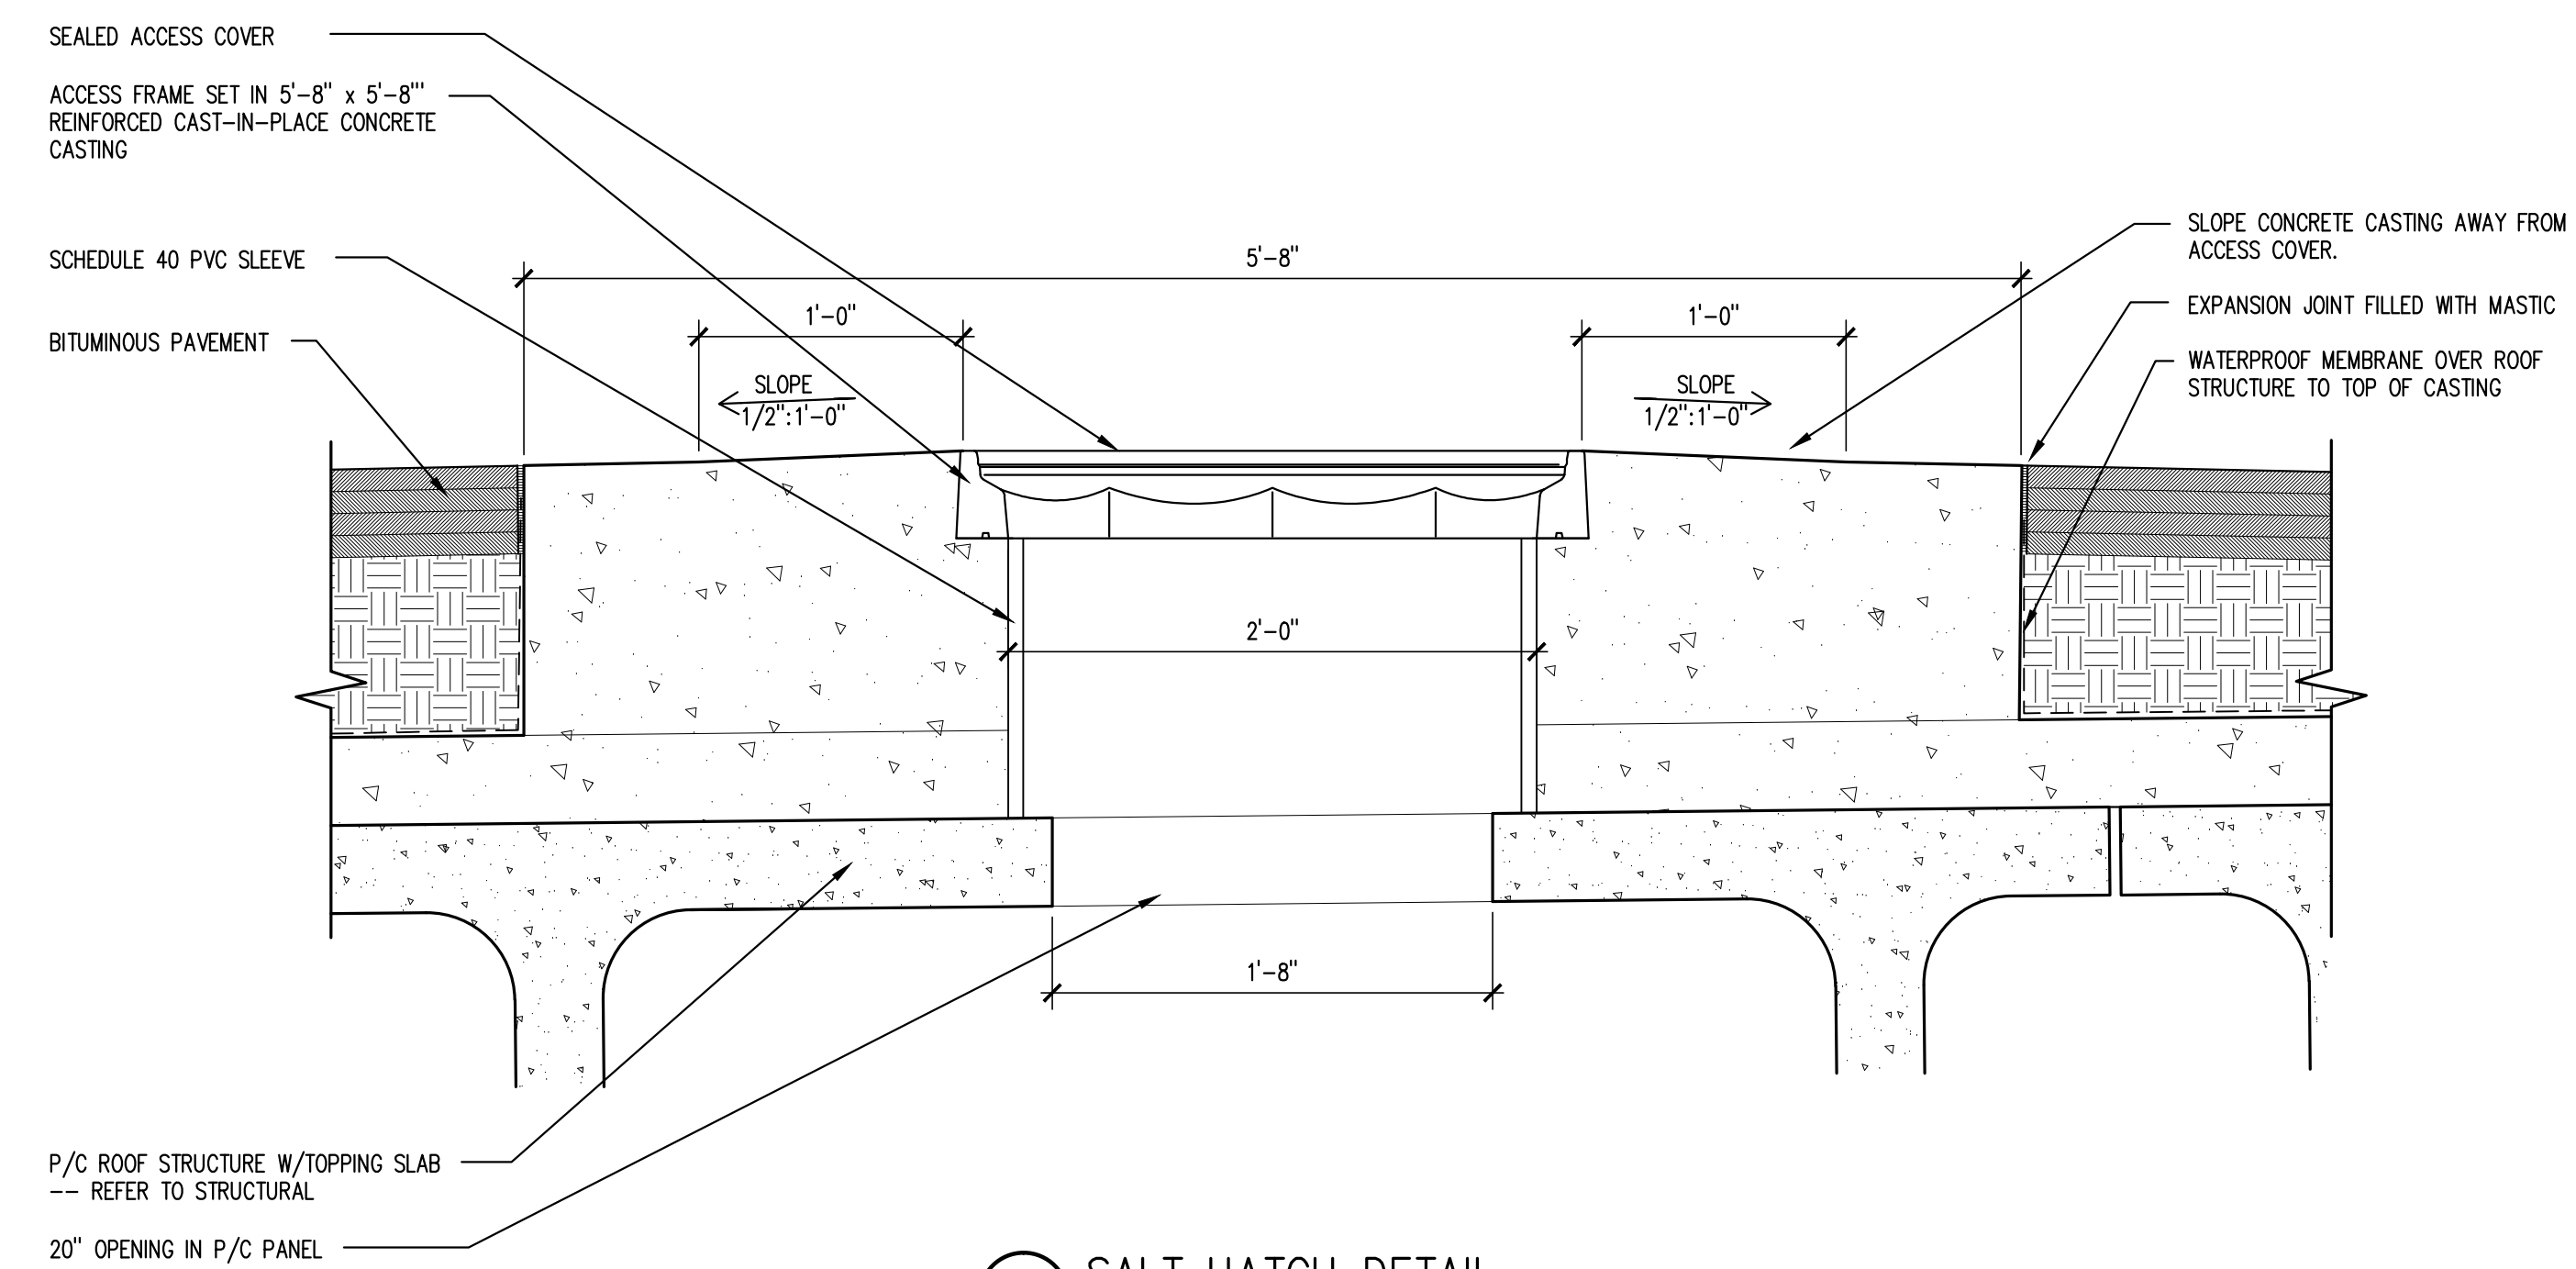


1 CEILING PLAN
1/4"=1'-0"

5 SALT HATCH DETAIL
1 1/2"=1'-0"

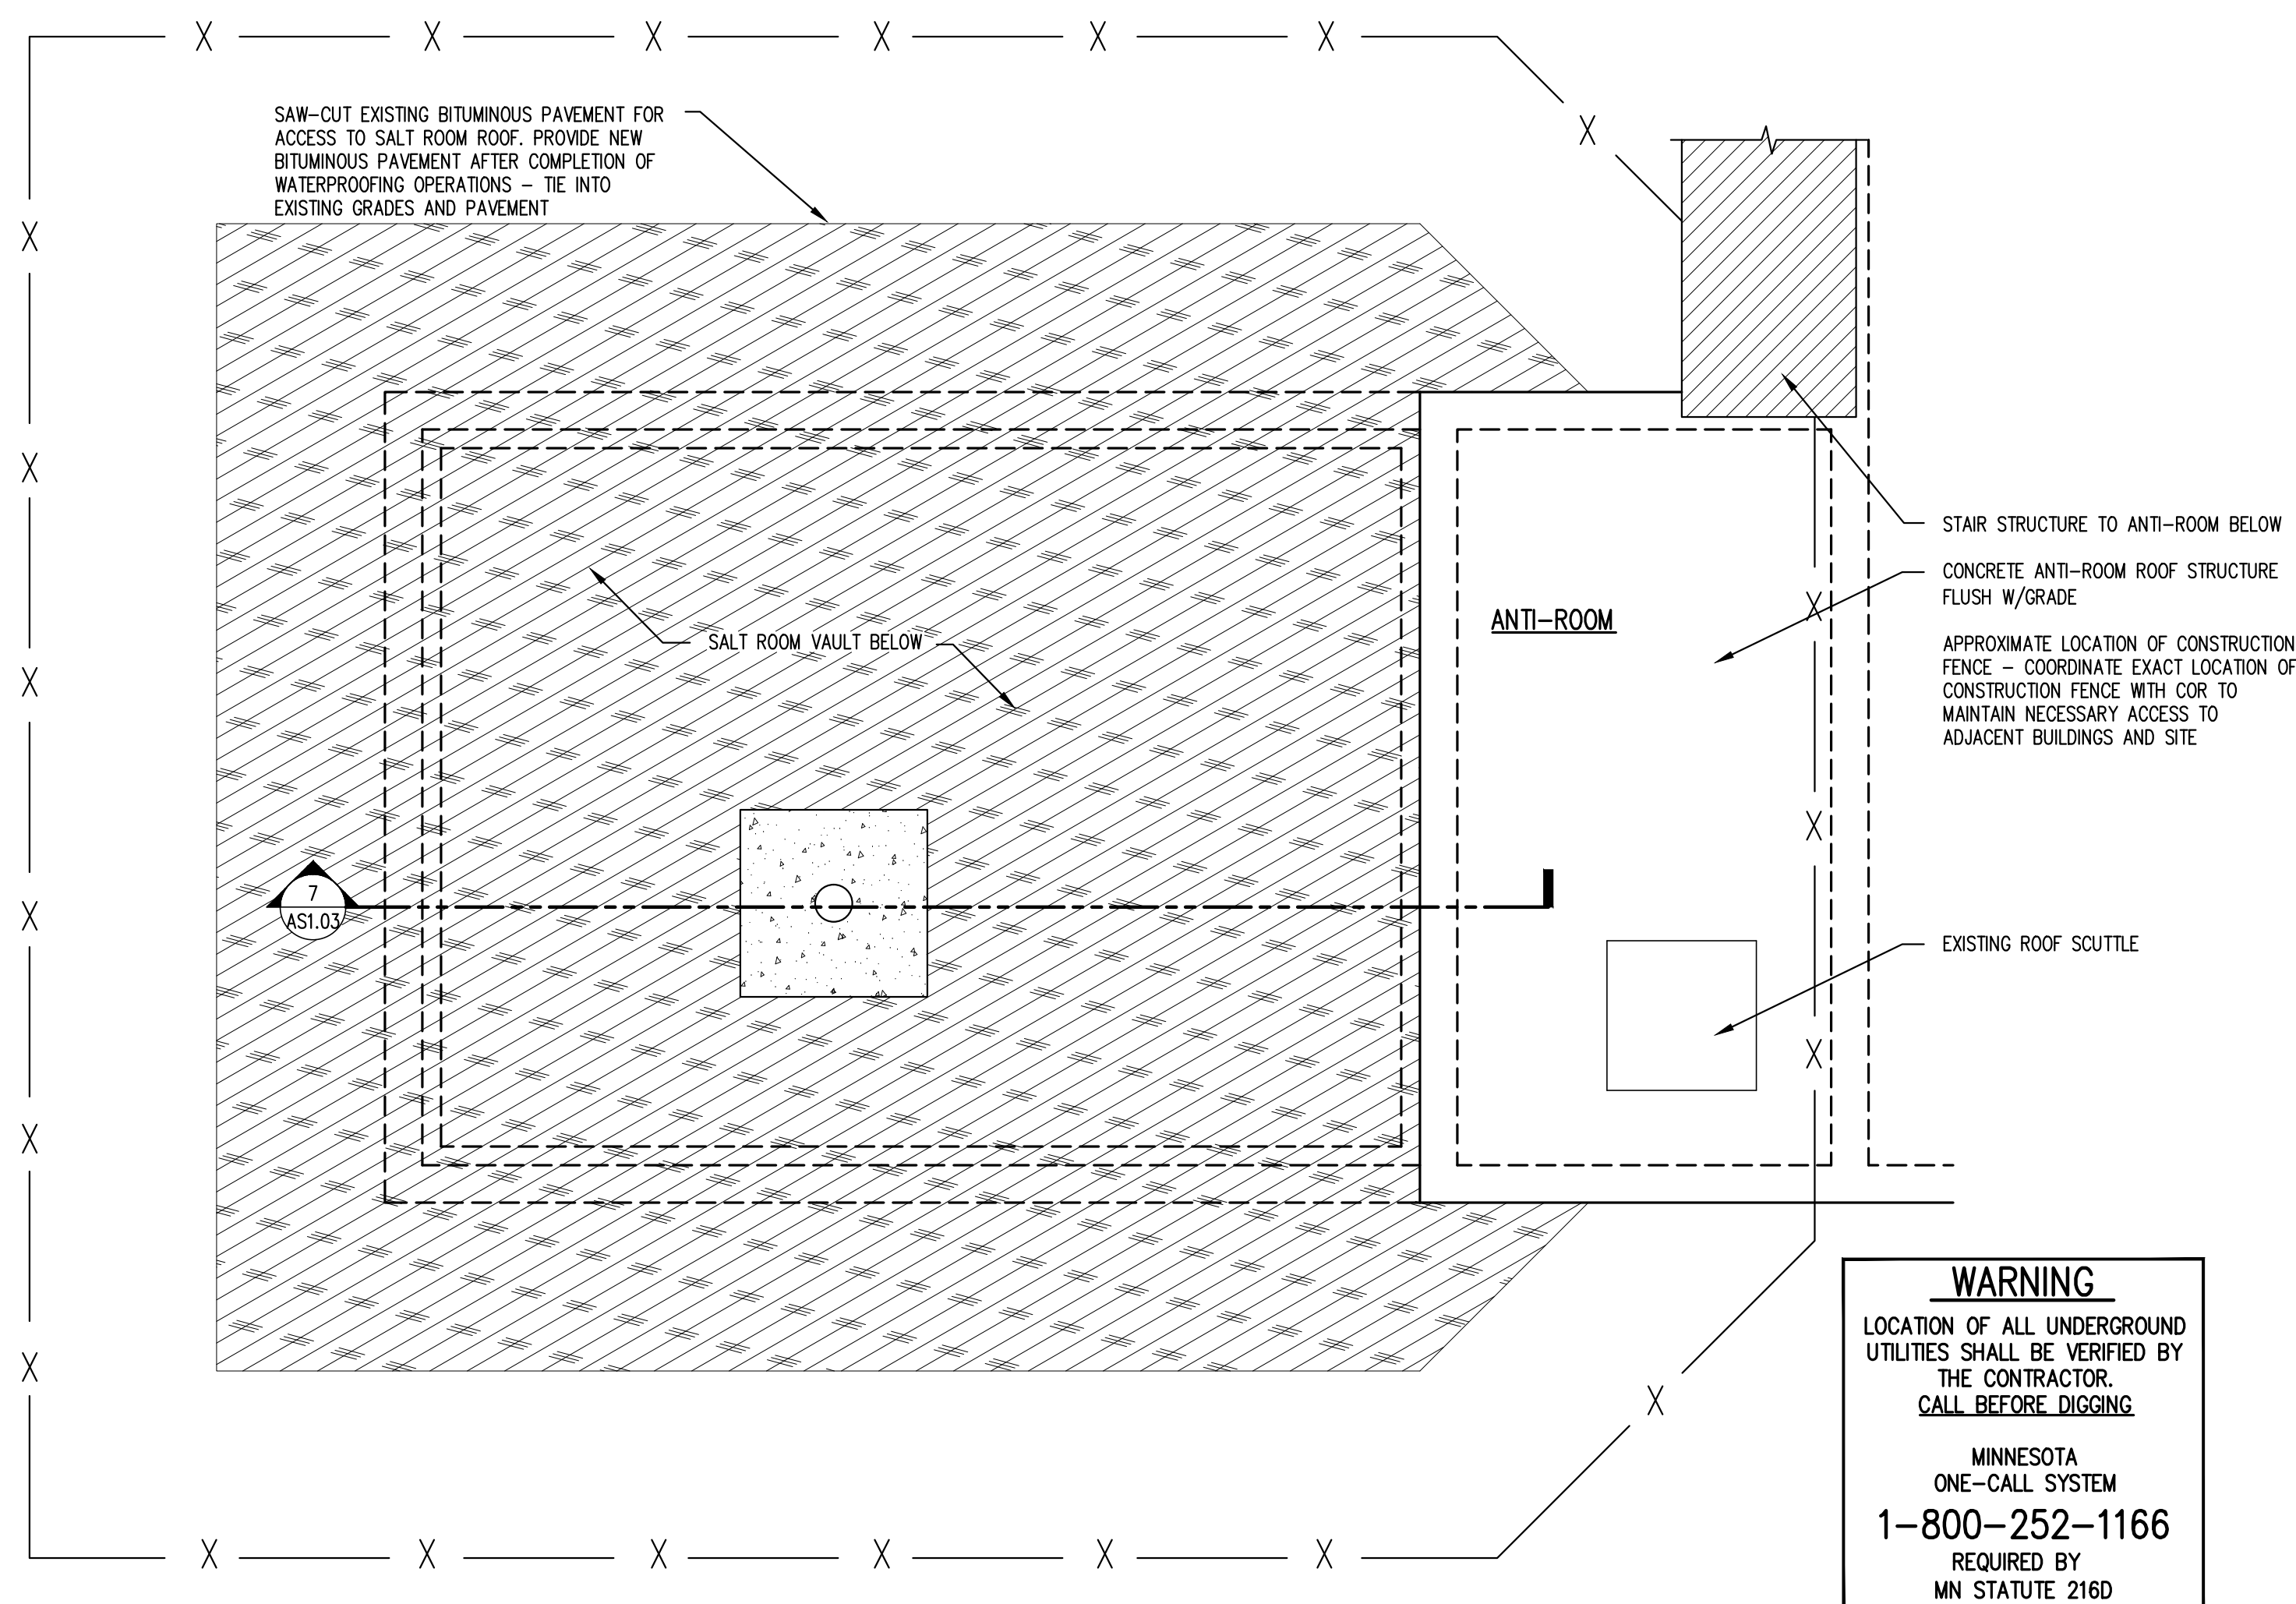


2 PARTIAL SITE PLAN @ SALT ROOM
1/4"=1'-0"

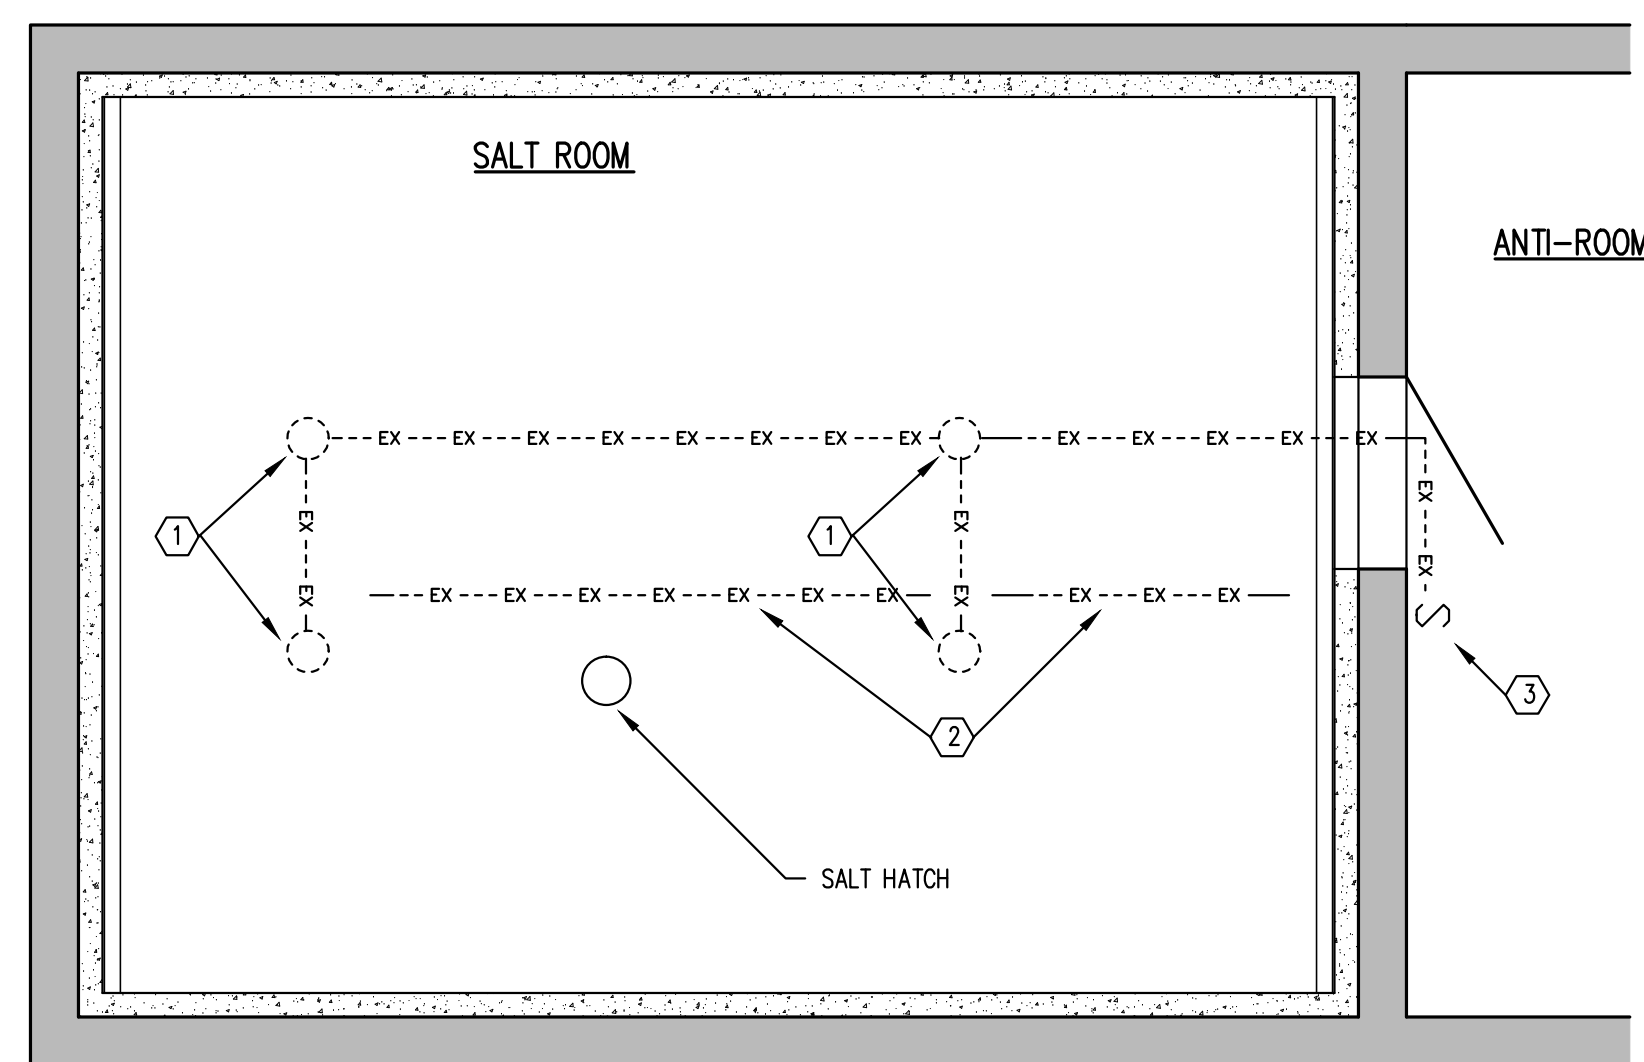


- ELECTRICAL DEMOLITION KEYED SHEET NOTES**
- DISCONNECT AND REMOVE EXISTING LIGHT FIXTURE AND ASSOCIATED PVC CONDUIT IN SALT ROOM.
 - REMOVE EXISTING ABANDONED PVC CONDUIT.
 - EXISTING CONDUIT AND LIGHT SWITCH AT SALT ROOM TO REMAIN.

3 ELECTRICAL DEMOLITION PLAN
1/4"=1'-0"

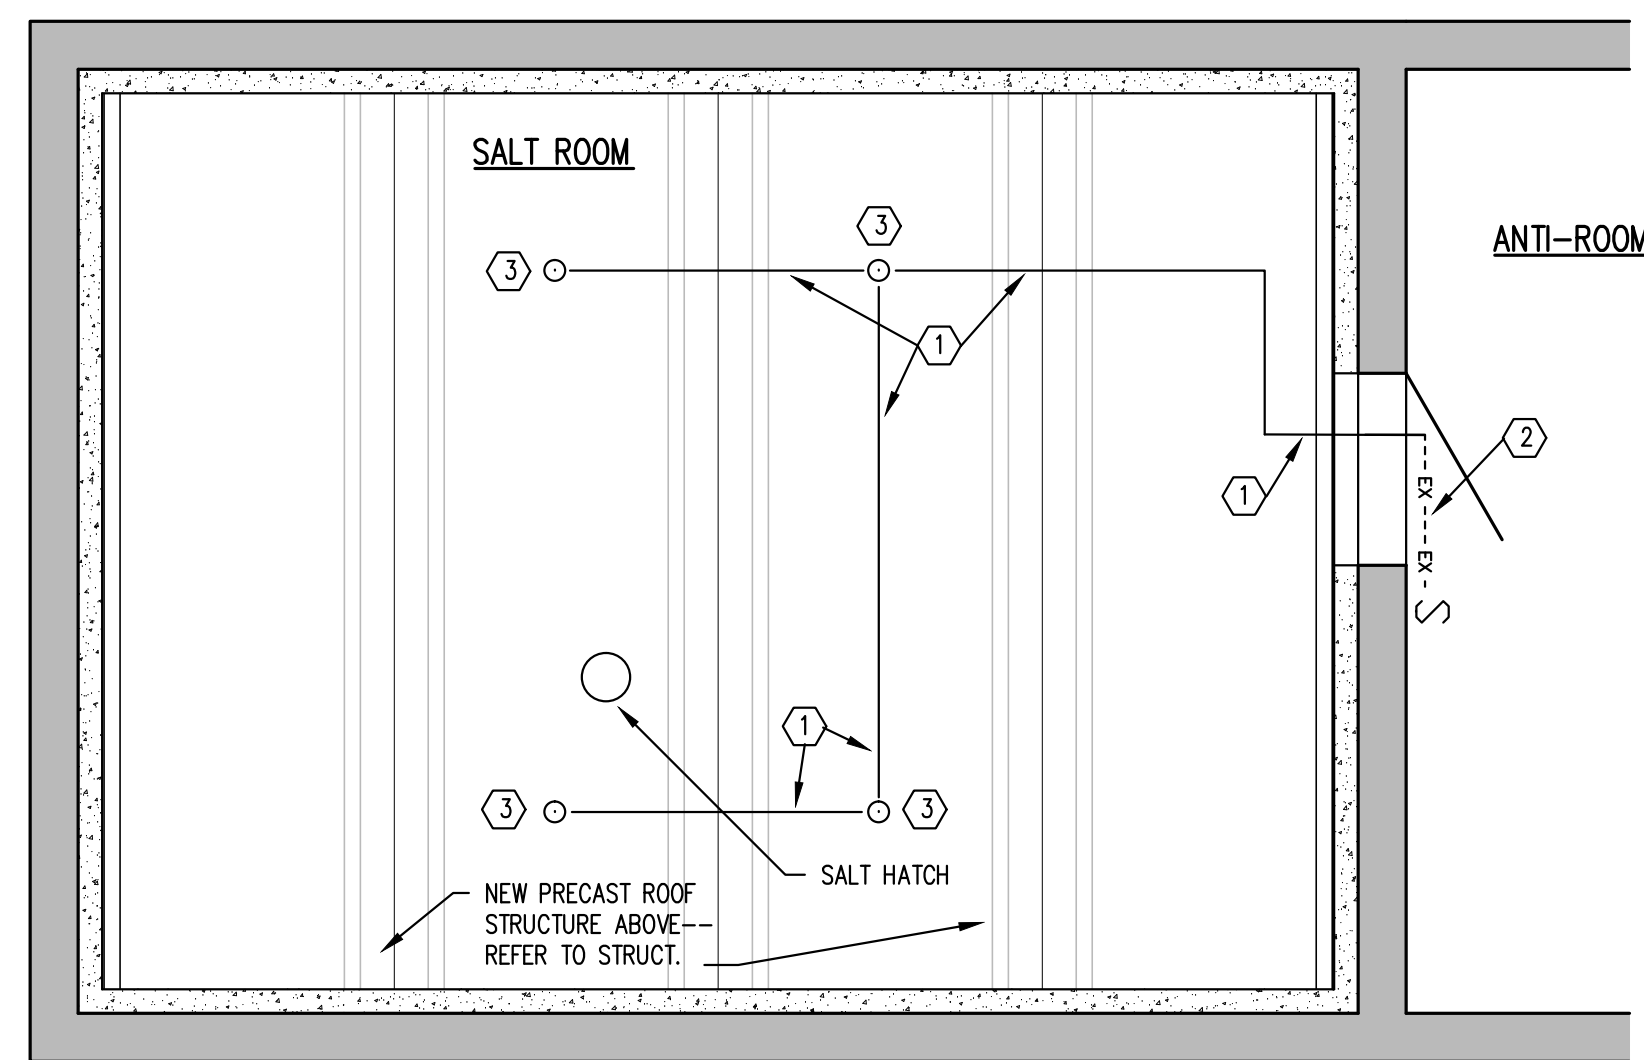


- LIGHTING PLAN KEYED SHEET NOTES**
- PROVIDE 3/4" PVC CONDUIT WITH 2#12, #12G. PROVIDE PVC ELBOWS AND OTHER FITTINGS, AS REQUIRED, AT STRUCTURAL BEAMS.
 - EXTEND WITH 2 #12, #12G IN EXISTING CONDUIT AND CONNECT TO EXISTING SWITCH.
 - PROVIDE NEW LIGHT FIXTURE: CORROSION-RESISTANT ENCLOSED AND GASKETED COMPACT FLUORESCENT LIGHT FIXTURE FEATURING CAST COPPER-FREE ALUMINUM HOUSING, EPOXY POWDER FINISH, CEILING-MOUNT, CLEAR GLASS GLOBE, GUARD, AND (2) 9W COMPACT FLUORESCENT LAMPS. COOPER CROUSE-HINDS #VHF222GP OR SIMILAR.

4 ELECTRICAL LIGHTING PLAN
1/4"=1'-0"

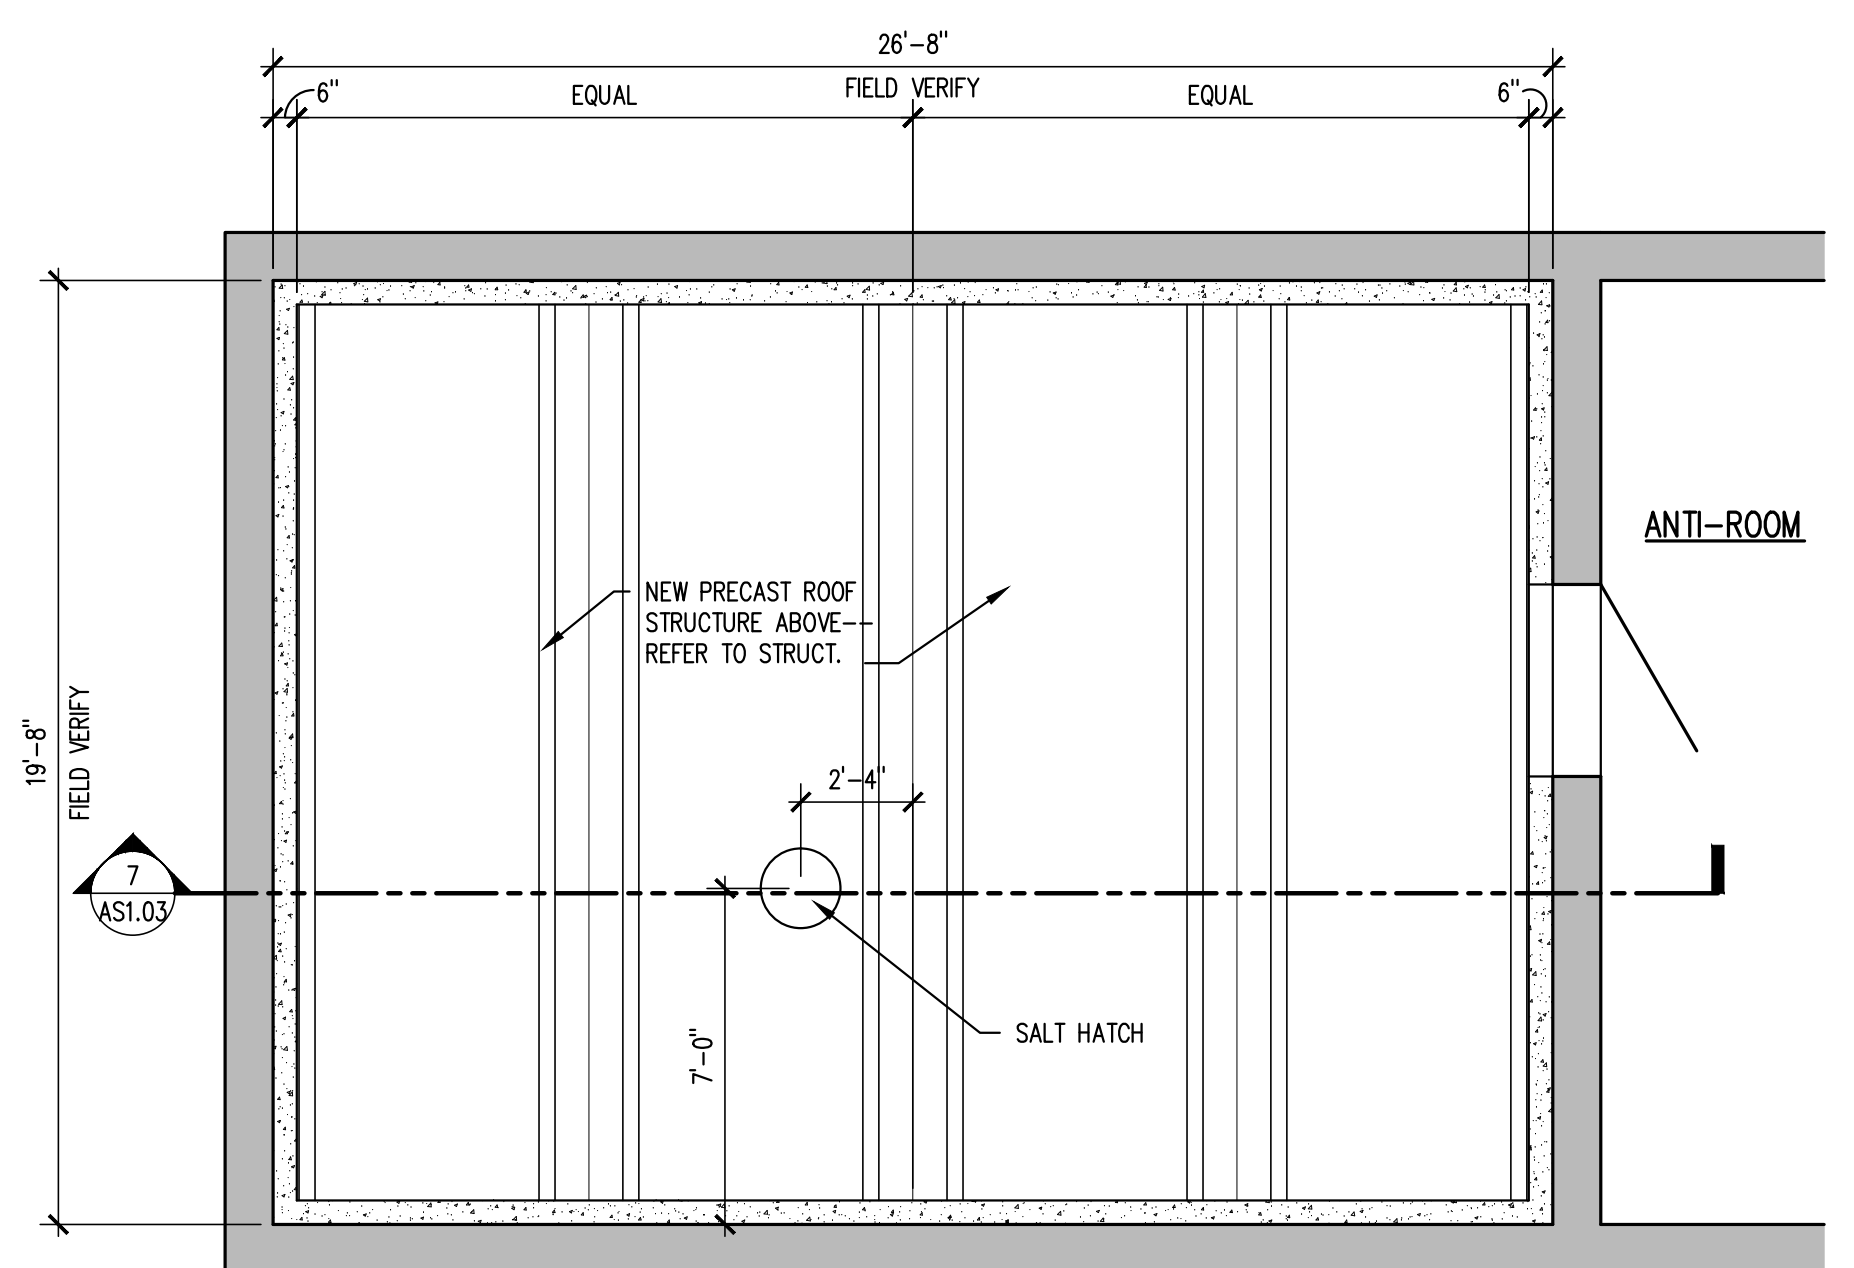

6 REFLECTED CEILING PLAN
1/4"=1'-0"

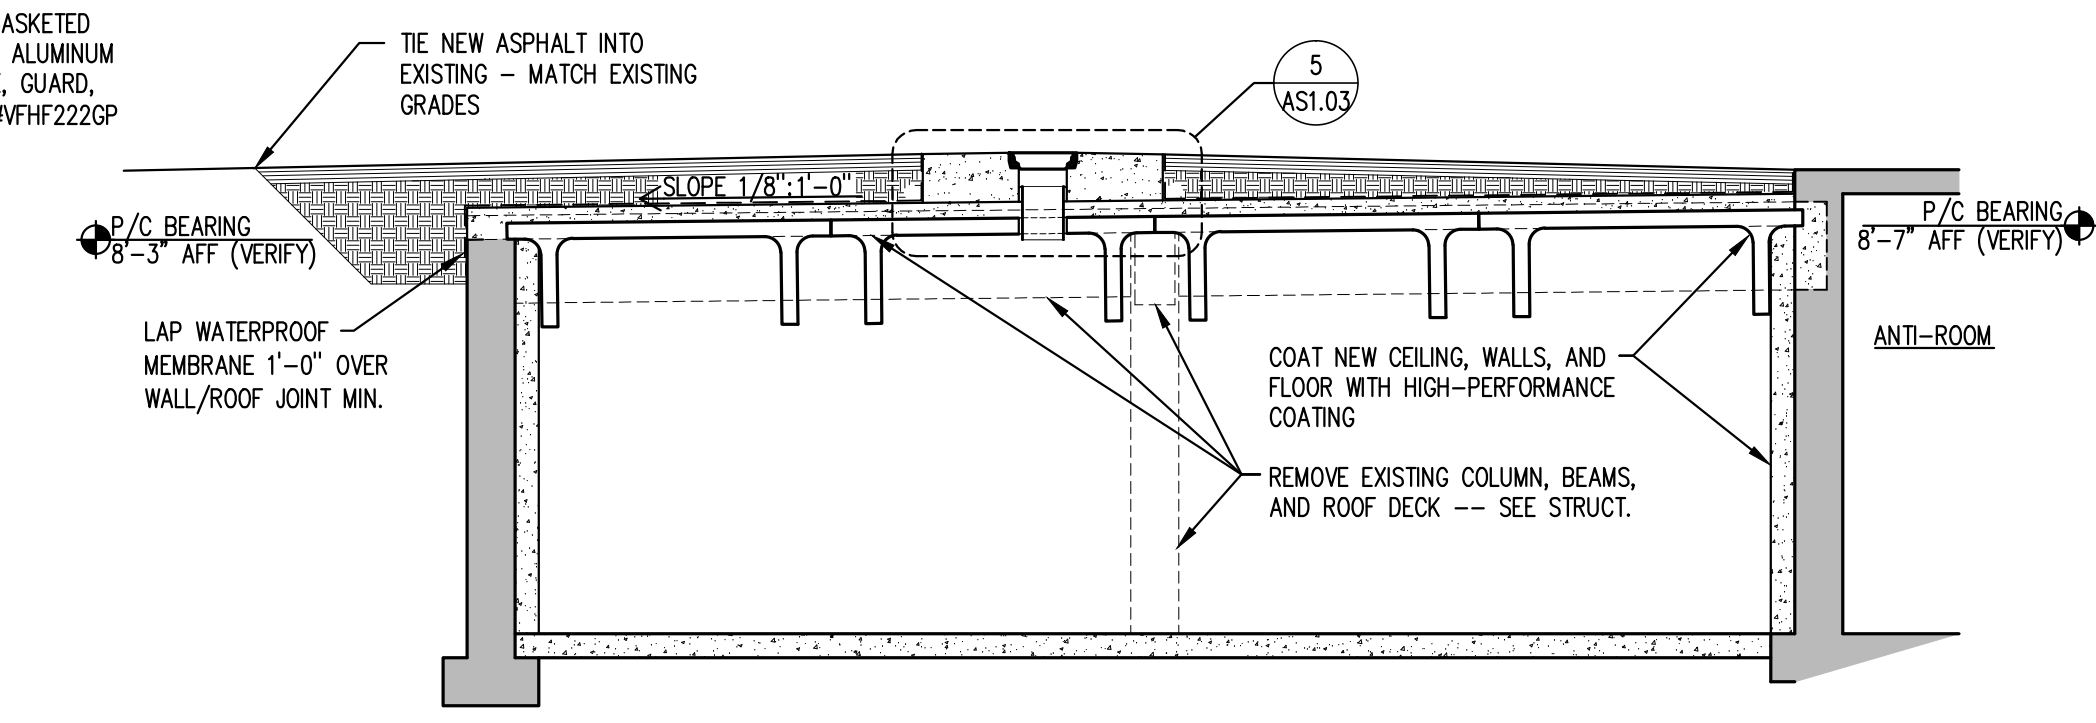

7 BUILDING SECTION
1/4"=1'-0"

No.	REVISION	DATE