

PROJECT MANUAL

Department of Veterans Affairs

Michael E. DeBAKEY Medical Center
2002 Holcombe Blvd
Houston Texas

**Expansion & Renovation of Building 108,
Mental Health
DVA Project Number 580-319**

Houston, Texas

Volume 2
Mechanical, Electrical, Plumbing, Fire Protection,
Telecommunications, Safety and Security

Issue for Construction

June 15, 2012

PSP PROJECT NO. 410760

This document is released for interim review under the authority of
John Cryer III, Texas Registration No. 5137
Not to be used for regulatory approval, permitting, or construction.

Architect/Engineer:

PageSouthernlandPage
1100 Louisiana, Suite One
Houston Texas 77002
713 | 871.8484

2

DEPARTMENT OF VETERANS AFFAIRS

PROFESSIONAL SEALS

Expansion & Renovation of Building 108 For Mental Health

Houston, Texas

Volume 2
Mechanical, Electrical, Plumbing, Fire Protection,
Telecommunications, Safety and Security

Issue for Construction

June 15, 2012

PSP PROJECT NO. 410760

MECHANICAL

ELECTRICAL


PLUMBING/FIRE

TECHNOLOGY

Firm Registration No. 958
Page Southerland Page, LLP



Firm Registration No. 958
Page Southerland Page, LLP

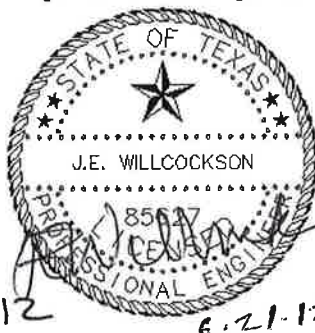

Firm Registration No. 958
Page Southerland Page, LLP



DEPARTMENT OF VETERANS AFFAIRS

TABLE OF CONTENTS - VOLUME 2
Section 00 01 10

		DATE
	DIVISION 21- FIRE SUPPRESSION	
21 05 11	Common Work Results for Fire Suppression	11-09
21 08 00	Commissioning of Fire Suppression System	07-10
21 12 00	Fire-Suppression Standpipes	02-11
21 13 13	Wet-Pipe Sprinkler Systems	05-08
	DIVISION 22 - PLUMBING	
22 05 11	Common Work Results for Plumbing	04-11
22 05 12	General Motor Requirements for Plumbing Equipment	12-09
22 05 19	Meters and Gages for Plumbing Piping	02-10
22 05 23	General-Duty Valves for Plumbing Piping	12-09
22 08 00	Commissioning of Plumbing Systems	07-10
22 11 00	Facility Water Distribution	05-11
22 11 23	Domestic Water Pumps	11-10
22 13 00	Facility Sanitary and Vent Piping	12-09
22 14 00	Facility Storm Drainage	12-09
22 14 29	Sump Pumps	01-11
22 33 00	Electric Domestic Water Heaters	02-10
22 40 00	Plumbing Fixtures	03-11
	DIVISION 23 - HEATING, VENTILATING, AND AIR CONDITIONING (HVAC)	
23 05 11	Common Work Results for HVAC	11-10
23 05 12	General Motor Requirements for HVAC and Steam Generation Equipment	11-10
23 05 41	Noise and Vibration Control for HVAC Piping and Equipment	11-10
23 05 93	Testing, Adjusting, and Balancing for HVAC	05-11
23 07 11	HVAC and Boiler Plant Insulation	05-11
23 08 00	Commissioning of HVAC	07-10
23 09 23	Direct-Digital Control System for HVAC	04-11
23 21 13	Hydronic Piping	03-10
23 21 23	Hydronic Pumps	02-10
23 22 13	Steam and Condensate Heating Piping	03-10
23 22 23	Steam Condensate Pumps	02-10
23 23 00	Refrigerant Piping	02-10
23 25 00	HVAC Water Treatment	02-10
23 31 00	HVAC Ducts and Casings	04-11
23 34 00	HVAC Fans	11-09
23 36 00	Air Terminal Units	03-10
23 37 00	Air Outlets and Inlets	11-09
23 64 00	Packaged Water Chillers	04-11
23 72 00	Air-to-Air Energy Recovery Equipment	05-11
23 73 00	Indoor Central-Station Air-Handling Units	04-11

23 81 00	Decentralized Unitary HVAC Equipment	02-11
	DIVISION 25 - INTEGRATED AUTOMATION	
25 10 10	Advanced Utility Metering System	02-10
	DIVISION 26 - ELECTRICAL	
26 05 11	Requirements for Electrical Installations	09-10
26 05 13	Medium-Voltage Cables	09-10
26 05 21	Low-Voltage Electrical Power Conductors and Cables (600 Volts and Below)	09-10
26 05 26	Grounding and Bonding for Electrical Systems	09-10
26 05 33	Raceway and Boxes for Electrical Systems	09-10
26 05 41	Underground Electrical Construction	09-10
26 05 74	Short Circuit and Overcurrent Device Coordination Study and Arc Flash Hazard Analysis	12-11
26 08 00	Commissioning of Electrical Systems	07-10
26 09 23	Lighting Controls	09-10
26 12 19	Pad-Mounted, Liquid-Filled, Medium-Voltage Transformers	09-10
26 22 00	Low-Voltage Transformers	09-10
26 24 11	Distribution Switchboards	04-09
26 24 16	Panelboards	09-10
26 27 26	Wiring Devices	12-11
26 29 11	Motor Starters	09-10
26 29 21	Disconnect Switches	09-10
26 41 00	Facility Lightning Protection	04-09
26 43 13	Transient-Voltage Surge Suppression	04-09
26 51 00	Interior Lighting	04-09
26 56 00	Exterior Lighting	09-10
	DIVISION 27 - COMMUNICATIONS	
27 05 00	Common Work Results for Communications	03-12
27 05 26	Grounding and Bonding for Communications Systems	10-06
27 05 28	Pathways for Communications Systems	12-05
27 05 43	Underground Duct and Raceways	03-12
27 05 53	Identifications for Communications Systems	03-12
27 11 00	Communications Equipment Room Fittings	10-06
27 13 00	Communications Backbone Cabling	03-12
27 15 00	Communications Horizontal Cabling	10-06
27 16 00	Communications Patch Cords	03-12
27 20 00	Data Communications Equipment	03-12
27 30 00	Voice Communications Equipment	03-12
27 40 00	Audio-Video Systems	08-09
27 51 17	Public Address Systems	01-10
27 52 23	Nurse Call and Code Blue Systems	01-10
	DIVISION 28 - ELECTRONIC SAFETY AND SECURITY	
28 05 00	Common Work Results for Electronic Safety and Security	03-12
28 05 26	Grounding and Bonding for Electronic Safety and Security	10-06
28 05 28	Pathways for Electronic Safety and Security	03-12
28 05 53	Identification for Electronic Safety and Security	03-12
28 06 00	Testing for Electronic Safety and Security	03-12

28 13 00	Access Control Systems	03-12
28 23 00	Video Surveillance	11-09
28 31 00	Fire Detection and Alarm	06-12

END OF TABLE CONTENTS - VOLUME 2

SECTION 21 05 11
COMMON WORK RESULTS FOR FIRE SUPPRESSION

PART 1 - GENERAL

1.1 DESCRIPTION

- A. The requirements of this Section apply to all sections of Division 21.
- B. Definitions:
 - 1. Exposed: Piping and equipment exposed to view in finished rooms.
 - 2. Option or optional: Contractor's choice of an alternate material or method.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Excavation and Backfill: Section 31 20 11, EARTH MOVING.
- D. Concrete and Grout: Section 03 30 00, CAST-IN-PLACE CONCRETE.
- E. Section 05 50 00, METAL FABRICATIONS.
- F. Section 07 84 00, FIRESTOPPING.
- G. Flashing for Wall and Roof Penetrations: Section 07 60 00, FLASHING AND SHEET METAL.
- H. Section 07 92 00, JOINT SEALANTS.
- I. Section 09 91 00, PAINTING.
- J. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS

1.3 QUALITY ASSURANCE

- A. Products Criteria:
 - 1. Standard Products: Material and equipment shall be the standard products of a manufacturer regularly engaged in the manufacture of the products for at least 3 years. See other specification sections for any exceptions.
 - 2. Equipment Service: Products shall be supported by a service organization which maintains a complete inventory of repair parts and is located reasonably close to the site.
 - 3. Multiple Units: When two or more units of materials or equipment of the same type or class are required, these units shall be products of one manufacturer.
 - 4. Assembled Units: Manufacturers of equipment assemblies, which use components made by others, assume complete responsibility for the final assembled product.
 - 5. Nameplates: Nameplate bearing manufacturer's name or identifiable trademark shall be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.

6. Asbestos products or equipment or materials containing asbestos shall not be used.
- B. Manufacturer's Recommendations: Where installation procedures or any part thereof are required to be in accordance with the recommendations of the manufacturer of the material being installed, printed copies of these recommendations shall be furnished to the Resident Engineer prior to installation. Installation of the item will not be allowed to proceed until the recommendations are received. Failure to furnish these recommendations can be cause for rejection of the material.
- C. Guaranty: In GENERAL CONDITIONS.
- D. Extended Guarantee Period Services:
 1. Qualifications: All service technicians assigned to perform work under this contract shall be qualified and factory trained by the Original Equipment Manufacturer (O.E.M.). Each technician shall have at least three years experience of working on comparable systems and shall be a full time employee of the contractor. The contractor shall furnish, for the Department of Veterans Affairs (VA) review and approval, resumes of all service technicians scheduled to service the equipment and systems. The resume shall include details of experience, training, and educational qualifications and performance evaluations.
 2. Replacement Parts: The contractor shall be equipped with all replacement parts of all equipment and systems to be serviced and the manufacturer's standard service and repair procedures. All replacement parts shall be brand new and of current design. The replacement parts shall be O.E.M. items. Obsolete or refurbished parts are unacceptable. "Approved Equal" parts must have prior approval of the Contracting Officer. Contractor shall furnish evidence of guaranteed supply of parts for the life of the system.
 3. Service Supplies: The services shall include, without any additional cost to the government, all replacement parts, special tools and equipment, and consumable materials, that is, lubrication oil, grease, and cleaning materials, as required. The requirement of UL listing, where applicable, shall not be voided by any replacement parts, components, software, or modifications provided by the contractor.
 4. Scheduled and Emergency Call Service: The service shall include a scheduled monthly visit to perform systematic examination of equipment and/or systems and a 7 day, 24 hours call back service for emergency service. The emergency service is defined as a situation created by a breakdown or malfunction of any equipment or system

- warranting urgent attention. A qualified service representative shall respond to the VA request for emergency service within two hours and assess the problem either by telephone or remote diagnostic capability. If the emergency situation cannot be rectified by the VA personnel, on site emergency service shall be provided by sending a qualified service representative within 24 hours. For the rural locations of the VA medical centers, situated over 200 miles from the contractor's established service depot, the maximum response time of 48 hours shall be acceptable. The emergency service shall be limited to adjustments and repairs specifically required to protect the safety of the equipment for which the emergency service was required to be performed.
5. Licensing: The contractor shall be licensed to perform the contracted services. The contractor shall furnish details of all applicable local and state licensing requirements to VA as a part of the qualification requirements. The licenses shall be current, valid through the term of the contract and in the name of the contractor.
 6. Documentation Requirements: The contractor shall maintain a separate log for each item of equipment and each system covered under the extended guarantee period service contract with the VA Medical Center (VAMC) Engineering Service. The log shall list dates and times of all scheduled and emergency calls. Each emergency call shall be described with details of the nature and causes of emergency, steps taken to rectify the situations, and specific recommendations to avoid such conditions in the future.
 7. Reports: The contractor shall provide a quarterly report for the first year and twice a year for the remainder of the guarantee period for all equipment and systems serviced under the extended guarantee period contract. The report shall clearly and concisely describe the services rendered, parts replaced, and repairs performed. The report shall prescribe anticipated future needs of the equipment and systems for preventive and predictive maintenance.
 8. Quality Program: The contractor shall provide a description of the quality management and control program. The description shall include a tangible proof the existence of such program, names of at least three customers who have participated in the program, and specific information showing the applicability of program to the project.
 9. Training: During each scheduled service visit, the contractor shall actively involve the VAMC maintenance personnel in performing scheduled service and associated activities. The practical training during the scheduled service visits shall include parting oral and

written instructions, for each specific task of the servicing contract, to the VAMC maintenance personnel who shall operate the hardware and software in accordance with the intent of the design and under direct supervision of the service contractor's qualified service technician. At the end of the first year of the service contract, the contractor shall obtain a certificate from the VAMC Engineering Service confirming completion of training to the authorized VA representatives.

10. Classroom Training: Provide list and costs of available classroom training courses offered by contractor or O.E.M.

E. Supports for sprinkler piping shall be in conformance with NFPA 13.

F. Supports for standpipe shall be in conformance with NFPA 14.

1.4 SUBMITTALS

A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Manufacturer's Literature and Data: Submit under the pertinent section rather than under this section.

1. Equipment and materials identification.

2. Fire-stopping materials.

3. Hangers, inserts, supports and bracing.

4. Wall, floor, and ceiling plates.

C. Coordination Drawings: Provide details of the following.

1. Mechanical equipment rooms.

2. Hangers, inserts, supports, and bracing.

3. Pipe sleeves.

4. Equipment penetrations of floors, walls, ceilings, or roofs.

D. Maintenance Data and Operating Instructions:

1. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Article, INSTRUCTIONS, for systems and equipment.

2. Provide a listing of recommended replacement parts for keeping in stock supply, including sources of supply, for equipment. Include in the listing belts for equipment.

1.5 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. American Society for Testing and Materials (ASTM):

A36/A36M-2001Carbon Structural Steel

A575-96Steel Bars, Carbon, Merchant Quality, M-Grades R
(2002)

E84-2003Standard Test Method for Burning Characteristics
of Building Materials

E119-2000Standard Test Method for Fire Tests of Building
Construction and Materials

C. National Fire Protection Association (NFPA):

90A-96Installation of Air Conditioning and Ventilating
Systems

101-97Life Safety Code

PART 2 - PRODUCTS

2.1 LIFTING ATTACHMENTS

Provide equipment with suitable lifting attachments to enable equipment to be lifted in its normal position. Lifting attachments shall withstand any handling conditions that might be encountered, without bending or distortion of shape, such as rapid lowering and braking of load.

2.4 EQUIPMENT AND MATERIALS IDENTIFICATION

- A. Use symbols, nomenclature and equipment numbers specified, shown on the drawings and shown in the maintenance manuals. In addition, provide bar code identification nameplate for all equipment which will allow the equipment identification code to be scanned into the system for maintenance and inventory tracking. Identification for piping is specified in Section 09 91 00, PAINTING.
- B. Interior (Indoor) Equipment: Engraved nameplates, with letters not less than 48 mm (3/16-inch) high of brass with black-filled letters, or rigid black plastic with white letters specified in Section 09 91 00, PAINTING permanently fastened to the equipment. Identify unit components such as coils, filters, fans, etc.
- C. Exterior (Outdoor) Equipment: Brass nameplates, with engraved black filled letters, not less than 48 mm (3/16-inch) high riveted or bolted to the equipment.
- D. Control Items: Label all temperature and humidity sensors, controllers and control dampers. Identify and label each item as they appear on the control diagrams.
- E. Valve Tags and Lists:
 - 1. Valve tags: Engraved black filled numbers and letters not less than 13 mm (1/2-inch) high for number designation, and not less than 6.4 mm(1/4-inch) for service designation on 19 gage 38 mm (1-1/2 inches) round brass disc, attached with brass "S" hook or brass chain.
 - 2. Valve lists: Typed or printed plastic coated card(s), sized 216 mm (8-1/2 inches) by 280 mm (11 inches) showing tag number, valve

function and area of control, for each service or system. Punch sheets for a 3-ring notebook.

3. Provide detailed plan for each floor of the building indicating the location and valve number for each valve. Identify location of each valve with a color coded thumb tack in ceiling.

2.5 FIRESTOPPING

Section 07 84 00, FIRESTOPPING specifies an effective barrier against the spread of fire, smoke and gases where penetrations occur for piping.

2.6 GALVANIZED REPAIR COMPOUND

Mil. Spec. DOD-P-21035B, paint form.

2.7 PIPE PENETRATIONS

- A. Install sleeves during construction for other than blocked out floor openings for risers in mechanical bays.
- B. To prevent accidental liquid spills from passing to a lower level, provide the following:
 1. For sleeves: Extend sleeve 25 mm (one inch) above finished floor and provide sealant for watertight joint.
 2. For blocked out floor openings: Provide 40 mm (1-1/2 inch) angle set in silicone adhesive around opening.
 3. For drilled penetrations: Provide 40 mm (1-1/2 inch) angle ring or square set in silicone adhesive around penetration.
- C. Penetrations are not allowed through beams or ribs, but may be installed in concrete beam flanges. Any deviation from this requirement must receive prior approval of Resident Engineer.
- D. Sheet Metal, Plastic, or Moisture-resistant Fiber Sleeves: Provide for pipe passing through floors, interior walls, and partitions, unless brass or steel pipe sleeves are specifically called for below.
- E. Cast Iron or Zinc Coated Pipe Sleeves: Provide for pipe passing through exterior walls below grade. Make space between sleeve and pipe watertight with a modular or link rubber seal. Seal shall be applied at both ends of sleeve.
- F. Galvanized Steel or an alternate Black Iron Pipe with asphalt coating Sleeves: Provide for pipe passing through concrete beam flanges, except where brass pipe sleeves are called for. Provide sleeve for pipe passing through floor of mechanical rooms, laundry work rooms, and animal rooms above basement. Except in mechanical rooms, connect sleeve with floor plate.
- G. Brass Pipe Sleeves: Provide for pipe passing through quarry tile, terrazzo or ceramic tile floors. Connect sleeve with floor plate.
- H. Sleeves are not required for wall hydrants for fire department connections or in drywall construction.

- I. Sleeve Clearance: Sleeve through floors, walls, partitions, and beam flanges shall be one inch greater in diameter than external diameter of pipe. Sleeve for pipe with insulation shall be large enough to accommodate the insulation. Interior openings shall be caulked tight with fire stopping material and sealant to prevent the spread of fire, smoke, and gases.
- J. Sealant and Adhesives: Shall be as specified in Section 07 92 00, JOINT SEALANTS.

2.8 TOOLS AND LUBRICANTS

- A. Furnish, and turn over to the Resident Engineer, special tools not readily available commercially, that are required for disassembly or adjustment of equipment and machinery furnished.
- B. Grease Guns with Attachments for Applicable Fittings: One for each type of grease required for each motor or other equipment.
- C. Tool Containers: Hardwood or metal, permanently identified for intended service and mounted, or located, where directed by the Resident Engineer.
- D. Lubricants: A minimum of 0.95 L (one quart) of oil, and 0.45 kg (one pound) of grease, of equipment manufacturer's recommended grade and type, in unopened containers and properly identified as to use for each different application.

2.9 WALL, FLOOR AND CEILING PLATES

- A. Material and Type: Chrome plated brass or chrome plated steel, one piece or split type with concealed hinge, with set screw for fastening to pipe, or sleeve. Use plates that fit tight around pipes, cover openings around pipes and cover the entire pipe sleeve projection.
- B. Thickness: Not less than 2.4 mm (3/32-inch) for floor plates. For wall and ceiling plates, not less than 0.64 mm (0.025-inch) for up to 80 mm (3-inch pipe), 0.89 mm (0.035-inch) for larger pipe.
- C. Locations: Use where pipe penetrates floors, walls and ceilings in exposed locations, in finished areas only. Use also where insulation ends on exposed water supply pipe drop from overhead. Provide a watertight joint in spaces where brass or steel pipe sleeves are specified.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Coordinate location of piping, sleeves, inserts, hangers, and equipment. Locate piping, sleeves, inserts, hangers, and equipment clear of windows, doors, openings, light outlets, and other services and

utilities. Follow manufacturer's published recommendations for installation methods not otherwise specified.

B. Protection and Cleaning:

1. Equipment and materials shall be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations and as approved by the Resident Engineer. Damaged or defective items in the opinion of the Resident Engineer, shall be replaced.
2. Protect all finished parts of equipment, such as shafts and bearings where accessible, from rust prior to operation by means of protective grease coating and wrapping. Close pipe openings with caps or plugs during installation. Tightly cover and protect equipment against dirt, water chemical, or mechanical injury. At completion of all work thoroughly exposed materials and equipment.

C. Concrete and Grout: Use concrete and shrink compensating grout 25 MPa (3000 psi) minimum, specified in Section 03 30 00, CAST-IN-PLACE CONCRETE.

D. Install gages, valves, and other devices with due regard for ease in reading or operating and maintaining said devices. Locate and position gages to be easily read by operator or staff standing on floor or walkway provided. Servicing shall not require dismantling adjacent equipment or pipe work.

E. Work in Existing Building:

1. Perform as specified in Article, OPERATIONS AND STORAGE AREAS, Article, ALTERATIONS, and Article, RESTORATION of the Section 01 00 00, GENERAL REQUIREMENTS for relocation of existing equipment, alterations and restoration of existing building(s).
2. As specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, OPERATIONS AND STORAGE AREAS, make alterations to existing service piping at times that will least interfere with normal operation of the facility.
3. Cut required openings through existing masonry and reinforced concrete using diamond core drills. Use of pneumatic hammer type drills, impact type electric drills, and hand or manual hammer type drills, will be permitted only with approval of the Resident Engineer. Locate openings that will least effect structural slabs, columns, ribs or beams. Refer to the Resident Engineer for determination of proper design for openings through structural sections and opening layouts approval, prior to cutting or drilling into structure. After Resident Engineer's approval, carefully cut

opening through construction no larger than absolutely necessary for the required installation.

G. Switchgear Drip Protection: Every effort shall be made to eliminate the installation of pipe above electrical and telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints.

H. Inaccessible Equipment:

1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, equipment shall be removed and reinstalled or remedial action performed as directed at no additional cost to the Government.
2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as motors, fans, pumps, belt guards, transformers, high voltage lines, piping, and ductwork.

3.4 STARTUP AND TEMPORARY OPERATION

Start up equipment as described in equipment specifications. Temporary use of equipment is specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT.

3.5 OPERATING AND PERFORMANCE TESTS

- A. Prior to the final inspection, perform required tests as specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TESTS and submit the test reports and records to the Resident Engineer.
- B. Should evidence of malfunction in any tested system, or piece of equipment or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost to the Government.
- C. When completion of certain work or system occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then make performance tests for heating systems and for cooling systems respectively during first actual seasonal use of respective systems following completion of work.

3.6 INSTRUCTIONS TO VA PERSONNEL

Provide in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.

- - - E N D - - -

SECTION 21 08 00
COMMISSIONING OF FIRE SUPPRESSION SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. The requirements of this Section apply to all sections of Division 21.
- B. This project will have selected building systems commissioned. The complete list of equipment and systems to be commissioned is specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. The commissioning process, which the Contractor is responsible to execute, is defined in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. A Commissioning Agent (CxA) appointed by the VA will manage the commissioning process.

1.2 RELATED WORK

- A. Section 01 00 00 GENERAL REQUIREMENTS.
- B. Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.
- C. Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

1.3 SUMMARY

- A. This Section includes requirements for commissioning the Fire Suppression systems, subsystems and equipment. This Section supplements the general requirements specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.
- B. The commissioning activities have been developed to support the VA requirements to meet guidelines for Federal Leadership in Environmental, Energy, and Economic Performance.
- C. The commissioning activities have been developed to support the United States Green Building Council (USGBC) LEED™ rating program and to support delivery of project performance in accordance with the Contract Documents developed with the approval of the VA.
 - 1. Commissioning activities and documentation for the LEED™ section on "Energy and Atmosphere" prerequisite of "Fundamental Building Systems Commissioning".
 - 2. Commissioning activities and documentation for the LEED™ section on "Energy and Atmosphere" requirements for the "Enhanced Building System Commissioning" credit.
 - 3. Activities and documentation for the LEED™ section on "Measurement and Verification" requirements for the Measurement and Verification credit.

- D. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for more details regarding processes and procedures as well as roles and responsibilities for all Commissioning Team members.

1.4 DEFINITIONS

- A. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for definitions.

1.5 COMMISSIONED SYSTEMS

- A. Commissioning of a system or systems specified in this Division is part of the construction process. Documentation and testing of these systems, as well as training of the VA's Operation and Maintenance personnel, is required in cooperation with the VA and the Commissioning Agent.
- B. The following Fire Suppression systems will be commissioned:
1. Fire Protection System (Wet-pipe fire suppression).

1.6 SUBMITTALS

- A. The commissioning process requires review of selected Submittals. The Commissioning Agent will provide a list of submittals that will be reviewed by the Commissioning Agent. This list will be reviewed and approved by the VA prior to forwarding to the Contractor. Refer to Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, and SAMPLES for further details.
- B. The commissioning process requires Submittal review simultaneously with engineering review. Specific submittal requirements related to the commissioning process are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

PART 2 - PRODUCTS (NOT USED)

PART 3- EXECUTION

3.1 PRE-FUNCTIONAL CHECKLISTS

- A. The Contractor shall complete Pre-Functional Checklists to verify systems, subsystems, and equipment installation is complete and systems are ready for Systems Functional Performance Testing. The Commissioning Agent will prepare Pre-Functional Checklists to be used to document equipment installation. The Contractor shall complete the checklists. Completed checklists shall be submitted to the VA and to the Commissioning Agent for review. The Commissioning Agent may spot check a sample of completed checklists. If the Commissioning Agent determines that the information provided on the checklist is not accurate, the Commissioning Agent will return the marked-up checklist

to the Contractor for correction and resubmission. If the Commissioning Agent determines that a significant number of completed checklists for similar equipment are not accurate, the Commissioning Agent will select a broader sample of checklists for review. If the Commissioning Agent determines that a significant number of the broader sample of checklists is also inaccurate, all the checklists for the type of equipment will be returned to the Contractor for correction and resubmission. Refer to SECTION 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for submittal requirements for Pre-Functional Checklists, Equipment Startup Reports, and other commissioning documents.

3.2 CONTRACTORS TESTS

- A. Contractor tests as required by other sections of Division 21 shall be scheduled and documented in accordance with Section 01 00 00 GENERAL REQUIREMENTS. The Commissioning Agent will witness selected Contractor tests. Contractor tests shall be completed prior to scheduling Systems Functional Performance Testing.

3.3 SYSTEMS FUNCTIONAL PERFORMANCE TESTING:

- A. The Commissioning Process includes Systems Functional Performance Testing that is intended to test systems functional performance under steady state conditions, to test system reaction to changes in operating conditions, and system performance under emergency conditions. The Commissioning Agent will prepare detailed Systems Functional Performance Test procedures for review and approval by the Resident Engineer. The Contractor shall review and comment on the tests prior to approval. The Contractor shall provide the required labor, materials, and test equipment identified in the test procedure to perform the tests. The Commissioning Agent will witness and document the testing. The Contractor shall sign the test reports to verify tests were performed. See Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS, for additional details.

3.4 TRAINING OF VA PERSONNEL

- A. Training of the VA operation and maintenance personnel is required in cooperation with the Resident Engineer and Commissioning Agent. Provide competent, factory authorized personnel to provide instruction to operation and maintenance personnel concerning the location, operation, and troubleshooting of the installed systems. The instruction shall be scheduled in coordination with the VA Resident Engineer after submission and approval of formal training plans.

Expansion & Renovation of Building 108
For Mental Health

Issue for Construction
June 15, 2012

Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS and
Division 21 Sections for additional Contractor training requirements.

----- END -----

SECTION 21 12 00
FIRE-SUPPRESSION STANDPIPES

PART 1 - GENERAL

1.1 DESCRIPTION

Fire-suppression wet standpipes.

1.2 SCOPE OF WORK

- A. Design, installation and testing shall be in accordance with NFPA 14 except for specified exceptions.
- B. Design, materials, equipment and installation, inspection and testing of a complete and ready for operation fire-suppression wet standpipe system as required by NFPA 14.
- C. Expansion or revision of the building system fire alarm system to incorporate new system alarms and supervisory devices.
- D. Painting of exposed piping and supports to match surrounding background in stairways and red in unfinished areas.

1.3 RELATED WORK

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Section 09 91 00, PAINTING.
- C. Section 28 31 00, FIRE DETECTION AND ALARM, Connection to fire alarm of flow switches, pressure switches and valve supervisory switches.
- D. Section 21 05 11 COMMON WORK RESULTS FOR FIRE SUPPRESSION for general mechanical requirements and items, which are common to more than one section.
- E. Section 22 05 23, HEAT TRACING FOR PLUMBING PIPING.
- F. Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION.

1.4 QUALITY ASSURANCE

- A. Designer's Qualifications: Design work and shop drawings shall be prepared by a licensed engineer practicing in the field of Fire Protection Engineering.
- B. Materials and Equipment: All equipment and devices shall be of a make and type listed by UL and approved by FM, or other nationally recognized testing laboratory for the specific purpose for which it is used. All materials, devices, and equipment shall be approved by the VA.
- C. Testing: Materials and Testing Certificate as per NFPA 14. Provide certificates for all parts of the system.

1.5 DESIGN CRITERIA

- A. The design, materials, equipment, installation, and testing of the system shall be in accordance with NFPA 14 the latest edition.

- B. For hydraulic calculations, calculated demand shall not fall less than 10 percent below the water supply curve.
- C. Size standpipes to provide 690 kPa (100 psig) at the most remote connections.

1.6 SUBMITTALS

- A. Submit as one package in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Prepare detailed working drawings that are stamped by a Registered Professional Engineer practicing in the field of Fire Protection Engineering. As Government review is for technical adequacy only, the installer remains responsible for correcting any conflicts with other trades and building construction that arise during installation. Partial submittals will not be accepted. Material submittals shall be approved prior to the purchase or delivery to the job site. Suitably bind submittals in notebooks or binders and provide index referencing the appropriate specification section. Submittals shall include, but not be limited to, the following:
 - 1. Certificates:
 - a. Materials and Testing certificates as specified.
 - 2. Drawings: Submit detailed 1:100 (1/8 inch) scale (minimum) working drawings conforming to NFPA 14. Include a site plan showing the fire hydrant nearest the fire department connection.
 - 3. Manufacturers Literature and Data Sheets: All pertinent literature and data for the materials and equipment proposed for the project. Include listing information and installation instructions in data sheets. Clearly identify the item to be used.
 - a. For backflow preventers, provide flow test curves from UL, FM, or the Foundation for Hydraulic Research and Cross-Connection Control to verify pressure loss calculations.
 - b. Provide for materials and equipment proposed for use on the system. Include listing information and installation instructions in data sheets. Where data sheet describes items in addition to that item being submitted, clearly identify proposed item on the sheet.
 - 4. Calculation Sheets: Submit hydraulic calculations in accordance with NFPA 14.
 - 5. Final Document Submittals: Provide as-built drawings, testing and maintenance instructions in accordance with the requirements in Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Submittals shall include, but not be limited to, the following:
 - a. One complete set of reproducible as-built drawings showing the installed system with the specific interconnections between the

waterflow switch or pressure switch and the fire alarm equipment.

One copy of final CADD drawing files shall be provided on diskettes that are compatible with the VAMC CADD system.

- b. Four sets of complete, simple, understandable, step-by-step, testing instructions giving recommended and required testing frequency of all equipment, methods for testing all equipment, and a complete trouble shooting manual. Provide maintenance instructions on replacing any components of the system including internal parts, periodic cleaning and adjustment of the equipment and components with information as to the address and telephone number of both the manufacturer and the local supplier of each item.
- c. Certificates shall document all parts of the installation.
 - 1. Materials and Testing certificates as specified.
- d. Instruction Manual: Provide one copy of the instruction manual covering the system in a flexible protective cover and mount in an accessible location adjacent to the riser.

1.7 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):
 - B16.3-99Malleable Iron Threaded Fittings
- C. Factory Mutual Engineering Corporation (FM):
 - Approval Guide - 2001
- D. National Fire Protection Association (NFPA), Latest Edition:
 - 14Installation of Standpipe, Private Hydrant and Hose Systems
 - 101Safety to Life from Fire in Buildings and Structures (Life Safety Code)
 - 170Fire Safety Symbols
- E. Underwriters Laboratories, Inc. (UL):
 - Fire Protection Equipment Directory - 2002

PART 2 PRODUCTS

2.1 GENERAL

All devices and equipment shall be Underwriters Laboratories listed for their intended purpose.

2.2 PIPING & FITTINGS

- A. Shall be in accordance with NFPA 14, black steel, schedule 10 minimum.

- B. Threaded or flanged fittings shall be ANSI B 16.3 cast iron, class 125 minimum. Threaded fitting are not permitted on pipe with wall thickness less than Schedule 40.
- C. Clamp-on fittings with rubber gaskets shall be listed for the piping application.
- D. Plain end pipe, fittings with locking lugs or shear bolts are not permitted. Use nonferrous piping in MRI Scanning Rooms.

2.3 VALVES

- A. Do not use quarter turn ball valves for 50 mm (2 inch) or larger drain valves.
- B. Listed Indicating Valves:
 - 1. Gate: OS&Y, 1200kPa (175 psig) WOG.
 - 2. Butterfly: Gear operated, indicating type, 1200 kPa (175 psig) WOG.
- C. Check Valves: Swing type, rubber faced or wafer type spring loaded butterfly check valve, 1200 kPa (175 psig) WOG.
- D. Drain Valves: Threaded bronze angle, globe, ball or butterfly, 1000 kPa (150 psig.) WOG equipped with reducer and hose connection with cap or connected to a drain line.
- E. Standpipe Hose Valves: 65 mm (2-1/2 inch) screwed, brass hose angle valve, male hose threads same as local fire protection service, 65 mm (2-1/2 inch) by 40 mm (1-1/2 inch) reducer, and with permanently attached polished brass cap and chain.
- F. Automatic Ball Drips: Cast brass 20 mm (3/4 inch) in-line automatic ball drip with both ends threaded with iron pipe threads.

2.5 IDENTIFICATION SIGNS/HYDRAULIC PLACARDS

- A. Provide for all new and existing sectional valves, riser control valves, drain valves and alarm devises. The signs shall be in accordance with NFPA 14 and attached securely to each item.
- B. Plastic, steel or aluminum signs with white lettering on a red background with holes for easy attachment. Enter pertinent data for each system on the hydraulic placard.

2.7 VALVE SUPERVISORY SWITCHES:

- A. Provide each indicating standpipe and control valve with adequate means for mounting a valve supervisory switch.
- B. Mount switch so as not to interfere with normal operation of the valve and adjust to operate within two revolutions toward the closed position of the valve control, or when the stem is moved no more than one fifth of the distance from its normal position.
- C. The mechanism shall be contained in a weatherproof die cast aluminum housing, which shall provide a 20 mm (3/4 in.) tapped conduit entrance and incorporate the necessary facilities for attachment to the valves.

- D. Switch housing to be finished in red baked enamel.
- E. Water flow Alarm Switches: Mechanical, non-coded, non-accumulative retard and adjustable from 0 to 60 seconds minimum. Set flow switches at an initial setting between 20 and 30 seconds.
- F. Valve Supervisory Switches for Ball and Butterfly Valves: May be integral with the valve.
- G. All conduit and wiring connected thereto shall be provided in Section 28 31 00, FIRE DETECTION AND ALARM.

2.8 GAUGES

Provide gauges as required by NFPA 14.

2.9 PIPE HANGERS AND SUPPORTS

Supports, hangers, etc., of an approved pattern placement to conform to NFPA 14. System piping shall be substantially supported to the building structure. Materials used in the installation or construction of hangers and supports shall be listed and approved for such application. Hangers or supports not specifically listed for service shall be designed and bear the seal of a professional engineer.

2.10 WALL, FLOOR AND CEILING PLATES

Provide chrome plated steel escutcheon plates for exposed piping passing through walls, floors or ceilings.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Installation shall be accomplished by the licensed contractor. Provide a qualified technician, experienced in the installation and operation of the type of system being installed, to supervise the installation and testing of the system.
- B. Installation of Piping: Accurately cut pipe to measurements established by the installer and work into place without springing or forcing. In any situation where bending of the pipe is required, use a standard pipe-bending template. Install concealed piping in spaces that have finished ceilings. Sidewall heads may need to be utilized. Locate piping in stairways as near to the ceiling as possible to prevent tampering by unauthorized personnel, and to provide a minimum headroom clearance of 2250 mm (seven feet six inches). To prevent an obstruction to egress, provide piping clearances in accordance with NFPA 101.
- C. Welding: Conform to the requirements and recommendations of NFPA 14.
- D. Drains: Pipe drains to discharge at safe points outside of the building or to sight cones attached to drains of adequate size to readily carry the full flow from each drain under maximum pressure. Do not provide a

direct drain connection to sewer system or discharge into sinks. Install drips and drains where necessary and required by NFPA 14.

- E. Valve Supervisory Switches: Provide supervisory switches for standpipe control valves. Do not provide standpipe hose valves and test and drain valves with supervisory switches. Do not provide valve supervisory switches on standpipe hose valves, test or drain valves. See Section 28 31 00, FIRE DETECTION AND ALARM for connections.
- F. Waterflow Alarm Switches: Install waterflow switch and adjacent valves in easily accessible locations.
- G. Affix cutout disks, which are created by cutting holes in the walls of pipe for flow switches and non-threaded pipe connections to the respective waterflow switch or pipe connection near to the pipe from where they were cut.
- H. Provide pressure gauge at each water flow alarm switch location, at the top of each standpipe, and at each main drain connection.
- I. Penetrations: Sleeve or core drill concrete and masonry. Provide clearance between pipe and openings as required by NFPA 14. Seal penetrations and clearances in fire rated wall and floor assemblies with listed through-penetration firestop materials in accordance with Section 07 84 00, FIRESTOPPING.
- J. Securely attach identification signs to control valves, drain valves, and test valves. Locate hydraulic placard information signs at each sectional control valve where there is a zone water flow switch.
- K. Interruption of Service: There shall be no interruption of the existing sprinkler protection, water, electric, or fire alarm services without prior permission of the Contracting Officer. Contractor shall develop an interim fire protection program where interruptions involve in occupied spaces. Request in writing at least one (1) week prior to the planned interruption. Any interruption shall be limited to 4 hours for final connections or repairs.
- L. Welding: All welding shall conform to the requirements and recommendations of NFPA 14 latest editions.
- M. Heat Trace: Provide heat tracing and insulation for new wet pipe standpipes in parking structure to protect against freezing.

3.2 INSPECTION AND TEST

- A. Flushing: Flush newly installed systems prior to performing hydrostatic tests in order to remove any debris which may have been left as well as ensuring piping is unobstructed.
- B. Hydrostatic Testing: Hydrostatically test the system including the fire department connections, as specified in NFPA 14, NFPA-25 and NFPA 13

latest edition, in the presence of the Authority Having Jurisdiction or his designated representative.

- C. Final Inspection and Testing: Test the system in accordance with NFPA 14, NFPA 25 and NFPA 13 latest editions after all necessary corrections have been accomplished. Advise the Authority Having Jurisdiction who will then schedule the final inspection and test. Furnish all instruments, labor and materials required for the tests and provide the services of the installation foreman or other competent representative of the installer to perform the tests. Correct any deficiencies found and retest the system. Include the operation of all features of the systems under normal conditions in the test.

3.3 INSTRUCTIONS

Furnish the services of a competent instructor for not less than two hours for instructing personnel in the operation and maintenance of the system, on the dates requested by the COTR/Resident Engineer.

3.3 WARRANTY

- A. All work performed and materials and equipment furnished under this contract shall be free from defects for a period of one year from date of acceptance by the government.
- B. All new piping and equipment incorporated into the new system shall be hydrostatically tested and warranted as new.

- - - E N D - - -

SECTION 21 13 13
WET-PIPE SPRINKLER SYSTEMS

PART 1 - GENERAL

1.1 SCOPE OF WORK

- A. Design, installation and testing shall be in accordance with NFPA 13 except for specified exceptions.
- B. The design and installation of a hydraulically calculated automatic wet system complete and ready for operation, for all portions of Building 108 and 108A, including the penthouse, mechanical equipment rooms, telephone rooms, elevator machine rooms, elevator pits, and linen chutes.

1.2 RELATED WORK

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Section 33 10 00, WATER UTILITIES.
- C. Section 07 84 00, FIRESTOPPING, Treatment of penetrations through rated enclosures.
- D. Section 09 91 00, PAINTING.
- E. Section 21 12 00, FIRE-SUPPRESSION STANDPIPES.
- F. Section 28 31 00, FIRE DETECTION AND ALARM, Connection to fire alarm of flow switches, pressure switches and valve supervisory switches.
- G. Section 21 05 11 COMMON WORK RESULTS FOR FIRE SUPPRESSION

1.3 QUALITY ASSURANCE

- A. Installer Reliability: The installer shall possess a valid State of Texas fire sprinkler contractor's license. The installer shall have been actively and successfully engaged in the installation of commercial automatic sprinkler systems for the past three years.
- B. Materials and Equipment: All equipment and devices shall be of a make and type listed by UL and approved by FM, or other nationally recognized testing laboratory for the specific purpose for which it is used. All materials, devices, and equipment shall be approved by the VA.
- C. Submittals: Submit as one package in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Prepare detailed working drawings that are signed by a NICET Level III or Level IV Sprinkler Technician or stamped by a Registered Professional Engineer practicing in the field of Fire Protection Engineering. As Government review is for technical adequacy only, the installer remains responsible for correcting any conflicts with other trades and building construction that arise during installation. Partial submittals will not be accepted. Material submittals shall be approved prior to the purchase or delivery

to the job site. Suitably bind submittals in notebooks or binders and provide index referencing the appropriate specification section.

Submittals shall include, but not be limited to, the following:

1. Qualifications:

- a. Provide a copy of the installing contractors state contractors license.
- b. Provide a copy of the NICET certification for the NICET Level III or Level IV Sprinkler Technician who prepared and signed the detailed working drawings unless the drawings are stamped by a Registered Professional Engineer practicing in the field of Fire Protection Engineering.

2. Drawings: Submit detailed 1:100 (1/8 inch) scale (minimum) working drawings conforming to NFPA 13. Include a site plan showing the piping to the water supply test location.

3. Manufacturers Data Sheets:

- a. For backflow preventers, provide flow test curves from UL, FM, or the Foundation for Hydraulic Research and Cross-Connection Control to verify pressure loss calculations.
- b. Provide for materials and equipment proposed for use on the system. Include listing information and installation instructions in data sheets. Where data sheet describes items in addition to that item being submitted, clearly identify proposed item on the sheet.

4. Calculation Sheets: Submit hydraulic calculation sheets in tabular form conforming to the requirements and recommendations of NFPA 13.

5. Final Document Submittals: Provide as-built drawings, testing and maintenance instructions in accordance with the requirements in Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

Submittals shall include, but not be limited to, the following:

- a. One complete set of reproducible as-built drawings showing the installed system with the specific interconnections between the waterflow switch or pressure switch and the fire alarm equipment.
- b. Complete, simple, understandable, step-by-step, testing instructions giving recommended and required testing frequency of all equipment, methods for testing all equipment, and a complete trouble shooting manual. Provide maintenance instructions on replacing any components of the system including internal parts, periodic cleaning and adjustment of the equipment and components with information as to the address and telephone number of both the manufacturer and the local supplier of each item.

- c. Material and Testing Certificate: Upon completion of the sprinkler system installation or any partial section of the system, including testing and flushing, provide a copy of a completed Material and Testing Certificate as indicated in NFPA 13.
 - d. Certificates shall document all parts of the installation.
 - e. Instruction Manual: Provide one copy of the instruction manual covering the system in a flexible protective cover and mount in an accessible location adjacent to the riser.
- D. Design Basis Information: Provide design, materials, equipment, installation, inspection, and testing of the automatic sprinkler system in accordance with the requirements of NFPA 13. Recommendations in appendices shall be treated as requirements.
- 1. Perform hydraulic calculations in accordance with NFPA 13 utilizing the Area/Density method. Do not restrict design area reductions permitted for using quick response sprinklers throughout by the required use of standard response sprinklers in the areas identified in this section.
 - 2. Sprinkler Protection: To determining spacing and sizing, apply the following coverage classifications:
 - a. Light Hazard Occupancies: Patient care, treatment, and customary access areas.
 - b. Ordinary Hazard Group 1 Occupancies: Laboratories, Mechanical Equipment Rooms, Transformer Rooms, Electrical Switchgear Rooms, Electric Closets, Elevator Shafts, Elevator Machine Rooms, Refrigeration Service Rooms, Repair Shops.
 - c. Ordinary Hazard Group 2 Occupancies: Storage rooms, trash rooms, clean and soiled linen rooms, pharmacy and associated storage, laundry, kitchens, kitchen storage areas, retail stores, retail store storage rooms, storage areas, building management storage, boiler plants, energy centers, warehouse spaces, file storage areas for the entire area of the space up to 140 square meters (1500 square feet) and Supply Processing and Distribution (SPD).
 - d. Request clarification from the Government for any hazard classification not identified.
 - 3. Hydraulic Calculations: Calculated demand including hose stream requirements shall fall no less than 10 percent below the available water supply curve.
 - 4. Zoning:
 - a. For each sprinkler zone provide a control valve, flow switch and a test and drain assembly with pressure gauge.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. National Fire Protection Association (NFPA), Latest Edition:
 - 13Installation of Sprinkler Systems
 - 101Safety to Life from Fire in Buildings and Structures (Life Safety Code)
 - 170Fire Safety Symbols
- C. Underwriters Laboratories, Inc. (UL), Latest Edition:
 - Fire Protection Equipment Directory
- D. Factory Mutual Engineering Corporation (FM), Latest Edition:
 - Approval Guide
- E. Uniform Building Code - 1997
- F. Foundation for Cross-Connection Control and Hydraulic Research-2005

PART 2 PRODUCTS

2.1 PIPING & FITTINGS

- A. Sprinkler systems in accordance with NFPA 13. Use nonferrous piping in MRI Scanning Rooms.

2.2 VALVES

- A. Valves in accordance with NFPA 13.
- B. Do not use quarter turn ball valves for 50 mm (2 inch) or larger drain valves.
- C. The wet system control valve shall be a listed indicating type valve. Control valve shall be UL Listed and FM Approved for fire protection installations. System control valve shall be rated for normal system pressure but in no case less than 175 PSI. (No Substitutions Allowed).
- D. Automatic Ball Drips: Cast brass 20 mm (3/4 inch) in-line automatic ball drip with both ends threaded with iron pipe threads.

2.3 FIRE DEPARTMENT SIAMESE CONNECTION

- A. Brass, flush wall type, fire department connection with brass escutcheon plate, and a minimum of two 65 mm (2-1/2 inch) connections threaded to match those on the local fire protection service, with polished brass caps and chains. Provide escutcheon with integral raised letters "Automatic Sprinkler". Install an automatic ball drip between fire department connection and check valve with drain piping routed to the exterior of the building or a floor drain.

2.4 SPRINKLERS

- A. All sprinklers except "institutional" type sprinklers shall be FM approved. "Institutional" type sprinklers in Mental Health and Behavior

Units shall be UL listed or FM approved quick response type. Maximum break away strength shall be certified by the manufacturer to be no more than 39 kPa (85 pounds). Provide quick response sprinklers in all areas, except where specifically prohibited by their listing or approval.

1. Cold storage rooms: Standard response dry pendant sprinklers.
2. Elevator shafts and elevator machine rooms: Standard response sprinklers.
3. Elevator pit: sidewall sprinklers.
4. In generator rooms: Standard response sprinklers.

(Note: Provide 'cages' to protect sprinkler heads from breakage/damage when the elevation of the head is less than 7 feet 6 inches above finished floor (mechanical rooms, janitor closets, etc)).

B. Temperature Ratings: In accordance with NFPA 13, except as follows:

1. Sprinklers in elevator shafts, elevator pits, and elevator machine rooms: Intermediate temperature rated.
2. Sprinklers in Generator Rooms: High temperature rated.

2.5 SPRINKLER CABINET

Provide sprinkler cabinet with the required number of sprinkler heads of all ratings and types installed, and a sprinkler wrench for each system. Locate adjacent to the riser. Sprinkler heads shall be installed in center of tile or center to center.

2.6 IDENTIFICATION SIGNS/HYDRAULIC PLACARDS

Plastic, steel or aluminum signs with white lettering on a red background with holes for easy attachment. Enter pertinent data for each system on the hydraulic placard.

2.7 SWITCHES:

- A. Contain in a weatherproof die cast/red baked enamel, oil resistant, aluminum housing with tamper resistant screws, 13 mm (1/2 inch) conduit entrance and necessary facilities for attachment to the valves. Provide two SPDT switches rated at 2.5 amps at 24 VDC.
- B. Water flow Alarm Switches: Mechanical, non-coded, non-accumulative retard and adjustable from 0 to 60 seconds minimum. Set flow switches at an initial setting between 20 and 30 seconds.
- D. Valve Supervisory Switches for Ball and Butterfly Valves: May be integral with the valve.

2.8 WATER MOTOR GONG

Water powered mechanical device providing an audible signal when there is a flow of water in the automatic sprinkler system. Water flow will activate a hydraulic powered water motor alarm by way of integral valve alarm line trim piping. The water motor gong shall be connected to a

water pressure retarding chamber to limit the propensity of unnecessary alarms. The water motor alarm shall be equipped with a rear closure plate to limit the access of foreign materials and accumulation of debris. The water motor alarm shall be UL Listed and Factory Mutual Approved for the application in which it is used.

2.9 GAUGES

Provide gauges as required by NFPA 13.

2.10 PIPE HANGERS AND SUPPORTS

Supports, hangers, etc., of an approved pattern placement to conform to NFPA 13. System piping shall be substantially supported to the building structure. The installation of hangers and supports shall adhere to the requirements set forth in NFPA 13, Standard for Installation of Sprinkler Systems. Materials used in the installation or construction of hangers and supports shall be listed and approved for such application. Hangers or supports not specifically listed for service shall be designed and bear the seal of a professional engineer.

2.11 WALL, FLOOR AND CEILING PLATES

Provide chrome plated steel escutcheon plates for exposed piping passing through walls, floors or ceilings.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Installation shall be accomplished by the licensed contractor. Provide a qualified technician, experienced in the installation and operation of the type of system being installed, to supervise the installation and testing of the system.
- B. Installation of Piping: Accurately cut pipe to measurements established by the installer and work into place without springing or forcing. In any situation where bending of the pipe is required, use a standard pipe-bending template. Install concealed piping in spaces that have finished ceilings. Where ceiling mounted equipment exists, such as in operating and radiology rooms, install sprinklers so as not to obstruct the movement or operation of the equipment. Sidewall heads may need to be utilized. Locate piping in stairways as near to the ceiling as possible to prevent tampering by unauthorized personnel, and to provide a minimum headroom clearance of 2250 mm (seven feet six inches). To prevent an obstruction to egress, provide piping clearances in accordance with NFPA 101.
- C. Welding: Conform to the requirements and recommendations of NFPA 13.
- D. Drains: Pipe drains to discharge at safe points outside of the building or to sight cones attached to drains of adequate size to readily carry

the full flow from each drain under maximum pressure. Do not provide a direct drain connection to sewer system or discharge into sinks. Install drips and drains where necessary and required by NFPA 13.

- E. Supervisory Switches: Provide supervisory switches for sprinkler control valves.
- F. Waterflow Alarm Switches: Install waterflow switch and adjacent valves in easily accessible locations.
- G. Inspector's Test Connection: Install and supply in conformance with NFPA 13, locate in a secured area, and discharge to the exterior of the building.
- H. Affix cutout disks, which are created by cutting holes in the walls of pipe for flow switches and non-threaded pipe connections to the respective waterflow switch or pipe connection near to the pipe from where they were cut.
- I. Sleeves: Provide for pipes passing through masonry or concrete. Provide space between the pipe and the sleeve in accordance with NFPA 13. Seal this space with a UL Listed through penetration fire stop material in accordance with Section 07 84 00, FIRESTOPPING. Where core drilling is used in lieu of sleeves, also seal space. Seal penetrations of walls, floors and ceilings of other types of construction, in accordance with Section 07 84 00, FIRESTOPPING.
- J. Provide pressure gauge at each water flow alarm switch location and at each main drain connection.
- K. For each fire department connection, provide the symbolic sign given in NFPA 170 and locate 2400 to 3000 mm (8 to 10 feet) above each connection location. Size the sign to 450 by 450 mm (18 by 18 inches) with the symbol being at least 350 by 350 mm (14 by 14 inches).
- L. Firestopping shall comply with Section 07 84 00, FIRESTOPPING.
- M. MRI Suite: Provide no more than one penetration of the MRI shield enclosure. The drain piping shall not be restricted or reduced and shall be of the same diameter as the drain collector.
- N. Securely attach identification signs to control valves, drain valves, and test valves. Locate hydraulic placard information signs at each sectional control valve where there is a zone water flow switch.
- O. Repairs: Repair damage to the building or equipment resulting from the installation of the sprinkler system by the installer at no additional expense to the Government.
- P. Interruption of Service: There shall be no interruption of the existing sprinkler protection, water, electric, or fire alarm services without prior permission of the Contracting Officer. Contractor shall develop an interim fire protection program where interruptions involve in occupied

spaces. Request in writing at least one week prior to the planned interruption.

3.2 INSPECTION AND TEST

- A. Preliminary Testing: Flush newly installed systems prior to performing hydrostatic tests in order to remove any debris which may have been left as well as ensuring piping is unobstructed. Hydrostatically test system, including the fire department connections, as specified in NFPA 13, in the presence of the Contracting Officers Technical Representative (COTR) or his designated representative. Test and flush underground water line prior to performing these hydrostatic tests.
- B. Final Inspection and Testing: Subject system to tests in accordance with NFPA 13, and when all necessary corrections have been accomplished, advise COTR/Resident Engineer to schedule a final inspection and test. Connection to the fire alarm system shall have been in service for at least ten days prior to the final inspection, with adjustments made to prevent false alarms. Furnish all instruments, labor and materials required for the tests and provide the services of the installation foreman or other competent representative of the installer to perform the tests. Correct deficiencies and retest system as necessary, prior to the final acceptance. Include the operation of all features of the systems under normal operations in test.

3.3 INSTRUCTIONS

Furnish the services of a competent instructor for not less than two hours for instructing personnel in the operation and maintenance of the system, on the dates requested by the COTR/Resident Engineer.

- - - E N D - - -

SECTION 22 05 11
COMMON WORK RESULTS FOR PLUMBING

PART 1 - GENERAL

1.1 DESCRIPTION

- A. The requirements of this Section shall apply to all sections of Division 22.
- B. Definitions:
 - 1. Exposed: Piping and equipment exposed to view in finished rooms.
 - 2. Option or optional: Contractor's choice of an alternate material or method.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 31 20 11, EARTH MOVING (Short Form): Excavation and Backfill.
- D. Section 03 30 00, CAST-IN-PLACE CONCRETE: Concrete and Grout.
- E. Section 05 31 00, STEEL DECKING, Section 05 36 00, COMPOSITE METAL DECKING. : Building Components for Attachment of Hangers.
- F. Section 05 50 00, METAL FABRICATIONS.
- G. Section 07 84 00, FIRESTOPPING.
- H. Section 07 60 00, FLASHING AND SHEET METAL: Flashing for Wall and Roof Penetrations.
- I. Section 07 92 00, JOINT SEALANTS.
- J. Section 09 91 00, PAINTING.
- K. Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION.
- L. Section 23 09 23, DIRECT DIGITAL CONTROLS FOR HVAC.
- M. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS
- N. Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT.
- O. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.

1.3 QUALITY ASSURANCE

- A. Products Criteria:
 - 1. Standard Products: Material and equipment shall be the standard products of a manufacturer regularly engaged in the manufacture of the products for at least 3 years. However, digital electronics devices, software and systems such as controls, instruments, computer work station, shall be the current generation of technology and basic design that has a proven satisfactory service record of at least three years.

2. Equipment Service: There shall be permanent service organizations, authorized and trained by manufacturers of the equipment supplied, located within 160 km (100 miles) of the project. These organizations shall come to the site and provide acceptable service to restore operations within four hours of receipt of notification by phone, e-mail or fax in event of an emergency, such as the shut-down of equipment; or within 24 hours in a non-emergency. Names, mail and e-mail addresses and phone numbers of service organizations providing service under these conditions for (as applicable to the project): pumps, critical instrumentation, computer workstation and programming shall be submitted for project record and inserted into the operations and maintenance manual.
 3. All items furnished shall be free from defects that would adversely affect the performance, maintainability and appearance of individual components and overall assembly.
 4. The products and execution of work specified in Division 22 shall conform to the referenced codes and standards as required by the specifications. Local codes and amendments enforced by the local code official shall be enforced, if required by local authorities such as the natural gas supplier. If the local codes are more stringent, then the local code shall apply. Any conflicts shall be brought to the attention of the Resident Engineer (RE)/Contracting Officers Technical Representative (COTR).
 5. Multiple Units: When two or more units of materials or equipment of the same type or class are required, these units shall be products of one manufacturer.
 6. Assembled Units: Manufacturers of equipment assemblies, which use components made by others, assume complete responsibility for the final assembled product.
 7. Nameplates: Nameplate bearing manufacturer's name or identifiable trademark shall be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.
 8. Asbestos products or equipment or materials containing asbestos shall not be used.
- B. Welding: Before any welding is performed, contractor shall submit a certificate certifying that welders comply with the following requirements:

1. Qualify welding processes and operators for piping according to ASME "Boiler and Pressure Vessel Code", Section IX, "Welding and Brazing Qualifications".
 2. Comply with provisions of ASME B31 series "Code for Pressure Piping".
 3. Certify that each welder has passed American Welding Society (AWS) qualification tests for the welding processes involved, and that certification is current.
 4. All welds shall be stamped according to the provisions of the American Welding Society.
- C. Manufacturer's Recommendations: Where installation procedures or any part thereof are required to be in accordance with the recommendations of the manufacturer of the material being installed, printed copies of these recommendations shall be furnished to the Resident Engineer prior to installation. Installation of the item will not be allowed to proceed until the recommendations are received. Failure to furnish these recommendations can be cause for rejection of the material.
- D. Execution (Installation, Construction) Quality:
1. All items shall be applied and installed in accordance with manufacturer's written instructions. Conflicts between the manufacturer's instructions and the contract drawings and specifications shall be referred to the RE/COTR for resolution. Written hard copies or computer files of manufacturer's installation instructions shall be provided to the RE/COTR at least two weeks prior to commencing installation of any item.
 2. Complete layout drawings shall be required by Paragraph, SUBMITTALS. Construction work shall not start on any system until the layout drawings have been approved.
- E. Guaranty: Warranty of Construction, FAR clause 52.246-21.
- F. Plumbing Systems: IPC, International Plumbing Code.

1.4 SUBMITTALS

- A. Submittals shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 05 11, COMMON WORK RESULTS FOR PLUMBING", with applicable paragraph identification.

- C. Contractor shall make all necessary field measurements and investigations to assure that the equipment and assemblies will meet contract requirements.
- D. If equipment is submitted which differs in arrangement from that shown, provide drawings that show the rearrangement of all associated systems. Approval will be given only if all features of the equipment and associated systems, including accessibility, are equivalent to that required by the contract.
- E. Prior to submitting shop drawings for approval, contractor shall certify in writing that manufacturers of all major items of equipment have each reviewed drawings and specifications, and have jointly coordinated and properly integrated their equipment and controls to provide a complete and efficient installation.
- F. Upon request by Government, lists of previous installations for selected items of equipment shall be provided. Contact persons who will serve as references, with telephone numbers and e-mail addresses shall be submitted with the references.
- G. Manufacturer's Literature and Data: Manufacturer's literature shall be submitted under the pertinent section rather than under this section.
 - 1. Electric motor data and variable speed drive data shall be submitted with the driven equipment.
 - 2. Equipment and materials identification.
 - 3. Fire stopping materials.
 - 4. Hangers, inserts, supports and bracing. Provide load calculations for variable spring and constant support hangers.
 - 5. Wall, floor, and ceiling plates.
- H. Coordination Drawings: In accordance with GENERAL CONDITIONS, Article, SUBCONTRACTS AND WORK COORDINATION. Complete consolidated and coordinated layout drawings shall be submitted for all new systems, and for existing systems that are in the same areas. The drawings shall include plan views, elevations and sections of all systems and shall be on a scale of not less than 1:32 (3/8-inch equal to one foot). Clearly identify and dimension the proposed locations of the principal items of equipment. The drawings shall clearly show the proposed location and adequate clearance for all equipment, piping, pumps, valves and other items. All valves, trap primer valves, water hammer arrestors, strainers, and equipment requiring service shall be provided with an access door sized for the complete removal of plumbing device,

component, or equipment. Equipment foundations shall not be installed until equipment or piping until layout drawings have been approved. Detailed layout drawings shall be provided for all piping systems. In addition, details of the following shall be provided.

1. Mechanical equipment rooms.
2. Interstitial space.
3. Hangers, inserts, supports, and bracing.
4. Pipe sleeves.
5. Equipment penetrations of floors, walls, ceilings, or roofs.

I. Maintenance Data and Operating Instructions:

1. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Article, INSTRUCTIONS, for systems and equipment.
2. Listing of recommended replacement parts for keeping in stock supply, including sources of supply, for equipment shall be provided.
3. The listing shall include belts for equipment: Belt manufacturer, model number, size and style, and distinguished whether of multiple belt sets.

1.5 DELIVERY, STORAGE AND HANDLING

A. Protection of Equipment:

1. Equipment and material placed on the job site shall remain in the custody of the Contractor until phased acceptance, whether or not the Government has reimbursed the Contractor for the equipment and material. The Contractor is solely responsible for the protection of such equipment and material against any damage.
2. Damaged equipment shall be replaced with an identical unit as determined and directed by the RE/COTR. Such replacement shall be at no additional cost to the Government.
3. Interiors of new equipment and piping systems shall be protected against entry of foreign matter. Both inside and outside shall be cleaned before painting or placing equipment in operation.
4. Existing equipment and piping being worked on by the Contractor shall be under the custody and responsibility of the Contractor and shall be protected as required for new work.

B. Cleanliness of Piping and Equipment Systems:

1. Care shall be exercised in the storage and handling of equipment and piping material to be incorporated in the work. Debris arising from cutting, threading and welding of piping shall be removed.
2. Piping systems shall be flushed, blown or pigged as necessary to deliver clean systems.
3. The interior of all tanks shall be cleaned prior to delivery and beneficial use by the Government. All piping shall be tested in accordance with the specifications and the International Plumbing Code (IPC), latest edition. All filters, strainers, fixture faucets shall be flushed of debris prior to final acceptance.
4. Contractor shall be fully responsible for all costs, damage, and delay arising from failure to provide clean systems.

1.6 APPLICABLE PUBLICATIONS

- A. The publications listed below shall form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):
Boiler and Pressure Vessel Code (BPVC):
SEC IX-2007.....Boiler and Pressure Vessel Code; Section IX,
Welding and Brazing Qualifications.
- C. American Society for Testing and Materials (ASTM):
A36/A36M-2008.....Standard Specification for Carbon Structural
Steel
A575-96 (R 2007).....Standard Specification for Steel Bars, Carbon,
Merchant Quality, M-Grades R (2002)
E84-2005.....Standard Test Method for Surface Burning
Characteristics of Building Materials
E119-2008a.....Standard Test Methods for Fire Tests of
Building Construction and Materials
- D. Manufacturers Standardization Society (MSS) of the Valve and Fittings Industry, Inc:
SP-58-02.....Pipe Hangers and Supports-Materials, Design and
Manufacture
SP 69-2003 (R 2004).....Pipe Hangers and Supports-Selection and
Application
- E. National Electrical Manufacturers Association (NEMA):
MG1-2003, Rev. 1-2007...Motors and Generators
- F. International Code Council, (ICC):

IBC-06, (R 2007).....International Building Code

IPC-06, (R 2007).....International Plumbing Code

PART 2 - PRODUCTS

2.1 FACTORY-ASSEMBLED PRODUCTS

- A. STANDARDIZATION OF COMPONENTS SHALL BE MAXIMIZED TO REDUCE SPARE PART requirements.
- B. Manufacturers of equipment assemblies that include components made by others shall assume complete responsibility for final assembled unit.
 - 1. All components of an assembled unit need not be products of same manufacturer.
 - 2. Constituent parts that are alike shall be products of a single manufacturer.
 - 3. Components shall be compatible with each other and with the total assembly for intended service.
 - 4. Contractor shall guarantee performance of assemblies of components, and shall repair or replace elements of the assemblies as required to deliver specified performance of the complete assembly.
- C. Components of equipment shall bear manufacturer's name and trademark, model number, serial number and performance data on a name plate securely affixed in a conspicuous place, or cast integral with, stamped or otherwise permanently marked upon the components of the equipment.
- D. Major items of equipment, which serve the same function, shall be the same make and model

2.2 COMPATIBILITY OF RELATED EQUIPMENT

- A. Equipment and materials installed shall be compatible in all respects with other items being furnished and with existing items so that the result will be a complete and fully operational system that conforms to contract requirements.

2.3 SAFETY GUARDS

- A. Pump shafts and couplings shall be fully guarded by a sheet steel guard, covering coupling and shaft but not bearings. Material shall be minimum 16-gage sheet steel; ends shall be braked and drilled and attached to pump base with minimum of four 6 mm (1/4-inch) bolts. Reinforce guard as necessary to prevent side play forcing guard onto couplings.
- B. All Equipment shall have moving parts protected from personal injury.

2.4 LIFTING ATTACHMENTS

Equipment shall be provided with suitable lifting attachments to enable equipment to be lifted in its normal position. Lifting attachments shall withstand any handling conditions that might be encountered, without bending or distortion of shape, such as rapid lowering and braking of load.

2.5 ELECTRIC MOTORS, MOTOR CONTROL, CONTROL WIRING

- A. All material and equipment furnished and installation methods shall conform to the requirements of Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT; Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS; and, Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW). All electrical wiring, conduit, and devices necessary for the proper connection, protection and operation of the systems shall be provided. Premium efficient motors shall be provided. Unless otherwise specified for a particular application, electric motors shall have the following requirements.
- B. Special Requirements:
1. Where motor power requirements of equipment furnished deviate from power shown on plans, provide electrical service designed under the requirements of NFPA 70 without additional time or cost to the Government.
 2. Assemblies of motors, starters, and controls and interlocks on factory assembled and wired devices shall be in accordance with the requirements of this specification.
 3. Wire and cable materials specified in the electrical division of the specifications shall be modified as follows:
 - a. Wiring material located where temperatures can exceed 71° C (160° F) shall be stranded copper with Teflon FEP insulation with jacket. This includes wiring on the boilers.
 - b. Other wiring at boilers and to control panels shall be NFPA 70 designation THWN.
 - c. Shielded conductors or wiring in separate conduits for all instrumentation and control systems shall be provided where recommended by manufacturer of equipment.
 4. Motor sizes shall be selected so that the motors do not operate into the service factor at maximum required loads on the driven

- equipment. Motors on pumps shall be sized for non-overloading at all points on the pump performance curves.
5. Motors utilized with variable frequency drives shall be rated "inverter-ready" per NEMA Standard, MG1, Part 31.4.4.2.
- C. Motor Efficiency and Power Factor: All motors, when specified as "high efficiency or Premium Efficiency" by the project specifications on driven equipment, shall conform to efficiency and power factor requirements in Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT, with no consideration of annual service hours. Motor manufacturers generally define these efficiency requirements as "NEMA premium efficient" and the requirements generally exceed those of the Energy Policy Act of 1992 (EPACT). Motors not specified as "high efficiency or premium efficient" shall comply with EPACT.
- D. Single-phase Motors: Capacitor-start type for hard starting applications. Motors for centrifugal fans and pumps may be split phase or permanent split capacitor (PSC).
- E. Poly-phase Motors: NEMA Design B, Squirrel cage, induction type. Each two-speed motor shall have two separate windings. A time delay (20 seconds minimum) relay shall be provided for switching from high to low speed.
- F. Rating: Rating shall be continuous duty at 100 percent capacity in an ambient temperature of 40° C (104° F); minimum horsepower as shown on drawings; maximum horsepower in normal operation shall not exceed nameplate rating without service factor.
- G. Insulation Resistance: Not less than one-half meg-ohm between stator conductors and frame shall be measured at the time of final inspection.

2.7 EQUIPMENT AND MATERIALS IDENTIFICATION

- A. Use symbols, nomenclature and equipment numbers specified, shown on the drawings, or shown in the maintenance manuals. In addition, provide bar code identification nameplate for all equipment which will allow the equipment identification code to be scanned into the system for maintenance and inventory tracking. Identification for piping is specified in Section 09 91 00, PAINTING.
- B. Interior (Indoor) Equipment: Engraved nameplates, with letters not less than 48 mm (3/16-inch) high of brass with black-filled letters, or rigid black plastic with white letters specified in Section 09 91 00, PAINTING shall be permanently fastened to the equipment. Unit

components such as water heaters, tanks, coils, filters, fans, etc. shall be identified.

- C. Exterior (Outdoor) Equipment: Brass nameplates, with engraved black filled letters, not less than 48 mm (3/16-inch) high riveted or bolted to the equipment.
- D. Control Items: All temperature, pressure, and controllers shall be labeled and the component's function identified. Identify and label each item as they appear on the control diagrams.
- E. Valve Tags and Lists:
 - 1. Plumbing: All valves shall be provided with valve tags and listed on a valve list (Fixture stops not included).
 - 2. Valve tags: Engraved black filled numbers and letters not less than 13 mm (1/2-inch) high for number designation, and not less than 6.4 mm (1/4-inch) for service designation on 19 gage, 38 mm (1-1/2 inches) round brass disc, attached with brass "S" hook or brass chain.
 - 3. Valve lists: Valve lists shall be created using a word processing program and printed on plastic coated cards. The plastic coated valve list card(s), sized 216 mm (8-1/2 inches) by 280 mm (11 inches) shall show valve tag number, valve function and area of control for each service or system. The valve list shall be in a punched 3-ring binder notebook. A copy of the valve list shall be mounted in picture frames for mounting to a wall.
 - 4. A detailed plan for each floor of the building indicating the location and valve number for each valve shall be provided. Each valve location shall be identified with a color coded sticker or thumb tack in ceiling.

2.8 FIRE STOPPING

- A. Section 07 84 00, FIRESTOPPING specifies an effective barrier against the spread of fire, smoke and gases where penetrations occur for piping. Refer to Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION, for pipe insulation.

2.9 GALVANIZED REPAIR COMPOUND

- A. Mil. Spec. DOD-P-21035B, paint.

2.10 PIPE AND EQUIPMENT SUPPORTS AND RESTRAINTS

- A. In lieu of the paragraph which follows, suspended equipment support and restraints may be designed and installed in accordance with the International Building Code (IBC), latest edition. Submittals based on

the International Building Code (IBC), latest edition, SECTION 13 05 41 requirements, or the following paragraphs of this Section shall be stamped and signed by a professional engineer registered in a state where the project is located. The Support system of suspended equipment over 227 kg (500 pounds) shall be submitted for approval of the Resident Engineer in all cases. See these specifications for lateral force design requirements.

- B. Type Numbers Specified: MSS SP-58. For selection and application refer to MSS SP-69. Refer to Section 05 50 00, METAL FABRICATIONS, for miscellaneous metal support materials and prime coat painting.
- C. For Attachment to Concrete Construction:
 - 1. Concrete insert: Type 18, MSS SP-58.
 - 2. Self-drilling expansion shields and machine bolt expansion anchors: Permitted in concrete not less than 102 mm (4 inches) thick when approved by the Resident Engineer for each job condition.
 - 3. Power-driven fasteners: Permitted in existing concrete or masonry not less than 102 mm (4 inches) thick when approved by the Resident Engineer for each job condition.
- D. For Attachment to Steel Construction: MSS SP-58.
 - 1. Welded attachment: Type 22.
 - 2. Beam clamps: Types 20, 21, 28 or 29. Type 23 C-clamp may be used for individual copper tubing up to 23 mm (7/8-inch) outside diameter.
- E. Attachment to Metal Pan or Deck: As required for materials specified in Section 05 36 00, COMPOSITE METAL DECKING.
- F. For Attachment to Wood Construction: Wood screws or lag bolts.
- G. Hanger Rods: Hot-rolled steel, ASTM A36 or A575 for allowable load listed in MSS SP-58. For piping, provide adjustment means for controlling level or slope. Types 13 or 15 turn-buckles shall provide 38 mm (1-1/2 inches) minimum of adjustment and incorporate locknuts. All-thread rods are acceptable.
- H. Multiple (Trapeze) Hangers: Galvanized, cold formed, lipped steel channel horizontal member, not less than 41 mm by 41 mm (1-5/8 inches by 1-5/8 inches), 2.7 mm (No. 12 gage), designed to accept special spring held, hardened steel nuts. Trapeze hangers are not permitted for steam supply and condensate piping.
 - 1. Allowable hanger load: Manufacturers rating less 91kg (200 pounds).
 - 2. Guide individual pipes on the horizontal member of every other trapeze hanger with 6 mm (1/4-inch) U-bolt fabricated from steel

rod. Provide Type 40 insulation shield, secured by two 13 mm (1/2-inch) galvanized steel bands, or insulated calcium silicate shield for insulated piping at each hanger.

I. Pipe Hangers and Supports: (MSS SP-58), use hangers sized to encircle insulation on insulated piping. Refer to Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION for insulation thickness. To protect insulation, provide Type 39 saddles for roller type supports or insulated calcium silicate shields. Provide Type 40 insulation shield or insulated calcium silicate shield at all other types of supports and hangers including those for insulated piping.

1. General Types (MSS SP-58):

- a. Standard clevis hanger: Type 1; provide locknut.
- b. Riser clamps: Type 8.
- c. Wall brackets: Types 31, 32 or 33.
- d. Roller supports: Type 41, 43, 44 and 46.
- e. Saddle support: Type 36, 37 or 38.
- f. Turnbuckle: Types 13 or 15.
- g. U-bolt clamp: Type 24.
- h. Copper Tube:

- 1) Hangers, clamps and other support material in contact with tubing shall be painted with copper colored epoxy paint, plastic coated or taped with isolation tape to prevent electrolysis.
- 2) For vertical runs use epoxy painted or plastic coated riser clamps.
- 3) For supporting tube to strut: Provide epoxy painted pipe straps for copper tube or plastic inserted vibration isolation clamps.
- 4) Insulated Lines: Provide pre-insulated calcium silicate shields sized for copper tube.
- i. Supports for plastic or glass piping: As recommended by the pipe manufacturer with black rubber tape extending one inch beyond steel support or clamp. Spring Supports (Expansion and contraction of vertical piping):
 - 1) Movement up to 20 mm (3/4-inch): Type 51 or 52 variable spring unit with integral turn buckle and load indicator.

- 2) Movement more than 20 mm (3/4-inch): Type 54 or 55 constant support unit with integral adjusting nut, turn buckle and travel position indicator.
- j. Spring hangers are required on all plumbing system pumps one horsepower and greater.
2. Plumbing Piping (Other Than General Types):
 - a. Horizontal piping: Type 1, 5, 7, 9, and 10.
 - b. Chrome plated piping: Chrome plated supports.
 - c. Hangers and supports in pipe chase: Prefabricated system ABS self-extinguishing material, not subject to electrolytic action, to hold piping, prevent vibration and compensate for all static and operational conditions.
 - d. Blocking, stays and bracing: Angle iron or preformed metal channel shapes, 1.3 mm (18 gage) minimum.
- J. Pre-insulated Calcium Silicate Shields:
 1. Provide 360 degree water resistant high density 965 kPa (140 psi) compressive strength calcium silicate shields encased in galvanized metal.
 2. Pre-insulated calcium silicate shields to be installed at the point of support during erection.
 3. Shield thickness shall match the pipe insulation.
 4. The type of shield is selected by the temperature of the pipe, the load it must carry, and the type of support it will be used with.
 - a. Shields for supporting cold water shall have insulation that extends a minimum of one inch past the sheet metal.
 - b. The insulated calcium silicate shield shall support the maximum allowable water filled span as indicated in MSS-SP 69. To support the load, the shields shall have one or more of the following features: structural inserts 4138 kPa (600 psi) compressive strength, an extra bottom metal shield, or formed structural steel (ASTM A36) wear plates welded to the bottom sheet metal jacket.
 5. Shields may be used on steel clevis hanger type supports, roller supports or flat surfaces.

2.11 PIPE PENETRATIONS

- A. Pipe penetration sleeves shall be installed for all pipe other than rectangular blocked out floor openings for risers in mechanical bays.

- B. Pipe penetration sleeve materials shall comply with all fire stopping requirements for each penetration.
- C. To prevent accidental liquid spills from passing to a lower level, provide the following:
 - 1. For sleeves: Extend sleeve 25 mm (1 inch) above finished floor and provide sealant for watertight joint.
 - 2. For blocked out floor openings: Provide 40 mm (1-1/2 inch) angle set in silicone adhesive around opening.
 - 3. For drilled penetrations: Provide 40 mm (1-1/2 inch) angle ring or square set in silicone adhesive around penetration.
- C. Penetrations are not allowed through beams or ribs, but may be installed in concrete beam flanges. Any deviation from these requirements must receive prior approval of Resident Engineer.
- D. Sheet metal, plastic, or moisture resistant fiber sleeves shall be provided for pipe passing through floors, interior walls, and partitions, unless brass or steel pipe sleeves are specifically called for below.
- E. Cast iron or zinc coated pipe sleeves shall be provided for pipe passing through exterior walls below grade. The space between the sleeve and pipe shall be made watertight with a modular or link rubber seal. The link seal shall be applied at both ends of the sleeve.
- F. Galvanized steel or an alternate black iron pipe with asphalt coating sleeves shall be for pipe passing through concrete beam flanges, except where brass pipe sleeves are called for. A galvanized steel Sleeve shall be provided for pipe passing through floor of mechanical rooms, laundry work rooms, and animal rooms above basement. Except in mechanical rooms, sleeves shall be connected with a floor plate.
- G. Brass Pipe Sleeves shall be provided for pipe passing through quarry tile, terrazzo or ceramic tile floors. The sleeve shall be connected with a floor plate.
- H. Sleeve clearance through floors, walls, partitions, and beam flanges shall be 25 mm (1 inch) greater in diameter than external diameter of pipe. Sleeve for pipe with insulation shall be large enough to accommodate the insulation plus 25 mm (1 inch) in diameter. Interior openings shall be caulked tight with fire stopping material and sealant to prevent the spread of fire, smoke, and gases.
- I. Sealant and Adhesives: Shall be as specified in Section 07 92 00, JOINT SEALANTS.

2.12 TOOLS AND LUBRICANTS

- A. Furnish, and turn over to the Resident Engineer, special tools not readily available commercially, that are required for disassembly or adjustment of equipment and machinery furnished.
- B. Grease Guns with Attachments for Applicable Fittings: One for each type of grease required for each motor or other equipment.
- C. Tool Containers: metal, permanently identified for intended service and mounted, or located, where directed by the Resident Engineer.
- D. Lubricants: A minimum of 0.95 L (1 quart) of oil, and 0.45 kg (1 pound) of grease, of equipment manufacturer's recommended grade and type, in unopened containers and properly identified as to use for each different application.

2.13 WALL, FLOOR AND CEILING PLATES

- A. Material and Type: Chrome plated brass or chrome plated steel, one piece or split type with concealed hinge, with set screw for fastening to pipe, or sleeve. Use plates that fit tight around pipes, cover openings around pipes and cover the entire pipe sleeve projection.
- B. Thickness: Not less than 2.4 mm (3/32-inch) for floor plates. For wall and ceiling plates, not less than 0.64 mm (0.025-inch) for up to 80 mm (3 inch) pipe, 0.89 mm (0.035-inch) for larger pipe.
- C. Locations: Use where pipe penetrates floors, walls and ceilings in exposed locations, in finished areas only. Wall plates shall be used where insulation ends on exposed water supply pipe drop from overhead. A watertight joint shall be provided in spaces where brass or steel pipe sleeves are specified.

2.14 ASBESTOS

Materials containing asbestos are not permitted.

PART 3 - EXECUTION

3.1 ARRANGEMENT AND INSTALLATION OF EQUIPMENT AND PIPING

- A. Location of piping, sleeves, inserts, hangers, and equipment, access provisions shall be coordinated with the work of all trades. Piping, sleeves, inserts, hangers, and equipment shall be located clear of windows, doors, openings, light outlets, and other services and utilities. Equipment layout drawings shall be prepared to coordinate proper location and personnel access of all facilities. The drawings shall be submitted for review.

Manufacturer's published recommendations shall be followed for installation methods not otherwise specified.

- B. Operating Personnel Access and Observation Provisions: All equipment and systems shall be arranged to provide clear view and easy access, without use of portable ladders, for maintenance and operation of all devices including, but not limited to: all equipment items, valves, filters, strainers, transmitters, sensors, control devices. All gages and indicators shall be clearly visible by personnel standing on the floor or on permanent platforms. Maintenance and operating space and access provisions that are shown on the drawings shall not be changed nor reduced.
- C. Structural systems necessary for pipe and equipment support shall be coordinated to permit proper installation.
- D. Location of pipe sleeves, trenches and chases shall be accurately coordinated with equipment and piping locations.
- E. Cutting Holes:
1. Holes through concrete and masonry shall be cut by rotary core drill. Pneumatic hammer, impact electric, and hand or manual hammer type drill will not be allowed, except as permitted by RE/COTR where working area space is limited.
 2. Holes shall be located to avoid interference with structural members such as beams or grade beams. Holes shall be laid out in advance and drilling done only after approval by RE/COTR. If the Contractor considers it necessary to drill through structural members, this matter shall be referred to RE/COTR for approval.
 3. Waterproof membrane shall not be penetrated. Pipe floor penetration block outs shall be provided outside the extents of the waterproof membrane.
- F. Interconnection of Instrumentation or Control Devices: Generally, electrical and pneumatic interconnections are not shown but must be provided.
- G. Minor Piping: Generally, small diameter pipe runs from drips and drains, water cooling, and other service are not shown but must be provided.
- H. Protection and Cleaning:
1. Equipment and materials shall be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations and as approved by the Resident Engineer. Damaged or defective items in the opinion of the Resident Engineer, shall be replaced.

2. Protect all finished parts of equipment, such as shafts and bearings where accessible, from rust prior to operation by means of protective grease coating and wrapping. Close pipe openings with caps or plugs during installation. Pipe openings, equipment, and plumbing fixtures shall be tightly covered against dirt or mechanical injury. At completion of all work thoroughly clean fixtures, exposed materials and equipment.
- I. Concrete and Grout: Concrete and shrink compensating grout 25 MPa (3000 psi) minimum, specified in Section 03 30 00, CAST-IN-PLACE CONCRETE. shall be used for all pad or floor mounted equipment. Gages, thermometers, valves and other devices shall be installed with due regard for ease in reading or operating and maintaining said devices. Thermometers and gages shall be located and positioned to be easily read by operator or staff standing on floor or walkway provided. Servicing shall not require dismantling adjacent equipment or pipe work.
- J. Interconnection of Controls and Instruments: Electrical interconnection is generally not shown but shall be provided. This includes interconnections of sensors, transmitters, transducers, control devices, control and instrumentation panels, instruments and computer workstations. Comply with NFPA-70.
- K. Many plumbing systems interface with the HVAC control system. See the HVAC control points list and section 23 09 23 DIRECT DIGITAL CONTROLS FOR HVAC
- L. Work in Existing Building:
 1. Perform as specified in Article, OPERATIONS AND STORAGE AREAS, Article, ALTERATIONS, and Article, RESTORATION of the Section 01 00 00, GENERAL REQUIREMENTS for relocation of existing equipment, alterations and restoration of existing building(s).
 2. As specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, OPERATIONS AND STORAGE AREAS, make alterations to existing service piping at times that will cause the least interfere with normal operation of the facility.
- N. Work in bathrooms, restrooms, housekeeping closets: All pipe penetrations behind escutcheons shall be sealed with plumbers putty.
- O. Switchgear Drip Protection: Every effort shall be made to eliminate the installation of pipe above electrical and telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints.

P. Inaccessible Equipment:

1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, equipment shall be removed and reinstalled or remedial action performed as directed at no additional cost to the Government.
2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as electrical conduit, motors, fans, pumps, belt guards, transformers, high voltage lines, piping, and ductwork.

3.2 TEMPORARY PIPING AND EQUIPMENT

- A. Continuity of operation of existing facilities may require temporary installation or relocation of equipment and piping. Temporary equipment or pipe installation or relocation shall be provided to maintain continuity of operation of existing facilities.
- B. The Contractor shall provide all required facilities in accordance with the requirements of phased construction and maintenance of service. All piping and equipment shall be properly supported, sloped to drain, operate without excessive stress, and shall be insulated where injury can occur to personnel by contact with operating facilities. The requirements of Para. 3.1 shall apply.
- C. Temporary facilities and piping shall be completely removed and any openings in structures sealed. Necessary blind flanges and caps shall be provided to seal open piping remaining in service.

3.3 RIGGING

- A. Openings in building structures shall be planned to accommodate design scheme.
- B. Alternative methods of equipment delivery may be offered and will be considered by Government under specified restrictions of phasing and service requirements as well as structural integrity of the building.
- C. All openings in the building shall be closed when not required for rigging operations to maintain proper environment in the facility for Government operation and maintenance of service.
- D. Contractor shall provide all facilities required to deliver specified equipment and place on foundations. Attachments to structures for rigging purposes and support of equipment on structures shall be Contractor's full responsibility.

- E. Contractor shall check all clearances, weight limitations and shall provide a rigging plan designed by a Registered Professional Engineer. All modifications to structures, including reinforcement thereof, shall be at Contractor's cost, time and responsibility.
- F. Rigging plan and methods shall be referred to RE/COTR for evaluation prior to actual work.

3.4 PIPE AND EQUIPMENT SUPPORTS

- A. Where hanger spacing does not correspond with joist or rib spacing, use structural steel channels secured directly to joist and rib structure that will correspond to the required hanger spacing, and then suspend the equipment and piping from the channels. Holes shall be drilled or burned in structural steel ONLY with the prior written approval of the Resident Engineer.
- B. The use of chain pipe supports, wire or strap hangers; wood for blocking, stays and bracing, or hangers suspended from piping above shall not be permitted. Rusty products shall be replaced.
- C. Hanger rods shall be used that are straight and vertical. Turnbuckles for vertical adjustments may be omitted where limited space prevents use. A minimum of 15 mm (1/2-inch) clearance between pipe or piping covering and adjacent work shall be provided.
- D. For horizontal and vertical plumbing pipe supports, refer to the International Plumbing Code (IPC), latest edition, and these specifications.
- E. Overhead Supports:
 - 1. The basic structural system of the building is designed to sustain the loads imposed by equipment and piping to be supported overhead.
 - 2. Provide steel structural members, in addition to those shown, of adequate capability to support the imposed loads, located in accordance with the final approved layout of equipment and piping.
 - 3. Tubing and capillary systems shall be supported in channel troughs.
- F. Floor Supports:
 - 1. Provide concrete bases, concrete anchor blocks and pedestals, and structural steel systems for support of equipment and piping. Concrete bases and structural systems shall be anchored and doweled to resist forces under operating and seismic conditions (if applicable) without excessive displacement or structural failure.
 - 2. Bases and supports shall not be located and installed until equipment mounted thereon has been approved. Bases shall be sized

- to match equipment mounted thereon plus 50 mm (2 inch) excess on all edges. Structural drawings shall be reviewed for additional requirements. Bases shall be neatly finished and smoothed, shall have chamfered edges at the top, and shall be suitable for painting.
3. All equipment shall be shimmed, leveled, firmly anchored, and grouted with epoxy grout. Anchor bolts shall be placed in sleeves, anchored to the bases. Fill the annular space between sleeves and bolts with a grout material to permit alignment and realignment.

3.5 LUBRICATION

- A. All equipment and devices requiring lubrication shall be lubricated prior to initial operation. All devices and equipment shall be field checked for proper lubrication.
- B. All devices and equipment shall be equipped with required lubrication fittings. A minimum of one liter (one quart) of oil and 0.5 kg (one pound) of grease of manufacturer's recommended grade and type for each different application shall be provided. All materials shall be delivered to RE/COTR in unopened containers that are properly identified as to application.
- C. A separate grease gun with attachments for applicable fittings shall be provided for each type of grease applied.
- D. All lubrication points shall be accessible without disassembling equipment, except to remove access plates.
- E. All lubrication points shall be extended to one side of the equipment.

3.6 PLUMBING SYSTEMS DEMOLITION

- A. Rigging access, other than indicated on the drawings, shall be provided after approval for structural integrity by the RE/COTR. Such access shall be provided without additional cost or time to the Government. Where work is in an operating plant, approved protection from dust and debris shall be provided at all times for the safety of plant personnel and maintenance of plant operation and environment of the plant.
- B. In an operating plant, cleanliness and safety shall be maintained. The plant shall be kept in an operating condition. Government personnel will be carrying on their normal duties of operating, cleaning and maintaining equipment and plant operation. Work shall be confined to the immediate area concerned; maintain cleanliness and wet down demolished materials to eliminate dust. Dust and debris shall not be permitted to accumulate in the area to the detriment of plant operation. All flame cutting shall be performed to maintain the fire

safety integrity of this plant. Adequate fire extinguishing facilities shall be available at all times. All work shall be performed in accordance with recognized fire protection standards. Inspections will be made by personnel of the VA Medical Center, and the Contractor shall follow all directives of the RE or COTR with regard to rigging, safety, fire safety, and maintenance of operations.

- C. Unless specified otherwise, all piping, wiring, conduit, and other devices associated with the equipment not re-used in the new work shall be completely removed from Government property. This includes all concrete equipment pads, pipe, valves, fittings, insulation, and all hangers including the top connection and any fastenings to building structural systems. All openings shall be sealed after removal of equipment, pipes, ducts, and other penetrations in roof, walls, floors, in an approved manner and in accordance with plans and specifications where specifically covered. Structural integrity of the building system shall be maintained. Reference shall also be made to the drawings and specifications of the other disciplines in the project for additional facilities to be demolished or handled.
- D. All valves including gate, globe, ball, butterfly and check, all pressure gages and thermometers with wells shall remain Government property and shall be removed and delivered to RE/COTR and stored as directed. The Contractor shall remove all other material and equipment, devices and demolition debris under these plans and specifications. Such material shall be removed from Government property expeditiously and shall not be allowed to accumulate.

3.7 CLEANING AND PAINTING

- A. Prior to final inspection and acceptance of the plant and facilities for beneficial use by the Government, the plant facilities, equipment and systems shall be thoroughly cleaned and painted. Refer to Section 09 91 00, PAINTING.
- B. In addition, the following special conditions apply:
 - 1. Cleaning shall be thorough. Solvents, cleaning materials and methods recommended by the manufacturers shall be used for the specific tasks. All rust shall be removed prior to painting and from surfaces to remain unpainted. Scratches, scuffs, and abrasions shall be repaired prior to applying prime and finish coats.
 - 2. The following Material And Equipment shall NOT be painted::
 - a. Motors, controllers, control switches, and safety switches.

- b. Control and interlock devices.
 - c. Regulators.
 - d. Pressure reducing valves.
 - e. Control valves and thermostatic elements.
 - f. Lubrication devices and grease fittings.
 - g. Copper, brass, aluminum, stainless steel and bronze surfaces.
 - h. Valve stems and rotating shafts.
 - i. Pressure gages and thermometers.
 - j. Glass.
 - k. Name plates.
- 3. Control and instrument panels shall be cleaned and damaged surfaces repaired. Touch-up painting shall be made with matching paint obtained from manufacturer or computer matched.
 - 4. Pumps, motors, steel and cast iron bases, and coupling guards shall be cleaned, and shall be touched-up with the same color as utilized by the pump manufacturer
 - 5. Temporary Facilities: Apply paint to surfaces that do not have existing finish coats.
 - 6. The final result shall be a smooth, even-colored, even-textured factory finish on all items. The entire piece of equipment shall be repainted, if necessary, to achieve this.

3.8 IDENTIFICATION SIGNS

- A. Laminated plastic signs, with engraved lettering not less than 5 mm (3/16-inch) high, shall be provided that designates equipment function, for all equipment, switches, motor controllers, relays, meters, control devices, including automatic control valves. Nomenclature and identification symbols shall correspond to that used in maintenance manual, and in diagrams specified elsewhere. Attach by chain, adhesive, or screws.
- B. Factory Built Equipment: Metal plate, securely attached, with name and address of manufacturer, serial number, model number, size, performance shall be placed on factory built equipment.
- C. Pipe Identification: Refer to Section 09 91 00, PAINTING.

3.9 STARTUP AND TEMPORARY OPERATION

- A. Start up of equipment shall be performed as described in the equipment specifications. Vibration within specified tolerance shall be verified prior to extended operation. Temporary use of equipment is specified in

Section 01 00 00, GENERAL REQUIREMENTS, Article, TEMPORARY USE OF
MECHANICAL AND ELECTRICAL EQUIPMENT.

3.10 OPERATING AND PERFORMANCE TESTS

- A. Prior to the final inspection, all required tests shall be performed as specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TESTS and submit the test reports and records to the Resident Engineer.
- B. Should evidence of malfunction in any tested system, or piece of equipment or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost to the Government.
- C. When completion of certain work or system occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then make performance tests such systems respectively during first actual seasonal use of respective systems following completion of work.

3.11 OPERATION AND MAINTENANCE MANUALS

- A. Provide four bound copies. The Operations and maintenance manuals shall be delivered to RE/COTR not less than 30 days prior to completion of a phase or final inspection.
- B. All new and temporary equipment and all elements of each assembly shall be included.
- C. Data sheet on each device listing model, size, capacity, pressure, speed, horsepower, impeller size, and other information shall be included.
- D. Manufacturer's installation, maintenance, repair, and operation instructions for each device shall be included. Assembly drawings and parts lists shall also be included. A summary of operating precautions and reasons for precautions shall be included in the Operations and Maintenance Manual.
- E. Lubrication instructions, type and quantity of lubricant shall be included.
- F. Schematic diagrams and wiring diagrams of all control systems corrected to include all field modifications shall be included.
- G. Set points of all interlock devices shall be listed.
- H. Trouble-shooting guide for the control system troubleshooting guide shall be inserted into the Operations and Maintenance Manual.

I. The combustion control system sequence of operation corrected with
submittal review comments shall be inserted into the Operations and
Maintenance Manual.

J. Emergency procedures.

3.12 INSTRUCTIONS TO VA PERSONNEL

Instructions shall be provided in accordance with Article,
INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.

- - - E N D - - -

SECTION 22 05 12
GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT

PART 1 - GENERAL

1.1 DESCRIPTION:

This section describes the general motor requirements for plumbing equipment.

1.2 RELATED WORK:

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements common to more than one section of Division 26.
- B. 26 29 11, LOW-VOLTAGE MOTOR STARTERS: Starters, control and protection of motors: Section

1.3 SUBMITTALS:

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Shop Drawings:
 - 1. Sufficient information, clearly presented, shall be included to determine compliance with drawings and specifications.
 - 2. Motor nameplate information shall be submitted including electrical ratings, dimensions, mounting details, materials, horsepower, power factor, current as a function of speed, current efficiency, speed as a function of load, RPM, enclosure, starting characteristics, torque characteristics, code letter, full load and locked rotor current, service factor, and lubrication method.
 - 3. Motor parameters required for the determination of the Reed Critical Frequency of vertical hollow shaft motors shall be submitted.
- C. Manuals:
 - 1. Companion copies of complete maintenance and operating manuals, including technical data sheets and application data shall be submitted simultaneously with the shop drawings.
- D. Certification: Two weeks prior to final inspection, unless otherwise noted, four copies of the following certification shall be submitted to the Resident Engineer:
 - 1. Certification shall be submitted stating that the motors have been properly applied, installed, adjusted, lubricated, and tested.

1.4 APPLICABLE PUBLICATIONS:

- A. The publications listed below (including amendments, addenda, revisions, supplements and errata) shall form a part of this

specification to the extent referenced. Publications are referenced in the text by designation only.

B. National Electrical Manufacturers Association (NEMA):

MG 1-07.....Motors and Generators

MG 2-01.....Safety Standard and Guide for Selection,
Installation and Use of Electric Motors and
Generators

C. National Fire Protection Association (NFPA):

70-08.....National Electrical Code (NEC)

PART 2 - PRODUCTS

2.1 MOTORS:

A. For alternating current, fractional and integral horsepower motors, NEMA Publications MG 1 and MG 2 shall apply.

B. Voltage ratings shall be as follows:

1. Single phase:

- a. Motors connected to 120-volt systems: 115 volts.
- b. Motors connected to 208-volt systems: 200 volts.
- c. Motors connected to 240 volt or 480 volt systems: 230/460 volts, dual connection.

2. Three phase:

- a. Motors connected to 208-volt systems: 200 volts.
- b. Motors, less than 74.6 kW (100 HP), connected to 240 volt or 480 volt systems: 230/460 volts, dual connection.
- c. Motors, 74.6 kW (100 HP) or larger, connected to 240-volt systems: 230 volts.
- d. Motors, 74.6 kW (100 HP) or larger, connected to 480-volt systems: 460 volts.
- e. Motors connected to high voltage systems: Shall conform to NEMA Standards for connection to the nominal system voltage shown on the drawings.

C. Number of phases shall be as follows:

- 1. Motors, less than 373 W (1/2 HP): Single phase.
- 2. Motors, 373 W (1/2 HP) and larger: 3 phase.
- 3. Exceptions:
 - a. Hermetically sealed motors.
 - b. Motors for equipment assemblies, less than 746 W (1 HP), may be single phase provided the manufacturer of the proposed assemblies cannot supply the assemblies with three phase motors.

- D. Horsepower ratings shall be adequate for operating the connected loads continuously in the prevailing ambient temperatures in areas where the motors are installed, without exceeding the NEMA standard temperature rises for the motor insulation.
- E. Motor designs, as indicated by the NEMA code letters, shall be coordinated with the connected loads to assure adequate starting and running torque.
- F. Motor Enclosures:
 - 1. Shall be the NEMA types shown on the drawings for the motors.
 - 2. Where the types of motor enclosures are not shown on the drawings, they shall be the NEMA types, which are most suitable for the environmental conditions where the motors are being installed.
 - 3. Enclosures shall be primed and finish coated at the factory with manufacturer's prime coat and standard finish.
 - 4. All motors in hazardous locations shall be approved for the application and meet the Class and Group as required by the area classification.
- G. Electrical Design Requirements
 - 1. Motors shall be continuous duty.
 - 2. The insulation system shall be rated minimum of class B, 130° C (266° F).
 - 3. The maximum temperature rise by resistance at rated power shall not exceed Class B limits, 80° C (176° F).
 - 4. The speed/torque and speed/current characteristics shall comply with NEMA Design A or B, as specified.
 - 5. Motors shall be suitable for full voltage starting, unless otherwise noted.
 - 6. Motors for variable frequency drive applications shall adhere to NEMA standards publication MG 1, Part 30, Application considerations for Constant Speed Motors Used on a Sinusoidal Bus with Harmonic Content and General Purpose Motors Used with Adjustable voltage or Adjustable frequency controls, or both, or Part 31, Definite Purpose Inverter Fed Polyphase Motors.
- H. Mechanical Design Requirements
 - 1. Bearings shall be rated for a minimum of 26,280 hours L-10 life at full load direct coupled, except vertical high thrust motors.
 - 2. Vertical motors shall be capable of withstanding a momentary up thrust of at least 30% of normal down thrust.

3. Grease lubricated bearings shall be designed for electric motor use. Grease shall be capable of the temperatures associated with electric motors and shall be compatible with Polyurea based greases.
4. Grease fittings, if provided, shall be Alemite type or equivalent.
5. Oil lubricated bearings, when specified, shall have an externally visible sight glass to view oil level.
6. Vibration shall not exceed 0.15 inch per second, unfiltered peak.
7. Noise level shall meet the requirements of the application.
8. Motors on 180 frames and larger shall have provisions for lifting eyes or lugs capable of a safety factor of 5.
9. All external fasteners shall be corrosion resistant.
10. Condensation heaters, when specified, shall keep motor windings at least 5° C (41° F) above ambient temperature.
11. Winding thermostats, when specified shall be normally closed, connected in series.
12. Grounding provisions shall be in the main terminal box.
- I. Additional requirements for specific motors, as indicated in other sections, shall also apply.
- J. NEMA Premium Efficiency Electric Motors, Motor Efficiencies: All permanently wired polyphase motors of 746 Watts (1 Horsepower) or more shall meet the minimum full-load efficiencies as indicated in the following table, and as specified in this specification. Motors of 746 Watts (one horsepower) or more with open, drip-proof or totally enclosed fan-cooled enclosures shall be NEMA premium efficiency type, unless otherwise indicated. Motors provided as an integral part of motor driven equipment are excluded from this requirement if a minimum seasonal or overall efficiency requirement is indicated for that equipment by the provisions of another section.

Minimum Efficiencies Open Drip-Proof				Minimum Efficiencies Totally Enclosed Fan-Cooled			
Rating kW (HP)	1200 RPM	1800 RPM	3600 RPM	Rating kW (HP)	1200 RPM	1800 RPM	3600 RPM
0.746 (1)	82.5%	85.5%	77.0%	0.746 (1)	82.5%	85.5%	77.0%
1.12 (1.5)	86.5%	86.5%	84.0%	1.12 (1.5)	87.5%	86.5%	84.0%
1.49 (2)	87.5%	86.5%	85.5%	1.49 (2)	88.5%	86.5%	85.5%
2.24 (3)	88.5%	89.5%	85.5%	2.24 (3)	89.5%	89.5%	86.5%
3.73 (5)	89.5%	89.5%	86.5%	3.73 (5)	89.5%	89.5%	88.5%
5.60 (7.5)	90.2%	91.0%	88.5%	5.60 (7.5)	91.0%	91.7%	89.5%
7.46 (10)	91.7%	91.7%	89.5%	7.46 (10)	91.0%	91.7%	90.2%
11.2 (15)	91.7%	93.0%	90.2%	11.2 (15)	91.7%	92.4%	91.0%
14.9 (20)	92.4%	93.0%	91.0%	14.9 (20)	91.7%	93.0%	91.0%
18.7 (25)	93.0%	93.6%	91.7%	18.7 (25)	93.0%	93.6%	91.7%
22.4 (30)	93.6%	94.1%	91.7%	22.4 (30)	93.0%	93.6%	91.7%
29.8 (40)	94.1%	94.1%	92.4%	29.8 (40)	94.1%	94.1%	92.4%
37.3 (50)	94.1%	94.5%	93.0%	37.3 (50)	94.1%	94.5%	93.0%
44.8 (60)	94.5%	95.0%	93.6%	44.8 (60)	94.5%	95.0%	93.6%
56.9 (75)	94.5%	95.0%	93.6%	56.9 (75)	94.5%	95.4%	93.6%
74.6 (100)	95.0%	95.4%	93.6%	74.6 (100)	95.0%	95.4%	94.1%
93.3 (125)	95.0%	95.4%	94.1%	93.3 (125)	95.0%	95.4%	95.0%
112 (150)	95.4%	95.8%	94.1%	112 (150)	95.8%	95.8%	95.0%
149.2 (200)	95.4%	95.8%	95.0%	149.2 (200)	95.8%	96.2%	95.4%

K. Minimum Power Factor at Full Load and Rated Voltage: 90 percent at 1200 RPM, 1800 RPM and 3600 RPM. Power factor correction capacitors shall be installed unless the motor is controlled by a variable frequency drive. The power factor correction capacitors shall be able to withstand high voltage transients and power line variations without breakdown.

PART 3 - EXECUTION

3.1 INSTALLATION:

Install motors in accordance with manufacturer's recommendations, the NEC, NEMA, as shown on the drawings and/or as required by other sections of these specifications.

3.2 FIELD TESTS

Megger all motors after installation, before start-up. All shall test
free from grounds.

- - - E N D - - -

SECTION 22 05 19
METERS AND GAGES FOR PLUMBING PIPING

PART 1 - GENERAL

1.1 DESCRIPTION

This section describes the requirements for pressure gages.

1.2 RELATED WORK

Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 - 2. Pressure Gages.
 - 3. BACnet communication protocol
 - 4. Product certificates for each type of gauge
- C. Operations and Maintenance manual shall include:
 - 1. System Description
 - 2. Major assembly block diagrams
 - 3. Troubleshooting and preventive maintenance guidelines
 - 4. Spare parts information.
- D. Shop Drawings shall include the following:
 - 1. One line, wiring and terminal diagrams including terminals identified, protocol or communication modules, and Ethernet connections.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standards Institute (ANSI):
 - American Society of Mechanical Engineers (ASME): (Copyrighted Society)
 - B40.1-05Gauges-Pressure Indicating Dial Type-Elastic
- C. American Water Works Association (AWWA):
 - C700-07 (R 2003)Standard for Cold Water Meters, Displacement Type, Bronze Main Case
 - C701-07Cold Water Meters-Turbine Type, for Customer Service AWWA/ ANSI
 - C702-01Cold water meters - Compound Type
- D. International Code Council (ICC):
 - IPC-06(2007 Supplement) International Plumbing Code

1.5 AS-BUILT DOCUMENTATION

- A. The electronic documentation and copies of the Operations and Maintenance Manual, approved submittals, shop drawings, and other closeout documentation shall be prepared by a computer software program complying with Section 508 of the Rehabilitation Act of 1973, as amended (29 U.S.C 794d). The manufacturer or vendor of the software used to prepare the electronic documentation shall have a Voluntary Product Accessibility Template made available for review and included as part of the Operations and Maintenance Manual or closeout documentation. All available accessibility functions listed in the Voluntary Accessibility Template shall be enabled in the prepared electronic files. As Adobe Acrobat is a common industry format for such documentation, following the document, "Creating Accessible Adobe PDF files, A Guide for Document Authors" that is maintained and made available by Adobe free of charge is recommended."
- B. Four sets of manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.
- C. Four sets of operation and maintenance data updated to include submittal review comments shall be inserted into a three ring binder. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices such as damper and door closure interlocks shall be included. A List of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.

PART 2 - PRODUCTS

2.7 PRESSURE GAGES FOR WATER AND SEWAGE USAGE

- A. ANSI B40.1 all metal case 114 mm (4-1/2 inches) diameter, bottom connected throughout, graduated as required for service, and identity labeled. Range shall be 0 to 1375 kPa (0 to 200 psi) gauge.
- B. The pressure element assembly shall be bourdon tube. The mechanical movement shall be lined to pressure element and connected to pointer.

- C. The dial shall be non-reflective aluminum with permanently etched scale markings graduated in kPa and psi.
- D. The pointer shall be dark colored metal.
- E. The window shall be glass.
- F. The ring shall be brass or stainless steel.
- G. The accuracy shall be grade A, plus or minus 1 percent of middle half of scale range.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Direct mounted pressure gages shall be installed in piping tees with pressure gage located on pipe at the most readable position.
- B. Valves and snubbers shall be installed in piping for each pressure gage.
- C. Test plugs shall be installed on the inlet and outlet pipes all heat exchangers or water heaters serving more than one plumbing fixture.
- D. Pressure gages shall be installed where indicated on the drawings and at the following locations:
 - 1. Building water service entrance into building
 - 2. Inlet and outlet of each pressure reducing valve
 - 3. Suction and discharge of each domestic water pump or re-circulating hot water return pump.

3.2 FIELD QUALITY CONTROL

3.3 TRAINING

- A. A training course shall be provided to the medical center on meter configuration and maintenance. Training manuals shall be supplied for all attendee with four additional copies supplied. The training course shall cover meter configuration, troubleshooting, and diagnostic procedures.

- - - E N D - - -

SECTION 22 05 23
GENERAL-DUTY VALVES FOR PLUMBING PIPING

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section describes the requirements for general-duty valves for domestic water and sewer systems.

1.2 RELATED WORK

- A. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
1. Valves.
 2. Backflow Preventers.
 3. Pressure Reducing Valves.
 4. Backwater Valves. All items listed in Part 2 - Products.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):A536-84(R 2004)
Standard Specification for Ductile Iron Castings
- C. American Society of Sanitary Engineering (ASSE)
ASSE 1003-01 (R 2003) ..Performance Requirements for Water Pressure Reducing Valves
ASSE 1012-02Backflow Preventer with Intermediate Atmospheric Vent
ASSE 1013-05Reduced Pressure Principle Backflow Preventers and Reduced Pressure Fire Protection Principle Backflow Preventers
- D. International Code Council (ICC)
IPC-06 (R 2007)International Plumbing Code
- E. Manufacturers Standardization Society of the Valve and Fittings Industry, Inc. (MSS):
SP-25-98Standard Marking System for Valves, Fittings, Flanges and UnionsSP-67-02a (R 2004) Butterfly Valve of the Single flange Type (Lug Wafer)

SP-70-06Cast Iron Gate Valves, Flanged and Threaded
Ends.

SP-72-99Ball Valves With Flanged or Butt Welding For
General Purpose

SP-80-03Bronze Gate, Globe, Angle and Check Valves.

SP-110-96Ball Valve Threaded, Socket Welding, Solder
Joint, Grooved and Flared Ends

1.5 DELIVERY, STORAGE, AND HANDLING

A. Valves shall be prepared for shipping as follows:

1. Protect internal parts against rust and corrosion.
2. Protect threads, flange faces, grooves, and weld ends.
3. Set angle, gate, and globe valves closed to prevent rattling.
4. Set ball and plug valves open to minimize exposure of functional surfaces
5. Set butterfly valves closed or slightly open.
6. Block check valves in either closed or open position.

B. Valves shall be prepared for storage as follows:

1. Maintain valve end protection.
2. Store valves indoors and maintain at higher than ambient dew point temperature.

C. A sling shall be used for large valves. The sling shall be rigged to avoid damage to exposed parts. Hand wheels or stems shall not be used as lifting or rigging points.

PART 2 - PRODUCTS

2.1 VALVES

- A. Asbestos packing and gaskets are prohibited.
- B. Bronze valves shall be made with dezincification resistant materials. Bronze valves made with copper alloy (brass) containing more than 15 percent zinc shall not be permitted.
- C. Valves in insulated piping shall have 50 mm or DN50 (2 inch) stem extensions and extended handles of non-thermal conductive material that allows operating the valve without breaking the vapor seal or disturbing the insulation. Memory stops shall be fully adjustable after insulation is applied.
- D. Exposed Valves over 65 mm or DN65 (2-1/2 inches) installed at an elevation over 3.6 meters (12 feet) shall have a chain-wheel attachment to valve hand-wheel, stem, or other actuator.

E. Ball valves, pressure regulating valves, gate valves, globe valves, and plug valves used to supply potable water shall meet the requirements of NSF 61.

F. Shut-off:

1. Cold, Hot and Re-circulating Hot Water:

a. 50 mm or DN50 (2 inches) and smaller: Ball, MSS SP-72, SP-110, Ball valve shall be full port three piece or two piece with a union design with adjustable stem package. Threaded stem designs are not allowed. The ball valve shall have a SWP rating of 1035 kPa (150 psig) and a CWP rating of 4140 kPa (600 psig). The body material shall be Bronze ASTM B584, Alloy C844. The ends shall be solder,

b. Less than 100 mm DN100 (4 inches): Butterfly shall have an iron body with EPDM seal and aluminum bronze disc. The butterfly valve shall meet MSS SP-67, type I standard. The butterfly valve shall have a SWP rating of 1380 kPa (200 psig). The valve design shall be lug type suitable for bidirectional dead-end service at rated pressure. The body material shall meet ASTM A 536, ductile iron.

c. 100 mm (DN100) (4 inches) and larger:

1) Class 125, OS&Y, Cast Iron Gate Valve. The gate valve shall meet MSS-SP-70 type I standard. The gate valve shall have a CWP rating of 1380 kPa (200 psig). The valve materials shall meet ASTM A 126, grey iron with bolted bonnet, flanged ends, bronze trim, and solid wedge disc. The gate valve shall be gear operated for sizes under 200 mms or DN200 (8 inches) and crank operated for sizes 200 mms or DN200 (8 inches) and above

2) Single flange, ductile iron butterfly valves: The single flanged butterfly valve shall meet the MSS SP-67 standard. The butterfly valve shall have a CWP rating of 1380 kPa (200 psig). The butterfly valve shall be lug type, suitable for bidirectional dead-end service at rated pressure without use of downstream flange. The body material shall comply with ASTM A536 ductile iron. The seat shall be EPDM with stainless steel disc and stem.

3) Grooved end, ductile iron butterfly valves. The grooved butterfly valve shall meet the MSS SP-67 standard. The grooved butterfly valve shall have a CWP rating of 1380 kPa

(200 psig). The valve materials shall be polyamide coated ductile iron conforming to ASTM A536 with two piece stainless steel stem, EPDM encapsulated ductile iron disc, and EPDM seal. The butterfly valve shall be gear operated

2. Reagent Grade Water: Valves for reagent grade, reverse osmosis, or deionized water service shall be ball type of same material as used for pipe.

C. Balancing:

1. Hot Water Re-circulating, 80 mm or DN80 (3 inches) and smaller manual balancing valve shall be of bronze body, brass ball construction with glass and carbon filled TFE seat rings and designed for positive shutoff. The manual balancing valve shall have differential pressure read-out ports across the valve seat area. The read out ports shall be fitting with internal EPT inserts and check valves. The valve body shall have 8 mm or DN8 NPT ($\frac{1}{4}$ " NPT) tapped drain and purge port. The valves shall have memory stops that allow the valve to close for service and then reopened to set point without disturbing the balance position. All valves shall have calibrated nameplates to assure specific valve settings.
2. Larger than 80 mm or DN80 (3 inches): Manual balancing valves shall be of heavy duty cast iron flanged construction with 862 kPa (125 psi) flange connections. The flanged manual balancing valves shall have either a brass ball with glass and carbon filled TFE seal rings or fitted with a bronze seat, replaceable bronze disc with EPDM seal insert and stainless steel stem. The design pressure shall be 1207 kPa (175) at 121 deg C (250 deg F).

D. Check:

1. Check valves less than 80 mm or DN80 (3 inches) and smaller) shall be class 125, bronze swing check valves with non metallic Buna-N disc. The check valve shall meet MSS SP-80 Type 4 standard. The check valve shall have a CWP rating of 1380 kPa (200 psig). The check valve shall have a Y pattern horizontal body design with bronze body material conforming to ASTM B 62, solder joints, and PTFE or TFE disc.
2. Larger than 100 mm or DN100 (4 inches and larger):
 - a. Check valves shall be class 125, iron swing check valve with lever and weight closure control. The check valve shall meet MSS SP-71 Type I standard. The check valve shall have a CWP rating

of 1380 kPa (200 psig). The check valve shall have a clear or full waterway body design with gray iron body material conforming to ASTM A 126, bolted bonnet, flanged ends, bronze trim.

- b. All check valves on the discharge side of submersible sump sumps shall have factory installed exterior level and weight with sufficient weight to prevent the check valve from hammering against the seat when the sump pump stops.

E. Globe:

- 1. 80 mm or DN80 (3 inches) or smaller: Class 150, bronze globe valve with non metallic disc. The globe valve shall meet MSS SP-80, Type 2 standard. The globe valve shall have a CWP rating of 2070 kPa (300 psig). The valve material shall be bronze with integral seal and union ring bonnet conforming to ASTM B 62 with solder ends, copper-silicon bronze stem, TPF E or TFE disc, malleable iron hand wheel.
- 2. Larger than 80 mm or DN80 (3 inches): Similar to above, except with cast iron body and bronze trim, class 125, iron globe valve. The globe valve shall meet MSS SP-85, Type 1 standard. The globe valve shall have a CWP rating of 1380 kPa (200 psig). The valve material shall be gray iron with bolted bonnet conforming to ASTM A 126 with flanged ends, bronze trim, malleable iron handwheel.

2.2 WATER PRESSURE REDUCING VALVE AND CONNECTIONS

- A. 80 mm or DN80 (3 inches) or smaller: The pressure reducing valve shall consist of a bronze body and bell housing, a separate access cover for the plunger, and a bolt to adjust the downstream pressure. The bronze bell housing and access cap shall be threaded to the body and shall not require the use of ferrous screws. The assembly shall be of the balanced piston design and shall reduce pressure in both flow and no flow conditions. The assembly shall be accessible for maintenance without having to remove the body from the line.
- B. 100 mm or DN100 (4 inches) and larger: The pressure reducing valve shall consist of a flanged cast iron body and rated to 1378-kPa (200-psig). The valve shall have a large Hycar diaphragm for sensitive response.
- C. The regulator shall have a tap for pressure gauge.
- D. The regulator shall have a temperature rating of 100° C (210° F) for hot water or hot water return service. Pressure regulators shall have accurate pressure regulation to 6.9-kPa (+/- 1 psig).

- C. Setting: Entering water pressure, discharge pressure, capacity, size, and related measurements shall be as shown on the drawings.
- D. Connections Valves and Strainers: shut off valves shall be installed on each side of reducing valve and a bypass line equal in size to the regulator inlet pipe shall be installed with a normally closed globe valve. A strainer shall be installed on inlet side of, and same size as pressure reducing valve. A pressure gage shall be installed on the low pressure side of the line.

2.3 BACKWATER VALVE

- A. The backwater valve shall have a cast iron body, automatic type ABS valve seat and flapper which are slightly open during periods of non operation. The cleanout shall be extended to the finish floor and fit with a threaded countersunk plug. A clamping device shall be included when the cleanout extends through the waterproofing membrane.
- B. When the backwater valve is installed greater than 600 mm (24 inches) below the finish floor elevation, a pit or manhole large enough for a repair person can enter to service the backwater valve shall be installed.

2.4 BACKFLOW PREVENTERS

- A. A backflow prevention assembly shall be installed at any point in the plumbing system where the potable water supply comes in contact with a potential source of contamination. The backflow prevention assembly shall be ASSE 1013 listed and certified.
- B. Reduced pressure backflow preventers shall be installed in the following applications.
 - 5. Water make up to heating systems, cooling tower, chilled water system, generators, and similar equipment consuming water.
 - 6. Water service entrance from loop system.
 - 9. Atmospheric Vacuum Breaker: ASSE 1001
 - a. Hose bibs and sinks w/threaded outlets.
 - b. Disposers.
 - i. Detergent system
- C. The reduced pressure principle backflow prevention assembly shall be ASSE listed 1013 with full port OS&Y gate valves and an integral relief monitor switch. The main body and access cover shall be epoxy coated duct iron conforming to ASTM A536 grade 4. The seat ring and check valve shall be Noryl (NSF listed). The stem shall be stainless steel conforming to ASTM A276. The seat disc elastomer shall be EPDM. The

checks and the relief valve shall be accessible for maintenance without removing the device from the line. An epoxy coated wye type strainer with flanged connections shall be installed on the inlet.

- D. The atmospheric vacuum breaker shall be ASSE listed 1001. The main body shall be either cast bronze. All internal polymers shall be NSF listed. The seat disc elastomer shall be silicone. The device shall be accessible for maintenance without removing the device from the service line. The installation shall not be in a concealed or inaccessible location or where the venting of water from the device during normal operation is deemed objectionable.
- E. The double check detector backflow prevention assembly shall be ASSE listed 1048 and supply with full port OS&Y gate valves. The main body and access cover shall be epoxy coated ductile iron conforming to ASTM A536 grade. The seat ring and check valve shall be Noryl (NSF listed). The stem shall be stainless steel conforming to ASTM A 276. The seat disc elastomers shall be EPDM. The first and second check valve shall be accessible for maintenance without removing the device from the line.

2.5 CHAINWHEELS

- A. Valve chain wheel assembly with sprocket rim brackets and chain shall be constructed according to the following:
 - 1. Brackets: type, number, size, and fasteners required to mount actuator on valve.
 - 2. Attachment: For connection to ball, butterfly valve stem.
 - 3. Sprocket rim with chain guides: ductile or cast iron of type and size required for valve with zinc coating.
 - 4. Chain: Hot dipped galvanized steel of size required to fit sprocket rim.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Valve interior shall be examined for cleanliness, freedom from foreign matter, and corrosion. Special packing materials shall be removed, such as blocks, used to prevent disc movement during shipping and handling.
- B. Valves shall be operated in positions from fully open to fully closed. Guides and seats shall be examined and made accessible by such operations.

- C. Threads on valve and mating pipe shall be examined for form and cleanliness.
- D. Mating flange faces shall be examined for conditions that might cause leakage. Bolting shall be checked for proper size, length, and material. Gaskets shall be verified for proper size and that its material composition is suitable for service and free from defects and damage.
- E. Do not attempt to repair defective valves; replace with new valves.

3.2 VALVE INSTALLATION

- A. Install valves with unions or flanges at each piece of equipment arranged to allow service, maintenance, and equipment removal without system shutdown.
- B. Valves shall be located for easy access and shall be provide with separate support. Valves shall be accessible with access doors when installed inside partitions or above hard ceilings.
- C. Valves shall be installed in horizontal piping with stem at or above center of pipe
- D. Valves shall be installed in a position to allow full stem movement.
- E. Install chain wheels on operators for [ball] [butterfly] [gate] and [globe] valves NPS 100 mm or DN100 (4 inches) and larger and more than [2400 mm (12 feet) above floor. Chains shall be extended to 1500 mm 3600 mm (60 inches) above finished floor.
- F. Check valves shall be installed for proper direction of flow and as follows:
 - 1. Swing Check Valves: In horizontal position with hinge pin level.

3.3 ADJUSTING

- A. Valve packing shall be adjusted or replaced after piping systems have been tested and put into service but before final adjusting and balancing. Replace valves shall be replaced if persistent leaking occurs.

- - E N D - - -

SECTION 22 08 00
COMMISSIONING OF PLUMBING SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. The requirements of this Section apply to all sections of Division 22.
- B. This project will have selected building systems commissioned. The complete list of equipment and systems to be commissioned are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. The commissioning process, which the Contractor is responsible to execute, is defined in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. A Commissioning Agent (CxA) appointed by the Department of Veterans Affairs will manage the commissioning process.

1.2 RELATED WORK

- A. Section 01 00 00 GENERAL REQUIREMENTS.
- B. Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.
- C. Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

1.3 SUMMARY

- A. This Section includes requirements for commissioning plumbing systems, subsystems and equipment. This Section supplements the general requirements specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.
- B. The commissioning activities have been developed to support the VA requirements to meet guidelines for Federal Leadership in Environmental, Energy, and Economic Performance.
- C. The commissioning activities have been developed to support the United States Green Building Council (USGBC) LEED™ rating program and to support delivery of project performance in accordance with the Contract Documents developed with the approval of the VA.
 - 1. Commissioning activities and documentation for the LEED™ section on "Energy and Atmosphere" prerequisite of "Fundamental Building Systems Commissioning".
 - 2. Commissioning activities and documentation for the LEED™ section on "Energy and Atmosphere" requirements for the "Enhanced Building System Commissioning" credit.
 - 3. Activities and documentation for the LEED™ section on "Measurement and Verification" requirements for the Measurement and Verification credit.

- D. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for more specifics regarding processes and procedures as well as roles and responsibilities for all Commissioning Team members.

1.4 DEFINITIONS

- A. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for definitions.

1.5 COMMISSIONED SYSTEMS

- A. Commissioning of a system or systems specified in this Division is part of the construction process. Documentation and testing of these systems, as well as training of the VA's Operation and Maintenance personnel, is required in cooperation with the VA and the Commissioning Agent.
- B. The following Plumbing systems will be commissioned:
1. Domestic Hot Water Systems (Domestic water heaters, steam-to-hot water converters, hot water circulating pumps and motors, controls, combustion burners/fans/motors).
 4. Sewage Ejection Pumps (Sump level controls, pump alternator, alarms and alarm panel, pumps and motors).
 5. Storm Sump Pumps (Sump level controls, pump alternator, alarms and alarm panel, pumps and motors).
 6. Domestic Water Filtration and Softener Systems (Tanks and casings, gages and instruments, controls, pumps and motors - if applicable, packaged piping, alarms).
 9. Emergency Plumbing Fixtures (Showers, eye wash stations, water tempering valves, instruments and gages)

1.6 SUBMITTALS

- A. The commissioning process requires review of selected Submittals. The Commissioning Agent will provide a list of submittals that will be reviewed by the Commissioning Agent. This list will be reviewed and approved by the VA prior to forwarding to the Contractor. Refer to Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, and SAMPLES for further details.
- B. The commissioning process requires Submittal review simultaneously with engineering review. Specific submittal requirements related to the commissioning process are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

PART 2 - PRODUCTS (NOT USED)

PART 3 - EXECUTION

3.1 PRE-FUNCTIONAL CHECKLISTS

- A. The Contractor shall complete Pre-Functional Checklists to verify systems, subsystems, and equipment installation is complete and systems are ready for Systems Functional Performance Testing. The Commissioning Agent will prepare Pre-Functional Checklists to be used to document equipment installation. The Contractor shall complete the checklists. Completed checklists shall be submitted to the VA and to the Commissioning Agent for review. The Commissioning Agent may spot check a sample of completed checklists. If the Commissioning Agent determines that the information provided on the checklist is not accurate, the Commissioning Agent will return the marked-up checklist to the Contractor for correction and resubmission. If the Commissioning Agent determines that a significant number of completed checklists for similar equipment are not accurate, the Commissioning Agent will select a broader sample of checklists for review. If the Commissioning Agent determines that a significant number of the broader sample of checklists is also inaccurate, all the checklists for the type of equipment will be returned to the Contractor for correction and resubmission. Refer to SECTION 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for submittal requirements for Pre-Functional Checklists, Equipment Startup Reports, and other commissioning documents.

3.2 CONTRACTORS TESTS

- A. Contractor tests as required by other sections of Division 22 shall be scheduled and documented in accordance with Section 01 00 00 GENERAL REQUIREMENTS. The Commissioning Agent will witness selected Contractor tests. Contractor tests shall be completed prior to scheduling Systems Functional Performance Testing.

3.3 SYSTEMS FUNCTIONAL PERFORMANCE TESTING:

- A. The Commissioning Process includes Systems Functional Performance Testing that is intended to test systems functional performance under steady state conditions, to test system reaction to changes in operating conditions, and system performance under emergency conditions. The Commissioning Agent will prepare detailed Systems Functional Performance Test procedures for review and approval by the Resident Engineer. The Contractor shall review and comment on the tests prior to approval. The Contractor shall provide the required

labor, materials, and test equipment identified in the test procedure to perform the tests. The Commissioning Agent will witness and document the testing. The Contractor shall sign the test reports to verify tests were performed. See Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS, for additional details.

3.4 TRAINING OF VA PERSONNEL

- A. Training of the VA operation and maintenance personnel is required in cooperation with the Resident Engineer and Commissioning Agent. Provide competent, factory authorized personnel to provide instruction to operation and maintenance personnel concerning the location, operation, and troubleshooting of the installed systems. The instruction shall be scheduled in coordination with the Resident Engineer after submission and approval of formal training plans. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS and Division 22 Sections for additional Contractor training requirements.

----- END -----

SECTION 22 11 00
FACILITY WATER DISTRIBUTION

PART 1 - GENERAL

1.1 DESCRIPTION

Domestic water systems, including piping, equipment and all necessary accessories as designated in this section.

1.2 RELATED WORK

- A. Penetrations in rated enclosures: Section 07 84 00, FIRESTOPPING.
- B. Preparation and finish painting and identification of piping systems: Section 09 91 00, PAINTING.
- C. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- D. Pipe Insulation: Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Piping.
 - 2. Strainers.
 - 3. All items listed in Part 2 - Products.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Federal Specifications (Fed. Spec.):
 - A-A-1427CSodium Hypochlorite Solution
 - A-A-59617Unions, Brass or Bronze Threaded, Pipe
Connections and Solder-Joint Tube Connections
- C. American National Standards Institute (ANSI):
 - American Society of Mechanical Engineers (ASME): (Copyrighted Society)
 - A13.1-96Scheme for Identification of Piping Systems
 - B16.3-98Malleable Iron Threaded Fittings ANSI/ASME
 - B16.4-98Cast Iron Threaded Fittings Classes 125 and 250
ANSI/ASME
 - B16.9-01Factory-Made Wrought Steel Buttwelding Fittings
ANSI/ASME
 - B16.11-01Forged Steel Fittings, Socket-Welding and
Threaded ANSI/ASME

B16.12-98Cast Iron Threaded Drainage Fittings ANSI/ASME
B16.15-85(R 1994)Cast Bronze Threaded Fittings ANSI/ASME
B16.18-01Cast Copper Alloy Solder-Joint Pressure
Fittings ANSI/ASME
B16.22-01Wrought Copper and Copper Alloy Solder Joint
Pressure Fittings ANSI/ASME
Element ANSI/ASME

D. American Society for Testing and Materials (ASTM):

A47-99Ferritic Malleable Iron Castings Revision 1989
A53-02Pipe, Steel, Black And Hot-Dipped, Zinc-coated
Welded and Seamless
A74-03Cast Iron Soil Pipe and Fittings
A183-83(R1998)Carbon Steel Track Bolts and Nuts
A312-03Seamless and Welded Austenitic Stainless Steel
Pipe
A536-84(R1999) E1Ductile Iron Castings
A733-03Welded and Seamless Carbon Steel and Austenitic
Stainless Steel Pipe Nipples
B32-03Solder Metal
B61-02Steam or Bronze Castings
B62-02Composition Bronze or Ounce Metal Castings
B75-99(Rev A)Seamless Copper Tube
B88-03Seamless Copper Water Tube
B584-00Copper Alloy Sand Castings for General
Applications Revision A
B687-99Brass, Copper, and Chromium-Plated Pipe Nipples
C564-03Rubber Gaskets for Cast Iron Soil Pipe and
Fittings
D2000-01Rubber Products in Automotive Applications
D4101-03bPropylene Plastic Injection and Extrusion
Materials
D2447-93Polyethylene (PE) Plastic Pipe, Schedule 40 and
80, Based on Outside Diameter
D2564-94Solvent Cements for Poly (Vinyl Chloride) (PVC)
Plastic Pipe and Fittings
D2665-94 Revision APoly (Vinyl Chloride) (PVC) Plastic Drain,
Waste, and Vent Pipe and Fittings

- D4101-03bPropylene Plastic Injection and Extrusion
Materials
- E1120Standard Specification For Liquid Chlorine
- E1229Standard Specification For Calcium Hypochlorite
- E. American Water Works Association (AWWA):
- C110-03/ A21.10-03Ductile Iron and Gray Iron Fittings - 75 mm
thru 1200 mm (3 inch thru 48 inches) for Water
and other liquids AWWA/ ANSI
- C151-00/ A21.51-02Ductile-Iron Pipe, Centrifugally Cast in Metal
Molds or Sand-Lined Molds, for Water or Other
Liquids AWWA/ ANSI
- C203-02Coal-Tar Protective Coatings and Linings for
Steel Water Pipelines - Enamel and Tape - Hot
Applied AWWA/ ANSI
- C651-99Disinfecting Water Mains
- F. American Welding Society (AWS):
- A5.8-92Filler Metals for Brazing
- G. Manufacturers Standardization Society of the Valve and Fittings
Industry, Inc. (MSS):
- SP-72-99Ball Valves With Flanged or Butt Welding For
General Purpose
- SP-110-96Ball Valve Threaded, Socket Welding, Solder
Joint, Grooved and Flared Ends
- H. American Society of Sanitary Engineers (ASSE):
- 1001-02Pipe Applied Atmospheric Type Vacuum Breakers
- 1018-01Performance for trap seal primer valve-water
supply fed
- 1020-04Vacuum Breakers, Anti-Siphon, Pressure Type
- I. Plumbing and Drainage Institute (PDI):
- PDI WH-201Water Hammer Arrestor

PART 2 - PRODUCTS

2.1 WATER SERVICE CONNECTIONS TO BUILDINGS

- A. From inside face of exterior wall to a distance of approximately 1500
mm (5 feet) outside of building and underground inside building,
material selected shall be the same for the size specified.
- B. Seventy five millimeters (3 inch) Diameter and Over: Ductile iron, AWWA
C151, 850 kPa (125 pounds) water steam pressure (WSP), exterior

bituminous coating, cement lined. Provide flanged and anchored connection to interior piping.

- C. Under 75 mm (3 inch) Diameter: Copper tubing, ASTM B88, Type K, seamless, annealed. Fittings as specified under Article, INTERIOR DOMESTIC WATER PIPING. Use brazing alloys, AWS A5.8, Classification BCuP.
- D. Flexible Expansion Joint: Ductile iron with ball joints rated for 1725 kPa (250 psi) working pressure conforming to ANSI/AWWA A21.53/C153, capable of deflecting a minimum of 30 degrees and expanding simultaneously to the amount shown on the drawings. Flexible expansion joint shall have the expansion capability designed as an integral part of the ductile iron ball castings. Pressure containing parts shall be lined with a minimum of 15 mils of fusion bonded epoxy conforming to the applicable requirements of ANSI/AWWA C213 and shall be factory holiday tested with a 1500 volt spark test. Flexible expansion joint shall have flanged connections conforming to ANSI/AWWA A21.11/C110. Bolts and nuts shall be 316 stainless steel and gaskets shall be neoprene.

2.2 INTERIOR DOMESTIC WATER PIPING

- A. Pipe: Copper tube, ASTM B88, Type K or L, drawn. For pipe 150 mm (6 inches) and larger, stainless, steel ASTM A312, schedule 10 may be used.
- B. Fittings for Copper Tube:
 - 1. Wrought copper or bronze castings conforming to ANSI B16.18 and B16.22. Unions shall be bronze, MSS SP72 & SP 110, Solder or braze joints.
 - 2. Grooved fittings, 50 to 150 mm (2 to 6 inch) wrought copper ASTM B75 C12200, 125 to 150 mm (5 to 6 inch) bronze casting ASTM B584, CDA 844. Mechanical grooved couplings, ductile iron, ASTM A536 (Grade 65-45-12), or malleable iron, ASTM A47 (Grade 32510) housing, with EPDM gasket, steel track head bolts, ASTM A183, coated with copper colored alkyd enamel.
- D. Adapters: Provide adapters for joining screwed pipe to copper tubing.
- E. Solder: ASTM B32 Composition Sb5 HA or HB. Provide non-corrosive flux.
- F. Brazing alloy: AWS A5.8, Classification BCuP.

2.3 EXPOSED WATER PIPING

- A. Finished Room: Use full iron pipe size chrome plated brass piping for exposed water piping connecting fixtures, casework, cabinets, equipment

and reagent racks when not concealed by apron including those furnished by the Government or specified in other sections.

1. Pipe: Fed. Spec. WW-P-351, standard weight.
2. Fittings: ANSI B16.15 cast bronze threaded fittings with chrome finish, (125 and 250).
3. Nipples: ASTM B 687, Chromium-plated.
4. Unions: Mss SP-72, SP-110, Brass or Bronze with chrome finish.
Unions 65 mm (2-1/2 inches) and larger shall be flange type with approved gaskets.

B. Unfinished Rooms, Mechanical Rooms and Kitchens: Chrome-plated brass piping is not required. Paint piping systems as specified in Section 09 91 00, PAINTING.

2.5 TRAP PRIMER WATER PIPING:

- A. Pipe: Copper tube, ASTM B88, type K, hard drawn.
- B. Fittings: Bronze castings conforming to ANSI B16.18 Solder joints.
- C. Solder: ASTM B32 composition Sb5. Provide non-corrosive flux.

2.6 WATERPROOFING

- A. Provide at points where pipes pass through membrane waterproofed floors or walls in contact with earth.
- B. Floors: Provide cast iron stack sleeve with flashing device and a underdeck clamp. After stack is passed through sleeve, provide a waterproofed caulked joint at top hub.
- C. Walls: See detail shown on drawings.

2.7 STRAINERS

- A. Provide on high pressure side of pressure reducing valves, on suction side of pumps, on inlet side of indicating and control instruments and equipment subject to sediment damage and where shown on drawings.
Strainer element shall be removable without disconnection of piping.
- B. Water: Basket or "Y" type with easily removable cover and brass strainer basket.
- C. Body: Smaller than 80 mm (3 inches), brass or bronze; 80 mm (3 inches) and larger, cast iron or semi-steel.

2.8 DIELECTRIC FITTINGS

Provide dielectric couplings or unions between ferrous and non-ferrous pipe.

2.9 STERILIZATION CHEMICALS

- A. Liquid Chlorine: ASTM E1120.
- B. Hypochlorite: ASTM E1229, or Fed. Spec. AA-1427C, grade B.

2.10 WATER HAMMER ARRESTER:

Closed copper tube chamber with permanently sealed 410 kPa (60 psig) air charge above a Double O-ring piston. Two high heat Buna-N O-rings pressure packed and lubricated with FDA approved Dow Corning No. 11 silicone compound. All units shall be designed in accordance with ASSE 1010 for sealed wall installations without an access panel. Size and install in accordance with Plumbing and Drainage Institute requirements (PDI WH 201). Unit shall be as manufactured by Precision Plumbing Products Inc., Watts or Sioux Chief. Provide water hammer arrestors at all solenoid valves, at all groups of two or more flush valves, at all quick opening or closing valves, and at all medical washing equipment.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. General: Comply with the PHCC National Standard Plumbing Code and the following:
 - 1. Install branch piping for water from the piping system and connect to all fixtures, valves, cocks, outlets, casework, cabinets and equipment, including those furnished by the Government or specified in other sections.
 - 2. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe, except for plastic and glass, shall be reamed to full size after cutting.
 - 3. All pipe runs shall be laid out to avoid interference with other work.
 - 4. Install union and shut-off valve on pressure piping at connections to equipment.
 - 5. Pipe Hangers, Supports and Accessories:
 - a. All piping shall be supported per of the National Standard Plumbing Code, Chapter No. 8.
 - b. Shop Painting and Plating: Hangers, supports, rods, inserts and accessories used for Pipe supports shall be shop coated with red lead or zinc Chromate primer paint. Electroplated copper hanger rods, hangers and accessories may be used with copper tubing.
 - c. Floor, Wall and Ceiling Plates, Supports, Hangers:
 - 1) Solid or split unplated cast iron.
 - 2) All plates shall be provided with set screws.
 - 3) Pipe Hangers: Height adjustable clevis type.
 - 4) Adjustable Floor Rests and Base Flanges: Steel.

- 5) Concrete Inserts: "Universal" or continuous slotted type.
 - 6) Hanger Rods: Mild, low carbon steel, fully threaded or Threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
 - 7) Riser Clamps: Malleable iron or steel.
 - 8) Rollers: Cast iron.
 - 9) Self-drilling type expansion shields shall be "Phillips" type, with case hardened steel expander plugs.
 - 10) Hangers and supports utilized with insulated pipe and tubing shall have 180 degree (min.) metal protection shield centered on and welded to the hanger and support. The shield shall be 4 inches in length and be 16 gauge steel. The shield shall be sized for the insulation.
 - 11) Miscellaneous Materials: As specified, required, directed or as noted on the drawings for proper installation of hangers, supports and accessories. If the vertical distance exceeds 6 m (20 feet) for cast iron pipe additional support shall be provided in the center of that span. Provide all necessary auxiliary steel to provide that support.
6. Install cast escutcheon with set screw at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
 7. Penetrations:
 - a. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING. Completely fill and seal clearances between raceways and openings with the fire stopping materials.
 - b. Waterproofing: At floor penetrations, completely seal clearances around the pipe and make watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS.
- B. Piping shall conform to the following:
1. Domestic Water:
 - a. Where possible, grade all lines to facilitate drainage. Provide drain valves at bottom of risers. All unnecessary traps in circulating lines shall be avoided.

- b. Connect branch lines at bottom of main serving fixtures below and pitch down so that main may be drained through fixture. Connect branch lines to top of main serving only fixtures located on floor above.

3.2 TESTS

- A. General: Test system either in its entirety or in sections.
- B. Potable Water System: Test after installation of piping and domestic water heaters, but before piping is concealed, before covering is applied, and before plumbing fixtures are connected. Fill systems with water and maintain hydrostatic pressure of 690 kPa (100 psi) gage for two hours. No decrease in pressure is allowed. Provide a pressure gage with a shutoff and bleeder valve at the highest point of the piping being tested.
- D. All Other Piping Tests: Test new installed piping under 1 1/2 times actual operating conditions and prove tight.

3.3 STERILIZATION

- A. After tests have been successfully completed, thoroughly flush and sterilize the interior domestic water distribution system in accordance with AWWA C651.
- B. Use either liquid chlorine or hypochlorite for sterilization.

- - - E N D - - -

SECTION 22 11 23
DOMESTIC WATER PUMPS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Hot water circulating pump.

1.2 RELATED WORK

- A. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- B. Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT.
- C. SECTION 22 08 00 - COMMISSIONING OF PLUMBING SYSTEMS.
Requirements for commissioning, systems readiness checklist, and training.
- D. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.

1.3 QUALITY ASSURANCE

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Pump:
 - a. Manufacturer and model.
 - b. Operating speed.
 - c. Capacity.
 - d. Characteristic performance curves.
 - 2. Motor:
 - a. Manufacturer, frame and type.
 - b. Speed.
 - c. Current Characteristics.
 - d. Efficiency.
- C. Certificate of shop test for domestic water booster system. Provide certified performance curves.
- D. Certified copies of all the factory and construction site test data sheets and reports.
- E. Complete operating and maintenance manuals including wiring diagrams, technical data sheets and information for ordering replaceable parts:
 - 1. Include complete list indicating all components of the systems.
 - 2. Include complete diagrams of the internal wiring for each item of equipment.
 - 3. Diagrams shall have their terminals identified to facilitate installation, operation and maintenance.
- F. Completed System Readiness Checklist provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and

dated on the date of completion, in accordance with the requirements of
Section 22 08 00 COMMISSIONING OF PLUMBING SYSTEMS.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. National Electrical Manufacturers Association (NEMA):
ICS6-93 (R2006)Industrial Control and Systems Enclosures
250-08Enclosures for Electrical Equipment (1000 Volts
Maximum)
- C. American Society of Mechanical Engineers (ASME):
Boiler and Pressure Vessel Code: 2010
Section VIIIPressure Vessels, Division I and II
- D. Underwriters' Laboratories, Inc. (UL):
508-99 (R2008) Standards for Industrial Control Equipment

PART 2 - PRODUCTS

2.2 INLINE HOT WATER RECIRCULATING PUMP

- A. Centrifugal in-line horizontal oil lubricated pump designed for quiet operation and 862 kPa (125 psi).
- B. Pump controlled from on/off aquastat located at pump. In addition, the pump shall be provided with "on-off" switch for shut down. In the inlet and outlet piping of the pump shutoff valves shall be installed to permit service to the pump without draining the system. A check valve shall be installed in the pump discharge piping immediately downstream of the pump.

PART 3 - EXECUTION

3.1 STARTUP AND TESTING

- A. Make tests as recommended by product manufacturer and listed standards and under actual or simulated operating conditions and prove full compliance with design and specified requirements. Tests of the various items of equipment shall be performed simultaneously with the system of which each item is an integral part.
- B. System Test: After installation is completed provide an operational test of the completed system including flow rates, pressure compliance, alarms and all control functions.
- C. When any defects are detected, correct defects and repeat test.
- D. The Commissioning Agent will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with the Resident Engineer and Commissioning Agent. Provide a minimum of 7 days prior to notice.

3.2 COMMISSIONING

- A. Provide Commissioning Documentation accordance with the requirements of Section 22 08 00 - COMMISSIONING OF PLUMBING SYSTEMS for all inspection, startup, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this Section of the specification will be tested as part of a larger system. Refer to Section 22 08 00 - COMMISSIONING OF PLUMBING SYSTEMS and related sections for contractor responsibilities for system commissioning.

3.3 DEMONSTRATION AND TRAINING

- A. Provide services of manufacturer's technical representative for four hours to instruct VA Personnel in operation and maintenance of units.
- B. Submit training plans and instructor qualifications in accordance with the requirements of Section 22 08 00 COMMISSIONING OF PLUMBING SYSTEMS.

- - - E N D - - -

SECTION 22 13 00
FACILITY SANITARY AND VENT PIPING

PART 1 - GENERAL

1.1 DESCRIPTION

This section pertains to sanitary sewer and vent systems, including piping, equipment and all necessary accessories as designated in this section.

1.2 RELATED WORK

- A. Section 07 84 00, FIRESTOPPING: Penetrations in rated enclosures.
- B. Section 09 91 00, PAINTING: Preparation and finish painting and identification of piping systems.
- C. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: Pipe Hangers and Supports, Materials Identification.
- D. Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION: Pipe Insulation.
- E. Section 07 92 00 Joint Sealants: Sealant products.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Piping.
 - 2. Floor Drains.
 - 4. Cleanouts.
 - 5. All items listed in Part 2 - Products.
- C. Detailed shop drawing of clamping device and extensions when required in connection with the waterproofing membrane or the floor drain.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME): (Copyrighted Society)
 - A112.6.3-01 (R 2007) ...Standard for Floor and Trench Drains
 - A13.1-07Scheme for Identification of Piping Systems
 - B16.3-06Malleable Iron Threaded Fittings, Classes 150 and 300.
 - B16.4-06Standard for Grey Iron Threaded Fittings
Classes 125 and 250
 - B16.12-98 (R 2006)Cast Iron Threaded Drainage Fittings

B16.15-06Cast Bronze Threaded Fittings, Classes 125 and
250

C. American Society for Testing and Materials (ASTM):

A47/A47M-99 (R 2004) ...Standard Specification for Steel Sheet,
Aluminum Coated, by the Hot Dip Process

A53/A53M-07Standard Specification for Pipe, Steel, Black
And Hot-Dipped, Zinc-coated, Welded and
Seamless

A74-06Standard Specification for Cast Iron Soil Pipe
and Fittings

A183-03Standard Specification for Carbon Steel Track
Bolts and Nuts

A536-84(R 2004)Standard Specification for Ductile Iron
Castings

B32-08Standard Specification for Solder Metal

B75-02Standard Specification for Seamless Copper Tube

B306-02Standard Specification for Copper Drainage Tube
(DWV)

B584-06aStandard Specification for Copper Alloy Sand
Castings for General Applications

C564-03aStandard Specification for Rubber Gaskets for
Cast Iron Soil Pipe and Fittings

D2000-08Standard Classification System for Rubber
Products in Automotive Applications

D2564-04E1Standard Specification for Solvent Cements for
Poly (Vinyl Chloride) (PVC) Plastic Pipe and
Fittings

D2665-08Standard Specification for Poly (Vinyl
Chloride) (PVC) Plastic Drain, Waste, and Vent
Pipe and Fittings

D. International Code Council:

IPC-06International Plumbing Code

E. Cast Iron Soil Pipe Institute (CISPI):

301-05Hubless Cast Iron Soil Pipe and Fittings for
Sanitary and Storm Drain, Waste, and Vent
Piping Applications

310-04Coupling for Use in Connection with Hubless
Cast Iron Soil Pipe and Fittings for Sanitary

and Storm Drain, Waste, and Vent Piping
Applications

F. American Society of Sanitary Engineers (ASSE):

1018-01Trap Seal Primer Valves - Potable, Water
Supplied

G. Plumbing and Drainage Institute (PDI):

PDI WH-201Water Hammer Arrestor

PART 2 - PRODUCTS

2.1 SANITARY WASTE, DRAIN, AND VENT PIPING

A. Cast iron waste, drain, and vent pipe and fittings

1. Cast iron waste, drain, and vent pipe and fittings shall be used for the following applications:
 - a. pipe buried in or in contact with earth
 - b. sanitary pipe extensions to a distance of approximately 1500 mm (5 feet) outside of the building.
 - c. interior waste and vent piping above grade.
2. Cast iron Pipe shall be bell and spigot or hubless (plain end or no-hub or hubless).
3. The material for all pipe and fittings shall be cast iron soil pipe and fittings and shall conform to the requirements of CISPI Standard 301, ASTM A-888, or ASTM A-74.
4. Joints for hubless pipe and fittings shall conform to the manufacturer's installation instructions. Couplings for hubless joints shall conform to CISPI 310. Joints for hub and spigot pipe shall be installed with compression gaskets conforming to the requirements of ASTM Standard C-564 or be installed with lead and oakum.

B. Copper Tube, (DWV):

1. Copper DWV tube sanitary waste, drain and vent pipe may be used for piping above ground, except for urinal drains.
2. The copper DWV tube shall be drainage type, drawn temper conforming to ASTM B306.
3. The copper drainage fittings shall be cast copper or wrought copper conforming to ASME B16.23 or ASME 16.29.
4. The joints shall be lead free, using a water flushable flux, and conforming to ASTM B32.

C. Polyvinyl Chloride (PVC)

1. Polyvinyl chloride (PVC) pipe and fittings are permitted where the waste temperature is below 60°C (140°F).
2. PVC piping and fittings shall NOT be used for the following applications:
 - a. Waste collected from steam condensate drains
 - b. spaces such as mechanical equipment rooms, kitchens, SPD, and sterilizer areas.
 - b. Vertical waste and soil stacks serving more than two floors
 - c. Exposed in mechanical equipment rooms.
 - d. Exposed inside of ceiling return plenums
3. Polyvinyl chloride sanitary waste, drain, and vent pipe and fittings shall be schedule 40 solid core sewer piping conforming to ASTM D 1785 and ASTM D2665, sewer and drain series with ends for solvent cemented joints.
4. Fittings:
 - a. PVC fittings shall be solvent welded socket type using solvent cement conforming to ASTM D2564.

2.2 EXPOSED WASTE PIPING

- A. Full iron pipe size chrome plated brass piping shall be used in finished rooms for exposed waste piping connecting fixtures, casework, cabinets, equipment and reagent racks when not concealed by apron including those furnished by the Government or specified in other sections.
 1. The Pipe shall meet Fed. Spec. WW-P-351, standard weight.
 2. The Fittings shall conform to ANSI B16.15, cast bronze threaded fittings with chrome finish, (125 and 250).
 3. Nipples shall conform to ASTM B 687, Chromium-plated.
 4. Unions shall be brass or bronze with chrome finish. Unions 65 mm (2-1/2 inches) and larger shall be flange type with approved gaskets.
- B. In unfinished Rooms such as mechanical Rooms and Kitchens, Chrome-plated brass piping is not required. The pipe materials specified under the paragraph "Sanitary Waste, Drain, and Vent Piping" can be used. The sanitary pipe in unfinished rooms shall be painted as specified in Section 09 91 00, PAINTING.

2.3 SPECIALTY PIPE FITTINGS

- A. Transition pipe couplings shall join piping with small differences in outside diameters or different materials. End connections shall be of

the same size and compatible with the pipes being joined. The transition coupling shall be elastomeric, sleeve type reducing or transition pattern and include shear and corrosion resistant metal, tension band and tightening mechanism on each end. The transition coupling sleeve coupling shall be of the following material:

1. For cast iron soil pipes, the sleeve material shall be rubber conforming to ASTM C564.
 2. For PVC soil pipes, the sleeve material shall be elastomeric seal or PVC, conforming to ASTM F 477 or ASTM D5926.
 3. For dissimilar pipes, the sleeve material shall be PVC conforming to ASTM D5926, or other material compatible with the pipe materials being joined.
- B. The dielectric fittings shall conform to ASSE 1079 with a pressure rating of 860 kPa (125 psig) at a minimum temperature of 82°C (180°F). The end connection shall be solder joint copper alloy and threaded ferrous.
- C. Dielectric flange insulating kits shall be of non conducting materials for field assembly of companion flanges with a pressure rating of 1035 kPa (150 psig). The gasket shall be neoprene or phenolic. The bolt sleeves shall be phenolic or polyethylene. The washers shall be phenolic with steel backing washers.
- D. The di-electric nipples shall be electroplated steel nipple complying with ASTM F 1545 with a pressure ratings of 2070 kPa (300 psig) at 107°C (225°F). The end connection shall be male threaded. The lining shall be inert and noncorrosive polyethylene.

2.4 CLEANOUTS

- A. Cleanouts shall be the same size as the pipe, up to 100 mm (4 inches); and not less than 100 mm (4 inches) for larger pipe. Cleanouts shall be easily accessible and shall be gastight and watertight. Minimum clearance of 600 mm (24 inches) shall be provided for clearing a clogged sanitary line.
- B. Floor cleanouts shall be gray iron housing with clamping device and round, secured, scoriated, gray iron cover conforming to ASME A112.36.2M. A gray iron ferrule with hubless, socket, inside calk or spigot connection and counter sunk, taper-thread, brass or bronze closure plug shall be included. The frame and cover material and finish shall be nickel-bronze copper alloy with a square shape. The cleanout shall be vertically adjustable for a minimum of 50 mm (2

inches). When a waterproof membrane is used in the floor system, clamping collars shall be provided on the cleanouts. Cleanouts shall consist of wye fittings and eighth bends with brass or bronze screw plugs. Cleanouts in the resilient tile floors, quarry tile and ceramic tile floors shall be provided with square top covers recessed for tile insertion. In the carpeted areas, carpet cleanout markers shall be provided. Two way cleanouts shall be provided where indicated on drawings and at every building exit. The loading classification for cleanouts in sidewalk areas or subject to vehicular traffic shall be heavy duty type.

- C. Cleanouts shall be provided at or near the base of the vertical stacks with the cleanout plug located approximately 600 mm (24 inches) above the floor. If there are no fixtures installed on the lowest floor, the cleanout shall be installed at the base of the stack. The cleanouts shall be extended to the wall access cover. Cleanout shall consist of sanitary tees. Nickel-bronze square frame and stainless steel cover with minimum opening of 150 by 150 mm (6 by 6 inches) shall be furnished at each wall cleanout. Where the piping is concealed, a fixture trap or a fixture with integral trap, readily removable without disturbing concealed pipe, shall be accepted as a cleanout equivalent providing the opening to be used as a cleanout opening is the size required.
- D. In horizontal runs above grade, cleanouts shall consist of cast brass tapered screw plug in fitting or caulked/hubless cast iron ferrule. Plain end (hubless) piping in interstitial space or above ceiling may use plain end (hubless) blind plug and clamp.

2.5 FLOOR DRAINS

- A. Type B (FD-B) floor drain shall comply with ANSI A112.6.3. The type B floor drain shall be constructed of galvanized cast iron with medium duty nickel bronze grate, double drainage pattern, clamping device, without sediment bucket but with secondary strainer in bottom. The grate shall be 175 mm (7 inches) minimum.
- B. Type C (FD-C) floor drain shall comply with ANSI A112.6.3. The type C floor drain shall have a cast iron body, double drainage pattern, clamping device, light duty square or round nickel bronze adjustable strainer and grate with vandal proof screws. The grate shall be square, 150 mm (6 inches) minimum.

- C. Type E (FD-E) floor drain shall comply with ANSI A112.6.3. The type E floor drain shall have a heavy, cast iron body, double drainage pattern, heavy non-tilting ductile iron grate not less than 300 mm (12 inches) square, removable sediment bucket. Clearance between body and bucket shall be ample for free flow of waste water. For traffic use, an extra heavy duty load classification ductile iron grate shall be provided.
- D. Type I (FD-I) floor drain shall comply with ANSI A112.6.3. The type I floor drain shall have a cast iron body, wide flange for seamless floor, double drainage pattern, with all interior surfaces and exposed exterior surfaces provided with acid resistant enamel finish. The type I floor drain shall have a clamping device, secured nickel bronze rim, aluminum enameled finish sediment basket with, perforations with not less than 19 300 square mm (30 square inches) of free area. The sediment basket shall be approximately 100 mm (4 inches) deep, and be provided with grips for easy handling. The floor drain shall be provided with a loose-set, nickel bronze grate approximately 300 mm (12 inches) square and of sufficient strength to support pedestrian traffic. Ample space between body of drain and sediment basket shall be provided for free flow of waste liquids.
- E. Type M (FD-M) floor drain shall comply with ANSI A112.6.3 The type M floor drain shall have a cast iron body, nickel bronze adjustable funnel strainer and clamping device. Funnel strainer shall consist of a perforated floor-level square or round grate and funnel extension. Minimum dimensions as follows:
1. Area of strainer and collar - 23 000 square mm (36 square inches).
 2. Height of funnel - 95 mm (3-3/4 inches).
 3. Diameter of lower portion of funnel - 50 mm (2 inches).
 4. Diameter of top portion of funnel - 100 mm (4 inches).
 5. Provide paper collars for construction purposes.
- F. Type S (FD-S) floor sink shall comply with ANSI A112.6.3. The type S floor sink shall be constructed from type 304 stainless steel and shall be 300 mm (12 inches) square, and 200 mm (8 inches deep). The interior surface shall be polished. The double drainage flange shall be provided with weep holes, internal dome strainer, and heavy duty non-tilting loose set grate. A clamping device shall be provided.
- G. Type Y (FD-Y) floor drain shall comply with ANSI A112.6.3. The type Y floor drain shall be suitable for parking decks and constructed of

extra heavy duty, galvanized cast iron body with double drainage pattern. The extra heavy duty polished bronze grate shall be not less than 225 mm (9 inches) in diameter with seepage pan and combination membrane flashing clamp, heavy duty support flange, under deck clamp and vandal proof grate.

2.6 TRAPS

A. Traps shall be provided on all sanitary branch waste connections from fixtures or equipment not provided with traps. Exposed brass shall be polished brass chromium plated with nipple and set screw escutcheons. Concealed traps may be rough cast brass or same material as pipe connected to. Slip joints are not permitted on sewer side of trap. Traps shall correspond to fittings on cast iron soil pipe or steel pipe respectively, and size shall be as required by connected service or fixture.

2.7 TRAP SEAL PRIMER VALVES AND TRAP SEAL PRIMER SYSTEMS

A. Trap Primer (TP-1): The trap seal primer system shall be electronic type conforming to ASSE 1044.

1. The controller shall have a 24 hour programmable timer, solid state, 6 outlet zones, minimum adjustable run time of 1 minute for each zone, 12 hour program battery backup, manual switch for 120VAC power, 120VAC to 24VAC internal transformer, fuse protected circuitry, UL listed, 120VAC input-24VAC output, constructed of enameled steel or plastic.
2. The cabinet shall be recessed mounting with a stainless steel cover.
3. The solenoid valve shall have a brass body, Buna "N" seats, normally closed, 5.98 kPa (125 psi) rated, 24VAC.
4. The control wiring shall be copper in accordance with the latest edition of the National Electric Code, Article 725 and not less than 18 gauge. All wiring shall be in conduit and in accordance with Division 26 of the specifications.
5. The vacuum breaker shall conform to ASSE 1001.

B. Trap Primer (TP-2): The trap seal primer valve shall be hydraulic, supply type with a pressure rating of 5.98 kPa (125 psig) and conforming to standard ASSE 1018.

1. The inlet and outlet connections shall be 15 mm or DN15 (NPS ½ inch)
2. The trap seal primer valve shall be fully automatic with an all brass or bronze body.

3. The trap seal primer valve shall be activated by a drop in building water pressure, no adjustment required.
4. The trap seal primer valve shall include a manifold when serving two, three, or four traps.
5. The manifold shall be omitted when serving only one trap.

2.9 WATERPROOFING

- A. A sleeve flashing device shall be provided at points where pipes pass through membrane waterproofed floors or walls. The sleeve flashing device shall be manufactured, cast iron fitting with clamping device that forms a sleeve for the pipe floor penetration of the floor membrane. A galvanized steel pipe extension shall be included in the top of the fitting that will extend 50 mm (2 inches) above finished floor and galvanized steel pipe extension in the bottom of the fitting that will extend through the floor slab. A waterproof caulked joint shall be provided at the top hub.
- B. Walls: See detail shown on drawings.

PART 3 - EXECUTION

3.1 PIPE INSTALLATION

- A. The pipe installation shall comply with the requirements of the International Plumbing Code (IPC) and these specifications.
- B. Branch piping shall be installed for waste from the respective piping systems and connect to all fixtures, valves, cocks, outlets, casework, cabinets and equipment, including those furnished by the Government or specified in other sections.
- C. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe shall be reamed to full size after cutting.
- D. All pipe runs shall be laid out to avoid interference with other work.
- E. The piping shall be installed above accessible ceilings where possible.
- F. The piping shall be installed to permit valve servicing or operation.
- G. Unless specifically indicated on the drawings, the minimum slope shall be 2% slope.
- H. The piping shall be installed free of sags and bends.
- I. Seismic restraint shall be installed where required by code.
- J. Changes in direction for soil and waste drainage and vent piping shall be made using appropriate branches, bends and long sweep bends. Sanitary tees and short sweep quarter bends may be used on vertical stacks if change in direction of flow is from horizontal to vertical. Long turn double wye branch and eighth bend fittings shall be used if

two fixtures are installed back to back or side by side with common drain pipe. Straight tees, elbows, and crosses may be used on vent lines. Do not change direction of flow more than 90 degrees. Proper size of standard increaser and reducers shall be used if pipes of different sizes are connected. Reducing size of drainage piping in direction of flow is prohibited.

- K. Buried soil and waste drainage and vent piping shall be laid beginning at the low point of each system. Piping shall be installed true to grades and alignment indicated with unbroken continuity of invert. Hub ends shall be placed upstream. Required gaskets shall be installed according to manufacturer's written instruction for use of lubricants, cements, and other installation requirements.
- L. Cast iron piping shall be installed according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook," Chapter IV, "Installation of Cast Iron Soil Pipe and Fittings"
- M. Aboveground copper tubing shall be installed according to CDA's "Copper Tube Handbook".
- N. Aboveground PVC piping shall be installed according to ASTM D2665. Underground PVC piping shall be installed according to ASTM D2321.

3.2 JOINT CONSTRUCTION

- A. Hub and spigot, cast iron piping with gasket joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for compression joints.
- B. Hub and spigot, cast iron piping with calked joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for lead and oakum calked joints.
- C. Hubless or No-hub, cast iron piping shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for hubless piping coupling joints.
- D. For threaded joints, thread pipe with tapered pipe threads according to ASME B1.20.1. The threads shall be cut full and clean using sharp disc cutters. Threaded pipe ends shall be reamed to remove burrs and restored to full pipe inside diameter. Pipe fittings and valves shall be joined as follows:
 - 1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is required by the pipe service
 - 2. Pipe sections with damaged threads shall be replaced with new sections of pipe.

- E. Copper tube and fittings with soldered joints shall be joined according to ASTM B828. A water flushable, lead free flux conforming to ASTM B813 and a lead free alloy solder conforming to ASTM B32 shall be used.
- F. For PVC piping, solvent cement joints shall be used for joints. All surfaces shall be cleaned and dry prior to applying the primer and solvent cement. Installation practices shall comply with ASTM F402. The joint shall conform to ASTM D2855 and ASTM D2665 appendixes.

3.3 SPECIALTY PIPE FITTINGS

- A. Transition coupling shall be installed at pipe joints with small differences in pipe outside diameters.
- B. Dielectric fittings shall be installed at connections of dissimilar metal piping and tubing.

3.3 PIPE HANGERS, SUPPORTS AND ACCESSORIES:

- A. All piping shall be supported according to the International Plumbing Code (IPC), Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, and these specifications. Where conflicts arise between these the code and Section 22 05 11, the most restrictive or the requirement that specifies supports with highest loading or shortest spacing shall apply.
- B. Hangers, supports, rods, inserts and accessories used for pipe supports shall be shop coated with zinc chromate primer paint. Electroplated copper hanger rods, hangers and accessories may be used with copper tubing.
- C. Horizontal piping and tubing shall be supported within 300 mm (12 inches) of each fitting or coupling.
- D. Horizontal cast iron piping shall be supported with the following maximum horizontal spacing and minimum hanger rod diameters:
 - 1. 40 mm or DN40 to 50 mm or DN50 (NPS 1-1/2 inch to NPS 2 inch): 1500 mm (60 inches) with 10 mm (3/8 inch) rod.
 - 2. 80 mm or DN 80 (NPS 3 inch): 1500 mm (60 inches) with 13 mm (½ inch) rod.
 - 3. 100 mm or DN100 to 125 mm or DN125 (NPS 4 to NPS 5): 1500 mm (60 inches) with 16 mm (5/8 inch) rod.
 - 4. 150 mm or DN150 to 200 mm or DN200 (NPS 6 inch to NPS 8 inch): 1500 mm (60 inches) with 19 mm (¾ inch) rod.
 - 5. 250 mm or DN250 to 300 mm or DN 300 (NPS 10 inch to NPS 12 inch): 1500 mm (60 inch) with 22 mm (7/8 inch) rod.
- E. The maximum spacing for plastic pipe shall be 1.22 m (4 feet).

- F. Vertical piping and tubing shall be supported at the base, at each floor, and at intervals no greater than 4.57 m (15 feet).
- G. In addition to the requirements in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, floor, Wall and Ceiling Plates, Supports, Hangers shall have the following characteristics:
1. Solid or split unplated cast iron.
 2. All plates shall be provided with set screws.
 3. Height adjustable clevis type pipe hangers.
 4. Adjustable floor rests and base flanges shall be steel.
 5. Hanger rods shall be low carbon steel, fully threaded or threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
 7. Riser clamps shall be malleable iron or steel.
 8. Rollers shall be cast iron.
 9. See Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, for requirements on insulated pipe protective shields at hanger supports.
- H. Miscellaneous materials shall be provided as specified, required, directed or as noted on the drawings for proper installation of hangers, supports and accessories. If the vertical distance exceeds 6 m (20 feet) for cast iron pipe additional support shall be provided in the center of that span. All necessary auxiliary steel shall be provided to provide that support.
- I. Cast escutcheon with set screw shall be provided at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
- J. Penetrations:
1. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoke partitions, or floors, a fire stop shall be installed that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING. Clearances between raceways and openings shall be completely filled and sealed with the fire stopping materials.
 2. Water proofing: At floor penetrations, clearances shall be completely sealed around the pipe and make watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS.
- K. Piping shall conform to the following:
1. Waste and Vent Drain to main stacks:

Pipe Size	Minimum Pitch
80 mm or DN 80 (3 inches) and smaller	2%
100 mm or DN 100 (4 inches) and larger	1%

2. Exhaust vents shall be extended separately through roof. Sanitary vents shall not connect to exhaust vents.

3.4 TESTS

- A. Sanitary waste and drain systems shall be tested either in its entirety or in sections.
- B. Waste System tests shall be conducted before trenches are backfilled or fixtures are connected. A water test or air test shall be conducted, as directed.
 1. If entire system is tested for a water test, tightly close all openings in pipes except highest opening, and fill system with water to point of overflow. If the waste system is tested in sections, tightly plug each opening except highest opening of section under test, fill each section with water and test with at least a 3 m (10 foot) head of water. In testing successive sections, test at least upper 3 m (10 feet) of next preceding section so that each joint or pipe except upper most 3 m (10 feet) of system has been submitted to a test of at least a 3 m (10 foot) head of water. Water shall be kept in the system, or in portion under test, for at least 15 minutes before inspection starts. System shall then be tight at all joints.
 2. For an air test, an air pressure of 35 kPa (5 psig) gage shall be maintained for at least 15 minutes without leakage. A force pump and mercury column gage shall be used for the air test.
 3. After installing all fixtures and equipment, open water supply so that all p-traps can be observed. For 15 minutes of operation, all p-traps shall be inspected for leaks and any leaks found shall be corrected.
3. Final Tests: Either one of the following tests may be used.
 - a. Smoke Test: After fixtures are permanently connected and traps are filled with water, fill entire drainage and vent systems with

smoke under pressure of 1.3 kPa (1 inch of water) with a smoke machine. Chemical smoke is prohibited.

- b. Peppermint Test: Introduce (2 ounces) of peppermint into each line or stack.

- - - E N D - - -

SECTION 22 14 00
FACILITY STORM DRAINAGE

PART 1 - GENERAL

1.1 DESCRIPTION

This section describes the requirements for storm drainage systems, including piping and all necessary accessories as designated in this section.

1.2 RELATED WORK

- A. Section 07 84 00, FIRESTOPPING: Penetrations in rated enclosures.
- B. Section 09 91 00, PAINTING: Preparation and finish painting and identification of piping systems.
- C. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: Pipe Hangers and Supports, Materials Identification.
- D. Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION: Pipe Insulation.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Piping.
 - 2. Roof Drains.
 - 3. Cleanouts.
 - 4. All items listed in Part 2 - Products.
- C. Detailed shop drawing of clamping device and extensions when required in connection with the waterproofing membrane.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standards Institute (ANSI).
- C. American Society of Mechanical Engineers (ASME): (Copyrighted Society)
 - A112.21.2m-83Roof Drains
 - A13.1-07Scheme for Identification of Piping Systems
 - B16.3-06Malleable Iron Threaded Fittings, Classes 150 and 300. B16.9-07 Factory-Made Wrought Steel Butt welding Fittings

- B16.11-05Forged Steel Fittings, Socket-Welding and
Threaded B16.12-98 (R 2006) Cast Iron
Threaded Drainage Fittings
- B16.15-06)Cast Bronze Threaded Fittings, Class 125 and
250
- B16.18-01 (R 2005)Cast Copper Alloy Solder-Joint Pressure
Fittings
- B16.22-01 (R 2005)Wrought Copper and Copper Alloy Solder Joint
Pressure Fittings
- D. American Society for Testing and Materials (ASTM):
- A47-99 (R 2004)Standard Specification for Steel Sheet,
Aluminum Coated, by the Hot-Dip Process
- A53-07Standard Specification for Pipe, Steel, Black
And Hot-Dipped, Zinc-coated Welded and Seamless
- A74-06Standard Specification for Cast Iron Soil Pipe
and Fittings
- A183-03)Standard Specification for Carbon Steel Track
Bolts and Nuts
- A312-03Standard Specification for Seamless and Welded
Austenitic Stainless Steel Pipe
- A536-84(R 2004)Standard Specification for Ductile Iron
Castings
- A733-03Standard Specification for Welded and Seamless
Carbon Steel and Austenitic Stainless Steel
Pipe Nipples
- B32-04Standard Specification for Solder Metal
- B61-08Standard Specification for Steam or Bronze
Castings
- B62-02Standard Specification for Composition Bronze
or Ounce Metal Castings
- B75-02Standard Specification for Seamless Copper Tube
- B88-03Standard Specification for Seamless Copper
Water Tube
- B306-02Standard Specification for Copper Drainage Tube
(DWV)
- B584-08Standard Specification for Copper Alloy Sand
Castings for General Applications

- B687-99Standard Specification for Brass, Copper, and
Chromium-Plated Pipe Nipples
- C564-06aStandard Specification for Rubber Gaskets for
Cast Iron Soil Pipe and Fittings
- D2000-08Standard Classification System for Rubber
Products in Automotive Applications
- D4101-07Standard Specification for Propylene Plastic
Injection and Extrusion Materials
- D2447-03Standard Specification for Polyethylene (PE)
Plastic Pipe, Schedule 40 and 80, Based on
Outside Diameter
- D2564-04e1Standard Specification for Solvent Cements for
Poly (Vinyl Chloride) (PVC) Plastic Pipe and
Fittings
- D2665-07Standard Specification for Poly (Vinyl
Chloride) (PVC) Plastic Drain, Waste, and Vent
Pipe and Fittings
- E. American Welding Society (AWS):
- A5.8-04Specification for Filler Metals for Brazing and
Braze Welding
- F. International Code Council (ICC):
- IPC-06International Plumbing Code
- G. Cast Iron Soil Pipe Institute (CISPI):
- 301-05Hubless Cast Iron Soil and Fittings for
Sanitary and Storm Drain, Waste, and Vent
Piping Applications
- 310-04Couplings for Use in Connection with Hubless
Cast Iron Soil and Fittings for Sanitary and
Storm Drain, Waste, and Vent Piping
Applications
- H. Manufacturers Standardization Society of the Valve and Fittings
Industry, Inc. (MSS):
- SP-72-99Standard for Ball Valves with Flanged or Butt
Welding For General Purpose
- SP-110-96Ball Valve Threaded, Socket Welding, Solder
Joint, Grooved and Flared Ends

PART 2 - PRODUCTS

2.1 STORM WATER DRAIN PIPING

A. Cast Iron Storm Pipe and Fittings:

1. Cast iron storm pipe and fittings shall be used for the following applications:
 - a. Pipe buried in or in contact with earth.
 - b. Extension of pipe to a distance of approximately 1500 mm (5 feet) outside of building walls.
 - c. Interior storm piping above grade.
 - d. All mechanical equipment rooms or other areas containing mechanical air handling equipment.
2. The cast iron storm Pipe shall be bell and spigot, or hubless (plain end or no-hub) as required by selected jointing method.
3. The material for all pipe and fittings shall be cast iron soil pipe and fittings and shall conform to the requirements of CISPI Standard 301, ASTM A-888, or ASTM A-74.
4. Joints for hubless pipe and fittings shall conform to the manufacturer's installation instructions. Couplings for hubless joints shall conform to CISPI 310. Joints for hub and spigot pipe shall be installed with compression gaskets conforming to the requirements of ASTM Standard C-564 or be installed with leak and oakum.

B. Copper Tube, (DWV): May be used for piping above ground.

1. The copper DWV tube shall be drainage type, drawn temper conforming to ASTM B306.
2. The Copper drainage fittings shall be cast copper or wrought copper conforming to ASME B16.23 or ASME 16.29.
3. The joints shall be lead free, using a water flushable flux, and conforming to ASTM B32.

C. Polyvinyl Chloride (PVC)

1. Polyvinyl chloride storm sewer pipe and fittings are permitted for single story structures except for mechanical equipment rooms and other areas containing air handling equipment or hot water generation equipment.
2. Polyvinyl chloride storm sewer pipe and fittings shall be schedule 40 solid core sewer piping conforming to ASTM D1785 and D 2665, Sewer and Drain Series, with ends for solvent cemented joints.

3. Polyvinyl chloride joints shall be solvent welded socket type using solvent cement conforming to ASTM D2564.

D. Roof drain piping in locations where the outdoor conditions are subject to freezing shall be insulated.

2.2 PUMPED DRAIN PIPING:

A. Pumped drain piping under 100 mm (4 inches) shall be copper tube conforming to ASTM B88, type K or L. For pumped drain piping 100 mm (4 inches) and above, galvanized steel conforming to A 53, seamless, schedule 40 may be used.

B. Pumped drain pipe fittings shall comply with the following:

1. Wrought copper or bronze castings conforming to ANSI B16.18 and B16.22.
2. Unions shall be bronze, MSS SP-72, SP-110. Solder or braze joints.
3. Grooved fittings, 65 mm to 100 mm (2-1/2 to 4 inch) wrought copper ASTM A75 C12200, 125 to 150 mm (5 to 6 inch) bronze castings ASTM B584, CDA 844. Mechanical grooved couplings, ductile iron, ASTM A536 (Grade 65-45-12), malleable iron, ASTM A47 (Grade 32510) housing, with EPDM gasket, steel track head bolts, ASTM A183, coated with colored alkyd enamel.

C. Adapters shall be provided for joining screwed pipe to copper tubing.

D. The solder shall use a non-corrosive flux conforming to ASTM B32.

2.3 SPECIALTY PIPE FITTINGS

A. Transition pipe couplings shall join piping with small differences in outside diameters or be of different materials. End connections shall be of the same size and compatible with the pipes being joined. The transition coupling shall be elastomeric, sleeve type reducing or transition pattern and include shear erring and corrosion resistant metal tension band and tightening mechanism on each end. The transition coupling sleeve coupling shall be of the following material:

1. For cast iron soil pipes, the sleeve material shall be rubber conforming to ASTM C564.
2. For PVC soil pipes, the sleeve material shall be elastomeric seal or PVC, conforming to ASTM F 477 or ASTM D5926.
3. For dissimilar pipes, the sleeve material shall be PVC conforming to ASTM D5926, or other material compatible with the pipe materials being joined.

B. The dielectric fittings shall conform to ASSE 1079 with a pressure rating of 860 kPa (125 psig) at a minimum temperature of 82°C (180°F).

The end connection shall be solder joint copper alloy and threaded ferrous.

- C. Dielectric flange insulating kits shall be of non conducting materials for field assembly of companion flanges with a pressure rating of 1035 kPa (150 psig). The gasket shall be neoprene or phenolic. The bolt sleeves shall be phenolic or polyethylene. The washers shall be phenolic with steel backing washers.
- D. The dielectric nipples shall be electroplated steel nipple comply with ASTM F 1545 with a pressure ratings of 2070 kPa (300 psig) at 107°C (225°F). The end connection shall be male threaded. The lining shall be inert and noncorrosive propylene.

2.4 CLEANOUTS

- A. Cleanouts shall be the same size as the pipe, up to 100 mm (4 inches); not less than 100 mm (4 inches) for larger pipe. Cleanouts shall be easily accessible and shall be gastight and watertight. A minimum clearance of 600 mm (24 inches) shall be provided for clearing a clogged storm sewer line.
- B. Floor cleanouts shall be gray iron housing with clamping device and round, secured, scoriated, gray iron cover conforming to ASME A112.36.2M. A gray iron ferrule with hubless, socket, inside calk or spigot connection and counter sunk, taper-thread, brass or bronze closure plug shall be included. The frame and cover material and finish shall be nickel-bronze copper alloy with a square shape. The cleanout shall be vertically adjustable for a minimum of 50 mm (2 inches). When a waterproof membrane is used in the floor system, clamping collars shall be provided on the cleanouts. Cleanouts shall consist of wye fittings and eighth bends with brass or bronze screw plugs. Cleanouts in the resilient tile floors, quarry tile and ceramic tile floors shall be provided with square top covers recessed for tile insertion. In the carpeted areas, carpet cleanout markers shall be provided. Two way cleanouts where shall be provided where indicated on the drawings and at each building exit. The loading classification for cleanouts in sidewalk areas or subject to vehicular traffic shall be heavy duty.
- C. Cleanouts shall be provided at or near the base of the vertical stacks with the cleanout plug located approximately 600 mm (24 inches) above the floor. The cleanouts shall be extended to the wall access cover. Cleanout shall consist of sanitary tees. Nickel bronze square frame and

stainless steel cover with minimum opening of 150 mm by 150 mm (6 inch by 6 inch) shall be provided at each wall cleanout.

- D. In horizontal runs above grade, cleanouts shall consist of cast brass tapered screw plug in fitting or caulked/no hub cast iron ferrule. Plain end (no-hub) piping in interstitial space or above ceiling may use plain end (no-hub) blind plug and clamp.

2.5 ROOF DRAINS AND CONNECTIONS

- A. Roof Drains: Roof Drains (RD) shall be cast iron with clamping device for making watertight connection. Free openings through strainer shall be twice area of drain outlet. For roof drains not installed in connection with a waterproof membrane, a soft copper membrane shall be provided 300 mm (12 inches) in diameter greater than outside diameter of drain collar. An integral gravel stop shall be provided for drains installed on roofs having built up roofing covered with gravel or slag. Integral no-hub, soil pipe gasket or threaded outlet connection shall be provided.

1. Flat Roofs: The roof drain shall have a beehive or dome shaped strainer with integral flange not less than 300 mm (12 inches) in diameter. For an insulated roof, a roof drain with an adjustable drainage collar shall be provided, which can be raised or lowered to meet required insulation heights, sump receiver and deck clamp. The Bottom section shall serve as roof drain during construction before insulation is installed.
2. Canopy Roofs: The roof drain shall have a beehive or dome shaped strainer with the integral flange not larger than 200 mm (8 inches) in diameter. For an insulated roof, the roof drain shall be provided with an adjustable drainage collar, which can be raised or lowered to meet the required insulation heights, sump receiver and deck clamp. Bottom section shall serve as roof drain during construction before insulation is installed.
5. Protective Roof Membrane Insulation Assembly: The roof drain shall have a perforated stainless steel extension filter, non puncturing clamp ring, large sump with extra wide roof flange and deck clamp.
 - a. Non pedestrian Roofs: The roof drain shall have large polypropylene or aluminum locking dome.
 - b. Pedestrian Roof: The rood drain shall have a bronze promenade top 350 mm (14 inches) square, set in square secured frame support collar.

6. Roof Drains, Overflow: Roof Drains identified as overflow drains shall have a 50 mm (2 inch) water dam integral to the drain body.
7. Roof drains in areas subject to freezing shall have heat tape and shall be insulated.
- B. Expansion Joints: Expansions joints shall be heavy cast iron with cast brass or copper expansion sleeve having smooth bearing surface working freely against a packing ring held in place and under pressure of a bolted gland ring, forming a water and air tight flexible joint. Asbestos packing is prohibited.
- C. Interior Downspouts: An expansion joint shall be provided, specified above, at top of run on straight, vertical runs of downspout piping 12 m (40 feet) long or more.
- D. Downspout Nozzle: The downspout nozzle fitting shall be of brass, unfinished, with internal pipe thread for connection to downspout.

2.6 WATERPROOFING

- A. A sleeve flashing device shall be provided at points where pipes pass through membrane waterproofed floors or walls. The sleeve flashing device shall be manufactured, cast iron fitting with clamping device that forms a sleeve for the pipe floor penetration of the floor membrane. A galvanized steel pipe extension shall be included in the top of the fitting that will extend 50 mm (2 inches) above finished floor and galvanized steel pipe extension in the bottom of the fitting that will extend through the floor slab. A waterproofed caulked joint shall be provided at the top hub.
- B. Walls: See detail shown on drawings.

PART 3 - EXECUTION

3.1 PIPE INSTALLATION

- A. The pipe installation shall comply with the requirements of the International code and these specifications.
- B. Branch piping shall be installed from the piping system and connect to all drains and outlets.
- C. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe shall be reamed to full size after cutting.
- D. All pipe runs shall be laid out to avoid interference with other work.
- E. The piping shall be installed above accessible ceilings to allow for ceiling panel removal.
- F. Unless otherwise stated on the documents, minimum horizontal slope shall be one inch for every 1.22 m (4 feet) of pipe length.

- G. The piping shall be installed free of sags and bends.
- I. Changes in direction for storm drainage piping shall be made using appropriate branches, bends and long sweep bends. Sanitary tees and short sweep $\frac{1}{4}$ bends may be used on vertical stacks if change in direction of flow is from horizontal to vertical. Long turn double wye branch and $\frac{1}{8}$ bend fittings shall be used if two fixtures are installed back to back or side by side with common drain pipe. Do not change direction of flow more than 90 degrees. Proper size of standard increaser and reducers shall be used if pipes of different sizes are connected. Reducing size of drainage piping in direction of flow is prohibited.
- J. Buried storm drainage piping shall be laid beginning at the low point of each system. Piping shall be installed true to grades and alignment indicated with unbroken continuity of invert. Hub ends shall be placed upstream. Required gaskets shall be installed according to manufacturer's written instruction for use of lubricants, cements, and other installation requirements.
- K. Cast iron piping shall be installed according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook," Chapter IV, "Installation of Cast Iron Soil Pipe and Fittings"
- L. Aboveground copper tubing shall be installed according to CDA's "Copper Tube Handbook".
- M. Aboveground PVC piping shall be installed according to ASTM D2665. Underground PVC piping shall be installed according to ASTM D2321.

3.2 JOINT CONSTRUCTION

- A. Hub and spigot, cast iron piping with gasket joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for compression joints.
- B. Hub and spigot, cast iron piping with calked joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for lead and oakum calked joints.
- C. Hubless, cast iron piping shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for hubless piping coupling joints.
- D. For threaded joints, thread pipe with tapered pipe threads according to ASME B1.20.1. The threads shall be cut full and clean using sharp disc cutters. Threaded pipe ends shall be reamed to remove burrs and

restored to full pipe inside diameter. Pipe fittings and valves shall be joined as follows:

1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is required by the pipe service
 2. Pipe sections with damaged threads shall be replaced with new sections of pipe.
- E. Copper tube and fittings with soldered joints shall be joined according to ASTM B828. A water flushable, lead free flux conforming to ASTM B813 and a lead free alloy solder conforming to ASTM B32 shall be used.
- F. for PVC piping, solvent cement joints shall be used for joints. All surfaces shall be cleaned and dry prior to applying the primer and solvent cement. Installation practices shall comply with ASTM F402. The joint shall conform to ASTM D2855 and ASTM D2665 appendixes.

3.3 SPECIALTY PIPE FITTINGS

- A. Transition coupling shall be installed at pipe joints with small differences in pipe outside diameters.
- B. Dielectric fittings shall be installed at connections of dissimilar metal piping and tubing.

3.4 PIPE HANGERS, SUPPORTS AND ACCESSORIES:

- A. All piping shall be supported according to the International plumbing code, Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, and these specifications.
- B. Hangers, supports, rods, inserts and accessories used for Pipe supports shall be shop coated with zinc Chromate primer paint. Electroplated copper hanger rods, hangers and accessories may be used with copper tubing.
- C. Horizontal piping and tubing shall be supported within 300 mm (12 inches) of each fitting or coupling.
- D. Horizontal cast iron piping shall be supported with the following maximum horizontal spacing and minimum hanger rod diameters:
 1. NPS 1-1/2 to NPS 2 (DN 40 to DN 50): 1500 mm (60 inches) with 10 mm (3/8 inch) rod.
 2. NPS 3 (DN 80): 1500 mm (60 inches) with 13 mm (1/2 inch) rod.
 3. NPS 4 to NPS 5 (DN 100 to DN 125): 1500 mm (60 inches) with 16 mm (5/8 inch) rod.
 4. NPS 6 to NPS 8 (DN 150 to DN 200): 1500 mm (60 inches) with 19 mm (3/4 inch) rod.

5. NPS 10 to NPS 12 (DN 250 to DN 300): 1500 mm (60 inches) with 22 mm (7/8 inch) rod.
- E. The maximum support spacing for horizontal plastic shall be 1.22 m (4 feet).
- F. Vertical piping and tubing shall be supported at the base, at each floor, and at intervals no greater than 4.57 m (15 feet).
- G. In addition to the requirements in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, floor, Wall and Ceiling Plates shall have the following characteristics:
1. Solid or split unplated cast iron.
 2. All plates shall be provided with set screws.
 3. Height adjustable clevis type pipe hangers.
 4. Adjustable Floor Rests and Base Flanges shall be steel.
 5. Hanger Rods shall be low carbon steel, fully threaded or Threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
 6. Riser Clamps shall be malleable iron or steel.
 7. Roller shall be cast iron.
 8. Hangers and supports utilized with insulated pipe and tubing shall have 180 degree (min.) metal protection shield Centered on and welded to the hanger and support. The shield shall be 4 inches in length and be 16 gage steel. The shield shall be sized for the insulation.
- H. Miscellaneous Materials shall be provided as specified, required, directed or as noted on the drawings for proper installation of hangers, supports and accessories. If the vertical distance exceeds 6 m (20 feet) for cast iron pipe additional support shall be provided in the center of that span. All necessary auxiliary steel shall be provided to provide that support.
- I. Cast escutcheon with set screw shall be installed at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
- J. Penetrations:
1. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoke partitions, or floors, a fire stop shall be installed that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING. Clearances

- between raceways and openings shall be completely filled and sealed with the fire stopping materials.
2. Water proofing: At floor penetrations, Clearances around the pipe shall be completely sealed and made watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS.
- K. Piping shall conform to the following:
1. Storm Water Drain and Vent Drain to main stacks:

Pipe Size	Minimum Pitch
80 mm (3 inches) and smaller	2%
100 mm (4 inches) (4 inches) and larger	1%

3.5 TESTS

- A. Storm sewer system shall be tested either in its entirety or in sections.
- B. Storm Water Drain tests shall be conducted before trenches are backfilled or fixtures are connected. A water test or air test shall be conducted, as directed.
1. If entire system is tested with water, tightly close all openings in pipes except the highest opening, and fill system with water to point of overflow. If system is tested in sections, tightly plug each opening except highest opening of section under test, fill each section with water and test with at least a 3 m (10 foot) head of water. In testing successive sections, test at least upper 3 m (10 feet) of next preceding section so that each joint or pipe except upper most 3 m (10 feet) of system has been submitted to a test of at least a 3 m (10 foot) head of water. Water shall be kept in the system, or in portion under test, for at least 15 minutes before inspection starts. System shall then be tight at all joints.
2. For an air test, an air pressure of 35 kPa (5 psi) gage shall be maintained for at least 15 minutes without leakage. A force pump and mercury column gage shall be used for the test.
3. Final Tests: Either one of the following tests may be used.
- a. Smoke Test: After fixtures are permanently connected and traps are filled with water, fill entire drainage and vent systems with

smoke under pressure of 1.3 kPa (1 inch of water) with a smoke machine. Chemical smoke is prohibited.

- b. Peppermint Test: Introduce .06 liters (2 ounces) of peppermint into each line or stack.

- - - E N D - - -

SECTION 22 14 29
SUMP PUMPS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Sump pumps. See schedule or detail on Drawings for pump capacity and head.

1.2 RELATED WORK

- A. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- B. Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT.
- C. SECTION 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS. Requirements for commissioning, systems readiness checklist, and training.
- D. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Pump:
 - a. Manufacturer and model.
 - b. Operating speed.
 - c. Capacity.
 - d. Characteristic performance curves.
 - 2. Motor:
 - a. Manufacturer, frame and type.
 - b. Speed.
 - c. Current Characteristics and W (HP).
 - d. Efficiency.
- C. Certified copies of all the factory and construction site test data sheets and reports.
- D. Complete operating and maintenance manuals including wiring diagrams, technical data sheets and information for ordering replaceable parts:
 - 1. Include complete list which indicates all components of the system.
 - 2. Include complete diagrams of the internal wiring for each item of equipment.
 - 3. Diagrams shall have their terminals identified to facilitate installation, operation and maintenance.
- E. Completed System Readiness Checklist provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. National Electrical Manufacturers Association (NEMA):
 - ICS6-93 (2006)Industrial Control and Systems Enclosures
 - 250-2008Enclosures for Electrical Equipment (1000 Volts Maximum)
- C. Underwriters' Laboratories, Inc. (UL):
 - 508-99 (R2008)Standards For Industrial Control Equipment

PART 2 - PRODUCTS

2.1 SUMP PUMP

- A. Centrifugal, vertical, submersible pump and motor. Driver shall be electric motor. Support shall be rigid type. Provide perforated, suction strainer. Systems may include one, two, or more pumps with alternator as required by: Contract Documents Pump shall be capable of continuous duty cycle.
 - 1. Pump housings may be cast iron, bronze, aluminum, plastic or stainless steel. Cast iron and aluminum housings for submersible pumps shall be epoxy coated.
- B. Impeller: Brass, bronze or cast iron.
- C. Shaft: Stainless steel or other approved corrosion-resisting metal.
- D. Bearings: As required to hold shaft alignment, anti-friction type for thrust permanently lubricated.
- E. Motor: Maximum 40 degrees C (104 degrees F) ambient temperature rise above the maximum fluid temperature being pumped , completely enclosed, voltage and phase as shown in schedule on Electrical drawings. Size the motor capacity to operate pump without overloading the motor at any point on the pump curve. Refer to Section 22 05 12, GENERAL MOTOR REQUIREMENTS FOR PLUMBING EQUIPMENT.
- G. Automatic Control and Level Alarm: Furnish a control panel in a Nema 1 enclosure for indoors . The controls shall be suitable for operation with the electrical characteristics listed on the Electrical drawings. The control panel shall have a level control system with switches to start and stop pumps automatically, and to activate a high water alarm. The level control system will include sensors in the sump that detect the level of the liquid. The sensors may be float type switches, ultrasonic level sensors, transducers, or other appropriate equipment. The high water alarm shall have a red beacon light at the control panel and a buzzer, horn, or bell. The alarm shall have a silencing switch. Provide auxiliary contacts for remote alarming to the Energy Control

Center and BAC net compatible open-protocol type interface to DDC Controls System.

1. The circuitry of the control panel shall include:
 - a. power switch to turn on/off the automatic control mechanism
 - b. HOA switches to manually override automatic control mechanism
 - c. run lights to indicate when pumps are powered up
 - d. level status lights to indicate when water in sump has reached the predetermined on/off and alarm levels
 - e. magnetic motor contactors
 - f. disconnect/breaker for each pump
 - g. automatic motor overload protection
2. Sensors that detect the level of water in the sump shall be so arranged as to allow the accumulation of enough volume of liquid below the normal on level that the pump will run for a minimum cycle time as recommended by the pump manufacturer. Sensors shall be located to activate the alarm adequately before the water level rises to the inlet pipe.
3. Provide two separate power supplies to the control panel, one for the control/alarm circuitry and one for power to the pump motors. Each power supply is to be fed from its own breaker so that if a pump overload trips a breaker, the alarm system will still function. Each power supply is to be wired in its own conduit.
4. Wiring from the sump to the control panel shall have separate conduits for the pump power and for the sensor switches. All conduits are to be sealed at the basin and at the control panel to prevent the intrusion of moisture and of flammable and/or corrosive gases.
- H. Sump: Concrete sump shall be coordinated with elevator pit construction. Sump shall be sized to allow an adequate volume of water to accumulate for a minimum one minute cycle of pump operation.
- I. Provide a check and ball valve in the discharge of each pump.
- J. Removal/Disconnect System: In a system utilizing a submersible pump, where sump depth, pump size, or other conditions make removal of the pump unusually difficult or unsafe, a removal/disconnect system shall be provided. The system will consist of a discharge fitting mounted on vertical guide rails attached to the sump. The pump shall be fitted with an adapter fitting that easily connects to/disconnects from the discharge fitting as the pump is raised from or lowered into the sump. The discharge piping will connect to the discharge fitting so that it is not necessary to disconnect any piping in order to remove the pump. Where the sump depth is greater than five feet or other conditions exist to make the removal of the pump difficult or hazardous, the system shall

include a rail guided quick disconnect apparatus to allow the pump to be pulled up out of the sump without workers entering the sump and without disconnecting the piping.

PART 3 - EXECUTION

3.1 STARTUP AND TESTING

- A. Make tests as recommended by product manufacturer and listed standards and under actual or simulated operating conditions and prove full compliance with design and specified requirements. Tests of the various items of equipment shall be performed simultaneously with the system of which each item is an integral part.
- B. The tests shall include system capacity and all control and alarm functions.
- C. When any defects are detected, correct defects and repeat test.
- D. The commissioning Agent will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with the Resident Engineer and Commissioning Agent. Provide a minimum of 7 days prior to notice.

3.2 COMMISSIONING

- A. Provide commissioning documentation accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS for all inspection, startup, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS and related sections for contractor responsibilities for system commissioning.

3.3 DEMONSTRATION AND TRAINING

- A. Provide services of manufacturer's technical representative for four hours to instruct VA Personnel in operation and maintenance of units.
- B. Submit training plans and instructor qualifications in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

- - - E N D - - -

SECTION 22 33 00
ELECTRIC DOMESTIC WATER HEATERS

PART 1 - GENERAL

1.1 DESCRIPTION:

This section describes the requirements for installing a complete electric domestic water heater system ready for operation including the water heaters, thermometers, and all necessary accessories, connections, and equipment.

1.2 RELATED WORK:

- A. Section 09 91 00, PAINTING: Preparation and finish painting.
- B. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- C. Section 22 11 23, DOMESTIC WATER PUMPS: Circulating Pumps.
- D. Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION: Heater Insulation.
- E. Section 22 05 19, METERS AND GAGES FOR PLUMBING PIPING, 22 05 23, GENERAL-DUTY VALVES FOR PLUMBING PIPING, and 22 11 00, FACILITY WATER DISTRIBUTION: Piping, Fittings, Valves and Gages.

1.3 QUALITY ASSURANCE:

- A. Comply with American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE) for efficiency performance:
 - 1. ASHRAE 90.1, Energy Efficient Design of New Buildings except Low-Rise Residential Buildings, "for commercial water heaters."
- B. Electrical components, devices and accessories shall be listed and labeled B as defined in NFPA 70 by a qualified testing agency, and marked for intended location and application.
- C. ASME code construction shall be a vessel fabricated in compliance with the ASME boiler and Pressure Vessel Code: Section VIII, Division 1.
- D. Fabricate and label equipment components that will be in contact with potable water to comply with NSF 61, "Drinking Water System Components - Health Effects"

1.4 SUBMITTALS:

- A. Submit manufacturer's literature and data pertaining to the water heater in properly bound package, in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Include the following as a minimum:
 - 1. Water Heaters.
 - 2. Pressure and Temperature Relief Valves.
 - 4. Thermometers.

5. Pressure Gages.
6. Vacuum Breakers.
- B. For each electric domestic hot water heater type and size, the following characteristics shall be submitted:
 1. Rated Capacities.
 2. Operating characteristics.
 3. Electrical characteristics.
 4. Furnished specialties and accessories.
 5. A form U-1 or other documentation stating compliance with the ASME Boiler and Pressure Vessel code.
- C. Shop drawings shall include wiring diagrams for power, signal and control functions.
- E. The domestic water heater shall be certified and labeled by a testing agency.

1.5 APPLICABLE PUBLICATIONS:

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Sanitary Engineering (ASSE):
1005.....Performance Requirements for Water Heater Drain Valves, 20 mm (3/4 inch) size
- C. American National Standard Institute (ANSI):
Z21.22B-2001.....Relief Valves for Hot Water Supply Systems
- D. American Society of Mechanical Engineers (ASME):
B1.20.1-83(R 2006).....Pipe Threads, General Purpose (Inch)
B16.5-03.....Standard for Pipe Flanges and Flanged Fittings:
NPS ½ through NPS 24
B16.24-06.....Cast Copper Alloy Pipe Flanges and Flanged Fittings: Classes 150, 300, 400, 600, 900, 1500, and 2500.
PTC 25.3-02.....Pressure Relief Devices
Section IV-07.....Boiler and Pressure Vessel Code; Section IV, Recommended Rules for the Care and Operation of Heating Boilers
Section VIII D1-07.....Boiler and Pressure Vessel Code, Section VIII, Pressure Vessels Division 1 -Basic Coverage
- E. National Fire Protection Association (NFPA)
70-06.....National Electrical Code

F. Underwriters Laboratories, Inc. (UL):

174-04.....Household Electric Storage Tank Water Heaters

1453-04.....Water Heaters, Electric Booster and Commercial
Storage Tank

499-05.....Standard for Safety Electric Heating Appliances

1.6 AS-BUILT DOCUMENTATION

- A. The electronic documentation and copies of the Operations and Maintenance Manual, approved submittals, shop drawings, and other closeout documentation shall be prepared by a computer software program complying with Section 508 of the Rehabilitation Act of 1973, as amended (29 U.S.C 794d). The manufacturer or vendor of the software used to prepare the electronic documentation shall have a Voluntary Product Accessibility Template made available for review and included as part of the Operations and Maintenance Manual or closeout documentation. All available accessibility functions listed in the Voluntary Accessibility Template shall be enabled in the prepared electronic files. As Adobe Acrobat is a common industry format for such documentation, following the document, "Creating Accessible Adobe PDF files, A Guide for Document Authors" that is maintained and made available by Adobe free of charge is recommended."
- B. Four sets of manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.
- C. Four sets of operation and maintenance data updated to include submittal review comments shall be inserted into a three ring binder. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices such as damper and door closure interlocks shall be included. A List of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.

PART 2 - PRODUCTS

2.1 ELECTRIC DOMESTIC WATER HEATERS:

- A. The tank construction shall be steel shell, with a inner tank liner complying with NSF 61 for barrier materials for potable water. The inner liner shall be extended into the tappings. The vessel shall be ASME Boiler and Pressure Vessel Code (BPVC), section VIII, fabricated with a pressure rating of 1035 kPa (150 psig)
- B. Tapping (openings) shall be Factory fabricated of materials compatible with the tank and in accordance with appropriate ASME standards B1.20.1 for piping connections, pressure and temperature relief valve, pressure gauge, thermometer, drain valve, anode rods and controls as required. Tappings shall comply with the following:
 - 1. 50 mm or DN50 (2 inch) and smaller: Threaded ends according to ASME B1.20.1.
 - 2. 65 mm or DN65 (2 1/2-inch) and Larger: Flanged ends according to ASME B16.5 for steel and stainless steel flanges, and according to ASME B 16.24.
- C. Tank insulation shall comply with ASHRAE 90.1.
- D. For domestic hot water heater sizes greater than 9 KW, the heating element shall be arranged in multiples of three elements.
- E. The domestic hot water heaters shall have screw in or bolt in immersion type, thermostatically adjustable. Set thermostat for maximum water temperature of 60°C (140°F). The electrical characteristics are scheduled on the drawings.
- F. Combination Pressure and Temperature Relief Valves shall be ASME rated and stamped for combination temperature and pressure relief valves. One or more relief valves with total relieving capacity at least as great as the heat input shall be included. The pressure setting shall be less than the domestic water heater working pressure rating.
- G. the anode rod shall be replaceable magnesium.
- H. the drain valve shall be corrosion resistant metal complying with ASSE 1005.

2.3 DOMESTIC HOT WATER COMPRESSION TANKS

- A. A steel pressure rated tank constructed with welded joints and factory installed butyl rubber diaphragm shall be installed as scheduled. The air pre charge shall be set to minimum system operating pressure at tank.

- B. The tappings shall be factory fabricated steel, welded to the tank and include ASME B1.20.1 pipe thread.
- C. The interior finish shall comply with NSF 61 barrier materials for potable water tank linings and the liner shall extend into and through the tank fittings and outlets.
- D. The air charging valve shall be factory installed.

2.5 HEAT TRAPS

- A. Heat traps shall be installed in accordance with ASHRAE 90.1, latest edition.

2.6 COMBINATION TEMPERATURE AND PRESSURE RELIEF VALVES

- A. The combination temperature and pressure relief valves shall be ASME rated and stamped and include a relieving capacity at least as great as the heat input and include a pressure setting less than the water heater's working pressure rating.

2.7 THERMOMETERS:

The thermometers shall be straight stem, iron case, red reflecting mercury thermometer or red liquid-filled thermometers, approximately 175 mm (7 inches) high, 4 to 115°C (40 to 240°F).

PART 3 - EXECUTION

3.1 INSTALLATION:

- A. Water heaters shall be installed on concrete bases unless elevated above the floor. Refer to Specification Section 03 30 00, CAST-IN-PLACE CONCRETE and Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING
- B. The water heaters shall be installed level and plumb and securely anchored.
- C. The water heaters shall be installed and connected in accordance with manufacturer's written instructions.
- D. All pressure and temperature relief valves discharge shall be piped to nearby floor drains.
- E. Thermometers shall be installed on the water heater inlet and outlet piping.
- F. The thermostatic control shall be set for a maximum setting of 60 degrees C (140 degrees F).
- G. Shutoff valves shall be installed on the domestic water supply piping to the water heater and on the domestic hot water outlet piping.
- H. All manufacturers's required clearances shall be maintained.
- J. A combination temperature and pressure relief valve shall be installed at the top portion of the storage tank. The sensing element shall

extend into the tank. The relief valve outlet drain piping shall discharge by positive air gap into a floor drain.

- K. Piping type heat traps shall be installed on the inlet and outlet piping of the electric domestic hot water heater storage tanks.
- L. Water heater drain piping shall be installed as indirect waste to spill by positive air gap into open drains or over floor drains. Hose end drain valves shall be installed at low points in water piping for electric domestic hot water heaters without integral drains.

3.2 LEAKAGE TEST:

Before piping connections are made, water heaters shall be tested with hydrostatic pressure of 1375 kPa (200 psi) and 1654 kPa (240 psi) for a unit with a MAWP of 1103 kPa (160 psi). Any domestic water heater leaking water shall be replaced with a new unit at no additional cost to the VA.

3.3 PERFORMANCE TEST:

All of the remote water outlets shall have a minimum of 41°C (105°F) and a maximum of 43°C (110°F) water flow at all times. If necessary, make all corrections to balance the return water system or reset the thermostat to make the system comply with design requirements.

- - - E N D - - -

SECTION 22 40 00
PLUMBING FIXTURES

PART 1 - GENERAL

1.1 DESCRIPTION

Plumbing fixtures, associated trim and fittings necessary to make a complete installation from wall or floor connections to rough piping, and certain accessories.

1.2 RELATED WORK

- A. Sealing between fixtures and other finish surfaces: Section 07 92 00, JOINT SEALANTS.
- D. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Submit plumbing fixture information in an assembled brochure, showing cuts and full detailed description of each fixture.

1.4 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standard Institute (ANSI):
The American Society of Mechanical Engineers (ASME):
A112.19.2M-03(R2008) ...Vitreous China Plumbing Fixtures
A112.19.3-2001(R2008) ..Stainless Steel Plumbing fixtures (Designed for Residential Use)
- C. American Society for Testing and Materials (ASTM):
A276-2003Stainless and Heat-Resisting Steel Bars and Shapes
- D. National Association of Architectural Metal Manufacturers (NAAMM): NAAMM AMP 500-505
Metal Finishes Manual (1988)
- E. American Society of Sanitary Engineers (ASSE):
1016-05Performance Requirements for Individual
Thermostatic, Pressure Balancing and Combination
Pressure Balancing and Thermostatic Control
Valves for Individual Fixture Fittings
- F. National Sanitation Foundation (NSF)/American National Standards Institute (ANSI):
61-03Drinking Water System Components-Health Effects

G. American with Disabilities Act(A.D.A) Section 4-19.4 Exposed Pipes and
Surfaces

PART 2 - PRODUCTS

2.1 STAINLESS STEEL

A. Corrosion-resistant Steel (CRS):

1. Plate, Sheet and Strip: CRS flat products shall conform to chemical composition requirements of any 300 series steel specified in ASTM A276.
2. Finish: Exposed surfaces shall have standard polish (ground and polished) equal to NAAMM finish Number 4.

B. Die-cast zinc alloy products are prohibited.

2.2 STOPS

- A. Provide lock-shield loose key or screw driver pattern angle stops, straight stops or stops integral with faucet, with each compression type faucet whether specifically called for or not, including sinks in wood and metal casework, laboratory furniture and pharmacy furniture. Locate stops centrally above or below fixture in accessible location.
- B. Furnish keys for lock shield stops to Resident Engineer.
- C. Supply from stops not integral with faucet shall be chrome plated copper flexible tubing or flexible stainless steel with inner core of non-toxic polymer.
- D. Supply pipe from wall to valve stop shall be rigid threaded IPS copper alloy pipe, i.e. red brass pipe nipple.
- E. Psychiatric Area: Provide stainless steel drain guard for all lavatories not installed in casework.

2.3 ESCUTCHEONS

Heavy type, chrome plated, with set screws. Provide for piping serving plumbing fixtures and at each wall, ceiling and floor penetrations in exposed finished locations and within cabinets and millwork.

2.4 LAMINAR FLOW CONTROL DEVICE

- A. Smooth, bright stainless steel or satin finish, chrome plated metal laminar flow device shall provide non-aeration, clear, coherent laminar flow that will not splash in basin. Device shall also have a flow control restrictor and have vandal resistant housing.
- B. Flow Control Restrictor:
 1. Capable of restricting flow from 95 to 110 mL/s (1.5 to 1.7 gpm) for lavatories; 125 to 140 mL/s (2.0 to 2.2 gpm) for sinks P-505 through P-520, P-524 and P-528; and 170 to 190 mL/s (2.75 to 3.0 gpm) for dietary food preparation and rinse sinks.

2. Compensates for pressure fluctuation maintaining flow rate specified above within 10 percent between 170 and 550 kPa (25 and 80 psi).
3. Operates by expansion and contraction, eliminates mineral/sediment build-up with self-clearing action, and is capable of easy manual cleaning.

C. Device manufactured by OMNI Products, Inc. or equal.

2.5 CARRIERS

- A. ASME/ANSI A112.6.1M, with adjustable gasket faceplate chair carriers for wall hung closets with auxiliary anchor foot assembly, hanger rod support feet, and rear anchor tie down.
- B. ASME/ANSI A112.6.1M, lavatory, chair carrier for thin wall construction
All lavatory chair carriers shall be capable of supporting the lavatory with a 250-pound vertical load applied at the front of the fixture.

2.6 WATER CLOSETS

- A. (P-101) Water Closet (Floor Mounted, ANSI 112.19.2M, Figure 6) - office and industrial, elongated bowl, siphon jet 4.8 L (1.28 gallons) per flush, floor outlet. Top of rim shall be 434 to 437 mm (17 1/8 inch to 17 1/4 inch) above finished floor.
 1. Seat: Institutional/Industrial, extra heavy duty, chemical resistant, solid plastic, open front less cover for elongated bowls, integrally molded bumpers, concealed check hinge with stainless steel post. Seat shall be posture contoured body design. Color shall be white.
 2. Fittings and Accessories: Floor flange fittings-cast iron; Gasket-wax; bolts with chromium plated cap nuts and washers.
 3. Flush valve: Large chloramines resistant diaphragm, semi red brass valve body, exposed chrome plated, non-hold-open ADA approved side oscillating handle water saver design 4.8 L (1.28 gallons) per flush with maximum 10 percent variance, top spud connection, adjustable tailpiece, one-inch IPS screwdriver back check angle stop with vandal resistant cap, high back pressure vacuum breaker, and sweat solder adapter with cover tube and cast set screw wall flange. Set centerline of inlet 275 mm (11-1/2) inches above rim. Seat bumpers shall be integral part of flush valve. Valve body, cover, tailpiece and control stop shall be in conformance with ASTM Alloy classification for semi-red brass.

2.7 URINALS

- A. (P-201) Urinal (Wall Hung, ANSI A112.19.2M, Figure 30) bowl with integral flush distribution, wall to front of flare 356 mm (14 inches). Wall hung with integral trap, siphon jet flushing action 0.5 L (0.125 gallons) per flush with 50mm (2-inch) back outlet and 20 mm (3/4-inch) top inlet spud.

1. Support urinal with chair carrier and install with rim 600 mm (24 inches) above finished floor.
 2. Flushing Device: Large chloramines resistant diaphragm, semi-red brass body, exposed flush valve non-hold-open, water saver design, 20 mm (3/4-inch) capped screwdriver angle stop valve. Set centerline of inlet 292 mm (11-1/2 inches) above urinal. Valve body, cover, tailpiece, and control stop shall be in conformance with ASTM alloy classification for semi-red brass.
- B. (P-202) Urinal (Wheelchair, Wall Hung, ANSI A112.19.2M, Figure 30) bowl with integral flush distribution, wall to front of flare 356mm (14 inches). Wall hung with integral trap, siphon jet flushing action 0.5 L (0.125 gallons) per flush) with 50mm (2-inch) back outlet and 20 mm (3/4 inch) top inlet spud.
1. Support urinal with chair carrier and install with rim 380 mm (15 inches) above finished floor.
 2. Flushing Device: Large chloramines resistant diaphragm, semi- red brass body, exposed flush valve, non-hold-open, water saver design, 20 mm (3/4-inch) capped screwdriver angle stop valve. Set centerline of inlet 292 mm (11-1/2 inches) above urinal. Valve body, cover, tailpiece and control stop shall be in conformance with ASTM alloy classification for semi-red brass.

2.8 LAVATORIES

- A. Dimensions for lavatories are specified, Length by width (distance from wall) and depth.
- B. Brass components in contact with water shall contain no more than 3 percent lead content by dry weight.
- C. (P-408) Lavatory (ASME/ANSI A112.19.2M, Figure 16) straight back, approximately 450 by 380 mm (18 by 15 inches) and a 102 mm (4-inch) maximum apron, first quality vitreous china. Punching for faucet on 102 mm (4-inch) centers. Support lavatory to wall with steel wall plate. Set with rim 864 mm (34 inches) above finished floor:
1. Faucet: Solid cast brass construction with washerless ceramic disc mixing cartridge type and centrally exposed rigid gooseneck spout Outlet 125-150 mm (5-6 inches) above rim. Provide laminar flow control device. One hundred two millimeters (4-inch) wrist blade type handles on faucets shall be cast, formed or drop forged copper alloy. Faucet, wall and floor escutcheons shall be either copper alloy or CRS. Exposed metal parts, including exposed part under valve handle when in open position, shall be chrome plated with a smooth bright finish.

2. Drain: Cast or wrought brass with flat grid strainer and offset tailpiece, chrome plated finish.
 3. Stops: Angle type. See paragraph 2.2. Stops
 4. Trap: Cast copper alloy, 40 by 32 mm (1-1/2 by 1-1/4 inch) P-trap. Adjustable with connected elbow and 1.4 mm thick (17 gauge) tubing extension to wall. Exposed metal trap surface, and connection hardware shall be chrome plated with a smooth bright finish. Set trap parallel to wall.
 5. Provide cover for drain, stops and trap per A.D.A 4-19.4.
- D. (P-413) Lavatory (Counter Mounted ASME/ANSI A112.19.2M, Figure 25) vitreous china, self-rimming, approximately 480 mm (19 inches) in diameter with punching for faucet on 203 mm (8-inch) centers. Mount unit in countertop. Support countertop with ANSI A112.6.1M, Type I, chair carrier with exposed arms.
1. Faucet: Solid cast brass construction with washerless ceramic disc mixing cartridge type, rigid gooseneck spout with outlet 102 to 127 mm (four to five inches) above slab with 102 mm (four-inch) wrist blade handles. Provide laminar flow control device. Faucet, wall and floor escutcheons shall be either copper alloy or CRS. Exposed metal parts shall be chrome plated with a smooth bright finish.
 2. Drain: cast or wrought brass with flat grid strainer, offset tailpiece, brass, chrome plated.
 3. Stops: Angle type. See paragraph 2.2. Stops
 4. Trap: Cast copper alloy, 40 by 32 mm (1-1/2 by 1-1/4 inch) P-trap, adjustable with connected elbow and 1.4mm thick (17 gauge) tubing extension to wall. Exposed metal trap surface and connection hardware shall be chrome plated with a smooth bright finish. Set trap parallel to the wall.
 5. Provide cover for drain, stops and trap per A.D.A 4-19.4.
- E. (P-418) Lavatory (Sensor Control, Gooseneck Spout, ASME/ANSI A112.19.2M, Figure 16) straight back, approximately 500 by 450 mm (20 by 18 inches) and a 102mm (4-inch) maximum apron, first quality vitreous china with punching for gooseneck spout. Set rim 864 mm (34 inches) above finished floor.
1. Faucet: Solid cast brass construction, chrome plated, gooseneck spout with outlet 102 to 127 mm (4 to 5 inches) above rim. Electronic sensor operated, 102 mm (4 inch) center set mounting, plug in transformer and inline filter. Provide laminar flow control device. Breaking the light beam shall activate the water flow. Flow shall stop when user moves away from light beam.

2. Drain: Cast or wrought brass with flat grid strainer with offset tailpiece, brass, chrome plated.
 3. Stops: Angle type. See paragraph 2.2.Stops
 4. Trap: Cast copper alloy, 40 by 32 mm (1-1/2 by 1-1/4 inch) P-trap. Adjustable with connected elbow and 17 gage tubing extension to wall. Exposed metal trap surface and connection hardware shall be chrome plated with a smooth bright finish. Set trap parallel to wall.
 5. Provide cover for drain, stops and trap per A.D.A 4-19.4.
- F. (P-420) Lavatory (Sensor Control, Counter Mounted ASME/ANSI A112.19.2M, Figure 25) vitreous china, self-rimming, approximately 480 mm (19 inches) in diameter with punching for faucet on 102 mm (4-inch) centers. Mount unit in countertop. Support countertop with ASME/ANSI A112.19.1M, Type 1, chair carrier with exposed arms.
1. Faucet: Brass, chrome plated, gooseneck spout with outlet 100 to 125 mm (4 to 5 inches) above rim. Electronic sensor operated, 102 mm (4 inch) center set mounting, plug in transformer and inline filter. Provide laminar flow control device. Breaking the light beam shall activate the water flow. Flow shall stop when user moves away from light beam.
 2. Drain: Cast or wrought brass with flat grid strainer, offset tailpiece, chrome plated. Set trap parallel to wall.
 3. Stops: Angle type. See paragraph 2.2.Stops
 4. Trap: Cast copper alloy, 40 by 32 mm (1-1/2 by 1-1/4 inch) P-trap, adjustable with connected elbow and 1.4 mm thick (17 gauge) tubing extension to wall. Set trap parallel to the wall. Exposed metal trap surface and connection hardware shall be chrome plated with a smooth bright finish.
 5. Provide cover for drain, stops and trap per A.D.A 4-19.4.

2.9 SINKS AND LAUNDRY TUBS

- A. Dimensions for sinks and laundry tubs are specified, length by width (distance from wall) and depth.
 - B. (P-502) Service Sink (Corner, Floor Mounted) stain resistant terrazzo, 711 by 711 mm (28 by 28 by 12 inches) with 152 mm (six-inch) drop front. Terrazzo, composed of marble chips and white Portland cement, shall develop compressive strength of 20 684 kPa (3000 psi) seven days after casting. Provide extruded aluminum cap on front side.
1. Faucet: Solid brass construction, combination faucet with replaceable monel seat, removable replacement unit containing all parts subject to wear, integral stops, mounted on wall above sink. Spout shall have a pail hook, 20 mm (3/4-inch) hose coupling threads, vacuum breaker, and top or bottom brace to wall. Four-arm handles on faucets shall be

cast, formed, or drop forged copper alloy. Escutcheons shall be either forged copper alloy or CRS. Exposed metal parts, including exposed part under valve handle when in open position, shall have a smooth bright finish. Provide 914 mm (three-foot) hose with wall hook. Centerline of rough in is 1220 mm (48 inches) above finished floor.

2. Drain: Eighty millimeter (3-inch) cast brass drain with nickel bronze strainer.

3. Trap: P-trap, drain through floor.

C. (P-528) Sink (CRS, Single Compartment, Counter Top ASME/ANSI A112.19.2M, Kitchen Sinks, Figure 5) self rimming, back faucet ledge, approximately 533 by 558 mm (21 by 22 inches) with single compartment inside dimensions approximately 406 by 483 by 190 mm (16 by 19 by 7 ½ inches) deep. Shall be minimum of 1.3 mm thick (18 gauge) CRS. Corners and edges shall be well rounded:

1. Faucet: Solid brass construction, deck mounted combination faucet with monel or ceramic seats, removable replacement unit containing all parts subject to ware, swivel gooseneck spout with approximately 200 mm (8-inches) reach with spout outlet 150 mm (6-inches) above deck and 102 mm (4 inch) wrist blades. Faucet shall be polished chrome plated.

2. Drain: Drain plug with cup strainer, stainless steel.

3. Trap: Cast copper alloy 40 mm (1-1/2 inch) P-trap with cleanout plug. Provide wall connection and escutcheon.

4. Provide cover for drain, stops and trap per A.D.A 4-19.4.

2.10 DISPENSER, DRINKING WATER

A. Standard rating conditions: 10 degrees C (50 degrees F) water with 27 degrees C (80 degrees F) inlet water temperature and 32 degrees C (90 degrees F) ambient air temperature.

B. (P-604) Electric Water Cooler (Mechanically Cooled, Wall Hung, Self-contained, Wheelchair) bubbler style, 5 mL/s (5 gph) minimum capacity, lead free. Top shall be CRS anti-splash design. Cabinet, CRS, satin finish, approximately 450 by 450 by 635 mm (18 by 18 inches by 25 inches) high with mounting plate. Set bubbler 914 mm (36 inches) above finished floor. Unit shall be push bar operated with front and side bar and automatic stream regulator. All trim polished chrome plated.

2.11 HYDRANT, HOSE BIBB AND MISCELLANEOUS DEVICES

A. (P-801) Wall Hydrant: Cast bronze non-freeze hydrant with detachable T-handle. Brass operating rod within casing of bronze pipe of sufficient length to extend through wall and place valve inside building. Brass valve with coupling and union elbow having metal-to-metal seat. Valve

rod and seat washer removable through face of hydrant; 20 mm (3/4-inch) hose thread on spout; 20 mm (3/4-inch) pipe thread on inlet. Finish may be rough; exposed surfaces shall be chrome plated. Set not less than 460 mm (1-1/2 feet) nor more than 920 mm (3-feet) above grade. On porches and platforms, set approximately 760 mm (2-1/2 feet) above finished floor. Provide integral vacuum breaker which automatically drains when shut off.

- B. (P-804) Hose Bibb (Single Faucet, Wall Mounted to Exposed Supply Pipe): Cast or wrought copper alloy, single faucet with replaceable monel seat, removable replacement unit containing all parts subject to wear, mounted on wall 914 mm (36 inches) above floor to concealed supply pipe. Provide faucet with 20 mm (3/4-inch) hose coupling thread on spout and vacuum breaker. Four-arm handle on faucet shall be cast, formed or drop forged copper alloy. Escutcheons shall be either forged copper alloy or CRS. Exposed metal parts, including exposed part under valve handle when in open position, shall have a bright finish.

PART 3 - EXECUTION

- A. Fixture Setting: Opening between fixture and floor and wall finish shall be sealed as specified under Section 07 92 00, JOINT SEALANTS.
- B. Supports and Fastening: Secure all fixtures, equipment and trimmings to partitions, walls and related finish surfaces. Exposed heads of bolts and nuts in finished rooms shall be hexagonal, polished chrome plated brass with rounded tops.
- C. Through Bolts: For free standing marble and metal stud partitions refer to Section 10 21 13, TOILET COMPARTMENTS.
- D. Toggle Bolts: For hollow masonry units, finished or unfinished.
- E. Expansion Bolts: For brick or concrete or other solid masonry. Shall be 6 mm (1/4-inch) diameter bolts, and to extend at least 75 mm (3-inches) into masonry and be fitted with loose tubing or sleeves extending into masonry. Wood plugs, fiber plugs, lead or other soft metal shields are prohibited.
- F. Power Set Fasteners: May be used for concrete walls, shall be 6 mm (1/4-inch) threaded studs, and shall extend at least 35 mm (1-1/4 inches) into wall.
- G. Tightly cover and protect fixtures and equipment against dirt, water and chemical or mechanical injury.
- H. Where water closet waste pipe has to be offset due to beam interference, provide correct and additional piping necessary to eliminate relocation of water closet.
- I. Do not use aerators on lavatories and sinks.

3.2 CLEANING

At completion of all work, fixtures, exposed materials and equipment shall be thoroughly cleaned.

- - - E N D - - -

SECTION 23 05 11
COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION

PART 1 - GENERAL

1.1 DESCRIPTION

- A. The requirements of this Section apply to all sections of Division 23.
- B. Definitions:
 - 1. Exposed: Piping, ductwork, and equipment exposed to view in finished rooms.
 - 2. Option or optional: Contractor's choice of an alternate material or method.
 - 3. RE: Resident Engineer
 - 4. COTR: Contracting Officer's Technical Representative.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- E. Excavation and Backfill: Section 31 20 11, EARTH MOVING (Short Form).
- F. Concrete and Grout: Section 03 30 00, CAST-IN-PLACE CONCRETE.
- G. Building Components for Attachment of Hangers: Section 05 31 00, STEEL DECKING,
- H. Section 05 50 00, METAL FABRICATIONS.
- I. Section 07 84 00, FIRESTOPPING.
- J. Flashing for Wall and Roof Penetrations: Section 07 60 00, FLASHING AND SHEET METAL.
- K. Section 07 92 00, JOINT SEALANTS.
- L. Section 09 91 00, PAINTING.
- N. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS
- O. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.

1.3 QUALITY ASSURANCE

- A. Mechanical, electrical and associated systems shall be safe, reliable, efficient, durable, easily and safely operable and maintainable, easily and safely accessible, and in compliance with applicable codes as specified. The systems shall be comprised of high quality institutional-class and industrial-class products of manufacturers that are experienced specialists in the required product lines. All construction firms and personnel shall be experienced and qualified specialists in industrial and institutional HVAC or steam boiler plant construction, as applicable.
- B. Flow Rate Tolerance for HVAC Equipment: Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.
- C. Equipment Vibration Tolerance:

1. Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT and 23 05 51, NOISE AND VIBRATION CONTROL FOR BOILER PLANT. Equipment shall be factory-balanced to this tolerance and re-balanced on site, as necessary.
2. After HVAC air balance work is completed and permanent drive sheaves are in place, perform field mechanical balancing and adjustments required to meet the specified vibration tolerance.

D. Products Criteria:

1. Standard Products: Material and equipment shall be the standard products of a manufacturer regularly engaged in the manufacture of the products for at least 3 years. The design, model and size of each item shall have been in satisfactory and efficient operation on at least three installations for approximately three years. However, digital electronics devices, software and systems such as controls, instruments, computer work station, shall be the current generation of technology and basic design that has a proven satisfactory service record of at least three years. See other specification sections for any exceptions.
2. Refer to Section 23 09 11, INSTRUMENTATION AND CONTROL FOR BOILER PLANT, for quality assurance requirements for boiler plant computer workstation software.
3. All items furnished shall be free from defects that would adversely affect the performance, maintainability and appearance of individual components and overall assembly.
4. Conform to codes and standards as required by the specifications. Conform to local codes, if required by local authorities such as the natural gas supplier, if the local codes are more stringent than those specified. Refer any conflicts to the Resident Engineer (RE)/Contracting Officers Technical Representative (COTR).
5. Multiple Units: When two or more units of materials or equipment of the same type or class are required, these units shall be products of one manufacturer.
6. Assembled Units: Manufacturers of equipment assemblies, which use components made by others, assume complete responsibility for the final assembled product.
7. Nameplates: Nameplate bearing manufacturer's name or identifiable trademark shall be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.
8. Asbestos products or equipment or materials containing asbestos shall not be used.

E. Equipment Service Organizations:

1. HVAC: Products and systems shall be supported by service organizations that maintain a complete inventory of repair parts and are located reasonably close to the site.
2. Boiler Plants: Service organizations, authorized and trained by manufacturers of the equipment supplied, shall be located within 100 miles of the project. These organizations shall come to the site and provide acceptable service to restore boiler plant operations within four hours of receipt of notification by phone, e-mail or fax in event of an emergency, such as the shut-down of equipment; or within 24 hours in a non-emergency. Submit names, mail and e-mail addresses and phone numbers of service organizations providing service under these conditions for (as applicable to the project): burners, burner control systems, boiler control systems, pumps, critical instrumentation, computer workstation and programming.

F. HVAC Mechanical Systems Welding: Before any welding is performed, contractor shall submit a certificate certifying that welders comply with the following requirements:

1. Qualify welding processes and operators for piping according to ASME "Boiler and Pressure Vessel Code", Section IX, "Welding and Brazing Qualifications".
2. Comply with provisions of ASME B31 series "Code for Pressure Piping".
3. Certify that each welder has passed American Welding Society (AWS) qualification tests for the welding processes involved, and that certification is current.

G. Boiler Plant and Outside Steam Distribution Welding: Refer to Sections 23 21 11, BOILER PLANT PIPING SYSTEMS, and 33 63 00, STEAM ENERGY DISTRIBUTION.

H. Execution (Installation, Construction) Quality:

1. Apply and install all items in accordance with manufacturer's written instructions. Refer conflicts between the manufacturer's instructions and the contract drawings and specifications to the RE/COTR for resolution. Provide written hard copies or computer files of manufacturer's installation instructions to the RE/COTR at least two weeks prior to commencing installation of any item. Installation of the item will not be allowed to proceed until the recommendations are received. Failure to furnish these recommendations is a cause for rejection of the material.
2. All items that require access, such as for operating, cleaning, servicing, maintenance, and calibration, shall be easily and safely accessible by persons standing at floor level, or standing on

permanent platforms, without the use of portable ladders. Examples of these items include, but are not limited to: all types of valves, filters and strainers, transmitters, control devices. Prior to commencing installation work, refer conflicts between this requirement and contract drawings to the RE/COTR for resolution.

3. Provide complete layout drawings required by Paragraph, SUBMITTALS. Do not commence construction work on any system until the layout drawings have been approved.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, and with requirements in the individual specification sections.
- B. Contractor shall make all necessary field measurements and investigations to assure that the equipment and assemblies will meet contract requirements.
- C. If equipment is submitted which differs in arrangement from that shown, provide drawings that show the rearrangement of all associated systems. Approval will be given only if all features of the equipment and associated systems, including accessibility, are equivalent to that required by the contract.
- D. Prior to submitting shop drawings for approval, contractor shall certify in writing that manufacturers of all major items of equipment have each reviewed drawings and specifications, and have jointly coordinated and properly integrated their equipment and controls to provide a complete and efficient installation.
- E. Upon request by Government, provide lists of previous installations for selected items of equipment. Include contact persons who will serve as references, with telephone numbers and e-mail addresses.
- F. Submittals and shop drawings for interdependent items, containing applicable descriptive information, shall be furnished together and complete in a group. Coordinate and properly integrate materials and equipment in each group to provide a completely compatible and efficient installation. Final review and approvals will be made only by groups.
- G. Submittal "Groups" for boiler plant work are defined in the following checklist:
 1. Group I (Burner Fuel Oil Tank Systems):
 - a. Oil tanks and accessories.
 - b. Tank oil level instrumentation systems.
 - c. Leak detection systems.
 - d. Tank oil heater, temperature control valves, steam traps.
 2. Group II (Burner Fuel Oil Systems):

- a. Fuel oil pumping system.
 - b. Pressure control and relief valves.
3. Group III: Boilers, burners including forced draft fan and motor controls, boiler accessories (trim), fuel valve trains, atomizing media valve trains, economizers and accessories (when provided), stacks and breeching.
4. Group IV (Boiler/Burner Controls and Boiler Plant Controls and Instrumentation): Boiler control system, burner management (flame safeguard) systems (may be included with Group III), flow measuring systems, control and instrument panels and accessories, feedwater deaerator and condensate storage tank water level control systems, instruments and accessories, computer workstation and software, instrumentation, tools.
5. Group V (Condensate Storage):
 - a. Condensate storage tank and accessories.
 - b. Concrete foundation and anchorage.
6. Group VI (Condensate Transfer and Feedwater System):
 - a. Condensate transfer pumps, motors, accessories.
 - b. Water level control valves for feedwater deaerator.
 - c. Feedwater deaerator and storage tank and accessories.
 - d. Boiler feed pumps, couplings, motors, motor controls and accessories.
 - e. Water level control valve at boilers as approved in Group III.
7. Group VII (Temporary Boiler Plant Equipment):
 - a. Boilers.
 - b. Burners.
 - c. Controls.
 - d. Instruments.
 - e. Other Equipment.
- H. Ungrouped submittal items for boiler plants, which may be submitted individually, include, but are not limited to:
 1. Pipe, valves and fittings identified as to service application.
 2. Strainers.
 3. Continuous blow-off heat recovery system.
 4. Emergency shut off valve - gas.
 5. Safety valves and drip pan ells.
 6. Temperature control valves, sensors.
 7. Steam pressure reducing valves and pilots.
 8. Continuous blow off control system, valves - boilers.
 9. Sight flow indicators, oil and water.
 10. Steam traps with orifice sizes and pressure ratings.

11. Steam exhaust silencer.
 12. Thermometers and pressure gauges and accessories.
 13. Chemical feeders.
 14. Sample coolers.
 15. Blowdown tank and accessories.
 16. Gas pressure regulators, relief valves, and filters.
 17. Flexible connectors, hose, braided.
 18. Dielectric fittings and unions.
 19. Quick-couple hose fittings and steam hose.
 20. Heating and ventilating equipment.
 21. Condensate pump sets.
 22. Compressed air system.
 23. Vibration isolators - air, water, oil.
 24. Supports and braces for pipe, stacks, breeching; load, size, movement calculations.
 25. Pressure gauge test kit.
 26. Insulation, field-applied.
 27. Boiler plant building dangerous gas detection system.
- I. Samples: Samples will not be required, except for insulation or where materials offered differ from specification requirements. Samples shall be accompanied by full description of characteristics different from specification. The Government, at the Government's expense, will perform evaluation and testing if necessary. The Contractor may submit samples of additional material at the Contractor's option; however, if additional samples of materials are submitted later, pursuant to Government request, adjustment in contract price and time will be made as provided in the GENERAL CONDITIONS.
- J. Layout Drawings:
1. Submit complete consolidated and coordinated layout drawings for all new systems, and for existing systems that are in the same areas. Refer to the GENERAL CONDITIONS.
 2. The drawings shall include plan views, elevations and sections of all systems and shall be on a scale of not less than 1:32 (3/8-inch equal to one foot). Clearly identify and dimension the proposed locations of the principal items of equipment. The drawings shall clearly show locations and adequate clearance for all equipment, piping, valves, control panels and other items. Show the access means for all items requiring access for operations and maintenance. Provide detailed layout drawings of all piping and duct systems.
 3. Do not install equipment foundations, equipment or piping until layout drawings have been approved.

4. In addition, for HVAC systems, provide details of the following:
 - a. Mechanical equipment rooms.
 - b. Interstitial space.
 - c. Hangers, inserts, supports, and bracing.
 - d. Pipe sleeves.
 - e. Duct or equipment penetrations of floors, walls, ceilings, or roofs.
- K. Manufacturer's Literature and Data: Submit under the pertinent section rather than under this section.
 1. Submit belt drive with the driven equipment. Submit selection data for specific drives when requested by the Resident Engineer.
 2. Submit electric motor data and variable speed drive data with the driven equipment.
 3. Equipment and materials identification.
 4. Fire-stopping materials.
 5. Hangers, inserts, supports and bracing. Provide load calculations for variable spring and constant support hangers. For boiler plants, refer to Section 23 21 11, BOILER PLANT PIPING SYSTEMS, for additional requirements.
 6. Wall, floor, and ceiling plates.
- L. HVAC Maintenance Data and Operating Instructions:
 1. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Article, INSTRUCTIONS, for systems and equipment.
 2. Provide a listing of recommended replacement parts for keeping in stock supply, including sources of supply, for equipment. Include in the listing belts for equipment: Belt manufacturer, model number, size and style, and distinguished whether of multiple belt sets.
- M. Boiler Plant Maintenance Data and Operating Instructions:
 1. Provide four bound copies. Deliver to RE/COTR not less than 30 days prior to completion of a phase or final inspection.
 2. Include all new and temporary equipment and all elements of each assembly.
 3. Data sheet on each device listing model, size, capacity, pressure, speed, horsepower, pump impeller size, other data.
 4. Manufacturer's installation, maintenance, repair, and operation instructions for each device. Include assembly drawings and parts lists. Include operating precautions and reasons for precautions.
 5. Lubrication instructions including type and quantity of lubricant.
 6. Schematic diagrams and wiring diagrams of all control systems corrected to include all field modifications.

7. Description of boiler firing and operating sequence including description of relay and interlock positions at each part of the sequence.
 8. Set points of all interlock devices.
 9. Trouble-shooting guide for control systems.
 10. Operation of the combustion control system.
 11. Emergency procedures.
 12. Control system programming information for parameters, such as set points, that do not require services of an experienced technician.
- M. Provide copies of approved HVAC equipment submittals to the Testing, Adjusting and Balancing Subcontractor.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Conditioning and Refrigeration Institute (ARI):
430-99.....Central Station Air-Handling Units
- C. American National Standard Institute (ANSI):
B31.1-2004.....Power Piping
- D. Rubber Manufacturers Association (ANSI/RMA):
IP-20-2007.....Drives Using Classical V-Belts and Sheaves
IP-21-1991(1997).....Drives Using Double-V (Hexagonal) Belts
IP-22-2007.....Drives Using Narrow V-Belts and Sheaves
- E. Air Movement and Control Association (AMCA):
410-96.....Recommended Safety Practices for Air Moving
Devices
- F. American Society of Mechanical Engineers (ASME):
Boiler and Pressure Vessel Code (BPVC):
Section I-2007.....Power Boilers
Section IX-2007.....Welding and Brazing Qualifications
Code for Pressure Piping:
B31.1-2004.....Power Piping, with Amendments
- G. American Society for Testing and Materials (ASTM):
A36/A36M-05.....Carbon Structural Steel
A575-96(2002).....Steel Bars, Carbon, Merchant Quality, M-Grades R
(2002)
E84-07.....Standard Test Method for Burning Characteristics
of Building Materials
E119-07.....Standard Test Method for Fire Tests of Building
Construction and Materials

H. Manufacturers Standardization Society (MSS) of the Valve and Fittings Industry, Inc:

SP-58-2002.....Pipe Hangers and Supports-Materials, Design and Manufacture

SP 69-2003.....Pipe Hangers and Supports-Selection and Application

SP 127-2001.....Bracing for Piping Systems, Seismic - Wind - Dynamic, Design, Selection, Application

J. National Electrical Manufacturers Association (NEMA):

MG-1-2006.....Motors and Generators

K. National Fire Protection Association (NFPA):

31-06.....Standard for Installation of Oil-Burning Equipment

54-06.....National Fuel Gas Code

70-08.....National Electrical Code

85-07.....Boiler and Combustion Systems Hazard Code

90A-02.....Installation of Air Conditioning and Ventilating Systems

101-06.....Life Safety Code

1.6 DELIVERY, STORAGE AND HANDLING

A. Protection of Equipment:

1. Equipment and material placed on the job site shall remain in the custody of the Contractor until phased acceptance, whether or not the Government has reimbursed the Contractor for the equipment and material. The Contractor is solely responsible for the protection of such equipment and material against any damage.
2. Place damaged equipment in first class, new operating condition; or, replace same as determined and directed by the RE/COTR. Such repair or replacement shall be at no additional cost to the Government.
3. Protect interiors of new equipment and piping systems against entry of foreign matter. Clean both inside and outside before painting or placing equipment in operation.
4. Existing equipment and piping being worked on by the Contractor shall be under the custody and responsibility of the Contractor and shall be protected as required for new work.

B. Cleanliness of Piping and Equipment Systems:

1. Exercise care in storage and handling of equipment and piping material to be incorporated in the work. Remove debris arising from cutting, threading and welding of piping.
2. Piping systems shall be flushed, blown or pigged as necessary to deliver clean systems.

3. Clean interior of all tanks prior to delivery for beneficial use by the Government.
4. Boilers shall be left clean following final internal inspection by Government insurance representative or inspector.
5. Contractor shall be fully responsible for all costs, damage, and delay arising from failure to provide clean systems.

1.7 JOB CONDITIONS - WORK IN EXISTING BOILER PLANT

- A. Plant Operation: Government employees will be continuously operating and managing all plant facilities, including temporary facilities, that serve the steam and condensate requirements of the medical center.
- B. Maintenance of Steam Supply and Condensate Return Service: Schedule all work to permit continuous steam and condensate service at pressures and flow rates as required by the medical center. At all times there shall be one spare boiler available and one spare pump for each service available, in addition to those required for serving the load demand. The spare boiler and pumps must be capable of handling the loads that may be imposed if the operating boiler or pump fails.
- C. Steam and Condensate Service Interruptions: Limited steam and condensate service interruptions, as required for interconnections of new and existing systems, will be permitted by the RE/COTR during periods when the steam demands are not critical to the operation of the medical center. These non-critical periods are limited to between 8 pm and 5 am during the non-heating season. Provide at least one week advance notice to the RE/COTR.
- D. Phasing of Work: Comply with all requirements shown on drawings or specified.
- E. Plant Working Environment: Maintain the architectural and structural integrity of the plant building and the working environment at all times. Maintain the interior of plant at 18 degrees C (65 degrees F) minimum. Limit the opening of doors, windows or other access openings to brief periods as necessary for rigging purposes. No storm water or ground water leakage permitted. Provide daily clean-up of construction and demolition debris on all floor surfaces and on all equipment being operated by VA.
- F. Acceptance of Work for Government Operation: As new facilities are made available for operation and these facilities are of beneficial use to the Government, inspections will be made and tests will be performed. Based on the inspections, a list of contract deficiencies will be issued to the Contractor. After correction of deficiencies as necessary for beneficial use, the Contracting Officer will process necessary

acceptance and the equipment will then be under the control and operation of Government personnel.

- G. Temporary Facilities: Refer to Article, TEMPORARY PIPING AND EQUIPMENT in this section.

PART 2 - PRODUCTS

2.1 FACTORY-ASSEMBLED PRODUCTS

- A. Provide maximum standardization of components to reduce spare part requirements.
- B. Manufacturers of equipment assemblies that include components made by others shall assume complete responsibility for final assembled unit.
 - 1. All components of an assembled unit need not be products of same manufacturer.
 - 2. Constituent parts that are alike shall be products of a single manufacturer.
 - 3. Components shall be compatible with each other and with the total assembly for intended service.
 - 4. Contractor shall guarantee performance of assemblies of components, and shall repair or replace elements of the assemblies as required to deliver specified performance of the complete assembly.
- C. Components of equipment shall bear manufacturer's name and trademark, model number, serial number and performance data on a name plate securely affixed in a conspicuous place, or cast integral with, stamped or otherwise permanently marked upon the components of the equipment.
- D. Major items of equipment, which serve the same function, must be the same make and model. Exceptions will be permitted if performance requirements cannot be met.

2.2 COMPATIBILITY OF RELATED EQUIPMENT

Equipment and materials installed shall be compatible in all respects with other items being furnished and with existing items so that the result will be a complete and fully operational plant that conforms to contract requirements.

2.3 BELT DRIVES

- A. Type: ANSI/RMA standard V-belts with proper motor pulley and driven sheave. Belts shall be constructed of reinforced cord and rubber.
- B. Dimensions, rating and selection standards: ANSI/RMA IP-20 and IP-21.
- C. Minimum Horsepower Rating: Motor horsepower plus recommended ANSI/RMA service factor (not less than 20 percent) in addition to the ANSI/RMA allowances for pitch diameter, center distance, and arc of contact.
- D. Maximum Speed: 25 m/s (5000 feet per minute).

- E. Adjustment Provisions: For alignment and ANSI/RMA standard allowances for installation and take-up.
- F. Drives may utilize a single V-Belt (any cross section) when it is the manufacturer's standard.
- G. Multiple Belts: Matched to ANSI/RMA specified limits by measurement on a belt measuring fixture. Seal matched sets together to prevent mixing or partial loss of sets. Replacement, when necessary, shall be an entire set of new matched belts.
- H. Sheaves and Pulleys:
1. Material: Pressed steel, or close grained cast iron.
 2. Bore: Fixed or bushing type for securing to shaft with keys.
 3. Balanced: Statically and dynamically.
 4. Groove spacing for driving and driven pulleys shall be the same.
 5. Minimum Diameter of V-Belt Sheaves (ANSI/RMA recommendations) in millimeters and inches:

Fractional Horsepower		Standard		High Capacity	
Cross Section	Min. od mm (in)	Cross Section	Min. od mm (in)	Cross Section	Min. od mm (in)
2L	20 (0.8)	A	83 (3.25)	3V	67 (2.65)
3L	38 (1.5)	B	146 (5.75)	4V	180 (7.10)
4L	64 (2.5)	C	239 (9.40)	5V	318 (12.50)
5L	89 (3.5)	D	345 (13.60)		
		E	554 (21.80)		

- I. Drive Types, Based on ARI 435:
1. Provide adjustable-pitch or fixed-pitch drive as follows:
 - a. Fan speeds up to 1800 RPM: 7.5 kW (10 horsepower) and smaller.
 - b. Fan speeds over 1800 RPM: 2.2 kW (3 horsepower) and smaller.
 2. Provide fixed-pitch drives for drives larger than those listed above.
 3. The final fan speeds required to just meet the system CFM and pressure requirements, without throttling, shall be determined by adjustment of a temporary adjustable-pitch motor sheave or by fan law calculation if a fixed-pitch drive is used initially.

2.4 DRIVE GUARDS

- A. For machinery and equipment, provide guards as shown in AMCA 410 for belts, chains, couplings, pulleys, sheaves, shafts, gears and other moving parts regardless of height above the floor to prevent damage to equipment and injury to personnel. Drive guards may be excluded where motors and drives are inside factory fabricated air handling unit casings.

- B. Pump shafts and couplings shall be fully guarded by a sheet steel guard, covering coupling and shaft but not bearings. Material shall be minimum 16-gage sheet steel; ends shall be braked and drilled and attached to pump base with minimum of four 6 mm (1/4-inch) bolts. Reinforce guard as necessary to prevent side play forcing guard onto couplings.
- C. V-belt and sheave assemblies shall be totally enclosed, firmly mounted, non-resonant. Guard shall be an assembly of minimum 22-gage sheet steel and expanded or perforated metal to permit observation of belts. 25 mm (one-inch) diameter hole shall be provided at each shaft centerline to permit speed measurement.
- D. Materials: Sheet steel, cast iron, expanded metal or wire mesh rigidly secured so as to be removable without disassembling pipe, duct, or electrical connections to equipment.
- E. Access for Speed Measurement: 25 mm (One inch) diameter hole at each shaft center.

2.5 LIFTING ATTACHMENTS

Provide equipment with suitable lifting attachments to enable equipment to be lifted in its normal position. Lifting attachments shall withstand any handling conditions that might be encountered, without bending or distortion of shape, such as rapid lowering and braking of load.

2.6 ELECTRIC MOTORS

- A. All material and equipment furnished and installation methods shall conform to the requirements of Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT; Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS; and, Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW). Provide all electrical wiring, conduit, and devices necessary for the proper connection, protection and operation of the systems. Provide special energy efficient motors as scheduled. Unless otherwise specified for a particular application use electric motors with the following requirements.
- B. Single-phase Motors: Capacitor-start type for hard starting applications. Motors for centrifugal fans and pumps may be split phase or permanent split capacitor (PSC).
- C. Poly-phase Motors: NEMA Design B, Squirrel cage, induction type. Each two-speed motor shall have two separate windings. Provide a time- delay (20 seconds minimum) relay for switching from high to low speed.
- D. Rating: Continuous duty at 100 percent capacity in an ambient temperature of 40 degrees centigrade (104 degrees F); minimum horsepower as shown on drawings; maximum horsepower in normal operation not to exceed nameplate rating without service factor.

E. Special Requirements:

1. Where motor power requirements of equipment furnished deviate from power shown on plans, provide electrical service designed under the requirements of NFPA 70 without additional time or cost to the Government.
2. Assemblies of motors, starters, controls and interlocks on factory assembled and wired devices shall be in accordance with the requirements of this specification.
3. Wire and cable materials specified in the electrical division of the specifications shall be modified as follows:
 - a. Wiring material located where temperatures can exceed 71 degrees C (160 degrees F) shall be stranded copper with Teflon FEP insulation with jacket. This includes wiring on the boilers.
 - b. Other wiring at boilers and to control panels shall be NFPA 70 designation THWN.
 - c. Provide shielded conductors or wiring in separate conduits for all instrumentation and control systems where recommended by manufacturer of equipment.
4. Select motor sizes so that the motors do not operate into the service factor at maximum required loads on the driven equipment. Motors on pumps shall be sized for non-overloading at all points on the pump performance curves.
5. Motors utilized with variable frequency drives shall be rated "inverter-ready" per NEMA Standard, MG1, Part 31.4.4.2. Provide motor shaft grounding apparatus that will protect bearings from damage from stray currents.

F. Motor Efficiency and Power Factor: All motors, when specified as "high efficiency" by the project specifications on driven equipment, shall conform to efficiency and power factor requirements in Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT, with no consideration of annual service hours. Motor manufacturers generally define these efficiency requirements as "NEMA premium efficient" and the requirements generally exceed those of the Energy Policy Act of 1992 (EPACT). Motors not specified as "high efficiency" shall comply with EPACT.

G. Insulation Resistance: Not less than one-half meg-ohm between stator conductors and frame, to be determined at the time of final inspection.

2.7 VARIABLE SPEED MOTOR CONTROLLERS

- A. Refer to Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS and Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS for specifications.

- B. The combination of controller and motor shall be provided by the manufacturer of the driven equipment, such as pumps and fans, and shall be rated for 100 percent output performance. Multiple units of the same class of equipment, i.e. air handlers, fans, pumps, shall be product of a single manufacturer.
- C. Motors shall be energy efficient type and be approved by the motor controller manufacturer. The controller-motor combination shall be guaranteed to provide full motor nameplate horsepower in variable frequency operation. Both driving and driven motor/fan sheaves shall be fixed pitch.
- D. Controller shall not add any current or voltage transients to the input AC power distribution system, DDC controls, sensitive medical equipment, etc., nor shall be affected from other devices on the AC power system.

2.8 BOILER PLANT CONTROLS AND INSTRUMENTATION, COMPUTER WORKSTATION

- A. Provide, and place into proper operation, complete systems as specified in Section 23 50 11, BOILER PLANT MECHANICAL EQUIPMENT; and Section 23 09 11, INSTRUMENTATION AND CONTROL FOR BOILER PLANT. Furnish all hardware, software and programming to properly accomplish specified functions.
- B. Pneumatic Systems: If pneumatic actuators/drive units are furnished, provide two complete instrument-quality compressed air systems (primary system and standby system). Each system shall be as specified in Section 23 50 11, BOILER PLANT MECHANICAL EQUIPMENT, and as shown on the drawings. Air supply to each actuator, drive unit or other compressed air-using device shall include filters, moisture separators, and pressure regulator, all designed for the service. Provide all interconnections between elements of the system. Loss of air pressure shall result in immediate automatic burner shut down and closure of pneumatically operated feedwater control valves.
- C. Electronic Systems: Provide complete, protected power supplies as specified. Power supplies shall protect computers, controls, instruments and accessories from damage due to spikes, surges, transients, and overloads in the incoming power supply. Provide all interconnections between elements of the system. Entire installation shall conform to NFPA 70.

2.9 TEMPORARY BOILER PLANT INSTALLATION

- A. Provide temporary facilities to replace all functions of the existing boiler plant during the construction period. Temporary facilities must remain in operation until all new facilities are accepted for beneficial use. Temporary facilities shall provide same quality of service as existing facilities.

- B. Refer to drawings for arrangement and location of temporary facilities and for equipment performance requirements.
- C. Temporary equipment may be new or previously used. Previously used equipment shall show no evidence of wear or deterioration that would effect the safe, reliable operation.
- D. Equipment to be utilized in the new plant shall not be used in the temporary plant, except with permission of the RE/COTR.
- E. Remove all temporary facilities from Government property after final use.
- F. Equipment must be clean inside and outside.
- G. Boilers and Accessories:
 - 1. Design pressure exceeding maximum safety valve set pressure.
 - 2. Construction and accessories in compliance with ASME Boiler and Pressure Vessel Code, Section I.
 - 3. After installation and prior to operation, provide internal inspection by authorized inspector certified by National Board of Boiler and Pressure Vessel Inspectors. Submit signed report. Inspector must certify boilers as clean and safe for operation.
 - 4. Steam output flow range and pressure as shown on drawings.
 - 5. Dual low water cutoffs, dual high steam pressure cutouts, high water alarm.
 - 6. Calibrated steam pressure gage, 150 mm (six inch) minimum diameter.
 - 7. One set of spares for all gaskets and water column gage glasses.
- H. Burners and Accessories, Fuel Trains:
 - 1. Automatic operation over entire firing range. Turndown capability 6/1 or greater.
 - 2. Comply with NFPA 85 regardless of burner input rating.
 - 3. All safety devices UL listed for the service.
 - 4. Fire fuels as shown on the drawings.
 - 5. Filtration devices at entrance to each fuel train designed to protect all downstream devices from clogging or plugging.
 - 6. Pressure regulating valves on main gas and igniter (pilot) gas.
 - 7. Pressure gages at burners and outlets of pressure regulating valves.
 - 8. One set of spare drive belts for all belt-driven equipment.
- I. Burner Control (Flame Safeguard) System:
 - 1. Automatic operation, self-checking circuits.
 - 2. UL listed, FM approved.
 - 3. Self-checking ultraviolet flame detectors. Infrared flame detectors with self-checking amplifiers permitted on fire tube boilers.
 - 4. Provide one spare scanner and control chassis for each type utilized.

- J. Combustion Control System: Automatic control of steam pressure, with provision for manual control.
- K. Feedwater System:
1. Provide system, including feedwater deaerator, to furnish minimum water temperature of 104 degrees C (220 degrees F), pressure and quality recommended by boiler manufacturer. Maximum oxygen content of feedwater from deaerator twelve parts per billion (12 ppb).
 2. Capacity shall exceed maximum steam flow requirement of Medical Center.
 3. Provide automatic feedwater deaerator water level control and high and low level alarms.
 4. Provide one full size redundant feed pump.
 5. Automatic boiler water level control with three-valve bypass.
 6. Automatic water softener for make-up water.
 7. Prior to operation, provide internal inspection of feedwater deaerator by Authorized Inspector certified by the National Board of Boiler and Pressure Vessel Inspectors. Submit signed report. Inspector must certify deaerator as clean and safe for operation.
- L. Instrumentation:
1. Record steam flow rate and provide totalizer for each boiler.
 2. Pressure gage for main steam, feedwater header, fuel oil and natural gas headers.
 3. Mount recorders and pressure gages in painted, reinforced sheet metal panel.
 4. Provide 100 recorder charts of each type and two replacement recorder pens for each pen arm.
- M. Chemical Treatment System: Provide individual pump type systems to deliver proper chemicals to each boiler. Water quality shall be maintained as directed by contractor-retained water treatment firm. All chemicals must be FDA approved for use where steam contacts food. Provide chemical treatment, or maintain existing chemical treatment, which protects all site condensate lines from corrosion.
- N. Blowoff System: Provide system to collect boiler bottom blowoff and to discharge it to sanitary sewer at temperature not exceeding 65 degrees C (150 degrees F).
- O. Fuel System: Provide systems to furnish sufficient No. 2 fuel oil or No. 6 fuel oil to generate steam to satisfy maximum steam flow demand of Medical Center. Comply with NFPA 31 and 54. Provide filtration systems to protect pumps, flow meters, and pressure control valves. Fuel oil systems shall operate with no air entrainment or pump cavitation.

- P. Access Platforms and Ladders: Provide for access to all valves, controls and instruments not accessible to personnel standing on floor. Design of platforms and ladders must comply with OSHA requirements.
- Q. Enclosure of Temporary Equipment: Provide clean, dry, ventilated, lighted, heated shelter for all equipment and for operating personnel. Heating system shall maintain 18 degrees C (65 degrees F) under all weather conditions and when boilers are not in operation. Shelter construction must comply with all state and local codes.
- R. Pipe, Stack, and Breeching Supports: Support all hot systems on roller and spring hangers. Anchor and support all systems in compliance with recommendations and requirements of ASME B31.1, and MSS-SP69.
- S. Pipe, Equipment, Boiler Stack and Breeching Insulation:
Provide material and thickness as specified for permanent installation, except maximum thickness shall be 50 mm (two-inches) and all pipe insulation may be fiberglass with all-service jackets.
- T. Power Supply: Provide full time power and emergency power to serve full load operation of all equipment in temporary boiler plant.
- U. Repairs and Maintenance: Contractor shall furnish labor and material for all repairs at no cost to the Government. Malfunctions that reduce the steam supply to the facility shall be repaired within four hours of notice. Other repairs shall be accomplished within 24 hours of notice. Routine maintenance requiring standard tools and supplies and less than one man-hour per day will be performed by the Government. Cleaning made necessary by Government operation will be performed by the Government.

2.10 EQUIPMENT AND MATERIALS IDENTIFICATION

- A. Use symbols, nomenclature and equipment numbers specified, shown on the drawings and shown in the maintenance manuals. Identification for piping is specified in Section 09 91 00, PAINTING.
- B. Interior (Indoor) Equipment: Engraved nameplates, with letters not less than 48 mm (3/16-inch) high of brass with black-filled letters, or rigid black plastic with white letters specified in Section 09 91 00, PAINTING permanently fastened to the equipment. Identify unit components such as coils, filters, fans, etc.
- C. Exterior (Outdoor) Equipment: Brass nameplates, with engraved black filled letters, not less than 48 mm (3/16-inch) high riveted or bolted to the equipment.
- D. Control Items: Label all temperature and humidity sensors, controllers and control dampers. Identify and label each item as they appear on the control diagrams.
- E. Valve Tags and Lists:

1. HVAC and Boiler Plant: Provide for all valves other than for equipment in Section 23 82 00, CONVECTION HEATING AND COOLING UNITS.
2. Valve tags: Engraved black filled numbers and letters not less than 13 mm (1/2-inch) high for number designation, and not less than 6.4 mm(1/4-inch) for service designation on 19 gage 38 mm (1-1/2 inches) round brass disc, attached with brass "S" hook or brass chain.
3. Valve lists: Typed or printed plastic coated card(s), sized 216 mm(8-1/2 inches) by 280 mm (11 inches) showing tag number, valve function and area of control, for each service or system. Punch sheets for a 3-ring notebook.
4. Provide detailed plan for each floor of the building indicating the location and valve number for each valve. Identify location of each valve with a color coded thumb tack in ceiling.

2.11 FIRESTOPPING

Section 07 84 00, FIRESTOPPING specifies an effective barrier against the spread of fire, smoke and gases where penetrations occur for piping and ductwork. Refer to Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION, for firestop pipe and duct insulation.

2.12 GALVANIZED REPAIR COMPOUND

Mil. Spec. DOD-P-21035B, paint form.

2.13 HVAC PIPE AND EQUIPMENT SUPPORTS AND RESTRAINTS

- A. Vibration Isolators: Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- B. Pipe Hangers and Supports for Boiler Plant: Refer to Section 23 21 11, BOILER PLANT PIPING SYSTEMS.
- C. Supports for Roof Mounted Items:
 1. Equipment: Equipment rails shall be galvanized steel, minimum 1.3 mm (18 gauge), with integral baseplate, continuous welded corner seams, factory installed 50 mm by 100 mm (2 by 4) treated wood nailer, 1.3 mm (18 gauge) galvanized steel counter flashing cap with screws, built-in cant strip, (except for gypsum or tectum deck), minimum height 280 mm (11 inches). For surface insulated roof deck, provide raised cant strip to start at the upper surface of the insulation.
 2. Pipe/duct pedestals: Provide a galvanized Unistrut channel welded to U-shaped mounting brackets which are secured to side of rail with galvanized lag bolts.
- D. Pipe Supports: Comply with MSS SP-58. Type Numbers specified refer to this standard. For selection and application comply with MSS SP-69. Refer to Section 05 50 00, METAL FABRICATIONS, for miscellaneous metal support materials and prime coat painting requirements.
- E. Attachment to Concrete Building Construction:

1. Concrete insert: MSS SP-58, Type 18.
 2. Self-drilling expansion shields and machine bolt expansion anchors:
Permitted in concrete not less than 102 mm (four inches) thick when approved by the Resident Engineer for each job condition.
 3. Power-driven fasteners: Permitted in existing concrete or masonry not less than 102 mm (four inches) thick when approved by the Resident Engineer for each job condition.
- F. Attachment to Steel Building Construction:
1. Welded attachment: MSS SP-58, Type 22.
 2. Beam clamps: MSS SP-58, Types 20, 21, 28 or 29. Type 23 C-clamp may be used for individual copper tubing up to 23mm (7/8-inch) outside diameter.
- H. Attachment to Wood Construction: Wood screws or lag bolts.
- I. Hanger Rods: Hot-rolled steel, ASTM A36 or A575 for allowable load listed in MSS SP-58. For piping, provide adjustment means for controlling level or slope. Types 13 or 15 turn-buckles shall provide 38 mm (1-1/2 inches) minimum of adjustment and incorporate locknuts. All-thread rods are acceptable.
- J. Hangers Supporting Multiple Pipes (Trapeze Hangers): Galvanized, cold formed, lipped steel channel horizontal member, not less than 41 mm by 41 mm (1-5/8 inches by 1-5/8 inches), 2.7 mm (No. 12 gage), designed to accept special spring held, hardened steel nuts. Not permitted for steam supply and condensate piping.
1. Allowable hanger load: Manufacturers rating less 91kg (200 pounds).
 2. Guide individual pipes on the horizontal member of every other trapeze hanger with 6 mm (1/4-inch) U-bolt fabricated from steel rod. Provide Type 40 insulation shield, secured by two 13mm (1/2-inch) galvanized steel bands, or preinsulated calcium silicate shield for insulated piping at each hanger.
- K. Supports for Piping Systems:
1. Select hangers sized to encircle insulation on insulated piping. Refer to Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION for insulation thickness. To protect insulation, provide Type 39 saddles for roller type supports or preinsulated calcium silicate shields. Provide Type 40 insulation shield or preinsulated calcium silicate shield at all other types of supports and hangers including those for preinsulated piping.
 2. Piping Systems except High and Medium Pressure Steam (MSS SP-58):
 - a. Standard clevis hanger: Type 1; provide locknut.
 - b. Riser clamps: Type 8.
 - c. Wall brackets: Types 31, 32 or 33.

- d. Roller supports: Type 41, 43, 44 and 46.
- e. Saddle support: Type 36, 37 or 38.
- f. Turnbuckle: Types 13 or 15. Preinsulate.
- g. U-bolt clamp: Type 24.
- h. Copper Tube:
 - 1) Hangers, clamps and other support material in contact with tubing shall be painted with copper colored epoxy paint, plastic coated or taped with non adhesive isolation tape to prevent electrolysis.
 - 2) For vertical runs use epoxy painted or plastic coated riser clamps.
 - 3) For supporting tube to strut: Provide epoxy painted pipe straps for copper tube or plastic inserted vibration isolation clamps.
 - 4) Insulated Lines: Provide pre-insulated calcium silicate shields sized for copper tube.
- i. Supports for plastic or glass piping: As recommended by the pipe manufacturer with black rubber tape extending one inch beyond steel support or clamp.
- 3. High and Medium Pressure Steam (MSS SP-58):
 - a. Provide eye rod or Type 17 eye nut near the upper attachment.
 - b. Piping 50 mm (2 inches) and larger: Type 43 roller hanger. For roller hangers requiring seismic bracing provide a Type 1 clevis hanger with Type 41 roller attached by flat side bars.
 - c. Piping with Vertical Expansion and Contraction:
 - 1) Movement up to 20 mm (3/4-inch): Type 51 or 52 variable spring unit with integral turn buckle and load indicator.
 - 2) Movement more than 20 mm (3/4-inch): Type 54 or 55 constant support unit with integral adjusting nut, turn buckle and travel position indicator.
- 4. Convertor and Expansion Tank Hangers: May be Type 1 sized for the shell diameter. Insulation where required will cover the hangers.
- L. Pre-insulated Calcium Silicate Shields:
 - 1. Provide 360 degree water resistant high density 965 kPa (140 psi) compressive strength calcium silicate shields encased in galvanized metal.
 - 2. Pre-insulated calcium silicate shields to be installed at the point of support during erection.
 - 3. Shield thickness shall match the pipe insulation.
 - 4. The type of shield is selected by the temperature of the pipe, the load it must carry, and the type of support it will be used with.

- a. Shields for supporting chilled or cold water shall have insulation that extends a minimum of 1 inch past the sheet metal. Provide for an adequate vapor barrier in chilled lines.
 - b. The pre-insulated calcium silicate shield shall support the maximum allowable water filled span as indicated in MSS-SP 69. To support the load, the shields may have one or more of the following features: structural inserts 4138 kPa (600 psi) compressive strength, an extra bottom metal shield, or formed structural steel (ASTM A36) wear plates welded to the bottom sheet metal jacket.
5. Shields may be used on steel clevis hanger type supports, roller supports or flat surfaces.

2.14 PIPE PENETRATIONS

- A. Install sleeves during construction for other than blocked out floor openings for risers in mechanical bays.
- B. To prevent accidental liquid spills from passing to a lower level, provide the following:
 1. For sleeves: Extend sleeve 25 mm (one inch) above finished floor and provide sealant for watertight joint.
 2. For blocked out floor openings: Provide 40 mm (1-1/2 inch) angle set in silicone adhesive around opening.
 3. For drilled penetrations: Provide 40 mm (1-1/2 inch) angle ring or square set in silicone adhesive around penetration.
- C. Penetrations are not allowed through beams or ribs, but may be installed in concrete beam flanges. Any deviation from these requirements must receive prior approval of Resident Engineer.
- D. Sheet Metal, Plastic, or Moisture-resistant Fiber Sleeves: Provide for pipe passing through floors, interior walls, and partitions, unless brass or steel pipe sleeves are specifically called for below.
- E. Cast Iron or Zinc Coated Pipe Sleeves: Provide for pipe passing through exterior walls below grade. Make space between sleeve and pipe watertight with a modular or link rubber seal. Seal shall be applied at both ends of sleeve.
- F. Galvanized Steel or an alternate Black Iron Pipe with asphalt coating Sleeves: Provide for pipe passing through concrete beam flanges, except where brass pipe sleeves are called for. Provide sleeve for pipe passing through floor of mechanical rooms, laundry work rooms, and animal rooms above basement. Except in mechanical rooms, connect sleeve with floor plate.
- G. Brass Pipe Sleeves: Provide for pipe passing through quarry tile, terrazzo or ceramic tile floors. Connect sleeve with floor plate.

- H. Sleeves are not required for wall hydrants for fire department connections or in drywall construction.
- I. Sleeve Clearance: Sleeve through floors, walls, partitions, and beam flanges shall be one inch greater in diameter than external diameter of pipe. Sleeve for pipe with insulation shall be large enough to accommodate the insulation. Interior openings shall be caulked tight with fire stopping material and sealant to prevent the spread of fire, smoke, and gases.
- J. Sealant and Adhesives: Shall be as specified in Section 07 92 00, JOINT SEALANTS.

2.15 SPECIAL TOOLS AND LUBRICANTS

- A. Furnish, and turn over to the RE/COTR, special tools not readily available commercially, that are required for disassembly or adjustment of equipment and machinery furnished.
- B. Grease Guns with Attachments for Applicable Fittings: One for each type of grease required for each motor or other equipment.
- C. Tool Containers: Hardwood or metal, permanently identified for intended service and mounted, or located, where directed by the Resident Engineer.
- D. Lubricants: A minimum of 0.95 L (one quart) of oil, and 0.45 kg (one pound) of grease, of equipment manufacturer's recommended grade and type, in unopened containers and properly identified as to use for each different application.

2.16 WALL, FLOOR AND CEILING PLATES

- A. Material and Type: Chrome plated brass or chrome plated steel, one piece or split type with concealed hinge, with set screw for fastening to pipe, or sleeve. Use plates that fit tight around pipes, cover openings around pipes and cover the entire pipe sleeve projection.
- B. Thickness: Not less than 2.4 mm (3/32-inch) for floor plates. For wall and ceiling plates, not less than 0.64 mm (0.025-inch) for up to 80 mm (3-inch pipe), 0.89 mm (0.035-inch) for larger pipe.
- C. Locations: Use where pipe penetrates floors, walls and ceilings in exposed locations, in finished areas only. Use also where insulation ends on exposed water supply pipe drop from overhead. Provide a watertight joint in spaces where brass or steel pipe sleeves are specified.

2.17 ASBESTOS

Materials containing asbestos are not permitted.

PART 3 - EXECUTION

3.1 ARRANGEMENT AND INSTALLATION OF EQUIPMENT AND PIPING

- A. Coordinate location of piping, sleeves, inserts, hangers, ductwork and equipment. Locate piping, sleeves, inserts, hangers, ductwork and equipment clear of windows, doors, openings, light outlets, and other services and utilities. Prepare equipment layout drawings to coordinate proper location and personnel access of all facilities. Submit the drawings for review as required by Part 1. Follow manufacturer's published recommendations for installation methods not otherwise specified.
- B. Operating Personnel Access and Observation Provisions: Select and arrange all equipment and systems to provide clear view and easy access, without use of portable ladders, for maintenance and operation of all devices including, but not limited to: all equipment items, valves, filters, strainers, transmitters, sensors, control devices. All gages and indicators shall be clearly visible by personnel standing on the floor or on permanent platforms. Do not reduce or change maintenance and operating space and access provisions that are shown on the drawings.
- C. Boiler Control Panel Locations: Locate and orient panels so that operating personnel standing in front of boilers can view the control switches and displays on the panel face. Panels mounted on the sides near the front of fire tube boilers are acceptable.
- D. Boiler and Economizer Access Platforms: Arrange piping and equipment to allow access by a person standing on the platforms to all valves located above the boilers, to boiler manways located on top of the boilers, and to all economizer valves and access panels.
- E. Equipment and Piping Support: Coordinate structural systems necessary for pipe and equipment support with pipe and equipment locations to permit proper installation.
- F. Location of pipe sleeves, trenches and chases shall be accurately coordinated with equipment and piping locations.
- G. Cutting Holes:
 - 1. Cut holes through concrete and masonry by rotary core drill. Pneumatic hammer, impact electric, and hand or manual hammer type drill will not be allowed, except as permitted by RE/COTR where working area space is limited.
 - 2. Locate holes to avoid interference with structural members such as beams or grade beams. Holes shall be laid out in advance and drilling done only after approval by RE/COTR. If the Contractor considers it necessary to drill through structural members, this matter shall be referred to RE/COTR for approval.

3. Do not penetrate membrane waterproofing.
- H. Interconnection of Instrumentation or Control Devices: Generally, electrical and pneumatic interconnections are not shown but must be provided.
- I. Minor Piping: Generally, small diameter pipe runs from drips and drains, water cooling, and other service are not shown but must be provided.
- J. Electrical and Pneumatic Interconnection of Controls and Instruments: This generally not shown but must be provided. This includes interconnections of sensors, transmitters, transducers, control devices, control and instrumentation panels, instruments and computer workstations. Comply with NFPA-70.
- K. Protection and Cleaning:
 1. Equipment and materials shall be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations and as approved by the Resident Engineer. Damaged or defective items in the opinion of the Resident Engineer, shall be replaced.
 2. Protect all finished parts of equipment, such as shafts and bearings where accessible, from rust prior to operation by means of protective grease coating and wrapping. Close pipe openings with caps or plugs during installation. Tightly cover and protect fixtures and equipment against dirt, water chemical, or mechanical injury. At completion of all work thoroughly clean fixtures, exposed materials and equipment.
- L. Concrete and Grout: Use concrete and shrink compensating grout 25 MPa (3000 psi) minimum, specified in Section 03 30 00, CAST-IN-PLACE CONCRETE.
- M. Install gages, thermometers, valves and other devices with due regard for ease in reading or operating and maintaining said devices. Locate and position thermometers and gages to be easily read by operator or staff standing on floor or walkway provided. Servicing shall not require dismantling adjacent equipment or pipe work.
- N. Install steam piping expansion joints as per manufacturer's recommendations.
- O. Work in Existing Building:
 1. Perform as specified in Article, OPERATIONS AND STORAGE AREAS, Article, ALTERATIONS, and Article, RESTORATION of the Section 01 00 00, GENERAL REQUIREMENTS for relocation of existing equipment, alterations and restoration of existing building(s).
 2. As specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, OPERATIONS AND STORAGE AREAS, make alterations to existing service

- piping at times that will least interfere with normal operation of the facility.
3. Cut required openings through existing masonry and reinforced concrete using diamond core drills. Use of pneumatic hammer type drills, impact type electric drills, and hand or manual hammer type drills, will be permitted only with approval of the Resident Engineer. Locate openings that will least effect structural slabs, columns, ribs or beams. Refer to the Resident Engineer for determination of proper design for openings through structural sections and opening layouts approval, prior to cutting or drilling into structure. After Resident Engineer's approval, carefully cut opening through construction no larger than absolutely necessary for the required installation.
 - P. Work in Animal Research Areas: Seal all pipe and duct penetrations with silicone sealant to prevent entrance of insects.
 - Q. Switchgear Drip Protection: Every effort shall be made to eliminate the installation of pipe above electrical and telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints.
 - R. Inaccessible Equipment:
 1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, equipment shall be removed and reinstalled or remedial action performed as directed at no additional cost to the Government.
 2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as motors, fans, pumps, belt guards, transformers, high voltage lines, piping, and ductwork.

3.2 TEMPORARY PIPING AND EQUIPMENT

- A. Continuity of operation of existing facilities will generally require temporary installation or relocation of equipment and piping.
- B. The Contractor shall provide all required facilities in accordance with the requirements of phased construction and maintenance of service. All piping and equipment shall be properly supported, sloped to drain, operate without excessive stress, and shall be insulated where injury can occur to personnel by contact with operating facilities. The requirements of Para. 3.1 apply.
- C. Temporary facilities and piping shall be completely removed and any openings in structures sealed. Provide necessary blind flanges and caps to seal open piping remaining in service.

3.3 RIGGING

- A. Design is based on application of available equipment. Openings in building structures are planned to accommodate design scheme.
- B. Alternative methods of equipment delivery may be offered by Contractor and will be considered by Government under specified restrictions of phasing and maintenance of service as well as structural integrity of the building.
- C. Close all openings in the building when not required for rigging operations to maintain proper environment in the facility for Government operation and maintenance of service.
- D. Contractor shall provide all facilities required to deliver specified equipment and place on foundations. Attachments to structures for rigging purposes and support of equipment on structures shall be Contractor's full responsibility. Upon request, the Government will check structure adequacy and advise Contractor of recommended restrictions.
- E. Contractor shall check all clearances, weight limitations and shall offer a rigging plan designed by a Registered Professional Engineer. All modifications to structures, including reinforcement thereof, shall be at Contractor's cost, time and responsibility.
- F. Rigging plan and methods shall be referred to RE/COTR for evaluation prior to actual work.
- G. Restore building to original condition upon completion of rigging work.

3.4 PIPE AND EQUIPMENT SUPPORTS

- A. Where hanger spacing does not correspond with joist or rib spacing, use structural steel channels secured directly to joist and rib structure that will correspond to the required hanger spacing, and then suspend the equipment and piping from the channels. Drill or burn holes in structural steel only with the prior approval of the RE/COTR.
- B. Use of chain, wire or strap hangers; wood for blocking, stays and bracing; or, hangers suspended from piping above will not be permitted. Replace or thoroughly clean rusty products and paint with zinc primer.
- C. Use hanger rods that are straight and vertical. Turnbuckles for vertical adjustments may be omitted where limited space prevents use. Provide a minimum of 15 mm (1/2-inch) clearance between pipe or piping covering and adjacent work.
- D. HVAC Horizontal Pipe Support Spacing: Refer to MSS SP-69. Provide additional supports at valves, strainers, in-line pumps and other heavy components. Provide a support within one foot of each elbow.
- E. HVAC Vertical Pipe Supports:

1. Up to 150 mm (6-inch pipe), 9 m (30 feet) long, bolt riser clamps to the pipe below couplings, or welded to the pipe and rests supports securely on the building structure.
2. Vertical pipe larger than the foregoing, support on base elbows or tees, or substantial pipe legs extending to the building structure.

F. Overhead Supports:

1. The basic structural system of the building is designed to sustain the loads imposed by equipment and piping to be supported overhead.
2. Provide steel structural members, in addition to those shown, of adequate capability to support the imposed loads, located in accordance with the final approved layout of equipment and piping.
3. Tubing and capillary systems shall be supported in channel troughs.

G. Floor Supports:

1. Provide concrete bases, concrete anchor blocks and pedestals, and structural steel systems for support of equipment and piping. Anchor and dowel concrete bases and structural systems to resist forces under operating and seismic conditions (if applicable) without excessive displacement or structural failure.
2. Do not locate or install bases and supports until equipment mounted thereon has been approved. Size bases to match equipment mounted thereon plus 50 mm (2 inch) excess on all edges. Boiler foundations shall have horizontal dimensions that exceed boiler base frame dimensions by at least 150 mm (6 inches) on all sides. Refer to structural drawings. Bases shall be neatly finished and smoothed, shall have chamfered edges at the top, and shall be suitable for painting.
3. All equipment shall be shimmed, leveled, firmly anchored, and grouted with epoxy grout. Anchor bolts shall be placed in sleeves, anchored to the bases. Fill the annular space between sleeves and bolts with a granular material to permit alignment and realignment.

3.5 MECHANICAL DEMOLITION

- A. Rigging access, other than indicated on the drawings, shall be provided by the Contractor after approval for structural integrity by the RE/COTR. Such access shall be provided without additional cost or time to the Government. Where work is in an operating plant, provide approved protection from dust and debris at all times for the safety of plant personnel and maintenance of plant operation and environment of the plant.
- B. In an operating plant, maintain the operation, cleanliness and safety. Government personnel will be carrying on their normal duties of operating, cleaning and maintaining equipment and plant operation.

Confine the work to the immediate area concerned; maintain cleanliness and wet down demolished materials to eliminate dust. Do not permit debris to accumulate in the area to the detriment of plant operation. Perform all flame cutting to maintain the fire safety integrity of this plant. Adequate fire extinguishing facilities shall be available at all times. Perform all work in accordance with recognized fire protection standards. Inspection will be made by personnel of the VA Medical Center, and Contractor shall follow all directives of the RE or COTR with regard to rigging, safety, fire safety, and maintenance of operations.

- C. Completely remove all piping, wiring, conduit, and other devices associated with the equipment not to be re-used in the new work. This includes all pipe, valves, fittings, insulation, and all hangers including the top connection and any fastenings to building structural systems. Seal all openings, after removal of equipment, pipes, ducts, and other penetrations in roof, walls, floors, in an approved manner and in accordance with plans and specifications where specifically covered. Structural integrity of the building system shall be maintained. Reference shall also be made to the drawings and specifications of the other disciplines in the project for additional facilities to be demolished or handled.
- D. All valves including gate, globe, ball, butterfly and check, all pressure gages and thermometers with wells shall remain Government property and shall be removed and delivered to RE/COTR and stored as directed. The Contractor shall remove all other material and equipment, devices and demolition debris under these plans and specifications. Such material shall be removed from Government property expeditiously and shall not be allowed to accumulate.

3.6 CLEANING AND PAINTING

- A. Prior to final inspection and acceptance of the plant and facilities for beneficial use by the Government, the plant facilities, equipment and systems shall be thoroughly cleaned and painted. Refer to Section 09 91 00, PAINTING.
- B. In addition, the following special conditions apply:
 - 1. Cleaning shall be thorough. Use solvents, cleaning materials and methods recommended by the manufacturers for the specific tasks. Remove all rust prior to painting and from surfaces to remain unpainted. Repair scratches, scuffs, and abrasions prior to applying prime and finish coats.
 - 2. Material And Equipment Not To Be Painted Includes:
 - a. Motors, controllers, control switches, and safety switches.

- b. Control and interlock devices.
 - c. Regulators.
 - d. Pressure reducing valves.
 - e. Control valves and thermostatic elements.
 - f. Lubrication devices and grease fittings.
 - g. Copper, brass, aluminum, stainless steel and bronze surfaces.
 - h. Valve stems and rotating shafts.
 - i. Pressure gauges and thermometers.
 - j. Glass.
 - k. Name plates.
- 3. Control and instrument panels shall be cleaned, damaged surfaces repaired, and shall be touched-up with matching paint obtained from panel manufacturer.
 - 4. Pumps, motors, steel and cast iron bases, and coupling guards shall be cleaned, and shall be touched-up with the same color as utilized by the pump manufacturer
 - 5. Boilers, Burners, Fuel Trains and Accessories: Retain manufacturer's factory finish. Touch up or recoat as necessary to provide smooth, even-colored and even-textured finish.
 - 6. Temporary Facilities: Apply paint to surfaces that do not have existing finish coats.
 - 7. Paint shall withstand the following temperatures without peeling or discoloration:
 - a. Boiler stack and breeching -- 65 degrees C (150 degrees F) on insulation jacket surface and 315 degrees C (600 degrees F) on metal surface of stacks and breeching.
 - b. Condensate and feedwater -- 38 degrees C (100 degrees F) on insulation jacket surface and 120 degrees C (250 degrees F) on metal pipe surface.
 - c. Steam -- 52 degrees C (125 degrees F) on insulation jacket surface and 190 degrees C (375 degrees F) on metal pipe surface.
 - 8. Final result shall be smooth, even-colored, even-textured factory finish on all items. Completely repaint the entire piece of equipment if necessary to achieve this.

3.7 IDENTIFICATION SIGNS

- A. Provide laminated plastic signs, with engraved lettering not less than 5 mm (3/16-inch) high, designating functions, for all equipment, switches, motor controllers, relays, meters, control devices, including automatic control valves. Nomenclature and identification symbols shall correspond to that used in maintenance manual, and in diagrams specified elsewhere. Attach by chain, adhesive, or screws.

- B. Factory Built Equipment: Metal plate, securely attached, with name and address of manufacturer, serial number, model number, size, performance.
- C. Boiler Plant Instrumentation Panel: Refer to Section 23 09 11, .
- D. Boiler Control Panels: Refer to Section 23 09 11, INSTRUMENTATION AND CONTROL FOR BOILER PLANT
- E. Pipe Identification: Refer to Section 09 91 00, PAINTING.

3.8 MOTOR AND DRIVE ALIGNMENT

- A. Belt Drive: Set driving and driven shafts parallel and align so that the corresponding grooves are in the same plane.
- B. Direct-connect Drive: Securely mount motor in accurate alignment so that shafts are free from both angular and parallel misalignment when both motor and driven machine are operating at normal temperatures.

3.9 LUBRICATION

- A. Lubricate all devices requiring lubrication prior to initial operation. Field-check all devices for proper lubrication.
- B. Equip all devices with required lubrication fittings or devices. Provide a minimum of one liter (one quart) of oil and 0.5 kg (one pound) of grease of manufacturer's recommended grade and type for each different application; also provide 12 grease sticks for lubricated plug valves. Deliver all materials to RE/COTR in unopened containers that are properly identified as to application.
- C. Provide a separate grease gun with attachments for applicable fittings for each type of grease applied.
- D. All lubrication points shall be accessible without disassembling equipment, except to remove access plates.

3.10 STARTUP AND TEMPORARY OPERATION

Start up equipment as described in equipment specifications. Verify that vibration is within specified tolerance prior to extended operation. Temporary use of equipment is specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT.

3.11 OPERATING AND PERFORMANCE TESTS

- A. Prior to the final inspection, perform required tests as specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TESTS, and Section 23 08 11, DEMONSTRATIONS AND TESTS FOR BOILER PLANT, and submit the test reports and records to the RE/COTR.
- B. Should evidence of malfunction in any tested system, or piece of equipment or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost to the Government.

- C. When completion of certain work or system occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then make performance tests for heating systems and for cooling systems respectively during first actual seasonal use of respective systems following completion of work.

3.12 DEMONSTRATIONS AND TESTS, TEMPORARY BOILER PLANT EQUIPMENT

- A. Test prior to placing in service.
- B. Demonstrate to RE/COTR the proper operation of all equipment, instruments, operating and safety controls, and devices.
- C. Demonstrate to RE/COTR the proper operation of burners.
 - 1. Emissions within limits specified for new boilers on this project.
 - 2. Stable flame at all operating points with no pulsations.
 - 3. Smooth flame light off, with no delays, puffs or flashbacks.
 - 4. Turndown capability as specified.
- D. Develop full steam output capacity required.
- E. New Boilers Installed in Temporary Location:
 - 1. Perform all tests required by boiler specification.
 - 2. Perform complete retest after boiler is placed in its permanent location.

3.13 INSTRUCTIONS TO VA PERSONNEL

Provide in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS, and Section 23 08 11, DEMONSTRATIONS AND TESTS FOR BOILER PLANT.

- - - E N D - - -

SECTION 23 05 12
GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies the furnishing, installation and connection of motors for HVAC and steam generation equipment.

1.2 RELATED WORK:

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements that are common to more than one Section of Division 26.
- B. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS: Starters, control and protection for motors.
- C. Other sections specifying motor driven equipment in Division 23.

1.3 SUBMITTALS:

- A. In accordance with Section, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Shop Drawings:
 - 1. Sufficient information, clearly presented, shall be included to determine compliance with drawings and specifications.
 - 2. Include electrical ratings, dimensions, mounting details, materials, horsepower, RPM, enclosure, starting characteristics, torque characteristics, code letter, full load and locked rotor current, service factor, and lubrication method.
- C. Manuals:
 - 1. Submit simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals, including technical data sheets and application data.
- D. Certification: Two weeks prior to final inspection, unless otherwise noted, submit four copies of the following certification to the Resident Engineer:
 - 1. Certification that the motors have been properly applied, installed, adjusted, lubricated, and tested.

1.4 APPLICABLE PUBLICATIONS:

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. National Electrical Manufacturers Association (NEMA):
 - MG 1-98.....Motors and Generators

MG 2-01.....Safety Standard and Guide for Selection,
Installation and Use of Electric Motors and
Generators

C. National Fire Protection Association (NFPA):

70-02.....National Electrical Code (NEC)

PART 2 - PRODUCTS

2.1 MOTORS:

A. For alternating current, fractional and integral horsepower motors, NEMA Publications MG 1 and MG 2 shall apply.

B. Voltage ratings shall be as follows:

1. Single phase:

- a. Motors connected to 120-volt systems: 115 volts.
- b. Motors connected to 208-volt systems: 200 volts.
- c. Motors connected to 240 volt or 480 volt systems: 230/460 volts, dual connection.

2. Three phase:

- a. Motors connected to 208-volt systems: 200 volts.
- b. Motors, less than 74.6 kW (100 HP), connected to 240 volt or 480 volt systems: 230/460 volts, dual connection.
- c. Motors, 74.6 kW (100 HP) or larger, connected to 240-volt systems: 230 volts.
- d. Motors, 74.6 kW (100 HP) or larger, connected to 480-volt systems: 460 volts.
- e. Motors connected to high voltage systems: Shall conform to NEMA Standards for connection to the nominal system voltage shown on the drawings.

C. Number of phases shall be as follows:

- 1. Motors, less than 373 W (1/2 HP): Single phase.
- 2. Motors, 373 W (1/2 HP) and larger: 3 phase.
- 3. Exceptions:
 - a. Hermetically sealed motors.
 - b. Motors for equipment assemblies, less than 746 W (one HP), may be single phase provided the manufacturer of the proposed assemblies cannot supply the assemblies with three phase motors.

D. Horsepower ratings shall be adequate for operating the connected loads continuously in the prevailing ambient temperatures in areas where the motors are installed, without exceeding the NEMA standard temperature rises for the motor insulation.

E. Motor designs, as indicated by the NEMA code letters, shall be coordinated with the connected loads to assure adequate starting and running torque.

F. Motor Enclosures:

1. Shall be the NEMA types shown on the drawings for the motors.
2. Where the types of motor enclosures are not shown on the drawings, they shall be the NEMA types, which are most suitable for the environmental conditions where the motors are being installed.
3. Enclosures shall be primed and finish coated at the factory with manufacturer's prime coat and standard finish.

G. Additional requirements for specific motors, as indicated in other sections, shall also apply.

H. Energy-Efficient Motors (Motor Efficiencies): All permanently wired polyphase motors of 746 Watts or more shall meet the minimum full-load efficiencies as indicated in the following table, and as specified in this specification. Motors of 746 Watts or more with open, drip-proof or totally enclosed fan-cooled enclosures shall be NEMA premium efficiency type, unless otherwise indicated. Motors provided as an integral part of motor driven equipment are excluded from this requirement if a minimum seasonal or overall efficiency requirement is indicated for that equipment by the provisions of another section.

Minimum Efficiencies Open Drip-Proof				Minimum Efficiencies Totally Enclosed Fan-Cooled			
Rating kW (HP)	1200 RPM	1800 RPM	3600 RPM	Rating kW (HP)	1200 RPM	1800 RPM	3600 RPM
0.746 (1)	82.5%	85.5%	77.0%	0.746 (1)	82.5%	85.5%	77.0%
1.12 (1.5)	86.5%	86.5%	84.0%	1.12 (1.5)	87.5%	86.5%	84.0%
1.49 (2)	87.5%	86.5%	85.5%	1.49 (2)	88.5%	86.5%	85.5%
2.24 (3)	88.5%	89.5%	85.5%	2.24 (3)	89.5%	89.5%	86.5%
3.73 (5)	89.5%	89.5%	86.5%	3.73 (5)	89.5%	89.5%	88.5%
5.60 (7.5)	90.2%	91.0%	88.5%	5.60 (7.5)	91.0%	91.7%	89.5%
7.46 (10)	91.7%	91.7%	89.5%	7.46 (10)	91.0%	91.7%	90.2%
11.2 (15)	91.7%	93.0%	90.2%	11.2 (15)	91.7%	92.4%	91.0%
14.9 (20)	92.4%	93.0%	91.0%	14.9 (20)	91.7%	93.0%	91.0%
18.7 (25)	93.0%	93.6%	91.7%	18.7 (25)	93.0%	93.6%	91.7%
22.4 (30)	93.6%	94.1%	91.7%	22.4 (30)	93.0%	93.6%	91.7%
29.8 (40)	94.1%	94.1%	92.4%	29.8 (40)	94.1%	94.1%	92.4%
37.3 (50)	94.1%	94.5%	93.0%	37.3 (50)	94.1%	94.5%	93.0%
44.8 (60)	94.5%	95.0%	93.6%	44.8 (60)	94.5%	95.0%	93.6%
56.9 (75)	94.5%	95.0%	93.6%	56.9 (75)	94.5%	95.4%	93.6%
74.6 (100)	95.0%	95.4%	93.6%	74.6 (100)	95.0%	95.4%	94.1%
93.3 (125)	95.0%	95.4%	94.1%	93.3 (125)	95.0%	95.4%	95.0%
112 (150)	95.4%	95.8%	94.1%	112 (150)	95.8%	95.8%	95.0%

149.2 (200)	95.4%	95.8%	95.0%	149.2 (200)	95.8%	96.2%	95.4%
-------------	-------	-------	-------	-------------	-------	-------	-------

I. Minimum Power Factor at Full Load and Rated Voltage: 90 percent at 1200 RPM, 1800 RPM and 3600 RPM.

J. Premium efficiency motors shall be used where energy cost/kW x (hours use/year) > 50.

PART 3 - EXECUTION

3.1 INSTALLATION:

Install motors in accordance with manufacturer's recommendations, the NEC, NEMA, as shown on the drawings and/or as required by other sections of these specifications.

3.2 FIELD TESTS

Megger all motors after installation, before start-up. All shall test free from grounds.

- - - E N D - - -

SECTION 23 05 41
NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT

PART 1 - GENERAL

1.1 DESCRIPTION

Noise criteria, vibration tolerance and vibration isolation for HVAC and plumbing work.

1.2 RELATED WORK

- A. Section 03 30 00, CAST-IN-PLACE CONCRETE: Requirements for concrete inertia bases.
- B. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION: General mechanical requirements and items, which are common to more than one section of Division 23.
- C. Section 23 22 13, STEAM AND CONDENSATE HEATING PIPING: Requirements for flexible pipe connectors to reciprocating and rotating mechanical equipment.
- D. Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS: Requirements for optional Air Handling Unit internal vibration isolation.
- E. Section 23 31 00, HVAC DUCTS AND CASINGS: requirements for flexible duct connectors, sound attenuators and sound absorbing duct lining.
- F. SECTION 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC: requirements for sound and vibration tests.

1.3 QUALITY ASSURANCE

- A. Refer to article, QUALITY ASSURANCE in specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- B. Noise Criteria:
 - 1. Noise levels in all 8 octave bands due to equipment and duct systems shall not exceed following NC levels:

TYPE OF ROOM	NC LEVEL
Audio Speech Pathology	25
Audio Suites	25
Auditoriums, Theaters	35
Bathrooms and Toilet Rooms	40
Chapels	35
Conference Rooms	35
Corridors (Nurse Stations)	40
Corridors(Public)	40

Dining Rooms, Food Services/ Serving	35
Examination Rooms	35
Gymnasiums	50
Kitchens	50
Laboratories	45
Laundries	50
Lobbies, Waiting Areas	40
Locker Rooms	50
Offices, large open (3 or more occupants)	40
Offices, small private (2 or fewer occupants)	35
Operating Rooms	40
Patient Rooms	35
Phono/ Cardiology	25
Recreation Rooms	50
Shops	50
SPD	35
Therapeutic Pools	45
Treatment Rooms	35
Warehouse	50
X-Ray & general Work Rooms	40

2. For equipment which has no sound power ratings scheduled on the plans, the contractor shall select equipment such that the foregoing noise criteria, local ordinance noise levels, and OSHA requirements are not exceeded. Selection procedure shall be in accordance with ASHRAE Fundamentals Handbook, Chapter 7, Sound and Vibration.
3. An allowance, not to exceed 5db, may be added to the measured value to compensate for the variation of the room attenuating effect between room test condition prior to occupancy and design condition after occupancy which may include the addition of sound absorbing material, such as, furniture. This allowance may not be taken after occupancy. The room attenuating effect is defined as the difference between sound power level emitted to room and sound pressure level in room.

4. In absence of specified measurement requirements, measure equipment noise levels three feet from equipment and at an elevation of maximum noise generation.

D. Allowable Vibration Tolerances for Rotating, Non-reciprocating Equipment: Not to exceed a self-excited vibration maximum velocity of 5 mm per second (0.20 inch per second) RMS, filter in, when measured with a vibration meter on bearing caps of machine in vertical, horizontal and axial directions or measured at equipment mounting feet if bearings are concealed. Measurements for internally isolated fans and motors may be made at the mounting feet.

1.4 SUBMITTALS

A. Submit in accordance with specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Manufacturer's Literature and Data:

1. Vibration isolators:

- a. Floor mountings
- b. Hangers
- c. Snubbers
- d. Thrust restraints

2. Bases.

3. Seismic restraint provisions and bolting.

4. Acoustical enclosures.

C. Isolator manufacturer shall furnish with submittal load calculations for selection of isolators, including supplemental bases, based on lowest operating speed of equipment supported.

1.5 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc. (ASHRAE):

2005.....Fundamentals Handbook, Chapter 7, Sound and
Vibration

C. American Society for Testing and Materials (ASTM):

A123/A123M-02.....Standard Specification for Zinc (Hot-Dip
Galvanized) Coatings on Iron and Steel Products

A307-04.....Standard Specification for Carbon Steel Bolts
and Studs, 60,000 PSI Tensile Strength

D2240-05.....Standard Test Method for Rubber Property -
Durometer Hardness

D. Manufacturers Standardization (MSS):

SP-58-02.....Pipe Hangers and Supports-Materials, Design and
Manufacture

E. Occupational Safety and Health Administration (OSHA):

29 CFR 1910.95.....Occupational Noise Exposure

PART 2 - PRODUCTS

2.1 GENERAL REQUIREMENTS

- A. Type of isolator, base, and minimum static deflection shall be as required for each specific equipment application as recommended by isolator or equipment manufacturer but subject to minimum requirements indicated herein and in the schedule on the drawings.
- B. Elastometric Isolators shall comply with ASTM D2240 and be oil resistant neoprene with a maximum stiffness of 60 durometer and have a straight-line deflection curve.
- C. Exposure to weather: Isolators, including springs, exposed to weather shall be hot dip galvanized after fabrication. Hot-dip zinc coating shall not be less than 609 grams per square meter (two ounces per square foot) by weight complying with ASTM A123. In addition provide limit stops to resist wind velocity. Comply with the design wind velocity of _____ mph (_____ kmph).
- D. Uniform Loading: Select and locate isolators to produce uniform loading and deflection even when equipment weight is not evenly distributed.
- E. Color code isolators by type and size for easy identification of capacity.

2.2 SEISMIC RESTRAINT REQUIREMENTS FOR EQUIPMENTS

- A. Bolt pad mounted equipment, without vibration isolators, to the floor or other support using ASTM A307 standard bolting material.
- B. Floor mounted equipment, with vibration Isolators: Type SS. Where Type N isolators are used provide channel frame base horizontal restraints bolted to the floor, or other support, on all sides of the equipment. Size and material required for the base shall be as recommended by the isolator manufacturer.

- C. On all sided of suspended equipment, provide bracing for rigid supports and provide restraints for resiliently supported equipment. The slack cable restraint method, Mason Industries, or equal, is acceptable.

2.3 VIBRATION ISOLATORS

A. Floor Mountings:

1. Double Deflection Neoprene (Type N): Shall include neoprene covered steel support plated (top and bottom), friction pads, and necessary bolt holes.
2. Spring Isolators (Type S): Shall be free-standing, laterally stable and include acoustical friction pads and leveling bolts. Isolators shall have a minimum ratio of spring diameter-to-operating spring height of 1.0 and an additional travel to solid equal to 50 percent of rated deflection.
3. Captive Spring Mount for Seismic Restraint (Type SS):
 - a. Design mounts to resiliently resist seismic forces in all directions. Snubbing shall take place in all modes with adjustment to limit upward, downward, and horizontal travel to a maximum of 6 mm (1/4-inch) before contacting snubbers. Mountings shall have a minimum rating of one G coefficient of gravity as calculated and certified by a registered structural engineer.
 - b. All mountings shall have leveling bolts that must be rigidly bolted to the equipment. Spring diameters shall be no less than 0.8 of the compressed height of the spring at rated load. Springs shall have a minimum additional travel to solid equal to 50 percent of the rated deflection. Mountings shall have ports for spring inspection. Provide an all directional neoprene cushion collar around the equipment bolt.
4. Spring Isolators with Vertical Limit Stops (Type SP): Similar to spring isolators noted above, except include a vertical limit stop to limit upward travel if weight is removed and also to reduce movement and spring extension due to wind loads. Provide clearance around restraining bolts to prevent mechanical short circuiting.
5. Pads (Type D), Washers (Type W), and Bushings (Type L): Pads shall be felt, cork, neoprene waffle, neoprene and cork sandwich, neoprene and fiberglass, neoprene and steel waffle, or reinforced duck and neoprene. Washers and bushings shall be reinforced duck and

- neoprene. Size pads for a maximum load of 345 kPa (50 pounds per square inch).
6. Seismic Pad (Type DS): Pads shall be felt, cork neoprene waffle, neoprene and cork sandwich, neoprene and fiberglass, neoprene and steel waffle, or reinforced duck and neoprene, with steel top plate and drilled for an anchor bolt. Washers and bushings shall be reinforced duck and neoprene. Size pads for a maximum load of 345 kPa (50 pounds per square inch).
- B. Hangers: Shall be combination neoprene and springs unless otherwise noted and shall allow for expansion of pipe.
1. Combination Neoprene and Spring (Type H): Vibration hanger shall contain a spring and double deflection neoprene element in series. Spring shall have a diameter not less than 0.8 of compressed operating spring height. Spring shall have a minimum additional travel of 50 percent between design height and solid height. Spring shall permit a 15 degree angular misalignment without rubbing on hanger box.
2. Spring Position Hanger (Type HP): Similar to combination neoprene and spring hanger except hanger shall hold piping at a fixed elevation during installation and include a secondary adjustment feature to transfer load to spring while maintaining same position.
3. Neoprene (Type HN): Vibration hanger shall contain a double deflection type neoprene isolation element. Hanger rod shall be separated from contact with hanger bracket by a neoprene grommet.
4. Spring (Type HS): Vibration hanger shall contain a coiled steel spring in series with a neoprene grommet. Spring shall have a diameter not less than 0.8 of compressed operating spring height. Spring shall have a minimum additional travel of 50 percent between design height and solid height. Spring shall permit a 15 degree angular misalignment without rubbing on hanger box.
5. Hanger supports for piping 50 mm (2 inches) and larger shall have a pointer and scale deflection indicator.
- C. Snubbers: Each spring mounted base shall have a minimum of four all-directional or eight two directional (two per side) seismic snubbers that are double acting. Elastomeric materials shall be shock absorbent neoprene bridge quality bearing pads, maximum 60 durometer, replaceable and have a minimum thickness of 6 mm (1/4 inch). Air gap between hard

and resilient material shall be not less than 3 mm (1/8 inch) nor more than 6 mm (1/4 inch). Restraints shall be capable of withstanding design load without permanent deformation.

- D. Thrust Restraints (Type THR): Restraints shall provide a spring element contained in a steel frame with neoprene pads at each end attachment. Restraints shall have factory preset thrust and be field adjustable to allow a maximum movement of 6 mm (1/4 inch) when the fan starts and stops. Restraint assemblies shall include rods, angle brackets and other hardware for field installation.

2.4 BASES

- A. Rails (Type R): Design rails with isolator brackets to reduce mounting height of equipment and cradle machines having legs or bases that do not require a complete supplementary base. To assure adequate stiffness, height of members shall be a minimum of 1/12 of longest base dimension but not less than 100 mm (4 inches). Where rails are used with neoprene mounts for small fans or close coupled pumps, extend rails to compensate overhang of housing.
- B. Integral Structural Steel Base (Type B): Design base with isolator brackets to reduce mounting height of equipment which require a complete supplementary rigid base. To assure adequate stiffness, height of members shall be a minimum of 1/12 of longest base dimension, but not less than 100 mm (four inches).
- C. Inertia Base (Type I): Base shall be a reinforced concrete inertia base. Pour concrete into a welded steel channel frame, incorporating prelocated equipment anchor bolts and pipe sleeves. Level the concrete to provide a smooth uniform bearing surface for equipment mounting. Provide grout under uneven supports. Channel depth shall be a minimum of 1/12 of longest dimension of base but not less than 150 mm (six inches). Form shall include 13-mm (1/2-inch) reinforcing bars welded in place on minimum of 203 mm (eight inch) centers running both ways in a layer 40 mm (1-1/2 inches) above bottom. Use height saving brackets in all mounting locations. Weight of inertia base shall be equal to or greater than weight of equipment supported to provide a maximum peak-to-peak displacement of 2 mm (1/16 inch).
- D. Curb Mounted Isolation Base (Type CB): Fabricate from aluminum to fit on top of standard curb with overlap to allow water run-off and have wind and water seals which shall not interfere with spring action.

Provide resilient snubbers with 6 mm (1/4 inch) clearance for wind resistance. Top and bottom bearing surfaces shall have sponge type weather seals. Integral spring isolators shall comply with Spring Isolator (Type S) requirements.

2.5 SOUND ATTENUATING UNITS

Refer to specification Section 23 31 00, HVAC DUCTS AND CASINGS.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Vibration Isolation:

1. No metal-to-metal contact will be permitted between fixed and floating parts.
2. Connections to Equipment: Allow for deflections equal to or greater than equipment deflections. Electrical, drain, piping connections, and other items made to rotating or reciprocating equipment (pumps, compressors, etc.) which rests on vibration isolators, shall be isolated from building structure for first three hangers or supports.
3. Common Foundation: Mount each electric motor on same foundation as driven machine. Hold driving motor and driven machine in positive rigid alignment with provision for adjusting motor alignment and belt tension. Bases shall be level throughout length and width. Provide shims to facilitate pipe connections, leveling, and bolting.
4. Provide heat shields where elastomers are subject to temperatures over 38 degrees C (100 degrees F).
5. Extend bases for pipe elbow supports at discharge and suction connections at pumps. Pipe elbow supports shall not short circuit pump vibration to structure.
6. Non-rotating equipment such as heat exchangers and convertors shall be mounted on isolation units having the same static deflection as the isolation hangers or support of the pipe connected to the equipment.

- #### **B. Inspection and Adjustments:**
- Check for vibration and noise transmission through connections, piping, ductwork, foundations, and walls. Adjust, repair, or replace isolators as required to reduce vibration and noise transmissions to specified levels.

3.2 ADJUSTING

- A. Adjust vibration isolators after piping systems are filled and equipment is at operating weight.
- B. Adjust limit stops on restrained spring isolators to mount equipment at normal operating height. After equipment installation is complete, adjust limit stops so they are out of contact during normal operation.
- C. Attach thrust limits at centerline of thrust and adjust to a maximum of 1/4inch (6-mm) movement during start and stop.
- D. Adjust active height of spring isolators.
- E. Adjust snubbers according to manufacturer's recommendations.
- F. Adjust seismic restraints to permit free movement of equipment within normal mode of operation.
- G. Torque anchor bolts according to equipment manufacturer's recommendations to resist seismic forces.

- - - E N D - - -

SELECTION GUIDE FOR VIBRATION ISOLATORS

EQUIPMENT	ON GRADE			20FT FLOOR SPAN			30FT FLOOR SPAN			40FT FLOOR SPAN			50FT FLOOR SPAN		
	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL
REFRIGERATION MACHINES															
ABSORPTION	---	D	---	---	SP	1.0	---	SP	1.0	---	SP	1.7	---	SP	1.7
PACKAGED HERMETIC	---	D	---	---	SP	1.0	---	SP	1.7	---	SP	1.7	R	SP	2.5
OPEN CENTRIFUGAL	B	D	---	B	SP	1.0	---	SP	1.7	B	SP	1.7	B	SP	3.5
RECIPROCATING:															
500 - 750 RPM	---	D	---	---	SP	1.7	R	SP	1.7	R	SP	2.5	R	SP	3.5
751 RPM & OVER	---	D	---	---	SP	1.0	---	---	1.7	R	SP	2.5	R	SP	2.5
COMPRESSORS AND VACUUM PUMPS															
UP THROUGH 1-1/2 HP	---	D,L, W	---	----	D,L, W	---	---	D,L, W	---	---	D,L, W	---	---	D,L, W	---
2 HP AND OVER:															
500 - 750 RPM	---	D	---	---	S	1.7	---	S	2.5	---	S	2.5	---	S	2.5
750 RPM & OVER	---	D	---	---	S	1.0	---	S	1.7	---	S	2.5	---	S	2.5
PUMPS															
CLOSE COUPLED	UP TO 1-1/2 HP	---	---	---	---	D,L, W	---	---	D,L, W	---	---	D,L, W	---	---	D,L, W

EQUIPMENT		ON GRADE			20FT FLOOR SPAN			30FT FLOOR SPAN			40FT FLOOR SPAN			50FT FLOOR SPAN		
		BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL
	2 HP & OVER	---	---	---	I	S	1.0	I	S	1.0	I	S	1.7	I	S	1.7
BASE MOUNTED	UP TO 10 HP	---	---	---	---	D,L, W	---	---	D,L, W	---	---	D,L, W	---	---	D,L, W	---
	15 HP THRU 40 HP	I	S	1.0	I	S	1.0	I	S	1.7	I	S	1.7	I	S	1.7
	50 HP & OVER	I	S	1.0	I	S	1.0	I	S	1.7	I	S	2.5	I	S	2.5
ROOF VENTILATORS																
ABOVE OCCUPIED AREAS:																
5 HP & OVER		---	---	---	CB	S	1.0	CB	S	1.0	CB	S	1.0	CB	S	1.0
CENTRIFUGAL BLOWERS																
UP TO 50 HP:																
UP TO 200 RPM		B	N	0.3	B	S	2.5	B	S	2.5	B	S	3.5	B	S	3.5
201 - 300 RPM		B	N	0.3	B	S	1.7	B	S	2.5	B	S	2.5	B	S	3.5
301 - 500 RPM		B	N	0.3	B	S	1.7	B	S	1.7	B	S	2.5	B	S	3.5
501 RPM & OVER		B	N	0.3	B	S	1.0	B	S	1.0	B	S	1.7	B	S	2.5
60 HP & OVER:																
UP TO 300 RPM		B	S	1.7	I	S	2.5	I	S	3.5	I	S	3.5	I	S	3.5

EQUIPMENT	ON GRADE			20FT FLOOR SPAN			30FT FLOOR SPAN			40FT FLOOR SPAN			50FT FLOOR SPAN		
	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL
301 - 500 RPM	B	S	1.7	I	S	1.7	I	S	2.5	I	S	3.5	I	S	3.5
501 RPM & OVER	B	S	1.0	I	S	1.7	I	S	1.7	I	S	2.5	I	S	2.5
COOLING TOWERS															
UP TO 500 RPM	---	---	---	---	SP	1.0	---	SP	1.7	---	SP	2.5	---	SP	3.5
501 RPM & OVER	---	---	---	---	SP	1.0	---	SP	1.0	---	SP	1.7	---	SP	2.5
INTERNAL COMBUSTION ENGINES															
UP TO 25 HP	I	N	0.3	I	N	0.3	I	S	1.7	I	S	2.5	I	S	2.5
30 THRU 100 HP	I	N	0.3	I	N	1.7	I	S	2.5	I	S	3.5	I	S	3.5
125 HP & OVER	I	N	0.3	I	N	2.5	I	S	3.5	I	S	4.5	I	S	4.5
AIR HANDLING UNIT PACKAGES															
SUSPENDED:															
UP THRU 5 HP	---	---	---	---	H	1.0	---	H	1.0	---	H	1.0	---	H	1.0
7-1/2 HP & OVER:															
UP TO 500 RPM	---	---	---	---	H, THR	1.7	---	H, THR	1.7	---	H, THR	1.7	---	H, THR	1.7
501 RPM & OVER	---	---	---	---	H, THR	1.0	---	H, THR	1.0	---	H,TH R	1.7	---	H,TH R	1.7
FLOOR MOUNTED:															
UP THRU 5 HP	---	D	---	---	S	1.0	---	S	1.0	---	S	1.0	---	S	1.0

EQUIPMENT	ON GRADE			20FT FLOOR SPAN			30FT FLOOR SPAN			40FT FLOOR SPAN			50FT FLOOR SPAN		
	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL
7-1/2 HP & OVER:															
UP TO 500 RPM	---	D	---	R	S, THR	1.7	R	S, THR	1.7	R	S, THR	1.7	R	S, THR	1.7
501 RPM & OVER	---	D	---	---	S, THR	1.0	---	S, THR	1.0	R	S, THR	1.7	R	S, THR	1.7
IN-LINE CENTRIFUGAL AND VANE AXIAL FANS, FLOOR MOUNTED: (APR 9)															
UP THRU 50 HP:															
UP TO 300 RPM	---	D	---	R	S	2.5	R	S	2.5	R	S	2.5	R	S	3.5
301 - 500 RPM	---	D	---	R	S	1.7	R	S	1.7	R	S	2.5	R	S	2.5
501 - & OVER	---	D	---	---	S	1.0	---	S	1.0	R	S	1.7	R	S	2.5
60 HP AND OVER:															
301 - 500 RPM	R	S	1.0	R	S	1.7	R	S	1.7	R	S	2.5	R	S	3.5
501 RPM & OVER	R	S	1.0	R	S	1.7	R	S	1.7	R	S	1.7	R	S	2.5

NOTES:

1. Edit the Table above to suit where isolator, other than those shown, are used, such as for seismic restraints and position limit stops.
2. For suspended floors lighter than 100 mm (4 inch) thick concrete, select deflection requirements from next higher span.
3. For separate chiller building on grade, pump isolators may be omitted.
4. Direct bolt fire pumps to concrete base. Provide pads (D) for domestic water booster pump package.
5. For projects in seismic areas, use only SS & DS type isolators and snubbers.
6. For floor mounted in-line centrifugal blowers (ARR 1): use "B" type in lieu of "R" type base.
7. Suspended: Use "H" isolators of same deflection as floor mounted.

SECTION 23 05 93
TESTING, ADJUSTING, AND BALANCING FOR HVAC

PART 1 - GENERAL

1.1 DESCRIPTION

A. Testing, adjusting, and balancing (TAB) of heating, ventilating and air conditioning (HVAC) systems. TAB includes the following:

1. Planning systematic TAB procedures.
2. Design Review Report.
3. Systems Inspection report.
4. Duct Air Leakage test report.
5. Systems Readiness Report.
6. Balancing air and water distribution systems; adjustment of total system to provide design performance; and testing performance of equipment and automatic controls.
7. Vibration and sound measurements.
8. Recording and reporting results.

B. Definitions:

1. Basic TAB used in this Section: Chapter 37, "Testing, Adjusting and Balancing" of ASHRAE Handbook, "HVAC Applications".
2. TAB: Testing, Adjusting and Balancing; the process of checking and adjusting HVAC systems to meet design objectives.
3. AABC: Associated Air Balance Council.
4. NEBB: National Environmental Balancing Bureau.
5. Hydronic Systems: Includes chilled water and heating hot water.
6. Air Systems: Includes all outside air, supply air, return air, exhaust air and relief air systems.
7. Flow rate tolerance: The allowable percentage variation, minus to plus, of actual flowrate from values (design) in the contract documents.

1.2 RELATED WORK

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION: General Mechanical Requirements.
- B. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT: Noise and Vibration Requirements.
- C. Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION: Piping and Equipment Insulation.
- D. Section 23 64 00, PACKAGED WATER CHILLERS: Testing Refrigeration Equipment.

- E. Section 23 36 00, AIR TERMINAL UNITS: Terminal Units Performance.
- F. Section 23 31 00, HVAC DUCTS AND CASINGS: Duct Leakage.
- G. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Controls and Instrumentation Settings.

1.3 QUALITY ASSURANCE

- A. Refer to Articles, Quality Assurance and Submittals, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- B. Qualifications:
 - 1. TAB Agency: The TAB agency shall be a subcontractor of the General Contractor and shall report to and be paid by the General Contractor.
 - 2. The TAB agency shall be either a certified member of AABC or certified by the NEBB to perform TAB service for HVAC, water balancing and vibrations and sound testing of equipment. The certification shall be maintained for the entire duration of duties specified herein. If, for any reason, the agency loses subject certification during this period, the General Contractor shall immediately notify the Resident Engineer and submit another TAB firm for approval. Any agency that has been the subject of disciplinary action by either the AABC or the NEBB within the five years preceding Contract Award shall not be eligible to perform any work related to the TAB. All work performed in this Section and in other related Sections by the TAB agency shall be considered invalid if the TAB agency loses its certification prior to Contract completion, and the successor agency's review shows unsatisfactory work performed by the predecessor agency.
 - 3. TAB Specialist: The TAB specialist shall be either a member of AABC or an experienced technician of the Agency certified by NEBB. The certification shall be maintained for the entire duration of duties specified herein. If, for any reason, the Specialist loses subject certification during this period, the General Contractor shall immediately notify the Resident Engineer and submit another TAB Specialist for approval. Any individual that has been the subject of disciplinary action by either the AABC or the NEBB within the five years preceding Contract Award shall not be eligible to perform any duties related to the HVAC systems, including TAB. All work specified in this Section and in other related Sections performed by the TAB specialist shall be considered invalid if the TAB Specialist

- loses its certification prior to Contract completion and must be performed by an approved successor.
4. TAB Specialist shall be identified by the General Contractor within 60 days after the notice to proceed. The TAB specialist will be coordinating, scheduling and reporting all TAB work and related activities and will provide necessary information as required by the Resident Engineer. The responsibilities would specifically include:
 - a. Shall directly supervise all TAB work.
 - b. Shall sign the TAB reports that bear the seal of the TAB standard. The reports shall be accompanied by report forms and schematic drawings required by the TAB standard, AABC or NEBB.
 - c. Would follow all TAB work through its satisfactory completion.
 - d. Shall provide final markings of settings of all HVAC adjustment devices.
 - e. Permanently mark location of duct test ports.
 5. All TAB technicians performing actual TAB work shall be experienced and must have done satisfactory work on a minimum of 3 projects comparable in size and complexity to this project. Qualifications must be certified by the TAB agency in writing.
- C. Test Equipment Criteria: The instrumentation shall meet the accuracy/calibration requirements established by AABC National Standards or by NEBB Procedural Standards for Testing, Adjusting and Balancing of Environmental Systems and instrument manufacturer. Provide calibration history of the instruments to be used for test and balance purpose.
- D. Tab Criteria:
1. One or more of the applicable AABC, NEBB or SMACNA publications, supplemented by ASHRAE Handbook "HVAC Applications" Chapter 36, and requirements stated herein shall be the basis for planning, procedures, and reports.
 2. Flow rate tolerance: Following tolerances are allowed. For tolerances not mentioned herein follow ASHRAE Handbook "HVAC Applications", Chapter 36, as a guideline. Air Filter resistance during tests, artificially imposed if necessary, shall be at least 90 percent of final values for pre-filters and after-filters.
 - a. Air handling unit and all other fans, cubic meters/min (cubic feet per minute): Minus 0 percent to plus 10 percent.

- b. Air terminal units (maximum values): Minus 2 percent to plus 10 percent.
- c. Exhaust hoods/cabinets: 0 percent to plus 10 percent.
- d. Minimum outside air: 0 percent to plus 10 percent.
- e. Individual room air outlets and inlets, and air flow rates not mentioned above: Minus 2 percent to plus 10 percent except if the air to a space is 100 CFM or less the tolerance would be 0 to plus 5 percent.
- f. Heating hot water pumps and hot water coils: Minus 5 percent to plus 5 percent.
- g. Chilled water and condenser water pumps: 0 percent to plus 5 percent.
- h. Chilled water coils: 0 percent to plus 5 percent.
- 3. Systems shall be adjusted for energy efficient operation as described in PART 3.
- 4. Typical TAB procedures and results shall be demonstrated to the Resident Engineer for one air distribution system (including all fans, three terminal units, three rooms) and one hydronic system (pumps and three coils) as follows:
 - a. When field TAB work begins.
 - b. During each partial final inspection and the final inspection for the project if requested by VA.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Submit names and qualifications of TAB agency and TAB specialists within 60 days after the notice to proceed. Submit information on three recently completed projects and a list of proposed test equipment.
- C. For use by the Resident Engineer staff, submit one complete set of applicable AABC or NEBB publications that will be the basis of TAB work.
- D. Submit Following for Review and Approval:
 - 1. Design Review Report within 90 days for conventional design projects after the system layout on air and water side is completed by the Contractor.
 - 2. Systems inspection report on equipment and installation for conformance with design.
 - 3. Duct Air Leakage Test Report.

4. Systems Readiness Report.
 5. Intermediate and Final TAB reports covering flow balance and adjustments, performance tests, vibration tests and sound tests.
 6. Include in final reports uncorrected installation deficiencies noted during TAB and applicable explanatory comments on test results that differ from design requirements.
- E. Prior to request for Final or Partial Final inspection, submit completed Test and Balance report for the area.

1.5 APPLICABLE PUBLICATIONS

- A. The following publications form a part of this specification to the extent indicated by the reference thereto. In text the publications are referenced to by the acronym of the organization.
- B. American Society of Heating, Refrigerating and Air Conditioning Engineers, Inc. (ASHRAE):
- 2003.....HVAC Applications ASHRAE Handbook, Chapter 37,
Testing, Adjusting, and Balancing and Chapter
47, Sound and Vibration Control
- C. Associated Air Balance Council (AABC):
- 2002.....AABC National Standards for Total System
Balance
- D. National Environmental Balancing Bureau (NEBB):
- 7th Edition 2005Procedural Standards for Testing, Adjusting,
Balancing of Environmental Systems
- 1st Edition 1994Procedural Standards for the Measurement and
Assessment of Sound and Vibration
- 2nd Edition 1999Procedural Standards for Building Systems
Commissioning
- E. Sheet Metal and Air Conditioning Contractors National Association
(SMACNA):
- 3rd Edition 2002HVAC SYSTEMS-Testing, Adjusting and Balancing

PART 2 - PRODUCTS

2.1 PLUGS

Provide plastic plugs to seal holes drilled in ductwork for test purposes.

2.2 INSULATION REPAIR MATERIAL

See Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION.
Provide for repair of insulation removed or damaged for TAB work.

PART 3 - EXECUTION

3.1 GENERAL

- A. Refer to TAB Criteria in Article, Quality Assurance.
- B. Obtain applicable contract documents and copies of approved submittals for HVAC equipment and automatic control systems.

3.2 DESIGN REVIEW REPORT

The TAB Specialist shall review the Contract Plans and specifications and advise the Resident Engineer of any design deficiencies that would prevent the HVAC systems from effectively operating in accordance with the sequence of operation specified or prevent the effective and accurate TAB of the system. The TAB Specialist shall provide a report individually listing each deficiency and the corresponding proposed corrective action necessary for proper system operation.

3.3 SYSTEMS INSPECTION REPORT

- A. Inspect equipment and installation for conformance with design.
- B. The inspection and report is to be done after air distribution equipment is on site and duct installation has begun, but well in advance of performance testing and balancing work. The purpose of the inspection is to identify and report deviations from design and ensure that systems will be ready for TAB at the appropriate time.
- C. Reports: Follow check list format developed by AABC, NEBB or SMACNA, supplemented by narrative comments, with emphasis on air handling units and fans. Check for conformance with submittals. Verify that diffuser and register sizes are correct. Check air terminal unit installation including their duct sizes and routing.

3.4 DUCT AIR LEAKAGE TEST REPORT

See paragraphs "Duct leakage Tests and Repairs" in Section 23 31 00, HVAC DUCTS AND CASINGS for TAB agency's role and responsibilities in witnessing, recording and reporting of deficiencies.

3.5 SYSTEM READINESS REPORT

- A. Inspect each System to ensure that it is complete including installation and operation of controls.
- B. Verify that all items such as ductwork piping, ports, terminals, connectors, etc., that is required for TAB are installed. Provide a report to the Resident Engineer.

3.6 TAB REPORTS

- A. Submit an intermediate report for 25 percent of systems and equipment tested and balanced to establish satisfactory test results.

- B. The TAB contractor shall provide raw data immediately in writing to the Resident Engineer if there is a problem in achieving intended results before submitting a formal report.
- C. If over 20 percent of readings in the intermediate report fall outside the acceptable range, the TAB report shall be considered invalid and all contract TAB work shall be repeated and re-submitted for approval.
- D. Do not proceed with the remaining systems until intermediate report is approved by the Resident Engineer.

3.7 TAB PROCEDURES

- A. Tab shall be performed in accordance with the requirement of the Standard under which TAB agency is certified by either AABC or NEBB.
- B. General: During TAB all related system components shall be in full operation. Fan and pump rotation, motor loads and equipment vibration shall be checked and corrected as necessary before proceeding with TAB. Set controls and/or block off parts of distribution systems to simulate design operation of variable volume air or water systems for test and balance work.
- C. Coordinate TAB procedures with any phased construction completion requirements for the project. Provide TAB reports for each phase of the project prior to partial final inspections of each phase of the project.
- D. Allow sufficient time in construction schedule for TAB and submission of all reports for an organized and timely correction of deficiencies.
- E. Air Balance and Equipment Test: Include air handling units, fans, terminal units, fan coil units, room diffusers/outlets/inlets, computer room AC units, and laboratory fume hoods and cabinets.
 - 1. Artificially load air filters by partial blanking to produce air pressure drop of at least 90 percent of the design final pressure drop.
 - 2. Adjust fan speeds to provide design air flow. V-belt drives, including fixed pitch pulley requirements, are specified in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
 - 3. Test and balance systems in all specified modes of operation, including variable volume, economizer, and fire emergency modes. Verify that dampers and other controls function properly.
 - 4. Variable air volume (VAV) systems:
 - a. Coordinate TAB, including system volumetric controls, with Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

- b. Section 23 36 00, AIR TERMINAL UNITS, specifies that maximum and minimum flow rates for air terminal units (ATU) be factory set. Check and readjust ATU flow rates if necessary. Balance air distribution from ATU on full cooling maximum scheduled cubic meters per minute (cubic feet per minute). Reset room thermostats and check ATU operation from maximum to minimum cooling, to the heating mode, and back to cooling. Record and report the heating coil leaving air temperature when the ATU is in the maximum heating mode.
- 5. Record final measurements for air handling equipment performance data sheets.
- F. Water Balance and Equipment Test: Include circulating pumps, convertors, coils, coolers and condensers:
 - 1. Coordinate water chiller flow balancing with Section 23 64 00, PACKAGED WATER CHILLERS.
 - 2. Adjust flow rates for equipment. Set coils and evaporator to values on equipment submittals, if different from values on contract drawings.
 - 3. Primary-secondary (variable volume) systems: Coordinate TAB with Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC. Balance systems at design water flow and then verify that variable flow controls function properly.
 - 4. Record final measurements for hydronic equipment on performance data sheets. Include entering and leaving water temperatures for heating and cooling coils, and for convertors. Include entering and leaving air temperatures (DB/WB for cooling coils) for air handling units and reheat coils. Make air and water temperature measurements at the same time.

3.8 VIBRATION TESTING

- A. Furnish instruments and perform vibration measurements as specified in Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT. Field vibration balancing is specified in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION. Provide measurements for all rotating HVAC equipment of 373 watts (1/2 horsepower) and larger, including centrifugal/screw compressors, cooling towers, pumps, fans and motors.
- B. Record initial measurements for each unit of equipment on test forms and submit a report to the Resident Engineer. Where vibration readings

exceed the allowable tolerance Contractor shall be directed to correct the problem. The TAB agency shall verify that the corrections are done and submit a final report to the Resident Engineer.

3.9 SOUND TESTING

- A. Perform and record required sound measurements in accordance with Paragraph, QUALITY ASSURANCE in Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
 1. Take readings in rooms, approximately ten percent of all rooms.

The Resident Engineer may designate the specific rooms to be tested.
- B. Take measurements with a calibrated sound level meter and octave band analyzer of the accuracy required by AABC or NEBB.
- C. Sound reference levels, formulas and coefficients shall be according to ASHRAE Handbook, "HVAC Applications", Chapter 46, SOUND AND VIBRATION CONTROL.
- D. Determine compliance with specifications as follows:
 1. When sound pressure levels are specified, including the NC Criteria in Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT:
 - a. Reduce the background noise as much as possible by shutting off unrelated audible equipment.
 - b. Measure octave band sound pressure levels with specified equipment "off."
 - c. Measure octave band sound pressure levels with specified equipment "on."
 - d. Use the DIFFERENCE in corresponding readings to determine the sound pressure due to equipment.

DIFFERENCE:	0	1	2	3	4	5 to 9	10 or More
FACTOR:	10	7	4	3	2	1	0

Sound pressure level due to equipment equals sound pressure level with equipment "on" minus FACTOR.

- e. Plot octave bands of sound pressure level due to equipment for typical rooms on a graph which also shows noise criteria (NC) curves.
2. When sound power levels are specified:
 - a. Perform steps 1.a. thru 1.d., as above.

- b. For indoor equipment: Determine room attenuating effect, i.e., difference between sound power level and sound pressure level. Determined sound power level will be the sum of sound pressure level due to equipment plus the room attenuating effect.
 - c. For outdoor equipment: Use directivity factor and distance from noise source to determine distance factor, i.e., difference between sound power level and sound pressure level. Measured sound power level will be the sum of sound pressure level due to equipment plus the distance factor. Use 10 meters (30 feet) for sound level location.
3. Where sound pressure levels are specified in terms of dB(A), measure sound levels using the "A" scale of meter. Single value readings will be used instead of octave band analysis.
- E. Where measured sound levels exceed specified level, the installing contractor or equipment manufacturer shall take remedial action approved by the Resident Engineer and the necessary sound tests shall be repeated.

3.10 MARKING OF SETTINGS

Following approval of Tab final Report, the setting of all HVAC adjustment devices including valves, splitters and dampers shall be permanently marked by the TAB Specialist so that adjustment can be restored if disturbed at any time. Style and colors used for markings shall be coordinated with the Resident Engineer.

3.11 IDENTIFICATION OF TEST PORTS

The TAB Specialist shall permanently and legibly identify the location points of duct test ports. If the ductwork has exterior insulation, the identification shall be made on the exterior side of the insulation. All penetrations through ductwork and ductwork insulation shall be sealed to prevent air leaks and maintain integrity of vapor barrier.

- - - E N D - - -

SECTION 23 07 11
HVAC, PLUMBING, AND BOILER PLANT INSULATION

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Field applied insulation for thermal efficiency and condensation control for
 - 1. HVAC piping, ductwork and equipment.
 - 2. Plumbing piping and equipment.
- B. Definitions
 - 1. ASJ: All service jacket, white finish facing or jacket.
 - 2. Air conditioned space: Space having air temperature and/or humidity controlled by mechanical equipment.
 - 3. Cold: Equipment, ductwork or piping handling media at design temperature of 16 degrees C (60 degrees F) or below.
 - 4. Concealed: Ductwork and piping above ceilings and in chases, and pipe spaces.
 - 5. Exposed: Piping, ductwork, and equipment exposed to view in finished areas including mechanical, Boiler Plant and electrical equipment rooms or exposed to outdoor weather. Attics and crawl spaces where air handling units are located are considered to be mechanical rooms. Shafts, chases, unfinished attics, crawl spaces and pipe basements are not considered finished areas.
 - 6. FSK: Foil-scrim-kraft facing.
 - 7. Hot: HVAC Ductwork handling air at design temperature above 16 degrees C (60 degrees F); HVAC and plumbing equipment or piping handling media above 41 degrees C (105 degrees F); Boiler Plant breechings and stack temperature range 150-370 degrees C (300-700 degrees F) and piping media and equipment 32 to 230 degrees C (90 to 450 degrees F)
 - 8. Density: kg/m^3 - kilograms per cubic meter (Pcf - pounds per cubic foot).
 - 9. Runouts: Branch pipe connections up to 25-mm (one-inch) nominal size to fan coil units or reheat coils for terminal units.
 - 10. Thermal conductance: Heat flow rate through materials.
 - a. Flat surface: Watt per square meter (BTU per hour per square foot).
 - b. Pipe or Cylinder: Watt per square meter (BTU per hour per linear foot).

- 11. Thermal Conductivity (k): Watt per meter, per degree C (BTU per inch thickness, per hour, per square foot, per degree F temperature difference).
- 12. HPS: High pressure steam (415 kPa [60 psig] and above).
- 13. HPR: High pressure steam condensate return.
- 14. MPS: Medium pressure steam (110 kPa [16 psig] thru 414 kPa [59 psig]).
- 15. MPR: Medium pressure steam condensate return.
- 16. LPS: Low pressure steam (103 kPa [15 psig] and below).
- 17. LPR: Low pressure steam condensate gravity return.
- 18. PC: Pumped condensate.
- 19. HWH: Hot water heating supply.
- 20. HWHR: Hot water heating return.
- 28. CPD: Condensate pump discharge.
- 29. R: Pump recirculation.
- 30. FOS: Fuel oil supply.
- 31. FOR: Fuel oil return.
- 32. CW: Cold water.
- 33. SW: Soft water.
- 34. HW: Hot water.
- 35. CH: Chilled water supply.
- 36. CHR: Chilled water return.
- 39. RS: Refrigerant suction.
- 40. PVDC: Polyvinylidene chloride vapor retarder jacketing, white.

1.2 RELATED WORK

- A. Section 07 84 00, FIRESTOPPING: Mineral fiber and bond breaker behind sealant.
- B. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION: General mechanical requirements and items, which are common to more than one section of Division 23.
- C. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION: General requirements pertaining to mechanical Boiler Plant work.
- D. Section 23 21 11, BOILER PLANT PIPING SYSTEMS: Boiler plant piping.
- E. Section 22 05 19, METERS AND GAGES FOR PLUMBING PIPING and Section 22 05 23, GENERAL-DUTY VALVES FOR PLUMBING PIPING: Hot and cold water piping.
- F. Section 23 64 00, PACKAGED WATER CHILLERS: Compressor, evaporator and piping.

- G. Section 23 23 00, REFRIGERANT PIPING: Requirements for refrigerant piping and fittings.
- H. Section 23 21 13, HYDRONIC PIPING and Section 23 22 13, STEAM AND CONDENSATE HEATING PIPING: Piping and equipment.
- I. Section 23 21 13, HYDRONIC PIPING: Chilled water piping.
- J. Section 23 31 00, HVAC DUCTS AND CASINGS: Ductwork, plenum and fittings.

1.3 QUALITY ASSURANCE

- A. Refer to article QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

- B. Criteria:

- 1. Comply with NFPA 90A, particularly paragraphs 4.3.3.1 through 4.3.3.6, 4.3.10.2.6, and 5.4.6.4, parts of which are quoted as follows:

- 4.3.3.1** Pipe insulation and coverings, duct coverings, duct linings, vapor retarder facings, adhesives, fasteners, tapes, and supplementary materials added to air ducts, plenums, panels, and duct silencers used in duct systems, unless otherwise provided for in 4.3.3.1.2 or 4.3.3.1.3, shall have, in the form in which they are used, a maximum flame spread index of 25 without evidence of continued progressive combustion and a maximum smoke developed index of 50 when tested in accordance with NFPA 255, *Standard Method of Test of Surface Burning Characteristics of Building Materials*.

- 4.3.3.1.1** Where these products are to be applied with adhesives, they shall be tested with such adhesives applied, or the adhesives used shall have a maximum flame spread index of 25 and a maximum smoke developed index of 50 when in the final dry state. (See 4.2.4.2.)

- 4.3.3.1.2** The flame spread and smoke developed index requirements of 4.3.3.1.1 shall not apply to air duct weatherproof coverings where they are located entirely outside of a building, do not penetrate a wall or roof, and do not create an exposure hazard.

- 4.3.3.1.3** Smoke detectors required by 6.4.4 shall not be required to meet flame spread index or smoke developed index requirements.

- 4.3.3.2** Closure systems for use with rigid and flexible air ducts tested in accordance with UL 181, Standard for Safety Factory-Made Air Ducts and Air Connectors, shall have been tested, listed, and used in accordance with the conditions of their listings, in accordance with one of the following:

- (1) UL 181A, Standard for Safety Closure Systems for Use with Rigid Air Ducts and Air Connectors

- (2) UL 181B, Standard for Safety Closure Systems for Use with Flexible Air Ducts and Air Connectors

4.3.3.3 Air duct, panel, and plenum coverings and linings, and pipe insulation and coverings shall not flame, glow, smolder, or smoke when tested in accordance with a similar test for pipe covering, ASTM C 411, Standard Test Method for Hot-Surface Performance of High-Temperature Thermal Insulation, at the temperature to which they are exposed in service.

4.3.3.3.1 In no case shall the test temperature be below 121°C (250°F).

4.3.3.4 Air duct coverings shall not extend through walls or floors that are required to be fire stopped or required to have a fire resistance rating, unless such coverings meet the requirements of 5.4.6.4.

4.3.3.5* Air duct linings shall be interrupted at fire dampers to prevent interference with the operation of devices.

4.3.3.6 Air duct coverings shall not be installed so as to conceal or prevent the use of any service opening.

4.3.10.2.6 Materials exposed to the airflow shall be noncombustible or limited combustible and have a maximum smoke developed index of 50 or comply with the following.

4.3.10.2.6.1 Electrical wires and cables and optical fiber cables shall be listed as noncombustible or limited combustible and have a maximum smoke developed index of 50 or shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with NFPA 262, Standard Method of Test for Flame Travel and Smoke of Wires and Cables for Use in Air-Handling Spaces.

4.3.10.2.6.2 Pneumatic tubing for control systems shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with UL 1820, Standard for Safety Fire Test of Pneumatic Tubing for Flame and Smoke Characteristics.

4.3.10.2.6.3 Nonferrous fire sprinkler piping shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with UL 1887, Standard for Safety Fire Test of Plastic Sprinkler Pipe for Visible Flame and Smoke Characteristics.

4.3.10.2.6.4 Optical-fiber and communication raceways shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with UL 2024, Standard for Safety Optical-Fiber Cable Raceway.

4.3.10.2.6.5 Loudspeakers and recessed lighting fixtures, including their assemblies and accessories, shall be permitted in the ceiling cavity plenum where listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a peak heat release rate of 100 kW or less when tested in accordance with UL 2043, Standard for Safety Fire Test

for Heat and Visible Smoke Release for Discrete Products and Their Accessories Installed in Air-Handling Spaces.

4.3.10.2.6.6 Supplementary materials for air distribution systems shall be permitted when complying with the provisions of 4.3.3.

4.3.10.2.6.7 Smoke detectors shall not be required to meet the provisions of this section.

5.4.6.4 Where air ducts pass through walls, floors, or partitions that are required to have a fire resistance rating and where fire dampers are not required, the opening in the construction around the air duct shall be as follows:

(1) Not exceeding a 25.4 mm (1 in.) average clearance on all sides

(2) Filled solid with an approved material capable of preventing the passage of flame and hot gases sufficient to ignite cotton waste when subjected to the time-temperature fire conditions required for fire barrier penetration as specified in NFPA 251, *Standard Methods of Tests of Fire Endurance of Building Construction and Materials*

2. Test methods: ASTM E84, UL 723, or NFPA 255.

3. Specified k factors are at 24 degrees C (75 degrees F) mean temperature unless stated otherwise. Where optional thermal insulation material is used, select thickness to provide thermal conductance no greater than that for the specified material. For pipe, use insulation manufacturer's published heat flow tables. For domestic hot water supply and return, run out insulation and condensation control insulation, no thickness adjustment need be made.

4. All materials shall be compatible and suitable for service temperature, and shall not contribute to corrosion or otherwise attack surface to which applied in either the wet or dry state.

C. Every package or standard container of insulation or accessories delivered to the job site for use must have a manufacturer's stamp or label giving the name of the manufacturer and description of the material.

1.4 SUBMITTALS

A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Shop Drawings:

1. All information, clearly presented, shall be included to determine compliance with drawings and specifications and ASTM, federal and military specifications.

- a. Insulation materials: Specify each type used and state surface burning characteristics.
- b. Insulation facings and jackets: Each type used. Make it clear that white finish will be furnished for exposed ductwork, casings and equipment.
- c. Insulation accessory materials: Each type used.
- d. Manufacturer's installation and fitting fabrication instructions for flexible unicellular insulation.
- e. Make reference to applicable specification paragraph numbers for coordination.

C. Samples:

1. Each type of insulation: Minimum size 100 mm (4 inches) square for board/block/ blanket; 150 mm (6 inches) long, full diameter for round types.
2. Each type of facing and jacket: Minimum size 100 mm (4 inches square).
3. Each accessory material: Minimum 120 ML (4 ounce) liquid container or 120 gram (4 ounce) dry weight for adhesives / cement / mastic.

1.5 STORAGE AND HANDLING OF MATERIAL

Store materials in clean and dry environment, pipe covering jackets shall be clean and unmarred. Place adhesives in original containers. Maintain ambient temperatures and conditions as required by printed instructions of manufacturers of adhesives, mastics and finishing cements.

1.6 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only.
- B. Federal Specifications (Fed. Spec.):
L-P-535E (2)-91.....Plastic Sheet (Sheeting): Plastic Strip; Poly (Vinyl Chloride) and Poly (Vinyl Chloride - Vinyl Acetate), Rigid.
- C. Military Specifications (Mil. Spec.):
MIL-A-3316C (2)-90.....Adhesives, Fire-Resistant, Thermal Insulation
MIL-A-24179A (1)-87.....Adhesive, Flexible Unicellular-Plastic Thermal Insulation
MIL-C-19565C (1)-88.....Coating Compounds, Thermal Insulation, Fire-and Water-Resistant, Vapor-Barrier

MIL-C-20079H-87.....Cloth, Glass; Tape, Textile Glass; and Thread,
Glass and Wire-Reinforced Glass

D. American Society for Testing and Materials (ASTM):

A167-99.....Standard Specification for Stainless and
Heat-Resisting Chromium-Nickel Steel Plate,
Sheet, and Strip

B209-04.....Standard Specification for Aluminum and
Aluminum-Alloy Sheet and Plate

C411-97.....Standard test method for Hot-Surface
Performance of High-Temperature Thermal
Insulation

C449-00.....Standard Specification for Mineral Fiber
Hydraulic-Setting Thermal Insulating and
Finishing Cement

C533-04.....Standard Specification for Calcium Silicate
Block and Pipe Thermal Insulation

C534-05.....Standard Specification for Preformed Flexible
Elastomeric Cellular Thermal Insulation in
Sheet and Tubular Form

C547-06.....Standard Specification for Mineral Fiber pipe
Insulation

C552-03.....Standard Specification for Cellular Glass
Thermal Insulation

C553-02.....Standard Specification for Mineral Fiber
Blanket Thermal Insulation for Commercial and
Industrial Applications

C585-90.....Standard Practice for Inner and Outer Diameters
of Rigid Thermal Insulation for Nominal Sizes
of Pipe and Tubing (NPS System) R (1998)

C612-04.....Standard Specification for Mineral Fiber Block
and Board Thermal Insulation

C1126-04.....Standard Specification for Faced or Unfaced
Rigid Cellular Phenolic Thermal Insulation

C1136-06.....Standard Specification for Flexible, Low
Permeance Vapor Retarders for Thermal
Insulation

D1668-97a (2006).....Standard Specification for Glass Fabrics (Woven
and Treated) for Roofing and Waterproofing

- E84-06.....Standard Test Method for Surface Burning
Characteristics of Building
Materials
- E119-05a.....Standard Test Method for Fire Tests of Building
Construction and Materials
- E136-04.....Standard Test Methods for Behavior of Materials
in a Vertical Tube Furnace at 750 degrees C
(1380 F)
- E. National Fire Protection Association (NFPA):
- 90A-02.....Installation of Air Conditioning and
Ventilating Systems
- 96-04.....Standards for Ventilation Control and Fire
Protection of Commercial Cooking Operations
- 101-06.....Life Safety Code
- 251-06.....Standard methods of Tests of Fire Endurance of
Building Construction Materials
- 255-06.....Standard Method of tests of Surface Burning
Characteristics of Building Materials
- F. Underwriters Laboratories, Inc (UL):
- 723.....UL Standard for Safety Test for Surface Burning
Characteristics of Building Materials with
Revision of 08/03
- G. Manufacturer's Standardization Society of the Valve and Fitting
Industry (MSS):
- SP58-2002.....Pipe Hangers and Supports Materials, Design,
and Manufacture

PART 2 - PRODUCTS

2.1 MINERAL FIBER

- A. ASTM C612 (Board, Block), Class 1 or 2, $k = 0.037$ Watt per meter, per degree C (0.26), external insulation for temperatures up to 204 degrees C (400 degrees F).
- B. ASTM C553 (Blanket, Flexible) Type I, Class B-5, Density 32 kg/m^3 (2 pcf), $k = 0.04$ (0.27) , for use at temperatures up to 204 degrees C (400 degrees F)
- C. ASTM C547 (Pipe Fitting Insulation and Preformed Pipe Insulation), Class 1, $k = 0.037$ (0.26) for use at temperatures 230 degrees C (450 degrees F).

2.2 MINERAL WOOL OR REFRACTORY FIBER

- A. Comply with Standard ASTM C612, Class 3, 450 degrees C (850 degrees F).

2.3 RIGID CELLULAR PHENOLIC FOAM

- A. Preformed (molded) pipe insulation, ASTM C1126, type III, grade 1, $k = 0.021(0.15)$, for temperatures up to 121 degrees C (250 degrees F) with vapor retarder and all service jacket with polyvinyl chloride premolded fitting covering.
- B. Equipment and Duct Insulation, ASTM C 1126, type II, grade 1, $k = 0.021(0.15)$, for temperatures up to 121 degrees C (250 degrees F) with rigid cellular phenolic insulation and covering, vapor retarder and all service jacket.

2.4 CELLULAR GLASS CLOSED-CELL

- A. Comply with Standard ASTM C177, C518, density 120 kg/m³ (7.5 pcf) nominal, $k = 0.033(0.29)$ at 0 degrees C (75 degrees F).
- B. Pipe insulation for temperatures up to 200 degrees C (400 degrees F).

2.5 POLYISOCYANURATE CLOSED-CELL RIGID

- A. Preformed (fabricated) pipe insulation, ASTM C591, type IV, $K=0.027(0.19)$, for use at temperatures up to 149 degree C (300 degree F) with factory applied PVDC or all service jacket vapor retarder with polyvinyl chloride premolded fitting covers.
- B. Equipment and duct insulation, ASTM C 591, type IV, $K=0.027(0.19)$, for use at temperatures up to 149 degrees C (300 degrees F) with PVDC or all service jacket vapor retarder jacket.

2.6 FLEXIBLE ELASTOMERIC CELLULAR THERMAL

- A. ASTM C177, C518, $k = 0.039$ Watt per meter, per degree C (0.27), at 24 degrees C (75 degrees F), flame spread not over 25, smoke developed not over 50, for temperatures from minus 4 degrees C (40 degrees F) to 93 degrees C (200 degrees F). No jacket required.

2.8 CALCIUM SILICATE

- A. Preformed pipe Insulation: ASTM C533, Type I and Type II with indicator denoting asbestos-free material.
- B. Premolded Pipe Fitting Insulation: ASTM C533, Type I and Type II with indicator denoting asbestos-free material.
- C. Equipment Insulation: ASTM C533, Type I and Type II
- D. Characteristics:

Insulation Characteristics

ITEMS	TYPE I	TYPE II
Temperature, maximum degrees C (degrees F)	649 (1200)	927 (1700)
Density (dry), Kg/m ³ (lb/ ft ³)	232 (14.5)	288 (18)
Thermal conductivity: Min W/ m K (Btu in/h ft ² degrees F)@ mean temperature of 93 degrees C (200 degrees F)	0.059 (0.41)	0.078 (0.540)
Surface burning characteristics: Flame spread Index, Maximum	0	0
Smoke Density index, Maximum	0	0

2.9 INSULATION FACINGS AND JACKETS

- A. Vapor Retarder, higher strength with low water permeance ≤ 0.02 or less perm rating, Beach puncture 50 units for insulation facing on exposed ductwork, casings and equipment, and for pipe insulation jackets. Facings and jackets shall be all service type (ASJ) or PVDC Vapor Retarder jacketing.
- B. ASJ jacket shall be white kraft bonded to 0.025 mm (1 mil) thick aluminum foil, fiberglass reinforced, with pressure sensitive adhesive closure. Comply with ASTM C1136. Beach puncture 5 units, Suitable for painting without sizing. Jackets shall have minimum 40 mm (1-1/2 inch) lap on longitudinal joints and minimum 100 mm (4 inch) butt strip on end joints. Butt strip material shall be same as the jacket. Lap and butt strips shall be self-sealing type with factory-applied pressure sensitive adhesive.
- C. Vapor Retarder medium strength with low water vapor permeance of 0.02 or less perm rating), Beach puncture 25 units: Foil-Scrim-Kraft (FSK) or PVDC vapor retarder jacketing type for concealed ductwork and equipment.
- D. Glass Cloth Jackets: Presized, minimum 0.18 kg per square meter (7.8 ounces per square yard), 2000 kPa (300 psig) bursting strength with integral vapor retarder where required or specified. Weather proof if utilized for outside service.
- E. Factory composite materials may be used provided that they have been tested and certified by the manufacturer.
- F. Pipe fitting insulation covering (jackets): Fitting covering shall be premolded to match shape of fitting and shall be polyvinyl chloride

(PVC) conforming to Fed Spec L-P-335, composition A, Type II Grade GU, and Type III, minimum thickness 0.7 mm (0.03 inches). Provide color matching vapor retarder pressure sensitive tape.

- G. Aluminum Jacket-Piping systems and circular breeching and stacks: ASTM B209, 3003 alloy, H-14 temper, 0.6 mm (0.023 inch) minimum thickness with locking longitudinal joints. Jackets for elbows, tees and other fittings shall be factory-fabricated to match shape of fitting and of 0.6 mm (0.024) inch minimum thickness aluminum. Fittings shall be of same construction as straight run jackets but need not be of the same alloy. Factory-fabricated stainless steel bands shall be installed on all circumferential joints. Bands shall be 20 mm (0.75 inch) wide on 450 mm (18 inch) centers. System shall be weatherproof if utilized for outside service.
- H. Aluminum jacket-Rectangular breeching: ASTM B209, 3003 alloy, H-14 temper, 0.5 mm (0.020 inches) thick with 32 mm (1-1/4 inch) corrugations or 0.8 mm (0.032 inches) thick with no corrugations. System shall be weatherproof if used for outside service.

2.10 PIPE COVERING PROTECTION SADDLES

- A. Cold pipe support: Premolded pipe insulation 180 degrees (half-shells) on bottom half of pipe at supports. Material shall be cellular glass or high density Polyisocyanurate insulation of the same thickness as adjacent insulation. Density of Polyisocyanurate insulation shall be a minimum of 48 kg/m³ (3.0 pcf).

Nominal Pipe Size and Accessories Material (Insert Blocks)	
Nominal Pipe Size mm (inches)	Insert Blocks mm (inches)
Up through 125 (5)	150 (6) long
150 (6)	150 (6) long
200 (8), 250 (10), 300 (12)	225 (9) long
350 (14), 400 (16)	300 (12) long
450 through 600 (18 through 24)	350 (14) long

- B. Warm or hot pipe supports: Premolded pipe insulation (180 degree half-shells) on bottom half of pipe at supports. Material shall be high density Polyisocyanurate (for temperatures up to 149 degrees C [300 degrees F]), cellular glass or calcium silicate. Insulation at supports shall have same thickness as adjacent insulation. Density of Polyisocyanurate insulation shall be a minimum of 48 kg/m³ (3.0 pcf).

- C. Boiler Plant Pipe supports: MSS SP58, Type 39. Apply at all pipe support points, except where MSS SP58, Type 3 pipe clamps provided as part of the support system.

2.11 ADHESIVE, MASTIC, CEMENT

- A. Mil. Spec. MIL-A-3316, Class 1: Jacket and lap adhesive and protective finish coating for insulation.
- B. Mil. Spec. MIL-A-3316, Class 2: Adhesive for laps and for adhering insulation to metal surfaces.
- C. Mil. Spec. MIL-A-24179, Type II Class 1: Adhesive for installing flexible unicellular insulation and for laps and general use.
- D. Mil. Spec. MIL-C-19565, Type I: Protective finish for outdoor use.
- E. Mil. Spec. MIL-C-19565, Type I or Type II: Vapor barrier compound for indoor use.
- F. ASTM C449: Mineral fiber hydraulic-setting thermal insulating and finishing cement.
- G. Other: Insulation manufacturers' published recommendations.

2.12 MECHANICAL FASTENERS

- A. Pins, anchors: Welded pins, or metal or nylon anchors with tin-coated or fiber washer, or clips. Pin diameter shall be as recommended by the insulation manufacturer.
- B. Staples: Outward clinching monel or stainless steel.
- C. Wire: 1.3 mm thick (18 gage) soft annealed galvanized or 1.9 mm (14 gage) copper clad steel or nickel copper alloy.
- D. Bands: 20 mm (3/4 inch) nominal width, brass, galvanized steel, aluminum or stainless steel.

2.13 REINFORCEMENT AND FINISHES

- A. Glass fabric, open weave: ASTM D1668, Type III (resin treated) and Type I (asphalt treated).
- B. Glass fiber fitting tape: Mil. Spec MIL-C-20079, Type II, Class 1.
- C. Tape for Flexible Elastomeric Cellular Insulation: As recommended by the insulation manufacturer.
- D. Hexagonal wire netting: 25 mm (one inch) mesh, 0.85 mm thick (22 gage) galvanized steel.
- E. Corner beads: 50 mm (2 inch) by 50 mm (2 inch), 0.55 mm thick (26 gage) galvanized steel; or, 25 mm (1 inch) by 25 mm (1 inch), 0.47 mm thick (28 gage) aluminum angle adhered to 50 mm (2 inch) by 50 mm (2 inch) Kraft paper.

F. PVC fitting cover: Fed. Spec L-P-535, Composition A, 11-86 Type II, Grade GU, with Form B Mineral Fiber insert, for media temperature 4 degrees C (40 degrees F) to 121 degrees C (250 degrees F). Below 4 degrees C (40 degrees F) and above 121 degrees C (250 degrees F). Provide double layer insert. Provide color matching vapor barrier pressure sensitive tape.

2.14 FIRESTOPPING MATERIAL

Other than pipe and duct insulation, refer to Section 07 84 00
FIRESTOPPING.

2.15 FLAME AND SMOKE

Unless shown otherwise all assembled systems shall meet flame spread 25 and smoke developed 50 rating as developed under ASTM, NFPA and UL standards and specifications. See paragraph 1.3 "Quality Assurance".

PART 3 - EXECUTION

3.1 GENERAL REQUIREMENTS

- A. Required pressure tests of duct and piping joints and connections shall be completed and the work approved by the Resident Engineer for application of insulation. Surface shall be clean and dry with all foreign materials, such as dirt, oil, loose scale and rust removed.
- B. Except for specific exceptions, insulate entire specified equipment, piping (pipe, fittings, valves, accessories), and duct systems. Insulate each pipe and duct individually. Do not use scrap pieces of insulation where a full length section will fit.
- C. Insulation materials shall be installed in a first class manner with smooth and even surfaces, with jackets and facings drawn tight and smoothly cemented down at all laps. Insulation shall be continuous through all sleeves and openings, except at fire dampers and duct heaters (NFPA 90A). Vapor retarders shall be continuous and uninterrupted throughout systems with operating temperature 16 degrees C (60 degrees F) and below. Lap and seal vapor barrier over ends and exposed edges of insulation. Anchors, supports and other metal projections through insulation on cold surfaces shall be insulated and vapor sealed for a minimum length of 150 mm (6 inches).
- D. Install vapor stops at all insulation terminations on either side of valves, pumps and equipment and particularly in straight lengths of pipe insulation.
- E. Construct insulation on parts of equipment such as chilled water pumps and heads of chillers, convertors and heat exchangers that must be

opened periodically for maintenance or repair, so insulation can be removed and replaced without damage. Install insulation with bolted 1 mm thick (20 gage) galvanized steel or aluminum covers as complete units, or in sections, with all necessary supports, and split to coincide with flange/split of the equipment.

- F. Insulation on hot piping and equipment shall be terminated square at items not to be insulated, access openings and nameplates. Cover all exposed raw insulation with white sealer or jacket material.
- G. Protect all insulations outside of buildings with aluminum jacket using lock joint or other approved system for a continuous weather tight system. Access doors and other items requiring maintenance or access shall be removable and sealable.
- H. HVAC work not to be insulated:
 - 1. Internally insulated ductwork and air handling units.
 - 2. Relief air ducts (Economizer cycle exhaust air).
 - 3. Exhaust air ducts and plenums, and ventilation exhaust air shafts.
 - 4. Equipment: Expansion tanks, flash tanks, hot water pumps, steam condensate pumps.
 - 5. In hot piping: Unions, flexible connectors, control valves, PRVs, safety valves and discharge vent piping, vacuum breakers, thermostatic vent valves, steam traps 20 mm (3/4 inch) and smaller, exposed piping through floor for convectors and radiators. Insulate piping to within approximately 75 mm (3 inches) of uninsulated items.
- I. Plumbing work not to be insulated:
 - 1. Piping and valves of fire protection system.
 - 2. Chromium plated brass piping.
 - 3. Water piping in contact with earth.
 - 4. Piping in pipe basement serving wall hydrants.
 - 5. Small horizontal cold water branch runs in partitions to individual fixtures may be without insulation for maximum distance of 900 mm (3 feet).
 - 6. Distilled water piping.
- J. Boiler plant work not to be insulated:
 - 1. Pipes, valves and fittings:
 - a. Gas fuel
 - b. Oil unheated
 - c. Compressed Air

- d. Flowmeter sensing piping and blowdown
 - e. Level sensor piping and blowdown
 - f. Tank drains
 - g. Vents-tank, safety and back pressure valves except protective.
 - h. Continuous blowdown and boiler water sampling except protective.
 - i. Threaded valves
 - j. Check valves
 - k. Unions
 - l. Orifice flanges
 - m. Dielectric flanges and unions
 - n. Steam header drains
 - o. Non-return stop and check valve drains
 - p. Pneumatic controls
 - q. Pressure transmission to gages
 - r. Piping in control panels
 - s. Tube cleaning piping
 - t. Chemical feed from pump-type feeders
 - u. Condensate piping from flash tank to condensate return pump
2. Boilers:
- a. Water column, piping and blowdown
 - b. Auxiliary low water cutoff, piping and blowdown
 - c. Remote water level indicators and piping blowdown
 - d. Steam gage piping
 - e. Soot blower and piping
 - f. Safety valves and drip pan ells
 - g. Water level sensors and piping except where required by equipment manufacturer
 - h. Control piping and devices or interlocks
 - i. Drum heads (watertube boilers)
3. Equipment:
- a. Condensate return pump units
 - b. Vacuum return pump units
 - c. Pumps-inlet to outlet
 - d. Flash tanks
 - e. Safety valves
 - f. Water meters
 - g. Oil meters
 - h. Air compressors and tanks

- i. Refrigerated or desiccant air drier
- j. Chemical feeders
- k. Boiler and feedwater sampler
- l. All nameplates
- 4. Specialties:
 - a. Pressure reducing valves
 - b. Control valves-water and steam
 - c. Level sensors-piping, valves and blowdown
 - d. Back pressure regulators-oil and steam
 - e. Strainers under 65 mm (2-1/2 inch) pipe size
 - f. Expansion bellows
 - g. Flexible connectors
 - h. Ball joints except piping between joints
- L. Apply insulation materials subject to the manufacturer's recommended temperature limits. Apply adhesives, mastic and coatings at the manufacturer's recommended minimum coverage.
- M. Elbows, flanges and other fittings shall be insulated with the same material as is used on the pipe straights. The elbow/ fitting insulation shall be field-fabricated, mitered or factory prefabricated to the necessary size and shape to fit on the elbow/ fitting. Use of polyurethane spray-foam to fill a PVC elbow jacket is prohibited on cold applications.
- N. Firestop Pipe and Duct insulation:
 - 1. Provide firestopping insulation at fire and smoke barriers through penetrations. Fire stopping insulation shall be UL listed as defines in Section 07 84 00, FIRESTOPPING.
 - 2. Pipe and duct penetrations requiring fire stop insulation including, but not limited to the following:
 - a. Pipe risers through floors
 - b. Pipe or duct chase walls and floors
 - c. Smoke partitions
 - d. Fire partitions
- O. Freeze protection of above grade outdoor piping (over heat tracing tape): 20 mm (0.75) thick insulation, for all pipe sizes 75 mm(3 inches) and smaller and 25 mm(1inch) thick insulation for larger pipes. Provide metal jackets for all pipes. Provide for cold water make-up to cooling towers and condenser water piping and chilled water piping as

described in Section 23 21 13, HYDRONIC PIPING (electrical heat tracing systems).

P. Provide metal jackets over insulation as follows:

- a. All piping and ducts exposed to outdoor weather.
- b. Piping exposed in building, within 1800 mm (6 feet) of the floor, that connects to sterilizers, kitchen and laundry equipment. Jackets may be applied with pop rivets. Provide aluminum angle ring escutcheons at wall, ceiling or floor penetrations.
- c. A 50 mm (2 inch) overlap is required at longitudinal and circumferential joints.

3.2 INSULATION INSTALLATION

A. Mineral Fiber Board:

1. Faced board: Apply board on pins spaced not more than 300 mm (12 inches) on center each way, and not less than 75 mm (3 inches) from each edge of board. In addition to pins, apply insulation bonding adhesive to entire underside of horizontal metal surfaces. Butt insulation edges tightly and seal all joints with laps and butt strips. After applying speed clips cut pins off flush and apply vapor seal patches over clips.
2. Plain board:
 - a. Insulation shall be scored, beveled or mitered to provide tight joints and be secured to equipment with bands spaced 225 mm (9 inches) on center for irregular surfaces or with pins and clips on flat surfaces. Use corner beads to protect edges of insulation.
 - b. For hot equipment: Stretch 25 mm (1 inch) mesh wire, with edges wire laced together, over insulation and finish with insulating and finishing cement applied in one coat, 6 mm (1/4 inch) thick, trowel led to a smooth finish.
 - c. For cold equipment: Apply meshed glass fabric in a tack coat 1.5 to 1.7 square meter per liter (60 to 70 square feet per gallon) of vapor mastic and finish with mastic at 0.3 to 0.4 square meter per liter (12 to 15 square feet per gallon) over the entire fabric surface.
 - d. Chilled water pumps: Insulate with removable and replaceable 1 mm thick (20 gage) aluminum or galvanized steel covers lined with insulation. Seal closure joints/flanges of covers with gasket

material. Fill void space in enclosure with flexible mineral fiber insulation.

3. Exposed, unlined ductwork and equipment in unfinished areas, mechanical and electrical equipment rooms and attics, and duct work exposed to outdoor weather:
 - a. 50 mm (2 inch) thick insulation faced with ASJ (white all service jacket): Supply air duct and afterfilter housing.
 - b. 40 mm (1-1/2 inch) thick insulation faced with ASJ: Return air duct, mixed air plenums and prefilter housing.
 - c. Outside air intake ducts: 25 mm (one inch) thick insulation faced with ASJ.
- 4.
5. Cold equipment: 40 mm (1-1/2inch) thick insulation faced with ASJ.
 - a. Chilled water pumps, water filter, chemical feeder pot or tank.
 - b. Pneumatic, cold storage water and surge tanks.
6. Hot equipment: 40 mm (1-1/2 inch) thick insulation faced with ASJ.
 - a. Convertors, air separators, steam condensate pump receivers.
 - b. Reheat coil casing and separation chambers on steam humidifiers located above ceilings.
 - c. Domestic water heaters and hot water storage tanks (not factory insulated).
 - d. Booster water heaters for dietetics dish and pot washers and for washdown grease-extracting hoods.

B. Flexible Mineral Fiber Blanket:

1. Adhere insulation to metal with 100 mm (4 inch) wide strips of insulation bonding adhesive at 200 mm (8 inches) on center all around duct. Additionally secure insulation to bottom of ducts exceeding 600 mm (24inches) in width with pins welded or adhered on 450 mm (18 inch) centers. Secure washers on pins. Butt insulation edges and seal joints with laps and butt strips. Staples may be used to assist in securing insulation. Seal all vapor retarder penetrations with mastic. Sagging duct insulation will not be acceptable. Install firestop duct insulation where required.
2. Supply air ductwork to be insulated includes main and branch ducts from AHU discharge to room supply outlets, and the bodies of ceiling outlets to prevent condensation. Insulate sound attenuator units, coil casings and damper frames. To prevent condensation insulate

trapeze type supports and angle iron hangers for flat oval ducts that are in direct contact with metal duct.

3. Concealed supply air ductwork.
 - a. Above ceilings at a roof level: 50 mm (2 inch) thick insulation faced with FSK.
 - b. Above ceilings for other than roof level: 40 mm (1 ½ inch) thick insulation faced with FSK.
4. Concealed return air duct above ceilings at a roof level, unconditioned areas, and in chases with external wall or containing steam piping; 40 mm (1-1/2 inch) thick, insulation faced with FSK. Concealed return air ductwork in other locations need not be insulated.
5. Return air duct in interstitial spaces: 40 mm (1-1/2 inch thick insulation faced with FSK.
6. Concealed outside air duct: 40 mm (1-1/2 inch) thick insulation faced with FSK.
7. Exhaust air branch duct from autopsy refrigerator to main duct: 40 mm (1-1/2 inch) thick insulation faced with FSK.

C. Molded Mineral Fiber Pipe and Tubing Covering:

1. Fit insulation to pipe or duct, aligning longitudinal joints. Seal longitudinal joint laps and circumferential butt strips by rubbing hard with a nylon sealing tool to assure a positive seal. Staples may be used to assist in securing insulation. Seal all vapor retarder penetrations on cold piping with a generous application of vapor barrier mastic. Provide inserts and install with metal insulation shields at outside pipe supports. Install freeze protection insulation over heating cable.
2. Contractor's options for fitting, flange and valve insulation:
 - a. Insulating and finishing cement for sizes less than 100 mm (4 inches) operating at surface temperature of 16 degrees C (61 degrees F) or more.
 - b. Factory premolded, one piece PVC covers with mineral fiber, (Form B), inserts. Provide two insert layers for pipe temperatures below 4 degrees C (40 degrees F), or above 121 degrees C (250 degrees F). Secure first layer of insulation with twine. Seal seam edges with vapor barrier mastic and secure with fitting tape.

- c. Factory molded, ASTM C547 or field mitered sections, joined with adhesive or wired in place. For hot piping finish with a smoothing coat of finishing cement. For cold fittings, 16 degrees C (60 degrees F) or less, vapor seal with a layer of glass fitting tape imbedded between two 2 mm (1/16 inch) coats of vapor barrier mastic.
- d. Fitting tape shall extend over the adjacent pipe insulation and overlap on itself at least 50 mm (2 inches).
3. Nominal thickness in millimeters and inches specified in table below, for piping above ground:

SPEC WRITER NOTE: Insulate vent piping for PRV safety valves, receivers and flash tanks where protection to personnel is required.

Nominal Thickness of Molded Mineral Fiber Insulation				
Nominal Pipe Size, millimeters (inches):	25 (1) & below	32- 75 (1-1/4- 3)	100-150 (4-6)	200 (8) and above
a. 122-177 degrees C (251-350 F) (HPS, MPS,)	50 (2.0)	65 (2.5)	90 (3.5)	90 (3.5)
b. 100-121 degrees C HPR, MPR (212-250 degrees F) (Vent piping from PRV safety valves, condensate receivers, and flash tanks)	25 (1.0)	50 (2.0)	50 (2.0)	50 (2.0)
c. 38-99 degrees C (100-211 degrees F) (LPR, PC, HWH, HWHR, GH, GHR)	25 (1.0)	40 (1.5)	50 (2.0)	50 (2.0)
1. Runouts to fan coil units	15 (0.5)	-	-	-
2. Runouts to air terminal unit reheat coils	15 (0.5)	-	-	-
d. Domestic hot water supply and return	15 (0.5)	20 (0.75)	25 (1.0)	40 (1.5)

D. Rigid Cellular Phenolic Foam:

1. Rigid closed cell phenolic insulation may be provided for piping, ductwork and equipment for temperatures up to 121 degrees C (250 degrees F).
2. Note the NFPA 90A burning characteristics requirements of 25/50 in paragraph 1.3.B
3. Provide secure attachment facilities such as welding pins.
4. Apply insulation with joints tightly drawn together
5. Apply adhesives, coverings, neatly finished at fittings, and valves.
6. Final installation shall be smooth, tight, neatly finished at all edges.
7. Minimum thickness in millimeters (inches) specified in table below, for piping above ground:

Nominal Thickness of Rigid Closed-Cell Phenolic Foam Insulation					
Nominal Pipe Size millimeters (inches):	25 (1) & below	32-75 (1 1/4-3)	100-150 (4-6)	200-300 (8-12)	350 (14) & above
1. 100-121 degrees C (212-250 degrees F), LPS, Vent piping from receivers and flash tanks.	15 (0.5)	25 (1)	25 (1)	--	--
2. 38-99 degrees C (100- 211 degrees F), LPR, PC, HWH, HWHR, GH and GHR.	15 (0.5)	20 (0.75)	25 (1)	--	--
a. Run outs to Fan Coil unit reheat coils.	15 (0.5)	--	--	--	--
3. 4-16 degrees C (40-60 degrees F), CH, CHR, GC, and GCR.	20 (0.75)	20 (0.75)	25 (1)	40 (1.5)	50 (2.0)
a. Run outs to Fan Coil Units.	15 (0.5)	--	--	--	--
4. 10 degrees C (50 degrees F) and less, RS for DX refrigerants.	15 (0.5)	20 (0.75)	--	--	--
5. Domestic hot water supply and return.	15 (0.5)	15 (0.5)	20 (0.75)	20 (0.75)	--

8. Condensation control insulation: Minimum 20 mm (0.75 inch) thick for all pipe sizes.

- a. HVAC: Cooling coil condensation piping to waste piping fixture or drain inlet. Omit insulation on plastic piping in mechanical rooms.
 - b. Plumbing piping as follows:
 - 1) Body of roof and overflow drains horizontal runs and offsets (including elbows) of interior downspout piping in all areas above pipe basement.
 - 2) Waste piping from electric water coolers and icemakers to drainage system.
 - 3) Waste piping located above basement floor from ice making and film developing equipment and air handling units, from fixture (including trap) to main vertical waste pipe.
 - 4) MRI quench vent piping.
 - 5) Bedpan sanitizer atmospheric vent
 - 6) Reagent grade water piping.
 - 7) Cold water piping.
- E. Cellular Glass Insulation:
1. Pipe and tubing, covering nominal thickness in millimeters and inches as tabulated below for chilled water and refrigerant piping.

Nominal Thickness of Cellular Glass Insulation				
Millimeters (inches)	Thru 38 (1 1/2)	50- 150 (2-6)	200-300 (8-12)	over 350 (14)
1. 4-16 degrees C (40-60 degrees F) (CH and CHR within chiller room and pipe chase and underground)	50 (2.0)	80 (3.0)	80 (3.0)	100 (4.0)
2. 4-16 degrees C (40-60 degrees F) (CH and CHR outside chiller room)	40 (1.5)	50 (2.0)	50 (2.0)	65 (2.5)

2. Underground Piping Other than or in lieu of that Specified in Section 23 21 13, HYDRONIC PIPING and Section 33 63 00, STEAM ENERGY DISTRIBUTION: Type II, factory jacketed with a 3 mm laminate jacketing consisting of 3000 mm x 3000 mm (10 ft x 10 ft) asphalt impregnated glass fabric, bituminous mastic and outside protective plastic film.
 - a. 75 mm (3 inches) thick for hot water piping.
 - b. As tabulated above for chilled water piping.

- c. Underground piping: Apply insulation with joints tightly butted. Seal longitudinal self-sealing lap. Use field fabricated or factory made fittings. Seal butt joints and fitting with jacketing as recommended by the insulation manufacturer. Use 100 mm (4 inch) wide strips to seal butt joints.
 - d. Provide expansion chambers for pipe loops, anchors and wall penetrations as recommended by the insulation manufacturer.
 - e. Underground insulation shall be inspected and approved by the Resident Engineer as follows:
 - 1) Insulation in place before coating.
 - 2) After coating.
 - f. Sand bed and backfill: Minimum 75 mm (3 inches) all around insulated pipe or tank, applied after coating has dried.
3. Cold equipment: 50 mm (2 inch) thick insulation faced with ASJ for chilled water pumps, water filters, chemical feeder pots or tanks, expansion tanks, air separators and air purgers.
- F. Polyisocyanurate Closed-Cell Rigid Insulation:
- 1. Polyisocyanurate closed-cell rigid insulation (PIR) may be provided for piping, equipment and ductwork for temperature up to 149 degree C (300 degree F) provided insulation thickness requirement does not exceed 38 mm (1.5 inches).
 - 2. Install insulation, vapor retarder and jacketing per manufacturer's recommendations. Particular attention should be paid to recommendations for joint staggering, adhesive application, external hanger design, expansion/contraction joint design and spacing and vapor retarder integrity.
 - 3. Install insulation with all joints tightly butted (except expansion joints in hot applications).
 - 4. If insulation thickness exceeds 63 mm (2.5 inches), install as a double layer system with longitudinal (lap) and butt joint staggering as recommended by manufacturer.
 - 5. For cold applications, vapor retarder shall be installed in a continuous manner. No staples, rivets, screws or any other attachment device capable of penetrating the vapor retarder shall be used to attach the vapor retarder or jacketing. No wire ties capable of penetrating the vapor retarder shall be used to hold the insulation in place. Banding shall be used to attach PVC or metal jacketing.

6. Elbows, flanges and other fittings shall be insulated with the same material as is used on the pipe straights. The elbow/ fitting insulation shall be field-fabricated, mitered or factory prefabricated to the necessary size and shape to fit on the elbow/ fitting. Use of polyurethane spray-foam to fill PVC elbow jacket is prohibited on cold applications.
7. For cold applications, the vapor retarder on elbows/fittings shall be either mastic-fabric-mastic or 2 mil thick PVDC vapor retarder adhesive tape.
8. All PVC and metal jacketing shall be installed so as to naturally shed water. Joints shall point down and shall be sealed with either adhesive or caulking (except for periodic slip joints).
9. Underground piping: Follow instructions for above ground piping but the vapor retarder jacketing shall be 6 mil thick PVDC or minimum 30 mil thick rubberized bituminous membrane. Sand bed and backfill shall be a minimum of 150 mm (6 inches) all around insulated pipe.
10. Note the NFPA 90A burning characteristic requirements of 25/50 in paragraph 1.3B. Refer to paragraph 3.1 for items not to be insulated.
11. Minimum thickness in millimeter (inches) specified in table below, for piping:

Nominal Thickness of Polyisocyanurate Rigid Insulation				
Nominal Pipe Size millimeters(inches):	25(1) & below	32-75 (1 1/4-3)	100-150 (4-6)	200-300 (8-12)
1. 122-149 degree C(251-300 degree F) (HPS, MPS)	40 (1.5)	--	--	--
2. 100-121 degrees C (211-250 degrees F), HPR, MPR, LPS, Vent piping from receivers and flash tanks	20 (0.75)	40(1.5)	40(1.5)	40(1.50)
3. 38-99 degrees C (100-211 degrees F), LPR, PC, HWH, HWHR, GH and GHR	20 (0.75)	25(1.0)	40(1.5)	40(1.50)

Nominal Thickness of Polyisocyanurate Rigid Insulation				
a. Run outs to fan coil units reheat coils	20 (0.75)	--	--	--
4. 4-16 degrees C (40-60 degrees F), CH, CHR, GC and GCR for relative humidity up to 80 percent or underground location	25 (1.00)	25 (1.0)	40 (1.50)	40(1.5)
a. Run outs to fan coil units	20 (0.75)	25 (1.)	--	--
5. 4-16 degrees C(40-60 degrees F) CH, CHR, GC and GCR for relative humidity 80 to 90 percent or higher	40 (1.50)	40 (1.5)	40 (1.5)	40 (1.5)
a. Run out to fan coils units	40 (1.5)	40 (1.5)	--	--
6. 10 degrees C (50 degrees F) and less, RS for DX refrigerants	20 (0.75) 40 (1.5)	25 (1.0)40 (1.5)	--40 (1.5)	----
7. Domestic hot water supply and return 6. 10 degrees C (50 degrees F) and less, RS for DX refrigerants	15 (0.5)2 0 (0.75)	20 (0.74)25 (1.0)	25 (1.0)--	25(1.0)--
7. Domestic hot water supply and return	15 (0.5)	20 (0.74)	25 (1.0)	25(1.0)

12. Condensation control insulation: Minimum 20 mm (0.75 inch) thick for all pipe sizes.

a. HVAC: Cooling coil condensation piping to waste piping fixture or drain inlet. Omit insulation on plastic piping in mechanical rooms.

- b. Plumbing piping as follows:
 - 1) Body of roof and overflow drains and horizontal runs and offsets (including elbows) of interior downspout piping in all areas above pipe basement.
 - 2) Waste piping from electric water coolers to drainage system.
 - 3) Waste piping located above basement floor from ice making and film developing equipment and air handling units, from fixture (including trap) to main vertical waste pipe.
 - 4) MRI quench vent piping.
 - 5) Bedpan sanitizer atmospheric vent.
 - 6) Reagent grade water piping.
 - 7) Cold Water Piping.
- G. Flexible Elastomeric Cellular Thermal Insulation:
 - 1. Apply insulation and fabricate fittings in accordance with the manufacturer's installation instructions and finish with two coats of weather resistant finish as recommended by the insulation manufacturer.
 - 2. Pipe and tubing insulation:
 - a. Use proper size material. Do not stretch or strain insulation.
 - b. To avoid undue compression of insulation, provide cork stoppers or wood inserts at supports as recommended by the insulation manufacturer. Insulation shields are specified under Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
 - c. Where possible, slip insulation over the pipe or tubing prior to connection, and seal the butt joints with adhesive. Where the slip-on technique is not possible, slit the insulation and apply it to the pipe sealing the seam and joints with contact adhesive. Optional tape sealing, as recommended by the manufacturer, may be employed. Make changes from mineral fiber insulation in a straight run of pipe, not at a fitting. Seal joint with tape.
 - 3. Apply sheet insulation to flat or large curved surfaces with 100 percent adhesive coverage. For fittings and large pipe, apply adhesive to seams only.
 - 4. Pipe insulation: nominal thickness in millimeters (inches as specified in table below for piping above ground:

Nominal Thickness of Flexible Elastomeric Cellular Insulation				
Nominal Pipe Size millimeters (inches)	25 (1) & below	32-75 (1 1/4- 3)	100-150 (4-6)	200 (8)
1. 38-93 degrees C (100-200 degrees F) (HWH, HWHR, GH, GHR)	25 (1.0)	40 (1.5)	-	-
a. Runouts to air terminal unit reheat coils	20 (0.75)	40 (1.5)	-	-
2. 4-16 degrees C (40-60 degrees F) (CH, CHR, GC, GCR)	25 (1.0)	40 (1.5)	-	-
a. Runouts to fan coil units ooling coil condensate piping	20 (0.75)	40 (1.5)	-	-
b. RS for DX refrigeration	25 (1.0)	40 (1.5)	-	-
3. Domestic hot water supply and return	15 (0.50)	20 (0.75)	25 (1.0)	40 (1.50)

5. Minimum 20 mm (0.75 inch) thick insulation for pneumatic control lines for a minimum distance of 6 m (20 feet) from discharge side of the refrigerated dryer.

6. Use Class S (Sheet), 20 mm (3/4 inch) thick for the following:

- Chilled water pumps
- Bottom and sides of metal basins for winterized cooling towers (where basin water is heated).
- Chillers, insulate any cold chiller surfaces subject to condensation which has not been factory insulated.
- Piping inside refrigerators and freezers: Provide heat tape under insulation.

H. Duct Wrap for Kitchen Hood Grease Ducts:

- The insulation thickness, layers and installation method shall be as per recommendations of the manufacturer to maintain the fire integrity and performance rating.
- Provide stainless steel jacket for all exterior and exposed interior ductwork.

I. Calcium Silicate:

- Minimum thickness in millimeter (inches) specified below for piping other than in boiler plant. See paragraphs 3.3 through 3.7 for Boiler Plant Applications.

Nominal Thickness Of Calcium Silicate Insulation (Non-Boiler Plant)				
Nominal Pipe Size Millimeters (Inches)	Thru 25 (1)	32 to 75 (1-1/4 to 3)	100-200 (4 to 6)	Over 200 (6)
93-260 degrees C(200- 500 degrees F)(HPS, HPR)	67 (2-1/2)	75(3)	100(4)	100(4)

2. Engine Exhaust Insulation for Emergency Generator and Diesel Driven Fire Pump: Type II, Class D, 65 mm (2 1/2 inch) nominal thickness. Cover exhaust completely from engine through roof or wall construction, including muffler. Secure with 16 AWG galvanized annealed wire or 0.38 x 12 mm 0.015 x 1/2 IN wide galvanized bands on 300 mm 12 IN maximum centers. Anchor wire and bands to welded pins, clips or angles. Apply 25 mm 1 IN hex galvanized wire over insulation. Fill voids with 6 mm 1/4 IN insulating cement.
3. ETO Exhaust (High Temperature): Type II, class D, 65 mm (2.5 inches) nominal thickness. Cover duct for entire length. Provide sheet aluminum jacket for all exterior ductwork.
5. MRI Quench Vent Insulation: Type I, class D, 150 mm (6 inch) nominal thickness.

3.3 APPLICATION -BOILER PLANT, PIPE, VALVES, STRAINERS AND FITTINGS:

- A. Temperature range 120 to 230 degrees C (251 to 450 degrees F);
 1. Application; Steam service 110 kpa (16 psig nominal) and higher, high pressure condensate to trap assembly, boiler bottom blowoff from boiler to blowoff valve closest to boiler.
 2. Insulation and Jacket:
 - a. Calcium silicate for piping from zero to 1800 mm (6 feet) above boiler room floor, feedwater heater mezzanine floor or access platform and any floors or platforms on which tanks or pumps are located.
 - b. Mineral fiber for remaining locations.
 - c. ASJ with PVC premolded fitting coverings.

- d. Aluminum jacket from zero to 1800 mm (6 feet) above floor on atomizing steam and condensate lines at boilers and burners.
3. Thickness:

Nominal Thickness Of Calcium Silicate Insulation (Boiler Plant)	
Pipe Diameter mm (in)	Insulation Thickness mm (in)
25 (1) and below	50 (2)
32 to 80 (1 1/4 to 3)	63 (2-1/2)
100 (4) and above	88 (3-1/2)

- B. Temperature range 100 to 121 degrees C (211 to 250 degrees F):
1. Application: Steam service 103 kpa (15 psig) and below, trap assembly discharge piping, boiler feedwater from feedwater heater to boiler feed pump recirculation, feedwater heater overflow, heated oil from oil heater to burners.
 2. Insulation and Jacket:
 - a. Calcium silicate for piping from zero to 1800 mm (0 to 6 feet) above boiler room floor, feedwater heater mezzanine floor and access platform, and any floors or access platforms on which tanks or pumps are located.
 - b. Mineral Fiber or rigid closed cell phenolic foam for remaining locations.
 - c. ASJ with PVC premolded fitting coverings.
 - d. Aluminum jacket from zero to 1800 mm (6 feet) above floor on condensate lines at boilers and burners.
 3. Thickness-calcium silicate and mineral fiber insulation:

Nominal Thickness Of Insulation	
Pipe Diameter mm (in)	Insulation Thickness mm (in)
25 (1) and below	25 (1)
32 to 80 (1-1/4 to 3)	50 (2)
100 (4) and above	50 (2)

4. Thickness-rigid closed-cell phenolic foam insulation:

Nominal Thickness Of Insulation	
Pipe Diameter mm (in)	Insulation Thickness mm (in)
25 (10 and below)	19 (0.75)
32 to 80 (1-1/4 to 30)	25 (1)
100 (4) and above	25 (1)

C. Temperature range 32 to 99 degrees C (90 to 211 degrees F):

1. Application: Pumped condensate, vacuum heating return, gravity and pumped heating returns, condensate transfer, condensate transfer pump recirculation, heated oil system to heaters and returns from burners, condensate return from convertors and heated water storage tanks.
2. Insulation Jacket:
 - a. Calcium silicate for piping from zero to 1800 mm (six feet above boiler room floor, feedwater heater mezzanine floor and access platform and any floor or access platform on which tanks or pumps are located.
 - b. Mineral fiber or rigid closed-cell phenolic foam for remaining locations.
 - c. ASJ with PVC premolded fitting coverings.
3. Thickness-calcium silicate and mineral fiber insulation:

Nominal Thickness Of Insulation	
Pipe Diameter mm (in)	Insulation Thickness mm (in)
25 (1) and below	25 (1)
32 to 80 (1-1/4 to 3)	38 (1-1/2)
100 (40 and above)	50 (2)

4. Thickness-rigid closed-cell phenolic foam insulation:

Nominal Thickness Of Insulation	
Pipe Diameter mm (in)	Insulation Thickness mm (in)
25 (1) and below	19 (0.75)
32 to 80 (1-1/4 to 3)	19 (0.75)
100 (4) and above	25 (1)

D. Protective insulation to prevent personnel injury:

1. Application: Piping from zero to 1800 mm (6 feet) above all floors and access platforms including continuous blowoff, feedwater and boiler water sample, blowoff tank vent, flash tank vents and condensater tank vent, shot-type chemical feed, fire tube boiler bottom blowoff after valves, valve by-passes.
2. Insulation thickness: 25 mm (1 inch).
3. Insulation and jacket: Calcium silicate with ASJ except provide aluminum jacket on piping at boilers within 1800 mm (6 feet) of floor. Use PVC premolded fitting coverings when all service jacket is utilized.

E. Installation:

1. At pipe supports, weld pipe covering protection saddles to pipe, except where MS-SP58, type 3 pipe clamps are utilized.
2. Insulation shall be firmly applied, joints butted tightly, mechanically fastened by stainless steel wires on 300 mm (12 inch) centers.
3. At support points, fill and thoroughly pack space between pipe covering protective saddle bearing area.
4. Terminate insulation and jacket hard and tight at anchor points.
5. Terminate insulation at piping facilities not insulated with a 45 degree chamfered section of insulating and finishing cement covered with jacket.
6. On calcium silicate, mineral fiber and rigid closed-cell phenolic foam systems, insulated flanged fittings, strainers and valves with sections of pipe insulation cut, fitted and arranged neatly and firmly wired in place. Fill all cracks, voids and coat outer surface with insulating cement. Install jacket. Provide similar construction on welded and threaded fittings on calcium silicate systems or use premolded fitting insulation.

7. On mineral fiber systems, insulate welded and threaded fittings more than 50 mm (2 inches) in diameter with compressed blanket insulation (minimum 2/1) and finish with jacket or PVC cover.
8. Insulate fittings 50 mm (2 inches) and smaller with mastic finishing material and cover with jacket.
9. Insulate valve bonnet upto valve side of bonnet flange to permit bonnet flange removal without disturbing insulation.
10. Install jacket smooth, tight and neatly finish all edges. Over wrap ASJ butt strips by 50 percent. Secure aluminum jacket with stainless steel bands 300 mm (12 inches) on center or aluminum screws on 200 mm (4 inch) centers.
11. Do not insulate basket removal flanges on strainers.

3.4 APPLICATION-BOILER FLUE GAS SYSTEMS

- A. Temperature range 150 to 370 degrees C (300 to 700 degrees F):
 1. Application: Transitions, stacks and breechings from boiler outlet to stack outlet; induced draft fans (if provided); flue gas recirculation fans and ductwork (if provided).
 2. Thickness:
 - a. Single-wall duct systems: 50 mm (2 inches).
 - b. Double-wall factory-fabricated duct systems with air space between walls: None.
 3. Insulation and jacket: Calcium Silicate with aluminum sheet metal jacket.
- B. Protective Insulation to Prevent Personnel Injury:
 1. Application: Double wall factory-fabricated duct system with uninsulated air space between walls within 900 mm (3 feet) horizontally and 1800 mm (6 feet) vertically of platform or floor.
 2. Insulation thickness; 25 mm (1 inch).
 3. Insulation and jacket: Calcium Silicate with aluminum sheet metal jacket.
- C. Insulating:
 1. Provide attachment facilities such as angles, welded studs, clip angles.
 2. Apply insulation with joints tightly butted and staggered. Seal joints with high temperature cement.
 3. Provide metal corner beads.
 4. Band insulation firmly in place to provide a smooth surface. Maximum band spacing shall not be more than 300 mm (12 inches).

5. Install jacket. All surfaces outside of building must be weather tight. At termination of stub stacks, provide metal closure system which is connected and sealed to perimeter of stack to prevent water penetration of insulation.

3.5 APPLICATION-BOILER DEAERATING FEEDWATER HEATER, TANKS

- A. Temperature range 38 to 120 degrees C (100 to 250 degrees F)
 1. Application: Deaerating feedwater heater and storage tank, condensate storage tanks, heat exchangers, blowoff tank.
 2. Insulation Thickness:
 - a. Feedwater heater and storage tanks: 75 mm (3 inches)
 - b. Condensate storage tanks: 50 mm (2 inches)
 - c. Blowoff tank, heat exchangers: 25 mm (1 inch).
 3. Insulation and covering: Calcium silicate with glass cloth jacket.
- B. Insulating:
 1. Insulate tanks with an assembly of chamfered block to fit curvature. Secure with 1.6 mm diameter (16 gage) wire or stainless steel bands 300 mm (12 inches) on centers, fill all voids and interstices with finishing cement coat, imbed hexagonal wire mesh in first finish coat. Provide a second finish coat and a glass cloth covering.
 2. Apply glass cloth with adhesive, smooth, tight and neatly finished at all cloth edges; prime to receive paint.
 3. Do not insulate over nameplates and data plates. Nameplates and data plates must be legible.

3.6 APPLICATION ON HEATED OR TRACED OIL FACILITIES OUTSIDE OF BUILDING

- A. Temperature range 30 to 120 degrees C (85 to 250 degrees F).
 1. Application: Aboveground oil storage tank, oil and steam or hot water underground and aboveground piping systems.
 2. Insulation thickness:
 - a. Tanks; 38 mm (1-1/2 inches) plus finish.
 - b. Oil suction and return piping: 38 mm (1-1/2 inches plus finish).
 - c. Steam or hot water piping: 38 mm (1-1/2 inches) plus finish.
- B. Insulation and jacket (aboveground tanks and piping): Calcium silicate with glass cloth or aluminum jacket, weatherproof jacket when used outside of building.
- C. Insulation and Jacket (underground piping); Calcium silicate with fiberglass scrim jacket located within secondary containment. Allow space for heating cable (if provided) along bottom line of piping.

- - - E N D - - -

SECTION 23 08 00
COMMISSIONING OF HVAC SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. The requirements of this Section apply to all sections of Division 23.
- B. This project will have selected building systems commissioned. The complete list of equipment and systems to be commissioned are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. The commissioning process, which the Contractor is responsible to execute, is defined in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. A Commissioning Agent (CxA) appointed by the Department of Veterans Affairs will manage the commissioning process.

1.2 RELATED WORK

- A. Section 01 00 00 GENERAL REQUIREMENTS.
- B. Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.
- C. Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

1.3 SUMMARY

- A. This Section includes requirements for commissioning the HVAC systems, subsystems and equipment. This Section supplements the general requirements specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.
- B. The commissioning activities have been developed to support the VA requirements to meet guidelines for Federal Leadership in Environmental, Energy, and Economic Performance.
- C. The commissioning activities have been developed to support the United States Green Building Council (USGBC) LEED™ rating program and to support delivery of project performance in accordance with the Contract Documents developed with the approval of the VA.
 - 1. Commissioning activities and documentation for the LEED™ section on "Energy and Atmosphere" prerequisite of "Fundamental Building Systems Commissioning".
 - 2. Commissioning activities and documentation for the LEED™ section on "Energy and Atmosphere" requirements for the "Enhanced Building System Commissioning" credit.
 - 3. Activities and documentation for the LEED™ section on "Measurement and Verification" requirements for the Measurement and Verification credit.

- D. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for more specifics regarding processes and procedures as well as roles and responsibilities for all Commissioning Team members.

1.4 DEFINITIONS

- A. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for definitions.

1.5 COMMISSIONED SYSTEMS

- A. Commissioning of a system or systems specified in this Division is part of the construction process. Documentation and testing of these systems, as well as training of the VA's Operation and Maintenance personnel, is required in cooperation with the VA and the Commissioning Agent.
- B. The following HVAC systems will be commissioned:
1. Air Handling Systems (including terminal units and energy recovery units)
 2. Air Handling Systems (Fans, motors, Variable Speed Drives, cooling coils and control valves, heating coils and control valves, filters, dampers, safeties such as smoke detectors or freezestats and damper end switches, controls, gages, and vibration isolation).
 3. Dehumidification Systems (Energy recovery devices - such as enthalpy wheels, fans, motors, Variable Speed Drives, cooling coils and control valves, heating coils and control valves, filters, dampers, safeties, controls, gages, and vibration isolation).
 4. Heating Hot Water Systems (Boilers, controls, instrumentation and gages, flues, heating water pumps and motors, Variable Speed Drives, mixing valves).
 5. Condensate Return Systems (Condensate receivers and transfer pumps, motors, controls, pump alternator, alarms and instrumentation, deaerators, boiler feed pumps and motors, safeties).
 6. Chilled Water Systems (Chilled water pumps and motors, Variable Speed Drives, chiller motor/compressor, controls, instrumentation and safeties, isolation valves, blending valves, side stream water cleaners/scrubbers/filters).
 7. Condenser Water Systems for Chillers (Condenser water pumps and motors, Variable Speed Drives, cooling tower fans, cooling tower sump level controls, open-circuit water treatment system, water treatment injection pumps and motors, water treatment controls,

- cooling tower basin heaters and controls, side stream water cleaners/scrubbers/filters, tower bypass valves).
8. Exhaust Fans (Fan, motor, Variable Speed Drives, controls and safeties).
 9. Steam System (Boilers, controls, gages and instrumentation, safety relief valves, combustion burners/fans/motors, fuel delivery pumps and motors, flues).
 10. Direct Digital Control System (BACnet or similar Local Area Network (LAN), Operator Work Station hardware and software, building controller hardware and software, terminal unit controller hardware and software, all sequences of operation, system accuracy and response time).
 14. OR Air Handling Systems (Fans, motors, Variable Speed Drives, Energy recovery devices - such as heat pipes, cooling coils and control valves, heating coils and control valves, filters, HEPA filter performance, dampers, safeties such as smoke detectors or freezestats and damper end switches, controls, gages, and vibration isolation).
 16. Computer Room Air Conditioning Systems (CRAC units - including fans, motors, Variable Speed Drives, cooling coils and control valves, heating coils and control valves, humidifiers, compressors and liquid-cooled condensers, filters, safeties, controls, gages, vibration isolation, condensate pumps, water/leak detection system and alarms, and shunt trip shut down).
 18. HVAC Water Treatment Systems (Closed circuits - including shot feeders and final water analysis, open circuits - including water analysis, chemical/biocide tanks, injection piping, chemical/biocide pumps and motors, controls, water meter, and automatic blowdown).
 20. Fuel Delivery and Storage Systems for Boilers and Standby Generators (Fuel level monitoring/controls/alarms, transfer pumps and motors, leak detection monitoring/alarms, and fill systems)

1.6 SUBMITTALS

- A. The commissioning process requires review of selected Submittals. The Commissioning Agent will provide a list of submittals that will be reviewed by the Commissioning Agent. This list will be reviewed and approved by the VA prior to forwarding to the Contractor. Refer to Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, and SAMPLES for further details.

- B. The commissioning process requires Submittal review simultaneously with engineering review. Specific submittal requirements related to the commissioning process are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

PART 2 - PRODUCTS (NOT USED)

PART 3 - EXECUTION

3.1 PRE-FUNCTIONAL CHECKLISTS

- A. The Contractor shall complete Pre-Functional Checklists to verify systems, subsystems, and equipment installation is complete and systems are ready for Systems Functional Performance Testing. The Commissioning Agent will prepare Pre-Functional Checklists to be used to document equipment installation. The Contractor shall complete the checklists. Completed checklists shall be submitted to the VA and to the Commissioning Agent for review. The Commissioning Agent may spot check a sample of completed checklists. If the Commissioning Agent determines that the information provided on the checklist is not accurate, the Commissioning Agent will return the marked-up checklist to the Contractor for correction and resubmission. If the Commissioning Agent determines that a significant number of completed checklists for similar equipment are not accurate, the Commissioning Agent will select a broader sample of checklists for review. If the Commissioning Agent determines that a significant number of the broader sample of checklists is also inaccurate, all the checklists for the type of equipment will be returned to the Contractor for correction and resubmission. Refer to SECTION 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for submittal requirements for Pre-Functional Checklists, Equipment Startup Reports, and other commissioning documents.

3.2 CONTRACTORS TESTS

- A. Contractor tests as required by other sections of Division 23 shall be scheduled and documented in accordance with Section 01 00 00 GENERAL REQUIREMENTS. The Commissioning Agent will witness selected Contractor tests. Contractor tests shall be completed prior to scheduling Systems Functional Performance Testing.

3.3 SYSTEMS FUNCTIONAL PERFORMANCE TESTING:

- A. The Commissioning Process includes Systems Functional Performance Testing that is intended to test systems functional performance under steady state conditions, to test system reaction to changes in operating conditions, and system performance under emergency

conditions. The Commissioning Agent will prepare detailed Systems Functional Performance Test procedures for review and approval by the Resident Engineer. The Contractor shall review and comment on the tests prior to approval. The Contractor shall provide the required labor, materials, and test equipment identified in the test procedure to perform the tests. The Commissioning Agent will witness and document the testing. The Contractor shall sign the test reports to verify tests were performed. See Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS, for additional details.

3.4 TRAINING OF VA PERSONNEL

- A. Training of the VA's operation and maintenance personnel is required in cooperation with the Resident Engineer and Commissioning Agent. Provide competent, factory authorized personnel to provide instruction to operation and maintenance personnel concerning the location, operation, and troubleshooting of the installed systems. The instruction shall be scheduled in coordination with the Resident Engineer after submission and approval of formal training plans. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS and Division 23 Sections for additional Contractor training requirements.

----- END -----

SECTION 23 09 23
DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC

PART 1 - GENERAL

1.1 DESCRIPTION

A. Provide (a) direct-digital control system(s) as indicated on the project documents, point list, interoperability tables, drawings and as described in these specifications. Include a complete and working direct-digital control system. Include all engineering, programming, controls and installation materials, installation labor, commissioning and start-up, training, final project documentation and warranty.

1. The direct-digital control system(s) shall consist of high-speed, peer-to-peer network of DDC controllers, a control system server, and an Engineering Control Center. Provide a remote user using a standard web browser to access the control system graphics and change adjustable setpoints with the proper password.
2. The direct-digital control system(s) shall be native BACnet. All new workstations, controllers, devices and components shall be listed by BACnet Testing Laboratories. All new workstations, controller, devices and components shall be accessible using a Web browser interface and shall communicate exclusively using the ASHRAE Standard 135 BACnet communications protocol without the use of gateways, unless otherwise allowed by this Section of the technical specifications, specifically shown on the design drawings and specifically requested otherwise by the VA.
 - a. If used, gateways shall support the ASHRAE Standard 135 BACnet communications protocol.
 - b. If used, gateways shall provide all object properties and read/write services shown on VA-approved interoperability schedules.
3. The work administered by this Section of the technical specifications shall include all labor, materials, special tools, equipment, enclosures, power supplies, software, software licenses, Project specific software configurations and database entries, interfaces, wiring, tubing, installation, labeling, engineering, calibration, documentation, submittals, testing, verification, training services, permits and licenses, transportation, shipping, handling, administration, supervision, management, insurance,

Warranty, specified services and items required for complete and fully functional Controls Systems.

4. The control systems shall be designed such that each mechanical system shall operate under stand-alone mode. The contractor administered by this Section of the technical specifications shall provide controllers for each mechanical system. In the event of a network communication failure, or the loss of any other controller, the control system shall continue to operate independently. Failure of the ECC shall have no effect on the field controllers, including those involved with global strategies.
 5. The control system shall accommodate 1 Engineering Control Center(s) and the control system shall accommodate 5 web-based Users simultaneously, and the access to the system should be limited only by operator password.
- B. Some products are furnished but not installed by the contractor administered by this Section of the technical specifications. The contractor administered by this Section of the technical specifications shall formally coordinate in writing and receive from other contractors formal acknowledgements in writing prior to submission the installation of the products. These products include the following:
1. Control valves.
 2. Flow switches.
 3. Flow meters.
 4. Sensor wells and sockets in piping.
 5. Terminal unit controllers.
- C. Some products are installed but not furnished by the contractor administered by this Section of the technical specifications. The contractor administered by this Section of the technical specifications shall formally coordinate in writing and receive from other contractors formal acknowledgements in writing prior to submission the procurement of the products. These products include the following:
- 1.
 2. Factory-furnished accessory thermostats and sensors furnished with unitary equipment.
- D. Some products are not provided by, but are nevertheless integrated with the work executed by, the contractor administered by this Section of the technical specifications. The contractor administered by this Section of the technical specifications shall formally coordinate in

writing and receive from other contractors formal acknowledgements in writing prior to submission the particulars of the products. These products include the following:

1. Fire alarm systems. If zoned fire alarm is required by the project-specific requirements, this interface shall require multiple relays, which are provided and installed by the fire alarm system contractor, to be monitored.
2. Boiler and/or chiller controls. These controls, if not native BACnet, will require a BACnet Gateway.
3. Terminal units' velocity sensors
4. Unitary HVAC equipment (split systems, packaged pumping stations, controls. These include:
 - a. Discharge temperature control.
 - b. Setpoint reset.
 - c. Time of day indexing.
 - d. Status alarm.
5. Variable frequency drives. These controls, if not native BACnet, will require a BACnet Gateway.
6. The following systems have limited control (as individually noted below) from the ECC:
 - a. Constant temperature rooms: temperature out of acceptable range and status alarms.
 - b. Domestic water heating systems: low temperature, high temperature and status alarms.
 - c. Elevators: status alarms.
 - d. Building lighting systems: on/off and scene control.
 - e. Stormwater removal pumps: status alarm.
 - f. Sanitary sewage pumps: status alarm.

E. Responsibility Table:

Work/Item/System	Furnish	Install	Low Voltage Wiring	Line Power
Control system low voltage and communication wiring	23 09 23	23 09 23	23 09 23	N/A
Terminal units	23	23	N/A	26
Controllers for terminal units	23 09 23	23	23 09 23	16
LAN conduits and raceway	23 09 23	23 09 23	N/A	N/A

Work/Item/System	Furnish	Install	Low Voltage Wiring	Line Power
Automatic dampers (not furnished with equipment)	23 09 23	23	N/A	N/A
Automatic damper actuators	23 09 23	23 09 23	23 09 23	23 09 23
Manual valves	23	23	N/A	N/A
Automatic valves	23 09 23	23	23 09 23	23 09 23
Pipe insertion devices and taps, flow and pressure stations.	23	23	N/A	N/A
Thermowells	23 09 23	23	N/A	N/A
Current Switches	23 09 23	23 09 23	23 09 23	N/A
Control Relays	23 09 23	23 09 23	23 09 23	N/A
Power distribution system monitoring interfaces	23 09 23	23 09 23	23 09 23	26
Interface with chiller/boiler controls	23 09 23	23 09 23	23 09 23	26
Chiller/boiler controls interface with control system	23	23	23 09 23	26
All control system nodes, equipment, housings, enclosures and panels.	23 09 23	23 09 23	23 09 23	26
Smoke detectors	28 31 00	28 31 00	28 31 00	28 31 00
Fire/Smoke Dampers	23	23	28 31 00	28 31 00
Smoke Dampers	23	23	28 31 00	28 31 00
Fire Dampers	23	23	N/A	N/A
Chiller/starter interlock wiring	N/A	N/A	26	26
Chiller Flow Switches	23	23	23	N/A
Boiler interlock wiring	23	23	23	26
Boiler Flow Switches	23	23	23	N/A
Water treatment system	23	23	23	26
VFDs	23 09 23	26	23 09 23	26
Refrigerant monitors	23	23 09 23	23 09 23	26
Laboratory Environmental Controls	23 09 23	23 09 23	23 09 23	26
Fume hood controls	23 09 23	23 09 23	23 09 23	26
Medical gas panels	23	23	26	26

Work/Item/System	Furnish	Install	Low Voltage Wiring	Line Power
Laboratory Air Valves	23	23	23 09 23	N/A
Computer Room A/C Unit field-mounted controls	23	23	16	26
Control system interface with CRU A/C controls	23 09 23	23 09 23	23 09 23	26
CRU A/C unit controls interface with control system	23	23 09 23	23 09 23	26
Fire Alarm shutdown relay interlock wiring	28	28	28	26
Control system monitoring of fire alarm smoke control relay	28	28	23 09 23	28
Fire-fighter's smoke control station (FSCS)	28	28	28	28
Fan Coil Unit controls (not furnished with equipment)	23 09 23	23 09 23	23 09 23	26
Unit Heater controls (not furnished with equipment)	23 09 23	23 09 23	23 09 23	26
Packaged RTU space-mounted controls (not furnished with equipment)	23 09 23	23 09 23	23 09 23	26
Packaged RTU unit-mounted controls (not furnished with equipment)	23 09 23	23 09 23	23 09 23	26
Cooling Tower Vibration Switches	23	23	23 09 23	23 09 23
Cooling Tower Level Control Devices	23	23	23 09 23	23 09 23
Cooling Tower makeup water control devices	23	23	23 09 23	23 09 23
Starters, HOA switches	23	23	N/A	26

F. This facility's existing direct-digital control system is manufactured by JCI. The contractor administered by this Section of the technical specifications shall observe the capabilities, communication network, services, spare capacity of the existing control system and its ECC prior to beginning work.

1. Provide a new BACnet ECC, communications network, and controllers.

Provide a programmable internetworking gateway allowing for real-time

communication between the existing direct-digital control system and the new BACnet control system. Real-time communication shall provide all object properties and read/write services shown on VA-approved interoperability schedules. The contractor administered by this Section of the technical specifications shall provide all necessary investigation and site-specific programming to execute the interoperability schedules.

- a. The combined system shall operate and function as one complete system including one database of control point objects and global control logic capabilities. Facility operators shall have complete operations and control capability over all systems, new and existing including; monitoring, trending, graphing, scheduling, alarm management, global point sharing, global strategy deployment, graphical operations interface and custom reporting as specified.
- G. This campus has standardized on an existing standard ASHRAE Standard 135, BACnet/IP Control System supported by a preselected controls service company. This entity is referred to as the "Control System Integrator" in this Section of the technical specifications. The Control system integrator is responsible for ECC system graphics and expansion. It also prescribes control system-specific commissioning/verification procedures to the contractor administered by this Section of the technical specification. It lastly provides limited assistance to the contractor administered by this Section of the technical specification in its commissioning/verification work.
1. The General Contractor of this project shall directly hire the Control System Integrator in a contract separate from the contract procuring the controls contractor administered by this Section of the technical specifications.
 2. The contractor administered by this Section of the technical specifications shall coordinate all work with the Control System Integrator. The contractor administered by this Section of the technical specifications shall integrate the ASHRAE Standard 135, BACnet/IP control network(s) with the Control System Integrator's area control through an Ethernet connection provided by the Control System Integrator.
 3. The contractor administered by this Section of the technical specifications shall provide a peer-to-peer networked, stand-alone,

distributed control system. This direct digital control (DDC) system shall include one portable operator terminal - laptop, one digital display unit, microprocessor-based controllers, instrumentation, end control devices, wiring, piping, software, and related systems. This contractor is responsible for all device mounting and wiring.

4. Responsibility Table:

Item/Task	Section 23 09 23 contractor	Control system integrator	VA
ECC expansion		X	
ECC programming		X	
Devices, controllers, control panels and equipment	X		
Point addressing: all hardware and software points including setpoint, calculated point, data point(analog/binary), and reset schedule point	X		
Point mapping		X	
Network Programming	X		
ECC Graphics		X	
Controller programming and sequences	X		
Integrity of LAN communications	X		
Electrical wiring	X		
Operator system training		X	
LAN connections to devices	X		
LAN connections to ECC		X	
IP addresses			X
Overall system verification		X	
Controller and LAN system verification	X		

H. Unitary standalone systems including Unit Heaters, Cabinet Unit Heaters, Fan Coil Units, Base Board Heaters, thermal comfort ventilation fans, and similar units for control of room environment conditions may be equipped with integral controls furnished and installed by the equipment manufacturer or field mounted. Refer to equipment specifications and as indicated in project documents. Application of standalone unitary controls is limited to at least those systems wherein remote monitoring, alarm and start-up are not necessary. Examples of such systems include:

1. Light-switch-operated toilet exhaust
2. Vestibule heater
3. Exterior stair heater
4. Attic heating and ventilation
5. Mechanical or electrical room heating and ventilation.

I The direct-digital control system shall start and stop equipment, move (position) damper actuators and valve actuators, and vary speed of

equipment to execute the mission of the control system. Use electricity as the motive force for all damper and valve actuators, unless use of pneumatics as motive force is specifically granted by the VA.

1.2 RELATED WORK

- A. Section 14 24 00, Hydraulic Elevators.
- B. Section 21 05 11, Common Work Results for Fire Suppression.
- C. Section 22 11 23, Domestic Water Pumps.
- D. Section 22 14 29, Sump Pumps.
- E. Section 22 33 00, Electric Domestic Water Heaters.
- F. Section 23 21 13, Hydronic Piping.
- G. Section 23 22 13, Steam and Condensate Heating Piping.
- H. Section 23 31 00, HVAC Ducts and Casings.
- I. Section 23 36 00, Air Terminal Units.
- J. Section 23 64 00, Packaged Water Chillers.
- K. Section 23 73 00, Indoor Central-Station Air-Handling Units.
- L. Section 23 81 00, Decentralized Unitary HVAC Equipment.
- M. Section 25 10 10, Advanced Utility Metering System.
- N. Section 26 05 11, Requirements for Electrical Installations.
- O. Section 26 05 21, Low-Voltage Electrical Power Conductors and Cables (600 Volts and Below).
- P. Section 26 05 26, Grounding and Bonding for Electrical Systems.
- Q. Section 26 05 33, Raceway and Boxes for Electrical Systems.
- R. Section 26 09 23, Lighting Controls.
- S. Section 26 27 26, Wiring Devices.
- T. Section 26 29 11, Motor Starters.
- U. Section 27 15 00, Communications Horizontal Cabling
- V. Section 28 31 00, Fire Detection and Alarm.

1.2 DEFINITION

- A. Algorithm: A logical procedure for solving a recurrent mathematical problem; A prescribed set of well-defined rules or processes for the solution of a problem in a finite number of steps.
- B. ARCNET: ANSI/ATA 878.1 - Attached Resource Computer Network. ARCNET is a deterministic LAN technology; meaning it's possible to determine the maximum delay before a device is able to transmit a message.
- C. Analog: A continuously varying signal value (e.g., temperature, current, velocity etc).

- D. BACnet: A Data Communication Protocol for Building Automation and Control Networks , ANSI/ASHRAE Standard 135. This communications protocol allows diverse building automation devices to communicate data over and services over a network.
- E. BACnet/IP: Annex J of Standard 135. It defines and allows for using a reserved UDP socket to transmit BACnet messages over IP networks. A BACnet/IP network is a collection of one or more IP sub-networks that share the same BACnet network number.
- F. BACnet Internetwork: Two or more BACnet networks connected with routers. The two networks may sue different LAN technologies.
- G. BACnet Network: One or more BACnet segments that have the same network address and are interconnected by bridges at the physical and data link layers.
- H. BACnet Segment: One or more physical segments of BACnet devices on a BACnet network, connected at the physical layer by repeaters.
- I. BACnet Broadcast Management Device (BBMD): A communications device which broadcasts BACnet messages to all BACnet/IP devices and other BBMDs connected to the same BACnet/IP network.
- J. BACnet Interoperability Building Blocks (BIBBs): BACnet Interoperability Building Blocks (BIBBs) are collections of one or more BACnet services. These are prescribed in terms of an "A" and a "B" device. Both of these devices are nodes on a BACnet internetwork.
- K. BACnet Testing Laboratories (BTL). The organization responsible for testing products for compliance with the BACnet standard, operated under the direction of BACnet International.
- L. Baud: It is a signal change in a communication link. One signal change can represent one or more bits of information depending on type of transmission scheme. Simple peripheral communication is normally one bit per Baud. (e.g., Baud rate = 78,000 Baud/sec is 78,000 bits/sec, if one signal change = 1 bit).
- M. Binary: A two-state system where a high signal level represents an "ON" condition and an "OFF" condition is represented by a low signal level.
- N. BMP or bmp: Suffix, computerized image file, used after the period in a DOS-based computer file to show that the file is an image stored as a series of pixels.
- O. Bus Topology: A network topology that physically interconnects workstations and network devices in parallel on a network segment.

- P. Control Unit (CU): Generic term for any controlling unit, stand-alone, microprocessor based, digital controller residing on secondary LAN or Primary LAN, used for local controls or global controls
- Q. Deadband: A temperature range over which no heating or cooling is supplied, i.e., 22-25 degrees C (72-78 degrees F), as opposed to a single point change over or overlap).
- R. Device: a control system component that contains a BACnet Device Object and uses BACnet to communicate with other devices.
- S. Device Object: Every BACnet device requires one Device Object, whose properties represent the network visible properties of that device. Every Device Object requires a unique Object Identifier number on the BACnet internetwork. This number is often referred to as the device instance.
- T. Device Profile: A specific group of services describing BACnet capabilities of a device, as defined in ASHRAE Standard 135-2008, Annex L. Standard device profiles include BACnet Operator Workstations (B-OWS), BACnet Building Controllers (B-BC), BACnet Advanced Application Controllers (B-AAC), BACnet Application Specific Controllers (B-ASC), BACnet Smart Actuator (B-SA), and BACnet Smart Sensor (B-SS). Each device used in new construction is required to have a PICS statement listing which service and BIBBs are supported by the device.
- U. Diagnostic Program: A software test program, which is used to detect and report system or peripheral malfunctions and failures. Generally, this system is performed at the initial startup of the system.
- V. Direct Digital Control (DDC): Microprocessor based control including Analog/Digital conversion and program logic. A control loop or subsystem in which digital and analog information is received and processed by a microprocessor, and digital control signals are generated based on control algorithms and transmitted to field devices in order to achieve a set of predefined conditions.
- W. Distributed Control System: A system in which the processing of system data is decentralized and control decisions can and are made at the subsystem level. System operational programs and information are provided to the remote subsystems and status is reported back to the Engineering Control Center. Upon the loss of communication with the Engineering Control center, the subsystems shall be capable of operating in a stand-alone mode using the last best available data.

- X. Download: The electronic transfer of programs and data files from a central computer or operation workstation with secondary memory devices to remote computers in a network (distributed) system.
- Y. DXF: An AutoCAD 2-D graphics file format. Many CAD systems import and export the DXF format for graphics interchange.
- Z. Electrical Control: A control circuit that operates on line or low voltage and uses a mechanical means, such as a temperature sensitive bimetal or bellows, to perform control functions, such as actuating a switch or positioning a potentiometer.
- AA. Electronic Control: A control circuit that operates on low voltage and uses a solid-state components to amplify input signals and perform control functions, such as operating a relay or providing an output signal to position an actuator.
- BB. Engineering Control Center (ECC): The centralized control point for the intelligent control network. The ECC comprises of personal computer and connected devices to form a single workstation.
- CC. Ethernet: A trademark for a system for exchanging messages between computers on a local area network using coaxial, fiber optic, or twisted-pair cables.
- DD. Firmware: Firmware is software programmed into read only memory (ROM) chips. Software may not be changed without physically altering the chip.
- EE. Gateway: Communication hardware connecting two or more different protocols. It translates one protocol into equivalent concepts for the other protocol. In BACnet applications, a gateway has BACnet on one side and non-BACnet (usually proprietary) protocols on the other side.
- FF. GIF: Abbreviation of Graphic interchange format.
- GG. Graphic Program (GP): Program used to produce images of air handler systems, fans, chillers, pumps, and building spaces. These images can be animated and/or color-coded to indicate operation of the equipment.
- HH. Graphic Sequence of Operation: It is a graphical representation of the sequence of operation, showing all inputs and output logical blocks.
- II. I/O Unit: The section of a digital control system through which information is received and transmitted. I/O refers to analog input (AI, digital input (DI), analog output (AO) and digital output (DO). Analog signals are continuous and represent temperature, pressure, flow rate etc, whereas digital signals convert electronic signals to digital

pulses (values), represent motor status, filter status, on-off equipment etc.

- JJ. I/P: a method for conveying and routing packets of information over LAN paths. User Datagram Protocol (UDP) conveys information to "sockets" without confirmation of receipt. Transmission Control Protocol (TCP) establishes "sessions", which have end-to-end confirmation and guaranteed sequence of delivery.
- KK. JPEG: A standardized image compression mechanism stands for Joint Photographic Experts Group, the original name of the committee that wrote the standard.
- LL. Local Area Network (LAN): A communication bus that interconnects operator workstation and digital controllers for peer-to-peer communications, sharing resources and exchanging information.
- MM. Network Repeater: A device that receives data packet from one network and rebroadcasts to another network. No routing information is added to the protocol.
- NN. MS/TP: Master-slave/token-passing (ISO/IEC 8802, Part 3). It is not an acceptable LAN option for VA health-care facilities. It uses twisted-pair wiring for relatively low speed and low cost communication.
- OO. Native BACnet Device: A device that uses BACnet as its primary method of communication with other BACnet devices without intermediary gateways. A system that uses native BACnet devices at all levels is a native BACnet system.
- PP. Network Number: A site-specific number assigned to each network segment to identify for routing. This network number must be unique throughout the BACnet internetwork.
- QQ. Object: The concept of organizing BACnet information into standard components with various associated properties. Examples include analog input objects and binary output objects.
- RR. Object Identifier: An object property used to identify the object, including object type and instance. Object Identifiers must be unique within a device.
- SS. Object Properties: Attributes of an object. Examples include present value and high limit properties of an analog input object. Properties are defined in ASHRAE 135; some are optional and some are required. Objects are controlled by reading from and writing to object properties.

- TT. Operating system (OS): Software, which controls the execution of computer application programs.
- UU. PCX: File type for an image file. When photographs are scanned onto a personal computer they can be saved as PCX files and viewed or changed by a special application program as Photo Shop.
- VV. Peripheral: Different components that make the control system function as one unit. Peripherals include monitor, printer, and I/O unit.
- WW. Peer-to-Peer: A networking architecture that treats all network stations as equal partners- any device can initiate and respond to communication with other devices.
- XX. PICS: Protocol Implementation Conformance Statement, describing the BACnet capabilities of a device. All BACnet devices have published PICS.
- YY. PID: Proportional, integral, and derivative control, used to control modulating equipment to maintain a setpoint.
- ZZ. Repeater: A network component that connects two or more physical segments at the physical layer.
- AAA. Router: a component that joins together two or more networks using different LAN technologies. Examples include joining a BACnet Ethernet LAN to a BACnet MS/TP LAN.
- BBB. Sensors: devices measuring state points or flows, which are then transmitted back to the DDC system.
- CCC. Thermostats : devices measuring temperatures, which are used in control of standalone or unitary systems and equipment not attached to the DDC system.

1.4 QUALITY ASSURANCE

A. Criteria:

1. Single Source Responsibility of subcontractor: The Contractor shall obtain hardware and software supplied under this Section and delegate the responsibility to a single source controls installation subcontractor. The controls subcontractor shall be responsible for the complete design, installation, and commissioning of the system. The controls subcontractor shall be in the business of design, installation and service of such building automation control systems similar in size and complexity.
2. Equipment and Materials: Equipment and materials shall be cataloged products of manufacturers regularly engaged in production and installation of HVAC control systems. Products shall be

manufacturer's latest standard design and have been tested and proven in actual use.

3. The controls subcontractor shall provide a list of no less than five similar projects which have building control systems as specified in this Section. These projects must be on-line and functional such that the Department of Veterans Affairs (VA) representative would observe the control systems in full operation.
4. The controls subcontractor shall have in-place facility within 50 miles with technical staff, spare parts inventory for the next five (5) years, and necessary test and diagnostic equipment to support the control systems.
5. The controls subcontractor shall have minimum of three years experience in design and installation of building automation systems similar in performance to those specified in this Section. Provide evidence of experience by submitting resumes of the project manager, the local branch manager, project engineer, the application engineering staff, and the electronic technicians who would be involved with the supervision, the engineering, and the installation of the control systems. Training and experience of these personnel shall not be less than three years. Failure to disclose this information will be a ground for disqualification of the supplier.
6. Provide a competent and experienced Project Manager employed by the Controls Contractor. The Project Manager shall be supported as necessary by other Contractor employees in order to provide professional engineering, technical and management service for the work. The Project Manager shall attend scheduled Project Meetings as required and shall be empowered to make technical, scheduling and related decisions on behalf of the Controls Contractor.

B. Codes and Standards:

1. All work shall conform to the applicable Codes and Standards.
2. Electronic equipment shall conform to the requirements of FCC Regulation, Part 15, Governing Radio Frequency Electromagnetic Interference, and be so labeled.

1.5 PERFORMANCE

A. The system shall conform to the following:

1. Graphic Display: The system shall display up to four (4) graphics on a single screen with a minimum of twenty (20) dynamic points per

- graphic. All current data shall be displayed within ten (10) seconds of the request.
2. Graphic Refresh: The system shall update all dynamic points with current data within eight (8) seconds. Data refresh shall be automatic, without operator intervention.
 3. Object Command: The maximum time between the command of a binary object by the operator and the reaction by the device shall be two(2) seconds. Analog objects shall start to adjust within two (2) seconds.
 4. Object Scan: All changes of state and change of analog values shall be transmitted over the high-speed network such that any data used or displayed at a controller or work-station will be current, within the prior six (6) seconds.
 5. Alarm Response Time: The maximum time from when an object goes into alarm to when it is annunciated at the workstation shall not exceed (10) seconds.
 6. Program Execution Frequency: Custom and standard applications shall be capable of running as often as once every (5) seconds. The Contractor shall be responsible for selecting execution times consistent with the mechanical process under control.
 7. Multiple Alarm Annunciations: All workstations on the network shall receive alarms within five (5) seconds of each other.
 8. Performance: Programmable Controllers shall be able to execute DDC PID control loops at a selectable frequency from at least once every one (1) second. The controller shall scan and update the process value and output generated by this calculation at this same frequency.
 9. Reporting Accuracy: Listed below are minimum acceptable reporting end-to-end accuracies for all values reported by the specified system:

Measured Variable	Reported Accuracy
Space temperature	$\pm 0.5^{\circ}\text{C}$ ($\pm 1^{\circ}\text{F}$)
Ducted air temperature	$\pm 0.5^{\circ}\text{C}$ [$\pm 1^{\circ}\text{F}$]
Outdoor air temperature	$\pm 1.0^{\circ}\text{C}$ [$\pm 2^{\circ}\text{F}$]
Dew Point	$\pm 1.5^{\circ}\text{C}$ [$\pm 3^{\circ}\text{F}$]
Water temperature	$\pm 0.5^{\circ}\text{C}$ [$\pm 1^{\circ}\text{F}$]
Relative humidity	$\pm 2\%$ RH

Water flow	±1% of reading
Air flow (terminal)	±10% of reading
Air flow (measuring stations)	±5% of reading
Carbon Monoxide (CO)	±5% of reading
Carbon Dioxide (CO ₂)	±50 ppm
Air pressure (ducts)	±25 Pa [±0.1"w.c.]
Air pressure (space)	±0.3 Pa [±0.001"w.c.]
Water pressure	±2% of full scale *Note 1
Electrical Power	±0.5% of reading

Note 1: for both absolute and differential pressure

10. Control stability and accuracy: Control sequences shall maintain measured variable at setpoint within the following tolerances:

Controlled Variable	Control Accuracy	Range of Medium
Air Pressure	±50 Pa (±0.2 in. w.g.)	0-1.5 kPa (0-6 in. w.g.)
Air Pressure	±3 Pa (±0.01 in. w.g.)	-25 to 25 Pa (-0.1 to 0.1 in. w.g.)
Airflow	±10% of full scale	
Space Temperature	±1.0°C (±2.0°F)	
Duct Temperature	±1.5°C (±3°F)	
Humidity	±5% RH	
Fluid Pressure	±10 kPa (±1.5 psi)	0-1 MPa (1-150 psi)
Fluid Pressure	±250 Pa (±1.0 in. w.g.)	0-12.5 kPa (0-50 in. w.g.) differential

11. Extent of direct digital control: control design shall allow for at least the points indicated on the points lists on the drawings.

1.6 WARRANTY

- A. Labor and materials for control systems shall be warranted for a period as specified under Warranty in FAR clause 52.246-21.
- B. Control system failures during the warranty period shall be adjusted, repaired, or replaced at no cost or reduction in service to the owner. The system includes all computer equipment, transmission equipment, and all sensors and control devices.
- C. The on-line support service shall allow the Controls supplier to dial out over telephone lines to or connect via (through password-limited access) VPN through the internet monitor and control the facility's

building automation system. This remote connection to the facility shall be within two (2) hours of the time that the problem is reported. This coverage shall be extended to include normal business hours, after business hours, weekend and holidays. If the problem cannot be resolved with on-line support services, the Controls supplier shall dispatch the qualified personnel to the job site to resolve the problem within 24 hours after the problem is reported.

- D. Controls and Instrumentation subcontractor shall be responsible for temporary operations and maintenance of the control systems during the construction period until final commissioning, training of facility operators and acceptance of the project by VA.

1.7 SUBMITTALS

- A. Submit shop drawings in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's literature and data for all components including the following:
1. A wiring diagram for each type of input device and output device including DDC controllers, modems, repeaters, etc. Diagram shall show how the device is wired and powered, showing typical connections at the digital controllers and each power supply, as well as the device itself. Show for all field connected devices, including but not limited to, control relays, motor starters, electric or electronic actuators, and temperature pressure, flow and humidity sensors and transmitters.
 2. A diagram of each terminal strip, including digital controller terminal strips, terminal strip location, termination numbers and the associated point names.
 3. Control dampers and control valves schedule, including the size and pressure drop.
 4. Control air-supply components, and computations for sizing compressors, receivers and main air-piping, if pneumatic controls are furnished.
 5. Catalog cut sheets of all equipment used. This includes, but is not limited to software (by manufacturer and by third parties), DDC controllers, panels, peripherals, airflow measuring stations and associated components, and auxiliary control devices such as sensors, actuators, and control dampers. When manufacturer's cut sheets apply to a product series rather than a specific product, the

- data specifically applicable to the project shall be highlighted.
- Each submitted piece of literature and drawings should clearly reference the specification and/or drawings that it supposed to represent.
6. Sequence of operations for each HVAC system and the associated control diagrams. Equipment and control labels shall correspond to those shown on the drawings.
 7. Color prints of proposed graphics with a list of points for display.
 8. Furnish a BACnet Protocol Implementation Conformance Statement (PICS) for each BACnet-compliant device.
 9. Schematic wiring diagrams for all control, communication and power wiring. Provide a schematic drawing of the central system installation. Label all cables and ports with computer manufacturers' model numbers and functions. Show all interface wiring to the control system.
 10. An instrumentation list for each controlled system. Each element of the controlled system shall be listed in table format. The table shall show element name, type of device, manufacturer, model number, and product data sheet number.
 11. Riser diagrams of wiring between central control unit and all control panels.
 12. Scaled plan drawings showing routing of LAN and locations of control panels, controllers, routers, gateways, ECC, and larger controlled devices.
 13. Construction details for all installed conduit, cabling, raceway, cabinets, and similar. Construction details of all penetrations and their protection.
 14. Quantities of submitted items may be reviewed but are the responsibility of the contractor administered by this Section of the technical specifications.
- C. Product Certificates: Compliance with Article, QUALITY ASSURANCE.
- D. Licenses: Provide licenses for all software residing on and used by the Controls Systems and transfer these licenses to the Owner prior to completion.
- E. As Built Control Drawings:
1. Furnish three (3) copies of as-built drawings for each control system. The documents shall be submitted for approval prior to final completion.

2. Furnish one (1) stick set of applicable control system prints for each mechanical system for wall mounting. The documents shall be submitted for approval prior to final completion.
3. Furnish one (1) CD-ROM in CAD DWG and/or .DXF format for the drawings noted in subparagraphs above.

F. Operation and Maintenance (O/M) Manuals):

1. Submit in accordance with Article, INSTRUCTIONS, in Specification Section 01 00 00, GENERAL REQUIREMENTS.
2. Include the following documentation:
 - a. General description and specifications for all components, including logging on/off, alarm handling, producing trend reports, overriding computer control, and changing set points and other variables.
 - b. Detailed illustrations of all the control systems specified for ease of maintenance and repair/replacement procedures, and complete calibration procedures.
 - c. One copy of the final version of all software provided including operating systems, programming language, operator workstation software, and graphics software.
 - d. Complete troubleshooting procedures and guidelines for all systems.
 - e. Complete operating instructions for all systems.
 - f. Recommended preventive maintenance procedures for all system components including a schedule of tasks for inspection, cleaning and calibration. Provide a list of recommended spare parts needed to minimize downtime.
 - g. Training Manuals: Submit the course outline and training material to the Owner for approval three (3) weeks prior to the training to VA facility personnel. These persons will be responsible for maintaining and the operation of the control systems, including programming. The Owner reserves the right to modify any or all of the course outline and training material.
 - h. Licenses, guaranty, and other pertaining documents for all equipment and systems.

- G. Submit Performance Report to Resident Engineer prior to final inspection.

1.8 INSTRUCTIONS

- A. Instructions to VA operations personnel: Perform in accordance with Article, INSTRUCTIONS, in Specification Section 01 00 00, GENERAL REQUIREMENTS, and as noted below.
1. First Phase: Formal instructions to the VA facilities personnel for a total of 16 hours, given in multiple training sessions (each no longer than four hours in length), conducted sometime between the completed installation and prior to the performance test period of the control system, at a time mutually agreeable to the Contractor and the VA.
 2. Second Phase: This phase of training shall comprise of on the job training during start-up, checkout period, and performance test period. VA facilities personnel will work with the Contractor's installation and test personnel on a daily basis during start-up and checkout period. During the performance test period, controls subcontractor will provide 8 hours of instructions, given in multiple training sessions (each no longer than four hours in length), to the VA facilities personnel.
 3. The O/M Manuals shall contain approved submittals as outlined in Article 1.7, SUBMITTALS. The Controls subcontractor will review the manual contents with VA facilities personnel during second phase of training.
 4. Training shall be given by direct employees of the controls system subcontractor.

1.9 PROJECT CONDITIONS (ENVIRONMENTAL CONDITIONS OF OPERATION)

- A. The ECC and peripheral devices and system support equipment shall be designed to operate in ambient condition of 20 to 35°C (65 to 90°F) at a relative humidity of 20 to 80% non-condensing.
- B. The CUs used outdoors shall be mounted in NEMA 4 waterproof enclosures, and shall be rated for operation at -40 to 65°C (-40 to 150°F).
- C. All electronic equipment shall operate properly with power fluctuations of plus 10 percent to minus 15 percent of nominal supply voltage.
- D. Sensors and controlling devices shall be designed to operate in the environment, which they are sensing or controlling.

1.10 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

- B. American Society of Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE):
Standard 135-08.....BACNET Building Automation and Control Networks
- C. American Society of Mechanical Engineers (ASME):
B16.18-05.....Cast Copper Alloy Solder Joint Pressure Fittings.
B16.22-05.....Wrought Copper and Copper Alloy Solder Joint Pressure Fittings.
- D. American Society of Testing Materials (ASTM):
B32-04.....Standard Specification for Solder Metal
B88-03.....Standard Specifications for Seamless Copper Water Tube
B88M-05.....Standard Specification for Seamless Copper Water Tube (Metric)
B280-03.....Standard Specification for Seamless Copper Tube for Air-Conditioning and Refrigeration Field Service
D2737-03.....Standard Specification for Polyethylene (PE) Plastic Tubing
- E. Federal Communication Commission (FCC):
Rules and Regulations Title 47 Chapter 1-2001 Part 15: Radio Frequency Devices.
- F. Institute of Electrical and Electronic Engineers (IEEE):
802.3-05.....Information Technology-Telecommunications and Information Exchange between Systems-Local and Metropolitan Area Networks- Specific Requirements-Part 3: Carrier Sense Multiple Access with Collision Detection (CSMA/CD) Access method and Physical Layer Specifications
- G. National Fire Protection Association (NFPA):
70-08.....National Electric Code
90A-09.....Standard for Installation of Air-Conditioning and Ventilation Systems
- H. Underwriter Laboratories Inc (UL):
94-06.....Tests for Flammability of Plastic Materials for Parts and Devices and Appliances
294-05.....Access Control System Units
486A/486B-04-.....Wire Connectors
555S-06.....Standard for Smoke Dampers
916-07.....Energy Management Equipment
1076-05.....Proprietary Burglar Alarm Units and Systems

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Use new products that the manufacturer is currently manufacturing and that have been installed in a minimum of 25 installations. Spare parts

shall be available for at least five years after completion of this contract.

2.2 CONTROLS SYSTEM ARCHITECTURE

A. General

1. The Controls Systems shall consist of multiple Nodes and associated equipment connected by industry standard digital and communication network arrangements.
2. The ECC, building controllers and principal communications network equipment shall be standard products of recognized major manufacturers available through normal PC and computer vendor channels - not "Clones" assembled by a third-party subcontractor.
3. The networks shall, at minimum, comprise, as necessary, the following:
 - a. A fixed ECC and a portable operator's terminal.
 - b. Network computer processing, data storage and BACnet-compliant communication equipment including Servers and digital data processors.
 - c. BACnet-compliant routers, bridges, switches, hubs, modems, gateways, interfaces and similar communication equipment.
 - d. Active processing BACnet-compliant building controllers connected to other BACnet-compliant controllers together with their power supplies and associated equipment.
 - e. Addressable elements, sensors, transducers and end devices.
 - f. Third-party equipment interfaces and gateways as described and required by the Contract Documents.
 - g. Other components required for a complete and working Control Systems as specified.

- B. The Specifications for the individual elements and component subsystems shall be minimum requirements and shall be augmented as necessary by the Contractor to achieve both compliance with all applicable codes, standards and to meet all requirements of the Contract Documents.

C. Network Architecture

1. The Controls communication network shall utilize BACnet communications protocol operating over a standard Ethernet LAN and operate at a minimum speed of 100 Mb/sec.
2. The networks shall utilize only copper and optical fiber communication media as appropriate and shall comply with applicable codes, ordinances and regulations

3. All necessary telephone lines, ISDN lines and internet Service Provider services and connections will be provided by the VA.

D. Third Party Interfaces:

1. The contractor administered by this Section of the technical specifications shall include necessary hardware, equipment, software and programming to allow data communications between the controls systems and building systems supplied by other trades.
2. Other manufacturers and contractors supplying other associated systems and equipment shall provide their necessary hardware, software and start-up at their cost and shall cooperate fully with the contractor administered by this Section of the technical specifications in a timely manner and at their cost to ensure complete functional integration.

E. Servers:

1. Provide data storage server(s) to archive historical data including trends, alarm and event histories and transaction logs.
2. Equip these server(s) with the same software tool set that is located in the BACnet building controllers for system configuration and custom logic definition and color graphic configuration.
3. Access to all information on the data storage server(s) shall be through the same browser functionality used to access individual nodes. When logged onto a server the operator will be able to also interact with any other controller on the control system as required for the functional operation of the controls systems. The contractor administered by this Section of the technical specifications shall provide all necessary digital processor programmable data storage server(s).
4. These server(s) shall be utilized for controls systems application configuration, for archiving, reporting and trending of data, for operator transaction archiving and reporting, for network information management, for alarm annunciation, for operator interface tasks, for controls application management and similar. These server(s) shall utilize IT industry standard data base platforms such as Microsoft SQL Server and Microsoft Data Engine (MSDE) or approved equal.

2.3 COMMUNICATION

- A. Control products, communication media, connectors, repeaters, hubs, and routers shall comprise a BACnet internetwork. Controller and operator

interface communication shall conform to ANSI/ASHRAE Standard 135-2008, BACnet.

1. The Data link / physical layer protocol (for communication) acceptable to the VA throughout its facilities is Ethernet (ISO 8802-3) and BACnet/IP.
 - 2.
 3. The MS/TP data link / physical layer protocol is not acceptable to the VA in any new BACnet network or sub-network in its healthcare or lab facilities.
- B. Each controller shall have a communication port for connection to an operator interface.
- C. Project drawings indicate remote buildings or sites to be connected by a nominal 56,000 baud modem over voice-grade telephone lines. In each remote location a modem and field device connection shall allow communication with each controller on the internetwork as specified in Paragraph D.
- D. Internetwork operator interface and value passing shall be transparent to internetwork architecture.
1. An operator interface connected to a controller shall allow the operator to interface with each internetwork controller as if directly connected. Controller information such as data, status, reports, system software, and custom programs shall be viewable and editable from each internetwork controller.
 2. Inputs, outputs, and control variables used to integrate control strategies across multiple controllers shall be readable by each controller on the internetwork. Program and test all cross-controller links required to execute specified control system operation. An authorized operator shall be able to edit cross-controller links by typing a standard object address.
- E. System shall be expandable to at least twice the required input and output objects with additional controllers, associated devices, and wiring. Expansion shall not require operator interface hardware additions or software revisions.
- F. ECCs and Controllers with real-time clocks shall use the BACnet Time Synchronization service. The system shall automatically synchronize system clocks daily from an operator-designated device via the internetwork. The system shall automatically adjust for daylight savings and standard time as applicable.

2.4 ENGINEERING CONTROL CENTER (ECC)

- A. The ECC shall reside on a high-speed network with controllers as shown on system drawings. The ECC and each standard browser connected to server shall be able to access all system information.
- B. ECC and controllers shall communicate using BACnet protocol. ECC and control network backbone shall communicate using ISO 8802-3 (Ethernet) Data Link/Physical layer protocol and BACnet/IP addressing as specified in ASHRAE/ANSI 135-2008, BACnet Annex J.
- C. Hardware: ECC shall conform to the BACnet Advanced Workstation (B-AWS) Profile and shall be BTL-Listed as a B-AWS device.
 - 1. ECC shall be commercial standard with supporting 32- or 64-bit hardware (as required by the direct-digital control system software) and software enterprise server. Internet Explorer v6.0 SP1 or higher, Windows Script Hosting version 5.6 or higher, Windows Message Queuing, Windows Internet Information Services (IIS) v5.0 or higher, minimum 2.8 GHz processor, minimum 4GB DDR3 SDRAM (minimum 1333 Mhz) memory, 512 MB video card, and 16 speed high density DVD-RW+/- optical drive.
 - a. The hard drive shall be at the minimum 1 TB 7200 rpm SATA hard drive with 16 MB cache, and shall have sufficient memory to store:
 - 1) All required operator workstation software
 - 2) A DDC database at least twice the size of the delivered system database
 - 3) One year of trend data based on the points specified to be trended at their specified trend intervals.
 - b. Real-time clock:
 - 1) Accuracy: Plus or minus 1 minute per month.
 - 2) Time Keeping Format: 24-hour time format including seconds, minutes, hours, date, day, and month; automatic reset by software.
 - 3) Clock shall function for one year without power.
 - 4) Provide automatic time correction once every 24 hours by synchronizing clock with the Time Service Department of the U.S. Naval Observatory.
 - c. Serial ports: Four USB ports and two RS-232-F serial ports for general use, with additional ports as required. Data transmission rates shall be selectable under program control.

- d. Parallel port: Enhanced.
 - e. Sound card: For playback and recording of digital WAV sound files associated with audible warning and alarm functions.
 - f. Color monitor: PC compatible, not less than 22 inches, LCD type, with a minimum resolution of 1280 by 1024 pixels, noninterlaced, and a maximum dot pitch of 0.28 mm.
 - g. Keyboard: Minimum of 64 characters, standard ASCII character set based on ANSI INCITS 154.
 - h. Mouse: Standard, compatible with installed software.
 - i. Removable disk storage: Include the following, each with appropriate controller:
 - 1) Minimum 1 TB removable hard disk, maximum average access time of 10 ms.
 - j. Network interface card (NIC): integrated 10-100-1000 Base-TX Ethernet NIC with an RJ45 connector or a 100Base-FX Ethernet NIC with an SC/ST connector.
- 2. Cable modem: 42.88 MBit/s, DOCSIS 2.0 Certified, also backwards compatible with DOCSIS 1.1/1.0 standards. Provide Ethernet or USB connectivity.
 - 3. Optical modem: full duplex link, for use on 10 GBase-R single-mode and multi-mode fiber with a XENPAK module.
 - 4. Auto-dial modem: 56,600 bps, full duplex for asynchronous communications. With error detection, auto answer/autodial, and call-in-progress detection. Modem shall comply with requirements in ITU-T v.34, ITU-T v.42, ITU-T v.42 Appendix VI for error correction, and ITU-T v.42 BIS for data compression standards; and shall be suitable for operating on unconditioned voice-grade telephone lines complying with 47 CFR 68.
 - 5. Audible Alarm: Manufacturer's standard.
 - 6. Printers:
 - a. Provide a dedicated, minimum resolution 600 dpi, color laser printer, connected to the ECC through a USB interface.
 - 1) If a network printer is used instead of this dedicated printer, it shall have a 100Base-T interface with an RJ45 connection and shall have a firmware print spooler compatible with the Operating System print spooler.
 - 2) RAM: 512 MB, minimum.

- 3) Printing Speed: Minimum twenty six pages per minute (color); minimum 30 pages per minute (black/white).
 - 4) Paper Handling: Automatic sheet feeder with 250-sheet x 8.5 inch x 11 inch paper cassette and with automatic feed.
 - b. Provide a dedicated black/white tractor-feed dot matrix printer for status/alarm message printing, minimum 10 characters per inch, minimum 160 characters per second, connected to the ECC through a USB interface.
 - 1) Paper: One box of 2000 sheets of 8-1/2x11 multi-fold type printer paper.
7. RS-232 ASCII Interface
- a. ASCII interface shall allow RS-232 connections to be made between a meter or circuit monitor operating as the host PC and any equipment that will accept RS-232 ASCII command strings, such as local display panels, dial-up modems, and alarm transmitters.
 - b. Pager System Interface: Alarms shall be able to activate a pager system with customized message for each input alarm.
 - c. Alarm System Interface: RS-232 output shall be capable of transmitting alarms from other monitoring and alarm systems to workstation software.
 - d. RS-232 output shall be capable of connection to a pager interface that can be used to call a paging system or service and send a signal to a portable pager. System shall allow an individual alphanumeric message per alarm input to be sent to paging system. This interface shall support both numeric and alphanumeric pagers.
 - e. Cables: provide Plenum-Type, RS-232 Cable: Paired, 2 pairs, No. 22 AWG, stranded (7x30) tinned copper conductors, plastic insulation, and individual aluminum foil-polyester tape shielded pairs with 100 percent shield coverage; plastic jacket. Pairs are cabled on common axis with No. 24 AWG, stranded (7x32) tinned copper drain wire.
 - 1) NFPA 70, Type CMP.
 - 2) Flame Resistance: NFPA 262, Flame Test.
8. Self-contained uninterruptible power supply (UPS):
- a. Size: Provide a minimum of six hours of operation of ECC equipment, including two hours of alarm printer operation.
 - b. Batteries: Sealed, valve regulated, recombinant, lead calcium.

c. Accessories:

- 1) Transient voltage suppression.
- 2) Input-harmonics reduction.
- 3) Rectifier/charger.
- 4) Battery disconnect device.
- 5) Static bypass transfer switch.
- 6) Internal maintenance bypass/isolation switch.
- 7) External maintenance bypass/isolation switch.
- 8) Output isolation transformer.
- 9) Remote UPS monitoring.
- 10) Battery monitoring.
- 11) Remote battery monitoring.

D. ECC Software:

1. Provide for automatic system database save and restore on the ECC's hard disk a copy of the current database of each Controller. This database shall be updated whenever a change is made in any system panel. In the event of a database loss in a building management panel, the ECC shall automatically restore the database for that panel. This capability may be disabled by the operator.
2. Provide for manual database save and restore. An operator with proper clearance shall be able to save the database from any system panel. The operator also shall be able to clear a panel database and manually initiate a download of a specified database to any panel in the system.
3. Provide a method of configuring the system. This shall allow for future system changes or additions by users with proper clearance.
4. Operating System. Furnish a concurrent multi-tasking operating system. The operating system also shall support the use of other common software applications. Acceptable operating systems are Windows XP, Windows System 7, Linux, and UNIX.
5. System Graphics. The operator workstation software shall be graphically oriented. The system shall allow display of up to 10 graphic screens at once for comparison and monitoring of system status. Provide a method for the operator to easily move between graphic displays and change the size and location of graphic displays on the screen. The system graphics shall be able to be modified while on-line. An operator with the proper password level shall be able to add, delete, or change dynamic objects on a

- graphic. Dynamic objects shall include analog and binary values, dynamic text, static text, and animation files. Graphics shall have the ability to show animation by shifting image files based on the status of the object.
6. Custom Graphics. Custom graphic files shall be created with the use of a graphics generation package furnished with the system. The graphics generation package shall be a graphically based system that uses the mouse to create and modify graphics that are saved in industry standard formats such as PCX, TIFF, and GEM. The graphics generation package also shall provide the capability of capturing or converting graphics from other programs such as Designer or AutoCAD.
 7. Graphics Library. Furnish a complete library of standard HVAC equipment graphics such as chillers, boilers, air handlers, terminals, fan coils, and unit ventilators. This library also shall include standard symbols for other equipment including fans, pumps, coils, valves, piping, dampers, and ductwork. The library shall be furnished in a file format compatible with the graphics generation package program.
 8. The Controls Systems Operator Interfaces shall be user friendly, readily understood and shall make maximum use of colors, graphics, icons, embedded images, animation, text based information and data visualization techniques to enhance and simplify the use and understanding of the displays by authorized users at the ECC. The operating system shall be Windows XP or better, and shall support the third party software.
 9. Provide graphical user software, which shall minimize the use of keyboard through the use of the mouse and "point and click" approach to menu selection.
 10. The software shall provide a multi-tasking type environment that will allow the user to run several applications simultaneously. The mouse or Alt-Tab keys shall be used to quickly select and switch between multiple applications. The operator shall be able automatically export data to and work in Microsoft Word, Excel, and other Windows based software programs, while concurrently on-line system alarms and monitoring information.
 11. On-Line Help. Provide a context-sensitive, on-line help system to assist the operator in operating and editing the system. On-line help shall be available for all applications and shall provide the

- relevant data for that particular screen. Additional help information shall be available through the use of hypertext.
12. User access shall be protected by a flexible and Owner re-definable software-based password access protection. Password protection shall be multi-level and partition able to accommodate the varied access requirements of the different user groups to which individual users may be assigned. Provide the means to define unique access privileges for each individual authorized user. Provide the means to on-line manage password access control under the control of a project specific Master Password. Provide an audit trail of all user activity on the Controls Systems including all actions and changes.
 13. The system shall be completely field-programmable from the common operator's keyboard thus allowing hard disk storage of all data automatically. All programs for the CUs shall be able to be downloaded from the hard disk. The software shall provide the following functionality as a minimum:
 - a. Point database editing, storage and downloading of controller databases.
 - b. Scheduling and override of building environmental control systems.
 - c. Collection and analysis of historical data.
 - d. Alarm reporting, routing, messaging, and acknowledgement.
 - e. Definition and construction of dynamic color graphic displays.
 - f. Real-time graphical viewing and control of environment.
 - g. Scheduling trend reports.
 - h. Program editing.
 - i. Operating activity log and system security.
 - j. Transfer data to third party software.
 14. Provide functionality such that using the least amount of steps to initiate the desired event may perform any of the following simultaneously:
 - a. Dynamic color graphics and graphic control.
 - b. Alarm management.
 - c. Event scheduling.
 - d. Dynamic trend definition and presentation.
 - e. Program and database editing.
 - f. Each operator shall be required to log on to the system with a user name and password to view, edit or delete the data. System

security shall be selectable for each operator, and the password shall be able to restrict the operator's access for viewing and changing the system programs. Each operator shall automatically be logged off the system if no keyboard or mouse activity is detected for a selected time.

15. Graphic Displays:

- a. The workstation shall allow the operator to access various system schematics and floor plans via a graphical penetration scheme, menu selection, or text based commands. Graphic software shall permit the importing of AutoCAD or scanned pictures in the industry standard format (such as PCX, BMP, GIF, and JPEG) for use in the system.
- b. System Graphics shall be project specific and schematically correct for each system. (ie: coils, fans, dampers located per equipment supplied with project.) Standard system graphics that do not match equipment or system configurations are not acceptable. Operator shall have capability to manually operate the entire system from each graphic screen at the ECC. Each system graphic shall include a button/tab to a display of the applicable sequence of operation.
- c. Dynamic temperature values, humidity values, flow rates, and status indication shall be shown in their locations and shall automatically update to represent current conditions without operator intervention and without pre-defined screen refresh values.
- d. Color shall be used to indicate status and change in status of the equipment. The state colors shall be user definable.
- e. A clipart library of HVAC equipment, such as chillers, boilers, air handling units, fans, terminal units, pumps, coils, standard ductwork, piping, valves and laboratory symbols shall be provided in the system. The operator shall have the ability to add custom symbols to the clipart library.
- f. A dynamic display of the site-specific architecture showing status of the controllers, the ECC and network shall be provided.
- g. The windowing environment of the workstation shall allow the user to simultaneously view several applications at a time to analyze total building operation or to allow the display of graphic associated with an alarm to be viewed without interrupting work

in progress. The graphic system software shall also have the capability to split screen, half portion of the screen with graphical representation and the other half with sequence of operation of the same HVAC system.

16. Trend reports shall be generated on demand or pre-defined schedule and directed to monitor display, printers or disk. As a minimum, the system shall allow the operator to easily obtain the following types of reports:
 - a. A general list of all selected points in the network.
 - b. List of all points in the alarm.
 - c. List of all points in the override status.
 - d. List of all disabled points.
 - e. List of all points currently locked out.
 - f. List of user accounts and password access levels.
 - g. List of weekly schedules.
 - h. List of holiday programming.
 - i. List of limits and dead bands.
 - j. Custom reports.
 - k. System diagnostic reports, including, list of digital controllers on the network.
 - l. List of programs.
17. ASHRAE Standard 147 Report: Provide a daily report that shows the operating condition of each chiller as recommended by ASHRAE Standard 147. At a minimum, this report shall include:
 - a. Chilled water (or other secondary coolant) inlet and outlet temperature
 - b. Chilled water (or other secondary coolant) flow
 - c. Chilled water (or other secondary coolant) inlet and outlet pressures
 - d. Evaporator refrigerant pressure and temperature
 - e. Condenser refrigerant pressure and liquid temperature
 - f. Condenser water inlet and outlet temperatures
 - g. Condenser water flow
 - h. Refrigerant levels
 - i. Oil pressure and temperature
 - j. Oil level
 - k. Compressor refrigerant discharge temperature
 - l. Compressor refrigerant suction temperature

- m. Addition of refrigerant
 - n. Addition of oil
 - o. Vibration levels or observation that vibration is not excessive
 - p. Motor amperes per phase
 - q. Motor volts per phase
 - r. PPM refrigerant monitor level
 - s. Purge exhaust time or discharge count
 - t. Ambient temperature (dry-bulb and wet-bulb)
 - u. Date and time logged
18. Electrical, Gas, and Weather Reports
- a. Electrical Meter Report: Provide a monthly report showing the daily electrical consumption and peak electrical demand with time and date stamp for each building meter.
 - b. Provide an annual (12-month) summary report showing the monthly electrical consumption and peak demand with time and date stamp for each meter.
 - c. Gas Meter Report: Provide a monthly report showing the daily natural gas consumption for each meter. Provide an annual (12-month) report that shows the monthly consumption for each meter.
 - d. Weather Data Report: Provide a monthly report showing the daily minimum, maximum, and average outdoor air temperature, as well as the number of heating and cooling degree-days for each day. Provide an annual (12-month) report showing the minimum, maximum, and average outdoor air temperature for the month, as well as the number of heating and cooling degree-days for the month.
19. Scheduling and Override:
- a. Provide override access through menu selection from the graphical interface and through a function key.
 - b. Provide a calendar type format for time-of-day scheduling and overrides of building control systems. Schedules reside in the ECC. The digital controllers shall ensure equipment time scheduling when the ECC is off-line. The ECC shall not be required to execute time scheduling. Provide the following spreadsheet graphics as a minimum:
 - 1) Weekly schedules.
 - 2) Zone schedules, minimum of 100 zones.
 - 3) Scheduling up to 365 days in advance.
 - 4) Scheduled reports to print at workstation.

20. Collection and Analysis of Historical Data:

- a. Provide trending capabilities that will allow the operator to monitor and store records of system activity over an extended period of time. Points may be trended automatically on time based intervals or change of value, both of which shall be user definable. The trend interval could be five (5) minutes to 120 hours. Trend data may be stored on hard disk for future diagnostic and reporting. Additionally trend data may be archived to network drives or removable disk media for off-site retrieval.
- b. Reports may be customized to include individual points or predefined groups of at least six points. Provide additional functionality to allow pre-defined groups of up to 250 trended points to be easily accessible by other industry standard word processing and spreadsheet packages. The reports shall be time and date stamped and shall contain a report title and the name of the facility.
- c. System shall have the set up to generate spreadsheet reports to track energy usage and cost based on weekly or monthly interval, equipment run times, equipment efficiency, and/or building environmental conditions.
- d. Provide additional functionality that will allow the operator to view real time trend data on trend graph displays. A minimum of 20 points may be graphed regardless of whether they have been predefined for trending. In addition, the user may pause the graph and take snapshots of the screens to be stored on the workstation disk for future reference and trend analysis. Exact point values may be viewed and the graph may be printed. Operator shall be able to command points directly on the trend plot by double clicking on the point.

21. Alarm Management:

- a. Alarm routing shall allow the operator to send alarm notification to selected printers or operator workstation based on time of day, alarm severity, or point type.
- b. Alarm notification shall be provided via two alarm icons, to distinguish between routine, maintenance type alarms and critical alarms. The critical alarms shall display on the screen at the time of its occurrence, while others shall display by clicking on their icon.

- c. Alarm display shall list the alarms with highest priority at the top of the display. The alarm display shall provide selector buttons for display of the associated point graphic and message in English language. The operator shall be able to sort out the alarms.
 - d. Alarm messages shall be customized for each point to display detailed instructions to the operator regarding actions to take in the event of an alarm.
 - e. An operator with proper security level access may acknowledge and clear the alarm. All that have not been cleared shall be archived at workstation disk.
22. Remote Communications: The system shall have the ability to dial out in the event of an alarm. Receivers shall include operator workstations, e-mail addresses, and alpha-numeric pagers. The alarm message shall include the name of the calling location, the device that generated the alarm, and the alarm message itself.
23. System Configuration:
- a. Network control strategies shall not be restricted to a single digital controller, but shall be able to include data from all other network devices to allow the development of global control strategies.
 - b. Provide automatic backup and restore of all digital controller databases on the workstation hard disk. In addition to all backup data, all databases shall be performed while the workstation is on-line without disturbing other system operations.

2.5 PORTABLE OPERATOR'S TERMINAL (POT)

- A. Provide a portable operator's terminal (POT) that shall be capable of accessing all system data. POT may be connected to any point on the system network or may be connected directly to any controller for programming, setup, and troubleshooting. POT shall communicate using BACnet protocol. POT may be connected to any point on the system network or it may be connected directly to controllers using the BACnet PTP (Point-To-Point) Data Link/ Physical layer protocol. The terminal shall use the Read (Initiate) and Write (Execute) BACnet Services. POT shall be an IBM-compatible notebook-style PC including all software and hardware required.
- B. Hardware: POT shall conform to the BACnet Advanced Workstation (B-AWS) Profile and shall be BTL-Listed as a B-AWS device.

1. POT shall be commercial standard with supporting 32- or 64-bit hardware (as limited by the direct-digital control system software) and software enterprise server. Internet Explorer v6.0 SP1 or higher, Windows Script Hosting version 5.6 or higher, Windows Message Queuing, Windows Internet Information Services (IIS) v5.0 or higher, minimum 2.8 GHz processor, minimum 500 GB 7200 rpm SATA hard drive with 16 MB cache, minimum 2GB DDR3 SDRAM (minimum 1333 Mhz) memory, 512 MB video card, minimum 16 inch (diagonal) screen, 10-100-1000 Base-TX Ethernet NIC with an RJ45 connector or a 100Base-FX Ethernet NIC with an SC/ST connector, 56,600 bps modem, an ASCII RS-232 interface, and a 16 speed high density DVD-RW+/- optical drive.

C. Software: POT shall include software equal to the software on the ECC.

2.6 BACNET PROTOCOL ANALYZER

- A. For ease of troubleshooting and maintenance, provide a BACnet protocol analyzer. Provide its associated fittings, cables and appurtenances, for connection to the communications network. The BACnet protocol analyzer shall be able to, at a minimum: capture and store to a file all data traffic on all network levels; measure bandwidth usage; filter out (ignore) selected traffic.

2.7 NETWORK AND DEVICE NAMING CONVENTION

A. Network Numbers

1. BACnet network numbers shall be based on a "facility code, network" concept. The "facility code" is the VAMC's or VA campus' assigned numeric value assigned to a specific facility or building. The "network" typically corresponds to a "floor" or other logical configuration within the building. BACnet allows 65535 network numbers per BACnet internet work.
2. The network numbers are thus formed as follows: "Net #" = "FFFNN" where:
 - a. FFF = Facility code (see below)
 - b. NN = 00-99 This allows up to 100 networks per facility or building

B. Device Instances

1. BACnet allows 4194305 unique devices instances per BACnet internet work. Using Agency's unique device instances are formed as follows: "Dev #" = "FFFNNDD" where
 - a. FFF and N are as above and
 - b. DD = 00-99, this allows up to 100 devices per network.

2. Note Special cases, where the network architecture of limiting device numbering to DD causes excessive subnet works. The device number can be expanded to DDD and the network number N can become a single digit. In NO case shall the network number N and the device number D exceed 4 digits.
3. Facility code assignments:
4. 000-400 Building/facility number
5. Note that some facilities have a facility code with an alphabetic suffix to denote wings, related structures, etc. The suffix will be ignored. Network numbers for facility codes above 400 will be assigned in the range 000-399.

C. Device Names

1. Name the control devices based on facility name, location within a facility, the system or systems that the device monitors and/or controls, or the area served. The intent of the device naming is to be easily recognized. Names can be up to 254 characters in length, without embedded spaces. Provide the shortest descriptive, but unambiguous, name. For example, in building #123 prefix the number with a "B" followed by the building number, if there is only one chilled water pump "CHWP-1", a valid name would be "B123.CHWP.1.STARTSTOP". If there are two pumps designated "CHWP-1", one in a basement mechanical room (Room 0001) and one in a penthouse mechanical room (Room PH01), the names could be "B123.R0001.CHWP.1.STARTSTOP " or " B123.RPH01.CHWP.1.STARTSTOP". In the case of unitary controllers, for example a VAV box controller, a name might be "B123.R101.VAV". These names should be used for the value of the "Object_Name" property of the BACnet Device objects of the controllers involved so that the BACnet name and the EMCS name are the same.

2.8 BACNET DEVICES

- A. All BACnet Devices - controllers, gateways, routers, actuators and sensors shall conform to BACnet Device Profiles and shall be BACnet Testing Laboratories (BTL) -Listed as conforming to those Device Profiles. Protocol Implementation Conformance Statements (PICs), describing the BACnet capabilities of the Devices shall be published and available of the Devices through links in the BTL website.
1. BACnet Building Controllers, historically referred to as NACs, shall conform to the BACnet B-BC Device Profile, and shall be BTL-Listed

- as conforming to the B-BC Device Profile. The Device's PICS shall be submitted.
2. BACnet Advanced Application Controllers shall conform to the BACnet B-AAC Device Profile, and shall be BTL-Listed as conforming to the B-AAC Device Profile. The Device's PICS shall be submitted.
 3. BACnet Application Specific Controllers shall conform to the BACnet B-ASC Device Profile, and shall be BTL-Listed as conforming to the B-ASC Device Profile. The Device's PICS shall be submitted.
 4. BACnet Smart Actuators shall conform to the BACnet B-SA Device Profile, and shall be BTL-Listed as conforming to the B-SA Device Profile. The Device's PICS shall be submitted.
 5. BACnet Smart Sensors shall conform to the BACnet B-SS Device Profile, and shall be BTL-Listed as conforming to the B-SS Device Profile. The Device's PICS shall be submitted.
 6. BACnet routers and gateways shall conform to the BACnet B-OTH Device Profile, and shall be BTL-Listed as conforming to the B-OTH Device Profile. The Device's PICS shall be submitted.

2.9 CONTROLLERS

- A. General. Provide an adequate number of BTL-Listed B-BC building controllers and an adequate number of BTL-Listed B-AAC advanced application controllers to achieve the performance specified in the Part 1 Article on "System Performance." Each of these controllers shall meet the following requirements.
1. The controller shall have sufficient memory to support its operating system, database, and programming requirements.
 2. The building controller shall share data with the ECC and the other networked building controllers. The advanced application controller shall share data with its building controller and the other networked advanced application controllers.
 3. The operating system of the controller shall manage the input and output communication signals to allow distributed controllers to share real and virtual object information and allow for central monitoring and alarms.
 4. Controllers that perform scheduling shall have a real-time clock.
 5. The controller shall continually check the status of its processor and memory circuits. If an abnormal operation is detected, the controller shall:
 - a. assume a predetermined failure mode, and

- b. generate an alarm notification.
- 6. The controller shall communicate with other BACnet devices on the internetwork using the BACnet Read (Execute and Initiate) and Write (Execute and Initiate) Property services.
- 7. Communication.
 - a. Each controller shall reside on a BACnet network using the ISO 8802-3 (Ethernet) Data Link/Physical layer protocol for its communications. Each building controller also shall perform BACnet routing if connected to a network of custom application and application specific controllers.
 - b. The controller shall provide a service communication port using BACnet Data Link/Physical layer protocol for connection to a portable operator's terminal.
- 8. Keypad. A local keypad and display shall be provided for each controller. The keypad shall be provided for interrogating and editing data. Provide a system security password shall be available to prevent unauthorized use of the keypad and display.
- 9. Serviceability. Provide diagnostic LEDs for power, communication, and processor. All wiring connections shall be made to field-removable, modular terminal strips or to a termination card connected by a ribbon cable.
- 10. Memory. The controller shall maintain all BIOS and programming information in the event of a power loss for at least 72 hours.
- 11. The controller shall be able to operate at 90% to 110% of nominal voltage rating and shall perform an orderly shutdown below 80% nominal voltage. Controller operation shall be protected against electrical noise of 5 to 120 Hz and from keyed radios up to 5 W at 1 m (3 ft).
- B. Provide BTL-Listed B-ASC application specific controllers for each piece of equipment for which they are constructed. Application specific controllers shall communicate with other BACnet devices on the internetwork using the BACnet Read (Execute) Property service.
 - 1. Each B-ASC shall be capable of stand-alone operation and shall continue to provide control functions without being connected to the network.
 - 2. Each B-ASC will contain sufficient I/O capacity to control the target system.
 - 3. Communication.

- a. Each controller shall reside on a BACnet network using the ISO 8802-3 (Ethernet) Data Link/Physical layer protocol for its communications. Each building controller also shall perform BACnet routing if connected to a network of custom application and application specific controllers.
- b. Each controller shall have a BACnet Data Link/Physical layer compatible connection for a laptop computer or a portable operator's tool. This connection shall be extended to a space temperature sensor port where shown.
4. Serviceability. Provide diagnostic LEDs for power, communication, and processor. All wiring connections shall be made to field-removable, modular terminal strips or to a termination card connected by a ribbon cable.
5. Memory. The application specific controller shall use nonvolatile memory and maintain all BIOS and programming information in the event of a power loss.
6. Immunity to power and noise. Controllers shall be able to operate at 90% to 110% of nominal voltage rating and shall perform an orderly shutdown below 80%. Operation shall be protected against electrical noise of 5-120 Hz and from keyed radios up to 5 W at 1 m (3 ft).
7. Transformer. Power supply for the ASC must be rated at a minimum of 125% of ASC power consumption and shall be of the fused or current limiting type.

C. Direct Digital Controller Software

1. The software programs specified in this section shall be commercially available, concurrent, multi-tasking operating system and support the use of software application that operates under DOS or Microsoft Windows.
2. All points shall be identified by up to 30-character point name and 16-character point descriptor. The same names shall be used at the ECC.
3. All control functions shall execute within the stand-alone control units via DDC algorithms. The VA shall be able to customize control strategies and sequences of operations defining the appropriate control loop algorithms and choosing the optimum loop parameters.
4. All controllers shall be capable of being programmed to utilize stored default values for assured fail-safe operation of critical processes. Default values shall be invoked upon sensor failure or,

- if the primary value is normally provided by the central or another CU, or by loss of bus communication. Individual application software packages shall be structured to assume a fail-safe condition upon loss of input sensors. Loss of an input sensor shall result in output of a sensor-failed message at the ECC. Each ACU and RCU shall have capability for local readouts of all functions. The UCUs shall be read remotely.
5. All DDC control loops shall be able to utilize any of the following control modes:
 - a. Two position (on-off, slow-fast) control.
 - b. Proportional control.
 - c. Proportional plus integral (PI) control.
 - d. Proportional plus integral plus derivative (PID) control. All PID programs shall automatically invoke integral wind up prevention routines whenever the controlled unit is off, under manual control of an automation system or time initiated program.
 - e. Automatic tuning of control loops.
 6. System Security: Operator access shall be secured using individual password and operator's name. Passwords shall restrict the operator to the level of object, applications, and system functions assigned to him. A minimum of six (6) levels of security for operator access shall be provided.
 7. Application Software: The controllers shall provide the following programs as a minimum for the purpose of optimizing energy consumption while maintaining comfortable environment for occupants. All application software shall reside and run in the system digital controllers. Editing of the application shall occur at the ECC or via a portable operator's terminal, when it is necessary, to access directly the programmable unit.
 - a. Power Demand Limiting (PDL): Power demand limiting program shall monitor the building power consumption and limit the consumption of electricity to prevent peak demand charges. PDL shall continuously track the electricity consumption from a pulse input generated at the kilowatt-hour/demand electric meter. PDL shall sample the meter data to continuously forecast the electric demand likely to be used during successive time intervals. If the forecast demand indicates that electricity usage will likely to exceed a user preset maximum allowable level, then PDL shall

automatically shed electrical loads. Once the demand load has met, loads that have been shed shall be restored and returned to normal mode. Control system shall be capable of demand limiting by resetting the HVAC system set points to reduce load while maintaining indoor air quality.

- b. Night Setback/Morning Warm up Control: The system shall provide the ability to automatically adjust set points for this mode of operation.
- c. Optimum Start/Stop (OSS): Optimum start/stop program shall automatically be coordinated with event scheduling. The OSS program shall start HVAC equipment at the latest possible time that will allow the equipment to achieve the desired zone condition by the time of occupancy, and it shall also shut down HVAC equipment at the earliest possible time before the end of the occupancy period and still maintain desired comfort conditions. The OSS program shall consider both outside weather conditions and inside zone conditions. The program shall automatically assign longer lead times for weekend and holiday shutdowns. The program shall poll all zones served by the associated AHU and shall select the warmest and coolest zones. These shall be used in the start time calculation. It shall be possible to assign occupancy start times on a per air handler unit basis. The program shall meet the local code requirements for minimum outdoor air while the building is occupied. Modification of assigned occupancy start/stop times shall be possible via the ECC.
- d. Event Scheduling: Provide a comprehensive menu driven program to automatically start and stop designated points or a group of points according to a stored time. This program shall provide the capability to individually command a point or group of points. When points are assigned to one common load group it shall be possible to assign variable time advances/delays between each successive start or stop within that group. Scheduling shall be calendar based and advance schedules may be defined up to one year in advance. Advance schedule shall override the day-to-day schedule. The operator shall be able to define the following information:
 - 1) Time, day.

- 2) Commands such as on, off, auto.
 - 3) Time delays between successive commands.
 - 4) Manual overriding of each schedule.
 - 5) Allow operator intervention.
- f. Alarm Reporting: The operator shall be able to determine the action to be taken in the event of an alarm. Alarms shall be routed to the ECC based on time and events. An alarm shall be able to start programs, login the event, print and display the messages. The system shall allow the operator to prioritize the alarms to minimize nuisance reporting and to speed operator's response to critical alarms. A minimum of six (6) priority levels of alarms shall be provided for each point.
- g. Remote Communications: The system shall have the ability to dial out in the event of an alarm to the ECC and alpha-numeric pagers. The alarm message shall include the name of the calling location, the device that generated the alarm, and the alarm message itself. The operator shall be able to remotely access and operate the system using dial up communications. Remote access shall allow the operator to function the same as local access.
- h. Maintenance Management (PM): The program shall monitor equipment status and generate maintenance messages based upon the operators defined equipment run time, starts, and/or calendar date limits. A preventative maintenance alarm shall be printed indicating maintenance requirements based on pre-defined run time. Each preventive message shall include point description, limit criteria and preventative maintenance instruction assigned to that limit. A minimum of 480-character PM shall be provided for each component of units such as air handling units.
- i. Chilled water Plant Operation: This program shall have the ability to sequence the multiple chillers to minimize energy consumption. The program shall provide sequence of operation as described on the drawings and include the following as a minimum:
- 1) Automatic start/stop of chillers and auxiliaries in accordance with the sequence of operation shown on the drawings, while incorporating requirements and restraints, such as starting frequency of the equipment imposed by equipment manufacturers.
 - 2) Secondary chilled water pumps and controls.

- 3) Generate chilled water plant load profiles for different seasons for use in forecasting efficient operating schedule.
- 4) Cooling Tower Operation Program: The objective of cooling tower control is to optimize chiller/tower energy use within the equipment restraints and minimum condenser water temperature limit recommended by the equipment manufacturer. Maintain chilled water plant performance records and print reports at intervals selected by the operator. It shall be possible for the operator to change the set points and the operating schedule.
- 5) The chilled water plant program shall display the following as a minimum:
 - a) Secondary chilled flow rate.
 - b) Secondary chilled water supply and return temperature.
 - c) Condenser water supply and return temperature.
 - d) Outdoor air dry bulb temperature.
 - e) Outdoor air wet bulb temperature.
 - f) Ton-hours of chilled water per day/month/year.
 - g) On-off status for each chiller.
 - h) Chilled water flow rate.
 - i) Chilled water supply and return temperature.
 - j) Operating set points-temperature and pressure.
 - k) Kilowatts and power factor.
 - l) Current limit set point.
 - m) Date and time.
 - n) Operating or alarm status.
 - o) Operating hours.

2.11 SENSORS (AIR, WATER AND STEAM)

- A. Sensors' measurements shall be read back to the DDC system, and shall be visible by the ECC.
- B. Temperature and Humidity Sensors shall be electronic, vibration and corrosion resistant for wall, immersion, and/or duct mounting. Provide all remote sensors as required for the systems.
 1. Temperature Sensors: thermistor type for terminal units and Resistance Temperature Device (RTD) with an integral transmitter type for all other sensors.

- a. Duct sensors shall be rigid or averaging type as shown on drawings. Averaging sensor shall be a minimum of 1 linear ft of sensing element for each sq ft of cooling coil face area.
- b. Immersion sensors shall be provided with a separable well made of stainless steel, bronze or monel material. Pressure rating of well is to be consistent with the system pressure in which it is to be installed.
- c. Space sensors shall be equipped with in-space User set-point adjustment, override switch, numerical temperature display on sensor cover, and communication port. Match room thermostats. Provide a tooled-access cover.
 - 1) Public space sensor: setpoint adjustment shall be only through the ECC or through the DDC system's diagnostic device/laptop. Do not provide in-space User set-point adjustment. Provide an opaque keyed-entry cover if needed to restrict in-space User set-point adjustment.
 - 2) Psychiatric patient room sensor: sensor shall be flush with wall, shall not include an override switch, numerical temperature display on sensor cover, shall not include a communication port and shall not allow in-space User set-point adjustment. Setpoint adjustment shall be only through the ECC or through the DDC system's diagnostic device/laptop. Provide a stainless steel coverplate with an insulated back and security screws.
- d. Outdoor air temperature sensors shall have watertight inlet fittings and be shielded from direct sunlight.
- e. Room security sensors shall have stainless steel cover plate with insulated back and security screws.
- f. Wire: Twisted, shielded-pair cable.
- g. Output Signal: 4-20 ma.
- 2. Humidity Sensors: Bulk polymer sensing element type.
 - a. Duct and room sensors shall have a sensing range of 20 to 80 percent with accuracy of ± 2 to ± 5 percent RH, including hysteresis, linearity, and repeatability.
 - b. Outdoor humidity sensors shall be furnished with element guard and mounting plate and have a sensing range of 0 to 100 percent RH.
 - c. 4-20 ma continuous output signal.

- C. Static Pressure Sensors: Non-directional, temperature compensated.
 - 1. 4-20 ma output signal.
 - 2. 0 to 5 inches wg for duct static pressure range.
 - 3. 0 to 0.25 inch wg for Building static pressure range.
- D. Water flow sensors:
 - 1. Type: Insertion vortex type with retractable probe assembly and 2 inch full port gate valve.
 - a. Pipe size: 3 to 24 inches.
 - b. Retractor: ASME threaded, non-rising stem type with hand wheel.
 - c. Mounting connection: 2 inch 150 PSI flange.
 - d. Sensor assembly: Design for expected water flow and pipe size.
 - e. Seal: Teflon (PTFE).
 - 2. Controller:
 - a. Integral to unit.
 - b. Locally display flow rate and total.
 - c. Output flow signal to BMCS: Digital pulse type.
 - 3. Performance:
 - a. Turndown: 20:1
 - b. Response time: Adjustable from 1 to 100 seconds.
 - c. Power: 24 volt DC
 - 4. Install flow meters according to manufacturer's recommendations.
Where recommended by manufacturer because of mounting conditions, provide flow rectifier.
- E. Water Flow Sensors: shall be insertion turbine type with turbine element, retractor and preamplifier/transmitter mounted on a two-inch full port isolation valve; assembly easily removed or installed as a single unit under line pressure through the isolation valve without interference with process flow; calibrated scale shall allow precise positioning of the flow element to the required insertion depth within plus or minute 1 mm (0.05 inch); wetted parts shall be constructed of stainless steel. Operating power shall be nominal 24 VDC. Local instantaneous flow indicator shall be LED type in NEMA 4 enclosure with 3-1/2 digit display, for wall or panel mounting.
 - 1. Performance characteristics:
 - a. Ambient conditions: -40°C to 60°C (-40°F to 140°F), 5 to 100% humidity.

- b. Operating conditions: 850 kPa (125 psig), 0°C to 120°C (30°F to 250°F), 0.15 to 12 m per second (0.5 to 40 feet per second) velocity.
 - c. Nominal range (turn down ratio): 10 to 1.
 - d. Preamplifier mounted on meter shall provide 4-20 ma divided pulse output or switch closure signal for units of volume or mass per a time base. Signal transmission distance shall be a minimum of 1,800 meters (6,000 feet).
 - e. Pressure Loss: Maximum 1 percent of the line pressure in line sizes above 100 mm (4 inches).
 - f. Ambient temperature effects, less than 0.005 percent calibrated span per °C (°F) temperature change.
 - g. RFI effect - flow meter shall not be affected by RFI.
 - h. Power supply effect less than 0.02 percent of span for a variation of plus or minus 10 percent power supply.
- F. Steam Flow Sensor/Transmitter:
- 1. Sensor: Vortex shedder incorporating wing type sensor and amplification technology for high signal-to-noise ratio, carbon steel body with 316 stainless steel working parts, 24 VDC power, NEMA 4 enclosure.
 - a. Ambient conditions, -40°C to 80°C (-40°F to 175°F).
 - b. Process conditions, 900 kPa (125 psig) saturated steam.
 - c. Turn down ratio, 20 to 1.
 - d. Output signal, 4-20 ma DC.
 - e. Processor/Transmitter, NEMA 4 enclosure with keypad program selector and six digit LCD output display of instantaneous flow rate or totalized flow, solid state switch closure signal shall be provided to the nearest DDC panel for totalization.
 - 1) Ambient conditions, -20°C to 50°C (0°F-120°F), 0 95 percent non-condensing RH.
 - 2) Power supply, 120 VAC, 60 hertz or 24 VDC.
 - 3) Internal battery, provided for 24-month retention of RAM contents when all other power sources are removed.
 - f. Sensor on all steam lines shall be protected by pigtail siphons installed between the sensor and the line, and shall have an isolation valve installed between the sensor and pressure source.
- G. Flow switches:

1. Shall be either paddle or differential pressure type.
 - a. Paddle-type switches (liquid service only) shall be UL Listed, SPDT snap-acting, adjustable sensitivity with NEMA 4 enclosure.
 - b. Differential pressure type switches (air or water service) shall be UL listed, SPDT snap acting, NEMA 4 enclosure, with scale range and differential suitable for specified application.
- H. Current Switches: Current operated switches shall be self powered, solid state with adjustable trip current as well as status, power, and relay command status LED indication. The switches shall be selected to match the current of the application and output requirements of the DDC systems.

2.12 CONTROL CABLES

A. General:

1. Ground cable shields, drain conductors, and equipment to eliminate shock hazard and to minimize ground loops, common-mode returns, noise pickup, cross talk, and other impairments. Comply with Sections 27 05 26 and 26 05 26.
2. Cable conductors to provide protection against induction in circuits. Crosstalk attenuation within the System shall be in excess of -80 dB throughout the frequency ranges specified.
3. Minimize the radiation of RF noise generated by the System equipment so as not to interfere with any audio, video, data, computer main distribution frame (MDF), telephone customer service unit (CSU), and electronic private branch exchange (EPBX) equipment the System may service.
4. The as-installed drawings shall identify each cable as labeled, used cable, and bad cable pairs.
5. Label system's cables on each end. Test and certify cables in writing to the VA before conducting proof-of-performance testing. Minimum cable test requirements are for impedance compliance, inductance, capacitance, signal level compliance, opens, shorts, cross talk, noise, and distortion, and split pairs on all cables in the frequency ranges used. Make available all cable installation and test records at demonstration to the VA. All changes (used pair, failed pair, etc.) shall be posted in these records as the change occurs.
6. Power wiring shall not be run in conduit with communications trunk wiring or signal or control wiring operating at 100 volts or less.

- B. Analogue control cabling shall be not less than No. 18 AWG solid, with thermoplastic insulated conductors as specified in Section 26 05 21.
- C. Copper digital communication cable between the ECC and the B-BC and B-AAC controllers shall be 100BASE-TX Ethernet, Category 5e or 6, not less than minimum 24 American Wire Gauge (AWG) solid, Shielded Twisted Pair (STP) or Unshielded Twisted Pair (UTP), with thermoplastic insulated conductors, enclosed in a thermoplastic outer jacket, as specified in Section 27 15 00.
 - 1. Other types of media commonly used within IEEE Std 802.3 LANs (e.g., 10Base-T and 10Base-2) shall be used only in cases to interconnect with existing media.
- D. Optical digital communication fiber, if used, shall be Multimode or Singlemode fiber, 62.5/125 micron for multimode or 10/125 micron for singlemode micron with SC or ST connectors as specified in TIA-568-C.1. Terminations, patch panels, and other hardware shall be compatible with the specified fiber and shall be as specified in Section 27 15 00. Fiber-optic cable shall be suitable for use with the 100Base-FX or the 100Base-SX standard (as applicable) as defined in IEEE Std 802.3.

2.13 THERMOSTATS AND HUMIDISTATS

- A. Room thermostats controlling unitary standalone heating and cooling devices not connected to the DDC system shall have three modes of operation (heating - null or dead band - cooling). Thermostats for patient bedrooms shall have capability of being adjusted to eliminate null or dead band. Wall mounted thermostats shall have polished or brushed aluminum finish, setpoint range and temperature display and external adjustment:
 - 1. Electronic Thermostats: Solid-state, microprocessor based, programmable to daily, weekend, and holiday schedules.
 - a. Public Space Thermostat: Public space thermostat shall have a thermistor sensor and shall not have a visible means of set point adjustment. Adjustment shall be via the digital controller to which it is connected.
 - b. Patient Room Thermostats: thermistor with in-space User set point adjustment and an on-casing room temperature numerical temperature display.
 - c. Psychiatric Patient Room Sensors: Electronic duct sensor as noted under Article 2.4.
 - d. Battery replacement without program loss.

- B. Strap-on thermostats shall be enclosed in a dirt-and-moisture proof housing with fixed temperature switching point and single pole, double throw switch.
- C. Freezestats shall have a minimum of 300 mm (one linear foot) of sensing element for each 0.093 square meter (one square foot) of coil area. A freezing condition at any increment of 300 mm (one foot) anywhere along the sensing element shall be sufficient to operate the thermostatic element. Freezestats shall be manually-reset.
- D. Room Humidistats: Provide fully proportioning humidistat with adjustable throttling range for accuracy of settings and conservation. The humidistat shall have set point scales shown in percent of relative humidity located on the instrument. Systems showing moist/dry or high/low are not acceptable.

2.14 FINAL CONTROL ELEMENTS AND OPERATORS

- A. Fail Safe Operation: Control valves and dampers shall provide "fail safe" operation in either the normally open or normally closed position as required for freeze, moisture, and smoke or fire protection.
- B. Spring Ranges: Range as required for system sequencing and to provide tight shut-off.
- C. Power Operated Control Dampers (other than VAV Boxes): Factory fabricated, balanced type dampers. All modulating dampers shall be opposed blade type and gasketed. Blades for two-position, duct-mounted dampers shall be parallel, airfoil (streamlined) type for minimum noise generation and pressure drop.
 - 1. Leakage: maximum leakage in closed position shall not exceed 7 L/S (15 CFMs) differential pressure for outside air and exhaust dampers and 200 L/S/ square meter (40 CFM/sq. ft.) at 50 mm (2 inches) differential pressure for other dampers.
 - 2. Frame shall be galvanized steel channel with seals as required to meet leakage criteria.
 - 3. Blades shall be galvanized steel or aluminum, 200 mm (8 inch) maximum width, with edges sealed as required.
 - 4. Bearing shall be nylon, bronze sleeve or ball type.
 - 5. Hardware shall be zinc-plated steel. Connected rods and linkage shall be non-slip. Working parts of joints shall be brass, bronze, nylon or stainless steel.
 - 6. Maximum air velocity and pressure drop through free area the dampers:

- a. Smoke damper in air handling unit: 305 meter per minute (1000 fpm).
- b. Duct mounted damper: 600 meter per minute (2000 fpm).
- c. Maximum static pressure loss: 50 Pascal (0.20 inches water gage).
- D. Smoke Dampers and Combination Fire/Smoke Dampers: Dampers and operators are specified in Section 23 31 00, HVAC DUCTS AND CASINGS. Control of these dampers is specified under this Section.
- E. Control Valves:
 - 1. Valves shall be rated for a minimum of 150 percent of system operating pressure at the valve location but not less than 900 kPa (125 psig).
 - 2. Valves 50 mm (2 inches) and smaller shall be bronze body with threaded or flare connections.
 - 3. Valves 60 mm (2 1/2 inches) and larger shall be bronze or iron body with flanged connections.
 - 4. Brass or bronze seats except for valves controlling media above 100 degrees C (210 degrees F), which shall have stainless steel seats.
 - 5. Flow characteristics:
 - a. Three way modulating valves shall be globe pattern. Position versus flow relation shall be linear relation for steam or equal percentage for water flow control.
 - b. Two-way modulating valves shall be globe pattern. Position versus flow relation shall be linear for steam and equal percentage for water flow control.
 - c. Two-way 2-position valves shall be ball, gate or butterfly type.
 - 6. Maximum pressure drop:
 - a. Two position steam control: 20 percent of inlet gauge pressure.
 - b. Modulating Steam Control: 80 percent of inlet gauge pressure (acoustic velocity limitation).
 - c. Modulating water flow control, greater of 3 meters (10 feet) of water or the pressure drop through the apparatus.
 - 7. Two position water valves shall be line size.
- F. Damper and Valve Operators and Relays:
 - 1. Pneumatic operators, spring return type with non-ferrous metal bellows or diaphragm of neoprene or other elastomer. Bellows or diaphragm shall be of sufficient size so that a change in operating pressure of not more than two (2) percent of the total motor operating pressure range will be required to start the valve or

- damper moving. Provide positive positioning or sequencing relays with adjustable operating range and starting point for operators sequenced with other operators to permit adjustment of control sequences, except for control valves in confined spaces in terminal units, which may use springs with range selected to provide necessary sequencing. Metal parts shall be aluminum, mill finish galvanized steel, or zinc plated steel or stainless steel.
2. Electric operator shall provide full modulating control of dampers and valves. A linkage and pushrod shall be furnished for mounting the actuator on the damper frame internally in the duct or externally in the duct or externally on the duct wall, or shall be furnished with a direct-coupled design. Metal parts shall be aluminum, mill finish galvanized steel, or zinc plated steel or stainless steel. Provide actuator heads which allow for electrical conduit attachment. The motors shall have sufficient closure torque to allow for complete closure of valve or damper under pressure. Provide multiple motors as required to achieve sufficient closeoff torque.
- a. Minimum valve closeoff pressure shall be equal to the system pump's dead-head pressure, minimum 50 psig for valves smaller than 4 inches.
3. Electronic damper operators: Metal parts shall be aluminum, mill finish galvanized steel, or zinc plated steel or stainless steel. Provide actuator heads which allow for electrical conduit attachment. The motors shall have sufficient closure torque to allow for complete closure of valve or damper under pressure. Provide multiple motors as required to achieve sufficient closeoff torque.
- a. VAV Box actuator shall be mounted on the damper axle or shall be of the air valve design, and shall provide complete modulating control of the damper. The motor shall have a closure torque of 35-inch pounds minimum with full torque applied at close off to attain minimum leakage.

4. See drawings for required control operation.

2.15 AIR FLOW CONTROL

- A. Airflow and static pressure shall be controlled via digital controllers with inputs from airflow control measuring stations and static pressure inputs as specified. Controller outputs shall be analog or pulse width modulating output signals. The controllers shall include the

capability to control via simple proportional (P) control, proportional plus integral (PI), proportional plus integral plus derivative (PID), and on-off. The airflow control programs shall be factory-tested programs that are documented in the literature of the control manufacturer.

B. Air Flow Measuring Station -- Pneumatic Type:

1. Airflow measuring stations shall measure airflow by the pitot tube traverse method. Each unit shall consist of a network of static and total pressure sensors, factory positioned and connected in parallel, to produce an equalized velocity pressure. The measured velocity pressure converted to airflow (cfm) shall have accuracy within 2 percent of the full scale throughout the velocity range from 200 to 1,200 meter per minute (700 to 4,000 fpm).
2. Airflow measuring stations shall consist of 16-gauge sheet metal casing, an aluminum air velocity treatment and air straightening section with an open face area not less than 97 percent and a total and static pressure sensing manifold made of copper. Each station shall contain noncombustible sensors which shall be incapable of producing toxic gases or fumes in the event of elevated duct temperatures. All interconnecting tubing shall be internal to the unit with the exception of one total pressure and one static pressure meter connection.
3. Each air flow measuring station shall be installed to meet at least the manufacturer's minimum installation conditions and shall not amplify the sound level within the duct. The maximum resistance to airflow shall not exceed 0.3 times the velocity head for the duct stations and 0.6 times the velocity head for the fan stations. The unit shall be suitable for continuous operation up to a temperature of 120°C (250°F).
4. Differential pressure transducers shall measure and transmit pressure signals to the direct digital controller.

- D. Static Pressure Measuring Station: shall consist of one or more static pressure sensors and transmitters along with relays or auxiliary devices as required for a complete functional system. The span of the transmitter shall not exceed two times the design static pressure at the point of measurement. The output of the transmitter shall be true representation of the input pressure with plus or minus 25 Pascal (0.1 inch) W.G. of the true input pressure:

1. Static pressure sensors shall have the same requirements as Airflow Measuring Devices except that total pressure sensors are optional, and only multiple static pressure sensors positioned on an equal area basis connected to a network of headers are required.
 2. For systems with multiple major trunk supply ducts, furnish a static pressure transmitter for each trunk duct. The transmitter signal representing the lowest static pressure shall be selected and this shall be the input signal to the controller.
 3. The controller shall receive the static pressure transmitter signal and CU shall provide a control output signal to the supply fan capacity control device. The control mode shall be proportional plus integral (PI) (automatic reset) and where required shall also include derivative mode.
 4. In systems with multiple static pressure transmitters, provide a switch located near the fan discharge to prevent excessive pressure during abnormal operating conditions. High-limit switches shall be manually-reset.
- E. Constant Volume Control Systems shall consist of an air flow measuring station along with such relays and auxiliary devices as required to produce a complete functional system. The transmitter shall receive its air flow signal and static pressure signal from the flow measuring station and shall have a span not exceeding three times the design flow rate. The CU shall receive the transmitter signal and shall provide an output to the fan volume control device to maintain a constant flow rate. The CU shall provide proportional plus integral (PI) (automatic reset) control mode and where required also inverse derivative mode. Overall system accuracy shall be plus or minus the equivalent of 2 Pascal (0.008 inch) velocity pressure as measured by the flow station.
- F. Airflow Synchronization:
1. Systems shall consist of an air flow measuring station for each supply and return duct, the CU and such relays, as required to provide a complete functional system that will maintain a constant flow rate difference between supply and return air to an accuracy of $\pm 10\%$. In systems where there is no suitable location for a flow measuring station that will sense total supply or return flow, provide multiple flow stations with a differential pressure transmitter for each station. Signals from the multiple transmitters

shall be added through the CU such that the resultant signal is a true representation of total flow.

2. The total flow signals from supply and return air shall be the input signals to the CU. This CU shall track the return air fan capacity in proportion to the supply air flow under all conditions.

PART 3 - EXECUTION

3.1 INSTALLATION

A. General:

1. Examine project plans for control devices and equipment locations; and report any discrepancies, conflicts, or omissions to Resident Engineer for resolution before proceeding for installation.
2. Work Coordination: GENERAL CONDITIONS.
3. Install equipment, piping, wiring /conduit parallel to or at right angles to building lines.
4. Install all equipment and piping in readily accessible locations. Do not run tubing and conduit concealed under insulation or inside ducts.
5. Mount control devices, tubing and conduit located on ducts and apparatus with external insulation on standoff support to avoid interference with insulation.
6. Provide sufficient slack and flexible connections to allow for vibration of piping and equipment.
7. Run tubing and wire connecting devices on or in control cabinets parallel with the sides of the cabinet neatly racked to permit tracing.
8. Install equipment level and plum.

A. Electrical Wiring Installation:

1. All wiring cabling shall be installed in conduits. Install conduits and wiring in accordance with Specification Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS. Conduits carrying control wiring and cabling shall be dedicated to the control wiring and cabling: these conduits shall not carry power wiring. Provide plastic end sleeves at all conduit terminations to protect wiring from burrs.
2. Install analog signal and communication cables in conduit and in accordance with Specification Section 26 05 21. Install digital communication cables in conduit and in accordance with Specification Section 27 15 00, Communications Horizontal Cabling.

3. Install conduit and wiring between operator workstation(s), digital controllers, electrical panels, indicating devices, instrumentation, miscellaneous alarm points, thermostats, and relays as shown on the drawings or as required under this section.
 1. Install all electrical work required for a fully functional system and not shown on electrical plans or required by electrical specifications. Where low voltage (less than 50 volt) power is required, provide suitable Class B transformers.
 5. Install all system components in accordance with local Building Code and National Electric Code.
 - a. Splices: Splices in shielded and coaxial cables shall consist of terminations and the use of shielded cable couplers. Terminations shall be in accessible locations. Cables shall be harnessed with cable ties.
 - b. Equipment: Fit all equipment contained in cabinets or panels with service loops, each loop being at least 300 mm (12 inches) long. Equipment for fiber optics system shall be rack mounted, as applicable, in ventilated, self-supporting, code gauge steel enclosure. Cables shall be supported for minimum sag.
 - c. Cable Runs: Keep cable runs as short as possible. Allow extra length for connecting to the terminal board. Do not bend flexible coaxial cables in a radius less than ten times the cable outside diameter.
 - d. Use vinyl tape, sleeves, or grommets to protect cables from vibration at points where they pass around sharp corners, through walls, panel cabinets, etc.
 6. Conceal cables, except in mechanical rooms and areas where other conduits and piping are exposed.
 7. Permanently label or code each point of all field terminal strips to show the instrument or item served. Color-coded cable with cable diagrams may be used to accomplish cable identification.
 8. Grounding: ground electrical systems per manufacturer's written requirements for proper and safe operation.
- C. Install Sensors and Controls:
1. Temperature Sensors:
 - a. Install all sensors and instrumentation according to manufacturer's written instructions. Temperature sensor locations

shall be readily accessible, permitting quick replacement and servicing of them without special skills and tools.

- b. Calibrate sensors to accuracy specified, if not factory calibrated.
 - c. Use of sensors shall be limited to its duty, e.g., duct sensor shall not be used in lieu of room sensor.
 - d. Install room sensors permanently supported on wall frame. They shall be mounted at 1.5 meter (5.0 feet) above the finished floor.
 - e. Mount sensors rigidly and adequately for the environment within which the sensor operates. Separate extended-bulb sensors from contact with metal casings and coils using insulated standoffs.
 - f. Sensors used in mixing plenum, and hot and cold decks shall be of the averaging of type. Averaging sensors shall be installed in a serpentine manner horizontally across duct. Each bend shall be supported with a capillary clip.
 - g. All pipe mounted temperature sensors shall be installed in wells.
 - h. All wires attached to sensors shall be air sealed in their conduits or in the wall to stop air transmitted from other areas affecting sensor reading.
 - i. Permanently mark terminal blocks for identification. Protect all circuits to avoid interruption of service due to short-circuiting or other conditions. Line-protect all wiring that comes from external sources to the site from lightning and static electricity.
2. Pressure Sensors:
- a. Install duct static pressure sensor tips facing directly downstream of airflow.
 - b. Install high-pressure side of the differential switch between the pump discharge and the check valve.
 - c. Install snubbers and isolation valves on steam pressure sensing devices.
3. Actuators:
- a. Mount and link damper and valve actuators according to manufacturer's written instructions.
 - b. Check operation of damper/actuator combination to confirm that actuator modulates damper smoothly throughout stroke to both open and closed position.

- c. Check operation of valve/actuator combination to confirm that actuator modulates valve smoothly in both open and closed position.
- 4. Flow Switches:
 - a. Install flow switch according to manufacturer's written instructions.
 - b. Mount flow switch a minimum of 5 pipe diameters up stream and 5 pipe diameters downstream or 600 mm (2 feet) whichever is greater, from fittings and other obstructions.
 - c. Assure correct flow direction and alignment.
 - d. Mount in horizontal piping-flow switch on top of the pipe.
- D. Installation of network:
 - 1. Ethernet:
 - a. The network shall employ Ethernet LAN architecture, as defined by IEEE 802.3. The Network Interface shall be fully Internet Protocol (IP) compliant allowing connection to currently installed IEEE 802.3, Compliant Ethernet Networks.
 - b. The network shall directly support connectivity to a variety of cabling types. As a minimum provide the following connectivity: 100 Base TX (Category 5e cabling) for the communications between the ECC and the B-BC and the B-AAC controllers.
 - 2. Third party interfaces: Contractor shall integrate real-time data from building systems by other trades and databases originating from other manufacturers as specified and required to make the system work as one system.
- E. Installation of digital controllers and programming:
 - 1. Provide a separate digital control panel for each major piece of equipment, such as air handling unit, chiller, pumping unit etc. Points used for control loop reset such as outdoor air, outdoor humidity, or space temperature could be located on any of the remote control units.
 - 2. Provide sufficient internal memory for the specified control sequences and trend logging. There shall be a minimum of 25 percent of available memory free for future use.
 - 3. System point names shall be modular in design, permitting easy operator interface without the use of a written point index.
 - 4. Provide software programming for the applications intended for the systems specified, and adhere to the strategy algorithms provided.

5. Provide graphics for each piece of equipment and floor plan in the building. This includes each chiller, cooling tower, air handling unit, fan, terminal unit, boiler, pumping unit etc. These graphics shall show all points dynamically as specified in the point list.

3.2 SYSTEM VALIDATION AND DEMONSTRATION

- A. As part of final system acceptance, a system demonstration is required (see below). Prior to start of this demonstration, the contractor is to perform a complete validation of all aspects of the controls and instrumentation system.

B. Validation

1. Prepare and submit for approval a validation test plan including test procedures for the performance verification tests. Test Plan shall address all specified functions of the ECC and all specified sequences of operation. Explain in detail actions and expected results used to demonstrate compliance with the requirements of this specification. Explain the method for simulating the necessary conditions of operation used to demonstrate performance of the system. Test plan shall include a test check list to be used by the Installer's agent to check and initial that each test has been successfully completed. Deliver test plan documentation for the performance verification tests to the owner's representative 30 days prior to start of performance verification tests. Provide draft copy of operation and maintenance manual with performance verification test.
2. After approval of the validation test plan, installer shall carry out all tests and procedures therein. Installer shall completely check out, calibrate, and test all connected hardware and software to insure that system performs in accordance with approved specifications and sequences of operation submitted. Installer shall complete and submit Test Check List.

C. Demonstration

1. System operation and calibration to be demonstrated by the installer in the presence of the Architect or VA's representative on random samples of equipment as dictated by the Architect or VA's representative. Should random sampling indicate improper commissioning, the owner reserves the right to subsequently witness complete calibration of the system at no addition cost to the VA.

2. Demonstrate to authorities that all required safeties and life safety functions are fully functional and complete.
3. Make accessible , personnel to provide necessary adjustments and corrections to systems as directed by balancing agency.
4. The following witnessed demonstrations of field control equipment shall be included:
 - a. Observe HVAC systems in shut down condition. Check dampers and valves for normal position.
 - b. Test application software for its ability to communicate with digital controllers, operator workstation, and uploading and downloading of control programs.
 - c. Demonstrate the software ability to edit the control program off-line.
 - d. Demonstrate reporting of alarm conditions for each alarm and ensure that these alarms are received at the assigned location, including operator workstations.
 - e. Demonstrate ability of software program to function for the intended applications-trend reports, change in status etc.
 - f. Demonstrate via graphed trends to show the sequence of operation is executed in correct manner, and that the HVAC systems operate properly through the complete sequence of operation, e.g., seasonal change, occupied/unoccupied mode, and warm-up condition.
 - g. Demonstrate hardware interlocks and safeties functions, and that the control systems perform the correct sequence of operation after power loss and resumption of power loss.
 - h. Prepare and deliver to the VA graphed trends of all control loops to demonstrate that each control loop is stable and the set points are maintained.
 - i. Demonstrate that each control loop responds to set point adjustment and stabilizes within one (1) minute. Control loop trend data shall be instantaneous and the time between data points shall not be greater than one (1) minute.
5. Witnessed demonstration of ECC functions shall consist of:
 - a. Running each specified report.
 - b. Display and demonstrate each data entry to show site specific customizing capability. Demonstrate parameter changes.
 - c. Step through penetration tree, display all graphics, demonstrate dynamic update, and direct access to graphics.

- d. Execute digital and analog commands in graphic mode.
- e. Demonstrate DDC loop precision and stability via trend logs of inputs and outputs (6 loops minimum).
- f. Demonstrate EMS performance via trend logs and command trace.
- g. Demonstrate scan, update, and alarm responsiveness.
- h. Demonstrate spreadsheet/curve plot software, and its integration with database.
- i. Demonstrate on-line user guide, and help function and mail facility.
- j. Demonstrate digital system configuration graphics with interactive upline and downline load, and demonstrate specified diagnostics.
- k. Demonstrate multitasking by showing dynamic curve plot, and graphic construction operating simultaneously via split screen.
- l. Demonstrate class programming with point options of beep duration, beep rate, alarm archiving, and color banding.

----- END -----

SECTION 23 21 13
HYDRONIC PIPING

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Water piping to connect HVAC equipment, including the following:
 - 1. Chilled water, condenser water, heating hot water and drain piping.
 - 2. Extension of domestic water make-up piping.
 - 3. Glycol-water piping.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- C. Section 31 20 11, EARTH MOVING (Short Form): Excavation and backfill.
- D. Section 03 30 00, CAST-IN-PLACE CONCRETE.
- E. Section 07 52 16, STYRENE-BUTADIENE-STYRENE MODIFIED BITUMINOUS MEMBRANE ROOFING - COLD APPLIED
- F. Section 33 10 00, WATER UTILITIES: Underground piping.
- G. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION: General mechanical requirements and items, which are common to more than one section of Division 23.
- H. Section 23 21 23, HYDRONIC PUMPS: Pumps.
- I. Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION: Piping insulation.
- J. Section 23 23 00, REFRIGERANT PIPING: Refrigerant piping and refrigerants.
- K. Section 23 25 00, HVAC WATER TREATMENT: Water treatment for open and closed systems.
- L. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Temperature and pressure sensors and valve operators.

1.3 QUALITY ASSURANCE

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION, which includes welding qualifications.
- B. Submit prior to welding of steel piping a certificate of Welder's certification. The certificate shall be current and not more than one year old.
- C. For mechanical pressed sealed fittings, only tools of fitting manufacturer shall be used.
- D. Mechanical pressed fittings shall be installed by factory trained workers.

E. All grooved joint couplings, fittings, valves, and specialties shall be the products of a single manufacturer. Grooving tools shall be the same manufacturer as the grooved components.

1. All castings used for coupling housings, fittings, valve bodies, etc., shall be date stamped for quality assurance and traceability.

1.4 SUBMITTALS

A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.

B. Manufacturer's Literature and Data:

1. Pipe and equipment supports.
2. Pipe and tubing, with specification, class or type, and schedule.
3. Pipe fittings, including miscellaneous adapters and special fittings.
4. Flanges, gaskets and bolting.
5. Grooved joint couplings and fittings.
6. Valves of all types.
7. Strainers.
8. Flexible connectors for water service.
9. Pipe alignment guides.
10. Expansion joints.
11. Expansion compensators.
12. All specified hydronic system components.
13. Water flow measuring devices.
14. Gages.
15. Thermometers and test wells.
16. Electric heat tracing systems.

C. Manufacturer's certified data report, Form No. U-1, for ASME pressure vessels:

1. Heat Exchangers (Water to Water)
2. Air separators.
3. Expansion tanks.

D. Submit the welder's qualifications in the form of a current (less than one year old) and formal certificate.

E. Coordination Drawings: Refer to Article, SUBMITTALS of Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

F. As-Built Piping Diagrams: Provide drawing as follows for chilled water, condenser water, and heating hot water system and other piping systems and equipment.

- ## 1.5 APPLICABLE PUBLICATIONS

- Department of Veteran Affairs
PSP Project No. 410760

- B31.1-08.....Power Piping
- E. American Society for Testing and Materials (ASTM):
- A47/A47M-99 (2004).....Ferritic Malleable Iron Castings
- A53/A53M-07.....Standard Specification for Pipe, Steel, Black
and Hot-Dipped, Zinc-Coated, Welded and
Seamless
- A106/A106M-08.....Standard Specification for Seamless Carbon
Steel Pipe for High-Temperature Service
- A126-04.....Standard Specification for Gray Iron Castings
for Valves, Flanges, and Pipe Fittings
- A183-03 Standard Specification for Carbon Steel Track
Bolts and Nuts
- A216/A216M-08 Standard Specification for Steel Castings,
Carbon, Suitable for Fusion Welding, for High
Temperature Service
- A234/A234M-07 Piping Fittings of Wrought Carbon Steel and
Alloy Steel for Moderate and High Temperature
Service
- A307-07 Standard Specification for Carbon Steel Bolts
and Studs, 60,000 PSI Tensile Strength
- A536-84 (2004) Standard Specification for Ductile Iron Castings
- A615/A615M-08 Deformed and Plain Carbon Steel Bars for
Concrete Reinforcement
- A653/A 653M-08 Steel Sheet, Zinc-Coated (Galvanized) or Zinc-
Iron Alloy Coated (Galvannealed) By the Hot-Dip
Process
- B32-08 Standard Specification for Solder Metal
- B62-02 Standard Specification for Composition Bronze or
Ounce Metal Castings
- B88-03 Standard Specification for Seamless Copper Water
Tube
- B209-07 Aluminum and Aluminum Alloy Sheet and Plate
- C177-04 Standard Test Method for Steady State Heat Flux
Measurements and Thermal Transmission Properties
by Means of the Guarded Hot Plate Apparatus
- C478-09 Precast Reinforced Concrete Manhole Sections
- C533-07 Calcium Silicate Block and Pipe Thermal
Insulation

- C552-07 Cellular Glass Thermal Insulation
- D3350-08 Polyethylene Plastics Pipe and Fittings
Materials
- C591-08 Unfaced Preformed Rigid Cellular
Polyisocyanurate Thermal Insulation
- D1784-08 Rigid Poly (Vinyl Chloride) (PVC) Compounds and
Chlorinated Poly (Vinyl Chloride) (CPVC)
Compound
- D1785-06 Poly (Vinyl Chloride) (PVC) Plastic Pipe,
Schedules 40, 80 and 120
- D2241-05 Poly (Vinyl Chloride) (PVC) Pressure Rated Pipe
(SDR Series)
- F439-06 Standard Specification for Chlorinated Poly
(Vinyl Chloride) (CPVC) Plastic Pipe Fittings,
Schedule 80
- F441/F441M-02 Standard Specification for Chlorinated Poly
(Vinyl Chloride) (CPVC) Plastic Pipe, Schedules
40 and 80
- F477-08 Elastomeric Seals Gaskets) for Joining Plastic
Pipe
- F. American Water Works Association (AWWA):
 - C110-08.....Ductile Iron and Grey Iron Fittings for Water
 - C203-02.....Coal Tar Protective Coatings and Linings for
Steel Water Pipe Lines Enamel and Tape Hot
Applied
- G. American Welding Society (AWS):
 - B2.1-02.....Standard Welding Procedure Specification
- H. Copper Development Association, Inc. (CDA):
 - CDA A4015-06.....Copper Tube Handbook
- I. Expansion Joint Manufacturer's Association, Inc. (EJMA):
 - EMJA-2003.....Expansion Joint Manufacturer's Association
Standards, Ninth Edition
- J. Manufacturers Standardization Society (MSS) of the Valve and Fitting
Industry, Inc.:
 - SP-67-02a.....Butterfly Valves
 - SP-70-06.....Gray Iron Gate Valves, Flanged and Threaded
Ends

SP-71-05.....Gray Iron Swing Check Valves, Flanged and
Threaded Ends
SP-80-08.....Bronze Gate, Globe, Angle and Check Valves
SP-85-02.....Cast Iron Globe and Angle Valves, Flanged and
Threaded Ends
SP-110-96.....Ball Valves Threaded, Socket-Welding, Solder
Joint, Grooved and Flared Ends
SP-125-00.....Gray Iron and Ductile Iron In-line, Spring
Loaded, Center-Guided Check Valves

K. National Sanitation Foundation/American National Standards Institute,
Inc. (NSF/ANSI):

14-06.....Plastic Piping System Components and Related
Materials
50-2009a.....Equipment for Swimming Pools, Spas, Hot Tubs
and other Recreational Water Facilities -
Evaluation criteria for materials, components,
products, equipment and systems for use at
recreational water facilities
61-2008.....Drinking Water System Components - Health
Effects

L. Tubular Exchanger Manufacturers Association: TEMA 9th Edition, 2007

1.6 SPARE PARTS

A. For mechanical pressed sealed fittings provide tools required for each
pipe size used at the facility.

PART 2 - PRODUCTS

2.1 PIPE AND EQUIPMENT SUPPORTS, PIPE SLEEVES, AND WALL AND CEILING PLATES

A. Provide in accordance with Section 23 05 11, COMMON WORK RESULTS FOR
HVAC and STEAM GENERATION.

2.2 PIPE AND TUBING

A. Chilled Water, Condenser Water, Heating Hot Water, and Glycol-Water,
and Vent Piping:

1. Steel: ASTM A53 Grade B, seamless or ERW, Schedule 40.
2. Copper water tube option: ASTM B88, Type K or L, hard drawn.

B. Extension of Domestic Water Make-up Piping: ASTM B88, Type K or L, hard
drawn copper tubing.

C. Cooling Coil Condensate Drain Piping:

1. From air handling units: Copper water tube, ASTM B88, Type M, or
schedule 40 PVC plastic piping.

- 2. From fan coil or other terminal units: Copper water tube, ASTM B88, Type L for runouts and Type M for mains.
- D. Chemical Feed Piping for Condenser Water Treatment: Chlorinated polyvinyl chloride (CPVC), Schedule 80, ASTM F441.
- E. Pipe supports, including insulation shields, for above ground piping: Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

2.3 FITTINGS FOR STEEL PIPE

- A. 50 mm (2 inches) and Smaller: Screwed or welded joints.
 - 1. Butt welding: ASME B16.9 with same wall thickness as connecting piping.
 - 2. Forged steel, socket welding or threaded: ASME B16.11.
 - 3. Screwed: 150 pound malleable iron, ASME B16.3. 125 pound cast iron, ASME B16.4, may be used in lieu of malleable iron. Bushing reduction of a single pipe size, or use of close nipples, is not acceptable.
 - 4. Unions: ASME B16.39.
 - 5. Water hose connection adapter: Brass, pipe thread to 20 mm (3/4 inch) garden hose thread, with hose cap nut.
- B. 65 mm (2-1/2 inches) and Larger: Welded or flanged joints. Contractor's option: Grooved mechanical couplings and fittings are optional.
 - 1. Butt welding fittings: ASME B16.9 with same wall thickness as connecting piping. Elbows shall be long radius type, unless otherwise noted.
 - 2. Welding flanges and bolting: ASME B16.5:
 - a. Water service: Weld neck or slip-on, plain face, with 6 mm (1/8 inch) thick full face neoprene gasket suitable for 104 degrees C (220 degrees F).
 - 1) Contractor's option: Convoluted, cold formed 150 pound steel flanges, with teflon gaskets, may be used for water service.
 - b. Flange bolting: Carbon steel machine bolts or studs and nuts, ASTM A307, Grade B.
- C. Welded Branch and Tap Connections: Forged steel weldolets, or branchlets and threadolets may be used for branch connections up to one pipe size smaller than the main. Forged steel half-couplings, ASME B16.11 may be used for drain, vent and gage connections.
- D. Grooved Mechanical Pipe Couplings and Fittings (Contractor's Option): Grooved Mechanical Pipe Couplings and Fittings may be used, with cut or roll grooved pipe, in water service up to 110 degrees C (230 degrees F)

in lieu of welded, screwed or flanged connections. All joints must be rigid type.

1. Grooved mechanical couplings: Malleable iron, ASTM A47 or ductile iron, ASTM A536, fabricated in two or more parts, securely held together by two or more track-head, square, or oval-neck bolts, ASTM A449 and A183.
2. Gaskets: Rubber product recommended by the coupling manufacturer for the intended service.
3. Grooved end fittings: Malleable iron, ASTM A47; ductile iron, ASTM A536; or steel, ASTM A53 or A106, designed to accept grooved mechanical couplings. Tap-in type branch connections are acceptable.

2.4 FITTINGS FOR COPPER TUBING

A. Joints:

1. Solder Joints: Joints shall be made up in accordance with recommended practices of the materials applied. Apply 95/5 tin and antimony on all copper piping.
2. Contractor's Option: Mechanical press sealed fittings, double pressed type, NSF 50/61 approved, with EPDM (ethylene propylene diene monomer) non-toxic synthetic rubber sealing elements for up to 65 mm (2-1/2 inch) and below are optional for above ground water piping only.
3. Mechanically formed tee connection in water and drain piping: Form mechanically extracted collars in a continuous operation by drilling pilot hole and drawing out tube surface to form collar, having a height of not less than three times the thickness of tube wall. Adjustable collaring device shall insure proper tolerance and complete uniformity of the joint. Notch and dimple joining branch tube in a single process to provide free flow where the branch tube penetrates the fitting.

B. Bronze Flanges and Flanged Fittings: ASME B16.24.

C. Fittings: ANSI/ASME B16.18 cast copper or ANSI/ASME B16.22 solder wrought copper.

2.5 FITTINGS FOR PLASTIC PIPING

- A. Schedule 40, socket type for solvent welding.
- B. Schedule 40 PVC drain piping: Drainage pattern.
- C. Chemical feed piping for condenser water treatment: Chlorinated polyvinyl chloride (CPVC), Schedule 80, ASTM F439.

2.6 DIELECTRIC FITTINGS

- A. Provide where copper tubing and ferrous metal pipe are joined.
- B. 50 mm (2 inches) and Smaller: Threaded dielectric union, ASME B16.39.
- C. 65 mm (2 1/2 inches) and Larger: Flange union with dielectric gasket and bolt sleeves, ASME B16.42.
- D. Temperature Rating, 99 degrees C (210 degrees F).
- E. Contractor's option: On pipe sizes 2" and smaller, screwed end brass ball valves or dielectric nipples may be used in lieu of dielectric unions.

2.7 SCREWED JOINTS

- A. Pipe Thread: ANSI B1.20.
- B. Lubricant or Sealant: Oil and graphite or other compound approved for the intended service.

2.8 VALVES

- A. Asbestos packing is not acceptable.
- B. All valves of the same type shall be products of a single manufacturer.
- C. Provide chain operators for valves 150 mm (6 inches) and larger when the centerline is located 2400 mm (8 feet) or more above the floor or operating platform.
- D. Shut-Off Valves
 - 1. Ball Valves (Pipe sizes 2" and smaller): MSS-SP 110, screwed or solder connections, brass or bronze body with chrome-plated ball with full port and Teflon seat at 2760 kPa (400 psig) working pressure rating. Provide stem extension to allow operation without interfering with pipe insulation.
 - 2. Butterfly Valves (Pipe Sizes 2-1/2" and larger): Provide stem extension to allow 50 mm (2 inches) of pipe insulation without interfering with valve operation. MSS-SP 67, flange lug type or grooved end rated 1205 kPa (175 psig) working pressure at 93 degrees C (200 degrees F). Valves shall be ANSI Leakage Class VI and rated for bubble tight shut-off to full valve pressure rating. Valve shall be rated for dead end service and bi-directional flow capability to full rated pressure. Not permitted for direct buried pipe applications.
 - a. Body: Cast iron, ASTM A126, Class B. Malleable iron, ASTM A47 electro-plated, or ductile iron, ASTM A536, Grade 65-45-12 electro-plated.

- b. Trim: Bronze, aluminum bronze, or 300 series stainless steel disc, bronze bearings, 316 stainless steel shaft and manufacturer's recommended resilient seat. Resilient seat shall be field replaceable, and fully line the body to completely isolate the body from the product. A phosphate coated steel shaft or stem is acceptable, if the stem is completely isolated from the product.
 - c. Actuators: Field interchangeable. Valves for balancing service shall have adjustable memory stop to limit open position.
 - 1) Valves 150 mm (6 inches) and smaller: Lever actuator with minimum of seven locking positions, except where chain wheel is required.
 - 2) Valves 200 mm (8 inches) and larger: Enclosed worm gear with handwheel, and where required, chain-wheel operator.
 - 3) 3. Gate Valves (Contractor's Option in lieu of Ball or Butterfly Valves):
 - a) 50 mm (2 inches) and smaller: MSS-SP 80, Bronze, 1034 kPa (150 psig), wedge disc, rising stem, union bonnet.
 - b) 65 mm (2 1/2 inches) and larger: Flanged, outside screw and yoke. MSS-SP 70, iron body, bronze mounted, 861 kPa (125 psig) wedge disc.
- E. Globe and Angle Valves
- 1. Globe Valves
 - a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.) Globe valves shall be union bonnet with metal plug type disc.
 - b. 65 mm (2 1/2 inches) and larger: 861 kPa (125 psig), flanged, iron body, bronzetrim, MSS-SP-85 for globe valves.
 - 2. Angle Valves:
 - a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.) Angle valves shall be union bonnet with metal plug type disc.
 - b. 65 mm (2 1/2 inches) and larger: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-85 for angle.
- F. Check Valves
- 1. Swing Check Valves:
 - a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.), 45 degree swing disc.

- b. 65 mm (2 1/2 inches) and larger: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-71 for check valves.
- 2. Non-Slam or Silent Check Valve: Spring loaded double disc swing check or internally guided flat disc lift type check for bubble tight shut-off. Provide where check valves are shown in chilled water and hot water piping. Check valves incorporating a balancing feature may be used.
 - a. Body: MSS-SP 125 cast iron, ASTM A126, Class B, or steel, ASTM A216, Class WCB, or ductile iron, ASTM 536, flanged, grooved, or wafer type.
 - b. Seat, disc and spring: 18-8 stainless steel, or bronze, ASTM B62. Seats may be elastomer material.
- G. Water Flow Balancing Valves: For flow regulation and shut-off. Valves shall be line size rather than reduced to control valve size.
 - 1. Ball or Globe style valve.
 - 2. A dual purpose flow balancing valve and adjustable flow meter, with bronze or cast iron body, calibrated position pointer, valved pressure taps or quick disconnects with integral check valves and preformed polyurethane insulating enclosure.
 - 3. Provide a readout kit including flow meter, readout probes, hoses, flow charts or calculator, and carrying case.
- H. Automatic Balancing Control Valves: Factory calibrated to maintain constant flow (plus or minus five percent) over system pressure fluctuations of at least 10 times the minimum required for control. Provide standard pressure taps and four sets of capacity charts. Valves shall be line size and be one of the following designs:
 - 1. Gray iron (ASTM A126) or brass body rated 1205 kPa (175 psig) at 93 degrees C (200 degrees F), with stainless steel piston and spring.
 - 2. Brass or ferrous body designed for 2067 kPa (300 psig) service at 121 degrees C (250 degrees F), with corrosion resistant, tamper proof, self-cleaning piston/spring assembly that is easily removable for inspection or replacement.
 - 3. Combination assemblies containing ball type shut-off valves, unions, flow regulators, strainers with blowdown valves and pressure temperature ports shall be acceptable.
 - 4. Provide a readout kit including flow meter, probes, hoses, flow charts and carrying case.

- I. Manual Radiator/Convactor Valves: Brass, packless, with position indicator.

2.9 WATER FLOW MEASURING DEVICES

- A. Minimum overall accuracy plus or minus three percent over a range of 70 to 110 percent of design flow. Select devices for not less than 110 percent of design flow rate.
- B. Venturi Type: Bronze, steel, or cast iron with bronze throat, with valved pressure sensing taps upstream and at the throat.
- C. Wafer Type Circuit Sensor: Cast iron wafer-type flow meter equipped with readout valves to facilitate the connecting of a differential pressure meter. Each readout valve shall be fitted with an integral check valve designed to minimize system fluid loss during the monitoring process.
- D. Self-Averaging Annular Sensor Type: Brass or stainless steel metering tube, shutoff valves and quick-coupling pressure connections. Metering tube shall be rotatable so all sensing ports may be pointed down-stream when unit is not in use.
- E. Insertion Turbine Type Sensor: Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
- F. Flow Measuring Device Identification:
1. Metal tag attached by chain to the device.
 2. Include meter or equipment number, manufacturer's name, meter model, flow rate factor and design flow rate in l/m (gpm).
- G. Portable Water Flow Indicating Meters:
1. Minimum 150 mm (6 inch) diameter dial, forged brass body, beryllium-copper bellows, designed for 1205 kPa (175 psig) working pressure at 121 degrees C (250 degrees F).
 2. Bleed and equalizing valves.
 3. Vent and drain hose and two 3000 mm (10 feet) lengths of hose with quick disconnect connections.
 4. Factory fabricated carrying case with hose compartment and a bound set of capacity curves showing flow rate versus pressure differential.
 5. Provide one portable meter for each range of differential pressure required for the installed flow devices.
- H. Permanently Mounted Water Flow Indicating Meters: Minimum 150 mm (6 inch) diameter, or 450 mm (18 inch) long scale, for 120 percent of

design flow rate, direct reading in lps (gpm), with three valve manifold and two shut-off valves.

2.10 STRAINERS

A. Y Type.

1. Screens: Bronze, monel metal or 18-8 stainless steel, free area not less than 2-1/2 times pipe area, with perforations as follows: 1.1 mm (0.045 inch) diameter perforations for 100 mm (4 inches) and larger: 3.2 mm (0.125 inch) diameter perforations.

B. Suction Diffusers: Specified in Section 23 21 23, HYDRONIC PUMPS.

2.11 FLEXIBLE CONNECTORS FOR WATER SERVICE

A. Flanged Spool Connector:

1. Single arch or multiple arch type. Tube and cover shall be constructed of chlorobutyl elastomer with full faced integral flanges to provide a tight seal without gaskets. Connectors shall be internally reinforced with high strength synthetic fibers impregnated with rubber or synthetic compounds as recommended by connector manufacturer, and steel reinforcing rings.
2. Working pressures and temperatures shall be as follows:
 - a. Connector sizes 50 mm to 100 mm (2 inches to 4 inches), 1137 kPa (165psig) at 121 degrees C (250 degrees F).
 - b. Connector sizes 125 mm to 300 mm (5 inches to 12 inches), 965 kPa (140 psig) at 121 degrees C (250 degrees F).
3. Provide ductile iron retaining rings and control units.

B. Mechanical Pipe Couplings:

See other fittings specified under Part 2, PRODUCTS.

2.12 EXPANSION JOINTS

- A. Factory built devices, inserted in the pipe lines, designed to absorb axial cyclical pipe movement which results from thermal expansion and contraction. This includes factory-built or field-fabricated guides located along the pipe lines to restrain lateral pipe motion and direct the axial pipe movement into the expansion joints.
- B. Manufacturing Quality Assurance: Conform to Expansion Joints Manufacturers Association Standards.
- C. Bellows - Internally Pressurized Type:
 1. Multiple corrugations of Type 304 or Type A240-321 stainless steel.
 2. Internal stainless steel sleeve entire length of bellows.
 3. External cast iron equalizing rings for services exceeding 340 kPa (50 psig).

4. Welded ends.
 5. Design shall conform to standards of EJMA and ASME B31.1.
 6. External tie rods designed to withstand pressure thrust force upon anchor failure if one or both anchors for the joint are at change in direction of pipeline.
 7. Integral external cover.
- D. Bellows - Externally Pressurized Type:
1. Multiple corrugations of Type 304 stainless steel.
 2. Internal and external guide integral with joint.
 3. Design for external pressurization of bellows to eliminate squirm.
 4. Welded ends.
 5. Conform to the standards of EJMA and ASME B31.1.
 6. Threaded connection at bottom, 25 mm (one inch) minimum, for drain or drip point.
 7. Integral external cover and internal sleeve.
- E. Expansion Compensators:
1. Corrugated bellows, externally pressurized, stainless steel or bronze.
 2. Internal guides and anti-torque devices.
 3. Threaded ends.
 4. External shroud.
 5. Conform to standards of EJMA.
- F. Expansion Joint (Contractor's Option): 2415 kPa (350 psig) maximum working pressure, steel pipe fitting consisting of telescoping body and slip-pipe sections, PTFE modified polyphenylene sulfide coated slide section, with grooved ends, suitable for axial end movement to 75 mm (3 inch).
- G. Expansion Joint Identification: Provide stamped brass or stainless steel nameplate on each expansion joint listing the manufacturer, the allowable movement, flow direction, design pressure and temperature, date of manufacture, and identifying the expansion joint by the identification number on the contract drawings.
- H. Guides: Provide factory-built guides along the pipe line to permit axial movement only and to restrain lateral and angular movement. Guides must be designed to withstand a minimum of 15 percent of the axial force which will be imposed on the expansion joints and anchors. Field-built guides may be used if detailed on the contract drawings.

- I. Supports: Provide saddle supports and frame or hangers for heat exchanger. Mounting height shall be adjusted to facilitate gravity return of steam condensate. Construct supports from steel, weld joints.

2.13 HYDRONIC SYSTEM COMPONENTS

- A. Heat Exchanger (Water to Water): Shell and tube type, U-bend removable tube bundle, heating fluid in shell, heated fluid in tubes, equipped with support cradles.
 1. Maximum tube velocity: 2.3 m/s (7.5 feet per second).
 2. Tube fouling factor: TEMA Standards, but not less than 0.001.
 3. Materials:
 - a. Shell: Steel.
 - b. Tube sheet and tube supports: Steel or brass.
 - c. Tubes: 20 mm (3/4 inch) OD copper.
 - d. Head or bonnet: Cast iron or steel.
 4. Construction: In accordance with ASME Pressure Vessel Code for 861 kPa (125 psig) working pressure for shell and tubes. Provide manufacturer's certified data report, Form No. U-1.
- B. Plate and Frame Heat Exchanger:
 1. Fixed frame with bolted removable corrugated channel plate assembly, ASME code stamped for 150 psig working pressure.
 2. Corrugated channel plates shall be type 316 or 304 stainless steel.
 3. Channel plate ports to be double gasketed to prevent mixing or cross-contamination of hot side and cold side fluids. Gaskets to be EPPM.
 4. Channel plate carrying bars to be carbon steel with zinc yellow chromate finish.
 5. Fixed frame plates and moveable pressure plates to be corrosion resistant epoxy painted carbon steel.
 6. Piping connections 2" and smaller to be carbon steel NPT tappings. Piping connections 4" and larger to be studed port design to accept ANSI flange connections. Connection ports to be integral to the frame or pressure plate.
 7. Finished units to be provided with OSHA required, formed aluminum splash guards to enclose exterior channel plate and gasket surfaces.
 8. Provide two sets of replacement gaskets and provide one set of wrenches for disassembly of plate type heat exchangers.
 9. Performance: As scheduled on drawings.

- C. Optional Heat Transfer Package: In lieu of field erected individual components, the Contractor may provide a factory or shop assembled package of converters, pumps, and other components supported on a welded steel frame. Refer to Section 23 22 13, STEAM and STEAM CONDENSATE HEATING PIPING, for additional requirements
- D. Air Purger: Cast iron or fabricated steel, 861 kPa (125 psig) water working pressure, for in-line installation.
- E. Tangential Air Separator: ASME Pressure Vessel Code construction for 861 kPa (125 psig) working pressure, flanged tangential inlet and outlet connection, internal perforated stainless steel air collector tube designed to direct released air into expansion tank, bottom blowdown connection. Provide Form No. U-1. If scheduled on the drawings, provide a removable stainless steel strainer element having 5 mm (3/16 inch) perforations and free area of not less than five times the cross-sectional area of connecting piping.
- F. Diaphragm Type Pre-Pressurized Expansion Tank: ASME Pressure Vessel Code construction for 861 kPa (125 psig) working pressure, welded steel shell, rust-proof coated, with a flexible elastomeric diaphragm suitable for a maximum operating temperature of 116 degrees C (240 degrees F). Provide Form No. U-1. Tank shall be equipped with system connection, drain connection, standard air fill valve and be factory pre-charged to a minimum of 83 kPa (12 psig).
- G. Closed Expansion (Compression) Tank: ASME Pressure Vessel Code construction for 861 kPa (125 psig) working pressure, steel, rust-proof coated. Provide gage glass, with protection guard, and angle valves with tapped openings for drain (bottom) and plugged vent (top). Provide Form No. U-1.
 - 1. Horizontal tank: Provide cradle supports and following accessories:
 - a. Air control tank fittings: Provide in each expansion tank to facilitate air transfer from air separator, or purger, into tank while restricting gravity circulation. Fitting shall include an integral or separate air vent tube, cut to length of about 2/3 of tank diameter, to allow venting air from the tank when establishing the initial water level in the tank.
 - b. Tank drainer-air charger: Shall incorporate a vent tube, cut to above 2/3 of tank diameter, and drain valve with hose connection draining and recharging with air.

2. Vertical floor-mounted expansion tank: Provide gage glass, system or drain connection (bottom) and air charging (top) tappings. Provide gate valve and necessary adapters for charging system. Tank support shall consist of floor mounted base ring with drain access opening or four angle iron legs with base plates.
- H. Pressure Reducing Valve (Water): Diaphragm or bellows operated, spring loaded type, with minimum adjustable range of 28 kPa (4 psig) above and below set point. Bronze, brass or iron body and bronze, brass or stainless steel trim, rated 861 kPa (125 psig) working pressure at 107 degrees C (225 degrees F).
- I. Pressure Relief Valve: Bronze or iron body and bronze or stainless steel trim, with testing lever. Comply with ASME Code for Pressure Vessels, Section 8, and bear ASME stamp.
- J. Automatic Air Vent Valves (where shown): Cast iron or semi-steel body, 1034 kPa (150 psig) working pressure, stainless steel float, valve, valve seat and mechanism, minimum 15 mm (1/2 inch) water connection and 6 mm (1/4 inch) air outlet. Air outlet shall be piped to the nearest floor drain.

2.14 WATER FILTERS AND POT CHEMICAL FEEDERS

See section 23 25 00, HVAC WATER TREATMENT, Article 2.2, CHEMICAL TREATMENT FOR CLOSED LOOP SYSTEMS.

2.15 GAGES, PRESSURE AND COMPOUND

- A. ASME B40.100, Accuracy Grade 1A, (pressure, vacuum, or compound for air, oil or water), initial mid-scale accuracy 1 percent of scale (Qualify grade), metal or phenolic case, 115 mm (4-1/2 inches) in diameter, 6 mm (1/4 inch) NPT bottom connection, white dial with black graduations and pointer, clear glass or acrylic plastic window, suitable for board mounting. Provide red "set hand" to indicate normal working pressure.
- B. Provide brass lever handle union cock. Provide brass/bronze pressure snubber for gages in water service.
- C. Range of Gages: Provide range equal to at least 130 percent of normal operating range.
1. For condenser water suction (compound): Minus 100 kPa (30 inches Hg) to plus 700 kPa (100 psig).

2.16 PRESSURE/TEMPERATURE TEST PROVISIONS

- A. Pete's Plug: 6 mm (1/4 inch) MPT by 75 mm (3 inches) long, brass body and cap, with retained safety cap, nordel self-closing valve cores,

permanently installed in piping where shown, or in lieu of pressure gage test connections shown on the drawings.

B. Provide one each of the following test items to the Resident Engineer:

1. 6 mm (1/4 inch) FPT by 3 mm (1/8 inch) diameter stainless steel pressure gage adapter probe for extra long test plug. PETE'S 500 XL is an example.
2. 90 mm (3-1/2 inch) diameter, one percent accuracy, compound gage, -- 100 kPa (30 inches) Hg to 700 kPa (100 psig) range.
3. 0 - 104 degrees C (220 degrees F) pocket thermometer one-half degree accuracy, 25 mm (one inch) dial, 125 mm (5 inch) long stainless steel stem, plastic case.

2.17 THERMOMETERS

- A. Mercury or organic liquid filled type, red or blue column, clear plastic window, with 150 mm (6 inch) brass stem, straight, fixed or adjustable angle as required for each in reading.
- B. Case: Chrome plated brass or aluminum with enamel finish.
- C. Scale: Not less than 225 mm (9 inches), range as described below, two degree graduations.
- D. Separable Socket (Well): Brass, extension neck type to clear pipe insulation.
- E. Scale ranges:
 1. Chilled Water and Glycol-Water: 0-38 degrees C (32-100 degrees F).
 2. Hot Water and Glycol-Water: -1 - 116 degrees C (30-240 degrees F).

2.18 FIRESTOPPING MATERIAL

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

2.19 ELECTRICAL HEAT TRACING SYSTEMS

- A. Systems shall meet requirements of the National Electrical Code (NEC), Section 427.
- C. Heat tracing shall be provided to the extent shown on the drawings (Floor plans and Elevations). Heat tracing shall extend below grade to below the defined frost line.
- D. Heating Cable: Flexible, parallel circuit construction consisting of a continuous self-limiting resistance, conductive inner core material between two parallel copper bus wires, designed for cut-to-length at the job site and for wrapping around valves and complex fittings.

Self-regulation shall prevent overheating and burnouts even where the cable overlaps itself.

1. Provide end seals at ends of circuits. Wire at the ends of the circuits is not to be tied together.
2. Provide sufficient cable, as recommended by the manufacturer, to keep the pipe surface at 2.2 degrees C (36 degrees F) minimum during winter outdoor design temperature, but not less than the following:
 - a. 75 mm (3 inch) pipe and smaller with 25 mm (1 inch) thick insulation: 4 watts per foot of pipe.
 - b. 100 mm (4 inch) pipe and larger 38 mm (1-1/2 inch) thick insulation: 8 watts per feet of pipe.

E. Electrical Heating Tracing Accessories:

1. Power supply connection fitting and stainless steel mounting brackets. Provide stainless steel worm gear clamp to fasten bracket to pipe.
2. 13 mm (1/2 inch) wide fiberglass reinforced pressure sensitive cloth tape to fasten cable to pipe at 300 mm (12 inch) intervals.
3. Pipe surface temperature control thermostat: Cast aluminum, NEMA 4 (watertight) enclosure, 13 mm (1/2 inch) NPT conduit hub, SPST switch rated 20 amps at 480 volts AC, with capillary and copper bulb sensor. Set thermostat to maintain pipe surface temperature at not less than 1.1 degrees C (34 degrees F).
4. Signs: Manufacturer's standard (NEC Code), stamped "ELECTRIC TRACED" located on the insulation jacket at 3000 mm (10 feet) intervals along the pipe on alternating sides.

PART 3 - EXECUTION

3.1 GENERAL

- A. The drawings show the general arrangement of pipe and equipment but do not show all required fittings and offsets that may be necessary to connect pipes to equipment, fan-coils, coils, radiators, etc., and to coordinate with other trades. Provide all necessary fittings, offsets and pipe runs based on field measurements and at no additional cost to the government. Coordinate with other trades for space available and relative location of HVAC equipment and accessories to be connected on ceiling grid. Pipe location on the drawings shall be altered by contractor where necessary to avoid interferences and clearance difficulties.

- B. Store materials to avoid excessive exposure to weather or foreign materials. Keep inside of piping relatively clean during installation and protect open ends when work is not in progress.
- C. Support piping securely. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION. Install heat exchangers at height sufficient to provide gravity flow of condensate to the flash tank and condensate pump.
- D. Install piping generally parallel to walls and column center lines, unless shown otherwise on the drawings. Space piping, including insulation, to provide 25 mm (one inch) minimum clearance between adjacent piping or other surface. Unless shown otherwise, slope drain piping down in the direction of flow not less than 25 mm (one inch) in 12 m (40 feet). Provide eccentric reducers to keep bottom of sloped piping flat.
- E. Locate and orient valves to permit proper operation and access for maintenance of packing, seat and disc. Generally locate valve stems in overhead piping in horizontal position. Provide a union adjacent to one end of all threaded end valves. Control valves usually require reducers to connect to pipe sizes shown on the drawing. Install butterfly valves with the valve open as recommended by the manufacturer to prevent binding of the disc in the seat.
- F. Offset equipment connections to allow valving off for maintenance and repair with minimal removal of piping. Provide flexibility in equipment connections and branch line take-offs with 3-elbow swing joints where noted on the drawings.
- G. Tee water piping runouts or branches into the side of mains or other branches. Avoid bull-head tees, which are two return lines entering opposite ends of a tee and exiting out the common side.
- H. Provide manual or automatic air vent at all piping system high points and drain valves at all low points. Install piping to floor drains from all automatic air vents.
- I. Connect piping to equipment as shown on the drawings. Install components furnished by others such as:
 - 1. Water treatment pot feeders and condenser water treatment systems.
 - 2. Flow elements (orifice unions), control valve bodies, flow switches, pressure taps with valve, and wells for sensors.
- J. Thermometer Wells: In pipes 65 mm (2-1/2 inches) and smaller increase the pipe size to provide free area equal to the upstream pipe area.

- K. Firestopping: Fill openings around uninsulated piping penetrating floors or fire walls, with firestop material. For firestopping insulated piping refer to Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION.
- L. Where copper piping is connected to steel piping, provide dielectric connections.

3.2 PIPE JOINTS

- A. Welded: Beveling, spacing and other details shall conform to ASME B31.1 and AWS B2.1. See Welder's qualification requirements under "Quality Assurance" in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Screwed: Threads shall conform to ASME B1.20; joint compound shall be applied to male threads only and joints made up so no more than three threads show. Coat exposed threads on steel pipe with joint compound, or red lead paint for corrosion protection.
- C. Mechanical Joint: Pipe grooving shall be in accordance with joint manufacturer's specifications. Lubricate gasket exterior including lips, pipe ends and housing interiors to prevent pinching the gasket during installation. Lubricant shall be as recommended by coupling manufacturer.
- D. 125 Pound Cast Iron Flange (Plain Face): Mating flange shall have raised face, if any, removed to avoid overstressing the cast iron flange.
- E. Solvent Welded Joints: As recommended by the manufacturer.

3.3 EXPANSION JOINTS (BELLOWS AND SLIP TYPE)

- A. Anchors and Guides: Provide type, quantity and spacing as recommended by manufacturer of expansion joint and as shown. A professional engineer shall verify in writing that anchors and guides are properly designed for forces and moments which will be imposed.
- B. Cold Set: Provide setting of joint travel at installation as recommended by the manufacturer for the ambient temperature during the installation.
- C. Preparation for Service: Remove all apparatus provided to restrain joint during shipping or installation. Representative of manufacturer shall visit the site and verify that installation is proper.
- D. Access: Expansion joints must be located in readily accessible space. Locate joints to permit access without removing piping or other

devices. Allow clear space to permit replacement of joints and to permit access to devices for inspection of all surfaces and for adding.

3.5 LEAK TESTING ABOVEGROUND PIPING

- A. Inspect all joints and connections for leaks and workmanship and make corrections as necessary, to the satisfaction of the Resident Engineer. Tests may be either of those below, or a combination, as approved by the Resident Engineer.
- B. An operating test at design pressure, and for hot systems, design maximum temperature.
- C. A hydrostatic test at 1.5 times design pressure. For water systems the design maximum pressure would usually be the static head, or expansion tank maximum pressure, plus pump head. Factory tested equipment (convertors, exchangers, coils, etc.) need not be field tested. Isolate equipment where necessary to avoid excessive pressure on mechanical seals and safety devices.

3.6 FLUSHING AND CLEANING PIPING SYSTEMS

- A. Water Piping: Clean systems as recommended by the suppliers of chemicals specified in Section 23 25 00, HVAC WATER TREATMENT.
 - 1. Initial flushing: Remove loose dirt, mill scale, metal chips, weld beads, rust, and like deleterious substances without damage to any system component. Provide temporary piping or hose to bypass coils, control valves, exchangers and other factory cleaned equipment unless acceptable means of protection are provided and subsequent inspection of hide-out areas takes place. Isolate or protect clean system components, including pumps and pressure vessels, and remove any component which may be damaged. Open all valves, drains, vents and strainers at all system levels. Remove plugs, caps, spool pieces, and components to facilitate early debris discharge from system. Sectionalize system to obtain debris carrying velocity of 1.8 m/S (6 feet per second), if possible. Connect dead-end supply and return headers as necessary. Flush bottoms of risers. Install temporary strainers where necessary to protect down-stream equipment. Supply and remove flushing water and drainage by various type hose, temporary and permanent piping and Contractor's booster pumps. Flush until clean as approved by the Resident Engineer.
 - 2. Cleaning: Using products supplied in Section 23 25 00, HVAC WATER TREATMENT, circulate systems at normal temperature to remove adherent organic soil, hydrocarbons, flux, pipe mill varnish, pipe

joint compounds, iron oxide, and like deleterious substances not removed by flushing, without chemical or mechanical damage to any system component. Removal of tightly adherent mill scale is not required. Keep isolated equipment which is "clean" and where dead-end debris accumulation cannot occur. Sectionalize system if possible, to circulate at velocities not less than 1.8 m/S (6 feet per second). Circulate each section for not less than four hours. Blow-down all strainers, or remove and clean as frequently as necessary. Drain and prepare for final flushing.

3. Final Flushing: Return systems to conditions required by initial flushing after all cleaning solution has been displaced by clean make-up. Flush all dead ends and isolated clean equipment. Gently operate all valves to dislodge any debris in valve body by throttling velocity. Flush for not less than one hour.

3.7 WATER TREATMENT

- A. Install water treatment equipment and provide water treatment system piping.
- B. Close and fill system as soon as possible after final flushing to minimize corrosion.
- C. Charge systems with chemicals specified in Section 23 25 00, HVAC WATER TREATMENT.
- D. Utilize this activity, by arrangement with the Resident Engineer, for instructing VA operating personnel.

3.8 ELECTRIC HEAT TRACING

- A. Install tracing as recommended by the manufacturer.
- B. Coordinate electrical connections.

3.9 OPERATING AND PERFORMANCE TEST AND INSTRUCTION

- A. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Adjust red set hand on pressure gages to normal working pressure.

- - - E N D - - -

RORSECTION 23 21 23
HYDRONIC PUMPS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Hydronic pumps for Heating, Ventilating and Air Conditioning.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- C. Section 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS.
- D. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- E. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.
- F. Section 23 21 13, HYDRONIC PIPING.
- G. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT.
- H. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.

1.3 QUALITY ASSURANCE

- A. Refer to Paragraph, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Design Criteria:
 - 1. Pumps design and manufacturer shall conform to Hydraulic Institute Standards.
 - 2. Pump sizes, capacities, pressures, operating characteristics and efficiency shall be as scheduled.
 - 3. Head-capacity curves shall slope up to maximum head at shut-off. Curves shall be relatively flat for closed systems. Select pumps near the midrange of the curve, so the design capacity falls to the left of the best efficiency point, to allow a cushion for the usual drift to the right in operation, without approaching the pump curve end point and possible cavitation and unstable operation. Select pumps

for open systems so that required net positive suction head (NPSHR) does not exceed the net positive head available (NPSHA).

4. Pump Driver: Furnish with pump. Size shall be non-overloading at any point on the head-capacity curve, including in a parallel or series pumping installation with one pump in operation.
5. Provide all pumps with motors, impellers, drive assemblies, bearings, coupling guard and other accessories specified. Statically and dynamically balance all rotating parts.
6. Furnish each pump and motor with a nameplate giving the manufacturers name, serial number of pump, capacity in GPM and head in feet at design condition, horsepower, voltage, frequency, speed and full load current and motor efficiency.
7. Test all pumps before shipment. The manufacturer shall certify all pump ratings.
8. After completion of balancing, provide replacement of impellers or trim impellers to provide specified flow at actual pumping head, as installed.

C. Allowable Vibration Tolerance for Pump Units: Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 1. Pumps and accessories.
 2. Motors and drives.
 3. Variable speed motor controllers.
- C. Manufacturer's installation, maintenance and operating instructions, in accordance with Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- D. Characteristic Curves: Head-capacity, efficiency-capacity, brake horsepower-capacity, and NPSHR-capacity for each pump and for combined pumps in parallel or series service. Identify pump and show fluid

pumped, specific gravity, pump speed and curves plotted from zero flow to maximum for the impeller being furnished and at least the maximum diameter impeller that can be used with the casing.

1.5 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only:

B. American Iron and Steel Institute (AISI):

AISI 1045Cold Drawn Carbon Steel Bar, Type 1045

AISI 416Type 416 Stainless Steel

C. American National Standards Institute (ANSI):

ANSI B15.1-00(R2008)..... Safety Standard for Mechanical Power
Transmission Apparatus

ANSI B16.1-05Cast Iron Pipe Flanges and Flanged Fittings,
Class 25, 125, 250 and 800

D. American Society for Testing and Materials (ASTM):

A48-03 (2008)Standard Specification for Gray Iron Castings

B62-2009Standard Specification for Composition Bronze or
Ounce Metal Castings

E. Maintenance and Operating Manuals in accordance with Section 01 00 00,
General Requirements.

1.6 DEFINITIONS

A. Capacity: Liters per second (L/s) (Gallons per minute (GPM) of the fluid pumped.

B. Head: Total dynamic head in kPa (feet) of the fluid pumped.

C. Flat head-capacity curve: Where the shutoff head is less than 1.16 times the head at the best efficiency point.

1.7 SPARE MATERIALS

A. Furnish one spare seal and casing gasket for each pump to the// Resident Engineer//Project Manager//.

PART 2 - PRODUCTS

2.1 CENTRIFUGAL PUMPS, BRONZE FITTED

A. General:

1. Provide pumps that will operate continuously without overheating bearings or motors at every condition of operation on the pump curve, or produce noise audible outside the room or space in which installed.
2. Provide pumps of size, type and capacity as indicated, complete with electric motor and drive assembly, unless otherwise indicated. Design pump casings for the indicated working pressure and factory test at 1½ times the designed pressure.
3. Provide pumps of the same type, the product of a single manufacturer, with pump parts of the same size and type interchangeable.
4. General Construction Requirements
 - a. Balance: Rotating parts, statically and dynamically.
 - b. Construction: To permit servicing without breaking piping or motor connections.
 - c. Pump Motors: Provide high efficiency motors, inverter duty for variable speed service. Refer to Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT. Motors shall be Open Drip Proof and operate at 1750 rpm unless noted otherwise.
 - d. Heating pumps shall be suitable for handling water to 225°F.
 - e. Provide coupling guards that meet ANSI B15.1, Section 8 and OSHA requirements.
 - f. Pump Connections: Flanged.
 - g. Pump shall be factory tested.
 - h. Performance: As scheduled on the Contract Drawings.
5. Variable Speed Pumps:
 - a. The pumps shall be the type shown on the drawings and specified herein flex coupled to an open drip-proof motor.

- b. Variable Speed Motor Controllers: Refer to Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS and to Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION paragraph, Variable Speed Motor Controllers. Furnish controllers with pumps and motors.
 - c. Pump operation and speed control shall be as shown on the drawings.
- B. In-Line Type, Base Mounted End Suction or Double Suction Type:
- 1. Casing and Bearing Housing: Close-grained cast iron, ASTM A48.
 - 2. Casing Wear Rings: Bronze.
 - 3. Suction and Discharge: Plain face flange, 850 kPa (125 psig), ANSI B16.1.
 - 4. Casing Vent: Manual brass cock at high point.
 - 5. Casing Drain and Gage Taps: 15 mm (1/2-inch) plugged connections minimum size.
 - 6. Impeller: Bronze, ASTM B62, enclosed type, keyed to shaft.
 - 7. Shaft: Steel, AISI Type 1045 or stainless steel.
 - 8. Shaft Seal: Manufacturer's standard mechanical type to suit pressure and temperature and fluid pumped.
 - 9. Shaft Sleeve: Bronze or stainless steel.
 - 10. Motor: Furnish with pump. Refer to Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT.
 - 11. Base Mounted Pumps:
 - a. Designed for disassembling for service or repair without disturbing the piping or removing the motor.
 - b. Impeller Wear Rings: Bronze.
 - c. Shaft Coupling: Non-lubricated steel flexible type or spacer type with coupling guard, ANSI B15.1, bolted to the baseplate.
 - d. Bearings (Double-Suction pumps): Regreaseable ball or roller type.

Provide lip seal and slinger outboard of each bearing.

- e. Base: Cast iron or fabricated steel for common mounting to a concrete base.
- 12. Provide line sized shut-off valve and suction strainer, maintain manufacturer recommended straight pipe length on pump suction (with blow down valve). Contractor option: Provide suction diffuser as follows:
 - a. Body: Cast iron with steel inlet vanes and combination diffuser-strainer-orifice cylinder with 5 mm (3/16-inch) diameter openings for pump protection. Provide taps for strainer blowdown and gage connections.
 - b. Provide adjustable foot support for suction piping.
 - c. Strainer free area: Not less than five times the suction piping.
 - d. Provide disposable start-up strainer.

2.2

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Follow manufacturer's written instructions for pump mounting and start-up. Access/Service space around pumps shall not be less than minimum space recommended by pumps manufacturer.
- B. Provide drains for bases and seals for base mounted pumps, piped to and discharging into floor drains.
- C. Coordinate location of thermometer and pressure gauges as per Section 23 21 13, HYDRONIC PIPING.

3.2 START-UP

- A. Verify that the piping system has been flushed, cleaned and filled.
- B. Lubricate pumps before start-up.
- C. Prime the pump, vent all air from the casing and verify that the rotation is correct. To avoid damage to mechanical seals, never start or run the pump in dry condition.
- D. Verify that correct size heaters-motor over-load devices are installed for each pump controller unit.

- E. Field modifications to the bearings and or impeller (including trimming) are not permitted. If the pump does not meet the specified vibration tolerance send the pump back to the manufacturer for a replacement pump. All modifications to the pump shall be performed at the factory.
- F. Ensure the disposable strainer is free of debris prior to testing and balancing of the hydronic system.
- G. After several days of operation, replace the disposable start-up strainer with a regular strainer in the suction diffuser.

- - - E N D - - -

SECTION 23 22 13
STEAM AND CONDENSATE HEATING PIPING

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Steam, condensate and vent piping inside buildings. Boiler plant and outside steam distribution piping is covered in specification Section 33 63 00, STEAM ENERGY DISTRIBUTION and Section 23 21 11, BOILER PLANT PIPING SYSTEMS.

1.2 RELATED WORK

- A. Excavation and backfill: Section 31 20 11, EARTH MOVING (Short Form).
- D. General mechanical requirements and items, which are common to more than one section of Division 23: Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- E. Pumps: Section 23 22 23, STEAM CONDENSATE PUMPS.
- F. Piping insulation: Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION.
- H. Water treatment for open and closed systems: Section 23 25 00, HVAC WATER TREATMENT.
- I. Heating Coils and Humidifiers: Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS and SECTION 23 31 00, HVAC DUCTS AND CASING.
- L. Temperature and pressure sensors and valve operators: Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

1.3 QUALITY ASSURANCE

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION, which includes welding qualifications.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Pipe and equipment supports
 - 2. Pipe and tubing, with specification, class or type, and schedule.
 - 3. Pipe fittings, including miscellaneous adapters and special fittings.
 - 4. Flanges, gaskets and bolting.
 - 5. Valves of all types.
 - 6. Strainers.
 - 7. Pipe alignment guides.
 - 8. Expansion joints.
 - 9. Expansion compensators.
 - 10. Flexible ball joints: Catalog sheets, performance charts, schematic drawings, specifications and installation instructions.

11. All specified steam system components.
 12. Gages.
 13. Thermometers and test wells.
 14. Electric heat tracing systems.
- C. Manufacturer's certified data report, Form No. U-1, for ASME pressure vessels:
1. Heat Exchangers (Steam-to-Hot Water).
 2. Flash tanks.
- D. Coordination Drawings: Refer to Article, SUBMITTALS of Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- E. As-Built Piping Diagrams: Provide drawing as follows for steam and steam condensate piping and other central plant equipment.
1. One wall-mounted stick file for prints. Mount stick file in the chiller plant or adjacent control room along with control diagram stick file.
 2. One set of reproducible drawings.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers/American National Standards Institute (ASME/ANSI):
- B1.20.1-83(R2006).....Pipe Threads, General Purpose (Inch)
 - B16.4-2006.....Gray Iron Threaded Fittings
- C. American Society of Mechanical Engineers (ASME):
- B16.1-2005.....Gray Iron Pipe Flanges and Flanged Fittings
 - B16.3-2006.....Malleable Iron Threaded Fittings
 - B16.9-2007.....Factory-Made Wrought Buttwelding Fittings
 - B16.11-2005.....Forged Fittings, Socket-Welding and Threaded
 - B16.14-91.....Ferrous Pipe Plugs, Bushings, and Locknuts with
Pipe Threads
 - B16.22-2001.....Wrought Copper and Copper Alloy Solder-Joint
Pressure Fittings
 - B16.23-2002.....Cast Copper Alloy Solder Joint Drainage Fittings
 - B16.24-2006.....Cast Copper Alloy Pipe Flanges and Flanged
Fittings, Class 150, 300, 400, 600, 900, 1500
and 2500
 - B16.39-98.....Malleable Iron Threaded Pipe Unions, Classes
150, 250, and 300
 - B31.1-2007.....Power Piping
 - B31.9-2008.....Building Services Piping

B40.100-2005.....Pressure Gauges and Gauge Attachments
Boiler and Pressure Vessel Code: SEC VIII D1-2001, Pressure Vessels,
Division 1

D. American Society for Testing and Materials (ASTM):

A47-99.....Ferritic Malleable Iron Castings
A53-2007.....Pipe, Steel, Black and Hot-Dipped, Zinc-Coated,
Welded and Seamless
A106-2008.....Seamless Carbon Steel Pipe for High-Temperature
Service
A126-2004.....Standard Specification for Gray Iron Castings
for Valves, Flanges, and Pipe Fittings
A181-2006.....Carbon Steel Forgings, for General-Purpose
Piping
A183-2003 Carbon Steel Track Bolts and Nuts
A216-2008 Standard Specification for Steel Castings,
Carbon, Suitable for Fusion Welding, for High
Temperature Service
A285-01 Pressure Vessel Plates, Carbon Steel, Low-and-
Intermediate-Tensile Strength
A307-2007 Carbon Steel Bolts and Studs, 60,000 PSI Tensile
Strength
A516-2006 Pressure Vessel Plates, Carbon Steel, for
Moderate-and- Lower Temperature Service
A536-84(2004)e1 Standard Specification for Ductile Iron Castings
B32-2008 Solder Metal
B61-2008 Steam or Valve Bronze Castings
B62-2009 Composition Bronze or Ounce Metal Castings
B88-2003 Seamless Copper Water Tube
F439-06 Socket-Type Chlorinated Poly (Vinyl Chloride)
(CPVC) Plastic Pipe Fittings, Schedule 80
F441-02(2008)Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic
Pipe, Schedules 40 and 80

E. American Welding Society (AWS):

A5.8-2004.....Filler Metals for Brazing and Braze Welding
B2.1-00.....Welding Procedure and Performance Qualifications

F. Manufacturers Standardization Society (MSS) of the Valve and Fitting
Industry, Inc.:

SP-67-95.....Butterfly Valves
SP-70-98.....Cast Iron Gate Valves, Flanged and Threaded Ends
SP-71-97.....Gray Iron Swing Check Valves, Flanged and
Threaded Ends

SP-72-99.....Ball Valves with Flanged or Butt-Welding Ends
for General Service

SP-78-98.....Cast Iron Plug Valves, Flanged and Threaded Ends

SP-80-97.....Bronze Gate, Globe, Angle and Check Valves

SP-85-94.....Cast Iron Globe and Angle Valves, Flanged and
Threaded Ends

G. Military Specifications (Mil. Spec.):

MIL-S-901D-1989.....Shock Tests, H.I. (High Impact) Shipboard
Machinery, Equipment, and Systems

H. National Board of Boiler and Pressure Vessel Inspectors (NB): Relieving
Capacities of Safety Valves and Relief Valves

I. Tubular Exchanger Manufacturers Association: TEMA 18th Edition, 2000

PART 2 - PRODUCTS

2.1 PIPE AND EQUIPMENT SUPPORTS, PIPE SLEEVES, AND WALL AND CEILING PLATES

A. Provide in accordance with Section 23 05 11, COMMON WORK RESULTS FOR
HVAC AND STEAM GENERATION.

2.2 PIPE AND TUBING

A. Steam Piping: Steel, ASTM A53, Grade B, seamless or ERW; A106 Grade B,
Seamless; Schedule 40.

B. Steam Condensate and Pumped Condensate Piping:

1. Concealed above ceiling, in wall or chase: Copper water tube ASTM
B88, Type K, hard drawn.

2. All other locations: Copper water tube ASTM B88, Type K, hard drawn;
or steel, ASTM A53, Grade B, Seamless or ERW, or A106 Grade B
Seamless, Schedule 80.

C. Vent Piping: Steel, ASTM A53, Grade B, seamless or ERW; A106 Grade B,
Seamless; Schedule 40, galvanized.

2.3 FITTINGS FOR STEEL PIPE

A. 50 mm (2 inches) and Smaller: Screwed or welded.

1. Butt welding: ASME B16.9 with same wall thickness as connecting
piping.

2. Forged steel, socket welding or threaded: ASME B16.11.

3. Screwed: 150 pound malleable iron, ASME B16.3. 125 pound cast iron,
ASME B16.4, may be used in lieu of malleable iron, except for steam
and steam condensate piping. Provide 300 pound malleable iron, ASME
B16.3 for steam and steam condensate piping. Cast iron fittings or
piping is not acceptable for steam and steam condensate piping.
Bushing reduction of a single pipe size, or use of close nipples, is
not acceptable.

4. Unions: ASME B16.39.

5. Steam line drip station and strainer quick-couple blowdown hose connection: Straight through, plug and socket, screw or cam locking type for 15 mm (1/2 inch) ID hose. No integral shut-off is required.
- B. 65 mm (2-1/2 inches) and Larger: Welded or flanged joints.
 1. Butt welding fittings: ASME B16.9 with same wall thickness as connecting piping. Elbows shall be long radius type, unless otherwise noted.
 2. Welding flanges and bolting: ASME B16.5:
 - a. Steam service: Weld neck or slip-on, raised face, with non-asbestos gasket. Non-asbestos gasket shall either be stainless steel spiral wound strip with flexible graphite filler or compressed inorganic fiber with nitrile binder rated for saturated and superheated steam service 750 degrees F and 1500 psi.
 - b. Flange bolting: Carbon steel machine bolts or studs and nuts, ASTM A307, Grade B.
- C. Welded Branch and Tap Connections: Forged steel weldolets, or branchlets and threadolets may be used for branch connections up to one pipe size smaller than the main. Forged steel half-couplings, ASME B16.11 may be used for drain, vent and gage connections.

2.4 FITTINGS FOR COPPER TUBING

- A. Solder Joint:
 1. Joints shall be made up in accordance with recommended practices of the materials applied. Apply 95/5 tin and antimony on all copper piping.
- B. Bronze Flanges and Flanged Fittings: ASME B16.24.
- C. Fittings: ANSI/ASME B16.18 cast copper or ANSI/ASME B16.22 solder wrought copper.

2.5 DIELECTRIC FITTINGS

- A. Provide where copper tubing and ferrous metal pipe are joined.
- B. 50 mm (2 inches) and Smaller: Threaded dielectric union, ASME B16.39.
- C. 65 mm (2 1/2 inches) and Larger: Flange union with dielectric gasket and bolt sleeves, ASME B16.42.
- D. Temperature Rating, 121 degrees C (250 degrees F) for steam condensate and as required for steam service.
- E. Contractor's option: On pipe sizes 2" and smaller, screwed end brass gate valves // or dielectric nipples // may be used in lieu of dielectric unions.

2.6 SCREWED JOINTS

- A. Pipe Thread: ANSI B1.20.
- B. Lubricant or Sealant: Oil and graphite or other compound approved for the intended service.

2.7 VALVES

- A. Asbestos packing is not acceptable.
- B. All valves of the same type shall be products of a single manufacturer.
- C. Provide chain operators for valves 150 mm (6 inches) and larger when the centerline is located 2100 mm (7 feet) or more above the floor or operating platform.
- D. Shut-Off Valves
 - 1. Gate Valves:
 - a. 50 mm (2 inches) and smaller: MSS-SP80, Bronze, 1034 kPa (150 lb.), wedge disc, rising stem, union bonnet.
 - b. 65 mm (2 1/2 inches) and larger: Flanged, outside screw and yoke.
 - 1) High pressure steam 413 kPa (60 psig) and above nominal MPS system): Cast steel body, ASTM A216 grade WCB, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel solid disc and seats. Provide 25 mm (1 inch) factory installed bypass with globe valve on valves 100 mm (4 inches) and larger.
 - 2) All other services: MSS-SP 70, iron body, bronze mounted, 861 kPa (125 psig) wedge disc.
- E. Globe and Angle Valves:
 - 1. Globe Valves:
 - a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.) Globe valves shall be union bonnet with metal plug type disc.
 - b. 65 mm (2 1/2 inches) and larger:
 - 1) Globe valves for high pressure steam 413 kPa (60 psig) and above nominal MPS system): Cast steel body, ASTM A216 grade WCB, flanged, OS&Y, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel disc and renewable seat rings.
 - 2) All other services: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-85 for globe valves.
 - 2. Angle Valves
 - a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.) Angle valves shall be union bonnet with metal plug type disc.
 - b. 65 mm (2 1/2 inches) and larger:
 - 1) Angle valves for high pressure steam 413 kPa (60 psig) and above nominal MPS system): Cast steel body, ASTM A216 grade WCB, flanged, OS&Y, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel disc and renewable seat rings.

- 2) All other services: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-85 for angle valves.

F. Swing Check Valves

1. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 psig), 45 degree swing disc.
2. 65 mm (2-1/2 inches) and Larger:
 - a Check valves for high pressure steam 413 kPa (60 psig) and above nominal MPS system: Cast steel body, ASTM A216 grade WCB, flanged, OS&Y, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel disc and renewable seat rings.
 - b. All other services: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-71 for check valves.

- G. Manual Radiator/Convactor Valves: Brass, packless, with position indicator.

2.8 STRAINERS

- A. Basket or Y Type. Tee type is acceptable for gravity flow and pumped steam condensate service.
- B. High Pressure Steam: Rated 1034 kPa (150 psig) saturated steam.
1. 50 mm (2 inches) and smaller: Iron, ASTM A116 Grade B, or bronze, ASTM B-62 body with screwed connections (250 psig).
 2. 65 mm (2-1/2 inches) and larger: Flanged cast steel or 1723 kPa (250 psig) cast iron.
- C. All Other Services: Rated 861 kPa (125 psig) saturated steam.
1. 50 mm (2 inches) and smaller: Cast iron or bronze.
 2. 65 mm (2-1/2 inches) and larger: Flanged, iron body.
- D. Screens: Bronze, monel metal or 18-8 stainless steel, free area not less than 2-1/2 times pipe area, with perforations as follows:
1. 75 mm (3 inches) and smaller: 20 mesh for steam and 1.1 mm (0.045 inch) diameter perforations for liquids.
 2. 100 mm (4 inches) and larger: 1.1 mm (0.045) inch diameter perforations for steam and 3.2 mm (0.125 inch) diameter perforations for liquids.

2.9 PIPE ALIGNMENT

- A. Guides: Provide factory-built guides along the pipe line to permit axial movement only and to restrain lateral and angular movement. Guides must be designed to withstand a minimum of 15 percent of the axial force which will be imposed on the expansion joints and anchors. Field-built guides may be used if detailed on the contract drawings.

2.10 EXPANSION JOINTS

- A. Factory built devices, inserted in the pipe lines, designed to absorb axial cyclical pipe movement which results from thermal expansion and contraction. This includes factory-built or field-fabricated guides located along the pipe lines to restrain lateral pipe motion and direct the axial pipe movement into the expansion joints.
- B. Minimum Service Requirements:
 - 1. Pressure Containment:
 - a. Steam Service 35-200 kPa (5-30 psig): Rated 345 kPa (50 psig) at 148 degrees C (298 degrees F).
 - b. Steam Service 214-850 kPa (31-125 psig): Rated 1025 kPa (150 psig) at 186 degrees C (366 degrees F).
 - c. Steam Service 869-1025 kPa (126-150 psig): Rated 1375 kPa (200 psig) at 194 degrees C (382 degrees F).
 - d. Condensate Service: Rated 690 kPa (100 psig) at 154 degrees C (310 degrees F).
 - 2. Number of Full Reverse Cycles without failure: Minimum 1000.
 - 3. Movement: As shown on drawings plus recommended safety factor of manufacturer.
- C. Manufacturing Quality Assurance: Conform to Expansion Joints Manufacturers Association Standards.
- D. Bellows - Internally Pressurized Type:
 - 1. Multiple corrugations of Type 304 or Type A240-321 stainless steel.
 - 2. Internal stainless steel sleeve entire length of bellows.
 - 3. External cast iron equalizing rings for services exceeding 340 kPa (50 psig).
 - 4. Welded ends.
 - 5. Design shall conform to standards of EJMA and ASME B31.1.
 - 6. External tie rods designed to withstand pressure thrust force upon anchor failure if one or both anchors for the joint are at change in direction of pipeline.
 - 7. Integral external cover.
- E. Bellows - Externally Pressurized Type:
 - 1. Multiple corrugations of Type 304 stainless steel.
 - 2. Internal and external guide integral with joint.
 - 3. Design for external pressurization of bellows to eliminate squirm.
 - 4. Welded ends.
 - 5. Conform to the standards of EJMA and ASME B31.1.
 - 6. Threaded connection at bottom, 25 mm (one inch) minimum, for drain or drip point.
 - 7. Integral external cover and internal sleeve.

- F. Expansion Joint Identification: Provide stamped brass or stainless steel nameplate on each expansion joint listing the manufacturer, the allowable movement, flow direction, design pressure and temperature, date of manufacture, and identifying the expansion joint by the identification number on the contract drawings.

2.11 FLEXIBLE BALL JOINTS

- A. Design and Fabrication: One piece component construction, fabricated from steel with welded ends, designed for a working steam pressure of 1720 kPa (250 psig) and a temperature of 232 degrees C (450 degrees F). Each joint shall provide for 360 degrees rotation in addition to a minimum angular flexible movement of 30 degrees for sizes 6 mm (1/4 inch) to 150 mm (6 inch) inclusive, and 15 degrees for sizes 65 mm (2-1/2 inches) to 750 mm (30 inches). Joints through 350 mm (14 inches) shall have forged pressure retaining members; while size 400 mm (16 inches) through 760 mm (30 inches) shall be of one piece construction.
- B. Material:
1. Cast or forged steel pressure containing parts and bolting in accordance with Section II of the ASME Boiler Code or ASME B31.1. Retainer may be ductile iron ASTM A536, Grade 65-45-12, or ASME Section II SA 515, Grade 70.
 2. Gaskets: Steam pressure molded composition design for a temperature range of from minus 10 degrees C (50 degrees F) to plus 274 degrees C (525 degrees F).
- C. Certificates: Submit qualifications of ball joints in accordance with the following test data:
1. Low pressure leakage test: 41 kPa (6psig) saturated steam for 60 days.
 2. Flex cycling: 800 Flex cycles at 3445 kPa (500 psig) saturated steam.
 3. Thermal cycling: 100 saturated steam pressure cycles from atmospheric pressure to operating pressure and back to atmospheric pressure.
 4. Environmental shock tests: Forward certificate from a recognized test laboratory, that ball joints of the type submitted has passed shock testing in accordance with Mil. Spec MIL-S-901.
 5. Vibration: 170 hours on each of three mutually perpendicular axis at 25 to 125 Hz; 1.3 mm to 2.5 mm (0.05 inch to 0.1 inch) double amplitude on a single ball joint and 3 ball joint off set.

2.12 STEAM SYSTEM COMPONENTS

- A. Heat Exchanger (Steam to Hot Water): Shell and tube type, U-bend removable tube bundle, steam in shell, water in tubes, equipped with support cradles.
1. Maximum tube velocity: 2.3 m/s (7.5 feet per second).

2. Tube fouling factor: TEMA Standards, but not less than $0.00018 \text{ m}^2\text{K/W}$ ($0.001 \text{ ft}^2\text{hrF/Btu}$).
3. Materials:
 - a. Shell: Steel.
 - b. Tube sheet and tube supports: Steel or brass.
 - c. Tubes: 20 mm (3/4 inch) OD copper.
 - d. Head or bonnet: Cast iron or steel.
4. Construction: In accordance with ASME Pressure Vessel Code for 861 kPa (125 psig) working pressure for shell and tubes. Provide manufacturer's certified data report, Form No. U-1.
- B. Optional Heat Transfer Package: In lieu of field erected individual components, the Contractor may provide a factory or shop assembled package of heat exchangers, pumps, and other components supported on a welded steel frame.
- C. Steam Pressure Reducing Valves in PRV Stations:
 1. Type: Single-seated, diaphragm operated, spring-loaded, external or internal steam pilot-controlled, normally closed, adjustable set pressure. Pilot shall sense controlled pressure downstream of main valve.
 2. Service: Provide controlled reduced pressure to steam piping systems.
 3. Pressure control shall be smooth and continuous with maximum drop of 10 percent. Maximum flow capability of each valve shall not exceed capacity of downstream safety valve(s).
 4. Main valve and pilot valve shall have replaceable valve plug and seat of stainless steel, monel, or similar durable material.
 - a. Pressure rating for high pressure steam: Not less than 1034 kPa (150 psig) saturated steam.
 - b. Connections: Flanged for valves 65 mm (2-1/2 inches) and larger; flanged or threaded ends for smaller valves.
 5. Select pressure reducing valves to develop less than 85 dbA at 1500 mm (5 feet) elevation above adjacent floor, and 1500 mm (5 feet) distance in any direction. Inlet and outlet piping for steam pressure reducing valves shall be Schedule 80 minimum for required distance to achieve required levels or sound attenuators shall be applied.

DESIGNER NOTE: Use pneumatically controlled valves for replacement of existing valves in existing facilities where continued use of pneumatics is required by the VA

- //6. Pneumatically controlled valve: May be furnished in lieu of steam-operation. All specification requirements for steam operated valves apply. Valves shall close on failure of air supply.//
- D. Safety Valves and Accessories: Comply with ASME Boiler and Pressure Vessel Code, Section VIII. Capacities shall be certified by National Board of Boiler and Pressure Vessel Inspectors, maximum accumulation 10 percent. Provide lifting lever. Provide drip pan elbow where shown.
- E. Steam PRV for Individual Equipment: Cast iron or bronze body, screwed or flanged ends, rated 861 kPa (125 psig) working pressure. Single-seated, diaphragm operated, spring loaded, adjustable range, all parts renewable.
- F. Flash Tanks: Horizontal or vertical vortex type, constructed of copper bearing steel, ASTM A516 or ASTM A285, for a steam working pressure of 861 kPa (125 psig) to comply with ASME Code for Unfired Pressure Vessels and stamped with "U" symbol. Perforated pipe inside tank shall be ASTM A53 Grade B, Seamless or ERW, or A106 Grade B Seamless, Schedule 80. Corrosion allowance of 1.6 mm (1/16 inch) may be provided in lieu of the copper bearing requirement. Provide data Form No. U-1.
- G. Steam Trap: Each type of trap shall be the product of a single manufacturer. Provide trap sets at all low points and at 61 m (200 feet) intervals on the horizontal main lines.
1. Floats and linkages shall provide sufficient force to open trap valve over full operating pressure range available to the system. Unless otherwise indicated on the drawings, traps shall be sized for capacities indicated at minimum pressure drop as follows:
 - a. For equipment with modulating control valve: 1.7 kPa (1/4 psig), based on a condensate leg of 300 mm (12 inches) at the trap inlet and gravity flow to the receiver.
 - b. For main line drip trap sets and other trap sets at steam pressure: Up to 70 percent of design differential pressure. Condensate may be lifted to the return line.
 2. Trap bodies: Bronze, cast iron, or semi-steel, constructed to permit ease of removal and servicing working parts without disturbing connecting piping. For systems without relief valve traps shall be 5. Mechanism: Brass, stainless steel or corrosion resistant alloy. rated for the pressure upstream of the PRV supplying the system.
 3. Balanced pressure thermostatic elements: Phosphor bronze, stainless steel or monel metal.
 4. Valves and seats: Suitable hardened corrosion resistant alloy.
 6. Floats: Stainless steel.

7. Inverted bucket traps: Provide bi-metallic thermostatic element for rapid release of non-condensables.
- H. Thermostatic Air Vent (Steam): Brass or iron body, balanced pressure bellows, stainless steel (renewable) valve and seat, rated 861 kPa (125 psig) working pressure, 20 mm (3/4 inch) screwed connections. Air vents shall be balanced pressure type that responds to steam pressure-temperature curve and vents air at any pressure.
- I. Steam Humidifiers:
 1. Steam separator type that discharges steam into the air stream through a steam jacketed distribution manifold or dispersion tube. Humidifiers shall be complete with Y-type steam supply strainer; modulating, normally closed steam control valve; normally closed condensate temperature switch; and manufacturer's standard steam trap.
 2. Steam separator: Stainless steel or cast iron.
 3. Distribution manifold: Stainless steel, composed of dispersion pipe and surrounding steam jacket, manifold shall span the width of duct or air handler, and shall be multiple manifold type under any of the following conditions:
 - a. Duct section height exceeds 900 mm (36 inches).
 - b. Duct air velocity exceeds 5.1 m/s (1000 feet per minute).
 - b. If within 900 mm (3 feet) upstream of fan, damper or pre-filter.
 - d. If within 3000 mm (10 feet) upstream of after-filter.
- J. Unfired clean steam generator
 1. Provide a packaged factory assembled, pre-piped unfired steam generator consisting of stainless steel shell, stainless steel tube coil, stainless steel steam piping, valves and controls All stainless steel piping shall be type //304//316 factory-fabricated and provided as a part of the complete package.
 2. Shell: Stainless steel ASME code construction with flanged piping connections. 345 kPa (50 psig) maximum WSP.
 3. Tubes: Copper tubes suitable for 862 kPa (125 psig) working pressure.
 4. Design: Heated fluid in shell and heating fluid (higher pressure steam) in tubes.
 5. Each steam generator shall be furnished with the following accessories:
 - a. Resilient insulation.
 - b. Pilot operated modulating control valve with pressure controller.
 - c. Control pilot to maintain constant steam output.

- d. Pressure relief valve.
 - e. Vessel and tube side pressure gages.
 - f. Liquid level controller with brass feed water solenoid valve, in check valve and strainer.
 - g. Over-pressure limit system with auto-reset.
 - h. Factory packaging.
 - i. Dual F&T condensate traps.
 - j. Manual blow down valve.
 - k. //Time based//TDS based// automatic blow down
 - l. Low water cut-off and high pressure cut-off.
 - m. Fully wired control box.
 - n. Automatic drain solenoid valve.
6. Provide solid state control module with LED backlit LCD display and LED pilot lights to indicate on-off, high pressure, low pressure, low water and water feed. Control module shall allow the local adjustment of pressure limits on display screen. Control module shall have alarm light and alarm horn with built in alarm silence relay. Control module shall be supplied with dry contact closure outputs to indicate to building automation controls (BAC) the occurrence of power on, high pressure, low pressure, low water and water feed. The control module shall allow the BAC to turn the unfired steam generator on or off through a remote relay suitable for 24 VAC, 1 amp. The control module shall allow the BAC to remotely monitor the operating pressure. Control module shall be supplied with an on-off switch and shall be mounted in a NEMA 1 panel. All solenoids and limits shall be 24 VAC.
- K. Steam Gun Set: Furnish for ready coupling to building steam and cold water and designed for rinsing equipment (such as carts and racks) with hot or cold water, cleaning such articles with detergent-laden hot water or steam, or alternately sanitizing the articles with only live steam.
- 1. Gun: Fit gun for finger-tip release of steam. Design so siphoning action will automatically mix detergent with gun effluent. Equip gun with hardwood front and rear handgrips. Include a 25 mm (15/16-inch) diameter, double tube butyl hose reinforced with braid and designed for 1034 kPa (150 psig) pressure. Hose shall be 3600 mm (12 feet) long.
 - 2. Detergent Tank: Furnish 9.5 L (2-1/2 gallon) polyethylene or fiberglass storage tank and fit for wall mounting. Also provide 13 mm (1/2 inch) diameter neoprene double wall detergent hose of the same length as steam hose. Fit hose-to-tank connection with strainer. Fit

- other end of hose with valve to regulate amount of detergent to be mixed with steam.
3. Steam/Water Selector: Furnish manifold for wall mounting; design manifold to deliver only steam or water, or steam and water mix to gun. Construct mounting panel of stainless steel. Valves and piping located in panel shall be brass.
 4. Accessories: Provide one pair of protective gloves and three 50 mm (2 inch) diameter brushes, one nylon and two stainless-steel.
- L. Steam Hose and Accessories: Hose shall be sufficiently flexible to be placed in a 100 mm (4 feet) diameter coil.
1. Furnish and install in the mechanical room housing each PRV station a 7500 mm (25 feet) length of 13 mm (1/2 inch) ID steam hose, rated 861 kPa (125 psig) and a hose rack. In one end of the hose install a quick-couple device, suitable for steam service, to match corresponding devices in the PRV blowdown connections.
 2. Hose storage rack: Wall-mounted, steel, iron or aluminum, semi-circular shape, with capacity to store 7500 mm (25 feet) of 13 mm (1/2 inch) ID steam hose.
- M. Steam Flow Meter/Recorder: Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
- N. Steam Exhaust Head: Cast iron, fitted with baffle plates, to trap and drain condensed water.

2.13 GAGES, PRESSURE AND COMPOUND

- A. ASME B40.1, Accuracy Grade 1A, (pressure, vacuum, or compound), initial mid-scale accuracy 1 percent of scale (Qualify grade), metal or phenolic case, 115 mm (4-1/2 inches) in diameter, 6 mm (1/4 inch) NPT bottom connection, white dial with black graduations and pointer, clear glass or acrylic plastic window, suitable for board mounting. Provide red "set hand" to indicate normal working pressure.
- B. Provide brass, lever handle union cock. Provide brass/bronze pressure snubber for gages in water service. Provide brass pigtail syphon for steam gages.
- C. Range of Gages: For services not listed provide range equal to at least 130 percent of normal operating range:

Low pressure steam and steam condensate to 103 kPa(15 psig)	0 to 207 kPa (30 psig).
Medium pressure steam and steam condensate nominal 413 kPa (60 psig)	0 to 689 kPa (100 psig).
High pressure steam and steam condensate nominal 620 kPa to 861 kPa (90 to 125 psig)	0 to 1378 kPa (200 psig).

Pumped condensate, steam condensate, gravity or vacuum (30" HG to 30 psig)	0 to 415 kPa (60 psig)
--	------------------------

2.14 PRESSURE/TEMPERATURE TEST PROVISIONS

- A. Provide one each of the following test items to the Resident Engineer:
1. 6 mm (1/4 inch) FPT by 3 mm (1/8 inch) diameter stainless steel pressure gage adapter probe for extra long test plug. PETE'S 500 XL is an example.
 2. 90 mm (3-1/2 inch) diameter, one percent accuracy, compound gage, 762 mm (30 inches) Hg to 689 kPa (100 psig) range.
 3. 0 - 104 degrees C (32-220 degrees F) pocket thermometer one-half degree accuracy, 25 mm (one inch) dial, 125 mm (5 inch) long stainless steel stem, plastic case.

2.15 FIRESTOPPING MATERIAL

- A. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

2.16 ELECTRICAL HEAT TRACING SYSTEMS

- //A. Systems shall meet requirements of the National Electrical Code (NEC), Section 427.
- C. Heat tracing shall be provided to the extent shown on the drawings (Floor Plans and Elevations). Heat tracing shall extend below grade to below the defined frost line.
- D. Heating Cable: Flexible, parallel circuit construction consisting of a continuous self-limiting resistance, conductive inner core material between two parallel copper bus wires, designed for cut-to-length at the job site and for wrapping around valves and complex fittings. Self-regulation shall prevent overheating and burnouts even where the cable overlaps itself.
1. Provide end seals at ends of circuits. Wires at the ends of the circuits are not to be tied together.
 2. Provide sufficient cable, as recommended by the manufacturer, to keep the pipe surface at 2.2 degrees C (36 degrees F) minimum during winter outdoor design temperature, but not less than the following:
 - a. 75 mm (3 inch) pipe and smaller with 25 mm (1 inch) thick insulation: 4 watts per foot of pipe.
 - b. 100 mm (4 inch) pipe and larger 38 mm (1-1/2 inch) thick insulation: 8 watts per feet of pipe.
- E. Electrical Heating Tracing Accessories:

1. Power supply connection fitting and stainless steel mounting brackets. Provide stainless steel worm gear clamp to fasten bracket to pipe.
2. 13 mm (1/2 inch) wide fiberglass reinforced pressure sensitive cloth tape to fasten cable to pipe at 300 mm (12 inch) intervals.
3. Pipe surface temperature control thermostat: Cast aluminum, NEMA 4 (watertight) enclosure, 13 mm (1/2 inch) NPT conduit hub, SPST switch rated 20 amps at 480 volts AC, with capillary and copper bulb sensor. Set thermostat to maintain pipe surface temperature at not less than 1.1 degrees C (34 degrees F).
4. Signs: Manufacturer's standard (NEC Code), stamped "ELECTRIC TRACED" located on the insulation jacket at 3000 mm (10 feet) intervals along the pipe on alternating sides.

PART 3 - EXECUTION

3.1 GENERAL

- A. The drawings show the general arrangement of pipe and equipment but do not show all required fittings and offsets that may be necessary to connect pipes to equipment, fan-coils, coils, radiators, etc., and to coordinate with other trades. Provide all necessary fittings, offsets and pipe runs based on field measurements and at no additional cost to the government. Coordinate with other trades for space available and relative location of HVAC equipment and accessories to be connected on ceiling grid. Pipe location on the drawings shall be altered by contractor where necessary to avoid interferences and clearance difficulties.
- B. Store materials to avoid excessive exposure to weather or foreign materials. Keep inside of piping relatively clean during installation and protect open ends when work is not in progress.
- C. Support piping securely. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION. Install convertors and other heat exchangers at height sufficient to provide gravity flow of condensate to the flash tank and condensate pump.
- D. Install piping generally parallel to walls and column center lines, unless shown otherwise on the drawings. Space piping, including insulation, to provide 25 mm (one inch) minimum clearance between adjacent piping or other surface. Unless shown otherwise, slope steam, condensate and drain piping down in the direction of flow not less than 25 mm (one inch) in 12 m (40 feet). Provide eccentric reducers to keep bottom of sloped piping flat.
- E. Locate and orient valves to permit proper operation and access for maintenance of packing, seat and disc. Generally locate valve stems in

overhead piping in horizontal position. Provide a union adjacent to one end of all threaded end valves. Control valves usually require reducers to connect to pipe sizes shown on the drawing. Install butterfly valves with the valve open as recommended by the manufacturer to prevent binding of the disc in the seat.

- F. Offset equipment connections to allow valving off for maintenance and repair with minimal removal of piping. Provide flexibility in equipment connections and branch line take-offs with 3-elbow swing joints where noted on the drawings.
- G. Tee water piping runouts or branches into the side of mains or other branches. Avoid bull-head tees, which are two return lines entering opposite ends of a tee and exiting out the common side.
- H. Connect piping to equipment as shown on the drawings. Install components furnished by others such as:
 - 1. Flow elements (orifice unions), control valve bodies, flow switches, pressure taps with valve, and wells for sensors.
- I. Firestopping: Fill openings around uninsulated piping penetrating floors or fire walls, with firestop material. For firestopping insulated piping refer to Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION.
- J. Where copper piping is connected to steel piping, provide dielectric connections.
- K. Pipe vents to the exterior. Where a combined vent is provided, the cross sectional area of the combined vent shall be equal to sum of individual vent areas. Slope vent piping one inch in 40 feet (0.25 percent) in direction of flow. Provide a drip trap elbow on relief valve outlets if the vent rises to prevent backpressure. Terminate vent minimum 0.3 M (12 inches) above the roof or through the wall minimum 2.5 M (8 feet) above grade with down turned elbow.

3.2 PIPE JOINTS

- A. Welded: Beveling, spacing and other details shall conform to ASME B31.1 and AWS B2.1. See Welder's qualification requirements under "Quality Assurance" in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Screwed: Threads shall conform to ASME B1.20; joint compound shall be applied to male threads only and joints made up so no more than three threads show. Coat exposed threads on steel pipe with joint compound, or red lead paint for corrosion protection.
- C. 125 Pound Cast Iron Flange (Plain Face): Mating flange shall have raised face, if any, removed to avoid overstressing the cast iron flange.

3.3 EXPANSION JOINTS (BELLOWS AND SLIP TYPE)

- A. Anchors and Guides: Provide type, quantity and spacing as recommended by manufacturer of expansion joint and as shown. A professional engineer shall verify in writing that anchors and guides are properly designed for forces and moments which will be imposed.
- B. Cold Set: Provide setting of joint travel at installation as recommended by the manufacturer for the ambient temperature during the installation.
- C. Preparation for Service: Remove all apparatus provided to restrain joint during shipping or installation. Representative of manufacturer shall visit the site and verify that installation is proper.
- D. Access: Expansion joints must be located in readily accessible space. Locate joints to permit access without removing piping or other devices. Allow clear space to permit replacement of joints and to permit access to devices for inspection of all surfaces and for adding packing.

3.4 STEAM TRAP PIPING

- A. Install to permit gravity flow to the trap. Provide gravity flow (avoid lifting condensate) from the trap where modulating control valves are used. Support traps weighing over 11 kg (25 pounds) independently of connecting piping.

3.6 LEAK TESTING

- A. Inspect all joints and connections for leaks and workmanship and make corrections as necessary, to the satisfaction of the Resident Engineer in accordance with the specified requirements. Testing shall be performed in accordance with the specification requirements.
- B. An operating test at design pressure, and for hot systems, design maximum temperature.
- C. A hydrostatic test at 1.5 times design pressure. For water systems the design maximum pressure would usually be the static head, or expansion tank maximum pressure, plus pump head. Factory tested equipment (convertors, exchangers, coils, etc.) need not be field tested. Avoid excessive pressure on mechanical seals and safety devices.

3.7 FLUSHING AND CLEANING PIPING SYSTEMS

- A. Steam, Condensate and Vent Piping: No flushing or chemical cleaning required. Accomplish cleaning by pulling all strainer screens and cleaning all scale/dirt legs during start-up operation.

3.8 OPERATING AND PERFORMANCE TEST AND INSTRUCTION

- A. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Adjust red set hand on pressure gages to normal working pressure.

- - - E N D - - -

SECTION 23 22 23
STEAM CONDENSATE PUMPS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Steam condensate pumps for Heating, Ventilating and Air Conditioning.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- D. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- E. Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.
- F. Section 23 22 13, STEAM AND CONDENSATE HEATING PIPING.
- G. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT.

1.3 QUALITY ASSURANCE

- A. Refer to Paragraph, QUALITY ASSURANCE in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Design Criteria:
 - 1. Pumps design and manufacturer shall conform to Hydraulic Institute Standards.
 - 2. Pump sizes, capacities, pressures, operating characteristics and efficiency shall be as scheduled.
 - 3. Select pumps so that required net positive suction head (NPSHR) does not exceed the net positive head available (NPSHA).
 - 4. Pump Driver: Furnish with pump. Size shall be non-overloading at any point on the head-capacity curve including one pump operation in a parallel or series pumping installation.
 - 5. Provide all pumps with motors, impellers, drive assemblies, bearings, coupling guard and other accessories specified. Statically and dynamically balance all rotating parts.
 - 6. Furnish each pump and motor with a nameplate giving the manufacturers name, serial number of pump, capacity in GPM and head in feet at design condition, horsepower, voltage, frequency, speed and full load current and motor efficiency.
 - 7. Test all pumps before shipment. The manufacturer shall certify all pump ratings.

8. After completion of balancing, provide replacement of impellers or trim impellers to provide specified flow at actual pumping head, as installed.
9. Furnish one spare seal and casing gasket for each pump to the // Resident Engineer// Project Manager //.
- C. Allowable Vibration Tolerance for Pump Units: Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 1. Pumps and accessories.
 2. Motors and drives.
- C. Manufacturer's installation, maintenance and operating instructions, in accordance with Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- D. Characteristic Curves: Head-capacity, efficiency-capacity, brake horsepower-capacity, and NPSHR-capacity for each pump.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only:
- B. American Iron and Steel Institute (AISI):
AISI 1045Cold Drawn Carbon Steel Bar, Type 1045
AISI 416Type 416 Stainless Steel
- C. American National Standards Institute (ANSI):
ANSI B15.1-00(R2008)....Safety Standard for Mechanical Power
Transmission Apparatus
ANSI B16.1-05Cast Iron Pipe Flanges and Flanged Fittings,
Class 25, 125, 250 and 800
- D. American Society for Testing and Materials (ASTM):
A48-03(2008)Standard Specification for Gray Iron Castings
B62-09Standard Specification for Composition Bronze
or Ounce Metal Castings
- E. Maintenance and Operating Manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS.

1.6 DEFINITIONS

A. Capacity: Liters per second (L/s) (Gallons per minute (GPM)) of the fluid pumped.

B. Head: Total dynamic head in kPa (feet) of the fluid pumped.

PART 2 - PRODUCTS

2.4 PRESSURE POWERED CONDENSATE PUMP

A. Pressure-Powered Pump Packages:

1. Pump packages shall be furnished and installed as a packaged assembly of the types, sizes, capacities, and characteristics as shown on the drawings. Pump package shall be rated for 185 degrees C (365 degrees F), maximum condensate temperatures.
2. Pump package(s) shall come completely piped and mounted on a steel skid including (1) receiver/reservoir, two positive displacement pressure-powered pumps as scheduled, interconnecting piping and valves, and all accessories as hereafter specified below:
 - a. The receiver shall be of a steel elevated design, warranted for 1 year against defects in material and workmanship. Receiver shall be 150 PSIG ASME labeled and coded. Receiver shall be sized for the required condensate storage volume and flash steam capacity. Receiver shall be horizontally mounted and have openings of the appropriate size and number including: (2) inlets, (1) vent opening, (1) NPT drain with pipe plug, (1) NPT anode opening with anode, and gauge glass openings with gauge glass set consisting of (2) brass isolation valves and guard rods, and red-line tubular glass. Replaceable magnesium anode, which retards the corrosive action of most waters and adds to the service life of the tanks, shall be furnished with each receiver for corrosion protection.
 - b. Pressure-powered pumps shall be non-electric as shown on the drawings. Units shall be constructed of 1034 kPa (150 psig) ASME labeled and coded fabricated steel body, shall be float operated, and contain a condensate inlet baffle. Each unit shall have (1) inlet check valve, (1) outlet check valve, and gauge glass set with isolation valves.
 - c. The float operating mechanism shall have all moving components constructed of stainless steel and be of a snap acting design with no external seals or packing. The float mechanism shall contain a reinforced stainless steel float, (2) 300 series

stainless steel open coil design springs, and spring calibration pins.

- d. Pressure-powered pumps shall be of a non-cavitating design capable of operation on systems up to the maximum working pressure of the tank rating using steam, compressed air, or other compatible inert gas as the supply (motive) pressure. Units shall be capable of operating at temperatures up to 365 F when pumping from a 'closed' system using a compatible motive gas. Balance and fine tune motive pressure to be 138 kPa (20 psig) higher than the static backpressure.
 - e. Package shall include interconnecting piping between receiver/reservoir and the positive displacement pressure-powered pump(s). Interconnecting suction (fill) line shall be provided to each unit and each suction (fill) line shall include a gate valve for isolation.
 - f. Manufacturer shall provide the following for field installation on each pressure-powered pump:
 - 1) Cycle counter
 - 2) Removable insulation jacket
 - 3) Pressure gauge
 - 4) Drain piping
 - g. Provide the following components for each pump:
 - 1) Motive pressure reducing valve
 - 2) Safety relief valve(s)
 - 3) Motive pressure inlet strainer
 - 4) Pressure gauge with pigtail, as required
 - 5) Motive pressure drip trap(s)
 - 6) Motive pressure line check valve(s)
 - 3. The package shall be factory tested as a complete unit using steam as the motive pressure. The pump manufacturer shall furnish appropriate assembly and parts drawings, and installation and operation manuals. The package shall be shipped completely assembled, or with connection match marks if package must be shipped as sub-assemblies.
- B. Removable Insulation Jacket:
- 1. The insulation jacket should be of sewn construction with Velcro fasteners and have openings for inlet, outlet, drain, and gauge glass.

2. Materials:

- a. Liner and jacket shall be silicone impregnated heavy duty glass fiber rated for a maximum temperature of 260 degrees C (500 degrees F).
- b. Insulation shall be 25 mm (1 inch) minimum thickness, Type E needled glass fiber mat rated for a maximum temperature of 650 degrees C (1200 F).
- c. Jacket shall be sewn with Nomex thread with a UV inhibitor.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Follow manufacturer's written instructions for pump mounting and start-up. Access/Service space around pumps shall not be less than minimum space recommended by pumps manufacturer.
- B. Permanently support in-line pumps by the connecting piping only, not from the casing or the motor eye bolt.
- C. Sequence of installation for base-mounted pumps:
 1. Level and shim the unit base and grout to the concrete pad.
 2. Shim the driver and realign the pump and driver. Correct axial, angular or parallel misalignment of the shafts.
 3. Connect properly aligned and independently supported piping.
 4. Recheck alignment.
- D. Pad-mounted Condensate Pump // or Vacuum Pump //: Level, shim, bolt, and grout the unit base onto the concrete pad.
- F. Coordinate location of thermometer and pressure gauges as per Section 23 22 13, STEAM and CONDENSATE HEATING PIPING.

3.2 START-UP

- A. Verify that the piping system has been flushed, cleaned and filled.
- B. Lubricate pumps before start-up.
- C. Prime the pump, vent all air from the casing and verify that the rotation is correct. To avoid damage to mechanical seals, never start or run the pump in dry condition.
- E. Field modifications to the bearings and or impeller (including trimming) are not permitted. If the pump does not meet the specified vibration tolerance send the pump back to the manufacturer for a replacement pump. All modifications to the pump shall be performed at the factory.

- - - E N D - - -

SECTION 23 23 00
REFRIGERANT PIPING

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Field refrigerant piping for direct expansion HVAC systems.
- B. Refrigerant piping shall be sized, selected, and designed either by the equipment manufacturer or in strict accordance with the manufacturer's published instructions. The schematic piping diagram shall show all accessories such as, stop valves, level indicators, liquid receivers, oil separator, gauges, thermostatic expansion valves, solenoid valves, moisture separators and driers to make a complete installation.
- C. Definitions:
 - 1. Refrigerating system: Combination of interconnected refrigerant-containing parts constituting one closed refrigeration circuit in which a refrigerant is circulated for the purpose of extracting heat.
 - a. Low side means the parts of a refrigerating system subjected to evaporator pressure.
 - b. High side means the parts of a refrigerating system subjected to condenser pressure.
 - 2. Brazed joint: A gas-tight joint obtained by the joining of metal parts with alloys which melt at temperatures higher than 449 degrees C (840 degrees F) but less than the melting temperatures of the joined parts.

1.2 RELATED WORK

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION: General mechanical requirements and items, which are common to more than one section of Division 23.
- B. Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION: Requirements for piping insulation.
- C. Section 23 64 00, PACKAGED WATER CHILLERS: Piping requirements for air cooled chillers and condensing units.
- D. Section 23 21 13, HYDRONIC PIPING: Requirements for water and drain piping and valves.

1.3 QUALITY ASSURANCE

- A. Refer to specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Comply with ASHRAE Standard 15, Safety Code for Mechanical Refrigeration. The application of this Code is intended to assure the safe design, construction, installation, operation, and inspection of

every refrigerating system employing a fluid which normally is vaporized and liquefied in its refrigerating cycle.

- C. Comply with ASME B31.5: Refrigerant Piping and Heat Transfer Components.
- D. Products shall comply with UL 207 "Refrigerant-Containing Components and Accessories, "Nonelectrical"; or UL 429 "Electrical Operated Valves."

1.4 SUBMITTALS

- A. Submit in accordance with specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Shop Drawings:
 - 1. Complete information for components noted, including valves and refrigerant piping accessories, clearly presented, shall be included to determine compliance with drawings and specifications for components noted below:
 - a. Tubing and fittings
 - b. Valves
 - c. Strainers
 - d. Moisture-liquid indicators
 - e. Filter-driers
 - f. Flexible metal hose
 - g. Liquid-suction interchanges
 - h. Oil separators (when specified)
 - i. Gages
 - j. Pipe and equipment supports
 - k. Refrigerant and oil
 - l. Pipe/conduit roof penetration cover
 - m. Soldering and brazing materials
 - 2. Layout of refrigerant piping and accessories, including flow capacities, valves locations, and oil traps slopes of horizontal runs, floor/wall penetrations, and equipment connection details.
- C. Certification: Copies of certificates for welding procedure, performance qualification record and list of welders' names and symbols.
- D. Design Manual: Furnish two copies of design manual of refrigerant valves and accessories.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Conditioning, Heating, and Refrigeration Institute (ARI/AHRI):
 - 495-1999 (R2002).....Standard for Refrigerant Liquid Receivers
 - 730-2005.....Flow Capacity Rating of Suction-Line Filters and Suction-Line Filter-Driers

- 750-2007.....Thermostatic Refrigerant Expansion Valves
- 760-2007.....Performance Rating of Solenoid Valves for Use
with Volatile Refrigerants
- C. American Society of Heating Refrigerating and Air Conditioning Engineers
(ASHRAE):
- ANSI/ASHRAE 15-2007.....Safety Standard for Refrigeration Systems (ANSI)
- ANSI/ASHRAE 17-2008.....Method of Testing Capacity of Thermostatic
Refrigerant Expansion Valves (ANSI)
- 63.1-95 (RA 01).....Method of Testing Liquid Line Refrigerant Driers
(ANSI)
- D. American National Standards Institute (ANSI):
- ASME (ANSI)A13.1-2007...Scheme for Identification of Piping Systems
- Z535.1-2006.....Safety Color Code
- E. American Society of Mechanical Engineers (ASME):
- ANSI/ASME B16.22-2001 (R2005)
- Wrought Copper and Copper Alloy Solder-Joint Pressure Fittings (ANSI)
- ANSI/ASME B16.24-2006 Cast Copper Alloy Pipe Flanges and Flanged
Fittings, Class 150, 300, 400, 600, 900, 1500 and 2500 (ANSI)
- ANSI/ASME B31.5-2006....Refrigeration Piping and Heat Transfer
Components (ANSI)
- ANSI/ASME B40.100-2005..Pressure Gauges and Gauge Attachments
- ANSI/ASME B40.200-2008..Thermometers, Direct Reading and Remote Reading
- F. American Society for Testing and Materials (ASTM)
- A126-04.....Standard Specification for Gray Iron Castings
for Valves, Flanges, and Pipe FittingsB32-08
Standard Specification for Solder Metal
- B88-03.....Standard Specification for Seamless Copper Water
Tube
- B88M-05.....Standard Specification for Seamless Copper Water
Tube (Metric)
- B280-08.....Standard Specification for Seamless Copper Tube
for Air Conditioning and Refrigeration Field
Service
- G. American Welding Society, Inc. (AWS):
- Brazing Handbook
- A5.8/A5.8M-04.....Standard Specification for Filler Metals for
Brazing and Braze Welding
- H. Federal Specifications (Fed. Spec.)
- Fed. Spec. GG
- I. Underwriters Laboratories (U.L.):

U.L.207-2009.....Standard for Refrigerant-Containing Components
and Accessories, Nonelectrical

U.L.429-99 (Rev.2006)...Standard for Electrically Operated Valves

PART 2 - PRODUCTS

2.1 PIPING AND FITTINGS

- A. Refrigerant Piping: For piping up to 100 mm (4 inch) use Copper refrigerant tube, ASTM B280, cleaned, dehydrated and sealed, marked ACR on hard temper straight lengths. Coils shall be tagged ASTM B280 by the manufacturer. For piping over 100 mm (4 inch) use A53 Black SML steel.
- B. Water and Drain Piping: Copper water tube, ASTM B88M, Type B or C (ASTM B88, Type M or L). Optional drain piping material: Schedule 80 flame retardant Polypropylene plastic.
- C. Fittings, Valves and Accessories:
 - 1. Copper fittings: Wrought copper fittings, ASME B16.22.
 - a. Brazed Joints, refrigerant tubing: Cadmium free, AWS A5.8/A5.8M, 45 percent silver brazing alloy, Class BAg-5.
 - b. Solder Joints, water and drain: 95-5 tin-antimony, ASTM B32 (95TA).
 - 2. Steel fittings: ASTM wrought steel fittings.
 - a. Refrigerant piping - Welded Joints.
 - 3. Flanges and flanged fittings: ASME B16.24.
 - 4. Refrigeration Valves:
 - a. Stop Valves: Brass or bronze alloy, packless, or packed type with gas tight cap, frost proof, back seating.
 - b. Pressure Relief Valves: Comply with ASME Boiler and Pressure Vessel Code; UL listed. Forged brass with nonferrous, corrosion resistant internal working parts of high strength, cast iron bodies conforming to ASTM A126, Grade B. Set valves in accordance with ASHRAE Standard 15.
 - c. Solenoid Valves: Comply with ARI 760 and UL 429, UL-listed, two-position, direct acting or pilot-operated, moisture and vapor-proof type of corrosion resisting materials, designed for intended service, and solder-end connections. Fitted with suitable NEMA 250 enclosure of type required by location and normally closed holding coil.
 - d. Thermostatic Expansion Valves: Comply with ARI 750. Brass body with stainless-steel or non-corrosive non ferrous internal parts, diaphragm and spring-loaded (direct-operated) type with sensing bulb and distributor having side connection for hot-gas bypass and external equalizer. Size and operating characteristics as recommended by manufacturer of evaporator and factory set for

- superheat requirements. Solder-end connections. Testing and rating in accordance with ASHRAE Standard 17.
- e. Check Valves: Brass or bronze alloy with swing or lift type, with tight closing resilient seals for silent operation; designed for low pressure drop, and with solder-end connections. Direction of flow shall be legibly and permanently indicated on the valve body.
5. Strainers: Designed to permit removing screen without removing strainer from piping system, and provided with screens 80 to 100 mesh in liquid lines DN 25 (NPS 1) and smaller, 60 mesh in liquid lines larger than DN 25 (NPS 1), and 40 mesh in suction lines. Provide strainers in liquid line serving each thermostatic expansion valve, and in suction line serving each refrigerant compressor not equipped with integral strainer.
6. Refrigerant Moisture/Liquid Indicators: Double-ported type having heavy sight glasses sealed into forged bronze body and incorporating means of indicating refrigerant charge and moisture indication. Provide screwed brass seal caps.
7. Refrigerant Filter-Dryers: UL listed, angle or in-line type, as shown on drawings. Conform to ARI Standard 730 and ASHRAE Standard 63.1. Heavy gage steel shell protected with corrosion-resistant paint; perforated baffle plates to prevent desiccant bypass. Size as recommended by manufacturer for service and capacity of system with connection not less than the line size in which installed. Filter driers with replaceable filters shall be furnished with one spare element of each type and size.
8. Flexible Metal Hose: Seamless bronze corrugated hose, covered with bronze wire braid, with standard copper tube ends. Provide in suction and discharge piping of each compressor.
9. Water Piping Valves and Accessories: Refer to specification Section 23 21 13, HYDRONIC PIPING.
10. Oil Separators: Provide for condensing units, as shown. All welded steel construction with capacity to eliminate a minimum of 95 percent of the oil from the hot gas flowing through it. Provide manufacturer's published ratings for minimum and maximum refrigeration tonnage corresponding to this oil separating efficiency. Separator shall be equipped with a float valve to prevent return of the hot gas to crankcase, and shall have isolating stop valves so it can be opened and services without pumping out any other part of the system. ASME construction or UL listed.

11. Receivers: Conform to AHRI 495, steel construction, equipped with tappings for liquid inlet and outlet valves, pressure relief valve and liquid level indicator.

2.2 GAGES

- A. Temperature Gages: Comply with ASME B40.200. Industrial-duty type and in required temperature range for service in which installed. Gages shall have Celsius scale in 1-degree (Fahrenheit scale in 2-degree) graduations and with black number on a white face. The pointer shall be adjustable. Rigid stem type temperature gages shall be provided in thermal wells located within 1525 mm (5 feet) of the finished floor. Universal adjustable angle type or remote element type temperature gages shall be provided in thermal wells located 1525 to 2135 mm (5 to 7 feet) above the finished floor. Remote element type temperature gages shall be provided in thermal wells located 2135 mm (7 feet) above the finished floor.
- B. Vacuum and Pressure Gages: Comply with ASME B40.100 and provide with throttling type needle valve or a pulsation dampener and shut-off valve. Gage shall be a minimum of 90 mm (3-1/2 inches) in diameter with a range from 0 kPa (0 psig) to approximately 1.5 times the maximum system working pressure. Each gage range shall be selected so that at normal operating pressure, the needle is within the middle-third of the range.
 1. Suction: 101 kPa (30 inches Hg) vacuum to 1723 kPa (gage) (250 psig).
 2. Discharge: 0 to 3445 kPa (gage) (0 to 500 psig).

2.3 THERMOMETERS AND WELLS

- A. Refer to specification Section 23 21 13, HYDRONIC PIPING.

2.4 PIPE SUPPORTS

- A. Refer to specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

2.5 ELECTRICAL HEAT TRACING SYSTEM

- A. Refer to specification Section 23 21 13, HYDRONIC PIPING. Provide for freezer unit cooler drain piping.

2.6 REFRIGERANTS AND OIL

- A. Provide EPA approved refrigerant and oil for proper system operation.

2.7 PIPE/CONDUIT ROOF PENETRATION COVER

- A. Prefabricated Roof Curb: Galvanized steel or extruded aluminum 300 mm (12 inches) overall height, continuous welded corner seams, treated wood nailer, 38 mm (1-1/2 inch) thick, 48 kg/cu.m (3 lb/cu.ft.) density rigid mineral fiberboard insulation with metal liner, built-in cant strip (except for gypsum or tectum decks). For surface insulated roof deck, provide raised cant strip (recessed mounting flange) to start at the

upper surface of the insulation. Curbs shall be constructed for pitched roof or ridge mounting as required to keep top of curb level.

B. Penetration Cover: Galvanized sheet metal with flanged removable top. Provide 38 mm (1-1/2 inch) thick mineral fiber board insulation.

C. Flashing Sleeves: Provide sheet metal sleeves for conduit and pipe penetrations of the penetration cover. Seal watertight penetrations.

2.8 PIPE INSULATION FOR DX HVAC SYSTEMS

Refer to specification Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION.

2.9 PIPE INSULATION FOR WALK-IN COOLERS AND FREEZERS AND LABORATORY REFRIGERATORS AND MORTUARY REFRIGERATORS

A. Flexible elastomeric: Refer to specification Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION.

B. Insulate refrigerant suction piping from unit cooler to condensing unit. Use 20 mm (3/4-inch) thick insulation on piping inside the refrigerator or freezer and 40 mm (1-1/2 inch) thick insulation (double layer required) on piping outside the refrigerated space.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Install refrigerant piping and refrigerant containing parts in accordance with ASHRAE Standard 15 and ASME B31.5

1. Install piping as short as possible, with a minimum number of joints, elbow and fittings.
2. Install piping with adequate clearance between pipe and adjacent walls and hangers to allow for service and inspection. Space piping, including insulation, to provide 25 mm (1 inch) minimum clearance between adjacent piping or other surface. Use pipe sleeves through walls, floors, and ceilings, sized to permit installation of pipes with full thickness insulation.
3. Locate and orient valves to permit proper operation and access for maintenance of packing, seat and disc. Generally locate valve stems in overhead piping in horizontal position. Provide a union adjacent to one end of all threaded end valves. Control valves usually require reducers to connect to pipe sizes shown on the drawing.
4. Use copper tubing in protective conduit when installed below ground.
5. Install hangers and supports per ASME B31.5 and the refrigerant piping manufacturer's recommendations.

B. Joint Construction:

1. Brazed Joints: Comply with AWS "Brazing Handbook" and with filler materials complying with AWS A5.8/A5.8M.

- a. Use Type BcuP, copper-phosphorus alloy for joining copper socket fittings with copper tubing.
 - b. Use Type BAg, cadmium-free silver alloy for joining copper with bronze or steel.
 - c. Swab fittings and valves with manufacturer's recommended cleaning fluid to remove oil and other compounds prior to installation.
 - d. Pass nitrogen gas through the pipe or tubing to prevent oxidation as each joint is brazed. Cap the system with a reusable plug after each brazing operation to retain the nitrogen and prevent entrance of air and moisture.
- C. Protect refrigerant system during construction against entrance of foreign matter, dirt and moisture; have open ends of piping and connections to compressors, condensers, evaporators and other equipment tightly capped until assembly.
- D. Pipe relief valve discharge to outdoors for systems containing more than 45 kg (100 lbs) of refrigerant.
- E. Firestopping: Fill openings around uninsulated piping penetrating floors or fire walls, with firestop material. For firestopping insulated piping refer to Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION.

3.2 PIPE AND TUBING INSULATION

- A. Refer to specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Apply two coats of weather-resistant finish as recommended by the manufacturer to insulation exposed to outdoor weather.

3.3 SIGNS AND IDENTIFICATION

- A. Each refrigerating system erected on the premises shall be provided with an easily legible permanent sign securely attached and easily accessible, indicating thereon the name and address of the installer, the kind and total number of pounds of refrigerant required in the system for normal operations, and the field test pressure applied.
- B. Systems containing more than 50 kg (110 lb) of refrigerant shall be provided with durable signs, in accordance with ANSI A13.1 and ANSI Z535.1, having letters not less than 13 mm (1/2 inch) in height designating:
 - 1. Valves and switches for controlling refrigerant flow, the ventilation and the refrigerant compressor(s).
 - 2. Signs on all exposed high pressure and low pressure piping installed outside the machinery room, with name of the refrigerant and the letters "HP" or "LP."

3.4 FIELD QUALITY CONTROL

Prior to initial operation examine and inspect piping system for conformance to plans and specifications and ASME B31.5. Correct equipment, material, or work rejected because of defects or nonconformance with plans and specifications, and ANSI codes for pressure piping.

- A. After completion of piping installation and prior to initial operation, conduct test on piping system according to ASME B31.5. Furnish materials and equipment required for tests. Perform tests in the presence of Resident Engineer. If the test fails, correct defects and perform the test again until it is satisfactorily done and all joints are proved tight.
 - 1. Every refrigerant-containing parts of the system that is erected on the premises, except compressors, condensers, evaporators, safety devices, pressure gages, control mechanisms and systems that are factory tested, shall be tested and proved tight after complete installation, and before operation.
 - 2. The high and low side of each system shall be tested and proved tight at not less than the lower of the design pressure or the setting of the pressure-relief device protecting the high or low side of the system, respectively, except systems erected on the premises using non-toxic and non-flammable Group A1 refrigerants with copper tubing not exceeding DN 18 (NPS 5/8). This may be tested by means of the refrigerant charged into the system at the saturated vapor pressure of the refrigerant at 20 degrees C (68 degrees F) minimum.
- B. Test Medium: A suitable dry gas such as nitrogen or shall be used for pressure testing. The means used to build up test pressure shall have either a pressure-limiting device or pressure-reducing device with a pressure-relief device and a gage on the outlet side. The pressure relief device shall be set above the test pressure but low enough to prevent permanent deformation of the system components.

3.5 SYSTEM TEST AND CHARGING

- A. System Test and Charging: As recommended by the equipment manufacturer or as follows:
 - 1. Connect a drum of refrigerant to charging connection and introduce enough refrigerant into system to raise the pressure to 70 kPa (10 psi) gage. Close valves and disconnect refrigerant drum. Test system for leaks with halide test torch or other approved method suitable for the test gas used. Repair all leaking joints and retest.

2. Connect a drum of dry nitrogen to charging valve and bring test pressure to design pressure for low side and for high side. Test entire system again for leaks.
3. Evacuate the entire refrigerant system by the triplicate evacuation method with a vacuum pump equipped with an electronic gage reading in mPa (microns). Pull the system down to 665 mPa (500 microns) 665 mPa (2245.6 inches of mercury at 60 degrees F) and hold for four hours then break the vacuum with dry nitrogen (or refrigerant). Repeat the evacuation two more times breaking the third vacuum with the refrigeration to be charged and charge with the proper volume of refrigerant.

- - - E N D - - -

SECTION 23 25 00
HVAC WATER TREATMENT

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies cleaning and treatment of circulating HVAC water systems, including the following.
 - 1. Cleaning compounds.
 - 2. Chemical treatment for closed loop heat transfer systems.
 - 3. Chemical treatment for open loop systems.
 - 4. Glycol-water heat transfer systems.

1.2 RELATED WORK

- A. Test requirements and instructions on use of equipment/system: Section 01 00 00, GENERAL REQUIREMENTS.
- B. General mechanical requirements and items, which are common to more than one section of Division 23: Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- C. Piping and valves: Section 23 21 13, HYDRONIC PIPING and Section 23 22 13, STEAM and CONDENSATE HEATING PIPING.

1.3 QUALITY ASSURANCE

- A. Refer to paragraph, QUALITY ASSURANCE in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Technical Services: Provide the services of an experienced water treatment chemical engineer or technical representative to direct flushing, cleaning, pre-treatment, training, debugging, and acceptance testing operations; direct and perform chemical limit control during construction period and monitor systems for a period of 12 months after acceptance, including not less than 6 service calls and written status reports. Emergency calls are not included. Minimum service during construction/start-up shall be 6 hours.
- C. Field Quality Control and Certified Laboratory Reports: During the one year guarantee period, the water treatment laboratory shall provide not less than 12 reports based on on-site periodic visits, as stated in paragraph 1.3.B, sample taking and testing, and review with VA personnel, of water treatment control for the previous period. In addition to field tests, the water treatment laboratory shall provide certified laboratory test reports. These monitoring reports shall assess chemical treatment accuracy, scale formation, fouling and

corrosion control, and shall contain instructions for the correction of any out-of-control condition.

D. Log Forms: Provide one year supply of preprinted water treatment test log forms.

E. Chemicals: Chemicals shall be non-toxic approved by local authorities and meeting applicable EPA requirements.

1.4 SUBMITTALS

A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.

B. Manufacturer's Literature and Data including:

1. Cleaning compounds and recommended procedures for their use.
2. Chemical treatment for closed systems, including installation and operating instructions.
3. Chemical treatment for open loop systems, including installation and operating instructions.
4. Glycol-water system materials, equipment, and installation.

C. Water analysis verification.

D. Materials Safety Data Sheet for all proposed chemical compounds, based on U.S. Department of Labor Form No. L5B-005-4.

E. Maintenance and operating instructions in accordance with Section 01 00 00, GENERAL REQUIREMENTS.

1.5 APPLICABLE PUBLICATIONS

A. The publication listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. National Fire Protection Association (NFPA):
70-2008National Electric Code (NEC)

C. American Society for Testing and Materials (ASTM):
F441/F441M-02 (2008) ... Standard Specification for Chlorinated Poly
(Vinyl Chloride) (CPVC) Plastic Pipe, Schedules
40 and 80

PART 2 - PRODUCTS

2.1 CLEANING COMPOUNDS

A. Alkaline phosphate or non-phosphate detergent/surfactant/specific to remove organic soil, hydrocarbons, flux, pipe mill varnish, pipe compounds, iron oxide, and like deleterious substances, with or without inhibitor, suitable for system wetted metals without deleterious effects.

- B. All chemicals to be acceptable for discharge to sanitary sewer.
- C. Refer to Section 23 21 13, HYDRONIC PIPING and Section 23 22 13, STEAM and CONDENSATE HEATING PIPING, PART 3, for flushing and cleaning procedures.

2.2 CHEMICAL TREATMENT FOR CLOSED LOOP SYSTEMS

- A. Inhibitor: Provide sodium nitrite/borate, molybdate-based inhibitor or other approved compound suitable for make-up quality and make-up rate and which will cause or enhance bacteria/corrosion problems or mechanical seal failure due to excessive total dissolved solids. Shot feed manually. Maintain inhibitor residual as determined by water treatment laboratory, taking into consideration residual and temperature effect on pump mechanical seals.
- B. pH Control: Inhibitor formulation shall include adequate buffer to maintain pH range of 8.0 to 10.5.
- C. Performance: Protect various wetted, coupled, materials of construction including ferrous, and red and yellow metals. Maintain system essentially free of scale, corrosion, and fouling. Corrosion rate of following metals shall not exceed specified mills per year penetration; ferrous, 0-2; brass, 0-1; copper, 0-1. Inhibitor shall be stable at equipment skin surface temperatures and bulk water temperatures of not less than 121 degrees C (250 degrees F) and 52 degrees C (125 degrees Fahrenheit) respectively. Heat exchanger fouling and capacity reduction shall not exceed that allowed by fouling factor 0.0005.
- D. Pot Feeder: By-pass type, complete with necessary shut off valves, drain and air release valves, and system connections, for introducing chemicals into system, cast iron or steel tank with funnel or large opening on top for easy chemical addition. Feeders shall be 18.9 L (five gallon) minimum capacity at 860 kPa (125 psig) minimum working pressure.
- E. Side stream Water Filter for Closed Loop Systems: Stainless steel housing, and polypropylene filter media with stainless steel core. Filter media shall be compatible with antifreeze and water treatment chemicals used in the system. Replaceable filter cartridges for sediment removal service with minimum 20 micrometer particulate at 98 percent efficiency for approximately five (5) percent of system design flow rate. Filter cartridge shall have a maximum pressure drop of 13.8 kPa (2 psig) at design flow rate when clean, and maximum pressure drop

of 172 kPa (25 psig) when dirty. A constant flow rate valve shall be provided in the piping to the filter. Inlet and outlet pressure gauges shall be provided to monitor filter condition.

2.5 EQUIPMENT AND MATERIALS IDENTIFICATION

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Delivery and Storage: Deliver all chemicals in manufacturer's sealed shipping containers. Store in designated space and protect from deleterious exposure and hazardous spills.
- B. Install equipment furnished by the chemical treatment supplier and charge systems according to the manufacturer's instructions and as directed by the Technical Representative.
- C. Refer to Section 23 21 13 HYDRONIC PIPING for chemical treatment piping, installed as follows:
 - 1. Provide a by-pass line around water meters and bleed off piping assembly. Provide ball valves to allow for bypassing, isolation, and servicing of components.
 - 2. Bleed off water piping with bleed off piping assembly shall be piped from pressure side of circulating water piping to a convenient drain. Bleed off connection to main circulating water piping shall be upstream of chemical injection nozzles.
 - 3. Provide piping for the flow assembly piping to the main control panel and accessories.
 - a. The inlet piping shall connect to the discharge side of the circulating water pump.
 - b. The outlet piping shall connect to the water piping serving the cooling tower downstream of the heat source.
 - c. Provide inlet Y-strainer and ball valves to isolate and service main control panel and accessories.
 - 4. Install injection nozzles with corporation stops in the water piping serving the cooling tower downstream of the heat source.
 - 5. Provide piping for corrosion monitor rack per manufacturer's installation instructions. Provide ball valves to isolate and service rack.
 - 7. Provide installation supervision, start-up and operating instruction by manufacturer's technical representative.

- D. Before adding cleaning chemical to the closed system, all air handling coils and fan coil units should be isolated by closing the inlet and outlet valves and opening the bypass valves. This is done to prevent dirt and solids from lodging the coils.
- E. Do not valve in or operate system pumps until after system has been cleaned.
- F. After chemical cleaning is satisfactorily completed, open the inlet and outlet valves to each coil and close the by-pass valves. Also, clean all strainers.
- G. Perform tests and report results in accordance with Section 01 00 00, GENERAL REQUIREMENTS.
- H. After cleaning is complete, and water PH is acceptable to manufacturer of water treatment chemical, add manufacturer-recommended amount of chemicals to systems.
- I. Instruct VA personnel in system maintenance and operation in accordance with Section 01 00 00, GENERAL REQUIREMENTS.

- - - E N D - - -

SECTION 23 31 00
HVAC DUCTS AND CASINGS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Ductwork and accessories for HVAC including the following:
 - 1. Supply air, return air, outside air, exhaust, make-up air, and relief systems.
 - 3. Exhaust duct for chemical fume hoods, kitchen hood exhaust (grease) and "wet exhaust" ducts.
- B. Definitions:
 - 1. SMACNA Standards as used in this specification means the HVAC Duct Construction Standards, Metal and Flexible.
 - 2. Seal or Sealing: Use of liquid or mastic sealant, with or without compatible tape overlay, or gasketing of flanged joints, to keep air leakage at duct joints, seams and connections to an acceptable minimum.
 - 3. Duct Pressure Classification: SMACNA HVAC Duct Construction Standards, Metal and Flexible.
 - 4. Exposed Duct: Exposed to view in a finished room, exposed to weather.

1.2 RELATED WORK

- A. Fire Stopping Material: Section 07 84 00, FIRESTOPPING.
- B. Outdoor and Exhaust Louvers: Section 08 90 00, LOUVERS and VENTS.
- F. General Mechanical Requirements: Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- G. Noise Level Requirements: Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.
- H. Duct Insulation: Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION
- I. Plumbing Connections: Section 22 11 00, FACILITY WATER DISTRIBUTION
- J. Air Flow Control Valves and Terminal Units: Section 23 36 00, AIR TERMINAL UNITS.
- K. Supply Air Fans: Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS.
- L. Air Filters and Filters' Efficiencies: Section 23 40 00, HVAC AIR CLEANING DEVICES.
- M. Duct Mounted Instrumentation: Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
- N. Testing and Balancing of Air Flows: Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC.
- O. Smoke Detectors: Section 28 31 00, FIRE DETECTION and ALARM.

1.3 QUALITY ASSURANCE

- A. Refer to article, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Fire Safety Code: Comply with NFPA 90A.
- C. Duct System Construction and Installation: Referenced SMACNA Standards are the minimum acceptable quality.
- D. Duct Sealing, Air Leakage Criteria, and Air Leakage Tests: Ducts shall be sealed as per duct sealing requirements of SMACNA HVAC Air Duct Leakage Test Manual for duct pressure classes shown on the drawings.
- E. Duct accessories exposed to the air stream, such as dampers of all types (except smoke dampers) and access openings, shall be of the same material as the duct or provide at least the same level of corrosion resistance.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Rectangular ducts:
 - a. Schedules of duct systems, materials and selected SMACNA construction alternatives for joints, sealing, gage and reinforcement.
 - b. Duct liner.
 - c. Sealants and gaskets.
 - d. Access doors.
 - 2. Round and flat oval duct construction details:
 - a. Manufacturer's details for duct fittings.
 - b. Duct liner.
 - c. Sealants and gaskets.
 - d. Access sections.
 - e. Installation instructions.
 - 3. Volume dampers, back draft dampers.
 - 4. Upper hanger attachments.
 - 5. Fire dampers, fire doors, and smoke dampers with installation instructions.
 - 6. Sound attenuators, including pressure drop and acoustic performance.
 - 7. Flexible ducts and clamps, with manufacturer's installation instructions.
 - 8. Flexible connections.
 - 9. Instrument test fittings.
 - 10. Details and design analysis of alternate or optional duct systems.
 - 11 COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

C. Coordination Drawings: Refer to article, SUBMITTALS, in Section 23 05

1.5 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. American Society of Civil Engineers (ASCE):

ASCE7-05.....Minimum Design Loads for Buildings and Other
Structures

C. American Society for Testing and Materials (ASTM):

A167-99(2009).....Standard Specification for Stainless and
Heat-Resisting Chromium-Nickel Steel Plate,
Sheet, and Strip

A653-09.....Standard Specification for Steel Sheet,
Zinc-Coated (Galvanized) or Zinc-Iron Alloy
coated (Galvannealed) by the Hot-Dip process

A1011-09a.....Standard Specification for Steel, Sheet and
Strip, Hot rolled, Carbon, structural, High-
Strength Low-Alloy, High Strength Low-Alloy with
Improved Formability, and Ultra-High Strength

B209-07.....Standard Specification for Aluminum and
Aluminum-Alloy Sheet and Plate

C1071-05e1.....Standard Specification for Fibrous Glass Duct
Lining Insulation (Thermal and Sound Absorbing
Material)

E84-09a.....Standard Test Method for Surface Burning
Characteristics of Building Materials

D. National Fire Protection Association (NFPA):

90A-09.....Standard for the Installation of Air
Conditioning and Ventilating Systems

96-08.....Standard for Ventilation Control and Fire
Protection of Commercial Cooking Operations

E. Sheet Metal and Air Conditioning Contractors National Association
(SMACNA):

2nd Edition - 2005.....HVAC Duct Construction Standards, Metal and
Flexible

1st Edition - 1985.....HVAC Air Duct Leakage Test Manual

6th Edition - 2003.....Fibrous Glass Duct Construction Standards

F. Underwriters Laboratories, Inc. (UL):

181-08.....Factory-Made Air Ducts and Air Connectors

555-06Standard for Fire Dampers

555S-06Standard for Smoke Dampers

PART 2 - PRODUCTS

2.1 DUCT MATERIALS AND SEALANTS

- A. General: Except for systems specified otherwise, construct ducts, casings, and accessories of galvanized sheet steel, ASTM A653, coating G90; or, aluminum sheet, ASTM B209, alloy 1100, 3003 or 5052.
- B. Specified Corrosion Resistant Systems: Stainless steel sheet, ASTM A167, Class 302 or 304, Condition A (annealed) Finish No. 4 for exposed ducts and Finish No. 2B for concealed duct or ducts located in mechanical rooms.
- C. Optional Duct Materials:
 - 1. Grease Duct: Double wall factory-built grease duct, UL labeled and complying with NFPA 96 may be furnished in lieu of specified materials for kitchen and grill hood exhaust duct. Installation and accessories shall comply with the manufacturers catalog data. Outer jacket of exposed ductwork shall be stainless steel. Square and rectangular duct shown on the drawings will have to be converted to equivalent round size.
- D. Joint Sealing: Refer to SMACNA HVAC Duct Construction Standards, paragraph S1.9.
 - 1. Sealant: Elastomeric compound, gun or brush grade, maximum 25 flame spread and 50 smoke developed (dry state) compounded specifically for sealing ductwork as recommended by the manufacturer. Generally provide liquid sealant, with or without compatible tape, for low clearance slip joints and heavy, permanently elastic, mastic type where clearances are larger. Oil base caulking and glazing compounds are not acceptable because they do not retain elasticity and bond.
 - 2. Tape: Use only tape specifically designated by the sealant manufacturer and apply only over wet sealant. Pressure sensitive tape shall not be used on bare metal or on dry sealant.
 - 3. Gaskets in Flanged Joints: Soft neoprene.
- E. Approved factory made joints may be used.

2.2 DUCT CONSTRUCTION AND INSTALLATION

- A. Regardless of the pressure classifications outlined in the SMACNA Standards, fabricate and seal the ductwork in accordance with the following pressure classifications:
- B. Duct Pressure Classification:
 - 0 to 50 mm (2 inch)
 - > 50 mm to 75 mm (2 inch to 3 inch)
 - > 75 mm to 100 mm (3 inch to 4 inch)Show pressure classifications on the floor plans.

C. Seal Class: All ductwork shall receive Class A Seal

M. Round and Flat Oval Ducts: Furnish duct and fittings made by the same manufacturer to insure good fit of slip joints. When submitted and approved in advance, round and flat oval duct, with size converted on the basis of equal pressure drop, may be furnished in lieu of rectangular duct design shown on the drawings.

1. Elbows: Diameters 80 through 200 mm (3 through 8 inches) shall be two sections die stamped, all others shall be gored construction, maximum 18 degree angle, with all seams continuously welded or standing seam. Coat galvanized areas of fittings damaged by welding with corrosion resistant aluminum paint or galvanized repair compound.
2. Provide bell mouth, conical tees or taps, laterals, reducers, and other low loss fittings as shown in SMACNA HVAC Duct Construction Standards.
3. Ribbed Duct Option: Lighter gage round/oval duct and fittings may be furnished provided certified tests indicating that the rigidity and performance is equivalent to SMACNA standard gage ducts are submitted.
 - a. Ducts: Manufacturer's published standard gage, G90 coating, spiral lock seam construction with an intermediate standing rib.
 - b. Fittings: May be manufacturer's standard as shown in published catalogs, fabricated by spot welding and bonding with neoprene base cement or machine formed seam in lieu of continuous welded seams.
4. Provide flat side reinforcement of oval ducts as recommended by the manufacturer and SMACNA HVAC Duct Construction Standard S3.13. Because of high pressure loss, do not use internal tie-rod reinforcement unless approved by the Resident Engineer.

O. Casings and Plenums: Construct in accordance with SMACNA HVAC Duct Construction Standards Section 6, including curbs, access doors, pipe penetrations, eliminators and drain pans. Access doors shall be hollow metal, insulated, with latches and door pulls, 500 mm (20 inches) wide by 1200 - 1350 mm (48 - 54 inches) high. Provide view port in the doors where shown. Provide drain for outside air louver plenum. Outside air plenum shall have exterior insulation. Drain piping shall be routed to the nearest floor drain.

P. Volume Dampers: Single blade or opposed blade, multi-louver type as detailed in SMACNA Standards. Refer to SMACNA Detail Figure 2-12 for Single Blade and Figure 2.13 for Multi-blade Volume Dampers.

- Q. Duct Hangers and Supports: Refer to SMACNA Standards Section IV. Avoid use of trapeze hangers for round duct.
- R. Ductwork in excess of 620 cm² (96 square inches) shall be protected unless the duct has one dimension less than 150 mm (6 inches) if it passes through the areas listed below. Refer to the Mission Critical Physical Design Manual for VA Facilities. This applies to the following:
1. Agent cashier spaces
 2. Perimeter partitions of caches
 3. Perimeter partitions of computer rooms
 4. Perimeter of a COOP sites
 5. Perimeter partitions of Entrances
 6. Security control centers (SCC)

2.3 DUCT LINER (WHERE INDICATED ON DRAWINGS)

- A. Duct sizes shown on drawings for lined duct are clear opening inside lining.
- B. Duct liner is only permitted to be used for return, relief and general exhaust ducts. Duct liner is not permitted for outside air ducts, supply air ducts or any other positive pressure ductwork (provide exterior insulation only).
- C. Rectangular Duct or Casing Liner: ASTM C1071, Type I (flexible), or Type II (board), 25 mm (one inch) minimum thickness, applied with mechanical fasteners and 100 percent coverage of adhesive in conformance with SMACNA, Duct Liner Application Standard.
- D. Round and Oval Duct Liner: Factory fabricated double-walled with one inch thick sound insulation and inner perforated galvanized metal liner. Construction shall comply with flame and smoke rating required by NFPA 90A. Metal liner shall be 1.0 to 0.60 mm (20 to 24 gage) having perforations not exceeding 2.4 mm (3/32 inch) diameter and approximately 22 percent free area. Metal liner for fittings need not be perforated. Assemblies shall be complete with continuous sheet Mylar liner, 2 mil thickness, between the perforated liner and the insulation to prevent erosion of the insulation. Provide liner couplings/spacer for metal liner. At the end of insulated sections, provide insulation end fittings to reduce outer shell to liner size. Provide liner spacing/concentricity leaving airway unobstructed.

2.4 DUCT ACCESS DOORS, PANELS AND SECTIONS

- A. Provide access doors, sized and located for maintenance work, upstream, in the following locations:
1. Each duct mounted coil and humidifier.

2. Each fire damper (for link service), smoke damper and automatic control damper.
 3. Each duct mounted smoke detector.
 4. For cleaning operating room supply air duct and kitchen hood exhaust duct, locate access doors at 6 m (20 feet) intervals and at each change in duct direction.
- B. Openings shall be as large as feasible in small ducts, 300 mm by 300 mm (12 inch by 12 inch) minimum where possible. Access sections in insulated ducts shall be double-wall, insulated. Transparent shatterproof covers are preferred for uninsulated ducts.
1. For rectangular ducts: Refer to SMACNA HVAC Duct Construction Standards (Figure 2-12).
 2. For round and flat oval duct: Refer to SMACNA HVAC duct Construction Standards (Figure 2-11).

2.5 FIRE DAMPERS

- A. Galvanized steel, interlocking blade type, UL listing and label, 1-1/2 hour rating, 70 degrees C (160 degrees F) fusible line, 100 percent free opening with no part of the blade stack or damper frame in the air stream.
- B. Fire dampers in wet air exhaust shall be of stainless steel construction, all others may be galvanized steel.
- C. Minimum requirements for fire dampers:
1. The damper frame may be of design and length as to function as the mounting sleeve, thus eliminating the need for a separate sleeve, as allowed by UL 555. Otherwise provide sleeves and mounting angles, minimum 1.9 mm (14 gage), required to provide installation equivalent to the damper manufacturer's UL test installation.
 2. Submit manufacturer's installation instructions conforming to UL rating test.

2.6 SMOKE DAMPERS

- A. Maximum air velocity, through free area of open damper, and pressure loss: Low pressure and medium pressure duct (supply, return, exhaust, outside air): 450 m/min (1500 fpm). Maximum static pressure loss: 32 Pa (0.13 inch W.G.).
- B. Maximum air leakage, closed damper: 0.32 cubic meters /min/square meter (4.0 CFM per square foot) at 750 Pa (3 inch W.G.) differential pressure.
- C. Minimum requirements for dampers:
1. Shall comply with requirements of Table 6-1 of UL 555S, except for the Fire Endurance and Hose Stream Test.
 2. Frame: Galvanized steel channel with side, top and bottom stops or seals.

3. Blades: Galvanized steel, parallel type preferably, 300 mm (12 inch) maximum width, edges sealed with neoprene, rubber or felt, if required to meet minimum leakage. Airfoil (streamlined) type for minimum noise generation and pressure drop are preferred for duct mounted dampers.
 4. Shafts: Galvanized steel.
 5. Bearings: Nylon, bronze sleeve or ball type.
 6. Hardware: Zinc plated.
 7. Operation: Automatic open/close. No smoke damper that requires manual reset or link replacement after actuation is acceptable. See drawings for required control operation.
- D. Motor operator (actuator): Provide pneumatic or electric as required by the automatic control system, externally mounted on stand-offs to allow complete insulation coverage.

2.7 COMBINATION FIRE AND SMOKE DAMPERS

- A. Combination fire and smoke dampers: Multi-blade type units meeting all requirements of both fire dampers and smoke dampers shall be used where shown and may be used at the Contractor's option where applicable.

2.8 FIRE DOORS

- A. Galvanized steel, interlocking blade type, UL listing and label, 71 degrees C (160 degrees F) fusible link, 3 hour rating and approved for openings in Class A fire walls with rating up to 4 hours, 100 percent free opening with no part of the blade stack or damper frame in the air stream.

2.9 FLEXIBLE AIR DUCT

- A. General: Factory fabricated, complying with NFPA 90A for connectors not passing through floors of buildings. Flexible ducts shall not penetrate any fire or smoke barrier which is required to have a fire resistance rating of one hour or more. Flexible duct length shall not exceed 1.5 m (5 feet). Provide insulated acoustical air duct connectors in supply air duct systems and elsewhere as shown.
- B. Flexible ducts shall be listed by Underwriters Laboratories, Inc., complying with UL 181. Ducts larger than 200 mm (8 inches) in diameter shall be Class 1. Ducts 200 mm (8 inches) in diameter and smaller may be Class 1 or Class 2.
- C. Insulated Flexible Air Duct: Factory made including mineral fiber insulation with maximum C factor of 0.25 at 24 degrees C (75 degrees F) mean temperature, encased with a low permeability moisture barrier outer jacket, having a puncture resistance of not less than 50 Beach Units. Acoustic insertion loss shall not be less than 3 dB per 300 mm (foot) of

straight duct, at 500 Hz, based on 150 mm (6 inch) duct, of 750 m/min (2500 fpm).

D. Application Criteria:

1. Temperature range: -18 to 93 degrees C (0 to 200 degrees F) internal.
2. Maximum working velocity: 1200 m/min (4000 feet per minute).
3. Minimum working pressure, inches of water gage: 2500 Pa (10 inches) positive, 500 Pa (2 inches) negative.

- E. Duct Clamps: 100 percent nylon strap, 80 kg (175 pounds) minimum loop tensile strength manufactured for this purpose or stainless steel strap with cadmium plated worm gear tightening device. Apply clamps with sealant and as approved for UL 181, Class 1 installation.

2.10 FLEXIBLE DUCT CONNECTIONS

- A. Where duct connections are made to fans and air handling units, install a non-combustible flexible connection of 822 g (29 ounce) neoprene coated fiberglass fabric approximately 150 mm (6 inches) wide. For connections exposed to sun and weather provide hypalon coating in lieu of neoprene. Burning characteristics shall conform to NFPA 90A. Securely fasten flexible connections to round ducts with stainless steel or zinc-coated iron draw bands with worm gear fastener. For rectangular connections, crimp fabric to sheet metal and fasten sheet metal to ducts by screws 50 mm (2 inches) on center. Fabric shall not be stressed other than by air pressure. Allow at least 25 mm (one inch) slack to insure that no vibration is transmitted.

2.11 SOUND ATTENUATING UNITS

- A. Casing, not less than 1.0 mm (20 gage) galvanized sheet steel, or 1.3 mm (18 gage) aluminum fitted with suitable flanges to make clean airtight connections to ductwork. Sound-absorbent material faced with glass fiber cloth and covered with not less than 0.6 mm (24 gage) or heavier galvanized perforated sheet steel, or 0.85 mm (22 gage) or heavier perforated aluminum. Perforations shall not exceed 4 mm (5/32-inch) diameter, approximately 25 percent free area. Sound absorbent material shall be long glass fiber acoustic blanket meeting requirements of NFPA 90A.
- B. Entire unit shall be completely air tight and free of vibration and buckling at internal static pressures up to 2000 Pa (8 inches W.G.) at operating velocities.
- C. Pressure drop through each unit: Not to exceed indicated value at design air quantities indicated.
- D. Submit complete independent laboratory test data showing pressure drop and acoustical performance.

- E. Cap open ends of attenuators at factory with plastic, heavy duty paper, cardboard, or other appropriate material to prevent entrance of dirt, water, or any other foreign matter to inside of attenuator. Caps shall not be removed until attenuator is installed in duct system.

2.12 PREFABRICATED ROOF CURBS

- A. Galvanized steel or extruded aluminum 300 mm (12 inches) above finish roof service, continuous welded corner seams, treated wood nailer, 40 mm (1-1/2 inch) thick, 48 kg/cubic meter (3 pound/cubic feet) density rigid mineral fiberboard insulation with metal liner, built-in cant strip (except for gypsum or tectum decks). For surface insulated roof deck, provide raised cant strip (recessed mounting flange) to start at the upper surface of the insulation. Curbs shall be constructed for pitched roof or ridge mounting as required to keep top of curb level.

2.13 FIRESTOPPING MATERIAL

- A. Refer to Section 07 84 00, FIRESTOPPING.

2.15 DUCT MOUNTED THERMOMETER (AIR)

- A. Stem Type Thermometers: ASTM E1, 7 inch scale, red appearing mercury, lens front tube, cast aluminum case with enamel finish and clear glass or polycarbonate window, brass stem, 2 percent of scale accuracy to ASTM E77 scale calibrated in degrees Fahrenheit.
- B. Thermometer Supports:
 - 1. Socket: Brass separable sockets for thermometer stems with or without extensions as required, and with cap and chain.
 - 2. Flange: 3 inch outside diameter reversible flange, designed to fasten to sheet metal air ducts, with brass perforated stem.

2.16 DUCT MOUNTED TEMPERATURE SENSOR (AIR)

- A. Refer to Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

2.17 INSTRUMENT TEST FITTINGS

- A. Manufactured type with a minimum 50 mm (two inch) length for insulated duct, and a minimum 25 mm (one inch) length for duct not insulated. Test hole shall have a flat gasket for rectangular ducts and a concave gasket for round ducts at the base, and a screw cap to prevent air leakage.
- B. Provide instrument test holes at each duct or casing mounted temperature sensor or transmitter, and at entering and leaving side of each heating coil, cooling coil, and heat recovery unit.

2.18 AIR FLOW CONTROL VALVES (AFCV)

- A. Refer to Section 23 36 00 / 23 82 00, AIR TERMINAL UNITS / CONVECTION HEATING and COOLING UNITS.

2.19 LEAD COVERED DUCT

- A. Sheet Lead: 3.1 mm (1/8 inch) thick, securely installed, free of waves, lumps or wrinkles and with as few joints as possible.
- B. Joints shall be made to obtain X-ray absorption equivalent to adjacent sheet lead, and finished smooth and neat.

2.20 ELECTROSTATIC SHIELDING

- A. At the point of penetration of shielded rooms ducts shall be made electrically discontinuous by means of a flexible, nonconductive connection outside shielded room.
- B. Metallic duct portion inside shielded room shall be electrically bonded to shielding.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Comply with provisions of Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION, particularly regarding coordination with other trades and work in existing buildings.
- B. Fabricate and install ductwork and accessories in accordance with referenced SMACNA Standards:
 - 1. Drawings show the general layout of ductwork and accessories but do not show all required fittings and offsets that may be necessary to connect ducts to equipment, boxes, diffusers, grilles, etc., and to coordinate with other trades. Fabricate ductwork based on field measurements. Provide all necessary fittings and offsets at no additional cost to the government. Coordinate with other trades for space available and relative location of HVAC equipment and accessories on ceiling grid. Duct sizes on the drawings are inside dimensions which shall be altered by Contractor to other dimensions with the same air handling characteristics where necessary to avoid interferences and clearance difficulties.
 - 2. Provide duct transitions, offsets and connections to dampers, coils, and other equipment in accordance with SMACNA Standards, Section II. Provide streamliner, when an obstruction cannot be avoided and must be taken in by a duct. Repair galvanized areas with galvanizing repair compound.
 - 3. Provide bolted construction and tie-rod reinforcement in accordance with SMACNA Standards.
 - 4. Construct casings, eliminators, and pipe penetrations in accordance with SMACNA Standards, Chapter 6. Design casing access doors to swing against air pressure so that pressure helps to maintain a tight seal.

- C. Install duct hangers and supports in accordance with SMACNA Standards, Chapter 4.
- D. Install fire dampers, smoke dampers and combination fire/smoke dampers in accordance with the manufacturer's instructions to conform to the installation used for the rating test. Install fire dampers, smoke dampers and combination fire/smoke dampers at locations indicated and where ducts penetrate fire rated and/or smoke rated walls, shafts and where required by the Resident Engineer. Install with required perimeter mounting angles, sleeves, breakaway duct connections, corrosion resistant springs, bearings, bushings and hinges per UL and NFPA. Demonstrate re-setting of fire dampers and operation of smoke dampers to the Resident Engineer.
- E. Seal openings around duct penetrations of floors and fire rated partitions with fire stop material as required by NFPA 90A.
- F. Flexible duct installation: Refer to SMACNA Standards, Chapter 3. Ducts shall be continuous, single pieces not over 1.5 m (5 feet) long (NFPA 90A), as straight and short as feasible, adequately supported. Centerline radius of bends shall be not less than two duct diameters. Make connections with clamps as recommended by SMACNA. Clamp per SMACNA with one clamp on the core duct and one on the insulation jacket. Flexible ducts shall not penetrate floors, or any chase or partition designated as a fire or smoke barrier, including corridor partitions fire rated one hour or two hour. Support ducts SMACNA Standards.
- G. Where diffusers, registers and grilles cannot be installed to avoid seeing inside the duct, paint the inside of the duct with flat black paint to reduce visibility.
- H. Control Damper Installation:
 - 1. Provide necessary blank-off plates required to install dampers that are smaller than duct size. Provide necessary transitions required to install dampers larger than duct size.
 - 2. Assemble multiple sections dampers with required interconnecting linkage and extend required number of shafts through duct for external mounting of damper motors.
 - 3. Provide necessary sheet metal baffle plates to eliminate stratification and provide air volumes specified. Locate baffles by experimentation, and affix and seal permanently in place, only after stratification problem has been eliminated.
 - 4. Install all damper control/adjustment devices on stand-offs to allow complete coverage of insulation.

- I. Air Flow Measuring Devices (AFMD): Install units with minimum straight run distances, upstream and downstream as recommended by the manufacturer.
- J. Low Pressure Duct Liner: Install in accordance with SMACNA, Duct Liner Application Standard.
- K. Protection and Cleaning: Adequately protect equipment and materials against physical damage. Place equipment in first class operating condition, or return to source of supply for repair or replacement, as determined by Resident Engineer. Protect equipment and ducts during construction against entry of foreign matter to the inside and clean both inside and outside before operation and painting. When new ducts are connected to existing ductwork, clean both new and existing ductwork by mopping and vacuum cleaning inside and outside before operation.

3.2 DUCT LEAKAGE TESTS AND REPAIR

- A. Ductwork leakage testing shall be performed by the Testing and Balancing Contractor directly contracted by the General Contractor and independent of the Sheet Metal Contractor.
- B. Ductwork leakage testing shall be performed for the entire air distribution system (including all supply, return, exhaust and relief ductwork), section by section, including fans, coils and filter sections. Based upon satisfactory initial duct leakage test results, the scope of the testing may be reduced by the Resident Engineer on ductwork constructed to the 500 Pa (2" WG) duct pressure classification. In no case shall the leakage testing of ductwork constructed above the 500 Pa (2" WG) duct pressure classification or ductwork located in shafts or other inaccessible areas be eliminated.
- C. Test procedure, apparatus and report shall conform to SMACNA Leakage Test manual. The maximum leakage rate allowed is 4 percent of the design air flow rate.
- D. All ductwork shall be leak tested first before enclosed in a shaft or covered in other inaccessible areas.
- E. All tests shall be performed in the presence of the Resident Engineer and the Test and Balance agency. The Test and Balance agency shall measure and record duct leakage and report to the Resident Engineer and identify leakage source with excessive leakage.
- F. If any portion of the duct system tested fails to meet the permissible leakage level, the Contractor shall rectify sealing of ductwork to bring it into compliance and shall retest it until acceptable leakage is demonstrated to the Resident Engineer.
- G. All tests and necessary repairs shall be completed prior to insulation or concealment of ductwork.

- H. Make sure all openings used for testing flow and temperatures by TAB Contractor are sealed properly.

3.4 TESTING, ADJUSTING AND BALANCING (TAB)

- A. Refer to Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC.

3.5 OPERATING AND PERFORMANCE TESTS

- A. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION

- - - E N D - - -

SECTION 23 34 00
HVAC FANS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Fans for heating, ventilating and air conditioning.
- B. Product Definitions: AMCA Publication 99, Standard 1-66.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- D. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- E. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT.
- F. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- G. Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.
- H. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
- I. Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS.
- J. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.

1.3 QUALITY ASSURANCE

- A. Refer to paragraph, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- B. Fans and power ventilators shall be listed in the current edition of AMCA 261, and shall bear the AMCA performance seal.
- C. Operating Limits for Centrifugal Fans: AMCA 99 (Class I, II, and III).
- D. Fans and power ventilators shall comply with the following standards:
 - 1. Testing and Rating: AMCA 210.
 - 2. Sound Rating: AMCA 300.
- E. Vibration Tolerance for Fans and Power Ventilators: Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- F. Performance Criteria:
 - 1. The fan schedule shall show the design air volume and static pressure. Select the fan motor HP by increasing the fan BHP by 10 percent to account for the drive losses and field conditions.
 - 2. Select the fan operating point as follows:
 - a. Forward Curve and Axial Flow Fans: Right hand side of peak pressure point
 - b. Air Foil, Backward Inclined, or Tubular: At or near the peak static efficiency
- G. Safety Criteria: Provide manufacturer's standard screen on fan inlet and discharge where exposed to operating and maintenance personnel.

H. Corrosion Protection:

1. Except for fans in fume hood exhaust service, all steel shall be mill-galvanized, or phosphatized and coated with minimum two coats, corrosion resistant enamel paint. Manufacturers paint and paint system shall meet the minimum specifications of: ASTM D1735 water fog; ASTM B117 salt spray; ASTM D3359 adhesion; and ASTM G152 and G153 for carbon arc light apparatus for exposure of non-metallic material.
2. Fans for general purpose fume hoods, or chemical hoods, and radioisotope hoods shall be constructed of materials compatible with the chemicals being transported in the air through the fan.

I. Spark resistant construction: If flammable gas, vapor or combustible dust is present in concentrations above 20% of the Lower Explosive Limit (LEL), the fan construction shall be as recommended by AMCA's Classification for Spark Resistant Construction. Drive set shall be comprised of non-static belts for use in an explosive.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturers Literature and Data:
 1. Fan sections, motors and drives.
 2. Centrifugal fans, motors, drives, accessories and coatings.
 - a. In-line centrifugal fans.
 - b. Tubular Centrifugal Fans.
 - c. Up-blast kitchen hood exhaust fans.
 - d. Industrial fans.
 - e. Utility fans and vent sets.
 3. Prefabricated roof curbs.
 4. Power roof and wall ventilators.
 5. Centrifugal ceiling fans.
- C. Certified Sound power levels for each fan.
- D. Motor ratings types, electrical characteristics and accessories.
- E. Roof curbs.
- F. Belt guards.
- G. Maintenance and Operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS.
- H. Certified fan performance curves for each fan showing cubic feet per minute (CFM) versus static pressure, efficiency, and horsepower for design point of operation.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Movement and Control Association International, Inc. (AMCA):
- 99-86.....Standards Handbook
 - 210-06.....Laboratory Methods of Testing Fans for
Aerodynamic Performance Rating
 - 261-09.....Directory of Products Licensed to bear the AMCA
Certified Ratings Seal - Published Annually
 - 300-08.....Reverberant Room Method for Sound Testing of
Fans
- C. American Society for Testing and Materials (ASTM):
- B117-07a.....Standard Practice for Operating Salt Spray (Fog)
Apparatus
 - D1735-08.....Standard Practice for Testing Water Resistance
of Coatings Using Water Fog Apparatus
 - D3359-08.....Standard Test Methods for Measuring Adhesion by
Tape Test
 - G152-06.....Standard Practice for Operating Open Flame
Carbon Arc Light Apparatus for Exposure of Non-
Metallic Materials
 - G153-04.....Standard Practice for Operating Enclosed Carbon
Arc Light Apparatus for Exposure of Non-Metallic
Materials
- D. National Fire Protection Association (NFPA):
- NFPA 96-08.....Standard for Ventilation Control and Fire
Protection of Commercial Cooking Operations
- E. National Sanitation Foundation (NSF):
- 37-07.....Air Curtains for Entrance Ways in Food and Food
Service Establishments
- F. Underwriters Laboratories, Inc. (UL):
- 181-2005.....Factory Made Air Ducts and Air Connectors

1.6 EXTRA MATERIALS

- A. Provide one additional set of belts for all belt-driven fans.

PART 2 - PRODUCTS

2.1 FAN SECTION (CABINET FAN)

Refer to specification Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS.

2.2 CENTRIFUGAL FANS

- A. Standards and Performance Criteria: Refer to Paragraph, QUALITY ASSURANCE. Record factory vibration test results on the fan or furnish to the Contractor.
- B. Fan arrangement, unless noted or approved otherwise:
 - 1. DWD1 fans: Arrangement 3.
 - 2. SWS1 fans: Arrangement 1, 3, 9 or 10,
- C. Construction: Wheel diameters and outlet areas shall be in accordance with AMCA standards.
 - 1. Housing: Low carbon steel, arc welded throughout, braced and supported by structural channel or angle iron to prevent vibration or pulsation, flanged outlet, inlet fully streamlined. Provide lifting clips, and casing drain. Provide manufacturer's standard access door. Provide 12.5 mm (1/2 inches) wire mesh screens for fan inlets without duct connections.
 - 2. Wheel: Steel plate with die formed blades welded or riveted in place, factory balanced statically and dynamically.
 - 3. Shaft: Designed to operate at no more than 70 percent of the first critical speed at the top of the speed range of the fans class.
 - 4. Bearings: Heavy duty ball or roller type sized to produce a B10 life of not less than 50,000 hours, and an average fatigue life of 200,000 hours. Extend filled lubrication tubes for interior bearings or ducted units to outside of housing.
 - 5. Belts: Oil resistant, non-sparking and non-static.
 - 6. Belt Drives: Factory installed with final alignment belt adjustment made after installation.
 - 7. Motors and Fan Wheel Pulleys: Adjustable pitch for use with motors through 15HP, fixed pitch for use with motors larger than 15HP. Select pulleys so that pitch adjustment is at the middle of the adjustment range at fan design conditions.
 - 8. Motor, adjustable motor base, drive and guard: Furnish from factory with fan. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION for specifications. Provide protective sheet metal enclosure for fans located outdoors.
 - 9. Furnish variable speed fan motor controllers where shown on the drawings. Refer to Section, MOTOR STARTERS. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION for controller/motor combination requirements.
- D. In-line Centrifugal Fans: In addition to the requirements of paragraphs A and 2.2.C3 thru 2.2.C9, provide minimum 18 Gauge galvanized steel housing with inlet and outlet flanges, backward inclined aluminum

centrifugal fan wheel, bolted access door and supports as required.

Motors shall be factory pre-wired to an external junction box. Provide factory wired disconnect switch.

2.3 POWER ROOF VENTILATOR

- A. Standards and Performance Criteria: Refer to Paragraph, QUALITY ASSURANCE.
- B. Type: Centrifugal fan, backward inclined blades. Provide down-blast or up-blast type as indicated.
- C. Construction: Steel or aluminum, completely weatherproof, for curb mounting, exhaust cowl or entire drive assembly readily removable for servicing, aluminum bird screen on discharge, UL approved safety disconnect switch, conduit for wiring, vibration isolators for wheel, motor and drive assembly. Provide self acting back draft damper.
- D. Motor and Drive: Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION. Bearings shall be pillow block ball type with a minimum L-50 life of 200,000 hours. Motor shall be located out of air stream.
- E. Prefabricated Roof Curb: As specified in paragraph 2.3 of this section.
- F. Up-blast Type: Top discharge exhauster, motor out of air stream. For kitchen hood exhaust applications, provide grease trough on base and threaded drain. The mounting height of the kitchen up-blast exhaust fan shall be in compliance with NFPA 96. (Provide vented curb extension if required to maintain required clearances.)

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install fan, motor and drive in accordance with manufacturer's instructions.
- B. Align fan and motor sheaves to allow belts to run true and straight.
- C. Bolt equipment to curbs with galvanized lag bolts.
- D. Install vibration control devices as shown on drawings and specified in Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.

3.2 PRE-OPERATION MAINTENANCE

- A. Lubricate bearings, pulleys, belts and other moving parts with manufacturer recommended lubricants.
- B. Rotate impeller by hand and check for shifting during shipment and check all bolts, collars, and other parts for tightness.
- C. Clean fan interiors to remove foreign material and construction dirt and dust.

3.3 START-UP AND INSTRUCTIONS

- A. Verify operation of motor, drive system and fan wheel according to the drawings and specifications.
- B. Check vibration and correct as necessary for air balance work.
- C. After air balancing is complete and permanent sheaves are in place perform necessary field mechanical balancing to meet vibration tolerance in Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.

- - - E N D - - -

SECTION 23 36 00
AIR TERMINAL UNITS

PART 1 - GENERAL

1.1 DESCRIPTION

Air terminal units, air flow control valves.

1.2 RELATED WORK

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION: General mechanical requirements and items, which are common to more than one section of Division 23.
- B. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT: Noise requirements.
- C. Section 23 31 00, HVAC DUCTS AND CASINGS: Ducts and flexible connectors.
- D. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Valve operators.
- E. Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC: Flow rates adjusting and balancing.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Air Terminal Units: Submit test data.
 - 2. Air flow control valves.
- C. Samples: Provide one typical air terminal unit for approval by the Resident Engineer. This unit will be returned to the Contractor after all similar units have been shipped and deemed acceptable at the job site.
- D. Certificates:
 - 1. Compliance with paragraph, QUALITY ASSURANCE.
 - 2. Compliance with specified standards.
- E. Operation and Maintenance Manuals: Submit in accordance with paragraph, INSTRUCTIONS, in Section 01 00 00, GENERAL REQUIREMENTS.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Conditioning and Refrigeration Institute (AHRI)/(ARI):
880-08.....Air Terminals Addendum to ARI 888-98
incorporated into standard posted 15th December
2002
- C. National Fire Protection Association (NFPA):
90A-09.....Standard for the Installation of Air
Conditioning and Ventilating Systems
- D. Underwriters Laboratories, Inc. (UL):
181-08.....Standard for Factory-Made Air Ducts and Air
Connectors
- E. American Society for Testing and Materials (ASTM):
C 665-06.....Standard Specification for Mineral-Fiber
Blanket Thermal Insulation for Light Frame
Construction and Manufactured Housing

1.6 GUARANTY

In accordance with the GENERAL CONDITIONS

PART 2 - PRODUCTS

2.1 GENERAL

- A. Coils:

3. Water Heating Coils:

- a. ARI certified, continuous plate or spiral fin type, leak tested at 2070 kPa (300 PSI).
 - b. Capacity: As indicated, based on scheduled entering water temperature.
 - c. Headers: Copper or Brass.
 - d. Fins: Aluminum, maximum 315 fins per meter (8 fins per inch).
 - e. Tubes: Copper, arrange for counter-flow of heating water.
 - f. Water Flow Rate: Minimum 0.032 Liters/second (0.5 GPM).
 - g. Provide vent and drain connection at high and low point, respectively of each coil.
 - h. Coils shall be guaranteed to drain.
- B. Labeling: Control box shall be clearly marked with an identification label that lists such information as nominal CFM, maximum and minimum

factory-set airflow limits, coil type and coil connection orientation, where applicable.

- C. Factory calibrate air terminal units to air flow rate indicated. All settings including maximum and minimum air flow shall be field adjustable.
- D. Dampers with internal air volume control: See section 23 31 00 HVAC DUCTS and CASINGS.
- E. Terminal Sound Attenuators: See Section 23 31 00 (HVAC DUCTS AND CASINGS).

2.2 AIR TERMINAL UNITS (BOXES)

- A. General: Factory built, pressure independent units, factory set-field adjustable air flow rate, suitable for single duct applications. Use of dual-duct air terminal units is not permitted. Clearly show on each unit the unit number and factory set air volumes corresponding to the contract drawings. Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC work assumes factory set air volumes. Coordinate flow controller sequence and damper operation details with the drawings and Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC. All air terminal units shall be brand new products of the same manufacturer.
- B. Capacity and Performance: The Maximum Capacity of a single terminal unit shall not exceed 566 Liters/second (1,300 CFM) with the exception of operating rooms and Cystoscopy rooms, which shall be served by a single air terminal unit at a maximum of 1,250 Liters/second (3,000 CFM).
- C. Sound Power Levels:
- D. Casing: Unit casing shall be constructed of galvanized steel no lighter than 0.85 mm (22 Gauge). Air terminal units serving the operating rooms and Cystoscopy rooms shall be fabricated without lining. Provide hanger brackets for attachment of supports.
 - 1. Lining material: Suitable to provide required acoustic performance, thermal insulation and prevent sweating. Meet the requirements of NFPA 90A and comply with UL 181 for erosion as well as ASTM C 665 antimicrobial requirements. Insulation shall consist of 13 mm (1/2 IN) thick non-porous foil faced rigid fiberglass insulation of 4-lb/cu.ft, secured by full length galvanized steel z-strips which enclose and seal all edges. Tape and adhesives shall not be used. Materials shall be non-friable and with surfaces, including all edges, fully encapsulated and faced with perforated metal or coated

- so that the air stream will not detach material. No lining material is permitted in the boxes serving operating rooms and Cystoscopy rooms.
2. Access panels (or doors): Provide panels large enough for inspection, adjustment and maintenance without disconnecting ducts, and for cleaning heating coils attached to unit, even if there are no moving parts. Panels shall be insulated to same standards as the rest of the casing and shall be secured and gasketed airtight. It shall require no tool other than a screwdriver to remove.
 3. Total leakage from casing: Not to exceed 2 percent of the nominal capacity of the unit when subjected to a static pressure of 750 Pa (3 inch WG), with all outlets sealed shut and inlets fully open.
 4. Octopus connector: Factory installed, lined air distribution terminal. Provide where flexible duct connections are shown on the drawings connected directly to terminals. Provide butterfly-balancing damper, with locking means in connectors with more than one outlet. Octopus connectors and flexible connectors are not permitted in the Surgical Suite.
- E. Construct dampers and other internal devices of corrosion resisting materials which do not require lubrication or other periodic maintenance.
1. Damper Leakage: Not greater than 2 percent of maximum rated capacity, when closed against inlet static pressure of 1 kPa (4 inch WG).
- F. Provide multi-point velocity pressure sensors with external pressure taps.
1. Provide direct reading air flow rate table pasted to box.
- G. Provide static pressure tubes.
- H. Externally powered DDC variable air volume controller and damper actuator to be furnished under Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC for factory mounting on air terminal units. The DDC controller shall be electrically actuated.

2.3 AIR FLOW CONTROL VALVE (AFCV)

- A. Airflow control device shall be a venturi valve type air flow control valve.
- B. Pressure independent over a 150 Pa-750 Pa (0.6 inch WG - 3.0 inch WG) drop across valve.

- C. Volume control accurate to plus or minus 5% of airflow over an airflow turndown range of 16 to 1. No minimum entrance or exit duct diameters shall be required to ensure accuracy or pressure independence.
- D. Response time to change in command signal and duct static pressure within three seconds.
- E. 16 gauge spun aluminum valve body and control device with continuous welded seam and 316 stainless steel shaft and shaft support brackets. Pressure independent springs shall be stainless steel. Shaft bearing surfaces shall be Teflon or polyester.
- F. 316 stainless steel continuous welded seam valve body, control device, shaft, shaft support bracket, pivot arm and internal mounting link. The control device shall have a baked on corrosion resistant phenolic coating. The shaft shall have a Teflon coating and all shaft bearing surfaces shall be made of Teflon. The pressure independent springs shall be made of stainless steel.
- G. The airflow device shall have no exposed aluminum or stainless steel components. The shaft support brackets, pivot arm, internal mounting link, and pressure independent springs shall have a baked-on corrosion resistant phenolic coating. Internal nuts, bolts, and rivets shall be titanium or phenolic coated stainless steel.
- H. Constant volume units:
 - 1. Actuator to be factory mounted to the valve.
 - 2. Closed loop control of airflow by way of flow feedback signal with less than 1 second response time.
 - 3. Shaft positioned using direct potentiometer measurement to produce a linear factory calibrated feedback.
 - 4. The maximum and minimum airflows shall be as scheduled.
- I. Variable volume units:
 - 1. Actuator to be factory mounted to the valve.
 - 2. Closed loop control of airflow by way of flow feedback signal with less than 1 second response time.
 - 3. Shaft positioned using direct potentiometer measurement to produce a linear factory calibrated feedback.
- J. Certification:
 - 1. Control device: factory calibrated to airflows detailed on plans using NIST traceable air stations and instrumentation having a combined accuracy of plus or minus 1% of signal over the entire range of measurement.

2. Electronic airflow control devices: further calibrated and their accuracy verified to plus or minus 5% of signal at a minimum of eight different airflows across the full operating range of the device.
 3. All airflow control devices: individually marked with device specific, factory calibration data to include: tag number, serial number, model number, eight point characterization information (for electronic devices), and quality control inspection numbers.
- K. Airflow measuring devices and airflow control devices that are not venturi valves (e.g., Pitot tube, flow cross, air bar, orifice ring, vortex shedder, etc.) are acceptable, provided the following conditions are met:
1. They meet the performance and construction characteristics stated throughout this section of the specification.
 2. Suppliers of airflow control devices or airflow measuring devices requiring minimum duct diameters: provide revised duct layouts showing the required straight duct runs upstream and downstream of these devices.
 3. Supplier of the airflow control system: submit coordination drawings reflecting these changes and include static pressure loss calculations as part of submittal.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Work shall be installed as shown and according to the manufacturer's diagrams and recommendations.
- B. Handle and install units in accordance with manufacturer's written instructions.
- C. Support units rigidly so they remain stationary at all times. Cross-bracing or other means of stiffening shall be provided as necessary. Method of support shall be such that distortion and malfunction of units cannot occur.
- D. Locate air terminal units to provide a straight section of inlet duct for proper functioning of volume controls. See VA Standard Detail.

3.2 OPERATIONAL TEST

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

- - - E N D - - -

SECTION 23 37 00
AIR OUTLETS AND INLETS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Roof Curbs
- B. Air Outlets and Inlets: Diffusers, Registers, and Grilles.

1.2 RELATED WORK

- A. Outdoor and Exhaust Louvers: Section 08 90 00, LOUVERS AND VENTS.
- E. General Mechanical Requirements: Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- F. Noise Level Requirements: Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- G. Testing and Balancing of Air Flows: Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.

1.3 QUALITY ASSURANCE

- A. Refer to article, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- B. Fire Safety Code: Comply with NFPA 90A.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Air intake/exhaust hoods.
 - 2. Diffusers, registers, grilles and accessories.
- C. Coordination Drawings: Refer to article, SUBMITTALS, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Diffusion Council Test Code:
 - 1062 GRD-84Certification, Rating, and Test Manual 4th Edition
- C. American Society of Civil Engineers (ASCE):
 - ASCE7-05Minimum Design Loads for Buildings and Other Structures
- D. American Society for Testing and Materials (ASTM):
 - A167-99 (2004)Standard Specification for Stainless and Heat-Resisting Chromium-Nickel Steel Plate, Sheet and Strip

B209-07Standard Specification for Aluminum and
Aluminum-Alloy Sheet and Plate

E. National Fire Protection Association (NFPA):

90A-09Standard for the Installation of Air
Conditioning and Ventilating Systems

F. Underwriters Laboratories, Inc. (UL):

181-08UL Standard for Safety Factory-Made Air Ducts
and Connectors

PART 2 - PRODUCTS

2.2 EQUIPMENT SUPPORTS

Refer to Section 21 05 11, COMMON WORK RESULTS FOR FIRE SUPPRESSION,
Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, and Section 23 05 11,
COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

2.3 AIR OUTLETS AND INLETS

A. Materials:

1. Steel or aluminum Exhaust air registers located in combination
toilets and shower stalls shall be constructed from aluminum. Provide
manufacturer's standard gasket.
2. Exposed Fastenings: The same material as the respective inlet or
outlet. Fasteners for aluminum may be stainless steel.
3. Contractor shall review all ceiling drawings and details and provide
all ceiling mounted devices with appropriate dimensions and trim for
the specific locations.

B. Performance Test Data: In accordance with Air Diffusion Council Code
1062GRD. Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC
PIPING AND EQUIPMENT for NC criteria.

C. Air Supply Outlets:

1. Ceiling Diffusers: Suitable for surface mounting, exposed T-bar or
special tile ceilings, off-white finish, square or round neck
connection as shown on the drawings. Provide plaster frame for units
in plaster ceilings.
 - a. Square, louver, fully adjustable pattern: Round neck, surface
mounting unless shown otherwise on the drawings. Provide
equalizing or control grid and volume control damper.
 - b. Louver face type: Square or rectangular, removable core for 1, 2,
3, or 4 way directional pattern. Provide equalizing or control
grid and opposed blade damper.
 - c.
 - d. Slot diffuser/plenum:

- 1) Diffuser: Frame and support bars shall be constructed of heavy gauge extruded aluminum. Form slots or use adjustable pattern controllers, to provide stable, horizontal air flow pattern over a wide range of operating conditions.
 - 2) Galvanized steel boot lined with 13 mm (1/2 inch) thick fiberglass conforming to NFPA 90A and complying with UL 181 for erosion. The internal lining shall be factory-fabricated, anti-microbial, and non-friable.
 - 3) Provide inlet connection diameter equal to duct diameter shown on drawings or provide transition coupling if necessary. Inlet duct and plenum size shall be as recommended by the manufacturer.
 - 4) Maximum pressure drop at design flow rate: 37 Pa (0.15 inch W.G.)
2. Linear Bar Grilles and Diffusers: Extruded aluminum, manufacturer's standard finish, and positive holding concealed fasteners.
- a. Margin Frame: Flat, 20 mm (3/4 inch) wide.
 - b. Bars: Minimum 5 mm (3/16 inch) wide by 20 mm (3/4 inch) deep, zero deflection unless otherwise shown. Bar spacing shall be a minimum of 3 mm (1/8 inch) on center. Reinforce bars on 450 mm (18 inch) center for sidewall units and on 150 mm (6 inch) center for units installed in floor or sills.
 - c. Provide opposed blade damper and equalizing or control grid where shown.
4. Supply Registers: Double deflection type with horizontal face bars and opposed blade damper with removable key operator.
- a. Margin: Flat, 30 mm (1-1/4 inches) wide.
 - b. Bar spacing: 20 mm (3/4 inch) maximum.
 - c. Finish: Off white baked enamel for ceiling mounted units. Wall units shall have a prime coat for field painting, or shall be extruded with manufacturer's standard finish.
5. Supply Grilles: Same as registers but without the opposed blade damper.
- DESIGNER'S NOTE:
- D. Return and Exhaust Registers and Grilles: Provide opposed blade damper without removable key operator for registers.
1. Finish: Off-white baked enamel for ceiling mounted units. Wall units shall have a prime coat for field painting, or shall be extruded aluminum with manufacturer's standard aluminum finish.
 2. Standard Type: Fixed horizontal face bars set at 30 to 45 degrees, approximately 30 mm (1-1/4 inch) margin.
 3. Perforated Face Type: To match supply units.

4. Grid Core Type: 13 mm by 13 mm (1/2 inch by 1/2 inch) core with 30 mm (1-1/4 inch) margin.
5. Linear Type: To match supply units.
6. Door Grilles: Are furnished with the doors.
7. Egg Crate Grilles: Aluminum or Painted Steel 1/2 by 1/2 by 1/2 inch grid providing 90% free area.
 - a. Heavy extruded aluminum frame shall have countersunk screw mounting. Unless otherwise indicated, register blades and frame shall have factory applied white finish.
 - b. Grille shall be suitable for duct or surface mounting as indicated on drawings. All necessary appurtenances shall be provided to allow for mounting.
- G. Acoustic Transfer Grille: Aluminum, suitable for partition or wall mounting.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Comply with provisions of Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION, particularly regarding coordination with other trades and work in existing buildings.
- B. Protection and Cleaning: Protect equipment and materials against physical damage. Place equipment in first class operating condition, or return to source of supply for repair or replacement, as determined by Resident Engineer. Protect equipment during construction against entry of foreign matter to the inside and clean both inside and outside before operation and painting.

3.3 TESTING, ADJUSTING AND BALANCING (TAB)

Refer to Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.

3.4 OPERATING AND PERFORMANCE TESTS

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION

- - - E N D - - -

SECTION 23 64 00
PACKAGED WATER CHILLERS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Scroll air-cooled chillers complete with accessories.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- C. Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- D. Section 23 21 23, HYDRONIC PUMPS.
- E. Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.
- F. Section 23 23 00, REFRIGERANT PIPING.
- G. Section 23 21 13, HYDRONIC PIPING.
- H. Section 23 31 00, HVAC DUCTS and CASINGS
- I. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT.
- J. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.
- K. Section 23 81 00, DECENTRALIZED UNITARY HVAC EQUIPMENT.

1.3 DEFINITION

- A. Engineering Control Center (ECC): The centralized control point for the intelligent control network. The ECC comprises of personal computer and connected devices to form a single workstation.
- B. BACNET: Building Automation Control Network Protocol, ASHRAE Standard 135.
- C. Ethernet: A trademark for a system for exchanging messages between computers on a local area network using coaxial, fiber optic, or twisted-pair cables.
- D. FTT-10: Echelon Transmitter-Free Topology Transceiver.

1.4 QUALITY ASSURANCE

- A. Refer to Paragraph, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION, and comply with the following.
- B. Refer to PART 3 herein after and Section 01 00 00, GENERAL REQUIREMENTS for test performance.
- C. Comply with AHRI requirements for testing and certification of the chillers.
- D. Refer to paragraph, WARRANTY, Section 00 72 00, GENERAL CONDITIONS, except as noted below:

1. Provide a 5-year motor and compressor warranty to include materials, parts and labor.
- E. Refer to OSHA 29 CFR 1910.95(a) and (b) for Occupational Noise Exposure Standard
- G. Refer to ASHRAE Standard 15, Safety Standard for Refrigeration System, for refrigerant vapor detectors and monitor.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Conditioning, Heating and Refrigeration Institute (AHRI):
 - 370-01.....Sound Rating of Large Outdoor Refrigerating and Air-Conditioning Equipment
 - 495-1999 (R2002).....Refrigerant Liquid Receivers
 - 550/590-03.....Standard for Water Chilling Packages Using the Vapor Compression Cycle
 - 560-00.....Absorption Water Chilling and Water Heating Packages
 - 575-94.....Methods for Measuring Machinery Sound within Equipment Space
- C. American Society of Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE):
 - ANSI/ASHRAE-15-2007....Safety Standard for Mechanical Refrigeration Systems
 - GDL 3-1996.....Guidelines for Reducing Emission of Halogenated Refrigerants in Refrigeration and Air-Conditioning Equipment and Systems
- D. American Society of Mechanical Engineers (ASME):
 - 2007ASME Boiler and Pressure Vessel Code, Section VIII, "Pressure Vessels - Division 1"
- E. American Society of Testing Materials (ASTM):
 - C 534/ C 534M-2008.....Preformed, Flexible Elastomeric Cellular Thermal Insulation in Sheet and Tubular Form
 - C 612-04.....Mineral-fiber Block and Board Thermal Insulation
- F. National Electrical Manufacturing Association (NEMA):
 - 250-2008.....Enclosures for Electrical Equipment (1000 Volts Maximum)
- G. National Fire Protection Association (NFPA):
 - 70-2008.....National Electrical Code
- H. Underwriters Laboratories, Inc. (UL):
 - 1995-2005..... Heating and Cooling Equipment

1.6 SUBMITTALS

- A. Submit in accordance with Specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data.
 - 1. scroll chillers, including motor starters, control panels, and vibration isolators, and remote condenser data shall include the following:
 - a. Rated capacity.
 - b. Pressure drop.
 - c. Efficiency at full load and part load WITHOUT applying any tolerance indicated in the AHRI 550/590/Standard.
 - d. Refrigerant
 - e. Fan performance (Air-Cooled Chillers only.)
 - f. Accessories.
 - g. Installation instructions.
 - h. Start up procedures.
 - i. Wiring diagrams, including factory-installed and field-installed wiring.
 - j. Sound/Noise data report. Manufacturer shall provide sound ratings. Noise warning labels shall be posted on equipment.
- C. Maintenance and operating manuals for each piece of equipment in accordance with Section 01 00 00, GENERAL REQUIREMENTS.
- D. Run test report for all chillers.
- E. Product Certificate: Signed by chiller manufacturer certifying that chillers furnished comply with AHRI requirements. The test report shall include calibrated curves, calibration records, and data sheets for the instrumentation used in factory tests.

PART 2 - PRODUCTS

2.3 ROTARY-SCREW, AND SCROLL AIR-COOLED WATER CHILLERS

- A. General: Factory-assembled and-tested rotary-screw or scroll water chillers, complete with evaporator, compressors, motor, starters, integral, and controls mounted on a welded steel base. The chiller unit shall consist of two compressors minimum, but not more than eight, mounted on a single welded steel base. Where compressors are paralleled, not more than two shall be so connected and not less than two independent refrigerant circuits shall be provided. Chiller shall be capable of operating one of the following refrigerants: HCFC-134a or HCFC-410a.

- B. Performance: Provide the capacity as shown on the drawings. Part load and full load efficiency ratings of the chiller shall not exceed those shown on the drawings. If chillers are required to operate at less than 25 percent of full unit rated capacity, specify provision for hot gas by-pass, to operate the unit stable at any stage of capacity reduction.
- C. Capacity of a single air-cooled chiller shall not exceed 200 Tons (Standard AHRI Conditions).
- D. Applicable Standard: Chillers shall be rated and certified according to AHRI 550/590, and shall be stamped in compliance with AHRI certification.
- E. Acoustics: Sound pressure levels shall not exceed the following specified levels. The manufacturer shall provide sound treatment if required to comply with the specified maximum levels. Testing shall be in accordance with AHRI requirements.

OCTAVE BAND								Overall
<u>63</u>	<u>125</u>	<u>250</u>	<u>500</u>	<u>1000</u>	<u>2000</u>	<u>4000</u>	<u>8000</u>	<u>dB(A)</u>

- G. Compressor (Scroll Type): Three dimensional, positive-displacement, hermetically sealed design, with suction and discharge valves, crankcase oil heater and suction strainer. Compressor shall be mounted on vibration isolators. Rotating parts shall be factory balanced. Lubrication system shall consist of reversible, positive displacement pump, strainer, oil level sight glass, and oil charging valve. Capacity control shall be by on-off compressor cycling of single and multiple compressors and hot gas bypass.
- H. Refrigerants Circuit: Each circuit shall contain include an expansion valve, refrigerant charging connections, hot-gas muffler, compressor suction and discharge shutoff valves, replaceable-core filter drier, sight glass with moisture indicator, liquid-line solenoid valve and insulated suction line.
- I. Refrigerant and Oil: Sufficient volume of dehydrated refrigerant and lubricating oil shall be provided to permit maximum unit capacity operation before and during tests. Replace refrigerant charge lost during the warranty period, due to equipment failure, without cost to the Government.
- J. Condenser:
1. Air-cooled integral condenser as shown on the drawings and specified hereinafter.
 2. Integral Condenser: Condenser coils shall be extended surface fin and tube type, seamless copper tubes with aluminum fins. For high-

humidity locations, provide factory-applied epoxy coating over aluminum fins. The epoxy coating shall be applied using multiple stage, electro-disposition coating process. Condenser coils shall be factory air tested at 3105 kPa (450 psig). Condenser fans shall be propeller type, directly connected to motor shaft. Fans shall be statically and dynamically balanced, with wire safety guards. Condenser fan motors with permanently lubricated ball bearings and three-phase thermal overload protection. Unit shall start -18°C (0°F) with external damper assemblies. Units shall have grilles factory mounted to prevent damage to coil surfaces.

3. Remote Condenser: Refer to paragraph 2.5

- K. Evaporator: Shell and tube design with seamless copper tubes roller expanded into tube sheets. Designed, tested, and stamped in accordance with applicable portions of ASME Boiler and Pressure Vessel Code, Section VIII, for working pressure produced by the water system, but not less than 1035 kPa (15 psig). Refrigerant side working pressure shall comply with ASHRAE Standard 15. Shell shall be constructed of carbon steel. For the waterside of liquid cooler the performance shall be based on a water velocity not less than 1 m/s (3 fps) with a maximum water velocity of 3 m/s (10 fps) and a fouling factor 0.0000176 m² degrees C (0.0001 hr. sq. ft.) degrees F/Btu. Evaporator for packaged air-cooled chiller units designed for outdoor installation shall be protected against freeze-up in ambient temperature down to -17 degrees C (0 degrees F) by a resistance heater cable under insulation with thermostat set to operate below 3 degrees C (37 degrees F) ambient.
- L. Insulation: Evaporator, suction piping, compressor, and all other parts subject to condensation shall be insulated with 20 mm (0.75 inch) minimum thickness of flexible-elastomeric thermal insulation, complying with ASTM C534.
- M. Refrigerant Receiver: Provide a liquid receiver for chiller units when system refrigerant charge exceeds 80 percent of condenser refrigerant volume. Liquid receivers shall be horizontal-type, designed, fitted, and rated in conformance with AHRI 495. Receiver shall be constructed and tested in conformance with Section VIII D1 of the ASME Boiler and Pressure Vessel Code. Each receiver shall have a storage capacity not less than 20 percent in excess of that required for fully charged system. Each receiver shall be equipped with inlet, outlet drop pipes, drain plug, purging valve, and relief devices as required by ASHRAE Standard 15.
- N. Controls: Chiller shall be furnished with unit mounted, stand-alone, microprocessor-based controls in NEMA 3R enclosure, hinged and

lockable, factory wired with a single point power connection and separate control circuit. The control panel provide chiller operation, including monitoring of sensors and actuators, and shall be furnished with light emitting diodes or liquid-crystal display keypad.

1. Following shall display as a minimum on the panel:

- a. Date and time.
- b. Outdoor air temperature.
- c. Operating and alarm status.
- d. Entering and leaving water temperature-chilled water
- e. Operating set points-temperature and pressure.
- f. Refrigerant temperature and pressure.
- g. Operating hours.
- h. Number of starts.
- i. Current limit set point.
- j. Maximum motor amperage (percent).

2. Control Functions:

- a. Manual or automatic startup and shutdown time schedule.
- b. Condenser water temperature.
- c. Entering and leaving chilled water temperature and control set points.
- d. Automatic lead-lag switch.

3. Safety Functions: Following conditions shall shut down the chiller and require manual reset to start:

- a. Loss of chilled water flow.
- b. Loss of condenser water flow (for water-cooled chillers only).
- c. Low chilled water temperature.
- d. Compressor motor current-overload protection.
- e. Freeze protection (for air-cooled chillers).
- f. Starter fault.
- g. High or low oil pressure.
- h. Recycling pumpdown.

- O. The chiller control panel shall provide leaving chilled water temperature reset based on signal from Energy Control Center (ECC).
- P. Provide contacts for remote start/stop, alarm for abnormal operation or shutdown, and for Engineering Control Center (ECC).
- Q. Chiller control panel shall reside on BACnet interworking using ARCNET or MS/TP physical data link layer protocol for communication with building automation control system .
- R. Auxiliary hydronic system and the chiller(s) shall be interlocked to provide time delay and start sequencing as indicated on control drawings.

- S. Motor: Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION. Compressor motor furnished with the chiller shall be in accordance with the chiller manufacturer and the electrical specification Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT. Starting torque of motors shall be suitable for driven machines.
- T. Motor Starter: Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION. Provide a starter in NEMA I enclosure, designed for floor or unit mounted chiller using multiple compressors, with the lead compressor starting at its minimum capacity may be provided with across-the-line starter. See Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS for additional requirements.

2.4 CONDENSING UNITS FOR AIR CONDITIONING SERVICE

- A. Refer to Section 23 81 00 DECENTRALIZED UNITARY HVAC EQUIPMENT.

2.5 CONDENSERS

- A. Air-Cooled Condensers: Suitable for remote installation in a weather-protected casing. For multiple compressors chiller units, provide a separate air-cooled condenser to match the compressor:
1. Condenser coils shall be extended surface fin and tube type, seamless copper tubes with aluminum fins. For high-humidity locations, provide factory-applied epoxy coating over aluminum fins. The epoxy coating shall be applied using multiple stage, electro-disposition coating process.
 2. Fans shall be either centrifugal or propeller type as best suited for application, directly connected to motor shaft or indirectly connected to motor by means of a V-belt drive. Fans shall be statically and dynamically balanced.
 3. Discharge air from each air-cooled condenser in vertical direction either directly from fan casing or by means of supplementary wind deflectors.
 4. Condenser Controls: Provide head pressure controls for operation of the system down to 5 degrees C (40 degrees F) by cycling the fans.
- B. Refrigerant Piping: Refrigerant piping shall be as specified in specification Section 23 23 00, REFRIGERANT PIPING.

PART 3 - EXECUTION

3.1 EXAMINATION

Examine roughing-in for concrete equipment bases, anchor-bolt sizes and locations, piping and electrical to verify actual locations and sizes before chiller installation and other conditions that might affect chiller performance, maintenance, and operation.

Equipment locations shown on drawings are approximate. Determine exact locations before proceeding with installation.

3.2 EQUIPMENT INSTALLATION

- A. Install chiller on concrete base with isolation pads or vibration isolators.
 - 1. Concrete base is specified in Section 03 30 00, CAST-IN-PLACE CONCRETE
 - 2. Vibration isolator types and installation requirements are specified in Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT
 - 3. Anchor chiller to concrete base according to manufacturer's written instructions
 - 4. Charge the chiller with refrigerant, if not factory charged.
 - 5. Install accessories and any other equipment furnished loose by the manufacturer, including remote starter, remote control panel, and remote flow switches, according to the manufacturer written instructions and electrical requirements.
 - 6. Chillers shall be installed in a manner as to provide easy access for tube pull and removal of compressor and motors etc.
- B. Install refrigerant monitoring and safety equipment in accordance with ASHRAE Standard 15.
- C. Install refrigerant piping as specified in Section 23 23 00, REFRIGERANT PIPING and ASHRAE Standard 15.
- D. Install thermometers and gages as recommended by the manufacturer and/or as shown on drawings.
- E. Piping Connections:
 - 1. Make piping connections to the chiller for chilled water, condenser water, and and other connections as necessary for proper operation and maintenance of the equipment.
 - 2. Make equipment connections with flanges and couplings for easy removal and replacement of equipment from the equipment room.

3.3 STARTUP AND TESTING

- A. Engage manufacturer's factory-trained representative to perform startup and testing service.
- B. Inspect, equipment installation, including field-assembled components, and piping and electrical connections.
- C. After complete installation startup checks, according to the manufacturers written instructions, do the following to demonstrate to the VA that the equipment operate and perform as intended.

1. Check refrigerant charge is sufficient and chiller has been tested for refrigerant leak.
 2. Check bearing lubrication and oil levels.
 3. Verify proper motor rotation.
 4. Verify pumps associated with chillers are installed and operational.
 5. Verify thermometers and gages are installed.
 6. Verify purge system, if installed, is functional and relief piping is routed outdoor.
 7. Operate chiller for run-in-period in accordance with the manufacturer's instruction and observe its performance.
 8. Check and record refrigerant pressure, water flow, water temperature, and power consumption of the chiller.
 9. Test and adjust all controls and safeties. Replace or correct all malfunctioning controls, safeties and equipment as soon as possible to avoid any delay in the use of the equipment.
 10. Prepare a written report outlining the results of tests and inspections, and submit it to the VA.
- D. Engage manufacturer's certified factory trained representative to provide training for 16 hours for the VA maintenance and operational personnel to adjust, operate and maintain equipment, including self-contained breathing apparatus.

- - - E N D - - -

SECTION 23 72 00
AIR-TO-AIR ENERGY RECOVERY EQUIPMENT

PART 1 - GENERAL

1.1 DESCRIPTION

This Section specifies rotary air-to-air heat exchanger

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS: Requirements for pre-test of equipment.
- B. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION: General mechanical requirements and items, which are common to more than one section of Division 23.
- C. Section 23 21 23, HYDRONIC PUMPS and Section 23 22 23, STEAM CONDENSATE PUMPS: Requirements for pumping equipment.
- D. Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION: Requirements for piping insulation.
- E. Section 23 21 13, HYDRONIC PIPING and Section 23 22 13, STEAM AND CONDENSATE HEATING PIPING: Requirements for piping for expansion tanks.
- F. Section 23 31 00, HVAC DUCTS AND CASINGS: Requirements for sheet metal ducts and fittings.
- H. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Requirements for controls and instrumentation.
- I. Section 23 05 93, TESTING, ADJUSTING AND BALANCING FOR HVAC: Requirements for testing, adjusting and balancing of HVAC system.

1.3 QUALITY ASSURANCE

- A. Refer to GENERAL CONDITIONS.
- B. Refer to specification Section 01 00 00, GENERAL REQUIREMENTS for performance tests and instructions to VA personnel.
- C. Refer to paragraph QUALITY ASSURANCE in specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- D. Performance Criteria: Heat recovery equipment shall be provided by a manufacturer who has been manufacturing such equipment and the equipment has a good track record for at least 3 years.
- E. Performance Test: In accordance with PART 3.

1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 - 1. Heat Pipe Heat Exchanger
 - 2. Rotary Heat Exchanger
 - 3. Plate Heat Exchanger

4. Run-Around Energy Recovery System

- C. Certificate: Submit, simultaneously with shop drawings, an evidence of satisfactory service of the equipment on three similar installations.
- D. Submit type, size, arrangement and performance details. Present application ratings in the form of tables, charts or curves.
- E. Provide installation, operating and maintenance instructions, in accordance with Article, INSTRUCTIONS, in Section 01 00 00, GENERAL REQUIREMENTS.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Conditioning and Refrigeration Institute (ARI)
ARI 1060-2005.....Performance Rating of Air-to-Air Heat Exchangers
for Energy Recovery Ventilation Heat Equipment
- C. American Society of Heating, Refrigeration and Air Conditioning
Engineers (ASHRAE):
15-07.....Safety Standard for Refrigeration Systems (ANSI)
52.1-92.....Gravimetric and Dust-Spot Procedures for Testing
Air-Cleaning Devices Used in General Ventilation
for Removing Particulate Matter
52.2-07.....Method of Testing General Ventilation Air-
Cleaning Devices for Removal Efficiency by
Particle Size
84-91.....Method of Testing Air-to-Air Heat Exchangers
- D. American Society for Testing and materials (ASTM)
D635-06.....Standard Test Method for Rate of Burning and/ or
Extent and Time of Burning of Plastics in a
Horizontal Position
E84-07.....Standard Test Method for Surface Burning
Characteristics of Building Materials
- E. Underwriters Laboratories, Inc (UL)
1812-95 (Rev. 2006).....Standard for Ducted Heat Recovery Ventilators
1815-01 (Rev. 2006).....Standard for Nonducted Heat Recovery Ventilators

PART 2 - PRODUCTS

2.2 ROTARY AIR-TO-AIR HEAT EXCHANGER:

- A. Exchanger Rotor or Wheel: Aluminum transfer media with a flame spread rating of not more than 25 and smoke developed rating of not more than 50 and independently tested in accordance with ASTM standard E-84. Rotor media shall be independently tested in accordance with ASHRAE Standard . It shall allow laminar flow (but not radial) at usual velocities and

prevent leakage, bypassing and cross contamination by cross flow within wheel. Size the transfer media to allow passage of 500 micrometers particles without fouling or clogging. When latent heat transfer is required, treat media with non-degrading silica-gel desiccant coating that is bacteriostatic, non-corroding and non-toxic. No asbestos material will be allowed. Wheel shall not condense water directly or require a condensate drain for summer or winter operation. Performance rating shall be in accordance with ARI Standard 1060.

- B. Rotor: Polymer segmented wheel strengthened with radial spokes impregnated with non-migrating, water-selected, molecular-sieve desiccant coating.
 - 1. Maximum Solid Size for media to pass: 500 micrometers.
- C. Casings shall be sealed on periphery of rotor as well as on duct divider and purge section. Seals shall be adjustable, of extended life materials and effective in limiting air leakage.
- D. Wheel shall be supported by ball or roller bearings and belt driven by a fractional horsepower, totally enclosed, NEMA Standard motor through a close coupled positively lubricated speed reducer, or gear/chain speed reduction.
 - 1. Motors for constant speed wheel shall be an AC motor.
 - 2. Variable-speed exchanger wheels shall have exchanger wheel speed and leaving-air temperature controlled by means of a variable-speed motor controller. Operation shall be from 115/1/60 and by a proportioning temperature controller which shall vary output voltage of a silicon controlled rectifier (SCR) to a rectified power motor which will change speed in proportion to changes of voltage to its armature. Automatic changeover for summer-winter operations shall be controlled by an adjustable thermostatswitch. Set point of adjustable proportioning temperature controller and thermostatswitch shall be indicated on visible scale. System shall be capable of speed reduction down to 5 percent of capacity while maintaining adequate torque at any point of operation to rotate wheel.
- E. An automatic, factory-fabricated, field-adjustable purge unit shall limit exhaust air carry-over to less than 1.0 percent of rated volume. Purge shall be effective when static pressure difference between supply and exhaust is 125 Pa (one-half, inch wg) or greater, and it shall have provision for restriction or adjustment to limit purge air volume to not over five percent of rated air flow when a static pressure difference up to 2.5 kPa (10 inch wg) exists.
- F. Unit shall be constructed of heavy gage steel to insure rigidity and stability. Casing side panels shall be removable to insure easy access

to internal parts and have integral flanges for flanged duct connection and lifting holes or lugs.

G. Controls starting relay shall be factory mounted and wired, and include a manual motor starter for field wiring.

H. Filters: Comply with NFPA 90A.

1. Minimum Arrestance: According to ASHRAE 52.1

2. Minimum Efficiency Reporting Value (MERV): According to ASHRAE 52.2.

3. Filter Holding Frames: Arranged for flat or angular orientation, with access doors on both sides of unit. Filters shall be removable from one side or lift out from access plenum.

4. Flat-Panel Type: Factory-fabricated, viscous-coated, 50 mm (2 inches).

9. MERV (According to ASHRAE 52.2): 7.

10. Media: Interlaced glass fibers sprayed with nonflammable adhesive and antimicrobial agent.

11. Frame: Galvanized steel with metal grid on outlet side, steel rod grid on inlet side, hinged, and with pull and retaining handles.

2.5 AIR FILTERS

Air Filters: MERV rating of 7, as indicated on the drawings. Comply with requirements in specification Section 23 40 00, HVAC AIR CLEANING DEVICES.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Follow the equipment manufacturer's instructions for handling and installation, and setting up of ductwork for makeup and exhaust air steamers for maximum efficiency.

B. Rotary Air-to-Air Exchanger: Adjust seals and purge as recommended by the manufacturer. Verify correct installation of controls.

C. Seal ductwork tightly to avoid air leakage.

D. Install units with adequate spacing and access for cleaning and maintenance of heat recovery coils as well as filters.

3.2 FIELD QUALITY CONTROL

A. Operational Test: Perform tests as per manufacturer's written instructions for proper and safe operation of the heat recovery system.

1. After electrical circuitry has been energized, start units to confirm proper motor rotation and unit operation.

2. Adjust seals and purge.

3. Test and adjust controls and safeties.

B. Replace damaged and malfunctioning controls and equipment.

- C. Set initial temperature and humidity set points. Set field-adjustable switches and circuit-breaker trip ranges as indicated.
- D. Prepare test and inspection reports to the Senior Resident Engineer in accordance with specification Section 01 00 00, GENERAL REQUIREMENTS.

3.3 INSTRUCTIONS

Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of heat recovery equipment.

- - - E N D - - -

SECTION 23 73 00
INDOOR CENTRAL-STATION AIR-HANDLING UNITS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. Air handling units including integral components specified herein.
- B. Definitions: Air Handling Unit (AHU): A factory fabricated and tested assembly of modular sections consisting of fan, coils, filters, and other necessary equipment to perform one or more of the following functions of circulating, cleaning, heating, cooling, humidifying, dehumidifying, and mixing of air. Design capacities of units shall be as scheduled on the drawings.

1.2 RELATED WORK

- B. General mechanical requirements and items, which are common to more than one section of Division 23: Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- C. Sound and vibration requirements: Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- D. Piping and duct insulation: Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION.
- E. Piping and valves: Section 23 21 13 / 23 22 13, HYDRONIC PIPING / STEAM AND CONDENSATE HEATING PIPING.
- F. Requirements for flexible duct connectors, sound attenuators and sound absorbing duct lining, and air leakage: Section 23 31 00, HVAC DUCTS and CASINGS.
- G. Air filters and filters' efficiency: Section 23 40 00, HVAC AIR CLEANING DEVICES.
- H. HVAC controls: Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
- I. Testing, adjusting and balancing of air and water flows: Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.
- J. Types of motors: Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT.
- K. Types of motor starters: Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.

1.3 QUALITY ASSURANCE

- A. Refer to Article, Quality Assurance, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- B. Air Handling Units Certification: Certify air-handling units in accordance with ARI 430.
- C. Heating, Cooling, and Air Handling Capacity and Performance Standards: ARI 430, ARI 410, ASHRAE 51, and AMCA 210.
- D. Performance Criteria:

1. The fan schedule indicates design CFM - Design Cubic Feet per Minute - followed by L/s - Liters per Second in brackets. The Fan motor BHP (KW) at the operating point on the fan curves shall be increased by 10% (safety factor) to cover the drive losses and field conditions. The fan motor shall be selected within the rated nameplate capacity, without relying upon NEMA Standard Service Factor.
 2. Select the fan operating point as follows:
 - a. Forward Curve and Axial Flow Fans: Right hand side of peak pressure point.
 - b. Air Foil, Backward Inclined, or Tubular: At or near the peak static efficiency.
 3. Operating Limits: AMCA 99.
- E. Units shall be constructed by a manufacturer who has been manufacturing air handling units for at least three (3) years.

1.4. SUBMITTALS:

- A. The contractor shall, in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish a complete submission for all air handling units covered in the project. The submission shall include all information listed below. Partial and incomplete submissions shall be rejected without reviews.
- B. Manufacturer's Literature and Data:
 1. Submittals for AHUs shall include fans, drives, motors, coils, , mixing box with outside/return air dampers, filter housings, blender sections, and all other related accessories. The contractor shall provide custom drawings showing total air handling unit assembly including dimensions, operating weight, access sections, flexible connections, door swings, controls penetrations, electrical disconnect, lights, duplex receptacles, switches, wiring, utility connection points, unit support system, vibration isolators, drain pan, pressure drops through each component (filter, coil etc).
 2. Submittal drawings of section or component only will not be acceptable. Contractor shall also submit performance data including performance test results, charts, curves or certified computer selection data; data sheets; fabrication and insulation details. If the unit cannot be shipped in one piece, the contractor shall indicate the number of pieces that each unit will have to be broken into to meet shipping and job site rigging requirements. This data shall be submitted in hard copies and in electronic version compatible to AutoCAD version used by the VA at the time of submission.

3. Submit sound power levels in each octave band for fan and at entrance and discharge of AHUs at scheduled conditions. In absence of sound power ratings refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
 4. Provide fan curves showing Liters/Second (cubic feet per minute), static pressure, efficiency, and horsepower for design point of operation and at maximum design Liters/Second (cubic feet per minute).
 5. Submit total fan static pressure, external static pressure, for AHU including total, inlet and discharge pressures, and itemized specified internal losses and unspecified internal losses. Refer to air handling unit schedule on drawings.
- C. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS. Include instructions for lubrication, filter replacement, motor and drive replacement, spare part lists, and wiring diagrams.
- D. Submit written test procedures two weeks prior to factory testing. Submit written results of factory tests for approval prior to shipping.
- E. Submit shipping information that clearly indicates how the units will be shipped in compliance with the descriptions below.
1. Units shall be shipped in one (1) piece where possible and in shrink wrapping to protect the unit from dirt, moisture and/or road salt.
 2. If not shipped in one (1) piece, provide manufacturer approved shipping splits where required for installation or to meet shipping and/or job site rigging requirements in modular sections. Indicate clearly that the shipping splits shown in the submittals have been verified to accommodate the construction constraints for rigging as required to complete installation and removal of any section for replacement through available access without adversely affecting other sections.
 3. If shipping splits are provided, each component shall be individually shrink wrapped to protect the unit and all necessary hardware (e.g. bolts, gaskets etc.) will be included to assemble unit on site (see section 2.1.A4).
 4. Lifting lugs will be provided to facilitate rigging on shipping splits and joining of segments. If the unit cannot be shipped in one piece, the contractor shall indicate the number of pieces that each unit will have to be broken into to meet shipping and job site rigging requirements.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air-Conditioning, Heating, and Refrigeration Institute (AHRI)/(ARI):
410-01.....Standard for Forced-Circulation Air-Heating and Air-Cooling Coils
430-09.....Central Station Air Handling Units
- C. Air Movement and Control Association International, Inc. (AMCA):
210-07.....Laboratory Methods of Testing Fans for Rating
- D. American Society of Heating, Refrigerating and Air-conditioning Engineers, Inc. (ASHRAE):
170-2008.....Ventilation of Health Care Facilities
- E. American Society for Testing and Materials (ASTM):
ASTM B117-07a.....Standard Practice for Operating Salt Spray (Fog) Apparatus
ASTM D1654-08.....Standard Test Method for Evaluation of Painted or Coated Specimens Subjected to Corrosive Environments
ASTM D1735-08.....Standard Practice for Testing Water Resistance of Coatings Using Water Fog Apparatus
ASTM D3359-08.....Standard Test Methods for Measuring Adhesion by Tape Test
- F. Military Specifications (Mil. Spec.):
MIL-P-21035B-2003.....Paint, High Zinc Dust Content, Galvanizing Repair (Metric)
- G. National Fire Protection Association (NFPA):
NFPA 90A.....Standard for Installation of Air Conditioning and Ventilating Systems, 2009
- H. Energy Policy Act of 2005 (P.L.109-58)

PART 2 - PRODUCTS

2.1 AIR HANDLING UNITS

- A. General:
1. AHUs shall be entirely of double wall galvanized steel construction without any perforations except as specified in section 2.1.C.2. Casing is specified in paragraph 2.1.C. Foil face lining is not an acceptable substitute for double wall construction. Galvanizing shall be hot dipped conforming to ASTM A525 and shall provide a minimum of 0.275 kg of zinc per square meter (0.90 oz. of zinc per square foot) (G90). Aluminum constructed units may be provided subject to VA

- approval and documentation that structural rigidity is equal or greater than the galvanized steel specified.
2. The contractor and the AHU manufacturer shall be responsible for insuring that the unit will not exceed the allocated space shown on the drawings, including required clearances for service and future overhaul or removal of unit components. All structural, piping, wiring, and ductwork alterations of units, which are dimensionally different than those specified, shall be the responsibility of the contractor at no additional cost to the government.
 3. AHUs shall be fully assembled by the manufacturer in the factory in accordance with the arrangement shown on the drawings. The unit shall be assembled into the largest sections possible subject to shipping and rigging restrictions. The correct fit of all components and casing sections shall be verified in the factory for all units prior to shipment. All units shall be fully assembled, tested and then split to accommodate shipment and job site rigging. On units not shipped fully assembled, the manufacturer shall tag each section and include air flow direction to facilitate assembly at the job site. Lifting lugs or shipping skids shall be provided for each section to allow for field rigging and final placement of unit.
 4. The AHU manufacturer shall provide the necessary gasketing, caulking, and all screws, nuts, and bolts required for assembly. The manufacturer shall provide a local representative at the job site to supervise the assembly and to assure the units are assembled to meet manufacturer's recommendations and requirements noted on the drawings. Provide documentation that this representative has provided this service on similar jobs to the Contracting Officer. If a local representative cannot be provided, the manufacturer shall provide a factory representative.
 5. Gaskets: All door and casing and panel gaskets and gaskets between air handling unit components, if joined in the field, shall be high quality which seal air tight and retain their structural integrity and sealing capability after repeated assembly and disassembly of bolted panels and opening and closing of hinged components. Bolted sections may use a more permanent gasketing method provided they are not disassembled.
 6. Structural Rigidity: Provide structural reinforcement when required by span or loading so that the deflection of the assembled structure shall not exceed 1/200 of the span based on a differential static pressure of 1991 PA (8 inch WG) or higher.

B. Base:

1. Provide a heavy duty steel base for supporting all major AHU components. Bases shall be constructed of wide-flange steel I-beams, channels, or minimum 125 mm (5 inch) high 3.5 mm (10 Gauge) steel base rails. Welded or bolted cross members shall be provided as required for lateral stability. Contractor shall provide supplemental steel supports as required to obtain proper operation heights for cooling coil condensate drain trap and as shown on drawings.
2. AHUs shall be completely self supporting for installation on concrete housekeeping pad, steel support pedestals, or suspended as shown on drawings.
3. The AHU bases not constructed of galvanized steel shall be cleaned, primed with a rust inhibiting primer, and finished with rust inhibiting exterior enamel.

C. Casing (including wall, floor and roof):

1. General: AHU casing shall be constructed as solid double wall, galvanized steel insulated panels without any perforations, integral of or attached to a structural frame. The thickness of insulation, mode of application and thermal breaks shall be such that there is no visible condensation on the exterior panels of the AHU located in the non-conditioned spaces.

2. Casing Construction:

Table 2.1.C.2

Outer Panel	0.8 mm (22 Gage) Minimum
Inner Panel	0.8 mm (22 Gage) Minimum
Insulation	Foam
Thickness	50 mm (2 inch) Minimum
Density	48 kg/m ³ (3.0 lb/ft ³) Minimum
Total R Value	2.3 m ² .K/W (13.0 ft ² .°F.hr/Btu) Minimum

3. Casing Construction (Contractor's Option):

Table 2.1.C.3

Outer Panel	1.3 mm (18 Gage) Minimum
Inner Panel	1.0 mm (20 Gage) Minimum
Insulation	Fiberglass
Thickness	50 mm (2 inch) Minimum
Density	24 kg/m ³ (1.5 lb/ft ³) Minimum
Total R Value	1.4 m ² .K/W (8.0 ft ² .°F.hr/Btu) Minimum

4. Blank-Off: Provide blank-offs as required to prevent air bypass between the AHU sections, around coils, and filters.
5. Casing panels shall be secured to the support structure with stainless steel or zinc-chromate plated screws and gaskets installed around the panel perimeter. Panels shall be completely removable to allow removal of fan, coils, and other internal components for future maintenance, repair, or modifications. Welded exterior panels are not acceptable.
6. Access Doors: Provide in each access section and where shown on drawings. Doors shall be a minimum of 50 mm (2 inch) thick with same double wall construction as the unit casing. Doors shall be a minimum of 600 mm (24 inches) wide, unless shown of different size on drawings, and shall be the full casing height up to a maximum of 1850 mm (6 feet). Doors shall be gasketed, hinged, and latched to provide an airtight seal. The access doors for fan section, mixing box, coil section shall include a minimum 150 mm x 150 mm (6 inch x 6 inch) double thickness, with air space between the glass panes tightly sealed, reinforced glass or Plexiglas window in a gasketed frame.
 - a. Hinges: Manufacturers standard, designed for door size, weight and pressure classifications. Hinges shall hold door completely rigid with minimum 45 kg (100 lb) weight hung on latch side of door.
 - b. Latches: Non-corrosive alloy construction, with operating levers for positive cam action, operable from either inside or outside. Doors that do not open against unit operating pressure shall allow the door to ajar and then require approximately 0.785 radian (45 degrees) further movement of the handle for complete opening. Latch shall be capable of restraining explosive opening of door with a force not less than 1991 Pa (8 inch WG).
 - c. Gaskets: Neoprene, continuous around door, positioned for direct compression with no sliding action between the door and gasket. Secure with high quality mastic to eliminate possibility of gasket slipping or coming loose.
7. Provide sealed sleeves, metal or plastic escutcheons or grommets for penetrations through casing for power and temperature control wiring and pneumatic tubing. Coordinate with electrical and temperature control subcontractors for number and location of penetrations. Coordinate lights, switches, and duplex receptacles and disconnect switch location and mounting. All penetrations and equipment mounting may be provided in the factory or in the field. All field penetrations shall be performed neatly by drilling or saw cutting. No

cutting by torches will be allowed. Neatly seal all openings airtight.

E. Floor:

1. Unit floor shall be level without offset space or gap and designed to support a minimum of 488 kg/square meter (100 lbs per square foot) distributed load without permanent deformation or crushing of internal insulation. Provide adequate structural base members beneath floor in service access sections to support typical service foot traffic and to prevent damage to unit floor or internal insulation. Unit floors in casing sections, which may contain water or condensate, shall be watertight with drain pan.
2. Where indicated, furnish and install floor drains, flush with the floor, with nonferrous grate cover and stub through floor for external connection.

F. Condensate Drain Pan: Drain pan shall be designed to extend entire length of cooling coils including headers and return bends. Depth of drain pan shall be at least 43 mm (1.7 inches) and shall handle all condensate without overflowing. Drain pan shall be double-wall, double sloping type, and fabricated from stainless (304) with at least 50 mm (2 inch) thick insulation sandwiched between the inner and outer surfaces. Drain pan shall be continuous metal or welded watertight. No mastic sealing of joints exposed to water will be permitted. Drain pan shall be placed on top of casing floor or integrated into casing floor assembly. Drain pan shall be pitched in all directions to drain line.

1. An intermediate, stainless-steel (304) condensate drip pan with copper downspouts shall be provided on stacked cooling coils. Use of intermediate condensate drain channel on upper casing of lower coil is permissible provided it is readily cleanable. Design of intermediate condensate drain shall prevent upper coil condensate from flowing across face of lower coil.
2. Drain pan shall be piped to the exterior of the unit. Drain pan shall be readily cleanable.
3. Installation, including frame, shall be designed and sealed to prevent blow-by.

G. Fans Sections:

1. Fans shall be minimum Class II construction, double width, double inlet centrifugal, air foil or backward inclined or forward curved type as indicated on drawings, factory balanced and rated in accordance with AMCA 210 or ASHRAE 51. Provide self-aligning, pillow block, regreasable ball-type bearings selected for a B (10) life of not less than 50,000 hours and an L (50) average fatigue life of

- 200,000 hours per AFBMA Standard 9. Extend bearing grease lines to motor and drive side of fan section. Fan shall be located in airstream to assure proper air flow.
2. Allowable vibration tolerances for fan shall not exceed a self-excited vibration maximum velocity of 0.005 m/s (0.20 inch per second) RMS, filter in, when measured with a vibration meter on bearing caps of machine in vertical, horizontal and axial directions or measured at equipment mounting feet if bearings are concealed. After field installation, compliance to this requirement shall be demonstrated with field test in accordance with Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT and Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC. For plenum fan applications, the fan wheel shall meet or exceed guidelines in AMCA 801-92 for dynamic balancing requirements. Following fan assembly, the complete fan assembly balance shall be tested using an electronic balance analyzer with a tunable filter and stroboscope. Vibration measurements shall be taken on each motor bearing housing in the vertical, horizontal, and axial planes (5 total measurements, 2 each motor bearing and 1 axial).

H. Fan Motor, Drive and Mounting Assembly:

1. Provide internally vibration isolated fan, motor and drive, mounted on a common integral bolted or welded structural steel base with adjustable motor slide rail with locking device. Provide vibration isolators and flexible duct connections at fan discharge to completely isolate fan assembly. Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT, for additional requirements.
2. Fan Motor and Drive: Motors shall be premium energy efficient type, as mandated by the Energy Policy Act of 2005, with efficiencies as shown in the Specifications Section 23 05 12 (General Motor Requirements For HVAC and Steam Equipment), on drawings and suitable for use in variable frequency drive applications on AHUs where this type of drive is indicated. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION, for additional motor and drive specifications. Refer to Specification Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.
3. Fan drive and belts shall be factory mounted with final alignment and belt adjustment to be made by the Contractor after installation. Drive and belts shall be as specified in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION. Provide additional drive(s) if required during balancing, to achieve desired airflow.

- J. Mixing Boxes: Mixing box shall consist of casing and outdoor air and return air dampers in opposed blade arrangement with damper linkage for automatic operation. Coordinate damper operator with Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC. Dampers shall be of ultra-low leak design with metal compressible bronze jamb seals and extruded vinyl edge seals on all blades. Blades shall rotate on stainless steel sleeve bearings or bronze bushings. Leakage rate shall not exceed 1.6 cubic meters/min/square meter (5 CFM per square foot) at 250 Pa (1 inch WG) and 2.8 cubic meters/min/square meter (9 CFM per square foot) at 995 Pa (4 inch WG) Electronic operators shall be furnished and mounted in an accessible and easily serviceable location by the air handling unit manufacturer at the factory. Damper operators shall be of same manufacturer as controls furnished under Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
- L. Filter Section: Refer to Section 23 40 00, HVAC AIR CLEANING DEVICES, for filter requirements.
1. Filters including one complete set for temporary use at site shall be provided independent of the AHU. The AHU manufacturer shall install filter housings and racks in filter section compatible with filters furnished. The AHU manufacturer shall be responsible for furnishing temporary filters (pre-filters and after-filters, as shown on drawings) required for AHU testing.
 2. Factory-fabricated filter section shall be of the same construction and finish as the AHU casing including filter racks and hinged double wall access doors. Filter housings shall be constructed in accordance with side service or holding frame housing requirements in Section 23 40 00, HVAC AIR CLEANING DEVICES.
 3. Air-Handling Units serving surgical suites, shall have after filters located on the downstream side of the supply air fans and cooling coils. Provide a diffuser section between the fan and the after-filters to ensure uniform air distribution. The final filters shall be HEPA filters located prior to the air outlets.
- N. Coils: Coils shall be mounted on hot dipped galvanized steel supports to assure proper anchoring of coil and future maintenance. Coils shall be face or side removable for future replacement thru the access doors or removable panels. Each coil shall be removable without disturbing adjacent coil. Cooling coils shall be designed and installed to insure no condensate carry over. Provide factory installed extended supply, return, drain, and vent piping connections. For air handling units serving surgical suites, provide copper fins for all coils. For all air handling units in high humidity areas, provide factory-coated coils for

protection from corrosion by using multiple stage electro-deposition coating process. Refer to Drawings and Section 23 82 16, AIR COILS for additional coil requirements.

1. Water Coils,.

P. Sound Attenuators: Refer to Drawings, Specification Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT, and Section 23 31 00, HVAC DUCTS AND CASINGS, for additional unit mounted sound attenuator requirements. AHU sound attenuators shall be factory installed as an integral part of AHU.

Q. Discharge Section: Provide aerodynamically designed framed discharge openings or spun bellmouth fittings to minimize pressure loss.

R. Electrical and Lighting: Wiring and equipment specifications shall conform to Division 26, ELECTRICAL.

1. Vapor-proof lights using cast aluminum base style with glass globe and cast aluminum guard shall be installed in access sections for fan, mixing box, and any section over 300 mm (12 inch) wide. A switch shall control the lights in each compartment with pilot light mounted outside the respective compartment access door. Wiring between switches and lights shall be factory installed. All wiring shall run in neatly installed electrical conduits and terminate in a junction box for field connection to the building system. Provide single point 115 volt - one phase connection at junction box.

2. Install compatible 100 watt bulb in each light fixture.

3. Provide a convenience duplex receptacle next to the light switch.

4. Disconnect switch and power wiring: Provide factory or field mounted disconnect switch. Coordinate with Division 26, ELECTRICAL.

PART 3 - EXECUTION

3.1 INSTALLATION

A. Install air handling unit in conformance with ARI 435.

B. Assemble air handling unit components following manufacturer's instructions for handling, testing and operation. Repair damaged galvanized areas with paint in accordance with Military Spec. DOD-P-21035. Repair painted units by touch up of all scratches with finish paint material. Vacuum the interior of air handling units clean prior to operation.

D. Leakage and test requirements for air handling units shall be the same as specified for ductwork in Specification Section 23 31 00, HVAC DUCTS AND CASINGS except leakage shall not exceed Leakage Class (C_L) 12 listed in SMACNA HVAC Air Duct Leakage Test Manual when tested at 1.5 times the design static pressure. Repair casing air leaks that can be heard or felt during normal operation and to meet test requirements.

- E. Perform field mechanical (vibration) balancing in accordance with Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- F. Seal and/or fill all openings between the casing and AHU components and utility connections to prevent air leakage or bypass.

3.2 STARTUP SERVICES

- A. The air handling unit shall not be operated for any purpose, temporary or permanent, until ductwork is clean, filters are in place, bearings are lubricated and fan has been test run under observation.
- B. After the air handling unit is installed and tested, provide startup and operating instructions to VA personnel.
- C. An authorized factory representative should start up, test and certify the final installation and application specific calibration of control components. Items to be verified include fan performance over entire operating range, noise and vibration testing, verification of proper alignment, overall inspection of the installation, Owner/Operator training, etc.

- - - E N D - - -

SECTION 23 81 00
DECENTRALIZED UNITARY HVAC EQUIPMENT

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies split-systems, air conditioners.
- B. Definitions:
 - 1. Energy Efficiency Ratio (EER): (Btu hour/Watt) is equal to the measured cooling capacity of the unit by its electrical input.
 - 2. Unitary (ARI): A Unitary Air Conditioner consists of one or more factory-made assemblies which normally include an evaporator or cooling coil, a compressor and condenser combination, and may include a heating function as well. Where such equipment is provided in more than one assembly the separated assemblies are to be designed to be used together and the requirements of rating are based upon use of matched assemblies.

1.2 RELATED WORK

- B. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION: General mechanical requirements and items, which are common to more than one section of Division 23.
- C. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT: Requirements for different types of vibration isolators and noise ratings in the occupied areas.
- D. Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION: Requirements for piping insulation.
- E. Section 23 23 00, REFRIGERANT PIPING: Requirements for refrigerant pipes and fittings.
- F. Section 23 36 00, AIR TERMINAL UNITS and Section 23 82 00, CONVECTION HEATING AND COOLING UNITS: Requirements for other similar units.
- G. Section 23 73 00, INDOOR CENTRAL-STATION AIR-HANDLING UNITS: Requirements for air handling units using chilled water and hot water coils.

1.3 QUALITY ASSURANCE

- A. Refer to specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- B. Safety Standards: ASHRAE Standard 15, Safety Code for Mechanical Refrigeration.

1.4 SUBMITTALS

- A. Submit in accordance with specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES
- B. Manufacturer's literature and data:

1. Sufficient information, including capacities, pressure drops and piping connections clearly presented, shall be included to determine compliance with drawings and specifications for units noted below:
 - a. Unitary air conditioners:
 - 2) Split systems
2. Unit Dimensions required clearances, operating weights accessories and start-up instructions.
3. Electrical requirements, wiring diagrams, interlocking and control wiring showing factory installed and portions to be field installed.
4. Mounting and flashing of the roof curb to the roofing structure with coordinating requirements for the roof membrane system.
- B. Certification: Submit proof of specified ARI Certification.
- C. Performance Rating: Submit catalog selection data showing equipment ratings and compliance with required sensible-to-heat-ratio, energy efficiency ratio (EER), and coefficient of performance (COP).
- D. Operating and Maintenance Manual: Submit three copies of Operating and Maintenance manual to Resident Engineer three weeks prior to final inspection.

1.5 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Federal Specifications (Fed. Spec.):
A-A-50502-90..... Air conditioner (Unitary Heat Pump) Air to Air
(3000-300,000 Btu)
- C. Military Specifications (Mil. Specs.):
MIL-PRF-26915D-06.....Primer Coating, for Steel Surfaces
- D. Air-Conditioning and Refrigeration Institute (ARI):
210/240-06.....Performance Rating of Unitary Air-Conditioning
and Air-Source Heat Pump Equipment
270-95.....Sound Rating of Outdoor Unitary Equipment
310/380-04.....Standard for Packaged Terminal Air-Conditioners
and Heat Pumps (CSA-C744-04)
340/360-04.....Commercial and Industrial Unitary Air-
Conditioning and Heat Pump Equipment
520-04.....Positive Displacement Condensing Units
- E. Air Movement and Control Association (AMCA):
210-99.....Laboratory Methods of Testing Fans for
Aerodynamic Performance Rating (ANSI)
410-96.....Recommended Safety Practices for Users and
Installers of Industrial and Commercial Fans

- F. American National Standards Institute (ANSI):
S12.51-02.....Acoustics - Determination of Sound Power Levels
of Noise Sources Using Sound Pressure -
Precision Method for Reverberation Rooms (same
as ISO 3741:1999)
- G. American Society of Heating, Refrigerating, and Air-Conditioning
Engineers (ASHRAE):
2004 Handbook.....HVAC Systems and Equipment
15-04.....Safety Standard for Refrigeration Systems (ANSI)
- H. American Society of Testing and Materials (ASTM):
B117-03.....Standard Practice for Operating Salt Spray (Fog)
Apparatus
- I. National Electrical Manufacturer's Association (NEMA):
MG 1-06.....Motors and Generators (ANSI)
ICS 1-00 (R2005).....Industrial Controls and Systems: General
Requirements
- J. National Fire Protection Association (NFPA) Publications:
90A-02.....Standard for the Installation of Air-
Conditioning and Ventilating Systems

PART 2 - PRODUCTS

2.3 SPLIT-SYSTEM AIR CONDITIONERS

- A. Description: Factory assembled and tested, unit, with an air-cooled remote condensing unit, and field-installed refrigeration piping.
- B. Concealed Evaporator Components:
1. Chassis: Galvanized steel with flanged edges, removable panels for servicing, and insulation on back of panel.
 2. Insulation: Factory-applied duct liner.
 3. Drain Pans: Galvanized steel, with connection for drain; insulated and complying with ASHRAE 62.1-2004.
 4. Airstream Surfaces: Surfaces in contact with the airstream shall comply with requirements in ASHRAE 62.1-2004.
 5. Refrigerant Coil: Copper tube, with mechanically bonded aluminum fins, complying with ARI 210/240, and with thermal-expansion valve.
 6. 7. 8. Fan: Forward-curved, double-width wheel of galvanized steel; directly connected to motor.
 9. Fan Motors: Comply with requirements in Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC AND STEAM GENERATION EQUIPMENT for multi-tapped, multi-speed motors with internal thermal protection and permanent lubrication.
 10. Disposable Filters: 25 mm (1 inch) thick, in fiberboard frames with MERV rating of 6 or higher according to ASHRAE 52.2

11. Wiring Terminations: Connect motor to chassis wiring with plug connection.

C

F. Air-Cooled, Compressor-Condenser Components:

1. Casing: Steel, finished with baked enamel in color selected by Architect, with removable panels for access to controls, weep holes for water drainage, and mounting holes in base. Service valves, fittings, and gage ports shall be brass and located outside of the casing.
2. Compressor: Hermetically sealed reciprocating with crankcase heater and mounted on vibration isolation. Compressor motor shall have thermal- and current-sensitive overload devices, start capacitor, relay, and contactor.
3. Two-speed compressor motor with manual-reset, high-pressure switch and automatic-reset, low-pressure switch.
4. Refrigerant: R-410A unless otherwise indicated.
5. Refrigerant Coil: Copper tube, with mechanically bonded aluminum fins, complying with ARI 210/240, and with liquid subcooler.
6. Heat Pump Components: Reversing valve and low-temperature-air cut-off thermostat.
7. Fan: Aluminum, propeller type, directly connected to motor.
8. Motor: Permanently lubricated, with integral thermal-overload protection.
9. Low Ambient Kit: Permit operation down to 7 deg C (45 deg F).
10. Mounting Base: Polyethylene.
11. Minimum Energy Efficiency: Comply with ASHRAE/IESNA 90.1-2004, "Energy Standard for Buildings except Low-Rise Residential Buildings."

PART 3 EXECUTION

3.1 INSTALLATION

- C. Install wind and seismic restraints according to manufacturer's written instructions.
- D. Install units level and plumb maintaining manufacturer's recommended clearances and tolerances.
- F. Install vibration spring isolators under base of self contained unit, with minimum static deflection of 25 mm (1 inch) unless otherwise indicated. Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT
- I. Install roof-mounting compressor-condenser components on equipment supports specified in Section 07 72 00, ROOF ACCESSORIES. Anchor units to supports with removable, cadmium-plated fasteners.

- K. Install compressor-condenser components on restrained, spring isolators with a minimum static deflection of 25 mm (1 inch) unless otherwise indicated. Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- L. Install and connect precharged refrigerant tubing to component's quick-connect fittings. Install tubing to allow access to unit.
- M. Install wall sleeves in finished wall assembly and weatherproof. Install and anchor wall sleeves to withstand, without damage seismic forces as required by code.

3.2 CONNECTIONS

- A. Verify condensate drainage requirements.
- B. Install condensate drain, minimum connection size, with trap and indirect connection to nearest roof drain or area drain.
- C. Install piping adjacent to units to allow service and maintenance.
- E. Install ducts to termination at top of roof curb. Cut roof decking only as required for passage of ducts. Do not cut out decking under entire roof curb.
- F. Connect supply ducts to units with flexible duct connectors specified in Section 23 31 00, HVAC DUCTS AND CASINGS.
- H. Install normal-weight, 20.7-MPa (3000-psi), compressive strength (28-day) concrete mix inside roof curb, 100 mm (4 inches) thick.
- I. Ground equipment and install power wiring, switches, and controls for self contained and split systems.
- L. Connect refrigerant piping to coils with shutoff valves on the suction and liquid lines at the coil and a union or flange at each connection at the coil and condenser.
- M. Install ducts to the units with flexible duct connections.
- N. Connect piping with shutoff duty valves on the supply and return side of the coil and unions at all connections and with a throttling valve on the return piping near the coil.
- O. Connect piping with shutoff duty valves on the supply and return side of the water cooled condenser and unions at all connections and with a throttling valve on the return piping near the condenser
- P. Connect piping with shutoff duty valves and unions on the steam supply and condensate side of the steam coil. On the condensate line near the coil provide a strainer, trap and shutoff valve.

3.3 FIELD QUALITY CONTROL

- A. Perform tests and inspections and prepare test reports.
- B. Tests and Inspections: After installing units and after electrical circuitry has been energized, test units for compliance with requirements. Inspect for and remove shipping bolts, blocks, and tie-

down straps. After electrical circuitry has been energized, start units to confirm proper motor rotation and unit operation. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment. Remove and replace malfunctioning units and retest as specified above.

3.7 INSTRUCTIONS

Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.

---END---

SECTION 25 10 10
ADVANCED UTILITY METERING SYSTEM

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This Section includes the following for the advanced metering of the systems of the facility. The metered systems include the electrical power, natural gas distribution, fuel gas and fuel oil, steam, steam condensate, chilled water, heating water, domestic water, recovered water and makeup water systems. The metering systems in each facility are part of a Corporate-Wide utility metering system, rendering the VA accurate and automated metering of its facilities' energy and water flows. Metering systems are comprised of:
1. PC-based workstation(s) or server(s) and software.
 2. Communication network and interface modules for //RS-232, RS-485, Modbus TCP/IP, IEEE 802.3// data transmission protocols.
 3. Electric meters.
 4. Volumetric flowmeters, temperature sensors and pressure transducers.
 5. Mass flowmeters.

1.2 RELATED WORK

- B. Section 22 05 19 METERS AND GAGES FOR PLUMBING PIPING: meters and gages.
- C. Section 22 33 00 ELECTRIC DOMESTIC WATER HEATERS: references meters.
- D. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION: General mechanical requirements, common to more than one section in mechanical.
- E. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Flowmeters and communications
- F. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- G. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Low voltage cable.
- H. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- I. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits.
- J. Section 26 24 11, DISTRIBUTION SWITCHBOARDS: Secondary distribution switchboards.

K. Section 33 10 00 WATER UTILITIES: references meters.

1.3 DEFINITIONS

- A. AMR: Automatic meter reading is the technology of automatically collecting consumption, diagnostic, and status data from water and energy metering devices (water, gas, electric, steam) and transferring that data to a central database for billing, troubleshooting, and analyzing.
- B. AUMS: Advanced Utility Metering System: the system described by this Section.
- C. BACnet: BACnet is a Data Communications Protocol for Building Automation and Control Networks. It is defined by ASHRAE/ANSI Standard 135 (ISO 16484-5) standard protocol.
- D. Data Over Cable Service Interface Specification (DOCSIS): an international standard defining communications and operation support interface requirements for a data over cable system, by the Cable Television Laboratories, Inc. consortium
- E. Data Head (on meters): converts analog and pulse signals to digital signals for transmission to the Site Data Aggregation Device. Also provides for limited storage of the digital signals.
- F. Device Accuracy: accuracy in this section is based on actual flow, not full scale or full range. Device accuracy measures the conversion of flow information to analog or pulse signals.
- G. Ethernet: Local area network, based on IEEE 802.3 standards.
- H. Firmware: Software (programs or data) that has been written onto read-only memory (ROM). Firmware is a combination of software and hardware. Storage media with ROMs that have data or programs recorded on them are firmware.
- I. Gateway: Bi-directional protocol translator connecting control systems that use different communication protocols.
- J. GB: gigabyte. When used to describe data storage, "GB" represents 1024 megabytes.
- K. HTML: Hypertext markup language.
- L. I/O: Input/output.
- M. KB: Short for kilobyte. When used to describe data storage, "KB" represents 1024 bytes.
- N. KY Pulse: A term used by the metering industry to describe a method of measuring consumption of electricity that is based on a relay changing status in response to the rotation of the disk in the meter.

- O. LAN: Local area network. Sometimes plural as "LANs."
- P. LCD: Liquid crystal display.
- Q. LonMark: An association comprising of suppliers and installers of LonTalk products. The Association provides guidelines for the implementation of the LonTalk protocol to ensure interoperability through Standard implementation.
- R. LonTalk: An open standard protocol developed by the Echelon Corporation that uses a "Neuron Chip" for communication.
- S. LonWorks: Network technology developed by the Echelon Corporation.
- T. Low Voltage: As defined in NFPA 70 for circuits and equipment operating at less than 50 V or remote-control, signaling and power-limited circuits.
- U. MB: megabyte. When used to describe data storage, "MB" represents 1024 kilobytes.
- V. Mbps: Megabytes per second, equal to 8 megabits per second
- W. Modbus TCP/IP: An open protocol for exchange of process data.
- X. Monitoring: Acquisition, processing, communication, and display of equipment status data, metered electrical parameter values, power quality evaluation data, event and alarm signals, tabulated reports, and event logs.
- Y. OTDR: Optical Time Domain Reflectometer. A test instrument that analyzes the light loss in an optical fiber. Used to find faults, splices and bends in the line, it works by sending out a light pulse and measuring its reflection. Such devices can measure fiber lines that are longer than 150 miles
- Z. PC: Personal computer
- AA.PICS, Protocol Implementation Conformance Statement: A written document that identifies the particular options specified by BACnet that are implemented in a device.
- BB.REO: Resident Engineer Office: the VA office administering the construction contract.
- CC.Reporting Accuracy: this is the root-mean-square sum of all of the metering devices' inaccuracies: measurement inaccuracy, mechanical inaccuracy, analog-to-digital or pulse integration inaccuracy, etc., up to the meter's data head.
- DD.rms: Root-mean-square value of alternating voltage, which is the square root of the mean value of the square of the voltage values during a complete cycle.

EE.Router: A device that connects two or more networks at the network layer.

FF.RS-232: A Telecommunications Industry Association standard for asynchronous serial data communications between terminal devices.

GG.RS-485: A Telecommunications Industry Association standard for multipoint communications using two twisted-pairs.

HH.TB: terrabyte. When used to describe data storage, "TB" represents 1024 gigabytes.

II.TCP/IP: Transport control protocol/internet protocol.

JJ.Turn-down: the maximum flow divided by the minimum flow through a meter; used along with accuracy requirements. For example, a meter shall be accurate to within 2% of actual flow with throughout a 20:1 turndown

KK.THD: Total harmonic distortion.

LL.UPS: Uninterruptible power supply; used both in singular and plural context.

MM.UTP: Unshielded twisted pair cabling, used to limit crosstalk and electromagnetic interference from the environment

NN.WAN: Wide area network.

1.4 QUALITY ASSURANCE

- A. Installer Qualifications: Manufacturer's authorized representative who is trained and approved for installation of units required for this Project.
- B. Manufacturer Qualifications: A firm experienced at least three years in manufacturing and installing power monitoring and control equipment similar to that indicated for this Project and with a record of successful in-service performance.
- C. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency, and marked for intended use.
- D. System Modifications: Make recommendations for system modification in writing to the VA. No system modifications shall be made without prior written approval of the VA. Any modifications made to the system shall be incorporated into the Operations and Maintenance Instructions, and other documentation affected. Provide to the VA software updates for all software furnished under this specification during this contract's construction and verification periods and for the first two years after

government acceptance. All updated software shall be verified as part of this contract.

1.5 PERFORMANCE

A. The advanced utility metering system shall conform to the following:

1. Site Data Aggregation Device Graphic Display: The system shall display up to 4 graphics on a single screen with a minimum of (20) dynamic points per graphic. All current data shall be displayed within (10) seconds of the request.
2. Site Data Aggregation Device Graphic Refresh: The system shall update all dynamic points with current data within ten seconds. Data refresh shall be automatic, without operator intervention.
3. Meter Scan: All changes of metered values shall be transmitted over the high-speed network such that any data used or displayed at a controller or Site Data Aggregation Device will be current, within the prior ten seconds.
4. Alarm Response Time: The maximum time from when meter goes into alarm to when it is annunciated at the workstation shall not exceed ten seconds.
5. Reporting Accuracy: Listed below are minimum acceptable reporting accuracies for all values within the below minimum turn-down envelope reported by the meters:

Measured Variable	Units Measured	Minimum Turn-Down of Meter	Reporting Accuracy (Note 1)
Electricity	V, A, W, etc.	n/a	±0.5% of measured value
Natural Gas	l/s (CFH)	10:1	±2%
Liquefied Petroleum Gas	l/s (CFH)	10:1	±2%
Steam	kW (MBH)	20:1	±2%
Condensate	kW (MBH)	20:1	±2%
Domestic Water flow	l/s (GPH)	20:1	±2%
Reclaimed Water flow	l/s (GPH)	20:1	±2%
Make-up Water to Boilers flow	l/s (GPH)	10:1	±2%
Make-up Water to Cooling Towers flow	l/s (GPH)	10:1	±2%
No. 2 Heating Oil	l/s (GPH)	10:1	±2%
No. 6 Heating Oil	l/s (GPH)	10:1	±2%
Heating Water	kW (MBH)	20:1	±2%

Chilled Water	kW (MBH)	20:1	±2%
Outside Air Temperature	°C (°F)	n/a	±2%
Outside Air Relative Humidity	% rh	n/a	±2.5%

Table 1.5: Meter Performance Criteria

Table Notes:

1. This table shows reporting accuracy, not merely the meter's accuracy. Reporting accuracy includes meter accuracy and data conversion accuracy. See Article 1.3 in this Section for definition. Accuracy is shown against the measured value, not against the full range of the meter.
2. l/s: liter per second
CFH: cubic feet per hour
kW: kilowatt
MBH: 1000's British Thermal Units per hour
GPH: gallons per hour

1.6 WARRANTY

- A. Labor and materials for advanced utility metering systems shall be warranted for a period as specified under Warranty in FAR clause 52.246-21.
- B. Advance utility metering system failures during the warranty period shall be adjusted, repaired, or replaced at no cost or reduction in service to the owner. The system includes all computer equipment, transmission equipment, and all sensors and metering devices.

1.7 SUBMITTALS

- A. Product Data: for each type of product indicated, Attach copies of approved Product Data submittals for products (such as flowmeters, temperature sensors and pressure transmitters, switchboards and switchgear) that describe advance utility metering features to illustrate coordination among related equipment and utility metering and control.
- B. Shop Drawings: include plans, elevations, sections, details, and attachments to other work.
 1. Outline Drawings: Indicate arrangement of meters, components and clearance and access requirements. Clearly identify system components, internal connections, and all field connections.
 2. Block Diagram: Show interconnections between components specified in this Section and devices furnished with power distribution system components. Indicate data communication paths and identify

- networks, data buses, data gateways, concentrators, and other devices to be used. Describe characteristics of network and other data communication lines.
3. Detail equipment assemblies and indicate dimensions, weights, loads, required clearances, method of field assembly, components, and location and size of each field connection.
 4. Wiring Diagrams: Power, signal, and communications wiring. Coordinate nomenclature and presentation with a block diagram. Show all communications network components and include a communications single-line diagram indicating device interconnection and addressing information for all system devices. Identify terminal blocks used for interconnections and wire type to be used.
 5. UPS sizing calculations for workstation.
- C. Software and Firmware Operational Documentation:
1. Self-study guide describing the process for setting equipment's network address; setting Owner's options; procedures to ensure data access from any PC on the network, using a standard Web browser; and recommended firewall setup.
 2. Software operating and upgrade manuals.
 3. Software Backup: On a compact disc, complete with Owner-selected options.
 4. Device address list and the set point of each device and operator option, as set in applications software.
 5. Graphic file and printout of graphic screens and related icons, with legend.
 6. "Quick-Start" guide to describe a simple, three-step commissioning process for setting the equipment's Ethernet address, and ensuring trouble-free data access from any PC on the network, using a standard web browser.
- D. Software Upgrade Kit: For Owner to use in modifying software to suit future utility metering system revisions.
- E. Firmware Upgrade Kit: For Owner to use in modifying firmware to suit future power system revisions or advanced utility metering system revisions. Firmware updates, and necessary software tools for firmware updates, shall be downloadable from the internet. VA shall be able to update firmware, in equipment, without removing device from the equipment. VA shall be capable of updating firmware over the utility

metering communication network or through local communication ports on the device.

F. Software licenses and upgrades required by and installed for operating and programming digital and analog devices.

G. Qualification Data: For installer and manufacturer

H. Other Informational Submittals:

1. System installation and setup guides, with data forms to plan and record options and setup decisions.

I. Revise and update the Contract Drawings to include details of the system design. Drawings shall be on 17 by 11 inches sheets. Details to be shown on the Design Drawing include:

1. Details on logical structure of the network. This includes logical location of all network hardware.

2. Manufacturer and model number for each piece of computer and network hardware.

3. Physical location for each piece of network or computer hardware.

4. Physical routing of LAN cabling.

5. Physical and qualitative descriptions of connectivities.

1.8 CLOSEOUT SUBMITTALS

A. Operation and Maintenance Data: For advanced utility metering system components and meters, to include in emergency, operation, and maintenance manuals. Include the following:

1. Operating and applications software documentation.

2. Software licenses.

3. Software service agreement.

4. PC installation and operating documentation, manuals, and software for the PC and all installed peripherals. Software shall include system restore, emergency boot compact disks, and drivers for all installed hardware. Provide separately for each PC.

5. Hard copies of manufacturer's specification sheets, operating specifications, design guides, user's guides for software and hardware, and PDF files on CD-ROM of the hard-copy submittal.

6. In addition to the copies required by 01 00 00, provide 5 bound paper copies of the Operation and Maintenance Data and two compact disks (CD), with all Instructions as Acrobat PDF files. The pdf files shall identical to the paper copies and shall Acrobat navigation tools including Bookmarks for each Chapter.

7. The advanced utility metering system Operation and Maintenance

Instructions shall include:

- a. Procedures for the AUMS system start-up, operation and shut-down.
- b. Final As-Built drawings, including actual LAN cabling routing shown on architectural backgrounds.
 - 1) IP address(es) as applicable for each piece of network hardware.
 - 2) IP address for each computer server, workstation and networked printer.
 - 3) Network identifier (name) for each printer, computer server and computer workstation.
 - 4) CEA-709.1B address (domain, subnet, node address) for each CEA-709.1B TP/FT-10 to IP Router.
- c. Routine maintenance checklist, rendered in a Microsoft Excel format. The routine maintenance checklist shall be arranged in a columnar format. The first column shall list all installed devices, the second column shall list each device's node identifier/address, the third column shall describe each device's physical location, the fourth column shall state the maintenance activity or state no maintenance required, the fifth column shall state the frequency of the maintenance activity, frequency of calibration and the sixth column for additional comments or reference.
- d. Qualified service organization list.
- e. In addition to the requirements in Section 01 33 23, the submittal shall include manufacturer Installation Requirements.
- f. Include complete instructions for calibration of each meter type and model.
- g. Start-Up and Start-Up Testing Report.
- h. Performance verification test procedures and reports.
- i. Preventive Maintenance Work Plan.
- j. In addition to factory-trained manufacturers' representatives requirements in 01 00 00, provide signed letter by factory-trained manufacturers' representatives stating that the system and components are installed in strict accordance with the manufacturers' recommendations.

B. Field quality-control test reports.

1.9 LICENSING AGREEMENT

- A. Licenses procured as part of this work become the property of the government upon acceptance of the work. Licenses shall have no expiration.
- B. Technical Support: Beginning with Government Acceptance, provide software support for two years.
- C. Upgrade Service: Update software to latest version at Project completion. Install and program software upgrades that become available within two years from date of Government Acceptance. Upgrading software shall include the operating systems. Upgrade shall include new or revised licenses for use of software.
 - 1. Provide 30-day notice to Owner to allow scheduling and access to system and to allow Owner to upgrade computer equipment if necessary.

1.10 MAINTENANCE AND SERVICE

- A. Preventive Maintenance Requirements: provide a preventative maintenance plan with attached procedures indicated by meter and component manufacturers. Perform maintenance procedures for a period of 1 year after government acceptance, at frequencies and using procedures required by the meter and component manufacturers. At a minimum and if the manufacturer is silent on its preventative maintenance requirements, frequencies, deliverables and activities shall comply with the following:
 - 1. Preventive Maintenance Work Plan: prepare a Preventive Maintenance Work Plan to schedule all required preventive maintenance. VA approval of the Work Plan shall be obtained. Adhere to the approved work plan to facilitate VA verification of work. If the Contractor finds it necessary to reschedule maintenance, a written request shall be made to the VA detailing the reasons for the proposed change at least five days prior to the originally scheduled date. Scheduled dates shall be changed only with the prior written approval of the REO.
 - 2. Semiannual Maintenance: perform the following Semiannual Maintenance as specified:
 - a. Perform data backups on all Server Hardware.
 - b. Run system diagnostics and correct diagnosed problems.
 - c. Perform fan checks and filter changes for AUMS hardware.
 - d. Perform all necessary adjustments on printers.

- e. Resolve all outstanding problems.
- f. Install new ribbons, ink cartridges and toner cartridges into printers, and ensure that there is at least one spare ribbon or cartridge located at each printer.

3. Maintenance Procedures

- a. Maintenance Coordination: Any scheduled maintenance event by Contractor that will result in component downtime shall be coordinated with the VA as follows. Time periods shall be measured as actual elapsed time from beginning of equipment off-line period, including working and non-working hours.
 - 1) For non-redundant computer server hardware, provide 14 days notice, components shall be off-line for no more than 8 hours.
 - 2) For redundant computer server hardware, provide 7 days notice, components shall be off-line for no more than 36 hours.
 - 3) For active (powered) network hardware, provide 14 days notice, components shall be off-line for no more than 6 hours.
 - 4) For cabling and other passive network hardware, provide 21 days notice, components shall be off-line for no more than 12 hours.
- b. Software/Firmware: Software/firmware maintenance shall include operating systems, application programs, and files required for the proper operation of the advanced utility metering system regardless of storage medium. User- (project site-) developed software is not covered by this contract, except that the advanced utility metering system software/firmware shall be maintained to allow user creation, modification, deletion, and proper execution of such user-developed software as specified. Perform diagnostics and corrective reprogramming as required to maintain total advanced utility metering system operations as specified. Back up software before performing any computer hardware and software maintenance. Do not modify any parameters without approval from the VA. Any approved changes and additions shall be properly documented, and the appropriate manuals shall be updated.
- c. Network: Network maintenance shall include testing transmission media and equipment to verify signal levels, system data rates, errors and overall system performance.

B. Service Call Reception

1. A VA representative will advise the Contractor by phone or in person of all maintenance and service requests, as well as the classification of each based on the definitions specified. A description of the problem or requested work, date and time notified, location, classification, and other appropriate information will be placed on a Service Call Work Authorization Form by the VA.
2. The Contractor shall have procedures for receiving and responding to service calls during regular working hours. A single telephone number shall be provided for receipt of service calls during regular working hours. Service calls shall be considered received by the Contractor at the time and date the telephone call is placed by the VA.
3. Separately record each service call request, as received on the Service Call Work Authorization form. Complete the Service Call Work Authorization form for each service call. The completed form shall include the serial number identifying the component involved, its location, date and time the call was received, nature of trouble, names of the service personnel assigned to the task, instructions describing what has to be done, the amount and nature of the materials to be used, the time and date work started, and the time and date of completion.
4. Respond to each service call request within two working hours. The status of any item of work must be provided within four hours of the inquiry during regular working hours, and within sixteen hours after regular working hours or as needed to repair equipment.

1.11 SPARE PARTS

- A. Furnish spare parts described below that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
 1. Addressable Relays: One for every ten installed. Furnish at least one of each type.
 2. Data Line Surge Suppressors: One for every ten of each type installed. Furnish at least one of each type.
- B. Furnish spare parts shall not be used for any warranty-required remediation.

1.12 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced, unless otherwise noted. Publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):
- B16.1-1998.....Cast Iron Pipe Flanges and Flanged Fittings
 - B31.1-2007.....Power Piping
 - B31.8-2007.....Gas Transmission and Distribution Piping Systems
 - B31.9-2008.....Building Services Piping
 - B40.100-1998.....Pressure Gauges and Gauge Attachments
- C. American Society of Heating, Refrigerating and Air-Conditioning Engineers
- ASHRAE 135-2008.....A Data Communication Protocol for Building Automation and Control Networks (ANSI)
- D. American Society for Testing and Materials (ASTM)
- A53-2006.....Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless
 - A106-2006.....Seamless Carbon Steel Pipe for High Temperature Service
- E. Consumer Electronics Association (CEA)
- 709.1B-2002.....Control Network Protocol Specification
 - 709.3-1999.....Free-Topology Twisted-Pair Channel Specification
 - 852-A-2004.....Tunneling Component Network Protocols Over Internet Protocol Channels
- F. Federal Communications Commission (FCC)
- EMC-2002.....FCC Electromagnetic Compliance Requirements
- G. Institute of Electrical and Electronics Engineers, Inc. (IEEE)
- 81-1983.....IEEE Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Ground System
 - 100-2000.....The Authoritative Dictionary of IEEE Standards Terms
 - 802.1D-2004.....Media Access Control Bridges
 - 802.2-2003.....Standards for Local Area Networks: Logical Link Control

- 802.3-2005.....Information Technology - Telecommunications and
Information Exchange between Systems. Local and
Metropolitan Area Networks - Specific
Requirements - Part 3: Carrier Sense Multiple
Access with Collision Detection (CSMA/CD)
Access Method and Physical Layer Specifications
(ANSI)
- 1100-2005.....Recommended Practice for Powering and Grounding
Electronic Equipment (ANSI)
- C37.90.1-2002.....Surge Withstand Capability (SWC) Tests for
Relays and Relay Systems Associated with
Electric Power Apparatus
- C57.13-2008.....Standard Requirements for Instrument
Transformers
- C62.41.1-2002.....Guide on the Surges Environment in Low-
Voltage(1000 V and Less) AC Power Circuits
- C62.41.2-2002.....Recommended Practice on Characterization of
Surges in Low-Voltage (1000 V and Less) AC
Power Circuits
- H. International Electrotechnical Commission (IEC)
- IEC 61000-2005.....Electromagnetic Compatibility (EMC)- Part 4-5:
Testing and Measurement Techniques; Surge
Immunity Test
- I. National Electrical Contractors Association
- NECA 1-2006.....Good Workmanship in Electrical Construction
- J. National Electrical Manufacturers Association (NEMA)
- 250-2008.....Enclosures for Electrical Equipment (1000 Volts
Maximum)
- C12.1-2008.....Electric Meters; Code for Electricity Metering
- C12.20-2002.....Electricity Meter - 0.2 and 0.5 Accuracy
Classes
- C62.61-1993.....Gas Tube Surge Arresters on Wire Line Telephone
Circuits
- ICS 1-2008.....Standard for Industrial Control and Systems
General Requirements
- K. National Institute of Standards and Technology (NIST)
- 800, Part 39-2008.....[DRAFT] Managing Risk from Information Systems:
An Organizational Perspective

- 800, Part 46-2009.....Guide to Enterprise Telework and Remote Access
Security
- 800, Part 52-2009.....Recommended Security Controls for Federal
Information Systems and Organizations
- (FIPS) 200-2006.....Minimum Security Requirements for Federal
Information and Information Systems
- L. National Fire Protection Association (NFPA)
 - 30-08.....Flammable and Combustible Liquids Code
 - 70-2008.....National Electrical Code (NEC)
 - 54-06.....National Fuel Gas Code
 - 85-07.....Boiler and Combustion Systems Hazard Code
 - 101-06.....Life Safety Code
 - 262-2007.....Test for Flame Travel and Smoke of Wires and
Cables for Use in Air-Handling Spaces
- M. NSF International
 - 14-03.....Plastics Piping Components and Related
Materials
 - 61-02.....Drinking Water System Components-Health Effects
(Sections 1-9)
- N. Telecommunications Industry Association, (TIA/EIA)
 - H-088C3.....Pathway Design Handbook
 - 232-F-2002.....Interface Between Data Terminal Equipment and
Data Circuit-Terminating Equipment Employing
Serial Binary Data Interchange
 - 485-A-2003.....Electrical Characteristics of Generators and
Receivers for Use in Balanced Digital
Multipoint System
 - 568-C.1-2009.....Commercial Building Telecommunications Cabling
Standard
 - 606-A-2002.....Administration Standard for the
Telecommunications Infrastructure
 - 607-A-2002.....Commercial Building Grounding (Earthing) and
Bonding Requirements for Telecommunications
- O. Underwriters Laboratories, Inc. (UL):
 - 916-2007.....Energy Management Equipment
 - 5085-3-2007.....UL Standard for Safety Standard Low Voltage
 - 1244-2000.....Electrical and Electronic Measuring and Testing
Equipment

1581-2006.....Electrical Wires, Cables, and Flexible Cords

PART 2 - PRODUCTS

2.1 ADVANCED UTILITY METERING SYSTEM

A. Functional Description

1. Meter and record load profiles. Chart energy and water consumption patterns.

a. Calculate and record the following:

- 1) Load factor.
- 2) Peak demand periods.
- 3) Consumption correlated with facility activities.

b. Measure and record metering data for the following:

- 1) Electricity.
- 2) Steam and condensate
- 3) Domestic water.
- 4) Natural gas.
- 5) Oil.
- 6) Liquefied Petroleum Gas.
- 7) Used, Boiled/Evaporated, Reclaimed and Recovered water.
- 8) Chilled water
- 9) Heating water

c. Software: calculate allocation of utility costs.

- 1) Automatically import energy and water usage records to allocate energy and water costs for the following:
 - a) At least ~~two~~ ~~///XXX//~~ departments.
 - b) At least ~~three~~ ~~///XXX//~~ processes.
 - c) At least ~~two~~ ~~///XXX//~~ buildings.
- 2) Verify utility bills and analyze alternate energy rates.

d. Electric Power Quality Monitoring: Identify power system anomalies and measure, display, capture waveforms, and record trends and alarms of the following power quality parameters:

- 1) Voltage regulation and unbalance.
- 2) Continuous three-phase rms voltage.
- 3) Periodic max./min./avg. samples.
- 4) Harmonics.
- 5) Voltage excursions.

~~6) ~~///XXX parameter.//~~~~

f. Demand Management:

- 1) Peaking or co-generator control.

- 2) Load interlocking.
- 3) Load shedding.
- 4) Load trimming.

~~5) //XXX management strategy.//~~

g. System: Report equipment status and power system control.

B. Communications Components and Networks

1. Site Data Aggregation Device and its networked meters shall communicate using BACNet protocol. Backbone shall communicate using ISO 8802-3 (Ethernet) Data Link/Physical layer protocol and BACnet/IP addressing as specified in ASHRAE/ANSI 135-2008, BACnet Annex J.
 - a. Control products, communication media, connectors, repeaters, hubs, and routers shall comprise a BACnet internetwork. Controller and operator interface communication shall conform to ANSI/ASHRAE Standard 135-2008, BACnet.
 - b. Each controller shall have a communication port for connection to an operator interface.
2. Network Configuration: High-speed, multi-access, open nonproprietary, industry standard LAN and WAN and Internetworked LAN.
3. Communication protocol; LANs complying with RS-485 or RS-485 accessed through Ethernet, 100 Base-TX Ethernet, and Modbus TCP/IP.
4. Network Hardware
 - a. Building Point of Connection Hardware
 - 1) Active equipment and communication interfaces.
 - 2) Switches, hubs, bridges, routers and servers.
 - b. IP Network Hardware
 - 1) Wire and Cables, copper connectivity devices.
 - 2) Fiber Optic Patch Panel.
 - 3) Fiber Optic Media Converter
 - 4) Ethernet Switch
 - 5) IP Router
5. Communication Security
 - a. Remote teleworking and remote access of the network shall be through a firewall, at the Site Data Aggregation Device, complying with the requirements associated with Level 1 security in the Federal Information Processing Standard 140-2 (2002), Security Requirements for Cryptographic Modules.

b. Direct access to network shall be restricted as described in

2.2 SITE DATA AGGREGATION DEVICE - PERSONAL COMPUTER WORKSTATION

A. Hardware

1. Workstation Hardware

- a. Environmental Conditions: System components shall be capable of withstanding Indoor installation in spaces that have environmental controls to maintain ambient conditions of 36 to 140 deg F dry bulb temperature and 20 to 95% relative humidity, noncondensing environmental conditions without mechanical or electrical damage or degradation of operating capability.
- b. Computer: Commercial standard with supporting 32- or 64-bit hardware (as limited by the advanced utility metering system software) and software enterprise server. Internet Explorer v6.0 SP1 or higher, Windows Script Hosting version 5.6 or higher, Windows Message Queuing, Windows Internet Information Services (IIS) v5.0 or higher, minimum 2.8 GHz processor, minimum 4GB DDR3 SDRAM (minimum 1333 Mhz) memory, minimum 1 TB 7200 rpm SATA hard drive with 16 MB cache, 512 MB video card, and 16 speed high density DVD-RW+/- optical drive.
- c. Real-Time Clock:
 - 1) Accuracy: Plus or minus 1 minute per month.
 - 2) Time Keeping Format: 24-hour time format including seconds, minutes, hours, date, day, and month; automatic reset by software.
 - 3) Clock shall function for one year without power.
 - 4) Provide automatic time correction once every 24 hours by synchronizing clock with the Time Service Department of the U.S. Naval Observatory.
- d. Serial Ports: Four USB ports and two RS-232-F serial ports for general use, with additional ports as required. Data transmission rates shall be selectable under program control.
- e. Parallel Port: Enhanced.
- f. Sound Card: For playback and recording of digital WAV sound files associated with audible warning and alarm functions.
- g. Color Monitor: PC compatible, not less than 22 inches, LCD type, with a minimum resolution of 1280 by 1024 pixels, noninterlaced, and a maximum dot pitch of 0.28 mm.

- h. Keyboard: Minimum of 64 characters, standard ASCII character set based on ANSI INCITS 154.
 - i. Mouse: Standard, compatible with installed software.
 - j. Removable Disk Storage: Include the following, each with appropriate controller:
 - 1) Minimum 1 TB removable hard disk, maximum average access time of 10 ms.
 - k. Network Interface Card (NIC): integrated 10-100-1000 Base-TX Ethernet NIC with an RJ45 connector or a 100Base-FX Ethernet NIC with an SC/ST connector.
 - l. Cable Modem: 42.88 Mbps, DOCSIS 3.0 Certified, also backwards compatible with DOCSIS 2.0 and DOCSIS 1.1/1.0 standards. Provide Ethernet or USB connectivity.
 - m. Optical Modem: full duplex link, for use on 10 GBase-R single-mode and multi-mode fiber with a XENPAK module.
 - n. Modem: 56,600 bits per second, full duplex for asynchronous communications. With error detection, auto answer/autodial, and call-in-progress detection. Modem shall comply with requirements in ITU-T v.34, ITU-T v.42, ITU-T v.42 Appendix VI for error correction, and ITU-T v.42 BIS for data compression standards; and shall be suitable for operating on unconditioned voice-grade telephone lines complying with 47 CFR 68.
 - o. Audible Alarm: Manufacturer's standard.
2. Printers: provide a dedicated, minimum resolution 600 dpi, color laser printer, connected to the Site Data Aggregation Device through a USB interface.
- a. If a network printer is used instead of this dedicated printer, it shall have a 100Base-T interface with an RJ45 connection and shall have a firmware print spooler compatible with the Operating System print spooler.
 - b. RAM: 512 MB, minimum.
 - c. Printing Speed: Minimum twenty six pages per minute (color); minimum 30 pages per minute (black/white).
 - d. Paper Handling: Automatic sheet feeder with 250-sheet x 8.5 inch x 11 inch paper cassette and with automatic feed.
3. RS-232 ASCII Interface
- a. ASCII interface shall allow RS-232 connections to be made between a meter or circuit monitor operating as the host PC and any

equipment that will accept RS-232 ASCII command strings, such as local display panels, dial-up modems, and alarm transmitters.

- b. Pager System Interface: Alarms shall be able to activate a pager system with customized message for each input alarm.
 - c. RS-232 output shall be capable of connection to a pager interface that can be used to call a paging system or service and send a signal to a portable pager. System shall allow an individual alphanumeric message per alarm input to be sent to paging system. This interface shall support both numeric and alphanumeric pagers.
 - d. Alarm System Interface: RS-232 output shall be capable of transmitting alarms from other monitoring and alarm systems to workstation software.
 - e. Cables: provide Plenum-Type, RS-232 Cable: Paired, 2 pairs, No. 22 AWG, stranded (7x30) tinned copper conductors, plastic insulation, and individual aluminum foil-polyester tape shielded pairs with 100 percent shield coverage; plastic jacket. Pairs are cabled on common axis with No. 24 AWG, stranded (7x32) tinned copper drain wire.
 - 1) NFPA 70, Type CMP.
 - 2) Flame Resistance: NFPA 262, Flame Test.
4. Rack-Mounted Server Hardware
- a. Environmental Conditions: System components shall be capable of withstanding Indoor installation in spaces that have environmental controls to maintain ambient conditions of 36 to 140 deg F dry bulb temperature and 20 to 95% relative humidity, noncondensing environmental conditions without mechanical or electrical damage or degradation of operating capability.
 - b. Computer: Commercial rack-mounted with supporting 32- or 64-bit hardware (as limited by the advanced utility metering system software) and software enterprise server. Internet Explorer v6.0 SP1 or higher, Windows Script Hosting version 5.6 or higher, Windows Message Queuing, Windows Internet Information Services (IIS) v5.0 or higher, minimum 2.8 GHz processor, minimum 4GB DDR3 SDRAM (minimum 1333 Mhz) memory, minimum 1 TB 7200 rpm SATA hard drive with 16 MB cache, and 16 speed high density DVD-RW+/- optical drive.
 - c. Real-Time Clock:

- 1) Accuracy: Plus or minus 1 minute per month.
 - 2) Time Keeping Format: 24-hour time format including seconds, minutes, hours, date, day, and month; automatic reset by software.
 - 3) Clock shall function for one year without power.
 - 4) Provide automatic time correction once every 24 hours by synchronizing clock with the Time Service Department of the U.S. Naval Observatory.
 - d. Serial Ports: Four USB ports and two RS-232-F serial ports for general use, with additional ports as required. Data transmission rates shall be selectable under program control.
 - e. Parallel Port: Enhanced.
 - f. Removable Disk Storage: Include minimum 1 TB removable hard disk, maximum average access time of 10 ms, with appropriate controller:
 - g. Network Interface Card (NIC): integrated 10-100-1000 Base-TX Ethernet NIC with an RJ45 connector or a 100Base-FX Ethernet NIC with an SC/ST connector.
 - h. Cable Modem: 42.88 Mbps, DOCSIS 2.0 Certified, also backwards compatible with DOCSIS 2.0 and DOCSIS 1.1/1.0 standards. Provide Ethernet or USB connectivity.
 - i. Optical Modem: full duplex link, for use on 10 GBase-R single-mode and multi-mode fiber with a XENPAK module.
 - j. Modem: 56,600 bits per second, full duplex for asynchronous communications. With error detection, auto answer/autodial, and call-in-progress detection. Modem shall comply with requirements in ITU-T v.34, ITU-T v.42, ITU-T v.42 Appendix VI for error correction, and ITU-T v.42 BIS for data compression standards; and shall be suitable for operating on unconditioned voice-grade telephone lines complying with 47 CFR 68.
 - k. Audible Alarm: Manufacturer's standard.
5. RS-232 ASCII Interface
- a. ASCII interface shall allow RS-232 connections to be made between a meter or circuit monitor operating as the host PC and any equipment that will accept RS-232 ASCII command strings, such as local display panels, dial-up modems, and alarm transmitters.
 - b. Pager System Interface: Alarms shall be able to activate a pager system with customized message for each input alarm.

- c. RS-232 output shall be capable of connection to a pager interface that can be used to call a paging system or service and send a signal to a portable pager. System shall allow an individual alphanumeric message per alarm input to be sent to paging system. This interface shall support both numeric and alphanumeric pagers.
 - d. Alarm System Interface: RS-232 output shall be capable of transmitting alarms from other monitoring and alarm systems to workstation software.
 - e. Cables: provide Plenum-Type, RS-232 Cable: Paired, 2 pairs, No. 22 AWG, stranded (7x30) tinned copper conductors, plastic insulation, and individual aluminum foil-polyester tape shielded pairs with 100 percent shield coverage; plastic jacket. Pairs are cabled on common axis with No. 24 AWG, stranded (7x32) tinned copper drain wire.
 - 1) NFPA 70, Type CMP.
 - 2) Flame Resistance: NFPA 262, Flame Test.
- B. Software
- 1. Operating System (OS)
 - a. For a Site Data Aggregation Device connected to multiple utility meters, software shall reside on the Workstation or Server PC connected to a network able to poll and support over 1000 utility metering devices; software shall be web-enabled with the option to add custom graphics displays and additional web-enabled clients. BACNet, Ethernet, Modbus TCP/IP, RS-232, and RS-485 digital communications.
 - b. Operating System Software: Based on 32- or 64-bit, Microsoft Windows operating system, as required by the metering and database software. Software shall have the following features:
 - 1) Multiuser and multitasking to allow independent activities and monitoring to occur simultaneously at different workstations.
 - 2) Graphical user interface to show pull-down menus and a menu tree format.
 - 3) Capability for future additions within the indicated system size limits.
 - 2. Office Automation Software shall consist of the e-mail, spreadsheet and word processing portions of the project site's standard office automation software.

3. Virus Protection Software shall consist of the project site's standard virus protection software complete with a virus definition update subscription.
4. Configuration server shall meet the requirements of CEA-852-A.
5. Network configuration tool shall meet the following minimum requirements:
 - a. It shall allow configuration of the network while off-line such that an operator may set up changes to the network while disconnected from the network, and then execute all of them once connected.
 - b. It shall have a graphics-based user interface, and be able to display and print a graphical representation of the control network.
 - c. It shall be capable of generating and printing a table containing domain/subnet/node address and node identifier for the entire network or any subset thereof, selected by the User.
 - d. It shall be capable of merging two existing standard databases into a single standard database.
6. Metering Software
 - a. Basic Requirements:
 - 1) Fully compatible with and based on the approved operating system.
 - 2) Password-protected operator login and access; three levels, minimum.
 - 3) Password-protected setup functions.
 - 4) Context sensitive on-line help.
 - 5) Capability of creating, deleting, and copying files; and automatically maintaining a directory of all files, including size and location of each sequential and random-ordered record.
 - 6) Capability for importing custom icons into graphic views to represent alarms and I/O devices.
 - 7) Automatic and encrypted backups for database and history; automatically stored at the Site Data Aggregation Device and encrypted with a nine-character alphanumeric password, which must be used to restore or read data contained in backup.
 - 8) Operator audit trail for recording and reporting all changes made to user-defined system options.

- b. Workstation and Server Functions:
 - 1) Support other client PCs on the LAN and WAN.
 - 2) Maintain recorded data in databases accessible from other PCs on the LAN and WAN.
- c. Data Formats:
 - 1) User-programmable export and import of data to and from commonly used Microsoft Windows spreadsheet, database, billing, and other applications; using dynamic data exchange technology.
 - 2) Option to convert reports and graphics to HTML format.
 - 3) Interactive graphics.
 - 4) Option to send preprogrammed or operator designed e-mail reports.
 - 5) Option to serve information to third-party applications via Object Linking and Embedding for Process Control using open standards.
- d. Metered data: Display metered values in real time with a rigid time-stamp. Couple all metered data with measured outside air conditions at the relevant facility.
- e. Metered Data alarms: Provide generic alarm modules to notify Users and highlight metered data gaps, data spikes outside of range, and data timestamp errors.
 - 1) Customize the generic alarm modules to the application.
 - 2) Modules shall allow for user adjustment of alarm criteria.
 - 3) Alarm notices shall be shown via hyperlinks on the graphical User interface, and shall also be shown by flags within the data set.
- f. Automatic Data Scrubbing: Provide tools for User-programming of rules to scrub the data of the followings errors: data gaps, data spikes outside of range, and data timestamp errors. Use these rules to scrub the raw metered data. Flag all data which has been so scrubbed.
- g. Remote control:
 - 1) (for electrical load control) Display circuit-breaker status and allow breaker control.
 - 2) User defined with load-shedding automatically initiated and executed schemes responding to programmed time schedules, set

points of metered demands, utility contracted load shedding,
or combinations of these.

- h. Equipment Documentation: Database for recording of equipment ratings and characteristics; with capability for graphic display on monitors.
- i. User-Defined Events: Display and record with date and time stamps accurate to 0.1 second, and including the following:
 - 1) Operator log on/off.
 - 2) Attempted operator log on/off.
 - 3) All alarms.
 - 4) Equipment operation counters.
 - 5) Out-of-limit, pickup, trip, and no-response events.
- j. (for electrical power monitoring) Waveform Data: Display and record waveforms on demand or automatically on an alarm or programmed event; include the graphic displays of the following, based on user-specified criteria:
 - 1) Phase voltages, phase currents, and residual current.
 - 2) Overlay of three-phase currents, and overlay each phase voltage and current.
 - 3) Waveforms ranging in length from 2 cycles to 5 minutes.
 - 4) Disturbance and steady-state waveforms up to 512 points per cycle.
 - 5) Transient waveforms up to 83,333 points per cycle on 60-Hz base.
 - 6) Calculated waveform on a minimum of four cycles of data of the following:
 - a) THD.
 - b) rms magnitudes.
 - c) Peak values.
 - d) Crest factors.
 - e) Magnitude of individual harmonics.
- k. Data Sharing: Allow export of recorded displays and tabular data to third-party applications software on the local server.
- l. Activity Tracking Software:
 - 1) Automatically compute and prepare activity demand and energy-use statements based on metering of energy use and peak demand integrated over user-defined interval.

- 2) Intervals shall be same as used by electric utilities, including current vendor.
 - 3) Import metered data from saved records that were generated by metering and monitoring software.
 - 4) Maintain separate directory for each activity's historical billing information.
 - 5) Prepare summary reports in user-defined formats and time intervals.
- m. Passwords
- n. Protocol Drivers
- o. System Graphic Displays: provide interactive color-graphics platform with pull-down menus and mouse-driven generation of power system graphics, in formats widely used for such drafting; to include the following:
- 1) Site plan.
 - 2) Floor plans.
 - 3) Equipment elevations.
 - 4) Single-line diagrams.
 - 5) Custom graphic screens configured, not programmed, using drag-and-drop tools available within the software.
- p. Alarms: display and record alarm messages from discrete input and controls outputs, according to user programmable protocol.
- 1) Functions requiring user acknowledgment shall run in background during computer use for other applications and override other presentations when they occur.
- q. Trending: display and record data acquired in real-time from different meters or devices, in historical format over user-defined time; unlimited as to interval, duration, or quantity of trends.
- 1) Spreadsheet functions of sum, delta, percent, average, mean, standard deviation, and related functions applied to recorded data.
 - 2) Charting, statistical, and display functions of standard Windows-based spreadsheet.
- r. Report Generation: User commands initiate the reporting of a list of current alarm, supervisory, and trouble conditions in system or a log of past events.

- 1) Print a record of user-defined alarm, supervisory, and trouble events on workstation printer.
 - a) Sort and report by device name and by function.
 - b) Report type of signal (alarm, supervisory, or trouble), description, date, and time of occurrence.
 - c) Differentiate alarm signals from other indications.
 - d) When system is reset, report reset event with same information concerning device, location, date, and time.
7. BACnet: Site Data Aggregation Device shall have demonstrated interoperability during at least one BMA Interoperability Workshop and shall substantially conform to BACnet Operator Workstation (BOWS) device profile as specified in ASHRAE/ANSI 135-2001, BACnet Annex L
8. Site Data Aggregation Device shall periodically upload metered data to the VA Corporate-wide server:
 - a. The metering software shall provide periodic upload (adjustable interval, initially set on 15-minute intervals) of the scrubbed and collected data.
 - b. The VA's Corporate wide server accepts the following data structures:
 - 1) Information structured using the 2005 and 2008 SQL server database engine.
 - 2) The following data stores are acceptable:
 - a) Databases: SQL Server, DB2, Oracle, Access, Sybase, MySQL.
 - b) Flat files: .CSV, .XLS, .TXT, .XML, .PQDIF
 - c. The minimum data to be uploaded (per meter) includes:
 - 1) A time stamp
 - 2) A device identifier
 - 3) A flow (power or water flow) value
 - 4) A flow order of magnitude
 - 5) Description of the flow's units
 - 6) The outside air drybulb temperature at the time stamp
 - 7) The outside air wetbulb temperature at the time stamp
 - 8) A "scrubbed data" flag
 - 9) An irregular data alarm stamp
- C. Self-contained uninterruptible power supply (UPS):
 1. Size: Provide a minimum of six hours of operation of workstation station equipment, including two hours of alarm printer operation.

2. Batteries: Sealed, valve regulated, recombinant, lead calcium.
3. Accessories:
 - a. Transient voltage suppression.
 - b. Input-harmonics reduction.
 - c. Rectifier/charger.
 - d. Battery disconnect device.
 - e. Static bypass transfer switch.
 - f. First six subparagraphs below are optional accessories.
 - g. Internal maintenance bypass/isolation switch.
 - h. External maintenance bypass/isolation switch.
 - i. Output isolation transformer.
 - j. Remote UPS monitoring.
 - k. Battery monitoring.
 - l. Remote battery monitoring.

2.3 CABLE SYSTEMS - TWISTED PAIR AND FIBER OPTIC

A. General:

1. All metallic cable sheaths, etc. (i.e.: risers, underground, station wiring, etc. shall be grounded.
2. Install temporary cable and wire pairs so as to not present a pedestrian safety hazard. Provide for all associated work for any temporary installation and for removal when no longer necessary. Temporary cable installations are not required to meet Industry Standards; but, must be reviewed and approved by the VA prior to installation.
3. Cable conductors to provide protection against induction in circuits. Crosstalk attenuation within the System shall be in excess of -80 dB throughout the frequency ranges specified.
4. Minimize the radiation of RF noise generated by the System equipment so as not to interfere with audio, video, data, computer main distribution frame (MDF), telephone customer service unit (CSU), and electronic private branch exchange (EPBX) equipment the System may service.
5. The as-installed drawings shall identify each cable as labeled, used cable, and bad cable pairs.
6. Label system's cables on each end. Test and certify cables in writing to the VA before conducting proof-of-performance testing. Minimum cable test requirements are for impedance compliance, inductance, capacitance, signal level compliance, opens, shorts,

cross talk, noise, and distortion, and split pairs on all cables in the frequency ranges specified. The cable tests shall demonstrate the operation of this cable at not less than 10 mega (m) Hertz (Hz) full bandwidth, fully channel loaded and a Bit Error Rate of a minimum of 10^{-6} at the maximum rate of speed. Make available all cable installation and test records at acceptance testing by the VA and shall thereafter be maintained in the Facility's Telephone Switch Room. All changes (used pair, failed pair, etc.) shall be posted in these records as the change occurs.

7. Coordinate with the Electrical Contractor to install the telephone entrance cable to the nearest point of entry into the Facility and as shown on the drawings. Coordinate with the VA and the Electrical Contractor to provide all cable pairs/circuits from the Facility point of entry to the Telephone Switch Room all telephone, FTS, DHCP, ATM, Frame Relay, data, pay stations, patient phones, and any low voltage circuits as described herein.
8. Provide all cable pairs/circuits from the Server Room and establish circuits throughout the Facility for all cabling as described herein.
9. Provide proper test equipment to demonstrate that cable pairs meet each OEM's standard transmission requirements, and guarantee the cable will carry data transmissions at the required speeds, frequencies, and fully loaded bandwidth.

B. LAN COPPER CABLES

1. Comply with Section 27 15 00 "Communications Horizontal Cabling."
2. RS-485 Cable:
 - a. PVC-Jacketed, RS-485 Cable: Paired, 2 pairs, twisted, No. 22 AWG, stranded (7x30) tinned copper conductors, PVC insulation, unshielded, PVC jacket, and NFPA 70, Type CMG.
3. Unshielded Twisted Pair Cables: Category 5e or 6 as specified for horizontal cable for data service in Section 27 15 00 "Communications Horizontal Cabling."
4. Cabling products shall be tested and certified for use at data speeds up to at least 100 Mbps. Other types of media commonly used within IEEE Std 802.3 LANs (e.g., 10Base-T and 10Base-2) shall be used only in cases to interconnect with existing media. Short lengths of media and transceivers may be used in these applications. Provide separately orderable media, taps and connectors.

5. Ethernet Switch shall be IEEE Std 802.3 bridges which shall function as the center of a distributed-star architecture and shall be "learning" bridges with spanning tree algorithms in accordance with IEEE Std 802.1D. The switch shall support the connected media types and shall have a minimum of 150% the required ports and no fewer than 4 ports. One port shall be switch selectable as an uplink port.
6. Provide IP router network equipment. The routers shall be fully configurable for protocol types, security, and routing selection of sub-networks. The router shall meet all requirements of RFC 1812.

C. LAN FIBER OPTICAL CABLES

1. Interior Fiber Optic Cable: Interior Fiber Optic Cable shall be Multimode or Singlemode fiber, 62.5/125 micron for multimode or 10/125 micron for singlemode micron with SC or ST connectors as specified in TIA-568-C.1. Terminations, patch panels, and other hardware shall be compatible with the specified fiber and shall be as specified in Section 27 15 00 "Communications Horizontal Cabling." The data communications equipment shall use the 850-nm range of multimode or 1310-nm range of singlemode fiber-optic cable. Fiber-optic cable shall be suitable for use with the 100Base-FX standard as defined in IEEE Std 802.3.
2. Exterior Fiber Optic Cable: Exterior Fiber Optic Cable shall be Multimode or Singlemode Fiber, 62.5/125 micron for multimode or 10/125 micron for singlemode micron with SC or ST connectors as specified in TIA-568-C.1. Terminations, patch panels, and other hardware shall be compatible with the specified fiber and shall be as specified in Section 27 15 00 "Communications Horizontal Cabling.". The data communications equipment shall use the 850-nm range of multimode or 1310-nm range of singlemode fiber-optic cable. Fiber-optic cable shall be suitable for use with the 100Base-FX standard as defined in IEEE Std 802.3.
3. Fiber Optic Patch Panels shall be wall or rack mountable and designed to provide termination facilities for up to 24 fibers. Unit shall also have capability to be equipped with spliced trays, six packs (for adapters), and blank panels for easy termination of the fiber bundles and tube cables. Fiber-optic terminating equipment shall provide for mounting of ST or SC connectors on an optical patch panel. Provide fiber-cable management and cable-routing hardware to assure conformance to minimum fiber and cable bend

radii. Connectors on the patch panel shall be ST or SC feed through. Provide access to both sides of the panel. The patch panel for the connectors shall be mounted to facilitate rearrangement and identification. Each apparatus shall have cabling and connection instructions associated with it.

4. Fiber Optic media converter shall provide media conversion between layer 1 copper and fiber media to support data rates equal to the greater of the physical layer or 100 Mbps as specified in IEEE Std 802.3.

D. LOW-VOLTAGE WIRING

1. Low-Voltage Control Cable: Multiple conductor, color-coded, No. 20 AWG copper, minimum.
 - a. Sheath: PVC; except in plenum-type spaces, use sheath listed for plenums.
 - b. Ordinary Switching Circuits: Three conductors, unless otherwise indicated.
 - c. Switching Circuits with Pilot Lights or Locator Feature: Five conductors, unless otherwise indicated.

E. WIRELESS MODEMS

Provide wireless modems for high speed, point-to-point Ethernet communications between sites. Transceivers shall be single integral units and may be mounted within the building in a NEMA 1 enclosure or weatherproof with integral antenna and pole mounted. System shall have the following features as a minimum:

1. 4.9x GHz Licensed Frequency 902-928Mhz Industrial/Scientific/Medical (ISM) 2.4GHz Industrial/Scientific/Medical (ISM) 5.8GHz Industrial/Scientific/Medical (ISM) band.
2. Obtain FCC license on behalf of the VA for each licensed frequency.
3. Security protocol shall utilize a minimum of 128-bit data encryption. Provide Simple Network Management Protocol (SNMP) for network diagnostics and management. Transceiver shall have status indicators for power, ethernet link status and RF link status.
4. Operating Conditions: 0 degrees C to 55 degrees C, 85% relative humidity (32 degrees F to 131 degrees F, 85% relative humidity).
5. Transmitter/Receiver/Antenna combination shall provide less than 0.005% frame error rate at 10Mbps data rate between sites.

6. Antennas may be omni-directional or directional as required for system gain. Antennas and supports shall withstand a combined load of ½" ice and 125mph wind loading.
7. Provide heavy-duty antenna masks and wall or roof mask mount to support antennas, applicable. All hardware shall be stainless steel. Ground antenna mast per NFPA 780.
8. Coaxial cable shall be 0.200 diameter minimum for lengths below 50' and 0.400 diameter or greater for length greater than 50'.
9. Surge suppressors for coaxial cables shall be rated for the frequency of operation, utilize gas tube technology and have a maximum let thru of 1mJ. Provide UL1449 listed, Type 1, 50kA, 120V, surge protective device for each power circuit.

2.4 GROUNDING

- A. Ground cable shields, drain conductors, and equipment to eliminate shock hazard and to minimize ground loops, common-mode returns, noise pickup, cross talk, and other impairments. Comply with VA 27 05 26 Grounding and Bonding for Communications Systems and with VA 26 05 26 Grounding and Bonding for Electrical Systems.

2.5 METER COMMUNICATION

- A. Provide a BACnet network allowing communication from the meters' data heads to the Site Data Aggregation Device.
- B. Provide data heads at each meter, converting analog and pulsed information to digital information. Data heads shall allow for up to 24 hours of data storage (including time stamp, measured value, and scaling factor).
 1. Each data head shall reside on a BACnet network using the MS/TP Data Link/Physical layer protocol. Each data head shall have a communication port for connection to an operator interface.
 2. Environment: Data Head hardware shall be suitable for the conditions ranging from -29°C to 60°C (-20°F to 140°F). Data Heads used outdoors and/or in wet ambient conditions shall be mounted within waterproof enclosures and shall be rated for operation at conditions ranging from -29°C to 60°C (-20°F to 140°F).
 3. Provide a local keypad and display for interrogating and editing data. An optional system security password shall be available to prevent unauthorized use of the keypad and display.
 4. Serviceability. Provide diagnostic LEDs for power, communication, and processor. All wiring connections shall be made to field-

removable, modular terminal strips or to a termination card connected by a ribbon cable.

5. Memory. The building controller shall maintain all BIOS and data in the event of a power loss for at least 72 hours.
6. Immunity to power and noise. Controller shall be able to operate at 90% to 110% of nominal voltage rating and shall perform an orderly shutdown below 80% nominal voltage. Operation shall be protected against electrical noise of 5 to 120 Hz and from keyed radios up to 5 W at 1 m (3 ft).

2.6 ELECTRICAL POWER METERS AND SUB-METERS

A. ELECTRICAL METER APPLICATIONS

1. Energy meters in the advanced utility metering system shall have models available for amperage ranges of 100-2400 amperes.
 - a. The RS-485 communications shall provide communications links up to 10,000 feet long.
2. Power meters shall be installed as part of the advanced utility metering system.
 - a. All setup parameters required by the power meter shall be stored in nonvolatile memory and retained in the event of a control power interruption.
 - b. The power meter may be applied in three-phase, three- or four-wire systems.
 - c. The power meter shall be capable of being applied without modification at nominal frequencies of 50, 60, or 400 Hz.
 - d. The power meter shall provide for onboard data logging, able to log data, alarms, waveforms and events.

B. Physical and Common Requirements

1. Electrical power meters shall be separately mounted, and enclosed in a NEMA 250, Type 1 enclosure. Environmental Conditions: System components shall be capable of withstanding the following environmental conditions without mechanical or electrical damage or degradation of operating capability:
 - a. Ambient conditions of 0 to 140 deg F dry bulb and 20 to 95 percent relative humidity, noncondensing.

C. Current and voltage ratings:

1. Designed for use with current inputs from standard instrument current transformers with 5-A secondary and shall have a metering range of 0-10 A.

2. Withstand ratings shall be not less than 15 A, continuous; 50 A, lasting over 10 seconds, no more frequently than once per hour; 500 A, lasting 1 second, no more frequently than once per hour.
 3. Voltage inputs from standard instrument potential transformers with 120 volt secondary output. The power meter shall support PT primaries through 3.2 MV.
 4. The power meter shall operate properly over a wide range of control power including 90-457 VAC or 100-300 VDC.
- D. Electrical measurements and calculated values
1. Power meters shall include the following rms Real-Time Measurements:
 - a. Current: Each phase, neutral, average of three phases, percent unbalance.
 - b. Voltage: Line-to-line each phase, line-to-line average of three phases, line-to-neutral each phase, line-to-neutral average of three phases, line-to-neutral percent unbalance.
 - c. Power: Per phase and three-phase total.
 - d. Reactive Power: Per phase and three-phase total.
 - e. Apparent Power: Per phase and three-phase total.
 - f. True Power Factor: Per phase and three-phase total.
 - g. Displacement Power Factor: Per phase and three-phase total.
 - h. Frequency.
 - i. THD: Current and voltage.
 - j. Accumulated Energy: Real kWh, reactive kVARh, apparent kVAh (signed/absolute).
 - k. Incremental Energy: Real kWh, reactive kVARh, apparent kVAh (signed/absolute).
 - l. Conditional Energy: Real kWh, reactive kVARh, apparent kVAh (signed/absolute).
 2. Power meters shall perform the following demand current calculations, per phase, three-phase average and neutral:
 - a. Present.
 - b. Running average.
 - c. Last completed interval.
 - d. Peak.
 3. Power meters shall perform the following demand real power calculations, three-phase total:
 - a. Present.
 - b. Running average.

- c. Last completed interval.
 - d. Predicted.
 - e. Peak.
 - f. Coincident with peak kVA demand.
 - g. Coincident with kVAR demand.
4. Power meters shall perform the following demand reactive power calculations, three-phase total:
- a. Present.
 - b. Running average.
 - c. Last completed interval.
 - d. Predicted.
 - e. Peak.
 - f. Coincident with peak kVA demand.
 - g. Coincident with kVAR demand.
5. Power meters shall perform the following demand apparent power calculations, three-phase total:
- a. Present.
 - b. Running average.
 - c. Last completed interval.
 - d. Predicted.
 - e. Peak.
 - f. Coincident with peak kVA demand.
 - g. Coincident with kVAR demand.
6. Power meters shall perform the following average true power factor calculations, demand coincident, three-phase total:
- a. Last completed interval.
 - b. Coincident with kW peak.
 - c. Coincident with kVAR peak.
 - d. Coincident with kVA peak.
7. Power Analysis Values:
- a. THD, Voltage and Current: Per phase, three phase, and neutral.
 - b. Displacement Power Factor: Per phase, three phase.
 - c. Fundamental Voltage, Magnitude and Angle: Per phase.
 - d. Fundamental Currents, Magnitude and Angle: Per phase.
 - e. Fundamental Real Power: Per phase, three phase.
 - f. Fundamental Reactive Power: Per phase.
 - g. Harmonic Power: Per phase, three phase.
 - h. Phase rotation.

- i Unbalance: Current and voltage.
 - j. Harmonic Magnitudes and Angles for Current and Voltages: Per phase, up to 31st harmonic.
8. Power meters shall perform one of the following demand calculations, selectable by the User; meters shall be capable of performance of all of the following demand calculations.
- a. Block interval with optional subintervals: Adjustable for 1-minute intervals, from 1 to 60 minutes. User-defined parameters for the following block intervals:
 - 1) Sliding block that calculates demand every second, with intervals less than 15 minutes, and every 15 seconds with an interval between 15 and 60 minutes.
 - 2) Fixed block that calculates demand at end of the interval.
 - 3) Rolling block subinterval that calculates demand at end of each subinterval and displays it at end of the interval.
 - b. Demand calculations initiated by a Utility-furnished synchronization signal:
 - 1) Signal is a pulse from an external source. Demand period begins with every pulse. Calculation shall be configurable as either a block or rolling block calculation.
 - 2) Signal is a communication signal. Calculation shall be configurable as either a block or rolling block calculation.
 - 3) Demand can be synchronized with clock in the power meter.
 - c. Minimum and maximum values: Record monthly minimum and maximum values, including date and time of record. For three-phase measurements, identify phase of recorded value. Record the following parameters:
 - 1) Line-to-line voltage.
 - 2) Line-to-neutral voltage.
 - 3) Current per phase.
 - 4) Line-to-line voltage unbalance.
 - 5) Line-to-neutral voltage unbalance.
 - 6) Power factor.
 - 7) Displacement power factor.
 - 8) Total power.
 - 9) Total reactive power.
 - 10) Total apparent power.
 - 11) THD voltage L-L.

12)THD voltage L-N.

13)THD current.

14)Frequency.

d. Harmonic calculation: display and record the following:

1) Harmonic magnitudes and angles for each phase voltage and current through 31st harmonic. Calculate for all three phases, current and voltage, and residual current. Current and voltage information for all phases shall be obtained simultaneously from same cycle.

2) Harmonic magnitude reported as a percentage of the fundamental or as a percentage of rms values, as selected by the VA.

E. Waveform Capture:

1. Capture and store steady-state waveforms of voltage and current channels; initiated manually. Each capture shall be for 3 cycles, 128 data points for each cycle, allowing resolution of harmonics to 31st harmonic of basic 60 Hz.
2. Capture and store disturbance waveform captures of voltage and current channels, initiated automatically based on an alarm event. Each capture shall be fully configurable for duration with resolution of at least 128 data points per cycle, for all channels simultaneously. Waveform shall be configurable to capture pre-event cycles for analysis.
3. Store captured waveforms in internal nonvolatile memory; available for PC display, archiving, and analysis.

F. Meter accuracy:

1. Comply with ANSI C12.20, Class 0.5; and IEC 60687, Class 0.5 for revenue meters.
2. Accuracy from Light to Full Rating:
 - a. Power: Accurate to 0.5 percent of reading.
 - b. Voltage and Current: Accurate to 0.5 percent of reading.
 - c. Power Factor: Plus or minus 0.005, from 0.5 leading to 0.5 lagging.
 - d. Frequency: Plus or minus 0.01 Hz at 45 to 67 Hz.

G. Meter input, sampling, display, output, recording and reading Capabilities

1. Input: One digital input signal.
 - a. Normal mode for on/off signal.

- b. Demand interval synchronization pulse, accepting a demand synchronization pulse from a utility demand meter.
 - c. Conditional energy signal to control conditional energy accumulation.
 - d. GPS time synchronization.
2. Sampling:
- a. Current and voltage shall be digitally sampled at a rate high enough to provide accuracy to 63rd harmonic of 60-Hz fundamental.
 - b. Power monitor shall provide continuous sampling at a rate of 128 samples per cycle on all voltage and current channels in the meter.
3. Display Monitor:
- a. Backlighted LCD to display metered data with touch-screen or touch-pad selecting device.
 - b. Touch-screen display shall be a minimum 12-inch diagonal, resolution of 800 by 600 RGB pixels, 256 colors; NEMA 250, Type 1 display enclosure.
 - c. Display four values on one screen at same time.
 - 1) Coordinate list below with meter capabilities specified in subparagraphs above.
 - 2) Current, per phase rms, three-phase average //and neutral//.
 - 3) Voltage, phase to phase, phase to neutral, and three-phase averages of phase to phase and phase to neutral.
 - 4) Real power, per phase and three-phase total.
 - 5) Reactive power, per phase and three-phase total.
 - 6) Apparent power, per phase and three-phase total.
 - 7) Power factor, per phase and three-phase total.
 - 8) Frequency.
 - 9) Demand current, per phase and three-phase average.
 - 10) Demand real power, three-phase total.
 - 11) Demand apparent power, three-phase total.
 - 12) Accumulated energy (MWh and MVARh).
 - 13) THD, current and voltage, per phase.
 - d. Reset: Allow reset of the following parameters at the display:
 - 1) Peak demand current.
 - 2) Peak demand power (kW) and peak demand apparent power (kVA).
 - 3) Energy (MWh) and reactive energy (MVARh).
4. Outputs:

- a. Operated either by user command sent via communication link, or set to operate in response to user-defined alarm or event.
 - b. Closed in either a momentary or latched mode as defined by user.
 - c. Each output relay used in a momentary contact mode shall have an independent timer that can be set by user.
 - d. One digital KY pulse to a user-definable increment of energy measurement. Output ratings shall be up to 120-V ac, 300-V dc, 50 mA, and provide 3500-V rms isolation.
 - e. One relay output module, providing a load voltage range from 20- to 240-V ac or from 20- to 30-V dc, supporting a load current of 2 A.
 - f. Output Relay Control:
 - 1) Relay outputs shall operate either by user command sent via communication link or in response to user-defined alarm or event.
 - 2) Normally open and normally closed contacts, field configured to operate as follows:
 - a) Normal contact closure where contacts change state for as long as signal exists.
 - b) Latched mode when contacts change state on receipts of a pickup signal; changed state is held until a dropout signal is received.
 - c) Timed mode when contacts change state on receipt of a pickup signal; changed state is held for a preprogrammed duration.
 - d) End of power demand interval when relay operates as synchronization pulse for other devices.
 - e) Energy Pulse Output: Relay pulses quantities used for absolute kWh, absolute kVARh, kVAh, kWh In, kVARh In, kWh Out, and kVARh Out.
 - f) Output controlled by multiple alarms using Boolean-type logic.
5. Onboard Data Logging:
- a. Store logged data, alarms, events, and waveforms in 2 MB of onboard nonvolatile memory.
 - b. Stored Data:
 - 1) Billing Log: User configurable; data shall be recorded every 15 minutes, identified by month, day, and 15-minute interval.

Accumulate 24 months of monthly data, 32 days of daily data, and between 2 to 52 days of 15-minute interval data, depending on number of quantities selected.

- 2) Custom Data Logs: three user-defined log(s) holding up to 96 parameters. Date and time stamp each entry to the second and include the following user definitions:

- a) Schedule interval.
- b) Event definition.
- c) Configured as "fill-and-hold" or "circular, first-in first-out."

- 3) Alarm Log: Include time, date, event information, and coincident information for each defined alarm or event.

- 4) Waveform Log: Store captured waveforms configured as "fill-and-hold" or "circular, first-in first-out."

- c. Default values for all logs shall be initially set at factory, with logging to begin on device power up.

6. Alarms.

a. User Options:

- 1) Define pickup, dropout, and delay.
- 2) Assign one of four severity levels to make it easier for user to respond to the most important events first.
- 3) Allow for combining up to four alarms using Boolean-type logic statements for outputting a single alarm.

b. Alarm Events:

- 1) Over/undercurrent.
- 2) Over/undervoltage.
- 3) Current imbalance.
- 4) Phase loss, current.
- 5) Phase loss, voltage.
- 6) Voltage imbalance.
- 7) Over kW demand.
- 8) Phase reversal.
- 9) Digital input off/on.
- 10) End of incremental energy interval.
- 11) End of demand interval.

2.7 WATER, OIL, GAS METER DEVICES

A. Water, oil and gas meter applications:

1. Steam Meters: provide vortex-shedding flowmeters, along with temperature sensors and pressure transducers to develop the energy flow.
2. Steam Condensate Meters: provide a magnetic flowmeter in new installations; provide an ultrasonic or vortex-shedding flowmeter in existing installations which service interruption is not allowed. Provide temperature and pressure transducers to develop the energy flow.
3. Natural Gas Meters: provide vortex-shedding flowmeters with pressure sensors.
4. Liquefied Petroleum Gas Meters: provide vortex-shedding flowmeters with pressure sensors.
5. Potable (Domestic) Water: provide a magnetic flowmeter in new installations; provide an ultrasonic or vortex-shedding flowmeter with pressure sensor in existing installations which service interruption is not allowed.
6. Reclaimed (storm or gray): provide a magnetic flowmeter in new installations; provide a vortex-shedding flowmeter with pressure sensor in existing installations which service interruption is not allowed.
7. Make-up Water Meters to Cooling Towers, Evaporative Cooling Systems and Boiler Systems: provide a magnetic flowmeter in new installations; provide a vortex-shedding flowmeter with pressure sensor in existing installations which service interruption is not allowed.
8. Oil Meters
 - a. No. 2 Oils and other Light Oils (less than 60 SSU viscosity at 38 degrees C (100 degrees F)): use screw-type or positive-displacement (such as rotating piston or oscillating piston) flowmeters.
 - b. No. 6 and Other Heavy Oils (more than 90 SSU viscosity at 38 degrees C (100 degrees F)): use positive-displacement flowmeters (such as rotating piston or oscillating piston).
9. HVAC Hydronic System Water Meters
 - a. Chilled Water Systems: provide vortex-shedding flowmeters with pressure and temperature sensors to determine energy flow.
 - b. Heating Water Systems: provide vortex-shedding flowmeters with pressure and temperature sensors to determine energy flow.

B. Associated Devices (to provide outside air conditions as well as energy metering, not merely flow metering):

1. Temperature Sensors: Resistance Temperature Device (RTD) with an integral transmitter type.
 - a. Immersion sensors shall be provided with a separable thermowell. Pressure rating of well is to be consistent with the system pressure in which it is to be installed.
 - b. Outdoor air temperature sensors shall have watertight inlet fittings and be shielded from direct sunlight.
 - c. Output Signal: 4-20 ma or digital.
2. Humidity Sensors: Bulk polymer sensing element type.
 - a. Outdoor humidity sensors shall be furnished with element guard and mounting plate and have a sensing range of 0 to 100 percent RH.
 - b. Output Signal: 4-20 ma continuous output signal.
3. Pressure sensors.
 - a. Gas Pressure Transmitter: Nondirectional sensor with suitable range for expected input, and temperature compensated.
 - b. Water Pressure Transmitters: Stainless-steel diaphragm construction, suitable for service; minimum 150-psig operating pressure and tested to 300-psig; linear output 4 to 20 mA.
4. Thermowells.
 - a. Description: Pressure-tight, socket-type fitting made for insertion into piping tee fitting. Stepped shank unless straight or tapered shank is indicated. ASME B40.200. Bore diameter required to match thermometer bulb or stem. Insertion length required to match thermometer bulb or stem. Provide a lagging extension on thermowells for insulated piping and tubing. Provide bushings. Use a mixture of graphite and glycerin for the thermowell's heat transfer medium.
 - 1) Material for Use with Copper Tubing: copper nickel (90-10).
 - 2) Material for Use with Steel Piping: stainless steel.

C. Turbine flowmeters (water duty).

1. Flowmeter shall be as specified in Section 23 09 23, in the "water flow sensors" paragraph. Provide data head on meter as specified in this section.
2. Sensor shall be insertion turbine type with turbine element, retractor and preamplifier/transmitter mounted on a two-inch full

- port isolation valve; assembly easily removed or installed as a single unit under line pressure through the isolation valve without interference with process flow; calibrated scale shall allow precise positioning of the flow element to the required insertion depth within plus or minus 0.05 inch; wetted parts shall be constructed of stainless steel. Operating power shall be nominal 24 VDC. Local instantaneous flow indicator shall be LED type in NEMA 4 enclosure with 3-1/2 digit display, for wall or panel mounting.
- a. Ambient conditions: -40 to 60 degrees C (-40 to 140 degrees F), 5 to 100 percent humidity
 - b. Operating conditions: 850 kPa (125 psig), 0 to 120 degrees C (30 to 250 degrees F), 0.15 to 12 m per second (0.5 to 40 feet per second) velocity.
3. Performance:
- a. Transmitted signal from flowmeter and its transmitter shall have a total (rms) accuracy plus or minus 1% of actual flow rate.
 - b. Flowmeter accuracy shall be no more than plus or minus 0.1% of actual flow rate. Flowmeter repeatability shall be no more than 0.3% of actual flow rate. Meter shall be designed to minimize vibration effect and to provide elimination of this effect.
 - c. Minimum turndown capability shall be 20:1.
 - d. Pressure drop shall be as scheduled, maximum 1% of line pressure in lines sized 4 inches and larger.
 - e. Ambient temperature effects, less than 0.005 percent calibrated span per degree C (degree F) temperature change.
 - f. RFI effect - flow meter shall not be affected by RFI.
 - g. Power supply effect less than 0.02 percent of actual flow rate for a variation of plus or minus 10 percent power supply.
4. Provide a data head on the meter.
- a. Preamplifier mounted on meter shall provide 4-20 ma divided pulse output or switch closure signal for units of volume or mass per a time base. Signal transmission distance shall be a minimum of 1,800 meters (6,000 feet)..
5. Straightening Vanes: Provide as recommended by the meter manufacturer for the actual installation arrangement.
- D. Screw type flowmeters (No. 2 oil duty)
1. Meters shall have cast iron cases, nitrided steel spindles, Viton seals, threaded pipe connections, designed for pressure exceeding

set pressure, plus 25 percent, of nearest upstream relief valve.
Meters shall be rated for 121 degrees C (250 degrees F) if utilized for heated oil.

2. Provide a meter data head.

- a. Meter Registers: Hermetically sealed flow computer with digital flow rate readout and digital register for totalizer with at least five digits located at meter, positioned for easy viewing. Provide a data head on the meter.

3. Performance:

- a. Transmitted signal from flowmeter and its transmitter shall have a total (rms) accuracy plus or minus 1% of flow rate.
- b. Flowmeter accuracy shall be no more than plus or minus 0.1%, over the required flow range. Flowmeter repeatability shall be no more than 0.2% of actual flow rate. Meter shall be designed to minimize vibration effect and to provide elimination of this effect.
- c. Minimum turndown capability shall be 10:1. Its maximum fluid pressure drop through meter shall be as scheduled.

E. Vortex-shedding flowmeters.

- 1. Meter shall have an all-welded flanged 316 stainless steel meter body with no seals. No sensor parts shall be exposed to the flow stream. Provide a 316 stainless steel trapezoidal shedder bar, sensing by detecting stresses in the shedder bar caused by vortices, and dual piezoelectric crystals located outside the process flow sense the shed vortices (dual crystal alignment cancels effects of noise and vibration). Design meter for Schedule 40 piping.
 - a. Meter shall be suitable for 25% warmer than the fluid operating temperature and for 25% higher than either the fluid's operating pressure or 25% higher than the piping system's safety valve set pressure, whichever is higher.
 - b. Meter flanges shall be Class 300 or higher, if required by the piping system's temperature and pressure Class.
 - c. Meter shall be suitable for installation in ambient conditions ranging from -29 to 60 degrees C (-20 to 140 degrees F).
- 2. Provide meter data head.
 - a. Meters shall have digital readout of pressure-compensated flow rate and totalization located at transmitter and transmit flow rate and totalization digital signals to the Site Data

Aggregation Device // and recorders //. As an option, pressure compensation and the compensated flow rate may be performed and displayed by the Site Data Aggregation Device receiving signals from the flow meter and from a pressure transmitter.

- b. Provide programmable microprocessor electronics with on-board programming. Output signals shall be immune to ambient temperature swings. Processor shall include continuous self-diagnostic routines that identify electronics problems and provide a warning. Electronics shall be replaceable in the field without affecting metering accuracy. Provide power supply as recommended by meter manufacturer. Mount electronics in a NEMA 4 enclosure separate from meter body in position accessible from platform or floor without the use of a portable ladder.
 - 1) Power supply to meter and transmitter shall be 120V/60hz.
Provide a Class 2 control voltage transformer for 24VDC power to meter as needed.
 - 2) Provide an internal battery, provided for 24-month retention of RAM contents when all other power sources are removed.
- 3. Performance:
 - a. Transmitted signal from flowmeter and its transmitter shall have a total (rms) accuracy plus or minus 1.5% of flow rate.
 - b. Flowmeter accuracy shall be no more than plus or minus 1% of span for gasses and plus or minus 0.7% of span for liquids. Flowmeter repeatability shall be no more than 0.2% of actual flow rate. Meter shall be designed to minimize vibration effect and to provide elimination of this effect.
 - c. Minimum turndown ratio shall be 20:1 for gasses and liquids.
Maximum fluid pressure drop shall be as scheduled.

F. Ultrasonic (Doppler and time of travel) flowmeters.

- 1. Provide a clamp-on flowmeter precluding the requirement of penetrating into the process pipe. The flowmeter shall be completely microprocessor based utilizing the transit-time flow measurement technique. The flowmeter shall employ the phase detection multiple pulse transmit principle in conjunction with multiple frequency axial beam transducer technology to insure operation on liquids with solids and or bubbles. In addition, the flowmeter shall incorporate an alternate Doppler method measurement mode for highly aerated or heavy solid bearing liquids.

2. Provide a meter data head.

a. The flowmeter shall provide automatic transducer spacing for clamp-on transducers utilizing a prefabricated mounting frame or mounting track (ruler scales shall not be acceptable), the meter shall also support in-line transducers. The meter shall also provide automatic Reynolds Number and liquid sonic velocity variation compensation and live zero flow measurement.

1) By use of either transit-time or Doppler modes of operation, the flowmeter shall be capable of measuring all liquids in full sonically conductive pipes.

b. The flowmeter shall have the ability to indicate flow rate, flow velocity, total flow, signal strength, liquid sonic velocity, Reynolds Number and liquid aeration level.

c. The flowmeter shall be equipped with an integral front panel keypad and multifunction 240 X 128 pixel LCD display. In addition, the flowmeter shall provide self and application diagnostics to isolate any fault conditions to either equipment failure or abnormal process conditions.

d. The flowmeter shall have full HELP menu routines corresponding to all levels of programming and operation.

e. The flowmeter electronics shall be housed in a NEMA 4X enclosure and powered by 90-240VAC, 50-60Hz. Two isolated 4 to 20 maDC and two 0 to 5000 Hz pulse outputs proportional to flow shall be provided. The current outputs must be capable of driving a 1000-ohm resistive load. In addition, the unit shall provide two 0 to 10 volt outputs and four SPDT alarm relays assignable to flow velocity, liquid sonic velocity, signal strength or liquid aeration.

f. Provide an internal 1 MB data logger shall be provided to allow storage of all measured and calculated variables and alarms in intervals of 10 minutes.

g. Two each bi-directional communications ports shall be provided.

1) One each RS-485 with Modbus RTU or BACnet protocol.

3. Performance:

a. The flowmeter shall have an accuracy of plus or minus 1% of flow over span. Repeatability shall be 0.25% of flow.

b. Meter shall have a flow sensitivity of 0.001 fps at any flow rate including no flow conditions.

H. Magnetic flowmeters.

1. Meter shall have an all-welded flanged 316 stainless steel engineered flow tube with no seals. No sensor parts shall be exposed to the flow stream. Design meter for mating with Schedule 40 piping.
 - a. Meter shall be suitable for 25% warmer than the fluid operating temperature and for 25% higher than either the fluid's operating pressure or 25% higher than the piping system's safety valve set pressure, whichever is higher.
 - b. Meter flanges shall be Class 150 // Class 300 // or higher, if required by the piping system's temperature and pressure Class.
 - c. Meter shall be suitable for installation in ambient conditions ranging from -29 to 60 degrees C (-20 to 140 degrees F).
2. Provide meter data head.
 - a. Meters shall have digital readout of pressure-compensated flow rate and totalization located at transmitter and transmit flow rate and totalization digital signals to the Site Data Aggregation Device // and recorders //. As an option, pressure compensation and the compensated flow rate may be performed and displayed by the Site Data Aggregation Device receiving signals from the flow meter and from a pressure transmitter.
 - b. Provide programmable microprocessor electronics with on-board programming. Output signals shall be immune to ambient temperature swings. Processor shall include continuous self-diagnostic routines that identify electronics problems and provide a warning. Electronics shall be replaceable in the field without affecting metering accuracy. Provide power supply as recommended by meter manufacturer. Mount electronics in a NEMA 4 enclosure separate from meter body in position accessible from platform or floor without the use of a portable ladder.
 - 1) Power supply to meter and transmitter shall be 120V/60hz.
Provide a Class 2 control voltage transformer for 24VDC power to meter as needed.
3. Performance:
 - a. Transmitted signal from flowmeter and its transmitter shall have a total (rms) accuracy plus or minus 1.5% of flow rate.
 - b. Flowmeter accuracy shall be no more than plus or minus 1.5% of actual flow rate for gasses and plus or minus 1% of actual flow

rate for liquids. Flowmeter repeatability shall be no more than 0.2% of actual flow rate. Meter shall be designed to minimize vibration effect and to provide elimination of this effect.

- c. Minimum turndown ratio shall be 20:1 for gasses and liquids. Maximum fluid pressure drop shall be as scheduled.

I. Positive-displacement oil flowmeters.

- 1. Meter shall be a rotating- or oscillating-piston meter with a and aluminum piston, cast bronze body, safety filter, viton o-rings and Class 150 flanges mating with Schedule 40 piping. Meter shall transmit pulse signals to meter's data head.

2. Provide meter data head.

- a. Meters shall have digital readout flow rate and totalization located at transmitter and transmit flow rate and totalization digital signals to the Site Data Aggregation Device // and recorders //. As an option,
- b. Provide programmable microprocessor electronics with on-board programming. Output signals shall be immune to ambient temperature swings. Processor shall include continuous self-diagnostic routines that identify electronics problems and provide a warning. Electronics shall be replaceable in the field without affecting metering accuracy. Provide power supply as recommended by meter manufacturer. Mount electronics in a NEMA 4 enclosure separate from meter body in position accessible from platform or floor without the use of a portable ladder.
 - 1) Power supply to meter and transmitter shall be 120V/60hz. Provide a Class 2 control voltage transformer for 24VDC power to meter as needed.

3. Performance:

- a. Flowmeter accuracy shall be no more than plus or minus 1.5% of actual flow rate.
- b. Minimum turndown ratio shall be 10:1.

PART 3 - EXECUTION

3.1 INSTALLATION REQUIREMENTS

A. Cabling

- 1. Install Category 5e UTP, Category 6 UTP, and optical fiber cabling system as detailed in TIA-568-C.1, TIA/EIA-568-B.2, or TIA-568-C.3.
- 2. Screw terminals shall not be used except where specifically indicated on plans.

3. Use an approved insulation displacement connection (IDC) tool kit for copper cable terminations.
4. Do not untwist Category 5e, Category 6 UTP cables more than 12 mm (1/2 inch) from the point of termination to maintain cable geometry.
5. Provide service loop on each end of the cable, 3 m (10 feet) at the server rack and 304 mm (12 inches) at the meter.
6. Do not exceed manufacturers' cable pull tensions for copper and optical fiber cables.
7. Provide a device to monitor cable pull tensions. Do not exceed 110 N (25 pounds) pull tension for four pair copper cables.
8. Do not chafe or damage outer jacket materials.
9. Use only lubricants approved by cable manufacturer.
10. Do not over cinch cables, or crush cables with staples.
11. For UTP cable, bend radii shall not be less than four times the cable diameter.
12. Cables shall be terminated; no cable shall contain unterminated elements.
13. Cables shall not be spliced.
14. Label cabling in accordance with paragraph Labeling in this section.

B. Labeling

1. Labels: Provide labeling in accordance with TIA/EIA-606-A.
Handwritten labeling is unacceptable. Stenciled lettering for all circuits shall be provided using laser printer.
2. Cables: Cables shall be labeled using color labels on both ends with identifiers in accordance with TIA/EIA-606-A.

C. Grounding: ground exposed, non-current-carrying metallic parts of electrical equipment, metallic raceway systems, grounding conductor in metallic and nonmetallic raceways, telecommunications system grounds, and grounding conductor of nonmetallic sheathed cables, as well as equipment to eliminate shock hazard and to minimize ground loops, common-mode returns, noise pickup, cross talk, and other impairments. Comply with VA 27 05 26 GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS and with VA 26 05 26 GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.

D. Surge Protection

1. Provide surge protective devices on all metallic cables entering and leaving an interior environment to an exterior environment or vice

versa, i.e. surge protective device at each interior location of a penetration to the exterior environment.

E. Network Hardware

1. System components and appurtenances shall be installed in accordance with the manufacturer's instructions and as shown. Necessary interconnections, services, and adjustments required for a complete and operable wired or wireless data transmission system shall be provided and shall be fully integrated with the configured network chosen for the project.

F. Computer Hardware

1. Provide the server(s) or personal computer workstation(s) where shown on the plans or indicated diagrammatically.

G. Computer Software

1. User friendly software shall be suitable for operation on computer workstations which serve as site data aggregation devices by monitoring the meters in the system, recording events, indicating alarm conditions, and logging and displaying system reports.
2. The software shall be developed by the manufacturer of the monitoring devices, and shall be designed specifically for energy, power monitoring and control. Additional utilities, i.e. water, air gas, electric and steam shall also be easily integrated.
3. The software shall be configured, not programmed. All software shall be configured by the vendor and delivered ready to use. This configuration shall include preparation of all graphics, displays, and interactive one-line diagrams required as a part of this project.
 - a. Configuration shall be to the point that when monitoring devices are required to be added, the user shall only convey to the software the communications address and type of device.
4. The software shall be a standard product offering with no customization required and clients shall interface with the server or computer workstation via Internet Explorer browser.
 - a. The web-enabled interactive graphics client shall only reside on the server PC, client PC not required to host any application software other than Internet Explorer 6.0 SP1 or higher browser to become a fully functional system.

H. Electrical Meters

1. Power monitoring and control components shall all be factory installed, wired and tested prior to shipment to the job site.
2. All control power, CT, PT and data communications wire shall be factory wired and harnessed within the equipment enclosure.
3. Where external circuit connections are required, terminal blocks shall be provided and the manufacturer's drawings must clearly identify the interconnection requirements including wire type to be used.
4. All wiring required to externally connect separate equipment lineups shall be furnished and installed at the site as part of the contractor's responsibility.
5. Contractor interconnection wiring requirements shall be clearly identified on the power monitoring and control system shop drawings.

I. Water, Oil and Gas Meters

1. Thermowells
 - a. Install thermowells with socket extending a minimum of 2 inches into fluid or one-third of pipe diameter and in vertical position in piping tees.
 - b. Install thermowells of sizes required to match temperature sensor connectors. Include bushings if required to match sizes.
 - c. Install thermowells with extension on insulated piping.
 - d. Fill thermowells with heat-transfer medium.
2. Provide a test plug beside each temperature sensor.
3. Flow meters, general
 - a. Install meters and gages adjacent to machines and equipment to allow service and maintenance of meters, gages, machines, and equipment.
 - b. Connect flowmeter-system elements to meters, connect flowmeter transmitters to meters, and connect thermal-energy meter transmitters to meters.
 - c. Assemble and install connections, tubing, and accessories between flow-measuring elements and flowmeters according to manufacturer's written instructions.
 - d. Install flowmeter elements in accessible positions in piping systems.
 - e. Install flowmeter, with minimum 20 x pipe diameter straight lengths of pipe upstream and minimum 10 x pipe diameter straight

lengths of pipe downstream from flowmeter unless otherwise indicated by manufacturer's written instructions.

- f. Mount thermal-energy meters on wall if accessible; if not, provide brackets to support meters.

3.2 ADJUSTING AND IDENTIFICATION

- A. Install a permanent wire marker on each wire at each termination.
- B. Identifying numbers and letters on the wire markers shall correspond to those on the wiring diagrams used for installing the systems.
- C. Wire markers shall retain their markings after cleaning.

3.3 FIELD QUALITY CONTROL

- A. The power monitoring and control system vendor must be able to provide development, integration and installation services required to complete and turn over a fully functional system including:
 - 1. Project management to coordinate personnel, information and on-site supervision for the various levels and functions of suppliers required for completion of the project.
 - 2. All technical coordination, installation, integration, and testing of all components.
 - 3. Detailed system design and system drawings.
- B. Cabling, equipment and hardware manufacturers shall have a minimum of 3 years experience in the manufacturing, assembly, and factory testing of components which comply with EIA TIA/EIA-568-B.1, EIA TIA/EIA-568-B.2 and EIA TIA/EIA-568-B.3.
- C. The network cabling contractor shall be a firm which is regularly and professionally engaged in the business of the applications, installation, and testing of the specified network cabling systems and equipment. The contractor shall demonstrate experience in providing successful systems within the past 3 years. Submit documentation for a minimum of three and a maximum of five successful network cabling system installations.
 - 1. Supervisors and installers assigned to the installation of this system or any of its components shall be Building Industry Consulting Services International (BICSI) Registered Cabling Installers, Technician Level. Submit documentation of current BICSI certification for each of the key personnel.

3.4 ACCEPTANCE TESTING

- A. Develop testing procedures to address all specified functions and components of the Advanced Utility Metering System (AUMS). Testing

shall demonstrate proper and anticipated responses to normal and abnormal operating conditions.

1. Provide skilled technicians to start and operate equipment.
 2. Coordinate with equipment manufacturers to determine specific requirements to maintain the validity of the warranty.
 3. Correct deficiencies and make necessary adjustments to O&M manuals and as-built drawings for issues identified in testing.
 4. Provide all tools to start, check-out and functionally test equipment and systems.
 5. Correct deficiencies and make necessary adjustments to O&M manuals and as-built drawings for issues identified in any testing
 6. Review test procedures, testing and results with Government.
- B. Testing checklists: Develop project-specific checklists to document the systems and all components are installed in accordance with the manufacturers recommendation and the Contract Documents.
- C. Before testing, the following prerequisite items must be completed.
1. All related equipment has been started and start-up reports and checklists submitted and approved as ready for testing:
 2. All associated system functions for all interlocking systems are programmed and operable per contract documents.
 3. All punchlist items for the AUMS and equipment are corrected.
 4. The test procedures reviewed and approved.
 5. Safeties and operating ranges reviewed.
- D. The following testing shall be included:
1. Demonstrate reporting of data and alarm conditions for each point and ensure that alarms are received at the assigned location, including Site Data Collection Device.
 2. Demonstrate ability of software program to function for the intended application.
 3. Demonstrate via graphed trends to show the reports are executed in correct manner.
 4. Demonstrate that the meter readings are accurate using portable NIST traceable portable devices and calibrated valves in the piping system
 5. Demonstrate that the systems perform during power loss and resumption of power.
- E. Copper cables: Contractor shall provide all necessary testing equipment to test all copper network circuit cables. Tests shall conform to

EIA/TIA 568B Permanent Link testing criteria. All testers are to be EIA/TIA 568B, Level IIe compliant. The primary field test parameters are:

1. Wire map: The wire map test is intended to verify pair to pin termination at each end and check for installation connectivity errors. For each of the conductors in the cable, the wire map indicates:
 - a. Continuity to the remote end
 - b. Shorts between any two or more conductors
 - c. Crossed pairs
 - d. Reversed pairs
 - e. Split pairs
 - f. Any other mis-wiring
2. Length requirements: The maximum physical length of the basic link shall be 94 meters (including test equipment cords).
3. Insertion Loss: Worst case insertion loss relative to the maximum insertion loss allowed shall be reported.
4. Near-end crosstalk (NEXT) loss: Field tests of NEXT shall be performed at both ends of the test configuration.
5. Power sum near-end crosstalk (PSNEXT) loss
6. Equal-level far-end crosstalk (ELFEXT): Field tests of ELFEXT shall be performed at both ends of the test configuration
7. Power sum equal-level far-end crosstalk (PSELFEXT): Must be determined from both ends of the cable. Power sum Near End Crosstalk is not a category 3 parameter. For all frequencies from 1 to 100 MHz, the category 5e PSELFEXT of the cabling shall be measured in accordance with annex E of ANSI/TIA/EIA-568-B.2 and shall meet the values determined using equations (12) and (13) for the permanent link. PSELFEXT is not a required category 3 measurement parameter.
8. Return loss: Includes all the components of the link. The limits are based on the category of components and cable lengths. Return loss must be tested at both ends of the cable. Cabling return loss is not a required measurement for category 3 cabling.
9. Propagation delay and delay skew: Propagation delay is the time it takes for a signal to propagate from one end to the other. Propagation delay shall be measured in accordance with annex D of ANSI/TIA/EIA-568 B.2. The maximum propagation delay for all category permanent link configurations shall not exceed 498 ns measured at 10

- MHz. Delay skew is a measurement of the signaling delay difference from the fastest pair to the slowest. Delay skew shall be measured in accordance with annex D of ANSI/TIA/EIA-568-B.2. The maximum delay skew for all category permanent link configurations shall not exceed 44 ns.
10. Administration: In addition to Pass/Fail indications, measured values of test parameters should be recorded in the administration system. Any reconfiguration of link components after testing may change the performance of the link and thus invalidates previous test results. Such links shall require retesting to regain conformance.
 11. Test equipment connectors and cords: Adapter cords that are qualified and determined by the test equipment manufacturer to be suitable for permanent link measurements shall be used to attach the field tester to the permanent link under consideration.
 12. Test setup: The permanent link test configuration is to be used by installers and users of data telecommunications systems to verify the performance of permanently installed cabling. A schematic representation of the permanent link is illustrated in figure 1. The permanent link consists of up to 90 m (295 ft) of horizontal cabling and one connection at each end and may also include an optional transition/consolidation point connection. The permanent link excludes both the cable portion of the field test instrument cord and the connection to the field test instrument.
 13. Replace or repair and cables, connectors, and/or terminations found to be defective.
 14. Repair, replace, and/or re-work any or all defective components to achieve cabling tests which meet or exceed 568B permanent link requirements prior to acceptance of the installation or payment for services.
- F. Optical Fiber cables: Contractor shall provide all necessary testing equipment to test all optical fiber cables.
1. Attenuation Testing:
 - a. Singlemode testing shall conform to TIA/EIA 526-7 Method A.1 single jumper reference and TIA/EIA 568-B-1 requirements for link segment testing.

- b. Multimode testing shall conform to TIA/EIA 526-14-A Method B single jumper reference and TIA/EIA 568-B-1 requirements for link segment testing.
 - c. Attenuation testing shall be performed in one direction at each operating wavelength.
 - d. Testing of backbone fiber optic cabling shall be performed from main telecommunications room to each telecommunications room.
 - e. Testing of horizontal fiber optic cabling shall be performed from telecommunications room to station outlet location.
 - f. Tester shall be capable of recording and reporting test reading in an electronic format.
2. OTDR Testing:
- a. OTDR testing is required on all backbone fiber optic cables
 - b. The test shall be preformed as per the EIA/TIA 455-61.
 - c. Multimode testing shall be performed with a minimum 80 meter launch cable.
 - d. Singlemode testing shall be performed with a minimum of 500 meter launch cable.
 - e. Tests shall be performed on each fiber in each direction at both operating wavelengths.
3. Test report data shall reference cables by cable labeling standards. Tests shall be submitted on a 1.5mb, 3.5" DOS formatted floppy disk. Contractor shall provide tests in the native file format of the tester. Contractor shall provide all software needed to view, print, and edit tests.
4. Replace or repair and defective cables, connectors, terminations, etc.
5. Mated connector pairs shall have no more than 0.5dB loss. Fusion splices shall have no more than .15dB loss per splice. Cable attenuation shall be no more than 2% more than the attenuation of the cable on the reel as certified at the factory. Repair, replace, and/or rework any or all defective components to achieve specified test results prior to acceptance of the installation or payment for services.
- G. Wireless Modems: Test system by sending 100,000 commands. Frame error rate shall not be greater than 5 out 100,000 commands.

3.5 DEMONSTRATION AND INSTRUCTION

- A. Furnish the services of a factory-trained engineer or technician for a total of two four-hour classes to instruct designated Facility Information Technologies personnel. Instruction shall include cross connection, corrective, and preventive maintenance of the wired network system and connectivity equipment.
- B. Before the System can be accepted by the VA, this training must be provided and executed. Training will be scheduled at the convenience of the Facilities Contracting Officer and Chief of Engineering Service.
- C. On-site start-up and training of the advanced utility metering system shall include a complete working demonstration of the system with simulation of possible operating conditions that may be encountered.
 - 1. Include any documentation and hands-on exercises necessary to enable electrical and mechanical operations personnel to assume full operating responsibility for the advanced utility monitoring system after completion of the training period.
- D. Include 6 days on-site start-up assistance and 3 days on-site training in two sessions separated by minimum 1 month.
- E. Regularly schedule and make available factory training for VA staff training on all aspects of advanced utility metering system including:
 - 1. Comprehensive software and hardware setup, configuration, and operation.
 - 2. Advanced monitoring and data reporting.
 - 3. Advanced power quality and disturbance monitoring.
- F. Before the system is accepted by the VA, the contractor shall walk-through the installation with the VA's representative and the design engineer to verify proper installation. The contractor may be requested to open enclosures and terminal compartments to verify cable labeling and/or installation compliance.
- G. As-built drawings shall be provided noting the exact cable path and cable labeling information. Drawings in .DWG format will be available to the contractor. As-builts shall be submitted to the VA on disk saved as .DXF or .DWG files. Redline hardcopies shall be provided as well. CAD generated as-built information shall be shown on a new layer named AS_BUILT.

----- END -----

SECTION 26 05 11
REQUIREMENTS FOR ELECTRICAL INSTALLATIONS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section applies to all sections of Division 26.
- B. Furnish and install electrical wiring, systems, equipment and accessories in accordance with the specifications and drawings. Capacities and ratings of motors, transformers, cable, switchboards, switchgear, panelboards, motor control centers, generators, automatic transfer switches, and other items and arrangements for the specified items are shown on drawings.
- C. Electrical service entrance equipment and arrangements for temporary and permanent connections to the utility's system shall conform to the utility's requirements. Coordinate fuses, circuit breakers and relays with the utility's system, and obtain utility approval for sizes and settings of these devices.
- D. Wiring ampacities specified or shown on the drawings are based on copper conductors, with the conduit and raceways accordingly sized. Aluminum conductors are prohibited.

1.2 MINIMUM REQUIREMENTS

- A. References to the International Building Code (IBC), National Electrical Code (NEC), Underwriters Laboratories, Inc. (UL) and National Fire Protection Association (NFPA) are minimum installation requirement standards.
- B. Drawings and other specification sections shall govern in those instances where requirements are greater than those specified in the above standards.
- C. Where current edition of referenced code or standard conflict with referenced edition, the more restrictive shall apply. Submit written requests for clarification to Owner and to Architect/Engineer, with proposed resolution.

1.3 TEST STANDARDS

- A. All materials and equipment shall be listed, labeled or certified by a nationally recognized testing laboratory to meet Underwriters Laboratories, Inc., standards where test standards have been established. Equipment and materials which are not covered by UL Standards will be accepted provided equipment and material is listed, labeled, certified or otherwise determined to meet safety requirements of a nationally recognized testing laboratory. Equipment of a class which no nationally recognized testing laboratory accepts, certifies,

lists, labels, or determines to be safe, will be considered if inspected or tested in accordance with national industrial standards, such as NEMA, or ANSI. Evidence of compliance shall include certified test reports and definitive shop drawings.

B. Definitions:

1. Listed; Equipment, materials, or services included in a list published by an organization that is acceptable to the authority having jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production or listed equipment or materials or periodic evaluation of services, and whose listing states that the equipment, material, or services either meets appropriate designated standards or has been tested and found suitable for a specified purpose.
2. Labeled; Equipment or materials to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the authority having jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled equipment or materials, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.
3. Certified; equipment or product which:
 - a. Has been tested and found by a nationally recognized testing laboratory to meet nationally recognized standards or to be safe for use in a specified manner.
 - b. Production of equipment or product is periodically inspected by a nationally recognized testing laboratory.
 - c. Bears a label, tag, or other record of certification.
4. Nationally recognized testing laboratory; laboratory which is approved, in accordance with OSHA regulations, by the Secretary of Labor.

1.4 QUALIFICATIONS (PRODUCTS AND SERVICES)

- A. Manufacturers Qualifications: The manufacturer shall regularly and presently produce, as one of the manufacturer's principal products, the equipment and material specified for this project, and shall have manufactured the item for at least three years.
- B. Product Qualification:
 1. Manufacturer's product shall have been in satisfactory operation, on three installations of similar size and type as this project, for approximately three years.

2. The Government reserves the right to require the Contractor to submit a list of installations where the products have been in operation before approval.

C. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within four hours of receipt of notification that service is needed. Submit name and address of service organizations.

1.5 APPLICABLE PUBLICATIONS

Applicable publications listed in all Sections of Division are the latest issue, unless otherwise noted.

1.6 MANUFACTURED PRODUCTS

- A. Materials and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items, for which replacement parts shall be available.
- B. When more than one unit of the same class or type of equipment is required, such units shall be the product of a single manufacturer.
- C. Equipment Assemblies and Components:
 1. Components of an assembled unit need not be products of the same manufacturer.
 2. Manufacturers of equipment assemblies, which include components made by others, shall assume complete responsibility for the final assembled unit.
 3. Components shall be compatible with each other and with the total assembly for the intended service.
 4. Constituent parts which are similar shall be the product of a single manufacturer.
- D. Factory wiring shall be identified on the equipment being furnished and on all wiring diagrams.
- E. When Factory Testing Is Specified:
 1. The Government shall have the option of witnessing factory tests. The contractor shall notify the VA through the Resident Engineer a minimum of 15 working days prior to the manufacturers making the factory tests.
 2. Four copies of certified test reports containing all test data shall be furnished to the Resident Engineer prior to final inspection and not more than 90 days after completion of the tests.
 3. When equipment fails to meet factory test and re-inspection is required, the contractor shall be liable for all additional expenses, including expenses of the Government.

1.7 EQUIPMENT REQUIREMENTS

Where variations from the contract requirements are requested in accordance with Section 01 00 00, GENERAL REQUIREMENTS and Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, the connecting work and related components shall include, but not be limited to additions or changes to branch circuits, circuit protective devices, conduits, wire, feeders, controls, panels and installation methods.

1.8 EQUIPMENT PROTECTION

- A. Equipment and materials shall be protected during shipment and storage against physical damage, vermin, dirt, corrosive substances, fumes, moisture, cold and rain.
 - 1. Store equipment indoors in clean dry space with uniform temperature to prevent condensation. Equipment shall include but not be limited to switchgear, switchboards, panelboards, transformers, motor control centers, motor controllers, uninterruptible power systems, enclosures, controllers, circuit protective devices, cables, wire, light fixtures, electronic equipment, and accessories.
 - 2. During installation, equipment shall be protected against entry of foreign matter; and be vacuum-cleaned both inside and outside before testing and operating. Compressed air shall not be used to clean equipment. Remove loose packing and flammable materials from inside equipment.
 - 3. Damaged equipment shall be, as determined by the Resident Engineer, placed in first class operating condition or be returned to the source of supply for repair or replacement.
 - 4. Painted surfaces shall be protected with factory installed removable heavy kraft paper, sheet vinyl or equal.
 - 5. Damaged paint on equipment and materials shall be refinished with the same quality of paint and workmanship as used by the manufacturer so repaired areas are not obvious.

1.9 WORK PERFORMANCE

- A. All electrical work must comply with the requirements of NFPA 70 (NEC), NFPA 70B, NFPA 70E, OSHA Part 1910 subpart J, OSHA Part 1910 subpart S and OSHA Part 1910 subpart K in addition to other references required by contract.
- B. Job site safety and worker safety is the responsibility of the contractor.
- C. Electrical work shall be accomplished with all affected circuits or equipment de-energized. When an electrical outage cannot be accomplished in this manner for the required work, the following requirements are mandatory:

1. Electricians must use full protective equipment (i.e., certified and tested insulating material to cover exposed energized electrical components, certified and tested insulated tools, etc.) while working on energized systems in accordance with NFPA 70E.
2. Electricians must wear personal protective equipment while working on energized systems in accordance with NFPA 70E.
3. Before initiating any work, a job specific work plan must be developed by the contractor with a peer review conducted and documented by the Resident Engineer and Medical Center staff. The work plan must include procedures to be used on and near the live electrical equipment, barriers to be installed, safety equipment to be used and exit pathways.
4. Work on energized circuits or equipment cannot begin until prior written approval is obtained from the Resident Engineer.
- D. For work on existing stations, arrange, phase and perform work to assure electrical service for other buildings at all times. Refer to Article OPERATIONS AND STORAGE AREAS under Section 01 00 00, GENERAL REQUIREMENTS.
- E. New work shall be installed and connected to existing work neatly, safely and professionally. Disturbed or damaged work shall be replaced or repaired to its prior conditions, as required by Section 01 00 00, GENERAL REQUIREMENTS.
- F. Coordinate location of equipment and conduit with other trades to minimize interferences.

1.10 EQUIPMENT INSTALLATION AND REQUIREMENTS

- A. Equipment location shall be as close as practical to locations shown on the drawings.
- B. Working spaces shall not be less than specified in the NEC for all voltages specified.
- C. Inaccessible Equipment:
 1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, the equipment shall be removed and reinstalled as directed at no additional cost to the Government.
 2. "Conveniently accessible" is defined as being capable of being reached quickly for operation, maintenance, or inspections without the use of ladders, or without climbing or crawling under or over obstacles such as, but not limited to, motors, pumps, belt guards, transformers, piping, ductwork, conduit and raceways.

1.11 EQUIPMENT IDENTIFICATION

- A. In addition to the requirements of the NEC, install an identification sign which clearly indicates information required for use and maintenance of items such as switchboards and switchgear, panelboards, cabinets, motor controllers (starters), fused and unfused safety switches, automatic transfer switches, separately enclosed circuit breakers, individual breakers and controllers in switchboards, switchgear and motor control assemblies, control devices and other significant equipment.
- B. Nameplates for Normal Power System equipment shall be laminated black phenolic resin with a white core with engraved lettering. Nameplates for Essential Electrical System (EES) equipment, as defined in the NEC, shall be laminated red phenolic resin with a white core with engraved lettering. Lettering shall be a minimum of 1/2 inch [12mm] high. Nameplates shall indicate equipment designation, rated bus amperage, voltage, number of phases, number of wires, and type of EES power branch as applicable. Secure nameplates with screws.
- C. Install adhesive arc flash warning labels on all equipment as required by NFPA 70E. Label shall indicate the arc hazard boundary (inches), working distance (inches), arc flash incident energy at the working distance (calories/cm²), required PPE category and description including the glove rating, voltage rating of the equipment, limited approach distance (inches), restricted approach distance (inches), prohibited approach distance (inches), equipment/bus name, date prepared, and manufacturer name and address.

1.12 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. The Government's approval shall be obtained for all equipment and material before delivery to the job site. Delivery, storage or installation of equipment or material which has not had prior approval will not be permitted at the job site.
- C. All submittals shall include adequate descriptive literature, catalog cuts, shop drawings and other data necessary for the Government to ascertain that the proposed equipment and materials comply with specification requirements. Catalog cuts submitted for approval shall be legible and clearly identify equipment being submitted.
- D. Submittals for individual systems and equipment assemblies which consist of more than one item or component shall be made for the system or assembly as a whole. Partial submittals will not be considered for approval.

1. Mark the submittals, "SUBMITTED UNDER SECTION_____".
 2. Submittals shall be marked to show specification reference including the section and paragraph numbers.
 3. Submit each section separately.
- E. The submittals shall include the following:
1. Information that confirms compliance with contract requirements.
Include the manufacturer's name, model or catalog numbers, catalog information, technical data sheets, shop drawings, pictures, nameplate data and test reports as required.
- /
3. Elementary and interconnection wiring diagrams for communication and signal systems, control systems and equipment assemblies. All terminal points and wiring shall be identified on wiring diagrams.
 4. Parts list which shall include those replacement parts recommended by the equipment manufacturer.
- F. Manuals: Submit in accordance with Section 01 00 00, GENERAL REQUIREMENTS.
1. Maintenance and Operation Manuals: Submit as required for systems and equipment specified in the technical sections. Furnish four copies, bound in hardback binders, (manufacturer's standard binders) or an approved equivalent. Furnish one complete manual as specified in the technical section but in no case later than prior to performance of systems or equipment test, and furnish the remaining manuals prior to contract completion.
 2. Inscribe the following identification on the cover: the words "MAINTENANCE AND OPERATION MANUAL," the name and location of the system, equipment, building, name of Contractor, and contract number. Include in the manual the names, addresses, and telephone numbers of each subcontractor installing the system or equipment and the local representatives for the system or equipment.
 3. Provide a "Table of Contents" and assemble the manual to conform to the table of contents, with tab sheets placed before instructions covering the subject. The instructions shall be legible and easily read, with large sheets of drawings folded in.
 4. The manuals shall include:
 - a. Internal and interconnecting wiring and control diagrams with data to explain detailed operation and control of the equipment.
 - b. A control sequence describing start-up, operation, and shutdown.
 - c. Description of the function of each principal item of equipment.
 - d. Installation instructions.
 - e. Safety precautions for operation and maintenance.

- f. Diagrams and illustrations.
 - g. Periodic maintenance and testing procedures and frequencies, including replacement parts numbers and replacement frequencies.
 - h. Performance data.
 - i. Pictorial "exploded" parts list with part numbers. Emphasis shall be placed on the use of special tools and instruments. The list shall indicate sources of supply, recommended spare parts, and name of servicing organization.
 - j. List of factory approved or qualified permanent servicing organizations for equipment repair and periodic testing and maintenance, including addresses and factory certification qualifications.
- G. Approvals will be based on complete submission of manuals together with shop drawings.
- H. After approval and prior to installation, furnish the Resident Engineer with one sample of each of the following:
- 1. A 300 mm (12 inch) length of each type and size of wire and cable along with the tag from the coils of reels from which the samples were taken.
 - 2. Each type of conduit coupling, bushing and termination fitting.
 - 3. Conduit hangers, clamps and supports.
 - 4. Duct sealing compound.
 - 5. Each type of receptacle, toggle switch, occupancy sensor, outlet box, manual motor starter, device wall plate, engraved nameplate, wire and cable splicing and terminating material, and branch circuit single pole molded case circuit breaker.

1.13 SINGULAR NUMBER

Where any device or part of equipment is referred to in these specifications in the singular number (e.g., "the switch"), this reference shall be deemed to apply to as many such devices as are required to complete the installation as shown on the drawings.

1.15 ACCEPTANCE CHECKS AND TESTS

The contractor shall furnish the instruments, materials and labor for field tests.

1.16 TRAINING

- A. Training shall be provided in accordance with Article 1.25, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.
- B. Training shall be provided for the particular equipment or system as required in each associated specification.

- C. A training schedule shall be developed and submitted by the contractor and approved by the Resident Engineer at least 30 days prior to the planned training.

- - - E N D - - -

SECTION 26 05 13
MEDIUM VOLTAGE CABLES

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation, and connection of medium voltage cables, splices, and terminations.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirement and items that are common to more than one section of Division 26.
- B. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- C. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits for medium voltage cables.
- D. Section 26 05 41, UNDERGROUND ELECTRICAL CONSTRUCTION: Manholes and ducts for medium voltage cables.
- E. Section 31 20 11, EARTH MOVING (Short Form): Bedding of conduits.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 FACTORY TESTS

Medium voltage cables shall be thoroughly tested at the factory per NEMA WC 74 to ensure that there are no electrical defects. Factory tests shall be certified.

1.5 SUBMITTALS

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Shop Drawings:
 - 1. Clearly present sufficient information to determine compliance with drawings and specifications.
 - 2. Include product and installation information for cables, splices, terminations, and fireproofing tape.
- C. Samples: After approval and prior to installation, furnish the COTR with a minimum 12 in [300 mm] length of each type and size of cable, along with the tag from the reel from which the sample was taken. The

sample shall contain the manufacturer's markings, showing all cable jacket information.

D. Certifications:

1. Factory Test Reports: Prior to installation of the cables, deliver four copies of the manufacturers certified NEMA WC 71 or WC 74 standard factory test reports to the COTR. Certified copies of test data shall show conformance with the referenced standards and shall be approved prior to delivery of cable.
2. Compatibility: Provide certification from the cable manufacturer that the splices and terminations are approved for use with the cable.
3. Field Test Reports: Test reports shall comply with the paragraph entitled "Acceptance Checks and Tests." After testing, submit four certified copies to the COTR of each of the graphs specified under field testing.
4. After splices and terminations have been installed and tested, deliver four copies of a certificate by the contractor to the COTR which includes the following:
 - a. A statement that the materials, detail drawings, and printed instructions used are those contained in the kits approved for this contract.
 - b. A statement that each splice and each termination was completely installed in a single continuous work period by a single qualified worker without any overnight interruption.
 - c. A statement that field-made splices and terminations conform to the following requirements:
 - 1) Pencil the cable insulation precisely.
 - 2) Connector installations:
 - a) Use tools that are designed for the connectors being installed.
 - b) Round and smooth the installed connectors to minimize localized voltage stressing of the insulating materials.
 - 3) Remove contaminants from all surfaces within the splices and terminations before installing the insulating materials.
 - 4) Solder block throughout stranded grounding wires that might penetrate the splicing and terminating materials.
 - 5) Use mirrors to observe the installation of materials on the backsides of the splices and terminations.

- 6) Eliminate air voids throughout the splices and terminations.
- 7) Stretch each layer of tape properly during installation.
- d. List all the materials purchased and installed for the splices and terminations for this contract, including the material descriptions, manufacturers' names, catalog numbers, and total quantities.
- E. Installer Approval:
 - 1. Employees who install splices and terminations and test the cables shall have not fewer than three years of experience splicing and terminating cables equivalent to those being spliced and terminated, including experience with the materials in the kits.
 - 2. Furnish satisfactory proof of such experience for each employee who splices or terminates the cables.

1.6 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only:
 - American Society for Testing and Materials (ASTM):
 - B3-01 (R2007).....Standard Specification for Soft or Annealed Copper Wire
- B. Institute of Electrical and Electronics Engineers, Inc. (IEEE):
 - 386-95 (R2001).....Separable Insulated Connector Systems for Power Distribution Systems above 600 V
 - 400-01.....Guide for Field Testing and Evaluation of the Insulation of Shielded Power Cable Systems
 - 400.2-05.....Guide for Field Testing of Shielded Power Cable Systems Using Very Low Frequency (VLF)
 - 400.3-06.....Guide for Partial Discharge Testing of Shielded Power Cable Systems in a Field Environment
 - 404-00.....Extruded and Laminated Dielectric Shielded Cable Joints Rated 2500-500,000 Volts
- C. National Electrical Manufacturers Association (NEMA):
 - WC 71-99.....Standard for Non-Shielded Cables Rated 2001-5000 Volts for Use in the Distribution of Electrical Energy (ICEA S-96-659)

WC 74-06.....5-46 KV Shielded Power Cable for Use in the
Transmission and Distribution of Electrical
Energy (ICEA S-93-969)

D. National Fire Protection Association (NFPA):

70-08.....National Electrical Code (NEC)

E. Underwriters Laboratories (UL):

1072-06 Medium-Voltage Power Cables

1.7 SHIPMENT AND STORAGE

- A. Cable shall be shipped on reels such that it is protected from mechanical injury. Each end of each length of cable shall be hermetically sealed with manufacturer's end caps and securely attached to the reel.
- B. Cable stored and/or cut on site shall have the ends turned down, and sealed with cable manufacturer's standard cable end seals, or field-installed heat-shrink cable end seals.

PART 2 - PRODUCTS

2.1 MEDIUM VOLTAGE CABLE

- A. Medium voltage cable shall be in accordance with the NEC and NEMA WC 71, WC 74, and UL 1072.
- B. Single conductor stranded copper conforming to ASTM B3.
- C. Voltage Rating:
15,000 V cable shall be used on all distribution systems with voltages ranging from 5,000 V to 15,000 V.
- D. Insulation:
 - 1. Insulation level shall be 133%.
 - 2. Types of insulation:
 - a. Cable type abbreviation, EPR: Ethylene propylene rubber insulation shall be thermosetting, light and heat stabilized.
 - b. Cable type abbreviation, CCLP: Polyethylene insulation shall be thermosetting, light and heat stabilized, and chemically cross-linked.
 - c. In wet locations, anti-tree CCLP or EPR shall be used.
 - d. Cable type abbreviation, XLPE: cross-linked polyethylene insulated shielded shall be thermosetting, light and heat stabilized and chemically cross-linked.
- E. Conductors and insulation shall be wrapped separately with semi-conducting tape.

- F. Insulation shall be wrapped with non-magnetic, metallic shielding tape, helically-applied over semi-conducting insulation shield.
- G. Heavy duty, overall protective jacket of chlorosulphonated polyethylene or polyvinyl chloride shall enclose every cable. The manufacturer's name, cable type and size, and other pertinent information shall be marked or molded clearly on the overall protective jacket.
- H. Cable temperature ratings for continuous operation, emergency overload operation, and short circuit operation shall be not less than the NEC, NEMA WC 71, or NEMA WC 74 standard for the respective cable.

2.2 SPLICES AND TERMINATIONS

- A. The materials shall be compatible with the cables.
- B. In locations where moisture might be present, the splices shall be watertight. In manholes and handholes, the splices shall be submersible.
- C. Where the Government determines that unsatisfactory splices and terminations have been installed, the contractor shall replace the unsatisfactory splices and terminations with approved material at no additional cost to the Government.
- D. Splices and Terminations:
 - 1. Materials shall be designed for the cables being spliced and terminated, and shall be suitable for the prevailing environmental conditions.
 - 2. Splices:
 - a. Shall comply with IEEE 404. Include all components required for complete splice, with detailed instructions.
 - b. Heat-shrink splice: Uniform cross-section, polymeric splicing kit with outer heat-shrink jacket.
 - 3. Terminations:
 - a. Shall comply with IEEE 48. Include shield ground strap for shielded cable terminations.
 - e. Class 3 terminations for outdoor use: Kit with stress cone and compression-type connector.
 - f. Load-break terminations for indoor and outdoor use: Elbow-type unit with test point and 200-A load make/break and continuous-current rating.
 - g. Dead-break terminations for indoor and outdoor use: Elbow-type unit with test point and 600-A continuous-current rating.

2.3 FIREPROOFING TAPE

Fireproofing tape shall be flexible, non-corrosive, self-extinguishing, arcproof, and fireproof intumescent elastomer. Securing tape shall be glass cloth electrical tape not less than 7 mils [0.18 mm] thick, and 0.75 in [19 mm] wide.

PART 3 - EXECUTION

3.1 GENERAL

- A. Installation shall be in accordance with the NEC, as shown on the drawings, and per cable manufacturer's instructions.
- B. Cable shall be installed in conduit above grade and duct bank below grade. All cables of a feeder shall be pulled simultaneously.
- C. Splice the cables only in manholes and accessible pullboxes.
- D. Ground shields in accordance with Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
- E. Cable maximum pull length, maximum pulling tension, and minimum bend radius shall conform with the recommendations of the cable manufacturer, And pulling calculations. Prepare pulling calculations prior to installation of cables.
- F. Use suitable lubricating compounds on the cables to prevent pulling damage. Provide compounds that are not injurious to the cable jacket and do not harden or become adhesive.
- G. Seal the cable ends prior to pulling, to prevent the entry of moisture or lubricant.

3.2 PROTECTION DURING SPLICING OPERATIONS

Blowers shall be provided to force fresh air into manholes where free movement or circulation of air is obstructed. Waterproof protective coverings shall be available on the work site to provide protection against moisture while a splice is being made. Pumps shall be used to keep manholes dry during splicing operations. Under no conditions shall a splice or termination be made that exposes the interior of a cable to moisture. A manhole ring at least 6 in [150 mm] above ground shall be used around the manhole entrance to keep surface water from entering the manhole. Unused ducts shall be plugged and water seepage through ducts in use shall be stopped before splicing.

3.3 PULLING CABLES IN DUCTS AND MANHOLES

- A. Cables shall be pulled into ducts with equipment designed for this purpose, including power-driven winches, cable-feeding flexible tube guides, cable grips, pulling eyes, and lubricants. A sufficient number

of trained personnel and equipment shall be employed to ensure the careful and proper installation of the cable.

- B. Cable reels shall be set up at the side of the manhole opening and above the duct or hatch level, allowing cables to enter through the opening without reverse bending. Flexible tube guides shall be installed through the opening in a manner that will prevent cables from rubbing on the edges of any structural member.
- C. Cable shall be unreeled from the top of the reel. Pay-out shall be carefully controlled. Cables to be pulled shall be attached through a swivel to the main pulling wire by means of a suitable cable grip and pulling eye.
- D. Woven-wire cable grips shall be used to grip the cable end when pulling small cables and short straight lengths of heavier cables.
- E. Pulling eyes shall be attached to the cable conductors to prevent damage to the cable structure.
- F. Cables shall be liberally coated with a suitable lubricant as they enter the tube guide or duct. Rollers, sheaves, or tube guides around which the cable is pulled shall conform to the minimum bending radius of the cable.
- G. Cables shall be pulled into ducts at a reasonable speed. Cable pulling using a vehicle shall not be permitted. Pulling operations shall be stopped immediately at any indication of binding or obstruction, and shall not be resumed until the potential for damage to the cable is corrected. Sufficient slack shall be provided for free movement of cable due to expansion or contraction.
- H. Splices in manholes shall be firmly supported on cable racks. No splices shall be pulled in ducts. Cable ends shall overlap at the ends of a section to provide sufficient undamaged cable for splicing.
- I. Cables cut in the field shall have the cut ends immediately sealed to prevent entrance of moisture.

3.4 SPLICES AND TERMINATIONS

- A. Install the materials as recommended by the manufacturer, including precautions pertaining to air temperature and humidity during installation.
- B. Installation shall be accomplished by qualified personnel trained to accomplish medium voltage equipment installations. All manufacturer's instructions shall be followed precisely.

- C. Splices in manholes shall be located midway between cable racks on walls of manholes, and supported with cable arms at approximately the same elevation as the enclosing duct.

3.5 FIREPROOFING

- A. Cover all cable segments exposed in manholes and pull-boxes with fireproofing tape.
- B. Apply the tape in a single layer, wrapped in a half-lap manner, or as recommended by the manufacturer. Extend the tape not less than 1 in [25 mm] into each duct.
- C. At each end of a taped cable section, secure the fireproof tape in place with glass cloth tape.

3.6 CIRCUIT IDENTIFICATION OF FEEDERS

In each manhole and pullbox, install permanent tags on each circuit's cables to clearly designate the circuit identification and voltage. The tags shall be the embossed brass type, 1.5 in [40 mm] in diameter and 40 mils thick. Attach tags with plastic ties. Position the tags so they will be easy to read after the fireproofing tape is installed.

3.7 ACCEPTANCE CHECKS AND TESTS

- A. Perform tests in accordance with the manufacturer's recommendations. Include the following visual and electrical inspections.
- B. Test equipment and labor and technical personnel shall be provided as necessary to perform the acceptance tests. Arrangements shall be made to have tests witnessed by the COTR.
- C. Visual Inspection:
 - 1. Inspect exposed sections of cables for physical damage.
 - 2. Inspect shield grounding, cable supports, splices, and terminations.
 - 3. Verify that visible cable bends meet manufacturer's minimum published bending radius.
 - 4. Verify installation of fireproofing tape and identification tags.
- D. Electrical Tests:
 - 1. Acceptance tests shall be performed on new and service-aged cables as specified herein.
 - 2. Test new cable after installation, splices, and terminations have been made, but before connection to equipment and existing cable.
- E. Service-Aged Cable Tests:
 - 1. Maintenance tests shall be performed on service-aged cable interconnected to new cable.

2. After new cable test and connection to an existing cable, test the interconnected cable. Disconnect cable from all equipment that could be damaged by the test.

F. Insulation-Resistance Test: Test all new and service-aged cables with respect to ground and adjacent conductors.

1. Test data shall include megohm readings and leakage current readings. Cable shall not be energized until insulation-resistance test results have been approved by the COTR. Test voltages and minimum acceptable resistance values shall be:

<u>Voltage Class</u>	<u>Test Voltage</u>	<u>Min. Insulation Resistance</u>
5kV	2,500 VDC	1,000 megohms
15kV	2,500 VDC	5,000 megohms
25kV	5,000 VDC	20,000 megohms
35kV	15,000 VDC	100,000 megohms

2. Provide a comprehensive report that describes the identification and location of cables tested, the test equipment used, and the date tests were performed; identifies the persons who performed the tests; and identifies the insulation resistance and leakage current results for each cable section tested. The report shall provide conclusions and recommendations for corrective action.

G. Online Partial Discharge Test: Comply with IEEE 400 and 400.3. Test all new and service-aged cables. Perform tests after cables have passed the insulation-resistance test, and after successful energization.

1. Testing shall use a time or frequency domain detection process, incorporating radio frequency current transformer sensors with a partial discharge detection range of 10 kHz to 300 MHz.
2. Provide a comprehensive report that describes the identification and location of cables tested, the test equipment used, and the date tests were performed; identifies the persons who performed the tests; and numerically and graphically identifies the magnitude of partial discharge detected for each cable section tested. The report shall provide conclusions and recommendations for corrective action.

H. Final Acceptance: Final acceptance shall depend upon the satisfactory performance of the cables under test. No cable shall be energized until recorded test data have been approved by the COTR. Final test reports shall be provided to the COTR.

- - - E N D - - -

SECTION 26 05 21
LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW)

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation, and connection of the low voltage power and lighting wiring.

1.2 RELATED WORK

- A. Section 07 84 00, FIRESTOPPING: Sealing around penetrations to maintain the integrity of fire-rated construction.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements that are common to more than one section.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits for cables and wiring.
- E. Section 26 05 41, UNDERGROUND ELECTRICAL CONSTRUCTION: Installation of low-voltage conductors and cables in manholes and ducts.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 FACTORY TESTS

Low voltage cables shall be thoroughly tested at the factory per NEMA WC-70 to ensure that there are no electrical defects. Factory tests shall be certified.

1.5 SUBMITTALS

In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:

- 1. Manufacturer's Literature and Data: Showing each cable type and rating.
- 2. Certifications: Two weeks prior to the final inspection, submit four copies of the following certifications to the COTR:
 - a. Certification by the manufacturer that the materials conform to the requirements of the drawings and specifications.
 - b. Certification by the contractor that the materials have been properly installed, connected, and tested.

1.6 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are reference in the text by designation only.
- B. American Society of Testing Material (ASTM):
 - D2301-04.....Standard Specification for Vinyl Chloride
Plastic Pressure-Sensitive Electrical Insulating
Tape
- C. National Fire Protection Association (NFPA):
 - 70-08.....National Electrical Code (NEC)
- D. National Electrical Manufacturers Association (NEMA):
 - WC 70-09.....Power Cables Rated 2000 Volts or Less for the
Distribution of Electrical Energy
- E. Underwriters Laboratories, Inc. (UL):
 - 44-05.....Thermoset-Insulated Wires and Cables
 - 83-08.....Thermoplastic-Insulated Wires and Cables
 - 467-071.....Electrical Grounding and Bonding Equipment
 - 486A-486B-03.....Wire Connectors
 - 486C-04.....Splicing Wire Connectors
 - 486D-05.....Sealed Wire Connector Systems
 - 486E-94.....Equipment Wiring Terminals for Use with Aluminum
and/or Copper Conductors
 - 493-07.....Thermoplastic-Insulated Underground Feeder and
Branch Circuit Cable
 - 514B-04.....Conduit, Tubing, and Cable Fittings
 - 1479-03.....Fire Tests of Through-Penetration Fire Stops

PART 2 - PRODUCTS

2.1 CONDUCTORS AND CABLES

- A. Conductors and cables shall be in accordance with NEMA WC-70 and as specified herein.
- B. Single Conductor:
 - 1. Shall be annealed copper.
 - 2. Shall be stranded for sizes No. 8 AWG and larger, solid for sizes No. 10 AWG and smaller.
 - 3. Shall be minimum size No. 12 AWG, except where smaller sizes are allowed herein.
- C. Insulation:
 - 1. XHHW-2 or THHN-THWN shall be in accordance with NEMA WC-70, UL 44, and UL 83.
 - 2. Direct burial: UF or USE shall be in accordance with NEMA WC-70 and UL 493.

D. Color Code:

1. Secondary service feeder and branch circuit conductors shall be color-coded as follows:

208/120 volt	Phase	480/277 volt
Black	A	Brown
Red	B	Orange
Blue	C	Yellow
White	Neutral	Gray *
* or white with colored (other than green) tracer.		

- a. Lighting circuit "switch legs" and 3-way switch "traveling wires" shall have color coding that is unique and distinct (e.g., pink and purple) from the color coding indicated above. The unique color codes shall be solid and in accordance with the NEC.
Coordinate color coding in the field with the COTR.
2. Use solid color insulation or solid color coating for No. 12 AWG and No. 10 AWG branch circuit phase, neutral, and ground conductors.
3. Conductors No. 8 AWG and larger shall be color-coded using one of the following methods:
 - a. Solid color insulation or solid color coating.
 - b. Stripes, bands, or hash marks of color specified above.
 - c. Color as specified using 0.75 in [19 mm] wide tape. Apply tape in half-overlapping turns for a minimum of 3 in [75 mm] for terminal points, and in junction boxes, pull-boxes, troughs, and manholes. Apply the last two laps of tape with no tension to prevent possible unwinding. Where cable markings are covered by tape, apply tags to cable, stating size and insulation type.
4. For modifications and additions to existing wiring systems, color coding shall conform to the existing wiring system.

2.2 SPLICES AND JOINTS

- A. In accordance with UL 486A, C, D, E, and NEC.
- B. Aboveground Circuits (No. 10 AWG and smaller):
 1. Connectors: Solderless, screw-on, reusable pressure cable type, rated 600 V, 220° F [105° C], with integral insulation, approved for copper and aluminum conductors.
 2. The integral insulator shall have a skirt to completely cover the stripped wires.

3. The number, size, and combination of conductors, as listed on the manufacturer's packaging, shall be strictly followed.

C. Aboveground Circuits (No. 8 AWG and larger):

1. Connectors shall be indent, hex screw, or bolt clamp-type of high conductivity and corrosion-resistant material, listed for use with copper and aluminum conductors.
2. Field-installed compression connectors for cable sizes 250 kcmil and larger shall have not fewer than two clamping elements or compression indents per wire.
3. Insulate splices and joints with materials approved for the particular use, location, voltage, and temperature. Splice and joint insulation level shall be not less than the insulation level of the conductors being joined.
4. Plastic electrical insulating tape: Per ASTM D2304, flame-retardant, cold and weather resistant.

D. Underground Branch Circuits and Feeders:

1. Submersible connectors in accordance with UL 486D, rated 600 V, 190° F [90° C], with integral insulation.

2.3 CONTROL WIRING

- A. Unless otherwise specified elsewhere in these specifications, control wiring shall be as specified for power and lighting wiring, except that the minimum size shall be not less than No. 14 AWG.
- B. Control wiring shall be large enough such that the voltage drop under in-rush conditions does not adversely affect operation of the controls.

2.4 WIRE LUBRICATING COMPOUND

- A. Lubricating compound shall be suitable for the wire insulation and conduit, and shall not harden or become adhesive.

PART 3 - EXECUTION

3.1 GENERAL

- A. Install in accordance with the NEC, and as specified.
- B. Install all wiring in raceway systems.
- C. Splice cables and wires only in outlet boxes, junction boxes, pull-boxes, manholes, or handholes.
- D. Wires of different systems (e.g., 120 V, 277 V) shall not be installed in the same conduit or junction box system.
- E. Install cable supports for all vertical feeders in accordance with the NEC. Provide split wedge type which firmly clamps each individual cable and tightens due to cable weight.

- F. For panel boards, cabinets, wireways, switches, and equipment assemblies, neatly form, train, and tie the cables in individual circuits.
- G. Seal cable and wire entering a building from underground between the wire and conduit where the cable exits the conduit, with a non-hardening approved compound.
- H. Wire Pulling:
 - 1. Provide installation equipment that will prevent the cutting or abrasion of insulation during pulling of cables. Use lubricants approved for the cable.
 - 2. Use nonmetallic ropes for pulling feeders.
 - 3. Attach pulling lines for feeders by means of either woven basket grips or pulling eyes attached directly to the conductors, as approved by the COTR.
 - 4. All cables in a single conduit shall be pulled simultaneously.
 - 5. Do not exceed manufacturer's recommended maximum pulling tensions and sidewall pressure values.
- I. No more than three single-phase branch circuits shall be installed in any one conduit.

3.2 INSTALLATION IN MANHOLES

- A. Install and support cables in manholes on the steel racks with porcelain or equivalent insulators. Train the cables around the manhole walls, but do not bend to a radius less than six times the overall cable diameter.

3.3 SPLICE INSTALLATION

- A. Splices and terminations shall be mechanically and electrically secure.
- B. Tighten electrical connectors and terminals according to manufacturer's published torque values.
- C. Where the Government determines that unsatisfactory splices or terminations have been installed, remove the devices and install approved devices at no additional cost to the Government.

3.4 FEEDER IDENTIFICATION

- A. In each interior pull-box and junction box, install metal tags on all circuit cables and wires to clearly designate their circuit identification and voltage. The tags shall be the embossed brass type, 1.5 in [40 mm] in diameter and 40 mils thick. Attach tags with plastic ties.
- B. In each manhole and handhole, provide tags of the embossed brass type, showing the circuit identification and voltage. The tags shall be the embossed brass type, 1.5 in [40 mm] in diameter and 40 mils thick. Attach tags with plastic ties.

3.5 EXISTING WIRING

Unless specifically indicated on the plans, existing wiring shall not be reused for a new installation.

3.6 CONTROL AND SIGNAL WIRING INSTALLATION

- A. Unless otherwise specified in other sections, install wiring and connect to equipment/devices to perform the required functions as shown and specified.
- B. Except where otherwise required, install a separate power supply circuit for each system so that malfunctions in any system will not affect other systems.
- C. Where separate power supply circuits are not shown, connect the systems to the nearest panel boards of suitable voltages, which are intended to supply such systems and have suitable spare circuit breakers or space for installation.

3.7 CONTROL AND SIGNAL SYSTEM WIRING IDENTIFICATION

- A. Install a permanent wire marker on each wire at each termination.
- B. Identifying numbers and letters on the wire markers shall correspond to those on the wiring diagrams used for installing the systems.
- C. Wire markers shall retain their markings after cleaning.
- D. In each manhole and handhole, install embossed brass tags to identify the system served and function.

3.8 DIRECT BURIAL CABLE INSTALLATION (TEMPORARY INSTALLATION OF NORMAL POWER)

- A. Tops of the cables:
 - 1. Below the finished grade: Minimum 24 in [600 mm] unless greater depth is shown.
 - 2. Below road and other pavement surfaces: In conduit as specified, minimum 30 in [750 mm] unless greater depth is shown.
 - 3. Do not install cables under railroad tracks.
- B. Under road and paved surfaces: Install cables in concrete-encased galvanized steel rigid conduits. Size as shown on plans, but not less than 2 in [50 mm] trade size with bushings at each end of each conduit run. Provide size/quantity of conduits required to accommodate cables plus one spare.
- C. Work with extreme care near existing ducts, conduits, cables, and other utilities to prevent any damage.
- D. Cut the trenches neatly and uniformly:
 - 1. Excavating and backfilling is specified in Section 31 20 11, EARTH MOVING (Short Form).

2. Place a 3 in [75 mm] layer of sand in the trenches before installing the cables.
 3. Place a 3 in [75 mm] layer of sand over the installed cables.
 4. Install continuous horizontal, 1 in x 8 in [25 mm x 200 mm] preservative impregnated wood planking 3 in [75 mm] above the cables before backfilling.
- E. Provide horizontal slack in the cables for contraction during cold weather.
- F. Install the cables in continuous lengths. Splices within cable runs shall not be accepted.
- G. Connections and terminations shall be listed submersible-type designed for the cables being installed.
- H. Warning tape shall be continuously placed 12 in [300 mm] above the buried cables.

3.9 ACCEPTANCE CHECKS AND TESTS

- A. Feeders and branch circuits shall have their insulation tested after installation and before connection to utilization devices, such as fixtures, motors, or appliances. Test each conductor with respect to adjacent conductors and to ground. Existing conductors to be reused shall also be tested.
- B. Applied voltage shall be 500VDC for 300-volt rated cable, and 1000VDC for 600-volt rated cable. Apply test for one minute or until reading is constant for 15 seconds, whichever is longer. Minimum insulation resistance values shall not be less than 25 megohms for 300-volt rated cable and 100 megohms for 600-volt rated cable.
- C. Perform phase rotation test on all three-phase circuits.
- D. The contractor shall furnish the instruments, materials, and labor for all tests.

- - - E N D - - -

SECTION 26 05 26
GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the general grounding and bonding requirements for electrical equipment and operations to provide a low impedance path for possible ground fault currents.
- B. "Grounding electrode system" refers to all electrodes required by NEC, as well as made, supplementary, and lightning protection system grounding electrodes.
- C. The terms "connect" and "bond" are used interchangeably in this specification and have the same meaning.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- B. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Low Voltage power and lighting wiring.
- C. Section 26 22 00, LOW-VOLTAGE TRANSFORMERS: Low voltage transformers.
- D. Section 26 24 11, DISTRIBUTION SWITCHBOARDS: Low voltage distribution switchboards.
- E. Section 26 24 16, PANELBOARDS: Low voltage panelboards.
- F. Section 26 41 00, FACILITY LIGHTNING PROTECTION: Requirements for lightning protection.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. Submit in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Shop Drawings:
 - 1. Clearly present enough information to determine compliance with drawings and specifications.
 - 2. Include the location of system grounding electrode connections and the routing of aboveground and underground grounding electrode conductors.
- C. Test Reports: Provide certified test reports of ground resistance.

D. Certifications: Two weeks prior to final inspection, submit four copies of the following to the COTR:

1. Certification that the materials and installation are in accordance with the drawings and specifications.
2. Certification by the contractor that the complete installation has been properly installed and tested.

1.5 APPLICABLE PUBLICATIONS

Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.

A. American Society for Testing and Materials (ASTM):

B1-07.....Standard Specification for Hard-Drawn Copper Wire

B3-07.....Standard Specification for Soft or Annealed Copper Wire

B8-04.....Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft

B. Institute of Electrical and Electronics Engineers, Inc. (IEEE):

81-1983.....IEEE Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Ground System

C2-07.....National Electrical Safety Code

C. National Fire Protection Association (NFPA):

70-08.....National Electrical Code (NEC)

99-2005.....Health Care Facilities

D. Underwriters Laboratories, Inc. (UL):

44-05Thermoset-Insulated Wires and Cables

83-08Thermoplastic-Insulated Wires and Cables

467-07Grounding and Bonding Equipment

486A-486B-03Wire Connectors

PART 2 - PRODUCTS

2.1 GROUNDING AND BONDING CONDUCTORS

A. Equipment grounding conductors shall be UL 44 or UL 83 insulated stranded copper, except that sizes No. 10 AWG [6 mm²] and smaller shall be solid copper. Insulation color shall be continuous green for all

equipment grounding conductors, except that wire sizes No. 4 AWG [25 mm²] and larger shall be identified per NEC.

- B. Bonding conductors shall be ASTM B8 bare stranded copper, except that sizes No. 10 AWG [6 mm²] and smaller shall be ASTM B1 solid bare copper wire.
- C. Conductor sizes shall not be less than shown on the drawings, or not less than required by the NEC, whichever is greater.

2.2 GROUND RODS

- A. Steel or copper clad steel, 0.75 in [19 mm] diameter by 10 ft [3.0 M] long, conforming to UL 467.
- B. Quantity of rods shall be as required to obtain the specified ground resistance, as shown on the drawings.

2.3 CONCRETE ENCASED ELECTRODE

Concrete encased electrode shall be No. 4 AWG bare copper wire, installed per NEC.

2.4 MEDIUM VOLTAGE SPLICES AND TERMINATIONS

Components shall meet or exceed UL 467 and be clearly marked with the manufacturer, catalog number, and permitted conductor size(s).

2.5 GROUND CONNECTIONS

- A. Below Grade: Exothermic-welded type connectors.
- B. Above Grade:
 - 1. Bonding Jumpers: Compression-type connectors, using zinc-plated fasteners and external tooth lockwashers.
 - 2. Connection to Building Steel: Exothermic-welded type connectors.
 - 3. Ground Busbars: Two-hole compression type lugs, using tin-plated copper or copper alloy bolts and nuts.
 - 4. Rack and Cabinet Ground Bars: One-hole compression-type lugs, using zinc-plated or copper alloy fasteners.

2.6 EQUIPMENT RACK AND CABINET GROUND BARS

Provide solid copper ground bars designed for mounting on the framework of open or cabinet-enclosed equipment racks with minimum dimensions of 0.375 in [4 mm] thick x 0.75 in [19 mm] wide.

2.7 GROUND TERMINAL BLOCKS

At any equipment mounting location (e.g., backboards and hinged cover enclosures) where rack-type ground bars cannot be mounted, provide screw lug-type terminal blocks.

2.8 GROUNDING BUS

Pre-drilled rectangular copper bar with stand-off insulators, minimum 0.25 in [6.3 mm] thick x 4 in [100 mm] high in cross-section, length as shown on drawings, with 0.281 in [7.1 mm] holes spaced 1.125 in [28 mm] apart.

PART 3 - EXECUTION

3.1 GENERAL

- A. Ground in accordance with the NEC, as shown on drawings, and as specified herein.
- B. System Grounding:
 - 1. Secondary service neutrals: Ground at the supply side of the secondary disconnecting means and at the related transformers.
 - 2. Separately derived systems (transformers downstream from the service entrance): Ground the secondary neutral.
- C. Equipment Grounding: Metallic structures, including ductwork and building steel, enclosures, raceways, junction boxes, outlet boxes, cabinets, machine frames, and other conductive items in close proximity with electrical circuits, shall be bonded and grounded.

3.2 INACCESSIBLE GROUNDING CONNECTIONS

Make grounding connections, which are normally buried or otherwise inaccessible (except connections for which access for periodic testing is required), by exothermic weld.

3.3 MEDIUM VOLTAGE EQUIPMENT AND CIRCUITS

- A. Duct Banks and Manholes: Provide an insulated equipment grounding conductor in each duct containing medium voltage conductors, sized per NEC except that minimum size shall be 2 AWG [25 mm²]. Bond the equipment grounding conductors to the switchgear ground bus, to all manhole hardware and ground rods, to the cable shielding grounding provisions of medium-voltage cable splices and terminations, and to equipment enclosures.
- B. Pad-Mounted Transformers:
 - 1. Provide a driven ground rod and bond with a grounding electrode conductor to the transformer grounding pad.
 - 2. Ground the secondary neutral.
- C. Lightning Arresters: Connect lightning arresters to the equipment ground bus or ground rods as applicable.

3.4 SECONDARY VOLTAGE EQUIPMENT AND CIRCUITS

- A. Main Bonding Jumper: Bond the secondary service neutral to the ground bus in the service equipment.
- B. Metallic Piping, Building Steel, and Supplemental Electrode(s):
 - 1. Provide a grounding electrode conductor sized per NEC between the service equipment ground bus and all metallic water pipe systems, building steel, and supplemental or made electrodes. Provide jumper insulating joints in the metallic piping. All connections to electrodes shall be made with fittings that conform to UL 467.
 - 2. Provide a supplemental ground electrode and bond to the grounding electrode system.
- C. Service Disconnect (Separate Individual Enclosure): Provide a ground bar bolted to the enclosure with lugs for connecting the various grounding conductors.
- D. Switchboards, Panelboards, and Panelboards:
 - 1. Connect the various feeder equipment grounding conductors to the ground bus in the enclosure with suitable pressure connectors.
 - 2. For service entrance equipment, connect the grounding electrode conductor to the ground bus.
 - 3. Provide ground bars, bolted to the housing, with sufficient lugs to terminate the equipment grounding conductors.
 - 4. Connect metallic conduits that terminate without mechanical connection to the housing, by grounding bushings and grounding conductor to the equipment ground bus.
- E. Transformers:
 - 1. Exterior: Exterior transformers supplying interior service equipment shall have the neutral grounded at the transformer secondary. Provide a grounding electrode at the transformer.
 - 2. Separately derived systems (transformers downstream from service equipment): Ground the secondary neutral at the transformer. Provide a grounding electrode conductor from the transformer to the nearest component of the grounding electrode system.

3.5 RACEWAY

- A. Conduit Systems:
 - 1. Ground all metallic conduit systems. All metallic conduit systems shall contain an equipment grounding conductor.
 - 2. Non-metallic conduit systems, except non-metallic feeder conduits that carry a grounded conductor from exterior transformers to

- interior or building-mounted service entrance equipment, shall contain an equipment grounding conductor.
3. Conduit that only contains a grounding conductor, and is provided for its mechanical protection, shall be bonded to that conductor at the entrance and exit from the conduit.
 4. Metallic conduits which terminate without mechanical connection to an electrical equipment housing by means of locknut and bushings or adapters, shall be provided with grounding bushings. Connect bushings with a bare grounding conductor to the equipment ground bus.
- B. Feeders and Branch Circuits: Install equipment grounding conductors with all feeders and power and lighting branch circuits.
- C. Boxes, Cabinets, Enclosures, and Panelboards:
1. Bond the equipment grounding conductor to each pullbox, junction box, outlet box, device box, cabinets, and other enclosures through which the conductor passes (except for special grounding systems for intensive care units and other critical units shown).
 2. Provide lugs in each box and enclosure for equipment grounding conductor termination.
- D. Wireway Systems:
1. Bond the metallic structures of wireway to provide 100% electrical continuity throughout the wireway system, by connecting a No. 6 AWG [16 mm²] bonding jumper at all intermediate metallic enclosures and across all section junctions.
 2. Install insulated No. 6 AWG [16 mm²] bonding jumpers between the wireway system, bonded as required above, and the closest building ground at each end and approximately every 50 ft [16 M].
 3. Use insulated No. 6 AWG [16 mm²] bonding jumpers to ground or bond metallic wireway at each end for all intermediate metallic enclosures and across all section junctions.
 4. Use insulated No. 6 AWG [16 mm²] bonding jumpers to ground cable tray to column-mounted building ground plates (pads) at each end and approximately every 49 ft [15 M].
- E. Receptacles shall not be grounded through their mounting screws. Ground receptacles with a jumper from the receptacle green ground terminal to the device box ground screw and a jumper to the branch circuit equipment grounding conductor.

- F. Ground lighting fixtures to the equipment grounding conductor of the wiring system when the green ground is provided; otherwise, ground the fixtures through the conduit systems. Fixtures connected with flexible conduit shall have a green ground wire included with the power wires from the fixture through the flexible conduit to the first outlet box.
- G. Fixed electrical appliances and equipment shall be provided with a ground lug for termination of the equipment grounding conductor.
- H. Raised Floors: Provide bonding of all raised floor components.

3.6 OUTDOOR METALLIC FENCES AROUND ELECTRICAL EQUIPMENT

- A. Outdoor Metallic Fences Around Electrical Equipment: Fences shall be grounded with a ground rod at each fixed gate post and at each corner post. Drive ground rods until the top is 12 in [300 mm] below grade. Attach a No. 4 AWG [25 mm²] copper conductor by exothermic weld to the ground rods, and extend underground to the immediate vicinity of fence post. Lace the conductor vertically into 12 in [300 mm] of fence mesh and fasten by two approved bronze compression fittings, one to bond the wire to post and the other to bond the wire to fence. Each gate section shall be bonded to its gatepost by a 0.375 in x 1 in [3 mm x 25 mm] flexible, braided copper strap and ground post clamps. Clamps shall be of the anti-electrolysis type.

3.7 CORROSION INHIBITORS

When making ground and ground bonding connections, apply a corrosion inhibitor to all contact surfaces. Use corrosion inhibitor appropriate for protecting a connection between the metals used.

3.8 CONDUCTIVE PIPING

- A. Bond all conductive piping systems, interior and exterior, to the grounding electrode system. Bonding connections shall be made as close as practical to the equipment ground bus.
- B. In operating rooms and at intensive care and coronary care type beds, bond the gases and suction piping at the outlets directly to the room or patient ground bus.

3.9 LIGHTNING PROTECTION SYSTEM

Bond the lightning protection system to the electrical grounding electrode system.

3.10 ELECTRICAL ROOM GROUNDING

Building Earth Ground Busbars: Provide ground busbar and mounting hardware at each electrical room and connect to pigtail extensions of the building grounding ring.

3.11 EXTERIOR LIGHT POLES

Provide 20 ft [6.1 M] of No. 4 bare copper coiled at bottom of pole base excavation prior to pour, plus additional unspliced length in and above foundation as required to reach pole ground stud.

3.12 GROUND RESISTANCE

- A. Grounding system resistance to ground shall not exceed 5 ohms. Make any modifications or additions to the grounding electrode system necessary for compliance without additional cost to the Government. Final tests shall ensure that this requirement is met.
- B. Resistance of the grounding electrode system shall be measured using a four-terminal fall-of-potential method as defined in IEEE 81. Ground resistance measurements shall be made before the electrical distribution system is energized and shall be made in normally dry conditions not fewer than 48 hours after the last rainfall. Resistance measurements of separate grounding electrode systems shall be made before the systems are bonded together below grade. The combined resistance of separate systems may be used to meet the required resistance, but the specified number of electrodes must still be provided.
- C. Services at power company interface points shall comply with the power company ground resistance requirements.
- D. Below-grade connections shall be visually inspected by the Resident Engineer prior to backfilling. The contractor shall notify the Resident Engineer 24 hours before the connections are ready for inspection.

3.12 GROUND ROD INSTALLATION

- A. For outdoor installations, drive each rod vertically in the earth, until top of rod is 24 in [609 mm] below final grade.
- B. For indoor installations, leave 4 in [100 mm] of rod exposed.
- C. Where permanently concealed ground connections are required, make the connections by the exothermic process, to form solid metal joints. Make accessible ground connections with mechanical pressure-type ground connectors.

- D. Where rock prevents the driving of vertical ground rods, install angled ground rods or grounding electrodes in horizontal trenches to achieve the specified resistance.

- - - E N D - - -

SECTION 26 05 33
RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the furnishing, installation, and connection of conduit, fittings, and boxes, to form complete, coordinated, grounded raceway systems. Raceways are required for all wiring unless shown or specified otherwise.
- B. Definitions: The term conduit, as used in this specification, shall mean any or all of the raceway types specified.

1.2 RELATED WORK

- A. Section 06 10 00, ROUGH CARPENTRY: Mounting board for telephone closets.
- B. Section 07 60 00, FLASHING AND SHEET METAL: Fabrications for the deflection of water away from the building envelope at penetrations.
- C. Section 07 84 00, FIRESTOPPING: Sealing around penetrations to maintain the integrity of fire rated construction.
- D. Section 07 92 00, JOINT SEALANTS: Sealing around conduit penetrations through the building envelope to prevent moisture migration into the building.
- E. Section 09 91 00, PAINTING: Identification and painting of conduit and other devices.
- F. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- G. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- H. Section 26 05 41, UNDERGROUND ELECTRICAL CONSTRUCTION: Underground conduits.
- I. Section 31 20 11, EARTH MOVING (Short Form): Bedding of conduits.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:

- A. Manufacturer's Literature and Data: Showing each cable type and rating. The specific item proposed and its area of application shall be identified on the catalog cuts.
- B. Shop Drawings:

1. Size and location of main feeders.
2. Size and location of panels and pull-boxes.
3. Layout of required conduit penetrations through structural elements.

C. Certifications:

1. Two weeks prior to the final inspection, submit four copies of the following certifications to the COTR:
 - a. Certification by the manufacturer that the material conforms to the requirements of the drawings and specifications.
 - b. Certification by the contractor that the material has been properly installed.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American National Standards Institute (ANSI):
- C80.1-05.....Electrical Rigid Steel Conduit
 - C80.3-05.....Steel Electrical Metal Tubing
 - C80.6-05.....Electrical Intermediate Metal Conduit
- C. National Fire Protection Association (NFPA):
- 70-08.....National Electrical Code (NEC)
- D. Underwriters Laboratories, Inc. (UL):
- 1-05.....Flexible Metal Conduit
 - 5-04.....Surface Metal Raceway and Fittings
 - 6-07.....Electrical Rigid Metal Conduit - Steel
 - 50-95.....Enclosures for Electrical Equipment
 - 360-093.....Liquid-Tight Flexible Steel Conduit
 - 467-07.....Grounding and Bonding Equipment
 - 514A-04.....Metallic Outlet Boxes
 - 514B-04.....Conduit, Tubing, and Cable Fittings
 - 514C-96.....Nonmetallic Outlet Boxes, Flush-Device Boxes and Covers
 - 651-05.....Schedule 40 and 80 Rigid PVC Conduit and Fittings
 - 651A-00.....Type EB and A Rigid PVC Conduit and HDPE Conduit
 - 797-07.....Electrical Metallic Tubing
 - 1242-06.....Electrical Intermediate Metal Conduit - Steel
- E. National Electrical Manufacturers Association (NEMA):
- TC-2-03.....Electrical Polyvinyl Chloride (PVC) Tubing and Conduit
 - TC-3-04.....PVC Fittings for Use with Rigid PVC Conduit and Tubing

FB1-07.....Fittings, Cast Metal Boxes and Conduit Bodies
for Conduit, Electrical Metallic Tubing and
Cable

PART 2 - PRODUCTS

2.1 MATERIAL

- A. Conduit Size: In accordance with the NEC, but not less than 0.5 in [13 mm] unless otherwise shown. Where permitted by the NEC, 0.5 in [13 mm] flexible conduit may be used for tap connections to recessed lighting fixtures.
- B. Conduit:
 - 1. Rigid steel: Shall conform to UL 6 and ANSI C80.1.
 - 3. Rigid intermediate steel conduit (IMC): Shall conform to UL 1242 and ANSI C80.6.
 - 4. Electrical metallic tubing (EMT): Shall conform to UL 797 and ANSI C80.3. Maximum size not to exceed 4 in [105 mm] and shall be permitted only with cable rated 600 V or less.
 - 5. Flexible galvanized steel conduit: Shall conform to UL 1.
 - 6. Liquid-tight flexible metal conduit: Shall conform to UL 360.
 - 7. Direct burial plastic conduit: Shall conform to UL 651 and UL 651A, heavy wall PVC or high density polyethylene (PE).
 - 8. Surface metal raceway: Shall conform to UL 5.
- C. Conduit Fittings:
 - 1. Rigid steel and IMC conduit fittings:
 - a. Fittings shall meet the requirements of UL 514B and NEMA FB1.
 - b. Standard threaded couplings, locknuts, bushings, conduit bodies, and elbows: Only steel or malleable iron materials are acceptable. Integral retractable type IMC couplings are also acceptable.
 - c. Locknuts: Bonding type with sharp edges for digging into the metal wall of an enclosure.
 - d. Bushings: Metallic insulating type, consisting of an insulating insert, molded or locked into the metallic body of the fitting. Bushings made entirely of metal or nonmetallic material are not permitted.
 - e. Erickson (union-type) and set screw type couplings: Approved for use in concrete are permitted for use to complete a conduit run where conduit is installed in concrete. Use set screws of case-hardened steel with hex head and cup point to firmly seat in conduit wall for positive ground. Tightening of set screws with pliers is prohibited.
 - f. Sealing fittings: Threaded cast iron type. Use continuous drain-type sealing fittings to prevent passage of water vapor. In

concealed work, install fittings in flush steel boxes with blank cover plates having the same finishes as that of other electrical plates in the room.

3. Electrical metallic tubing fittings:
 - a. Fittings and conduit bodies shall meet the requirements of UL 514B, ANSI C80.3, and NEMA FB1.
 - b. Only steel or malleable iron materials are acceptable.
 - c. Compression couplings and connectors: Concrete-tight and rain-tight, with connectors having insulated throats.
 - d. Indent-type connectors or couplings are prohibited.
 - e. Die-cast or pressure-cast zinc-alloy fittings or fittings made of "pot metal" are prohibited.
4. Flexible steel conduit fittings:
 - a. Conform to UL 514B. Only steel or malleable iron materials are acceptable.
 - b. Clamp-type, with insulated throat.
5. Liquid-tight flexible metal conduit fittings:
 - a. Fittings shall meet the requirements of UL 514B and NEMA FB1.
 - b. Only steel or malleable iron materials are acceptable.
 - c. Fittings must incorporate a threaded grounding cone, a steel or plastic compression ring, and a gland for tightening. Connectors shall have insulated throats.
6. Direct burial plastic conduit fittings:

Fittings shall meet the requirements of UL 514C and NEMA TC3.
7. Surface metal raceway fittings: As recommended by the raceway manufacturer. Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, conduit entry fittings, accessories, and other fittings as required for complete system.
8. Expansion and deflection couplings:
 - a. Conform to UL 467 and UL 514B.
 - b. Accommodate a 0.75 in [19 mm] deflection, expansion, or contraction in any direction, and allow 30 degree angular deflections.
 - c. Include internal flexible metal braid, sized to guarantee conduit ground continuity and a low-impedance path for fault currents, in accordance with UL 467 and the NEC tables for equipment grounding conductors.
 - d. Jacket: Flexible, corrosion-resistant, watertight, moisture and heat-resistant molded rubber material with stainless steel jacket clamps.

D. Conduit Supports:

1. Parts and hardware: Zinc-coat or provide equivalent corrosion protection.
2. Individual Conduit Hangers: Designed for the purpose, having a pre-assembled closure bolt and nut, and provisions for receiving a hanger rod.
3. Multiple conduit (trapeze) hangers: Not less than 1.5 x 1.5 in [38 mm x 38 mm], 12-gauge steel, cold-formed, lipped channels; with not less than 0.375 in [9 mm] diameter steel hanger rods.
4. Solid Masonry and Concrete Anchors: Self-drilling expansion shields, or machine bolt expansion.

E. Outlet, Junction, and Pull Boxes:

1. UL-50 and UL-514A.
2. Cast metal where required by the NEC or shown, and equipped with rustproof boxes.
3. Sheet metal boxes: Galvanized steel, except where otherwise shown.
4. Flush-mounted wall or ceiling boxes shall be installed with raised covers so that the front face of raised cover is flush with the wall. Surface-mounted wall or ceiling boxes shall be installed with surface-style flat or raised covers.

- F. Wireways: Equip with hinged covers, except where removable covers are shown. Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, and other fittings to match and mate with wireways as required for a complete system.

PART 3 - EXECUTION

3.1 PENETRATIONS

A. Cutting or Holes:

1. Cut holes in advance where they should be placed in the structural elements, such as ribs or beams. Obtain the approval of the COTR prior to drilling through structural elements.
2. Cut holes through concrete and masonry in new and existing structures with a diamond core drill or concrete saw. Pneumatic hammers, impact electric, hand, or manual hammer-type drills are not allowed, except where permitted by the COTR as required by limited working space.

- B. Firestop: Where conduits, wireways, and other electrical raceways pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING.

- C. Waterproofing: At floor, exterior wall, and roof conduit penetrations, completely seal clearances around the conduit and make watertight, as specified in Section 07 92 00, JOINT SEALANTS.

3.2 INSTALLATION, GENERAL

- A. In accordance with UL, NEC, as shown, and as specified herein.

- C. Install conduit as follows:

1. In complete mechanically and electrically continuous runs before pulling in cables or wires.
2. Unless otherwise indicated on the drawings or specified herein, installation of all conduits shall be concealed within finished walls, floors, and ceilings.
3. Flattened, dented, or deformed conduit is not permitted. Remove and replace the damaged conduits with new undamaged material.
4. Assure conduit installation does not encroach into the ceiling height head room, walkways, or doorways.
5. Cut square, ream, remove burrs, and draw up tight.
6. Independently support conduit at 8 ft [2.4 M] on centers. Do not use other supports, i.e., suspended ceilings, suspended ceiling supporting members, lighting fixtures, conduits, mechanical piping, or mechanical ducts.
7. Support within 12 in [300 mm] of changes of direction, and within 12 in [300 mm] of each enclosure to which connected.
8. Close ends of empty conduit with plugs or caps at the rough-in stage until wires are pulled in, to prevent entry of debris.
9. Conduit installations under fume and vent hoods are prohibited.
10. Secure conduits to cabinets, junction boxes, pull-boxes, and outlet boxes with bonding type locknuts. For rigid and IMC conduit installations, provide a locknut on the inside of the enclosure, made up wrench tight. Do not make conduit connections to junction box covers.
11. Flashing of penetrations of the roof membrane is specified in Section 07 60 00, FLASHING AND SHEET METAL.
12. Conduit bodies shall only be used for changes in direction, and shall not contain splices.

- D. Conduit Bends:

1. Make bends with standard conduit bending machines.
2. Conduit hickey may be used for slight offsets and for straightening stubbed out conduits.
3. Bending of conduits with a pipe tee or vise is prohibited.

- E. Layout and Homeruns:

1. Install conduit with wiring, including homeruns, as shown on drawings.
2. Deviations: Make only where necessary to avoid interferences and only after drawings showing the proposed deviations have been submitted approved by the COTR.

3.3 CONCEALED WORK INSTALLATION

A. In Concrete:

1. Conduit: Rigid steel, IMC, or EMT. Do not install EMT in concrete slabs that are in contact with soil, gravel, or vapor barriers.
2. Align and run conduit in direct lines.
3. Install conduit through concrete beams only:
 - a. Where shown on the structural drawings.
 - b. As approved by the COTR prior to construction, and after submittal of drawing showing location, size, and position of each penetration.
4. Installation of conduit in concrete that is less than 3 in [75 mm] thick is prohibited.
 - a. Conduit outside diameter larger than one-fourth of the slab thickness is prohibited.
 - b. Space between conduits in slabs: Approximately six conduit diameters apart, and one conduit diameter at conduit crossings.
 - c. Install conduits approximately in the center of the slab so that there will be a minimum of 0.75 in [19 mm] of concrete around the conduits.
5. Make couplings and connections watertight. Use thread compounds that are UL approved conductive type to ensure low resistance ground continuity through the conduits. Tightening setscrews with pliers is prohibited.

B. Above Furred or Suspended Ceilings and in Walls:

1. Conduit for conductors above 600 V: Rigid steel. Mixing different types of conduits indiscriminately in the same system is prohibited.
2. Conduit for conductors 600 V and below: EMT. Mixing different types of conduits indiscriminately in the same system is prohibited.
3. Align and run conduit parallel or perpendicular to the building lines.
4. Connect recessed lighting fixtures to conduit runs with maximum 6 ft [1.8 M] of flexible metal conduit extending from a junction box to the fixture.
5. Tightening setscrews with pliers is prohibited.

3.4 EXPOSED WORK INSTALLATION

- A. Unless otherwise indicated on the drawings, exposed conduit is only permitted in mechanical and electrical rooms.
- B. Conduit for Conductors above 600 V: Rigid steel. Mixing different types of conduits indiscriminately in the system is prohibited.
- C. Conduit for Conductors 600 V and Below: EMT. Mixing different types of conduits indiscriminately in the system is prohibited.
- D. Align and run conduit parallel or perpendicular to the building lines.
- E. Install horizontal runs close to the ceiling or beams and secure with conduit straps.
- F. Support horizontal or vertical runs at not over 8 ft [2.4 M] intervals.
- G. Surface metal raceways: Use only where shown.
- H. Painting:
 - 1. Paint exposed conduit as specified in Section 09 91 00, PAINTING.
 - 2. Paint all conduits containing cables rated over 600 V safety orange. Refer to Section 09 91 00, PAINTING for preparation, paint type, and exact color. In addition, paint legends, using 2 in [50 mm] high black numerals and letters, showing the cable voltage rating. Provide legends where conduits pass through walls and floors and at maximum 20 ft [6 M] intervals in between.

3.5 DIRECT BURIAL INSTALLATION

Refer to Section 26 05 41, UNDERGROUND ELECTRICAL CONSTRUCTION.

3.6 HAZARDOUS LOCATIONS

- A. Use rigid steel conduit only, notwithstanding requirements otherwise specified in this or other sections of these specifications.
- B. Install UL approved sealing fittings that prevent passage of explosive vapors in hazardous areas equipped with explosion-proof lighting fixtures, switches, and receptacles, as required by the NEC.

3.7 WET OR DAMP LOCATIONS

- A. Unless otherwise shown, use conduits of rigid steel or IMC.
- B. Provide sealing fittings to prevent passage of water vapor where conduits pass from warm to cold locations, i.e., refrigerated spaces, constant-temperature rooms, air-conditioned spaces, building exterior walls, roofs, or similar spaces.
- C. Unless otherwise shown, use rigid steel or IMC conduit within 5 ft [1.5 M] of the exterior and below concrete building slabs in contact with soil, gravel, or vapor barriers. Conduit shall be half-lapped with 10 mil PVC tape before installation. After installation, completely recoat or retape any damaged areas of coating.

3.8 MOTORS AND VIBRATING EQUIPMENT

- A. Use flexible metal conduit for connections to motors and other electrical equipment subject to movement, vibration, misalignment, cramped quarters, or noise transmission.
- B. Use liquid-tight flexible metal conduit for installation in exterior locations, moisture or humidity laden atmosphere, corrosive atmosphere, water or spray wash-down operations, inside airstream of HVAC units, and locations subject to seepage or dripping of oil, grease, or water. Provide a green equipment grounding conductor with flexible metal conduit.

3.9 EXPANSION JOINTS

- A. Conduits 3 in [75 mm] and larger that are secured to the building structure on opposite sides of a building expansion joint require expansion and deflection couplings. Install the couplings in accordance with the manufacturer's recommendations.
- B. Provide conduits smaller than 3 in [75 mm] with junction boxes on both sides of the expansion joint. Connect conduits to junction boxes with sufficient slack of flexible conduit to produce 5 in [125 mm] vertical drop midway between the ends. Flexible conduit shall have a bonding jumper installed. In lieu of this flexible conduit, expansion and deflection couplings as specified above for conduits 15 in [375 mm] and larger are acceptable.
- C. Install expansion and deflection couplings where shown.

3.10 CONDUIT SUPPORTS, INSTALLATION

- A. Safe working load shall not exceed one-quarter of proof test load of fastening devices.
- B. Use pipe straps or individual conduit hangers for supporting individual conduits.
- C. Support multiple conduit runs with trapeze hangers. Use trapeze hangers that are designed to support a load equal to or greater than the sum of the weights of the conduits, wires, hanger itself, and 200 lbs [90 kg]. Attach each conduit with U-bolts or other approved fasteners.
- D. Support conduit independently of junction boxes, pull-boxes, fixtures, suspended ceiling T-bars, angle supports, and similar items.
- E. Fasteners and Supports in Solid Masonry and Concrete:
 - 1. New Construction: Use steel or malleable iron concrete inserts set in place prior to placing the concrete.
 - 2. Existing Construction:
 - a. Steel expansion anchors not less than 0.25 in [6 mm] bolt size and not less than 1.125 in [28 mm] embedment.

- b. Power set fasteners not less than 0.25 in [6 mm] diameter with depth of penetration not less than 3 in [75 mm].
- c. Use vibration and shock-resistant anchors and fasteners for attaching to concrete ceilings.
- E. Hollow Masonry: Toggle bolts.
- F. Bolts supported only by plaster or gypsum wallboard are not acceptable.
- G. Metal Structures: Use machine screw fasteners or other devices specifically designed and approved for the application.
- H. Attachment by wood plugs, rawl plug, plastic, lead or soft metal anchors, or wood blocking and bolts supported only by plaster is prohibited.
- I. Chain, wire, or perforated strap shall not be used to support or fasten conduit.
- J. Spring steel type supports or fasteners are prohibited for all uses except horizontal and vertical supports/fasteners within walls.
- K. Vertical Supports: Vertical conduit runs shall have riser clamps and supports in accordance with the NEC and as shown. Provide supports for cable and wire with fittings that include internal wedges and retaining collars.

3.11 BOX INSTALLATION

- A. Boxes for Concealed Conduits:
 - 1. Flush-mounted.
 - 2. Provide raised covers for boxes to suit the wall or ceiling, construction, and finish.
- B. In addition to boxes shown, install additional boxes where needed to prevent damage to cables and wires during pulling-in operations.
- C. Remove only knockouts as required and plug unused openings. Use threaded plugs for cast metal boxes and snap-in metal covers for sheet metal boxes.
- D. Outlet boxes mounted back-to-back in the same wall are prohibited. A minimum 24 in [600 mm] center-to-center lateral spacing shall be maintained between boxes.
- E. Minimum size of outlet boxes for ground fault interrupter (GFI) receptacles is 4 in [100 mm] square x 2.125 in [55 mm] deep, with device covers for the wall material and thickness involved.
- F. Stencil or install phenolic nameplates on covers of the boxes identified on riser diagrams; for example "SIG-FA JB No. 1."
- G. On all branch circuit junction box covers, identify the circuits with black marker.

- - - E N D - - -

SECTION 26 05 41
UNDERGROUND ELECTRICAL CONSTRUCTION

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the furnishing, installation, and connection of precast manholes and pullboxes with ducts to form a complete underground raceway system.
- B. "Duct" and "conduit," and "rigid metal conduit" and "rigid steel conduit" are used interchangeably in this specification.

1.2 RELATED WORK

- A. Section 07 92 00, JOINT SEALANTS: Sealing of conduit penetrations.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits, fittings and boxes for raceway systems.
- E. Section 31 20 11, EARTH MOVING (Short Form): Trenching, backfill and compaction.

1.3 QUALITY ASSURANCE

- A. Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Coordinate layout and installation of ducts, manholes, pullboxes, and pull-boxes with final arrangement of other utilities, site grading, and surface features, as determined in the field.

1.4 SUBMITTALS

- A. Submit in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Shop Drawings:
 - 1. Clearly present sufficient information to determine compliance with drawings and specifications.
 - 2. Include manholes, pullboxes, duct materials, and hardware. Submit plan and elevation drawings, showing openings, pulling irons, cable supports, cover, ladder, sump, and other accessories and details.

3. Proposed deviations from details on the drawings shall be clearly marked on the submittals. If it is necessary to locate manholes or pullboxes at locations other than shown on the drawings, show the proposed locations accurately on scaled site drawings, and submit four copies to the COTR for approval prior to construction.
- C. Certifications: Two weeks prior to the final inspection, submit four copies of the following certifications to the COTR:
 1. Certification by the manufacturer that the materials conform to the requirements of the drawings and specifications.
 2. Certification by the contractor that the materials have been properly installed, connected, and tested.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American Concrete Institute (ACI):
 - Building Code Requirements for Structural Concrete
 - 318/318M-05.....Building Code Requirements for Structural Concrete & Commentary
 - SP-66-04.....ACI Detailing Manual
- C. American National Standards Institute (ANSI):
 - 77-07.....Underground Enclosure Integrity
- D. American Society for Testing and Materials (ASTM):
 - C478-09.....Standard Specification for Precast Reinforced Concrete Manhole Sections
 - C858-09.....Underground Precast Concrete Utility Structures
 - C990-09.....Standard Specification for Joints for Concrete Pipe, Manholes and Precast Box Sections Using Preformed Flexible Joint Sealants.
- E. Institute of Electrical and Electronic Engineers (IEEE):
 - C2-07National Electrical Safety Code
- F. National Electrical Manufacturers Association (NEMA):
 - TC 2-03.....Electrical Polyvinyl Chloride (PVC) Tubing And Conduit
 - TC 3-2004.....PVC Fittings for Use With Rigid PVC Conduit And Tubing

TC 6 & 8 2003.....PVC Plastic Utilities Duct For Underground
Installations

TC 9-2004.....Fittings For PVC Plastic Utilities Duct For
Underground Installation

G. National Fire Protection Association (NFPA):

70-08.....National Electrical Code (NEC)

H. Underwriters Laboratories, Inc. (UL):

6-07.....Electrical Rigid Metal Conduit-Steel

467-07.....Grounding and Bonding Equipment

651-05.....Schedule 40 and 80 Rigid PVC Conduit and
Fittings

651A-00.....Type EB and A Rigid PVC Conduit and HDPE
Conduit

651B-07.....Continuous Length HDPE Conduit

I. U.S. General Services Administration (GSA):

A-A-60005-1998.....Frames, Covers, Gratings, Steps, Sump and Catch
Basin, Manhole

1.6 STORAGE

Lift and support pre-cast concrete structures only at designated
lifting or supporting points.

PART 2 - PRODUCTS

2.1 PRE-CAST CONCRETE MANHOLES AND HARDWARE

A. Structure: Factory-fabricated, reinforced-concrete, monolithically-
poured walls and bottom. Frame and cover shall form top of manhole.
Comply with ASTM C 858.

B. Cable Supports:

1. Cable stanchions shall be hot-rolled, heavy duty, hot-dipped
galvanized "T" section steel, 2.25 in [56 mm] x 0.25 in [6 mm] in
size, and punched with 14 holes on 1.5 in [38 mm] centers for
attaching cable arms.
2. Cable arms shall be 0.1875 in [5 mm] gauge, hot-rolled, hot-dipped
galvanized sheet steel, pressed to channel shape. Arms shall be
approximately 2.5 in [63 mm] wide x 14 in [350 mm] long.
3. Insulators for cable supports shall be high-glazed, wet process
porcelain, and shall completely encircle the cable.
4. Equip each cable stanchion with two spare cable arms and six spare
insulators for future use.

- C. Ladder: Fiberglass with 16 in [400 mm] rung spacing. Provide securely-mounted ladder for every manhole over 4 ft [1.2 M] deep.
- D. Ground Rod Sleeve: Provide a 3 in [75 mm] PVC sleeve in manhole floors so that a driven ground rod may be installed.
- E. Sump: Provide 12 in x 12 in [305 mm x 305 mm] covered sump frame and cover.

2.2 PULLBOXES

- A. General: Size as indicated on drawings. Provide pullboxes with weatherproof, non-skid covers with recessed hook eyes, secured with corrosion- and tamper-resistant hardware. Cover material shall be identical to pullbox material. Covers shall have molded lettering, ELECTRIC or SIGNAL as applicable. Pullboxes shall comply with the requirements of ANSI/SCTE 77 Tier 5 loading. Provide pulling irons, 0.875 in [22 mm] diameter galvanized steel bar with exposed triangular-shaped opening.
- B. Polymer Concrete Pullboxes: Shall be molded of sand, aggregate, and polymer resin, and reinforced with steel, fiberglass, or both. Pullbox shall have open bottom.

2.3. DUCTS

- A. Number and sizes shall be as shown on drawings.
- B. Ducts (concrete-encased):
 - 1. Plastic Duct:
 - a. NEMA TC6 & 8 and TC9 plastic utilities duct UL 651 and 651A Schedule 40 PVC.
 - b. Duct shall be suitable for use with 194° F [90° C] rated conductors.
 - 2. Conduit Spacers: Prefabricated plastic.
- C. Ducts (direct-burial):
 - 1. Plastic duct:
 - a. NEMA TC2 and TC3
 - b. UL 651, 651A, and 651B, Schedule 80 PVC or HDPE.
 - c. Duct shall be suitable for use with 167° F [75° C] rated conductors.
 - 2. Rigid metal conduit: UL6 and NEMA RN1 galvanized rigid steel, threaded type, half-lapped with 10 mil PVC tape.

2.4 GROUNDING

A. Rods: Per Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.

B. Ground Wire: Stranded bare copper 6 AWG [16 mm²] minimum.

2.5 WARNING TAPE

Standard 4-mil polyethylene 3 in [76 mm] wide detectable tape, red with black letters, imprinted with "CAUTION - BURIED ELECTRIC CABLE BELOW" or similar.

2.6 PULL ROPE FOR SPARE DUCTS

Plastic with 200 lb [890 N] minimum tensile strength.

PART 3 - EXECUTION

3.1 MANHOLE AND PULLBOX INSTALLATION

A. Assembly and installation shall follow the printed instructions and recommendations of the manufacturer. Install manholes and pullboxes level and plumb.

1. Units shall be installed on a 12 in [300 mm] level bed of 90% compacted granular fill, well-graded from the 1 in [25 mm] sieve to the No. 4 sieve. Granular fill shall be compacted with a minimum of four passes with a plate compactor.

2. Seal duct terminations so they are watertight.

B. Access: Ensure the top of frames and covers are flush with finished grade.

C. Ground Rods in Manholes: Drive a ground rod into the earth, through the floor sleeve, after the manhole is set in place. Fill the sleeve with sealant to make a watertight seal. Rods shall protrude approximately 4 in [100 mm] above the manhole floor.

D. Grounding in Manholes:

1. Install a No. 3/0 AWG [95 mm²] bare copper ring grounding conductor around the inside perimeter of the manhole and anchor to the walls with metallic cable clips.

2. Connect the ring grounding conductor to the ground rod by an exothermic welding process.

3. Bond the ring grounding conductor to the duct bank equipment grounding conductors, the exposed non-current carrying metal parts of racks, sump covers, and like items in the manholes with a minimum No. 6 AWG [16 mm²] bare copper jumper.

3.2 TRENCHING

- A. Refer to Section 31 20 00, EARTH MOVING for trenching, backfilling, and compaction.
- B. Before performing trenching work at existing facilities, the Ground Penetrating Radar Survey shall be carefully performed by certified technician to reveal all existing underground ducts, conduits, cables, and other utility systems.
- C. Work with extreme care near existing ducts, conduits, cables, and other utilities to avoid damaging them.
- D. Cut the trenches neatly and uniformly.
- E. For Concrete-Encased Ducts:
 - 1. After excavation of the trench, stakes shall be driven in the bottom of the trench at 4 ft [1.2 M] intervals to establish the grade and route of the duct bank.
 - 2. Pitch the trenches uniformly toward manholes or both ways from high points between manholes for the required duct line drainage. Avoid pitching the ducts toward buildings wherever possible.
 - 3. The walls of the trench may be used to form the side walls of the duct bank, provided that the soil is self-supporting and that concrete envelope can be poured without soil inclusions. Forms are required where the soil is not self-supporting.
 - 4. After the concrete-encased duct has sufficiently cured, the trench shall be backfilled to grade with earth, and appropriate warning tape installed.
- F. Conduits to be installed under existing paved areas and roads that cannot be disturbed shall be jacked into place. Conduits shall be heavy wall rigid steel.

3.3 DUCT INSTALLATION

- A. General Requirements:
 - 1. Ducts shall be in accordance with the NEC and IEEE C2, as shown on the drawings, and as specified.
 - 2. Slope ducts to drain towards manholes and pullboxes, and away from building and equipment entrances. Pitch not less than 4 in [100 mm] in 100 ft [30 M].
 - 3. Underground conduit stub-ups and sweeps to equipment inside of buildings shall be taped galvanized rigid steel, and shall extend a minimum of 5 ft [1.5 M] outside the building foundation. Tops of conduits below building slab shall be minimum 24 in [610 mm] below bottom of slab.

4. Stub-ups, sweeps, and risers to equipment mounted on outdoor concrete slabs shall be taped galvanized rigid steel, and shall extend a minimum of 5 ft [1.5 M] away from the edge of slab.
5. Install insulated grounding bushings on the terminations.
6. Radius for turns of direction shall be sufficient to accomplish pulls without damage. Minimum radius shall be six times conduit diameter. Use manufactured long sweep bends.
7. Additional burial depth shall be required in order to accomplish NEC-required minimum bend radius of ducts.
8. All multiple conduit runs shall have conduit spacers. Spacers shall securely support and maintain uniform spacing of the duct assembly a minimum of 3 in [75 mm] above the bottom of the trench during the concrete pour. Spacer spacing shall not exceed 5 ft [1.5 M]. Secure spacers to ducts and earth to prevent floating during concrete pour. Provide nonferrous tie wires to prevent displacement of the ducts during pouring of concrete. Tie wires shall not act as substitute for spacers.
9. Duct lines shall be installed no less than 12 in [300 mm] from other utility systems, such as water, sewer, and chilled water.
10. Clearances between individual ducts:
 - a. For like services, not less than 3 in [75 mm].
 - b. For power and signal services, not less than 6 in [150 mm].
11. Duct lines shall terminate at window openings in manhole walls as shown on the drawings. All ducts shall be fitted with end bells.
12. Couple the ducts with proper couplings. Stagger couplings in rows and layers to ensure maximum strength and rigidity of the duct bank.
13. Keep ducts clean of earth, sand, or gravel, and seal with tapered plugs upon completion of each portion of the work.
14. Seal conduits, including spare conduits, at building entrances and at outdoor equipment terminations with a suitable compound to prevent entrance of moisture and gases.

B. Concrete-Encased Ducts and Conduits:

1. Install concrete-encased ducts for medium-voltage systems, low-voltage systems, and signal systems, unless otherwise shown on the drawings.

2. Duct lines shall consist of single or multiple duct assemblies encased in concrete. Ducts shall be uniform in size and material throughout the installation.
3. Tops of concrete-encased ducts shall be:
 - a. Not less than 24 in [600 mm] and not less than shown on the drawings, below finished grade.
 - b. Not less than 30 in [750 mm] and not less than shown on the drawings, below roads and other paved surfaces.
 - c. Conduits crossing under grade slab construction joints shall be installed a minimum of 4 ft [1.2 M] below slab.
4. Extend the concrete envelope encasing the ducts not less than 3 in [75 mm] beyond the outside walls of the outer ducts and conduits.
5. Within 10 ft [3 M] of building manhole and pullbox wall penetrations, install reinforcing steel bars at the top and bottom of each concrete envelope to provide protection against vertical shearing. Flare out concrete encasement at a 45 degree angle to create a wider 'neck' at concrete joint to manhole and pullbox. Dowel into edge of window and extend reinforcing bar into dowl prior to concrete placement. Roughen concrete face to achive strong bond with new concrete. Refer to Paragraph 3.3H, this section.
6. Install reinforcing steel bars at the top and bottom of each concrete envelope of all ducts underneath roadways and parking areas.
7. Where new ducts, conduits, and concrete envelopes are to be joined to existing manholes, pullboxes, ducts, conduits, and concrete envelopes, make the joints with the proper fittings and fabricate the concrete envelopes to ensure smooth durable transitions.
8. Conduit joints in concrete may be placed side by side horizontally, but shall be staggered at least 6 in [150 mm] vertically.
9. Pour each run of concrete envelope between manholes or other terminations in one continuous pour. If more than one pour is necessary, terminate each pour in a vertical plane and install 0.75 in [19 mm] reinforcing rod dowels extending 18 in [450 mm] into concrete on both sides of joint near corners of envelope.
10. Pour concrete so that open spaces are uniformly filled. Do not agitate with power equipment unless approved by COTR.

11. Duct Bank Markers:

- a. Duct bank markers, where required and shown on plans, shall be located at the ends of duct banks except at manholes or pullboxes at approximately every 200 ft [60 M] along the duct run and at each change in direction of the duct run. Markers shall be placed 2 ft [0.6 M] to the right of the duct bank, facing the longitudinal axis of the run in the direction of the electrical load.
- b. The letter "D" with two arrows shall be impressed or cast on top of the marker. One arrow shall be located below the letter and shall point toward the ducts. The second arrow shall be located adjacent to the letter and shall point in a direction parallel to the ducts. The letter and arrow adjacent to it shall each be approximately 2 in [75 mm] long. The letter and arrows shall be V-shaped, and shall have a width of stroke at least 0.75 in [6 mm] at the top and a depth of 0.25 in [6 mm].
- c. In paved areas, the top of the duct markers shall be flush with the finished surface of the paving.
- d. Where the duct bank changes direction, the arrow located adjacent to the letter shall be cast or impressed with an angle in the arrow equivalent to the angular change of the duct bank.

C. Direct-Burial Duct and Conduits:

1. Install direct-burial ducts and conduits only where shown on the drawings. Provide direct-burial ducts only for low-voltage systems.
2. Join and terminate ducts and conduits with fittings recommended by the conduit manufacturer.
3. Tops of ducts and conduits shall be:
 - a. Not less than 24 in [600 mm] and not less than shown on the drawings, below finished grade.
 - b. Not less than 30 in [750 mm] and not less than shown on the drawings, below roads and other paved surfaces.
4. Do not kink the ducts or conduits. Compaction shall not deform the ducts.

D. Concrete-Encased and Direct-Burial Duct and Conduit Identification:

Place continuous strip of warning tape approximately 12 in [300 mm] above ducts or conduits before backfilling trenches. Warning tape shall be preprinted with proper identification.

- E. Spare Ducts and Conduits: Where spare ducts are shown, they shall have a nylon pull rope installed. They shall be capped at each end and labeled as to location of the other end.
- F. Duct and Conduit Cleaning:
1. Upon completion of the duct installation, a standard flexible mandrel shall be pulled through each duct to loosen particles of earth, sand, or foreign material left in the duct. The mandrel shall be not less than 12 in [3600 mm] long, and shall have a diameter not less than 0.5 in [13 mm] less than the inside diameter of the duct. A brush with stiff bristles shall then be pulled through each duct to remove the loosened particles. The diameter of the brush shall be the same as, or slightly larger than, the diameter of the duct.
 2. Mandrel pulls shall be witnessed by the COTR.
- G. Duct and Conduit Sealing: Seal the ducts and conduits at building entrances, and at outdoor terminations for equipment, with a suitable non-hardening compound to prevent the entrance of moisture and gases.
- H. Connections to Manholes: Ducts connecting to manholes shall be flared to have an enlarged cross-section to provide additional shear strength. Dimensions of the flared cross-section shall be larger than the corresponding manhole opening dimensions by no less than 12 in [300 mm] in each direction. Perimeter of the duct bank opening in the underground structure shall be flared toward the inside or keyed to provide a positive interlock between the duct and the wall of the manhole. Use vibrators when this portion of the encasement is poured to ensure a seal between the envelope and the wall of the structure.
- I. Connections to Existing Manholes: For duct connections to existing manholes, break the structure wall out to the dimensions required and preserve the steel in the structure wall. Cut steel and extend into the duct bank envelope. Chip the perimeter surface of the duct bank opening to form a key or flared surface, providing a positive connection with the duct bank envelope.
- J. Connections to Existing Ducts: Where connections to existing duct banks are indicated, excavate around the duct banks as necessary. Cut off the ducts and remove loose concrete from inside before installing new ducts. Provide a reinforced-concrete collar, poured monolithically with the new ducts, to take the shear at the joint of the duct banks.
- K. Partially-Completed Duct Banks: During construction, wherever a construction joint is necessary in a duct bank, prevent debris such as

mud and dirt from entering ducts by providing suitable conduit plugs.
Fit concrete envelope of a partially completed duct bank with
reinforcing steel extending a minimum of 2 ft [0.6 M] back into the
envelope and a minimum of 2 ft [0.6 M] beyond the end of the envelope.
Provide one No. 4 bar in each corner, 3 in [75 mm] from the edge of the
envelope. Secure corner bars with two No. 3 ties, spaced approximately
12 in [300 mm] apart. Restrain reinforcing assembly from moving during
pouring of concrete.

- - - E N D - - -

**SECTION 260574 - SHORT CIRCUIT AND OVERCURRENT PROTECTIVE DEVICE COORDINATION
STUDY AND ARC FLASH HAZARD ANALYSIS**

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes computer-based, fault-current and overcurrent protective device coordination studies. Protective devices shall be set based on results of the protective device coordination study.
- B. This section also includes the furnishing of an Arc Flash Hazard Analysis Study and provision of Arc Flash labels for all equipment per the requirements set forth in NFPA 70E - Standard for Electrical Safety in the Workplace. The arc flash hazard analysis shall be performed according to the IEEE 1584 equations that are presented in NFPA70E-2004, Annex D.

1.2 QUALITY ASSURANCE

- A. Studies shall use computer programs that are distributed nationally and are in wide use. Software algorithms shall comply with requirements of standards and guides specified in this Section. Manual calculations are not acceptable.
- B. Coordination-Study Specialist Qualifications: An entity experienced in the application of computer software used for studies, having performed successful studies of similar magnitude on electrical distribution systems using similar devices.
 - 1. Professional engineer, licensed in the state where Project is located, shall be responsible for the study. All elements of the study shall be performed under the direct supervision and control of the engineer. All documentation shall be signed and sealed by the Professional Engineer.
- C. Institute of Electrical and Electronics Engineers, Inc. (IEEE):
 - 1. IEEE 141 - Recommended Practice for Electric Power Distribution and Coordination of Industrial and Commercial Power Systems.
 - 2. IEEE 242 - Recommended Practice for Protection and Coordination of Industrial and Commercial Power Systems.
 - 3. IEEE 399 - Recommended Practice for Industrial and Commercial Power System Analysis.
 - 4. IEEE 241 - Recommended Practice for Electric Power Systems in Commercial Buildings.
 - 5. IEEE 1015 - Recommended Practice for Applying Low-Voltage Circuit Breakers Used in Industrial and Commercial Power Systems.
 - 6. IEEE 1584 - Guide for Performing Arc-Flash Hazard Calculations
- D. American National Standards Institute (ANSI):
 - 1. ANSI C57.12.00.
 - 2. ANSI C37.13.
 - 3. ANSI C37.010.

4. ANSI C 37.41.
5. ANSI C57.12.10.
6. ANSI C57.12.22.
7. ANSI C57.12.40.
8. IEEE C57.12.00.
9. IEEE C57.96.
10. IEEE 1015
11. IEEE C37.20.1.
12. IEEE C37.46.

- E. The National Fire Protection Association (NFPA)
1. NFPA 70 - National Electrical Code, latest edition.
 2. NFPA 70E - Standard for Electrical Safety in the Workplace, latest edition.

1.3 SUBMITTALS

- A. Product Data: For computer software program to be used for studies.
- B. Product Certificates: For coordination-study and fault-current-study computer software programs, certifying compliance with IEEE 399.
- C. Qualification Data: For coordination-study specialist.
- D. The results of the short-circuit, protective device coordination and arc flash hazard analysis studies shall be summarized in a final report. The contractor is required to provide the study project files and report in hard copy and electronic format.
- E. The report shall include the following sections:
1. Cover Page and Engineer's seal.
 2. Executive Summary.
 3. Descriptions, purpose, basis and scope of the study.
 4. A definition of terms and guide for interpretation of the computer printout.
 5. Equipment Evaluation Summary Tables.
 6. Color One-line diagram; minimum 11" x 17". If all device tags are illegible on minimum size sheet, one-line shall be submitted on larger format paper.
 7. Input data tables shall include, but not be limited to the following:
 - a. Feeder input data including feeder type (cable or bus), size, length, number per phase, conduit type (magnetic or non-magnetic) and conductor material (copper or aluminum).
 - b. Transformer input data, including winding connections, secondary neutral-ground connection, primary and secondary voltage ratings, kVA rating, impedance, % taps and phase shift.
 - c. Reactor data, including voltage rating, and impedance.
 - d. Generation contribution data, (synchronous generators and Utility), including short-circuit reactance (X''_d), rated MVA, rated voltage, three-phase and single line-ground contribution (for Utility sources) and X/R ratio.

- e. Motor contribution data (induction motors and synchronous motors), including short circuit reactance, rated horsepower or kVA, rated voltage, and X/R ratio.
- 8. Short-Circuit Output Data shall include, but not be limited to the following reports:
 - a. Low Voltage Fault Report shall include a section for three-phase and unbalanced fault calculations and shall show the following information for each applicable location:
 - 1) Voltage.
 - 2) Calculated fault current magnitude and angle.
 - 3) Fault point X/R ratio.
 - 4) Equivalent impedance.
 - b. Momentary Duty Report shall include a section for three-phase and unbalanced fault calculations and shall show the following information for each applicable location:
 - 1) Voltage.
 - 2) Calculated symmetrical fault current magnitude and angle.
 - 3) Fault point X/R ratio.
 - 4) Calculated asymmetrical fault currents:
 - a) Based on fault point X/R ratio.
 - b) Based on calculated symmetrical value multiplied by 1.6.
 - c) Based on calculated symmetrical value multiplied by 2.7.
 - 5) Equivalent impedance.
 - c. Interrupting Duty Report shall include a section for three-phase and unbalanced fault calculations and shall show the following information for each applicable location:
 - 1) Voltage.
 - 2) Calculated symmetrical fault current magnitude and angle.
 - 3) Fault point X/R ratio.
 - 4) No AC Decrement (NACD) Ratio.
 - 5) Equivalent impedance.
 - 6) Multiplying factors for 2, 3, 5 and 8 cycle circuit breakers rated on a symmetrical basis.
 - 7) Multiplying factors for 2, 3, 5 and 8 cycle circuit breakers rated on a total basis.
- 9. Recommended Protective Device Settings:
 - a. Phase and Ground Relays:
 - 1) Current transformer ratio.
 - 2) Current setting.
 - 3) Time setting.
 - 4) Instantaneous setting.
 - 5) Recommendations on improved relaying systems, if applicable.
 - b. Circuit Breakers:
 - 1) Adjustable pickups and time delays (long time, short time, ground).
 - 2) Adjustable time-current characteristic.
 - 3) Adjustable instantaneous pickup.
 - 4) Recommendations on improved trip systems, if applicable.
- 10. Coordination Curves: Prepared to determine settings of overcurrent protective devices to achieve selective coordination. Maximum number of overcurrent devices per time current curve

- (TCC) is three (3). Prepare separate sets of curves for all possible switching schemes and for emergency periods where the power source is local generation (if applicable). Provide phase and ground fault protection curves for all aforementioned scenarios. All curves shall be submitted in color for clarity.
11. Incident energy and flash protection boundary calculations:
 - a. Arcing fault magnitude.
 - b. Protective device clearing time.
 - c. Duration of arc.
 - d. Arc flash boundary.
 - e. Working distance.
 - f. Incident energy.
 - g. Hazard Risk Category.
 - h. Recommendations for arc flash energy reduction.
 12. Arc flash labels shall be provided in color hard copy only.
- F. One final complete system study shall be performed after installation and final adjustment to all equipment. Final study and report shall incorporate all changes made in the field to the electrical distribution system and should be based on "As Built" conditions. Final submittals shall include all report parameters listed above as well as an electronic copy of the model for the Owner's use.

PART 2 - PRODUCTS

2.1 COMPUTER SOFTWARE DEVELOPERS

- A. Computer Software: Subject to compliance with requirements, produce study with the following software package:
1. ETAP
 2. EDSA Micro Corporation.
 3. SKM Systems Analysis, Inc.

2.2 COMPUTER SOFTWARE PROGRAM REQUIREMENTS

- A. Comply with IEEE 399.
- B. Analytical features of fault-current-study computer software program shall include "mandatory," "very desirable," and "desirable" features as listed in IEEE 399.
- C. Computer software program shall be capable of plotting and diagramming time-current-characteristic curves as part of its output. Computer software program shall report device settings and ratings of all overcurrent protective devices and shall demonstrate selective coordination by computer-generated, time-current coordination plots.
1. Optional Features:
 - a. Arcing faults.
 - b. Simultaneous faults.
 - c. Explicit negative sequence.
 - d. Mutual coupling in zero sequence.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine Project overcurrent protective device submittals for compliance with electrical distribution system coordination requirements and other conditions affecting performance. Devices to be coordinated are indicated on Drawings.
 - 1. Proceed with coordination study only after relevant equipment submittals have been assembled and approved. Overcurrent protective devices that have not been submitted and approved prior to coordination study may not be used in study.

3.2 POWER SYSTEM DATA

- A. Gather and tabulate the following input data to support coordination study:
 - 1. Product Data for overcurrent protective devices specified in other Division 26 Sections and involved in overcurrent protective device coordination studies. Use equipment designation tags that are consistent with electrical distribution system diagrams, overcurrent protective device submittals, input and output data, and recommended device settings.
 - 2. Impedance of utility service entrance.
 - 3. Electrical Distribution System Diagram: In hard-copy and electronic-copy formats, showing the following:
 - a. Circuit-breaker and fuse-current ratings and types.
 - b. Relays and associated power and current transformer ratings and ratios.
 - c. Transformer kilovolt amperes, primary and secondary voltages, connection type, impedance, and X/R ratios.
 - d. Generator kilovolt amperes, size, voltage, and source impedance.
 - e. Cables: Indicate conduit material, sizes of conductors, conductor material, insulation, and length.
 - f. Busway ampacity and impedance.
 - g. Motor horsepower and code letter designation according to NEMA MG 1.
 - 4. Data sheets to supplement electrical distribution system diagram, cross-referenced with tag numbers on diagram, showing the following:
 - a. Special load considerations, including starting inrush currents and frequent starting and stopping.
 - b. Transformer characteristics, including primary protective device, magnetic inrush current, and overload capability.
 - c. Motor full-load current, locked rotor current, service factor, starting time, type of start, and thermal-damage curve.
 - d. Generator thermal-damage curve.
 - e. Ratings, types, and settings of utility company's overcurrent protective devices.
 - f. Special overcurrent protective device settings or types stipulated by utility company.

- g. Time-current-characteristic curves of devices indicated to be coordinated.
- h. Manufacturer, frame size, interrupting rating in amperes rms symmetrical, ampere or current sensor rating, long-time adjustment range, short-time adjustment range, and instantaneous adjustment range for circuit breakers.
- i. Manufacturer and type, ampere-tap adjustment range, time-delay adjustment range, instantaneous attachment adjustment range, and current transformer ratio for overcurrent relays.
- j. Panelboards, switchboards, motor-control center ampacity, and interrupting rating in amperes rms symmetrical.

3.3 FAULT-CURRENT STUDY AND PROTECTIVE DEVICE EVALUATION STUDY

- A. Use actual conductor impedances if known. If unknown, use typical conductor impedances based on IEEE Standard 141-1993.
- B. Transformer design impedances shall be used when test impedances are not available.
- C. Provide the following:
 - 1. Calculation methods and assumptions.
 - 2. Selected base per unit quantities.
 - 3. One-line diagram of the system being evaluated.
 - 4. Source impedance data, including electric utility system and motor fault contribution characteristics.
 - 5. Tabulations of calculated quantities.
 - 6. Results, conclusions, and recommendations.
- D. Calculate short-circuit momentary and interrupting duties for a three-phase bolted fault at each:
 - 1. Electric utility's supply termination point.
 - 2. Incoming switchgear.
 - 3. Unit substation primary and secondary terminals.
 - 4. Low voltage switchgear.
 - 5. Motor control centers.
 - 6. Standby generators and automatic transfer switches.
 - 7. Branch circuit panelboards.
 - 8. Other significant locations throughout the system.
- E. For grounded systems, provide a bolted line-to-ground fault current study for areas as defined for the three-phase bolted fault short-circuit study.
- F. Protective Device Evaluation:
 - 1. Evaluate equipment and protective devices and compare to short circuit ratings
 - 2. Adequacy of switchgear, motor control centers, and panelboard bus bars to withstand short-circuit stresses.
 - 3. For 600-V overcurrent protective devices, ensure that interrupting ratings are equal to or higher than calculated 1/2-cycle symmetrical fault current.

4. For devices and equipment rated for asymmetrical fault current, apply multiplication factors listed in the standards to 1/2-cycle symmetrical fault current.
 5. Verify adequacy of phase conductors at maximum three-phase bolted fault currents; verify adequacy of equipment grounding conductors and grounding electrode conductors at maximum ground-fault currents. Ensure that short-circuit withstand ratings are equal to or higher than calculated 1/2-cycle symmetrical fault current.
- G. Study electrical distribution system from normal and alternate power sources throughout electrical distribution system for Project. Include studies of system-switching configurations and alternate operations that could result in maximum fault conditions.
- H. Calculate momentary and interrupting duties on the basis of maximum available fault current under both normal and emergency scenarios.
- I. Calculations to verify interrupting ratings of overcurrent protective devices shall comply with IEEE 141 and IEEE 242.

3.4 COORDINATION STUDY

- A. Perform coordination study using approved computer software program. Prepare a written report using results of fault-current study. Comply with IEEE 399.
1. Calculate the maximum and minimum 1/2-cycle short-circuit currents.
 2. Calculate the maximum and minimum interrupting duty (5 cycles to 2 seconds) short-circuit currents.
 3. Calculate the maximum and minimum ground-fault currents.
- B. Comply with IEEE 141 recommendations for fault currents and time intervals.
- C. Proposed protective device coordination time-current curves (TCC) shall be displayed on color log-log scale graphs.
- D. Include on each TCC graph, a complete title and one-line diagram with legend identifying the specific portion of the system covered.
- E. Terminate device characteristic curves at a point reflecting maximum symmetrical or asymmetrical fault current to which the device is exposed.
- F. Identify the device associated with each curve by manufacturer type, function, and, if applicable, tap, time delay, and instantaneous settings recommended.
- G. Motors served by voltages more than 600 V shall be protected according to IEEE 620.
- H. Conductor Protection: Protect cables against damage from fault currents according to ICEA P-32-382, ICEA P-45-482, and conductor melting curves in IEEE 242. Demonstrate that equipment withstands the

maximum short-circuit current for a time equivalent to the tripping time of the primary relay protection or total clearing time of the fuse. To determine temperatures that damage insulation, use curves from cable manufacturers or from listed standards indicating conductor size and short-circuit current.

- I. Coordination-Study Report: Prepare a written report indicating the following results of coordination study:
 1. Tabular Format of Settings Selected for Overcurrent Protective Devices:
 - a. Device tag.
 - b. Relay-current transformer ratios; and tap, time-dial, and instantaneous-pickup values.
 - c. Circuit-breaker sensor rating; and long-time, short-time, and instantaneous settings.
 - d. Fuse-current rating and type.
 - e. Ground-fault relay-pickup and time-delay settings.
 2. Coordination Curves: Prepared to determine settings of overcurrent protective devices to achieve selective coordination. Graphically illustrate that adequate time separation exists between devices installed in series, including power utility company's upstream devices. Maximum number of overcurrent devices per time current curve (TCC) is three (3). Prepare separate sets of curves for all possible switching schemes and for emergency periods where the power source is local generation (if applicable). Provide phase and ground fault protection curves for all aforementioned scenarios. All curves shall be submitted in color for clarity. Show the following information:
 - a. Device tag.
 - b. Voltage and current ratio for curves.
 - c. Three-phase and single-phase damage points for each transformer.
 - d. No damage, melting, and clearing curves for fuses.
 - e. Cable damage curves.
 - f. Transformer inrush points.
 - g. Maximum fault-current cutoff point.
 3. Plot the following characteristics on the TCC graphs, where applicable:
 - a. Electric utility's overcurrent protective device.
 - b. Medium voltage equipment overcurrent relays.
 - c. Medium and low voltage fuses including manufacturer's minimum melt, total clearing, tolerance, and damage bands.
 - d. Low voltage equipment circuit breaker trip devices, including manufacturer's tolerance bands.
 - e. Conductor damage curves.
 - f. Ground fault protective devices, as applicable.
 - g. Pertinent motor starting characteristics and motor damage points, where applicable.
 - h. Pertinent generator short-circuit decrement curve and generator damage point.
 - i. The largest feeder circuit breaker in each motor control center and applicable panelboard.
 - j. Provide adequate time margins between device characteristics such that selective operation is provided, while providing proper protection.

- k. Transformer full-load current, magnetizing inrush current, and ANSI through-fault protection curves.
 - l. Transformer Primary Overcurrent Protective Devices:
 - 1) Device shall not operate in response to the following:
 - a) Inrush current when first energized.
 - b) Self-cooled, full-load current or forced-air-cooled, full-load current, whichever is specified for that transformer.
 - c) Permissible transformer overloads according to IEEE C57.96 if required by unusual loading or emergency conditions.
 - 2) Device settings shall protect transformers according to IEEE C57.12.00, for fault currents.
- J. Completed data sheets for setting of overcurrent protective devices.

3.5 ARC FLASH HAZARD ANALYSIS

- A. The arc flash hazard analysis shall be performed according to the IEEE 1584 equations that are presented in NFPA70E-2004, Annex D.
- B. The flash protection boundary and the incident energy shall be calculated at all significant locations in the electrical distribution system (switchboards, switchgear, motor-control centers, panelboards, busway and splitters) where work could be performed on energized parts.
- C. The Arc-Flash Hazard Analysis shall include all significant locations in 240 volt and 208 volt systems fed from transformers equal to or greater than 75 kVA where work could be performed on energized parts.
- D. Safe working distances shall be based upon the calculated arc flash boundary considering an incident energy of 1.2 cal/cm².
- E. When appropriate, the short circuit calculations and the clearing times of the phase overcurrent devices will be retrieved from the short-circuit and coordination study model. Ground overcurrent relays should not be taken into consideration when determining the clearing time when performing incident energy calculations.
- F. The short-circuit calculations and the corresponding incident energy calculations for multiple system scenarios must be compared and the greatest incident energy must be uniquely reported for each equipment location. Calculations must be performed to represent the maximum and minimum contributions of fault current magnitude for all normal and emergency operating conditions. The minimum calculation will assume that the utility contribution is at a minimum and will assume a minimum motor contribution (all motors off). Conversely, the maximum calculation will assume a maximum contribution from the utility and will assume the maximum amount of motors to be operating. Calculations shall take into consideration the parallel operation of synchronous generators with the electric utility, where applicable.

- G. The incident energy calculations must consider the accumulation of energy over time when performing arc flash calculations on buses with multiple sources. Iterative calculations must take into account the changing current contributions, as the sources are interrupted or decremented with time. Fault contribution from motors and generators should be decremented as follows:
 - 1. Fault contribution from induction motors should not be considered beyond 3-5 cycles.
 - 2. Fault contribution from synchronous motors and generators should be decayed to match the actual decrement of each as closely as possible (e.g. contributions from permanent magnet generators will typically decay from 10 per unit to 3 per unit after 10 cycles).
- H. For each equipment location with a separately enclosed main device (where there is adequate separation between the line side terminals of the main protective device and the work location), calculations for incident energy and flash protection boundary shall include both the line and load side of the main breaker.
- I. When performing incident energy calculations on the line side of a main breaker (as required per above), the line side and load side contributions must be included in the fault calculation.
- J. Mis-coordination should be checked amongst all devices within the branch containing the immediate protective device upstream of the calculation location and the calculation should utilize the fastest device to compute the incident energy for the corresponding location.
- K. Arc Flash calculations shall be based on actual overcurrent protective device clearing time. Maximum clearing time will be capped at 2 seconds based on IEEE 1584-2002 section B.1.2. Where it is not physically possible to move outside of the flash protection boundary in less than 2 seconds during an arc flash event, a maximum clearing time based on the specific location shall be utilized.

3.6 FIELD ADJUSTMENT

- A. Adjust relay and protective device settings according to the recommended settings table provided by the coordination study. Field adjustments to be completed by the engineering service division of the equipment manufacturer under the Startup and Acceptance Testing contract portion.
- B. Make minor modifications to equipment as required to accomplish conformance with short circuit and protective device coordination studies.
- C. Notify Owner in writing of any required major equipment modifications.

3.7 ARC FLASH WARNING LABELS

- A. The contractor of the Arc Flash Hazard Analysis shall provide a 3.5 in. x 5 in. thermal transfer type label of high adhesion polyester for each work location analyzed.
- B. All labels will be based on recommended overcurrent device settings and will be provided after the results of the analysis have been presented to the owner and after any system changes, upgrades or modifications have been incorporated in the system.
- C. The label shall include the following information, at a minimum:
 - 1. Location designation.
 - 2. Nominal voltage.
 - 3. Flash protection boundary.
 - 4. Hazard risk category.
 - 5. Incident energy.
 - 6. Working distance.
 - 7. Recommended PPE.
 - 8. Engineering report number, revision number and issue date.
- D. Labels shall be machine printed, with no field markings.
- E. Arc flash labels shall be provided in the following manner and all labels shall be based on recommended overcurrent device settings and calculated incident energy level.
 - 1. For each 600, 480 and 208 volt panelboard, one arc flash label shall be provided.
 - 2. For each motor control center, one arc flash label shall be provided.
 - 3. For each low voltage switchboard, one arc flash label shall be provided.
 - 4. For each switchgear lineup, one arc flash label shall be provided per breaker position.
 - 5. For each low voltage panelboard, one arc flash label shall be provided.
 - 6. For medium voltage switches one arc flash label shall be provided.
 - 7. Labels shall be field installed by the engineering service division of the equipment manufacturer and field verified by Electrical Engineer responsible for study.

3.8 ARC FLASH TRAINING

- A. The manufacturer of the equipment shall train the owner's qualified electrical personnel of the potential arc flash hazards associated with working on energized equipment (minimum of 4 hours). The training shall be certified for continuing education units (CEUs) by the International Association for Continuing Education Training (IACET) or equivalent.

END OF SECTION 260574

SECTION 26 08 00
COMMISSIONING OF ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. The requirements of this Section apply to all sections of Division 26.
- B. This project will have selected building systems commissioned. The complete list of equipment and systems to be commissioned are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. The commissioning process, which the Contractor is responsible to execute, is defined in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. A Commissioning Agent (CxA) appointed by the Department of Veterans Affairs will manage the commissioning process.

1.2 RELATED WORK

- A. Section 01 00 00 GENERAL REQUIREMENTS.
- B. Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.
- C. Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

1.3 SUMMARY

- A. This Section includes requirements for commissioning the electrical systems, subsystems and equipment. This Section supplements the general requirements specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.
- B. The commissioning activities have been developed to support the VA requirements to meet guidelines for Federal Leadership in Environmental, Energy, and Economic Performance.
- C. The commissioning activities have been developed to support the Green Globes rating program and to support delivery of project performance in accordance with the Contract Documents developed with the approval of the VA.
 - 1. Commissioning activities and documentation for the LEED™ section on "Energy and Atmosphere" prerequisite of "Fundamental Building Systems Commissioning".
 - 2. Commissioning activities and documentation for the LEED™ section on "Energy and Atmosphere" requirements for the "Enhanced Building System Commissioning" credit.
 - 3. Activities and documentation for the LEED™ section on "Measurement and Verification" requirements for the Measurement and Verification credit.

- D. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for more specifics regarding processes and procedures as well as roles and responsibilities for all Commissioning Team members.

1.4 DEFINITIONS

- A. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for definitions.

1.5 COMMISSIONED SYSTEMS

- A. Commissioning of a system or systems specified in this Division is part of the construction process. Documentation and testing of these systems, as well as training of the VA's Operation and Maintenance personnel, is required in cooperation with the VA and the Commissioning Agent.
- B. The following Electrical systems will be commissioned:
1. Service Entrance Switchgear (Fuses and circuit breaker settings, metering, mimic diagram, gages, and controls).
 2. Service Entrance Transformer (Transformers and tap settings, fuses and circuit breaker settings, metering, gages, and controls).
 3. Normal Power Distribution Systems (Grounding tests, coordination study review, major circuit breaker settings, meters and gages, and controls).
 4. Lighting Controls (Control system hardware and software, scene settings, zone settings, occupancy sensor interface, and unoccupied cycle control).

1.6 SUBMITTALS

- A. The commissioning process requires review of selected Submittals. The Commissioning Agent will provide a list of submittals that will be reviewed by the Commissioning Agent. This list will be reviewed and approved by the Resident Engineer prior to forwarding to the Contractor. Refer to Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, and SAMPLES for further details.
- B. The commissioning process requires Submittal review simultaneously with engineering review. Specific submittal requirements related to the commissioning process are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

PART 2 - PRODUCTS (NOT USED)

PART 3 - EXECUTION

3.1 PRE-FUNCTIONAL CHECKLISTS

- A. The Contractor shall complete Pre-Functional Checklists to verify systems, subsystems, and equipment installation is complete and systems are ready for Systems Functional Performance Testing. The Commissioning Agent will prepare Pre-Functional Checklists to be used to document equipment installation. The Contractor shall complete the checklists. Completed checklists shall be submitted to the VA and to the Commissioning Agent for review. The Commissioning Agent may spot check a sample of completed checklists. If the Commissioning Agent determines that the information provided on the checklist is not accurate, the Commissioning Agent will return the marked-up checklist to the Contractor for correction and resubmission. If the Commissioning Agent determines that a significant number of completed checklists for similar equipment are not accurate, the Commissioning Agent will select a broader sample of checklists for review. If the Commissioning Agent determines that a significant number of the broader sample of checklists is also inaccurate, all the checklists for the type of equipment will be returned to the Contractor for correction and resubmission. Refer to SECTION 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for submittal requirements for Pre-Functional Checklists, Equipment Startup Reports, and other commissioning documents.

3.2 CONTRACTORS TESTS

- A. Contractor tests as required by other sections of Division 26 shall be scheduled and documented in accordance with Section 01 00 00 GENERAL REQUIREMENTS. The Commissioning Agent will witness selected Contractor tests. Contractor tests shall be completed prior to scheduling Systems Functional Performance Testing.

3.3 SYSTEMS FUNCTIONAL PERFORMANCE TESTING:

- A. The Commissioning Process includes Systems Functional Performance Testing that is intended to test systems functional performance under steady state conditions, to test system reaction to changes in operating conditions, and system performance under emergency conditions. The Commissioning Agent will prepare detailed Systems Functional Performance Test procedures for review and approval by the Resident Engineer. The Contractor shall review and comment on the tests prior to approval. The Contractor shall provide the required

labor, materials, and test equipment identified in the test procedure to perform the tests. The Commissioning Agent will witness and document the testing. The Contractor shall sign the test reports to verify tests were performed. See Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS, for additional details.

3.4 TRAINING OF VA PERSONNEL

- A. Training of the VA's operation and maintenance personnel is required in cooperation with the Resident Engineer and Commissioning Agent. Provide competent, factory authorized personnel to provide instruction to operation and maintenance personnel concerning the location, operation, and troubleshooting of the installed systems. The instruction shall be scheduled in coordination with the Resident Engineer after submission and approval of formal training plans. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS and Division 26 Sections for additional Contractor training requirements.

----- END -----

SECTION 26 09 23
LIGHTING CONTROLS

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation and connection of the lighting controls.

1.2 RELATED WORK

- A. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Interface of lighting controls with HVAC control systems.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General requirements that are common to more than one section of Division 26.
- C. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Cables and wiring.
- D. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.
- E. Section 24 26 16, PANELBOARDS: panelboard enclosure and interior bussing used for lighting control panels.
- F. Section 26 27 26, WIRING DEVICES: Wiring devices used for control of the lighting systems.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Product Data: For each type of lighting control, submit the following information.
 - 1. Manufacturer's catalog data.
 - 2. Wiring schematic and connection diagram.
 - 3. Installation details.
- C. Manuals:
 - 1. Submit, simultaneously with the shop drawings companion copies of complete maintenance and operating manuals including technical data sheets, and information for ordering replacement parts.
 - 2. Two weeks prior to the final inspection, submit four copies of the final updated maintenance and operating manuals, including any changes, to the Resident Engineer.
- D. Certifications:

1. Two weeks prior to final inspection, submit four copies of the following certifications to the Resident Engineer:
 - a. Certification by the Contractor that the equipment has been properly installed, adjusted, and tested.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. Green Seal (GS):
GC-12.....Occupancy Sensors
- C. Illuminating Engineering Society of North America (IESNA):
IESNA LM-48.....Guide for Calibration of Photoelectric Control Devices
- D. National Electrical Manufacturer's Association (NEMA)
C136.10.....American National Standard for Roadway Lighting Equipment-Locking-Type Photocontrol Devices and Mating Receptacles - Physical and Electrical Interchangeability and Testing
ICS-1.....Standard for Industrial Control and Systems General Requirements
ICS-2.....Standard for Industrial Control and Systems: Controllers, Contractors, and Overload Relays Rated Not More than 2000 Volts AC or 750 Volts DC: Part 8 - Disconnect Devices for Use in Industrial Control Equipment
ICS-6.....Standard for Industrial Controls and Systems Enclosures
- E. Underwriters Laboratories, Inc. (UL):
20.....Standard for General-Use Snap Switches
773.....Standard for Plug-In Locking Type Photocontrols for Use with Area Lighting
773ANonindustrial Photoelectric Switches for Lighting Control
98.....Enclosed and Dead-Front Switches
917.....Clock Operated Switches

PART 2 - PRODUCTS

2.1 ELECTRONIC TIME SWITCHES

- A. Electronic, solid-state programmable units with alphanumeric display; complying with UL 917.
 1. Contact Configuration: DPDT.

2. Contact Rating: 12 relays at 30-A, 120/277V Maximum, power supply 120/277V.
3. Astronomical Clock: Capable of switching a load on at sunset and off at sunrise, and automatically changing the settings each day in accordance with seasonal changes of sunset and sunrise. Additionally, it shall be programmable to a fixed on/off weekly schedule.
4. Battery Backup: For schedules and time clock.

2.2 ELECTROMECHANICAL-DIAL TIME SWITCHES

- A. Electromechanical-dial time switches; complying with UL 917.
 1. Contact Configuration: DPDT.
 2. Contact Rating: 30-A inductive or resistive, 240-V ac.
 3. Wound-spring reserve carryover mechanism to keep time during power failures.

2.3 OUTDOOR PHOTOELECTRIC SWITCHES

- A. Solid state, with SPST or DPST dry contacts rated for 1800 VA tungsten or 1000 VA inductive, complying with UL 773A.
 1. Light-Level Monitoring Range: 1.5 to 10 fc [16.14 to 108 lx], with adjustable turn-on and turn-off levels.
 2. Time Delay: 15-second minimum.
 3. Surge Protection: Metal-oxide varistor.
 4. Mounting: Twist lock, with base-and-stem mounting or stem-and-swivel mounting accessories as required.

2.4 TIMER SWITCHES

- A. Digital switches with backlit LCD display, 120/277 volt rated, fitting as a replacement for standard wall switches.
 1. Compatibility: Compatible with all ballasts.
 2. Warning: Audible warning to sound during the last minute of "on" operation.
 3. Time-out: Adjustable from 5 minutes to 12 hours.
 4. Faceplate: Refer to wall plate material and color requirements for toggle switches, as specified in Section 26 27 26, WIRING DEVICES.

2.5 CEILING-MOUNTED PHOTOELECTRIC SWITCHES

- A. Solid-state, light-level sensor unit, with separate relay unit.
 1. Sensor Output: Contacts rated to operate the associated relay. Sensor shall be powered from the relay unit.
 2. Relay Unit: Dry contacts rated for 20A ballast load at 120V and 277V, for 13A tungsten at 120V, and for 1 hp at 120V.
 3. Monitoring Range: 100 to 1000 fc [1080 to 10 800 lx], with an adjustment for turn-on and turn-off levels.

4. Time Delay: Adjustable from 5 to 300 seconds, with deadband adjustment.
5. Indicator: Two LEDs to indicate the beginning of on-off cycles.

2.6 SKYLIGHT PHOTOELECTRIC SENSORS

- A. Solid-state, light-level sensor; housed in a threaded, plastic fitting for mounting under skylight; with separate relay unit.
 1. Sensor Output: Contacts rated to operate the associated relay, complying with UL 773A. Sensor shall be powered from the relay unit.
 2. Relay Unit: Dry contacts rated for 20A ballast load at 120V and 277V, for 13A tungsten at 120V, and for 1 hp at 120V.
 3. Monitoring Range: 1000 to 10,000 fc [10,800 to 108,000 lx], with an adjustment for turn-on and turn-off levels.
 4. Time Delay: Adjustable from 5 to 300 seconds, with deadband adjustment.
 5. Indicator: Two LEDs to indicate the beginning of on-off cycles.

2.7 INDOOR OCCUPANCY SENSORS

- A. Wall- or ceiling-mounting, solid-state units with a power supply and relay unit, suitable for the environmental conditions in which installed.
 1. Operation: Unless otherwise indicated, turn lights on when covered area is occupied and off when unoccupied; with a 1 to 15 minute adjustable time delay for turning lights off.
 2. Sensor Output: Contacts rated to operate the connected relay. Sensor shall be powered from the relay unit.
 3. Relay Unit: Dry contacts rated for 20A ballast load at 120V and 277V, for 13A tungsten at 120V, and for 1 hp at 120V.
 4. Mounting:
 - a. Sensor: Suitable for mounting in any position on a standard outlet box.
 - b. Time-Delay and Sensitivity Adjustments: Recessed and concealed behind hinged door.
 5. Indicator: LED, to show when motion is being detected during testing and normal operation of the sensor.
 6. Bypass Switch: Override the on function in case of sensor failure.
 7. Manual/automatic selector switch.
 8. Automatic Light-Level Sensor: Adjustable from 2 to 200 fc [21.5 to 2152 lx]; keep lighting off when selected lighting level is present.
 9. Faceplate for Wall-Switch Replacement Type: Refer to wall plate material and color requirements for toggle switches, as specified in Section 26 27 26, WIRING DEVICES.

- B. Dual-technology Type: Ceiling mounting; combination PIR and microphone detection methods, field-selectable.
 - 1. Sensitivity Adjustment: Separate for each sensing technology.
 - 2. Detector Sensitivity: Detect occurrences of 6-inch [150mm] minimum movement of any portion of a human body that presents a target of not less than 36 sq. in. [232 sq. cm], and detect a person of average size and weight moving not less than 12 inches [305 mm] in either a horizontal or a vertical manner at an approximate speed of 12 inches/s [305 mm/s].
 - 3. Detection Coverage: as scheduled on drawings.

2.8 OUTDOOR MOTION SENSOR (PIR)

- A. Suitable for operation in ambient temperatures ranging from minus 40 to plus 130 deg F (minus 40 to plus 54 deg C).
 - 1. Operation: Turn lights on when sensing infrared energy changes between background and moving body in area of coverage; with a 1 to 15 minute adjustable time delay for turning lights off.
 - 2. Mounting:
 - a. Sensor: Suitable for mounting in any position on a standard outdoor junction box.
 - b. Relay: Internally mounted in a standard weatherproof electrical enclosure.
 - c. Time-Delay and Sensitivity Adjustments: Recessed and concealed behind hinged door.
 - 3. Bypass Switch: Override the on function in case of sensor failure.
 - 4. Automatic Light-Level Sensor: Adjustable from 1 to 20 fc [11 to 215 lx]; keep lighting off during daylight hours.
- B. Detector Sensitivity: Detect occurrences of 6-inch [150mm] minimum movement of any portion of a human body that presents a target of not less than 36 sq. in. [232 sq. cm].
- C. Detection Coverage: as scheduled on drawings.
- D. Individually Mounted Sensor: Contacts rated to operate the connected relay, complying with UL 773A. Sensor shall be powered from the relay unit.
 - 1. Relay Unit: Dry contacts rated for 20A ballast load at 120V and 277V, for 13A tungsten at 120V, and for 1 hp at 120V.
 - 2. Indicator: LED, to show when motion is being detected during testing and normal operation of the sensor.

2.9 LIGHTING CONTROL PANEL - RELAY TYPE

- A. Controller: Comply with UL 508; programmable, solid-state, astronomic 365-day control unit with non-volatile memory, mounted in

- preassembled relay panel with low-voltage-controlled, latching-type, single-pole lighting circuit relays. Controller shall be capable of receiving inputs from sensors and other sources, and capable of timed overrides and/or blink-warning on a per-circuit basis. Controller communication protocol shall be compatible with the building automation system specified in SECTION 23 09 23 DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC. Where indicated, a limited number of digital or analog, low-voltage control-circuit outputs shall be supported by control unit and circuit boards associated with relays.
- B. Cabinet: Steel with hinged, locking door. Barriers separate low-voltage and line-voltage components.
 - C. Directory: Identifies each relay as to load controlled.
 - D. Control Power Supply: Transformer and full-wave rectifier with filtered dc output.
 - E. Single-Pole Relays: Mechanically held unless otherwise indicated; split-coil, momentary-pulsed type, rated 20 A, 125-V ac for tungsten filaments and 20 A, 277-V ac for ballasts, 50,000 cycles at rated capacity.

PART 3 - EXECUTION

3.1 INSTALLATION:

- A. Installation shall be in accordance with the NEC, manufacturer's instructions and as shown on the drawings or specified.
- B. Aim outdoor photocell switch according to manufacturer's recommendations. Set adjustable window slide for 1 footcandle photocell turn-on.
- C. Aiming for wall-mounted and ceiling-mounted motion sensor switches shall be per manufacturer's recommendations.
- D. Set occupancy sensor "on" duration to 15minutes.
- E. Locate light level sensors as indicated and in accordance with the manufacturer's recommendations. Adjust sensor for the scheduled light level at the typical work plane for that area.
- F. Label time switches and contactors with a unique designation.

3.2 ACCEPTANCE CHECKS AND TESTS

- A. Perform in accordance with the manufacturer's recommendations.
- B. Upon completion of installation, conduct an operating test to show that equipment operates in accordance with requirements of this section.
- C. Test for full range of dimming ballast and dimming controls capability. Observe for visually detectable flicker over full dimming range.
- D. Test occupancy sensors for proper operation. Observe for light control over entire area being covered.
- E. Program lighting control panels per schedule on drawings.

- F. Upon completion of the installation, the system shall be commissioned by the manufacturer's factory-authorized technician who will verify all adjustments and sensor placements.

3.3 FOLLOW-UP VERIFICATION

Upon completion of acceptance checks and tests, the Contractor shall show by demonstration in service that the lighting control devices are in good operating condition and properly performing the intended function.

- - - E N D - - -

SECTION 26 12 19
PAD-MOUNTED, LIQUID-FILLED, MEDIUM-VOLTAGE TRANSFORMERS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the furnishing, installation, and connection of pad-mounted transformers.
- B. Pad-mounted transformers shall be complete, outdoor type, continuous duty, integral assembly, grounded, tamper-resistant, and weatherproof, with liquid-immersed transformers.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements that are common to more than one section of Division 26.
- B. Section 26 05 13, MEDIUM-VOLTAGE CABLES: Medium-voltage cables.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground currents.
- D. Section 26 05 41, UNDERGROUND ELECTRICAL CONSTRUCTION: Manholes, pull-boxes, and duct lines for underground raceway systems.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 FACTORY TESTS

Transformers shall be thoroughly tested at the factory to ensure that there are no electrical or mechanical defects. Tests shall be conducted as per UL and ANSI Standards. Factory tests shall be certified. The following tests shall be performed:

- 1. Perform insulation-resistance tests, winding-to-winding and each winding-to-ground.
- 2. Perform turns-ratio tests at all tap positions.

1.5 SUBMITTALS

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Shop Drawings:
 - 1. Clearly present sufficient information to determine compliance with drawings and specifications.
 - 2. Include electrical ratings, nameplate data, impedance, outline drawing with dimensions and front, top, and side views, weight, mounting details, decibel rating, termination information,

temperature rise, no-load and full-load losses, regulation, overcurrent protection, connection diagrams, and accessories.

3. Complete nameplate data, including manufacturer's name and catalog number.

C. Manuals:

1. When submitting the shop drawings, submit companion copies of complete maintenance and operating manuals, including technical data sheets, wiring diagrams, and information for ordering replacement parts.
 - a. Identify terminals on wiring diagrams to facilitate installation, maintenance, and operation.
 - b. Indicate on wiring diagrams the internal wiring for each piece of equipment and interconnections between the pieces of equipment.
 - c. Approvals will be based on complete submissions of manuals, together with shop drawings.
2. Two weeks prior to the final inspection, submit four copies of the final up-dated maintenance and operation manuals to the COTR.
 - a. Update the manual to include any information necessitated by shop drawing approval.
 - b. Show all terminal identification.
 - c. Include information for testing, repair, trouble-shooting, assembly, disassembly, and recommended maintenance intervals.
 - d. Provide a replacement parts list with current prices. Include a list of recommended spare parts, tools, and instruments for testing and maintenance purposes.
 - e. Furnish manuals in loose-leaf binder or manufacturer's standard binder.

D. Certifications:

Two weeks prior to the final inspection, submit four copies of the following certifications to the COTR:

1. Certification by the manufacturer that the materials conform to the requirements of the drawings and specifications.
2. Certification by the contractor that the materials have been properly installed, connected, and tested.

1.6 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.

B. American Concrete Institute (ACI):

318-05.....Building Code Requirements for Structural
Concrete

C. American National Standards Institute (ANSI):

- C37.47-00.....High Voltage Current-Limiting Type Distribution
Class Fuses and Fuse Disconnecting Switches
- C57.12.00-00.....General Requirements for Liquid-Immersed
Distribution, Power and Regulating Transformers
- C57.12.25-90.....Transformers-Pad-Mounted, Compartmental-Type,
Self Cooled, Single-Phase Distribution
Transformers with Separable Insulated High
Voltage Connectors; High Voltage, 34500 Grd
Y/19920 Volts and Below; Low-Voltage 240/120
Volts; 167 kVA and Smaller Requirements
- C57.12.28-05.....Pad-Mounted Equipment Enclosure Integrity
- C57.12.29-99.....Pad-Mounted Equipment - Enclosure Integrity for
Coastal Environments
- C57.12.34-04.....Pad-Mounted, Compartmental-Type, Self Cooled,
Three-Phase Distribution Transformers, 2500kVA
and Smaller - High Voltage 34500 Grd Y/19920
Volts and Below; Low-Voltage 480 Volts and Below

D. American Society for Testing and Materials (ASTM):

- D3487-08.....Standard Specification for Mineral Insulating
Oil Used in Electrical Apparatus

E. Institute of Electrical and Electronic Engineers (IEEE):

- C2-07.....National Electrical Safety Code
- C62.11-99.....Metal-Oxide Surge Arresters for Alternating
Current Power Circuits
- 48-09.....Test Procedures and Requirements for Alternating
Current Cable Terminations Used on Shielded
Cables Having Laminated Insulation Rated 2.5kV
Through 765kV or Extruded Insulation Rated 2.5kV
Through 500kV
- 386-06.....Standard for Separable Insulated Connector
Systems for Power Distribution Systems Above
600V
- 592-96.....Standard for Exposed Semiconducting Shields on
High Voltage Cable Joints and Separable
Insulated Connectors

F. National Electrical Manufacturers Association (NEMA):

- C57.12.26-87.....Pad-Mounted, Compartmental-Type, Self-Cooled,
Three-Phase Distribution Transformers for Use
with Separable Insulated High-Voltage

- Connectors, High-Voltage, 34500 Grd Y/19920
Volts and Below; 2500 kVA and Smaller
LA1-92.....Surge Arresters
TP1-02.....Guide for Determining Energy Efficiency for
Distribution Transformers
TR1-00.....Transformers, Regulators, and Reactors
G. National Fire Protection Association (NFPA):
70-08.....National Electrical Code (NEC)
H. Underwriters Laboratories Inc. (UL):
467-07.....Grounding and Bonding Equipment

PART 2 - PRODUCTS

2.1 EQUIPMENT, GENERAL

- A. Equipment shall be in accordance with ANSI, ASTM, IEEE, NEMA, NFPA, UL, as shown on the drawings, and as specified herein. The transformer shall be assembled as an integral unit by a single manufacturer.
- B. Ratings shall not be less than shown on the drawings.
- C. Provide transformers designed to withstand the mechanical stresses caused by rough handling during shipment in addition to the electrical and mechanical stresses that may occur during operation.
- D. Completely fabricate transformers at the factory so that only the external cable connections are required at the job site.
- E. Thoroughly clean, phosphatize, and finish all the metal surfaces at the factory with a rust-resistant primer and dark green enamel finish coat, except where a different color is specified in Section 09 06 00, SCHEDULE FOR FINISHES. All surfaces of the unit that will be in contact with the concrete pad shall be treated with corrosion-resistant compounds and epoxy resin or a rubberized sealing compound.

2.2 COMPARTMENTS

- A. Construction:
 - 1. Enclosures shall be in accordance with ANSI C57.12.28 //or ANSI C57.12.29 if installed in coastal environments//.
 - 2. The medium- and low-voltage compartments shall be separated with a steel barrier that extends the full height and depth of the compartments.
 - 3. The compartments shall be constructed of sheet steel (gauge to meet ANSI requirements) with bracing, reinforcing gussets, and jig-welding to ensure rectangular rigidity.
 - 4. Use cadmium or zinc plated bolts, nuts, and washers.
 - 5. Sufficient space shall be provided for equipment, cabling, and terminations within the compartments.

6. Affix transformer nameplate permanently within the low-voltage compartment. Voltage and kVA rating, connection configuration, impedance, date of manufacture, and serial number shall be shown on the nameplate.

B. Doors:

1. Provide a separate door for each compartment with provisions for a single padlock to secure all doors. Provide each compartment door with open-position doorstops and corrosion-resistant tamperproof hinges welded in place. The medium-voltage compartment door shall be mechanically prevented from opening unless the low-voltage compartment door is open.
2. The secondary compartment door shall have a one-piece steel handle and incorporate three-point locking mechanisms.

2.3 BIL RATING

- A. 15 kV class equipment shall have a minimum 95 kV BIL rating.

2.4 TRANSFORMER FUSE ASSEMBLY

The primary fuse assembly shall be load-break combination fuse and dry-well fuse holder rated for system voltage, rated for 10 load makes and 10 load breaks, with rated 200 amp load current at 75% power factor, 10,000 symmetrical A close-in on fault duty, and 95 kV BIL. The entire fuse assembly shall be removable through the use of hot stick.

1. The fuses shall be concealed, hot stick removable, 50,000 A symmetrical interrupting, non-expulsion, current-limiting primary distribution type, of the size and voltage class as shown on the drawings. The fuses shall operate within the fuse holder as a unit disconnecting means. Fuses shall be in accordance with ANSI C37.47.
2. Transformers shall not have internal "weak link" fuses that require transformer tank cover removal for replacement.
3. For units above 500 kVA using fusing above the 50 A 15 kV and 100 A 5 kV application, a clip-mounted arrangement of the current limiting fuses (i.e., live-front configuration) is required.

2.5 PRIMARY CONNECTIONS

- A. Primary connections shall be 200 A dead-front load break wells and inserts for cable sizes shown on the drawings.
- B. Surge Arresters: Distribution class, one for each primary phase, complying with IEEE C62.11 and NEMA LA 1, supported from tank wall.

2.7 MEDIUM-VOLTAGE TERMINATIONS

- A. Terminate the medium voltage cables in the primary compartment with loadbreak premolded rubber elbow connectors, suitable for submersible

applications. Elbow connectors shall have a minimum of 0.125 in [3 mm] semi-conductive shield material covering the housing. The separable connector system shall include the loadbreak elbow, the bushing insert, and the bushing well. Separable connectors shall comply with the requirements of IEEE 386, and shall be interchangeable between suppliers. Loadbreak elbow and bushing insert shall be from the same manufacturer. Allow sufficient slack in medium-voltage cable, ground, and drain wires to permit elbow connectors to be moved to their respective parking stands. Elbow connectors shall be rated as follows:

1. Voltage: 15kV phase-to-phase.
 2. Continuous current: 200 A RMS.
- B. Ground metallic cable shields with a device designed for that purpose, consisting of a solderless connector enclosed in watertight rubber housing covering the entire assembly.
- C. Provide insulated cable supports to relieve any strain imposed by cable weight or movement.

2.8 LOW-VOLTAGE EQUIPMENT

- A. Mount the low voltage bushings, and hot stick in the low voltage compartment.
- B. The low-voltage leads shall be brought out of the tank by epoxy pressure tight bushings, and shall be standard arrangement per ANSI.
- C. Tin-plate the low-voltage neutral terminal and isolate from the transformer tank. Provide a removable ground strap sized in accordance with the NEC and connect between the neutral and ground pad.

2.9 TRANSFORMERS

- A. Transformers shall be three-phase, liquid-immersed, isolated winding, and self-cooled by natural convection.
- B. The kVA ratings shown on the drawings are for continuous duty without the use of cooling fans.
- C. Temperature rises shall not exceed the NEMA TR1 standards of 149° F [65° C] by resistance, and 180° F [80° C] hotspot at rated kVA.
- D. Transformer insulating material shall be less flammable, dielectric, and UL listed as complying with NFPA 70 requirements for fire point of not less than 600° F [300° C] when tested according to ASTM D 92. Liquid shall be biodegradable and nontoxic.
- E. Transformer impedance shall be not less than 4.5% for sizes 150 kVA and larger. Impedance shall be as shown on the drawings.
- F. Sound levels shall conform to NEMA TR1 standards.

G. Primary and Secondary Windings for Three-Phase Transformers:

1. Primary windings shall be delta-connected.
2. Secondary windings shall be wye-connected, except where otherwise indicated on the drawings. Provide isolated neutral bushings for secondary wye-connected transformers.
3. Secondary leads shall be brought out through pressure-tight epoxy bushings.

H. Primary windings shall have four 2.55 full-capacity voltage taps; two taps above and two taps below rated voltage.

I. Core and Coil Assemblies:

1. Cores shall be grain-oriented, non-aging, and silicon steel to minimize losses.
2. Core and coil assemblies shall be rigidly braced to withstand the stresses caused by rough handling during shipment, and stresses caused by any possible short-circuit currents.
3. Coils shall be continuous-winding type without splices except for taps. Material shall be copper.
4. Coil and core losses shall be optimum for efficient operation.
5. Primary, secondary, and tap connections shall be brazed or pressure type.
6. Provide end fillers or tiedowns for coil windings.

J. The transformer tank, cover, and radiator gauge thickness shall not be less than that outlined in ANSI.

K. Accessories:

1. Provide standard NEMA features, accessories, and the following:
 - a. No-load tap changer (Provide warning sign).
 - b. Lifting, pulling, and jacking facilities.
 - c. Globe-type valve for oil filtering and draining, including sampling device.
 - d. Pressure relief valve.
 - e. Liquid level gauge and filling plug.
 - f. A grounding pad in the medium- and low-voltage compartments.
 - g. A diagrammatic nameplate and operating instructions enclosed by a transparent cover located in the low-voltage compartment.
 - h. Dial-type liquid thermometer with a maximum reading pointer and an external reset.
 - i. Hot stick. Securely fasten hot stick within low-voltage compartment.
2. The accessories shall be made accessible within the compartments without disassembling trims and covers.

- L. Transformers shall meet the minimum energy efficiency values per NEMA TP1:

KVA	(%)
75	98.1
112.5	98.3
150	99.0
225	99.0
300	99.0
500	99.1
750	99.2
1000	99.2
1500	99.3
2000	99.4
2500	99.4

2.10 CABLE FAULT INDICATORS (LOOP SYSTEM ONLY):

- A. Provide each incoming and outgoing cable within the medium-voltage compartment with a single-phase cable fault indicator with in-rush restraint. Mount the indicator on the cable support member.
1. The sensor assembly shall have a split-core for easy installation over the incoming and outgoing cable. The core shall be laminated, grain-oriented silicon steel, and encapsulated. Provide a clamp to secure the two coil halves around the cable.
 2. Select the coil to the pick-up at the current setting shown on the drawings.
 - a. The coil setting shall be accurate to within 10% of the pick-up.
 - b. The coil current-time curve shall coordinate with the primary current-limiting fuse.
- B. Upon restoration of the system to normal operating conditions, the cable fault indicator shall automatically reset to normal and be ready to operate.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install transformers as shown on the drawings, in accordance with the NEC, and as recommended by the manufacturer.
- B. Foundation:
1. Provide foundation of reinforced concrete, Type C, 21mPa (3000 psi minimum, 28 day compressive strength), complying with the ACI 318.

2. Locate the top of foundation pads 6 in [150 mm] above the adjacent finished grade, unless otherwise shown on the drawings. Refer to drawings for size, location, and structural steel reinforcing required.
3. Grade the adjacent terrain so that surface water will flow away from the foundation.
4. Anchor transformers with cadmium- or zinc-plated bolts, nuts, and washers. Bolts shall not be less than 0.5 in [12 mm] diameter.

C. Grounding:

1. Ground each transformer in accordance with the requirements of the NEC. Install ground rods per the requirements of Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS, to maintain a maximum resistance of 5 ohms to ground.
2. Connect the ground rod to the ground pads in the medium- and low-voltage compartments, and to the secondary //and primary// neutral with not less than a No. 2/0 AWG bare copper conductor.
3. Independently connect cable shield grounding devices ground wires to ground with sufficient slack to permit elbow connector operation. Connect elbow connectors with a No. 14 AWG bare copper drain wire from its grounding eye to the related cable shield grounding device ground wire. Do not connect drain wires in any manner that could permit circulating currents, or cable fault currents, to pass through them.

3.2 ACCEPTANCE CHECKS AND TESTS

- A. Perform tests in accordance with the manufacturer's recommendations. Include the following visual and mechanical inspections.

B. Transformers:

1. Compare equipment nameplate data with specifications and approved shop drawings.
2. Inspect physical and mechanical condition. Check for damaged or cracked bushings and liquid leaks.
3. Verify that control and alarm settings on temperature indicators are as specified.
4. Inspect all field-installed bolted electrical connections, using the calibrated torque-wrench method to verify tightness of accessible bolted electrical connections, or perform thermographic survey after energization under load.
5. Verify correct liquid level in transformer tank.
6. Perform specific inspections and mechanical tests as recommended by manufacturer.

7. Verify correct equipment grounding per the requirements of Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
8. Verify the presence of transformer surge arresters, if provided.
9. Verify that the tap-changer is set at specified ratio.

3.3 FOLLOW-UP VERIFICATION

Upon completion of acceptance checks, settings, and tests, the contractor shall demonstrate that the transformers are in good operating condition and properly performing the intended function.

3.4 SPARE PARTS

Deliver the following spare parts for the project to the COTR two weeks prior to final inspection:

1. Six stand-off insulators.
2. Six insulated protective caps.
3. One spare set of medium-voltage fuses for each size fuse used in the project.
4. One spare set of three cable fault indicators.

3.5 INSTRUCTIONS

The contractor shall instruct maintenance personnel, for not less than one 2-hour period, on the maintenance and operation of the equipment on the date requested by the COTR.

- - - E N D - - -

SECTION 26 22 00
LOW-VOLTAGE TRANSFORMERS

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation, and connection of dry-type general-purpose transformers.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items common to more than one section of Division 26.
- B. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Cables and wiring.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits and outlet boxes.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Shop Drawings:
 - 1. Clearly present sufficient information to determine compliance with drawings and specifications.
 - 2. Include electrical ratings, impedance, dimensions, weight, mounting details, decibel rating, terminations, temperature rise, no load and full load losses, and connection diagrams.
 - 3. Complete nameplate data, including manufacturer's name and catalog number.
- C. Manuals:
 - 1. When submitting the shop drawings, submit companion copies of complete maintenance and operating manuals, including technical data sheets and wiring diagrams.
 - 2. If changes have been made to the maintenance and operating manuals originally submitted, then submit four copies of the updated maintenance and operating manuals to the COTR two weeks prior to final inspection.

- D. Certifications: Two weeks prior to the final inspection, submit four copies of the following to the COTR:
1. Certification by the manufacturer that the materials conform to the requirements of the drawings and specifications.
 2. Certification by the contractor that the equipment has been properly installed and tested.

1.4 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. National Fire Protection Association (NFPA):
- 70-08National Electrical Code (NEC)
- C. National Electrical Manufacturers Association (NEMA):
- ST20-92Dry-Type Transformers for General Applications
- TP1-02Guide for Determining Energy Efficiency for
Distribution Transformers
- TR1-00Transformers, Regulators, and Reactors

PART 2 - PRODUCTS

2.1 GENERAL PURPOSE DRY-TYPE TRANSFORMERS

- A. Unless otherwise specified, dry-type transformers shall be in accordance with NEMA, NEC, and as shown on the drawings. Transformers shall be UL-listed and labeled.
- B. Dry-type transformers shall have the following features:
1. Transformers shall be self-cooled by natural convection, isolating windings, indoor dry-type. Autotransformers will not be accepted.
 2. Rating and winding connections shall be as shown on the drawings.
 3. Transformers shall have copper windings.
 4. Ratings shown on the drawings are for continuous duty without the use of cooling fans.
 5. Insulation systems:
 - a. Transformers 30 kVA and larger: UL rated 220 • C system with an average maximum rise by resistance of 150 • C in a maximum ambient of 40 • C.
 - b. Transformers below 30 kVA: Same as for 30 kVA and larger or UL rated 185 • C system with an average maximum rise by resistance of 115 • C in a maximum ambient of 40 • C.
 6. Core and coil assemblies:
 - a. Rigidly braced to withstand the stresses caused by short-circuit currents and rough handling during shipment.
 - b. Cores shall be grain-oriented, non-aging, and silicon steel.

- c. Coils shall be continuous windings without splices except for taps.
 - d. Coil loss and core loss shall be minimized for efficient operation.
 - e. Primary and secondary tap connections shall be brazed or pressure type.
 - f. Coil windings shall have end filters or tie-downs for maximum strength.
7. Certified sound levels determined in accordance with NEMA, shall not exceed the following:

Transformer Rating	Sound Level Rating
0 - 9 KVA	40 dB
10 - 50 KVA	45 dB
51 - 150 KVA	50 dB
151 - 300 KVA	55 dB
301 - 500 KVA	60 dB

8. If not shown on drawings, nominal impedance shall be as permitted by NEMA.
9. Single phase transformers rated 15 kVA through 25 kVA shall have two 5% full capacity taps below normal rated primary voltage. All transformers rated 30 kVA and larger shall have two 2.5% full capacity taps above, and four 2.5% full capacity taps below normal rated primary voltage.
10. Core assemblies shall be grounded to their enclosures with adequate flexible ground straps.
11. Enclosures:
- a. Comprised of not less than code gauge steel.
 - b. Outdoor enclosures shall be NEMA 3R.
 - c. Temperature rise at hottest spot shall conform to NEMA Standards, and shall not bake and peel off the enclosure paint after the transformer has been placed in service.
 - d. Ventilation openings shall prevent accidental access to live components.
 - e. The enclosure at the factory shall be thoroughly cleaned and painted with manufacturer's prime coat and standard finish.

12. Standard NEMA features and accessories, including ground pad, lifting provisions, and nameplate with the wiring diagram and sound level indicated on it.
13. Dimensions and configurations shall conform to the spaces designated for their installations.
14. Transformers shall meet the minimum energy efficiency values per NEMA TP1 as listed below:

kVA Rating	Output efficiency (%)
15	97
30	97.5
45	97.7
75	98
112.5	98.2
150	98.3
225	98.5
300	98.6
500	98.7
750	98.8

2.2 NONLINEAR TRANSFORMERS

- A. Shall be as specified in Paragraph 2.1, with additional features as specified below.
- B. Transformers shall be designed to withstand the overheating effects caused by harmonics resulting from non-linear (non-sinusoidal) loads.
- C. Neutral rating shall be 200% of rated secondary phase current.
- D. Minimum efficiency designed to supply circuits with a harmonic profile equal to or less than a K factor of 13, without exceeding specified temperature rise. Transformers with K factor of 13 shall be provided, if K factor is not shown on contract drawings. Table below applies to K-13 transformers only.

Harmonic	K-13 (%)
Fundamental	100
3 rd	70
5 th	42
7 th	5
9 th	3
11 th	3
13 th	1
15 th	0.7
17 th	0.6

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Installation of transformers shall be in accordance with the NEC, as recommended by the equipment manufacturer and as shown on the drawings.
- B. Install transformers with manufacturer's recommended clearance from wall and adjacent equipment for air circulation. Minimum clearance shall be 6 in [150 mm].
- C. Install transformers on vibration pads designed to suppress transformer noise and vibrations.
- D. Use flexible metal conduit to enclose the conductors from the transformer to the raceway systems.

3.2 ACCEPTANCE CHECKS AND TESTS

Perform tests in accordance with the manufacturer's recommendations. Include the following visual and mechanical inspections.

- 1. Compare equipment nameplate data with specifications and approved shop drawings.
- 2. Inspect physical and mechanical condition.
- 3. Inspect all field-installed bolted electrical connections, using the calibrated torque-wrench method to verify tightness of accessible bolted electrical connections.
- 4. Perform specific inspections and mechanical tests as recommended by manufacturer.
- 5. Verify correct equipment grounding.
- 6. Verify proper secondary phase-to-phase and phase-to-neutral voltage after energization and prior to connection to loads.

3.3 FOLLOW-UP VERIFICATION

Upon completion of acceptance checks, settings, and tests, the contractor shall demonstrate that the transformers are in good operating condition and properly performing the intended function.

- - - E N D - - -

SECTION 26 24 11
DISTRIBUTION SWITCHBOARDS

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation, and connection of the distribution switchboards.

1.2 RELATED WORK

- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- C. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Cables and wiring.
- D. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for Personnel Safety and to provide a low impedance path for possible fault currents.
- E. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduit and outlet boxes.
- G. Section 26 43 13, TRANSIENT-VOLTAGE SURGE SUPPRESSION: TVSS equipment for distribution switchboards.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 FACTORY TESTS

- A. Distribution switchboards shall be thoroughly tested at the factory to assure that there are no electrical or mechanical defects. Tests shall be conducted as per NEMA PB 2 and UL 891. Factory tests shall be certified.
- B. The following additional tests shall be performed:
 - 1. Verify that circuit breaker sizes and types correspond to drawings and coordination study.
 - 2. Verify tightness of bolted electrical connections by calibrated torque-wrench method in accordance with manufacturer's published data.
 - 3. Exercise all active components.
 - 4. Perform a dielectric withstand voltage test on each bus section, each phase-to-ground with phases not under test grounded, in accordance with manufacturer's published data.
 - 5. Perform insulation-resistance tests on control wiring with respect to ground. Applied potential shall be 500 volts dc for 300-volt rated cable and 1000 volts dc for 600-volt rated cable, or as required if

- solid-state components or control devices cannot tolerate the applied voltage.
6. If applicable, verify correct function of control transfer relays located in the switchboard with multiple control power sources.
 7. Perform phasing checks on double-ended or dual-source switchboards to insure correct bus phasing from each source.
- C. Furnish four (4) copies of certified manufacturer's factory test reports to the Resident Engineer prior to shipment of the switchboards to ensure that the switchboards have been successfully tested as specified.
- D. The Government shall have an option to witness the factory tests. All expenses of the Government Representative's trips to witness the testing will be paid by the Government. Notify the Resident Engineer not less than 30 days prior to making tests at the factory.

1.5 SUBMITTALS

Submit in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS:

A. Shop Drawings:

1. Sufficient information, clearly presented, shall be included to determine compliance with drawings and specifications.
2. Include electrical ratings, dimensions, mounting details, materials, required clearances, terminations, weight, temperature rise, wiring and connection diagrams, plan, front, side, and rear elevations, sectional views, bus work, circuit breaker frame sizes, trip and short-circuit rating, long-time, short-time, instantaneous and ground fault settings, coordinated breaker and fuse curves, accessories, and device nameplate data.
3. Show the size, ampere-rating, number of bars per phase and neutral in each bus run (horizontal and vertical), bus spacing, equipment ground bus, and bus material.

B. Manuals:

1. Submit, simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals including technical data sheets, wiring diagrams, and information for ordering replacement parts.
 - a. Wiring diagrams shall have their terminals identified to facilitate installation, maintenance, and operation.
 - b. Wiring diagrams shall indicate internal wiring for each item of equipment and the interconnection between the items of equipment.
 - c. Provide a clear and concise description of operation, which gives, in detail, the information required to properly operate the equipment.

- d. Approvals will be based on complete submissions of manuals together with shop drawings.
2. Two weeks prior to final inspection, deliver four copies of the final updated maintenance and operating manuals to the Resident Engineer.
 - a. The manuals shall be updated to include any information necessitated by shop drawing approval.
 - b. Complete "As Installed" wiring and schematic diagrams shall be included which show all items of equipment and their interconnecting wiring.
 - c. Show all terminal identification.
 - d. Include information for testing, repair, trouble shooting, assembly, disassembly, and recommended maintenance intervals.
 - e. Provide a replacement parts list with current prices. Include a list of recommended spare parts, tools, and instruments for testing and maintenance purposes.
 - f. Furnish manuals in loose-leaf binder or manufacturer's standard binder.

C. Certifications:

1. Two weeks prior to final inspection, submit four copies of the following to the Resident Engineer:
 - a. Certification by the Contractor that the assemblies have been properly installed, adjusted and tested, including circuit breakers settings.
 - b. Certified copies of all of the factory design and production tests, field test data sheets and reports for the assemblies.

1.6 APPLICABLE PUBLICATIONS

Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by basic designation only.

A. Institute of Engineering and Electronic Engineers (IEEE):

C37.13.....Low Voltage AC Power Circuit Breakers Used in Enclosures
C57.13.....Instrument Transformers
C62.41.....Surge Voltage in Low Voltage AC Power Circuits
C62.45.....Surge Testing for Equipment connected to Low-Voltage AC Power Circuits

B. National Electrical Manufacturer's Association (NEMA):

PB-2.....Dead-Front Distribution Switchboards.
PB-2.1.....Instructions for Proper Handling, Installation, Operation, and Maintenance of Switchboards

AB-1.....Molded Case Circuit Breakers, Molded Case
Switches and Circuit Breaker Enclosures

C. National Fire Protection Association (NFPA):

70.....National Electrical Code (NEC)

D. Underwriters Laboratories, Inc. (UL):

67.....Panelboards

489.....Molded Case Circuit Breakers and Circuit
Breakers Enclosures

891.....Dead-Front Switchboards

1283.....Electromagnetic Interference Filters

1449.....Transient Voltage Surge Suppressors

PART 2 - PRODUCTS

2.1 GENERAL

- A. Switchboards shall be in accordance with UL, NEMA, NEC, IEEE, and as shown on the drawings.
- B. Switchboards shall be provided complete, ready for operation including, but not limited to housing, buses, circuit breakers, instruments and related transformers, fuses, and wiring.
- C. Switchboard dimensions shall not exceed the dimensions shown on the drawings.
- D. Manufacturer's nameplate shall include complete ratings of switchboard in addition to the date of manufacture.

2.2 BASIC ARRANGEMENT

- A. Type I: Switchboard shall be front accessible with the following features:
 - 1. Device mounting:
 - a. Main breaker: Individually mounted and compartmented or group mounted with feeder breakers.
 - b. Feeder breakers: Group mounted.
 - 2. Section alignment: As shown on the drawings.
 - 3. Accessibility:
 - a. Main section line and load terminals: Front and side.
 - b. Distribution section line and load terminals: Front.
 - c. Through bus connections: Front and end.
 - 4. Bolted line and load connections.
 - 5. Full height wiring gutter covers for access to wiring terminals.
 - 6. Short Circuit Current Rating: 65k amperes rms symmetrical, minimum, or as shown on the drawings, whichever is higher.

2.3 HOUSING

- A. Provide a completely enclosed, free standing, steel enclosure not less than the gage required by the ANSI and UL standards. The enclosure is to consist of the required number of vertical sections bolted together to form one metal enclosed rigid switchboard. The sides, top and rear shall be covered with removable screw on sheet steel plates.
- B. Provide ventilating louvers where required to limit the temperature rise of current carrying parts. All openings shall be protected against entrance of falling dirt, water, or foreign matter.
- C. Enclosure shall be thoroughly cleaned, phosphate treated, and primed with rust-inhibiting paint. Final finish coat to be the manufacturers standard gray. Provide a quart of finish paint for touch-up purposes.

2.4 BUSES

- A. General: Buses shall be arranged for 3 phase, 4 wire distribution. Main phase buses (through bus), full size neutral bus, and ground bus shall be full capacity the entire length of the switchboard. Provide for future extensions by means of bolt holes or other approved method. Brace the bus to withstand the available short circuit current at the particular location and as shown on the drawings. No magnetic material shall be used between buses to form a magnetic loop.
- B. Material and Size: Buses and connections shall be hard drawn copper of 98 percent conductivity. Bus temperature rise shall not exceed 65 degrees C (149 degrees F). Section busing shall be sized based on UL and NEMA Switchboard Standards.
- C. Bus Connections: All contact surfaces shall be copper. Provide a minimum of two plated bolts per splice. Where physical bus size permits only one bolt, provide a means other than friction to prevent turning, twisting or bending. Torque bolts to the manufacturer's recommended values.
- D. Neutral Bus: Provide bare or plated bus and mount on insulated bus supports. Provide neutral disconnect link to permit isolation of neutral bus from the common ground bus and service entrance conductors.
- E. Ground Bus: Provide an uninsulated 6 mm by 50 mm (1/4 inch by 2 inch) copper equipment ground bus bar sized per UL 891 the length of the switchboard and secure at each section.

2.5 TRANSIENT VOLTAGE SURGE SUPPRESSION

Refer to Section 26 43 13, TRANSIENT-VOLTAGE SURGE SUPPRESSION.

2.6 METERING

Refer to Section 26 09 13, ELECTRICAL POWER MONITORING AND CONTROL.

2.7 NAMEPLATES AND MIMIC BUS

- A. Nameplates: For Normal Power system, provide laminated black phenolic resin with white core with 1/2 inch [12mm] engraved lettered nameplates next to each circuit breaker. Nameplates shall indicate equipment served, spaces, or spares in accordance with one line diagram shown on drawings. Nameplates shall be mounted with plated screws on front of breakers or on equipment enclosure next to breakers. Mounting nameplates only with adhesive is not acceptable.
- B. Mimic Bus: Provide an approved mimic bus on front of each switchboard assembly. Color shall be black for the Normal Power system and red for the Essential Electrical System, either factory-painted plastic or metal strips. Plastic tape shall not be used. Use symbols similar to one line diagram shown on drawings. Plastic or metal strips shall be mounted with plated screws.

2.8 PROVISION FOR FUTURE

Where "provision for", "future", or "space" is noted on drawings, the space shall be equipped with bus connections to the future overcurrent device with suitable insulation and bracing to maintain proper short circuit rating and physical clearance. Provide buses for the ampere rating as shown for the future device.

2.9 BREAKER REMOVAL EQUIPMENT

Where draw out circuit breakers are provided, furnish a portable elevating carriage or switchboard permanent top mounted device for installation and removal of the breakers.

2.10 CONTROL WIRING

Control wiring shall be 600 volt class B stranded SIS. Install all control wiring complete at the factory adequately bundled and protected. Wiring across hinges and between shipping units shall be Class C stranded. Size in accordance with NEC. Provide control circuit fuses.

2.11 MAIN CIRCUIT BREAKERS

- A. Type I Switchboard: Provide UL listed and labeled molded case circuit breakers in accordance with NEC and as shown on the drawings. Circuit breakers shall be the solid state adjustable trip type.
 - 1. Trip units shall have field adjustable tripping characteristics as follows:

- a. Ampere setting (continuous).
 - b. Long time band.
 - c. Short time trip point.
 - d. Short time delay.
 - e. Instantaneous trip point.
 - f. Ground fault trip point.
 - g. Ground fault trip delay.
2. Trip settings shall be as indicated on the drawings. Final settings shall be as shown on the electrical system protective device study.
 3. Breakers, which have same rating, shall be interchangeable with each other.

2.12 FEEDER CIRCUIT BREAKERS

- A. Provide UL listed and labeled molded case circuit breakers, in accordance with the NEC, as shown on the drawings, and as herein specified.
- B. Non-adjustable Trip Molded Case Circuit Breakers:
 1. Molded case circuit breakers shall have automatic, trip free, non-adjustable, inverse time, and instantaneous magnetic trips for 100 ampere frame size or less. Magnetic trip shall be adjustable from 3X to 10X for breakers with 600 ampere frame size and higher. Factory setting shall be LOW unless otherwise noted.
 2. Breaker features shall be as follows:
 - a. A rugged, integral housing of molded insulating material.
 - b. Silver alloy contacts.
 - c. Arc quenchers and phase barriers for each pole.
 - d. Quick-make, quick-break, operating mechanisms.
 - e. A trip element for each pole, thermal magnetic type with long time delay and instantaneous characteristics, a common trip bar for all poles and a single operator.
 - f. Electrically and mechanically trip free.
 - g. An operating handle which indicates ON, TRIPPED and OFF positions.
 - h. Line and load connections shall be bolted.
 - i. Interrupting rating shall not be less than the maximum short circuit current available at the line.
 - j. An overload on one pole of a multipole breaker shall automatically cause all the poles of the breaker to open.
- C. Adjustable Trip Molded Case Circuit Breakers:
 1. Provide molded case, solid state adjustable trip type circuit breakers.

2. Trip units shall have field adjustable tripping characteristics as follows:
 - a. Ampere setting (continuous).
 - b. Long time band.
 - c. Short time trip point.
 - d. Short time delay.
 - e. Instantaneous trip point.
 - f. Ground fault trip point.
 - g. Ground fault trip delay.
3. Trip settings shall be as indicated on the drawings. Final settings shall be shown on the electrical system protective device study.
4. Breakers, which have same rating, shall be interchangeable with each other.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install the switchboard in accordance with the NEC, as shown on the drawings, and as recommended by the manufacturer.
- B. Anchor switchboard to the slab with plated 1/2 inch [12.5mm] minimum anchor bolts, or as recommended by the manufacturer.
- C. Exterior Location. Mount switchboard on concrete slab. Unless otherwise indicated, the slab shall be at least 8 inches [200mm] thick, reinforced with a 6 by 6 inch [150 by 150mm] No. 6 mesh placed uniformly 4 inches [100mm] from the top of the slab. Slab shall be placed on a 6 inch [150mm] thick, well-compacted gravel base. The top of the concrete slab shall be approximately 6 inches [100mm] above the finished grade. Edges above grade shall have 1/2 inch [12.5mm] chamfer. The slab shall be of adequate size to project at least 8 inches [200mm] beyond the equipment (See drawings for overall dimensions). Provide conduit turnups and cable entrance space required by the equipment to be mounted. Seal voids around conduit openings in slab with water- and oil-resistant caulking or sealant. Cut off and bush conduits 3 inches [75mm] above slab surface. Concrete work shall be as specified in Section 03 30 00, CAST-IN-PLACE CONCRETE.
- D. Interior Location. Mount switchboard on concrete slab. Unless otherwise indicated, the slab shall be at least 4 inches [100mm] thick. The top of the concrete slab shall be approximately 4 inches [100mm] above finished floor. Edges above floor shall have 1/2 inch [12.5mm] chamfer. The slab shall be of adequate size to project at least 8 inches [200mm] beyond the equipment. Provide conduit turnups and cable entrance space required by the equipment to be mounted. Seal voids around conduit openings in slab with water- and oil-resistant caulking or sealant. Cut off and bush

conduits 3 inches [75mm] above slab surface. Concrete work shall be as specified in Section 03 30 00, CAST-IN-PLACE CONCRETE.

3.2 ACCEPTANCE CHECKS AND TESTS

A. Perform in accordance with the manufacturer's recommendations. Include the following visual and mechanical inspections and electrical tests:

1. Visual and Mechanical Inspection

- a. Compare equipment nameplate data with specifications and approved shop drawings.
- b. Inspect physical, electrical, and mechanical condition.
- c. Confirm correct application of manufacturer's recommended lubricants.
- d. Verify appropriate anchorage, required area clearances, and correct alignment.
- e. Verify that circuit breaker sizes and types correspond to approved shop drawings.
- f. Verifying tightness of accessible bolted electrical connections by calibrated torque-wrench method, or performing thermographic survey after energization.
- g. Confirm correct operation and sequencing of electrical and mechanical interlock systems.
- h. Clean switchboard.
- i. Inspect insulators for evidence of physical damage or contaminated surfaces.
- j. Verify correct shutter installation and operation.
- k. Exercise all active components.
- l. Verify the correct operation of all sensing devices, alarms, and indicating devices.
- m. If applicable, verify that vents are clear.
- n. If applicable, inspect control power transformers.

2. Electrical Tests

- a. Perform insulation-resistance tests on each bus section.
- b. Perform overpotential tests.
- c. Perform insulation-resistance test on control wiring; do not perform this test on wiring connected to solid-state components.
- d. Perform phasing check on double-ended switchboard to ensure correct bus phasing from each source.

3.3 FOLLOW-UP VERIFICATION

Upon completion of acceptance checks, settings, and tests, the Contractor shall show by demonstration in service that the switchboard is in good operating condition and properly performing the intended function. Circuit breakers shall be tripped by operation of each protective device.

3.4 INSTRUCTION

Furnish the services of a factory certified instructor for one 4 hour period for instructing personnel in the operation and maintenance of the switchboard and related equipment on the date requested by the Resident Engineer.

- - - E N D - - -

SECTION 26 24 16
PANELBOARDS

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation, and connection of panelboards.

1.2 RELATED WORK

- A. Section 09 91 00, PAINTING: Identification and painting of panelboards.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one Section of Division 26.
- C. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Cables and wiring.
- D. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- E. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits and outlet boxes.
- F. Section 26 09 23, LIGHTING CONTROLS: Lighting controls integral to panelboards.
- G. Section 26 43 13, TRANSIENT-VOLTAGE SURGE SUPPRESSION: Surge suppressors installed in panelboards.

1.3 QUALITY ASSURANCE

- A. Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. Submit in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Shop Drawings:
 - 1. Sufficient information, shall be clearly presented to determine compliance with drawings and specifications.
 - 2. Include electrical ratings, dimensions, mounting details, materials, wiring diagrams, accessories, and weights of equipment. Complete nameplate data, including manufacturer's name and catalog number.

C. Manuals:

1. When submitting the shop drawings, submit companion copies of complete maintenance and operating manuals, including technical data sheets and wiring diagrams.
2. If changes have been made to the maintenance and operating manuals that were originally submitted, then submit four copies of updated maintenance and operating manuals to the COTR two weeks prior to final inspection.

D. Certification: Two weeks prior to final inspection, submit four copies of the following to the COTR:

1. Certification by the manufacturer that the materials conform to the requirements of the drawings and specifications.
2. Certification by the contractor that the materials have been properly installed, connected, and tested.

1.5 APPLICABLE PUBLICATIONS

A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.

B. National Electrical Manufacturers Association (NEMA):

PB-1-06.....Panelboards
250-08.....Enclosures for Electrical Equipment (1000V
Maximum)

C. National Fire Protection Association (NFPA):

70-2008National Electrical Code (NEC)
70E-2009.....Standard for Electrical Life Safety in the
Workplace

D. Underwriters Laboratories, Inc. (UL):

50-95.....Enclosures for Electrical Equipment
67-09.....Panelboards
489-09.....Molded Case Circuit Breakers and Circuit
Breaker Enclosures

PART 2 - PRODUCTS

2.1 PANELBOARDS

- A. Panelboards shall be in accordance with UL, NEMA, NEC, and as shown on the drawings.
- B. Panelboards shall be standard manufactured products.
- C. All panelboards shall be hinged "door in door" type with:

1. Interior hinged door with hand-operated latch or latches, as required to provide access only to circuit breaker operating handles, not to energized parts.
 2. Outer hinged door shall be securely mounted to the panelboard box with factory bolts, screws, clips, or other fasteners, requiring a tool for entry. Hand-operated latches are not acceptable.
 3. Push inner and outer doors shall open left to right.
- D. All panelboards shall be completely factory-assembled with molded case circuit breakers and integral accessories, such as surge protective devices per Section 26 43 13, TRANSIENT-VOLTAGE SURGE SUPPRESSION, metering devices per Section 25 10 10, ADVANCED UTILITY METERING, lighting controls per Section 26 09 23, LIGHTING CONTROLS, and as scheduled on the drawings or specified herein. Include one-piece removable, inner dead front cover, independent of the panelboard cover.
- E. Panelboards shall have main breaker or main lugs, bus size, voltage, phase, top or bottom feed, and flush or surface mounting as scheduled on the drawings.
- F. Panelboards shall conform to NEMA PB-1, NEMA AB-1, and UL 67 and have the following features:
1. Non-reduced size copper bus bars with current ratings as shown on the panel schedules, rigidly supported on molded insulators.
 2. Bus bar connections to the branch circuit breakers shall be the "distributed phase" or "phase sequence" type.
 3. Mechanical lugs furnished with panelboards shall be cast, stamped, or machined metal alloys of sizes suitable for the conductors to which they will be connected.
 4. Neutral bus shall be 100% and 200% rated as indicated on drawings, mounted on insulated supports.
 5. Grounding bus bar shall be equipped with screws or lugs for the connection of grounding wires.
 6. Buses shall be braced for the available short-circuit current. Bracing shall not be less than 10,000 A symmetrical for 120/208 V and 120/240 V panelboards, and 14,000 A symmetrical for 277/480 V panelboards.
 7. Branch circuit panelboards shall have buses fabricated for bolt-on type circuit breakers.

8. Protective devices shall be designed so that they can easily be replaced.
9. Where designated on panel schedule "spaces," include all necessary bussing, device support, and connections. Provide blank cover for each space.
10. In two section panelboards, the main bus in each section shall be full size. The first section shall be furnished with through-feed lugs and have cable connections to the second section. Panelboard sections with tapped bus or crossover bus are not acceptable.
11. Series-rated panelboards are not permitted.

2.2 CABINETS AND TRIMS

Cabinets:

1. Provide galvanized steel cabinets to house panelboards. Cabinets for outdoor panelboards shall be factory primed and suitably treated with a corrosion-resisting paint finish meeting UL 50 and UL 67.
2. Cabinet enclosure shall not have ventilating openings.
3. Cabinets for panelboards may be of one-piece formed steel or of formed sheet steel with end and side panels welded, riveted, or bolted as required.

2.3 MOLDED CASE CIRCUIT BREAKERS FOR PANELBOARDS

- A. Circuit breakers shall be per UL 489, in accordance with the NEC, as shown on the drawings, and as specified.
- B. Circuit breakers in panelboards shall be bolt-on type.
- C. Molded case circuit breakers shall have minimum interrupting rating as required to withstand the available fault current, but not less than:
 1. 120/208 V Panelboard: 10,000 A symmetrical.
 2. 120/240 V Panelboard: 10,000 A symmetrical.
 3. 277/480 V Panelboard: 14,000 A symmetrical.
- D. Molded case circuit breakers shall have automatic, trip free, non-adjustable, inverse time, and instantaneous magnetic trips for 100 A frame or lower. Magnetic trip shall be adjustable from 3x to 10x for breakers with 250 A frames and higher. Breaker trip setting shall be set in the field, based on the approved protective device study as specified in Section 26 05 71, ELECTRICAL SYSTEM PROTECTIVE DEVICE STUDY.
- E. Breaker features shall be as follows:
 1. A rugged, integral housing of molded insulating material.

2. Silver alloy contacts.
3. Arc quenchers and phase barriers for each pole.
4. Quick-make, quick-break, operating mechanisms.
5. A trip element for each pole, thermal magnetic type with long time delay and instantaneous characteristics, a common trip bar for all poles and a single operator.
6. Electrically and mechanically trip free.
7. An operating handle which indicates ON, TRIPPED, and OFF positions.
8. An overload on one pole of a multipole breaker shall automatically cause all the poles of the breaker to open.
9. Ground fault current interrupting breakers, shunt trip breakers, lighting control breakers (including accessories to switch line currents), or other accessory devices or functions shall be provided where indicated.
10. For circuit breakers being added to existing panelboards, coordinate the breaker type with existing panelboards. Modify the panel directory accordingly.

2.4 SURGE SUPPRESSION

Where shown on drawings, furnish panelboard with integral transient voltage surge suppression device. Refer to Section 26 43 13, TRANSIENT-VOLTAGE SURGE SUPPRESSION.

2.5 SEPARATELY ENCLOSED MOLDED CASE CIRCUIT BREAKERS

- A. Where separately enclosed molded case circuit breakers are shown on the drawings, provide circuit breakers in accordance with the applicable requirements of those specified for panelboards.
- B. Enclosures are to be of the NEMA types shown on the drawings. Where the types are not shown, they are to be the NEMA type most suitable for the environmental conditions where the circuit breakers are being installed.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Installation shall be in accordance with the manufacturer's instructions, the NEC, as shown on the drawings, and as specified.
- B. Locate panelboards so that the present and future conduits can be conveniently connected.
- C. Install a printed schedule of circuits in each panelboard after approval by the COTR. Schedules shall be printed on the panelboard

directory cards, installed in the appropriate panelboards, and incorporate all applicable contract changes. Information shall indicate outlets, lights, devices, or other equipment controlled by each circuit, and the final room numbers served by each circuit. Indicate spares and spaces using erasable pencil.

- D. Mount the fully-aligned panelboard such that the maximum height of the top circuit breaker above the finished floor shall not exceed 78 in [1980 mm]. Mount panelboards that are too high such that the bottom of the cabinets will not be less than 6 in [150 mm] above the finished floor.
- E. For panelboards located in areas accessible to the public, paint the exposed surfaces of the trims, doors, and boxes with finishes to match surrounding surfaces after the panelboards have been installed.
- F. Rust and scale shall be removed from the inside of existing backboxes where new panelboards are to be installed. Paint inside of backboxes with rust-preventive paint before the new panelboard interior is installed. Provide new trim and doors for these panelboards. Covers shall fit tight to the box with no gaps between the cover and the box.

3.2 ACCEPTANCE CHECKS AND TESTS

Perform in accordance with the manufacturer's recommendations. Include the following visual and mechanical inspections and electrical tests:

1. Visual and Mechanical Inspection

- a. Compare equipment nameplate data with specifications and approved shop drawings.
- b. Inspect physical, electrical, and mechanical condition.
- c. Verify appropriate anchorage and required area clearances.
- d. Verify that circuit breaker sizes and types correspond to approved shop drawings.
- e. To verify tightness of accessible bolted electrical connections, use the calibrated torque-wrench method or perform thermographic survey after energization.
- f. Clean panelboard.

3.3 FOLLOW-UP VERIFICATION

Upon completion of acceptance checks, settings, and tests, the contractor shall demonstrate that the panelboards are in good operating condition and properly performing the intended function.

- - - E N D - - -

SECTION 26 27 26
WIRING DEVICES

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation and connection of wiring devices.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements that are common to more than one section of Division 26.
- B. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits and outlets boxes.
- C. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Cables and wiring.
- D. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Shop Drawings:
 - 1. Sufficient information, clearly presented, shall be included to determine compliance with drawings and specifications.
 - 2. Include electrical ratings, dimensions, mounting details, construction materials, grade and termination information.
- C. Manuals: Two weeks prior to final inspection, deliver four copies of the following to the Resident Engineer: Technical data sheets and information for ordering replacement units.
- D. Certifications: Two weeks prior to final inspection, submit four copies of the following to the Resident Engineer: Certification by the Contractor that the devices comply with the drawings and specifications, and have been properly installed, aligned, and tested.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent

referenced. Publications are referenced in the text by basic designation only.

- B. National Fire Protection Association (NFPA):
 - 70National Electrical Code (NEC)
- C. National Electrical Manufacturers Association (NEMA):
 - WD 1General Color Requirements for Wiring Devices
 - WD 6Wiring Devices - Dimensional Requirements
- D. Underwriter's Laboratories, Inc. (UL):
 - 5Surface Metal Raceways and Fittings
 - 20General-Use Snap Switches
 - 231Power Outlets
 - 467Grounding and Bonding Equipment
 - 498Attachment Plugs and Receptacles
 - 943Ground-Fault Circuit-Interrupters

PART 2 - PRODUCTS

2.1 RECEPTACLES

- A. General: All receptacles shall be listed by Underwriters Laboratories, Inc., and conform to NEMA WD 6.
 - 1. Mounting straps shall be plated steel, with break-off plaster ears and shall include a self-grounding feature. Terminal screws shall be brass, brass plated or a copper alloy metal.
 - 2. Receptacles shall have provisions for back wiring with separate metal clamp type terminals (four min.) and side wiring from four captively held binding screws.
- B. Duplex Receptacles: Hospital-grade, single phase, 20 ampere, 120 volts, 2-pole, 3-wire, and conform to the NEMA 5-20R configuration in NEMA WD 6. The duplex type shall have break-off feature for two-circuit operation. The ungrounded pole of each receptacle shall be provided with a separate terminal.
 - 1. Bodies shall be ivory in color.
 - 2. Switched duplex receptacles shall be wired so that only the top receptacle is switched. The remaining receptacle shall be unswitched.
 - 3. Duplex Receptacles on Emergency Circuit:
 - a. In rooms without emergency powered general lighting, the emergency receptacles shall be of the self-illuminated type.
 - 4. Ground Fault Interrupter Duplex Receptacles: Shall be an integral unit, hospital-grade, suitable for mounting in a standard outlet box.
 - a. Ground fault interrupter shall be consist of a differential current transformer, solid state sensing circuitry and a circuit interrupter switch. Device shall have nominal sensitivity to

- ground leakage current of five milliamperes and shall function to interrupt the current supply for any value of ground leakage current above five milliamperes (+ or - 1 milliamp) on the load side of the device. Device shall have a minimum nominal tripping time of 1/30th of a second.
- b. Ground Fault Interrupter Duplex Receptacles (not hospital-grade) shall be the same as ground fault interrupter hospital-grade receptacles except for the "hospital-grade" listing.
5. Safety Type Duplex Receptacles:
- a. Bodies shall be gray in color.
- 1) Shall permit current to flow only while a standard plug is in the proper position in the receptacle.
- 2) Screws exposed while the wall plates are in place shall be the tamperproof type.
6. Duplex Receptacles (not hospital grade): Shall be the same as hospital grade duplex receptacles except for the "hospital grade" listing and as follows.
- a. Bodies shall be brown phenolic compound supported by a plated steel mounting strap having plaster ears.
- C. Receptacles; 20, 30 and 50 ampere, 250 volts: Shall be complete with appropriate cord grip plug. Devices shall meet UL 231. NEMA Configuration type shall be per drawings.
- D. Weatherproof Receptacles: Shall consist of a duplex receptacle, mounted in box with a gasketed, weatherproof, cast metal cover plate and cap over each receptacle opening. The cap shall be permanently attached to the cover plate by a spring-hinged flap. The weatherproof integrity shall not be affected when heavy duty specification or hospital grade attachment plug caps are inserted. Cover plates on outlet boxes mounted flush in the wall shall be gasketed to the wall in a watertight manner.
- E. TVSS Receptacles. Shall comply with NEMA WD 1, NEMA WD 6, UL 498, and UL 1449, with integral TVSS in line to ground, line to neutral, and neutral to ground.
1. TVSS Components: Multiple metal-oxide varistors; with a nominal clamp-level rating of 400 volts and minimum single transient pulse energy dissipation of 240 J, according to IEEE C62.41.2 and IEEE C62.45.
2. Active TVSS Indication: Visual and audible, with light visible in face of device to indicate device is "active" or "no longer in service."

2.2 TOGGLE SWITCHES

- A. Toggle Switches: Shall be totally enclosed tumbler type with bodies of phenolic compound. Toggle handles shall be ivory in color unless otherwise specified. The rocker type switch is not acceptable and will not be approved.
 - 1. Switches installed in hazardous areas shall be explosion proof type in accordance with the NEC and as shown on the drawings.
 - 2. Shall be single unit toggle, butt contact, quiet AC type, heavy-duty general-purpose use with an integral self grounding mounting strap with break-off plaster ears and provisions for back wiring with separate metal wiring clamps and side wiring with captively held binding screws.
 - 3. Ratings:
 - a. 120 volt circuits: 20 amperes at 120-277 volts AC.
 - b. 277 volt circuits: 20 amperes at 120-277 volts AC.

2.3 MANUAL DIMMING CONTROL

- A. Slide dimmer with on/off control, single-pole or three-way as shown on plans. Faceplates shall be ivory in color unless otherwise specified.
- B. Manual dimming controls shall be fully compatible with electronic dimming ballasts and approved by the ballast manufacturer, shall operate over full specified dimming range, and shall not degrade the performance or rated life of the electronic dimming ballast and lamp.

2.4 WALL PLATES

- A. Wall plates for switches and receptacles shall be type 302 stainless steel. Oversize plates are not acceptable.
- B. Standard NEMA design, so that products of different manufacturers will be interchangeable. Dimensions for openings in wall plates shall be accordance with NEMA WD 6.
- C. For receptacles or switches mounted adjacent to each other, wall plates shall be common for each group of receptacles or switches.
- D. In psychiatric areas, wall plates shall be 302 stainless steel, have tamperproof screws and beveled edges.
- E. Wall plates for data, telephone or other communication outlets shall be as specified in the associated specification.
- F. Duplex Receptacles on Emergency Circuit:
 - 1. Bodies shall be red in color. Wall plates shall be red with the word "EMERGENCY" engraved in 6 mm, (1/4 inch) white letters.

2.5 SURFACE MULTIPLE-OUTLET ASSEMBLIES

- A. Assemblies shall conform to the requirements of NFPA 70 and UL 5.

B. Shall have the following features:

1. Enclosures:

- a. Thickness of steel shall be not less than 0.040 inch [1mm] steel for base and cover. Nominal dimension shall be 1-1/2 by 2-3/4 inches [40 by 70mm] with inside cross sectional area not less than 3.5 square inches [2250 square mm]. The enclosures shall be thoroughly cleaned, phosphatized and painted at the factory with primer and the manufacturer's standard baked enamel or lacquer finish.
2. Receptacles shall be duplex, hospital grade. See paragraph 'RECEPTACLES' in this section. Device cover plates shall be the manufacturer's standard corrosion resistant finish and shall not exceed the dimensions of the enclosure.
3. Unless otherwise shown on drawings, spacing of the receptacles along the strip shall be 24 inches [600mm] on centers.
4. Wires within the assemblies shall be not less than No. 12 AWG copper, with 600 volt ratings.
5. Installation fittings shall be designed for the strips being installed including bends, offsets, device brackets, inside couplings, wire clips, and elbows.
6. Bond the strips to the conduit systems for their branch supply circuits.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Installation shall be in accordance with the NEC and as shown as on the drawings.
- B. Ground terminal of each receptacle shall be bonded to the outlet box with an approved green bonding jumper, and also connected to the green equipment grounding conductor.
- C. Outlet boxes for light and dimmer switches shall be mounted on the strike side of doors.
- D. Provide barriers in multigang outlet boxes to separate systems of different voltages, Normal Power and Emergency Power systems, and in compliance with the NEC.
- E. Coordinate with other work, including painting, electrical boxes and wiring installations, as necessary to interface installation of wiring devices with other work. Coordinate the electrical work with the work of other trades to ensure that wiring device flush outlets are positioned with box openings aligned with the face of the surrounding finish material. Pay special attention to installations in cabinet work, and in connection with laboratory equipment.

- F. Exact field locations of floors, walls, partitions, doors, windows, and equipment may vary from locations shown on the drawings. Prior to locating sleeves, boxes and chases for roughing-in of conduit and equipment, the Contractor shall coordinate exact field location of the above items with other trades. In addition, check for exact direction of door swings so that local switches are properly located on the strike side.
- G. Install wall switches 48 inches [1200mm] above floor, OFF position down.
- H. Install wall dimmers 48 inches [1200mm] above floor; derate ganged dimmers as instructed by manufacturer; do not use common neutral.
- I. Install convenience receptacles 18 inches [450mm] above floor, and 6 inches [152mm] above counter backsplash or workbenches. Install specific-use receptacles at heights shown on the drawings.
- J. Label device plates with a permanent adhesive label listing panel and circuit feeding the wiring device.
- K. Test wiring devices for damaged conductors, high circuit resistance, poor connections, inadequate fault current path, defective devices, or similar problems using a portable receptacle tester. Correct circuit conditions, remove malfunctioning units and replace with new, and retest as specified above.
- L. Test GFCI devices for tripping values specified in UL 1436 and UL 943.

- - - E N D - - -

SECTION 26 29 11
MOTOR STARTERS

PART 1 - GENERAL

1.1 DESCRIPTION

All motor starters and variable speed motor controllers, including installation and connection (whether furnished with the equipment specified in other Divisions or otherwise), shall meet these specifications.

1.2 RELATED WORK

- A. Other sections which specify motor driven equipment, except elevator motor controllers.
- D. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one Section of Division 26.
- E. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. Submit in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS:
- B. Shop Drawings:
 - 1. Sufficient information, clearly presented, shall be included to determine compliance with drawings and specifications.
 - 2. Include electrical ratings, dimensions, weights, mounting details, materials, running over current protection, size of enclosure, over current protection, wiring diagrams, starting characteristics, interlocking and accessories.
- C. Manuals:
 - 1. Submit, simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals, including technical data sheets, wiring diagrams and information for ordering replacement parts.
 - a. Wiring diagrams shall have their terminals identified to facilitate installation, maintenance and operation.
 - b. Wiring diagrams shall indicate internal wiring for each item of equipment and interconnections between the items of equipment.

- c. Elementary schematic diagrams shall be provided for clarity of operation.
- 2. Two weeks prior to the project final inspection, submit four copies of the final updated maintenance and operating manual to the Resident Engineer.
- D. Certification: Two weeks prior to final inspection, unless otherwise noted, submit four copies of the following certifications to the Resident Engineer:
 - 1. Certification that the equipment has been properly installed, adjusted, and tested.
 - 2. Certification by the manufacturer that medium voltage motor controller(s) conforms to the requirements of the drawings and specifications. This certification must be furnished to the Resident Engineer prior to shipping the controller(s) to the job site.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by basic designation only.
- B. Institute of Electrical and Electronic Engineers (IEEE):
 - 519Recommended Practices and Requirements for
Harmonic Control in Electrical Power Systems
 - C37.90.1Standard Surge Withstand Capability (SWC) Tests
for Protective Relays and Relay Systems
- C. National Electrical Manufacturers Association (NEMA):
 - ICS 1Industrial Control and Systems General
Requirements
 - ICS 1.1Safety Guidelines for the Application,
Installation and Maintenance of Solid State
Control
 - ICS 2Industrial Control and Systems, Controllers,
Contactors and Overload Relays Rated 600 Volts
DC
 - ICS 6Industrial Control and Systems Enclosures
 - ICS 7Industrial Control and Systems Adjustable-Speed
Drives
 - ICS 7.1Safety Standards for Construction and Guide for
Selection, Installation and Operation of
Adjustable-Speed Drive Systems
- D. National Fire Protection Association (NFPA):
 - 70National Electrical Code (NEC)

E. Underwriters Laboratories Inc. (UL):

508Industrial Control Equipment

PART 2 - PRODUCTS

2.1 MOTOR STARTERS, GENERAL

- A. Shall be in accordance with the requirements of the IEEE, NEC, NEMA (ICS 1, ICS 1.1, ICS 2, ICS 6, ICS 7 and ICS 7.1) and UL.
- B. Shall have the following features:
 - 1. Separately enclosed unless part of another assembly.
 - 2. Circuit breakers and safety switches within the motor controller enclosures shall have external operating handles with lock-open padlocking provisions and shall indicate the ON and OFF positions.
 - 3. Motor control circuits:
 - a. Shall operate at not more than 120 volts.
 - b. Shall be grounded except as follows:
 - 1) Where isolated control circuits are shown.
 - 2) Where manufacturers of equipment assemblies recommend that the control circuits be isolated.
 - c. Incorporate a separate, heavy duty, control transformer within each motor controller enclosure to provide the control voltage for each motor operating over 120 volts.
 - d. Incorporate over current protection for both primary and secondary windings of the control power transformers in accordance with the NEC.
 - 4. Overload current protective devices:
 - a. Overload relay thermal or bi-metallic type.
 - b. Overload relay solid state type.
 - c. One for each pole.
 - d. Manual reset on the door of each motor controller enclosure.
 - e. Correctly sized for the associated motor's rated full load current.
 - f. Check every motor controller after installation and verify that correct sizes of protective devices have been installed.
 - g. Deliver four copies of a summarized list to the Resident Engineer, which indicates and adequately identifies every motor controller installed. Include the catalog numbers for the correct sizes of protective devices for the motor controllers.
 - 5. Hand-Off-Automatic (H-O-A) switch is required unless specifically stated on the drawings as not required for a particular starter. H-O-A switch is not required for manual motor starters.

6. Incorporate into each control circuit a 120-volt, solid state time delay relay (ON delay), minimum adjustable range from 0.3 to 10 minutes, with transient protection. Time delay relay is not required where H-O-A switch is not required.
7. Unless noted otherwise, equip with not less than two normally open and two normally closed auxiliary contacts. Provide green run pilot lights and H-O-A control devices as indicated, operable at front of enclosure without opening enclosure. Push buttons, selector switches, pilot lights, etc., shall be interchangeable.
8. Enclosures:
 - a. Shall be the NEMA types shown on the drawings for the motor controllers and shall be the NEMA types which are the most suitable for the environmental conditions where the motor controllers are being installed.
 - b. Doors mechanically interlocked to prevent opening unless the breaker or switch within the enclosure is open. Provision for padlock must be provided.
 - c. Enclosures shall be primed and finish coated at the factory with the manufacturer's prime coat and standard finish.
- C. Motor controllers incorporated with equipment assemblies shall also be designed for the specific requirements of the assemblies.
- D. For motor controllers being installed in existing motor control centers or panelboards, coordinate with the existing centers or panelboards.
- E. Additional requirements for specific motor controllers, as indicated in other sections, shall also apply.
- F. Provide a disconnecting means or safety switch near and within sight of each motor. Provide all wiring and conduit required to facilitate a complete installation.

2.2 MANUAL MOTOR STARTERS

- A. Shall be in accordance with applicable requirements of 2.1 above.
- B. Manual motor starters.
 1. Starters shall be general-purpose Class A, manually operated type with full voltage controller for induction motors, rated in horsepower.
 2. Units shall include overload and low voltage protection, red pilot light, NO auxiliary contact and toggle operator.
- C. Fractional horsepower manual motor starters.
 1. Starters shall be general-purpose Class A, manually operated with full voltage controller for fractional horsepower induction motors.

2. Units shall include thermal overload protection, red pilot light and toggle operator.

D. Motor starting switches.

1. Switches shall be general-purpose Class A, manually operated type with full voltage controller for fractional horsepower induction motors.

2. Units shall include thermal overload protection, red pilot light low voltage protection, NO auxiliary contact and toggle operator.

2.3 MAGNETIC MOTOR STARTERS

A. Shall be in accordance with applicable requirements of 2.1 above.

B. Starters shall be general-purpose, Class A magnetic controllers for induction motors rated in horsepower. Minimum size 0.

C. Where combination motor starters are used, combine starter with protective or disconnect device in a common enclosure.

D. Provide phase loss protection for each starter, with contacts to de-energize the starter upon loss of any phase.

E. Unless otherwise indicated, provide full voltage non-reversing across-the-line mechanisms for motors less than 75 HP, closed by coil action and opened by gravity. For motors 75 HP and larger, provide reduced voltage starters. Equip starters with 120V AC coils and individual control transformer unless otherwise noted. Locate "reset" button to be accessible without opening the enclosure.

2.6 VARIABLE SPEED MOTOR CONTROLLERS

A. Shall be in accordance with applicable portions of 2.1 above.

B. Shall be solid state, micro processor-based with adjustable frequency and voltage, three phase output capable of driving standard NEMA B design, three phase alternating current induction motors at full rated speed. The drives shall utilize a full wave bridge design incorporating diode rectifier circuitry with pulse width modulation (PWM). Other control techniques are not acceptable. Silicon controlled rectifiers (SCR) shall not be used in the rectifying circuitry. The drives shall be designed to be used on variable torque loads and shall be capable of providing sufficient torque to allow the motor to break away from rest upon first application of power.

C. Unit shall be capable of operating within voltage parameters of plus 10 to minus 10 percent of line voltage, and be suitably rated for the full load amps of the maximum watts (HP) within its class.

D. Operating and Design Conditions:

Elevation: 1000feet AMSL

Temperatures: Maximum +90°F Minimum 10°F

Relative Humidity: 95%

Drive Location: non-conditioned Building

E. Controllers shall have the following features:

1. Isolated power for control circuits.
2. Manually re-settable motor overload protection for each phase.
3. Adjustable current limiting circuitry to provide soft motor starting. Maximum starting current shall not exceed 200 percent of motor full load current.
4. Independent acceleration and deceleration time adjustment, manually adjustable from 2 to 30 seconds. (Set timers to the equipment manufacturer's recommended time in the above range.)
5. Provide 4 to 20 ma current follower circuitry for interface with mechanical sensor devices.
6. Automatic frequency adjustment from 20 Hz to 60 Hz.
7. Provide circuitry to initiate an orderly shutdown when any of the conditions listed below occur. The controller shall not be damaged by any of these electrical disturbances and shall automatically restart when the conditions are corrected. The drive shall be able to restart into a rotating motor operating in either the forward or reverse direction and matching that frequency.
 - a. Incorrect phase sequence.
 - b. Single phasing.
 - c. Over voltage in excess of 10 percent.
 - d. Under voltage in excess of 10 percent.
 - e. Running over current above 110 percent (shall not automatically reset for this condition.)
 - f. Instantaneous overcurrent above 150 percent (shall not automatically reset for this condition).
 - g. Surge voltage in excess of 1000 volts.
 - h. Short duration power outages of 12 cycles or less (i.e., distribution line switching, generator testing, and automatic transfer switch operations.)
9. Automatic Reset/Restart: Attempt three restarts after drive fault or on return of power after an interruption and before shutting down for manual reset or fault correction; adjustable delay time between restart attempts.
10. Power-Interruption Protection: To prevent motor from re-energizing after a power interruption until motor has stopped, unless "Bidirectional Autospeed Search" feature is available and engaged.

11. Bidirectional Autospeed Search: Capable of starting VFC into rotating loads spinning in either direction and returning motor to set speed in proper direction, without causing damage to drive, motor, or load.
- F. Minimum efficiency shall be 95 percent at 100 percent speed and 85percent at 50 percent speed.
- G. The displacement power factor of the controller shall not be less than 95 percent under any speed or load condition.
- H. Controllers shall include a door interlocked fused safety disconnect switch or door interlocked circuit breaker switch which will disconnect all input power.
- I. Controller shall include a 3% input line reactor, and RFI/EMI filter.
- J. The following accessories are to be door mounted:
 1. AC Power on light.
 2. Ammeter (RMS motor current).
 3. HAND-OFF-AUTOMATIC switch.
 4. Manual speed control in HAND mode.
 5. System protection lights indicating that the system has shutdown and will not automatically restart.
 6. System protection light indicating that the system has shutdown but will restart when conditions return to normal.
 7. Manual variable speed controller by-pass switch.
 8. Diagnostic shutdown indicator lights for each shutdown condition.
 9. Provide two N.O. and two N.C. dry contacts rated 120 volts, 10 amperes, 60 HZ for remote indication of the following:
 - a. System shutdown with auto restart.
 - b. System shutdown without auto restart.
 - c. System running.
 10. Incorporate into each control circuit a 120-volt, time delay relay (ON delay), adjustable from 0.3-10 minutes, with transient protection. Provide transformer/s for the control circuit/s.
 11. Controller shall not add any current or voltage transients to the input AC power distribution system nor shall transients from other devices on the AC power distribution system affect the controller. Controllers shall be protected to comply with IEEE C37.90.1 and UL-508. Line noise and harmonic voltage distortion shall not exceed the values allowed by IEEE 519.
- K. Hardware and software to enable the BAS to monitor, control, and display controller status and alarms.
- L. Network Communications Ports: Ethernet and //RS-422/485// // //.

- M. Embedded BAS Protocols for Network Communications: As specified in Division 22.
- N. Bypass Operation: Manually transfers motor between power converter output and bypass circuit, manually, automatically, or both. Unit is capable of stable operation (starting, stopping, and running) with motor completely disconnected from power converter. Transfer between power converter and bypass contactor and retransfer shall only be allowed with the motor at zero speed.
- O. Bypass Controller: Provide contactor-style bypass, arranged to isolate the power converter input and output and permit safe testing of the power converter, both energized and de-energized, while motor is operating in bypass mode. Motor overload protection shall be provided.
 - 1. Bypass Contactor: Load-break NEMA-rated contactor.
 - 2. Input and Output Isolating Contactors: Non-load-break, NEMA-rated contactors.
 - 3. Isolating Switch: Non-load-break switch arranged to isolate power converter and permit safe troubleshooting and testing of the power converter, both energized and de-energized, while motor is operating in bypass mode; pad-lockable, door-mounted handle mechanism.

2.7 MOTOR CONTROL STATIONS

- A. Shall have the following features:
 - 1. Designed for suitably fulfilling the specific control functions for which each station is being installed.
 - 2. Coordinate the use of momentary contacts and maintained contacts with the complete motor control systems to insure safety for people and equipment.
 - 3. Each station shall have two pilot lights behind red and green jewels and a circuit to its motor controller. Connect the lamps so they will be energized as follows:
 - a. Red while the motor is running.
 - b. Green while the motor is stopped.
 - 4. Where two or more stations are mounted adjacent to each other, install a common wall plate, except where the designs of the stations make such common plates impracticable.
 - 5. Identify each station with a permanently attached individual nameplate, of laminated black phenolic resin with a white core and engraved lettering not less than 6 mm (1/4-inch) high. Identify the motor by its number or other designation and indicate the function fulfilled by the motor.

B. Components of Motor Control Circuits:

1. Shall also be designed and arranged so that accidental faulting or grounding of the control conductors will not be able to start the motors.
2. Use of locking type STOP pushbuttons or switches, which cause motors to restart automatically when the pushbuttons or switches are released, will not be permitted.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install motor control equipment in accordance with manufacturer's recommendations, the NEC, NEMA and as shown on the drawings.
- C. Furnish and install heater elements in motor starters and to match the installed motor characteristics. Submit a list of all motors listing motor nameplate rating and heater element installed.
- D. Motor Data: Provide neatly-typed label inside each motor starter enclosure door identifying motor served, nameplate horsepower, full load amperes, code letter, service factor, voltage/phase rating and heater element installed.
- E. Connect hand-off auto selector switches so that automatic control only is by-passed in "manual" position and any safety controls are not by-passed.
- F. Install manual motor starters in flush enclosures in finished areas.
- G. Examine control diagrams indicated before ordering motor controllers. Should conflicting data exist in specifications, drawings and diagrams, request corrected data prior to placing orders.

3.2 ADJUSTING

- A. Set field-adjustable switches, auxiliary relays, time-delay relays, timers, and overload-relay pickup and trip ranges.
- B. Adjust overload-relay heaters or settings if power factor correction capacitors are connected to the load side of the overload relays.
- C. Adjust trip settings of MCPs and thermal-magnetic circuit breakers with adjustable instantaneous trip elements. Initially adjust at six times the motor nameplate full-load ampere ratings and attempt to start motors several times, allowing for motor cooldown between starts. If tripping occurs on motor inrush, adjust settings in increments until motors start without tripping. Do not exceed eight times the motor full-load amperes (or 11 times for NEMA Premium Efficient motors if required). Where these maximum settings do not allow starting of a motor, notify Resident Engineer before increasing settings.

3.3 ACCEPTANCE CHECKS AND TESTS

- A. Perform in accordance with the manufacturer's recommendations. Include the following visual and mechanical inspections and electrical tests:

1. Visual and Mechanical Inspection
 - a. Compare equipment nameplate data with specifications and approved shop drawings.
 - b. Inspect physical, electrical, and mechanical condition.
 - c. Inspect contactors.
 - d. Clean motor starters and variable speed motor controllers.
 - e. Verify overload element ratings are correct for their applications.
 - f. If motor-running protection is provided by fuses, verify correct fuse rating.
 - g. Verify tightness of accessible bolted electrical connections by calibrated torque-wrench method in accordance with manufacturer's published data.
2. Variable speed motor controllers:
 - a. Final programming and connections to variable speed motor controllers shall be by a factory-trained technician. Set all programmable functions of the variable speed motor controllers to meet the requirements and conditions of use.
 - b. Test all control and safety features of the variable frequency drive.

3.4 FOLLOW-UP VERIFICATION

Upon completion of acceptance checks, settings, and tests, the Contractor shall show by demonstration in service that the motor starters and variable speed motor controllers are in good operating condition and properly performing the intended functions.

3.5 SPARE PARTS

Two weeks prior to the final inspection, provide one complete set of spare fuses (including heater elements) for each starter/controller installed on this project.

- - - E N D - - -

SECTION 26 29 21
DISCONNECT SWITCHES

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the furnishing, installation, and connection of low voltage disconnect switches.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- B. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES 600 VOLTS AND BELOW: Cables and wiring.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground faults.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits for cables and wiring.
- E. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS: Motor rated toggle switches.

1.3 QUALITY ASSURANCE

- A. Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. Submit in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Shop Drawings:
 - 1. Clearly present sufficient information to determine compliance with drawings and specifications.
 - 2. Include electrical ratings, dimensions, mounting details, materials, enclosure types, and fuse types and classes.
 - 3. Show the specific switch and fuse proposed for each specific piece of equipment or circuit.
- C. Manuals:
 - 1. Provide complete maintenance and operating manuals for disconnect switches, including technical data sheets, wiring diagrams, and information for ordering replacement parts. Deliver four copies to the COTR two weeks prior to final inspection.
 - 2. Terminals on wiring diagrams shall be identified to facilitate maintenance and operation.
 - 3. Wiring diagrams shall indicate internal wiring and any interlocking.

- D. Certifications: Two weeks prior to the final inspection, submit four copies of the following certifications to the COTR:
1. Certification by the manufacturer that the materials conform to the requirements of the drawings and specifications.
 2. Certification by the contractor that the materials have been properly installed, connected, and tested.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. National Electrical Manufacturers Association (NEMA):
- FU 1-07Low Voltage Cartridge Fuses
- KS 1-06Enclosed and Miscellaneous Distribution
Equipment Switches (600 Volts Maximum)
- C. National Fire Protection Association (NFPA):
- 70-08National Electrical Code (NEC)
- D. Underwriters Laboratories, Inc. (UL):
- 98-04Enclosed and Dead-Front Switches
- 248-00Low Voltage Fuses
- 977-94Fused Power-Circuit Devices

PART 2 - PRODUCTS

2.1 LOW VOLTAGE FUSIBLE SWITCHES RATED 600 AMPERES AND LESS

- A. In accordance with UL 98, NEMA KS1, and NEC.
- B. Shall have NEMA classification General Duty (GD) for 240 V switches and NEMA classification Heavy Duty (HD) for 480 V switches.
- C. Shall be HP rated.
- D. Shall have the following features:
1. Switch mechanism shall be the quick-make, quick-break type.
 2. Copper blades, visible in the OFF position.
 3. An arc chute for each pole.
 4. External operating handle shall indicate ON and OFF position and have lock-open padlocking provisions.
 5. Mechanical interlock shall permit opening of the door only when the switch is in the OFF position, defeatable to permit inspection.
 6. Fuse holders for the sizes and types of fuses specified.
 8. Solid neutral for each switch being installed in a circuit which includes a neutral conductor.
 9. Ground lugs for each ground conductor.
 10. Enclosures:
 - a. Shall be the NEMA types shown on the drawings for the switches.

b. Where the types of switch enclosures are not shown, they shall be the NEMA types most suitable for the ambient environmental conditions. Unless otherwise indicated on the plans, all outdoor switches shall be NEMA 3R.

c. Shall be finished with manufacturer's standard gray baked enamel paint over pretreated steel (for the type of enclosure required).

2.2 LOW VOLTAGE UNFUSED SWITCHES RATED 600 AMPERES AND LESS

Shall be the same as Low Voltage Fusible Switches Rated 600 Amperes and Less, but without provisions for fuses.

2.3 LOW VOLTAGE FUSIBLE SWITCHES RATED OVER 600 AMPERES TO 1200 AMPERES

Shall be the same as Low Voltage Fusible Switches Rated 600 Amperes and Less, except for the minimum duty rating which shall be NEMA classification Heavy Duty (HD). These switches shall also be HP rated.

2.4 MOTOR RATED TOGGLE SWITCHES

Refer to Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS.

2.5 LOW VOLTAGE CARTRIDGE FUSES

- A. In accordance with NEMA FU1.
- B. Service Entrance: Class L, time delay.
- C. Feeders: Class RK1, time delay.
- D. Motor Branch Circuits: time delay.
- E. Other Branch Circuits: Class J, fast acting.
- F. Control Circuits: Class CC, fast acting.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install disconnect switches in accordance with the NEC and as shown on the drawings.
- B. Fusible disconnect switches shall be furnished complete with fuses. Arrange fuses such that rating information is readable without removing the fuse.

3.2 SPARE PARTS

Two weeks prior to the final inspection, furnish one complete set of spare fuses for each fusible disconnect switch installed on the project. Deliver the spare fuses to the COTR.

- - - E N D - - -

SECTION 26 41 00
FACILITY LIGHTNING PROTECTION

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing and installation of a complete master labeled lightning protection system, complying with NFPA 780, UL 96 and UL 96A.

1.2 RELATED WORK

- A. Section 07 60 00, FLASHING AND SHEET METAL: penetrations through the roof.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements that are common to more than one section of Division 26.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground faults.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Shop Drawings:
 - 1. Isometric and plan views showing layout and connections to the required metal surfaces.
 - 2. Show the methods of mounting the system to the adjacent construction.
- C. Qualifications: Submit proof that the installer of the lightning protection system is a certified Lightning Protection Institute (LPI) installer, and has had suitable and adequate experience installing other lightning protection systems, and is capable of installing the system as recommended by the manufacturer of the equipment.
- D. Certification: Two weeks prior to final inspection, submit four copies of the following certifications to the Resident Engineer:
 - 1. Certification that the lightning protection system has been properly installed and tested.
 - 2. Certification that the lightning protection system has been inspected by a UL representative and has been approved by UL without variation.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. National Fire Protection Association (NFPA):
 - 70.....National Electrical Code (NEC)
 - 780.....Standard for the Installation of Lightning Protection Systems
- C. Underwriters Laboratories, Inc. (UL):
 - 96.....Lightning Protection Components
 - 96A.....Installation Requirements for Lightning Protection Systems
 - UL 467Standard for Grounding and Bonding Equipment

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Attach master labels to each item by its manufacturer as evidence that the materials have been manufactured in conformance with the UL Standards for master label lightning protection materials.
- B. In addition to conformance to UL 96, the component material requirements are as follows:
 - 1. Conductors: Electrical grade copper. Conductors shall be in accordance with NFPA 780 and UL 96 for Class I, Class II, or Class II modified materials as applicable.
 - 2. Air terminals: Solid copper, 24 inches long, not less than 3/8 inch [9mm] diameter, with sharp nickel-plated points.
 - 3. Ground rods: Copper clad steel, not less than 3/4 inch [19mm] diameter by 10 feet [3050mm] long. Rods made of copper-clad steel shall conform to UL 467 and galvanized ferrous rods shall conform to IEEE C135.30. Ground rods of copper-clad steel, steel, stainless steel, galvanized ferrous, and solid copper shall not be mixed on the project.
 - 4. Ground plates: Solid copper, not less than 1/16 inch [2mm] thick.
 - 5. Tubing: Stiff copper or brass.
- C. Anchors and fasteners: Bolt type which are most suitable for the specific anchor and fastener installations. Clamp-type connectors for splicing conductors shall conform to UL 96, class as applicable, and, Class 2, style and size as required for the installation. Clamp-type connectors shall only be used for the connection of the roof conductor to the air terminal and to the guttering. All other connections, bonds, and splices shall be done by exothermic welds or by high compression

fittings. The exothermic welds and high compression fittings shall be listed for the purpose. The high compression fittings shall be the type which require a hydraulically operated mechanism to apply a minimum of 10,000 psi.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Installation shall be coordinated with the roofing manufacturer and installer.
- B. Install the conductors as inconspicuously as practical and with the proper bends.
- C. Install the vertical conductors within the concealed cavity of exterior walls. Run the conductors to the exterior at elevations below the finished grade and make the ground connections to the earth outside of the building or stack perimeter.
- D. Make connections of dissimilar metal with bimetallic type fittings to prevent electrolytic action.
- E. Use the exothermic welding type connections that form solid metal joints in the main vertical and horizontal conductors, and for connections that are not exposed in the finish work.
- F. Protect copper conductors with stiff copper or brass tubing, which enclose the conductors from the top to the bottom of the tubing, between one foot [300mm] below and seven feet [2100mm] above the finished grade. The conductor shall be bonded to the top and bottom of the tubing.
- G. Sheath copper conductors, which pass over cast stone, cut stone, architectural concrete and masonry surfaces, with not less than a 1/16 inch [2mm] thickness of lead to prevent staining of the exterior finish surfaces.
- H. For the earth connections, install ground rods and ground plates, and the conductor connections to them and the main water pipes in the presence of the Resident Engineer. For the conductors located outside of the building or stack, install the conductors not less than two feet [600mm] below the finished grade.
- I. For structural steel buildings, connect the steel framework of the buildings to the main water pipe near the water system entrance to the building.
- J. Connect lightning protection cables to all metallic projections, equipment, and components above the roof as indicated on the drawings.
- K. Connect exterior metal surfaces, located within three feet [900mm] of the lightning protection system conductors, to the lightning protection system conductors to prevent flashovers.

- L. Maintain horizontal or downward coursing of main conductor and insure that all bends have at least an 8-inch radius and do not exceed 90 degrees.
- M. Conductors shall be rigidly fastened every three feet [900mm] along the roof and down to the building to ground.
- N. Air terminals shall be secured against overturning either by attachment to the object to be protected or by means of a substantial tripod or other braces permanently and rigidly attached to the building or structure. Install air terminal bases, cable holders and other roof-system supporting means without piercing roof metal.
- O. Use through-roof connectors for down-conductor attachment to roof system. Provide flashing in accordance with Section 07 60 00, FLASHING AND SHEET METAL.
- P. Down-conductors coursed on or in reinforced concrete columns or on structural steel columns shall be connected to the reinforcing steel or the structural steel member at its upper and lower extremities. In the case of long vertical members an additional connection shall be made at intervals not exceeding 100 feet [30m].
- Q. A counterpoise, where shown, shall be of No. 1/0 copper cable or equivalent material having suitable resistance to corrosion and shall be laid around the perimeter of the structure in a trench not less than 2 feet [600mm] deep at a distance not less than 3 feet [900mm] nor more than 8 feet [2.5m] from the nearest point of the structure.
- R. On construction utilizing post tensioning systems to secure precast concrete sections, the post tension rods shall not be used as a path for lightning to ground. Down conductors shall be provided on structures using post tensioning systems. Down conductors shall have sufficient separation from post tension rods to prevent side-flashing. Post tension rods shall be bonded to the lightning protection and grounding systems only at the base of the structure; this bonding shall be performed in strict accordance with the recommendations of the post tension rod manufacturer, and shall be done by, or in the presence of, a representative of the manufacturer.
- S. Grounding: Test the ground resistance to earth by standard methods and conform to the ground resistance requirements specified in Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
- T. Where shown, use the structural steel framework or reinforcing steel as the main conductor:
 - 1. Weld or bond the non-electrically-continuous sections together and make them electrically continuous.

2. Verify the electrical continuity by measuring the ground resistances to earth at the ground level, at the top of the building or stack, and at intermediate points with a sensitive ohmmeter. Compare the resistance readings.
 3. Connect the air terminals together with an exterior conductor connected to the structural steel framework at not more than 60 foot [18m] intervals.
 4. Install ground connections to earth at not more than 60 foot [18m] intervals around the perimeter of the building.
 5. Weld or braze bonding plates, not less than 8 inches [200mm] square, to cleaned sections of the steel and connect the conductors to the plates.
 6. Do not pierce the structural steel in any manner. Connections to the structural steel shall conform to UL Publication No. 96A.
- U. When the lightning protection systems have been installed, have the systems inspected by a UL representative. Obtain and install a UL numbered master label for each of the lightning protection systems at the location directed by the UL representative and the Resident Engineer.
- V. Where the drawings show the new lightning protection system connected to an existing lightning protection system without a UL master label, the new portion of the lightning system shall require inspection and labels as specified above for new work.
- W. Metal fences that are electrically continuous with metal posts extending at least 2 feet [600mm] into the ground require no additional grounding. Other fences shall be grounded on each side of every gate. Fences shall be grounded by means of ground rods every 1000 to 1500 feet [300 to 450m] of length when fences are located in isolated places, and every 500 to 750 feet [150 to 225m] when in proximity (100 feet [30m] or less) to public roads, highways, and buildings.

- - - E N D - - -

SECTION 26 43 13
TRANSIENT-VOLTAGE SURGE SUPPRESSION

PART 1 - GENERAL

1.1 DESCRIPTION

Section includes transient voltage surge suppression equipment for low-voltage power distribution and control equipment.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General requirements that are common to more than one section of Division 26.
- C. Section 26 24 11, DISTRIBUTION SWITCHBOARDS: For factory-installed TVSS.
- D. Section 26 24 16, PANELBOARDS: For factory-installed TVSS.
- E.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. Include rated capacities, operating weights, electrical characteristics, furnished specialties, and accessories.
- B. Operation and Maintenance Data: For TVSS devices to include in emergency, operation, and maintenance manuals.
- C. Warranties: Sample of special warranties.
- D. Certifications:
 - 1. Two weeks prior to final inspection, submit four copies of the following to the Resident Engineer:
 - a. Certification by the Contractor that the assemblies have been properly installed, adjusted and tested.
 - b. Certified copies of all of the factory design and production tests, field test data sheets and reports for the assemblies.

1.5 APPLICABLE PUBLICATIONS

Publications listed below (including amendments, addenda, revisions, supplement and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.

- A. Institute of Engineering and Electronic Engineers (IEEE):
 - IEEE C62.41.2Recommended Practice on Characterization of Surges in Low-Voltage (1000 V and Less) AC Power Circuits

IEEE C62.45Recommended Practice on Surge Testing for
Equipment Connected to Low-Voltage (1000
V and Less) AC Power Circuits

B. National Electrical Manufacturers Association (NEMA):

NEMA LS 1Low Voltage Surge Protective Devices

C. Underwriters Laboratories, Inc. (UL):

UL 1283Electromagnetic Interference Filters

UL 1449, Third Edition.....Surge Protective Devices

D. National Fire Protection Association (NFPA):

NFPA 70National Electrical Code (NEC)

PART 2 - PRODUCTS

2.1 SWITCHGEAR/SWITCHBOARD SUPPRESSORS

A. Surge Protection Devices:

1. Comply with UL 1449.
 2. Modular design with field-replaceable modules orNon-modular design.
 3. Fuses, rated at 200-kA interrupting capacity.
 4. Fabrication using bolted compression lugs for internal wiring.
 5. Integral disconnect switch.
 6. Redundant suppression circuits.
 7. Redundant replaceable modules.
 8. Arrangement with copper bus bars and for bolted connections to phase buses, neutral bus, and ground bus.
 9. Arrangement with wire connections to phase buses, neutral bus, and ground bus.
 10. LED indicator lights for power and protection status.
 11. Audible alarm, with silencing switch, to indicate when protection has failed.
 12. Form-C contacts rated at 5 A and 250-V ac, one normally open and one normally closed, for remote monitoring of protection status.
Contacts shall reverse on failure of any surge diversion module or on opening of any current-limiting device. Coordinate with building power monitoring and control system.
 13. Four-digit transient-event counter set to totalize transient surges.
- B. Peak Single-Impulse Surge Current Rating: 320 kA per mode/640 kA per phase.
- C. Minimum single impulse current ratings, using 8-by-20-mic.sec waveform described in IEEE C62.41.2
1. Line to Neutral: 70,000 A.

2. Line to Ground: 70,000 A.
 3. Neutral to Ground: 50,000 A.
- D. Protection modes and UL 1449 SVR for grounded wye circuits shall be as follows:
1. Line to Neutral: 800 V for 480Y/277 V, 400 V for 208Y/120 V.
 2. Line to Ground: 800 V for 480Y/277 V, 400 V for 208Y/120 V.
 3. Neutral to Ground: 800 V for 480Y/277 V, 400 V for 208Y/120 V.
- E. Protection modes and UL 1449 SVR for 240/120 V, single-phase, 3-wire circuits shall be as follows:
1. Line to Neutral: 400 V.
 2. Line to Ground: 400 V.
 3. Neutral to Ground: 400 V.
- F. Protection modes and UL 1449 SVR for 240/120-V, 3-phase, 4-wire circuits with high leg shall be as follows:
1. Line to Neutral: 400 V, 800 V from high leg.
 2. Line to Ground: 400 V.
 3. Neutral to Ground: 400 V.
- G. Protection modes and UL 1449 SVR for 240 V or 480 V, 3-phase, 3-wire, delta circuits shall be as follows:
1. Line to Line: 2000 V for 480 V, 1000 V for 240 V.
 2. Line to Ground: 2000 V for 480 V, 1000 V for 240 V.

2.2 PANELBOARD SUPPRESSORS

- A. Surge Protection Devices:
1. Non-modular.
 2. LED indicator lights for power and protection status.
 3. Audible alarm, with silencing switch, to indicate when protection has failed.
- B. Peak Single-Impulse Surge Current Rating: 160 kA per mode/320 kA per phase.
- C. Minimum single impulse current ratings, using 8-by-20-mic.sec waveform described in IEEE C62.41.2:
1. Line to Neutral: 70,000 A.
 2. Line to Ground: 70,000 A.
 3. Neutral to Ground: 50,000 A.
- D. Protection modes and UL 1449 SVR for grounded wye circuits shall be as follows:
1. Line to Neutral: 800 V for 480Y/277 V, 400 V for 208Y/120 V.
 2. Line to Ground: 800 V for 480Y/277 V, 400 V for 208Y/120 V.

3. Neutral to Ground: 800 V for 480Y/277 V, 400 V for 208Y/120 V.
- E. Protection modes and UL 1449 SVR for 240/120-V, single-phase, 3-wire circuits shall be as follows:
 1. Line to Neutral: 400 V.
 2. Line to Ground: 400 V.
 3. Neutral to Ground: 400 V.
- F. Protection modes and UL 1449 SVR for 240/120-V, 3-phase, 4-wire circuits with high leg shall be as follows:
 1. Line to Neutral: 400 V, 800 V from high leg.
 2. Line to Ground: 400 V.
 3. Neutral to Ground: 400 V.
- G. Protection modes and UL 1449 SVR for 240 V or 480 V, 3-phase, 3-wire, delta circuits shall be as follows:
 1. Line to Line: 2000 V for 480 V, 1000 V for 240 V.
 2. Line to Ground: 1500 V for 480 V, 800 V for 240 V.

2.3 ENCLOSURES

- A. Indoor Enclosures: NEMA 250 Type 1.
- B. Outdoor Enclosures: NEMA 250 Type 3R.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install TVSS devices at switchboard, switchgear, or panelboard on load side, with ground lead bonded to service entrance ground.
- B. Install TVSS devices for panelboards and auxiliary panels with conductors or buses between suppressor and points of attachment as short and straight as possible. Do not exceed manufacturer's recommended lead length. Do not bond neutral and ground.
 1. Provide a circuit breaker, sized by manufacturer, as a dedicated disconnecting means for TVSS unless otherwise shown on drawings.

3.2 ACCEPTANCE CHECKS AND TESTS

- A. Perform in accordance with the manufacturer's recommendations. Include the following visual and mechanical inspections and electrical tests:
 1. Visual and Mechanical Inspection
 - a. Compare equipment nameplate data with specifications and approved shop drawings.
 - b. Inspect physical, electrical, and mechanical condition.
 - c. Verify that disconnecting means and feeder size and maximum to TVSS unit correspond to approved shop drawings.

- d. Verifying tightness of accessible bolted electrical connections by calibrated torque-wrench method.
- e. Clean TVSS unit.
- f. Complete startup checks according to manufacturer's written instructions.
- g. Verify the correct operation of all sensing devices, alarms, and indicating devices.

3.3 STARTUP

- A. Do not energize or connect switchgear, switchboards, or panelboards to their sources until TVSS devices are installed and connected.
- B. Do not perform insulation resistance tests of the distribution wiring equipment with the TVSS installed. Disconnect before conducting insulation resistance tests, and reconnect immediately after the testing is over.

3.4 SPARE PARTS

- A. Furnish extra materials that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
 - 1. Replaceable Protection Modules: One of each size and type installed.

3.5 INSTRUCTION

Provide factory certified technician to train Government maintenance personnel to maintain TVSS devices. Training shall be provided for a total period of 4 hours of normal working time and shall start after the system is functionally complete but prior to final acceptance test. Training shall cover all essential items contained in the operation and maintenance manual.

-- -END OF SECTION - - -

SECTION 26 51 00
INTERIOR LIGHTING

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies the furnishing, installation and connection of the interior lighting systems.

1.2 RELATED WORK

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General requirements that are common to more than one section of Division 26.
- B. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Cables and wiring.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.
- D. Section 26 27 26, WIRING DEVICES: Wiring devices used for control of the lighting systems.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Product Data: For each type of lighting fixture (luminaire) designated on the LIGHTING FIXTURE SCHEDULE, arranged in order of fixture designation, submit the following information.
 - 1. Material and construction details include information on housing, optics system and lens/diffuser.
 - 2. Physical dimensions and description.
 - 3. Wiring schematic and connection diagram.
 - 4. Installation details.
 - 5. Energy efficiency data.
 - 6. Photometric data based on laboratory tests complying with IESNA Lighting Measurements, testing and calculation guides.
 - 7. Lamp data including lumen output (initial and mean), color rendition index (CRI), rated life (hours) and color temperature (degrees Kelvin).
 - 8. Ballast data including ballast type, starting method, ambient temperature, ballast factor, sound rating, system watts and total harmonic distortion (THD).
- C. Manuals:

1. Submit, simultaneously with the shop drawings companion copies of complete maintenance and operating manuals including technical data sheets, and information for ordering replacement parts.
2. Two weeks prior to the final inspection, submit four copies of the final updated maintenance and operating manuals, including any changes, to the Resident Engineer.

D. Certifications:

1. Two weeks prior to final inspection, submit four copies of the following certifications to the Resident Engineer:
 - a. Certification by the Contractor that the equipment has been properly installed, adjusted, and tested.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. Institute of Electrical and Electronic Engineers (IEEE):
C62.41-91Guide on the Surge Environment in Low Voltage
(1000V and less) AC Power Circuits
- C. National Fire Protection Association (NFPA):
70National Electrical Code (NEC)
101Life Safety Code
- D. National Electrical Manufacturer's Association (NEMA):
C82.1-97Ballasts for Fluorescent Lamps - Specifications
C82.2-02Method of Measurement of Fluorescent Lamp
Ballasts
C82.4-02Ballasts for High-Intensity-Discharge and Low-
Pressure Sodium Lamps
C82.11-02High Frequency Fluorescent Lamp Ballasts
- E. Underwriters Laboratories, Inc. (UL):
496-96Edison-Base Lampholders
542-99Lampholders, Starters, and Starter Holders for
Fluorescent Lamps
844-95Electric Lighting Fixtures for Use in Hazardous
(Classified) Locations
924-95Emergency Lighting and Power Equipment
935-01Fluorescent-Lamp Ballasts
1029-94High-Intensity-Discharge Lamp Ballasts
1029A-06.....Ignitors and Related Auxiliaries for HID Lamp
Ballasts
1598-00Luminaires
1574-04.....Standard for Track Lighting Systems

2108-04.....Standard for Low-Voltage Lighting Systems

8750-08.....Light Emitting Diode (LED) Light Sources for Use
in Lighting Products

F. Federal Communications Commission (FCC):

Code of Federal Regulations (CFR), Title 47, Part 18

PART 2 - PRODUCTS

2.1 LIGHTING FIXTURES (LUMINAIRES)

A. Shall be in accordance with NFPA 70 and UL 1598, as shown on drawings, and as specified.

B. Sheet Metal:

1. Shall be formed to prevent warping and sagging. Housing, trim and lens frame shall be true, straight (unless intentionally curved) and parallel to each other as designed.

2. Wireways and fittings shall be free of burrs and sharp edges and shall accommodate internal and branch circuit wiring without damage to the wiring.

3. When installed, any exposed fixture housing surface, trim frame, door frame and lens frame shall be free of light leaks; lens doors shall close in a light tight manner.

4. Hinged door closure frames shall operate smoothly without binding when the fixture is in the installed position, latches shall function easily by finger action without the use of tools.

C. Ballasts shall be serviceable while the fixture is in its normally installed position, and shall not be mounted to removable reflectors or wireway covers unless so specified.

D. Lamp Sockets:

1. Fluorescent: Lampholder contacts shall be the biting edge type or phosphorous-bronze with silver flash contact surface type and shall conform to the applicable requirements of UL 542. Lamp holders for bi-pin lamps shall be of the telescoping compression type, or of the single slot entry type requiring a one-quarter turn of the lamp after insertion.

2. High Intensity Discharge (H.I.D.): Shall have porcelain enclosures.

E. Recessed fixtures mounted in an insulated ceiling shall be listed for use in insulated ceilings.

F. Mechanical Safety: Lighting fixture closures (lens doors, trim frame, hinged housings, etc.) shall be retained in a secure manner by captive screws, chains, captive hinges or fasteners such that they cannot be accidentally dislodged during normal operation or routine maintenance.

G. Metal Finishes:

1. The manufacturer shall apply standard finish (unless otherwise specified) over a corrosion resistant primer, after cleaning to free the metal surfaces of rust, grease, dirt and other deposits. Edges of pre-finished sheet metal exposed during forming, stamping or shearing processes shall be finished in a similar corrosion resistant manner to match the adjacent surface(s). Fixture finish shall be free of stains or evidence of rusting, blistering, or flaking, and shall be applied after fabrication.
 2. Interior light reflecting finishes shall be white with not less than 85 percent reflectances, except where otherwise shown on the drawing.
 3. Exterior finishes shall be as shown on the drawings.
- H. Lighting fixtures shall have a specific means for grounding metallic wireways and housings to an equipment grounding conductor.
- I. Light Transmitting Components for Fluorescent Fixtures:
1. Shall be 100 percent virgin acrylic.
 2. Flat lens panels shall have not less than 1/8 inch [3.2mm] of average thickness. The average thickness shall be determined by adding the maximum thickness to the minimum unpenetrated thickness and dividing the sum by 2.
 3. Unless otherwise specified, lenses, diffusers and louvers shall be retained firmly in a metal frame by clips or clamping ring in such a manner as to allow expansion and contraction of the lens without distortion or cracking.
- J. Lighting fixtures in hazardous areas shall be suitable for installation in Class and Group areas as defined in NFPA 70, and shall comply with UL 844.
- K. Compact fluorescent fixtures shall be manufactured specifically for compact fluorescent lamps with ballast integral to the fixture. Assemblies designed to retrofit incandescent fixtures are prohibited except when specifically indicated for renovation of existing fixtures (not the lamp). Fixtures shall be designed for lamps as specified.

2.2 BALLASTS

- A. Linear Fluorescent Lamp Ballasts: Multi-voltage (120 - 277V) electronic programmed-start type, complying with UL 935 and with ANSI C 82.11, designed for type and quantity of lamps indicated. Ballast shall be designed for full light output unless dimmer or bi-level control is indicated; including the following features:
1. Lamp end-of-life detection and shutdown circuit (T5 lamps only).
 2. Automatic lamp starting after lamp replacement.
 3. Sound Rating: Class A.

4. Total Harmonic Distortion Rating: 10 percent or less.
 5. Transient Voltage Protection: IEEE C62.41.1 and IEEE C62.41.2, Category A or better.
 6. Operating Frequency: 20 kHz or higher.
 7. Lamp Current Crest Factor: 1.7 or less.
 8. Ballast Factor: 0.87 or higher unless otherwise indicated.
 9. Power Factor: 0.98 or higher.
 10. Interference: Comply with 47 CFT 18, Ch.1, Subpart C, for limitations on electromagnetic and radio-frequency interference for non-consumer equipment.
 11. To facilitate multi-level lamp switching, lamps within fixture shall be wired with the outermost lamp at both sides of the fixture on the same ballast, the next inward pair on another ballast and so on to the innermost lamp (or pair of lamps). Within a given room, each switch shall uniformly control the same corresponding lamp (or lamp pairs) in all fixture units that are being controlled.
 12. Where three-lamp fixtures are indicated, unless switching arrangements dictate otherwise, utilize a common two-lamp ballast to operate the center lamp in pairs of adjacent units that are mounted in a continuous row. The ballast fixture and slave-lamp fixture shall be factory wired with leads or plug devices to facilitate this circuiting. Individually mounted fixtures and the odd fixture in a row shall utilize a single-lamp ballast for operation of the center lamp.
 13. Dimming ballasts shall be as per above, except dimmable from 100% to 5% of rated lamp lumens.
- C. Compact Fluorescent Lamp Ballasts: Multi-voltage (120 - 277V), electronic-programmed rapid-start type, complying with UL 935 and with ANSI C 82.11, designed for type and quantity of lamps indicated. Ballast shall be designed for full light output unless dimmer or bi-level control is indicated; including the following features:
1. Lamp end-of-life detection and shutdown circuit.
 2. Automatic lamp starting after lamp replacement.
 3. Sound Rating: Class A.
 4. Total Harmonic Distortion Rating: 10 percent or less.
 5. Transient Voltage Protection: IEEE C62.41.1 and IEEE C62.41.2, Category A or better.
 6. Operating Frequency: 20 kHz or higher.
 7. Lamp Current Crest Factor: 1.7 or less.
 8. Ballast Factor: 0.95 or higher unless otherwise indicated.
 9. Power Factor: 0.98 or higher.

10. Interference: Comply with 47 CFR 18, Ch. 1, Subpart C, for limitations on electromagnetic and radio-frequency interference for non-consumer equipment.
11. Dimming ballasts shall be as per above, except dimmable from 100% to 5% of rated lamp lumens.
- D. Ballasts for high intensity discharge fixtures: Multi-tap voltage (120-480v) electromagnetic ballast for high intensity discharge lamps. Comply with ANSI C82.4 and UL 1029. Include the following features unless otherwise indicated:
 1. Ballast Circuit: Constant-wattage autotransformer or regulating high-power-factor type.
 2. Minimum Starting Temperature: Minus 22 deg F (Minus 30 deg C) for single-lamp ballasts.
 3. Rated Ambient Operating Temperature: 104 deg F (40 deg C).
 4. Open-circuit operation that will not reduce average life.
 5. Low-Noise Ballasts: Manufacturers' standard epoxy-encapsulated models designed to minimize audible fixture noise.
- E. Electronic ballast for high intensity discharge metal-halide lamps shall include the following features unless otherwise indicated:
 1. Minimum Starting Temperature: Minus 20 deg F (Minus 29 deg C) for single-lamp ballasts.
 2. Rated Ambient Operating Temperature: 130 deg F (54 deg C).
 3. Lamp end-of-life detection and shutdown circuit.
 4. Sound Rating: Class A.
 5. Total Harmonic Distortion Rating: 20 percent or less.
 6. Transient Voltage Protection: IEEE C62.41.1 and IEEE C62.41.2, Category A or better.
 7. Lamp Current Crest Factor: 1.5 or less.
 8. Power Factor: 0.90 or higher.
 9. Interference: Comply with 47 CFR 18, Ch. 1, Subpart C, for limitations on electromagnetic and radio-frequency interference for non-consumer equipment.
 10. Protection: Class P thermal cut.

2.3 FLUORESCENT EMERGENCY BALLAST

- A. Self-contained, modular, battery-inverter unit, factory mounted within lighting fixture body and compatible with ballast. Comply with UL 924.
 1. Emergency Connection: Operate one fluorescent lamp continuously at an output of 1100 lumens each. Connect unswitched circuit to battery-inverter unit and switched circuit to fixture ballast.
 2. Test Push Button and Indicator Light: Visible and accessible without opening fixture or entering ceiling space.

- a. Push Button: Push-to-test type, in unit housing, simulates loss of normal power and demonstrates unit operability.
- b. Indicator Light: LED indicates normal power on. Normal glow indicates trickle charge; bright glow indicates charging at end of discharge cycle.
3. Battery: Sealed, maintenance-free, nickel-cadmium type.
4. Charger: Fully automatic, solid-state, constant-current type with sealed power transfer relay.
5. Integral Self-Test: Automatically initiates test of unit emergency operation at required intervals. Test failure is annunciated by an integral audible alarm and a flashing LED.

2.4 EMERGENCY LIGHTING UNIT

- A. Complete, self-contained unit with batteries, battery charger, one or more local or remote lamp heads with lamps, under-voltage relay, and test switch. Comply with UL 924.
 1. Enclosure: Shall be impact-resistant thermoplastic, which will protect components from dust, moisture, and oxidizing fumes from the battery. Enclosure shall be suitable for the environmental conditions in which installed.
 2. Lamp Heads: Horizontally and vertically adjustable, mounted on the face of the unit, except where otherwise indicated.
 3. Lamps: Shall be sealed-beam MR-16 halogen, rated not less than 12watts at the specified DC voltage.
 4. Battery: Shall be maintenance-free nickel-cadmium. Minimum normal life shall be 10 years.
 5. Battery Charger: Dry-type full-wave rectifier with charging rates to maintain the battery in fully-charged condition during normal operation, and to automatically recharge the battery within 12 hours following a 1-1/2 hour continuous discharge.
 6. Integral Self-Test: Automatically initiates test of unit emergency operation at required intervals. Test failure is annunciated by an integral audible alarm and a flashing LED.

2.5 LAMPS

- A. Linear and U-shaped T5 and T8 Fluorescent Lamps:
 1. Rapid start fluorescent lamps shall comply with ANSI C78.1; and instant-start lamps shall comply with ANSI C78.3.
 2. Chromacity of fluorescent lamps shall comply with ANSI C78.376.
 3. Except as indicated below, lamps shall be low-mercury energy saving type, have a color temperature between 3500° and 4100°K, a Color Rendering Index (CRI) of greater than 70, average rated life of

20,000 hours, and be suitable for use with dimming ballasts, unless otherwise indicated. Low mercury lamps shall have passed the EPA Toxicity Characteristic Leachate Procedure (TCLP) for mercury by using the lamp sample preparation procedure described in NEMA LL 1.

b. Other areas as indicated on the drawings.

B. Compact Fluorescent Lamps:

1. T4, CRI 80 (minimum), color temperature 3500 K, and suitable for use with dimming ballasts, unless otherwise indicated.

C. Long Twin-Tube Fluorescent Lamps:

1. T5, CRI 80 (minimum), color temperature between 3500° and 4100°K, 20,000 hours average rated life.

D. High Intensity Discharge Lamps:

3. Ceramic, Pulse-Start, Metal-Halide Lamps: CRI 80 (minimum), and color temperature 4000°K.

2.9 EXIT LIGHT SIGNS

A. Exit signs shall meet applicable requirements of NFPA 101 and UL 924.

B. Housing and Canopy:

1. Shall be made of die-cast aluminum.
2. Optional steel housing shall be a minimum 20 gauge thick or equivalent strength aluminum.
3. Steel housing shall have baked enamel over corrosion resistant, matte black or ivory white primer.

C. Door frame shall be cast or extruded aluminum, and hinged with latch.

D. Finish shall be satin or fine-grain brushed aluminum.

E. There shall be no radioactive material used in the fixtures.

F. Fixtures:

1. Maximum fixture wattage shall be 1 watt or less.
2. Inscription panels shall be cast or stamped aluminum a minimum of 0.090 inch [2.25mm] thick, stenciled with 6 inch [150mm] high letters, baked with red color stable plastic or fiberglass. Lamps shall be luminous Light Emitting Diodes (LED) mounted in center of letters on red color stable plastic or fiberglass. The LED shall be rated minimum 25 years life.
3. Double-Faced Fixtures: Provide double-faced fixtures where required or as shown on drawings.
4. Directional Arrows: Provide directional arrows as part of the inscription panel where required or as shown on drawings. Directional arrows shall be the "chevron-type" of similar size and width as the letters and meet the requirements of NFPA 101.

G. Voltages: Refer to Lighting Fixture Schedule.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Installation shall be in accordance with the NEC, manufacturer's instructions and as shown on the drawings or specified.
- B. Align, mount and level the lighting fixtures uniformly.
- C. Fluorescent bed light fixtures shall be attached to the studs in the walls. Attachment to gypsum board only is not acceptable.
- D. Lighting Fixture Supports:
 - 1. Shall provide support for all of the fixtures. Supports may be anchored to channels of the ceiling construction, to the structural slab or to structural members within a partition, or above a suspended ceiling.
 - 2. Shall maintain the fixture positions after cleaning and relamping.
 - 3. Shall support the lighting fixtures without causing the ceiling or partition to deflect.
- 4. Hardware for recessed fluorescent fixtures:
 - a. Provide hardware devices to clamp the fixture to the ceiling system structural members, or plaster frame at not less than four points in such a manner as to resist spreading of the support members and safely lock the fixture into the ceiling system.
 - b. Provide hardware devices to support the fixture from the building structure at four points independently of the suspended ceiling system.
- 5. Hardware for surface mounting fluorescent fixtures to suspended ceilings:
 - a. In addition to being secured to any required outlet box, fixtures shall be bolted to a grid ceiling system at four points spaced near the corners of each fixture. The bolts shall be not less than 1/4 inch [6mm] secured to channel members attached to and spanning the tops of the ceiling structural grid members. Non-turning studs may be attached to the ceiling structural grid members or spanning channels by special clips designed for the purpose, provided they lock into place and require simple tools for removal.
 - b. In addition to being secured to any required outlet box, fixtures shall be bolted to ceiling structural members at four points spaced near the corners of each fixture. Pre-positioned 1/4 inch [6mm] studs or threaded plaster inserts secured to ceiling structural members shall be used to bolt the fixtures to the ceiling. In lieu of the above, 1/4 inch [6mm] toggle bolts may be

used on new or existing ceiling provided the plaster and lath can safely support the fixtures without sagging or cracking.

- E. Furnish and install the specified lamps for all lighting fixtures installed and all existing lighting fixtures reinstalled under this project.
- F. Coordinate between the electrical and ceiling trades to ascertain that approved lighting fixtures are furnished in the proper sizes and installed with the proper devices (hangers, clips, trim frames, flanges), to match the ceiling system being installed.
- G. Bond lighting fixtures and metal accessories to the grounding system as specified in Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
- H. Exercise electronic dimming ballasts over full range of dimming capability by operating the control devices(s) in the presence of the Resident Engineer. Observe for visually detectable flicker over full dimming range.
- I. Burn-in all lamps that require specific aging period to operate properly, prior to occupancy by Government. Burn-in period to be 40 hours minimum, unless a lesser period is specifically recommended by lamp manufacturer. Burn-in fluorescent and compact fluorescent lamps intended to be dimmed, for at least 100 hours at full voltage. Replace any lamps and ballasts which fail during burn-in.
- J. At completion of project, relamp/reballast fixtures which have failed lamps/ballasts. Clean fixtures, lenses, diffusers and louvers that have accumulated dust/dirt/fingerprints during construction. Replace damaged lenses, diffusers and louvers with new.
- K. Dispose of lamps per requirements of Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT.

- - - E N D - - -

SECTION 26 56 00
EXTERIOR LIGHTING

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the furnishing, installation, and connection of exterior luminaires, poles, and supports.

1.2 RELATED WORK

- A. Section 09 06 00, SCHEDULE FOR FINISHES: Finishes for exterior light poles and luminaires.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- C. Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW): Low voltage power and lighting wiring.
- D. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- E. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits, fittings, and boxes for raceway systems.
- F. Section 26 05 41, UNDERGROUND ELECTRICAL CONSTRUCTION: Underground handholes and conduits.
- G. Section 26 09 23, LIGHTING CONTROLS: Controls for exterior lighting.

1.3 QUALITY ASSURANCE

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

1.4 SUBMITTALS

- A. Submit in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Shop Drawings:
 - 1. Clearly present sufficient information to determine compliance with drawings and specifications.
 - 2. Include electrical ratings, dimensions, mounting, details, materials, required clearances, terminations, wiring and connection diagrams, photometric data, ballasts, poles, luminaires, lamps, and accessories.
- C. Manuals: Two weeks prior to final inspection, submit four copies of operating and maintenance manuals to the COTR. Include technical data

sheets, wiring and connection diagrams, and information for ordering replacement lamps, ballasts, and parts.

- D. Certifications: Two weeks prior to final inspection, submit four copies of the following to the COTR:
1. Certification by the manufacturer that the materials are in accordance with the drawings and specifications.
 2. Certification by the contractor that the complete installation has been properly installed and tested.

1.5 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. Aluminum Association Inc. (AA):
AAH35.1-06.....Alloy and Temper Designation Systems for
Aluminum
- C. American Association of State Highway and Transportation Officials
(AASHTO):
LTS-5-09Structural Supports for Highway Signs,
Luminaires and Traffic Signals
- D. American Concrete Institute (ACI):
318-05Building Code Requirements for Structural
Concrete
- E. American National Standards Institute (ANSI):
C81.61-09Electrical Lamp Bases - Specifications for
Bases (Caps) for Electric Lamps
- F. American Society for Testing and Materials (ASTM):
A123/A123M-09Zinc (Hot-Dip Galvanized) Coatings on Iron and
Steel Products
A153/A153M-09.....Zinc Coating (Hot-Dip) on Iron and Steel
Hardware
B108-03a-08Aluminum-Alloy Permanent Mold Castings
C1089-06Spun Cast Prestressed Concrete Poles
- G. Federal Aviation Administration (FAA):
AC 70/7460-IK-07.....Obstruction Lighting and Marking
AC 150/5345-43F-06.....Obstruction Lighting Equipment
- H. Illuminating Engineering Society of North America (IESNA)
HB-9-00.....Lighting Handbook

- RP-8-05.....Roadway Lighting
- RP-20-98.....Lighting for Parking Facilities
- RP-33-99.....Lighting for Exterior Environments
- LM-5-96.....Photometric Measurements of Area and Sports
Lighting Installations
- LM-50-99.....Photometric Measurements of Roadway Lighting
Installations
- LM-52-99.....Photometric Measurements of Roadway Sign
Installations
- LM-64-01.....Photometric Measurements of Parking Areas
- LM-72-97.....Directional Positioning of Photometric Data
- LM-79-08.....Approved Method for the Electrical and
Photometric Measurements of Solid-State Lighting
Products
- LM-80-08.....Approved Method for Measuring Lumen Maintenance
of LED Light Sources
- I. National Electrical Manufacturers Association (NEMA):
- C78.41-06.....Electric Lamps - Guidelines for Low-Pressure
Sodium Lamps
- C78.42-07Electric Lamps - Guidelines for High-Pressure
Sodium Lamps
- C78.43-07Electric Lamps - Single-Ended Metal-Halide
Lamps
- C78.1381-98.....Electric Lamps - 70-Watt M85 Double-Ended
Metal-Halide Lamps
- C82.4-02Ballasts for High-Intensity-Discharge and Low-
Pressure Sodium Lamps (Multiple-Supply Type)
- C136.3-05For Roadway and Area Lighting Equipment -
Luminaire Attachments
- C136.17-05Roadway and Area Lighting Equipment - Enclosed
Side-Mounted Luminaires for Horizontal-Burning
High-Intensity-Discharge Lamps - Mechanical
Interchangeability of Refractors
- ICS 2-00 (R2005)Controllers, Contactors and Overload Relays
Rated 600 Volts
- ICS 6-93 (R2006)Enclosures
- J. National Fire Protection Association (NFPA):
- 70-08National Electrical Code (NEC)

K. Underwriters Laboratories, Inc. (UL):

- 496-08Lampholders
- 773-95.....Plug-In, Locking Type Photocontrols for Use
with Area Lighting
- 773A-06Nonindustrial Photoelectric Switches for
Lighting Control
- 1029-94.....High-Intensity-Discharge Lamp Ballasts
- 1598-08Luminaires
- 8750-08.....Light Emitting Diode (LED) Light Sources for
Use in Lighting Products

1.6 DELIVERY, STORAGE, AND HANDLING

Provide manufacturer's standard provisions for protecting pole finishes during transport, storage, and installation. Do not store poles on ground. Store poles so they are at least 12 in [305 mm] above ground level and growing vegetation. Do not remove factory-applied pole wrappings until just before installing pole.

PART 2 - PRODUCTS

2.1 MATERIALS AND EQUIPMENT

Materials and equipment shall be in accordance with NEC, UL, ANSI, and as shown on the drawings and specified.

2.2 POLES

A. General:

1. Poles shall be as shown on the drawings, and as specified. Finish shall be as specified on the drawings.
2. The pole and arm assembly shall be designed for wind loading of 100 mph [161 km/hr], with an additional 30% gust factor, supporting luminaire(s) and accessories such as shields, banner arms, and banners that have the effective projected areas indicated. The effective projected area of the pole shall be applied at the height of the pole base, as shown on the drawings.
3. Poles shall be anchor-bolt type designed for use with underground supply conductors. Poles shall have handhole having a minimum clear opening of 2.5 x 5 in [65 x 125 mm]. Handhole covers shall be secured by stainless steel captive screws.
4. Provide a steel-grounding stud opposite handhole openings, designed to prevent electrolysis when used with copper wire.

5. Provide a base cover that matches the pole in material and color to conceal the mounting hardware pole-base welds and anchor bolts.
6. Hardware and Accessories: All necessary hardware and specified accessories shall be the product of the pole manufacturer.
7. Provide manufacturer's standard finish, as scheduled on the drawings. Where indicated on drawings, provide finishes as indicated in Section 09 06 00, SCHEDULE FOR FINISHES.

B. Types:

1. Aluminum: Provide round aluminum poles manufactured of corrosion-resistant AA AAH35.1 aluminum alloys conforming to AASHTO LTS-4. Poles shall be seamless extruded or spun seamless type.

2.3 FOUNDATIONS FOR POLES

- A. Foundations shall be cast-in-place concrete, having 3000 psi minimum 28-day compressive strength.
- B. Foundations shall support the effective projected area of the specified pole, arm(s), luminaire(s), and accessories, such as shields, banner arms, and banners, under wind conditions previously specified in this section.
- C. Place concrete in spirally-wrapped treated paper forms for round foundations, and construct forms for square foundations.
- D. Rub-finish and round all above-grade concrete edges to approximately 0.25 in [6 mm] radius.
- E. Anchor bolt assemblies and reinforcing of concrete foundations shall be as shown on the drawings. Anchor bolts shall be in a welded cage or properly positioned by the tie-wire to stirrups.
- F. Prior to concrete pour, install electrode per Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.

2.4 LUMINAIRES

- A. Per UL 1598 and NEMA C136.17. Luminaires shall be weatherproof, heavy duty, outdoor types designed for efficient light utilization, adequate dissipation of lamp and ballast heat, and safe cleaning and relamping.
- B. Light distribution pattern types shall be as shown on the drawings.
- C. Incorporate ballasts in the luminaire housing, except where otherwise shown on the drawings.
- D. Lenses shall be frame-mounted, heat-resistant, borosilicate glass, with prismatic refractors, unless otherwise shown on the drawings. Attach the frame to the luminaire housing by hinges or chain. Use heat and

aging-resistant, resilient gaskets to seal and cushion lenses and refractors in luminaire doors.

- E. Lamp sockets for high intensity discharge (H.I.D) fixture shall have locking-type porcelain enclosures in conformance to the applicable requirements of ANSI C81.61 and UL 496.
- F. Pre-wire internal components to terminal strips at the factory.
- G. Bracket-mounted luminaires shall have leveling provisions and clamp-type adjustable slip-fitters with locking screws.
- H. Materials shall be rustproof. Latches and fittings shall be non-ferrous metal.
- I. Provide manufacturer's standard finish, as scheduled on the drawings. Where indicated on drawings, match finish process and color of pole or support materials. Where indicated on drawings, provide finishes as indicated in Section 09 06 00, SCHEDULE FOR FINISHES.
- J. Luminaires shall carry factory labels, showing complete, specific lamp and ballast information.

2.5 LAMPS

- A. Install the proper lamps in every luminaire installed and every existing luminaire relocated or reinstalled.
- B. Lamps shall be general-service, outdoor lighting types.
- C. High-Pressure Sodium (HPS) Lamps: NEMA C78.42, CRI 21 (minimum), wattage as indicated. Lamps shall have minimum average rated life of 24,000 hours.
- D. Low-Pressure Sodium (LPS) Lamps: NEMA C78.43.
- E. Metal-Halide Lamps: NEMA C78.43 or NEMA C78.1381.
- F. LED sources shall meet the following requirements:
 - 1. Operating temperature rating shall be between -40° F [-40° C] and 120° F [50° C].
 - 2. Correlated Color Temperature (CCT): per Schedule.
 - .
 - 4. The manufacturer shall have performed JEDEC (Joint Electron Devices Engineering Council) reliability tests on the LEDs as follows: High Temperature Operating Life (HTOL), Room Temperature Operating Life (RTOL), Low Temperature Operating Life (LTOL), Powered Temperature Cycle (PTMCL), Non-Operating Thermal Shock (TMSK), Mechanical Shock Variable Vibration Frequency, and Solder Heat Resistance (SHR).//
- G. Mercury vapor lamps shall not be used.

2.6 HIGH INTENSITY DISCHARGE BALLASTS

- A. Per NEMA C82.4 and UL 1029. Ballasts shall be encapsulated single-lamp, copper-wound, constant-wattage autotransformer type, designed to operate on the voltage system to which they are connected, and capable of open-circuit operation without reducing lamp life.
- B. Ballasts shall have individual overcurrent protection in each ungrounded supply conductor.
- C. Ballast shall have an allowable line voltage variations of $\pm 10\%$, with a maximum 20% lamp wattage regulation spread.
- D. Power factor shall be not less than 90%.
- E. Ballast shall have a minimum starting temperature of $-22^{\circ}\text{ F } [-30^{\circ}\text{ C}]$, and a normal ambient operating temperature of $104^{\circ}\text{ F } [40^{\circ}\text{ C}]$.
- F. Lamp current crest factor shall be 1.8 or less, in accordance with lamp manufacturer recommendations.

2.7 METAL HALIDE CORE AND COIL BALLASTS

- A. Shall be pulse start, linear reactor type for 277 volt luminaires and constant-wattage autotransformer (CWA) type for other voltage luminaires (if not otherwise specified).
- B. Ballasts shall have individual overcurrent protection in each ungrounded supply conductor.
- C. Power factor shall be not less than 90%.
- D. Ballast shall have an allowable line voltage variations of $\pm 5\%$ for linear reactor type and $\pm 10\%$ for CWA, with a maximum 20% lamp wattage regulation spread.
- E. Ballast shall have a minimum starting temperature of $-40^{\circ}\text{ F } [-40^{\circ}\text{ C}]$.
- F. Lamp current crest factor shall be 1.8 or less, in accordance with lamp manufacturer recommendations.

2.8 METAL HALIDE ELECTRONIC BALLASTS

- A. Ballast shall be low-frequency electronic type, and shall operate pulse start and ceramic metal halide lamps at a frequency of 90 to 200 Hz square wave.
- B. Ballast shall be labeled Type '1' outdoor, suitable for recessed use, Class 'P'.
- C. Ballast shall have auto-resetting thermal protector to shut off ballast when operating temperatures reach unacceptable levels.
- D. Ballast shall have an end of lamp life detection and shut-down circuit.
- E. Lamp current crest factor shall be 1.5 or less.

- F. Ballasts shall comply with FCC Title 47 CFR Part 18 Non-consumer RFI/EMI Standards.
- G. Ballast shall have a minimum ballast factor of 1.0.
- H. Input current THD shall not exceed 20% for the primary lamp.
- I. Ballasts shall have ANSI C62.41, category 'A' transient protection.
- J. Ballasts shall have power factor greater than 90%.
- K. Ballast shall have a Class 'A' sound rating.

2.9 LED DRIVERS

- A. LED drivers shall meet the following requirements:
 - 1. Drivers shall have a minimum efficiency of 85%.
 - 2. Starting Temperature: -40° F [-40° C].
 - 3. Input Voltage: 120 to 480 (±10%) V.
 - 4. Power Supplies: Class I or II output.
 - 5. Surge Protection: The system must survive 250 repetitive strikes of "C Low" (C Low: 6kV/1.2 x 50 µs, 10kA/8 x 20 µs) waveforms at 1-minute intervals with less than 10% degradation in clamping voltage. "C Low" waveforms are as defined in IEEE/ASNI C62.41.2-2002, Scenario 1 Location Category C.
 - 6. Power Factor (PF): ≥ 0.90.
 - 7. Total Harmonic Distortion (THD): ≤ 20%.
 - 8. Comply with FCC Title 47 CFR Part 18 Non-consumer RFI/EMI Standards.
 - 9. Drivers shall be reduction of hazardous substances (ROHS)-compliant.

2.10 EXISTING LIGHTING SYSTEMS

- A. For modifications or additions to existing lighting systems, the new components shall be compatible with the existing systems.
- B. New poles and luminaires shall have approximately the same configurations and dimensions as the existing poles and luminaires, except where otherwise shown on the drawings.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install lighting in accordance with the NEC, as shown on the drawings, and in accordance with manufacturer's recommendations.
- B. Pole Foundations:
 - 1. Excavate only as necessary to provide sufficient working clearance for installation of forms and proper use of tamper to the full depth of the excavation. Prevent surface water from flowing into the excavation. Thoroughly compact backfill with compacting arranged to

- prevent pressure between conductor, jacket, or sheath, and the end of conduit.
2. Set anchor bolts according to anchor-bolt templates furnished by the pole manufacturer.
 3. Install poles as necessary to provide a permanent vertical position with the bracket arm in proper position for luminaire location.
 4. After the poles have been installed, shimmed, and plumbed, grout the spaces between the pole bases and the concrete base with non-shrink concrete grout material. Provide a plastic or copper tube, of not less than 0.375 in [9 mm] inside diameter through the grout, tight to the top of the concrete base to prevent moisture weeping from the interior of the pole.
- C. Install lamps in each luminaire.
- D. Adjust luminaires that require field adjustment or aiming.

3.2 GROUNDING

Ground noncurrent-carrying parts of equipment, including metal poles, luminaires, mounting arms, brackets, and metallic enclosures, as specified in Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS. Where copper grounding conductor is connected to a metal other than copper, provide specially-treated or lined connectors suitable and listed for this purpose.

3.3 ACCEPTANCE CHECKS AND TESTS

Verify operation after installing luminaires and energizing circuits.

- - - E N D - - -

SECTION 27 05 00
COMMON WORK RESULTS FOR COMMUNICATION SYSTEMS

PART 1 - GENERAL

1.1 SUMMARY

- A. This document identifies the design and specification requirements for a complete and functional communications cable plant to be performed at the Expansion & Renovation of Building 108 for Mental Health in Houston, Texas. The communications cable plant as specified herein will support the voice, data, AV and security systems as well as other low voltage signaling and control devices.
- B. The technology infrastructure will be compliant with the latest versions of the TIA/EIA 568-C Series Commercial Building Telecommunications Cabling Standards and the Department of Veteran Affairs adopted cabling standards. Supported speeds will include up to 1Gigabit Ethernet in the registered Category 6 horizontal subsystem from the Main Telecom Closet (MTC) and the Intermediate Telecom Closet (ITC) to the telecommunications outlets.
- C. The Architectural Plans and Specifications, General Conditions, Supplementary General Conditions and other requirements of Division 1, the Mechanical Plans and Specifications, the Electrical Plans and Specifications, and the Communications Plans may apply to the work specified in the Division 27 Sections, and shall be complied with in every respect. The Contractor shall examine all of these documents, which make up the Contract Documents, and shall coordinate them with all communications work on the Communications plans and in the Division 27 specifications.
- D. Contract Documents: Drawings and specifications are to be used in conjunction with one another and to supplement one another. In general the specifications determine the nature and quality of the materials, and the drawings establish the quantities, details, and give characteristics of performance that shall be adhered to in the installation of the communications system components. If there is an apparent conflict between the drawings and specifications, the items with the greater quantity or quality shall be estimated upon and

installed. Clarification with the Owner or their designated representative about these items shall be made prior to bid response.

1.2 RELATED DOCUMENTS

- A. Drawings and General Provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.
- B. Related Division 27 Sections include:
 - 1. 27 05 26 Grounding and Bonding for Communications Systems
 - 2. 27 05 28 Pathways for Communications Systems
 - 3. 27 05 43 Underground Ducts and Raceways
 - 4. 27 05 53 Identification for Communications Systems
 - 5. 27 11 00 Communications Equipment Room Fittings
 - 6. 27 13 00 Communications Backbone Cabling
 - 7. 27 15 00 Communications Horizontal Cabling
 - 8. 27 16 00 Patch Cords, Station Cords, & Cross-Connect Wire
 - 9. 27 20 00 Data Communications Equipment
 - 10. 27 30 00 Voice Communications Equipment
 - 11. 27 51 17 Public Address Systems
 - 12. 27 52 23 Nurse Call Systems

1.3 REFERENCES

- A. Codes and Standards:
 - 1. ANSI/TIA/EIA-568-C, Commercial Building Telecommunications Wiring Standards
 - 2. ANSI/TIA/EIA-569-A Commercial Building Standard for Telecommunications Pathways and Spaces
 - 3. ANSI/TIA/EIA-606-A Administration Standard for the Telecommunications Infrastructure of Commercial Buildings
 - 4. JTD-607-A, Commercial Building Grounding (Earthing) and Bonding Requirements for Telecommunications
 - 5. TIA/EIA-758-A, Telecommunications Standard for Outside Plant
 - 6. National Electrical Code (NEC), based upon year approval by local codes or AHJ
 - 7. Building Industry Consulting Services International (BICSI) Telecommunications
 - 8. Distribution Methods Manual (TDMM), current edition

9. Local, county, state and federal regulations and codes in effect as of date of purchase

B. Acronyms and Abbreviations

1. ADA Americans with Disabilities Act
2. AKA also known as
3. ANSI American National Standards Institute
4. AP access provider
5. ASTM American Society for Testing and Materials
6. AWG American Wire Gauge
7. BICSI Building Industry Consulting Services International
8. CATV community antenna television
9. CO-OSP customer owned outside plant
10. EF entrance facility
11. EIA Electronic Industries Alliance
12. EMI electromagnetic interference
13. FCC Federal Communications Commission
14. HVAC heating, ventilation, and air conditioning
15. IEEE The Institute of Electrical and Electronics Engineers
16. ITS Information Transport System
17. ISO International Organization for Standardization
18. LAN local area network
19. Mb/s megabits per second
20. MC main cross-connect AKA Main Distribution Frame (MDF)
21. MDF main distribution frame AKA main cross-connect (MC)
22. NEMA National Electrical Manufacturers Association
23. NESCO National Electrical Safety Code
24. NFPA National Fire Protection Association
25. OFOI Owner Furnished Owner Installed
26. RCDD Registered Communications Distribution Designer
27. SCS Structured Cabling System
28. TBB telecommunications bonding backbone
29. TR telecommunications room AKA Intermediate Distribution Frame (IDF)
30. TGB telecommunications grounding busbar
31. TMGB telecommunications main grounding busbar

- 32. TIA Telecommunications Industry Association
- 33. UL Underwriters Laboratories
- 34. UTP unshielded twisted-pair
- 35. WA work area
- 36. WAP wireless access points
- 37. X cross-connect

1.4 ADMINISTRATIVE REQUIREMENTS

A. Coordination

1. The Communications Cabling Contractor, hereafter referred to as "Contractor", shall provide all materials, components, tools and labor necessary for the complete installation of all communications work required in the contract documents and specified herein.
2. The Electrical Contractor, here after referred to as "Electrical Contractor", shall provide materials, components, tools and labor to complete a communications cabling pathway, electrical power distribution and communications building grounding system as set forth in the Structured Cabling System specifications and Electrical specifications and Telecommunications and Electrical drawings.
3. Work furnished and installed by the Contractor as specified in Division 27 and as shown in E and T drawings includes:
 - a. The basket tray within the MTC/ITC;
 - b. Identification for Communications Systems;
 - c. Communications Equipment Room Fittings;
 - d. Communications Backbone Cabling;
 - e. Communications Horizontal Cabling;
 - f. J-Hook Cable Support System
 - g. Patch Cords, Station Cords, and Cross-Connect Wire;
 - h. Bonding conductors from all cable tray, sleeves and conduits;
 - i. Coordination with OFOI Communications Services;
 - j. Coordination with OFOI Data Communications Equipment;
 - k. Coordination with OFOI Voice Communications Equipment;
4. Work under this Division not in contract (NIC) that will be Owner Furnished/Owner Installed (OFOI) includes:
 - a. Communications services;
 - b. Wired Data communications equipment;

- c. Wireless Data communications equipment;
- d. Voice communications equipment;
- e. Phone cords at the work area;
- 5. Work furnished and installed by the Electrical Contractor as specified in Division 27 and as shown in E and T drawings includes:
 - a. Underground ducts and raceways;
 - b. The conduits and back boxes for the work area telecommunications outlets.
 - c. Installation of the TMGB in the new MTC;
 - d. Installation of the TBB from the new MTC to the new ITC;
 - e. Installation of the Bonding Conductor for Telecommunications (BCT) that bonds the TMGB to the electrical power ground compliant with ANSI J STD-607A Standards;
 - g. Electrical circuits in the telecom rooms.
- 6. Work furnished and installed by others.
 - a. The new MTC/ITC walls will be covered with rigidly fixed $\frac{3}{4}$ " marine plywood, void free, 8 ft high, and capable of supporting attached connecting hardware. Plywood will be covered with two coats of gray, fire retardant paint.

B. VA Labeling Scheme

- 1. Refer to specification section 27 05 53 for identification procedures.

1.5 WORK RESULTS - DESCRIPTION OF PROJECT

A. Communications Services

- 1. Communications Services include customer owned outside plant (CO-OSP) copper and fiber and the voice and data circuits required to connect the Mental Health Building to the Internet and the public switched telephone network (PSTN). It includes network services for the local area network, wide area network, security network, voice network and community antenna television (CATV) network.

B. Underground Ducts and Raceways

- 1. The new telecommunications duct bank will consist of 2 - 4" conduits from the MTC to the existing Maintenance Hole (MH).

C. Grounding and Bonding

1. The Telecommunications Main Grounding Busbar (TMGB) will be located in the new Telecommunications Main Telecom Closet (MTC) room and a Telecommunications Bonding Backbone (TBB) will connect the TMGB in the MTC to the Telecommunications Grounding Busbar (TGB) in the Intermediate Telecom Closet (ITC). A Bonding Conductor for Telecommunications (BCT) will bond the TMGB to the electrical power ground compliant with ANSI J STD-607A Standards.
2. Bonding conductors from the TMGB or TGB will be installed to all communications equipment cabinets, equipment racks, raceway, cable ladder rack, cable tray, sleeves and conduits.
3. Final design and specifications for the Grounding and Bonding system shall be coordinated with the Electrical Engineer of Record.

D. Pathways for Communications Systems

1. In typical work areas, two (2) 1" conduits with pull strings, not more than 100' long with a maximum of two (2) 90 degree bends, will provide the cabling pathway for Category 6 cables from a double gang back box to the primary horizontal overhead pathway system via J-hooks. Conduits will be properly bonded.
2. In a typical work areas with only one (1) Voice or Wireless Access Point (WAP) horizontal cable, one (1) 1" conduit with pull string, not more than 100' long with a maximum of two 90 degree bends, will provide the cabling pathway for a single CAT 6 cable from a single gang back box to the primary horizontal overhead cable pathway system via J-hooks. Conduits will be properly bonded.
3. The main routing and support system for communication cables will be J-hooks installed in the accessible ceiling spaces. The j-hook pathway will be the utility run closest to the ceiling grid.
 - a. Final design and specifications for the Pathways for Communications Systems conduit and primary cable pathway outside the MTC shall be coordinated with other trades to avoid pathway conflicts.

E. Identification for Communications Systems

1. All labeling will be compliant with TIA/EIA 606-A - Administration Standard for Commercial Telecommunications Infrastructures and comply with VA Labeling standards.

F. Communications Equipment Room Fittings

1. The new communications service entrance facility will be located in the MTC. The new service entrance pathway will consist of two (2) 4" conduits from the MTC to the existing Maintenance Hole (MH). Refer to the T drawings for details.

G. Communications Horizontal Cabling

1. All voice and data horizontal cables will consist of plenum rated, Category 6, 4 pair UTP copper cables terminated on 48 port, 8P8C, Category 6, 568B flat patch panels in the MTC and ITCs. The maximum horizontal distance shall be 270 feet.
2. All voice and data horizontal cables shall be terminated on 8P8C 568B Category 6, flat inserts at the work area information outlets. Information outlets shall be white for data.

H. Patch Cords, Station Cords, and X-Connect Wire

1. Office and support areas require 2 - CFCI - 568B 8P8C patch cords per CAT 6 cable.
2. 568B Patch cords used in the work area shall meet or exceed the performance requirements in ANSI/TIA/EIA-568-B.2 and ANSI/TIA/EIA-568-B CAT 6 specifications.
3. 568B CAT 6 8P8C patch cords will be Contractor Furnished Contractor Installed (CFCI) in the MTC and ITCs to connect each data horizontal cable to an Ethernet switch and each voice cable to a voice tie cable.

I. Data Communications Equipment

1. Data communications equipment will be Owner Furnished Owner Installed (OFOI).

J. Voice Communications Equipment

1. Voice communications equipment will be OFOI.

K. Commissioning Administration

1. Contractor shall comply with GENERAL COMMISSIONING REQUIREMENTS of the Technology Transport System.

L. Meetings

1. Contractor shall attend Division 27 preconstruction meeting with the Owner's Representative and the General Contractor to discuss the details of the Project.

2. Contractor shall provide representation on Project Team Meetings as specified in Division 1 and by the General Contractor as required.
3. Contractor shall attend a pre-testing meeting to review testing parameters and testing documentation deliverables.
3. Contractor will provide ad-hoc representation on the Commissioning Team as required for implementation of the Commissioning Plan.

M. Preconstruction Evaluation

1. Examination of buildings and site shall be the responsibility of the Contractor. Examine conditions for compliance with Communications design specifications. Validate Communications section is in accordance with related Contract Documents and the specified Owner's operational needs.

N. Construction Documentation

1. Contractor shall coordinate requirements with General Provisions specified in Division 1 - Construction Progress Documentation.
2. Contractor shall provide a weekly report of inspection by project RCDD to confirm Contractor's work is compliant with industry and manufacturer standards.

1.6 SUBMITTALS

- A. Follow Division 1 and this Section. All submittals shall be reviewed and stamped by the Contractor's project RCDD.
 1. Submit a resume and copy of Building Industry Consulting Services International (BICSI) Registered Communication Distribution Designer (RCDD) certificate for Contractor's project RCDD.
- B. A list of technical product education (training) completed by the Contractor's project personnel.
 1. All members of the installation team must be certified by the manufacturer as having completed the necessary training to complete their part of the installation. All installation team members must also have completed BICSI Installer Level One or higher training courses. Submit copies of certificates of manufacturer training and BICSI certification for each installation team member.
 2. Submit cable tester manufacturer or a third party certification for copper and fiber cable test technicians.

- C. The Contractor shall review Codes and Standards Section- Latest issue and addendums and state understanding and compliance or exception.
- D. Product Data: Submit Product Data sheets for each type of product indicated below. Product data to include, but not limited to, materials, finishes, approvals, load ratings, and dimensional information.
 - 1. Submittals shall include the manufacturers cut sheets for the following:
 - a. Equipment enclosures and/or racks;
 - b. Fiber optic and balanced twisted pair cable;
 - c. Patch cords and cross connect media;
 - d. Connectors and termination hardware;
 - e. Protection hardware;
 - f. Fire stopping materials;
 - g. Test equipment to be used for fiber and balanced twisted pair channels;
 - h. Cable tray and cable support hardware.
- E. Product Data manufacturer's literature sheets for all materials and equipment, including a copy of the proposed warranty, recommended preventative maintenance and spare part inventory recommendations. Literature containing more than one device shall be highlighted and clearly marked to delineate item(s) included in the work. Clearly indicate color or special finishes.
- F. Submittals shall be original catalog sheets or photocopies thereof. Facsimile (fax) sheets will not be accepted.
- G. Manufacturer and Contractor statement of RoHS: Restriction of Certain Hazardous Substances Compliance.
- H. Design and Installation Certificates: Signed by local cable manufacturer's representative certifying that design is acceptable with cable manufacturer's Design Engineer(s) and state that the Contractor is authorized by manufacturer to install registered (warranty) cabling system.
- I. A minimum of five (5) similar cabling projects must be submitted as references to include the name, Architect or Consultant, cost of the cabling project and the contact person to include phone number.

1.7 SUBMITTALS FOR PROJECT RECORD

A. Follow Division 1 and this Section.

1. Drawings: As-built documentation MUST be submitted five (5) business days PRIOR to obtaining approval for cutover to any portion of the new cable plant system. Furnish for review and comments, 4 CDs containing all electronic AutoCAD 2000 or newer (DWG) files.
2. Final approved Shop Drawings: Include plan and elevation of TRs, cable pathway details, and cable locations and cable ID#.
3. 4 sets of cable inventory data must be submitted for all copper and fiber, termination hardware prior to cutover to new cable plant. Submit data electronically on CDs in "Microsoft Excel " format, listing products furnished, including:
 - a. Manufacturer's name and part numbers;
 - b. Cable numbers utilizing the Owner's cable numbering standard;
 - c. Location and riser assignments.
4. Manufacturer Certificates: Within 10 days of completion of the project, Contractor shall deliver letter signed by local Structured Cabling Components representatives and Contractor's RCDD stating that installed cabling system complies with all requirements specified in manufacturer's installation guidelines and that there were no accidents, improper installation, mishandling, misuse, damage while in transit, unauthorized alteration, unauthorized repair, failure to follow instructions, or misuse with the structured cabling system that could adversely impact warranty.
5. Test Reports: 4 copies on CD in compliance with related Test Result Documentation.
6. Submitted test results and other submittals that are non-compliant will be reviewed and returned to the Contractor with comments.
7. Re-submitted test results and other submittals that are non-compliant will be reviewed and returned to the Contractor with comments.
8. Subsequent reviews of test results and other submittals will be performed jointly by the Contractor and the Communications Consultant and Contractor will pay Communications Consultant's published hourly rate during third review and thereafter.

9. Manufacturer's warranty to the Owner. This shall include, but is not limited to: Owner's name and project name and address. (Within three weeks of substantial completion).
10. Within 21 days of completion of the project the communications contractor and/or the manufacturer's local representative will provide the owner with the Structured Cabling Performance Warranty signed by the manufacturer. The warranty shall list The Department of Veteran Affairs Mental Health Building and Parking Garage Phase II in Houston, Texas as the holder of the Warranty.

1.8 EQUIPMENT RELOCATION AND SYSTEM STARTUP

- A. Upon notice of construction completion, the selected Contractor will be responsible for system startup services for the new telecommunication room. The Contractor shall be responsible for ensuring the new equipment room, cabinets, floors and walls are clean and ready for equipment installation. On behalf of the Owner, the Contractor shall be responsible for coordinating with the GC and other trades to keep the room (s) clean and dust free at all times.
- B. After installation is complete, Contractor shall clean all systems; vacuum debris from system components, enclosures, racks, etc. and thoroughly clean the MTC/ITCs.
- C. It shall be the responsibility of the Contractor to develop and implement a full migration project schedule detailing the responsibilities of assigned personnel, along with contingency plans, and submit it to the Owner, or their designated representative, for approval.
- D. During the transition period, Contractor shall have the necessary supervisory, technical, and other personnel available throughout technology relocations and cutover of the telephone, networking, and video systems. This is to ensure that technicians are on site to observe the operation and maintenance of the equipment, and to resolve any cabling related issues during system start-up.
- E. Contractor shall accomplish a smooth and successful transition of operations and services to the new telecommunication room. The transition includes the coordination, migration, testing, and problem resolution with the system vendors.

1.9 SEQUENCING AND SCHEDULING

- A. An initial planning meeting will be held with the successful bidder to clarify all requirements (systems, services, distribution methods, etc.), identify responsibilities, and schedule the events that will transpire during the implementation of the project. Within two (2) weeks of the initial meeting, the Contractor shall provide a written report and project schedule to clearly document the events and responsibilities associated with the project taking into account all lead time for delivery of materials.
- B. Contractor shall be responsible for the development and implementation of a complete project schedule detailing the responsibilities of assigned personnel and submit it to the GC and Owner for approval.

1.10 QUALITY ASSURANCE - CONTRACTOR QUALIFICATIONS

- A. Follow Division 1 and this Section.
- B. Voice/Data
 - 1. The Contractor must be a Manufacturer's Business Partner capable of issuing a numbered registration 20 year warranty certificate for the installed cable system.
 - 2. The Contractor shall have been in telecommunications business continually for at least the past 3 years.
 - 3. A minimum of five (5) similar projects must be submitted as references to include the name, Architect or Consultant, cost of the project and the contact person to include phone number.
 - 4. The Contractor shall possess the most recent version of the TIA/EIA 568 C Series Telecommunications Building Wiring Standards available from Global Engineering Documents.
 - 5. The Contractor shall possess at least one copy of BICSI Telecommunications Distribution Methods Manual, Eleventh Edition, or newer.
 - 6. All contractor project managers, supervisors, lead technicians, and technicians shall each possess individual certification(s) for the installation and testing of voice and data products from the manufacturer of the warranted system.
 - 7. Supervisor or Lead Technician shall possess BICSI certificates of completion for training course TE300.

8. Installation Technicians shall possess BICSI certificates of completion for the training course IN100 for ITS Installer Level 1 and preferably IN200 for ITS Installer Level 2.
9. Testing Technicians shall possess manufacturer's certificates of completion for the test equipment used on the project.
10. The Contractor shall have a minimum of one (1) full time employee on staff that is a BICSI RCDD with experience in similar projects to review and approve the design and construction plans and inspect work and report status on a weekly basis.
11. Untrained, undocumented, or otherwise unqualified personnel are not allowed to perform any portion of the communications infrastructure installation.
12. All personnel must be permanent employees of the telecommunications contractor, or approved sub-contractors.
13. One hundred percent (100%) of Contractors' personnel shall be BICSI certified Contractors and have a minimum of 3 years experience in the installation of the types of systems, equipment, and cables specified in this document.
14. One hundred percent (100%) of Contractors' personnel shall be certified by specified manufacturer(s) for telecommunication cabling installations and maintenance of listed products.

C. Audio/Video

1. **Three (3)** years experience in the installation of AV distribution systems.
2. A minimum of five (5) similar AV projects must be submitted as references to include the name, Architect or Consultant, cost of the project and the contact to include phone number.
3. Installers must have been trained and experienced in the specific splicing, terminating and testing equipment to be used in the installation.

PART 2 - PRODUCTS

2.1 PRODUCT SCHEDULE

- A. Refer to Division 27 sections for approved products and schedules.
- B. 27 05 26 Grounding and Bonding
- C. 27 05 28 Pathways for Communications Systems

- D. 27 05 43 Underground Ducts and Raceways
- E. 27 05 53 Identification for Communications Systems
- F. 27 11 00 Communications Equipment Room Fittings
- G. 27 13 00 Communications Backbone Cabling
- H. 27 15 00 Communications Horizontal Cabling
- I. 27 16 00 Patch Cords, Station Cords, and Cross-Connect Wire

2.2 WARRANTY

- A. Within 10 days of completion of the project, Contractor shall deliver letter signed by local SCS Manufacturer's representative and Contractor's RCDD stating that installed cabling system complies with all requirements specified in installation guidelines and that there were no accidents, improper installation, mishandling, misuse, damage while in transit, unauthorized alteration, unauthorized repair, failure to follow instructions, or misuse with the structured cabling system that could adversely impact the warranty.
- B. Within 21 days of completion of a project the communications contractor and/or the manufacturer's local representative will provide the Owner with the 20 year Structured Cabling Performance Warranty signed by the manufacturer. The warranty shall list The Department of Veteran Affairs in Houston, Texas as the holder of the Warranty.
- C. The Owner shall not be responsible for any aspect of ensuring the warranty is issued or updated. It shall be the Contractor's responsibility in conjunction with the Manufacturer.
- D. During the warranty period, Owner may engage any manufacturer approved communication contractor to perform future moves, adds and changes to the system. Owner approved contractors shall be responsible for updating any required documentation. Owner shall not be responsible for any aspect of updating and maintaining the warranty.
- E. The 20 year Labor, Material and Performance Warranty shall cover the testing and replacement of all structured cabling components. The structured cabling system shall be a complete certified system. The system and all components shall be performance matched and guaranteed by the manufacturer.
- F. Person / Entity Covered

1. This warranty is for the sole benefit of Owner to the site in which such Registered SCS was originally installed.
2. All communications work and materials not included in the SCS components shall be warranted by the Contractor that performed the work for a minimum of three years from the date of substantial completion.

2.3 DELIVERY, STORAGE, AND HANDLING

- A. Delivery Requirements: Follow Division 1 Requirements.
- B. Packing, Shipping, Handling, and Unloading
 1. All material shall be shipped to the Project's designated on-site staging area (to be determined), or a mutually agreed upon location.
- C. Acceptance at Site
 1. All risk of damage or loss will remain with the Contractor until project completion and acceptance of the installation by the Project Manager. Upon acceptance, risk of loss will pass to the Owner. Prior to that time, the Contractor shall be solely responsible for security of all Contractor provided project materials.
- D. Storage and Protection
 1. All materials and equipment delivered and placed in storage shall be stored with protection from the weather, humidity, and temperature variation, dirt, and dust, or other contaminants.
 2. Material will be properly packaged in original factory-fabricated type containers and protected from damaging fumes, construction debris, and traffic until installation or job completion.
 3. Any flammable materials or hazardous materials shall be kept and/or stored in suitable places approved by the General Contractor and outside the buildings at all times.

2.4 PRODUCT QUALITY ASSURANCE

- A. All materials and equipment provided shall be the standard Commercial-Off-The-Shelf (COTS) products of a manufacturer engaged in the manufacture of such products. All materials shall be typical commercial designs that comply with the requirements specified. All materials and equipment shall be readily available through manufacturers and/or distributors. All equipment shall be supplied complete with any optional items required for proper installation.

- B. Expansion Capability: Unless otherwise indicated, provide spare conductor pairs in multi pair cables, positions in patch panels, cross connects, and terminal strips, and space in cable pathways and backboard layouts to accommodate 100 percent future growth in campus distribution and active workstations.
- C. In the event of a breach of the representations and warranties contained herein, the Contractor, at their own expense, shall take all measures necessary to correct and make the cabling system work in compliance with the applicable manufacturer written technical recommendations and standards.

PART 3 - EXECUTION

3.1 SITE CONDITIONS

- A. Existing Site Conditions
 - 1. Cable pathways and runs to individual outlets are not shown in their entirety but shall be provided as if shown in their entirety. The Contractor shall coordinate with other trades to determine exact placement and routing.
- B. Environmental Limitations
 - 1. Due to the critical nature of the environment, the Contractor shall use extra effort to provide a clean work environment, free from trash/rubbish accumulated during and after cabling installation. Contractor shall remove all rubbish from job site daily at his or her own expense.

3.2 EXAMINATION

- A. Examination of buildings and site shall be the responsibility of the Contractor. Examine conditions for compliance with requirements of other Sections in which related work is specified and determine if conditions affecting performance of the work of this Section are satisfactory. Do not proceed with work of this Section until unsatisfactory conditions have been corrected in an acceptable manner.
- B. Verify liquid-carrying pipes are not installed in or above voice and data system equipment rooms. Verify conduit, raceways, and boxes are properly installed.

- C. Verify fire-rated backboards are properly installed and painted. Notify the Project Manager immediately and prior to installation in the event that the backboards are not installed or painted properly.
- D. Prior to starting the installation, the assigned installation supervisor shall participate in a walk-through of the project site with the Project Manager to review the installation documentation, verify that all construction necessary for the installation has been completed, and verify all installation methods and cable routes.
- E. The Contractor shall provide a complete cabling infrastructure according to the written specifications and drawings. If the scope of work to be performed by the Contractor changes, it shall be in writing. Contractor shall respond to these changes with a complete material list, including pricing, labor, and taxes in writing per Division 1 requirements. Contractor shall not proceed with additional scope of work without signed approval by the General Contractor.

3.3 PREPARATION

- A. Protection of Surroundings
 - 1. Repair: Patching and repair of facilities, finishes, and equipment. Any damage to building or site caused by Contractor, including grass, paving, curbs etc., shall be restored at Contractor's expense to match condition prior to damage. If necessary and requested by the General Contractor, Contractor shall provide professional services to clean or repair scratched/soiled finishes at their own expense.
 - 2. Contractor shall keep all foods and liquids (water, drinks, etc.) in designated break areas.
 - 3. The Contractor shall obtain the Architect's and Engineer's written permission via the General Contractor before proceeding with any work necessitating cutting into or through any part of building structures such as girders, beams, concrete or tile floors, partition and/or ceilings.
 - 4. If it becomes necessary to cut through any wall, floor, or ceiling to install any work under this Section of the Contract or to repair any defects that may appear up to the expiration of the guarantee

- period, such cutting shall be done by the Contractor under the supervision of the General Contractor.
5. Patching of all openings cut by the Contractor, or repairing of any damage to the work of other trades caused by cutting or by the failure of any part of the work installed under this Contract, shall be performed by the appropriate trade but shall be paid for by the Contractor.
 6. Openings cut through concrete and masonry shall be made with masonry saws and/or core drills and at such locations acceptable to the Architect/Engineer. Impact-type equipment shall not be used except where specifically approved by the Architect/Engineer.
 7. All openings shall be restored to "as-new" condition under the appropriate Specification Section for the materials involved, and shall match remaining surrounding materials and/or finishes.
 8. Refer to Division 1 for additional information.

3.4 DEMOLITION / REMOVAL

- A. Unless indicated otherwise, all items that must be removed due to interference with work of this contract remain the property of the Owner, and are to be salvaged at the Owner's discretion. Any material to be salvaged, other than Contractor's waste material, must be approved in writing by the General Contractor.

3.5 FIRESTOPPING.

- A. The Contractor is required to properly fire-stop any penetrations through fire barriers utilized for the placement of telecom cabling. Provide fire resistant intumescent materials to restore fire ratings to wall, floor, or ceiling penetrations according to local and national codes.
- B. Verify the hourly rating of the barrier.
- C. Select the UL Listing to match or exceed the barrier.
- D. Adhere to cable loads and fill procedure in the Listing.
- E. Seek pre-approval from the Authority Having Jurisdiction (Inspector).
- F. When installing the System, be sure not to exceed the listing limitations.

- G. All openings shall be restored to "as-new" condition under the appropriate Specification Section for the materials involved, and shall match remaining surrounding materials and/or finishes.
- H. Provide fire resistant materials to restore fire ratings to all wall, floor, or ceiling penetrations used in the distribution and installation for communications cabling system. Coordinate fire stopping procedures and materials with General Contractor.
- I. Solutions and shop drawings/submittals for fire stop materials and systems shall be presented to the General Contractor for written approval of materials prior to purchase and installation.
- J. Materials shall be installed per manufacturer instructions, be UL listed for intended use, and meet NEC codes for fire stopping measures.
- K. The material chosen shall be distinctively colored to be clearly distinguishable from other materials, adhere to itself, and remain resilient and pliable to allow for the removal and/or addition of communication cables without the necessity of drilling holes in the material.
- L. The fire stopping material shall maintain/establish the fire rated integrity of the wall/barrier that has been penetrated.
- M. Contractor shall coordinate with electrical contractor and ensure communications pathway firestopping is properly identified and labeled.

3.6 CONSTRUCTION WASTE MANAGEMENT

- A. Contractor shall remove all excess material and debris from the site upon completion of work each day and in a manner approved by the General Contractor's Project Manager.

3.7 LABELING

- A. Confirm administrative labeling scheme of cabling and its numerical positions on the termination hardware. Ensure compliance with ANSI/TIA/EIA-606A Labeling standards.

3.8 CLOSEOUT ACTIVITIES

- A. Acceptance shall be subject to substantial completion of all work, successful post-installation testing which yields 100% PASS rating, and receipt of full documentation as described herein.
 - 1. All Proposal Submittals and Project Record Submittals.

2. Training to Owner's representative on methods to add and remove fire stop barriers
3. Maintenance manuals specified in Div. 1 to GC and Owner regarding structured cabling system, fire stopping and manufacturer's recommended maintenance instructions.
4. Contractor shall complete all punch list items within five (5) days of notification by GC.
5. Contractor shall complete Closeout Checklist listing status of all submittals, maintenance manuals, Owner training, and punch list items and deliver per Division 1.

- - - E N D - - -

SECTION 27 05 26
GROUNDING AND BONDING

PART 1 - GENERAL

1.1 SECTION INCLUDES

- A. This Section specifies the requirements for the Communications Grounding and Bonding for the Expansion & Renovation of Building 108 for Mental Health in Houston, Texas.

1.2 RELATED REQUIREMENTS

- A. Drawings and General Provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.
- B. Section 27-05-00 Common Work Results
- C. Section 27-05-26 Grounding and Bonding for Communications Systems.
- D. Section 27-05-28 Pathways for Communications Systems.
- E. Section 27-05-53 Identification for Communications Systems.
- F. Section 27-11-00 Communications Equipment Room Fittings
- G. Section 27-13-00 Backbone Cabling Requirements

1.3 REFERENCES AND STANDARDS

- A. ANSI J-STD-607-A, Commercial Building. Grounding/Bonding Requirements-Joint Standard for Commercial Building Grounding (Earthing) and Bonding Requirements for Telecommunications, 2002*.
- B. IEEE/ANSI 142, Recommended Practice for Grounding of Industrial and Commercial Power Systems.
- C. IEEE 1100, Recommended Practice for Powering and Grounding Sensitive Electronic Equipment.
- D. UL 467 Electrical Grounding and Bonding Equipment.
- E. NEC, NFPA 780, Standards for Installation of Lightning Protection.

1.4 DEFINITIONS AND ABBREVIATIONS

- A. TMGB - Telecommunications Main Grounding Busbar: The dedicated extension of the building grounding electrode system for the telecommunications infrastructure. The central attachment point for the TBB's and equipment typically located in the MTC, also known as the Main Telecom Closet.
- B. TGB - Telecommunications Grounding Busbar: The grounding connection point for telecommunications systems and equipment in the area typically served by a ITC, also known as the Intermediate Telecom.

- C. TBB - Telecommunications Bonding Backbone: A bonding conductor that interconnects telecommunications main grounding busbar (TMGB) to the telecommunications grounding busbar (TGB).
- D. BCT - Bonding Conductor for Telecommunications that bonds the TMGB to the electrical power ground.
- E. GE - Grounding Equalizer: A conductor that interconnects elements of telecommunications grounding infrastructure.
- F. Exothermic Weld: A method of permanently bonding two metals together by controlled heat reaction resulting in a molecular bond.

1.5 SUMMARY

- A. Telecommunications Main Grounding Bus Bar Connection to the Electrical Ground must be an exothermic weld. When making exothermic welds, wire brush or file the point of contact to a bare metal surface. Use exothermic welding cartridges and molds in accordance with the manufacturer's recommendations. After welds have been made and cooled, brush slag from the weld area and thoroughly cleaned the joint area. Notify the Resident Engineer prior to backfilling any ground connections.
- B. Provide ground lug for each 19" rack. Racks shall be grounded to wall mounted ground bus bar using #6 AWG stranded, green jacketed, insulated copper conductor. Furnish all required bonding material and hardware, and bond to building grounding electrode subsystem TMGB in MTC. If crimp connectors are used to bond the #6 AWG wire, follow NEC bonding procedures/specifications.
- C. Ground all telecommunication hardware such as cable ladder, conduit, equipment racks, and protection units and shielded cabling with #6AWG ground wire.
- D. An inert dielectric material shall separate dissimilar metals apt to corrode through electrolysis under the environmental operating conditions specified.
- E. Telecommunications Grounding Bus Bars and grounding wires connecting to main building grounding electrode system provided by Electrical Contractor.

PART 2 - PRODUCTS

2.1 TELECOMMUNICATIONS BUSBARS

- A. Material: Copper, ¼" thick (aluminum not permitted).
- B. Pre-drilled
 - 1. 3/8" Diameter.

2. Hole spacing per ANSI Joint Standard J-STD-607-A.
3. Hole pattern shall accommodate two hole lugs.
- C. Busbars shall be listed by a nationally recognized testing laboratory.
- D. Telecommunications Main Grounding Busbar (TMGB)
 1. Chatsworth #10622-012 ground busbar with Chatsworth #10622-000 busbar insulators or equivalent, 20"x4" minimum.
- E. Telecommunications Grounding Busbar (TGB)
 1. Chatsworth #10622-012 ground busbar with Chatsworth #10622-000 busbar insulators or equivalent, 12"x2" minimum.

2.2 GROUNDING JOINTS/SPLICES

- A. Grounding conductor joints/splices shall be mechanical type, copper alloy, with a minimum of two bolts and a separate section for each conductor equal to Burndy "QPX", OZ/Gedney "XTP" or "PMX" or Penn-Union "VX" or copper compression type with two (2) indents equal to Burndy, T&B or Blackburn.
- B. Grounding conductor terminations (lugs) shall be single barrel, mechanical screw type, copper alloy with machined contact surfaces equal to OZ type "SL", T&B, or Burndy or copper compression type with two (2) indents equal to Burndy, T&B or Blackburn.

2.3 BONDING CONDUCTORS

- A. Material: Stranded copper (aluminum not permitted).
- B. Cable Tray Bonding Conductor: Green #8 AWG insulated bonding jumper (12" max) with appropriate lugs or manufactured braided copper grounding jumper equal to B-Line #CAM-GJ, T&B #BD12, OZ/Gedney type "FB" or Mono-Systems.
- C. Equipment Frame Bonding Conductor; Panduit #TRGK672 Telecommunications Rack Grounding Kit.
- D. Bonding Conductor (BC): Green insulated copper bonding conductor, size as required by NEC.
- E. The BC shall be, as a minimum, the same size as the TBB.
- F. Telecommunications Bonding Backbone (TBB): Green insulated copper conductor, minimum size of No. 6 AWG.
- G. The TBB shall be sized at 2 kcmil per linear foot of conductor length up to a maximum size of 3/0 AWG. Insulation shall meet fire ratings of its pathway.

Table 1
Sizing of the TBB
TBB length (ft) TBB Size (AWG)

Less than 13	6
14-20	4
21-26	3

27-33	2
34-41	1
42-52	1/0
53-66	2/0
Greater than 66	3/0

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Provide the required elements and associated hardware necessary to provide a complete Telecommunications Grounding Infrastructure as specified.
- C. TMGB
 - 1. Locate the TMGB at the bottom of plywood backboard near the outside plant entrance conduits in the "MTC".
 - 2. TMGB shall be installed so that the BC for telecommunications is as short and straight as possible.
 - 3. Conductor shall be installed in continuous 3/4" conduit.
- D. TGB
 - 1. Locate the TGB at the bottom of plywood backboard near the copper riser terminations in each "ITC".
 - 2. TGB shall be installed so that the TBB for telecommunications is as short and straight as possible.
- E. TBB
 - 1. Install Green insulated copper grounding conductor (refer to 2.03.D for conductor size) from the TMGB to each TGB.
- F. Grounding Conductor Joints/Splices
 - 1. Install mechanical type, copper alloy, with a minimum of two bolts and a separate section for each conductor or copper compression type with two (2) indents.
 - 2. Install manufactured insulating cover or heavy tape insulation over joints/splices.
- G. Grounding of Cable Tray
 - 1. Install Green #8 AWG bonding jumper (12" max) with appropriate lugs at each cable tray joint or install manufactured braided copper grounding jumper equal to B-Line #CAM-GJ, T&B #BD12, OZ/Gedney type "FB" or Mono-Systems.
 - 2. Install Green #8 AWG grounding conductor with appropriate lugs from side of cable tray down to TMGB or TGB. Drill and tap side of cable tray (for appropriate size bolt, 1/4" x 20 min.), making sure that bolt does not extend into wire management part of tray.
- H. Grounding of Equipment Frame
 - 1. Install Panduit or equivalent Telecommunications Rack Grounding Kit from equipment frame to grounded cable tray, TMGB, or TGB.
- I. ANSI J-STD-607-A, Commercial Building. Grounding/Bonding Requirements-Joint Standard for Commercial Building Grounding (Earthing) and Bonding Requirements for Telecommunications, 2002*.
- J. IEEE 1100, IEEE Recommended Practice for Powering and Grounding Sensitive Electronic Equipment.

K. NEC, NFPA 780.

L. SECTION 27 05 53 IDENTIFICATION FOR COMMUNICATIONS SYSTEMS.

3.2 QUALITY CONTROL

A. Inspect grounding and bonding system connections and conductors for proper installation and tightness.

3.3 DOCUMENTATION

A. Provide documentation of actual locations of grounding electrodes, busbars and backbone grounding conductors.

- - - E N D - - -

SECTION 27 05 28
PATHWAYS FOR COMMUNICATIONS SYSTEMS

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section specifies the requirements for the Pathways for Communications Systems for the Expansion & Renovation of Building 108 for Mental Health in Houston, Texas.
- B. Communication Pathways are defined to include, but are not limited to, innerduct, conduit, pull boxes, cable hooks, cable trays, supports, accessories, associated hardware and fire stopping materials. Final design and specifications for conduits shall be made by the Electrical Engineer of Record.
- C. In typical work areas, two (2) 1" conduits with pull strings, not more than 100' long with a maximum of two (2) 90 degree bends, will provide the cabling pathway from a double gang box to the primary horizontal overhead pathway system.
- D. Provide a Cable Saddle and J-Hook Cable Support system for horizontal cabling in the accessible ceiling space from each work area conduit to the nearest primary horizontal pathway. Assemblies shall be complete with mounting hardware and rated for CAT 6 data cabling. Confirm with Architect and Construction Manager for J-Hook installation and mounting techniques.
- E. Work furnished and installed by Electrical Contractor as specified in this Section and as shown in E and T drawings includes:
 - 1. The conduits and back boxes for the work area telecommunications, AV and specialty systems outlets.
 - 2. Fire stopping of conduit cable pathway.
- F. Work furnished and installed by the Cable Contractor as specified in this section and as shown in E and T drawings includes:
 - 1. The overhead cable runway system (cable tray) within the new TR.
 - 2. Bonding and grounding of overhead cable runway system (ladder rack), racks and cabinets within the TR.

PART 2 - PRODUCTS

2.1 GENERAL

- A. Where conduit, pull boxes, cable basket tray and other raceway sizes are not specifically shown on contract drawings, all communication

pathways shall be sized in accordance with the requirements of BICSI and the NEC. No conduit shall be less than 1".

2.2 CABLE HOOK SYSTEMS

- A. All horizontal voice and data runs will be supported by j-hooks down major hallways from the MTC/ITC transitioning to J-hook Cable Supports to the conduit connecting to the outlet box. Refer to the T drawings for details.

2.3 CONDUITS AND FITTINGS

- A. For each wireway system indicated, provide a complete assembly of conduit, tubing or duct with fittings including, but not necessarily limited to, connectors, nipples, couplings, locknuts, bushings, expansion fittings, other components and accessories as needed to form a complete system of the same type indicated.
- B. See Division 26 for RACEWAYS, CONDUITS AND BOXES
- C. Minimum conduit size for Telecommunications Outlets shall be 1 (one) inch.

2.4 WALL AND CEILING OUTLET BOXES

- A. Galvanized steel interior outlet wiring boxes of the type, shape and size, including depth of box, to suit each respective location and installation; constructed with stamped knockouts in back and sides, and with threaded holes with screws for securing box covers or wiring devices.
- B. Outlet box accessories as required for each installation, including mounting brackets, wallboard hangers, extension rings, fixture studs, cable clamps and metal straps for supporting outlet boxes, compatible with outlet boxes being used and meeting requirements of individual situations.
- C. See Division 26 for RACEWAYS, CONDUITS AND BOXES.

2.5 PULL AND JUNCTION BOXES

- A. See Division 26 for RACEWAYS, CONDUITS AND BOXES

PART 3 - EXECUTION

3.1 SUMMARY

- A. Final design and specifications for the Communications Systems conduits shall be made by the Electrical Engineer and Architect of Record.
- B. Conduits shall be reamed to eliminate sharp edges. Metallic conduit shall be terminated with an insulated bushing. Refer to ANSI/TIA/EIA-606A and Section 27 05 53 for Administration of the Pathway system.

- C. When J-hooks are used in the ceiling area, conduits from the J-hooks to outlets or zones shall be provided unless otherwise permitted by code and specified.
- D. Provide #8 AWG wire and/or all-threaded rod for supporting hangers when hanging from floor deck and deck members. Refer to manufacturer recommendations for proper installation, sizing, and loading of hangers.
- E. Cables shall be neatly dressed along common paths with Velcro tie wraps. Maximum number of cables per bundle shall not exceed manufacturer specifications.
- F. Layout cable runs in advance to determine quantities of cable to be installed along pathways, and to ensure non-interference from other trade installations.
- G. Do not support cables from, or on, ceiling suspension system or use electrical, plumbing, or other pipes for support. Cable supports shall be permanently anchored to building structure or joist. Provide attachment hardware and anchors designed for the structure to which attached, and that are suitably sized to carry the weight of the cables to be supported. Confirm with Architect and/or Construction Manager on installation procedures for cable support system prior to implementation.
- H. Secure and support exposed horizontal cable at intervals not exceeding 4ft and not more than 16 inches from cabinets, boxes, fittings, outlets, racks, frames, and terminals.

3.2 MINIMUM CLEARANCES

- A. Communication Pathway minimum clearances from:
 - 1. Minimum of 1 foot parallel, 3 inches crossover from power cables and conduits.
 - 2. Minimum of 6 inches above ceiling tiles.
 - 3. Minimum of 24 inches Hot Flues, Steam pipes, Hot water pipes and other hot surfaces.
 - 4. Minimum of 3 feet separation from electrical panel boards.
 - 5. Minimum of 12-inches from fluorescent fixtures.
 - 6. Minimum of 6 feet separation from electrical motors and transformers.
 - 7. Minimum of 2-inches from exposed all-thread rods.

3.3 FIRE STOPPING

- A. Provide fire resistant materials to restore fire ratings to all wall, floor, or ceiling penetrations used in the distribution and installation for communications cabling system. Coordinate fire stopping procedures and materials with General Contractor and Electrical Contractor.
- B. Solutions and shop drawings/submittals for fire stop materials and systems shall be presented to the General Contractor for written approval of materials prior to purchase and installation.
- C. Materials shall be installed per manufacturer instructions, be UL listed for intended use, and meet NEC codes for fire stopping measures.
- D. The material chosen shall be distinctively colored to be clearly distinguishable from other materials, adhere to itself, and remain resilient and pliable to allow for the removal and/or addition of communication cables without the necessity of drilling holes in the material.
- E. The fire stopping material shall maintain/establish the fire rated integrity of the wall/barrier that has been penetrated.

- - - E N D - - -

SECTION 27 05 43
UNDERGROUND DUCT AND RACEWAYS

PART 1 - GENERAL

1.1 SECTION INCLUDES

- A. This Section specifies the requirements for the Underground Ducts and Raceways for the Expansion & Renovation of Building 108 for Mental Health in Houston, Texas.
- B. Provide all services, labor, materials, tools, and equipment required for the complete and proper installation of exterior telecommunications pathways as called for in these specifications and related T, E and C drawings.
- C. This section includes minimum requirements and installation methods for the following:
 - 1. Trenching and Excavation
 - 2. Underground Conduit Systems
 - 3. Communications Vaults
- D. The new communications service entrance facility will be located in the first floor MTC. The new service entrance pathway will consist of two (2) 4" conduits from the existing maintenance hole (MH) located outside building.
- E. All conduits shall be installed with pull tape to facilitate cable installation.

1.2 RELATED REQUIREMENTS

- A. See Section 01-10-00 - Summary: Contract descriptions, description of alterations work, work by others, future work, occupancy conditions, use of site and premises, work sequence.
- B. See Section 27-05-00 - Common Work Results

1.3 REFERENCES

- A. ANSI/NFPA 70 - National Electrical Code including, but not limited to, the following articles:
 - 1. 314 - Outlet, Device, Pull-Boxes; Conduit Bodies; Fittings; and Manholes
 - 2. 344 - Rigid Metal Conduit: Type RMC
 - 3. 352 - Rigid Nonmetallic Conduit: Type RNC
 - 4. 358 - Electrical Metallic Tubing: Type EMT
 - 5. 384 - Strut-Type Channel Raceway
- B. IEEE/NESC - National Electrical Safety Code

C. NEMA Standards including, but not limited to:

1. NEMA, RN1, 1986 PVC Externally Coated Galvanized Rigid Steel Conduit and Intermediate Metal Conduit.
2. NEMA, TC3, 1982 PVC Fittings for use with Rigid PVC Conduit and Tubing.
3. NEMA, TC6, 1983 PVC and ABS Plastic Utilities Duct for Underground Installation.
4. NEMA, TC8, 1983 Extra Strength PVC Plastic Utilities Duct for Underground Installation.
5. NEMA, TC9, 1983 Fitting for ABS and OVC Plastic Utilities Duct and Fittings for Underground Installation.
6. NEMA, TC10, 1983 PVC and ABS Plastic Communications Duct and Fittings for Underground Installation.

D. UL Standards including, but not limited to:

1. UL 6, 1981 Rigid Metal Electrical Conduit
2. UL 651 1981 Schedule 40 and 80 PVC Conduit

E. ANSI-C80.2, 1983 Specification for Rigid Steel Conduit, Enameled

F. ANSI/TIA/EIA-569-B - Commercial Building Standard for Telecommunications Pathways and Spaces.

G. ANSI J-STD-607A - Commercial Building Grounding and Bonding Requirements for Telecommunications

H. ANSI/TIA/EIA-758-B - Customer Owned Outside Plant Telecommunications Cabling Standard (including all applicable addenda)

I. BICSI Telecommunications Distribution Methods Manual

J. BICSI Customer-Owned Outside Plant Manual

1.4 SUBMITTALS

- A. See Section 01-30-00 - Administrative Requirements, for submittal procedures.

1.5 WARRANTY

- A. See Section 01-78-00 - Closeout Submittals, for additional warranty requirements.

PART 2 - PRODUCTS

2.1 TRENCH/BACKFILL MATERIALS

- A. Trenching and Excavation Backfill: Select fill materials as specified in Section 01-57-13
- B. Cast-In-Place Concrete: Select Flow Fill as specified in Section 01-10-00

- C. Portland Cement Concrete Pavement: Select concrete paving materials as specified in Section 01-60-00
- D. Concrete Reinforcements: Select reinforcement materials as specified in Section 01-60-00.

2.2 CONDUIT SYSTEM

- A. Non-Metallic Conduit:
 - 1. PVC plastic pipe, ASTM D1785, Schedule 40, Type PVC 1120.
- B. Conduit Joint Couplings:
 - 1. PVC non-metallic fittings must be installed with solvent applied couplings.
 - 2. An approved transition coupling shall be used to connect metal to plastic (PVC) conduits.
 - 3. Couplings may be threaded and /or glued to provide watertight seal at conduit junctions.
- C. Rigid Steel or Intermediate Metal Conduit
 - 1. Rigid steel shall be UL 6 and ANSI C80.1 hot-dipped galvanized steel.
 - 2. Both ends of conduits shall be threaded with factory installed thread protectors.
 - 3. Fittings shall be threaded Type UL 6/1242 and ANSI C80.1 and C80.6 hot-dipped galvanized steel.
 - 4. Expansion fittings shall be OZ Type "DX", Appleton Type "XJ", Crouse-Hinds Type "XC" or an approved equal.
- D. Moisture Sealing and Corrosion Protection Tape: Mastic for protection of PVC to Rigid conduit joints shall be a polyvinyl chloride based tapes with special high tack adhesives formulated to resist corrosion above and below ground for fittings and joints on electrical conduit systems. Tape shall be 20mil (0,508 mm). Tapes have high electric strength, excellent insulating properties. Tapes shall be 3M brand "Scotchrap 51" All-Weather Corrosion Protective Tape or equivalent.
- E. Underground Plastic Line marker: Manufacturer's standard permanent, continuous-printed polyethylene film tape with metallic core, intended for direct burial service; not less than 3" wide x 4 mils thick. Provide orange tape with black printing reading, "CAUTION TELEPHONE/DATA CABLE BELOW," or similar.
- F. Pull-rope: 1/4" Nylon pull rope.
- G. Ground Wire: Bare Copper # 6 Tracer Box:

H. NEMA-3 4" x 4" weatherproof box

I. Spacers for 4" Conduit

J. Communications Vault Components;

1. Conduit Entry: Plastic conduits shall include a bell end inside the communications vault, mounted flush and grouted to seal openings. Precast fiber type terminators shall be provided for each ductbank entry.

PART 3 - EXECUTION

3.1 INSPECTION

- A. Examine areas and conditions under which the new exterior telecommunications pathways are to be installed. Provide notification, in writing, of conditions detrimental to proper completion of the work.
- B. Verify field measurements and pathway routing conditions are as shown on drawings. Provide notification, in writing, of conditions deviating from drawings.
- C. Beginning the telecommunications pathway installation indicates Contractor acceptance of existing conditions.

3.2 EXCAVATING, TRENCHING AND BACKFILLING:

- A. Follow Civil and Electrical specifications.
- B. Sequencing of work shall be coordinated with all other trades and be according to Section 01110 Sequencing of Work. Coordinate the voice and data communications work with other work in the same area.
- C. Contractor shall call appropriate utility locate service to locate any existing conduits (Power, Gas, Telephone, and other utilities) prior to start of work.
- D. Except as otherwise indicated, comply with the applicable sitework provisions within Division 2 for voice and data communications work excavating and backfilling.
- E. Coordinate excavating, trenching and backfilling Civil, Mechanical, Plumbing and Electrical drawings. Voice and Data Communications duct banks shall be independent of any other systems.
- F. Schedule operation so dust and other contaminants will not interfere with other construction.
- G. Refer to Civil contract documents for information regarding required depths, slope and grade and additional information regarding trenches.

- H. If any unknown and/or uncharted utilities are encountered during excavation, promptly notify Architect/ Engineer and wait for his instructions before proceeding.
- I. Trenches shall not be backfilled until all required tests have been made by the Contractor and approved by the Architect/Engineer and any local authorities having jurisdiction.
- J. Backfill up to grade shall be in maximum 6" lifts with minimum 95% compaction of lifts. Refer to Specifications within Division 2 or elsewhere in Contract Documents for additional trenching and backfill requirements.
- K. Opening and Re-closing Pavement, Landscape Areas and Lawns: Where excavation requires the opening of existing walks, street, drives, other existing pavement or lawns, such surfaces shall be cut as required to install new conduit and to make new connections to existing conduits. The sizes of the cut shall be held to a minimum, consistent with the work to be accomplished. After the installation of the new work is completed and the excavation has been backfilled and flooded, the area shall be patched or replaced, using materials to match those cut out or removed.

3.3 CONDUIT SYSTEM PLACEMENT

- A. Follow Civil and Electrical specifications.
- B. Place new conduit system including hand holes and communications vaults as shown on the project drawings.
- C. A minimum of twelve inches (12") of clearance from all utilities shall be maintained
- D. Telecommunications conduit ducts are to cross above other utilities.
- E. All conduits shall be thoroughly cleaned before laying or using.
- F. During construction the ends of the conduits shall be plugged.
Particular care shall be taken to keep the conduits clean of any foreign substance during the course of construction.
- G. Support multiple conduits on preformed nonmetallic separators to provide not less than 1" spacing between exterior surfaces of conduit. Spacing between separators shall be close enough to prevent sagging of conduits or breaking of couplings and watertight seals.
- H. All sweeps installed in the ductbank are to be bent as long a radius as conditions will allow. Minimum radius for any bend is to be no less than 4 feet. Sweeps are to be rigid steel conduit with the joint to

Schedule 40 PVC being threaded and wrapped in a 3M or equivalent mastic suitable to the application.

- I. Conduits shall be securely anchored in place with nylon tie-downs to prevent movement during the placement of concrete slurry (flow fill), and other backfill materials. Wire tie-downs are prohibited.
- J. Seal all conduit junctions and fittings watertight prior to pour of concrete slurry (flow fill). Conduit couplings shall be made in accordance with the manufacturer's recommendation for the particular type of conduit and coupling selected and as approved. .
- K. Bury underground plastic line marker one foot (12") above the telecommunications conduit.
- L. Provide plastic conduit bell ends at each PVC conduit termination and for all conduit entering communications vaults.
- M. Communications vault core drills must be sealed around conduits with approved waterproof plugging compound.
 - 1. Seal openings around conduits that pass through inside building wall core drills with UL listed foamed silicon elastomer compound.
 - 2. Seal openings around conduits that pass through communications vault walls with foundation foam on the interior of the core and silicone sealer on the inside and outside of the core for a waterproof seal.
- N. The ends of the metallic conduit shall be reamed and bushed using:
 - 1. Insulated metallic bushings for 1-1/4" conduit and larger
 - 2. Insulated metallic bushings with grounding lugs for conduit entering the MTC.
- O. After conduit duct installation has been completed and concrete has set, pull "D" test mandrel through all new conduit ducts to verify duct integrity and insure smooth interior surfaces free from burrs or obstructions that might damage cable sheaths.
- P. Following mandrel testing, draw cylindrical wire brush with stiff bristles through each conduit to clean the conduit and remove any concrete, dirt or other obstructions.
- Q. Stub out conduits through sleeves into the new MTC a minimum of 3" AFF and attach connector and bushings with grounding lugs.
- R. Install a pull rope in all new conduits and extend them three feet into the building space.

- S. Plug the ends of the new conduits with watertight rubber conduit plugs, conduit caulking compound, or conduit caps to ensure foreign matter does not enter the buildings.

3.4 CABLE ROUTING HARDWARE

- A. Perform installation of routing hardware including anchoring and supports, grounding and bonding, etc.
- B. Place new ladder, pulling-in irons, cable racks, "S" rack supports in the communications vaults as required for backbone cable routing.

3.5 SAFETY

- A. The contractor must comply with OSHA regulations for asbestos, lead, and confined spaces.
- B. All applicable state, federal and local safety regulations shall be adhered to and all operations shall be conducted in a safe manner.
- C. Guard communications vault openings in compliance with National Electrical Safety Code (NESC)
- D. When covers of communications vaults, hand holes, or vaults are removed, the opening shall be promptly protected with a barrier, temporary cover, or other suitable guard.
- E. Test for gas in communications vaults and unventilated vaults per National Electrical Safety Code (NESC) including, but not limited to:
 - 1. The atmosphere shall be tested for combustible or flammable gases before entry.
 - 2. Where combustible or flammable gases are detected, the work area shall be ventilated and made safe before entry.
 - 3. Forced continuous ventilation shall be provided
 - 4. Provision shall be made for adequate continuous supply of air. Note: The term adequate includes evaluation of both the quantity and quality of the air.
 - 5. Employees shall not smoke in communications vaults.
 - 6. Where open flames must be used in communications vaults or vaults, extra precautions shall be taken to ensure adequate ventilation.

3.6 AS-BUILT DRAWINGS

- A. Mark the project drawings with notations reflecting any variations from the base specifications and drawings including as-built conduit routing.

Expansion & Renovation of Building 108
For Mental Health

Issue for Construction
June 15, 2012

- - - E N D - - -

SECTION 27 05 53
IDENTIFICATION FOR COMMUNICATIONS SYSTEMS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and General Provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section specifies the requirements for the Identification for Communications Systems for the Expansion & Renovation of Building 108 for Mental Health in Houston, Texas.
- B. Work covered by this Section shall consist of furnishing labor, equipment and materials necessary for the labeling of the telecommunications infrastructure as described on the Drawings and/or required by these specifications.

1.3 QUALITY ASSURANCE

- A. Identification and administration work specified herein shall comply with the applicable requirements of:
 - 1. ANSI/TIA/EIA - 606-A Administration Standards.
 - 2. ANSI/TIA/EIA - 569 Pathway and Spaces
 - 3. ANSI/TIA/EIA - 568-B Telecommunications Cabling Standard.
 - 4. BICSI Telecommunications Distribution Methods Manual.
 - 5. UL 969.

1.4 TELECOMMUNICATIONS ADMINISTRATION

- A. Administration of the telecommunications infrastructure includes documentation of cables, termination hardware, patching and cross-connection facilities, conduits, other cable pathways, Telecommunications Rooms, and other telecommunications spaces.
- B. VA IT maintains a numbering scheme for voice and data outlets and patch panels.
- C. The following infrastructure identifiers shall be required for the Telecommunications Administration.
 - 1. All voice and data outlets and patch panels shall be clearly marked using permanent means. Voice and data outlets shall use the following system of numbering and labeling.

- a. DATA: Actual room number of jack + patch panel port number
 - b. VOICE: V +Actual room number of jack
 - c. When more than one ITC is needed per floor, the room number of the ITC shall be added to the numbering scheme.
 - d. When more than one data patch panel is needed per TR, the numbering scheme shall continue consecutively. Example: If two 48 port patch panels are needed, the second patch panel will be labeled starting with port 49.
 - e. All voice and data outlet and port numbering must match actual room numbers. Careful consideration shall be given when developing and maintaining a numbering scheme that the scheme matches the actual room numbers exactly; not builder's room number.
 - f. All voice and data terminations in the MTC/ITC shall be made in a numerical order by room number of each jack.
 - g. Outlet numbers shall be marked by permanent means on each cable at the outlet and at the TR.
- D. Telecommunications Infrastructure Records must be maintained in a computer spreadsheet, or in a computer database. Paper records are encouraged, but are optional. A cable record is prepared for each backbone cable. The record will show the cable name, and must describe the origin point and destination point of the cable. The cable record will record what services and/or connections are assigned to each cable pair or strand. An equipment record is prepared for services distributed from a certain piece of equipment, such as a router, or a system such as the telephone system PBX.
- E. The Contractor is required to keep accurate, up-to-date Installation or Construction Drawings. At a minimum, the Installation Drawings shall show pathway locations and routing, configuration of telecommunications spaces including backboard and equipment rack configurations, and wiring details including identifier assignments.
- F. The Contractor to provide a complete and accurate set of as-built drawings. The as-built drawings shall record the identifiers for major infrastructure components including; the pathways, spaces, and wiring portions of the infrastructure which may each may have separate

drawings if warranted by the complexity of the installation, or the scale of the drawings.

PART 2 - PRODUCTS

2.1 COMMUNICATION CABLING LABELS

- A. Shall meet the legibility, defacement, exposure and adhesion requirements of UL 969.
- B. Approved Manufacturer:
 - 1. Brady Corporation
 - 2. Panduit
 - 3. Equivalent

2.2 LABELS

- A. Shall meet the legibility, defacement, exposure and adhesion requirements of UL 969.
- B. Shall be preprinted or computer printed type. Hand written labels are not acceptable.
- C. Where insert type labels are used provide clear plastic cover over label.
- D. Approved Manufacturer:
 - 1. Brady Corporation
 - 2. Panduit
 - 3. Equivalent

PART 3 - EXECUTION

3.1 IDENTIFICATION AND LABELING

- A. Contractor shall follow ANSI/TIA/EIA-606A Labeling Standard.
- B. All labeling must be coordinated with VA IT prior to start date.
- C. The size, color, and contrast of all labels shall be selected to ensure that the identifiers are easily read. Labels should be visible during the installation of and normal maintenance of the infrastructure.
- D. Labels should be resistant to the environmental conditions at the point of installation (such as moisture, heat, or ultraviolet light), and should have a design life equal to or greater than that of the labeled component.
- E. All labels shall be printed or generated by a mechanical device.

- - - E N D - - -

SECTION 27 11 00
COMMUNICATIONS EQUIPMENT ROOM FITTINGS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and General Provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section specifies the requirements for the Communications Equipment Room Fittings for the Expansion & Renovation of Building 108 for Mental Health in Houston, Texas.
- B. Communications Equipment Room Fittings
 - 1. The new communications service entrance facility will be located in the Mental Health Building MTC. The new service entrance pathway will consist of 2 - 4" conduit from the existing outside Maintenance Hole (MH).
 - 2. The new MTC will be located in the Mental Health Building as indicated on the T drawings.
 - a. A minimum size of approximately 9' x 10'.
 - b. 24/7 environmental controls - 18 °C to 24 °C (64 °F to 75 °F).
The humidity range shall be 30% to 55% relative humidity.
 - c. Ceiling height a minimum of 10 ft. above finished floor (AFF).
 - d. No false ceilings.
 - e. Light fixture height a minimum of 8.5 ft AFF, with a minimum equivalent of 500 lux (50 foot candles) measured 3' AFF, with 30% emergency light fixtures, if available.
 - f. Dedicated Telecom Room power panels fed from UPS distribution, if available.
 - g. A minimum of one fourplex isolated ground 120-volt power outlet per wall with a maximum of two fourplex outlets per circuit.
 - h. One 30-amp 120-volt single phase circuit per equipment rack/cabinet.
 - i. ¾ "void-free" marine plywood on each wall, 8 ft high, painted with at least two coats of light gray fire retardant paint.
 - p. Fire suppression systems.
 - q. A floor rating greater than 4.8 kPa (100 lbf/ft²) distributed loading.

- r. A floor rating greater than 8.8 kilonewton (kN) (2000 lbf) concentrated loading.
- s. Fully-opening, secured, lockable doors that are at least 4 ft wide and 6.7 ft [80 in]) tall.
- j. A Telecommunications Main Grounding Bus Bar (TMGB) in the MTC and Telecommunications Grounding Bus Bar (TGB) in the ITC and a Bonding Conductor for Telecommunications (BCT) that bonds the TMGB to the electrical power ground compliant with ANSI J STD-607 A Standards.
- k. Equipment racks and overhead basket tray system as indicated on the T Drawings.

PART 2 - PRODUCTS

2.1 RELAY RACKS

A. Approved Manufacturers:

- 1. CPI
- 2. Cooper B-Line
- 3. Mid Atlantic
- 4. Hoffman

B. Equipment Racks:

- 1. Constructed of painted aluminum
- 2. 84" in height
- 3. Black finish
- 4. Each equipment rack designated for voice services shall have 1 - L5 - 20R twist lock 20 amp dedicated and protected installed at the rear base of the rack.
- 5. Each equipment rack designated for data or security services shall have at dedicated 120VAC 20AMP Quad receptacle installed at the rear base of each rack
- 6. Supplied with #6 AWG ground lug kit
- 7. Supplied with spare screws (minimum 50)
- 8. Mounting holes shall be drilled and tapped each side at 5/8"-5/8"-1/2" patterns compatible with EIA 1-1/4"-5/8" alternating patterns.
- 9. Include base flanges with mounting holes securing the rack to the floor. Each mounting hole must be at least 5/8" in diameter.

C. Where the rack is to be mounted to VCT flooring or bare concrete, an insulating pad must be used, and care must be taken that anchors, used

to secure the rack to the floor, do not come in contact with any reinforcing steel embedded in the concrete slab.

2.2 CABLE MANAGEMENT

A. Approved Manufacturers:

1. CPI
2. Cooper B-Line
3. Hoffman

B. Vertical Cable Management:

1. Double-sided cable routing
2. 6" or wider depending upon application requirements
3. Lockable latching sections with protective edge guards
4. Space slots at 1 RU intervals
5. Black finish

C. Horizontal Cable Management:

1. Capable of attachment to a 19" rack
2. 2 U, maximum 4" deep
3. Heavy-duty aluminum rings with rounded edges
4. Incorporate cable routing guides and supports on rear panel
5. Black finish

2.3 CABLE RUNWAY SYSTEM

A. Approved Manufacturers:

1. B-Line Cable Management System or equivalent.

B. Basket tray is required within the communications rooms to provide a suitable pathway to route all cabling into and out of termination equipment, mounted in equipment racks or on backboards attached to walls.

C. Wire mesh tray: Provide UL classified basket tray and components.

Such products are to be UL classified as to its suitability as an equipment-grounding conductor. Basket tray and components are to have rounded edges and smooth surfaces in compliance with applicable standards, and with the following additional construction features:

1. Basket tray size shall be 12" x 4" inches except as otherwise shown on the Telecommunications Drawings.
2. Continuous top wire safety edge must be kinked and T-welded on all tray sizes.
3. Wire mesh welded at all intersections.

4. All mesh sections must have at least one (1) bottom longitudinal wire along entire length, Wire Diameter: 0.197" (5mm) minimum on all mesh sections (minimum size of 4.5mm on stainless steel).
5. Manufacturer's cutting tool must be used when performing any field fabrication or modification of the tray sections.
- D. Wire mesh tray fittings are to be purchased precut from the manufacturer or field fabricated from straight tray sections, utilizing the manufacturer's cutting tool, according to manufacturers' instructions. Supports and Accessories shall be purchased from the manufacturer of the straight tray sections. Tray must be attached to a support by mechanical means (e.g. nuts/bolts), or by use of support tabs.
- E. Special accessories shall be furnished as required to protect, support and install a wire basket support system.
- F. Fill Ratio: Cable Tray may be filled to 40% of total fill capacity per TIA 569-A

PART 3 - EXECUTION

3.1 GENERAL

- A. Telecommunications rooms are generally considered a zone serving facility. These rooms may be equipped with fiber and copper cables, wall mounted termination blocks/patch panels, rack mounted copper and fiber patch panel terminations, vertical and horizontal cable management systems and equipment racks. Cable Contractor shall provide proper identifications/labeling scheme for all structured cabling components installed in these rooms.
- B. Follow manufacturer's recommended installation and termination practices.
- C. Cabling within racks and enclosures: provide adequate length of cabling. Train conductors to termination terminal points that follow manufacturer's installation procedures for maintaining cable performance specifications. Provide lacing/mounting bars to restrain cables, to prevent straining connections, and to stop bending cables to smaller radii than minimums recommended by manufacturer.
- D. Equipment Racks: Provide 19" wide x 7'-0" tall racks with number of vertical rack sections as required to allow space for termination of all fiber and data/voice cabling plus mounting space for multi-port concentrators (Hub/Switches) required to cross-connect all data jacks.
- E. Locate/space racks and enclosures (cabinet) according to EIA/TIA guidelines for front and around access.

- F. Vertical wire management: double-sided vertical rack cabling sections shall be a minimum width of 6 inches or wider. Reference T. Drawings
- G. Entrance: Arrange and coordinate locations of distribution frames, patch panels, cross-connections (furnished by others) in communication rooms and racks to optimize space requirements of any service provider requirements, telephone system and LAN equipment.
- H. Provide cable runway in equipment room above all racks and up to cross-connects/runway/conduits/sleeve's entering room from corridors. Form a complete runway system by ringing the room and connecting all hardware installations. Route the cables within the room by taking the longest available path through the perimeter cable tray. Attach grounding lugs to each rack/cable raceway, conduit, etc. Refer to 'T' drawings for details.
- I. Coordinate runway locations with lighting, air-handling systems, and fire extinguishing systems so that fully loaded trays will not obstruct or impede their operation. In the United States, NEC Article 392 provides requirements for cable trays.
- J. Provide horizontal cable runways. Equip each 19" rack with overhead ladder style cable runway installed between the wall and horizontal/equipment racks. Refer to COMMUNICATIONS "T" drawings for proposed locations and sizing of each runway. Securely attach to wall studs with support brackets (and racks if applicable), in accordance with manufacturers written instructions.
- K. Provide ground lug for each 19" rack. Racks shall be grounded to wall mounted ground bus bar using #6 AWG stranded, green jacketed, insulated copper conductor. Furnish all required bonding material and hardware, and bond to building grounding electrode subsystem TMGB in MTC. If crimp connectors are used to bond the #6 AWG wire, follow NEC bonding procedures/specifications.
- L. An inert dielectric material shall separate dissimilar metals apt to corrode through electrolysis under the environmental operating conditions specified.

- - - E N D - - -

SECTION 27 13 00
COMMUNICATIONS BACKBONE CABLING

PART 1 - GENERAL

1.1 SCOPE OF WORK

- A. Work covered by this Section shall consist of furnishing labor, equipment, supplies, materials, and testing, unless otherwise specified, in performing the following operations recognized as necessary for the installation, termination, and labeling of copper backbone infrastructure as described on the Drawings and/or required by these Specifications.

1.2 RELATED SECTIONS

- A. 27 05 00 General Communications Requirements
- B. 27 05 28 Pathways for Communications Systems
- C. 27 05 26 Grounding and Bonding
- D. 27 05 43 Underground Ducts and Raceways
- E. 27 05 53 Identification for Communications Systems
- F. 27 11 00 Communications Equipment Room Fittings
- G. 27 13 00 Communications Backbone Cabling
- H. 27 15 00 Communications Horizontal Cabling
- I. 27 16 00 Patch Cords, Station Cords,& Cross-Connect Wire
- J. 27 20 00 Data Communications Equipment
- K. 27 30 00 Voice Communications Equipment

1.3 COORDINATION

- A. Contractor shall coordinate the work specified in this Section with the work in other parts of the Contract document.
- B. Plans in general are diagrammatic. It is the full responsibility of the Contractor to be familiar with under the work of other trades to eliminate conflicts between the multipair copper cable installation and the work of other trades.
- C. All questions and issues with regard to coordination shall be directed to the Owner.

1.4 SUBMITTALS

- A. All submittals for substitutions or modifications shall be made to the Owner for approval prior to start of work. (See Section 27 05 00)
- B. The Contractor shall submit a copper cable pulling plan for all multipair copper cables with a pair count of 25 pairs or greater, that includes, but is not limited to, the following:

1. Each cable run and route.
2. Date and duration of the pull.
3. Pulling methodology and equipment setups.
4. Pulling tension calculations for each pull in the run.
5. Safety issues and precautions to be taken.

1.5 QUALITY ASSURANCE

- A. Verification: The Owner will maintain inspection personnel on the job site. It is incumbent upon the Contractor to verify that the installation and material used has been inspected before it is enclosed within building features, or otherwise hidden from view. The Contractor shall bear costs associated with uncovering or exposing installations or features that have not been inspected.
- B. Equipment Qualifications: The Contractor is to use equipment and rigs designed for pulling, placement and termination of multipair copper cable; including reel trucks, mechanical mules, sheaves, shoes, anchors etc., and equipment for drilling masonry, installing anchors, etc., to install support and cable management hardware.
- C. Backbone Cable Testing
 1. Complete end-to-end test results for all copper UTP and fiber optic lines installed is required.
 2. All fiber optic cable must be visually inspected and optically tested on the reel upon delivery to the installation site. Using an Optical Time Domain Reflectometer (OTDR), an access jumper with like fiber, a pigtail, and a mechanical splice, all fibers shall be tested for continuity and attenuation. Testing for continuity and attenuation on the reel must confirm factory specifications to ensure that the fiber optic cable was not damaged during shipment. The test results must match the results of the factory-attached tag on the reel, or the fiber shall not be used. Reel data sheet must be provided showing test results.
 3. End to end (bi-directional) test measurements shall be provided for singlemode and multimode fibers (2 wavelengths per test are required). Test results must be submitted for review as part of the installation inspection requirements. Test results shall be in paper form and electronic form, and must contain the names and signatures of the technicians performing the tests.
 4. Testing shall be performed on 100% of the fibers in the completed end-to-end system. ANSI/TIA/EIA-568-C-3, provides the technical

criteria and formula to be used in fiber optic testing. Note however, that all fiber must be tested, rated and guaranteed for performance. Additionally, all fiber optic cable links must pass all installation and performance tests both recommended and mandated by the cable manufacturer.

5. 100% of all pairs in backbone copper cables shall be tested for continuity and wire-map.

D. Format

1. Test Results must be submitted in 2 formats. First, must be original file(s) down loaded from tester. Second, the file must be cohesively placed in Excel format with the following fields: ER/TR RM # / RM # of drop / Port # / all relevant test information in as many fields as necessary and delivered in electronic format.
2. Care with reference to above format criteria, should be taken when recording the information in the tester, proper consistency with port identification is required.
3. As Built drawings must be submitted with .dgn or .dwg file extensions.

PART 2 - PRODUCTS

2.1 GENERAL

- A. Cables and Termination hardware shall be technically compliant with and installed in accordance with referenced TIA/EIA documents.
- B. Cables shall be Underwriters Laboratory (UL) listed, comply with Article 800 (Communications Circuits) of National Electrical Code and shall meet specifications of NEMA (low loss), UL 444, and ICEA (where applicable).

2.2 COPPER CABLE

- A. Backbone UTP Cable (Provide proper rated cable per installation type OSP, Riser or Plenum).
 1. Manufacturers:
 - a. Superior Essex (Preferred, or Equivalent)
- B. Cables and termination hardware shall be technically compliant with and installed in accordance with referenced TIA/EIA documents.
- C. Cables shall be Underwriters Laboratory (UL) listed, comply with Article 800 (Communications Circuits) of National Electrical Code and shall meet specifications of NEMA (low loss), UL 444, and ICEA (where applicable).

- D. Backbone Cable and Termination Components (Jack, Patch Panel) are specified to function as a System.
 - 1. Where required for warranty purposes, manufacturers of cabling and termination components used (if more than one) shall recognize each other in their Certification Programs.
- E. Cabling shall be packaged to minimize tangling and kinking of cable during installation.
 - 1. Category 3 Unshielded Twisted Pair (UTP)
 - 2. Color: Per Manufacturer
- F. Bundled 25 pairs shall be identified by banded color code in which conductor insulation is marked with dominant color and banded with contrasting color.
- G. Backbone Cable
 - 1. Shall be ETL verified to meet or exceed ANSI/TI EIA-568-B.2-1 Category 3 performance requirements.
 - 2. Shall be minimally tested to 100 MHz.
 - 3. Shall exhibit nominal Velocity of Propagation of 72%.
 - 4. Shall exhibit a maximum Time Delay Skew of 25nsec/100m.
 - 5. Shall exhibit an Input Impedance of 100ohm +/- 13% between 1-100MHz.
 - 6. Shall not incorporate an overall shield.

2.3 PROTECTOR PANELS

- A. Manufacturers:
 - 1. Leviton (Preferred, or Equivalent)

2.4 COPPER TERMINATION HARDWARE

- A. Multi-pair copper riser cable from protection block shall be terminated into patch panels in the rack.

2.5 FIBER OPTIC CABLE

- A. Manufacturers:
 - 1. Corning (Preferred, or Equivalent)
- B. Fiber optic cabling: (Provide proper rated cable per installation type OSP, Riser or Plenum).
 - 1. 12 Strand Single-mode
 - 2. 12 Strand 50um Multi-Mode Laser Optimized
 - 3. 6 Strand Single-mode
 - 4. 6 Strand 50um Multi-Mode Laser Optimized
- C. All fiber optic cable with loose tube construction installed underground shall be gel filled or be constructed of appropriate waterproofing compounds.

- D. Fiber optic cables shall always have minimum 20-foot service loop at the terminating ends and all approved splice points. Place service loops with large bend radii neatly bundled on walls or on the attached to the bottom side of ladder trays in 'figure-8' configuration.

2.6 FIBER OPTIC CONNECTORS

- A. Manufacturers:
 - 1. Corning (Preferred, or Equivalent)
- B. Connectors must adhere to the following requirements:
 - 1. LC-type.
 - 2. Accept fibers having clad diameter of 125 microns.
 - 3. Accept fibers having buffered diameter of 900 microns.
 - 4. Sustain minimum of 200 mating cycles.
- C. Connector ferrule shall be or ceramic or glass-in-ceramic
- D. Connectors shall meet the following performance criteria:
 - 1. Test Procedure Max. Attenuation Change
 - 2. Cable Retention (FOTP-6) ...0.2 dB
 - 3. Durability (FOTP-21) ... 0.2 dB
 - 4. Impact (FOTP-2) ...0.2 dB
 - 5. Thermal Shock (FOTP-3) ... 0.2 dB
 - 6. Humidity (FOTP-5) ...0.2 dB
- E. Optical fiber shall be fusion spliced with mated pig-tail
- F. Attenuation per mated connector pair shall not exceed 0.75dB
- G. Maximum Reflectance of patch-cords with the correct matching connectors shall be:
 - 1. Single-mode: -40 dB

2.7 COAXIAL CABLE

- A. Coaxial Cable shall be .500 Hard-Line. (Provide proper rated cable per installation type OSP, Riser or Plenum).
- B. Manufacturers:
 - 1. Commscope
 - 2. Belden
 - a. Cables shall be suitable for installation in environment defined and shall meet Plenum -CATVP rating as defined by NEC.
 - b. Coaxial cable shall be sweep tested 5 MHz to 2.25 GHz.
 - c. RG-6 Type (Quad-shield)
 - 1) Center Conductor: 18 AWG solid bare copper or copper-clad steel.
 - 2) Dielectric: Foam FEP or equivalent as required for cable

rating.

- 3) First shield: Aluminum-polypropylene-aluminum laminated tape with overlap bonded to dielectric.
- 4) Second shield: 34 AWG aluminum braid wire (60% coverage).
- 5) Third shield: Non-bonded aluminum foil shield.
- 6) Fourth shield: 34 AWG aluminum braid wire (40% coverage).
- 7) Jacket: Commflex(V), Foam FEP, or equivalent as required for cable rating.
- 8) Impedance: 75 ± 3 ohms
- 9) Velocity of Propagation: 84% nominal
- 10) Maximum Attenuation @ 68°F:
 - (a) 50 MHz: 1.48 dB/100 ft
 - (b) 700 MHz: 5.96 dB/100 ft
 - (c) 1 GHz: 7.45 dB/100 ft
 - (d) 2.2 GHz: 11.54 db/100 ft

PART 3 - EXECUTION

3.1 CABLE INSTALLATION

- A. Submit the cable pulling plan to the Owner prior to commencement of the operation.
- B. The route of multi-pair copper cable installation is as described herein or as shown on the Drawings.
- C. Ensure the cables are pulled into the ducts in a manner observing the bend radii and tension restrictions of the cable.
- E. Use appropriate shoes, guides, wheels and lubricants to prevent damage to the cable jacket and sheath during installation.
- F. All multipair copper cable pairs installed shall be tested to TIA/EIA 568A, Category 3 equivalent performance specifications. In addition, provide loop resistance measurements in ohms and dB loss at 1KHz, 8KHz, and 256KHz.
- K. The Owner is to be notified at least 24 hours prior to testing to allow observation at the Owner's discretion. If the Owner confirms his intention to observe, a reasonable starting time will be agreed upon. Should the Owner not be present at the scheduled commencement time, the Contractor may begin testing as scheduled.
- L. All test results are to be recorded and turned over to the Owner for checking.

3.2 CABLE AND TERMINATION PANEL LABELING

- A. Label the installed cables in accordance with Section 27 05 53

3.3 CABLE SUPPORT

- A. Provide cable supports and clamps to attach cables to backboards and walls.
 - 1. Attach horizontal and vertical backbone cables at 2 foot intervals using Owner approved supports.

3.4 AS BUILT DRAWINGS

- A. Provide three (3) copies of E and three (3) copies of C size prints along with CADD files in .dwg or .dgn formats showing floor plans with room numbers and actual backbone cabling and pathway locations and labeling. The deliverable is required within 5 business days of final cable testing.
 - 1. Red Line Drawings: Contract must kept one (1) E size set of floor plans on site during work hours with installation progress marked and backbone cable labels noted. Contractor may be asked to produce these drawings for examination during construction meetings or field inspections.

- - - E N D - - -

SECTION 27 15 00
COMMUNICATIONS HORIZONTAL CABLING

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section specifies the requirements for the Communications Horizontal Cabling System for the Expansion & Renovation of Building 108 for Mental Health in Houston, Texas.
- B. Section includes: twisted pair cable, connectors, faceplates and testing.
- C. All voice and data horizontal cables shall consist of plenum rated, Category 6, 4 pair UTP copper cable from the appropriate MTC or ITC to each Telecommunications Outlet location as indicated on the Telecommunications Drawings.
- D. Installation and termination of four (4) data Category 6 at each typical office location or as designated on the on the Telecommunications Drawings.
- E. Installation and termination of one (1) Category 6 cable at each Wireless Access Point Outlet as indicated on the Telecommunications Drawings.
- F. Installation and termination of coaxial cable CATV locations as indicated on the Telecommunications Drawings.
- G. All information outlets will be flush-type mounted plates into conduits and boxes.

1.2 RELATED DOCUMENTS

- A. Drawings and General Provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

PART 2 - PRODUCTS

2.1 GENERAL

- A. Cables and termination hardware shall be technically compliant with and installed in accordance with referenced TIA/EIA documents.
- B. Cables shall be Underwriters Laboratory (UL) listed, comply with Article 800 (Communications Circuits) of National Electrical Code and shall meet specifications of NEMA (low loss), UL 444, and ICEA (where applicable).
- C. The project shall be registered for a 25 year warranty and test data submitted for acceptance.

D. Horizontal Cable and Termination Components specified are to function as a System.

1. If different manufacturers of cabling and termination components are used, they shall recognize each other in their Certification Programs for warranty purposes with the termination component manufacturer providing the certification.

E. Horizontal Cable types include:

1. 4-pair Copper Unshielded Twisted Pair (UTP)
2. Quad Shielded RG-6 - 75 ohm coaxial cable (for CATV applications only)

2.02 4-PAIR UTP HORIZONTAL COPPER CABLE

A. Plenum-rated, Category 6 Unshielded Twisted Pair (UTP)

B. Color: Data-Blue

C. The 4 pair UTP cable shall be Underwriter Laboratories (UL) listed type CMP.

D. Manufacturers:

1. Superior Essex, (Preferred)
2. Or, Approved equivalent.

E. Note: The minimum acceptable electrical performance characteristics of the 4-pair horizontal UTP copper cable must meet the following requirements:

1. ETL verified to meet or exceed ANSI/TI EIA-568-B.2-1, Category 6 performance requirements.
2. Minimally tested to 250 MHz.
3. Exhibit nominal Velocity of Propagation of 72%.
4. Exhibit an Input Impedance of 100ohm +/- 13% between 1-100MHz.
5. Exhibit a maximum Time Delay Skew of 25nsec/100m.
6. Not incorporate an overall shield.

2.3 HORIZONTAL COAXIAL CABLE

A. Horizontal Coaxial Cable shall be RG-6 type, Quad-shield, plenum-rated.

B. Manufacturers:

1. Commscope, (Preferred)
2. Or, Approved equivalent.

C. Cables shall be suitable for installation in environment defined and shall meet Plenum -CATVP rating as defined by NEC.

D. Coaxial cable shall be sweep tested 5 MHz to 2.25 GHz.

E. RG-6 Type (Quad-shield)

1. Center Conductor: 18 AWG solid bare copper or copper-clad steel.

2. Dielectric: Foam FEP or equivalent as required for cable rating.
3. First shield: Aluminum-polypropylene-aluminum laminated tape with overlap bonded to dielectric.
4. Second shield: 34 AWG aluminum braid wire (60% coverage).
5. Third shield: Non-bonded aluminum foil shield.
6. Fourth shield: 34 AWG aluminum braid wire (40% coverage).
7. Jacket: Commflex(V), Foam FEP, or equivalent as required for cable rating.
8. Impedance: 75 ± 3 ohms
9. Velocity of Propagation: 84% nominal
10. Maximum Attenuation @ 68°F:
 - a. 50 MHz: 1.48 dB/100 ft
 - b. 700 MHz: 5.96 dB/100 ft
 - c. 1 GHz: 7.45 dB/100 ft
 - d. 2.2 GHz: 11.54 db/100 ft

2.4 TELECOMMUNICATIONS OUTLETS

- A. Manufacturers:
 1. Leviton, (Preferred)
 2. Or, Approved equivalent
- B. Faceplate housing shall be one piece, flush mount style that fits standard NEMA openings.
- C. Faceplates shall have two separate labeling areas.
- D. Label areas shall be covered with a clear plastic insert.
- E. Unused ports shall have blank inserts installed.

2.5 WALL-MOUNT FACEPLATES

- A. Stainless or plastic
- B. Including Label Field

2.6 WIRELESS ACCESS POINT FACEPLATES

- A. Surface mounted, plenum rated, biscuit block with plenum rated, modular jack or connector.
- B. Made of High Impact thermoplastic.

2.7 SURFACE RACEWAY FACEPLATE

- A. Surface raceway faceplates shall:
 1. Accept four (4) modular jacks or connectors.
 2. Snap into raceway opening and be retained by integral latching tabs.
 3. Match standard opening of raceway type(s) to be installed.
 4. Have an optional extender bracket available to increase mounting depth if needed.
- B. Made of High Impact thermoplastic.
- C. Incorporate recessed designation strips for identifying labels.

D. Surface raceway faceplate color shall match color of raceway.

2.8 MODULAR WALL AND FURNITURE FACEPLATE

A. Modular furniture faceplates shall:

1. Accept 4 modular jacks or connectors.
2. Snap into modular furniture opening and be retained by integral latching tabs.
3. Match standard opening of furniture type(s) to be installed.
4. Have an optional extender bracket available to increase mounting depth.

B. Be made of High Impact thermoplastic.

C. Incorporate recessed designation strips for identifying labels.

D. Modular furniture faceplate color shall match color of furniture panel.

E. Must be coordinated with Haworth Products.

2.9 FLOOR BOXES & POKE-THRU DEVICES

A. To be provided by Electrical Contractor

2.10 MODULAR CONNECTORS

A. Modular jacks shall be 8 pin-8conductor, non-keyed.

B. Insulation displacement type contact.

C. Voice and data jacks shall meet or exceed the performance requirements of TIA Category 6.

D. Jack color: White

2.11 COAXIAL CONNECTORS

A. Coaxial Connectors shall be threaded male F-type.

B. Male F-connectors shall be:

1. Matched to cable type(s) used.
2. Single piece connector.
3. Compression type required.

PART 3 - EXECUTION

3.1 GENERAL

A. Follow manufacturer's installation guidelines.

B. All data and voice cabling and terminations and termination hardware shall be TIA/EIA wiring configuration T568B.

C. The maximum horizontal Channel Link distance shall be 270 feet

D. Adhere to the manufacturer's guidelines on bend radii and maximum pulling tension during installation. Notice that the recommended minimum bend radius for a cable during installation is typically greater than the recommended bend radius after the cable is installed. This is to minimize tension and deformation as the cables pass around

corners during installation. The maximum pull-force guideline for 4-pair horizontal balanced twisted pair cables is 110 N (25 lbf).

- E. Provide a minimum of 3-foot service loop for every horizontal cable in ceiling above outlet. Locate service loop where horizontal cable run transitions to the last J-Hook support before the cable enters the fishable wall, conduit, surface raceway or box. In addition, place at least 12" of service loop in Information Outlet box.
- F. Provide a minimum of 6-foot service loop at telecommunications/data rooms or by routing the cables within the room by taking the longest available path through the perimeter cable tray.
- G. Limit the size of cable bundles along pathways and in communications equipment rooms to 24 cables.
- H. The horizontal distance is the cable length from the mechanical termination of the media at the horizontal cross-connect in the telecommunications room to the telecommunications outlet/connector in the work area. The maximum horizontal distance shall be 270 ft, independent of media type.
- I. The length of the cross-connect jumpers and patch cords in the cross-connect facilities, including horizontal cross-connects, jumpers, and patch cords that connect horizontal cabling with equipment or backbone cabling, shall not exceed 5 m (16 ft) in length. For each horizontal channel, the total length allowed for cords in the work area plus patch cords or jumpers plus equipment cables or cords in the telecommunications room shall not exceed 10 m (33 ft).
- J. Cable and components shall be visually inspected for proper installation. Cable stress, such as that caused by tension in suspended cable runs and tightly cinched bundles, shall be minimized. Plenum rated Velcro ties used to bundle cables shall be applied loosely to allow the Velcro tie to slide around the cable bundle. The vector ties shall not be cinched so tightly as to deform the cable sheath. Cable placement shall not deform the cable sheath. Tightly bundled cables are not acceptable.
- K. Minimum bend radius: The minimum bend radius for cable will vary depending on the condition of the cable during installation (tensile load) and after installation when the cable is at rest (no-load).
- L. The minimum bend radius, under no-load conditions, for 4-pair unshielded twisted-pair (UTP) cable shall be four times the cable diameter.

- M. Copper cable splicing or bridge tapping is unacceptable.
- N. Minimum power separation for UTP cabling systems:
 - 1. Motors or transformers: 4 feet
 - 2. Power cables and conduits: 1 foot parallel, 3 inches crossover
 - 3. Fluorescent lights: 5 inches
 - 4. Above ceiling tiles: 3 inches
 - 5. Access above cable tray: 12 inches
 - 6. Hot Flues, Steam pipes, Hot water pipes and other hot surfaces: at least 6"
- O. Cables shall be terminated with connecting hardware of the same category or higher. To maintain the cable geometry, remove the cable sheath only as much as necessary to terminate the cable pairs on the connecting hardware. The connecting hardware manufacturer's instructions for cable sheath strip-back shall be followed. When terminating Category 6 cables, the cable pair twists shall be maintained to within 13 mm (0.5 in) from the point of termination. For best performance when terminating cable on connecting hardware, the cable pair twists shall be maintained as close as possible to the point of termination.

3.2 SITE QUALITY CONTROL, TESTING AND INSPECTION

- A. Every cabling link in the installation shall be tested in accordance with the field test specifications defined in ANSI/TIA/EIA-568-B.2-1 "Transmission Performance Specifications for 4-pair Category 6 Cabling".
- B. The installed twisted-pair horizontal links shall be tested from the patch panel in the telecommunications room to the telecommunication wall outlet in the work area against the "Permanent Link" performance limits specification as defined in ANSI/TIA/EIA-568-B.2-1.
- C. Trained technicians who have successfully attended an appropriate training program and have obtained a certificate as proof thereof shall execute the tests. Appropriate training programs include but are not limited to installation certification programs provided by BICSI or the ACP (Association of Cabling Professionals).
- D. The test equipment shall comply with the accuracy requirements for level III field testers as defined in ANSI/TIA/EIA-568-B.2-1. The tester including the appropriate interface adapter must meet the specified accuracy requirements. The accuracy requirements for the

permanent link test configuration (baseline accuracy plus adapter contribution) are specified in Table B.2 of Annex B of ANSI/TIA/EIA-568-B.2-1. (Table B.3 in this document specifies the accuracy requirements for the Channel configuration.)

- E. The test plug shall fall within the values specified in E.3.2.2 Modular test plug NEXT loss requirements of ANSI/TIA/EIA-568-B.2-1.
- F. The tester shall be within the calibration period recommended by the vendor in order to achieve the vendor-specified measurement accuracy.
- G. The tester interface adapters must be of high quality and the cable shall not show any twisting or kinking resulting from coiling and storing of the tester interface adapters. In order to deliver optimum accuracy, preference is given to a permanent link interface adapter for the tester that can be calibrated to extend the reference plane of the Return Loss measurement to the permanent link interface. The Cable Contractor shall provide proof that the interface has been calibrated within the period recommended by the vendor. To ensure that normal handling on the job does not cause measurable Return Loss Change, the adapter cord cable shall not be of twisted-pair construction.
- H. One hundred percent of the installed cabling links must be tested and must pass the requirements of the standards in this section. Any failing link must be diagnosed and corrected. The corrective action shall be followed with a new test to prove that the corrected link meets the performance requirements. The final and passing result of the tests for all links shall be provided in the test results documentation in accordance with the Test Result Documentation as listed below.

3.3 SITE TESTING, INSPECTION AND ACCEPTANCE

- A. The Pass or Fail condition for the link-under-test is determined by the results of the required individual tests. Any Fail or Fail* result yields a Fail for the link-under-test. In order to achieve an overall Pass condition, the results for each individual test parameter must Pass or Pass*.
- B. A Pass or Fail result for each parameter is determined by comparing the measured values with the specified test limits for that parameter. The test result of a parameter shall be marked with an asterisk (*) when the result is closer to the test limit than the accuracy of the field tester. The field tester manufacturer must provide documentation as an aid to interpret results marked with asterisks.

- C. A representative of the design team shall be invited to witness field testing. The representative shall be notified of the start date of the testing phase five business days before testing commences.
- D. At the conclusion of field testing, at a time scheduled by the Owner's representative, the Owner's representative will select a random sample (up to 10%) of the installed links in each wiring closet. The Cable Contractor, under supervision of the Owner's representative, shall test these randomly selected links and the results are to be stored in accordance with the requirements in Test Result Documentation as listed below.
- E. The results obtained shall be compared to the data originally provided by the Cable Contractor. If any (one or more) of the sample test reports displays a fail or fail* result, the Cable Contractor shall resolve any conditions causing the failed test and under supervision of the Owner's representative shall repeat 100% of the testing and the cost shall be borne by the Cable Contractor.

3.4 PERFORMANCE TEST PARAMETERS

- A. The test parameters for Category 6 are defined in TIA Category 6 standard, which refers to the ANSI/TIA/EIA-568-B.2 standard. The test of each link shall contain all of the following parameters as detailed below. In order to pass the test all measurements (at each frequency in the range from 1 MHz through 100 MHz) must meet or exceed the limit value determined in the above-mentioned standard.
 - 1. Wire Map
 - a. Wire Map shall report Pass if the wiring of each wire-pair from end to end is determined to be correct. The Wire Map results shall include the continuity of the shield connection if present.
 - 2. Length
 - a. The field tester shall be capable of measuring length of all pairs of a basic link or channel based on the propagation delay measurement and the average value for NVP (1). The physical length of the link shall be calculated using the pair with the shortest electrical delay. This length figure shall be reported and shall be used for making the Pass/Fail decision. The Pass/Fail criteria are based on the maximum length allowed for the Permanent Link configuration (90 meters - 295 feet) plus 10% to allow for the variation and uncertainty of NVP.
 - 3. Insertion Loss (Attenuation)
 - a. Insertion Loss is a measure of signal loss in the permanent link or channel. The term "Attenuation" has been used to designate "Insertion Loss." Insertion Loss shall be tested from 1 MHz through 250 MHz in maximum step size of 1 MHz. It is preferred to measure insertion loss at the same frequency

intervals as NEXT Loss in order to provide a more accurate calculation of the Attenuation-to-Crosstalk ratio (ACR) parameter. Minimum test results documentation (summary results): Identify the worst wire pair (1 of 4 possible). The test results for the worst wire pair must show the highest attenuation value measured (worst case), the frequency at which this worst case value occurs, and the test limit value at this frequency.

4. NEXT Loss

- a. Pair-to-pair near-end crosstalk loss (abbreviated as NEXT Loss) shall be tested for each wire pair combination from each end of the link (a total of 12 pair combinations). This parameter is to be measured from 1 through 250 MHz. NEXT Loss measures the crosstalk disturbance on a wire pair at the end from which the disturbance signal is transmitted (near-end) on the disturbing pair. The maximum step size for NEXT Loss measurements shall not exceed the maximum step size defined in the standard as shown in Table 1, column 2. Minimum test results documentation (summary results): Identify the wire pair combination that exhibits the worst case NEXT margin (2) and the wire pair combination that exhibits the worst value of NEXT (worst case). NEXT is to be measured from each end of the link-under-test. These wire pair combinations must be identified for the tests performed from each end. Each reported case shall include the frequency at which it occurs as well as the test limit value at this frequency.

5. PSNEXT Loss

- a. Power Sum NEXT Loss shall be evaluated and reported for each wire pair from both ends of the link under-test (a total of eight results). PSNEXT Loss captures the combined near-end crosstalk effect (statistical) on a wire pair when all other pairs actively transmit signals. Like NEXT this test parameter must be evaluated from 1 through 250 MHz and the step size may not exceed the maximum step size defined in the standard as shown in Table 1, column 2.
- b. Minimum test results documentation (summary results): Identify the wire pair that exhibits the worst-case margin and the wire pair that exhibits the worst value for PSNEXT. These wire pairs must be identified for the tests performed from each end. Each reported case shall include the frequency at which it occurs as well as the test limit value at this frequency.

6. ELFEXT Loss, pair-to-pair

- a. Pair-to-pair FEXT Loss shall be measured for each wire-pair combination from both ends of the link under-test. FEXT Loss measures the crosstalk disturbance on a wire pair at the opposite end (far-end) from which the transmitter emits the disturbing signal on the disturbing pair. FEXT is measured to compute ELFEXT Loss that must be evaluated and reported in the test results. ELFEXT measures the relative strength of the far-end crosstalk disturbance relative to the attenuated signal that arrives at the end of the link. This test yields 24 wire pair combinations. ELFEXT is to be measured from 1 through 250 MHz and the maximum step size for FEXT Loss measurements shall not exceed the maximum step size defined in the standard as in Table 1, column 2.

- b. Minimum test results documentation (summary results): Identify the wire pair combination that exhibits the worst-case margin and the wire pair combination that exhibits the worst value for ELFEXT. These wire pairs must be identified for the tests performed from each end. Each reported case shall include the frequency at which it occurs as well as the test limit value at this frequency.

7. PSELFEXT Loss

- a. Power Sum ELFEXT is a calculated parameter that combines the effect of the FEXT disturbance from three wire pairs on the fourth one. This test yields eight wire-pair combinations. Each wire-pair is evaluated from 1 through 250 MHz in frequency increments that do not exceed the maximum step size defined in the standard as shown in Table 1, column 2. Minimum test results documentation (summary results): Identify the wire pair that exhibits the worst pair combinations must be identified for the tests performed from each end. Each reported case shall include the frequency at which it occurs as well as the test limit value at this frequency.

8. Return Loss

- a. Return Loss (RL) measures the total energy reflected on each wire pair. Return Loss is to be measured from both ends of the link-under-test for each wire pair. This parameter is also to be measured from 1 through 250 MHz in frequency increments that do not exceed the maximum step size defined in the standard as shown in Table 1, column 2.
- b. Minimum test results documentation (summary results): Identify the wire pair that exhibits the worst-case margin and the wire pair that exhibits the worst value for Return Loss. These wire pairs must be identified for the tests performed from each end. Each reported case shall include the frequency at which it occurs as well as the test limit value at this frequency.

9. ACR (Attenuation to crosstalk ratio)

- a. This parameter is not demanded by the standard but may be required in order to obtain the premise wiring manufacturer's warranty. ACR provides an indication of bandwidth for the two wire-pair network applications. ACR is a computed parameter that is analogous to ELFEXT and expresses the signal to noise ratio for a two wire-pair system. This calculation yields 12 combinations - six from each end of the link. Minimum test results documentation (summary results): Identify the wire pair combination that exhibits the worst-case margin and the wire pair combination that exhibits the worst value for ACR. These wire pair combinations must be identified for the tests performed from each end. Each reported case shall include the frequency at which it occurs as well as the test limit value at this frequency.

10. PSACR

- a. [This parameter is not required by the standard but may be required in order to obtain the premise wiring vendor's warranty]. The Power Sum version of ACR is based on PSNEXT and takes into account the combined NEXT disturbance of all adjacent wire pairs on each individual pair. This calculation yields eight combinations -one for each wire pair from both ends of the link. Minimum test results documentation (summary

results): Identify the wire pair that exhibits the worst-case margin and the wire pair that exhibits the worst value for PSACR. These wire pairs must be identified for the tests performed from each end. Each reported case shall include the frequency at which it occurs as well as the test limit value at this frequency.

11. Propagation Delay

- a. Propagation delay is the time required for the signal to travel from one of the link to the other. This measurement is to be performed for each of the four wire pairs. Minimum test results documentation (summary results): Identify the wire pair with the worst-case propagation delay. The report shall include the propagation delay value measured as well as the test limit value.

12. Delay Skew [as defined in TIA/EIA-568-B.1; Section 11.2.4.11]

- a. This parameter shows the difference in propagation delay between the four wire pairs. The pair with the shortest propagation delay is the reference pair with a delay skew value of zero. Minimum test results documentation (summary results): Identify the wire pair with the worst-case propagation delay (the longest propagation delay). The report shall include the delay skew value measured as well as the test limit value.

D. Test Result Documentation

1. The test results information for each link shall be recorded in the memory of the field tester upon completion of the test.
2. The test results records saved by the tester shall be transferred into a Windows™-based database utility that allows for the maintenance, inspection and archiving of these test records. A guarantee must be made that the measurement results are transferred to the PC unaltered, i.e., "as saved in the tester" at the end of each test and that these results cannot be modified at a later time. Superior protection in this regard is offered by testers that transfer the numeric measurement data from the tester to the PC in a non-printable format.
3. The database for the completed job shall be stored and delivered on CD-ROM including the software tools required to view, inspect, and print any selection of test reports.
4. The test results shall be provided on CD-ROM listing the links that have been tested with the following summary information:
 - a. The identification of the link in accordance with the naming convention defined in the overall system documentation.
 - b. The overall Pass/Fail evaluation of the link-under-test including the NEXT Headroom (overall worst case) number.
 - c. The date and time the test results were saved in the memory of the tester.
5. General Information to be provided in the electronic data base with the test results information for each link:
 - a. The identification of the customer site as specified by the end-user.
 - b. The identification of the link in accordance with the naming convention defined in the overall system documentation.
 - c. The overall Pass/Fail evaluation of the link-under-test.
 - d. The name of the standard selected to execute the stored test results.
 - e. The cable type and the value of NVP used for length calculations.

- f. The date and time the test results were saved in the memory of the tester.
 - g. The brand name, model and serial number of the tester.
 - h. The identification of the tester interface.
 - i. The revision of the tester software and the revision of the test standards database in the tester.
 - j. The test results information must contain information on each of the required test parameters.
 - k. The name of the person performing the test.
6. The detailed test results data to be provided in the electronic database for each tested link must contain the following information:
- a. For each of the frequency-dependent test parameters, the value measured at every frequency during the test is stored. In this case, the PC-resident database program must be able to process the stored results to display and print a color graph of the measured parameters. The PC-resident software must also provide a summary numeric format in which some critical information is provided numerically as defined by the summary results (minimum numeric test results documentation) as outlined above for each of the test parameters.
 - 1) Length: Identify the wire-pair with the shortest electrical length, the value of the length rounded to the nearest 0.1 m (1) and the test limit value.
 - 2) Propagation delay: Identify the pair with the shortest propagation delay, the value measured in nanoseconds (ns) and the test limit value.
 - 3) Delay Skew: Identify the pair with the largest value for delay skew, the value calculated in nanoseconds (ns) and the test limit value.
 - 4) Attenuation: Minimum test results for the worst pair.
 - 5) Return Loss: Minimum test results for the worst pair as measured from each end of the link.
 - 6) NEXT, ELFEXT, ACR: Minimum test results documentation for the worst pair combination as measured from each end of the link.
 - 7) PSNEXT, PSELFEXT, and PSACR: Minimum test results documentation for the worst pair as measured from each end of the link.

- - - E N D - - -

SECTION 27 16 00
COMMUNICATIONS PATCH CORDS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This Section specifies the requirements for the Communications Connecting Cords, Devices and Adapters for Expansion & Renovation of Building 108 for Mental Health in Houston, Texas.
- B. Section includes:
 - 1. 4-pair Modular Patch Cords
 - 2. Modular-to-110 Patch Cords
 - 3. Multimode Fiber Optic Patch Cords
 - 4. Single-mode Fiber Optic Patch Cords
 - 5. Coaxial Patch Cords

1.2 RELATED REQUIREMENTS

- A. Drawings and General Provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.
- B. Section 27-05-00 Basic Communications Requirements.
- C. Section 27-05-26 Grounding and Bonding for Communications Systems.
- D. Section 27-05-28 Pathways for Communications Systems.
- E. Section 27-05-53 Identification for Communications Systems.
- F. Section 27-11-00 Communications Equipment Room Fittings
- G. Section 27-13-00 Backbone Cabling Requirements
- H. Section 27 15 00 - Communications Horizontal Cabling

PART 2 - PRODUCTS

2.1 COPPER PATCH CORDS

- A. Approved Manufacturers:
 - 1. Leviton (Preferred)
 - 2. Or, Approved equivalent
- B. Patch cords shall meet or exceed performance requirements of TIA Category 6.
- C. Copper patch cables shall be of the same category and manufacturer as the cable listed in Section 27 15 00.
- D. Patch cords shall be plenum-rated with T568B pin out.
- E. Quantities and Colors: Data patch cables are blue in the following quantities:

1. Two (2) Category 6 copper patch cables shall be furnished and installed for each horizontal cable, one will be used for workstation cords and one will be used as horizontal cross-connect cords, installed as follows:
 - a. Horizontal cross connect cords distribution includes: 50%-5 feet; 50%-7 feet; blue in color.
 - b. Workstation cords distribution includes: 100%-10 feet blue in color.
- F. Field terminated patch cables are strictly prohibited.
- G. At minimum, every horizontal cabling permanent link in the installation shall meet or exceed performance characteristics of the field test specifications defined in ANSI/TIA/EIA-568-B.2-1 "Transmission Performance Specifications for 4-pair 100 Ohm Category 6 Cabling".

2.2 FIBER OPTIC PATCH CORDS - MULTIMODE

- A. Approved Manufacturers:
 1. Leviton or Superior Essex (preferred)
 2. Or, Approved equivalent
- B. Color: Cable jacket - AQUA; Connectors - BEIGE.
- C. Duplex LC-LC type fiber optic patch cable for fiber optic termination.
- D. Duplex patch cords shall be configured per TIA/EIA-568-B-1.
- E. Fiber optic patch cables types shall coincide with terminated fiber optic type.
- F. Field terminated patch cords are strictly prohibited.

2.3 FIBER OPTIC PATCH CORDS - SINGLEMODE

- A. Approved Manufacturers:
 1. Leviton or Superior Essex (preferred)
 2. Or, Approved equivalent
- B. Color: Cable jacket - YELLOW Connectors - BLUE.
- C. Duplex LC-LC type fiber optic patch cable for fiber optic termination.
- D. Duplex patch cords shall be configured per TIA/EIA-568-B-1.
- E. Fiber optic patch cables types shall coincide with terminated fiber optic type.
- F. Field terminated patch cords are strictly prohibited.

2.4 FIBER OPTIC PATCH CORD QUANTITIES

- A. Furnish LC-LC Duplex Multimode Fiber Optic Patch Cords in the same quantities as the number of multimode fibers terminated in each room and in the following lengths:
 1. 25% - 2 meter
 2. 25% - 3 meter

3. 50% - 5 meter

B. Furnish LC-LC Duplex Single-mode Fiber Optic Patch Cords in the same quantities as the number of single-mode fibers terminated in each room and in the following lengths

1. 25% - 2 meter

2. 25% - 3 meter

3. 50% - 5 meter

PART 3 - EXECUTION

3.1 PATCH CABLES

- A. Fully cooperate and coordinate with Owner's Voice and Data Communications Equipment providers as required to ensure proper integration and connectivity between systems.
- B. Care must be taken to protect the minimum bend radius of 4 times the cable diameter on all copper patch cables.
- C. Furnish labeled floor plan and Excel run sheet to Owner's Voice and Data Communications Equipment providers two weeks prior to occupancy.
- D. Furnish and install all patch cords in conjunction with Owner's Voice and Data Communications Equipment providers.
- E. Provide adequate technician support when Owner's Voice and Data Communications Equipment providers are planning and installing new voice and data equipment installation and connectivity.

- - - E N D - - -

SECTION 27 20 00
DATA COMMUNICATIONS EQUIPMENT

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and General Provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section specifies the requirements for the Data Communications Equipment for the Expansion & Renovation of Building 108 for Mental Health in Houston, Texas. Data Communications Equipment includes customer owned routers, servers, Ethernet switches, personal computers, printers, wireless access points, etc. required to connect the new building, the internet and the public switched telephone network (PSTN).
- B. Data Communications Equipment for the Expansion & Renovation of Building 108 for Mental Health in Houston, Texas is provided by Owner.
- C. Data Communications Equipment will be Owner Furnished Owner Installed (OFOI).

PART 2 - PRODUCTS (NOT APPLICABLE)

PART 3 - EXECUTION

3.1 COORDINATION

- A. Cable Contractor shall fully cooperate and coordinate with Owner as required to ensure proper integration and connectivity between systems.
- B. Cable Contractor shall furnish labeled floor plan and excel run sheet to Owner two weeks prior to occupancy.
- C. Cable Contractor shall furnish and install all patch cords in conjunction with Owner.
- D. Cable Contractor shall provide adequate technical support to Owner during planning, installation and connectivity of new voice and data equipment.
- E. Cable Contractor shall provide adequate technician support first business day after data equipment installation and connectivity.

- - - E N D - - -

SECTION 27 30 00
VOICE COMMUNICATIONS EQUIPMENT

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and General Provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section specifies the requirements for the Voice Communications Equipment for the Expansion & Renovation of Building 108 for Mental Health in Houston, Texas.
- B. Voice Communications Equipment
 - 1. Voice Communications Equipment includes customer owned phones, faxes, etc. required to connect the facility to the public switched telephone network (PSTN).
 - 2. Voice Communications Equipment for the Expansion & Renovation of Building for Mental Health and Phase II Parking Garage in Houston, Texas is provided by Owner.
 - 3. Voice Communications Equipment will be Owner Furnished Owner Installed (OFOI).

PART 2 - PRODUCTS (NOT APPLICABLE)

PART 3 - EXECUTION

3.1 COORDINATION

- A. Contractor shall fully coordinate with Owner's Voice Communications Equipment provider as required to ensure proper integration and connectivity between systems.
- B. Contractor shall furnish labeled floor plan and excel run sheet to Owner's Voice Communications Equipment provider two weeks prior to occupancy.
- C. Contractor shall furnish and install all patch cords in conjunction with Owner's Voice Communications Equipment provider.
- D. Contractor shall provide adequate technician support when Owner's Voice Communications Equipment provider are planning and installing new voice and data equipment installation and connectivity.
- E. Contractor shall provide adequate technician support first business day after Voice equipment installation and connectivity.

Expansion & Renovation of Building 108
For Mental Health

Issue for Construction
June 15, 2012

- - - E N D - - -

SECTION 27 40 00
AUDIO-VIDEO SYSTEMS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section includes: furnishing, installing, testing and documenting audio-visual systems for multi-use and conference rooms in Expansion & Renovation of Building for Mental Health in Houston, Texas.
- B. Audio-Visual Systems shall consist of multiple systems with various configurations per the design specifications and drawings.
- C. These systems include some or all of the following:
 - 1. Mounting of flat screen video displays and projectors.
 - 2. Audio input/output panels, microphones, wireless microphone systems, mixers, switchers, audio processors and amplifiers.
 - 3. Video input/output panels, DVD players, switchers and scalers.
 - 4. Programmable audio-visual remote and automated control system and associated support devices for controlling: audio and videos systems, etc.
 - 5. Floor, wall and desktop connection hubs for audio, video, broadband, LAN, remote control signaling, computer and power connections.
 - 6. Termination, connector and pull junction boxes.
 - 7. Flat screen video display mounting systems.
 - 8. Projector mounting
 - 9. Wiring and connectors.

1.3 OVERVIEW

- A. The work detailed by these specifications and drawings has been specified to meet certain requirements for performance. Some information, such as exact equipment models, layout, wire routing, additional conduit and power requirements, etc. has been omitted. It shall be the responsibility of the Contractor to translate these specifications and drawings into a complete design package containing

all necessary elements for a complete turnkey installation including all material, labor, warranties, shipping and permits.

B. General elements of the work shall consists of but not limited to:

1. Procure all permits and license required to complete this installation.
2. Submission of Part 3.14 Pricing Forms for all equipment, materials and labor.
3. Attend pre-construction/pre-submittal meeting with Owner and Consultant to review design package for the Audio-Video Systems.
4. Prepare schedule of work.
5. Submittal preparation and processing prior to ordering equipment.
6. Attend submittal review meeting.
7. Provide materials necessary to complete the Audio-Video Systems.
8. Provide all required software and licenses to the Owner.
9. Contractor shall provide continuous on-site supervision of the installation technicians. On-site supervision shall include: daily supervision of the work, updating work site progress drawings to reflect changes and installations details, preparing weekly progress reports and attendance at site coordination meetings as directed by the Owner and Consultant.
10. The Contractor shall provide all miscellaneous hardware including cable management devices, termination cabinets, wire and cable labeling materials, fasteners, hangers and brackets as required.
11. Coordinate receipt of Owner furnished equipment.
12. Perform installation according to contract documents and manufacturers recommendations.
13. Protect new facilities finishes and equipment.
14. Maintain construction materials and refuse within the area of work.
15. Clean the work area at the end of each day.
16. Provide system software and programming and other materials necessary for the Audio-Video Systems to function by standard industry practices.
17. Program Audio-Video Systems and load with user define text and specified operations per design specifications and drawings.
18. Perform initial testing, programming and adjustments with written reports.

19. Make final adjustments, calibrations and programming modifications as directed by the Owner and Consultant.
20. Demonstrate all systems for final acceptance.
21. Preparation of O&M manuals and as-built documents for Owner's use.
22. Providing training for Owner's staff, facility personnel and technical staff.
23. Providing warranty service for a period of one year from acceptance date.
24. Provide extended system support.

1.4 DEFINITIONS

- A. AVS: Audio-Visual System.
- B. OWNER: Department of Veteran Affairs as described herein and supplementary drawings.
- C. OFOI: Owner Furnished Owner Installed.
- D. CONTRACTOR: Contractor or subcontractor providing and installing the Audio-Visual System.
- E. PROJECT: Expansion & Renovation of Building 108 for Mental Health.
- F. PROVIDE: Furnish, install, commission, test and warrant.
- G. WORK: Action required furnishing, installing, commissioning, testing and warranting the Audio-Visual Systems.
- H. COMPONENT: Any individual item of equipment or material which is an element of the Audio-Visual Infrastructure System.
- I. ZONE - Separate parallel signal path with independent processing and alternate program capabilities.
- J. AGC: Automatic gain control.
- K. CCD: Charge-coupled device.
- L. CTS: Certified Technology Specialist.
- M. MPEG: Moving picture experts group.
- N. NTSC: National Television System Committee.
- O. UPS: Uninterruptible power supply.
- P. PoE: Power over Ethernet

1.5 PERFORMANCE REQUIREMENTS

- A. These specialized AVS systems are designed to efficiently support the Owner's various facilities and activity areas in a manner, which can be proficiently managed by the staff. Work shall include the complete

turnkey installation and commissioning of these systems per the following specifications and drawings.

1.6 SUBMITTALS

A. Product Data:

1. List all system components including manufacturer and model number.
2. Manufacturer's literature sheets for all materials and equipment, including warranty information, recommended preventative maintenance and spare part inventory recommendations. Literature containing more than one device shall be clearly marked to delineate item(s) included in the Work.
3. Clearly indicate color or special finishes.
4. Correlate products with 274000 Specification and use in Project.
5. Contractor's on-site CTS supervisor shall review, approve and sign off all submittal documents.

B. Pricing Forms: Contractor shall submit completed pricing form that includes an itemized listing of all equipment, materials and labor required for the installation of the system as specified herein for Change Order pricing. The listing shall contain: item description, item model number, quantity, unit cost and extended labor, material and installation cost required to provide a complete and functional system.

C. Programming:

1. Provide and coordinate with the Owner all possible control functionalities based on project drawing and specifications.

D. Shop Drawings:

1. Contractor's on-site CTS supervisor shall review, approve and sign off all shop drawings, coordination drawings As Built Drawings documents.
2. Reproducing Contract Documents for shop drawing is not acceptable.
3. Shop drawings to include the following:
 - a. Drawing legend sheet describing all symbols used on the drawings.
 - b. Floor plans with all devices and wiring raceway depicted.
 - c. Wire runs with tags for type, gauge, quantities and cable identifiers.
 - d. System riser diagram indicating all field devices, riser paths and room designations.
 - e. Block diagram for each system showing all equipment and signal pathways.
 - f. Point schedules defining interconnection of all inputs and

- outputs for all equipment including data connections and other systems with cable identifiers.
 - g. Elevations of equipment racks and teaching consoles.
 - h. Fabrication shop drawings for all custom components.
 - i. Diagrams for power, signal, control wiring and grounding.
 - j. Include plans, elevations, sections, details, and attachments to other work.
- E. Coordination Drawings: Reflected ceiling plans, drawn to scale, with ceiling-mounted items including lighting fixtures, diffusers, grilles, speakers, sprinklers, access panels, and special moldings are shown and coordinated, using input from installers of the items involved.
- Provide similar elevation drawings for wall-mounted items.
- F. Samples: Provide as requested for colors and texture coordination.
- G. Partial submittals shall not be acceptable without prior approval by Owner.
- H. No portion of the work shall commence or equipment ordered until the Owner has approved the submittals.
- I. The Contractor shall not be relieved from any contract-required responsibility by the Owner's approval of submittals.
- 1. Nothing in the specification shall relieve Contractor of system package design responsibility, including, but not limited to, all equipment furnished under this Contract. The Contractor is, in all cases, solely responsible for the performance of the delivered AVS, and for furnishing complete system documentation for each and every part of the system.
- J. Extended AVS Support.
- 1. Provide pricing for AVS hardware and software support including necessary reconfiguration and data base changes for years 2 through 5.
- K. Resubmitting.
- 1. Make corrections or changes in Submittals as required by the Consultant's stamped instructions and attached comments and resubmit.
 - 2. Identify changes on resubmittals by clouding. Only indicated changes will be reviewed when resubmitted.
 - 3. Added drawings shall be clearly identified.
 - 4. Contractor shall be responsible for project delays caused by rejected submittals.

5. Consultant shall be compensated for additional services for submittals rejected more than twice. The amount of such compensation shall be incorporated by change order and withheld from the Contractor's Application for Payment.

1.7 QUALITY ASSURANCE

A. Installer Qualifications:

1. The Contractor performing the installation shall have a minimum of 3 years experience in the installation of AVS systems of similar size and scope.
2. An Infocomm CTS shall supervise and approve all on-site work as a recognized member of the Contractor's installation team. All installation team members must demonstrate knowledge and compliance with all Infocomm, TIA, UL, and NEC methods, standards and codes. Submit resumes of the entire team and completed training courses and certifications.
3. All members of the installation team must be certified by the Manufacturer as having completed the necessary training to complete their part of the installation.
4. Owner's representative may make such investigations as deemed necessary to determine that the Contractor is responsive, responsible and qualified in the area of work contemplated by the Contract. In this regard, the Contractor shall furnish to the Owner such information as requested for this purpose. Information and data may include (but not necessarily be limited to): Date of organization and/or incorporation and number of years engaged in this business under present firm's names; list of major equipment owned by the company; list of principal personnel who will be involved in the execution of this contract with the experience and qualifications of each person.
5. Contractor shall have local in-house engineering and project management capability consistent with the requirements of this project. The Contractor shall provide a project manager that shall be the same individual throughout the project and shall be the person responsible for system programming, preparation of Operation and Maintenance Manuals, Training, Programs, Schedules and Test

Protocols, documentation of system testing, maintenance of record drawings and coordination and scheduling of all labor.

6. Contractor shall be or have direct relations through their subcontractors, an authorized manufacturer's representative for all products they furnish or install.
7. Contractor shall have a local organization capable of providing maintenance and service for the specified system. Facility shall be no more than 100 miles from Owner's site.
8. Contractor shall be capable of providing emergency service on a 24-hour, 7 days a week basis.

B. Conflicts:

1. In the event of any conflicts between documents referenced herein and the contents of this specification, the Contractor shall notify in writing to Consultant of any such occurrences before the purchasing of any equipment, materials and/or installation. The Consultant will notify the Contractor of any actions required to resolve these conflicts. Such actions may include but are not limited to: design changes, equipment, materials and/or installation changes. In any event, Contractor shall not supersede specifications and standards from the latest NFPA and NEC publications.

C. The Contractor shall provide all materials, equipment and installation in compliance with the latest applicable standards from ANSI, ASTM, FCC, IEEE, NCTA, NEC, NEMA, NFPA, REA, TIA/EIA, and UL including but not limited to:

1. American National Standards Institute (ANSI).
2. ANSI T1.404 (DS3) and CATV Applications.
3. American Society for Testing And Materials (ASTM).
4. American with Disabilities Act (ADA).
5. EIA/TIA-569 Standard, Commercial Building Standard for Telecommunications Pathways and Spaces.
6. EIA/TIA-607 Commercial Building Grounding and Bonding Requirements for Telecommunications.
7. National Cable Television Association (NCTA).
8. NCTA-02 NCTA Recommended Practices for Measurements on Cable Television Systems.

9. National Electrical Code (NEC) (Latest revision and pertinent addendums).
 - a. Article 250, Grounding.
 - b. Article 300, Part A. Wiring Method.
 - c. Article 310, Conductors for General Wiring.
 - d. Article 800, Communication Systems.
10. National Fire Protection Association (NFPA) Publications (Latest revisions and pertinent addendums).
11. Underwriters Laboratories (UL).
- D. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- E. NECA 1 Good Workmanship in Electrical Contracting.

1.8 PROJECT CONDITIONS

- A. Environmental Limitations: System components shall be equipped and rated for the environments where installed.
- B. Environmental Conditions.
 1. Capable of withstanding the following environmental conditions without mechanical or electrical damage or degradation of operating capability:
 - a. Interior, Controlled Environment: System components installed in conditioned interior environments shall be rated for continuous operation in ambient conditions of 36 to 122 deg F (2 to 50 deg C) dry bulb and 20 to 90 percent relative humidity, non-condensing.
 - b. Interior, Uncontrolled Environment: System components installed in non-conditioned interior environments shall be rated for continuous operation in ambient conditions of 0 to 122 deg F (minus 18 to plus 50 deg C) dry bulb and 20 to 90 percent relative humidity, non-condensing.
 - c. Exterior Environment: System components installed in locations exposed to weather shall be rated for continuous operation in ambient conditions of minus 30 to plus 122 deg F (minus 34 to plus 50 deg C) dry bulb and 20 to 90 percent relative humidity, condensing. Rate for continuous operation when exposed to rain as specified in NEMA 250, winds up to 85 mph (137 km/h) and snow cover up to 24 inches (610 mm) thick.

1.9 PROJECT COORDINATION AND PLAN

- A. Contractor shall submit a project plan detailing the steps and associated timeframe to meet the General Contractor's schedule requirements. Project plan should include benchmarks for items such as regular project meetings, equipment order and delivery, installations,

configuration and calibrations, testing and burn-in, training, substantial completion notification, testing and final acceptance.

- B. Contractor assumes total responsibility for coordinating with building trades or other parties as may be identified by the General Contractor.
- C. Coordinate size and location of conduit systems, back boxes, and provisions for electrical power to equipment of this Section.
- D. The Contractor must obtain written permission from the General Contractor prior to routing and/or installing cable, equipment or service through the facility.
- E. Contractor shall prepare the installation schedule to coordinate sequencing, dependencies and priorities of the system installation including work by other trades.

1.10 COMMISSIONING

- A. Commissioning of systems specified in this section is part of the construction process. Documentation and testing of these systems, as well as training of the Owner's operation and maintenance personnel, is required in cooperation with the Owner's Representative and the Commissioning Agent. Project Closeout is dependent on successful completion of all commissioning procedures, documentation, and issue closure.
- B. Training of the Owner's operation and maintenance personnel is required in cooperation with the Owner's Representative. Provide competent, factory authorized personnel to provide instruction to operation and maintenance personnel concerning the location, operation, and troubleshooting of the installed systems. The instruction shall be scheduled in coordination with the Owner's Representative after submission and approval of formal training plans.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the manufacturers specified.
- B. Approved manufacturers:
 - 1. Altinex
 - 2. Altronix
 - 3. American Power Conversion

4. Atlas Sound
5. Audio Technica
6. Avocent
7. Best Power
8. Best-Tronics Mfg.
9. Biamp
10. Cable Specialties Inc.
11. Cables to Go
12. CAD
13. Canon
14. Chief Manufacturing
15. CommScope Properties, LLC.
16. Covid
17. Crestron
18. Crown
19. Da-Lite
20. Denon
21. Draper
22. Electro-Voice
23. Elmo
24. Ergotron
25. Extron
26. FSR Inc.
27. Furman
28. Gepco
29. Hitachi
30. Hoffman
31. Hubbell
32. Innovative Inc.
33. JBL
34. JVC
35. Liberty Wire and Cable
36. Middle Atlantic Products
37. Nady
38. Neutrik
39. Panasonic

- 40. Peerless
- 41. Pelco
- 42. Pioneer
- 43. Premier
- 44. QSC
- 45. Rack Solutions
- 46. Radio Design Labs
- 47. Rane
- 48. Raxxess
- 49. Russound
- 50. Samsung
- 51. Sanyo
- 52. Sennheiser
- 53. Sharp
- 54. Shure
- 55. Sony
- 56. Spectrum Furniture
- 57. Stewart
- 58. Tannoy
- 59. Tascam
- 60. Toshiba
- 61. Tripp Lite
- 62. West Penn Wire/CDT; a division of Cable Design Technologies, Inc.
- 63. Wiremold

2.2 AUDIO VISUAL TYPES

- A. Provide all necessary elements for a complete turnkey installation including all material, labor, programming, warranties, shipping and permits.
- B. Final programming A/V source code to remain property of Owner. Provided copies of all A/V room types compiled and uncompiled source code, to Owner for backup and future reference as part of the Final Acceptance.
- C. Coordinate and verify all AV programming with Owner prior to installation.

2.3 PROJECTION SCREENS

- A. Approved manufacturers:

1. Electronic powered projection screen
 - a. Provide unistrut and althread for proper mounting installation. All mounting must support a minimum of 5 time total weight mounting.
 - b. Provide quantities per drawings and schedules with the following minimum features:
 - 1) Verify projector / format for screen size and aspect ratio.
 - 2) Provide proper black drop per ceiling heights and bottom of image at 48 AFF.
 - 3) Seamless high contrast matt white screen surface.
 - 4) Includes suspended ceiling trim valance.

2.4 CEILING MOUNT FOR PROJECTOR

A. Approved products:

1. Ceiling Box with projector pole mounts.

2.5 FLOOR BOXES

A. Approved manufacturers:

1. Provide AV Floor Box to support all AV connectivity and cabling.

2.6 A/V CONNECTION PLATES

- A. Provide types, sizes and configuration per drawings and schedules with the following minimum features:
1. Stainless steel or silver anodized aluminum.
 2. Engraved legends.
 3. Solder, pass thru and pig tail style connection and connectors as required

2.7 CABLES

- A. All AV is to be provided by AV Contractor.
- B. Provide yellow cable for all AV horizontal cabling.
- C. Provide types and quantities per drawings and schedules.
- D. Conductor Sizing:
1. Insulation shall be rated for a minimum of 300 volts.
 2. Wire types and minimum sizes:
 - a. 70 Volt Speaker Cable - 16 AWG, twisted, stranded CL2/CL2P.
 - b. Low Impedance Speaker Cable - minimum 12 AWG, twisted, stranded CL2/CL2P.
 - c. Microphone Level Cable - 22 AWG, with 22 AWG drain wire, shielded, twisted, stranded CL2/CL2P.
 - d. Line Level Cable - 22 AWG, with 22 AWG drain wire, shielded, twisted, stranded CL2/CL2P.
 - e. Low Voltage Control Cable - 18 AWG twisted, stranded CL2/CL2P.
 - f. CAT-5/6 - low skew type.
 - g. Digital Media - Per manufacturer (Crestron)

E. Minimum acceptable AVS systems wiring performance standards shall be as follows:

1. Speaker cable - Per ANSI WC57 standard test.
2. CAT-5/6 - Per ANSI/TIA/EIA-568-8.1 standard test.
3. Fiber optic cable - Per ANSI/TIA/EIA-568-B standard test.
4. RS 232 - Per ANSI/ WC66 standard test.
5. Line level shielded audio cable - Per ANSI WC66 standard test.
6. Microphone level shielded audio cable - Per ANSI WC66 standard test.
7. Video coax cable - Per ANSI/TIA/EIA-TSB-67 standard test.
8. Multi-conductor control cable - Per ANSI WC57 standard test.

2.8 AV PATCH CABLE

- A. Provide AV patch cables for all AV interconnection plates

PART 3 - EXECUTION

3.1 CONSTRUCTION MEETINGS

- B. The Consultant and/or Owner will hold regular construction meetings to review the installation schedule. It is mandatory that the Contractor's project manager attend each meeting.

3.2 SITE INSPECTION

- A. Continuously verify that the site conditions are in agreement with the Contract Documents and the AVS design. Notify Owner's representative immediately of conditions that affect the performance of the installed system.
- B. Coordinate any required work that is not specified in the Contract Documents.

3.3 COORDINATION

- A. Adequate conduit and back boxes are provided for the specified system installation.
- B. Adequate power has been provided for the specified system installation.
- C. Verify mounting location of all devices with Owner prior to installation.

3.4 GENERAL

- A. The Contractor shall be responsible for providing all wire and cable as required for complete and operational system.
- B. All cables must be continuous runs from device location to the final point of termination. No mid run cable splices will be allowed.

- C. Make connections and splices with solderless devices that are mechanically and electrically secure in accordance with manufacturer's recommendations.
- D. The cable installation techniques shall be such that the mechanical and communications characteristics of the cables are not degraded at the time of installation. Any special environmental requirements for equipment shall be specified.
- E. Wiring Method: Install cables in raceways except in accessible indoor ceiling spaces, in hollow gypsum-board partitions, and as otherwise indicated. Conceal raceways and wiring except in unfinished spaces.
- F. Distribution of the cabling will be accomplished through cable trays, J-hooks, cable runways, conduit raceways, ducts, core holes, extended columns, false half columns and plenums. Horizontal cable segments will be placed in cable trays and when they leave cable trays will be supported by distribution rings. Where cables converge at equipment room locations, they will be supported by cable runways and distribution rings. All cable placements shall be based on the enclosed drawings.
- G. The Contractor shall not place wiring in the same conduit or raceway with wire for electrical power distribution.
- H. Connectors to all devices in system shall be protected against moisture. Approval of the method shall not relieve the Contractor of full responsibility for proper application and workmanship of the materials in the manner specifically approved. All connector threads shall be treated with an approved silicone lubricant.
- I. The Contractor shall be responsible for providing approved grounds for all AVS system equipment per the manufactures recommendations. The Contractor shall also be responsible for ensuring ground continuity by properly bonding all appropriate cabling, closures, cabinets, service boxes, and framework. All ground connections shall consist of minimum 12 AWG copper wires and shall be supplied from an approved building ground and bonded to the main electrical ground. Contractor must notify the Owner prior to making any changes in submitted system design and/or installation.
- J. Wiring within Enclosures: Bundle, lace, and train conductors to terminal points with no excess and without exceeding manufacturer's

limitations on bending radii. Provide and use lacing bars and distribution spools.

- K. Splices, Taps, and Terminations: For power and control wiring, use numbered terminal strips in junction, pull, and outlet boxes; terminal cabinets; and equipment enclosures. Tighten electrical connectors and terminals according to manufacturer's published torque-tightening values. If manufacturer's torque values are not indicated, use those specified in UL 486A and UL 486B.
- L. Grounding: Provide independent-signal circuit grounding per practices published by the manufacturer.

3.5 IDENTIFICATION, LABELING AND DOCUMENTATION

- A. The Contractor shall label all termination devices, panels, enclosures and equipment rooms. The Contractor will mark each unit with permanently attached markings that will not impair the equipment or present a hazard to maintenance personnel.
- B. Place wire identification numbers ¼" on each end of all conductors and or connectors by using sleeve type heat shrinkable markers. Install markers to be readable from left to right or top to bottom. Wire numbers shall be computer printed (Brady TLS2200 with Permasleeve cable marking labels or equivalent). Hand written labels are not acceptable.
- C. Mark all spare conductors.
- D. Contractor to maintain a progress set of design documents on the Project site. These documents shall be updated daily to reflect the current condition of the work and available for review by the Consultant and Owner when requested.
- E. If changes occur prior to acceptance testing altering the documentation previously furnished. The Contractor shall formally update and reissue the relevant documentation to the Consultant and Owner.
- F. Consultant and Owner will review all documentation for accuracy and completeness and may reject substandard submittals.
- G. The Contractor shall establish and maintain complete system documentation, including documentation procedures, operational information, configuration information and drawings. Documentation shall include the following:

1. Floor plan drawings indicating device locations, unique system point numbers with device legends indicating manufacturers and model numbers for each device.
2. The unique system point number of a device shall identify either through the software or hardwire connection, the specific device or group of devices associated with the unique point number in the system.
3. Floor plan drawings indicating conduit and wire routing and junction box locations.
4. Wire routing shall include cable identification and terminal strip numbers.
5. Mounting details for all equipment and hardware.
6. Functional block diagrams for each system.
7. Wiring details showing rack elevations, equipment wiring and terminations and inter-rack wiring.

3.6 FIELD QUALITY CONTROL

- A. Inspection: Verify that units and controls are properly installed, connected, and labeled, and that interconnecting wires and terminals are identified.
- B. Pre-testing: Align and adjust system and pretest components, wiring, and functions to verify that they comply with specified requirements.
- C. Test Schedule: Schedule tests after pre-testing has been successfully completed and system has been in normal functional operation for at least 14 days. Provide a minimum of 10 days' notice of test schedule.
- D. Operational Tests: Perform operational system tests to verify that system complies with Specifications. Include all modes of system operation. Test equipment for proper operation in all functional modes.
- E. Remove and replace malfunctioning items and retest as specified above.
- F. Record test results for each piece of equipment.
- G. Re-test: Correct deficiencies identified by tests and observations and **retest until specified requirements are met.**

3.7 TRAINING

- A. AVS training shall be provided for the operator/user and technical staff. Operator/user training shall minimally consist of 8 ea. 1-hour sessions. Technical operation and maintenance training session shall

minimally consist of 8 ea. 1-hour session. Training sessions to be coordinated with the Owner and scheduled throughout the 1-year warranty period.

- B. A complete operation and maintenance manuals and preliminary as-built drawings shall be delivered to the Owner one week prior to the training sessions.
- C. Operator/user training shall minimally consist of:
 - 1. Provide custom system specific printed reference material for each trainee that documents and explains in layman's terms:
 - a. System block diagram.
 - b. Normal day-to-day operation.
 - c. Operator selectable features.
 - d. Provide a hands-on training with Q & A session.
 - 2. Provide and review a custom, system specific, quick reference guide for the inexperienced operator.
- D. Technical Operations and Maintenance training shall consist of:
 - 1. The technical explanation shall be sufficiently thorough that: staff personnel shall be able to make any programming changes required, analyze malfunctions and make equipment substitutions or bypasses necessary to maintain system operation except for the malfunctioning equipment or circuits.
 - 2. Provide printed reference material for each trainee that documents and explains in technical terms:
 - a. System block diagram with technical features.
 - b. Technical operation, adjustments and programming.
 - c. System features and programming.
 - d. Review of as-built drawings.
 - e. Provide a hands-on training with Q & A session.

3.2 WARRANTY

- A. The Contractor shall warrant the system for parts and labor for one (1) year. Warranty commences at the time of substantial project completion and acceptance by Owner. Nothing shall be construed to limit this obligation to a shorter period.
- B. Warranty service shall be rendered on-site by request of Owner to repair or replace any defective materials, equipment and workmanship without cost to the Owner, unless the Owner has previously given the Contractor a written acceptance of such condition.
- C. The Owner shall give prompt notice of the defect(s) either verbally or in writing to Contractor.

- D. Perform preventative maintenance during the warranty period, which includes:
- E. Cleaning and inspection of all devices every 6 months.
- F. Clean and vacuum console and rack equipment every 6 months.
- G. Service technician performing service / warranty work shall check-in and out with Owner for each visit.
- H. Provide a written report to Owner documenting any work performed during the warranty period within 24 hours of such event. Report shall detail work performed, equipment repaired or replaced, etc.
- I. Provide loner equipment that is equivalent to the malfunction equipment for any equipment not field repairable.
- J. Repair or Replacement Service.
 - 1. Repair or replacement service during the warranty period shall be performed 7 days a week, 24 hours a day and with a 4 hour response time.
 - 2. Emergency repair or replacement service during the warranty period shall be performed 7 days a week, 24 hours a day and with a 1 hour response time.
 - 3. If the Contractor cannot restore system operation during the warranty period within 2 business days of the system failure, the Owner reserves the right to require the Contractor to provide on-site manufacturer's service technicians at no additional cost.
 - 4. The Owner reserves the right to expand or add to the system during the warranty period using firm(s) other than the Contractor for such expansion without affecting the Contractor's responsibilities, provided the expansion is performed by an authorized dealer for the affected equipment.

3.3 SUBSTANTIAL COMPLETION

- A. Work must meet the following requirements to qualify for the Owner's consideration of Substantial Completion:
 - 1. All AVS devices shall be fully installed, powered, online and fully operational.
 - 2. All sub-system interfaces must be complete and operational.
 - 3. All training complete.
 - 4. Owner may utilize the system for its designed intent.

- B. Contractor will provide a list of remaining work items and approximate completion date.
- C. Contractor will certify in writing that all remaining work is minor in nature and will be completed in less than 30 days.

3.4 TESTING REQUIREMENTS

- A. The Contractor shall perform sample tests in the presence of the Consultant and Owner. Performing the testing procedures specified herein assures that the communication cabling and system electronics meets the performance characteristics specified.
- B. All testing shall comply with EIA/TIA Standards and that of the equipment manufacturers. If testing indicates that the performance characteristics are not met, the test shall be failed test and any other test that may be affected by the modification and/or repair shall be rerun and verified.
- C. Test equipment will be provided by the Contractor to test and to certify the 100% operational condition of all materials and equipment.
- D. The Contractor shall prepare and submit all test procedures and data forms for the pre-installation, post installation and subsystem test to Owner. The test procedures shall have Owner approval before the tests.

3.5 SYSTEM CHECK OUT AND VERIFICATION

- A. Verify continuity of cabling between field devices and controllers.
- B. Commission all devices from field to front end.
- C. Contractor supplied "As Built" Drawings shall show conduit routing.
- D. Review all as-built documentation and Operation and Maintenance manuals with Owner. Revise and reissue as required.
- E. Provide as-built documentation in hard copy, PDF and AutoCAD formats.
- F. Demonstrate proper sequences of operation for all devices.

3.6 FINAL ACCEPTANCE OF SYSTEMS

- A. Each area of construction completed and submitted as complete shall meet the following criteria under testing:
 - 1. System must meet all specifications as described in these instructions.
 - 2. Operational prints, manuals, signal logs, an as built prints must be furnished.
 - 3. Visual testing and signal verification will be conducted at random locations to determine that equipment performs satisfactorily.

- B. Specifications set forth for construction of the system have been devised in order to insure system compatibility and performance. Compliance to these specifications will be determined during periodic observances of construction. Repeated failure to comply with the specification will be considered before the initial acceptance phase of the plant commences.
- C. Within ten days receipt of the final acceptance notice, the Owner's representatives shall schedule and perform the final inspection. When the work is found acceptable under the contract documents and the contract is fully performed, declare the project complete.

3.7 PRICING FORMS

- A. In addition to all other required bid forms, Contractor shall prepare and present to Owner and Owner's representative pricing based on the requirements of 27 40 00.
- B. Pricing shall include the list of equipment and labor in tabular form including; part number, item description, unit price, number of units, extended price and totals. The pricing shall breakdown the material and labor in the categories.
- C. Contractor shall provide Service Agreement pricing levels for terms of 1, 2 and 3 years. Breakout service pricing levels by response times of within 2 hours, 24 hours or more than 24 hours.

- - - E N D - - -

SECTION 27 51 17
PUBLIC ADDRESS SYSTEMS

PART 1 - GENERAL

1.1 SECTION INCLUDES

- A. Amplified speakers and power supplies.
- B. Sound system cables and hardware.

1.2 RELATED SECTIONS

- A. Section 26 05 26 - Grounding and Bonding for Electrical Systems.

1.3 REFERENCES

- A. NFPA 70 - National Electrical Code; National Fire Protection Association; 2008.

1.4 SYSTEM DESCRIPTION

- A. Public address system for voice and music.
- B. Input components but not limited to:
 - 1. Turntable.
 - 2. Compact disc player.
 - 3. AM/FM tuner.
 - 4. Microphone.
- C. Features:
 - 1. Interface to IP telephone system.
 - 2. One-way paging by zone and or all zones.
 - 3. Emergency paging override.

1.5 SUBMITTALS

- A. See Section 01 30 00 (01300) - Administrative Requirements, for submittal procedures.
- B. Shop Drawings: Indicate electrical characteristics and connection requirements. Indicate layout of equipment mounted in racks and cabinets, component interconnecting wiring, and wiring diagrams of field wiring to speakers and remote input devices.
- C. Product Data: Provide data showing electrical characteristics and connection requirements for each component.
- D. Test Reports: Indicate satisfactory completion of each test recommended by the manufacturer.
- E. Manufacturer's Installation Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation, installation, and starting of product.
- F. Manufacturer's Certificate: Certify that products meet or exceed specified requirements.

- G. Manufacturer's Field Reports: Indicate that installation is complete and system performs according to specified requirements.
- H. Project Record Documents: Record actual locations of speakers, control equipment, and outlets for input/output connectors, cables routing with labeling.
- I. Operation Data: Include instructions for adjusting, operating, and extending the system.
- J. Maintenance Data: Include repair procedures and spare parts documentation.

1.6 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70 and Federal Communications Commission.
- B. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience with service facilities within 100 miles of Project.
- C. Supplier Qualifications: Authorized distributor of specified manufacturer with minimum three years documented experience.
- D. Installer Qualifications: Authorized installer of specified manufacturer with service facilities within 100 miles of Project.
- E. Products: Furnish products listed and classified by Underwriters Laboratories Inc. as suitable for purpose specified and indicated.

1.7 MAINTENANCE SERVICE

- A. Furnish service and maintenance of public address and music system for one year from Date of Substantial Completion.

PART 2 - PRODUCTS

2.1 MANUFACTURERS:

- A. Valcom
- B. Bogen
- C. Approved Equal

2.2 AMPLIFICATION AND CONTROL EQUIPMENT:

- A. Valcom
- B. Bogen
- C. Approved Equal

2.3 WIRE AND CABLE

- A. Speaker Wire and Cable: Plenum-rated, Category 6 Unshielded Twisted Pair (UTP).

1. Substitutions and standards: See Section 271500 - Horizontal Cabling.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install in accordance with manufacturer's instructions.
- B. Splice cable only in accessible junction boxes or at terminal block units.
- C. Install input circuits in separate cables and raceways from output circuits.
- D. Leave 18 inches (300 mm) excess cable at each termination at speaker, and other system outlet.
- E. Leave 6 feet (2 M) excess cable at each termination at system cabinet
- F. Provide protection for exposed cables where subject to damage.
- G. Support cables above accessible ceilings to keep them from resting on ceiling tiles. Use spring metal clips or plastic cable ties to support cables from structure for ceiling suspension system. Include J-hooks or saddles.
- H. Use suitable cable fittings and 3m Scotch locks for cable connection to speakers.

3.2 FIELD QUALITY CONTROL

- A. Perform field inspection and testing and document results.
- B. Measure and record sound power levels at designated locations.

3.3 MANUFACTURER'S FIELD SERVICES

- A. Provide the services of manufacturer's technical representative to prepare and start system.
- B. Include making final wiring connections, inspection and adjusting of completed installation, and systems demonstration.
- C. Certify that installation is complete and performs according to specified requirements.

3.4 ADJUSTING

- A. Adjust appropriate sound level.
- B. Adjust devices and wall plates to be flush and level.

3.5 DEMONSTRATION

- A. Demonstrate operation of systems.
- B. Conduct walking tour of Project. Briefly describe function, operation, and maintenance of each component.

- C. Use submitted operation and maintenance manual as reference during demonstration.

3.6 OWNER PERSONNEL TRAINING

- A. Provide detailed operation and maintenance instruction and training.
- B. Provide local classroom facilities.
- C. Use submitted operation and maintenance manual as reference during training. Supplement with training materials as required.

3.7 WARRANTY

- A. Provide a minimum of 1 year warranty for PA contractor supplied parts.
- B. Provide a minimum of 1 year warranty for labor on all PA equipment.

- - - E N D - - -

27 52 23 - NURSE/PATIENT COMMUNICATIONS NETWORKS

1 PART 1 GENERAL

1.01 GENERAL REQUIREMENTS

- A. Provide a complete working Nurse/Patient Communications Network based upon the specification outlined here to include all necessary devices that provide the functions listed in this specification for the Expansion & Renovation of Building for Mental Health. This facility will be referenced as the OWNER in this specification.
- B. The material and equipment specifications herein are intended to match existing conditions at the Michael E. DeBakey Veterans Affairs Medical Center and deviation from these general specifications must be approved by the VA. Items submitted that are not as listed or specified must be accompanied by documentation or literature clearly stating the suitability for the purpose intended in this document.
- C. The buildings are intended to be secure areas. Locks must be re-closed as soon as possible. Padlocks for open accesses shall not be left lying loose, but locked to the gate or other solid object. All entrances shall be secured and all lights turned off at the end of each workday.
- D. All damage shall be repaired at once to the satisfaction of VA.

1.02 QUALIFIED CONTRACTORS

- A. The work of this Section is to be performed only by companies able to demonstrate their qualifications to install communications wiring as specified. Please refer to the list of those contractors having met the requirements for demonstrating these skills at the end of this document. Contractors listed must provide proof of current certification and meet the specific requirements stated below in section 1.3 item B.
- B. In order for contractors to be considered, they must meet the following requirements:
 - 1. Contractors must provide a list of 3 references for completed cabling jobs performed by this company (not subcontracted). References should include the following:
 - a. Name and address of company work performed for
 - b. Contact person name and position
 - c. Brief description of the work performed (including the number of outlets), type of cable system and testing
 - d. Date work completed
 - 2. Along with meeting these requirements, contractors will be determined to be qualified based on site visits displaying the quality and correctness of prior installations.
 - 3. In some cases sub-contractors may be used with prior approval from VA. Bidders must provide the name of the contractor that will actually perform the communications wiring. Subcontractors are subject to the same certification requirements as stated above.

1.03 APPROVED PRODUCT AND REQUIRED PERFORMANCE SPECIFICATIONS

- A. All Nurse Communications Network devices shall be UL-1069 listed. This includes routers, hubs, switches, and room control devices. The nurse call network shall be an FDA Registered Class II (or higher) medical device and the system's manufacturer shall be an FDA Registered Operator. Field wiring shall be CAT 6 cable, control wiring for power distributions and very long runs, and utilize an optional fiber backbone (when distances exceed normal Ethernet limitations). All station equipment shall use plug on connectors and all switches, routers and controllers shall utilize standard RJ-45 modular connections. All remote devices utilizing standard structured cabling shall be capable of PoE (Power over Ethernet) or power supplied within the CAT 5E or CAT 6 cable jacket. Systems which require separate DC power to devices, remote power supplies, or heavy DC wiring to each individual room shall not be accepted. Wiring shall be capable of either being installed in conduit or cable trays, where shown on the plans. Nurse Communications cabling may be run along with other low voltage and data cables where permitted by code. Nurse Communications cabling to be separated out from any high voltage AC or DC wiring that exceeds 90 volts, or which violates any national or local electrical code.
- B. All Nurse call network cable shall be the color "White"
- C. The system must be UL 1069 listed as a Nurse Communications Network. Systems listed by other nationally recognized testing laboratory may not be accepted. The system shall be capable of interconnecting with the hospital's LAN (Local Area Network). This connection shall be minimal and utilize only one Ethernet 100 Mbps (or optionally 1 Gb) connection to accomplish all ADT, hospital information, reporting software and information exchange. The HL-7 standard shall be utilized for receipt of patient information from the ADT system.
- D. The capability to assign patients to staff shall be via a networked software infrastructure on existing OWNER workstations.
- E. The Network shall be expandable to any combination of over 15,000 bed, duty, or staff stations and 120,000 sub-stations connected as a contiguous interconnected system. Multiple buildings and intra-building connections may be linked together utilizing a fiber connection. Audio communications between devices shall be digital and virtually non-blocking, so as to provide fast, instantaneous communications without queuing or delay.

1.03 SUBMITTALS

- A. Refer to Division 01. Contractors must submit a complete listing of all proposed manufacturers, products, model numbers, and designs proposed for work to be completed on this contract.
- B. Maintain one copy of all shop drawings, product data, and samples, manufacturer's specifications, recommendations, installation instructions, and maintenance data at the project site. At project closeout, copies of all shop drawings shall be turned over to the architect who will then transmit to the owner.
- C. Submit only the items listed below to the architect for review in accordance with Conditions of the Contract and Division 1 sections
 - 1. Submit a drawing for the system configuration and design within two (2) weeks after contract award. The drawing shall show all device

locations, jack labels, and cable paths associated with each cable span.

2. Submit materials lists, manufacturer's literature, and other required information for VA approval no less than 20 days before such materials are required to be ordered for the installation work.
3. Submit samples of all cable and a list of all proposed components of the system to be installed for approval prior to beginning work.

1.05 PROJECT RECORD DOCUMENTS

A. Refer to Division 01. Maintain corrected as-built prints current with each completed project segment within (5) five days following completion.

B. After construction of the distribution system(s), but prior to system acceptance, the contractor must submit to VA detailed as-built documentation for the as-installed system for approval. Documentation format for all "as-builts" must be approved by VA prior to development. Scale drawings for as-built documentation must be produced for each separate media installed. "As-built" documentation must include, at a minimum, the following information:

1. Twisted Pair: Cable identification number, cable design makeup, cable lengths between termination points, and precise cable routing, indication of all support hardware, bonding and grounding locations, protected locations, all installed equipment and hardware locations, detail drawings as necessary, manufacturer and cable identification.
2. Technical Documentation: All technical documentation and equipment inventory lists relating to the operational and maintenance aspect of any and all of the system(s) installed under this contract.
3. Cable test results: Test documentation package for all copper and fiber cables installed. All test documentation must be printed hard copies bound in a loose leaf type binder as well as electronic floppy disk or CD.
4. System Test Results. Test documentation showing proper operation of each installed device.

1.06 STANDARDS FOR MATERIALS

A. All materials used on VA projects must meet all the quality and performance specifications of the manufacturer. All materials shall be the most current models or type offered by each manufacturer, shall conform to the current applicable industry standards. Workmanship and neat appearance shall be as important as the electrical and mechanical efficiency.

B. Unless more rigid specifications are established, all equipment and material shall comply with the latest applicable standards:

1. EIA/TIA
2. IEEE
3. BICSI
4. NEC
5. NEMA

6. ULM TEAM IPCEA
7. ANSI
8. ASTM
9. Underwriter's Laboratories - UL-1069 current release
10. Texas Hospital Code/Joint Commission of Hospitals - Nurse Call Requirements

11. Authority having Jurisdiction

C. Defective or damaged materials shall be replaced or repaired prior to final acceptance in a manner which meets the approval of VA and at no additional cost to VA.

D. Where requirements of the specifications conflict with existing rules, standards, codes, etc., VA shall be advised (in writing) and shall render a decision prior to performance of work.

1.07 WARRANTY

A. The supplying contractor shall provide a warranty on the system which shall include all necessary labor and equipment to maintain the system(s) in full operation for a period of one year from the date of acceptance.

B. In addition, the equipment (parts) warranty for all core system components including control / switching equipment, power supplies, patient stations, sub-stations, and nurse consoles shall extend to a total of at least five (5) years. Warranty for ancillary devices such as pillow speakers and call cords shall extend to a total of at least two (2) years.

C. Manufacturer shall provide, free of charge, product firmware upgrades throughout the 1 year warranty period for any product feature fixes.

D. After the acceptance of the system(s) service shall be provided on the following basis

1. Emergency Service: Provided 24-hours a day. When a total or catastrophic failure of equipment is reported to contractor, within 2 hours of notification, a service person will be on site. (An example of a catastrophic failure would be a hub failure or a nurse console failure.)
2. Routine Service: Provided within 4-business hours (9 a.m. to 5 p.m., Monday through Friday, excluding holidays) of notification. When a minor failure of equipment is reported to contractor, a service person will be on site within 24 hours of notification. (An example of a minor failure includes peripheral equipment such as control stations, entertainment speakers, corridor lights, pull-cord stations, etc. which normally affect only one patient or patient room.)

E. The Bid Proposal shall include a one-year warranty, including time and materials for the repair of all items installed. Responses to warranty problems shall be made within twenty-four hours after notification of such problems by VA. The appropriate response shall include a physical visit and investigation of the warranty difficulty. Prior to leaving the job site, the contractor shall leave a written report of the following to the VA Telecommunications Department:

1. A description of and time of the malfunction

2. What repairs and improvements were made to rectify the problem
3. What can be done to prevent the problem from accruing again
4. Location of service call

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. The products specified shall be new and of the standard manufacture of a single reputable manufacturer. As a reference of standard and quality, functionality and operation, it is the request of the Owner that bids be based only on equipment manufactured by Rauland-Borg Corporation **or equal.**

2.2 NURSE CALL NETWORK WIRING

- B. All Nurse Call Network wiring shall be only Cat 6. Plenum wire shall be used in open areas and standard Cat 6 within conduit. System shall be capable of injecting DC power into a Cat 6 run, for additional rooms, or long runs, by running a separate DC cable pair to a remote location.

2.3 NURSE CALL CONTROLLER(S)

- A. Furnish as needed in each nursing unit a nurse call network controller. Each controller shall provide the following:
 1. Non-blocking, duplex communications between consoles and rooms, sub stations and duplex pillow speakers, within each 6 station loop. Provide four loops for a total of 12 speech paths.
 2. Cat 5e or Cat 6 wiring standard utilizing PoE (Power over Ethernet) between console and nurse call controllers and local wiring to power room station equipment and dome lights.
 3. VoIP audio to Nurse Call Network, VoIP Nurse console, VoIP staff terminal, wired or wireless phones via SIP protocol. VoIP digital audio stream out to rooms without IP overhead signaling.
 4. Up to 96 corridor lights can be operated with a single controller.
- B. Controller must be life safety grade meaning that it shall not require regular rebooting for continued basic functions of system and it shall be possible for controller to act as a stand alone controller should loss of network communication occur. Personal Computers may not be used for this purpose PCs will only be allowed outside of the UL-listed nurse call network on the customer supported LAN.
- C. Nurse call controller(s) are connected to the hospital's LAN via Ethernet switches. The nurse call servers also connected to the hospital's LAN are running specialized software for using hospital data resources and telephone communications resources.

2.4 VoIP NURSE CONSOLES

- A. Furnish as shown on plans, a UL-1069 listed VoIP nurse console capable of the following functions:
 1. Full duplex audio
 2. Color display
 3. 12 or 24 hours time display and synchronization to hospital standard network time from the nurse call gateway server including any daylight savings time changes supported by the network.

4. Display up to 3 incoming calls each with an individual elapsed timer which increments time since call was placed. Also provide the ability to scroll to see all incoming calls.
5. Power over Ethernet powered connection to uL-1069 listed Ethernet controller. No local power supplies required.
6. Choice of hands-free duplex communications through built in speaker and separate microphone or private handset conversation.
7. Ability to create up to 32 soft keys, user-configurable, with 4 buttons, 8 screens deep.
8. Console shall be interactive with an associated PC workstation (user provided) without the necessity of any interconnection to the PC. The work process relationship shall be software defined through the network connections.
9. Optional tone/mute of calls in progress.
10. Ability to block all nurse call loudspeaker paging to facilitate a low noise patient environment. Password protection can be enabled to only allow authorized access to audio paging.
11. Ability to swing an individual room or any group of rooms by touching one labeled touch point. Room(s) and consoles may be located anywhere within hospital nurse/patient communications network.
12. Console can be programmed to be the receiver of any call that is not answered by another console, or can be programmed to receive any call from a console that has failed or has been unplugged, or otherwise not receiving the call (call orphaning).
13. Ability to dial through built in key pad.
14. Self-contained unit which shall not occupy more than 88 square inches of desk space and is desk or wall-mountable.

2.5 PC CONSOLE DISPLAY

- A. Provide a PC console display on any networked Owner provided PC that meets the system manufacturer's minimum specifications, whether it utilizes touch screen or standard mouse control. Also, Owner provided wall mounted PC displays shall have the global option provided in this software package of a touch screen keyboard. When a PC is "associated" with a VoIP console described previously, it shall have full interoperability to provide user with easy to follow on screen functions, such as display of call priority, room and patient information. Selecting a touch point or by mouse click shall provide an automated service reminder. While in audio contact with the patient, an enriched display shall show all user defined display information, such as caregiver assigned, and pertinent patient information.
- B. The following additional functions shall be provided at each one of these users' screens:
 1. Full display of all calls, including corridor light color sequence.
 2. Complete electronically generated census of patients showing assigned caregiver, current patient needs as sent by service reminder process, time patient has been waiting for call answering, or need, list of caregivers on duty and staff location (when RTLS option available).
 3. Ability to text message to any single individual, group of users, or all users, a text message to a pager or wireless phone display.

4. Ability to display calls in a centralized display format (i.e. Centralized Code Blue display).
5. Ability to display all staff information, staff status and wireless extension.

2.6 VoIP STAFF TERMINAL

- A. Furnish as shown on plans, as part of the nurse call communications network, a UL 1069 listed VoIP Staff Terminal. This dynamic device shall serve as a patient or procedure room communications tool while providing staff with "soft" touch-points to initiate an instantaneous notification of an in room need. Additionally this terminal may be used as a functional nurse call console.
- B. The following functions shall be provided.
 1. Color touch screen display.
 2. Ability to create up to 60 soft keys, user-configurable, up to 8 screens per terminal.
 - i. Sends specific need for that location. Examples: Emergency, Staff Assist, Cleaning Needed, Lifting Help, Transport, Order, Stat Order, Rounding, etc.
 - ii. Speed dial to any location.
 3. Power over Ethernet powered connection to UL-1069 listed Ethernet switch. Local power not required.
 4. Full duplex audio.
 5. Choice of hands-free duplex communications through built in speaker and separate microphone or private handset conversation.
 6. Display up to 3 incoming calls each with an individual elapsed timer which increments time since call was placed. Also provide the ability to scroll to see all incoming calls.
 7. Ability to dial through touch key pad.
 8. Ability to capture an individual nursing unit, selected units, or all units in hospital by touching single custom labeled touch point.

2.7 CAREGIVER ASSIGNMENTS AND SIGNING ON AND OFF DUTY

- A. Provide software to make caregiver to patient assignments from any Owner provided PC workstation within the hospital by easy user sign on. Assignment process shall be intuitive and indicate to that Supervisor making the assignment, each caregiver's patient load based on number of patients and patient difficulty. These assignments shall stay in queue until each individual signs on duty. The assignment is released when the caregiver goes off duty.
- B. The following additional functions shall be provided:
 1. Unlimited assignment of caregivers to patients, patients to caregivers.
 2. Group assignments.
 3. Assignments may be made up to 7 days in advance.
 4. Easy display of prior day's assignment and easy click to accept if you want to keep assignment the same.
 5. Display pertinent HL-7 fields for patient.
 6. Allow for assigning advanced call escalation for unanswered calls.

7. Staff member shall have ability to use Bar Code for ID and wireless devices.
8. Users' assignment can print out to a local printer.
9. User shall have the ability to go On and Off break forwarding their device to another caregiver and reflecting this activity in the reporting software.

2.8 PATIENT STATIONS

- A. Provide single patient or dual patient station as shown on plans.
- B. Each patient station shall be capable of the following functions:
 1. Separate speaker and microphone for full duplex audio. Entertainment audio to be muted when intercom in use.
 2. One DIN pillow speaker receptacle per bed that shall have a tilt design, with automatic release of pillow speaker plug when pillow speaker cord is pulled at any angle.
 3. Station shall support an optional module to feature bed side rail control on station to indicate bed connection. LED on station shall indicate bed connection(s).
 4. Built in lighting control that interfaces directly to low voltage controllers.
 5. One universal ¼" jack for auxiliary alarm input/call cord per bed. Call priority of these receptacles shall be independent of any other button or receptacle.
 6. No dummy plugs required.
 7. Cancel button shall cancel any call on this station and any other station in room that is programmed for universal room cancel.
 8. Continuous supervision.
 9. Ability to service exchange station "hot" without removing system power or powering down the local controller.
 10. Ability to program on a per patient station basis, each bed and entertainment/call cord receptacle to custom call priorities.
 11. Supply where noted the Enhanced Single Patient Station that includes all the features above, and additionally, two programmable buttons: code blue and staff assist. Optionally these two buttons may be changes to any call process that is selected by Owner by changing the buttons.
 12. Unit shall mount in a standard 3-gang electrical box.

2.9 STAFF STATION

- A. Provide as shown on plans a staff station. Unit shall provide two-way hands free duplex intercom to its assigned nurse console(s) by pushing a call in button. Station shall support an optional module to feature bed side rail control on station to indicate bed connection. LED on station shall indicate bed connection. Unit shall mount in a standard 3-gang electrical box.

2.10 DUTY STATION

- A. Provide as shown on plans a duty station. Unit shall provide remote annunciation of assigned patient stations and sub-stations via 4 LEDs and 12 call tones. Duty station faceplate LEDs shall mimic corridor light activity

for the assigned nursing area. Also provides two-way duplex intercom to the assigned nurse console(s) through separate speaker and microphone. Call tones generated at duty station must be identical and repeat in synch with tones produced at closest nurse console. It shall be possible to mute the call in tone, without cancelling call. The next call in, assigned to this duty station, will un-mute the station. Muting feature may be defeated in those jurisdictions that do not allow muting of duty station. The duty station shall be capable of being programmed for a specific time that a day/night mode takes place, allowing a volume change to the call-in tones. This feature is required to minimize noise for patients. Unit shall mount in a standard 3-gang electrical box.

2.11 SUB-STATIONS

- A. Provide as shown on plans, sub-stations which shall be flush mounted in a single gang box. All substation cancel buttons will follow the cancel policy as defined in the system configuration. Typically canceling a high priority call can only be accomplished by the station initiating a call, while lower priority calls may be cancelled by any associated station in the room.
- B. Individual sub-stations shall be:
 - 1. Pull cord station shall be water resistant with a replaceable PVC pull-cord, and easily cleaned surface. The pull-cord shall have a large, easy to pull plastic "bell" attached. This station may only be cancelable with the room and not cancelable from the nurse console.
 - 2. Pull cord station with Call button shall have the same characteristics as above, with the addition of one extra pushbutton for call-in. This button shall be programmable separately from the pull-cord to indicate a different call process (i.e. call caregiver to return to bed) than the pull cord which may indicate an emergency situation. Although this station trims out to a double gang faceplate, the mounting is in a single gang box.
 - 3. Pull cord station with speaker shall have all the capabilities of the pull cord station with call button, and include a built in speaker and microphone for communications with the patient. Although this station trims out to a double gang faceplate, the mounting is in a single gang box.
 - 4. Single call button station and dual button stations shall be water resistant. The buttons shall be back lit and have the ability for a user defined customized call label corresponding to the 990 call priorities available within the system. An elapsed timer may be activated by any call button to start a count up timer on any clock that accepts remote activation.
 - 5. Remote Cancel Station shall have a large "Cancel" button and will follow the room cancel policy established by the system configuration.
 - 6. Staff Registration station shall have four backlit buttons that allow by default three levels of staff and one Staff Assist Button. Any button can be configured as a staff registration or call button to provide maximum flexibility. Although this station trims out to a double gang faceplate, the mounting is in a single gang box.
 - 7. Bed Management station shall have four backlight buttons: Transport, Cleaning Needed, Cleaning in Progress, Bed Ready. The buttons will indicate the room condition and alert transportation personnel to this room. When the Transport button is depressed, the transport person assigned to this area receives a wireless message to transport this patient, or alternately, transportation dispatcher receives an on screen display. Environmental Services staff will receive a wireless message that this bed requires cleaning. Environmental Services and

nursing supervisors are alerted to the bed's state. Alternately, customized descriptions can be assigned to this station for specific facility needs. Canceling an event may be accomplished by pressing a button a second time, using the cancel button, or by pressing another button in the chain of events.

8. A two jack auxiliary alarm station shall allow the connection of external patient monitoring devices via two (2) ¼ inch jacks. This allows individual annunciation of patient alarms to nurse call consoles and wireless devices. Each jack may be programmed for one of 990 call processes and may be configured for latching or non-latching. A call in timer may be set within system configuration to buffer a device that produces intermittent alarms.
9. Remote Pillow Speaker Station shall provide a remote connection for the standard 9 pin DIN connector associated with a patient station. This allows the remote installation of the patient station, while keeping the 9 pin receptacle close to the patient.
10. Provide where noted, an 8 pin DIN Universal Pillow Speaker Station. This station shall function with either legacy 8 pin DIN pillow speakers, or interactive system pillow speakers.
11. Provide where noted a Logical Input Station which allows any dry contact closure from an external device to activate a call into the nurse communications network.
12. Provide where noted a Logical Output Station that allows external devices to be controlled from the nurse call network. Either dry contacts or a driver voltage output shall be available.

2.12 CORRIDOR LIGHTS AND DOMELESS CONTROLLERS

- A. Provide as shown on plans, the proper type of corridor light or domeless controller. Corridor lights shall contain four sections, each lighted by a long life, RGB LED capable of producing 7 colors. Each section shall have a diffusion lens which allows for 180 degree horizontal visibility of call lights. The corridor lights shall be capable of the following:
 1. All segments of corridor light can indicate a call in any of the following 7 colors: Blue, Red, White, Green, Orange, Yellow, Pink.
 2. Custom call patterns (any combination of light segments, such as all segments blue for code blue).
 3. Flash any single color or strobe the sections of the light in any color pattern.
- B. Intelligence in the corridor light and domeless controller shall support up to 16 room devices and allow for the ability of any room station to be associated with any other room in the system. This allows special functions where needed, such as associated call stations and cancelling options, (i.e. door monitoring).
- C. Staff registration shall be indicated by a custom color associated with that staff level (i.e. Green = Nurse, Orange = LPN, Yellow = Aide).
- D. Domeless controllers shall have all the function of the corridor light, less LEDs.
- E. In the unexpected event of communications loss with the nurse call controller, corridor lights and domeless controllers shall enter a local room failsafe mode showing all calls in the hallway via the LED indicators.
- F. Corridor lights and domeless controllers may be hot-swapped on the room-to-room communication line without the loss of communications to other devices on the local network.

2.13 PATIENT ENTERTAINMENT SPEAKER/CALL CORDS

- A. Provide one (1) pillow speaker per bed station and 5% spares. The pillow speaker shall have a mating 9 pin din plug and nurse call button. TV control shall be programmed as a system function to allow pillow speakers to work with any standard hospital grade TV. Lighting control is optional to control up to two lights. All pillow speakers to have call assurance and monitor LEDs. The Pillow speaker shall be the:
 - a. Rauland Enhanced Model: Digital TV control with full duplex communications via built in microphone and separate speaker. There shall be three additional buttons for the use by the patient for special needs, such as "pain", "water", and "toilet". The system shall have the ability to discern the difference between these calls and send it to the appropriate care level. Buttons for up/down volume, up/down channel. TV mute, closed caption and TV on/off shall be standard. A direct entry key pad gives patient ability to enter channel number.

2.14 WIRELESS DEVICE INTERFACES - OPTIONAL

- A. The pocket Paging Software Module shall receive Ethernet messages from the nurse call network. Industry standard TAP protocol is sent to the hospitals pocket page transmitter.
- B. The Telephony Interface Software Module shall receive, via an Ethernet connection, VoIP connectivity using the standard SIP protocol. This module shall support up to 60 simultaneous voice connections between wired/wireless phones and the nurse call network. There shall be four different possibilities (specification writer to choose one method):
 - 1. The facility will utilize a VoIP/SIP wireless phone system and an IP/SIP PBX. The software module shall directly support an interface through the Owner provided Telephony/SIP Call server that communicates to the nurse call network gateway server. Any nurse call system that only utilizes analog station/trunk ports to communicate with SIP wireless phones will not be acceptable.
 - 2. The facility will utilize a VoIP/SIP wireless phone system with a non-SIP PBX. The software module shall directly support an interface through the Owner provided Telephony/SIP Call Server that communicates to the nurse call network gateway server. Owner will also provide a Telephony/SIP Gateway. Any nurse call system that only utilizes analog station/trunk ports to communicate with SIP wireless phones will not be acceptable.
 - 3. The facility will utilize a wireless phone system which is not SIP compatible and a VoIP/SIP PBX. The software module shall directly support an interface through the Owner provided Telephony/SIP Call Server that communicates to the nurse call network gateway server. The supplying contractor is to provide middleware which interfaces the non SIP wireless phone system display to the nurse call system software module. Owner provides wireless phone system OAI. Owner will also provide a Telephony/SIP Gateway.
 - 4. The facility will utilize a wireless phone system which is not SIP compatible and a non SIP PBX. The software module shall directly support an interface through the Owner provided Telephony/SIP Call Server that communicates to the nurse call network gateway server. The supplying contractor is to provide middleware which interfaces the non SIP wireless phone system display to the nurse call system software module. Owner provides wireless phone system OAI. Owner will also provide a Telephony/SIP Gateway.

2.15 ADT INTERFACE

- A. Provide a HL-7 compliant interface (V2.2-2.5) for the purpose of receiving relevant patient information.
- B. This interface shall be capable of the following:
 - 1. Mapping of standard ADT segment field components and subcomponents to nurse call fields.
 - 2. Ability for custom field mapping (i.e. z segments).
 - 3. All updates shall be real time, but software shall buffer data for any interruption of service.

2.15 RTLS (REAL TIME LOCATING SYSTEM) - OPTIONAL

- A. Provide an interface (OAI) to integrate with the facilities Real Time Locating System (specified or provided elsewhere) and the nurse call network. Nurse call features and location of staff shall communicate per standard API published by manufacturer of nurse call.
- B. The full integration shall include, but not be limited to the following:
 - 1. Staff location.
 - 2. Ability to choose specific calls to be canceled as a staff member walks into room.
 - 3. Optionally lights corridor light to show staff in room with specific staff color.
 - 4. Ability to locate staff throughout the facility on networked PC.

2.16 DATABASE MANAGEMENT

- A. Provide standard ODBC (MS SQL 2005) compliant databases. Databases shall be able to be backed up using facilities standard backup processes and disaster recovery methods.

2.18 REPORTING SOFTWARE

- A. Provide software that may be accessed by any networked PC work station that gives management patient call details in clear readable format. HL-7 integration shall make all pertinent patient details available, including the ability to search by patient name and/or patient ID number for those nurse call records associated for that patient during their stay, regardless of room/bed occupied.
- B. In addition, the reporting software shall provide the following functions:
 - 1. Standard, global reports.
 - 2. Individual user reports.
 - 3. Reports shall be viewed in Adobe Acrobat Reader.
 - 4. Any trained individual may utilize standard ODBC compliant reporting software to generate more enhanced reporting.

2.19 WIRELESS BED INTERFACE - OPTIONAL

- A. Provide, one per bed, a Wireless Wall Unit that includes the following functions:
 - 1. A wireless (RF) link between the Nurse Call system and a Feature Bed. This unit will receive any patient call or bed exit call from the associated bed.
 - 2. Plugs into a standard 37-pin wall receptacle.
 - 3. The Wall unit must provide a Link LED and audible tone confirmation when linked successfully to the Bed Unit.
 - 4. If a bed is moved out of range, a "bed out" call is placed in the system.

5. A Cancel button must be provided to silence tone notifications such as "Bed Out" or "Low Battery".
 6. Power is provided by Nurse Call system or via an A/C adapter.
- B. Provide, one per bed, a Wireless Bed Unit for use with the above Wireless Wall Unit that includes the following functions:
1. A wireless (RF) link between the Nurse Call system and a Feature Bed when used in conjunction with the Wireless Wall Unit.
 2. Plugs into a 37-pin socket receptacle on a Feature Bed such as the Hill-Rom or Stryker Feature Beds with side rails.
 3. The Bed Unit must have a Low Battery LED Indicator and tone. Bed Unit uses 3 AA batteries.
- C. By pressing a Link button on each unit the wall unit provides a Link LED and audible tone confirmation when linked successfully to the Bed Unit. An Unlink button allows de-association of the wall and bed unit for removal of the bed from the room which also places a "Bed Out" call on the Nurse Call system. There must also be a Link reminder tone if an unlinked Bed Unit senses an unlinked wall unit after 2 minutes.

PART 3 - EXECUTION

3.1 SUPERVISION

- A. Only factory certified installers shall install, service and maintain the specified network system.
- B. Manufacturer shall have the equipment manufacturer's engineer or their designated agent inspect the installation and operation of this network to determine that the network complies with all standards listed in Part 1.04, A.

3.2 TRAINING

- A. Contractor shall provide thorough training of all nursing staff assigned to those nursing units receiving new networked nurse/patient communications equipment. This training shall be developed and implemented to address two different types of staff. Floor nurses/staff shall receive training from their perspective, and likewise, unit secretaries (or any person whose specific responsibilities include answering patient calls and dispatching staff) shall receive operational training from their perspective. A separate training room will be set up that allows this type of individualized training utilizing in-service training unit, prior to cut over of the new system.

3.3 NEEDS ASSESSMENT

- A. Manufacturer shall provide a one-on-one meeting with the particular nursing manager of each unit affected by the installation of the new networked nurse/patient communications equipment. This meeting shall include reviewing the floor plan drawing, educating the nursing manager with the functions of the equipment that is being provided and gathering details specific to the individual units; coverage and priorities of calls; staffing patterns; and other pertinent details that will affect the training. In-service scheduling materials and sample of training materials will be provided. A staff member

list and Pocket Page Tag Message list, if needed, be filled out for inclusion in the software. Information gathered will be provided to Contractor to program the network software.

3.4 IN-SERVICE TRAINING

- A. Manufacturer shall provide thorough training of all nursing staff assigned to those nursing units receiving needs assessment of new networked nurse/patient communications equipment. This training shall be developed and implemented to address all types of staff determined at the needs assessment. Floor nurses/staff shall receive training appropriate to their needs, and likewise, unit secretaries (or any person whose specific responsibilities include answering patient calls and dispatching staff) shall receive operational training appropriate to their needs and charge nurses (or any person whose specific responsibilities include scheduling staff to patient assignments) shall receive operational training appropriate to their needs. A separate training room will be set up that allows this type of individualized training utilizing in-service training unit.

3.5 WIRING

- A. Contractor shall terminate all wiring with manufacturer approved connectors. The use of wire nuts is prohibited.
- B. All wiring shall be free from shorts and faults. Wiring shall be UL listed, NEC and NFPA 70, Article 25 approved.
- C. Nurse patient communications network wiring shall not be run in the same cable systems with other systems (i.e. Class 1 AC power distribution, fire alarm, entertainment systems, lighting controls, etc.)

3.6 ELECTRICAL POWER CONNECTIONS

- A. It shall be the responsibility of the hospital to provide a dedicated 120 VAC, 60 HZ conduit feed into the equipment cabinet. This power feed shall not have any other devices connected directly to it. A 20 AMP circuit breaker located in the electrical sub-panel labeled "nurse call" will control this circuit. This electrical circuit will be connected to the hospital's emergency power system for automatic power switch over during loss of utility power.
 - 1. Large hospital systems may require multiple equipment cabinets that are separated between floors and buildings.
 - 2. Care should be taken to connect power supply common mode lines when DC current can flow.
 - 3. Large separation between controllers and power supplies should be connected by fiber optic cable to reduce common mode power supply issues.
- B. Connect all network system power supplies and equipment cabinets to a common earth ground utilizing a 14 AWG, or larger, solid conductor which is at minimum the same conductor size as the AC feed wires.

3.7 ENVIRONMENTAL PROTECTION

- A. Make certain that all network control equipment is accessible for service. Contractor shall notify specifying authority if designated equipment closet

does not meet manufacturer's requirements for heat, radiation or static electricity.

3.8 PROTECTION OF NETWORK DEVICES

- A. Contractor shall protect network devices during unpacking and installation by wearing manufacturer approved ESD wrist straps tied to chassis ground. The wrist strap shall meet OSHA requirements for prevention of electrical shock, should technician come in contact with high voltage.

3.9 CLEANING AND PATCHING

- A. It shall be the responsibility of the contractor to keep their work area clear of debris and clean area daily at completion of work.
- B. It shall be the responsibility of the contractor to patch and paint any wall or surface that has been disturbed by the execution of this work.

END OF SECTION 27 52 23

SECTION 28 05 00
COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This Section, Requirements for Electronic Safety and Security Installations, applies to all sections of Division 28.
- B. The contract shall furnish and install electronic safety and security pathways, cabling and accessories in accordance with the specifications and drawings. All systems and electronic equipment will be contractor furnished contractor installed (CFCI). Capacities and ratings of, cable and other items and arrangements for the specified items are shown on drawings.

1.2 REFERENCE STANDARDS

- A. Adherence to, and compliance with, the codes and standards referenced, and the Physical Security Design Manual for VA Facilities unique requirements and design solutions identified in the manual, is mandatory. Requests to deviate from the industry standards and design solutions prescribed in these guidelines may be submitted, on a case-by-case basis, in accordance with the instructions in the Policy and Procedures section of these guidelines. No deviation from the requirements of the National Electrical Code (NEC) will be allowed.

1.3 CODES, STANDARDS, REFERENCES, AND APPLICABILITY

- A. NATIONAL ELECTRICAL CODE, NFPA 70.
 - 1. The National Fire Protection Association has acted as the sponsor of the National Electrical Code (NEC) since 1911. The original Code was developed in 1897 as a result of the united efforts of various insurance, electrical, architectural, and allied interests. The purpose of the NEC is the practical safeguarding of persons and property from hazards arising from the use of electricity. The NEC provides the minimum code requirements for electrical safety. In security distribution design, the NEC must be used in concert with the ANSI/EIA/TIA standards identified below, which are intended to insure the performance of the security infrastructure.
- B. ANSI/TIA/EIA STANDARDS
 - 1. The Telecommunications Industry Association/Electronics Industry Association (TIA/EIA) engineering standards and publications are designed to serve the public interest through eliminating misunderstandings between manufacturers and purchasers. The standards facilitate interchangeability and improvement of products, and assist the purchaser in selecting and obtaining the proper product for his or her particular need.
- C. CABLING STANDARD, ANSI/TIA/EIA-568 (SERIES)
 - 1. The ANSI/TIA/EIA-568-C (series) is the Commercial Building Cabling Standard. This standard defines a generic security wiring system for commercial buildings that will support a multi-product, multi-vendor environment. It also provides direction for the design of security cabling products for commercial enterprise.
 - a. The purpose of the standard is to enable planning and installation of building wiring with little knowledge of the security products that subsequently will be installed. Installation of wiring systems during building construction or renovation is significantly less expensive and less disruptive than after the building is occupied. TIA/EIA-568-C establishes

performance and technical criteria for various wiring system configurations for interfacing and connecting their respective elements.

D. PATHWAYS AND SPACES, ANSI/TIA/EIA-569-B (SERIES).

1. The ANSI/EIA/TIA-569-B (series) is the Commercial Building Standard for Pathways and Spaces. This standard will be followed for all low voltage systems in all CTC buildings. This standard encompasses security considerations both within and between buildings, and recognizes three fundamental concepts:
 - a. Buildings are dynamic. Over the life of a building, or campus, remodeling is more the rule than the exception. The standard recognizes that changes will take place.
 - b. Building security systems and media are dynamic. Over the life of a building, or campus, both security equipment and cabling change dramatically. The standard recognizes this fact by being as independent as possible from specific vendor equipment and media.
 - c. Security is more than just locks and cameras. Security also encompasses many building systems including environmental controls, fire alarms and emergency paging.
 - d. In order to have a building, or campus, successfully designed, constructed, and provisioned for security, it is imperative that the security design be incorporated during the preliminary architectural design phase. To accomplish this, the architect must work closely with the designated Security & IT staff members.

E. GROUNDING AND BONDING, ANSI/TIA/EIA-607-A (SERIES)

1. The ANSI/TIA/EIA-607-A (series) (also known as ANSI J-STD-607-A) is the Commercial Building Grounding and Bonding Requirements for Security. The National Electrical Code (NEC) provides grounding, bonding, and electrical protection requirements to ensure life safety. Modern security systems require an effective grounding infrastructure to insure optimum performance of the wide variety of electronic security systems that may be used throughout the life of a building. The grounding and bonding requirements of this standard are additional technical requirements for security that are beyond the scope of the NEC. These standards are intended to work in concert with the cabling topology specified in ANSI/TIA/EIA-568-C, and installed in the pathways and spaces designed in accordance with ANSI/TIA/EIA-569-B.

F. AMERICANS WITH DISABILITIES ACT (ADA)

1. The Americans with Disabilities Act defines accessible design considerations such as spacing between equipment, room layouts mounting heights and device and communications requirements applicable to Electronic Safety and Security designs and installations. It also contains regulations concerning alarms and signage.

G. OCCUPATIONAL SAFETY & HEALTH ADMINISTRATION (OSHA)

1. Through the Occupational Safety and Health Administration the federal government enforces the safety aspects of codes and standards that apply to employee working conditions. Guidelines for good practice when installing electronic safety and security systems are defined in the following documents:
 - a. 29CFR1910, Title 29, Labor-Part 1910 OSHA Standards.
 - 1) 29CFR1926, Title 29, Labor-Part 1926 Safety & Health Regulations for Construction.
 - 2) Individual states may have their own occupational safety

divisions. Most states or localities accept certification of electrical products by a national testing laboratory as evidence that products and materials are safe for use in that jurisdiction.

H. UNDERWRITERS LABORATORIES INC. (UL)

1. In the United States the Authority Having Jurisdiction (AHJ) typically requires UL testing and certification on electrical equipment. Some of the applicable standards are as shown below:
 - a. UL 294 (1999) Standard for Access Control System Units. UL 639 (1997) Standard for Intrusion-Detection Units.

I. THE BICSI ELECTRONIC SAFETY & SECURITY DESIGN REFERENCE MANUAL

1. The Building Industry Consulting Service International, Inc. (BICSI) is an information technology association whose mission is to provide state-of-the-art information technology and security knowledge to the industry, resulting in good service to the end user. BICSI develops and publishes the Electronic Safety and Security Design Reference Manual (ESSDRM). The ESSDRM is not a code or standard. The ESSDRM is an extensive volume of information on the various aspects of security systems and security distribution.
 - a. The ESSDRM provides discussions and examples of various engineering methods and design solutions that can be selected and employed in order to meet the requirements of the NFPA and ANSI/TIA/EIA standards. Designers and installers are encouraged to use the ESSDRM as an engineering tool, within the constraints of the unique requirements of the VA Security Infrastructure Standards.

1.4 MINIMUM REQUIREMENTS

- A. References to industry and trade association standards and codes are minimum installation requirement standards.
- B. Drawings and other specification sections shall govern in those instances where requirements are greater than those specified in the above standards.

1.5 QUALIFICATIONS (PRODUCTS AND SERVICES)

- A. Manufacturers Qualifications: The manufacturer shall regularly and presently produce, as one of the manufacturer's principal products, the equipment and material specified for this project, and shall have manufactured the item for at least three years.
- B. Product Qualification:
 1. Manufacturer's product shall have been in satisfactory operation, on three installations of similar size and type as this project, for approximately three years.
 2. The VA PD reserves the right to require the Contractor to submit a list of installations where the products have been in operation before approval.
- C. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within four hours of receipt of notification that service is needed. Submit name and address of service organizations.

PART 2 - PRODUCTS

2.1 GENERAL

- A. Materials and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items, for which replacement parts shall be available.

- B. When more than one unit of the same class of equipment is required, such units shall be the product of a single manufacturer.
- C. Equipment Assemblies and Components:
 - 1. Components of an assembled unit need not be products of the same manufacturer.
 - 2. Manufacturers of equipment assemblies, which include components made by others, shall assume complete responsibility for the final assembled unit.
 - 3. Components shall be compatible with each other and with the total assembly for the intended service.
 - 4. Constituent parts which are similar shall be the product of a single manufacturer.
- D. Factory wiring shall be identified on the equipment being furnished and on all wiring diagrams.
- E. When Factory Testing Is Specified:
 - 1. The Owner shall have the option of witnessing factory tests. The contractor shall notify VA PD through the GC a minimum of 15 working days prior to the manufacturers making the factory tests.
 - 2. Four copies of certified test reports containing all test data shall be furnished to the Resident Engineer prior to final inspection and not more than 90 days after completion of the tests.
 - 3. When equipment fails to meet factory test and re-inspection is required, the contractor shall be liable for all additional expenses, including expenses of the VA PD.

2.2 EQUIPMENT REQUIREMENTS

- A. Where variations from the contract requirements are requested in accordance with Section 00 72 00, GENERAL CONDITIONS and Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, the connecting work and related components shall include, but not be limited to additions or changes to branch circuits, circuit protective devices, conduits, wire, feeders, controls, panels and installation methods.

PART 3 - EXECUTION

3.1 SUMMARY

- A. Equipment and materials shall be protected during shipment and storage against physical damage, dirt, moisture, cold and rain:
 - 1. During installation, enclosures, equipment, controls, controllers, circuit protective devices, and other like items, shall be protected against entry of foreign matter; and be vacuum cleaned both inside and outside before testing and operating and repainting if required.
 - 2. Damaged equipment shall be, as determined by the Resident Engineer, placed in first class operating condition or be returned to the source of supply for repair or replacement.
 - 3. Painted surfaces shall be protected with factory installed removable heavy kraft paper, sheet vinyl or equal.
 - 4. Damaged paint on equipment and materials shall be refinished with the same quality of paint and workmanship as used by the manufacturer so repaired areas are not obvious.

3.2 WORK PERFORMANCE

- A. Job site safety and worker safety is the responsibility of the contractor.
- B. For work on existing stations, arrange, phase and perform work to assure electronic safety and security service for other buildings at all times. Refer to Article OPERATIONS AND STORAGE AREAS under Section

01 00 00, GENERAL REQUIREMENTS.

- C. New work shall be installed and connected to existing work neatly and carefully. Disturbed or damaged work shall be replaced or repaired to its prior conditions, as required by Section 01 00 00, GENERAL REQUIREMENTS.
- D. Coordinate location of equipment and conduit with other trades to minimize interferences. See Section 00 72 00, GENERAL CONDITIONS.

3.3 EQUIPMENT INSTALLATION AND REQUIREMENTS

- A. Equipment location shall be as close as practical to locations shown on the drawings.
- B. Inaccessible Equipment:
 - 1. Where VA PD determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, the equipment shall be removed and reinstalled as directed at no additional cost to the VA PD.
 - 2. "Conveniently accessible" is defined as being capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as, but not limited to, motors, pumps, belt guards, transformers, piping, ductwork, conduit and raceways.

3.4 EQUIPMENT IDENTIFICATION

- A. Install an identification sign which clearly indicates information required for use and maintenance of equipment.
- B. Nameplates shall be laminated black phenolic resin with a white core with engraved lettering, a minimum of 6 mm (1/4 inch) high. Secure nameplates with screws. Nameplates that are furnished by manufacturer as a standard catalog item, or where other method of identification is herein specified, are exceptions.

3.5 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. The VA approval shall be obtained for all equipment and material before delivery to the job site. Delivery, storage or installation of equipment or material which has not had prior approval will not be permitted at the job site.
- C. All submittals shall include adequate descriptive literature, catalog cuts, shop drawings and other data necessary for the VA to ascertain that the proposed equipment and materials comply with specification requirements. Catalog cuts submitted for approval shall be legible and clearly identify equipment being submitted.
- D. Submittals for individual systems and equipment assemblies which consist of more than one item or component shall be made for the system or assembly as a whole. Partial submittals will not be considered for approval.
 - 1. Mark the submittals, "SUBMITTED UNDER SECTION_____".
 - 2. Submittals shall be marked to show specification reference including the section and paragraph numbers.
 - 3. Submit each section separately.
- E. The submittals shall include the following:
 - 1. Information that confirms compliance with contract requirements. Include the manufacturer's name, model or catalog numbers, catalog information, technical data sheets, shop drawings, pictures, nameplate data and test reports as required.
 - 2. Elementary and interconnection wiring diagrams for communication and signal systems, control system and equipment assemblies. All terminal points and wiring shall be identified on wiring diagrams.

3. Parts list which shall include those replacement parts recommended by the equipment manufacturer, quantity of parts, current price and availability of each part.
- F. Manuals: Submit in accordance with Section 01 00 00, GENERAL REQUIREMENTS.
1. Maintenance and Operation Manuals: Submit as required for systems and equipment specified in the technical sections. Furnish four copies, bound in hardback binders, (manufacturer's standard binders) or an approved equivalent. Furnish one complete manual as specified in the technical section but in no case later than prior to performance of systems or equipment test, and furnish the remaining manuals prior to contract completion.
 2. Inscribe the following identification on the cover: the words "MAINTENANCE AND OPERATION MANUAL," the name and location of the system, equipment, building, name of Contractor, and contract number. Include in the manual the names, addresses, and telephone numbers of each subcontractor installing the system or equipment and the local representatives for the system or equipment.
 3. Provide a "Table of Contents" and assemble the manual to conform to the table of contents, with tab sheets placed before instructions covering the subject. The instructions shall be legible and easily read, with large sheets of drawings folded in.
 4. The manuals shall include:
 - a. Internal and interconnecting wiring and control diagrams with data to explain detailed operation and control of the equipment.
 - b. A control sequence describing start-up, operation, and shutdown.
 - c. Description of the function of each principal item of equipment.
 - d. Installation and maintenance instructions.
 - e. Safety precautions.
 - f. Diagrams and illustrations.
 - g. Testing methods.
 - h. Performance data.
 - i. Pictorial "exploded" parts list with part numbers. Emphasis shall be placed on the use of special tools and instruments. The list shall indicate sources of supply, recommended spare parts, and name of servicing organization.
 - j. Appendix; list qualified permanent servicing organizations for support of the equipment, including addresses and certified qualifications.
- G. Approvals will be based on complete submission of manuals together with shop drawings.
- H. After approval and prior to installation, furnish the Resident Engineer with one sample of each of the following:
1. A 300 mm (12 inch) length of each type and size of wire and cable along with the tag from the coils of reels from which the samples were taken.
 2. Each type of conduit and pathway coupling, bushing and termination fitting.
 3. Conduit hangers, clamps and supports.
 4. Duct sealing compound.

3.6 SINGULAR NUMBER

- A. Where any device or part of equipment is referred to in these specifications in the singular number (e.g., "the switch"), this

reference shall be deemed to apply to as many such devices as are required to complete the installation as shown on the drawings.

3.7 TRAINING

- A. Training shall be provided in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.
- B. Training shall be provided for the particular equipment or system as required in each associated specification.
- C. A training schedule shall be developed and submitted by the contractor and approved by the Resident Engineer at least 30 days prior to the planned training.

END OF SECTION

SECTION 28 05 26
GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY

PART 1 - GENERAL

1.1 GROUNDING, BONDING, AND ELECTRICAL PROTECTION

- A. Per ANSI J-STD 607-, a 4/0 bare stranded conductor cable shall be provided from the security room to the building main electrical service ground electrode. A Telecommunications Main Grounding Busbar (TMGB) shall be installed in the security room. All metallic conduits entering the security room all equipment racks in the security room and all exposed non-current carrying metal parts of security equipment in the security room must be bonded to the TMGB. The ITC shall be bonded to the TMGB busbar in the MTC via 3/0 backbones and contain a Telecommunications Ground Busbar (TGB) for bonding of all ladder tray, racks and cabinets via minimum 6-AWG insulated stranded bonding conductor.
- B. Adhere to all manufacturers' specific grounding and bonding requirements.

PART 2 - PRODUCTS

2.1 TELECOMMUNICATIONS BUSBARS

- A. Material: Copper, ¼" thick (aluminum not permitted).
- B. Pre-drilled
 - 1. 3/8" Diameter.
 - 2. Hole spacing per ANSI Joint Standard J-STD-607-A.
 - 3. Hole pattern shall accommodate two hole lugs.
- C. Busbars shall be listed by a nationally recognized testing laboratory.
- D. Telecommunications Main Grounding Busbar (TMGB)
 - 1. Chatsworth #10622-012 ground busbar with Chatsworth #10622-000 busbar insulators or equivalent, 20"x4" minimum.
- E. Telecommunications Grounding Busbar (TGB)
 - 1. Chatsworth #10622-012 ground busbar with Chatsworth #10622-000 busbar insulators or equivalent, 12"x2" minimum.

2.2 GROUNDING JOINTS/SPLICES

- A. Grounding conductor joints/splices shall be mechanical type, copper alloy, with a minimum of two bolts and a separate section for each conductor equal to Burndy "QPX", OZ/Gedney "XTP" or "PMX" or Penn-Union "VX" or copper compression type with two (2) indents equal to Burndy, T&B or Blackburn.
- B. Grounding conductor terminations (lugs) shall be single barrel, mechanical screw type, copper alloy with machined contact surfaces equal to OZ type "SL", T&B, or Burndy or copper compression type with two (2) indents equal to Burndy, T&B or Blackburn.

2.3 BONDING CONDUCTORS

- A. Material: Stranded copper (aluminum not permitted).

- B. Cable Tray Bonding Conductor: Green #8 AWG insulated bonding jumper (12" max) with appropriate lugs or manufactured braided copper grounding jumper equal to B-Line #CAM-GJ, T&B #BD12, OZ/Gedney type "FB" or Mono-Systems.
- C. Equipment Frame Bonding Conductor; Panduit #TRGK672 Telecommunications Rack Grounding Kit.
- D. Bonding Conductor (BC): Green insulated copper bonding conductor, size as required by NEC.
- E. The BC shall be, as a minimum, the same size as the TBB.
- F. Telecommunications Bonding Backbone (TBB): Green insulated copper conductor, minimum size of No. 6 AWG.
- G. The TBB shall be sized at 2 kcmil per linear foot of conductor length up to a maximum size of 3/0 AWG. Insulation shall meet fire ratings of its pathway.

Table 1
Sizing of the TBB
TBB length (ft) TBB Size (AWG)

Less than 13	6
14-20	4
21-26	3
27-33	2
34-41	1
42-52	1/0
53-66	2/0
Greater than 66	3/0

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install products in accordance with manufacturer's instructions.
- B. Provide the required elements and associated hardware necessary to provide a complete Telecommunications Grounding Infrastructure as specified.
- C. TMGB
 - 1. Locate the TMGB at the bottom of plywood backboard near the outside plant entrance conduits in the "MTC".
 - 2. TMGB shall be installed so that the BC for telecommunications is as short and straight as possible.
 - 3. Conductor shall be installed in continuous 3/4" PVC conduit.
- D. TGB
 - 1. Locate the TGB at the bottom of plywood backboard near the copper riser terminations in each "ITC".
 - 2. Find
- E. TBB
 - 1. Install Green insulated copper grounding conductor (refer to 2.03.D for conductor size) from the TMGB to each TGB.
- F. Grounding Conductor Joints/Splices
 - 1. Install mechanical type, copper alloy, with a minimum of two bolts and a separate section for each conductor or copper compression

- type with two (2) indents.
2. Install manufactured insulating cover or heavy tape insulation over joints/splices.
- G. Grounding of Cable Tray
1. Install Green #8 AWG bonding jumper (12" max) with appropriate lugs at each cable tray joint or install manufactured braided copper grounding jumper equal to B-Line #CAM-GJ, T&B #BD12, OZ/Gedney type "FB" or Mono-Systems.
 2. Install Green #8 AWG grounding conductor with appropriate lugs from side of cable tray down to TMGB or TGB. Drill and tap side of cable tray (for appropriate size bolt, 1/4" x 20 min.), making sure that bolt does not extend into wire management part of tray.
- H. Grounding of Equipment Frame
1. Install Panduit or equivalent Telecommunications Rack Grounding Kit from equipment frame to grounded cable tray, TMGB, or TGB.
- I. ANSI J-STD-607-A, Commercial Building. Grounding/Bonding Requirements- Joint Standard for Commercial Building Grounding (Earthing) and Bonding Requirements for Telecommunications, 2002*.
- J. IEEE 1100, IEEE Recommended Practice for Powering and Grounding Sensitive Electronic Equipment.
- K. NEC, NFPA 780.
- L. SECTION 28 05 53 IDENTIFICATION FOR COMMUNICATIONS SYSTEMS.

3.2 QUALITY CONTROL

- A. Inspect grounding and bonding system connections and conductors for proper installation and tightness.

3.3 DOCUMENTATION

- A. Provide documentation of actual locations of grounding electrodes, busbars and backbone grounding conductors.

END OF SECTION

SECTION 28 05 28
PATHWAYS FOR ELECTRONIC SAFETY AND SECURITY

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section specifies the requirements for the Security Systems Pathway for the Expansion & Renovation of Building 108 for Mental Health in Houston, Texas.
- B. Security Systems will utilize the following pathway as indicated on the T and TY drawings
 - 1. Security Systems will utilize j-hooks up to the closest accessible point nearest the end device (camera or access control).
 - 2. From the j-hook a dedicated conduit will be routed to the location of the device.

1.2 INSIDE PLANT CONDUIT

- A. Security conduit must be properly designed and installed. The design and installation practices for security conduit have some unique requirements beyond those normally seen in standard electrical conduit. The following items are required to be included in the design and installation of interior security conduit:
 - 1. Conduits must be designed and installed in the most direct route possible from the security room to the device location.
 - 2. The maximum length of LAN copper horizontal distribution cable is 270 feet from the device location to the TR or security room termination point, no exceptions. This applies in particular to IP based cameras or IP based card readers. Where this length would be exceeded the contractor will need to add media converters or cable extenders as required.
 - 3. Security cabling is always installed in a home-run fashion with individual cables running from the device location all the way to the security room. Splices in horizontal distribution cable are not allowed.
 - 4. Factory-manufactured sweeps which meet ANSI/TIA/EIA569-A bend radius requirements shall be used for all security conduit. The bend radius of the sweeps must be a minimum of 10- times the internal conduit diameter. Bending conduit in the field using manual or mechanical methods is not acceptable. Standard electrical elbows shall not be used. This sweep radius is necessary to insure that the conduits can accept future cabling. All horizontal conduit will be tested by the conduit installation contractor with a mandrel to prove compliance with the sweep radius requirements throughout the conduit run
 - 5. Each security back box shall have an individual conduit routing to the security room, or to the pull box or pulling point, connecting to a major cable pathway routing to the security room. Box shall be located in serviceable space. Looping, or "daisy-chaining," of conduits between outlet boxes is not allowed.
 - 6. All conduit ends shall have plastic bushings installed before the cable is pulled into the conduit.
 - 7. Conduits will not be run next to hot water lines, steam pipes, or other utilities that may present a safety hazard or cause a degradation of system performance.

8. Conduits entering the Security Room should be designed and located allowing for the most flexibility in the routing and racking of cables.
 9. Conduits or conduit sleeves entering through the floor of the Security Room shall terminate four (4) inches above the finished floor.
 10. All metallic security conduits entering the Security Room, Equipment Room, or Entrance Facility shall be bonded together, and bonded to the Main Grounding Busbar with a #6 AWG ground cable.
 11. All in-use and spare conduits entering the Security Room, Equipment Room, or Entrance Facility shall be sealed to prevent the intrusion of water, gasses, and rodents throughout the construction project. Within five days of releasing the conduit for the installation of cable, the conduit installation contractor shall prove all conduits to be clean and dry.
 12. All conduits and cables that penetrate fire rated walls or floors must be fire stopped.
 13. All OSP conduits and inner-duct, used and spare, shall be plugged with watertight plugs at both ends to prevent the intrusion of water, gasses, and rodents throughout the construction project. All OSP conduits shall have pull lines rated at a minimum of 90 kg (200 lb) pulling tension installed. The pull lines must be re-pulled each time an additional cable is installed. Prior to releasing the conduit for the installation of cables, all OSP conduits must be cleaned with a brush pulled through the conduit at least two times in the same direction and swabbed with clean rags until the rag comes out of the conduit clean and dry. All OSP conduits must be tested with a mandrel to prove compliance with the sweep radius requirements throughout the conduit run. Within five days of releasing the conduit for the installation of cable, the conduit installation contractor shall prove all conduits to be clean and dry.
- B. Wire Mesh Cable Tray Supports
1. Fittings/Supports: Wire mesh cable tray fittings are field-fabricated from straight tray sections, in accordance with manufacturer's instructions. Supports will include the FAS (Fast Assembly System) where possible so that screws, bolts, and additional tools are not required for cable tray mounting; installation time is reduced; and tray path can adapt to installation obstacles without the need for additional parts. Place supports so that support span does not exceed that shown on the drawings.
 2. System support methods to mount from ceiling and wall structures with 1/4", 3/8" or 1/2" threaded rod, if applicable
 3. Splices, including those approved for electrical continuity (bonding), as recommended by cable tray manufacturer.
 4. Accessories: As required to protect, support, and install a cable tray system. Select from the following accessories, if applicable:
 5. Divider Strips, of same material and finish as cable tray.
 - a. 4 inch
 6. Cable Routing Accessories:
 - a. Dropout: Bolt to tray; slotted design.
 7. Support Accessories:
 - a. Connector to mount tray to unistrut.

- b. J-Bolt kit to mount tray to 19" racks.
 - 8. Wire Cable Hanging Support.
 - a. Wall Termination Bracket
 - b. Beam Supports:
 - 9. Grounding Clamp to ground cable tray.
 - 10. Supports will be sized at minimum to match the width of the wire mesh cable tray that is supported. The support may be wider than wire mesh cable tray.
 - 11. Support design will allow the support to be placed under a wire mesh cable tray at any point mid-span or directly under a pathway splice or intersection.
 - 12. Each support will be punched with an alternating obround and round hole-pattern that accepts wire mesh cable tray ends which are formed downward at 90° and self-threading splice plate attachment hardware.
 - 13. When placed directly under a splice or intersection, the support will allow drop-in attachment of cable tray. Splice hardware will simultaneously splice cable trays and secure wire mesh cable trays to the support.
 - 14. Supports will be manufactured from steel extrusion and/or sheet.
 - 15. Wire Mesh Cable Tray Supports will be zinc electroplated after fabrication.
- C. Wire Mesh Cable Tray Splices and Fasteners:
- 1. UL Classified cable trays (including painted tray) may act as Equipment Grounding Conductors.
 - 2. Use UL Classified splicing methods to ensure cable tray is electrically continuous and bonded as recommended by Cablofil.
 - 3. Ground cable trays at end of continuous run.
 - 4. Ground continuous cable tray runs every 60 feet.
 - 5. Test cable tray system per NFPA70B, Chapter 18 to verify grounding less than 1 ohm.
 - 6. Ground cable trays against fault current, noise, lightning, and electromagnetic interference by mounting grounding wire to each 10' cable tray section with grounding clamp.
 - 7. Provide a method of simultaneously splicing, bonding and securing intersecting wire mesh cable tray sections to supports when supports are placed directly under a wire mesh cable tray pathway at a splice point, intersection point, or at the beginning or end of a change in elevation.
 - 8. Provide a method of splicing and bonding wire mesh cable tray sections together at a splice point or an intersection point that is not located directly over a support.
 - 9. Provide a method for bonding and securing wire mesh cable tray to supports when supports are placed mid-span (in between a splice or intersection point) along a wire mesh cable tray pathway.
 - 10. Provide a method for attaching wire mesh cable tray directly to the top of racks and cabinets.
 - 11. Provide a method for attaching wire mesh cable tray supports to raised floor pedestals.
 - 12. Provide a method for attaching a bonding conductor to the wire mesh cable tray.
- D. Wire Mesh Cable Tray Accessories:

1. Provide a divider to separate cable tray into multiple pathways. The divider should be the same height as the sidewalls of the cable tray.
 2. Provide a cover for wire mesh cable tray. The cover should be sized to match the width of the cable tray.
 3. Provide a solid bottom for wire mesh cable tray. The bottom should be sized to match the width of the cable tray.
 4. Provide a bend radius to connect the sidewalls of adjoining wire mesh cable tray wherever a splice or an intersection in the cable tray pathway results in a 4" or wider gap between the sidewalls. The bend radius should be the same height as the sidewalls of the wire mesh cable tray.
 5. Provide a radius drop to form cable over a smooth curve wherever cable exits or enters the side, bottom or end of wire mesh cable tray.
 6. Wire mesh cable tray accessories will be manufactured from steel extrusion and/or sheet.
 7. Wire mesh cable tray accessories will be pre-galvanized before fabrication.
- E. Wire Mesh Cable Tray Installation Tools and Hardware :
1. Provide specialized cutting and forming tools required for field fabrication of wire mesh cable tray pathways.
 2. Provide specialized tools required for pulling cable around turns, bends or intersections in wire mesh cable tray pathway.
 3. Provide installation hardware to attach wire mesh cable tray supports to building structure.

PART 2 - PRODUCTS

2.1 INSIDE PLANT PULLBOXES

- A. Pull boxes used with security conduits in interior locations shall be rated NEMA-1. Pull boxes used in damp or wet locations such as plumbing chases or out of doors shall be rated NEMA-3R. Pull boxes shall be installed in conduits at an interval no greater than every 100 feet. A pull box shall be installed in conduit runs whenever there are two 90°sweeps, or a total of 180°of sweeps, in a conduit run. Any deviations from these criteria must have prior approval from HASC Facilities Construction.

2.2 CABLE PATHWAYS AND SUPPORT STRUCTURES

- A. The Inside Plant (ISP) security substructure are the cable pathways and support structures necessary for routing security cabling between security rooms, and from the security room to the device location. There are numerous different products and methods that can be employed to build the substructure. Some of these methods include: Enclosed conduit system, Open or enclosed cable trays, Routing above a false ceiling using cable supports, and in-slab floor ducts. Security cable pathways shall be separate from IT pathways whenever and where ever possible, if it is necessary to route security cabling in the same cable pathway as IT cables a metallic divider must be installed between the cables.
1. The conduit system shall be routed inside ceilings, floors, and walls to the greatest extent possible. Surface mounted conduit shall be used only when there is no other route to provide service to the desired location.

2. For the main floor in, "slab on grade constructed buildings", conduit will route in walls and ceilings not in or under the slab. If this design is not possible, an alternate must be presented and approved following the "Approval for Alternate Design Solutions" process detailed in section 27 01 00. If an under slab route solution is approved, the conduit must be installed with at least 1" of concrete encasement around all sides of the conduit.
3. All device locations shall have a minimum 1" conduit. Increase the conduit size as necessary for the quantity of cables to be installed. Cable fill shall not exceed 40% and plan on 25% growth.
4. Security cable and conduit shall maintain the minimum separation distance from power as listed below.
5. For power systems operating at 480V or greater, maintain a minimum separation distance of 3 m (10 ft) from all security cabling. Pathways should cross perpendicular to electrical power cables or conduits.
6. For large electrical motors or transformers, maintain a minimum separation distance of 1.2 m (4 ft) from all security cabling
7. For lightning protection system conductors (NEC 800-13), maintain a minimum separation distance of 1.8 m (6 ft) from all security cabling
8. For power systems operating at less than 480V, including all conduit and cables used for electrical power distribution, maintain a minimum separation distance of 0.6 m (2 ft) from all security cabling. Pathways should cross perpendicular to electrical power cables or conduits.
9. For fluorescent lighting, maintain a minimum separation distance of 12 cm (5 in) from all security cabling. Pathways should cross at right angles to fluorescent lighting.
10. For branch circuits (secondary) power (120/240V, 20A) where electric light or power circuits coexist with security cabling, maintain a minimum separation distance of 0.50 m (2 in).

PART 3 - EXECUTION

3.1 SUMMARY

- A. Final design and specifications for the Security Systems conduits shall be made by the Electrical Engineer and Architect of Record.
- B. Conduits shall be reamed to eliminate sharp edges. Metallic conduit shall be terminated with an insulated bushing. Refer to ANSI/TIA/EIA-606 and Section 27 05 53 for Administration of the Pathway system.
- C. The inside of the cable tray or wireway shall be free of burrs, sharp edges or projections that can damage cable insulation. Abrasive supports (e.g., threaded rod) shall have the portion within the tray protected with a smooth, non-scratching covering so that cable can be pulled without physical damage. When a wireway passes through a partition or wall, it shall be an unbroken length. Installation of telecommunications cables shall not exceed the fill requirements. Openings in fire-rated walls, floors and ceilings shall be properly firestopped. Barriers between power and telecommunications cables shall be installed per electrical code. Cable trays and wireways shall not be used as walkways or ladders unless specifically designed and installed for that purpose.

- D. Supports should be located where practicable so that connections between sections of the tray fall between the support point and the quarter section of the span. The support centers shall be in accordance with the load and span for the applicable class as specified in the electrical code. A support should be placed within 600 mm (2 ft) on each side of any connection to a fitting. Wireways shall be supported on 1500 mm (5 ft) centers unless designed for greater lengths.
- E. A minimum of 300 mm (12 in) access headroom shall be provided and maintained above a cable tray. Care shall be taken to ensure that other building components e.g., air conditioning ducts) do not restrict access to trays or wireways.
- F. When J-hooks are used in the ceiling area, conduits from the J-hooks to outlets or zones shall be provided unless otherwise permitted by code and specified.
- G. Provide #8 AWG wire and/or all-threaded rod for supporting hangers when hanging from floor deck and deck members. Refer to manufacturer recommendations for proper installation, sizing, and loading of hangers.
- H. All threaded rod shall be ½" diameter for supporting slotted channel under cable runway between floor deck and deck members. Refer to communications drawings for details. Threaded rod ends shall be filed to remove sharp edges and capped with plastic caps.
- I. Cables shall be neatly dressed along common paths with Velcro tie wraps. Maximum number of cables per bundle shall not exceed manufacturer specifications.
- J. Layout cable runs in advance to determine quantities of cable to be installed along pathways, and to ensure non-interference from other trade installations.
- K. Do not support cables from, or on, ceiling suspension system or use electrical, plumbing, or other pipes for support. Cable supports shall be permanently anchored to building structure or joist. Provide attachment hardware and anchors designed for the structure to which attached, and that are suitably sized to carry the weight of the cables to be supported. Confirm with Architect and/or Construction Manager on installation procedures for cable support system prior to implementation.
- L. Secure and support exposed horizontal cable at intervals not exceeding 4ft and not more than 16 inches from cabinets, boxes, fittings, outlets, racks, frames, and terminals.

3.2 MINIMUM CLEARANCES

- A. Communication Pathway minimum clearances from:
 - 1. Minimum of 1 foot parallel, 3 inches crossover from power cables and conduits.
 - 2. Minimum of 6 inches above ceiling tiles.
 - 3. Minimum of 24 inches Hot Flues, Steam pipes, Hot water pipes and other hot surfaces.
 - 4. Minimum of 3 feet separation from electrical panel boards.
 - 5. Minimum of 12-inches from fluorescent fixtures.
 - 6. Minimum of 6 feet separation from electrical motors and

transformers.

7. Minimum of 2-inches from exposed all-thread rods.

3.3 FIRE STOPPING

- A. Provide fire resistant materials to restore fire ratings to all wall, floor, or ceiling penetrations used in the distribution and installation for communications cabling system. Coordinate fire stopping procedures and materials with General Contractor and Electrical Contractor.
- B. Solutions and shop drawings/submittals for fire stop materials and systems shall be presented to the General Contractor for written approval of materials prior to purchase and installation.
- C. Materials shall be installed per manufacturer instructions, be UL listed for intended use, and meet NEC codes for fire stopping measures.
- D. The material chosen shall be distinctively colored to be clearly distinguishable from other materials, adhere to itself, and remain resilient and pliable to allow for the removal and/or addition of communication cables without the necessity of drilling holes in the material.
- E. The fire stopping material shall maintain/establish the fire rated integrity of the wall/barrier that has been penetrated.

END OF SECTION

SECTION 28 05 53
IDENTIFICATION FOR ELECTRONIC SAFETY AND SECURITY

PART 1 GENERAL

1.1 SECURITY ADMINISTRATION

- A. Administration of the security infrastructure includes documentation of cables, termination hardware, cross-connection facilities, conduits, other cable pathways, security rooms, and other security spaces. VA PD shall apply and maintain a system for documenting and administering the security infrastructure.
 - 1. In order to create a consistent environment, VAPD will maintain a facility wide numbering scheme for security devices and cable connectivity.
 - a. All security devices and cables shall be clearly marked using permanent means. The designation scheme must be consistent with the scheme in use on the campus where the work is being performed. The scheme shall be approved by VAPD and VA IT prior to use.
 - 1) Each individual cable shall be clearly marked on both ends.
 - 2) Multi conductor cables shall have each conductor clearly marked

1.2 RECORDS

- A. A record is a collection of information about or related to a specific element of the security infrastructure. Records must be maintained in a computer spreadsheet, or in a computer database. Paper records are encouraged, but are optional. A cable record is prepared for each cable. The record will show the cable name, and must describe the origin point and destination point of the cable. The cable record will record what services and/or connections are assigned to each conductor or strand. An equipment record is prepared for services distributed from a certain piece of equipment, such as a router, or a system such as data gathering panel.

1.3 DRAWINGS

- A. Drawings are used to illustrate different stages of security infrastructure planning, installation, and administration.
- B. Installation or Construction Drawings
 - 1. Installation or construction drawings are the plans that show the installer how the infrastructure is to be installed. The quality of the installation can be directly impacted by the level of detail in the installation drawings and written specifications. Installation drawings for VA projects shall, at a minimum, show pathway locations and routing, configuration of security spaces including backboard and equipment rack configurations, and wiring details including identifier assignments.
- C. As-built Drawings
 - 1. The as-built drawings graphically document the installed security infrastructure through floor plan, elevation, and detail drawings. In many cases, these drawings will differ from the installation drawings because of changes made during construction and specific site conditions. The identifiers for major infrastructure

components must be recorded on the as-built drawings. The pathways, spaces, and wiring portions of the infrastructure each may have separate drawings if warranted by the complexity of the installation, or the scale of the drawings. As-built drawings are a vital component of the security administration system, and must be kept current as adds, moves, and changes take place. VA requires the installer to provide a complete and accurate set of as-built drawings.

1.4 LABELING

- A. To be consistent with ANSI/TIA/EIA standards and industry practices, it is important that labeling be applied to all security infrastructure components. Labeling with the unique identifier will identify a particular component.
- B. Labels are generally of either the adhesive or insert type. All labels must be legible, resistant to defacement, and maintain adhesion to the application surface.
 - 1. Outside plant labels shall be totally waterproof, even when submerged.
 - 2. All labels shall be machine printed.
 - 3. Labels applied directly to a cable shall have a clear vinyl wrapping applied over the label and around the cable to permanently affix the label.
 - 4. Other types of labels, such as tie-on labels, may be used. However, the label must be appropriate for the environment in which it is used, and must be used in the manner intended by the manufacturer.

PART 2 - PRODUCTS

2.1 LABELS

- A. Shall meet the legibility, defacement, exposure and adhesion requirements of UL 969.
- B. Approved Manufacturer:
 - 1. Brady Corporation
 - 2. Panduit
 - 3. Equivalent

2.2 LABELS

- A. Shall meet the legibility, defacement, exposure and adhesion requirements of UL 969.
- B. Shall be preprinted or computer printed type. Hand written labels are not acceptable.
- C. Where insert type labels are used provide clear plastic cover over label.
- D. Approved Manufacturer:
 - 1. Brady Corporation
 - 2. Panduit
 - 3. Equivalent
- E. Equipment Room Copper, Fiber, and Coax Backbone Cable Labels
 - 1. Brady part #WML-1231-292 or Panduit #LS7-75NL-1
- F. Equipment Room Copper, Fiber, and Coax Horizontal Cable Labels

1. Brady part #WML-317-292 or Panduit #LS7-75NL-1
- G. Work Area Copper, Fiber, and Coax Riser Cable Labels
 1. Brady part #WML-317-292 or Panduit #LS7-75NL-1
- H. Patch Panel Labels
 1. Brady part #CL-111-619 or Panduit #LS7-38-1

PART 3 - EXECUTION

3.1 IDENTIFICATION and LABELING

- A. All labeling will be compliant with TIA/EIA 606-A - Administration Standard for Commercial Telecommunications Infrastructures and comply with VA Labeling Standards.
- B. All labeling must be coordinated with VA prior to start date.
- C. The size, color, and contrast of all labels should be selected to ensure that the identifiers are easily read. Labels should be visible during the installation of and normal maintenance of the infrastructure.
- D. Labels should be resistant to the environmental conditions at the point of installation (such as moisture, heat, or ultraviolet light), and should have a design life equal to or greater than that of the labeled component.
- E. All labels shall be printed or generated by a mechanical device.

END OF SECTION

SECTION 28 06 00
TESTING FOR ELECTRONIC SAFETY AND SECURITY

PART 1 - GENERAL

1.1 SECTION INCLUDES

- A. Deliverables
- B. Test Procedures
- C. Field Quality Control
- D. Manufacturer's Field Services
- E. Demonstration

1.2 DELIVERABLES

- A. It is essential for Department of Veteran Affairs Police Department to receive all test results and as-built drawings prior to job acceptance. The test results must adhere to the following specifications, formats and delivery conditions:

- 1. Specifications

- a. Complete end-to-end test results for all copper STP, UTP and fiber optic cables installed are required.

- 1) All fiber optic cable must be visually inspected and optically tested on the reel upon delivery to the installation site. Using an Optical Time Domain Reflectometer (OTDR), an access jumper with like fiber, a pigtail, and a mechanical splice, all fibers shall be tested for continuity and attenuation. Testing for continuity and attenuation on the reel must confirm factory specifications to ensure that the fiber optic cable was not damaged during shipment. The test results must match the results of the factory-attached tag on the reel, or the fiber shall not be used. Reel data sheet must be provided showing test results.
 - 2) End to end (bi-directional) test measurements shall be provided for single mode and multimode fibers (2 wave lengths per test are required). Test results must be submitted for review as part of the installation inspection requirements. Test results shall be in paper form and electronic form, and must contain the names and signatures of the technicians performing the tests.
 - 3) Testing shall be performed on 100% of the fibers in the completed end-to-end system. ANSI/TIA/EIA-568-A, Annex H, provides the technical criteria and formulae to be used in

fiber optic testing. Note however, that all UNT fiber must be tested, rated and guaranteed for Ethernet 1000B-X performance. Additionally, all fiber optic cable links must pass all installation and performance tests both recommended and mandated by the cable manufacturer.

- 4) 100% of all pairs of copper cables shall be tested for continuity and wire-map.

2. Format

- a. Test Results must be submitted in both hard and soft copy in a format previously agreed to by the client.
- b. As Built drawings must be submitted with .dgn or .dwg file extensions.

3. Delivery

- a. Test Results must be both hard copy and electronically submitted to the VA PD. Contact information will be provided after contract is awarded and before project completion.

PART 2 - PRODUCTS (NOT APPLICABLE)

PART 3 - EXECUTION

3.1 TEST PROCEDURES

- A. Install in accordance with manufacturer's instructions.
- B. Field Test Reports: Upon completion and testing of the installed system, test reports shall be submitted in booklet form and electronic media showing all field tests performed on, and adjustments made to each/any component and all field tests performed to prove compliance with the specified performance criteria. Indicate and interpret test results in written form and verbally to owner/consultant for compliance with performance requirements at a pre-scheduled meeting.

1. Specific test and verification requirements by demonstration or test are as follows. Owner reserves the right to witness any and all tests.
 - a. Following factory assembly and delivery, the security subcontractor shall individually test each component and sensor and verify the proper functioning of each component within a particular sub-system.
 - b. Following installation, individually test each component and sensor and verify the proper functioning of each component within a particular sub-system. Similarly test each sub-system until all detection zones, alarm assessment components, alarm reporting

and display, and access control functions have been verified. Prior to final functional and operational tests of the system correct any deficiencies. After sub-system verification is complete, test the entire system to assure that all elements are compatible and function properly as a complete system.

- c. Upon completion of the above outlined tests conduct a formal test to be known as the "System Operational Test", in which all components and sub-systems of the security system are demonstrated to operate together as a system. This test is to be performed over a continuous seventy-two (72) hour period. A formal test plan and test procedures for each portion of the test shall be prepared by the security subcontractor and submitted to the Owner/Architect for approval. The subcontractor must demonstrate that the security system components and sub-systems meet specification requirements in the "As-Installed" operating environment during the "System Operational Test". While no formal environmental testing is required, temperature, humidity and other environmental parameters should be measured and recorded. Include this data in the test report document for the "System Operational Test".

3.2 FIELD QUALITY CONTROL

- A. Perform field inspection and testing in accordance with Section 28 00 00.

3.3 MANUFACTURER'S FIELD SERVICES

- A. Include services of technician to supervise installation, adjustments, final connections, system testing, and to train VA PD personnel.

3.4 DEMONSTRATION

- A. Demonstrate normal and abnormal modes of operation, and required response to each.
- B. Provide 8 hours of instruction each for two persons.
 1. Conduct instruction at project site with manufacturer's representative.

- - - E N D - - -

SECTION 28 13 00
ACCESS CONTROL

PART 1 - GENERAL

1.1 SECTION INCLUDES

- A. Security access and monitoring devices.
- B. Access control panels.

1.2 RELATED SECTIONS

- A. Section 08 71 00 - Door Hardware.
- B. Section 28 05 00 - Common Work Results for Electronic Safety and Security
- C. Section 28 05 26 - Grounding and Bonding for Electronic Safety and Security.
- D. Section 28 05 28 - Pathways for Electronic Safety and Security.
- E. Section 28 05 53 - Identification for Electronic Safety and Security.
- F. Section 28 06 00 - Testing for Electronic Safety and Security.
- G. Section 28 23 00 - Video Surveillance.
- H. Department of Veteran Affairs Security System Standards (latest edition)
- I. Conduit, cable tray and back boxes for this system shall be furnished and installed by the electrical contractor under the supervision of the security contractor.
- J. See Division 26 for all information relating to the fire alarm system and required relay interface to release emergency delay exit doors. The fire alarm integrator shall provide the control relays as required.
- 1. See Division 26 for all specifications governing the performance of work associated with the installation of raceway, system junction and pull boxes and device rough-in boxes for all work shown in the Access Control System refer to the TY series security drawings.

1.3 REFERENCES

- A. EIA/TIA-569 Standard, Commercial Building Standard for Telecommunications Pathways and Spaces.
- B. EIA/TIA-607 Commercial Building Grounding and Bonding Requirements for Telecommunications
- C. National Electrical Code (NEC) (Latest revision and pertinent addendums)

- D. National Fire Protection Association (NFPA) Publications (Latest revisions and pertinent addendums)
- E. Americans with Disabilities Act (ADA)
- F. NFPA 101, National Fire Protection Association
- G. NFPA -70, National Fire Protection Association
- H. UL 294, Underwriter's Laboratories Access Control Systems
- I. UL 1037, Underwriter's Laboratories Anti-Theft Alarms and Devices
- J. UL 1076, Underwriter's Laboratories Propriety Burglar Alarms Units and Systems
- K. EIA-RS-170 Broadcast Standards
- L. NTSC Color System Standards
- M. Building Officials and Code Administrators International, Inc. (BOCA) National Building Code
- N. Uniform Building Code (UBC)
- O. Local Governing Authorities Having Jurisdiction
- P. FIPS-201 Personal Identity Verification (PIV) of Federal Employees and Contractors
- Q. HSPD-12 Policies for Common Identification Standard for Federal Employees and Contractors

1.4 SYSTEM DESCRIPTION

- A. Security Access System: Control access to building using FIPS encoded cards:
 - 1. FIPS card access system controlling selected Interior and exterior doors: Control and monitoring of access into and within the building.
- B. The contractor shall provide all materials, equipment, labor and all other incidental material, tools, appliances and transportation as required for a complete and functional Access Control System Electronic Security System (ESS) as described herein and including supplementary drawings.
- C. General elements of the work shall consist of but not limited to:
 - 1. Procure all permits and license required to complete this installation.
 - 2. Submission of Schedule of Values for all equipment, materials and labor.

3. Attend pre-construction/pre-submittal meeting with Owner and Security Consultant to review design package for security and finish hardware.
4. Submit all equipment, materials and processing prior to ordering equipment.
5. Attend finish hardware submittal review meeting.
6. Coordination of conduit system, raceway and power distribution provided by Division 26 contractors.
7. Coordination with all trades and Owner representatives as required facilitating the installation of the security equipment including: Divisions 8 Door Hardware, Division 13 Fire Alarm and Division 26 Electrical.
8. Provide security system sensors, initiating devices, cable, connectors, wiring, equipment enclosures and all other materials necessary to complete the security system per the design documents.
9. Verify conditions and dimensions at the job site prior to installation.
10. Attend finish hardware pre-installation meeting (Low Voltage Meeting).
11. Perform installation according to contract documents and manufacturers recommendations.
12. Protect new facilities finishes and equipment.
13. Maintain construction materials and refuse within the area of work.
14. Clean the work area at the end of each day.
15. Coordinate all system programming and point naming convention with Owner.
16. Perform initial testing and adjustments with written reports.
17. Make final adjustments and calibrations as directed by the Owner and Security Consultant.
18. Demonstrate all systems and component operations for final acceptance.
19. Preparation of O&M manuals and as-built documents for Owner's use.
20. Provide training for Owner's security staff, facility personnel and technical staff.
21. Provide warranty service for a period of one year from acceptance date.
22. Provide extended maintenance service.

23. All equipment and materials for the system will be compatible to ensure correct operations outlined in FIPS 201, March 2006 and HSPD-12.

D. General:

1. Designated interior and exterior doors shall be controlled and monitored by local intelligent data gathering panels which report to the building central alarm monitoring and control system as well as the security station. Work per this section shall include the installation of door status switches, end of line supervision modules, wireways, card reader wiring and other required connecting wiring. The contractor shall provide and install intelligent data gathering panels, necessary support equipment with programming, card reader heads and make necessary connections to the security head-end.
2. Designated exterior doors shall be provisioned with NFPA 101 compliant emergency delay exit doors. Work per this section shall include extending the alarm signal to the security head-end panel including; end of line supervision modules, wireways and other required connecting wiring. The Contractor shall provide and install intelligent data gathering panels, necessary support equipment with programming and make necessary connections to the security head-end.

1.5 SECURITY SYSTEM

- A. This Section specifies the requirements for the Access Control system for the Expansion & Renovation of Building 108 for Mental Health.
 1. The work detailed by these specifications and drawings has been specified to meet certain requirements for performance. Some information, such as exact equipment layout, wire routing, additional conduit and power requirements, etc. has been omitted. It shall be the responsibility of the Contractor to translate these specifications and drawings into a complete design package containing all necessary elements for a complete turnkey installation including all material, labor, warranties, shipping and permits.
 2. Work shall include the installation and commissioning of the following:
 - a. Electronic Security System (ESS) consisting of:

- 1) Battery backup lock power supplies with fire alarm interface
 - 2) Interface to electrified door hardware
 - 3) Infrastructure for card access control doors
 - 4) Access Card printers
3. Work to include, but not limited to the following:
- a. Installation of electrical power and signal surge and transient protection devices for the ESS head-end.
 - b. Contractor shall provide continuous on-site supervision of the installation technicians. On-site supervision shall include: daily supervision of the work, updating work site progress drawings to reflect changes and installations details, maintaining the site engineering drawings to maintain a continuous record of work progress and as-built work, preparing weekly progress reports and attendance at site coordination meetings as directed by the Owner and Security Consultant.
 - c. Provide evidence of the site supervisor's qualifications and work history in the proposal.
 - d. The Contractor shall provide continuous engineering and programming support during the installation as required to accommodate existing conditions and unforeseen conditions that may arise during performance of the work.
 - e. The Contractor shall provide all miscellaneous hardware including cable management devices, termination cabinets, wire and cable labeling materials, fasteners, hangers and brackets as required.
 - f. The contractor will coordinate the delivery and storage of all materials, wire, cable, equipment and miscellaneous hardware.

1.6 SUBMITTALS

- A. See Section
1. Section 01300 - Administrative Requirements, for submittal procedures.
 2. Section 280500 - Common Work Results For Electronic Safety and Security for submittal procedures.
- B. Shop Drawings: Provide system wiring diagram showing each device and wiring connection required.
- C. Product Data: Provide electrical characteristics and connection requirements.

- D. Test Reports: Indicate satisfactory completion of required tests and inspections.
- E. Manufacturer's Installation Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation, installation, and starting of product.
- F. Project Record Documents: Record actual locations of access authorization equipment.
- G. Operation Data: Operating instructions.
- H. Maintenance Data: Maintenance and repair procedures.
- I. The submittal shall be a detailed response describing methods, procedures and specific equipment proposed to conform to the system design detailed in these documents.
- J. Submittals shall consist of product data, shop drawings, samples and detailed completion schedules.
- K. Partial submittals shall not be acceptable without prior approval by Owner.
- L. No portion of the work shall commence or equipment ordered until the Owner has approved the submittals.
- M. The Contractor shall not be relieved from any contract-required responsibility by the Owner's approval of submittals.
- N. Nothing in the specification shall relieve the Security Contractor of delivering a functioning turnkey security system responsibility.

1.7 SUBMITTAL REQUIREMENTS

- A. Product Data
 - 1. Provide Submittals no less than 10 working days after notice to proceed.
 - 2. Submit data in 3-ring binder divided into separate section (Access Control, Video Surveillance, etc.) for each system.
 - 3. Equipment lists and equipment data sheets shall be 8.5" x 11" in size.
 - 4. Each section to include the following:
 - a. List all system components with an assigned item number, manufacturer, model number and quantities of each.
 - b. Manufacturer's literature sheets for all materials and equipment, including warranty information and recommended preventative maintenance and spare part inventory recommendations. Literature

containing more than one device shall be clearly marked to delineate item(s) included in the work.

- c. Clearly indicate color or special finishes.
 - d. Cable types including manufacturer's verification and acceptance information.
5. General functional description of each system including:
- a. Description of operating systems and application software.
 - b. Power requirements and UPS sizing.

B. Schedule of Values

1. Contractor shall submit in addition to Division 1 requirements, a Schedule of Values, which includes itemized listing of all equipment, materials and labor required for the installation of the ESS as specified herein for Change Order pricing. Listing shall contain: assign item number, item description, item model number, item quantity, unit cost and extended labor, material and installation cost to provide a complete and functional security system. Submit in electronic format (Microsoft Excel).

C. Shop Drawings

- 1. Provide Shop Drawings no less than 25 working days after notice to proceed.
- 2. Reproducing Contract Documents for shop drawing is not acceptable.
- 3. Submit 3 complete sets of shop drawings along with CD-ROM copy to the Security Consultant.
- 4. Produce all shop drawings on latest version of AutoCAD.
- 5. Shop drawings to include the following:
 - a. Drawing legend sheet describing all symbols used on the drawings.
 - b. Floor plans with all device locations and wiring.
 - c. Wire runs to include tags for type, gauge, quantities and cable identifiers.
 - d. System riser diagram indicating all field devices, riser paths and room designations.
 - e. Block diagram for each system showing: all equipment, interconnections, network connections and data flow.
 - f. Point schedule-defining interconnection of all inputs and outputs for all equipment including fire alarm interface, data connections and other systems.

- g. Schedule of device power requirements, power source and load calculations.
 - h. Elevations of equipment racks with new equipment.
 - i. Elevations of electrical closet(s) with security panel, termination enclosure, wire management, lock power supply(s), UPS, and power routing, etc.
 - j. Fabrication shop drawings for all custom equipment.
- D. Samples
- 1. Upon specific request of the Owner and Security Consultant, submit samples of any proposed devices.
- E. Resubmitting
- 1. Make corrections or changes in Submittals as required by the Security Consultant's stamped instructions and attached comments and resubmit.
 - 2. Identify changes on resubmittals by clouding. Only indicated changes will be reviewed when resubmitted.
 - 3. Added drawings shall be clearly identified.
 - 4. Contractor shall be responsible for project delays caused by rejected submittals.
 - 5. Security Consultant shall be compensated for additional services for submittals rejected more than twice. The amount of such compensation shall be incorporated by change order and withheld from the Contractor's Application for Payment.

1.8 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.
- B. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience and with service facilities within 100 miles of Project.
- C. Installer Qualifications: Company specializing in installing the products specified in this section with minimum three years documented experience.
- D. Products: Furnish products listed and classified by Underwriters Laboratories Inc. as suitable for purpose specified and indicated.
- E. Contractor Qualifications
 - 1. An experienced Contractor shall perform the installation. Contractor shall have at least 3 years experience in the installation of security systems of similar size and scope.

2. The installation shall be performed by a Contractor licensed by the Texas Board of Private Investigators and Private Security Agencies and shall be bonded and insured.
3. All installation personnel shall also be licensed as required by local and/or state jurisdictions.
4. Contractor shall provide all licensing documentation as part of the bid.
5. Owner's representative may make such investigations as deemed necessary to determine that the Contractor is responsive, responsible and qualified in the area of work contemplated by the contract. In this regard, the security system installation firm shall furnish to the Owner such information and data as shall be requested for this purpose. Information and data may include (but not necessarily be limited to): Date of organization and/or incorporation and number of years engaged in this business under present firm's names; list of major equipment owned by the company; list of principal personnel who will be involved in the execution of this contract with the experience and qualifications of each person.
6. The Contractor shall provide a project manager that shall be constantly in charge of the ESS installation. The project manager shall be the same person authorized to make decisions and answer questions asked by the Architect and Owner Representatives. The project manager shall also be responsible for system programming, preparation of Operation and Maintenance Manuals, Training, Programs, Schedules and Test Protocols, documentation of system testing, maintenance of Record Drawings and coordination and scheduling of all labor.
7. Provide evidence of site supervisor's qualifications and work history
8. Contractor shall be or have direct relations through their subcontractors, and authorized manufacturer's representatives for all products they furnish or install.
9. Provide documentation that the Contractor and or subcontractor are factory certified to install, program, train and repair all major components or systems to be used in the project.
10. Contractor shall have a local organization capable of providing maintenance and service for the specified system. Facility shall be

no more than 100 miles from Owner's site. The security system installation firm shall be capable of providing emergency service on a 24-hour, 7 days a week basis.

1.9 PRODUCT STANDARDS

- A. The Contractor will provide all materials, equipment and installation in compliance with the latest applicable standards from ANSI, FCC, ASTM, EIA/TIA, IEEE, NEC, NFPA, NEMA, REA and UL including but not limited to:
1. EIA/TIA-569 Standard, Commercial Building Standard for Telecommunications Pathways and Spaces.
 2. EIA/TIA-607 Commercial Building Grounding and Bonding Requirements for Telecommunications
 3. ANSI T1.404 (DS3) and CATV Applications
 4. National Electrical Code (NEC) (Latest revision and pertinent addendums)
 5. National Fire Protection Association (NFPA) Publications (Latest revisions and pertinent addendums)
 6. Americans with Disabilities Act (ADA).
 7. In the event of any conflicts between documents referenced herein and the contents of this specification, the Contractor shall notify in writing to Engineer of any such occurrences before the purchase of any equipment, materials and/or installation by the Contractor. The Engineer will notify the Contractor of any actions required to resolve these conflicts. Such actions may include but are not limited to: design changes, equipment, materials and/or installation changes. In any event Contractor shall not supersede specifications and standards from the latest NFPA and NEC publications.
- B. All equipment, materials and articles incorporated in the work covered by this contract are to be new and unused.
- C. The contractor shall provide at installation time the latest current standard model and/or version of all equipment (hardware and software).

1.10 MAINTENANCE SERVICE

- A. Furnish service and maintenance of security access system for one year from Date of Substantial Completion.

1.11 EXTRA MATERIALS

- A. See Section 01600 (01 6000) - Product Requirements, for additional provisions.

PART 2 - PRODUCTS

2.1 GENERAL

- A. Manufacturer's name and model numbers are given in the specifications for the purpose of establishing a standard of performance, quality, style, size and type and shall not be construed as limiting competition unless otherwise noted "No Exceptions".
- B. These specifications list approved equipment types and items. In instances where quantities are not detailed, they shall be obtained from the drawings.
- C. Substitutions will only be considered if they are specifically requested in writing and include shop drawings and manufacturer data sheets. The contractor represents that they have personally investigated the proposed substitute and have determined that it is equal or superior in all respects to the equipment originally specified and that similar guarantees apply. This includes Original Equipment Manufacturer's model number changes.

2.2 MANUFACTURERS

- A. Security Access System Software:
 - 1. Department of Veteran Affairs Police Department approved software.
- B. Security Access System Computer Hardware:
 - 1. Host Controller: Locate in new MTC
 - 2. Client Workstation: Locate per Owner
- C. Card Readers:
 - 1. FIPS compliant Reader.

2.3 COMPONENTS

- A. Field devices and infrastructure for card access control of specified doors.
- B. Duress buttons with connecting wiring
- C. Common equipment location with mounting board, support equipment, wire management, power and fire alarm signal
- D. Lock power supplies
- E. Wiring termination enclosure
- F. Field and cross connect wiring and terminations to be terminated in the security monitoring and control equipment including, but not limited to:
 - 1. Card reader head

2. Electric lock
3. Door position switch
4. Request to exit signal switch
5. Delay exit system alarm
6. Enclosure tamper
7. Low battery alarm
8. Power failure alarm
9. Duress button

2.4 TECHNICAL SPECIFICATIONS

A. Tamper Switch

1. Provide a tamper switch to sense the opening of all security equipment enclosures
2. Plunger type actuator sensor
3. Switch configuration normally closed when enclosure door is shut.

B. Electric Lock Power Distribution System

1. Provides lock power and fire alarm system door release interface.
2. Individual fused circuit protection for each electric lock output.
3. Lock release trigger input is activated through normally open (NO) or normally closed (NC) supervised inputs or polarity reversal outputs from the Fire Alarm Panel.
4. Size for 150% of actual load.
5. Output voltage coordinated to match electric locks
6. Minimum NEMA 1 wall mounted enclosure with key locking hinged cover and tamper switch.

C. Battery Back-Up Auxiliary Device Power Distribution System

1. Individual fused circuit protection for each security device feed.
2. Size for 150% of actual load.
3. Size battery for 4 hours of reserve power
4. Minimum NEMA 1 wall mounted enclosure with key locking hinged cover and tamper switch.

D. Concealed Door Switch

1. Switch shall sense open or closed-door status.
2. Rhodium plated contacts are hermetically sealed
3. Switch configuration to be SPDT
4. 10,000,000 operations rated life
5. Gap make distance greater than 7/8"
6. 12"minimum #22 wire leads

7. UL listed

E. End of Line Supervision Module

1. Provides 4 state supervision
2. Coordinate exact value with Owner.
3. Screw terminal wiring terminations

F. Wiring Termination Enclosure

1. NEMA Type 1 enclosure
2. 14 gauge steel construction
3. Surface mounted installation
4. Hinged key locking door with tamper switch
5. Polyester powder coated finish inside and out
6. Includes door tamper switch
7. Labeled screw terminal plug strips and/or BNC male plugs
8. Isolated ground buss bar with screw wiring terminations

2.5 WIRE AND CABLE

A. Minimum Specifications:

1. All wire and cable shall be: UL approved, meet all national, state and local codes, and manufacturers recommendations for connected components for its intended application.
2. Plenum rated cable shall be used in all return air plenum spaces and where required by code.
3. Insulation shall be rated for a minimum of 300 volts.
4. Conductors shall be 100% copper.
5. Cable shall be shielded where required by equipment manufacturer.

B. Minimum wire types and sizes:

1. Low Voltage Power Cable - 14 to 18 AWG, twisted, stranded CL2P.
AWG based on supplied current and distance.
2. Alarm Point Monitoring Cable - 20 AWG, twisted, stranded CL2P
3. Card Reader Cable Category 6 as specified in Division 27.
4. UTP Video Cable - CAT6
5. Control Point Cable - 18 AWG twisted, stranded CL2P
6. Acceptable Manufactures
 - a. Belden
 - b. Commscope
 - c. West Penn

PART 3 - EXECUTION

3.1 INSTALLATION

- A. This section covers the general requirements for the installation of the security system by the Contractor.
- B. Install in accordance with manufacturer's instructions.
- C. Use 16 AWG minimum size conductors for detection and signal circuit conductors. Install wiring in pathway provided by electrical i.e. conduit and or cable tray.
- D. Make conduit and wiring connections to door hardware devices furnished and installed under Section 08710 (08 7100).

3.2 GENERAL

- A. The Contractor shall be responsible for providing all wire and cable as required for complete and operational system.
- B. All cables must be continuous runs from device location to the final point of termination. No mid run cable splices will be allowed.
- C. Make connections and splices with solderless devices mechanically and electrically secure in accordance with manufacturer's recommendations.
- D. The cable installation techniques shall be such that the mechanical and communications characteristics of the cables are not degraded at the time of installation. Any special environmental requirements for equipment shall be specified.
- E. Distribution of the cabling will be accomplished through cable trays, cable runways, conduit raceways, ducts, core holes, extended columns, false half columns and plenums. Cabling shall be run at right angles. Horizontal cable segments will be placed in cable trays and when they leave cable trays will be supported by distribution rings or J-hooks. Where cables converge at equipment room locations, they will be supported by cable runways and distribution rings. All cable placements shall be based on the enclosed drawings.
- F. The contractor shall not place security wiring in the same conduit or raceway with wire for electrical power distribution.
- G. Connectors to all devices in system shall be protected against moisture. Approval of the method shall not relieve the contractor of full responsibility for proper application and workmanship of the materials in the manner specifically approved. All connector threads shall be treated with an approved silicone lubricant.

- H. The Contractor shall be responsible for providing an approved ground and ground bus bars at all newly installed systems insuring proper bonding to telecommunications facilities. The Contractor shall also be responsible for ensuring ground continuity by properly bonding all appropriate cabling, closures, cabinets, service boxes, and framework. All grounds shall consist of a minimum 6 AWG copper wire and shall be supplied from an approved building ground and bonded to the main electrical ground. Contractor must notify the Owner prior to making any changes in submitted system design and/or installation.
- I. All exposed J-boxes or enclosures shall have tamper resistant features and hardware. Tamper resistant fasteners to be Tamper-Proof pin-in-hex or pin-in-torx button head screws.
- J. Additional requirements as follows:
1. Use of common wires for input or output circuits is not allowed.
 2. Configure all zones to be normally closed loop with an end of line resistor (EOL) at the most distant point of the zone.
 3. The Contractor shall obtain Owner's permission before proceeding with any work necessitating cutting into or through any part of building structures such as girders, beams, concrete or tile floors and partition ceilings.
 4. The Contractor shall exercise reasonable care to avoid any damage to Owner's property. Contractor shall be responsible for and repair all damage due to carelessness of workers. Contractor will report to Owner any damage to the building, which may exist or may occur during the occupancy of the quarters.
 5. The Contractor shall be responsible for proper electrical grounds.
 6. The Contractor shall take necessary steps to ensure that required firefighting apparatus is accessible at all times. Flammable materials shall be kept in suitable places outside the building.
 7. The Contractor shall install the materials in accordance with the manufacturers' specifications.
 8. The Contractor shall promptly correct all defects for which the Contractor is responsible.
 9. The Contractor shall insure that all records and reports, City relations, engineering, metering, inspections, testing, quality or service standards and safety measures comply with standards applicable for the State of Texas.

10. The Contractor shall coordinate all work with Owner's designated representative.
11. The Contractor shall maintain a work area free of debris, trash, empty cable reels, scrap wire, etc., and dispose of such items on a daily basis.
12. All work shall be done in a thorough and conscientious manner according to industry standards and shall be subject to inspection and acceptance.
13. The Contractor shall be certain that all installation work areas are secure and made safe in accordance with Occupational Safety and Health Administration (OSHA) regulations.
14. The installation crew should include at least one installation supervisor, or lead technician, for on-site management of the project at all times.
15. The Contractor shall be responsible for completing a standardized report form addressing the weekly progress of the installation schedule.
16. The Contractor shall maintain conductor polarity in accordance with industry practices.
17. The Contractor shall provide any necessary screws, anchors, clamps, tie wraps, distribution rings, miscellaneous grounding and support hardware, etc., necessary to facilitate the installation of the distribution system.
18. The Contractor shall be responsible for labeling all cable, distribution devices, enclosures and outlet locations, according to industry standards. Numbering scheme shall be coordinated with Owner's representative before installation.
19. It shall be the responsibility of the Installation Contractor to furnish any special installation equipment or tools necessary to properly complete the installation.
20. The Contractor shall not roll or store cable reels without an appropriate underlay.
21. The Contractor shall not place any distribution security cabling alongside power lines, or share the same conduit, channel or sleeve with electrical apparatus.
22. The Contractor shall insure that the maximum pulling tensions of the specified distribution security cables are not exceeded at any time

- during the placement facilities. Failure to follow the appropriate guidelines may require the Contractor to provide additional material and labor necessary to properly rectify the situation. This shall also apply to any and all damages sustained to the cables by the installation Contractor during the implementation.
23. The Contractor shall be responsible for testing all cable prior to the installation of the cable. If the Installation Contractor fails to perform this testing operation, the Installation Contractor shall accept the cable as good and assume all liability for the replacement of the cable should it be found defective at a later date.
 24. The Contractor shall plug conduits where cabling has been installed by the Installation Contractor in all equipment rooms and other cable entrance locations with re-enterable duct seal of flame retardant putty.
 25. Materials shall be consistent throughout the building. Where two or more units of the same class of equipment are required, these units shall be the product of a single manufacturer and shall be the same product with the same material, model, and manufacturer number.
 26. Wiring, materials, and equipment will be delivered and stored in a clean dry space. They will be properly packaged in factory fabricated type containers and protected from damaging fumes, construction debris and traffic until job completion.
 27. The wiring, materials, and equipment furnished for this request shall be essentially the standard product of the manufacturer.
 28. All wiring, materials, and equipment must be listed and labeled by a nationally recognized testing laboratory.
 29. All installation techniques and fixtures shall result in ease of maintenance and ready access to all components for testing measurements. All external screws, nuts, and locking washers shall be stainless steel. No self-tapping screws shall be used unless specifically approved by Owner. All parts shall be made of corrosion resistant material, such as plastic, anodized aluminum or brass. All materials used in installation shall be resistant to fungus growth and moisture deterioration.

30. An inert dielectric material shall separate dissimilar metals apt to corrode through electrolysis under the environmental operating conditions specified.
31. The cable pulling operation shall be performed such that a minimum bending of the cable shall occur in the unreeling and pulling operations. The pulling tension shall not be allowed to exceed the maximum tension specified by the manufacturer of the cable.
32. Jacketing and insulation shall satisfy the Underwriters Laboratories (UL) listed fire rated cable insulation requirements in plenum areas.
33. Any pulling compound or lubricant used in cable installation shall not deteriorate the conductor or the insulation.
34. Parts and components not specifically mentioned in these specifications, which are required to provide a complete unit, shall be included as a part of the equipment to be furnished.
35. Nothing in the specification shall relieve respondents of system package design responsibility, including, but not limited to, all equipment furnished under this contract. The successful respondent is, in all cases, solely responsible for the performance of the delivered system, and for furnishing complete system documentation for each and every part of the system.

3.3 WEEKLY CONSTRUCTION MEETING

- A. The Security Consultant and/or Owner will hold weekly construction meetings to review the installation schedule. It is mandatory that the Contractor's project manager attend each meeting.

3.4 SITE INSPECTION

- A. Continuously verify that the site conditions are in agreement with the Contract Documents and the security system design. Notify Owner's representative immediately of conditions that affect the performance of the installed system.
- B. Coordinate any required work that is not specified in the Contract Documents.

3.5 COORDINATION

- A. Adequate conduit and back boxes are provided for the specified system installation.
- B. Verify value of end of line supervision module with Owner.
- C. Adequate power has been provided for the specified system installation.

1. Verify mounting location of all devices with Owner prior to installation.
2. Attend finish hardware pre-installation meeting (Low Voltage Meeting) to coordinate hardware provided and work performed by: Hardware installer, Door and Frame installer, Automatic operator installer, and Electrical subcontractor.

3.6 IDENTIFICATION, LABELING AND DOCUMENTATION

- A. The Contractor shall label all termination devices, panels, enclosures and equipment rooms. The Contractor will mark each unit with permanently attached markings that will not impair the equipment or present a hazard to maintenance personnel.
- B. Place wire identification numbers on each end of all conductors by using sleeve type heat shrinkable markers. Install markers to be readable from left to right or top to bottom. Wire numbers shall be computer printed (Brady TLS2200 with Permasleeve cable marking labels or equivalent). Hand written labels are not acceptable.
- C. Mark all spare conductors.
- D. If changes occur prior to acceptance testing altering the documentation previously furnished, the contractor shall formally update and reissue the relevant documentation to the Security Consultant and Owner.
- E. Security Consultant and Owner will review all documentation for accuracy and completeness and may reject substandard submittals.
- F. The Contractor shall establish and maintain complete system documentation, including documentation procedures, operational information, configuration information, historical records, and drawings. Documentation shall include the following:
 1. Floor plan drawings indicating device locations, unique system point numbers with device legends indicating manufacturers and model numbers for each device.
 2. The unique system point number of a device shall identify either through the software or hardwire connection, the specific device or group of devices associated with the unique point number in the system.
 3. Floor plan drawings indicating conduit and wire routing and junction box locations.
 4. Wire routing shall include cable identification and terminal strip numbers.

5. Mounting details for all equipment and hardware.
6. Functional block diagrams for each system.
7. Wiring details showing rack elevations, equipment wiring and terminations and inter-rack wiring.

3.7 SECURITY SYSTEM PROGRAMMING

- A. Security System Programming to include commissioning of all controllers, points and related devices.
- B. All system programming shall take place in the field to verify Owner-designated zones for all devices. Programming shall be developed with Owner's input and shall not be accepted without Owner's approval.

3.8 WARRANTY

- A. The Contractor shall warrant the system for parts and labor for one (1) year. Warranty commences at the time of substantial project completion and acceptance by Owner. Nothing shall be construed to limit this obligation to a shorter period.
- B. Warranty service shall be rendered on-site by request of Owner to repair or replace any defective materials, equipment and workmanship without cost to the Owner, unless the Owner has previously given the Contractor a written acceptance of such condition.
- C. The Owner shall give prompt notice of the defect(s) either verbally or in writing to Contractor.
- D. Perform preventative maintenance during the warranty period, which includes:
 1. Quarterly cleaning and inspection of all devices.
 2. Quarterly inspection, cleaning and testing of all power supplies/UPS.
 3. Quarterly test and replace of batteries as necessary.
 4. Clean and vacuum MTC console and rack equipment
- E. Service technician performing service / warranty work shall check-in and out for each visit.
- F. Provide a written report to Owner documenting any work performed during the warranty period within 24 hours of such event. Report shall detail work performed, equipment repaired or replaced, etc.
- G. Provide loaner equipment which is equivalent to the malfunction equipment for any equipment not field repairable.
- H. Repair or Replacement Service

1. Repair or replacement service during the warranty period shall be performed 7 days a week, 24 hours a day and with a 4 hour response time.
2. Emergency repair or replacement service during the warranty period shall be performed 7 days a week, 24 hours a day and with a 1 hour response time.
3. If the Contractor cannot restore system operation during the warranty period within 2 business days of the system failure, the Owner reserves the right to require the Contractor to provide on-site manufacturer's service technicians at no additional cost.
4. The Owner reserves the right to expand or add to the system during the warranty period using firm(s) other than the contractor for such expansion without affecting the Contractor's responsibilities, provided the expansion is performed by an authorized dealer for the affected equipment.
5. On-line software and hardware service shall be provided and shall be password protected and controlled by the Owner.

3.9 TECHNICAL VERIFICATION SESSION

- A. Security system walk through and verification shall be provided for the technical staff and shall minimally consist of 4 ea. 1-hour session.
- B. A complete product manuals and preliminary as-built drawings shall be delivered to the owner one week prior to the training sessions.
- C. Technical verification and walk through shall consist of:
 1. Technical explanation sufficiently thorough that: staff personnel shall be able to identify and trace circuits, analyze malfunctions and make changes as necessary to maintain system operation.
 2. Provide printed reference material for each trainee that documents and explains in technical terms:
 - a. System block diagram with technical features
 - b. Method and record of end-to-end testing
 - c. Review of as-built drawings.
 - d. Q & A session.

3.10 TESTING REQUIREMENTS

- A. The contractor shall perform sample tests in the presence of the Security Consultant and Owner. Performing the testing procedures specified herein assures that the communication cabling and system electronics meets the performance characteristics specified. All

testing shall comply with EIA/TIA Standards and that of the equipment manufacturers. If testing indicates that the performance characteristics are not met, the test shall be failed test and any other test that may be affected by the modification and/or repair shall be rerun and verified.

- B. Test equipment will be provided by the contractor to test and to certify the 100% operational condition of all materials and equipment.
- C. The Vendor shall prepare and submit all test procedures and data forms for the pre-installation, post installation and subsystem test to Owner. The test procedures shall have Owner approval before the tests.

3.11 SYSTEM CHECK OUT AND VERIFICATION

- A. Commission all security devices from field to head-end.
- B. For all security field devices, verify monitoring of open and alarm resistance value at the head-end.
- C. Contractor supplied "As Built" Drawings shall show security conduit routing, cable labeling and end of line resistor location for each zone.
- D. Review all as-built and testing documentation with owner. Revise and reissue as required.
- E. Demonstrate proper sequences of operation for all connected points and access control hardware.

3.12 ACCEPTANCE OF SYSTEMS

- A. Each area of construction completed and submitted as complete shall meet the following criteria under testing:
 - 1. System must meet all specifications as described in these instructions.
 - 2. Operational prints, manuals, signal logs, and as built prints must be furnished.
 - 3. Visual testing and signal verification will be conducted at random locations to determine that equipment performs satisfactorily.
- B. Specifications set forth for construction of the system have been devised in order to insure system compatibility and performance. Compliance to these specifications will be determined during periodic observances of construction. Repeated failure to comply with the specification will be considered before the initial acceptance phase of the plant commences.

- C. Within ten days receipt of the final acceptance notice, the Owner's representatives shall schedule and perform the final inspection. When the work is found acceptable under the contract documents and the contract is fully performed, the project will be declared complete.

- - - E N D - - -

SECTION 28 23 00
VIDEO SURVEILLANCE

PART 1 - GENERAL

1.1 SECTION INCLUDES

- A. Cameras.
- B. Control equipment.
- C. Cable and accessories.

1.2 RELATED SECTIONS

- A. Section 08 71 00 - Door Hardware.
- B. Section 28 05 00 - Common Work Results for Electronic Safety and Security
- C. Section 28 05 26 - Grounding and Bonding for Electronic Safety and Security.
- D. Section 28 05 28 - Pathways for Electronic Safety and Security.
- E. Section 28 05 53 - Identification for Electronic Safety and Security.
- F. Section 28 13 00 - Access Control.
- G. Department of Veteran Affairs Police Department Design Guideline and Security System Standards (latest edition)
- H. Conduit, cable tray and back boxes for this system shall be furnished and installed by the electrical contractor under the supervision of the security contractor.

1.3 REFERENCES

- A. NFPA 70 - National Electrical Code; National Fire Protection Association; 2005
- B. EIA/TIA-569 Standard, Commercial Building Standard for Telecommunications Pathways and Spaces.
- C. EIA/TIA-607 Commercial Building Grounding and Bonding Requirements for Telecommunications
- D. National Electrical Code (NEC) (Latest revision and pertinent addendums)
- E. National Fire Protection Association (NFPA) Publications (Latest revisions and pertinent addendums)
- F. Americans with Disabilities Act (ADA)
- G. NFPA 101, National Fire Protection Association
- H. UL 294, Underwriter's Laboratories Access Control Systems
- I. UL 1037, Underwriter's Laboratories Anti-Theft Alarms and Devices

- J. UL 1076, Underwriter's Laboratories Propriety Burglar Alarms Units and Systems
- K. EIA-RS-170 Broadcast Standards
- L. NTSC Color System Standards
- M. Building Officials and Code Administrators International, Inc. (BOCA) National Building Code
- N. Uniform Building Code (UBC)
- O. Local Governing Authorities Having Jurisdiction

1.4 CONTRACT DOCUMENTS

- A. All work of this Section shall comply with the requirements of the Conditions of Contract (including: Bidding requirements, Contract forms, Conditions of Contract and Standard forms), with all Specification Sections of Division 1 General Requirements, with the Drawings, and with all other Contractual Documents.
- B. Coordinate with other Division sections as required.

1.5 SYSTEM DESCRIPTION

- A. This Section specifies the requirements for the Video Surveillance system for the Expansion & Renovation of Building 108 for Mental Health in Houston, Texas.
- B. Scope of Work
 - 1. The work detailed by these specifications and drawings has been specified to meet certain +requirements for performance. Some information, such as exact equipment layout, wire routing, additional conduit and power requirements, etc. has been omitted. It shall be the responsibility of the Contractor to translate these specifications and drawings into a complete design package containing all necessary elements for a complete turnkey installation including all material, labor, warranties, shipping and permits.
 - 2. Work shall include the installation and commissioning of the following:
 - a. Video Surveillance System (VSS)
 - 3. Work to include, but not limited to the following:
 - a. Perform camera pre-installation sign-off walk through with Owner and Security Consultant.
 - b. Installation of cameras and camera cabling
 - c. Provide all required software and licenses to the Owner.

- d. Contractor shall provide continuous on-site supervision of the installation technicians. On-site supervision shall include: daily supervision of the work, updating work site progress drawings to reflect changes and installations details, preparing weekly progress reports and attendance at site coordination meetings as directed by the Owner and Security Consultant.
- e. The Contractor shall provide continuous engineering and programming support during the installation as required to accommodate existing conditions and unforeseen conditions that may arise during performance of the work.
- f. The Contractor shall provide all miscellaneous hardware including cable management devices, termination cabinets, wire and cable labeling materials, fasteners, hangers and brackets as required.
- g. The contractor will coordinate the delivery and storage of all materials, wire, cable, equipment and miscellaneous hardware.
- 4. Description: Provide video communications between points of surveillance indicated on Drawings and central monitoring station.
- 5. The contractor shall provide all materials, equipment, labor and all other incidental material, tools, appliances and transportation as required for a complete and functional video surveillance system (VSS) as described herein and supplementary drawings.
- 6. General elements of the work shall consist of but not limited to:
 - a. Procure all permits and license required to complete this installation.
 - b. Submission of Schedule of Values for all equipment, materials and labor.
 - c. Attend pre-construction/pre-submittal meeting with Owner and Security Consultant to review design package for security and finish hardware.
 - d. Submittal preparation and processing prior to ordering equipment.
 - e. Attend finish hardware submittal review meeting.
 - f. Coordination of conduit system, raceway and power distribution provided by Division 26 contractors.
 - g. Coordination with all trades and Owner representatives as required facilitating the installation of the security equipment including: Divisions 8 Door Hardware, Division 23 Fire Alarm and Division 26 Electrical.

- h. Provide security system sensors, cable, connectors, wiring, equipment enclosures and all other materials necessary to complete the security system per the design documents.
- i. Verify conditions and dimensions at the job site prior to installation.
- j. Coordinate all system programming and camera naming with Owner.
- k. Perform pre-installation camera position and view sign off with Owner
- l. Perform installation according to contract documents and manufacturers recommendations.
- m. Protect new facilities finishes and equipment.
- n. Maintain construction materials and refuse within the area of work.
- o. Clean the work area at the end of each day.
- p. Perform initial testing and adjustments with written reports.
- q. Make final adjustments and calibrations as directed by the Owner and Security Consultant.
- r. Demonstrate all systems and component operations for final acceptance.
- s. Preparation of O&M manuals and as-built documents for Owner's use.
- t. Provide training for Owner's security staff, facility personnel and technical staff.
- u. Provide warranty service for a period of one year from acceptance date.
- v. Provide extended maintenance service.

1.6 SUBMITTALS

- A. See Section 01300 (01 3000) - Administrative Requirements, for submittal procedures.
- B. Shop Drawings: Indicate electrical characteristics and connection requirements, including system wiring diagram.
- C. Product Data: Provide showing electrical characteristics and connection requirements for each component.
- D. Manufacturer's Installation Instructions: Indicate application conditions and limitations of use stipulated by product testing agency. Include instructions for storage, handling, protection, examination, preparation, installation, and starting of product.

- E. Project Record Documents: Record actual locations of cameras and routing of television cable.
- F. Operation Data: Instructions for starting and operating system.
- G. Maintenance Data: Routine trouble shooting procedures.
- H. The submittal shall be a detailed response describing methods, procedures and specific equipment proposed to conform to the system design detailed in these documents.
- I. Submittals shall consist of product data, shop drawings, samples and detailed completion schedules.
- J. Partial submittals shall not be accepted without prior approval by Owner.
- K. No portion of the work shall commence or equipment ordered until the Owner has approved the submittals.
- L. The Contractor shall not be relieved from any contract-required responsibility by the Owner's approval of submittals.
- M. Nothing in the specification shall relieve the Security Contractor of responsibility in delivering a functioning turnkey security system.

1.7 SUBMITTAL REQUIREMENTS

- A. Product Data
 - 1. Provide Submittals no less than 10 working days after notice to proceed.
 - 2. Submit data in 3-ring binder divided into separate section (Access Control, Video Surveillance, etc.) for each system.
 - 3. Equipment lists and equipment data sheets shall be 8.5" x 11" in size.
 - 4. Each section to include the following:
 - a. List all system components with an assigned item number, manufacturer, model number and quantities of each.
 - b. Manufacturer's literature sheets for all materials and equipment, including warranty information and recommended preventative maintenance and spare part inventory recommendations. Literature containing more than one device shall be clearly marked to delineate item(s) included in the work.
 - c. Clearly indicate color or special finishes.
 - d. Cable types including manufacturer's verification and acceptance information.
 - e. General functional description of each system including:

- 1) Description of operating systems and application software.
 - 2) Power requirements and UPS sizing.
5. Schedule of Values
 - a. Contractor shall submit in addition to Division 1 requirements, a Schedule of Values, which includes itemized listing of all equipment, materials and labor required for the installation of the VSS as specified herein for Change Order pricing. Listing shall contain: assign item number, item description, item model number, item quantity, unit cost and extended labor, material and installation cost to provide a complete and functional security system. Submit in electronic format (Microsoft Excel).
6. Shop Drawings
 - a. Provide Shop Drawings no less than 25 working days after notice to proceed.
 - b. Reproducing Contract Documents for shop drawing is not acceptable.
 - c. Submit 3 complete sets of shop drawings along with CD-ROM copy to the Security Consultant.
 - d. Produce all shop drawings on latest version of AutoCAD.
 - e. Shop drawings to include the following:
 - 1) Drawing legend sheet describing all symbols used on the drawings.
 - 2) Floor plans with all device locations and wiring.
 - 3) Wire runs to include tags for type, gauge, quantities and cable identifiers.
 - 4) System riser diagram indicating all field devices, riser paths and room designations.
 - 5) Block diagram for each system showing: all equipment, interconnections, network connections and data flow.
 - 6) Point schedule-defining interconnection of all inputs and outputs for all equipment including fire alarm interface, data connections and other systems.
 - 7) Schedule of device power requirements, power source and load calculations.
 - 8) Elevations of equipment racks with new equipment.
 - 9) Elevations of telecom closet(s) with security panel, termination enclosure, wire management, lock power supply(s), UPS, and power routing, etc.
 - 10) Fabrication shop drawings for all custom equipment.
7. Samples
 - a. Upon specific request of the Owner and Security Consultant, submit samples of any proposed devices.
8. Resubmitting

- a. Make corrections or changes in Submittals as required by the Security Consultant's stamped instructions and attached comments and resubmit.
- b. Identify changes on resubmittals by clouding. Only indicated changes will be reviewed when resubmitted.
- c. Added drawings shall be clearly identified.
- d. Contractor shall be responsible for project delays caused by rejected submittals.
- e. Security Consultant shall be compensated for additional services for submittals rejected more than twice. The amount of such compensation shall be incorporated by change order and withheld from the Contractor's Application for Payment.

1.8 RECORD DOCUMENTATION

- A. Furnish 3 complete sets of record documents.
- B. Record documents shall include all revised information provided as submittals and reflect as installed revisions.
- C. General Description and Requirements
 1. Record drawings shall consist of As-Built Drawings and Operation and Maintenance Manuals.
 2. Transmit 3 copies of a preliminary draft of the Record Documents to the Owner and Security Consultant prior to final acceptance testing and training.
 3. Update all Record Documents to reflect changes or modifications made during final acceptance testing as required.
 4. Submit 3 sets of final corrected Record Documents to the Security Consultant within 30 days from the date of final acceptance.
 5. As-Built Drawings
 - a. Furnish 3 complete sets of as-built drawings along with a complete CD-ROM copy.
 - b. Maintain on the job site, current up to date as-built drawings and schedule(s) including most recent changes. Included field notes shall be neat and legible. The Contractor shall make any needed changes to this drawing and schedule set as to accurately depict the as-built condition of the security system as it is installed.
 - c. As-built Drawings shall, at a minimum, include the following:
 - 1) Floor plan drawings (1/8"=1' scale) indicating device location, with device legends indicating manufacturer and model number for each device.
 - 2) Floor plan drawings (1/8"=1' scale) indicating wire

- routing or approximate routing for existing wiring. Wiring shall be tagged with cable identifier and terminal strip number, which references wiring schedules.
- 3) Mounting details for all equipment and hardware.
 - 4) Functional block diagrams for each system and subsystem.
 - 5) Wiring details showing: rack elevations, DGP and support equipment elevations, equipment wiring and terminations and inter-rack wiring.
 - 6) Typical point-to-point wiring for each piece of equipment and groups of equipment within the system.
 - 7) Schedule of all devices with associated panel termination, zoning, power circuit numbers, etc.
6. Operational and Maintenance (O&M) Manuals
- a. Provide 3 complete operation and maintenance manuals for all equipment and devices with project title and contractor's name on cover and spine.
 - b. Submit operation and maintenance manuals in 3 ring binders.
 - c. O&M manuals shall include:
 - 1) Provide table of contents page with tabbed divider sections for each device or system.
 - 2) Tabbed sections shall include: theory of operation, design philosophy, specific functions and system block diagram.
 - 3) List of manufacturer's, their local representatives and subcontractors that performed work on the project. List to include contact names, addresses and phone numbers for each.
 - 4) Custom written instructions and procedures for system operation.
 - 5) Operator commands.
 - 6) Start-up and shutdown procedures.
 - 7) Detailed programming descriptions for each system.
 - 8) Manufacturer's operation manual for each piece of equipment in the system. Product data sheets are not acceptable.
 - 9) Custom written quick users guide for inexperienced operators.
 - 10) System backup disk.
 - 11) System software licenses.
 - 12) Equipment list, including a brief description, model, and the total number of each item used in the project.
 - 13) A separate list of serial numbers for all items used in the system
 - 14) Copies of all programming specific to the job, including new code, initial parameters, and settings entered on site, etc.
 - 15) Setup procedures for each component in the system.
 - 16) Maintenance requirements for equipment, inspections and preventative maintenance schedules.
 - 17) Final test data (measured levels and other significant

operating parameters).

- 18) List of system associated mechanical locking keys and tamper resistant hardware types with key codes.

1.9 QUALITY ASSURANCE

- A. Conform to requirements of NFPA 70.
- B. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years documented experience and with service facilities within 100 miles of Project.
- C. Supplier Qualifications: Authorized distributor of specified manufacturer with minimum three years documented experience.
- D. Installer Qualifications: Authorized installer of specified manufacturer with service facilities within 100 miles of Project.
- E. Products: Furnish products listed and classified by Underwriters Laboratories, Inc. as suitable for purpose specified and indicated.
- F. Contractor Qualifications
 - 1. An experienced Contractor shall perform the installation. Contractor shall have at least 3 years experience in the installation of security systems of similar size and scope.
 - 2. The installation shall be performed by a Contractor licensed by the Texas Board of Private Investigators and Private Security Agencies and shall be bonded and insured.
 - 3. All installation personnel shall also be licensed as required by local and/or state jurisdictions.
 - 4. Contractor shall provide all licensing documentation as part of the bid.
 - 5. Owner's representative may make such investigations as deemed necessary to determine that the Contractor is responsive, responsible and qualified in the area of work contemplated by the contract. In this regard, the security system installation firm shall furnish to the Owner such information and data as shall be requested for this purpose. Information and data may include (but not necessarily be limited to): Date of organization and/or incorporation and number of years engaged in this business under present firm's names; list of major equipment owned by the company; list of principal personnel who will be involved in the execution of this contract with the experience and qualifications of each person.
 - 6. The Contractor shall provide a project manager that shall be constantly in charge of the VSS installation. The project manager

- shall be the same person authorized to make decisions and answer questions asked by the Architect and Owner Representatives. The project manager shall also be responsible for system programming, preparation of Operation and Maintenance Manuals, Training, Programs, Schedules and Test Protocols, documentation of system testing, maintenance of Record Drawings and coordination and scheduling of all labor.
7. Provide evidence of site supervisor's qualifications and work history
 8. Contractor shall be or have direct relations through their subcontractors, and authorized manufacturer's representatives for all products they furnish or install.
 9. Provide documentation that the Contractor and or subcontractor are factory certified to install, program, train and repair all major components or systems to be used in the project.
 10. Contractor shall have a local organization capable of providing maintenance and service for the specified system. Facility shall be no more than 100 miles from Owner's site. The security system installation firm shall be capable of providing emergency service on a 24-hour, 7 days a week basis.

1.10 PRODUCT STANDARDS

- A. The Contractor will provide all materials, equipment and installation in compliance with the latest applicable standards from ANSI, FCC, ASTM, EIA/TIA, IEEE, NEC, NFPA, NEMA, REA and UL including but not limited to:
 1. EIA/TIA-569 Standard, Commercial Building Standard for Telecommunications Pathways and Spaces.
 2. EIA/TIA-607 Commercial Building Grounding and Bonding Requirements for Telecommunications
 3. ANSI T1.404 (DS3) and CATV Applications
 4. National Electrical Code (NEC) (Latest revision and pertinent addendums)
 5. National Fire Protection Association (NFPA) Publications (Latest revisions and pertinent addendums)
 6. Americans with Disabilities Act (ADA).
 7. In the event of any conflicts between documents referenced herein and the contents of this specification, the Contractor shall notify

in writing to Engineer of any such occurrences before the purchase of any equipment, materials and/or installation by the Contractor. The Engineer will notify the Contractor of any actions required to resolve these conflicts. Such actions may include but are not limited to: design changes, equipment, materials and/or installation changes. In any event Contractor shall not supersede specifications and standards from the latest NFPA and NEC publications.

8. All equipment, materials and articles incorporated in the work covered by this contract are to be new and unused.
9. The contractor shall provide at installation time the latest current standard model and/or version of all equipment (hardware and software).

1.11 MAINTENANCE SERVICE

- A. Furnish service and maintenance of surveillance system for one year from Date of Substantial Completion.

PART 2 - PRODUCTS

2.1 COMPONENTS

- A. Manufacturers:
 1. Indoor Camera:
 - a Axis
 - b. Pelco
 - c. Scallop
 - d. Panasonic
 - e Sony
 2. Outdoor Camera:
 - a Axis
 - b. Pelco
 - c. Scallop
 - d. Panasonic
 - e Sony
 3. Network Video Recorders:
 - a. Dell Server with Video Management Software
 4. Indoor Power Supply:
 - a. POE
 5. Outdoor Power Supply:
 - a. Altronics
 6. Cabling.

- a. Category 6 data cabling per division 27 specifications.
 - b. Low voltage power Lake cable 18-2c.
 - c. High Voltage Power Lake cable 16-2c.
7. PoE Switches. OFOI

2.2 GENERAL

- A. Manufacturer's name and model numbers are given in the specifications for the purpose of establishing a standard of performance, quality, style, size and type and shall not be construed as limiting competition unless otherwise noted "No Exceptions".
- B. These specifications list approved equipment types and items. In instances where quantities are not detailed, they shall be obtained from the drawings.
- C. Substitutions will only be considered if they are specifically requested in writing and include shop drawings and manufacturer data sheets. The contractor represents that they have personally investigated the proposed substitute and have determined that it is equal or superior in all respects to the equipment originally specified and that similar guarantees apply. This includes Original Equipment Manufacturer's model number changes.

2.3 VIDEO SURVEILLANCE SYSTEM

- A. System Description: Provide and install an IP Video Surveillance system including IP cameras, data cabling per division 27, mounts, domes, dedicated security patch panels and any required components/accessories.
- B. General
 - 1. Cameras and support wiring to the common equipment location and video processing equipment in the MTC.
 - 2. Common equipment location with mounting board, support equipment, wire management and power.
- C. Video Cameras
 - 1. Camera schedule location, camera view, lens and mounting method are for reference purposes. Contractor is responsible for coordinating these details with Owner and Security Consultant.
 - 2. Prior to camera installation, contractor will schedule with Owner and Security Consultant, a walkthrough of the scheduled camera locations for exact equipment and position selection. Contractor will provide a technician with ladder, proposed camera with lens assortment and 20-inch monitor with appropriate power to test and

adjust camera/lens combination for optimum view. Final camera position and lens schedule shall be submitted for Security Consultant's approval.

D. Camera Signal Transient/Surge Protection

1. Provide camera transient/surge protection as specified in the drawings and specifications.
2. Protector to guard sensitive electronics against lightning induced surges, electrostatic discharge and ground loop energies.
3. Install at video head end and at all exterior cameras
4. Connect to nearest communication ground bus or proper building ground.

E. Video Camera Power Supply(s)

1. Cameras will be PoE. PoE switches will be OFOI.

2.4 STATIC CAMERA SYSTEM

- A. Cameras shall be high-resolution dual mode color/monochrome and accept CS lens mounts.
- B. Minimum resolution 1280 X 960
- D. Backlight compensated
- E. Camera shall automatically switch between modes at user defined light levels, with minimum 3 lux sensitivity color and 0.2 lux monochrome
- F. Provide backlight compensation for locations with high contrast lighting areas
- G. Back focus cameras to ensure proper focus in low light conditions
- H. Provide ground isolation transformers as required to eliminate humbars and ground loops
 1. Pelco IDE20DN-PM0 with
 2. Or VA Police Department Approved Equal

2.5 LENS SYSTEM

- A. Provide varifocal lens for fixed cameras, which are designed for black and white applications and provide high quality, glare free, clear pictures at the monitor position.
- B. Provide auto iris varifocal lens with the focal range coordinated with the desired view and approved by the Owner.
- C. Provide spot filters as required to reduce picture whiteout.
- D. Acceptable manufactures and models:
 1. Pelco
 2. Or VA Police Department Approved Equal

2.6 CAMERA VIDEO AND POWER TRANSIENT/SURGEVPROTECTION DEVICE

- A. Provide inline camera video signal and power protection at all outdoor camera locations with grounds connected to closest electrical ground as specified in the drawings and specifications

2.7 CAMERA POWER SUPPLY

- A. Camera power to be provided by Power over Ethernet (PoE)

2.8 WIRE AND CABLE

- A. Category 6 Per division 27 specifications

2.9 ACCESSORIES

- A. Rack: Provide free-standing equipment Rack.
 - 1. Size: 7' x 19" with minimum 6" vertical cable managers on each side.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. This section covers the general requirements for the installation of the security system by the Contractor.
- B. Install in accordance with manufacturer's instructions.
- C. The Contractor shall be responsible for providing all wire and cable as required for complete and operational system.
- D. All cables must be continuous runs from device location to the final point of termination. No mid run cable splices will be allowed.
- E. The cable installation techniques shall be such that the mechanical and communications characteristics of the cables are not degraded at the time of installation. Any special environmental requirements for equipment shall be specified.
- F. Distribution of the cabling will be accomplished through cable trays, cable runways, conduit raceways, ducts, core holes, extended columns, false half columns and plenums. Cabling shall be run at right angles. Horizontal cable segments will be placed in cable trays and when they leave cable trays will be supported by distribution rings or J-hooks. Where cables converge at equipment room locations, they will be supported by cable runways and distribution rings. All cable placements shall be based on the enclosed drawings.
- G. The contractor shall not place security wiring in the same conduit or raceway with wire for electrical power distribution.
- H. Connectors to all devices in system shall be protected against moisture. Approval of the method shall not relieve the contractor of

full responsibility for proper application and workmanship of the materials in the manner specifically approved. All connector threads shall be treated with an approved silicone lubricant.

- I. The Contractor shall be responsible for providing an approved ground and ground bus bars at all newly installed systems insuring proper bonding to telecommunications facilities. The Contractor shall also be responsible for ensuring ground continuity by properly bonding all appropriate cabling, closures, cabinets, service boxes, and framework. All grounds shall consist of a minimum 6 AWG copper wire and shall be supplied from an approved building ground and bonded to the main electrical ground. Contractor must notify the Owner prior to making any changes in submitted system design and/or installation.
- J. All exposed J-boxes or enclosures shall have tamper resistant features and hardware. Tamper resistant fasteners to be Tamper-Proof pin-in-hex or pin-in-torx button head screws.
 1. Use of common wires for input or output circuits is not allowed.
 2. Configure all zones to be normally closed loop with an end of line resistor (EOL) at the most distant point of the zone.
 3. The Contractor shall obtain Owner's permission before proceeding with any work necessitating cutting into or through any part of building structures such as girders, beams, concrete or tile floors and partition ceilings.
 4. The Contractor shall exercise reasonable care to avoid any damage to Owner's property. Contractor shall be responsible for and repair all damage due to carelessness of workers. Contractor will report to Owner any damage to the building, which may exist or may occur during the occupancy of the quarters.
 5. The Contractor shall be responsible for proper electrical grounds.
 6. The Contractor shall take necessary steps to ensure that required fire fighting apparatus is accessible at all times. Flammable materials shall be kept in suitable places outside the building.
 7. The Contractor shall install the materials in accordance with the manufacturers' specifications.
 8. The Contractor shall promptly correct all defects for which the Contractor is responsible.
 9. The Contractor shall insure that all records and reports, City relations, engineering, metering, inspections, testing, quality or

- service standards and safety measures comply with standards applicable for the State of Texas.
10. The Contractor shall coordinate all work with Owner's designated representative.
 11. The Contractor shall maintain a work area free of debris, trash, empty cable reels, scrap wire, etc., and dispose of such items on a daily basis.
 12. All work shall be done in a thorough and conscientious manner according to industry standards and shall be subject to inspection and acceptance.
 13. The Contractor shall be certain that all installation work areas are secure and made safe in accordance with Occupational Safety and Health Administration (OSHA) regulations.
 14. The installation crew should include at least one installation supervisor, or lead technician, for on-site management of the project at all times.
 15. The Contractor shall be responsible for completing a standardized report form addressing the weekly progress of the installation schedule.
 16. The Contractor shall maintain conductor polarity in accordance with industry practices.
 17. The Contractor shall provide any necessary screws, anchors, clamps, tie wraps, distribution rings, miscellaneous grounding and support hardware, etc., necessary to facilitate the installation of the distribution system.
 18. The Contractor shall be responsible for labeling all cable, distribution devices, enclosures and outlet locations, according to industry standards. Numbering scheme shall be coordinated with Owner's representative before installation.
 19. It shall be the responsibility of the Installation Contractor to furnish any special installation equipment or tools necessary to properly complete the installation.
 20. The Contractor shall not roll or store cable reels without an appropriate underlay.
 21. The Contractor shall not place any distribution cabling alongside power lines, or share the same conduit, channel or sleeve with electrical apparatus.

22. The Contractor shall insure that the maximum pulling tensions of the specified distribution cables are not exceeded at any time during the placement facilities. Failure to follow the appropriate guidelines may require the Contractor to provide additional material and labor necessary to properly rectify the situation. This shall also apply to any and all damages sustained to the cables by the installation Contractor during the implementation.
23. The Contractor shall be responsible for testing all cable prior to the installation of the cable. If the Installation Contractor fails to perform this testing operation, the Installation Contractor shall accept the cable as good and assume all liability for the replacement of the cable should it be found defective at a later date.
24. The Contractor shall plug conduits where cabling has been installed by the Installation Contractor in all equipment rooms and other cable entrance locations with re-enterable duct seal of flame retardant putty.
25. Materials shall be consistent throughout the building. Where two or more units of the same class of equipment are required, these units shall be the product of a single manufacturer and shall be the same product with the same material, model, and manufacturer number.
26. Wiring, materials, and equipment will be delivered and stored in a clean dry space. They will be properly packaged in factory fabricated type containers and protected from damaging fumes, construction debris and traffic until job completion.
27. The wiring, materials, and equipment furnished for this request shall be essentially the standard product of the manufacturer.
28. All wiring, materials, and equipment must be listed and labeled by a nationally recognized testing laboratory.
29. All installation techniques and fixtures shall result in ease of maintenance and ready access to all components for testing measurements. All external screws, nuts, and locking washers shall be stainless steel. No self-tapping screws shall be used unless specifically approved by Owner. All parts shall be made of corrosion resistant material, such as plastic, anodized aluminum or brass. All materials used in installation shall be resistant to fungus growth and moisture deterioration.

30. An inert dielectric material shall separate dissimilar metals apt to corrode through electrolysis under the environmental operating conditions specified.
31. The cable pulling operation shall be performed such that a minimum bending of the cable shall occur in the unreeling and pulling operations. The pulling tension shall not be allowed to exceed the maximum tension specified by the manufacturer of the cable.
32. Jacketing and insulation shall satisfy the Underwriters Laboratories (UL) listed fire rated cable insulation requirements in plenum areas.
33. Any pulling compound or lubricant used in cable installation shall not deteriorate the conductor or the insulation.
34. Parts and components not specifically mentioned in these specifications, which are required to provide a complete unit, shall be included as a part of the equipment to be furnished.
35. Nothing in the specification shall relieve respondents of system package design responsibility, including, but not limited to, all equipment furnished under this contract. The successful respondent is, in all cases, solely responsible for the performance of the delivered system, and for furnishing complete system documentation for each and every part of the system.

3.2 INTERFACES WITH OTHER PRODUCTS

- A. Interface installation of video surveillance with security access and intrusion detection systems.

3.3 MANUFACTURER'S FIELD SERVICES

- A. Provide the services of manufacturer's technical representative to prepare and start systems and supervise final wiring connections and system adjustments.

3.4 ADJUSTING

- A. Adjust manual lens irises to meet lighting conditions.

3.5 DEMONSTRATION

- A. Demonstrate system operation and provide two hours of instruction with manufacturer's training personnel.
- B. Conduct walking tour of project and briefly describe function, operation, and maintenance of each component.

3.6 WEEKLY CONSTRUCTION MEETING

- A. The Security Consultant and/or Owner will hold weekly construction meetings to review the installation schedule. It is mandatory that the Contractor's project manager attend each meeting.

3.7 SITE INSPECTION

- A. Continuously verify that the site conditions are in agreement with the Contract Documents and the security system design. Notify Owner's representative immediately of conditions that affect the performance of the installed system.
- B. Coordinate any required work that is not specified in the Contract Documents.

3.8 COORDINATION

- A. Adequate conduit and back boxes are provided for the specified system installation.
- B. Verify value of end of line supervision module with Owner.
- C. Adequate power has been provided for the specified system installation.
 - 1. Verify mounting location of all devices with Owner prior to installation.

3.9 IDENTIFICATION, LABELING AND DOCUMENTATION

- A. The Contractor shall label all termination devices, panels, enclosures and equipment rooms. The Contractor will mark each unit with permanently attached markings that will not impair the equipment or present a hazard to maintenance personnel.
- B. Place wire identification numbers on each end of all conductors by using sleeve type heat shrinkable markers. Install markers to be readable from left to right or top to bottom. Wire numbers shall be computer printed (Brady TLS2200 with Permasleeve cable marking labels or equivalent). Hand written labels are not acceptable.
- C. Mark all spare conductors.
- D. If changes occur prior to acceptance testing altering the documentation previously furnished, the contractor shall formally update and reissue the relevant documentation to the Security Consultant and Owner.
- E. Security Consultant and Owner will review all documentation for accuracy and completeness and may reject substandard submittals.
- F. The Contractor shall establish and maintain complete system documentation, including documentation procedures, operational

information, configuration information, historical records, and drawings. Documentation shall include the following:

1. Floor plan drawings indicating device locations, unique system point numbers with device legends indicating manufacturers and model numbers for each device.
2. The unique system point number of a device shall identify either through the software or hardwire connection, the specific device or group of devices associated with the unique point number in the system.
3. Floor plan drawings indicating conduit and wire routing and junction box locations.
4. Wire routing shall include cable identification and terminal strip numbers.
5. Mounting details for all equipment and hardware.
6. Functional block diagrams for each system.
7. Wiring details showing rack elevations, equipment wiring and terminations and inter-rack wiring.

3.10 SECURITY SYSTEM PROGRAMMING

- A. Security System Programming to include commissioning of all controllers, points and related devices.
- B. All system programming shall take place in the field to verify Owner-designated zones for all devices. Programming shall be developed with Owner's input and shall not be accepted without Owner's approval.

3.11 WARRANTY

- A. The Contractor shall warrant the system for parts and labor for one (1) year. Warranty commences at the time of substantial project completion and acceptance by Owner. Nothing shall be construed to limit this obligation to a shorter period.
- B. Warranty service shall be rendered on-site by request of Owner to repair or replace any defective materials, equipment and workmanship without cost to the Owner, unless the Owner has previously given the Contractor a written acceptance of such condition.
- C. The Owner shall give prompt notice of the defect(s) either verbally or in writing to Contractor.
- D. Perform preventative maintenance during the warranty period, which includes:
 1. Quarterly cleaning and inspection of all devices.

2. Quarterly inspection, cleaning and testing of all power supplies/UPS.
3. Quarterly test and replace of batteries as necessary.
4. Clean and vacuum MTC console and rack equipment
5. Service technician performing service / warranty work shall check-in and out for each visit.
6. Provide a written report to Owner documenting any work performed during the warranty period within 24 hours of such event. Report shall detail work performed, equipment repaired or replaced, etc.
7. Provide loaner equipment which is equivalent to the malfunction equipment for any equipment not field repairable.
8. Repair or Replacement Service
 - a. Repair or replacement service during the warranty period shall be performed 7 days a week, 24 hours a day and with a 4 hour response time.
 - b. Emergency repair or replacement service during the warranty period shall be performed 7 days a week, 24 hours a day and with a 1 hour response time.
 - c. If the Contractor cannot restore system operation during the warranty period within 2 business days of the system failure, the Owner reserves the right to require the Contractor to provide on-site manufacturer's service technicians at no additional cost.
 - d. The Owner reserves the right to expand or add to the system during the warranty period using firm(s) other than the contractor for such expansion without affecting the Contractor's responsibilities, provided the expansion is performed by an authorized dealer for the affected equipment.
 - e. On-line software and hardware service shall be provided and shall be password protected and controlled by the Owner.

3.12 TECHNICAL VERIFICATION SESSION

- A. Security system walk through and verification shall be provided for the technical staff and shall minimally consist of 4 ea. 1-hour session.
- B. A complete product manuals and preliminary as-built drawings shall be delivered to the owner one week prior to the training sessions.
- C. Technical verification and walk through shall consist of:

1. Technical explanation sufficiently thorough that: staff personnel shall be able to identify and trace circuits, analyze malfunctions and make changes as necessary to maintain system operation.
2. Provide printed reference material for each trainee that documents and explains in technical terms:
 - a. System block diagram with technical features
 - b. Method and record of end-to-end testing
 - c. Review of as-built drawings.
 - d. Q & A session.

3.13 SUBSTANTIAL COMPLETION

- A. Work must meet the following requirements to qualify for the Owner's consideration of Substantial Completion:
 1. All cameras and monitoring devices shall be fully installed, tested and fully operational
 2. Video cameras powered and focused.
 3. End to end testing reports produced
 4. Technical verification process complete.
 5. Owner may utilize the system for its designed intent.
 6. Contractor will provide a list of remaining work items and approximate completion date.
 7. Contractor will certify in writing that all remaining work is minor in nature and will be completed in less than 30 days.

3.14 TESTING REQUIREMENTS

- A. The contractor shall perform sample tests in the presence of the Security Consultant and Owner. Performing the testing procedures specified herein assures that the communication cabling and system electronics meets the performance characteristics specified. All testing shall comply with EIA/TIA Standards and that of the equipment manufacturers. If testing indicates that the performance characteristics are not met, the test shall be failed test and any other test that may be affected by the modification and/or repair shall be rerun and verified.
- B. Test equipment will be provided by the contractor to test and to certify the 100% operational condition of all materials and equipment.
- C. The Vendor shall prepare and submit all test procedures and data forms for the pre-installation, post installation and subsystem test to Owner. The test procedures shall have Owner approval before the tests.

3.15 SYSTEM CHECK OUT AND VERIFICATION

- A. Commission all security devices from field up to and including the head-end.
- B. Contractor supplied "As Built" Drawings shall show security conduit routing and cable labeling.
- C. Review all as-built and testing documentation with Owner. Revise and reissue as required.
- D. Video camera image as received at the head-end is noise free, focused and field of view of view is optimized for intended content.

3.16 ACCEPTANCE OF SYSTEMS

- A. Each area of construction completed and submitted as complete shall meet the following criteria under testing:
 - 1. System must meet all specifications as described in these instructions.
 - 2. Operational prints, manuals, signal logs, and as built prints must be furnished.
 - 3. Visual testing and signal verification will be conducted at random locations to determine that equipment performs satisfactorily.
 - 4. Specifications set forth for construction of the system have been devised in order to insure system compatibility and performance. Compliance to these specifications will be determined during periodic observances of construction. Repeated failure to comply with the specification will be considered before the initial acceptance phase of the plant commences.
 - 5. Within ten days receipt of the final acceptance notice, the Owner's representatives shall schedule and perform the final inspection. When the work is found acceptable under the contract documents and the contract is fully performed, the project will be declared complete.

- - - E N D - - -

SECTION 28 31 00
FIRE DETECTION AND ALARM

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section of the specifications includes the furnishing, installation, and connection of the fire alarm equipment to form a complete coordinated system ready for operation. It shall include, but not be limited to, alarm initiating devices, alarm notification appliances, control units, fire safety control devices, annunciators, power supplies, and wiring as shown on the drawings and specified. The fire alarm system shall not be combined with other systems such as building automation, energy management, security, etc.
- B. Fire alarm systems shall comply with requirements of the most recent VA FIRE PROTECTION DESIGN MANUAL and NFPA 72 unless variations to NFPA 72 are specifically identified within these contract documents by the following notation: "variation". The design, system layout, document submittal preparation, and supervision of installation and testing shall be provided by a technician that is certified NICET level III or a registered fire protection engineer. The NICET certified technician shall be on site for the supervision and testing of the system. Factory engineers from the equipment manufacturer, thoroughly familiar and knowledgeable with all equipment utilized, shall provide additional technical support at the site as required by the Resident Engineer or his authorized representative. Installers shall have a minimum of 2 years experience installing fire alarm systems.
- C. Fire alarm signals:
 - 1. Building 108 Expansion shall have an automatic digitized voice fire alarm signal with emergency manual voice override to notify occupants to evacuate. The digitized voice message shall identify the area of the building (smoke zone) from which the alarm was initiated.
 - 2. Building 108 Expansion shall have a general evacuation fire alarm signal in accordance with ASA S3.41 to notify all occupants in the respective building to evacuate.
- D. Alarm signals (by device), supervisory signals (by device) and system trouble signals (by device not reporting) shall be distinctly transmitted to the main fire alarm system control unit located in the security office.

- E. The main fire alarm control unit shall automatically transmit alarm signals to a listed central station using a digital alarm communicator transmitter in accordance with NFPA 72.

1.2 SCOPE

- A. A fully addressable fire alarm system shall be designed and installed in accordance with the specifications and drawings. Device location and wiring runs shown on the drawings are for reference only unless specifically dimensioned. Actual locations shall be in accordance with NFPA 72 and this specification.
- C. Existing fire alarm bells, chimes, door holders, 120VAC duct smoke detectors, valve tamper switches and waterflow/pressure switches may be reused only as specifically indicated on the drawings and provided the equipment:
 - 1. Meets this specification section
 - 2. Is UL listed or FM approved
 - 3. Is compatible with new equipment being installed
 - 4. Is verified as operable through contractor testing and inspection
 - 5. Is warranted as new by the contractor.
- D. Existing 120 VAC duct smoke detectors, waterflow/pressure switches, and valve tamper switches reused by the Contractor shall be equipped with an addressable interface device compatible with the new equipment being installed.
- E. Existing reused equipment shall be covered as new equipment under the Warranty specified herein.
- F. Basic Performance:
 - 1. Alarm and trouble signals from each building fire alarm control panel shall be digitally encoded by UL listed electronic devices onto a multiplexed communication system.
 - 2. Response time between alarm initiation (contact closure) and recording at the main fire alarm control unit (appearance on alphanumeric read out) shall not exceed 5 seconds.
 - 3. The signaling line circuits (SLC) between building fire alarm control units shall be wired Style 7 in accordance with NFPA 72. Isolation shall be provided so that no more than one building can be lost due to a short circuit fault.

4. Initiating device circuits (IDC) shall be wired Style C in accordance with NFPA 72.
5. Signaling line circuits (SLC) within buildings shall be wired Style 4 in accordance with NFPA 72. Individual signaling line circuits shall be limited to covering 22,500 square feet (2,090 square meters) of floor space or 3 floors whichever is less.
6. Notification appliance circuits (NAC) shall be wired Style Y in accordance with NFPA 72.

1.3 RELATED WORK

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Requirements for procedures for submittals.
- B. Section 07 84 00 - FIRESTOPPING. Requirements for fire proofing wall penetrations.
- C. Section 08 71 00 - DOOR HARDWARE. For combination Closer-Holders.
- D. Section 21 13 13 - WET-PIPE SPRINKLER SYSTEMS. Requirements for sprinkler systems.
- E. Section 28 05 00 - COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY. Requirements for general requirements that are common to more than one section in Division 28.
- F. Section 28 05 26 - GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY. Requirements for grounding of equipment.
- G. Section 28 13 00, PHYSICAL ACCESS CONTROL SYSTEMS (PACS). Requirements for integration with physical access control system.

1.4 SUBMITTALS

- A. General: Submit 5 copies in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, and Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Drawings:
 1. Prepare drawings using AutoCAD 2007 or later, and include all contractors information. Layering shall be by VA criteria as provided by the Contracting Officer's Technical Representative (COTR). Bid drawing files on AutoCAD will be provided to the Contractor at the pre-construction meeting. The contractor shall be responsible for verifying all critical dimensions shown on the drawings provided by VA.
 2. Floor plans: Provide locations of all devices (with device number at each addressable device corresponding to control unit programming), appliances, panels, equipment, junction/terminal cabinets/boxes,

- risers, electrical power connections, individual circuits and raceway routing, system zoning; number, size, and type of raceways and conductors in each raceway; conduit fill calculations with cross section area percent fill for each type and size of conductor and raceway. Only those devices connected and incorporated into the final system shall be on these floor plans. Do not show any removed devices on the floor plans. Show all interfaces for all fire safety functions.
3. Riser diagrams: Provide, for the entire system, the number, size and type of riser raceways and conductors in each riser raceway and number of each type device per floor and zone. Show door holder interface, elevator control interface, HVAC shutdown interface, fire extinguishing system interface, and all other fire safety interfaces. Show wiring Styles on the riser diagram for all circuits. Provide diagrams both on a per building and campus wide basis.
 4. Detailed wiring diagrams: Provide for control panels, modules, power supplies, electrical power connections, auxiliary relays and annunciators showing termination identifications, size and type conductors, circuit boards, LED lamps, indicators, adjustable controls, switches, ribbon connectors, wiring harnesses, terminal strips and connectors, spare zones/circuits. Diagrams shall be drawn to a scale sufficient to show spatial relationships between components, enclosures and equipment configuration.
 5. Two weeks prior to final inspection, the Contractor shall deliver to the COTR 3 sets of as-built drawings and one set of the as-built drawing computer files (using AutoCAD 2007 or later). As-built drawings (floor plans) shall show all new and/or existing conduit used for the fire alarm system.

C. Manuals:

1. Submit simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals including technical data sheets for all items used in the system, power requirements, device wiring diagrams, dimensions, and information for ordering replacement parts.
 - a. Wiring diagrams shall have their terminals identified to facilitate installation, operation, expansion and maintenance.

- b. Wiring diagrams shall indicate internal wiring for each item of equipment and the interconnections between the items of equipment.
 - c. Include complete listing of all software used and installation and operation instructions including the input/output matrix chart.
 - d. Provide a clear and concise description of operation that gives, in detail, the information required to properly operate, inspect, test and maintain the equipment and system. Provide all manufacturer's installation limitations including but not limited to circuit length limitations.
 - e. Complete listing of all digitized voice messages.
 - f. Provide standby battery calculations under normal operating and alarm modes. Battery calculations shall include the magnets for holding the doors open for one minute.
 - g. Include information indicating who will provide emergency service and perform post contract maintenance.
 - h. Provide a replacement parts list with current prices. Include a list of recommended spare parts, tools, and instruments for testing and maintenance purposes.
 - i. A computerized preventive maintenance schedule for all equipment. The schedule shall be provided on disk in a computer format acceptable to the VAMC and shall describe the protocol for preventive maintenance of all equipment. The schedule shall include the required times for systematic examination, adjustment and cleaning of all equipment. A print out of the schedule shall also be provided in the manual. Provide the disk in a pocket within the manual.
 - j. Furnish manuals in 3 ring loose-leaf binder or manufacturer's standard binder.
 - k. A print out for all devices proposed on each signaling line circuit with spare capacity indicated.
2. Two weeks prior to final inspection, deliver 4 copies of the final updated maintenance and operating manual to the COTR.
- a. The manual shall be updated to include any information necessitated by the maintenance and operating manual approval.

- b. Complete "As installed" wiring and schematic diagrams shall be included that shows all items of equipment and their interconnecting wiring. Show all final terminal identifications.
 - c. Complete listing of all programming information, including all control events per device including an updated input/output matrix.
 - d. Certificate of Installation as required by NFPA 72 for each building. The certificate shall identify any variations from the National Fire Alarm Code.
 - e. Certificate from equipment manufacturer assuring compliance with all manufacturers installation requirements and satisfactory system operation.
- D. Certifications:
- 1. Together with the shop drawing submittal, submit the technician's NICET level III fire alarm certification as well as certification from the control unit manufacturer that the proposed performer of contract maintenance is an authorized representative of the major equipment manufacturer. Include in the certification the names and addresses of the proposed supervisor of installation and the proposed performer of contract maintenance. Also include the name and title of the manufacturer's representative who makes the certification.
 - 2. Together with the shop drawing submittal, submit a certification from either the control unit manufacturer or the manufacturer of each component (e.g., smoke detector) that the components being furnished are compatible with the control unit.
 - 3. Together with the shop drawing submittal, submit a certification from the major equipment manufacturer that the wiring and connection diagrams meet this specification, UL and NFPA 72 requirements.

1.5 WARRANTY

All work performed and all material and equipment furnished under this contract shall be free from defects and shall remain so for a period of one year from the date of acceptance of the entire installation by the Contracting Officer.

1.6 APPLICABLE PUBLICATIONS

- A. The publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. The publications are referenced in text by the

basic designation only and the latest editions of these publications shall be applicable.

B. National Fire Protection Association (NFPA):

NFPA 13Standard for the Installation of Sprinkler
Systems, 2010 edition

NFPA 14Standard for the Installation of Standpipes and
Hose Systems, 2010 edition

NFPA 20Standard for the Installation of Stationary
Pumps for Fire Protection, 2010 edition

NFPA 70.....National Electrical Code (NEC), 2011 edition

NFPA 72.....National Fire Alarm Code, 2010 edition

NFPA 90A.....Standard for the Installation of Air
Conditioning and Ventilating Systems, 2009
edition

NFPA 101.....Life Safety Code, 2009 edition

C. Underwriters Laboratories, Inc. (UL): Fire Protection Equipment
Directory

D. Factory Mutual Research Corp (FM): Approval Guide, 2007-2011

E. American National Standards Institute (ANSI):

S3.41.....Audible Emergency Evacuation Signal, 1990
edition, reaffirmed 2008

F. International Code Council, International Building Code (IBC), 2009
edition

PART 2 PRODUCTS

2.1 EQUIPMENT AND MATERIALS, GENERAL

A. All equipment and components shall be new and the manufacturer's current model. All equipment shall be tested and listed by Underwriters Laboratories, Inc. or Factory Mutual Research Corporation for use as part of a fire alarm system. The authorized representative of the manufacturer of the major equipment shall certify that the installation complies with all manufacturers' requirements and that satisfactory total system operation has been achieved.

2.2 CONDUIT, BOXES, AND WIRE

A. Conduit shall be in accordance with Section 28 05 28.33 CONDUIT AND BACKBOXES FOR ELECTRONIC SAFETY AND SECURITY and as follows:

1. All new conduits shall be installed in accordance with NFPA 70.

2. Conduit fill shall not exceed 40 percent of interior cross sectional area.
3. All new conduits shall be 3/4 inch (19 mm) minimum.

B. Wire:

1. Wiring shall be in accordance with NEC article 760, Section 28 05 13, CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY, and as recommended by the manufacturer of the fire alarm system. All wires shall be color coded. Number and size of conductors shall be as recommended by the fire alarm system manufacturer, but not less than 18 AWG for initiating device circuits and 14 AWG for notification device circuits.
2. Addressable circuits and wiring used for the multiplex communication loop shall be twisted and shielded unless specifically excepted by the fire alarm equipment manufacturer in writing.
3. Any fire alarm system wiring that extends outside of a building shall have additional power surge protection to protect equipment from physical damage and false signals due to lightning, voltage and current induced transients. Protection devices shall be shown on the submittal drawings and shall be UL listed or in accordance with written manufacturer's requirements.
4. All wire or cable used in underground conduits including those in concrete shall be listed for wet locations.

C. Terminal Boxes, Junction Boxes, and Cabinets:

1. Shall be galvanized steel in accordance with UL requirements.
2. All boxes shall be sized and installed in accordance with NFPA 70.
3. covers shall be repainted red in accordance with Section 09 91 00, PAINTING and shall be identified with white markings as "FA" for junction boxes and as "FIRE ALARM SYSTEM" for cabinets and terminal boxes. Lettering shall be a minimum of 3/4 inch (19 mm) high.
4. Terminal boxes and cabinets shall have a volume 50 percent greater than required by the NFPA 70. Minimum sized wire shall be considered as 14 AWG for calculation purposes.
5. Terminal boxes and cabinets shall have identified pressure type terminal strips and shall be located at the base of each riser. Terminal strips shall be labeled as specified or as approved by the COTR.

2.3 FIRE ALARM CONTROL UNIT

A. General:

1. Each building and building expansion shall be provided with a fire alarm control unit and shall operate as a supervised zoned fire alarm system.
2. Each power source shall be supervised from the other source for loss of power.
3. All circuits shall be monitored for integrity.
4. Visually and audibly annunciate any trouble condition including, but not limited to main power failure, grounds and system wiring derangement.
5. Transmit digital alarm information to the main fire alarm control unit.

B. Enclosure:

1. The control unit shall be housed in a cabinet suitable for both recessed and surface mounting. Cabinet and front shall be corrosion protected, given a rust-resistant prime coat, and manufacturer's standard finish.
2. Cabinet shall contain all necessary relays, terminals, lamps, and legend plates to provide control for the system.

D. Power Supply:

1. The control unit shall derive its normal power from a 120 volt, 60 Hz dedicated supply connected to the emergency power system. Standby power shall be provided by a 24 volt DC battery as hereinafter specified. The normal power shall be transformed, rectified, coordinated, and interfaced with the standby battery and charger.
2. The door holder power shall be arranged so that momentary or sustained loss of main operating power shall not cause the release of any door.
3. Power supply for smoke detectors shall be taken from the fire alarm control unit.
4. Provide protectors to protect the fire alarm equipment from damage due to lightning or voltage and current transients.
5. Provide new separate and direct ground lines to the outside to protect the equipment from unwanted grounds.

E. Circuit Supervision: Each alarm initiating device circuit, signaling line circuit, and notification appliance circuit, shall be supervised against the occurrence of a break or ground fault condition in the

field wiring. These conditions shall cause a trouble signal to sound in the control unit until manually silenced by an off switch.

F. Supervisory Devices: All sprinkler system valves, standpipe control valves, post indicator valves (PIV), and main gate valves shall be supervised for off-normal position. Closing a valve shall sound a supervisory signal at the control unit until silenced by an off switch. The specific location of all closed valves shall be identified at the control unit. Valve operation shall not cause an alarm signal. Low air pressure switches and duct detectors shall be monitored as supervisory signals. The power supply to the elevator shunt trip breaker shall be monitored by the fire alarm system as a supervisory signal.

G. Trouble signals:

1. Arrange the trouble signals for automatic reset (non-latching).
2. System trouble switch off and on lamps shall be visible through the control unit door.

H. Function Switches: Provide the following switches in addition to any other switches required for the system:

1. Remote Alarm Transmission By-pass Switch: Shall prevent transmission of all signals to the main fire alarm control unit when in the "off" position. A system trouble signal shall be energized when switch is in the off position.
2. Alarm Off Switch: Shall disconnect power to alarm notification circuits on the local building alarm system. A system trouble signal shall be activated when switch is in the off position.
3. Trouble Silence Switch: Shall silence the trouble signal whenever the trouble silence switch is operated. This switch shall not reset the trouble signal.
4. Reset Switch: Shall reset the system after an alarm, provided the initiating device has been reset. The system shall lock in alarm until reset.
5. Lamp Test Switch: A test switch or other approved convenient means shall be provided to test the indicator lamps.
6. Drill Switch: Shall activate all notification devices without tripping the remote alarm transmitter. This switch is required only for general evacuation systems specified herein.
7. Door Holder By-Pass Switch: Shall prevent doors from releasing during fire alarm tests. A system trouble alarm shall be energized when switch is in the abnormal position.

8. Elevator recall By-Pass Switch: Shall prevent the elevators from recalling upon operation of any of the devices installed to perform that function. A system trouble alarm shall be energized when the switch is in the abnormal position.
9. HVAC/Smoke Damper By-Pass: Provide a means to disable HVAC fans from shutting down and/or smoke dampers from closing upon operation of an initiating device designed to interconnect with these devices.
- I. Remote Transmissions:
 1. Provide capability and equipment for transmission of alarm, supervisory and trouble signals to the main fire alarm control unit.
 2. Transmitters shall be compatible with the systems and equipment they are connected to such as timing, operation and other required features.
- J. Remote Control Capability: Each building fire alarm control unit shall be installed and programmed so that each must be reset locally after an alarm, before the main fire alarm control unit can be reset. After the local building fire alarm control unit has been reset, then the all system acknowledge, reset, silence or disabling functions can be operated by the main fire alarm control unit
- K. System Expansion: Design the control units and enclosures so that the system can be expanded in the future (to include the addition of 20 percent more alarm initiating, alarm notification and door holder circuits) without disruption or replacement of the existing control unit and secondary power supply.

2.5 ANNUNCIATION

- A. Annunciator, Alphanumeric Type (System):
 1. Shall be a supervised, LCD display containing a minimum of 2 lines of 40 characters for alarm annunciation in clear English text.
 2. Message shall identify building number, floor, zone, etc on the first line and device description and status (pull station, smoke detector, waterflow alarm or trouble condition) on the second line.
 3. The initial alarm received shall be indicated as such.
 4. A selector switch shall be provided for viewing subsequent alarm messages.
 5. The display shall be UL listed for fire alarm application.
 6. Annunciators shall display information for all buildings connected to the system. Local building annunciators, for general evacuation

system buildings, shall be permitted when shown on the drawings and approved by the COTR.

B. Printers:

1. System printers shall be high reliability digital input devices, UL approved, for fire alarm applications. The printers shall operate at a minimum speed of 30 characters per second. The printer shall be continually supervised.
2. Printers shall be programmable to either alarm only or event logging output.
 - a. Alarm printers shall provide a permanent (printed) record of all alarm information that occurs within the fire alarm system. Alarm information shall include the date, time, building number, floor, zone, device type, device address, and condition.
 - b. Event logging printers shall provide a permanent (printed) record of every change of status that occurs within the fire alarm system. Status information shall include date, time, building number, floor, zone, device type, device address and change of status (alarm, trouble, supervisory, reset/return to normal).
3. System printers shall provide tractor drive feed pins for conventional fan fold 8-1/2" x 11" (213 mm x 275 mm) paper.
4. The printers shall provide a printing and non-printing self test feature.
5. Power supply for printers shall be taken from and coordinated with the building emergency service.
6. Each printer shall be provided with a stand for the printer and paper.
7. Spare paper and ribbons for printers shall be stocked and maintained as part of the one year guarantee period services in addition to the one installed after the approval of the final acceptance test.

2.6 VOICE COMMUNICATION SYSTEM (VCS)

A. General:

1. An emergency voice communication system shall be installed throughout.
2. Upon receipt of an alarm signal from the building fire alarm system, the VCS shall automatically transmit a pre-recorded fire alarm message throughout the building.

3. A digitized voice module shall be used to store each prerecorded message.
4. The VCS shall be arranged as a dual channel system capable of transmitting 2 different messages simultaneously.
5. The VCS shall supervise all speaker circuits, control equipment, remote audio control equipment, and amplifiers.

B. Speaker Circuit Control Unit:

1. The speaker circuit control unit shall include switches to manually activate or deactivate speaker circuits grouped by floor in the system.
2. Speaker circuit control switches shall provide on, off, and automatic positions and indications.
3. The speaker circuit control unit shall include visual indication of active or trouble status for each group of speaker circuits in the system.
4. A trouble indication shall be provided if a speaker circuit group is disabled.
5. A lamp test switch shall be provided to test all indicator lamps.
6. A single "all call" switch shall be provided to activate all speaker circuit groups simultaneously.
7. A push-to-talk microphone shall be provided for manual voice messages.
8. Remote microphones shall be provided in the security office for manual "all call" messages to each individual building.
9. A voice message disconnect switch shall be provided to disconnect automatic digitized voice messages from the system. The system shall be arranged to allow manual voice messages and indicate a system trouble condition when activated.

C. Speaker Circuit Arrangement:

1. Speaker circuits shall be arranged such that there is one speaker circuit per smoke zone.
2. Audio amplifiers and control equipment shall be electrically supervised for normal and abnormal conditions.
3. Speaker circuits shall be either 25 VRMS or 70.7 VRMS with a minimum of 50 percent spare power available.
4. Speaker circuits and control equipment shall be arranged such that loss of any one speaker circuit will not cause the loss of any other speaker circuit in the system.

D. Digitized Voice Module (DVM):

1. The Digitized Voice Module shall provide prerecorded digitized evacuation and instructional messages. The messages shall be professionally recorded and approved by the COTR prior to programming.
2. The DVM shall be configured to automatically output to the desired circuits following a 10-second slow whoop alert tone.
3. Prerecorded magnetic taped messages and tape players are not permitted.
4. The digitized message capacity shall be no less than 15 second in length.
5. The digitized message shall be transmitted 3 times.
6. The DVM shall be supervised for operational status.
7. Failure of the DVM shall result in the transmission of a constant alarm tone.
8. The DVM memory shall have a minimum 50 percent spare capacity after those messages identified in this section are recorded. Multiple DVM's may be used to obtain the required capacity.

E. Audio Amplifiers:

1. Audio Amplifiers shall provide a minimum of 50 Watts at either 25 or 70.7 VRMS output voltage levels.
2. Amplifiers shall be continuously supervised for operational status.
3. Amplifiers shall be configured for either single or dual channel application.
4. Each audio output circuit connection shall be configurable for Style X.
5. A minimum of 50 percent spare output capacity shall be available for each amplifier.

F. Tone Generator(s):

1. Tone Generator(s) shall be capable of providing a distinctive 3-pulse temporal pattern fire alarm signal as well as a slow whoop.
2. Tone Generator(s) shall be continuously supervised for operational status.

2.7 ALARM NOTIFICATION APPLIANCES

A. Bells:

1. Shall be electric, single-stroke or vibrating, heavy-duty, under-dome, solenoid type.

2. Unless otherwise shown on the drawings, shall be 6 inches (150 mm) diameter and have a minimum nominal rating of 80 dBA at 10 feet (3,000 mm).
3. Mount on removable adapter plates on outlet boxes.
4. Bells located outdoors shall be weatherproof type with metal housing and protective grille.
5. Each bell circuit shall have a minimum of 20 percent spare capacity.

B. Speakers:

1. Shall operate on either 25 VRMS or 70.7 VRMS with field selectable output taps from 0.5 to 2.0W and originally installed at the 1/2 watt tap. Speakers shall provide a minimum sound output of 80 dBA at 10 feet (3,000 mm) with the 1/2 watt tap.
2. Frequency response shall be a minimum of 400 HZ to 4,000 HZ.
3. Four inches (100 mm) or 8 inches (200 mm) cone type speakers ceiling mounted with white colored baffles in areas with suspended ceilings and wall mounted in areas without ceilings.

C. Strobes:

1. Xenon flash tube type minimum 15 candela in toilet rooms and 75 candela in all other areas with a flash rate of 1 HZ. Strobes shall be synchronized where required by the National Fire Alarm Code (NFPA 72).
2. Backplate shall be red with 1/2 inch (13 mm) permanent red letters. Lettering to read "Fire", be oriented on the wall or ceiling properly, and be visible from all viewing directions.
3. Each strobe circuit shall have a minimum of 20 percent spare capacity.
4. Strobes may be combined with the audible notification appliances specified herein.

D. Fire Alarm Horns:

1. Shall be electric, utilizing solid state electronic technology operating on a nominal 24 VDC.
2. Shall be a minimum nominal rating of 80 dBA at 10 feet (3,000 mm).
3. Mount on removable adapter plates on conduit boxes.
4. Horns located outdoors shall be of weatherproof type with metal housing and protective grille.
5. Each horn circuit shall have a minimum of 20 percent spare capacity.

2.8 ALARM INITIATING DEVICES

A. Manual Fire Alarm Stations:

1. Shall be non-breakglass, address reporting type.
2. Station front shall be constructed of a durable material such as cast or extruded metal or high impact plastic. Stations shall be semi-flush type.
3. Stations shall be of single action pull down type with suitable operating instructions provided on front in raised or depressed letters, and clearly labeled "FIRE."
4. Operating handles shall be constructed of a durable material. On operation, the lever shall lock in alarm position and remain so until reset. A key shall be required to gain front access for resetting, or conducting tests and drills.
5. Unless otherwise specified, all exposed parts shall be red in color and have a smooth, hard, durable finish.
6. Stations identified as key operated only shall have a single standardized lock and key separate from the control equipment.

B. Smoke Detectors:

1. Smoke detectors shall be photoelectric type and UL listed for use with the fire alarm control unit being furnished.
2. Smoke detectors shall be addressable type complying with applicable UL Standards for system type detectors. Smoke detectors shall be installed in accordance with the manufacturer's recommendations and NFPA 72.
3. Detectors shall have an indication lamp to denote an alarm condition. Provide remote indicator lamps and identification plates where detectors are concealed from view. Locate the remote indicator lamps and identification plates flush mounted on walls so they can be observed from a normal standing position.
4. All spot type and duct type detectors installed shall be of the photoelectric type.
5. Photoelectric detectors shall be factory calibrated and readily field adjustable. The sensitivity of any photoelectric detector shall be factory set at 3.0 plus or minus 0.25 percent obscuration per foot.
6. Detectors shall provide a visual trouble indication if they drift out of sensitivity range or fail internal diagnostics. Detectors shall also provide visual indication of sensitivity level upon testing. Detectors, along with the fire alarm control units shall be UL listed for testing the sensitivity of the detectors.

C. Heat Detectors:

1. Heat detectors shall be of the addressable restorable rate compensated fixed-temperature spot type.
2. Detectors shall have a minimum smooth ceiling rating of 2,500 square feet (230 square meters).
3. Ordinary temperature (135 degrees F (57 degrees C)) heat detectors shall be utilized in // elevator shafts and // elevator mechanical rooms. Intermediate temperature rated (200 degrees F (93 degrees C)) heat detectors shall be utilized in all other areas.
4. Provide a remote indicator lamp, key test station and identification nameplate (e.g. "Heat Detector - Elevator P-_____) for each elevator group. Locate key test station in plain view on elevator machine room wall.

D. Water Flow and Pressure Switches:

1. Wet pipe water flow switches and dry pipe alarm pressure switches for sprinkler systems shall be connected to the fire alarm system by way of an address reporting interface device.
2. All new water flow switches shall be of a single manufacturer and series and non-accumulative retard type. See Section 21 12 00, FIRE-SUPPRESSION STANDPIPES and Section 21 13 13, WET-PIPE SPRINKLER SYSTEMS for new switches added. Connect all switches shown on the approved shop drawings.
3. All new switches shall have an alarm transmission delay time that is conveniently adjustable from 0 to 60 seconds. Initial settings shall be 30-45 seconds. Timing shall be recorded and documented during testing.

E. Extinguishing System Connections:

1. Kitchen Range Hood and Duct Suppression Systems:
 - a. Each suppression system shall be equipped with a micro-switch connected to the building fire alarm control unit. Discharge of a suppression system shall automatically send a alarm signal to the building fire detection and alarm system for annunciation.
 - b. Operation of this suppression system shall also automatically shut off all sources of fuel and heat to all equipment requiring protection under the same hood.
2. Each gaseous suppression system shall be monitored for system alarm and system trouble conditions via addressable interface devices.

2.9 SUPERVISORY DEVICES

A. Duct Smoke Detectors:

1. Duct smoke detectors shall be provided and connected by way of an address reporting interface device. Detectors shall be provided with an approved duct housing mounted exterior to the duct, and shall have perforated sampling tubes extending across the full width of the duct (wall to wall). Detector placement shall be such that there is uniform airflow in the cross section of the duct.
2. Interlocking with fans shall be provided in accordance with NFPA 90A and as specified hereinafter under Part 3.2, "TYPICAL OPERATION".
3. Provide remote indicator lamps, key test stations and identification nameplates (e.g. "DUCT SMOKE DETECTOR AHU-X") for all duct detectors. Locate key test stations in plain view on walls or ceilings so that they can be observed and operated from a normal standing position.

B. Sprinkler and Standpipe System Supervisory Switches:

1. Each sprinkler system water supply control valve, riser valve or zone control valve, and each standpipe system riser control valve shall be equipped with a supervisory switch. Standpipe hose valves, and test and drain valves shall not be equipped with supervisory switches.
2. PIV (post indicator valve) or main gate valve shall be equipped with a supervisory switch.
3. Valve supervisory switches shall be connected to the fire alarm system by way of address reporting interface device. See Section 21 13 13, WET-PIPE SPRINKLER SYSTEMS for new switches to be added. Connect tamper switches for all control valves shown on the approved shop drawings.
4. The mechanism shall be contained in a weatherproof die-cast aluminum housing that shall provide a 3/4 inch (19 mm) tapped conduit entrance and incorporate the necessary facilities for attachment to the valves.
5. The entire installed assembly shall be tamper-proof and arranged to cause a switch operation if the housing cover is removed or if the unit is removed from its mounting.
6. Where dry-pipe sprinkler systems are installed, high and low air pressure switches shall be provided and monitored by way of an address reporting interface devices.

2.10 ADDRESS REPORTING INTERFACE DEVICE

- A. Shall have unique addresses that reports directly to the building fire alarm panel.
- B. Shall be configurable to monitor normally open or normally closed devices for both alarm and trouble conditions.
- C. Shall have terminal designations clearly differentiating between the circuit to which they are reporting from and the device that they are monitoring.
- D. Shall be UL listed for fire alarm use and compatibility with the panel to which they are connected.
- E. Shall be mounted in weatherproof housings if mounted exterior to a building.

2.11 SMOKE BARRIER DOOR CONTROL

- A. Electromagnetic Door Holders:
 - 1. New Door Holders shall be standard wall mounted electromagnetic type. In locations where doors do not come in contact with the wall when in the full open position, an extension post shall be added to the door bracket.
 - 2. Operation shall be by 24 volt DC supplied from a battery located at the fire alarm control unit. Door holders shall be coordinated as to voltage, ampere drain, and voltage drop with the battery, battery charger, wiring and fire alarm system for operation as specified.
- B. A maximum of twelve door holders shall be provided for each circuit. Door holders shall be wired to allow releasing doors by smoke zone.
- C. Door holder control circuits shall be electrically supervised.
- D. Smoke detectors shall not be incorporated as an integral part of door holders.

2.12 UTILITY LOCKS AND KEYS:

- A. All key operated test switches, control units, annunciator panels and lockable cabinets shall be provided with a single standardized utility lock and key.
- B. Key-operated manual fire alarm stations shall have a single standardized lock and key separate from the control equipment.
- C. All keys shall be delivered to the COTR.

2.13 SPARE AND REPLACEMENT PARTS

- A. Provide spare and replacement parts as follows:
 - 1. Manual pull stations - 2
 - 2. Key operated manual pull stations - 2

3. Heat detectors - 2 of each type
 4. Fire alarm strobes - 2
 5. Fire alarm bells - 2
 6. Fire alarm speakers - 2
 7. Smoke detectors - 4
 8. Duct smoke detectors with all appurtenances - 1
 9. Sprinkler system water flow switch - 1 of each size
 10. Sprinkler system water pressure switch - 1 of each type
 11. Sprinkler valve tamper switch - 1 of each type
 12. Control equipment utility locksets - 1
 13. Control equipment keys - 5
 14. Key operated manual pull station keys - 5
 15. 2.5 oz containers aerosol smoke - 12
 16. Printer paper - 3 boxes
 17. Printer replacement ribbons - 3
 18. Monitor modules - 1
 19. Control modules - 1
 20. Fire alarm SLC cable (same as installed) - 50 feet (15 m)
- B. Keys for key-operated manual pull stations shall be provided 30 days prior to actual installation.
- C. Spare and replacement parts shall be in original packaging and submitted to the COTR.
- D. Furnish and install a storage cabinet of sufficient size and suitable for storing spare equipment. Doors shall include a pad locking device. Padlock to be provided by the VA. Location of cabinet to be determined by the COTR.
- E. Provide to the VA, all hardware, software, programming tools, license and documentation necessary to permanently modify the fire alarm system on site. The minimum level of modification includes addition and deletion of devices, circuits, zones and changes to system description, system operation, and digitized evacuation and instructional messages.

2.14 INSTRUCTION CHART:

Provide typewritten instruction card mounted behind a Lexan plastic or glass cover in a stainless steel or aluminum frame with a backplate. Install the frame in a conspicuous location observable from each control unit where operations are performed. The card shall show those steps to be taken by an operator when a signal is received under all conditions, normal, alarm, supervisory, and trouble. Provide an

additional copy with the binder for the input output matrix for the sequence of operation. The instructions shall be approved by the COTR before being posted.

PART 3 - EXECUTION

3.1 INSTALLATION:

- A. Installation shall be in accordance with NFPA 70, 72, 90A, and 101 as shown on the drawings, and as recommended by the major equipment manufacturer. Fire alarm wiring shall be installed in conduit. All conduit and wire shall be installed in accordance with, Section 28 05 13 CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY, Section 28 05 26 GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY, Section 28 05 28.33 CONDUIT AND BACKBOXES FOR ELECTRONIC SAFETY AND SECURITY, and all penetrations of smoke and fire barriers shall be protected as required by Section 07 84 00, FIRESTOPPING.
- B. All conduits, junction boxes, conduit supports and hangers shall be concealed in finished areas and may be exposed in unfinished areas.
- C. All new and reused exposed conduits shall be painted in accordance with Section 09 91 00, PAINTING to match surrounding finished areas and red in unfinished areas.
- D. All existing accessible fire alarm conduit not reused shall be removed.
- E. Existing devices that are reused shall be properly mounted and installed. Where devices are installed on existing shallow backboxes, extension rings of the same material, color and texture of the new fire alarm devices shall be used. Mounting surfaces shall be cut and patched in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Restoration, and be re-painted in accordance with Section 09 91 00, PAINTING as necessary to match existing.
- F. All fire detection and alarm system devices, control units and remote annunciators shall be flush mounted when located in finished areas and may be surface mounted when located in unfinished areas. Exact locations are to be approved by the COTR.
- G. Speakers shall be ceiling mounted and fully recessed in areas with suspended ceilings. Speakers shall be wall mounted and recessed in finished areas without suspended ceilings. Speakers may be surface mounted in unfinished areas.

- H. Strobes shall be flush wall mounted with the bottom of the unit located 80 inches (2,000 mm) above the floor or 6 inches (150 mm) below ceiling, whichever is lower. Locate and mount to maintain a minimum 36 inches (900 mm) clearance from side obstructions.
- I. Manual pull stations shall be installed not less than 42 inches (1,050 mm) or more than 48 inches (1,200 mm) from finished floor to bottom of device and within 60 inches (1,500 mm) of a stairway or an exit door.
- J. Where possible, locate water flow and pressure switches a minimum of 12 inches (300 mm) from a fitting that changes the direction of the flow and a minimum of 36 inches (900 mm) from a valve.
- K. Mount valve tamper switches so as not to interfere with the normal operation of the valve and adjust to operate within 2 revolutions toward the closed position of the valve control, or when the stem has moved no more than 1/5 of the distance from its normal position.
- L. Connect flow and tamper switches installed under Section 21 13 13, WET-PIPE SPRINKLER SYSTEMS.
- M. Connect combination closer-holders installed under Section 08 71 00, DOOR HARDWARE.

3.2 TYPICAL OPERATION

- A. Activation of any manual pull station, water flow or pressure switch, heat detector, kitchen hood suppression system, gaseous suppression system, or smoke detector shall cause the following operations to occur:
 - 1. Operate the emergency voice communication system in Building 108A. For sprinkler protected buildings, flash strobes continuously only in the zone of alarm. For buildings without sprinkler protection throughout, flash strobes continuously only on the floor of alarm.
 - 2. Continuously sound atemporal pattern general alarm and flash all strobes in the building in alarm until reset at the local fire alarm control unit in Building 108A.
 - 3. Release only the magnetic door holders on the floor from which alarm was initiated after the alert signal.
 - 4. Transmit a separate alarm signal, via the main fire alarm control unit to the fire department.
 - 5. Unlock the electrically locked exit doors within the zone of alarm.
- B. Heat detectors in elevator machine rooms shall, in addition to the above functions, disconnect all power to all elevators served by that machine room after a time delay. The time delay shall be programmed

within the fire alarm system programming and be equal to the time it takes for the car to travel from the highest to the lowest level, plus 10 seconds.

- C. Smoke detectors in the primary elevator lobbies of Building 108A shall, in addition to the above functions, return all elevators in the bank to the secondary floor.
- D. Smoke detectors in the remaining elevator lobbies, elevator machine room, or top of hoistway shall, in addition to the above functions, return all elevators in the bank to the primary floor.
- E. Operation of a smoke detector at a corridor door used for automatic closing shall also release only the magnetic door holders on that floor. Operation of a smoke detector at a shutter used for automatic closing shall also release only the shutters on that floor.
- F. Operation of duct smoke detectors shall cause a system supervisory condition and shut down the ventilation system and close the associated smoke dampers as appropriate.
- G. Operation of any sprinkler or standpipe system valve supervisory switch, high/low air pressure switch, or fire pump alarm switch shall cause a system supervisory condition.
- H. Alarm verification shall not be used for smoke detectors installed for the purpose of early warning.

3.3 TESTS

- A. Provide the service of a NICET level III, competent, factory-trained engineer or technician authorized by the manufacturer of the fire alarm equipment to technically supervise and participate during all of the adjustments and tests for the system. Make all adjustments and tests in the presence of the COTR.
- B. When the systems have been completed and prior to the scheduling of the final inspection, furnish testing equipment and perform the following tests in the presence of the COTR. When any defects are detected, make repairs or install replacement components, and repeat the tests until such time that the complete fire alarm systems meets all contract requirements. After the system has passed the initial test and been approved by the COTR, the contractor may request a final inspection.
 - 1. Before energizing the cables and wires, check for correct connections and test for short circuits, ground faults, continuity, and insulation.

2. Test the insulation on all installed cable and wiring by standard methods as recommended by the equipment manufacturer.
3. Run water through all flow switches. Check time delay on water flow switches. Submit a report listing all water flow switch operations and their retard time in seconds.
4. Open each alarm initiating and notification circuit to see if trouble signal actuates.
5. Ground each alarm initiation and notification circuit and verify response of trouble signals.

3.4 FINAL INSPECTION AND ACCEPTANCE

- A. Prior to final acceptance a minimum 30 day "burn-in" period shall be provided. The purpose shall be to allow equipment to stabilize and potential installation and software problems and equipment malfunctions to be identified and corrected. During this diagnostic period, all system operations and malfunctions shall be recorded. Final acceptance will be made upon successful completion of the "burn-in" period and where the last 14 days is without a system or equipment malfunction.
- B. At the final inspection a factory trained representative of the manufacturer of the major equipment shall repeat the tests in Article 3.3 TESTS and those required by NFPA 72. In addition the representative shall demonstrate that the systems function properly in every respect. The demonstration shall be made in the presence of a VA representative.

3.5 INSTRUCTION

- A. The manufacturer's authorized representative shall provide instruction and training to the VA as follows:
 1. Six 1-hour sessions to engineering staff, security police and central attendant personnel for simple operation of the system. Two sessions at the start of installation, 2 sessions at the completion of installation and 2 sessions 3 months after the completion of installation.
 2. Four 2-hour sessions to engineering staff for detailed operation of the system. Two sessions at the completion of installation and 2 sessions 3 months after the completion of installation.
 3. Three 8-hour sessions to electrical technicians for maintaining, programming, modifying, and repairing the system at the completion of installation and one 8-hour refresher session 3 months after the completion of installation.

- B. The Contractor and/or the Systems Manufacturer's representative shall provide a typewritten "Sequence of Operation" including a trouble shooting guide of the entire system for submittal to the VA. The sequence of operation will be shown for each input in the system in a matrix format and provided in a loose leaf binder. When reading the sequence of operation, the reader will be able to quickly and easily determine what output will occur upon activation of any input in the system. The INPUT/OUTPUT matrix format shall be as shown in Appendix A to NFPA 72.
- C. Furnish the services of a competent instructor for instructing personnel in the programming requirements necessary for system expansion. Such programming shall include addition or deletion of devices, zones, indicating circuits and printer/display text.

PART 4 - SCHEDULES

4.1 SMOKE ZONE DESCRIPTIONS:

4.2 DIGITIZED VOICE MESSAGES:

- A. Digitized voice messages shall be provided for each smoke zone of Building 108A. The messages shall be arranged with a 3 second alert tone, a "Code Red" message and a description of the fire alarm area (building number, floor, level and smoke zone). A sample of such a message is as follows:

Alert Tone

Code Red

Building One, Second Floor, East Wing

Code Red

Building One, Second Floor, East Wing

Code Red

Building One, Second Floor, East Wing

4.3 LOCATION OF VOICE MESSAGES:

Upon receipt of an alarm signal from the building fire alarm system, the voice communication system shall automatically transmit a 3 second tone alert and a pre-recorded fire alarm message throughout Building 108A.

- - END - -