


GENERAL NOTES:

- DOMESTIC WATER SERVICE LINES SHOWN ARE ONLY INTENDED TO INDICATE THE GENERAL LOCATION OF THE WATER SERVICE ENTRANCE IN RELATION TO THE BUILDING. ACTUAL WATER LINE LOCATIONS MUST BE FIELD VERIFIED BY THE CONTRACTOR.
- PLUMBING CONTRACTOR SHALL PRODUCE COORDINATION DRAWINGS FOR ALL PLUMBING DEMOLITION AND NEW PLUMBING TO BE PERFORMED AND SUBMIT TO COR FOR APPROVAL PRIOR TO BEGINNING WORK.
- COORDINATE LOCATIONS OF ALL OUTDOOR PROTECTIVE ENCLOSURES, SUMP PITS, AND SUMP DISCHARGE PADS WITH COR.

CROSS CONNECTION CONTROL PLAN NOTES:


- INSTALL DOUBLE CHECK VALVE ASSEMBLY, SEE TABLE 1.
- INSTALL SINGLE REDUCED PRESSURE ZONE ASSEMBLY, SEE TABLE 1.
- INSTALL DUPLEX REDUCED PRESSURE ZONE ASSEMBLY, SEE TABLE 1.
- INSTALL SUMP PIT AND PUMP SYSTEM, SEE DETAIL **CU-002**
- INSTALL SUMP DISCHARGE PIPING AND CONCRETE DISCHARGE PAD, SEE DETAILS **CU-002**, **CU-003**
- CONSTRUCT INTERIOR EQUIPMENT ENCLOSURE AND ACCESS PANEL. PROVIDE DISCHARGE BASIN AND DRAIN THROUGH WALL TO DRIVEWAY.
- CONSTRUCT OUTDOOR PROTECTIVE ENCLOSURE AND CONCRETE EQUIPMENT PAD, SEE DETAIL **CU-002**
- INSTALL SUMP DISCHARGE PIPING TO EXISTING CONCRETE GUTTER DRAIN.

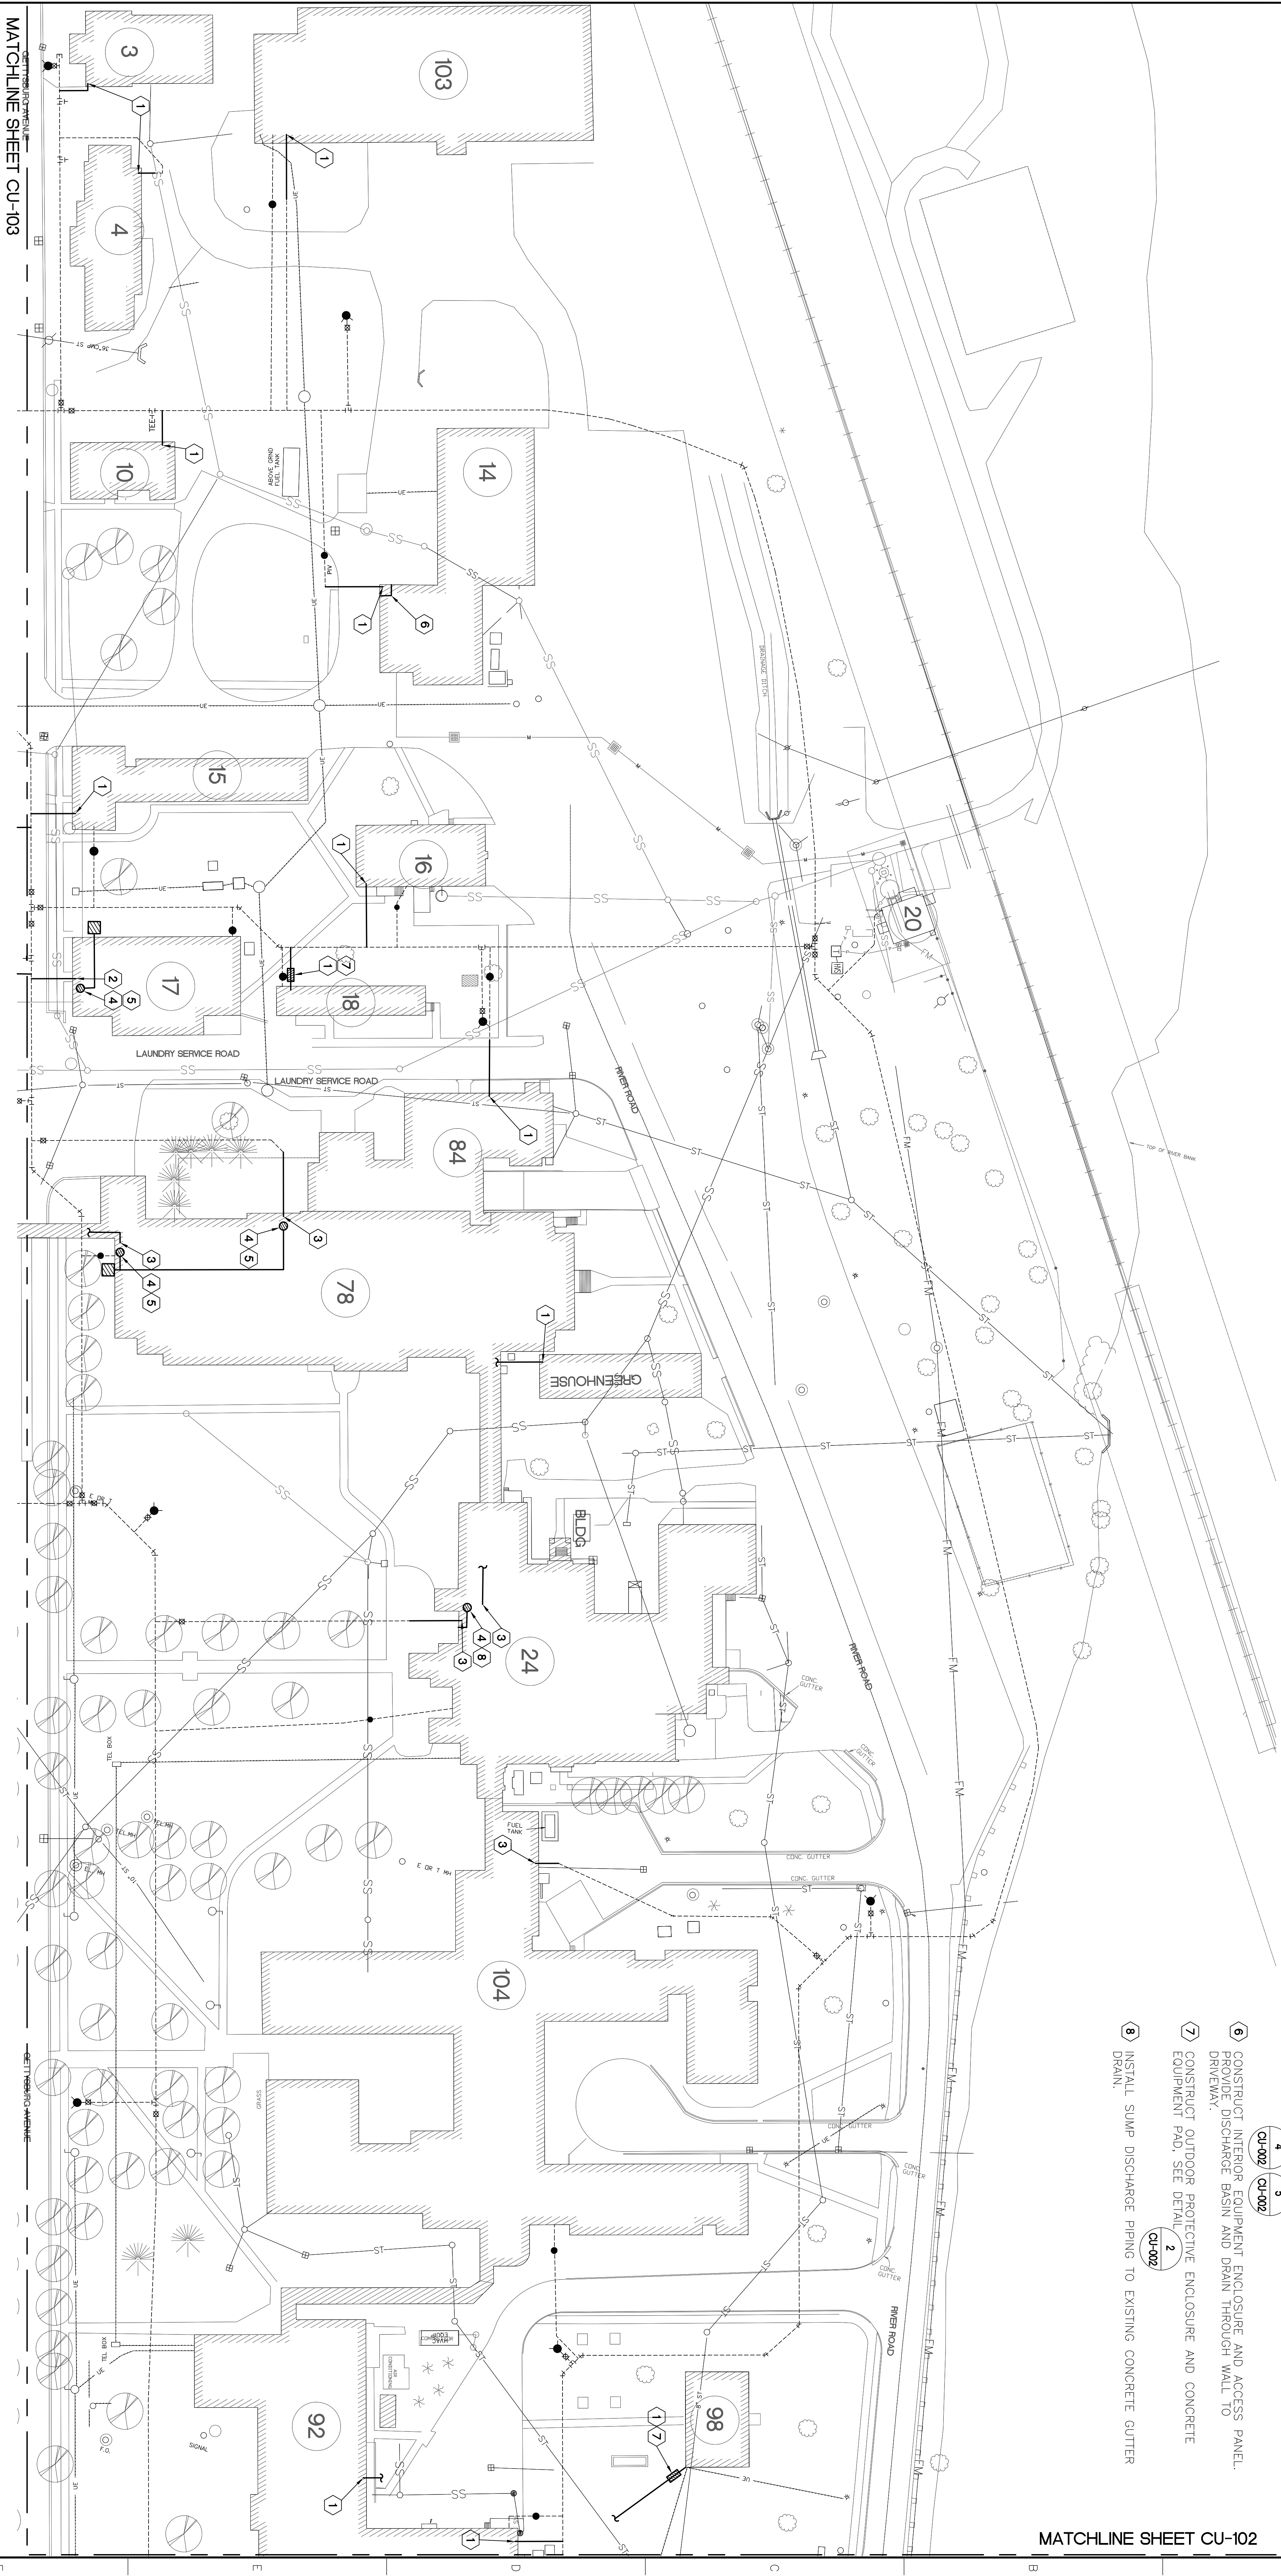

MATCHLINE SHEET CU-103


MATCHLINE SHEET CU-102

CROSS CONNECTION CONTROL - ENLARGED SITE PLAN
SCALE 1" = 40'-0"

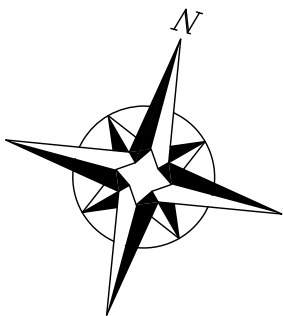

CONSULTANTS:

ARCHITECT/ENGINEERS:

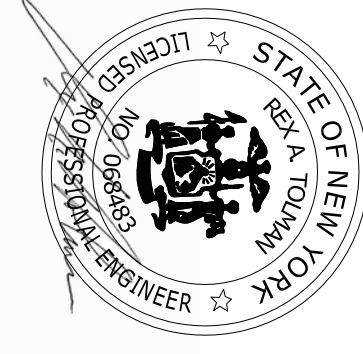

TOLMAN ENGINEERING, PLLC
3610 LAWSON ROAD
JAMESTOWN, NEW YORK 14701
PHONE: (716) 484 - 1366
FAX: (716) 484 - 1519

Drawing Title
**CROSS CONNECTION CONTROL -
ENLARGED SITE PLAN**

Project Title
**INSTALL CROSS CONNECTION
CONTROLS**

Approved Eng. Project Supervisor	Date
Approved Medical Center Director	Date

Building No.	Checked	Drawn
N/A	BFP	EHA/JLE
Location	BATH, NEW YORK	

Date	01/12/2015
Project No.	529A6-14-624
Drawing Number	WMO-529A6-7/61
Dwg	7 of 10

Office of
Construction
and Facilities
Management
Department of
Veterans Affairs