




8 AIR HANDLER UNIT S-10A SECTION DETAIL  
NTS

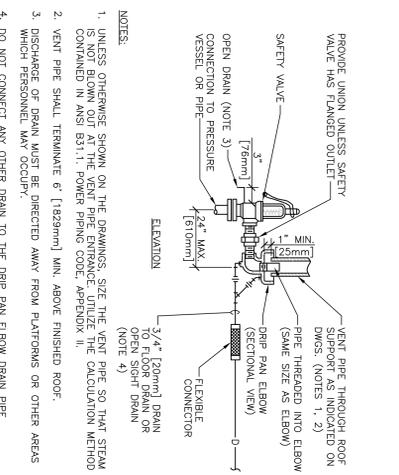


6 STEAM SAFETY VALVE  
NTS

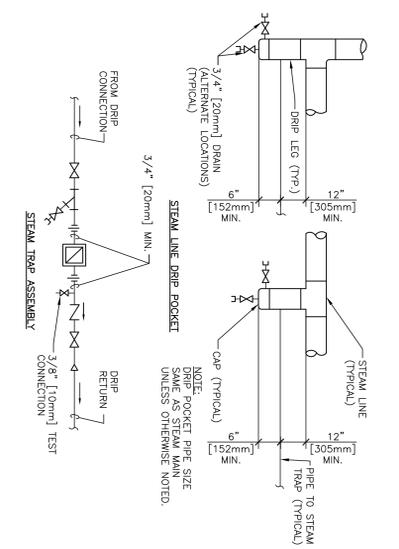


4 STEAM TRAP ASSEMBLY  
NTS

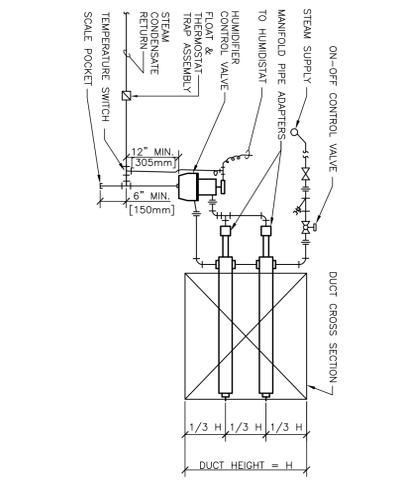


2 PIPING CONNECTIONS (MULTIPLE DISPERSION TUBES)  
NTS

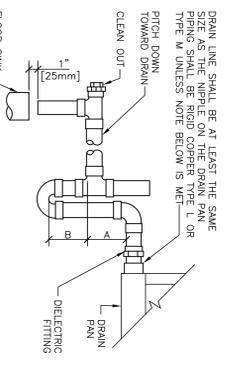


7 AIR HANDLING UNIT DRAIN TRAP DETAIL  
NTS

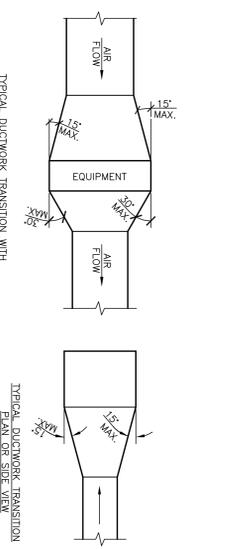

5 DUCTWORK - REDUCTIONS + TRANSITIONS  
NTS

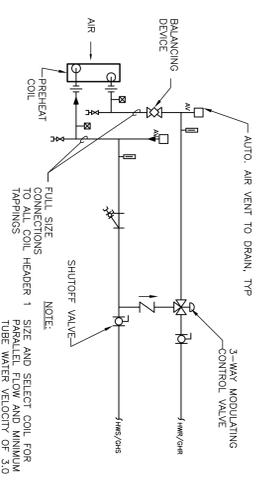

3 PREHEAT COIL PIPING CONNECTIONS  
NTS

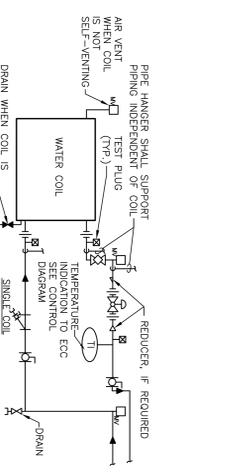

1 CHILLED WATER COIL - PIPING CONNECTIONS  
NTS

UNIT TYPE	A	B
DRAIN THRU	2" [50mm]	X
BLOW THRU	1" [25mm]	2X
MINIMUM		

WHERE X = STATIC PRESSURE IN PAN

NOTE: UNLESS OTHERWISE INDICATED ON PLANS, MAXIMUM ANGLES SHOWN SHALL APPLY.

Date	Description
11/26/13	ISSUED FOR CONSTRUCTION DOCUMENTS (FINAL BD)
10/29/13	ISSUED FOR RFP DESIGN SUBMITTAL
10/22/13	ISSUED FOR 75% DESIGN DEVELOPMENT

CONSULTANTS:

ARCHITECT/ENGINEERS:

**SEPSTEIN**  
600 West Fulton Street  
Chicago, Illinois 60661

Mechanical Details

Project Title: REPLACEMENT OF AHU S-10A IN BUILDING 30  
Location: 820 S. DAMEN AVE CHICAGO, IL 60612  
Date: 11/26/2013

Project Number	Building Number	Drawing Number
537-10-122	BUILDING 30	30-M-500

FULLY SPRINKLERED

Office of Construction and Facilities Management  
Department of Veterans Affairs