


**UPPER-LEVEL FIRE SPRINKLER PLAN**

1/8"=1'-0"

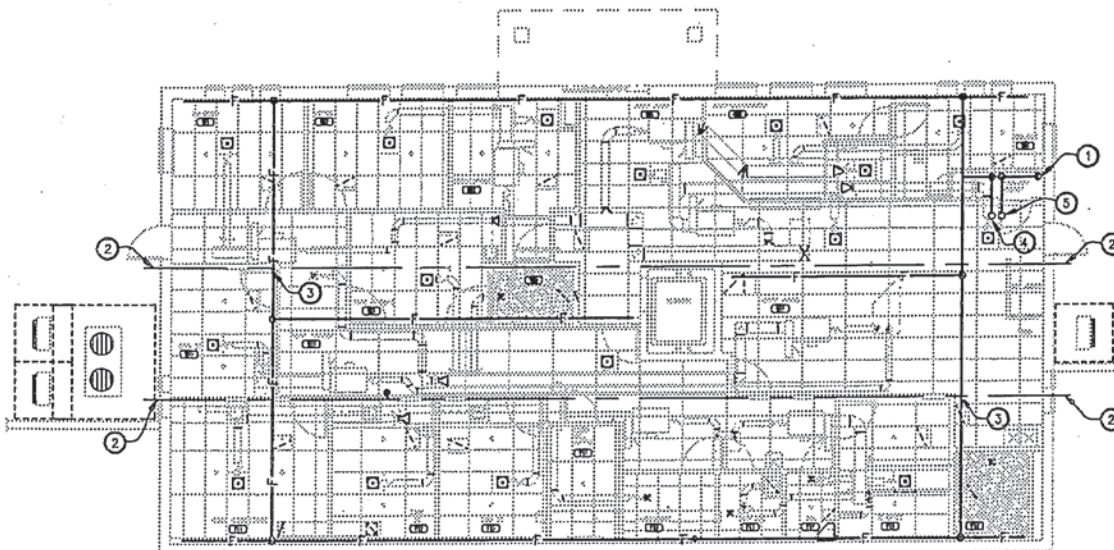

**LOWER-LEVEL FIRE SPRINKLER PLAN**

1/8"=1'-0"



### GENERAL NOTES

- (A) PIPE ROUTING SHOWN IS FOR REFERENCE PURPOSES ONLY. FINAL PIPE ROUTING IS TO BE DETERMINED BY THE FIRE PROTECTION CONTRACTOR.
- (B) THE CEILING SPACE IS EXTREMELY LIMITED. THE FIRE PROTECTION CONTRACTOR SHALL COORDINATE ROUTING WITH ALL OTHER TRADES TO ASSURE CLEARANCE FOR ALL SYSTEMS.

### KEY NOTES

- (1) FIRE SERVICE ENTRY. SEE FOUNDATION PLUMBING PLAN FOR CONTINUATION.
- (2) CENTERLINE OF WIDE FLANGE STEEL BEAM
- (3) ROUTE PIPE IN COFFIT BELOW CEILING TO PASS UNDER BEAMS.
- (4) WET PIPE SYSTEM RISER. SEE UPPER-LEVEL PLAN FOR CONTINUATION.
- (5) DRY PIPE SYSTEM RISER. SEE UPPER-LEVEL PLAN FOR CONTINUATION.
- (6) WET TYPE SYSTEM RISER. SEE LOWER-LEVEL PLAN FOR CONTINUATION.
- (7) DRY-TYPE SYSTEM RISER. SEE LOWER-LEVEL PLAN FOR CONTINUATION.
- (8) DRY-TYPE SYSTEM CONTINUES INTO ATTIC TO COVER ENTIRE ATTIC (NOT SHOWN).