



File Name: P:\2010\20100195\Drawings\Bldg 2\Sheet\95F.02.2D.dwg Last Plotted: 2010/11/01 12:25 PM By: jdd

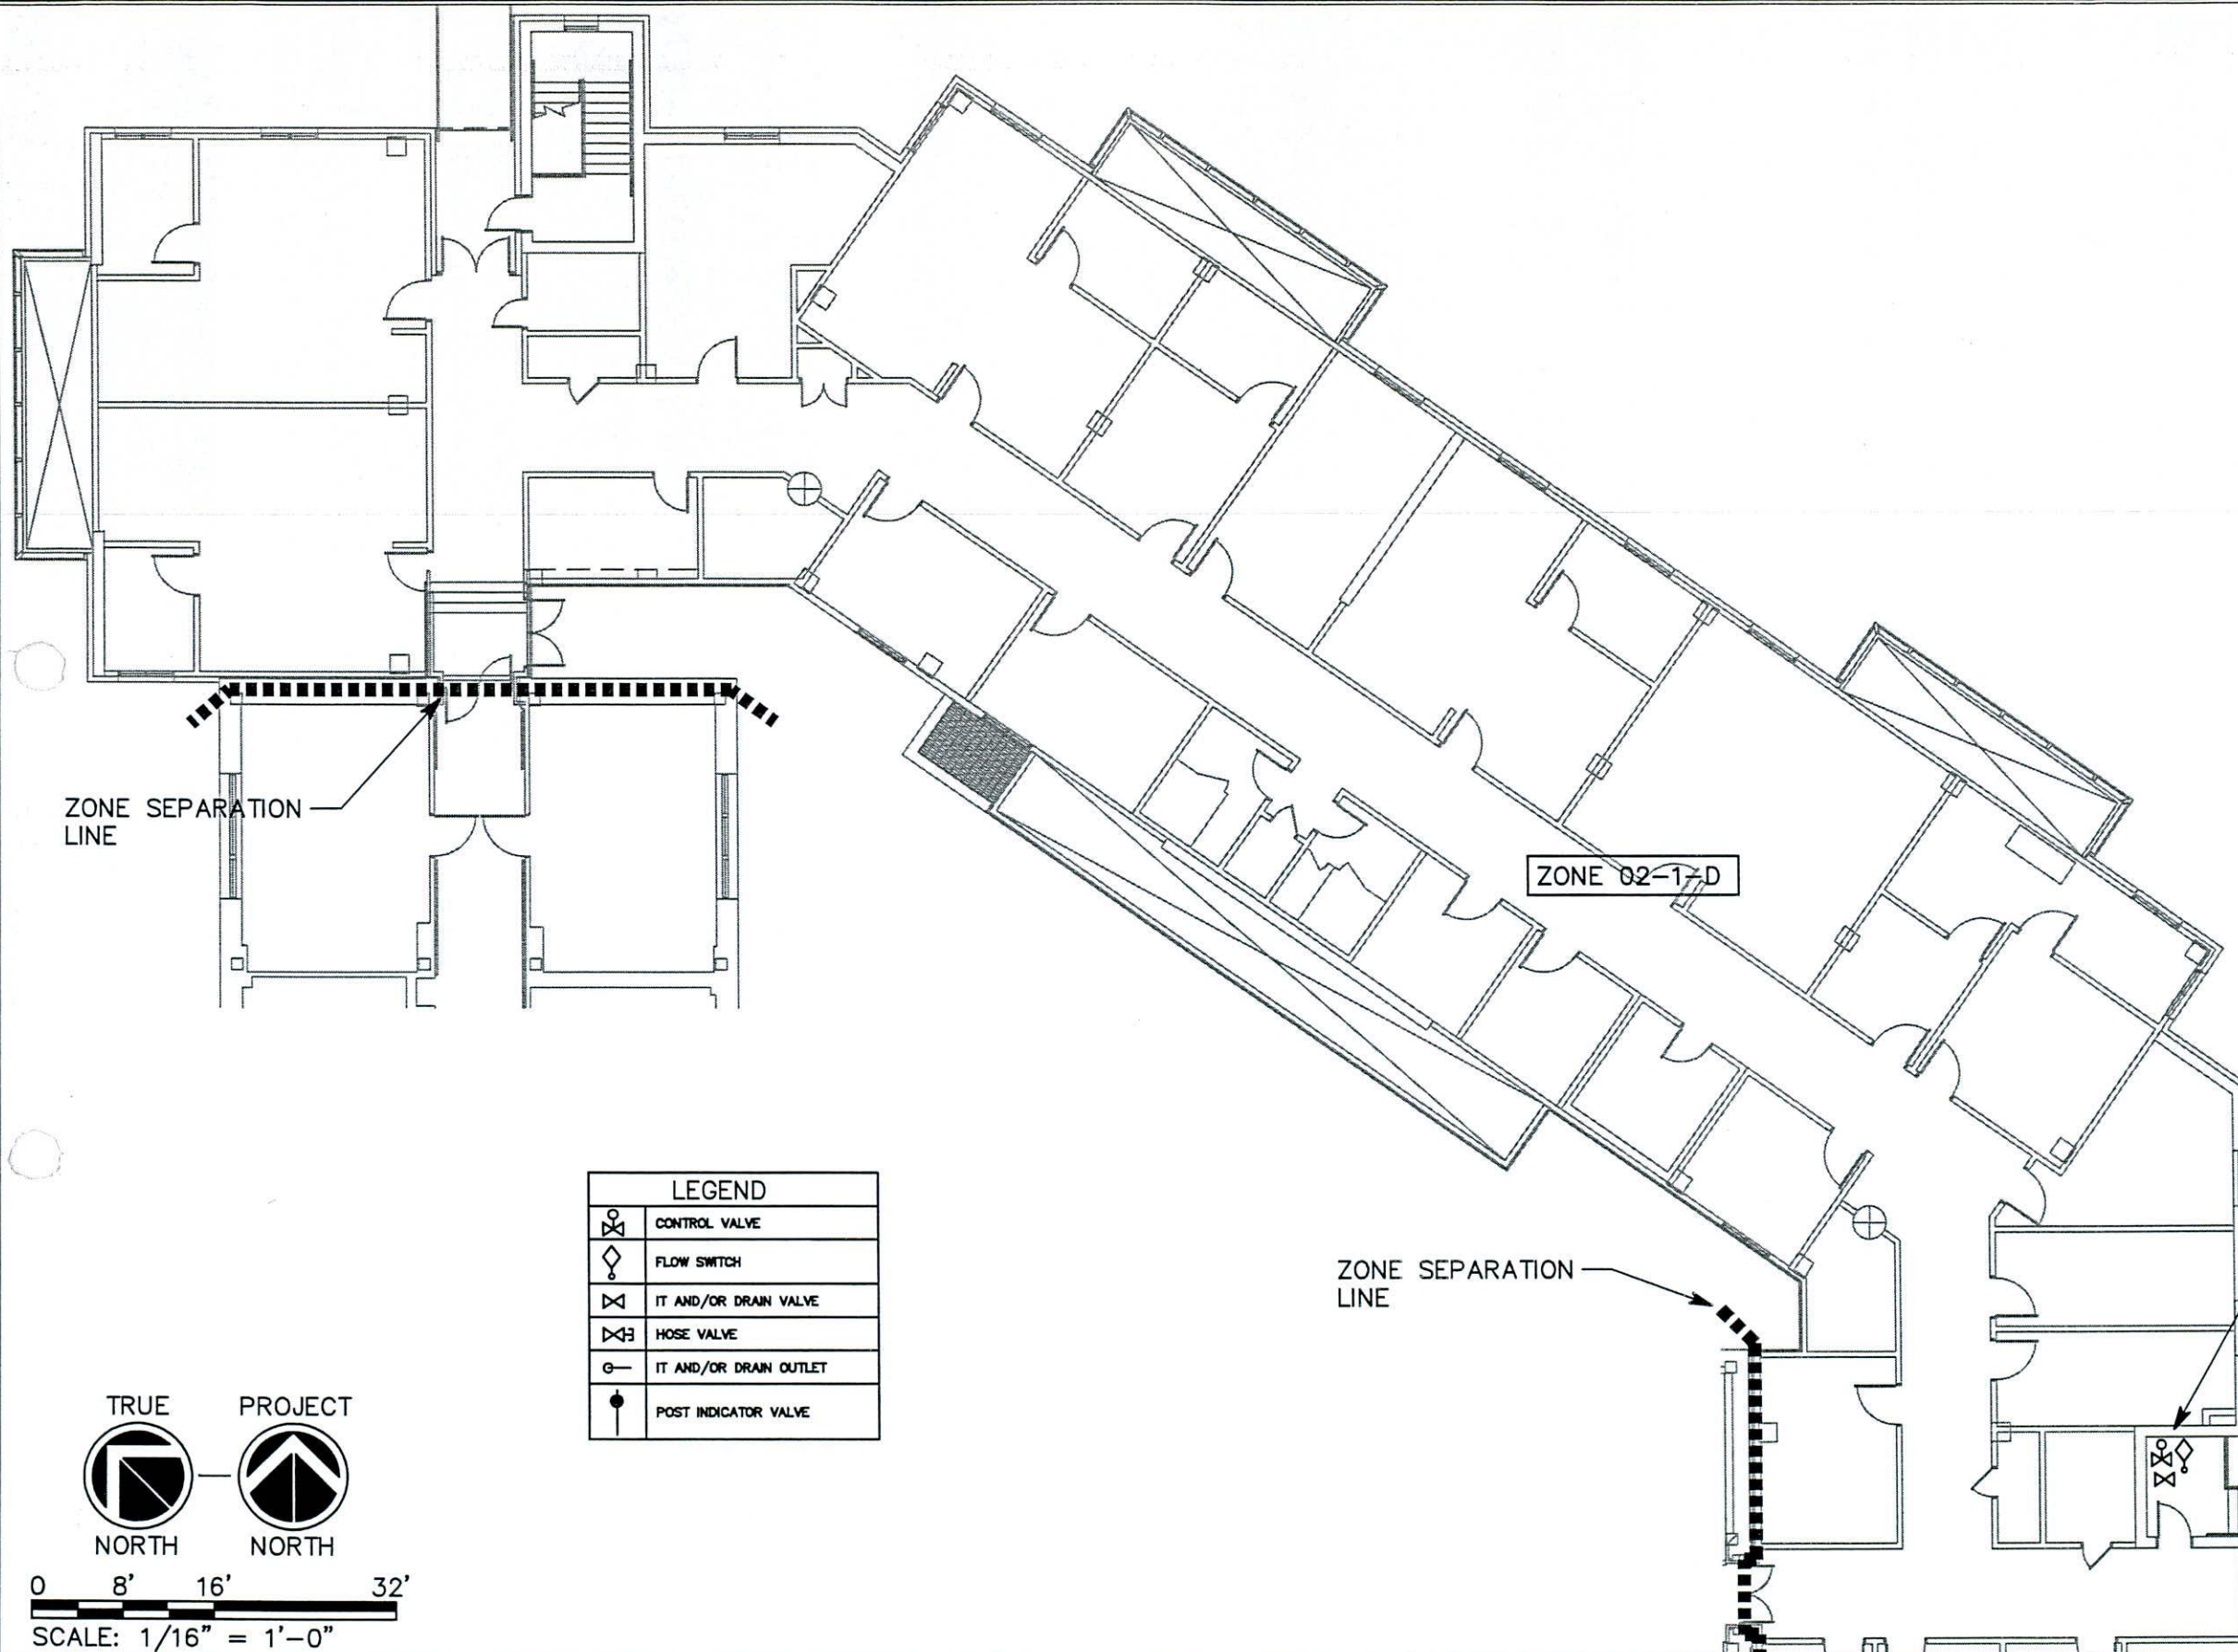


| LEGEND |                        |
|--------|------------------------|
|        | CONTROL VALVE          |
|        | FLOW SWITCH            |
|        | IT AND/OR DRAIN VALVE  |
|        | HOSE VALVE             |
|        | IT AND/OR DRAIN OUTLET |
|        | POST INDICATOR VALVE   |

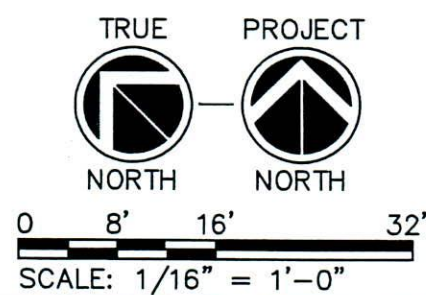

There is a D zone second floor not shown in the set (layout is like 1st floor)

ZONE 02-1-D CONTROL VALVE, FLOW SWITCH, AND COMBINATION INSPECTORS TEST/DRAIN

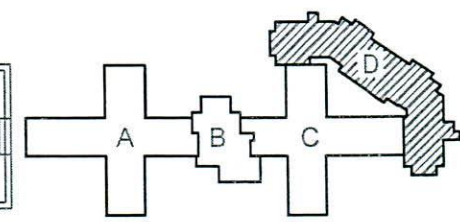

| Revisions | Date |
|-----------|------|
|           |      |

Consultant

324 South State Street, Suite 400  
Salt Lake City, Utah 84111  
801.328.5151  
800.678.7077  
FAX 801.328.5155  
www.spectrum-engineers.com

Project Title  
CAMPUS WIDE FIRE SPRINKLING TEST STATION  
MODIFICATION AND DEFICIENCIES STUDY

Consultant Project No. 20100195

Drawn BXW Checked JDD

Drawing Title  
BUILDING 2  
FIRST LEVEL  
ZONE D

Date  
08.03.2010

Project No.  
660-10-110

Building No.  
2

DRAWING No.  
F.02.2D

Dep. of XX