


ROOM 1AB-143A – FIRE PROTECTION
SCALE: 1/2" = 1'-0"




ROOM 1A-105 – FIRE PROTECTION
SCALE: 1/2" = 1'-0"

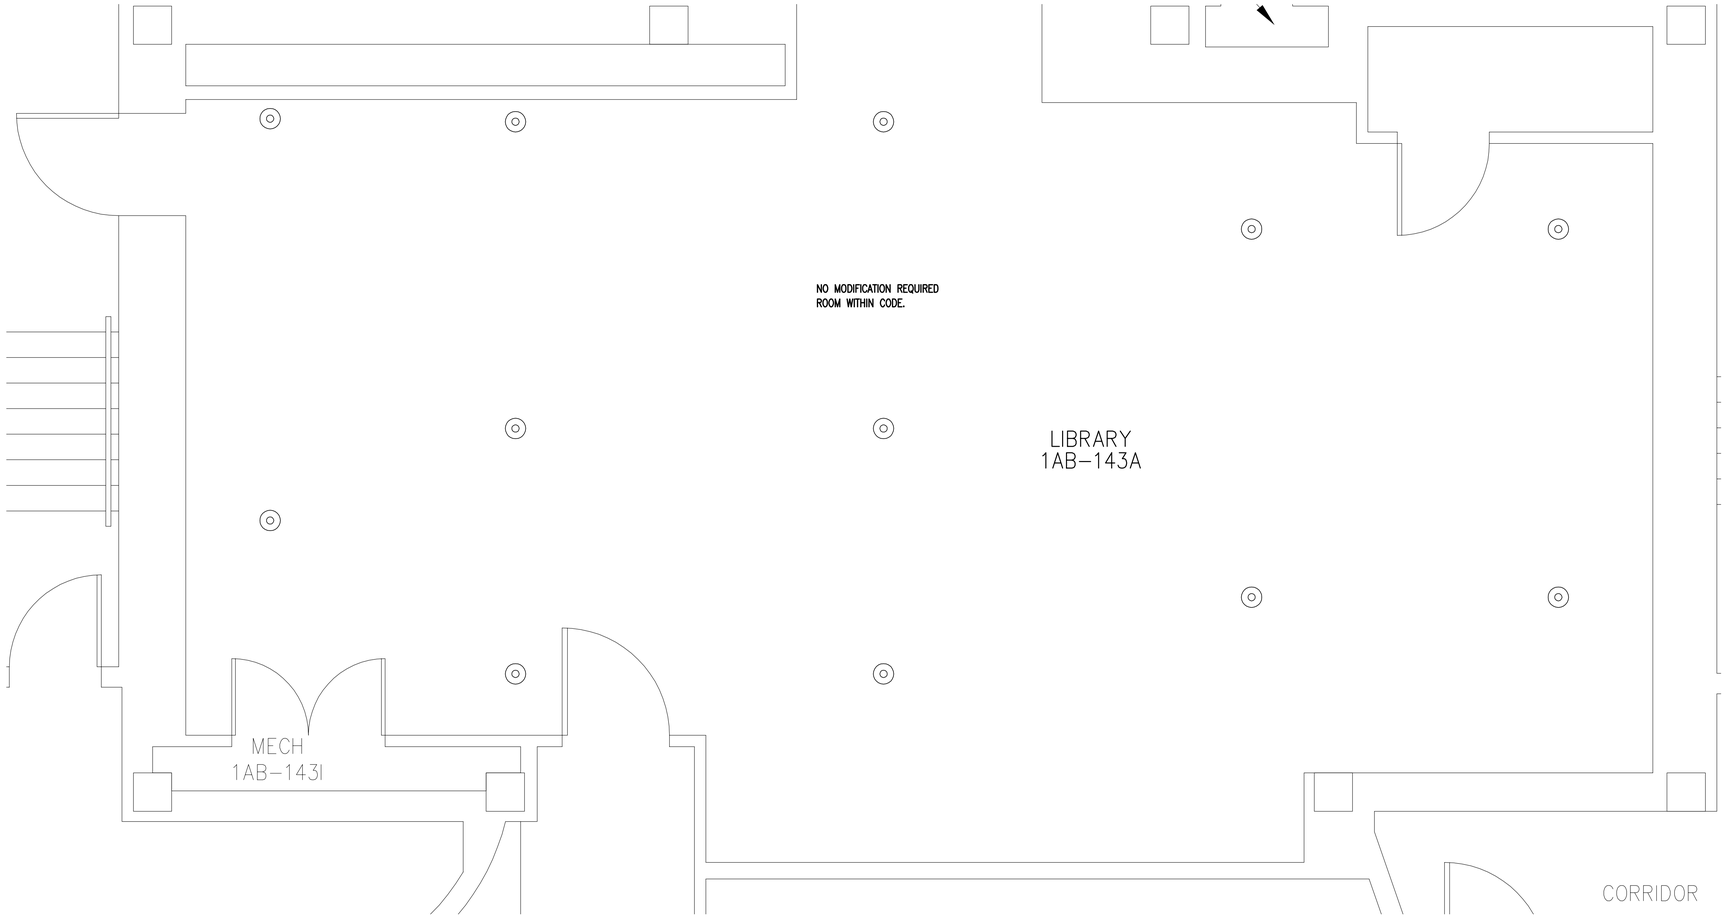


ROOM 1A-120B – FIRE PROTECTION
SCALE: 1/2" = 1'-0"

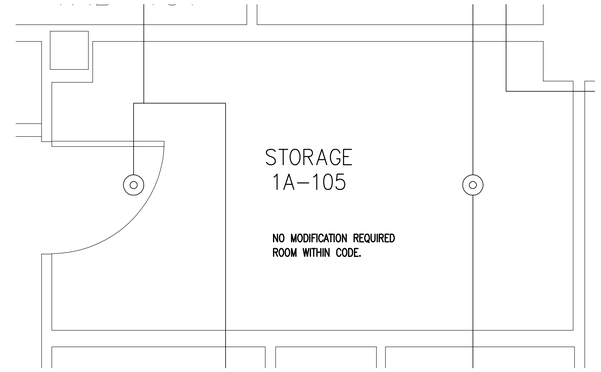


ROOM 1AB-134 – FIRE PROTECTION
SCALE: 1/2" = 1'-0"

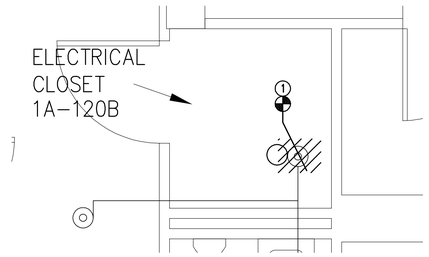


ROOM 1A-167 – FIRE PROTECTION
SCALE: 1/2" = 1'-0"

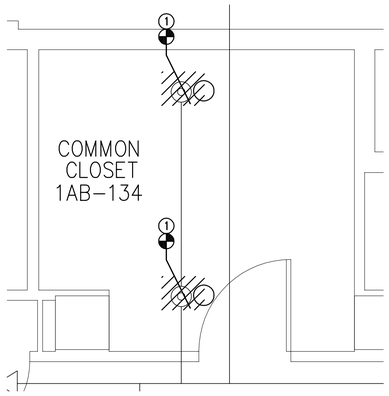


ROOM 1AB-127A – FIRE PROTECTION
SCALE: 1/2" = 1'-0"

## NOTES:
(THIS SHEET ONLY)

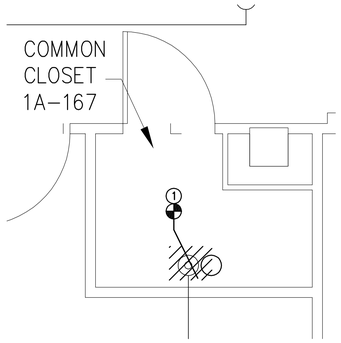1. REMOVE EXISTING PENDENT SPRINKLER HEAD AND ROUTE PIPE UP AND INSTALL AN UPRIGHT SPRINKLER HEAD IN ACCORDANCE WITH NFPA 13.
2. CONNECT TO EXISTING SPRINKLER PIPING AND INSTALL A UPRIGHT SPRINKLER HEAD AS INDICATED TO PROVIDE COVERAGE IN ACCORDANCE WITH NFPA 13.

## GENERAL NOTES:
(THIS SHEET ONLY)

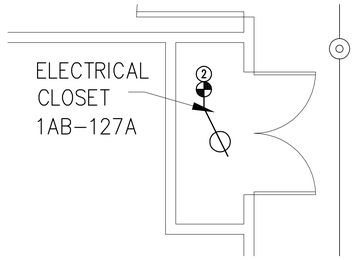1. ALL MATERIALS AND EQUIPMENT USED ON THIS PROJECT SHALL BE UL LISTED AND FM APPROVED.
2. EXISTING PIPING IS THREADED SCHEDULE 40 BLACK STEEL PIPE. NEW PIPING SHALL MATCH EXISTING.
3. EXISTING PIPING WILL BE PERMITTED TO BE REUSED BUT FITTINGS AND HEADS SHALL BE NEW.
4. ALL PIPING AND EQUIPMENT INSTALLED ON THIS PROJECT SHALL BE INSTALLED IN ACCORDANCE WITH NFPA 13 AND VA FIRE PROTECTION DESIGN GUIDE
5. ALL NEW PENDENT HEADS INSTALLED SHALL BE ON A RETURN BEND CONFIGURATION.



FIRST FLOOR KEY PLAN
SCALE: NTS

| Revisions | Date |
|---|---|
| | |

TOLAND MIZELL MOLNAR
CORPORATE OFFICE
590 Means St. NW, Ste. 200
Atlanta, GA 30318
404.214.9774

ROBERT CARLON REGISTERED 18102 VIRGINIA PROFESSIONAL ENGINEER

CLARK•NEXSEN
440 MARTIN LUTHER KING, JR. BLVD
MACON, GEORGIA 31201
478-743-8415 FAX 478-743-8239
WWW.CLARKNEXSEN.COM

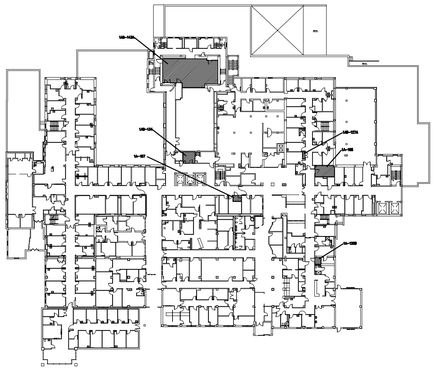Drawing Title: PARTIAL FIRST FLOOR PLAN FIRE PROTECTION

Approved Project Engineer

Project Title: CORRECT LIFE SAFETY DEFICIENCIES BECKLEY VAMC

FINAL SUBMITTAL

Building Number: -
Checked: RC
Drawn: PW
Location: BECKLEY, W.V.

Date: 09-05-2014
Project No. 517-14-106
DRAWING NO. FP103
Dwg. XX Of XX

Veterans Administration

Drawing File: H:\2014\5317-Correct Facility Life Safety Deficiencie\Drawings\5317 FP103.dwg
Plotted by: mcrowell
Plotted Date: Sep 04, 2014 – 2:33pm