

Legend for Network Drawings:

MZII-Micro-zone II

UNC-Universal Network Controller

AHU-Air Handling Unit

MNL-Micro-Net Lon

EF-Exhaust Fan

VAV-Variable Air Volume


SPD-Sterile Processing Department


HW-Heating Water

CW-Chilled Water

FCU-Fan Coil Unit

INT-Interstitial

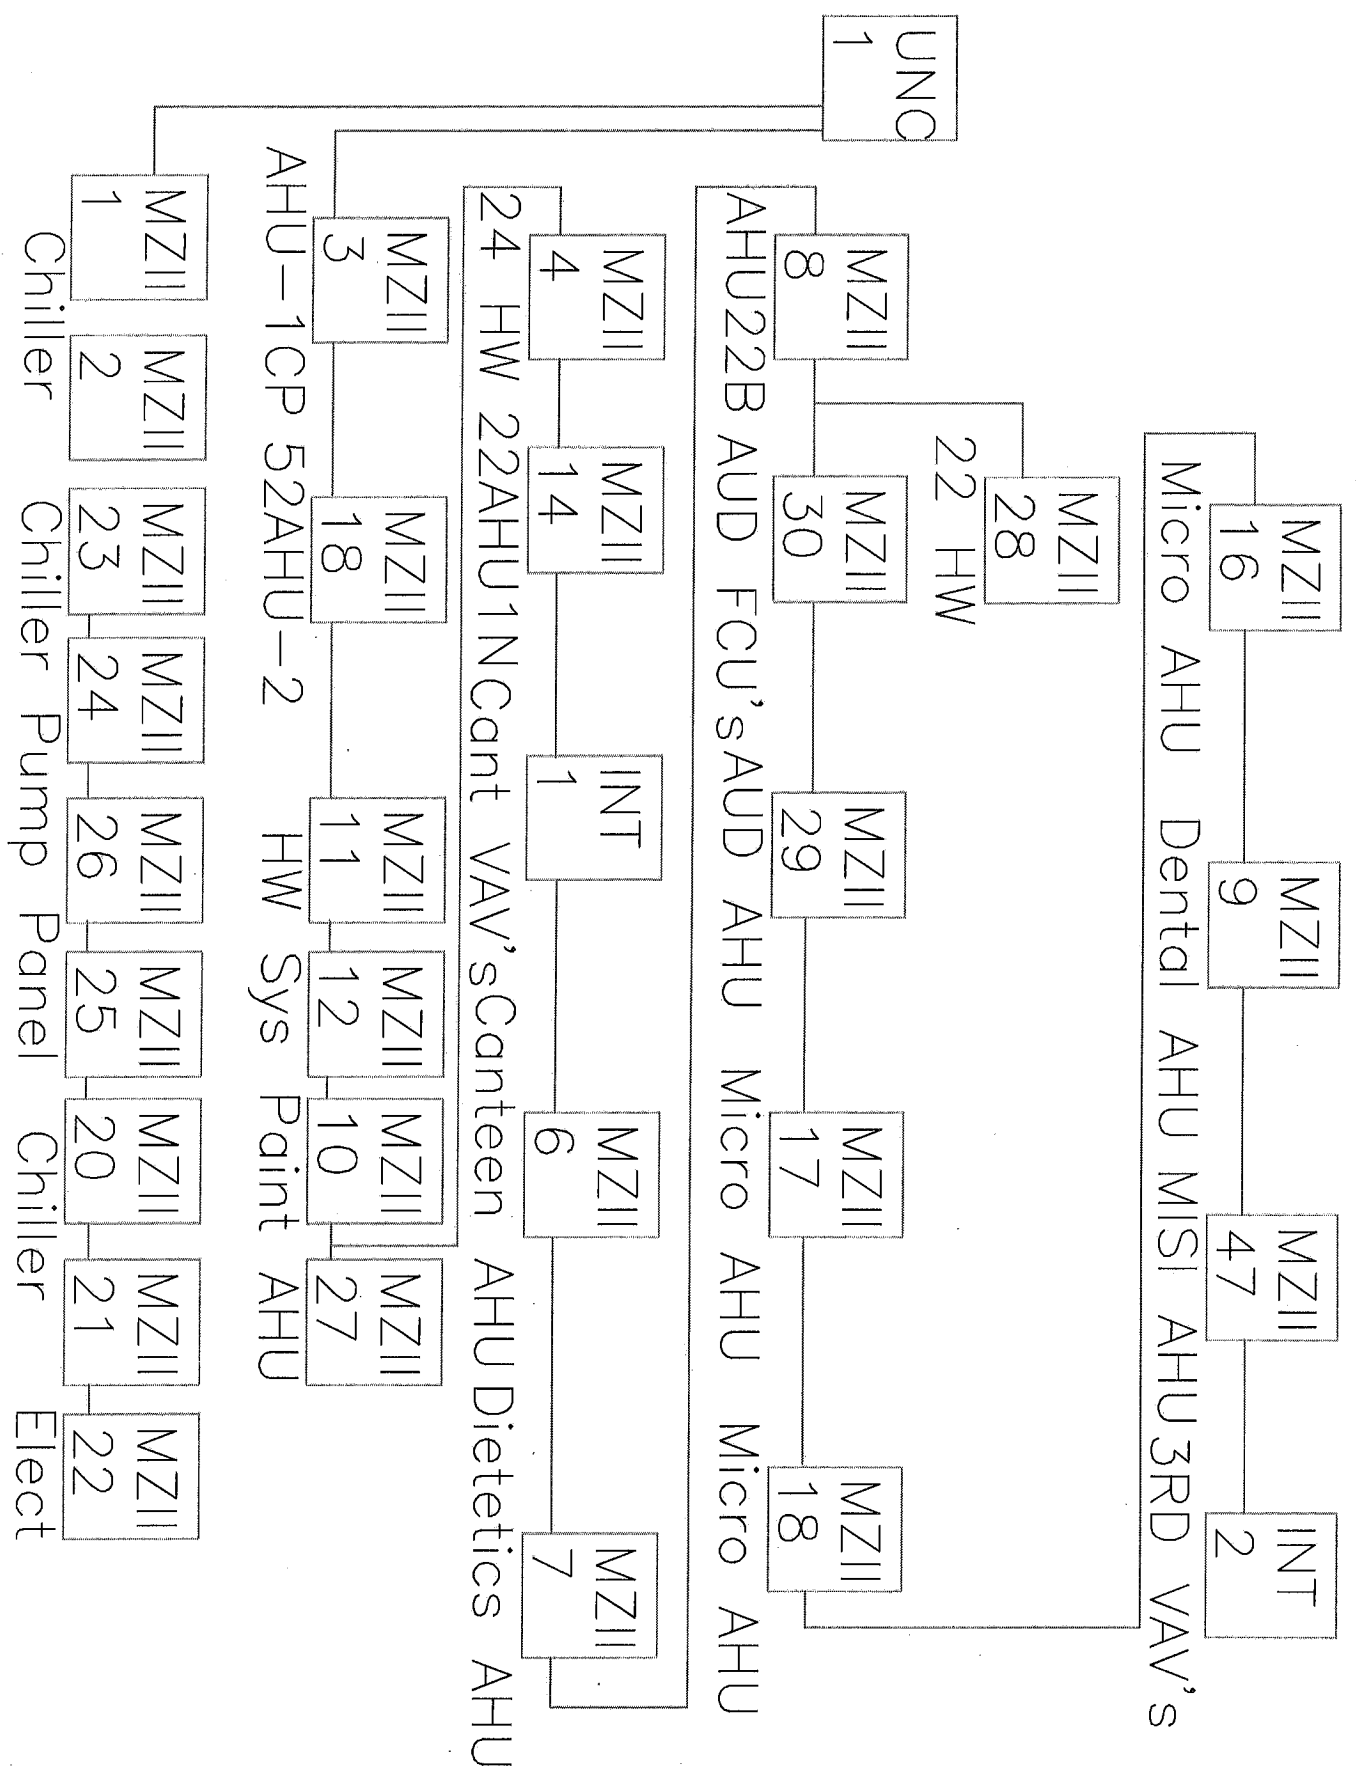

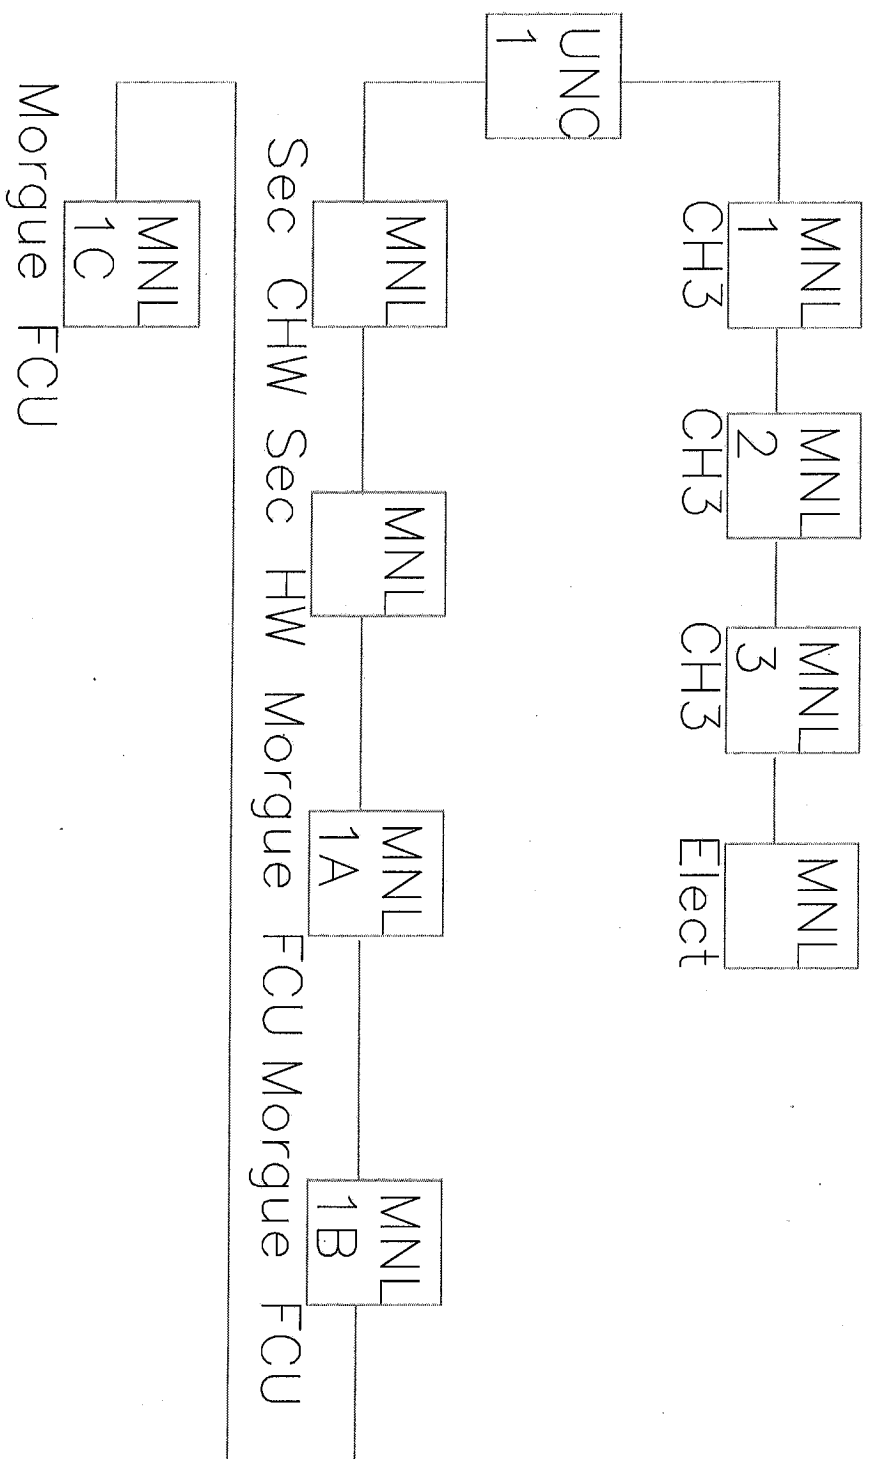

UNC
2

MZII
6

MZII
5

INT
2

MZII
4

MZII
3

MZII
2

MZII
1

53AHU1E

ER VAV's 53AHU1E

53AHUER

MZII
9

MZII
8

INT
1

MZII
7

MZII
12

MZII
11

MZII
16

53AHU3E

3rd VAV's 53AHU3E

53AHU4E

Hepa Filter

MZII
10

MZII
13

MZII
14

MZII
15


INT
3


INT
4

53AHU4E


53AHU5E

5th VAV's

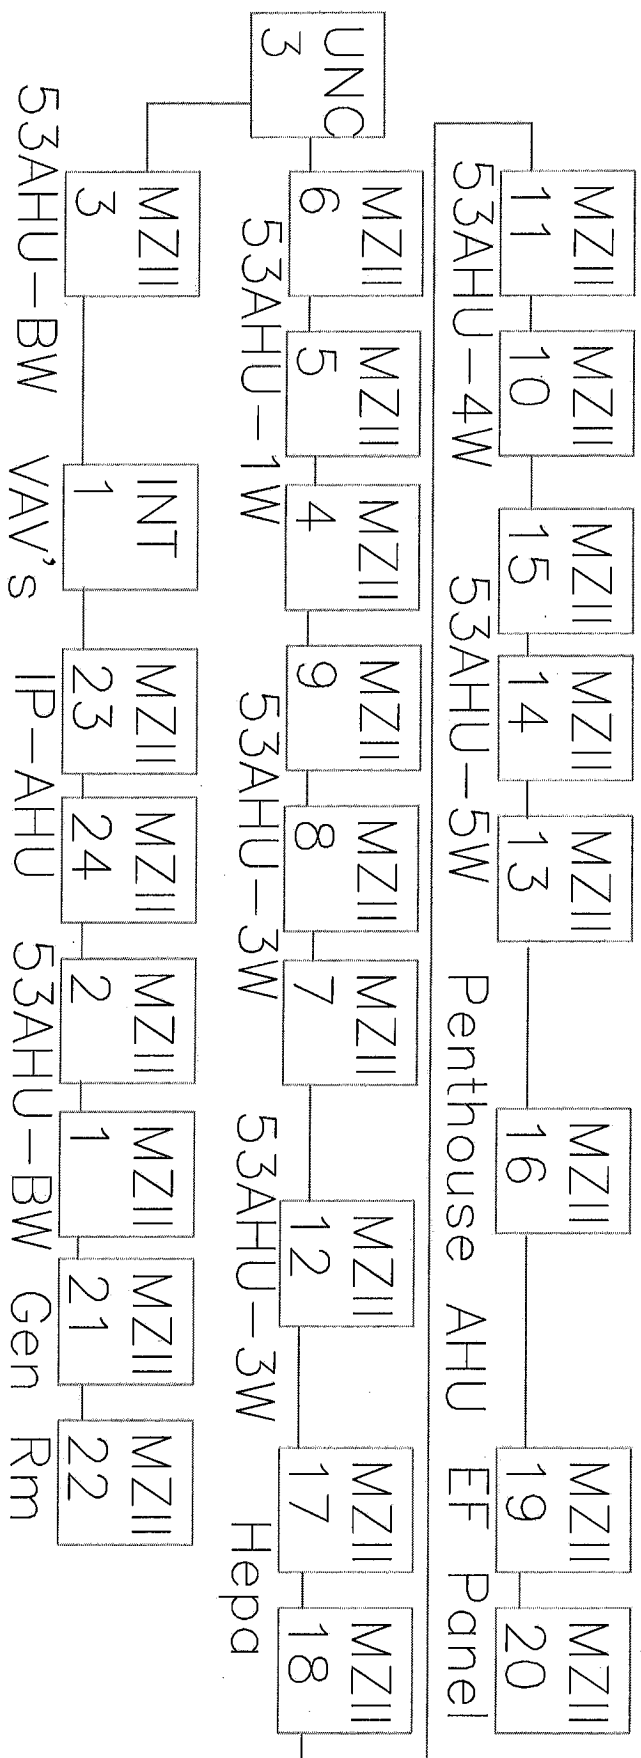

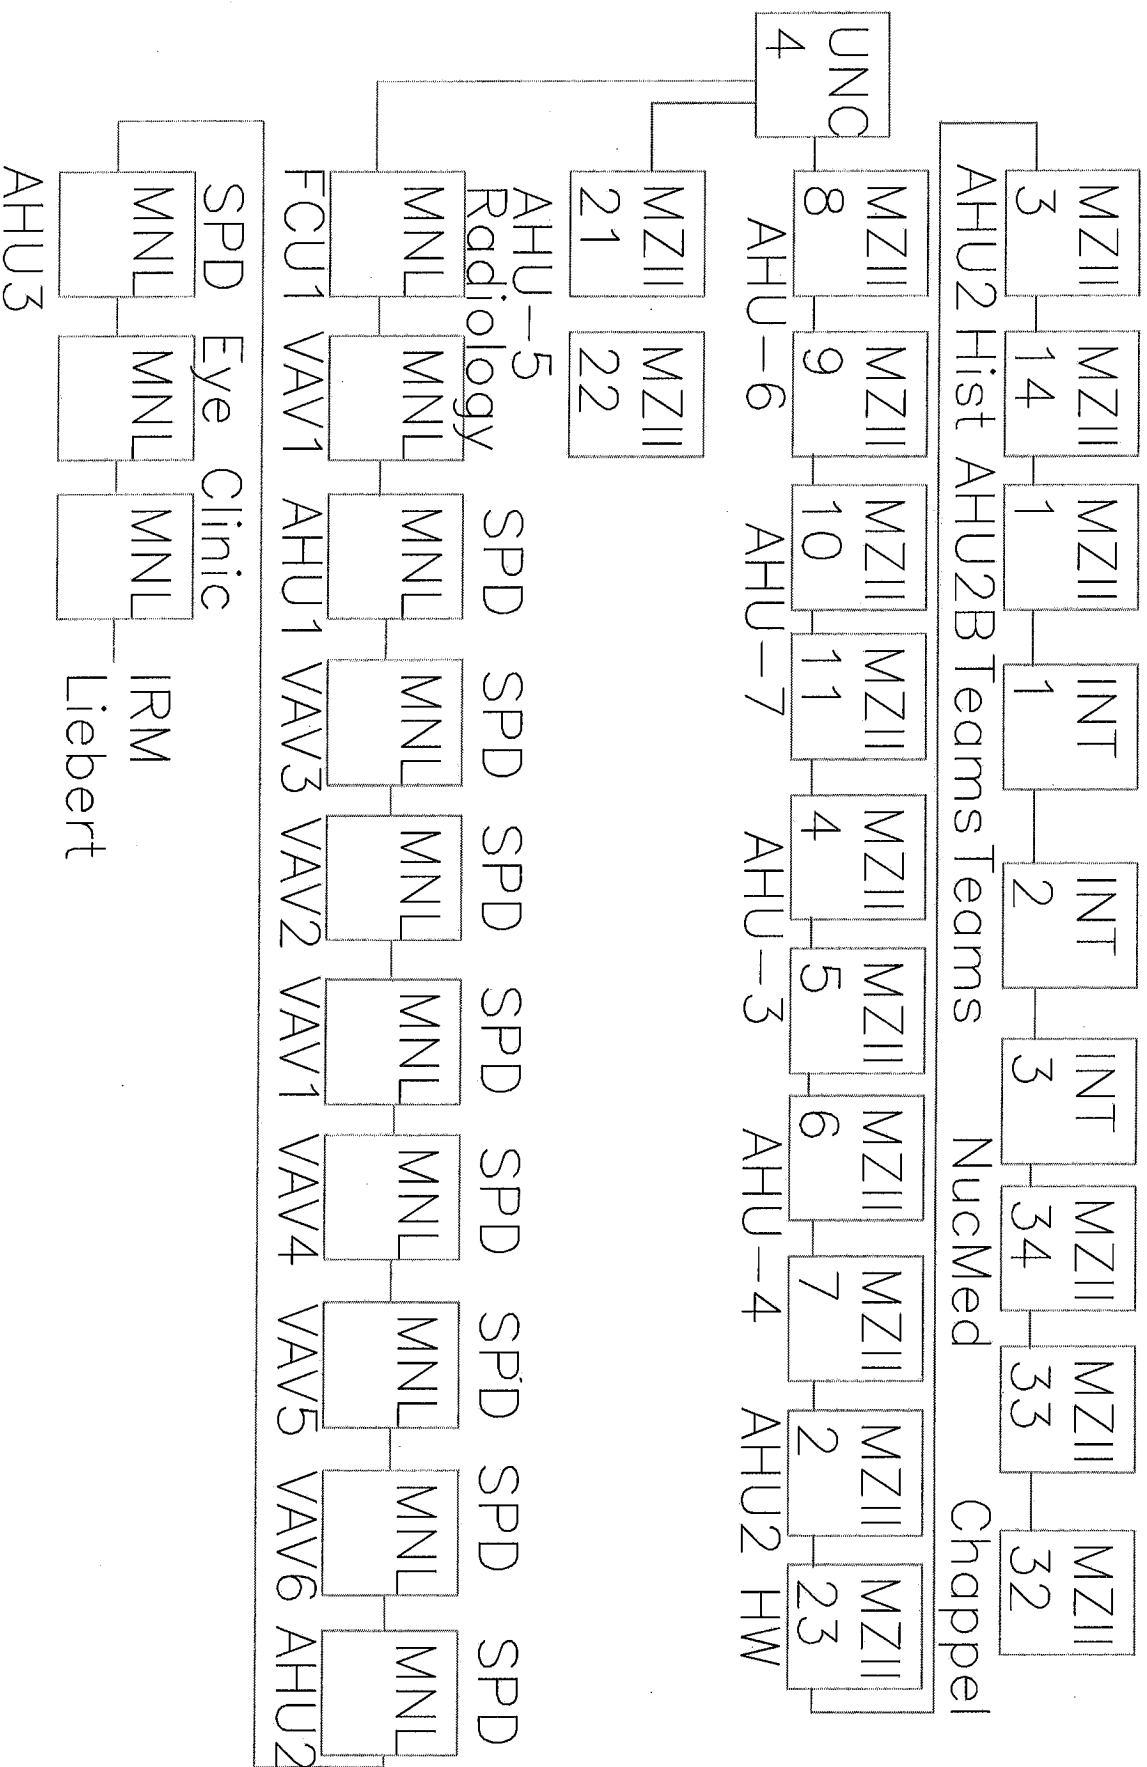

UNC
5



MNL MNL MNL MNL MNL MNL MNL
HW System VVB3-1 VVB3-2 VVB3-3 VVB3-4 VVB3-5

MNL MNL MNL MNL MNL MNL MNL MNL
VVB3-6 VVB3-7 OR1 OR3 OR5 7 9

UNC
6

MNL MNL MNL MNL MNL MNL MNL MNL
10 8 6 OR4 OR2 VVB3-8 1

MNL MNL MNL MNL MNL MNL MNL MNL
2 3 4 VVB3-12 VVB3-11 VVB3-10 PH5

MNL MNL MNL MNL MNL
PH4 PH3 PH2 VVB3-9 PH1