


ROOM LEGEND

| No. | ROOM NAME |
|--------|-----------------------------|
| LL300 | ETVS MAIN & CONTROL AREA |
| LL301 | UNASSIGNED (STORAGE) |
| LL302 | ARCHIVES ROOM |
| LL303 | PHARMACY LIFT |
| LL308 | LAB - CHEMISTRY |
| LL309 | COMPRESSOR ROOM |
| LL310 | CONTROLLED TEMP. ROOM (4°C) |
| LL311 | OFFICE, INVESTIGATOR |
| LL312 | OFFICE, INVESTIGATOR |
| LL313 | OFFICE, INVESTIGATOR |
| LL314 | OFFICE, INVESTIGATOR |
| LL315 | OFFICE, INVESTIGATOR |
| LL316 | OFFICE, INVESTIGATOR |
| LL317 | STORAGE |
| LL318 | INSTRUMENT ROOM - COMMON |
| LL319 | STERILIZER/WASH ROOM |
| LL320 | LAB - GENERAL |
| LL321 | LAB - CHEMISTRY |
| LL322 | LAB - CHEMISTRY |
| LL323 | LAB - GENERAL |
| LL324 | LAB - CHEMISTRY |
| LL325 | LAB - GENERAL |
| LL326 | LAB - GENERAL |
| LL327 | LAB - MULTI-USE |
| LL328 | LAB - CHEMISTRY |
| LL330 | LAB - CHEMISTRY |
| LL333 | LAB - MULTI-USE |
| LL334 | H. A. C. |
| LL340 | CAGE WASHING |
| LL340A | PUMP ROOM |
| LL342 | ANIMAL HOLDING |
| LL343 | ANIMAL HOLDING |
| LL344 | ANIMAL HOLDING |
| LL345 | STORAGE |
| LL346 | ANIMAL HOLDING |
| LL347 | ANIMAL HOLDING |
| LL348 | ANIMAL HOLDING |
| LL349 | ANIMAL HOLDING |
| LL350 | ANIMAL HOLDING |
| LL351 | ANIMAL HOLDING |
| LL352 | ANIMAL WARD |
| LL353 | ANIMAL HOLDING |
| LL355 | LOUNGE - STAFF |
| LL394 | SURGICAL PREP. |
| LL396 | POST OPERATIVE WARD |
| LL398 | RADIOGRAPHIC ROOM |
| LL398A | DARKROOM |
| LL399 | STERILIZER ROOM |
| LL400 | STORAGE - CLEAN CAGE |
| LL402 | LAB - NECROPSY |
| LL402A | CONTROLLED TEMP. ROOM (4°C) |
| LL404 | PAT. - WARD/RADIOISOTOPE |
| LL406 | LAB - RADIOISOTOPE SUITE |
| LL407 | STORAGE |
| LL408 | H. A. C. |
| LL409 | COMPRESSOR ROOM |
| LL410 | HAZARDOUS WASTE DISPOSAL |
| LL411 | ELECTRICAL ROOM |
| LL412 | MECHANICAL ROOM |
| CL158 | CORRIDOR |
| CL159 | CORRIDOR |
| CL164 | CORRIDOR |
| CL165 | CORRIDOR |
| CL167 | CORRIDOR |
| CL168 | CORRIDOR |
| CL170 | CORRIDOR |
| CL172 | CORRIDOR |
| SL006 | STAIR NO. 6 |

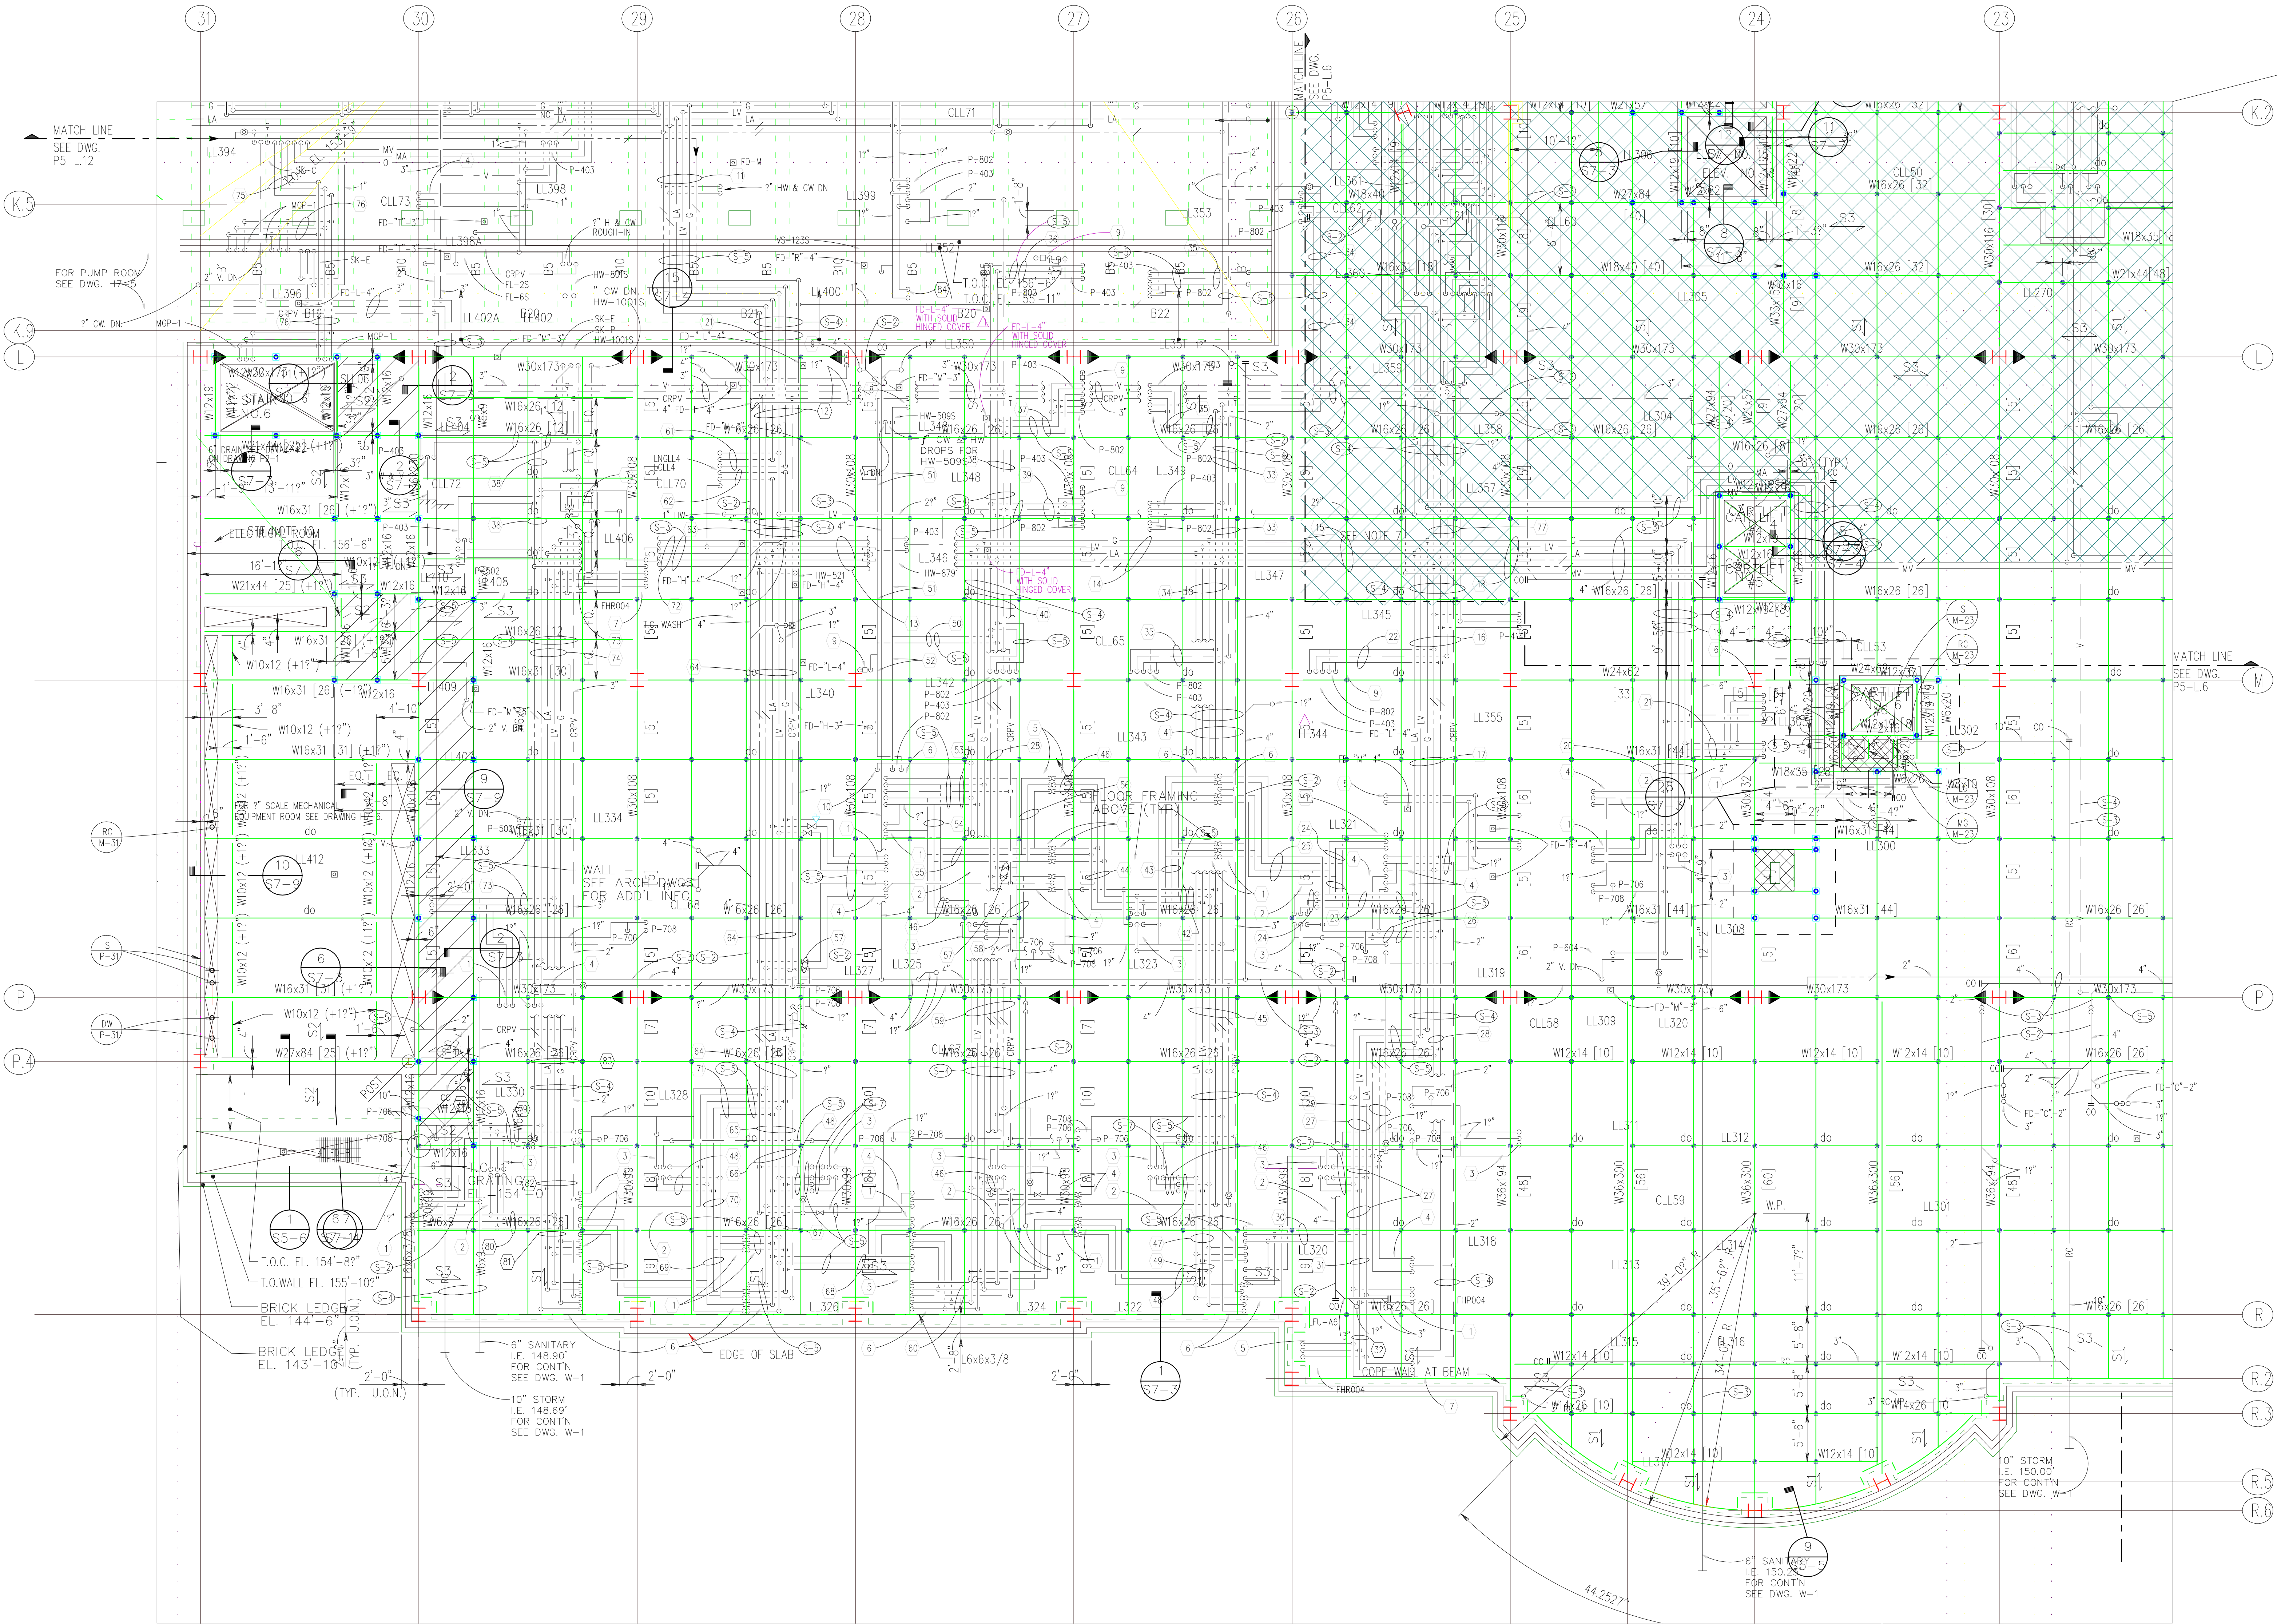

KEY NOTES:

1. GAV-1
2. GAV-2
3. SK-E
4. SK-P
5. H2B2-78
6. H7-48
7. H3-48
8. ROUGH-IN 1\"/>

9. FLUSH VALVE IN WALL BOX
10. 1\"/>
11. 2\"/>
12. 2\"/>
13. 1\"/>
14. 1\"/>
15. 1\"/>
16. 1\"/>
17. 1\"/>
18. 1\"/>
19. 1\"/>
20. 1\"/>
21. 2\"/>
22. 2\"/>
23. 1\"/>
24. 1\"/>
25. 1\"/>
26. 1\"/>
27. 1\"/>
28. 1\"/>
29. 1\"/>
30. 1\"/>
31. 1\"/>
32. 1\"/>
33. 1\"/>
34. 1\"/>
35. 1\"/>
36. 1\"/>
37. 1\"/>
38. 1\"/>
39. 1\"/>
40. 1\"/>
41. 1\"/>
42. 1\"/>
43. 1\"/>
44. 1\"/>
45. 1\"/>
46. 1\"/>
47. 1\"/>
48. 1\"/>
49. 1\"/>
50. 1\"/>
51. 1\"/>
52. 1\"/>
53. 1\"/>
54. 1\"/>
55. 1\"/>
56. 1\"/>
57. 1\"/>
58. 1\"/>
59. 1\"/>
60. 1\"/>
61. 1\"/>
62. 1\"/>
63. 1\"/>
64. 1\"/>
65. 1\"/>
66. 1\"/>
67. 1\"/>
68. 1\"/>
69. 1\"/>
70. 1\"/>
71. 1\"/>
72. 1\"/>
73. 1\"/>
74. 1\"/>
75. 1\"/>
76. 1\"/>
77. 1\"/>
78. 1\"/>
79. 1\"/>
80. 1\"/>
81. 1\"/>
82. 1\"/>
83. 1\"/>
84. 1\"/>

NOTE:
FOR PLUMBING NOTES REFER TO DRAWING M0-2

FULLY PROTECTED BY AUTOMATIC SPRINKLER SYSTEM
FINAL SUBMISSION
NOT FOR CONSTRUCTION


DEPARTMENTS - THIS DRAWING:
00278 MEDICAL RESEARCH & DEVELOPMENT

SH&G

Smith, Hinchman & Grylls Associates, Inc.
Architects Engineers Planners

455 West Fort Street, Detroit, Michigan 48226
313/964-3000

SH&G Project No. 4999L

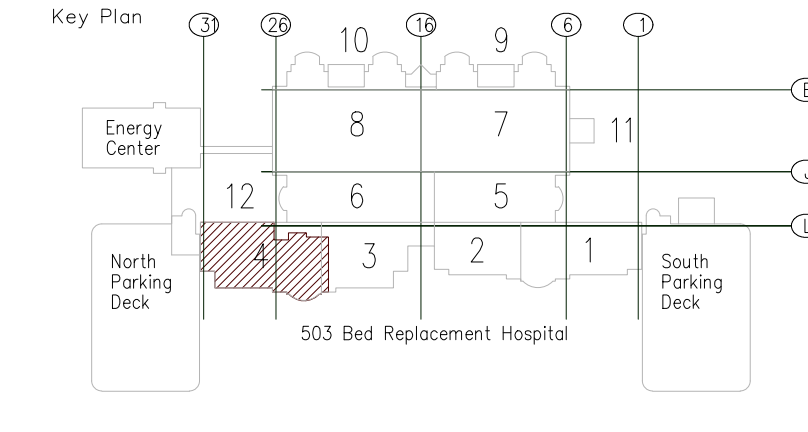

Drawing Title
LOWER LEVEL PLAN
ZONE 4 - PLUMBING

Scale: 1/8"=1'-0"
Approved: Area Project Manager

Project Title
503 BED REPLACEMENT
HOSPITAL

Building Number
100

Location
Detroit, Michigan

Date
4-29-91

Project No.
553-080

DRAWING NO.
P5-L.4R

Dwg. Of

Veterans
Administration