




Dead Leg Criteria Checklist

	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-B-053-001				
Dead Leg Type		X			
Termination	Capped				
Fixture served	-				
Valve Type	Ball				
Pipe Length	10' / 4'-6"				
Pipe Size	1-1/2" / 3/4"				
Pipe Function	DCW / DHW				
Pipe Material	CU				
Length of non insulated pipe	-				
Building #	18		Comments		
Floor Number	BASEMENT				
Room Number	53				
Location in Room	Center				
Demo Needed? Y/N	N				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 07/30/2014					


Dead Leg Criteria Checklist

	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-B-053-002				
Dead Leg Type		X			
Termination	Open				
Fixture served	-				
Valve Type	Ball				
Pipe Length	4'-6"				
Pipe Size	1/2"				
Pipe Function	DCW				
Pipe Material	CU				
Length of non insulated pipe	-				
Building #	18		Comments		
Floor Number	BASEMENT		South side of building		
Room Number	53				
Location in Room	Out side wall				
Demo Needed? Y/N	N				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 07/30/2014					


Dead Leg Criteria Checklist

	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-B-053-003				
Dead Leg Type		X			
Termination	Capped				
Fixture served	-				
Valve Type	Ball				
Pipe Length	8'				
Pipe Size	1-1/2"				
Pipe Function	DHW				
Pipe Material	CU				
Length of non insulated pipe	-				
Building #	18		Comments		
Floor Number	BASEMENT		South side of building		
Room Number	53				
Location in Room	Out side wall				
Demo Needed? Y/N	N				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 07/30/2014					


Dead Leg Criteria Checklist

	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-B-040-001				
Dead Leg Type		X			
Termination	Capped				
Fixture served	-				
Valve Type	-				
Pipe Length	3'				
Pipe Size	1/2"				
Pipe Function	DCW/DHW				
Pipe Material	CU				
Length of non insulated pipe	-				
Building #	18		Comments		
Floor Number	BASEMENT				
Room Number	40				
Location in Room	Back Wall from Entrance				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 07/31/2014					


Dead Leg Criteria Checklist

	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-B-040-002				
Dead Leg Type		X			
Termination	Capped				
Fixture served	-				
Valve Type	-				
Pipe Length	3'				
Pipe Size	1/2"				
Pipe Function	DCW/DHW				
Pipe Material	CU				
Length of non insulated pipe	-				
Building #	18		Comments		
Floor Number	BASEMENT				
Room Number	40				
Location in Room	Back Wall from Entrance				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 07/31/2014					


Dead Leg Criteria Checklist

	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-B-003-001				
Dead Leg Type		X			
Termination	Capped				
Fixture served	-				
Valve Type	-				
Pipe Length	3'				
Pipe Size	1/2"				
Pipe Function	DCW/DHW				
Pipe Material	CU				
Length of non insulated pipe	-				
Building #	18		Comments		
Floor Number	BASEMENT				
Room Number	3				
Location in Room	Right Corner from Entrance				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 07/31/2014					

Dead Leg Criteria Checklist

	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-LB-001-001				
Dead Leg Type		X			
Termination	Capped				
Fixture served	-				
Valve Type	Ball				
Pipe Length	5'				
Pipe Size	2"				
Pipe Function	DCW				
Pipe Material	CU				
Length of non insulated pipe	16"				
Building #	18		Comments		
Floor Number	LOWER BASEMENT				
Room Number	1				
Location in Room	Center				
Demo Needed? Y/N	N				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 07/31/2014					

Dead Leg Criteria Checklist

	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-LB-002-001				
Dead Leg Type		X			
Termination	Capped				
Fixture served	-				
Valve Type	-				
Pipe Length	13'				
Pipe Size	3/4"				
Pipe Function	DCW				
Pipe Material	CU				
Length of non insulated pipe	90"				
Building #	18		Comments		
Floor Number	LOWER BASEMENT				
Room Number	2				
Location in Room	North East Corner				
Demo Needed? Y/N	N				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 07/31/2014					


	Dead Leg Criteria Checklist						
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture			
Dead Leg #	18-2-228C-001						
Dead Leg Type				X			
Termination	sink						
Fixture served	hand sink						
Valve Type	ball						
Pipe Length	25'						
Pipe Size	1/2"						
Pipe Function	DCW, DHW						
Pipe Material	copper						
Length of non insulated pipe							
Building #	18		Comments				
Floor Number	2						
Room Number	228C						
Location in Room							
Room	left of entrance						
Demo Needed? Y/N	Y						
Drawing #							
Picture of Dead Leg (or area of termination)							
Date of Inspection	19-Aug						

Dead Leg Criteria Checklist									
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture					
Dead Leg #	18-3-350A-001								
Dead Leg Type			X						
Termination	bathroom group								
Fixture served	hand sink/water closet								
Valve Type	ball								
Pipe Length	10'								
Pipe Size	1/2"								
Pipe Function	DCW, DHW								
Pipe Material	copper								
Length of non insulated pipe									
Building #	18		Comments						
Floor Number	3								
Room Number	350A								
Location in Room	center								
Demo Needed? Y/N	Y								
Drawing #									
Picture of Dead Leg (or area of termination)									
Date of Inspection	19-Aug								


Dead Leg Criteria Checklist									
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture					
Dead Leg #	18-3-341A-001								
Dead Leg Type			X						
Termination	shower								
Fixture served	shower								
Valve Type									
Pipe Length	10'								
Pipe Size	1/2"								
Pipe Function	DCW, DHW								
Pipe Material	copper								
Length of non insulated pipe									
Building #	18		Comments						
Floor Number	3								
Room Number	341A								
Location in Room	rear								
Demo Needed? Y/N	Y								
Drawing #									
Picture of Dead Leg (or area of termination)									
Date of Inspection	19-Aug								


	Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture		
Dead Leg #	18-5-544-001					
Dead Leg Type				X		
Termination	sink					
Fixture served	hand sink					
Valve Type	ball					
Pipe Length	10'					
Pipe Size	1/2"					
Pipe Function	DCW, DHW					
Pipe Material	copper					
Length of non insulated pipe						
Building #	18		Comments			
Floor Number	5					
Room Number	544					
Location in Room						
Room	right of entrance					
Demo Needed? Y/N	Y					
Drawing #						
Picture of Dead Leg (or area of termination)						
Date of Inspection	19-Aug					

Dead Leg Criteria Checklist

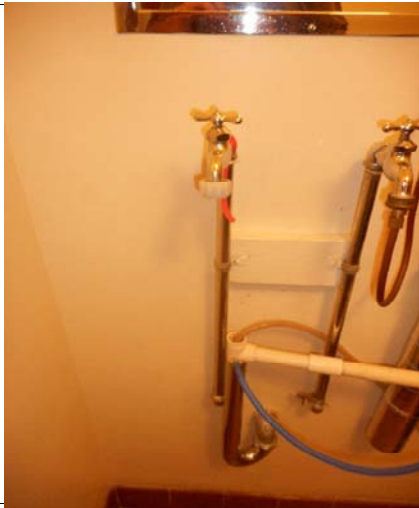
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-1-128-001				
Dead Leg Type		X			
Termination	Capped				
Fixture served	-				
Valve Type	-				
Pipe Length	11'				
Pipe Size	1/2"				
Pipe Function	DCW				
Pipe Material	CU				
Length of non insulated pipe	-				
Building #	18		Comments		
Floor Number	First		No tape due to location behind stove hood.		
Room Number	128				
Location in Room	Behind stove hood				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/04/2014					


Dead Leg Criteria Checklist


	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-1-150-001				
Dead Leg Type		X			
Termination	Capped				
Fixture served	-				
Valve Type	-				
Pipe Length	5'				
Pipe Size	1/2"				
Pipe Function	DCW / DHW				
Pipe Material	CU				
Length of non insulated pipe	All				
Building #	18		Comments		
Floor Number	First		No tape due to location behind stove hood.		
Room Number	150				
Location in Room	Back right corner				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/04/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-2-227-001				
Dead Leg Type			X		
Termination	Hand Sink				
Fixture served	Sink				
Valve Type	Ball				
Pipe Length	5'				
Pipe Size	1/2"				
Pipe Function	DCW / DHW				
Pipe Material	CU				
Length of non insulated pipe	All				
Building #	18		Comments		
Floor Number	Second		5' to Bathroom		
Room Number	227				
Location in Room	Left of Entrance				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/04/2014					


	Dead Leg Criteria Checklist				
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-2-241-001				
Dead Leg Type		X			
Termination	Capped				
Fixture served	-				
Valve Type	-				
Pipe Length	-				
Pipe Size	1/2"				
Pipe Function	-				
Pipe Material	CU				
Length of non insulated pipe	All				
Building #	18		Comments		
Floor Number	Second		Location in wall survey can not be determind. Can Not Confirm.		
Room Number	241				
Location in Room	Dividing Wall				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
Date of Inspection: 08/04/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-2-237-001				
Dead Leg Type		X			
Termination	Capped				
Fixture served	-				
Valve Type	Globe				
Pipe Length	4'				
Pipe Size	1/2"				
Pipe Function	DHW				
Pipe Material	Chrome Finish				
Length of non insulated pipe	All				
Building #	18		Comments		
Floor Number	First				
Room Number	237				
Location in Room	Left of Entrance				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/04/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-3-326-001				
Dead Leg Type		X			
Termination	Open				
Fixture served	-				
Valve Type	Ball				
Pipe Length	64'				
Pipe Size	1/2"				
Pipe Function	DCW				
Pipe Material	Copper				
Length of non insulated pipe	-				
Building #	18		Comments		
Floor Number	3		Starts on 3rd floor in room 321		
Room Number	326				
Location in Room	Back Wall				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/05/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-3-316A-001				
Dead Leg Type			X		
Termination	Shower				
Fixture served	Shower				
Valve Type	-				
Pipe Length	20'				
Pipe Size	1/2"				
Pipe Function	DCW/DHW				
Pipe Material	Copper				
Length of non insulated pipe	None				
Building #	18		Comments		
Floor Number	3				
Room Number	316A				
Location in Room	Center				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/05/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-3-316A-002				
Dead Leg Type			X		
Termination	Shower				
Fixture served	Shower				
Valve Type	-				
Pipe Length	20'				
Pipe Size	1/2"				
Pipe Function	DCW/DHW				
Pipe Material	Copper				
Length of non insulated pipe	None				
Building #	18		Comments		
Floor Number	3				
Room Number	316A				
Location in Room	Center				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/05/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-3-316A-003				
Dead Leg Type			X		
Termination	Shower				
Fixture served	Shower				
Valve Type	-				
Pipe Length	20'				
Pipe Size	1/2"				
Pipe Function	DCW/DHW				
Pipe Material	Copper				
Length of non insulated pipe	None				
Building #	18		Comments		
Floor Number	3				
Room Number	316A				
Location in Room	Center				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/05/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-3-316A-004				
Dead Leg Type			X		
Termination	Shower				
Fixture served	Shower				
Valve Type	-				
Pipe Length	20'				
Pipe Size	1/2"				
Pipe Function	DCW/DHW				
Pipe Material	Copper				
Length of non insulated pipe	None				
Building #	18		Comments		
Floor Number	3				
Room Number	316A				
Location in Room	Center				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/05/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-3-314A-001				
Dead Leg Type			X		
Termination	Shower				
Fixture served	Shower				
Valve Type	-				
Pipe Length	10'				
Pipe Size	1/2"				
Pipe Function	DCW/DHW				
Pipe Material	Copper				
Length of non insulated pipe	None				
Building #	18		Comments		
Floor Number	3				
Room Number	314A				
Location in Room	Left of Bathroom				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/05/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-3-311-001				
Dead Leg Type			X		
Termination	Hand Sink				
Fixture served	Hand Sink				
Valve Type	-				
Pipe Length	5'				
Pipe Size	1/2"				
Pipe Function	DCW/DHW				
Pipe Material	Copper				
Length of non insulated pipe	None				
Building #	18		Comments		
Floor Number	3				
Room Number	311				
Location in Room	Right of Room				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/05/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-4-416A-001				
Dead Leg Type			X		
Termination	Shower				
Fixture served	Shower				
Valve Type	-				
Pipe Length	20'				
Pipe Size	1/2"				
Pipe Function	DCW/DHW				
Pipe Material	Copper				
Length of non insulated pipe	None				
Building #	18		Comments		
Floor Number	4				
Room Number	416A				
Location in Room					
Room	Across from Entrance				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/05/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-4-416A-002				
Dead Leg Type			X		
Termination	Shower				
Fixture served	Shower				
Valve Type	-				
Pipe Length	20'				
Pipe Size	1/2"				
Pipe Function	DCW/DHW				
Pipe Material	Copper				
Length of non insulated pipe	None				
Building #	18		Comments		
Floor Number	4				
Room Number	416A				
Location in Room	Across from Entrance				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/05/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-4-416A-003				
Dead Leg Type			X		
Termination	Shower				
Fixture served	Shower				
Valve Type	-				
Pipe Length	20'				
Pipe Size	1/2"				
Pipe Function	DCW/DHW				
Pipe Material	Copper				
Length of non insulated pipe	None				
Building #	18		Comments		
Floor Number	4				
Room Number	416A				
Location in Room	Across from Entrance				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/05/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-4-416A-004				
Dead Leg Type			X		
Termination	Shower				
Fixture served	Shower				
Valve Type	-				
Pipe Length	20'				
Pipe Size	1/2"				
Pipe Function	DCW/DHW				
Pipe Material	Copper				
Length of non insulated pipe	None				
Building #	18		Comments		
Floor Number	4				
Room Number	416A				
Location in Room	Across from Entrance				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/05/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-4-430-001				
Dead Leg Type		X			
Termination	Capped				
Fixture served	-				
Valve Type	-				
Pipe Length	5'				
Pipe Size	1/2"				
Pipe Function	DHW				
Pipe Material	Copper				
Length of non insulated pipe	None				
Building #	18		Comments		
Floor Number	4				
Room Number	430				
Location in Room	Left of Entrance				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/06/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-4-430-002				
Dead Leg Type		X			
Termination	Capped				
Fixture served	-				
Valve Type	-				
Pipe Length	5'				
Pipe Size	1"				
Pipe Function	DCW				
Pipe Material	Copper				
Length of non insulated pipe	None				
Building #	18		Comments		
Floor Number	4				
Room Number	430				
Location in Room	Left of Entrance				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/06/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-4-432-001				
Dead Leg Type		X			
Termination	Capped				
Fixture served	-				
Valve Type	-				
Pipe Length	10'				
Pipe Size	1"				
Pipe Function	DCW				
Pipe Material	Copper				
Length of non insulated pipe	None				
Building #	18		Comments		
Floor Number	4				
Room Number	432				
Location in Room	Pipechase				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/06/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-4-433-001				
Dead Leg Type		X			
Termination	Capped				
Fixture served	-				
Valve Type	-				
Pipe Length	10'				
Pipe Size	1"/3/4"				
Pipe Function	DCW/DHW				
Pipe Material	Copper				
Length of non insulated pipe	None				
Building #	18		Comments		
Floor Number	4				
Room Number	433				
Location in Room	Pipechase				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/06/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-4-450A-001				
Dead Leg Type			X		
Termination	Sink				
Fixture served	Sink				
Valve Type	-				
Pipe Length	5'				
Pipe Size	1/2"				
Pipe Function	DCW/DHW				
Pipe Material	Copper				
Length of non insulated pipe	None				
Building #	18		Comments		
Floor Number	4				
Room Number	450A				
Location in Room	Center				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/06/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-4-447-001				
Dead Leg Type		X			
Termination	Capped				
Fixture served	-				
Valve Type	-				
Pipe Length	10'				
Pipe Size	3/4"				
Pipe Function	DCW				
Pipe Material	Copper				
Length of non insulated pipe	None				
Building #	18		Comments		
Floor Number	4				
Room Number	447				
Location in Room	Above Sink				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/06/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-4-434A-001				
Dead Leg Type			X		
Termination	Shower				
Fixture served	Shower				
Valve Type	-				
Pipe Length	20'				
Pipe Size	1/2"				
Pipe Function	DCW/DHW				
Pipe Material					
Length of non insulated pipe	None				
Building #	18		Comments		
Floor Number	4		Only tagged once.		
Room Number	434A				
Location in Room	Center				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/06/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-4-434A-002				
Dead Leg Type			X		
Termination	Shower				
Fixture served	Shower				
Valve Type	-				
Pipe Length	20'				
Pipe Size	1/2"				
Pipe Function	DCW/DHW				
Pipe Material					
Length of non insulated pipe	None				
Building #	18		Comments		
Floor Number	4		Only tagged once.		
Room Number	434A				
Location in Room	Center				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/06/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-4-434A-003				
Dead Leg Type			X		
Termination	Shower				
Fixture served	Shower				
Valve Type	-				
Pipe Length	20'				
Pipe Size	1/2"				
Pipe Function	DCW/DHW				
Pipe Material					
Length of non insulated pipe	None				
Building #	18		Comments Only tagged once.		
Floor Number	4				
Room Number	434A				
Location in Room	Center				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/06/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-5-516A-001				
Dead Leg Type			X		
Termination	Shower				
Fixture served	Shower				
Valve Type	-				
Pipe Length	20'				
Pipe Size	1/2"				
Pipe Function	DCW/DHW				
Pipe Material					
Length of non insulated pipe	None				
Building #	18		Comments		
Floor Number	5		Can not confirm Mixing Valve type.		
Room Number	516A				
Location in Room	Center				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/06/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-5-516A-002				
Dead Leg Type			X		
Termination	Shower				
Fixture served	Shower				
Valve Type	-				
Pipe Length	20'				
Pipe Size	1/2"				
Pipe Function	DCW/DHW				
Pipe Material					
Length of non insulated pipe	None				
Building #	18		Comments		
Floor Number	5		Can not confirm Mixing Valve type.		
Room Number	516A				
Location in Room	Center				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/06/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-5-516A-003				
Dead Leg Type			X		
Termination	Shower				
Fixture served	Shower				
Valve Type	-				
Pipe Length	20'				
Pipe Size	1/2"				
Pipe Function	DCW/DHW				
Pipe Material					
Length of non insulated pipe	None				
Building #	18		Comments		
Floor Number	5		Can not confirm Mixing Valve type.		
Room Number	516A				
Location in Room	Center				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/06/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-5-516A-004				
Dead Leg Type			X		
Termination	Shower				
Fixture served	Shower				
Valve Type	-				
Pipe Length	20'				
Pipe Size	1/2"				
Pipe Function	DCW/DHW				
Pipe Material					
Length of non insulated pipe	None				
Building #	18		Comments		
Floor Number	5		Can not confirm Mixing Valve type.		
Room Number	516A				
Location in Room	Center				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/06/2014					


Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	18-5-543-001				
Dead Leg Type		X			
Termination	Capped				
Fixture served	-				
Valve Type	Ball				
Pipe Length	5'				
Pipe Size	1/2"				
Pipe Function	DCW/DHW				
Pipe Material	Copper				
Length of non insulated pipe	None				
Building #	18		Comments		
Floor Number	5				
Room Number	543				
Location in Room	Right Corner				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
					
Date of Inspection: 08/06/2014					


Mixing Valve Criteria Checklist					
			Description		
Mix Valve #	18-1-126-001				
Mixing Valve Type	Temporing				
Termination	Hand Sink				
Fixture served	Sink				
Valve Type	Mixing				
Mixing Valve Size	1/2"				
Building #	18	Comments			
Floor Number	First	Feeds 1st and 2nd			
Room Number	126				
Location in Room	pipechase				
Drawing #					
Picture of Dead Leg					
					
					Date of Inspection:


Mixing Valve Criteria Checklist				
Description				
Mix Valve #	18-2-241-001			
Mixing Valve Type	Temporing			
Termination	Showers			
Fixture served	Showers			
Valve Type	Mixing			
Mixing Valve Size	1/2"			
Building #	18	Comments		
Floor Number	Second	MN: Lower Model 4000 Idianapolis IN		
Room Number	241			
Location in Room	Dividing Wall			
Drawing #				
Picture of Dead Leg				
				
Date of Inspection:	8/4/2014			

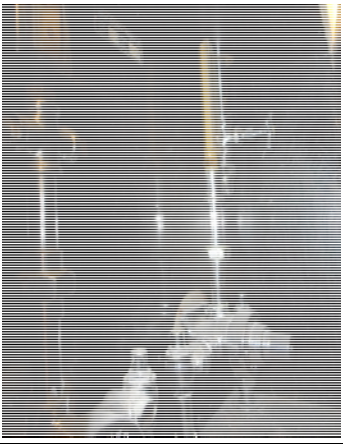
Mixing Valve Criteria Checklist				
Description				
Mix Valve #	18-2-241-002			
Mixing Valve Type	Temporing			
Termination	Showers			
Fixture served	Showers			
Valve Type	Mixing			
Mixing Valve Size	1/2"			
Building #	18	Comments		
Floor Number	Second	MN: Lower Model 4000 Idianapolis IN		
Room Number	241			
Location in Room	Dividing Wall			
Drawing #				
Picture of Dead Leg				
				
Date of Inspection:	8/4/2014			

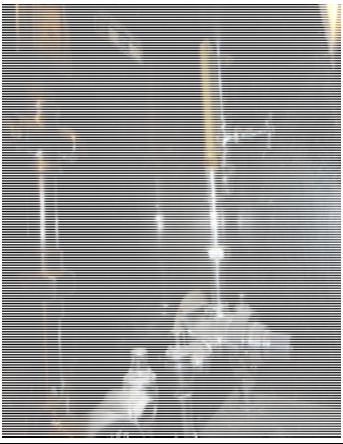
Mixing Valve Criteria Checklist				
Description				
Mix Valve #	18-2-241-003			
Mixing Valve Type	Temporing			
Termination	Showers			
Fixture served	Showers			
Valve Type	Mixing			
Mixing Valve Size	1/2"			
Building #	18	Comments		
Floor Number	Second	MN: Lower Model 4000 Idianapolis IN		
Room Number	241			
Location in Room	Dividing Wall			
Drawing #				
Picture of Dead Leg				
Date of Inspection:				
8/4/2014				


Mixing Valve Criteria Checklist			
Description			
Mix Valve #	18-3-316A-001		
Mixing Valve Type	Tempering		
Termination	Shower		
Fixture served	Shower		
Valve Type	Mixing		
Mixing Valve Size	1/2"		
Building #	18	Comments	
Floor Number	Third		
Room Number	316A		
Location in Room	Wall Along Entrance		
Drawing #			
Picture of Dead Leg			
			
Date of Inspection:	8/5/2014		


Mixing Valve Criteria Checklist				
Description				
Mix Valve #	18-3-316A-002			
Mixing Valve Type	Tempering			
Termination	Shower			
Fixture served	Shower			
Valve Type	Mixing			
Mixing Valve Size	1/2"			
Building #	18	Comments		
Floor Number	Third			
Room Number	316A			
Location in Room	Wall Along Entrance			
Drawing #				
Picture of Dead Leg				
Date of Inspection:				
8/5/2014				


Mixing Valve Criteria Checklist				
Description				
Mix Valve #	18-3-316A-003			
Mixing Valve Type	Tempering			
Termination	Shower			
Fixture served	Shower			
Valve Type	Mixing			
Mixing Valve Size	1/2"			
Building #	18	Comments		
Floor Number	Third			
Room Number	316A			
Location in Room	Wall Along Entrance			
Drawing #				
Picture of Dead Leg				
Date of Inspection:				
8/5/2014				


Mixing Valve Criteria Checklist			
Description			
Mix Valve #	18-3-316A-004		
Mixing Valve Type	Tempering		
Termination	Shower		
Fixture served	Shower		
Valve Type	Mixing		
Mixing Valve Size	1/2"		
Building #	18	Comments	
Floor Number	Third		
Room Number	316A		
Location in Room	Wall Along Entrance		
Drawing #			
Picture of Dead Leg			
			
Date of Inspection:	8/5/2014		


Mixing Valve Criteria Checklist			
Description			
Mix Valve #	18-3-316A-005		
Mixing Valve Type	Tempering		
Termination	Shower		
Fixture served	Shower		
Valve Type	Mixing		
Mixing Valve Size	1/2"		
Building #	18	Comments	
Floor Number	Third		
Room Number	316A		
Location in Room	Wall Along Entrance		
Drawing #			
Picture of Dead Leg			
			
Date of Inspection:	8/5/2014		


Mixing Valve Criteria Checklist				
Description				
Mix Valve #	18-3-334A-001			
Mixing Valve Type	Tempering			
Termination	Shower			
Fixture served	Shower			
Valve Type	Mixing			
Mixing Valve Size	1/2"			
Building #	18	Comments		
Floor Number	Third			
Room Number	334A			
Location in Room	Left of Entrance			
Drawing #				
Picture of Dead Leg				
Date of Inspection:				
8/5/2014				


Mixing Valve Criteria Checklist				
Description				
Mix Valve #	18-3-334A-002			
Mixing Valve Type	Tempering			
Termination	Shower			
Fixture served	Shower			
Valve Type	Mixing			
Mixing Valve Size	1/2"			
Building #	18	Comments		
Floor Number	Third			
Room Number	334A			
Location in Room	Left of Entrance			
Drawing #				
Picture of Dead Leg				
Date of Inspection:				
8/5/2014				


Mixing Valve Criteria Checklist				
Description				
Mix Valve #	18-3-334A-003			
Mixing Valve Type	Tempering			
Termination	Shower			
Fixture served	Shower			
Valve Type	Mixing			
Mixing Valve Size	1/2"			
Building #	18	Comments		
Floor Number	Third			
Room Number	334A			
Location in Room	Left of Entrance			
Drawing #				
Picture of Dead Leg				
Date of Inspection:				
8/5/2014				

Mixing Valve Criteria Checklist			
Description			
Mix Valve #	18-4-416A-001		
Mixing Valve Type	Tempering		
Termination	Shower		
Fixture served	Shower		
Valve Type	Mixing		
Mixing Valve Size	1/2"		
Building #	18	Comments	
Floor Number	4		
Room Number	416A		
Location in Room	Wall Along Entrance		
Drawing #			
Picture of Dead Leg			
			
Date of Inspection:	8/5/2014		

Mixing Valve Criteria Checklist			
Description			
Mix Valve #	18-4-416A-002		
Mixing Valve Type	Tempering		
Termination	Shower		
Fixture served	Shower		
Valve Type	Mixing		
Mixing Valve Size	1/2"		
Building #	18	Comments	
Floor Number	4		
Room Number	416A		
Location in Room	Wall Along Entrance		
Drawing #			
Picture of Dead Leg			
			
Date of Inspection: 8/5/2014			

Mixing Valve Criteria Checklist			
Description			
Mix Valve #	18-4-416A-003		
Mixing Valve Type	Tempering		
Termination	Shower		
Fixture served	Shower		
Valve Type	Mixing		
Mixing Valve Size	1/2"		
Building #	18	Comments	
Floor Number	4		
Room Number	416A		
Location in Room	Wall Along Entrance		
Drawing #			
Picture of Dead Leg			
			
Date of Inspection:	8/5/2014		

Mixing Valve Criteria Checklist				
Description				
Mix Valve #	18-4-416A-004			
Mixing Valve Type	Tempering			
Termination	Shower			
Fixture served	Shower			
Valve Type	Mixing			
Mixing Valve Size	1/2"			
Building #	18	Comments		
Floor Number	4			
Room Number	416A			
Location in Room	Wall Along Entrance			
Drawing #				
Picture of Dead Leg				
Date of Inspection:				
8/5/2014				

Mixing Valve Criteria Checklist					
Description					
Mix Valve #	18-4-418-001				
Mixing Valve Type	Tempering				
Termination	Multiple Hand Sinks				
Fixture served	Hand Sink				
Valve Type	Mixing				
Mixing Valve Size	3/4"				
Building #	18	Comments			
Floor Number	4				
Room Number	418				
Location in Room	In Pipechase				
Drawing #					
Picture of Dead Leg					
Date of Inspection:					

8/5/2014