

Dead Leg Criteria Checklist

Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	19-B-004-001			
Dead Leg Type		X		
Termination	Cap			
Fixture served	None			
Valve Type	Gate			
Pipe Length	4'			
Pipe Size	3/4"			
Pipe Function	DCW			
Pipe Material	Copper			
Length of non insulated pipe	None			

Building #	19		Comments
Floor Number	Basement		
Room Number	Area 004		
Location in Room	Center		
Demo Needed? Y/N	No		
Drawing #			

Picture of Dead Leg



Date of Inspection: 05/29/2014

Dead Leg Criteria Checklist

Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	19-B-004-002			
Dead Leg Type		X		
Termination	Cap			
Fixture served	None			
Valve Type	Gate			
Pipe Length	20'			
Pipe Size	2"			
Pipe Function	DCW			
Pipe Material	Copper			
Length of non insulated pipe	None			

Building #	19			Comments
Floor Number	Basement			
Room Number	Area 004			
Location in Room	center			
Demo Needed? Y/N	No			
Drawing #				

Picture of Dead Leg



Date of Inspection: 05/29/2014

Dead Leg Criteria Checklist

Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	19-B-004-003			
Dead Leg Type		X		
Termination	Cap			
Fixture served	None			
Valve Type	Gate			
Pipe Length	5'			
Pipe Size	1-1/2"			
Pipe Function	DCW			
Pipe Material	Copper			
Length of non insulated pipe	None			

Building #	19		Comments	
Floor Number	Basement			
Room Number	Area 004			
Location in Room	Center			
Demo Needed? Y/N	No			
Drawing #				

Picture of Dead Leg



Date of Inspection: 05/29/2014

Dead Leg Criteria Checklist

Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	19-B-001-002			
Dead Leg Type		X		
Termination	Valve/Cap			
Fixture served	None			
Valve Type	Gate			
Pipe Length	56'			
Pipe Size	1-1/4', 1/2"			
Pipe Function	DHW, DHWR			
Pipe Material	Copper			
Length of non insulated pipe	None			

Building #	19		Comments	
Floor Number	Basement			
Room Number	Area 001			
Location in Room	center			
Demo Needed? Y/N	No			
Drawing #				

Picture of Dead Leg



Date of Inspection: 05/30/2014

Dead Leg Criteria Checklist

	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture
Dead Leg #	19-B-001-003			
Dead Leg Type		X		
Termination	Cap			
Fixture served	None			
Valve Type	None			
Pipe Length	9'			
Pipe Size	1/2"			
Pipe Function	DHW			
Pipe Material	Copper			
Length of non insulated pipe	None			

Building #	19		Comments
Floor Number	Basement		
Room Number	Area 001		
Location in Room	center		
Demo Needed? Y/N	No		
Drawing #			

Picture of Dead Leg



Date of Inspection: 05/30/2014

Dead Leg Criteria Checklist

Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	19-B-001-004			
Dead Leg Type		X		
Termination	Cap			
Fixture served	None			
Valve Type	None			
Pipe Length	9'			
Pipe Size	1/2"			
Pipe Function	DCW			
Pipe Material	Copper			
Length of non insulated pipe	None			

Building #	19		Comments
Floor Number	Basement		
Room Number	Area 001		
Location in Room	center		
Demo Needed? Y/N	No		
Drawing #			

Picture of Dead Leg



Date of Inspection: 05/30/2014

Dead Leg Criteria Checklist

	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	19-B-001-005				
Dead Leg Type		X			
Termination	Cap				
Fixture served	None				
Valve Type	Gate				
Pipe Length	12'				
Pipe Size	3/4"/3/4"				
Pipe Function	DHW/DCW				
Pipe Material	Copper				
Length of non insulated pipe	None				

Building #	19		Comments
Floor Number	Basement		
Room Number	Area 001		
Location in Room	center		
Demo Needed? Y/N	No		
Drawing #			

Picture of Dead Leg



Date of Inspection: 05/30/2014

Dead Leg Criteria Checklist

	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	19-B-001-006				
Dead Leg Type		X			
Termination	Cap				
Fixture served	None				
Valve Type	Gate				
Pipe Length	21'				
Pipe Size	3/4"/3/4"/3/4"				
Pipe Function	DHW/DCW/DHWR				
Pipe Material	Copper				
Length of non insulated pipe	None				
Building #	19		Comments		
Floor Number	Basement				
Room Number	Area 001				
Location in Room	center				
Demo Needed? Y/N	No				
Drawing #					
Picture of Dead Leg					
					
Date of Inspection: 06/02/2014					

Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	19-2-229C-001				
Dead Leg Type			X		
Termination	sink				
Fixture served	hand sink				
Valve Type	ball				
Pipe Length	8'				
Pipe Size	1/2"				
Pipe Function	DCW, DHW				
Pipe Material	copper				
Length of non insulated pipe					
Building #	19		Comments		
Floor Number	2				
Room Number	229C				
Location in Room	northeast wall				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
Date of Inspection	4-Jun				

Dead Leg Criteria Checklist					
	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	19-3-328-001				
Dead Leg Type			X		
Termination	sink				
Fixture served	hand sink				
Valve Type	ball				
Pipe Length	30'				
Pipe Size	1/2"				
Pipe Function	DCW, DHW				
Pipe Material	copper				
Length of non insulated pipe					
Building #	19		Comments		
Floor Number	3				
Room Number	229				
Location in Room	north wall				
Demo Needed? Y/N	Y				
Drawing #					
Picture of Dead Leg (or area of termination)					
Date of Inspection	19-Aug				

Dead Leg Criteria Checklist

Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	19-2-247-001			
Dead Leg Type		X		
Termination	Cap			
Fixture served	WC / LAV			
Valve Type	Ball			
Pipe Length	3' / 3'			
Pipe Size	1" / 3/4"			
Pipe Function	DCW / DHW			
Pipe Material	Galv / Copper			
Length of non insulated pipe	ALL			

Building #	19		Comments
Floor Number	2		
Room Number	247		
Location in Room	chase		
Demo Needed? Y/N	No		
Drawing #			

Picture of Dead Leg



Date of Inspection: 06/03/2014

Dead Leg Criteria Checklist

Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	19-2-219-001			
Dead Leg Type		X		
Termination	Cap			
Fixture served	Water Closet			
Valve Type	None			
Pipe Length	8'			
Pipe Size	1"			
Pipe Function	DCW			
Pipe Material	Copper			
Length of non insulated pipe	None			

Building #	19		Comments
Floor Number	2		
Room Number	219		
Location in Room	chase		
Demo Needed? Y/N	No		
Drawing #			

Picture of Dead Leg



Date of Inspection: 05/30/2014

Dead Leg Criteria Checklist

Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	19-2-204A-001			
Dead Leg Type		X		
Termination	Cap			
Fixture served	sink, water closet			
Valve Type	None			
Pipe Length	5', 3'			
Pipe Size	3/4" /1/2"			
Pipe Function	DCW/DHW-temp			
Pipe Material	Copper			
Length of non insulated pipe	3'			

Building #	19		Comments
Floor Number	2		tempered water from mixing valve in chase, tempered still feeds first floor
Room Number	204		
Location in Room	chase		
Demo Needed? Y/N	No		
Drawing #			

Picture of Dead Leg



Date of Inspection: 06/03/2014

Dead Leg Criteria Checklist

Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	19-2-256A-001			
Dead Leg Type		X		
Termination	Cap			
Fixture served	None			
Valve Type	None			
Pipe Length	15'			
Pipe Size	1 1/2" /3/4"			
Pipe Function	DCW/DHW			
Pipe Material	Galvanized			
Length of non insulated pipe	None			

Building #	19		Comments
Floor Number	2		
Room Number	256		
Location in Room	ceiling		
Demo Needed? Y/N	No		
Drawing #			

Picture of Dead Leg




Date of Inspection: 06/03/2014

Dead Leg Criteria Checklist

	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	19-2-257A-001				
Dead Leg Type		X			
Termination	Cap				
Fixture served	sink, water closet				
Valve Type	Gate valve				
Pipe Length	13'-6"/11'-6"/1'-6"				
Pipe Size	1 1/4" / 3/4" / 1/2"				
Pipe Function	DCW/DHW/DHWR				
Pipe Material	Copper				
Length of non insulated pipe	ALL				

Building #	19		Comments
Floor Number	2		
Room Number	257A		
Location in Room	chase		
Demo Needed? Y/N	No		
Drawing #			

Picture of Dead Leg

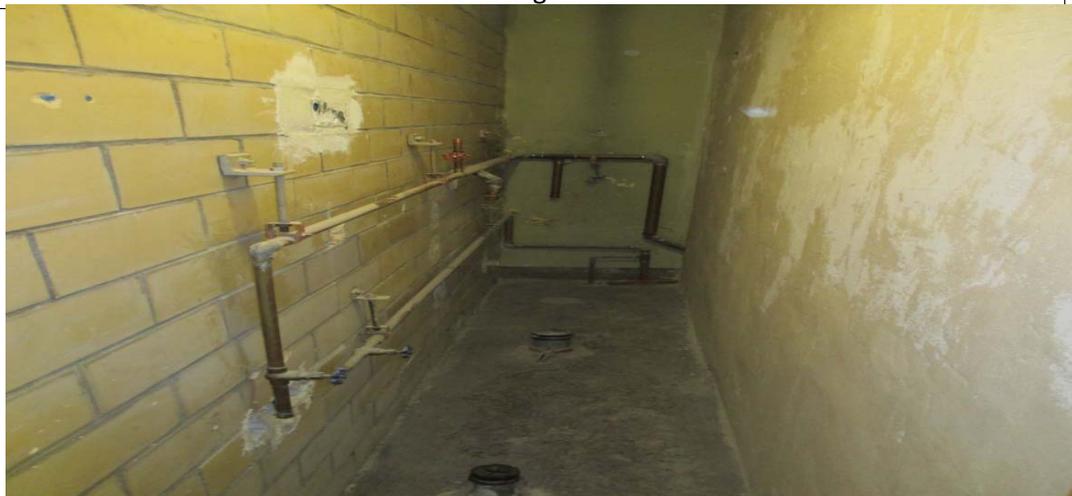

Date of Inspection: 06/03/2014

Dead Leg Criteria Checklist

	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	19-2-229-001				
Dead Leg Type			X		
Termination	sink				
Fixture served	Hand Sink				
Valve Type	Ball				
Pipe Length	10', 10'				
Pipe Size	1/2", 1/2"				
Pipe Function	DCW /DHW				
Pipe Material	Copper				
Length of non insulated pipe	none				
Building #	19		Comments		
Floor Number	2		Foot pedal operated		
Room Number	229				
Location in Room					
Demo Needed? Y/N	No				
Drawing #					
Picture of Dead Leg					
					
Date of Inspection: 06/04/2014					

Dead Leg Criteria Checklist

	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	19-2-229B-001				
Dead Leg Type			X		
Termination	sink				
Fixture served	Mop Sink				
Valve Type	Ball				
Pipe Length	10', 10'				
Pipe Size	1/2", 1/2"				
Pipe Function	DCW /DHW				
Pipe Material	Copper				
Length of non insulated pipe	none				

Building #	19		Comments
Floor Number	2		
Room Number	229B		
Location in Room			
Demo Needed? Y/N	No		
Drawing #			

Picture of Dead Leg



Date of Inspection: 06/04/2014

Dead Leg Criteria Checklist

Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	19-3-329A-001			
Dead Leg Type		X		
Termination	Cap			
Fixture served	None			
Valve Type	None			
Pipe Length	10', 10'			
Pipe Size	1/2", 1/2"			
Pipe Function	DHW/DCW			
Pipe Material	Copper			
Length of non insulated pipe	None			

Building #	19		Comments
Floor Number	3		
Room Number	329A		
Location in Room	wall		
Demo Needed? Y/N	yes		
Drawing #			

Picture of Dead Leg



Date of Inspection: 06/04/2014

Dead Leg Criteria Checklist

Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	19-3-315-001			
Dead Leg Type		X		
Termination	Cap			
Fixture served	none			
Valve Type	none			
Pipe Length	35'			
Pipe Size	3/4"			
Pipe Function	DCW			
Pipe Material	Copper			
Length of non insulated pipe	none			

Building #	19		Comments
Floor Number	3		tagged in basement and 3rd floor
Room Number	315		
Location in Room	pipe chase		
Demo Needed? Y/N	No		
Drawing #			

Picture of Dead Leg



Date of Inspection: 06/04/2014

Dead Leg Criteria Checklist

	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	19-3-315-002				
Dead Leg Type		X			
Termination	Cap				
Fixture served	none				
Valve Type	none				
Pipe Length	17'				
Pipe Size	3/4"				
Pipe Function	DCW				
Pipe Material	Copper				
Length of non insulated pipe	none				
Building #	19		Comments		
Floor Number	3		no photo		
Room Number	315				
Location in Room	pipe chase				
Demo Needed? Y/N	No				
Drawing #					
Picture of Dead Leg					
Date of Inspection: 06/04/2014					

Dead Leg Criteria Checklist

Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	19-3-339-001			
Dead Leg Type		x		
Termination	Cap			
Fixture served	WC			
Valve Type	None			
Pipe Length	3'			
Pipe Size	1"			
Pipe Function	DCW			
Pipe Material	Copper			
Length of non insulated pipe	none			

Building #	19		Comments	
Floor Number	3			
Room Number	339			
Location in Room	Chase			
Demo Needed? Y/N	No			
Drawing #				

Picture of Dead Leg



Date of Inspection: 06/04/2014

Dead Leg Criteria Checklist

	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	19-3-339-002				
Dead Leg Type		x			
Termination	Cap				
Fixture served	Sink				
Valve Type	Ball				
Pipe Length	4' / 4'				
Pipe Size	3/4" / 3/4"				
Pipe Function	DCW / DHW				
Pipe Material	Copper				
Length of non insulated pipe	none				
Building #	19		Comments		
Floor Number	3				
Room Number	339				
Location in Room	Chase				
Demo Needed? Y/N	No				
Drawing #					
Picture of Dead Leg					
					
Date of Inspection: 06/04/2014					

Dead Leg Criteria Checklist

	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	19-3-345A-001				
Dead Leg Type		x			
Termination	Cap				
Fixture served	Mixing Valve				
Valve Type	Mixing Valve				
Pipe Length	50'				
Pipe Size	1/2" / 1/2"				
Pipe Function	DCW / DHW				
Pipe Material	Copper				
Length of non insulated pipe					

Building #	19		Comments
Floor Number	3		
Room Number	345A		
Location in Room	Cabinet		
Demo Needed? Y/N	Yes		
Drawing #			

Picture of Dead Leg



Date of Inspection: 06/04/2014

Dead Leg Criteria Checklist

	Description	Pipe Length greater than three feet terminating at a cap, valve, or fitting	Pipe length greater than three feet terminating at an infrequently used plumbing fixture	Pipe length greater than 25 feet terminating at a frequently used plumbing fixture	
Dead Leg #	19-3-345A-002				
Dead Leg Type		x			
Termination	Cap				
Fixture served	Mixing Valve				
Valve Type	Mixing Valve				
Pipe Length	50'				
Pipe Size	1/2" / 1/2"				
Pipe Function	DCW / DHW				
Pipe Material	Copper				
Length of non insulated pipe					

Building #	19		Comments
Floor Number	3		
Room Number	345A		
Location in Room	Cabinet		
Demo Needed? Y/N	Yes		
Drawing #			

Picture of Dead Leg



Date of Inspection: 06/04/2014

Mixing Valve Criteria Checklist

Description

Mix Valve #	19-B-004-001
Mixing Valve Type	MCC Powers Process Controls
Termination	DHW
Fixture served	Distribution System
Valve Type	
Mixing Valve Size	1-1/2"

Building #	19	Comments Mixing Valve is from former DHW system and appears to be not used.
Floor Number	Basement	
Room Number	4	
Location in Room	Center	
Drawing #		

Picture of Dead Leg



Date of Inspection:	5/29/2014						
---------------------	-----------	--	--	--	--	--	--

Mixing Valve Criteria Checklist

Description

Mix Valve #	19-2-204-01
Mixing Valve Type	
Termination	DHW
Fixture served	Sinks 204A and 104A
Valve Type	
Mixing Valve Size	1"

Building #	19	Comments
Floor Number	Second	
Room Number	204	
Location in Room	Center	
Drawing #		

Picture of Dead Leg



Date of Inspection:	5/29/2014							
---------------------	-----------	--	--	--	--	--	--	--

Mixing Valve Criteria Checklist

Description

Mix Valve #	19-3-338-001 (19-3-337-001)
Mixing Valve Type	
Termination	
Fixture served	Hand Sink
Valve Type	Tempering
Mixing Valve Size	3/4"

Building #	19	Comments
Floor Number	3	
Room Number	338 (337)	
Location in Room	Chase	
Drawing #		

Picture of Dead Leg



Date of Inspection:	5/29/2014							
---------------------	-----------	--	--	--	--	--	--	--

Mixing Valve Criteria Checklist

Description

Mix Valve #	19-3-319-001
Mixing Valve Type	Tempering
Termination	Room 317
Fixture served	Hand Sink
Valve Type	Tempering
Mixing Valve Size	1/2"

Building #	19	Comments
Floor Number	3	
Room Number	319	
Location in Room	Chase	
Drawing #		

Picture of Dead Leg



Date of Inspection: 5/29/2014

Mixing Valve Criteria Checklist

Description

Mix Valve #	19-3-353A-001
Mixing Valve Type	Tempering
Termination	sink
Fixture served	Hand Sink
Valve Type	Tempering
Mixing Valve Size	1/2"

Building #	19	Comments
Floor Number	3	
Room Number	353A	
Location in Room	Chase	
Drawing #		

Picture of Dead Leg



Date of Inspection: 5/29/2014