
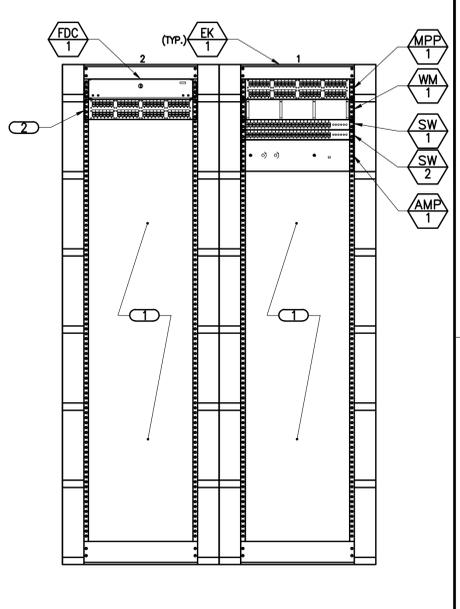
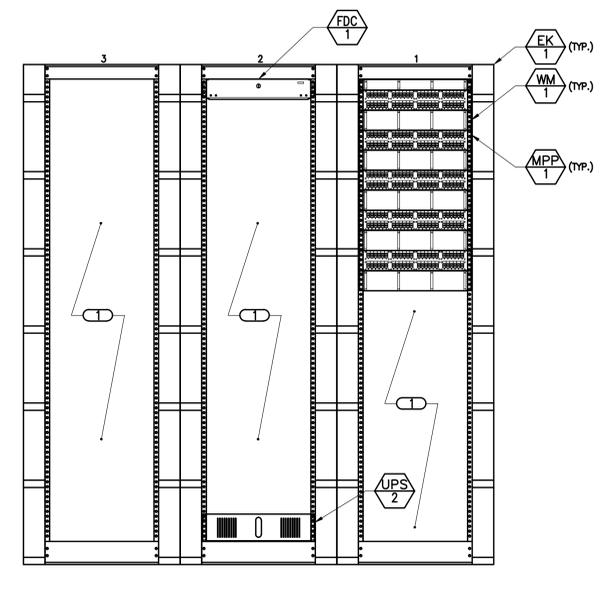
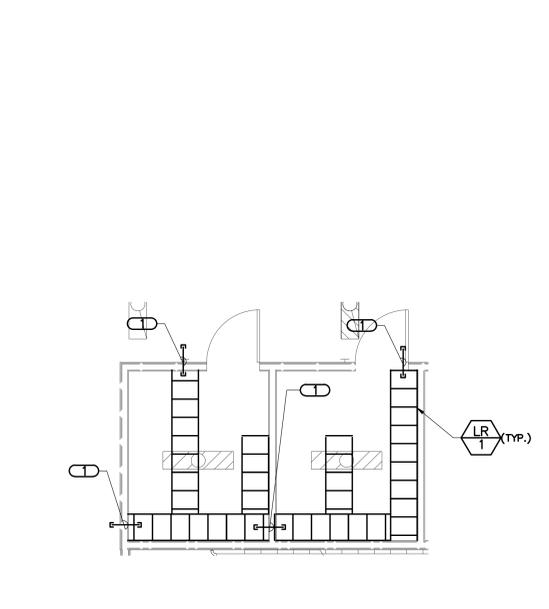
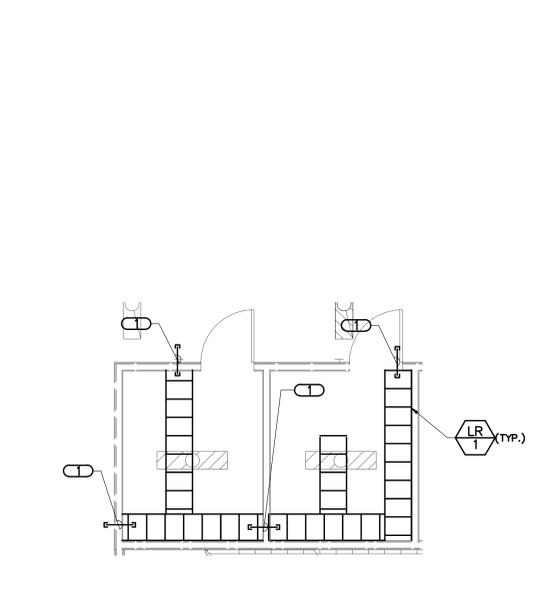


three inches = one foot
 one and one half inches = one foot
 three quarters inch = one foot
 one half inch = one foot
 three eighths inch = one foot
 one quarter inch = one foot
 one eighth inch = one foot

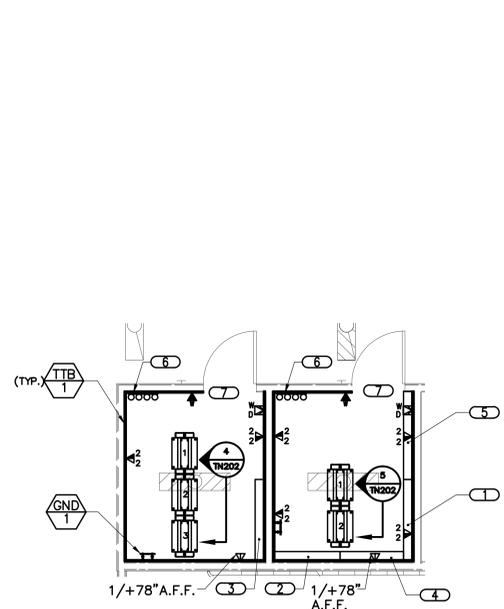

1 TECH/DATA ROOM 2A 122 AND 2A 121 LAYOUT
 SCALE 1/4"=1'-0"

NOTES:
 1. CONTRACTOR SHALL MOUNT GROUND BAR AT 7'-0" A.F.F. REFER TO 3/TN301 FOR GROUND BAR DETAIL.
 2. REFER TO 2/TN300 FOR TECH/DATA ROOM HORIZONTAL CABLE LADDER RACK LAYOUT.
 3. REFER TO 3/TN202 FOR TECH/DATA ROOM BACKBONE CABLE LADDER RACK LAYOUT.

KEYNOTES:
 1 SPACE FOR FIRE ALARM EQUIPMENT.
 2 SPACE FOR ACCESS CONTROL EQUIPMENT.
 3 VOICE BACKBONE TERMINATIONS 110 BLOCKS.
 4 SPACE FOR CCTV EQUIPMENT.
 5 SPACE FOR PAGING EQUIPMENT.
 6 FOUR (4) 4" CONDUIT SLEEVES TO 1A 109 AND 1A 108.
 7 CONTRACTOR SHALL MOUNT MOTION DETECTOR BELOW LADDER RACK AT 7'-8" A.F.F.

2 TECH/DATA ROOM 2A 122 AND 2A 121 LADDER RACK LAYOUT
 SCALE 1/4"=1'-0"

NOTES:
 1. CONTRACTOR SHALL MOUNT LADDER RACK AT 8'-0" A.F.F.
 2. REFER TO 7/TN300 FOR CABLE RUNWAY RADIUS DROP. PROVIDE CABLE RUNWAY RADIUS DROP FOR EACH RACK.

KEYNOTES:
 1 CONTRACTOR SHALL PROVIDE FOUR (4) 4" CONDUIT SLEEVES

3 TECH/DATA ROOM 2A 122 AND 2A 121 LADDER RACK LAYOUT
 SCALE 1/4"=1'-0"

NOTES:
 1. CONTRACTOR SHALL MOUNT LADDER RACK AT 10'-0" A.F.F.
 2. REFER TO 7/TN300 FOR CABLE RUNWAY RADIUS DROP. PROVIDE CABLE RUNWAY RADIUS DROP FOR EACH RACK.

KEYNOTES:
 1 CONTRACTOR SHALL PROVIDE FOUR (4) 4" CONDUIT SLEEVES

4 OI + T RACK ELEVATION
 NO SCALE






NOTES:
 1. REFER TO TN400 FOR TECHNOLOGY RISER DIAGRAM.

KEYNOTES:
 1 SPACE FOR OWNER PROVIDED EQUIPMENT

5 FMS RACK ELEVATION
 NO SCALE

NOTES:
 1. REFER TO TN400 FOR TECHNOLOGY RISER DIAGRAM.

KEYNOTES:
 1 SPACE FOR OWNER PROVIDED EQUIPMENT
 2 TERMINATE FUTURE CCTV CAMERAS TO THIS PANEL.

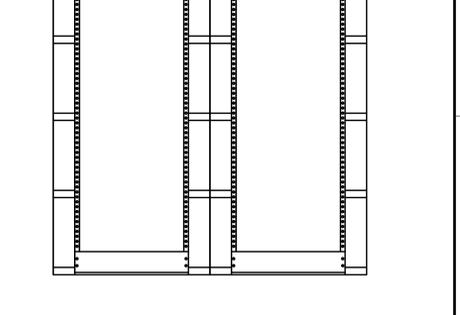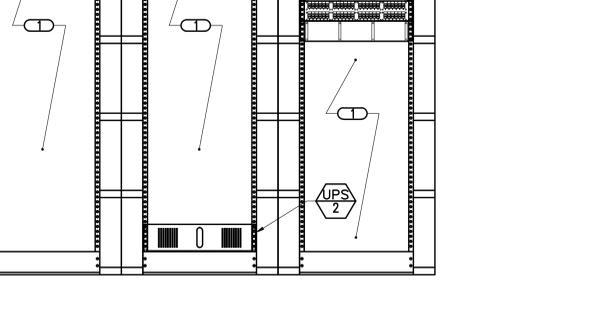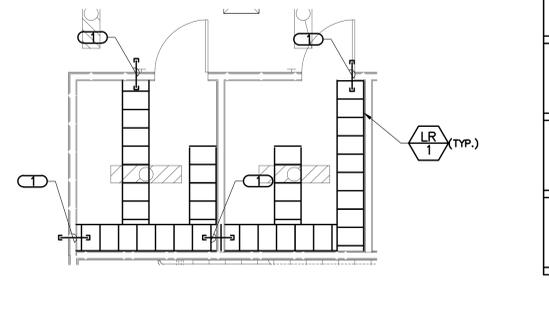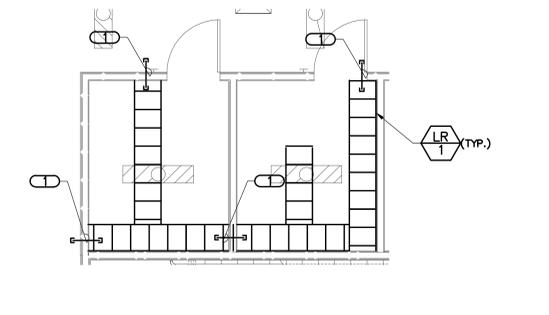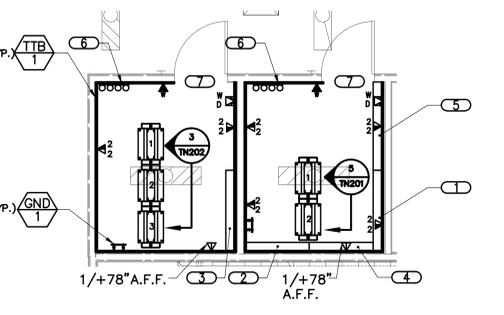

6 TECH/DATA ROOM 3A 122 AND 3A 121 LAYOUT
 SCALE 1/4"=1'-0"

NOTES:
 1. CONTRACTOR SHALL MOUNT GROUND BAR AT 7'-0" A.F.F. REFER TO 3/TN301 FOR GROUND BAR DETAIL.
 2. REFER TO 7/TN202 FOR TECH/DATA ROOM HORIZONTAL CABLE LADDER RACK LAYOUT.
 3. REFER TO 8/TN202 FOR TECH/DATA ROOM BACK BONE CABLE LADDER RACK LAYOUT.

KEYNOTES:
 1 SPACE FOR FIRE ALARM EQUIPMENT.
 2 SPACE FOR ACCESS CONTROL EQUIPMENT.
 3 VOICE BACKBONE TERMINATIONS.
 4 SPACE FOR CCTV EQUIPMENT.
 5 SPACE FOR PAGING EQUIPMENT.
 6 FOUR (4) 4" CONDUITS TO 2A 121 AND 2A 122.
 7 CONTRACTOR SHALL MOUNT MOTION DETECTOR BELOW LADDER RACK AT 7'-8" A.F.F.

7 TECH/DATA ROOM 3A 122 AND 3A 121 LOWER RACK LAYOUT
 SCALE 1/4"=1'-0"

NOTES:
 1. CONTRACTOR SHALL MOUNT LADDER RACK AT 8'-0" A.F.F.
 2. REFER TO 7/TN300 FOR CABLE RUNWAY RADIUS DROP. PROVIDE CABLE RUNWAY RADIUS DROP FOR EACH RACK.

KEYNOTES:
 1 CONTRACTOR SHALL PROVIDE FOUR (4) 4" CONDUIT SLEEVES

8 TECH/DATA ROOM 3A 122 AND 3A 121 UPPER RACK LAYOUT
 SCALE 1/4"=1'-0"

NOTES:
 1. CONTRACTOR SHALL MOUNT LADDER RACK AT 10'-0" A.F.F.
 2. REFER TO 7/TN300 FOR CABLE RUNWAY RADIUS DROP. PROVIDE CABLE RUNWAY RADIUS DROP FOR EACH RACK.

KEYNOTES:
 1 CONTRACTOR SHALL PROVIDE FOUR (4) 4" CONDUIT SLEEVES

9 OI + T RACK ELEVATION
 NO SCALE


NOTES:
 1. REFER TO 1/TN400 FOR TECHNOLOGY RISER DIAGRAM.

KEYNOTES:
 1 SPACE FOR OWNER PROVIDED EQUIPMENT

10 FMS RACK ELEVATION
 NO SCALE

NOTES:
 1. REFER TO 1/TN400 FOR TECHNOLOGY RISER DIAGRAM.

KEYNOTES:
 1 SPACE FOR OWNER PROVIDED EQUIPMENT
 2 TERMINATE FUTURE CCTV CAMERAS TO THIS PANEL.



FULLY SPRINKLERED

<p>CONSULTANTS:</p> <p>STRUCTURAL ENGINEER: KPFF CONSULTING ENGINEERS 1630 DES PERES ROAD, SUITE 100 ST. LOUIS, MO 63131 PHONE: (314) 635-0524</p> <p>MECHANICAL/ELECTRICAL/PLUMBING: KJWW ENGINEERING CONSULTANTS #15 SUNSHINE DRIVE, SUITE 104 ST. LOUIS, MO 63143 PHONE: (314) 645-1132</p> <p>CODE CONSULTANT/FIRE PROTECTION: CODE CONSULTANTS, INC. 2043 WOODLAND PARKWAY, SUITE 300 ST. LOUIS, MO 63146 PHONE: (314) 991-2633</p> <p>CIVIL ENGINEER: KWAME & ASSOCIATES CONSULTING ENGINEERS, INC. 257 CHESTERFIELD BUSINESS PARKWAY CHESTERFIELD, MO 63005 PHONE: (636) 530-9100</p> <p>AUTOMATIC TRANSPORT: LERCH BATES INC. 8088 S LINCOLN STREET, SUITE 207 LITTLETON, CO 80122 PHONE: (720) 283-6182</p> <p>ESTIMATING: KWAME BUILDING GROUP, INC. 1204 WASHINGTON AVENUE, SUITE 200 ST. LOUIS, MO 63126 PHONE: (314) 962-5344</p> <p>HAZARDOUS MATERIALS: ALTEC ENVIRONMENTAL CONSULTING, LLC P.O. BOX 17867 SHREVEPORT, LA 71138-0867 PHONE: (318) 687-3771</p> <p>IRRIGATION CONSULTANTS: IRM 9502 BANYON TREE ST. LOUIS, MO 63126 PHONE: (318) 843-1481</p>			<p>CERTIFICATE OF AUTHORITY:</p>	<p>ARCHITECT/ENGINEERS:</p> <p>CHRISTNER</p> <p>ARCHITECTS DESIGNERS PLANNERS LANDSCAPE ARCHITECTS</p> <p>168 N. MERAMEC AVENUE ST. LOUIS, MISSOURI 63105 TEL 314 725 2927 FAX 314 725 2928 CHRISTNERINC.COM</p> <p>THE SEAL (S) AND SIGNATURE(S) APPLY ONLY TO THE DOCUMENT TO WHICH THEY ARE AFFIXED, AND WE EXPRESSLY DISCLAIM ANY RESPONSIBILITY FOR ALL OTHER PLANS, SPECIFICATIONS, ESTIMATES, REPORTS, OR OTHER DOCUMENTS OR INSTRUMENTS RELATING TO OR INTENDED TO BE USED FOR ANY PART OF PARTS OF THE PROJECT. © COPYRIGHT 2012 CHRISTNER INC.</p>	<p>Drawing Title ENLARGED FLOOR PLANS - TECHNOLOGY</p> <p>Approved: Project Director </p>	<p>Project Title TENANT BUILDING</p> <p>Location JEFFERSON BARRACKS DIVISION</p> <p>Date 29 OCTOBER 2012</p> <p>Checked DARHAR</p> <p>Drawn KEIEVE</p>	<p>Project Number 657-313D</p> <p>Building Number 56</p> <p>Drawing Number TN202</p> <p>Dwg. 125 of 153</p>	<p>Office of Construction and Facilities Management</p> <p>Department of Veterans Affairs</p>
--	--	--	----------------------------------	--	---	---	--	---