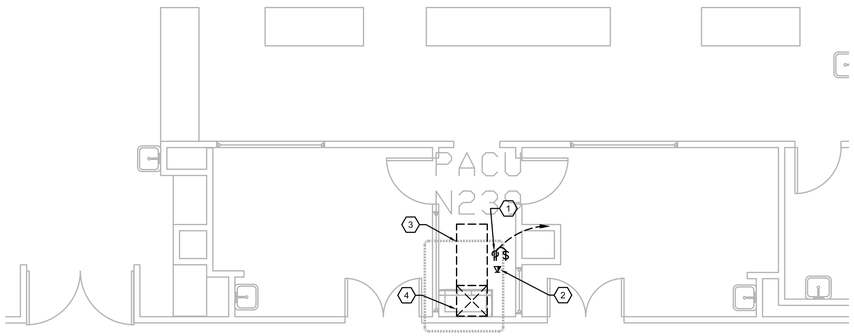

B1 SECOND FLOOR PLAN, BLDG. CC; (PTS #17) PACU N239
SCALE: 1/4" = 1'-0"

NORTH

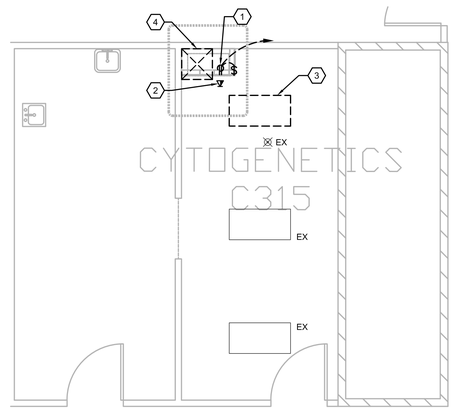

B6 THIRD FLOOR PLAN, BLDG. CC; (PTS #22) CYTOGENETICS C315
SCALE: 1/4" = 1'-0"

NORTH

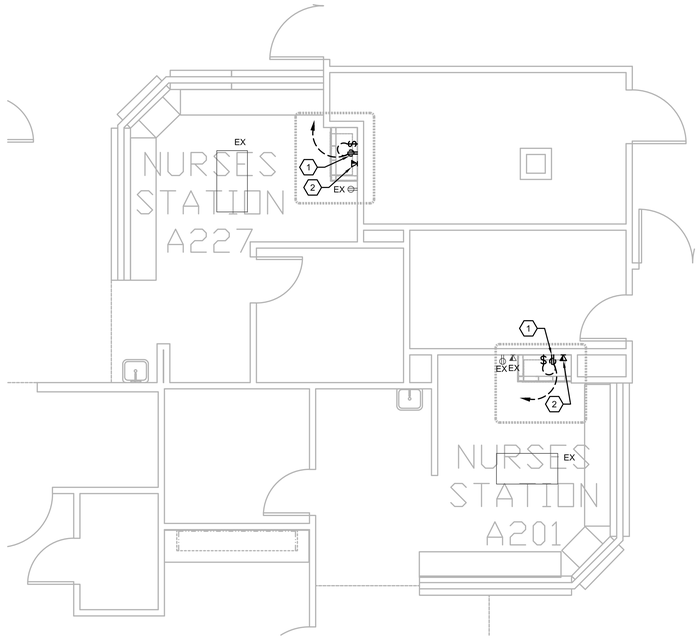

NORTH

D6 SECOND FLOOR PLAN, BLDG. CC; (PTS #36 AND #37) SURGERY INPATIENT UNIT-A201 AND A227
SCALE: 1/4" = 1'-0"

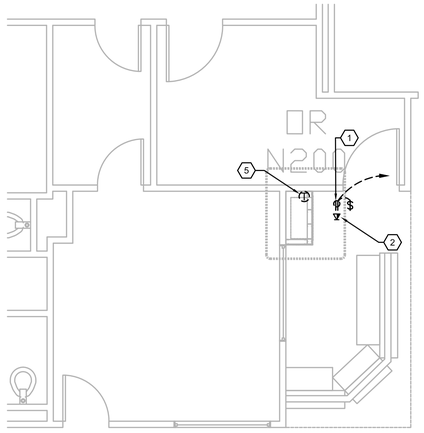

F1 SECOND FLOOR PLAN, BLDG. CC; (PTS #16) O.R. RECEPTION N200
SCALE: 1/4" = 1'-0"

NORTH

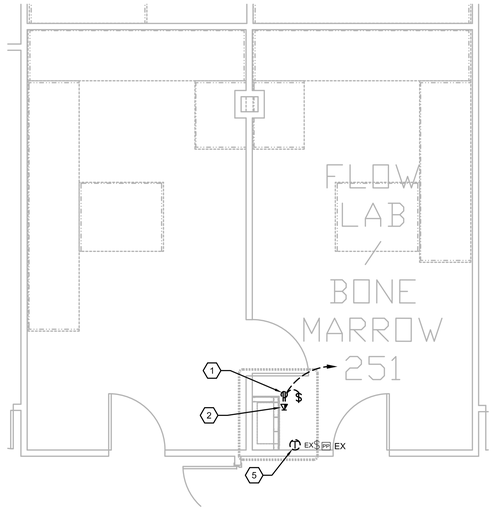

F6 SECOND FLOOR PLAN, BLDG. CC; (PTS #13) FLOW LAB/BONE MARROW LAB 251
SCALE: 1/4" = 1'-0"

NORTH

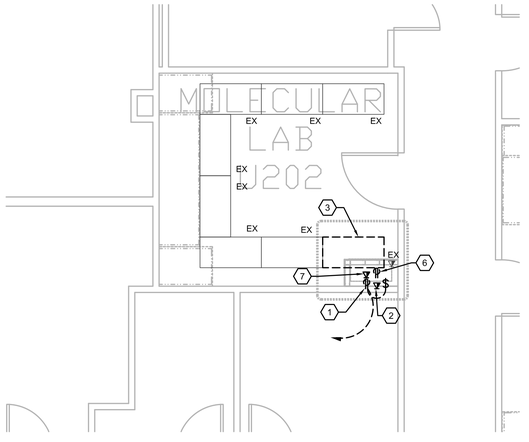

F7 SECOND FLOOR PLAN, BLDG. CC; (PTS #14) MOLECULAR LAB U202
SCALE: 1/4" = 1'-0"

NORTH

GENERAL NOTES:

1. REFER TO MEP000 FOR ADDITIONAL NOTES.
2. THE PNEUMATIC TUBE SYSTEM INFRASTRUCTURE DESIGN HEREIN BASED ON SWISSLOG HEALTHCARE SOLUTIONS EQUIPMENT. THE VA RESERVES THE RIGHT FOR APPROVAL OF ALTERNATE PNEUMATIC TUBE SYSTEMS MANUFACTURER.
3. CONTRACTOR SHALL RE-ROUTE ANY DUCTWORK, MECHANICAL OR PLUMBING PIPING, DAMPERS OR TERMINAL BOXES LOCATED IN THE CEILING PLENUM AS REQUIRED TO ACCOMMODATE NEW PNEUMATIC OR ASSOCIATED EQUIPMENT.
4. REFER E109 THRU E111 FOR PANELBOARD LOCATIONS AND ADDITIONAL INFORMATION.

NOTES BY SYMBOL: "⬡"

1. PROVIDE 120V, 20A, DUPLEX RECEPTACLE WITH TOGGLE SWITCH BEHIND CABINET OF THE PNEUMATIC TUBE SYSTEM STATION.
2. PROVIDE TELEPHONE/DATA OUTLET WITH ETHERNET, CAT5 OUTLET CAPABILITY BEHIND PNEUMATIC TUBE SYSTEM STATION.
3. REMOVE AND RETAIN EXISTING LIGHT FIXTURE, ASSOCIATED BRANCH CIRCUIT TO BE RELOCATED AT 90 ° AS REQUIRED TO ALLOW FOR INSTALLATION OF PNEUMATIC TUBE CABINET. REINSTALL AS CLOSE AS POSSIBLE TO THE ORIGINAL LOCATION.
4. REMOVE AND RETAIN EXISTING HVAC DEVICE, ASSOCIATED DUCTWORK AS REQUIRED TO ALLOW FOR INSTALLATION OF PNEUMATIC TUBE CABINET. REINSTALL AS CLOSE AS POSSIBLE TO THE ORIGINAL LOCATION.
5. REMOVE AND RETAIN EXISTING THERMOSTAT, ASSOCIATED CONTROL WIRING TO ALLOW FOR INSATLLATION OF PNEUMATIC TUBE CABINET. REINSTALL AS CLOSE AS POSSIBLE TO THE ORIGINAL LOCATION.
6. REMOVE AND RETAIN EXISTING RECEPTACLE, OUTLET BOX, ASSOCIATED BRANCH CIRCUIT TO BE RELOCATED WITHIN THE ROOM NEAR EQUIPMENT BEING SERVED. COORDINATE EXACT LOCATION WITH OWNER PRIOR TO ROUGH-IN.
7. REMOVE AND RETAIN EXISTING TELE/DATA OUTLET, OUTLET BOX, ASSOCIATED WIRING TO BE RELOCATED WITHIN THE ROOM NEAR EQUIPMENT BEING SERVED. COORDINATE EXACT LOCATION WITH OWNER PRIOR TO ROUGH-IN.

100% CONSTRUCTION ISSUE

Revisions	Date

Computer Filename:

FRATTO ENGINEERING INC
2201 N Collins, Suite 295
Arlington, Texas 76011-2698
(817) 461-2337 Fax: (817) 461-1025
F-1166
MECHANICAL - ELECTRICAL - PLUMBING
FEI PROJECT # 13069

FEI Project No.: 13069

MPI Architects
Architecture ■ Planning ■ Interior Design
4949 Addison Circle ■ Addison, Texas 75001

MPI Project No.: 8130707

Seal

Seal

STATE OF TEXAS
MARK S. FRATTO
60977
REGISTERED
PROFESSIONAL ENGINEER
04/24/2015

Drawing Title
BUILDING CC
SECOND & THIRD FLOOR PLAN
PTS STATION LOCATIONS - MECHANICAL/ELECTRICAL

Approved: Area Project Manager

Project Title
AUDIE L. MURPHY VA HOSPITAL
PNEUMATIC TUBING SYSTEM

Building Number: CC
Checked: SLT
Drawn: AOP
Location: 7400 Merton Minter San Antonio, TX 78229

Date: 04/24/15
Project No.: 671-13-104
Drawing No.: ME405
Dwg. of

South Texas Veterans Health Care System

STVHCS
San Antonio, Texas

VA FORM 08-6231A, JAN 1990