


1. DEMOLISH (E) BOILER STEAM PRESSURE RELIEF VALVE (TYPICAL 4).
2. DEMOLISH 6" BOILER VENT PIPING AS SHOWN (TYPICAL). PATCH WALL PENETRATIONS. WATER TIGHT.
3. DEMOLISH DEAEATOR STEAM PRESSURE RELIEF VALVE PIPING AS SHOWN. PATCH WALL PENETRATION WATER TIGHT.
4. DEMOLISH (E) DEAEATOR STEAM PRESSURE RELIEF VALVE.
5. REMOVE (E) DEAEATOR STEAM PRESSURE REDUCING STATION.
6. DISCONNECT PIPING. RELOCATE PER NEW WORK PLAN AND SPECIFICATIONS.
7. DEMOLISH (E) 1" DEAEATOR VENT PIPING. PATCH WALL PENETRATION WATER TIGHT.
8. DEMOLISH (E) 6" NON RETURN ANGLE STOP VALVE. (TYPICAL 2)
9. DEMOLISH (E) INLINE BOILER DRAFT INDUCING FAN. REMOVE ELECTRICAL FROM MOTOR BACK TO DISCONNECT. MAKE ELECTRICALLY SAFE FOR MECHANICAL DEMOLITION. SEE ELECTRICAL DRAWINGS.
10. DEMOLISH (E) 24" DOUBLE WALL BOILER FLU BETWEEN BOILERS AND BUILDING 74" STACK
11. DEMOLISH (E) DEAEATOR OVERFLOW FLOAT TRAP AND PIPING AS REQUIRED.

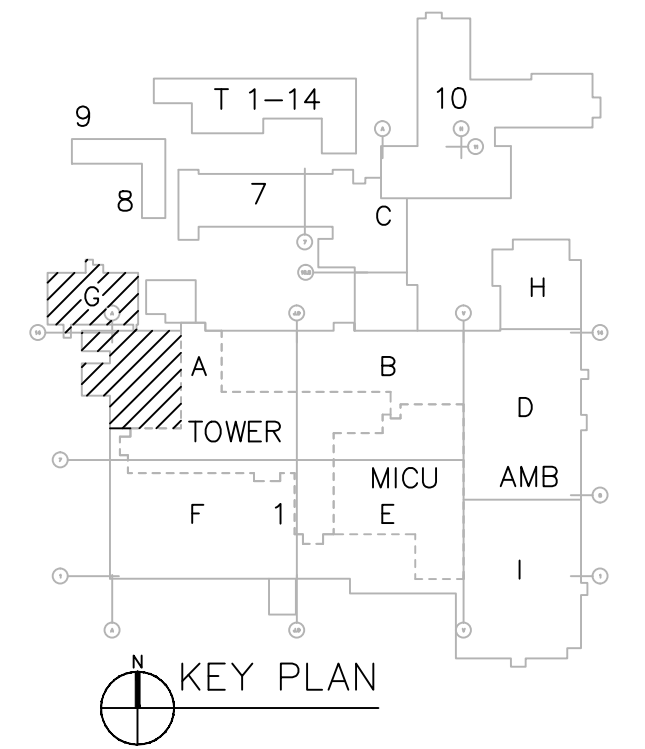

DESIGN DEVELOPMENT - NOT FOR CONSTRUCTION

		CONSULTANTS:		ARCHITECT/ENGINEERS: GLHN ARCHITECTS & ENGINEERS, INC. 2939 E. Broadway Blvd. Tucson, Arizona 85716 PH: 520-881- 4546 FAX: 520-795-1822 glhn.com <small>COPYRIGHT 2010 GLHN ARCHITECTS & ENGINEERS, INC. ALL RIGHTS RESERVED</small>	Drawing Title BASE BID: LEVEL 2 AREA G ENLARGED MECH DEMOLITION PLAN	Project Title MIAMI UTILITY PLANT CORRECTIONS	Project Number 0555.118	Office of Construction and Facilities Management
					Building Number G/A			
					Location MIAMI UTILITY PLANT		Drawing Number	
					Date 06-05-11	Checked H-WJ	Drawn WMK	MD421 Dwg. -- of --
					Approved Project Director			
Revisions	Date							