


GENERAL ELECTRICAL SHEET NOTES:

1. NEW WORK BY OTHERS AND/OR EXISTING TO REMAIN (LIGHT SOLID LINE)
EXISTING TO BE REMOVED BY THIS CONTRACTOR (DARK SHORT DASHED LINE)
UNDERGROUND TO REMAIN (LIGHT LONG DASHED)
2. ABBREVIATION KEY:
E.C. ELECTRICAL CONTRACTOR
T.C. TELECOMMUNICATIONS CONTRACTOR
M.C. MECHANICAL CONTRACTOR
G.C. GENERAL CONTRACTOR
AFF. ABOVE FINISHED FLOOR
C. CONDUIT
TYP. TYPICAL
+F' MOUNTING HEIGHT FROM FINISHED FLOOR TO CENTERLINE
3. OE EXISTING OVERHEAD ELECTRICAL LINES TO REMAIN
OE EXISTING OVERHEAD ELECTRICAL LINES TO BE REMOVED
5. M METER HOUSING AND SOCKET
6. J JUNCTION BOX
7. HH-1 HAND HOLE
8. THE LOCATION AND EXTENT OF UNDERGROUND UTILITIES, IF SHOWN, ARE BASED UPON EXISTING DRAWINGS PROVIDED BY OTHERS AND BY ABOVE GROUND EVIDENCE. THERE IS NO GUARANTEE AS TO THE ACCURACY OR THE COMPLETENESS OF THIS INFORMATION. SIZE AND LOCATION OF ITEMS SHALL BE CONSIDERED APPROXIMATE. ADDITIONAL UNDERGROUND UTILITIES MAY BE PRESENT. VERIFICATION OF THE EXISTENCE AND LOCATION OF ALL UTILITIES SHOULD BE OBTAINED FROM THE UTILITY OWNERS PRIOR TO ANY PLANNING OR DESIGN.

- ### GENERAL SHEET NOTES
1. UTILITY COMPANY: PACIFIC POWER AND LIGHTING (P.P.L.)
 2. UTILITY COMPANY CONTACT:
RICK WHEELER
541-858-3204
RICK.WHEELER@PACIFICORP.COM
 3. NO EXISTING GRAVE SITES SHALL BE DISTURBED DURING CONSTRUCTION. REFER TO CIVIL DRAWINGS FOR ADDITIONAL GRAVEYARD SITE LOCATIONS.
 4. GENERAL CONTRACTOR (G.C.) SHALL COORDINATE SITE WORK AND UTILITY WORK WITH CONSTRUCTION PHASING AND RESTORE LANDSCAPE AS NEEDED. REFER TO X-SERIES DRAWINGS FOR PHASING INFORMATION. REFER TO B-SERIES FOR LANDSCAPE AND ADDITIONAL SITE/CIVIL DRAWINGS.

- ### KEYNOTES
1. EXISTING PANEL "PNL-1 & PNL-2" CHARACTERISTICS: PANELS TO BE REMOVED
JUNCTION BOX FOR INCOMING SERVICE LOCATED BELOW PANELBOARDS
SIZE: 12"x12"x8"
PANELBOARD MANUFACTURER: ITE
TYPE: CDP-7 BOLT ON
RATING: 225A/120/240V, 16.3W
MAIN CIRCUIT BREAKER: 200A
TOTAL CIRCUITS: 30
PNL-2 CIRCUITS E.S.: 100A/2P FEED TO MAINTENANCE BUILDING JUNCTION BOX WITH NO. 2 COPPER WIRE.
PNL-2 CIRCUITS E.S.: 100A/2P FEED TO POLE MOUNTED BRANCH PANEL WITH NO. 2 COPPER WIRE.

- ### KEYNOTES (CONTINUE)
2. COMMITTEE SHELTER PANEL CHARACTERISTICS: 16 CIRCUITS, 9 SPACES, 1- 50A/2P, 3- 20A/1P, AND 1- 20A/2P.
 3. THERE ARE TWO(2) CIRCUITS IN THIS PANEL (#13, & #15) THAT CURRENTLY FEED THE FUEL TANKS. THESE CIRCUITS SHALL BE REMOVED AND RE-FED OUT OF THE NEW PANEL "P1" E.C. IS RESPONSIBLE FOR REMOVAL AND RE-CIRCUITING OF CIRCUIT BREAKERS TO REMAIN.

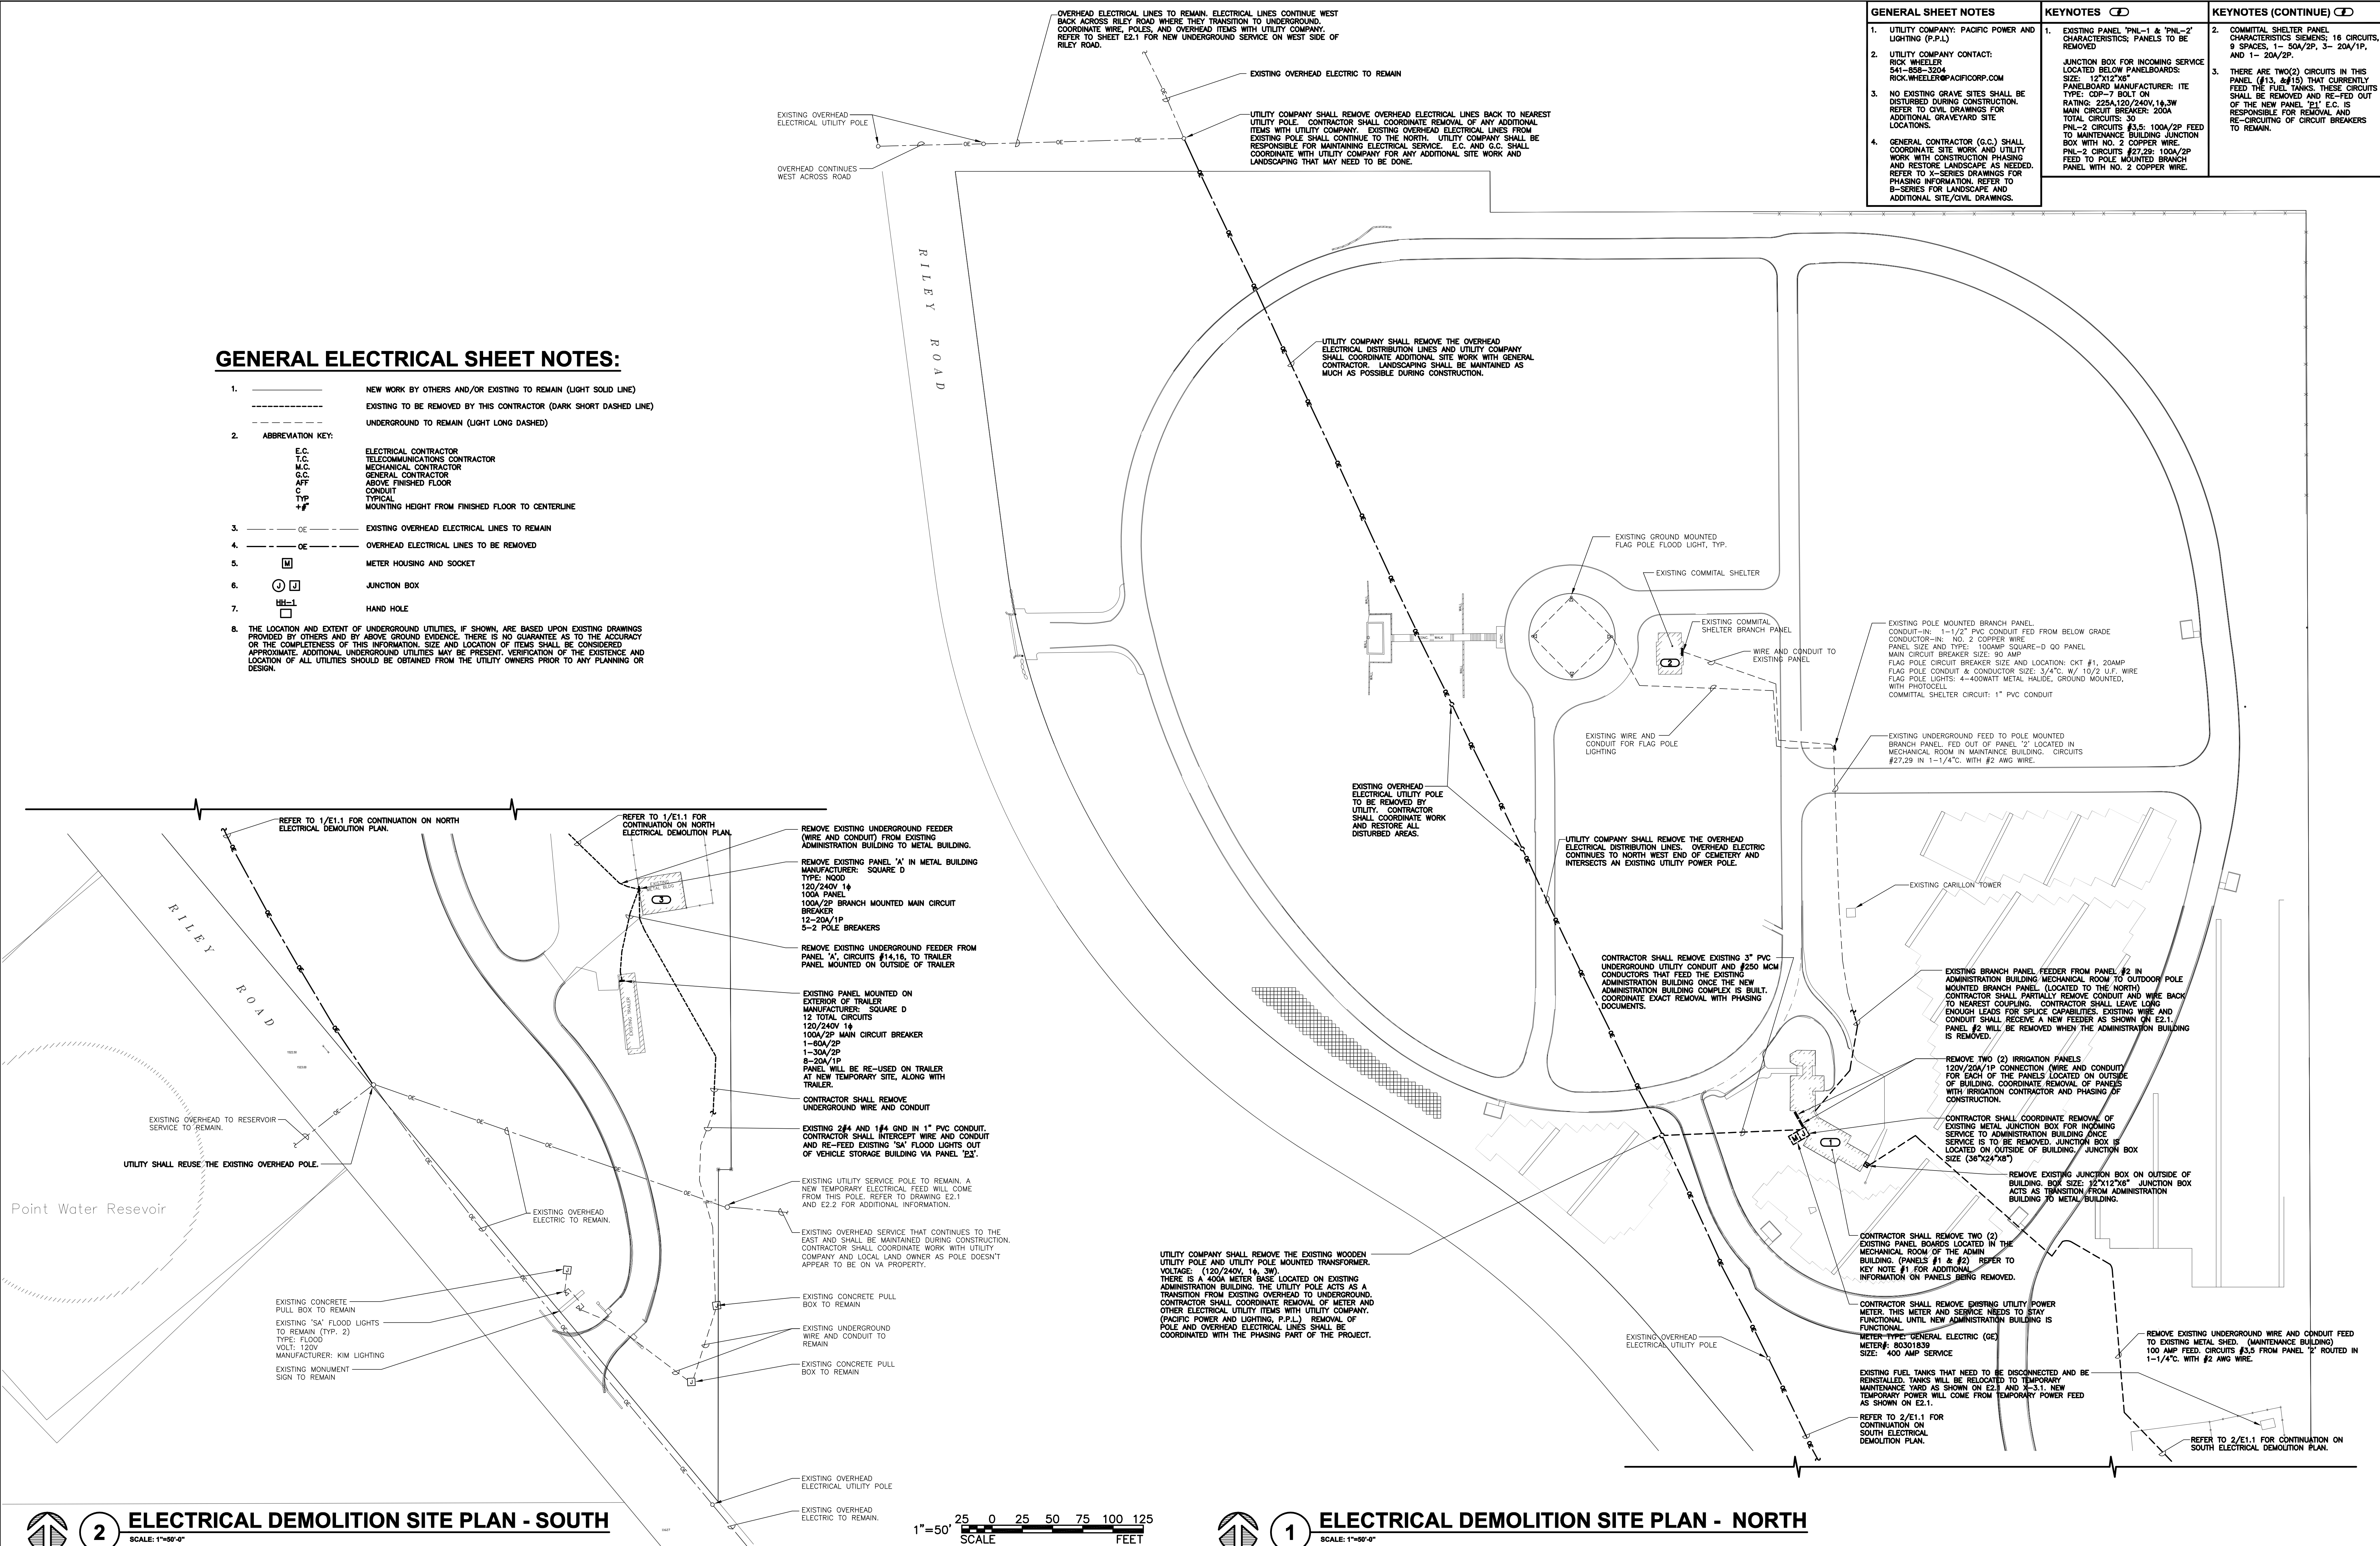

BID DOCUMENTS 7/1/2011

2 ELECTRICAL DEMOLITION SITE PLAN - SOUTH SCALE: 1"=50'-0"		1 ELECTRICAL DEMOLITION SITE PLAN - NORTH SCALE: 1"=50'-0"	
Anderson Engineering of Minnesota, LLC 13605 1st AVENUE NORTH, SUITE 100, PLYMOUTH, MN 55441 TEL (763) 412-4000 FAX (763) 412-4090 www.ae-mn.com		NATIONAL CEMETERY ADMINISTRATION 2763 RILEY ROAD EAGLE POINT, OR 97524	
ENGINEERING CONSULTANTS 623 26TH AVENUE ROCK ISLAND, IL 61201 309.786.0673 FAX: 309.786.5967 www.kjww.com KJWW Project # 10.0356.00 STRUCTURAL: MECHANICAL: ELECTRICAL: TECHNOLOGY: MEDICAL EQUIPMENT SOLUTIONS		I hereby certify that this Plan, Specification, or Report was prepared by me, or under my direct supervision and that I am a duly licensed Professional Engineer under the laws of the State of Oregon. Signature: Lee D. VanOndorp Name: Lee D. VanOndorp Discipline: Electrical Oregon Registration No. 78702PE Expiration date: 06.30.12 Date Issued: **/**/11	
Revisions		Date	