


INFORMATION OUTLET SCHEDULE								
CONFIGURATION	FACEPLATE FEATURES						SCHEDULE NOTES	JACK LEGEND
	FACEPLATE POSITION 1	FACEPLATE POSITION 2	FACEPLATE POSITION 3	FACEPLATE POSITION 4	FACEPLATE POSITION 5	FACEPLATE POSITION 6		
1 2 W W	4	VOICE	DATA	DATA	BLANK			
1 AV	1	VOICE					1.	
	2	DATA	BL					
	2	VGA						

**GENERAL NOTES:**

1. PROVIDE REMOVABLE BLANK INSERT FOR UNUSED PORTS.
2. REFER TO SPECIFICATIONS FOR LABELING REQUIREMENTS.
3. REFER TO FLOOR PLANS FOR DEVICE QUANTITIES AND LOCATION.
4. JACKS SHALL BE CONFIGURED PER ANSI/TIA/EIA T568B REQUIREMENTS.
5. REFER TO 1/E-1001-7.2 FOR FIBER AND COPPER RISER DIAGRAM.

**SCHEDULE NOTES:**

1. PROVIDE STAINLESS STEEL FACEPLATE WITH MATING LUGS FOR WALL HUNG PHONE.

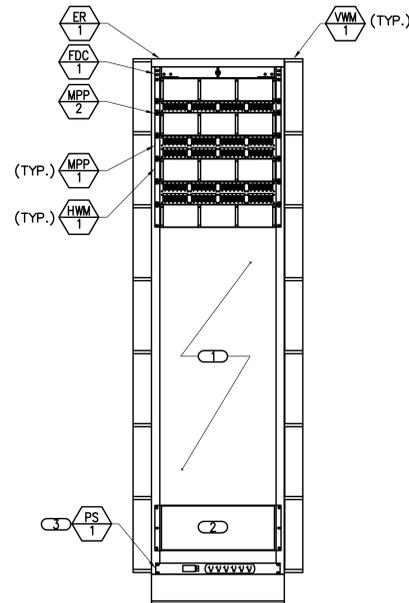

**ADMINISTRATION BUILDING MAIN TELECOMMUNICATIONS ROOM EQUIPMENT RACK**

1


NO SCALE

**NOTES:**

1. COORDINATE MOUNTING LOCATIONS WITH OWNER.

**KEYNOTES:**

- 1. SPACE FOR OWNER SUPPLIED EQUIPMENT (HUBS, SWITCHES, PATCH PANELS, ETC.)
- 2. OWNER COMPUTER FOR DIGITAL SIGNAGE MONITOR LOCATED IN LOBBY.
- 3. INSTALL POWER STRIP SO OUTLETS FACE TOWARDS REAR OF RACK.

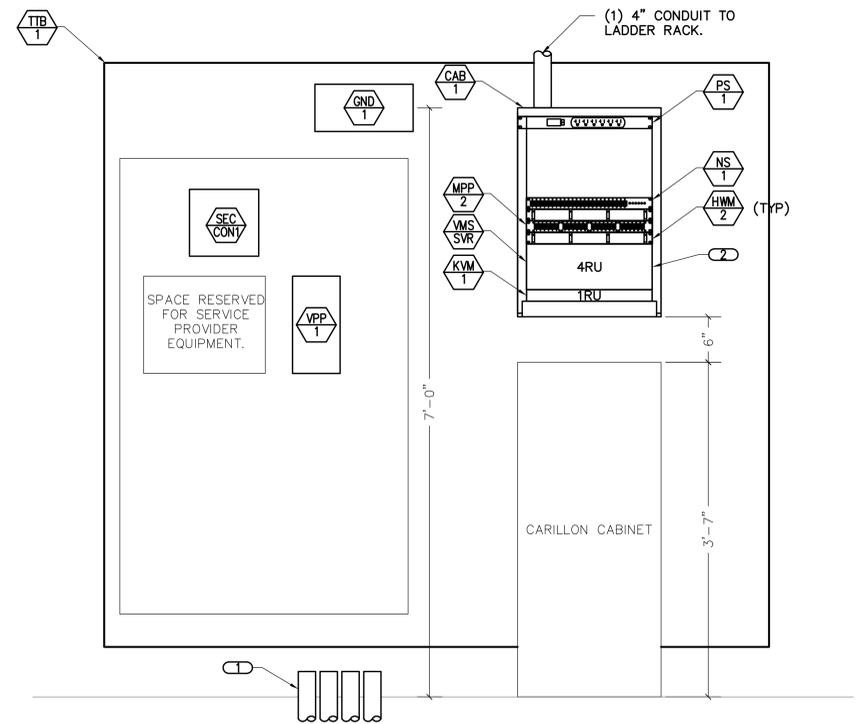


**ADMINISTRATION BUILDING MAIN TELECOMMUNICATIONS WALL ELEVATION**

2

NO SCALE

**KEYNOTES:**

1. REFER TO 1/E-3.1 FOR CONTINUATION AND ADDITIONAL INFORMATION.
2. REFER TO CCTV RISER ON 7/E-1001-7.2 FOR ADDITIONAL INFORMATION.

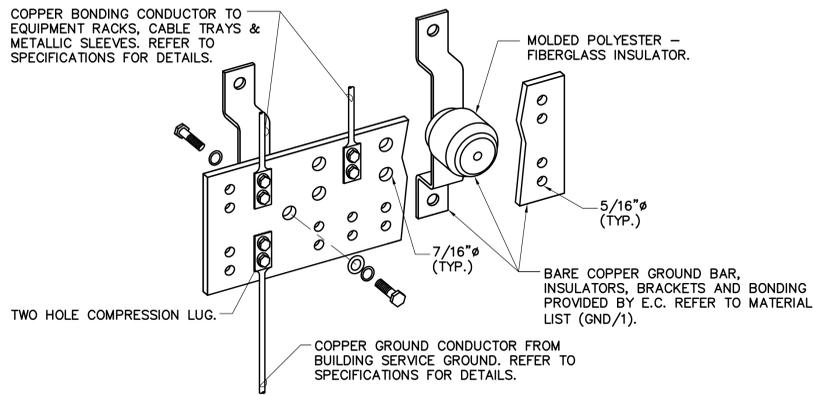


**3 GROUND BAR DETAIL**

NO SCALE

**NOTES:**

1. REFER TO MATERIAL LIST (GND/1) FOR WIDTH REQUIREMENTS.
2. REFER TO 3/E-1001-7.2 FOR ROOM GROUNDING DETAIL.

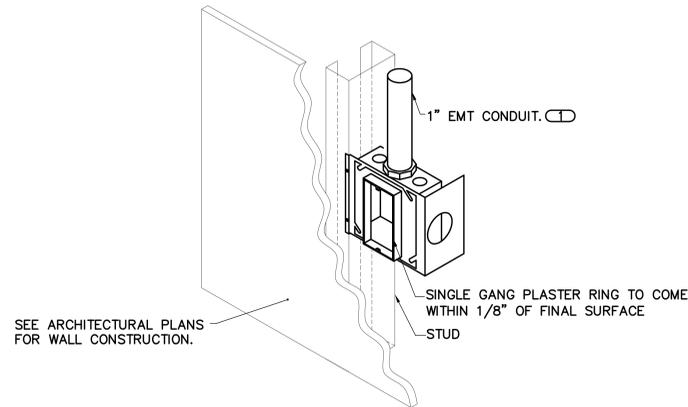


**4 TECHNOLOGY ROUGH-IN MOUNTING DETAIL**

NO SCALE

**KEYNOTES:**

- 1. ROUTE CONDUIT TO ABOVE ACCESSIBLE CEILING UNLESS OTHERWISE NOTED. REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION.

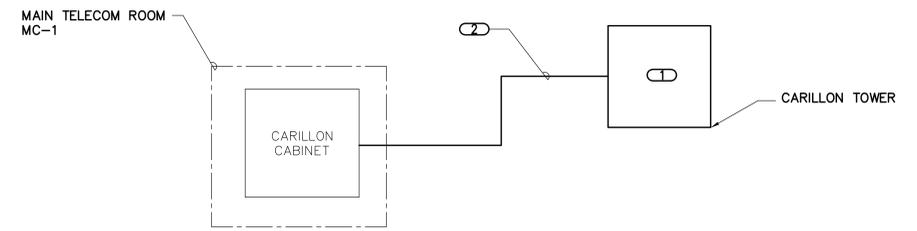

**5 CARILLON CABINET RISER DIAGRAM**

NO SCALE

**NOTES:**

1. REFER TO ELECTRICAL SITE PLAN ON E-2.0 FOR COMPLETE ROUTING INFORMATION.
2. CONTRACTOR SHALL NOTIFY OWNER NEW CABLE WALL BE INSTALLED AND AUDIO SYSTEM SHALL BE OUT OF SERVICE. PRIOR TO CABLE INSTALLATION. A PLAN SHALL BE SUBMITTED BY CONTRACTOR TO SHOW DURATION OF DOWN TIME AND NOTIFICATION OF WHO TO CALL IF THEIR IS AN ISSUE WITH INSTALLATION. THE PLAN SHALL BE REVIEWED AND APPROVED BY OWNER PRIOR TO INSTALLATION.

**KEYNOTES:**

- 1. CONTRACTOR SHALL SPLICE CONDUIT CONNECTION AT CARILLON TOWER. REFER TO E-2.0 FOR ADDITIONAL INFORMATION.
- 2. CONTRACTOR PROVIDED AND INSTALLED 2-PAIR 14 AWG SHIELDED CABLE.

**BID DOCUMENTS 7/1/2011**

Revisions	Date

**KJW ENGINEERING CONSULTANTS**  
 Experience you can build on.<sup>™</sup>  
 623 26TH AVENUE  
 ROCK ISLAND, IL 61201  
 309.786.0673 FAX: 309.786.5967  
 www.kjw.com  
 KJW Project # 10.0356.00  
**STRUCTURAL | MECHANICAL | ELECTRICAL |**  
**TECHNOLOGY | MEDICAL EQUIPMENT SOLUTIONS**

I hereby certify that this Plan, Specification, or Report was prepared by me, or under my direct supervision and that I am a duly licensed Professional Engineer under the laws of the State of Oregon.  
 Signature: \_\_\_\_\_  
 Name: **Lee D. VanOpporp**  
 Discipline: **Electrical**  
 Oregon Registration No. **78702PE** Expiration date: **06.30.12**  
 Date Issued: \*\*, \*\*, \*\*

**Anderson Engineering of Minnesota, LLC**  
 13605 1st AVENUE NORTH, SUITE 100, PLYMOUTH, MN 55441  
 TEL (763) 412-4000 FAX (763) 412-4090  
 www.ae-mn.com

**NATIONAL CEMETERY ADMINISTRATION**

Drawing Title <b>TECHNOLOGY RISERS AND DETAILS</b>	Project Title REPLACE ADMINISTRATION AND MAINTENANCE BUILDING AND SITE IMPROVEMENTS	Date 7-1-2011
Approved: Director, Office of Construction Management	Building Number <b>1001</b>	Checked <b>PETMOG</b>
Approved: Director, Project Management Service	Location EAGLE POINT NATIONAL CEMETERY 2763 RILEY ROAD EAGLE POINT, OR 97524	Drawn <b>JAYSTI</b>
		Project No. 906CM3009
		DRAWING NO. <b>E-1001-7.3</b>
		Dep. 99 OF 181