KEYNOTES

1. LOCATE SMOKE DETECTOR WITHIN 5' OF THE TOP OF FIRE ALARM CONTROL PANEL (FACP-3003).
2. MOUNT SMOKE DETECTOR TO BOTTOM OF TRUSSES.

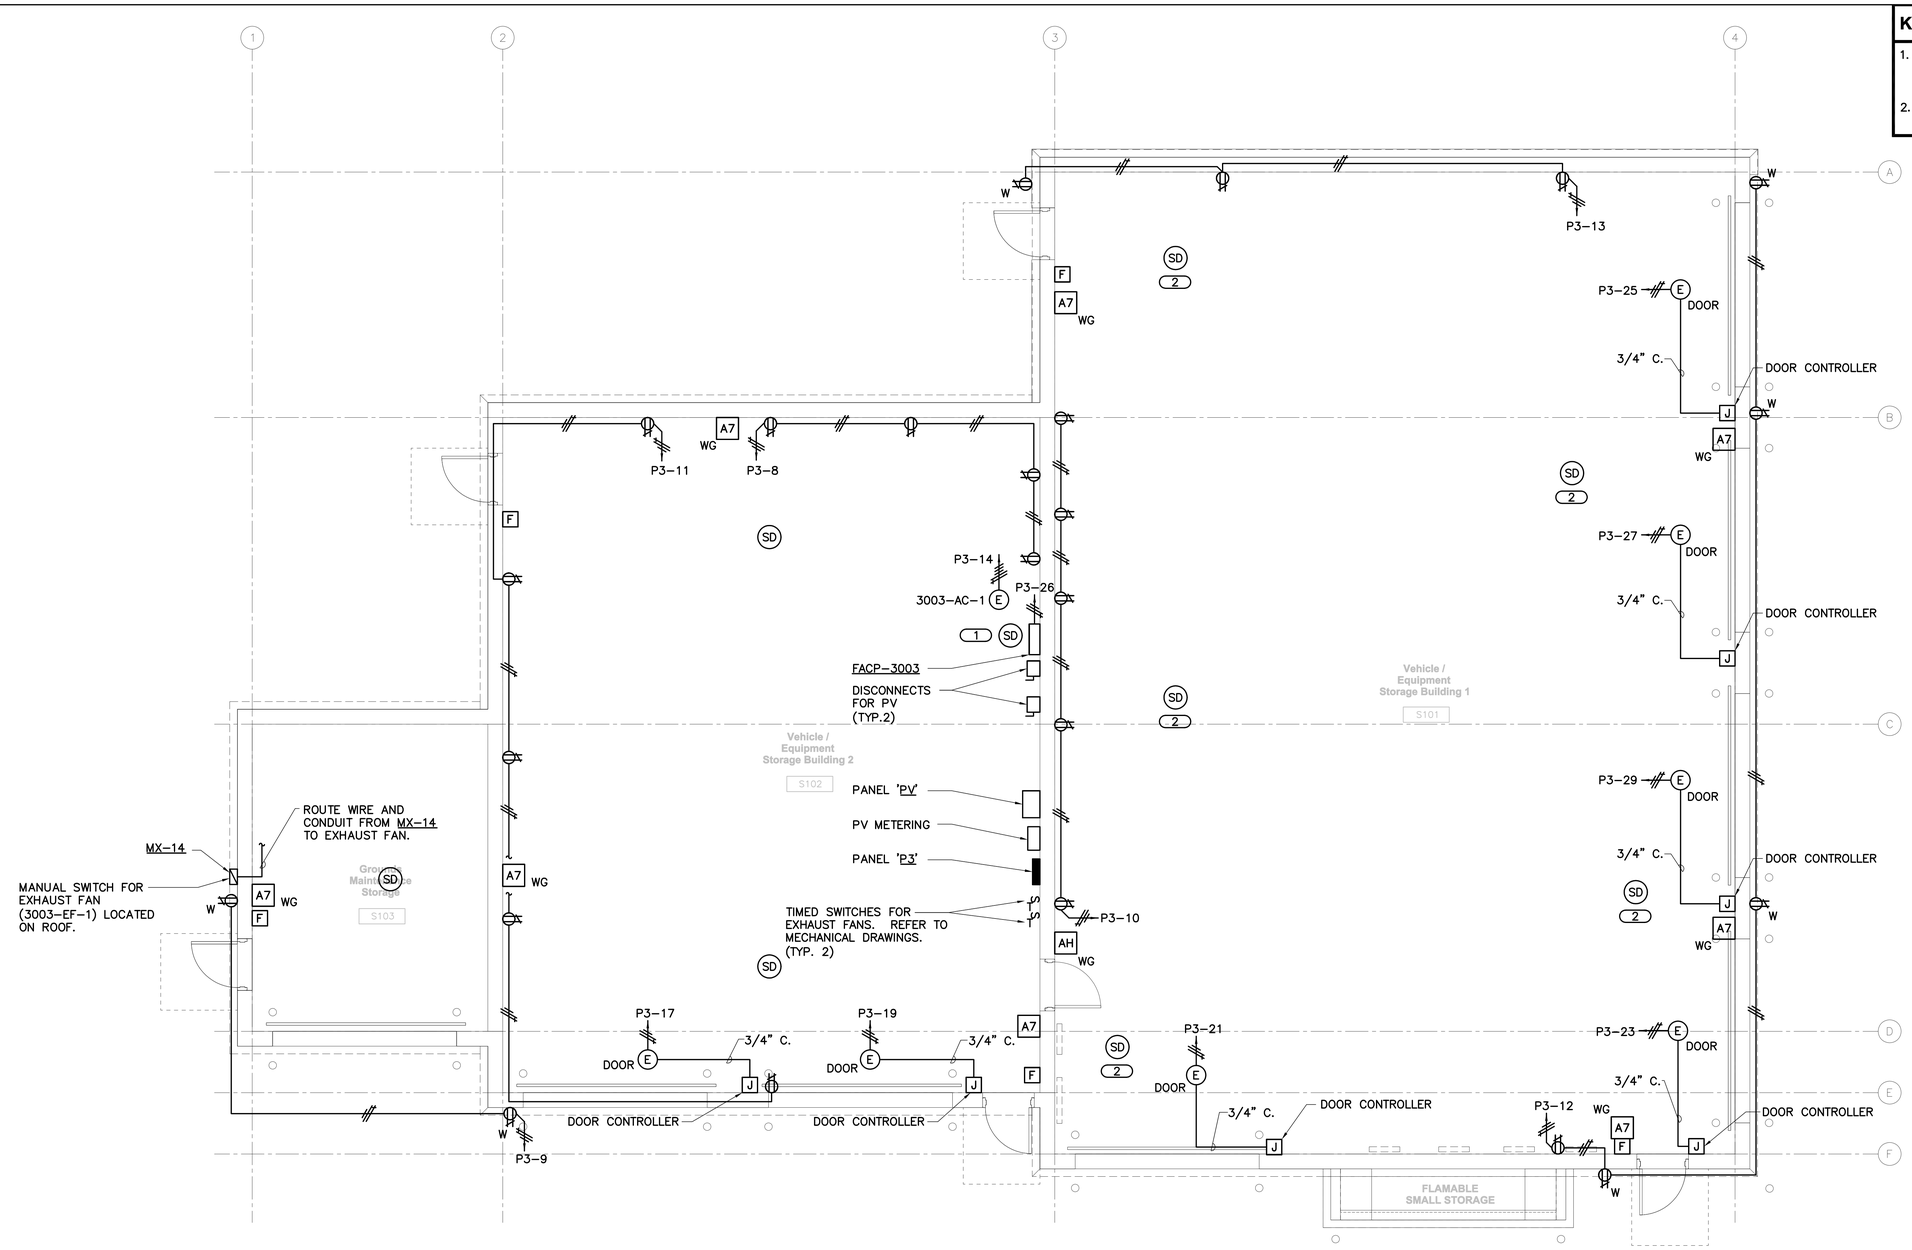

1 VEHICLE STORAGE BLDG. FLOOR PLAN - POWER AND SYSTEMS
SCALE: 1/4"=1'-0"

1/4"=1' 2 0 2 4 6 8 10 SCALE FEET

BID DOCUMENTS 7/1/2011

Revisions	Date

KJWW ENGINEERING CONSULTANTS
Experience you can build on.™
623 26TH AVENUE
ROCK ISLAND, IL 61201
309.788.0673 FAX: 309.786.5967
www.kjww.com
KJWW Project # 10.0356.00
STRUCTURAL : MECHANICAL : ELECTRICAL : TECHNOLOGY : MEDICAL EQUIPMENT SOLUTIONS

I hearby certify that this Plan, Specification, or Report was prepared by me, or under my direct supervision and that I am a duly licensed Professional Engineer under the laws of the State of Oregon.

Signature:
Name: Lee D. VanOpdorp
Discipline: Electrical
Oregon Registration No. 78702PE Expiration date: 06.30.12
Date Issued: **.**.**

Anderson Engineering of Minnesota, LLC
13605 1st AVENUE NORTH, SUITE 100, PLYMOUTH, MN 55441
TEL (763) 412-4000 FAX (763) 412-4090
www.ae-mn.com

NATIONAL CEMETERY ADMINISTRATION

Drawing Title: VEHICLE STORAGE BLDG. FLOOR PLAN - POWER	Project Title: REPLACE ADMINISTRATION AND MAINTENANCE BUILDING AND SITE IMPROVEMENTS		Date: 7-1-2011
Approved: Director, Office of Construction Management	Building Number: 3003	Checked: JOHMcG	Drawn: BRAWIT
Approved: Director, Project Management Service	Location: EAGLE POINT NATIONAL CEMETERY, 2763 RILEY ROAD, EAGLE POINT, OR 97524		Project No. 906CM3009
			DRAWING NO. E-3003-3.1
			Dwg. 172 OF 181