

1. PROVIDE REMOVABLE BLANK INSERT FOR UNUSED PORTS.
2. REFER TO SPECIFICATIONS FOR LABELING REQUIREMENTS.
3. REFER TO FLOOR PLANS FOR DEVICE QUANTITIES AND LOCATION.
4. JACKS SHALL BE CONFIGURED PER ANSI/TIA/EIA T568B REQUIREMENTS.
5. REFER TO 1/E-3003-7.2 FOR COPPER RISER DIAGRAM.


1. PROVIDE STAINLESS STEEL FACEPLATE WITH MATING LUGS FOR WALL HUNG PHONE.



KEY NOTES:

① REFER TO 1/E-3.1 FOR CONTINUATION AND ADDITIONAL INFORMATION.

② INSTALL POWER STRIP SO OUTLETS FACE TOWARDS REAR OF RACK.

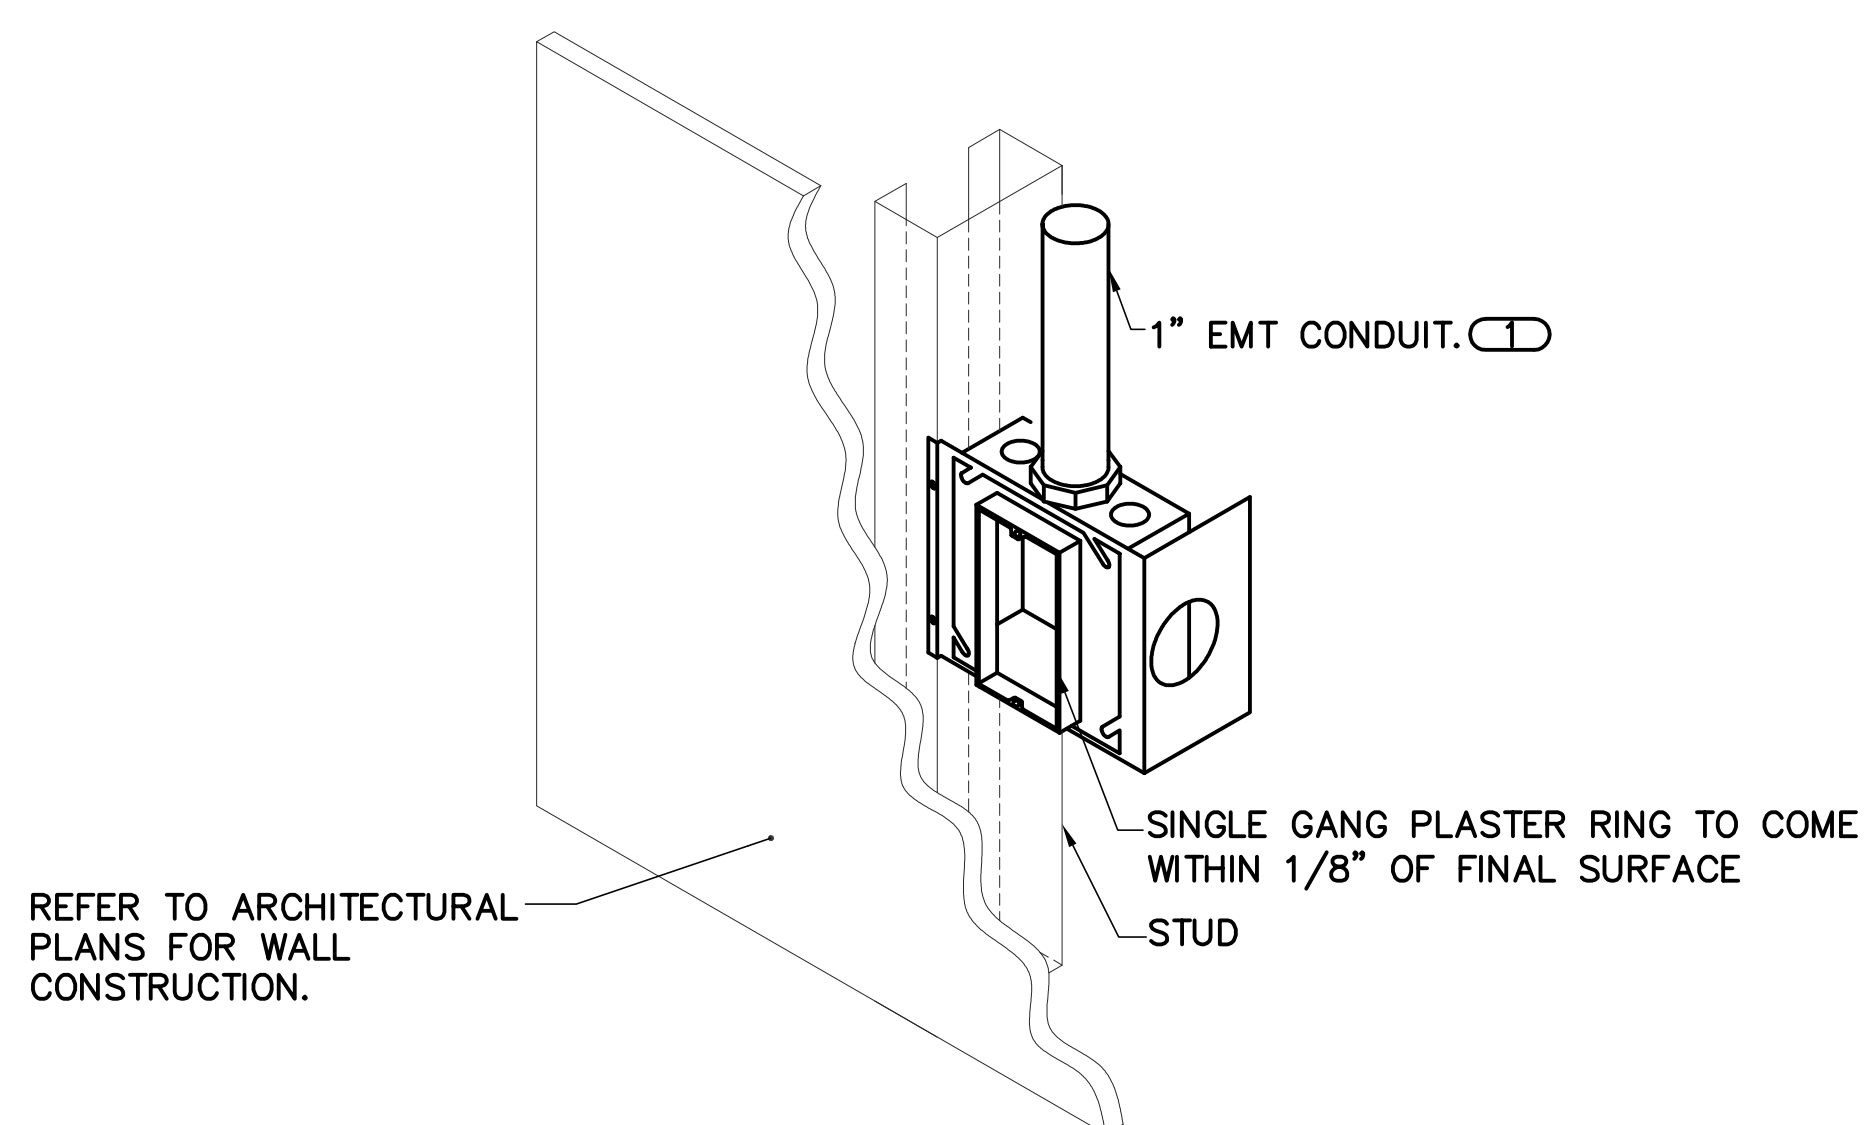

NOTES:

1. REFER TO MATERIAL LIST (GND/1) FOR WIDTH REQUIREMENTS.
2. REFER TO 3/E-3003-7.2 FOR ROOM GROUNDING DETAIL.

KEY NOTES:

① ROUTE CONDUIT TO NEAREST TELECOMMUNICATIONS ROOM. REFER TO SPECIFICATIONS FOR ADDITION INFORMATION.

[illegible]