


GENERAL NOTES:

1. REFER TO MEP000 FOR ADDITIONAL NOTES.
2. THE PNEUMATIC TUBE SYSTEM INFRASTRUCTURE DESIGN HEREIN BASED ON SWISSLOG HEALTHCARE SOLUTIONS EQUIPMENT. THE VA RESERVES THE RIGHT FOR APPROVAL OF ALTERNATE PNEUMATIC TUBE SYSTEMS MANUFACTURER.
3. CONTRACTOR SHALL RE-ROUTE ANY DUCTWORK, MECHANICAL OR PLUMBING PIPING, DAMPERS OR TERMINAL BOXES LOCATED IN THE CEILING PLENUM AS REQUIRED TO ACCOMMODATE NEW PNEUMATIC OR ASSOCIATED EQUIPMENT.



F1 SIXTH FLOOR PLAN, BLDG. CC
SCALE: 1" = 10'-0"

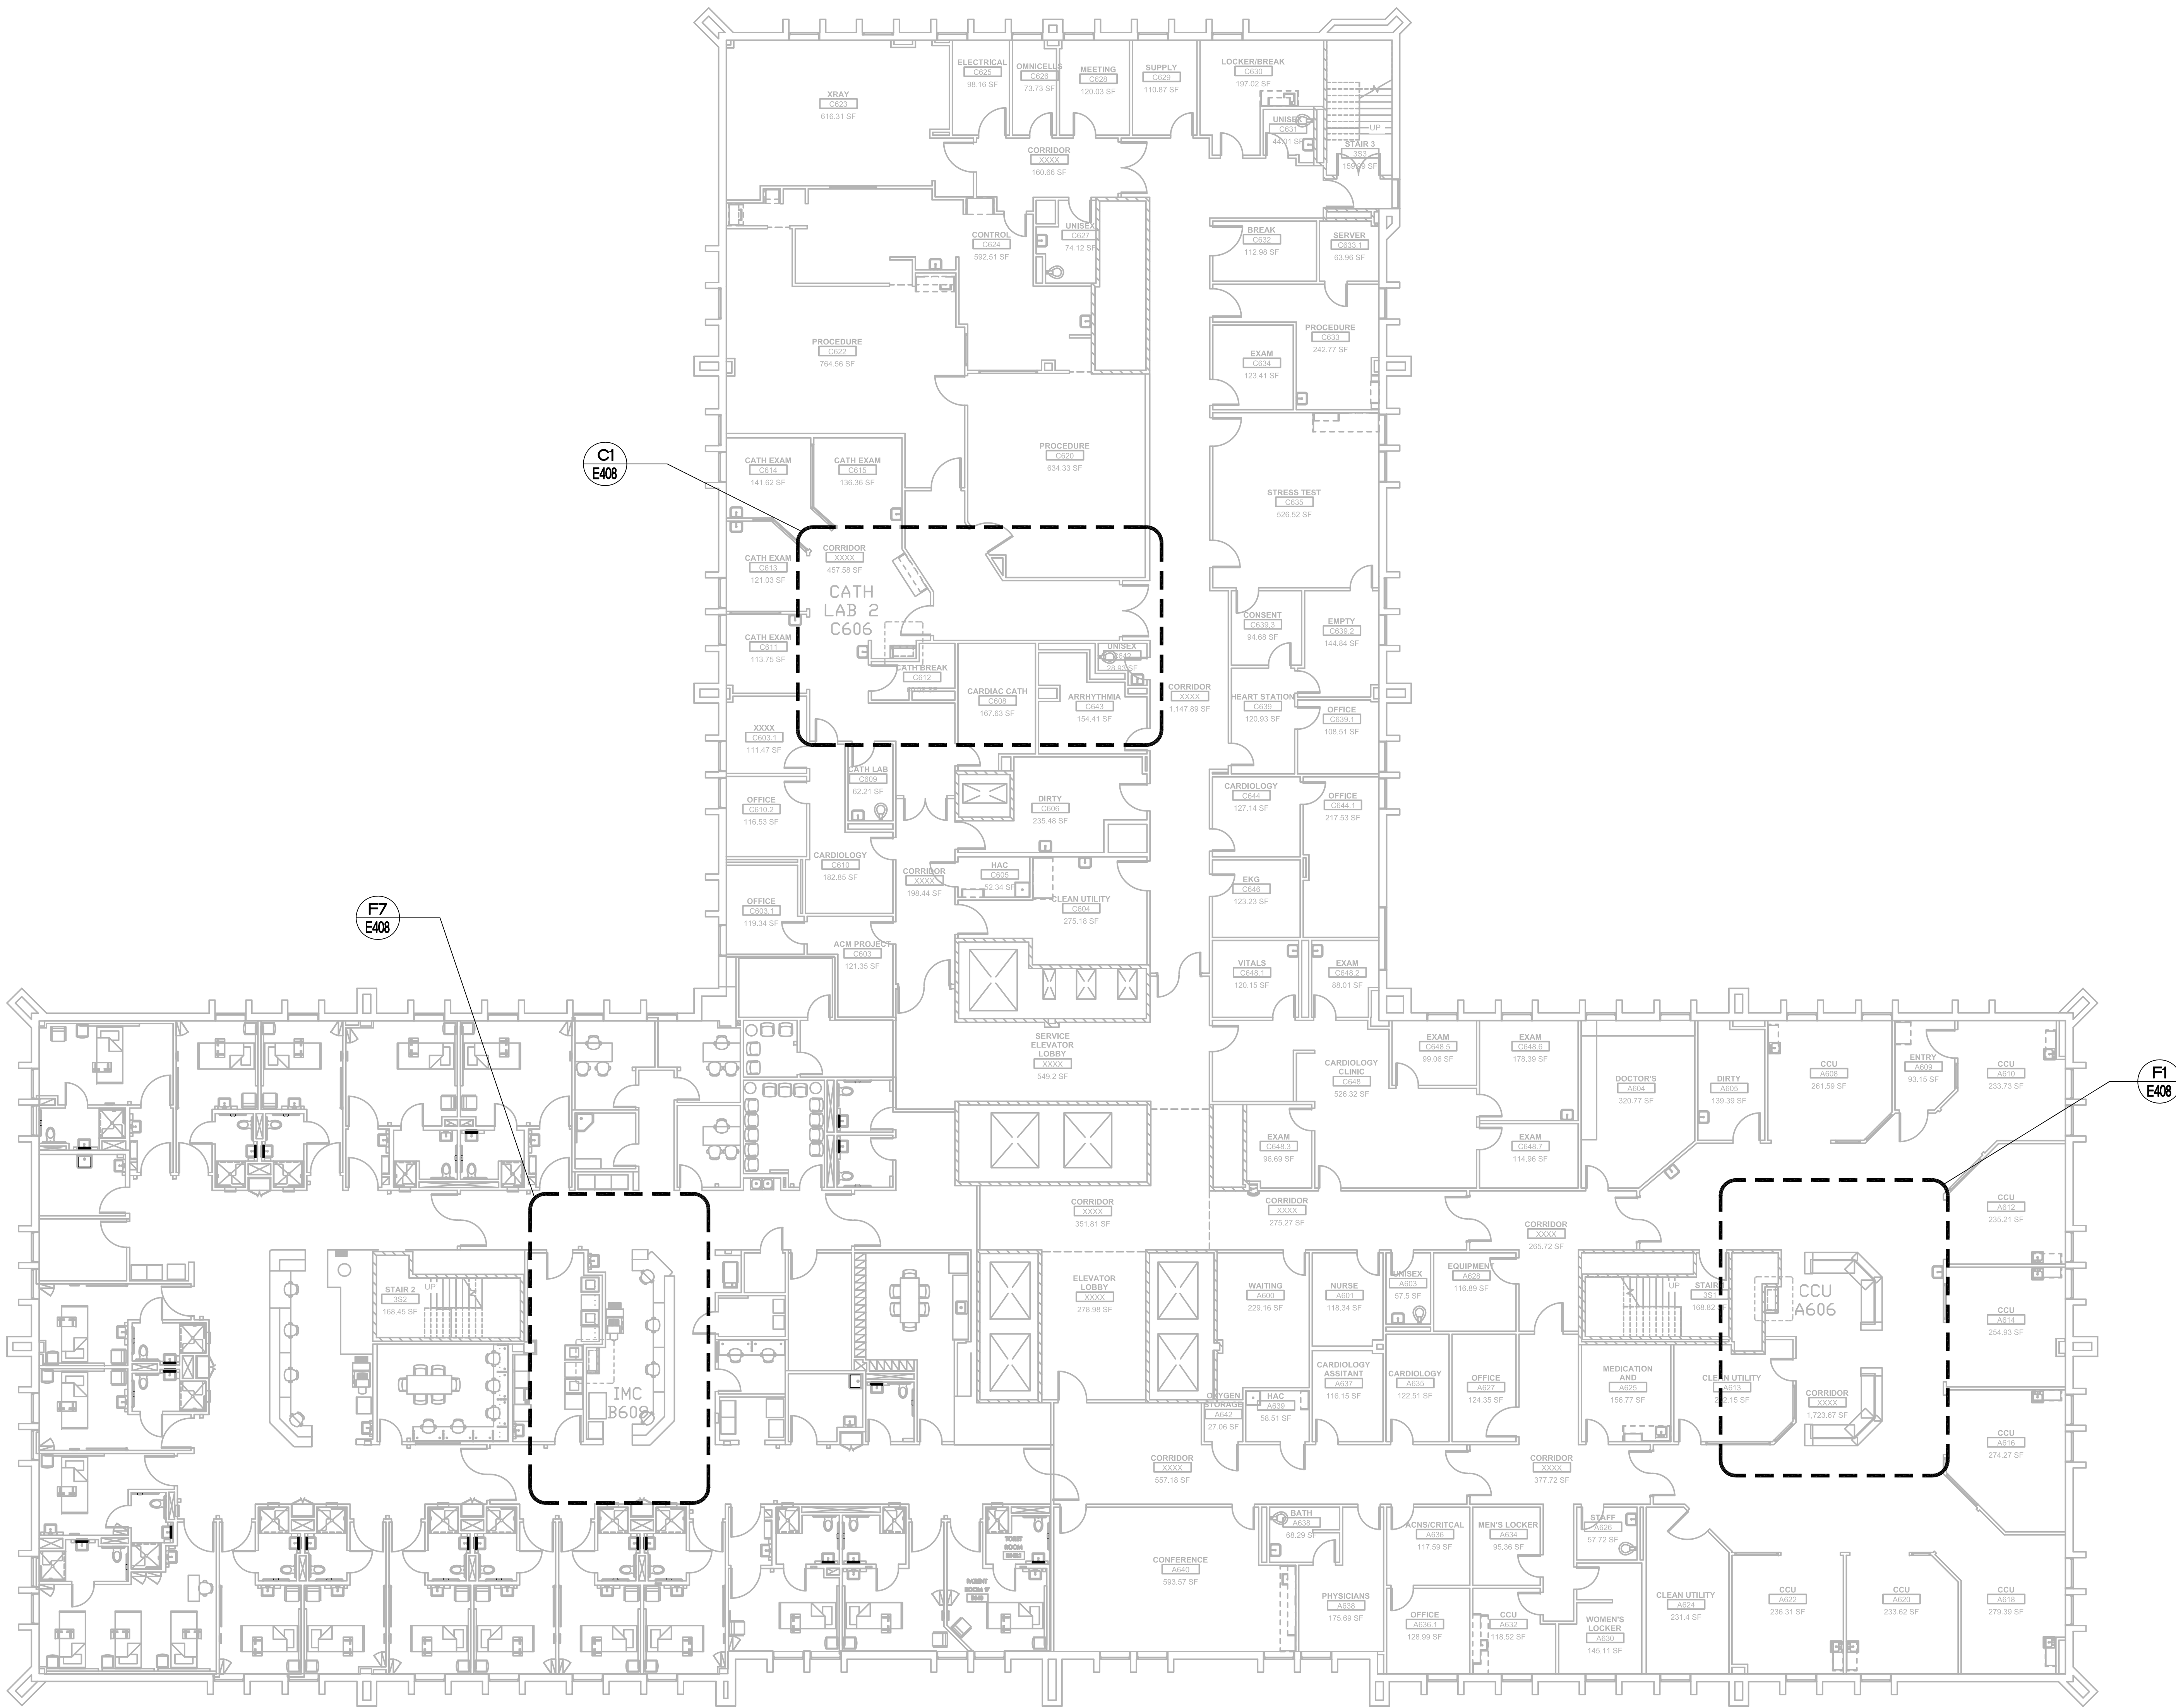

SIXTH FLOOR

Revisions	Date

FEI ENGINEERING INC.

2201 N. Collins, Suite 250
Arlington, Texas 76011-2609
(817) 461-0337 Fax: (817) 461-0325
E: info@fei-engineering.com
MECHANICAL/ELECTRICAL/PLUMBING
FBI PROJECT # 13069

FEI Project No.: 13069

MPI Architects

Architecture ■ Planning ■ Interior Design
4949 Addison Circle ■ Addison, Texas 75001

MPI Project No.: 8130707

Seal

Seal

04/24/2015

Building Title
**BUILDING CC
SIXTH FLOOR PLAN**

Approved: Area Project Manager

Project Title
**AUDIE L. MURPHY VA HOSPITAL
PNEUMATIC TUBING SYSTEM**

Building Number
CC

Location
7400 Merton Minter
San Antonio, TX 78229

Date
04/24/15

Project No.
671-13-104

Drawing No.
E107

Dwg. of

South Texas
**Veterans
Health Care
System**

STVHCS
San Antonio, Texas

100% CONSTRUCTION ISSUE