



three-quarters inch = one foot  
 one-half inch = one foot  
 one-quarter inch = one foot  
 one-eighth inch = one foot

**B1** FIRST FLOOR PLAN, BLDG (PTS #8 AND #6). CC, BLOOD DRAW 131 AND P140  
 SCALE: 1/4" = 1'-0"

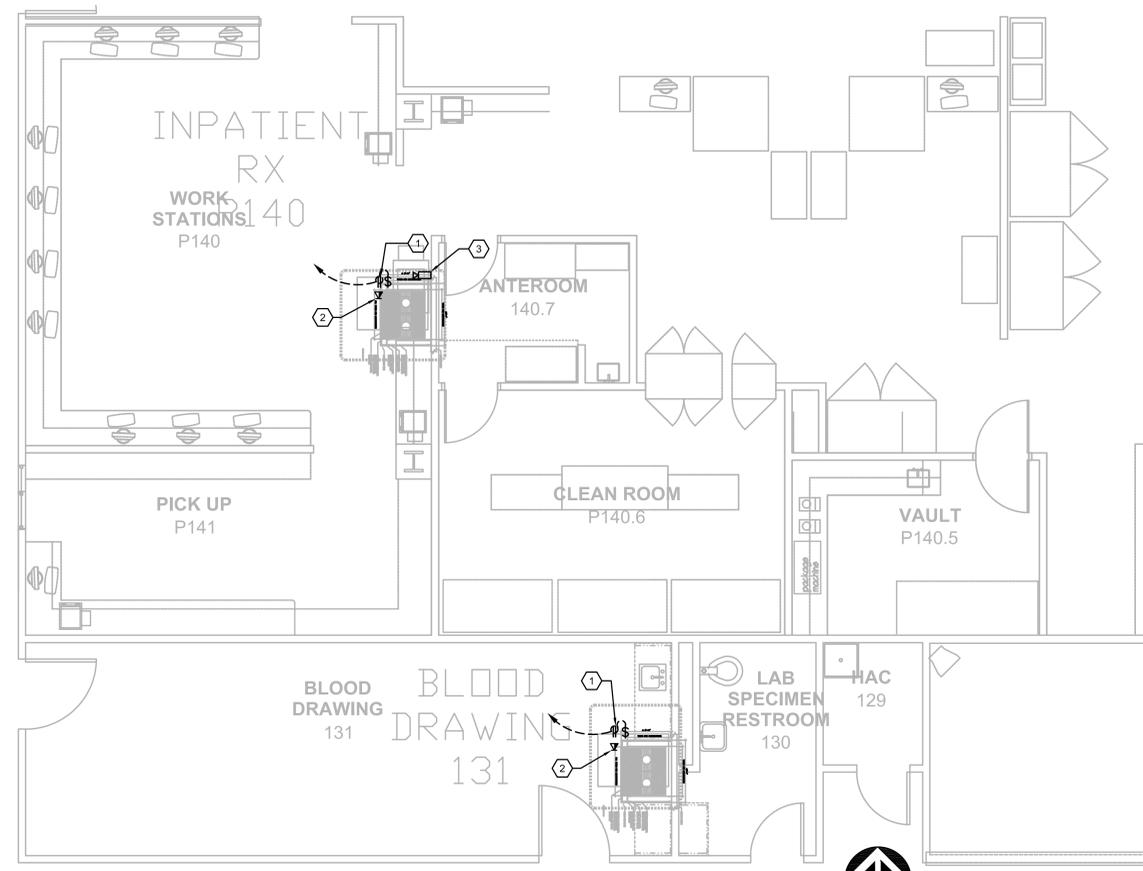


**B6** FIRST FLOOR PLAN, BLDG (PTS #35). CC, FUTURE ED EXPANSION  
 SCALE: 1/4" = 1'-0"

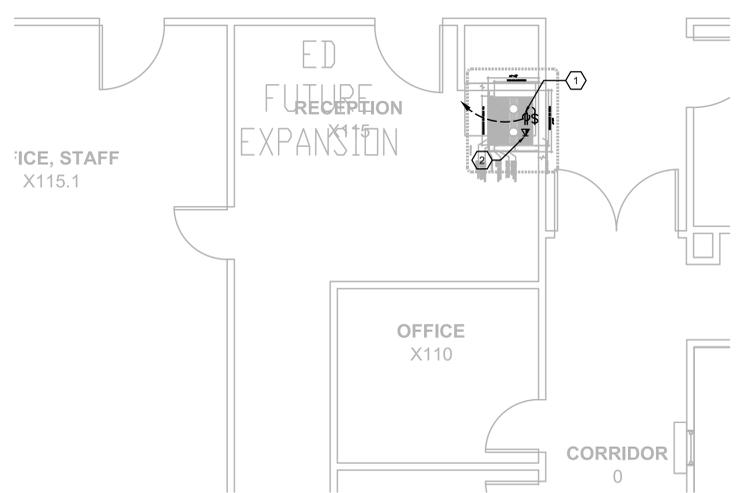


NOTE: GENERAL CONTRACTOR TO PROVIDE ROUGH-IN ONLY ABOVE CEILING. CAP UTILITY/TUBE CONNECTIONS AND PROVIDE THE PACKAGE WRAPPED PTS EQUIPMENT TO THE VA FOR INSTALLATION AT A LATER TIME.

**F1** FIRST FLOOR PLAN, BLDG (PTS #12). CLC; NURSING STATION 2A143  
 SCALE: 1/4" = 1'-0"

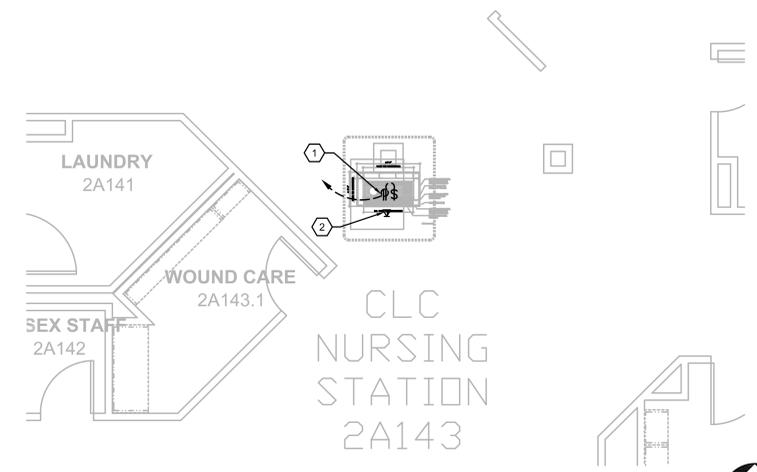

**F6** FIRST FLOOR PLAN, BLDG (PTS #11). CC; ED FAST TRACK 127  
 SCALE: 1/4" = 1'-0"

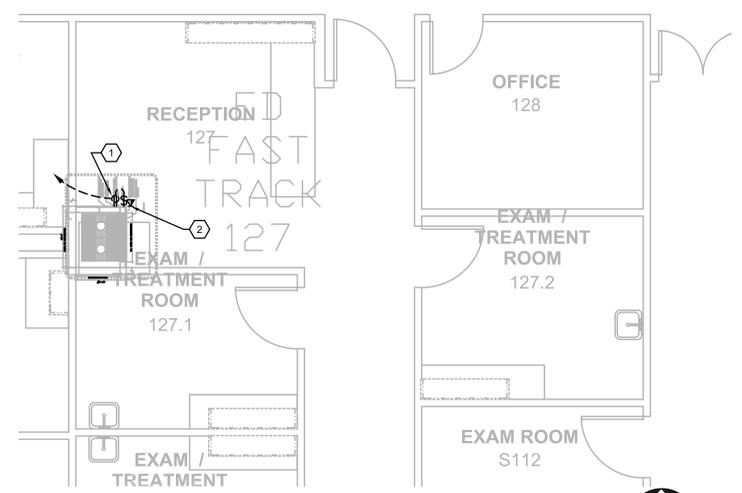

- GENERAL NOTES:**
- REFER TO MEP000 FOR ADDITIONAL NOTES.
  - THE PNEUMATIC TUBE SYSTEM INFRASTRUCTURE DESIGN HEREIN BASED ON SWISSLOG HEALTHCARE SOLUTIONS EQUIPMENT. THE VA RESERVES THE RIGHT FOR APPROVAL OF ALTERNATE PNEUMATIC TUBE SYSTEMS MANUFACTURER.
  - CONTRACTOR SHALL RE-ROUTE ANY DUCTWORK, MECHANICAL OR PLUMBING PIPING, DAMPERS OR TERMINAL BOXES LOCATED IN THE CEILING PLENUM AS REQUIRED TO ACCOMMODATE NEW PNEUMATIC OR ASSOCIATED EQUIPMENT.
  - REFER E109 THRU E111 FOR PANELBOARD LOCATIONS AND ADDITIONAL INFORMATION.
- NOTES BY SYMBOL: '○'**
- PROVIDE 120V, 20A, DUPLEX RECEPTACLE WITH TOGGLE SWITCH BEHIND CABINET OF THE PNEUMATIC TUBE SYSTEM STATION.
  - PROVIDE TELEPHONE/DATA OUTLET WITH ETHERNET, CAT5 OUTLET CAPABILITY BEHIND PNEUMATIC TUBE SYSTEM STATION.
  - REMOVE AND RETAIN EXISTING SECURITY CAMERA, OUTLET BOX, ASSOCIATED WIRING TO BE RELOCATED AS REQUIRED TO ALLOW FOR INSTALLATION OF PNEUMATIC TUBE CABINET. REINSTALL AS CLOSE AS POSSIBLE TO THE ORIGINAL LOCATION.

**100% CONSTRUCTION ISSUE**

Revisions Date	 2201 N. Collins, Suite 205 Arlington, Texas 76011-2005 (817) 461-0333 Fax: (817) 461-1025 MECHANICAL - ELECTRICAL - PLUMBING FEI PROJECT # 13069	 Architecture ■ Planning ■ Interior Design 4949 Addison Circle ■ Addison, Texas 75001 MPI Project No.: 8130707	 04/24/2015	Drawing Title <b>BUILDINGS CC &amp; CLC          FIRST FLOOR PLAN          PTS STATION LOCATIONS - ELECTRICAL</b>	Project Title <b>AUDIE L. MURPHY VA HOSPITAL          PNEUMATIC TUBING SYSTEM</b>	Date 04/24/15
				Approved: Area Project Manager	Project No. 671-13-104	Drawing No. <b>E402</b>
Building Number <b>CC, CLC</b>		Checked <b>SLT</b>	Drawn <b>AOP</b>	Location 7400 Merton Minter San Antonio, TX 78229		

