

# 100% CONSTRUCTION DOCUMENTS

## SPECIFICATIONS

Renovate Surgical Service & Upgrade Operating Rooms


Project No. 581-13-101



Huntington VA Medical Center  
Huntington, WV

January 15, 2016

# Volume II

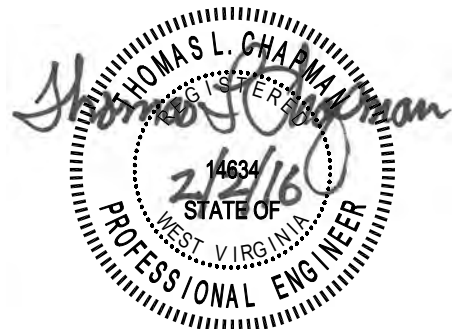



**DEPARTMENT OF VETERANS AFFAIRS  
VHA MASTER SPECIFICATIONS**

**TABLE OF CONTENTS  
Section 00 01 10**

**Volume I**

	<b>DIVISION 00 - SPECIAL SECTIONS</b>	<b>DATE</b>
00 01 15	List of Drawing Sheets	09-11
	<b>DIVISION 01 - GENERAL REQUIREMENTS</b>	
01 00 00	General Requirements	10-13
01 33 23	Shop Drawings, Product Data, and Samples	11-08
01 42 19	Reference Standards	09-11
01 45 29	Testing Laboratory Services	07-13
01 57 19	Temporary Environmental Controls	01-11
01 58 16	Temporary Interior Signage	08-11
01 74 19	Construction Waste Management	09-13
01 91 00	General Commissioning Requirements	06-13
	<b>DIVISION 02 - EXISTING CONDITIONS</b>	
02 41 00	Demolition	04-13
	<b>DIVISION 03 - CONCRETE</b>	
03 54 00	Cast Underlayment	
	<b>DIVISION 05 - METALS</b>	
05 50 00	Metal Fabrications	09-11
	<b>DIVISION 06 - WOOD, PLASTICS AND COMPOSITES</b>	
06 10 00	Rough Carpentry	09-11
06 20 00	Finish Carpentry	06-13
	<b>DIVISION 07 - THERMAL AND MOISTURE PROTECTION</b>	
07 01 50.19	Preparation for Re-Roofing	10-10
07 21 13	Thermal Insulation	03-09
07 22 00	Roof and Deck Insulation	10-10
07 53 23	Ethylene-Propylene-Diene-Monomer Roofing	10-11
07 60 00	Flashing and Sheet Metal	11-13
07 81 00	Applied Fireproofing	11-11
07 84 00	Firestopping	10-11
07 92 00	Joint Sealants	12-11
07 95 13	Expansion Joint Cover Assemblies	10-11
	<b>DIVISION 08 - OPENINGS</b>	
08 11 13	Hollow Metal Doors and Frames	01-13
08 14 00	Interior Wood Doors	10-12
08 31 13	Access Doors and Frames	10-11
08 33 13	Coiling Counter Doors	10-11
08 56 19	Pass Windows	10-11
08 71 00	Door Hardware	09-11

08 71 13	Automatic Door Operators	12-09
08 80 00	Glazing	10-12
08 90 00	Louvers and Vents	10-11
	<b>DIVISION 09 - FINISHES</b>	
09 06 00	Schedule for Finishes	10-11
09 22 16	Non-Structural Metal Framing	07-13
09 29 00	Gypsum Board	02-13
09 30 13	Ceramic/Porcelain Tiling	05-12
09 51 00	Acoustical Ceilings	10-10
09 65 13	Resilient Base and Accessories	10-11
09 65 16	Resilient Sheet Flooring	07-13
09 65 19	Resilient Tile Flooring	03-11
09 67 23.30	Resinous (Epoxy Resin Composition) Mortar Flooring (RES-3)	05-11
09 68 00	Carpeting	10-11
09 72 00	Hygienic Vinyl Wall Covering	
09 72 60	Tackable Wall Coverings	11-11
09 91 00	Painting	07-13
	<b>DIVISION 10 - SPECIALTIES</b>	
10 14 00	Signage	11-11
10 21 13	Toilet Compartments	05-12
10 21 23	Cubicle Curtain Tracks	11-11
10 25 13	Patient Bed Service Walls	11-11
10 26 00	Wall and Door Protection	01-11
10 28 00	Toilet, Bath, and Laundry Accessories	11-11
10 44 13	Fire Extinguisher Cabinets	11-11
10 51 00	Lockers	
	<b>DIVISION 12 - FURNISHINGS</b>	
12 31 00	Manufactured Metal Casework	04-11
12 36 00	Countertops	05-10
	<b>DIVISION 13 - SPECIAL CONSTRUCTION</b>	
13 49 00	Radiation Protection	07-11
	<b>DIVISION 21- FIRE SUPPRESSION</b>	
21 05 11	Common Work Results for Fire Suppression	11-09
21 08 00	Commissioning of Fire Suppression System	06-13
21 13 13	Wet-Pipe Sprinkler Systems	05-08
	<b>DIVISION 22 - PLUMBING</b>	
22 05 11	Common Work Results for Plumbing	04-11
22 05 19	Meters and Gages for Plumbing Piping	02-10
22 05 23	General-Duty Valves for Plumbing Piping	12-09
22 07 11	Plumbing Insulation	05-11
22 08 00	Commissioning of Plumbing Systems	06-13
22 11 00	Facility Water Distribution	07-13
22 13 00	Facility Sanitary and Vent Piping	12-09
22 14 00	Facility Storm Drainage	12-09
22 40 00	Plumbing Fixtures	03-11
22 62 00	Vacuum Systems for Laboratory and Healthcare Facilities	08-12

22 63 00	Gas Systems for Laboratory and Healthcare Facilities	12-10
<b>Volume II</b>		
	<b>DIVISION 23 - HEATING, VENTILATING, AND AIR CONDITIONING (HVAC)</b>	
23 05 11	Common Work Results for HVAC	11-10
23 05 12	General Motor Requirements for HVAC	11-10
23 05 41	Noise and Vibration Control for HVAC Piping and Equipment	11-10
23 05 93	Testing, Adjusting, and Balancing for HVAC	05-11
23 07 11	HVAC Insulation	05-11
23 08 00	Commissioning of HVAC	06-13
23 09 23	Direct-Digital Control System for HVAC	09-11
23 21 13	Hydronic Piping	09-12
23 22 13	Steam and Condensate Heating Piping	03-10
23 25 00	HVAC Water Treatment	02-10
23 31 00	HVAC Ducts and Casings	03-13
23 34 00	HVAC Fans	11-09
23 36 00	Air Terminal Units	03-10
23 37 00	Air Outlets and Inlets	11-09
23 40 00	HVAC Air Cleaning Devices	02-12
23 74 43	Custom, Outdoor Penthouse Equipment Module /Central-Station Air Handling Unit	
23 82 00	Convection Heating and Cooling Units	04-11
23 82 16	Air Coils	04-11
	<b>DIVISION 26 - ELECTRICAL</b>	
26 05 11	Requirements for Electrical Installations	12-12
26 05 19	Low-Voltage Electrical Power Conductors and Cables	07-13
26 05 26	Grounding and Bonding for Electrical Systems	12-12
26 05 33	Raceway and Boxes for Electrical Systems	09-10
26 05 41	Underground Electrical Construction	12-12
26 08 00	Commissioning of Electrical Systems	06-13
26 09 23	Lighting Controls	09-10
26 20 11	Isolated Power Systems	12-12
26 22 00	Low-Voltage Transformers	12-12
26 24 16	Panelboards	12-12
26 24 19	Motor-Control Centers	12-12
26 27 26	Wiring Devices	12-12
26 29 11	Motor Controllers	12-12
26 29 21	Enclosed Switches and Circuit Breakers	12-12
26 36 23	Automatic Transfer Switches	12-12
26 41 00	Facility Lightning Protection	12-12
26 51 00	Interior Lighting	12-12
	<b>DIVISION 27 - COMMUNICATIONS</b>	
27 05 11	Requirements for Communications Installations	11-09
27 05 26	Grounding and Bonding for Communications Systems	10-06
27 05 33	Raceways and Boxes for Communications Systems	12-05
27 08 00	Commissioning of Communications Systems	06-13
27 10 00	Structured Cabling	12-05
27 11 00	Communications Equipment Room Fittings	06-13
27 15 00	Communications Horizontal Cabling	06-13
27 51 16	Public Address and Mass Notification Systems	01-10

27 52 23	Nurse Call and Code Blue Systems	01-10
	<b>DIVISION 28 - ELECTRONIC SAFETY AND SECURITY</b>	
28 05 00	Common Work Results for Electronic Safety and Security	06-13
28 05 13	Conductors and Cables for Electronic Safety and Security	09-11
28 05 26	Grounding and Bonding for Electronic Safety and Security	09-11
28 05 28.33	Conduits and Backboxes for Electronic Safety and Security	09-11
28 08 00	Commissioning of Electronic Safety and Security Systems	06-13
28 13 00	Physical Access Control Systems	10-11
28 23 00	Video Surveillance	09-11
28 31 00	Fire Detection and Alarm	10-11

**SECTION 21 05 11**  
**COMMON WORK RESULTS FOR FIRE SUPPRESSION**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. The requirements of this Section apply to all sections of Division 21.
- B. Definitions:
  - 1. Exposed: Piping and equipment exposed to view in finished rooms.
  - 2. Option or optional: Contractor's choice of an alternate material or method.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 05 50 00, METAL FABRICATIONS.
- D. Section 07 84 00, FIRESTOPPING.
- E. Section 07 92 00, JOINT SEALANTS.
- F. Section 09 91 00, PAINTING.
- G. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS

**1.3 QUALITY ASSURANCE**

- A. Products Criteria:
  - 1. Standard Products: Material and equipment shall be the standard products of a manufacturer regularly engaged in the manufacture of the products for at least 3 years. See other specification sections for any exceptions.
  - 2. Equipment Service: Products shall be supported by a service organization which maintains a complete inventory of repair parts and is located reasonably close to the site.
  - 3. Multiple Units: When two or more units of materials or equipment of the same type or class are required, these units shall be products of one manufacturer.
  - 4. Assembled Units: Manufacturers of equipment assemblies, which use components made by others, assume complete responsibility for the final assembled product.
  - 5. Nameplates: Nameplate bearing manufacturer's name or identifiable trademark shall be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.
  - 6. Asbestos products or equipment or materials containing asbestos shall not be used.

- B. Manufacturer's Recommendations: Where installation procedures or any part thereof are required to be in accordance with the recommendations of the manufacturer of the material being installed, printed copies of these recommendations shall be furnished to the Contracting Officers Representative (COR) prior to installation. Installation of the item will not be allowed to proceed until the recommendations are received. Failure to furnish these recommendations can be cause for rejection of the material.
- C. Guaranty: In GENERAL CONDITIONS.
- D. Supports for sprinkler piping shall be in conformance with NFPA 13.
- E. Supports for standpipe shall be in conformance with NFPA 14.

#### **1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data: Submit under the pertinent section rather than under this section.
  - 1. Equipment and materials identification.
  - 2. Fire-stopping materials.
  - 3. Hangers, inserts, supports and bracing. Provide load calculations for variable spring and constant support hangers.
  - 4. Wall, floor, and ceiling plates.
- C. Coordination Drawings: Provide details of the following.
  - 1. Mechanical equipment rooms.
  - 2. Hangers, inserts, supports, and bracing.
  - 3. Pipe sleeves.
  - 4. Equipment penetrations of floors, walls, ceilings, or roofs.
- D. Maintenance Data and Operating Instructions:
  - 1. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Article, INSTRUCTIONS, for systems and equipment.
  - 2. Provide a listing of recommended replacement parts for keeping in stock supply, including sources of supply, for equipment.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):
  - A36/A36M-2001.....Carbon Structural Steel
  - A575-96.....Steel Bars, Carbon, Merchant Quality, M-Grades R (2002)



E84-2003.....Standard Test Method for Burning Characteristics  
of Building Materials

E119-2000.....Standard Test Method for Fire Tests of Building  
Construction and Materials

C. National Fire Protection Association (NFPA):

90A-12.....Installation of Air Conditioning and Ventilating  
Systems

101-12.....Life Safety Code

**PART 2 - PRODUCTS**

**2.1 LIFTING ATTACHMENTS**

Provide equipment with suitable lifting attachments to enable equipment to be lifted in its normal position. Lifting attachments shall withstand any handling conditions that might be encountered, without bending or distortion of shape, such as rapid lowering and braking of load.

**2.2 EQUIPMENT AND MATERIALS IDENTIFICATION**

- A. Use symbols, nomenclature and equipment numbers specified, shown on the drawings and shown in the maintenance manuals. Identification for piping is specified in Section 09 91 00, PAINTING.
- B. Interior (Indoor) Equipment: Engraved nameplates, with letters not less than 48 mm (3/16-inch) high of brass with black-filled letters, or rigid black plastic with white letters specified in Section 09 91 00, PAINTING permanently fastened to the equipment. Identify unit components such as coils, filters, fans, etc.
- C. Control Items: Label all temperature and humidity sensors, controllers and control dampers. Identify and label each item as they appear on the control diagrams.
- D. Valve Tags and Lists:
  - 1. Valve tags: Engraved black filled numbers and letters not less than 13 mm (1/2-inch) high for number designation, and not less than 6.4 mm (1/4-inch) for service designation on 19 gage 38 mm (1-1/2 inches) round brass disc, attached with brass "S" hook or brass chain.
  - 2. Valve lists: Typed or printed plastic coated card(s), sized 216 mm (8-1/2 inches) by 280 mm (11 inches) showing tag number, valve function and area of control, for each service or system. Punch sheets for a 3-ring notebook.
  - 3. Provide detailed plan for each floor of the building indicating the location and valve number for each valve. Identify location of each valve with a color coded thumb tack in ceiling.

### **2.3 FIRESTOPPING**

Section 07 84 00, FIRESTOPPING specifies an effective barrier against the spread of fire, smoke and gases where penetrations occur for piping.

### **2.4 GALVANIZED REPAIR COMPOUND**

Mil. Spec. DOD-P-21035B, paint form.

### **2.5 PIPE PENETRATIONS**

- A. Install sleeves during construction for other than blocked out floor openings for risers in mechanical bays.
- B. To prevent accidental liquid spills from passing to a lower level, provide the following:
  - 1. For sleeves: Extend sleeve 25 mm (one inch) above finished floor and provide sealant for watertight joint.
  - 2. For blocked out floor openings: Provide 40 mm (1-1/2 inch) angle set in silicone adhesive around opening.
  - 3. For drilled penetrations: Provide 40 mm (1-1/2 inch) angle ring or square set in silicone adhesive around penetration.
- C. Penetrations are not allowed through beams or ribs, but may be installed in concrete beam flanges. Any deviation from this requirement must receive prior approval of COR.
- D. Sheet Metal, Plastic, or Moisture-resistant Fiber Sleeves: Provide for pipe passing through floors, interior walls, and partitions, unless brass or steel pipe sleeves are specifically called for below.
- E. Galvanized Steel or an alternate Black Iron Pipe with asphalt coating Sleeves: Provide for pipe passing through concrete beam flanges, except where brass pipe sleeves are called for. Provide sleeve for pipe passing through floor of mechanical rooms above basement. Except in mechanical rooms, connect sleeve with floor plate.
- F. Brass Pipe Sleeves: Provide for pipe passing through quarry tile, terrazzo or ceramic tile floors. Connect sleeve with floor plate.
- G. Sleeves are not required for fire department connections in drywall construction.
- H. Sleeve Clearance: Sleeve through floors, walls, partitions, and beam flanges shall be one inch greater in diameter than external diameter of pipe. Sleeve for pipe with insulation shall be large enough to accommodate the insulation. Interior openings shall be caulked tight with fire stopping material and sealant to prevent the spread of fire, smoke, and gases.
- I. Sealant and Adhesives: Shall be as specified in Section 07 92 00, JOINT SEALANTS.

## **2.6 TOOLS AND LUBRICANTS**

- A. Furnish, and turn over to the COR, special tools not readily available commercially, that are required for disassembly or adjustment of equipment and machinery furnished.
- B. Tool Containers: Hardwood or metal, permanently identified for intended service and mounted, or located, where directed by the COR.

## **2.7 WALL, FLOOR AND CEILING PLATES**

- A. Material and Type: Chrome plated brass or chrome plated steel, one piece or split type with concealed hinge, with set screw for fastening to pipe, or sleeve. Use plates that fit tight around pipes, cover openings around pipes and cover the entire pipe sleeve projection.
- B. Thickness: Not less than 2.4 mm (3/32-inch) for floor plates. For wall and ceiling plates, not less than 0.64 mm (0.025-inch) for up to 80 mm (3-inch pipe), 0.89 mm (0.035-inch) for larger pipe.
- C. Locations: Use where pipe penetrates floors, walls and ceilings in exposed locations, in finished areas only. Use also where insulation ends on exposed water supply pipe drop from overhead. Provide watertight joint in spaces where brass or steel pipe sleeves are specified.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Coordinate location of piping, sleeves, inserts, hangers, and equipment. Locate piping, sleeves, inserts, hangers, and equipment clear of windows, doors, openings, light outlets, and other services and utilities. Follow manufacturer's published recommendations for installation methods not otherwise specified.
- B. Protection and Cleaning:
  - 1. Equipment and materials shall be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations and as approved by the COR. Damaged or defective items in the opinion of the COR, shall be replaced.
  - 2. Close pipe openings with caps or plugs during installation. Tightly cover and protect equipment against dirt, water chemical, or mechanical injury. At completion of all work thoroughly exposed materials and equipment.
- C. Install gages, valves, and other devices with due regard for ease in reading or operating and maintaining said devices. Locate and position gages to be easily read by operator or staff standing on floor or walkway provided. Servicing shall not require dismantling adjacent equipment or pipe work.

D. Work in Existing Building:

1. Perform as specified in Article, OPERATIONS AND STORAGE AREAS, Article, ALTERATIONS, and Article, RESTORATION of the Section 01 00 00, GENERAL REQUIREMENTS for relocation of existing equipment, alterations and restoration of existing building(s).
2. As specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, OPERATIONS AND STORAGE AREAS, make alterations to existing service piping at times that will least interfere with normal operation of the facility.
3. Cut required openings through existing masonry and reinforced concrete using diamond core drills. Use of pneumatic hammer type drills, impact type electric drills, and hand or manual hammer type drills, will be permitted only with approval of the COR. Locate openings that will least effect structural slabs, columns, ribs or beams. Refer to the COR for determination of proper design for openings through structural sections and opening layouts approval, prior to cutting or drilling into structure. After COR's approval, carefully cut opening through construction no larger than absolutely necessary for the required installation.

E. Switchgear Drip Protection: Every effort shall be made to eliminate the installation of pipe above electrical and telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints.

F. Inaccessible Equipment:

1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, equipment shall be removed and reinstalled or remedial action performed as directed at no additional cost to the Government.
2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as motors, fans, pumps, belt guards, transformers, high voltage lines, piping, and ductwork.

**3.2 STARTUP AND TEMPORARY OPERATION**

Start up equipment as described in equipment specifications. Verify that vibration is within specified tolerance prior to extended operation. Temporary use of equipment is specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT.

### **3.3 OPERATING AND PERFORMANCE TESTS**

- A. Prior to the final inspection, perform required tests as specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TESTS and submit the test reports and records to the COR.
- B. Should evidence of malfunction in any tested system, or piece of equipment or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost to the Government.
- C. When completion of certain work or system occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then make performance tests for heating systems and for cooling systems respectively during first actual seasonal use of respective systems following completion of work.

### **3.4 INSTRUCTIONS TO VA PERSONNEL**

Provide in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.

- - - E N D - - -



**SECTION 21 08 00**  
**COMMISSIONING OF FIRE SUPPRESSION SYSTEMS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. The requirements of this Section apply to all sections of Division 21.
- B. This project will have selected building systems commissioned. The complete list of equipment and systems to be commissioned is specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. The commissioning process, which the Contractor is responsible to execute, is defined in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. A Commissioning Agent (CxA) appointed by the VA will manage the commissioning process.

**1.2 RELATED WORK**

- A. Section 01 00 00 GENERAL REQUIREMENTS.
- B. Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.
- C. Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

**1.3 SUMMARY**

- A. This Section includes requirements for commissioning the Fire Suppression systems, subsystems and equipment. This Section supplements the general requirements specified in Section 01 91 00 General Commissioning Requirements.
- B. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for more details regarding processes and procedures as well as roles and responsibilities for all Commissioning Team members.

**1.4 DEFINITIONS**

- A. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for definitions.

**1.5 COMMISSIONED SYSTEMS**

- A. Commissioning of a system or systems specified in Division 21 is part of the construction process. Documentation and testing of these systems, as well as training of the VA's Operation and Maintenance personnel in accordance with the requirements of Section 01 91 00 and

of Division 21, is required in cooperation with the VA and the Commissioning Agent.

- B. The Fire Suppression systems commissioning will include the systems listed in Section 01 19 00 General Commissioning Requirements:

#### **1.6 SUBMITTALS**

- A. The commissioning process requires review of selected Submittals. The Commissioning Agent will provide a list of submittals that will be reviewed by the Commissioning Agent. This list will be reviewed and approved by the VA prior to forwarding to the Contractor. Refer to Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, and SAMPLES for further details.
- B. The commissioning process requires Submittal review simultaneously with engineering review. Specific submittal requirements related to the commissioning process are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

#### **PART 2 - PRODUCTS (NOT USED)**

#### **PART 3 - EXECUTION**

##### **3.1 CONSTRUCTION INSPECTIONS**

- A. Commissioning of the building fire suppression systems will require inspection of individual elements of the fire suppression construction throughout the construction period. The Contractor shall coordinate with the Commissioning Agent in accordance with Section 01 19 00 and the Commissioning plan to schedule inspections as required to support the Commissioning Process.

##### **3.2 PRE-FUNCTIONAL CHECKLISTS**

- A. The Contractor shall complete Pre-Functional Checklists to verify systems, subsystems, and equipment installation is complete and systems are ready for Systems Functional Performance Testing. The Commissioning Agent will prepare Pre-Functional Checklists to be used to document equipment installation. The Contractor shall complete the checklists. Completed checklists shall be submitted to the VA and to the Commissioning Agent for review. The Commissioning Agent may spot check a sample of completed checklists. If the Commissioning Agent determines that the information provided on the checklist is not accurate, the Commissioning Agent will return the marked-up checklist



to the Contractor for correction and resubmission. If the Commissioning Agent determines that a significant number of completed checklists for similar equipment are not accurate, the Commissioning Agent will select a broader sample of checklists for review. If the Commissioning Agent determines that a significant number of the broader sample of checklists is also inaccurate, all the checklists for the type of equipment will be returned to the Contractor for correction and resubmission. Refer to SECTION 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for submittal requirements for Pre-Functional Checklists, Equipment Startup Reports, and other commissioning documents.

### **3.3 CONTRACTORS TESTS**

- A. Contractor tests as required by other sections of Division 21 shall be scheduled and documented in accordance with Section 01 00 00 GENERAL REQUIREMENTS. All testing shall be incorporated into the project schedule. Contractor shall provide no less than 7 calendar days' notice of testing. The Commissioning Agent will witness selected Contractor tests at the sole discretion of the Commissioning Agent. Contractor tests shall be completed prior to scheduling Systems Functional Performance Testing.

### **3.4 SYSTEMS FUNCTIONAL PERFORMANCE TESTING**

- A. The Commissioning Process includes Systems Functional Performance Testing that is intended to test systems functional performance under steady state conditions, to test system reaction to changes in operating conditions, and system performance under emergency conditions. The Commissioning Agent will prepare detailed Systems Functional Performance Test procedures for review and approval by the Resident Engineer. The Contractor shall review and comment on the tests prior to approval. The Contractor shall provide the required labor, materials, and test equipment identified in the test procedure to perform the tests. The Commissioning Agent will witness and document the testing. The Contractor shall sign the test reports to verify tests were performed. See Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS, for additional details.

### **3.5 TRAINING OF VA PERSONNEL**

- A. Training of the VA operation and maintenance personnel is required in cooperation with the Contracting Officer's Representative (COR) and

Commissioning Agent. Provide competent, factory authorized personnel to provide instruction to operation and maintenance personnel concerning the location, operation, and troubleshooting of the installed systems. Contractor shall submit training agendas and trainer resumes in accordance with the requirements of Section 01 19 00. The instruction shall be scheduled in coordination with the COR after submission and approval of formal training plans. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS and Division 21 Sections for additional Contractor training requirements.

----- END -----

**SECTION 21 13 13**  
**WET-PIPE SPRINKLER SYSTEMS**

**PART 1 - GENERAL**

**1.1 SCOPE OF WORK**

- A. Design, installation and testing shall be in accordance with NFPA 13 except for specified exceptions.
- B. The design and installation of a hydraulically calculated automatic wet system complete and ready for operation, for all portions of Building 1S, including the mechanical equipment rooms, telephone rooms, patient areas and operating rooms, office areas, toilet rooms and storage rooms.
- C. Modification of the existing sprinkler system as indicated on the drawings and as further required by these specifications. Sprinkler heads indicated on architectural and fire protection drawings are for design coordination and establishing budgetary pricing only.

**1.2 RELATED WORK**

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Section 07 84 00, FIRESTOPPING, Treatment of penetrations through rated enclosures.
- C. Section 09 91 00, PAINTING.
- D. Section 28 31 00, FIRE DETECTION AND ALARM, Connection to fire alarm of flow switches, pressure switches and valve supervisory switches.
- E. Section 21 05 11 COMMON WORK RESULTS FOR FIRE SUPPRESSION

**1.3 QUALITY ASSURANCE**

- A. Installer Reliability: The installer shall possess a valid State of West Virginia contractor's license. The installer shall have been actively and successfully engaged in the installation of commercial automatic sprinkler systems for the past ten years.
- B. Materials and Equipment: All equipment and devices shall be of a make and type listed by UL and approved by FM, or other nationally recognized testing laboratory for the specific purpose for which it is used. All materials, devices, and equipment shall be approved by the VA.
- C. Submittals: Submit as one package in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Prepare detailed working drawings that are signed by a NICET Level III or Level IV Sprinkler Technician or stamped by a Registered Professional Engineer practicing in the field of Fire Protection Engineering. As Government review is for technical adequacy only, the installer remains responsible for correcting any conflicts with other trades and building construction that arise during installation. Material submittals shall be approved

prior to the purchase or delivery to the job site. Suitably bind submittals in notebooks or binders and provide index referencing the appropriate specification section. Submittals shall include, but not be limited to, the following:

1. Qualifications:

- a. Provide a copy of the installing contractors state contractors license.
- b. Provide a copy of the NICET certification for the NICET Level III or Level IV Sprinkler Technician who prepared and signed the detailed working drawings unless the drawings are stamped by a Registered Professional Engineer practicing in the field of Fire Protection Engineering.

2. Drawings: Submit detailed 1:100 (1/8 inch) scale (minimum) working drawings conforming to NFPA 13. Include a site plan showing the piping to the water supply test location.

3. Manufacturers Data Sheets:

- a. Provide for materials and equipment proposed for use on the system. Include listing information and installation instructions in data sheets. Where data sheet describes items in addition to that item being submitted, clearly identify proposed item on the sheet.

4. Calculation Sheets: Submit hydraulic calculation sheets in tabular form conforming to the requirements and recommendations of NFPA 13.

5. Final Document Submittals: Provide as-built drawings, testing and maintenance instructions in accordance with the requirements in Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

Submittals shall include, but not be limited to, the following:

- a. One complete set of reproducible as-built drawings showing the installed system with the specific interconnections between the waterflow switch or pressure switch and the fire alarm equipment.
- b. Complete, simple, understandable, step-by-step, testing instructions giving recommended and required testing frequency of all equipment, methods for testing all equipment, and a complete trouble shooting manual. Provide maintenance instructions on replacing any components of the system including internal parts, periodic cleaning and adjustment of the equipment and components with information as to the address and telephone number of both the manufacturer and the local supplier of each item.
- c. Material and Testing Certificate: Upon completion of the sprinkler system installation or any partial section of the system,

- including testing and flushing, provide a copy of a completed Material and Testing Certificate as indicated in NFPA 13.
- d. Certificates shall document all parts of the installation.
  - e. Instruction Manual: Provide one copy of the instruction manual covering the system in a flexible protective cover and mount in an accessible location adjacent to the riser.
- D. Design Basis Information: Provide design, materials, equipment, installation, inspection, and testing of the automatic sprinkler system in accordance with the requirements of NFPA 13. Recommendations in appendices shall be treated as requirements.
- 1. Perform hydraulic calculations in accordance with NFPA 13 utilizing the Area/Density method. Do not restrict design area reductions permitted for using quick response sprinklers throughout by the required use of standard response sprinklers in the areas identified in this section.
  - 2. Sprinkler Protection: To determining spacing and sizing, apply the following coverage classifications:
    - a. Light Hazard Occupancies: Patient care, treatment, and customary access areas.
    - b. Ordinary Hazard Group 1 Occupancies: Laboratories, Mechanical Equipment Rooms, Transformer Rooms, Electrical Switchgear Rooms, Electric Closets.
    - c. Ordinary Hazard Group 2 Occupancies: Storage rooms, trash rooms, clean and soiled linen rooms, pharmacy and associated storage, laundry, storage areas, building management storage, file storage areas for the entire area of the space up to 140 square meters (1500 square feet) and Supply Processing and Distribution (SPD).
    - d. Request clarification from the Government for any hazard classification not identified.
  - 3. Hydraulic Calculations: Calculated demand including hose stream requirements shall fall no less than 10 percent below the available water supply curve.
  - 4. Water Supply: Base sprinkler system hydraulic design on existing fire pump hydraulic flow test data of (see VAMC -Huntington for current pump test data):
    - a. Pump Location: Building 1S basement mechanical room
    - b. Pump Elevation: 572 ft
    - c. Suction pressure: 62 psi
    - e. Discharge pressure: 140 psi
    - f. Rated Pump Capacity: 500 gpm)

- g. Date: September 28, 2013
- 5. Zoning:
  - a. For each sprinkler zone provide a control valve, flow switch and a test and drain assembly with pressure gauge.
  - b. Sprinkler zones shall conform to the smoke barrier zones shown on the drawings.
  - c. Provide seismic protection in accordance with NFPA 13.

#### **1.4 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. National Fire Protection Association (NFPA):
  - 13-2013.....Installation of Sprinkler Systems
  - 101-12.....Safety to Life from Fire in Buildings and Structures (Life Safety Code)
  - 170-2012.....Fire Safety Symbols
- C. Underwriters Laboratories, Inc. (UL):
  - Fire Protection Equipment Directory - 2012
- D. Factory Mutual Engineering Corporation (FM):
  - Approval Guide - 2012
- E. International Building Code - 2012
- F. Foundation for Cross-Connection Control and Hydraulic Research-2011

### **PART 2 PRODUCTS**

#### **2.1 PIPING & FITTINGS**

- A. Sprinkler systems in accordance with NFPA 13. Use nonferrous piping in MRI Scanning Rooms.

#### **2.2 VALVES**

- A. Valves in accordance with NFPA 13.
- B. Do not use quarter turn ball valves for 50 mm (2 inch) or larger drain valves.
- C. The wet system control valve shall be a listed indicating type valve. Control valve shall be UL Listed and FM Approved for fire protection installations. System control valve shall be rated for normal system pressure but in no case less than 175 PSI. (No Substitutions Allowed).

#### **2.3 SPRINKLERS**

- A. All sprinklers except "institutional" type sprinklers shall be FM approved. Provide quick response sprinklers in all areas, except where specifically prohibited by their listing or approval. Quick response extended coverage sprinklers may be used in rooms which cannot be

adequately covered with standard sprinklers due to ceiling mounted equipment and fixtures.

1. In mechanical equipment: Standard response sprinklers.

(Note: Provide 'cages' to protect sprinkler heads from breakage/damage when the elevation of the head is less than 7 feet 6 inches above finished floor (mechanical rooms, janitor closets, etc).)

- B. Temperature Ratings: In accordance with NFPA 13, except as follows:

1. Sprinklers in mechanical rooms and electrical rooms/closet: High temperature rated.

#### **2.4 SPRINKLER CABINET**

Provide sprinkler cabinet with the required number of sprinkler heads of all ratings and types installed, and a sprinkler wrench for each system. Locate adjacent to the riser. Sprinkler heads shall be installed in center of tile or center to center.

#### **2.5 IDENTIFICATION SIGNS/HYDRAULIC PLACARDS**

Plastic, steel or aluminum signs with white lettering on a red background with holes for easy attachment. Enter pertinent data for each system on the hydraulic placard.

#### **2.6 SWITCHES:**

- A. Contain in a weatherproof die cast/red baked enamel, oil resistant, aluminum housing with tamper resistant screws, 13 mm (1/2 inch) conduit entrance and necessary facilities for attachment to the valves. Provide two SPDT switches rated at 2.5 amps at 24 VDC.
- B. Water flow Alarm Switches: Mechanical, non-coded, non-accumulative retard and adjustable from 0 to 60 seconds minimum. Set flow switches at an initial setting between 20 and 30 seconds.
- C. Valve Supervisory Switches for Ball and Butterfly Valves: May be integral with the valve.

#### **2.7 GAUGES**

Provide gauges as required by NFPA 13.

#### **2.8 PIPE HANGERS AND SUPPORTS**

Supports, hangers, etc., of an approved pattern placement to conform to NFPA 13. System piping shall be substantially supported to the building structure. The installation of hangers and supports shall adhere to the requirements set forth in NFPA 13, Standard for Installation of Sprinkler Systems. Materials used in the installation or construction of hangers and supports shall be listed and approved for such application. Hangers or supports not specifically listed for service shall be designed and bear the seal of a professional engineer.

## **2.9 WALL, FLOOR AND CEILING PLATES**

Provide chrome plated steel escutcheon plates for exposed piping passing through walls, floors or ceilings.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Installation shall be accomplished by the licensed contractor. Provide a qualified technician, experienced in the installation and operation of the type of system being installed, to supervise the installation and testing of the system.
- B. Installation of Piping: Accurately cut pipe to measurements established by the installer and work into place without springing or forcing. In any situation where bending of the pipe is required, use a standard pipe-bending template. Install concealed piping in spaces that have finished ceilings. Where ceiling mounted equipment exists, such as in operating and radiology rooms, install sprinklers so as not to obstruct the movement or operation of the equipment. Sidewall heads may need to be utilized. Locate piping in stairways as near to the ceiling as possible to prevent tampering by unauthorized personnel, and to provide a minimum headroom clearance of 2250 mm (seven feet six inches). To prevent an obstruction to egress, provide piping clearances in accordance with NFPA 101.
- C. Welding: Conform to the requirements and recommendations of NFPA 13.
- D. Drains: Pipe drains to discharge at safe points outside of the building or to sight cones attached to drains of adequate size to readily carry the full flow from each drain under maximum pressure. Do not provide a direct drain connection to sewer system or discharge into sinks. Install drips and drains where necessary and required by NFPA 13.
- E. Supervisory Switches: Provide supervisory switches for sprinkler control valves.
- F. Waterflow Alarm Switches: Install waterflow switch and adjacent valves in easily accessible locations.
- G. Inspector's Test Connection: Install and supply in conformance with NFPA 13, locate in a secured area, and discharge to the exterior of the building.
- H. Affix cutout disks, which are created by cutting holes in the walls of pipe for flow switches and non-threaded pipe connections to the respective waterflow switch or pipe connection near to the pipe from where they were cut.
- I. Sleeves: Provide for pipes passing through masonry or concrete. Provide space between the pipe and the sleeve in accordance with NFPA 13. Seal



this space with a UL Listed through penetration fire stop material in accordance with Section 07 84 00, FIRESTOPPING. Where core drilling is used in lieu of sleeves, also seal space. Seal penetrations of walls, floors and ceilings of other types of construction, in accordance with Section 07 84 00, FIRESTOPPING.

- J. Provide pressure gauge at each water flow alarm switch location and at each main drain connection.
- K. For each fire department connection, provide the symbolic sign given in NFPA 170 and locate 2400 to 3000 mm (8 to 10 feet) above each connection location. Size the sign to 450 by 450 mm (18 by 18 inches) with the symbol being at least 350 by 350 mm (14 by 14 inches).
- L. Firestopping shall comply with Section 07 84 00, FIRESTOPPING.
- M. The drain piping shall not be restricted or reduced and shall be of the same diameter as the drain collector.
- N. Securely attach identification signs to control valves, drain valves, and test valves. Locate hydraulic placard information signs at each sectional control valve where there is a zone water flow switch.
- O. Repairs: Repair damage to the building or equipment resulting from the installation of the sprinkler system by the installer at no additional expense to the Government.
- P. Interruption of Service: There shall be no interruption of the existing sprinkler protection, water, electric, or fire alarm services without prior permission of the Contracting Officer. Contractor shall develop an interim fire protection program where interruptions involve in occupied spaces. Request in writing at least one week prior to the planned interruption.

### **3.2 INSPECTION AND TEST**

- A. Preliminary Testing: Flush newly installed systems prior to performing hydrostatic tests in order to remove any debris which may have been left as well as ensuring piping is unobstructed. Hydrostatically test system, including the fire department connections, as specified in NFPA 13, in the presence of the Contracting Officers Representative (COR) or his designated representative. Test and flush underground water line prior to performing these hydrostatic tests.
- B. Final Inspection and Testing: Subject system to tests in accordance with NFPA 13, and when all necessary corrections have been accomplished, advise Contracting Officers Representative (COR) to schedule a final inspection and test. Connection to the fire alarm system shall have been in service for at least ten days prior to the final inspection, with adjustments made to prevent false alarms. Furnish all instruments, labor

and materials required for the tests and provide the services of the installation foreman or other competent representative of the installer to perform the tests. Correct deficiencies and retest system as necessary, prior to the final acceptance. Include the operation of all features of the systems under normal operations in test.

### **3.3 INSTRUCTIONS**

Furnish the services of a competent instructor for not less than two hours for instructing personnel in the operation and maintenance of the system, on the dates requested by the COR.

- - - E N D - - -

**SECTION 22 05 11**  
**COMMON WORK RESULTS FOR PLUMBING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. The requirements of this Section shall apply to all sections of Division 22.
- B. Definitions:
  - 1. Exposed: Piping and equipment exposed to view in finished rooms.
  - 2. Option or optional: Contractor's choice of an alternate material or method.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 05 50 00, METAL FABRICATIONS.
- D. Section 07 84 00, FIRESTOPPING.
- E. Section 07 60 00, FLASHING AND SHEET METAL: Flashing for Wall and Roof Penetrations.
- F. Section 07 92 00, JOINT SEALANTS.
- G. Section 09 91 00, PAINTING.
- H. Section 22 07 11, PLUMBING INSULATION.
- I. Section 23 09 23, DIRECT DIGITAL CONTROLS FOR HVAC.
- J. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS

**1.3 QUALITY ASSURANCE**

- A. Products Criteria:
  - 1. Standard Products: Material and equipment shall be the standard products of a manufacturer regularly engaged in the manufacture of the products for at least 3 years. However, digital electronics devices, software and systems such as controls, instruments, computer work station, shall be the current generation of technology and basic design that has a proven satisfactory service record of at least three years.
  - 2. Equipment Service: There shall be permanent service organizations, authorized and trained by manufacturers of the equipment supplied, located within 160 km (100 miles) of the project. These organizations shall come to the site and provide acceptable service to restore operations within four hours of receipt of notification by phone, e-mail or fax in event of an emergency, such as the shut-

- down of equipment; or within 24 hours in a non-emergency. Names, mail and e-mail addresses and phone numbers of service organizations providing service under these conditions for (as applicable to the project): pumps, critical instrumentation, computer workstation and programming shall be submitted for project record and inserted into the operations and maintenance manual.
3. All items furnished shall be free from defects that would adversely affect the performance, maintainability and appearance of individual components and overall assembly.
  4. The products and execution of work specified in Division 22 shall conform to the referenced codes and standards as required by the specifications. Local codes and amendments enforced by the local code official shall be enforced, if required by local authorities such as the natural gas supplier. If the local codes are more stringent, then the local code shall apply. Any conflicts shall be brought to the attention of the Contracting Officers Representative (COR).
  5. Multiple Units: When two or more units of materials or equipment of the same type or class are required, these units shall be products of one manufacturer.
  6. Assembled Units: Manufacturers of equipment assemblies, which use components made by others, assume complete responsibility for the final assembled product.
  7. Nameplates: Nameplate bearing manufacturer's name or identifiable trademark shall be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.
  8. Asbestos products or equipment or materials containing asbestos shall not be used.
- B. Welding: Before any welding is performed, contractor shall submit a certificate certifying that welders comply with the following requirements:
1. Qualify welding processes and operators for piping according to ASME "Boiler and Pressure Vessel Code", Section IX, "Welding and Brazing Qualifications".
  2. Comply with provisions of ASME B31 series "Code for Pressure Piping".

3. Certify that each welder has passed American Welding Society (AWS) qualification tests for the welding processes involved, and that certification is current.
  4. All welds shall be stamped according to the provisions of the American Welding Society.
- C. Manufacturer's Recommendations: Where installation procedures or any part thereof are required to be in accordance with the recommendations of the manufacturer of the material being installed, printed copies of these recommendations shall be furnished to the COR prior to installation. Installation of the item will not be allowed to proceed until the recommendations are received. Failure to furnish these recommendations can be cause for rejection of the material.
- D. Execution (Installation, Construction) Quality:
1. All items shall be applied and installed in accordance with manufacturer's written instructions. Conflicts between the manufacturer's instructions and the contract drawings and specifications shall be referred to the COR for resolution. Written hard copies or computer files of manufacturer's installation instructions shall be provided to the COR at least two weeks prior to commencing installation of any item.
  2. Complete layout drawings shall be required by Paragraph, SUBMITTALS. Construction work shall not start on any system until the layout drawings have been approved.
- E. Guaranty: Warranty of Construction, FAR clause 52.246-21.
- F. Plumbing Systems: IPC, International Plumbing Code.

#### **1.4 SUBMITTALS**

- A. Submittals shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 05 11, COMMON WORK RESULTS FOR PLUMBING", with applicable paragraph identification.
- C. Contractor shall make all necessary field measurements and investigations to assure that the equipment and assemblies will meet contract requirements.
- D. If equipment is submitted which differs in arrangement from that shown, provide drawings that show the rearrangement of all associated systems. Approval will be given only if all features of the equipment and

associated systems, including accessibility, are equivalent to that required by the contract.

- E. Prior to submitting shop drawings for approval, contractor shall certify in writing that manufacturers of all major items of equipment have each reviewed drawings and specifications, and have jointly coordinated and properly integrated their equipment and controls to provide a complete and efficient installation.
- F. Upon request by Government, lists of previous installations for selected items of equipment shall be provided. Contact persons who will serve as references, with telephone numbers and e-mail addresses shall be submitted with the references.
- G. Manufacturer's Literature and Data: Manufacturer's literature shall be submitted under the pertinent section rather than under this section.
  - 1. Equipment and materials identification.
  - 2. Fire stopping materials.
  - 3. Hangers, inserts, supports and bracing. Provide load calculations for variable spring and constant support hangers.
  - 4. Wall, floor, and ceiling plates.
- H. Coordination Drawings: Complete consolidated and coordinated layout drawings shall be submitted for all new systems, and for existing systems that are in the same areas. The drawings shall include plan views, elevations and sections of all systems and shall be on a scale of not less than 1:32 (3/8-inch equal to one foot). Clearly identify and dimension the proposed locations of the principal items of equipment. The drawings shall clearly show the proposed location and adequate clearance for all equipment, piping, pumps, valves and other items. All valves, trap primer valves, water hammer arrestors, strainers, and equipment requiring service shall be provided with an access door sized for the complete removal of plumbing device, component, or equipment. Equipment foundations shall not be installed until equipment or piping until layout drawings have been approved. Detailed layout drawings shall be provided for all piping systems. In addition, details of the following shall be provided.
  - 1. Mechanical equipment rooms.
  - 2. Hangers, inserts, supports, and bracing.
  - 3. Pipe sleeves.
  - 4. Equipment penetrations of floors, walls, ceilings, or roofs.

I. Maintenance Data and Operating Instructions:

1. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Article, INSTRUCTIONS, for systems and equipment.
2. Listing of recommended replacement parts for keeping in stock supply, including sources of supply, for equipment shall be provided.

**1.5 DELIVERY, STORAGE AND HANDLING**

A. Protection of Equipment:

1. Equipment and material placed on the job site shall remain in the custody of the Contractor until phased acceptance, whether or not the Government has reimbursed the Contractor for the equipment and material. The Contractor is solely responsible for the protection of such equipment and material against any damage.
2. Damaged equipment shall be replaced with an identical unit as determined and directed by the COR. Such replacement shall be at no additional cost to the Government.
3. Interiors of new equipment and piping systems shall be protected against entry of foreign matter. Both inside and outside shall be cleaned before painting or placing equipment in operation.
4. Existing equipment and piping being worked on by the Contractor shall be under the custody and responsibility of the Contractor and shall be protected as required for new work.

B. Cleanliness of Piping and Equipment Systems:

1. Care shall be exercised in the storage and handling of equipment and piping material to be incorporated in the work. Debris arising from cutting, threading and welding of piping shall be removed.
2. Piping systems shall be flushed, blown or pigged as necessary to deliver clean systems.
3. The interior of all tanks shall be cleaned prior to delivery and beneficial use by the Government. All piping shall be tested in accordance with the specifications and the International Plumbing Code (IPC), latest edition. All filters, strainers, fixture faucets shall be flushed of debris prior to final acceptance.
4. Contractor shall be fully responsible for all costs, damage, and delay arising from failure to provide clean systems.

## **1.6 APPLICABLE PUBLICATIONS**

- A. The publications listed below shall form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):  
Boiler and Pressure Vessel Code (BPVC):  
SEC IX-2007.....Boiler and Pressure Vessel Code; Section IX,  
Welding and Brazing Qualifications.
- C. American Society for Testing and Materials (ASTM):  
A36/A36M-2008.....Standard Specification for Carbon Structural  
Steel  
A575-96 (R 2007).....Standard Specification for Steel Bars, Carbon,  
Merchant Quality, M-Grades R (2002)  
E84-2005.....Standard Test Method for Surface Burning  
Characteristics of Building Materials  
E119-2008a.....Standard Test Methods for Fire Tests of  
Building Construction and Materials
- D. Manufacturers Standardization Society (MSS) of the Valve and Fittings Industry, Inc:  
SP-58-02.....Pipe Hangers and Supports-Materials, Design and  
Manufacture  
SP 69-2003 (R 2004).....Pipe Hangers and Supports-Selection and  
Application
- E. National Electrical Manufacturers Association (NEMA):  
MG1-2003, Rev. 1-2007...Motors and Generators
- F..International Code Council, (ICC):  
IBC-12.....International Building Code  
IPC-12.....International Plumbing Code

## **PART 2 - PRODUCTS**

### **2.1 FACTORY-ASSEMBLED PRODUCTS**

- A. STANDARDIZATION OF COMPONENTS SHALL BE MAXIMIZED TO REDUCE SPARE PART requirements.
- B. Manufacturers of equipment assemblies that include components made by others shall assume complete responsibility for final assembled unit.
1. All components of an assembled unit need not be products of same manufacturer.



2. Constituent parts that are alike shall be products of a single manufacturer.
  3. Components shall be compatible with each other and with the total assembly for intended service.
  4. Contractor shall guarantee performance of assemblies of components, and shall repair or replace elements of the assemblies as required to deliver specified performance of the complete assembly.
- C. Components of equipment shall bear manufacturer's name and trademark, model number, serial number and performance data on a name plate securely affixed in a conspicuous place, or cast integral with, stamped or otherwise permanently marked upon the components of the equipment.
- D. Major items of equipment, which serve the same function, shall be the same make and model

## **2.2 COMPATIBILITY OF RELATED EQUIPMENT**

- A. Equipment and materials installed shall be compatible in all respects with other items being furnished and with existing items so that the result will be a complete and fully operational system that conforms to contract requirements.

## **2.7 EQUIPMENT AND MATERIALS IDENTIFICATION**

- A. Use symbols, nomenclature and equipment numbers specified, shown on the drawings, or shown in the maintenance manuals. Identification for piping is specified in Section 09 91 00, PAINTING.
- B. Interior (Indoor) Equipment: Engraved nameplates, with letters not less than 48 mm (3/16-inch) high of brass with black-filled letters, or rigid black plastic with white letters specified in Section 09 91 00, PAINTING shall be permanently fastened to the equipment. Unit components such as water heaters, tanks, coils, filters, etc. shall be identified.
- C. Control Items: All temperature, pressure, and controllers shall be labeled and the component's function identified. Identify and label each item as they appear on the control diagrams.
- D. Valve Tags and Lists:
1. Plumbing: All valves shall be provided with valve tags and listed on a valve list (Fixture stops not included).
  2. Valve tags: Engraved black filled numbers and letters not less than 13 mm (1/2-inch) high for number designation, and not less than 6.4 mm (1/4-inch) for service designation on 19 gage, 38 mm (1-1/2

inches) round brass disc, attached with brass "S" hook or brass chain.

3. Valve lists: Valve lists shall be created using a word processing program and printed on plastic coated cards. The plastic coated valve list card(s), sized 216 mm (8-1/2 inches) by 280 mm (11 inches) shall show valve tag number, valve function and area of control for each service or system. The valve list shall be in a punched 3-ring binder notebook. A copy of the valve list shall be mounted in picture frames for mounting to a wall.
4. A detailed plan for each floor of the building indicating the location and valve number for each valve shall be provided. Each valve location shall be identified with a color coded sticker or thumb tack in ceiling.

## **2.8 FIRE STOPPING**

- A. Section 07 84 00, FIRESTOPPING specifies an effective barrier against the spread of fire, smoke and gases where penetrations occur for piping. Refer to Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION, for pipe insulation.

## **2.9 GALVANIZED REPAIR COMPOUND**

- A. Mil. Spec. DOD-P-21035B, paint.

## **2.10 PIPE AND EQUIPMENT SUPPORTS AND RESTRAINTS**

- A. In lieu of the paragraph which follows, suspended equipment support and restraints may be designed and installed in accordance with the International Building Code (IBC), latest edition, and SECTION 13 05 41, SEISMIC RESTRAINT REQUIREMENTS FOR NON-STRUCTURAL COMPONENTS. Submittals based on the International Building Code (IBC), latest edition, SECTION 13 05 41 requirements, or the following paragraphs of this Section shall be stamped and signed by a professional engineer registered in a state where the project is located. The Support system of suspended equipment over 227 kg (500 pounds) shall be submitted for approval of the COR in all cases. See these specifications for lateral force design requirements.
- B. Type Numbers Specified: MSS SP-58. For selection and application refer to MSS SP-69. Refer to Section 05 50 00, METAL FABRICATIONS, for miscellaneous metal support materials and prime coat painting.
- C. For Attachment to Concrete Construction:
  1. Concrete insert: Type 18, MSS SP-58.

2. Self-drilling expansion shields and machine bolt expansion anchors:  
Permitted in concrete not less than 102 mm (4 inches) thick when approved by the COR for each job condition.
3. Power-driven fasteners: Permitted in existing concrete or masonry not less than 102 mm (4 inches) thick when approved by the COR for each job condition.
- D. For Attachment to Steel Construction: MSS SP-58.
  1. Welded attachment: Type 22.
  2. Beam clamps: Types 20, 21, 28 or 29. Type 23 C-clamp may be used for individual copper tubing up to 23 mm (7/8-inch) outside diameter.
- E. For Attachment to Wood Construction: Wood screws or lag bolts.
- F. Hanger Rods: Hot-rolled steel, ASTM A36 or A575 for allowable load listed in MSS SP-58. For piping, provide adjustment means for controlling level or slope. Types 13 or 15 turn-buckles shall provide 38 mm (1-1/2 inches) minimum of adjustment and incorporate locknuts. All-thread rods are acceptable.
- G. Multiple (Trapeze) Hangers: Galvanized, cold formed, lipped steel channel horizontal member, not less than 41 mm by 41 mm (1-5/8 inches by 1-5/8 inches), 2.7 mm (No. 12 gage), designed to accept special spring held, hardened steel nuts. Trapeze hangers are not permitted for steam supply and condensate piping.
  1. Allowable hanger load: Manufacturers rating less 91kg (200 pounds).
  2. Guide individual pipes on the horizontal member of every other trapeze hanger with 6 mm (1/4-inch) U-bolt fabricated from steel rod. Provide Type 40 insulation shield, secured by two 13 mm (1/2-inch) galvanized steel bands, or insulated calcium silicate shield for insulated piping at each hanger.
- H. Pipe Hangers and Supports: (MSS SP-58), use hangers sized to encircle insulation on insulated piping. Refer to Section 22 07 11, PLUMBING INSULATION for insulation thickness. To protect insulation, provide Type 39 saddles for roller type supports or insulated calcium silicate shields. Provide Type 40 insulation shield or insulated calcium silicate shield at all other types of supports and hangers including those for insulated piping.
  1. General Types (MSS SP-58):
    - a. Standard clevis hanger: Type 1; provide locknut.
    - b. Riser clamps: Type 8.

- c. Wall brackets: Types 31, 32 or 33.
  - d. Roller supports: Type 41, 43, 44 and 46.
  - e. Saddle support: Type 36, 37 or 38.
  - f. Turnbuckle: Types 13 or 15.
  - g. U-bolt clamp: Type 24.
  - h. Copper Tube:
    - 1) Hangers, clamps and other support material in contact with tubing shall be painted with copper colored epoxy paint, plastic coated or taped with isolation tape to prevent electrolysis.
    - 2) For vertical runs use epoxy painted or plastic coated riser clamps.
    - 3) For supporting tube to strut: Provide epoxy painted pipe straps for copper tube or plastic inserted vibration isolation clamps.
    - 4) Insulated Lines: Provide pre-insulated calcium silicate shields sized for copper tube.
  - i. Supports for plastic or glass piping: As recommended by the pipe manufacturer with black rubber tape extending one inch beyond steel support or clamp.
2. Plumbing Piping (Other Than General Types):
- a. Horizontal piping: Type 1, 5, 7, 9, and 10.
  - b. Chrome plated piping: Chrome plated supports.
  - c. Hangers and supports in pipe chase: Prefabricated system ABS self-extinguishing material, not subject to electrolytic action, to hold piping, prevent vibration and compensate for all static and operational conditions.
  - d. Blocking, stays and bracing: Angle iron or preformed metal channel shapes, 1.3 mm (18 gage) minimum.
- I. Pre-insulated Calcium Silicate Shields:
- 1. Provide 360 degree water resistant high density 965 kPa (140 psi) compressive strength calcium silicate shields encased in galvanized metal.
  - 2. Pre-insulated calcium silicate shields to be installed at the point of support during erection.
  - 3. Shield thickness shall match the pipe insulation.

4. The type of shield is selected by the temperature of the pipe, the load it must carry, and the type of support it will be used with.
  - a. Shields for supporting cold water shall have insulation that extends a minimum of one inch past the sheet metal.
  - b. The insulated calcium silicate shield shall support the maximum allowable water filled span as indicated in MSS-SP 69. To support the load, the shields shall have one or more of the following features: structural inserts 4138 kPa (600 psi) compressive strength, an extra bottom metal shield, or formed structural steel (ASTM A36) wear plates welded to the bottom sheet metal jacket.
5. Shields may be used on steel clevis hanger type supports, roller supports or flat surfaces.

## **2.11 PIPE PENETRATIONS**

- A. Pipe penetration sleeves shall be installed for all pipe other than rectangular blocked out floor openings for risers in mechanical bays.
- B. Pipe penetration sleeve materials shall comply with all fire stopping requirements for each penetration.
- C. To prevent accidental liquid spills from passing to a lower level, provide the following:
  1. For sleeves: Extend sleeve 25 mm (1 inch) above finished floor and provide sealant for watertight joint.
  2. For blocked out floor openings: Provide 40 mm (1-1/2 inch) angle set in silicone adhesive around opening.
  3. For drilled penetrations: Provide 40 mm (1-1/2 inch) angle ring or square set in silicone adhesive around penetration.
- D. Penetrations are not allowed through beams or ribs, but may be installed in concrete beam flanges. Any deviation from these requirements must receive prior approval of COR.
- E. Sheet metal, plastic, or moisture resistant fiber sleeves shall be provided for pipe passing through floors, interior walls, and partitions, unless brass or steel pipe sleeves are specifically called for below.
- F. Galvanized steel or an alternate black iron pipe with asphalt coating sleeves shall be for pipe passing through concrete beam flanges, except where brass pipe sleeves are called for. A galvanized steel Sleeve shall be provided for pipe passing through floor of mechanical rooms

above basement. Except in mechanical rooms, sleeves shall be connected with a floor plate.

- G. Brass Pipe Sleeves shall be provided for pipe passing through quarry tile, terrazzo or ceramic tile floors. The sleeve shall be connected with a floor plate.
- H. Sleeve clearance through floors, walls, partitions, and beam flanges shall be 25 mm (1 inch) greater in diameter than external diameter of pipe. Sleeve for pipe with insulation shall be large enough to accommodate the insulation plus 25 mm (1 inch) in diameter. Interior openings shall be caulked tight with fire stopping material and sealant to prevent the spread of fire, smoke, and gases.
- I. Sealant and Adhesives: Shall be as specified in Section 07 92 00, JOINT SEALANTS.

## **2.12 TOOLS AND LUBRICANTS**

- A. Furnish, and turn over to the COR, special tools not readily available commercially, that are required for disassembly or adjustment of equipment and machinery furnished.
- B. Tool Containers: metal, permanently identified for intended service and mounted, or located, where directed by the COR.

## **2.13 WALL, FLOOR AND CEILING PLATES**

- A. Material and Type: Chrome plated brass or chrome plated steel, one piece or split type with concealed hinge, with set screw for fastening to pipe, or sleeve. Use plates that fit tight around pipes, cover openings around pipes and cover the entire pipe sleeve projection.
- B. Thickness: Not less than 2.4 mm (3/32-inch) for floor plates. For wall and ceiling plates, not less than 0.64 mm (0.025-inch) for up to 80 mm (3 inch) pipe, 0.89 mm (0.035-inch) for larger pipe.
- C. Locations: Use where pipe penetrates floors, walls and ceilings in exposed locations, in finished areas only. Wall plates shall be used where insulation ends on exposed water supply pipe drop from overhead. A watertight joint shall be provided in spaces where brass or steel pipe sleeves are specified.

## **2.14 ASBESTOS**

Materials containing asbestos are not permitted.

### **PART 3 - EXECUTION**

#### **3.1 ARRANGEMENT AND INSTALLATION OF EQUIPMENT AND PIPING**

A. Location of piping, sleeves, inserts, hangers, and equipment, access provisions shall be coordinated with the work of all trades. Piping, sleeves, inserts, hangers, and equipment shall be located clear of windows, doors, openings, light outlets, and other services and utilities. Equipment layout drawings shall be prepared to coordinate proper location and personnel access of all facilities. The drawings shall be submitted for review.

Manufacturer's published recommendations shall be followed for installation methods not otherwise specified.

B. Operating Personnel Access and Observation Provisions: All equipment and systems shall be arranged to provide clear view and easy access, without use of portable ladders, for maintenance and operation of all devices including, but not limited to: all equipment items, valves, filters, strainers, transmitters, sensors, control devices. All gages and indicators shall be clearly visible by personnel standing on the floor or on permanent platforms. Maintenance and operating space and access provisions that are shown on the drawings shall not be changed nor reduced.

C. Structural systems necessary for pipe and equipment support shall be coordinated to permit proper installation.

D. Location of pipe sleeves, trenches and chases shall be accurately coordinated with equipment and piping locations.

E. Cutting Holes:

1. Holes through concrete and masonry shall be cut by rotary core drill. Pneumatic hammer, impact electric, and hand or manual hammer type drill will not be allowed, except as permitted by COR where working area space is limited.
2. Holes shall be located to avoid interference with structural members such as beams or grade beams. Holes shall be laid out in advance and drilling done only after approval by COR. If the Contractor considers it necessary to drill through structural members, this matter shall be referred to COR for approval.
3. Waterproof membrane shall not be penetrated. Pipe floor penetration block outs shall be provided outside the extents of the waterproof membrane.

- F. Interconnection of Instrumentation or Control Devices: Generally, electrical and pneumatic interconnections are not shown but must be provided.
- G. Minor Piping: Generally, small diameter pipe runs from drips and drains, water cooling, and other service are not shown but must be provided.
- H. Protection and Cleaning:
1. Equipment and materials shall be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations and as approved by the COR. Damaged or defective items in the opinion of the COR, shall be replaced.
  2. Close pipe openings with caps or plugs during installation. Pipe openings, equipment, and plumbing fixtures shall be tightly covered against dirt or mechanical injury. At completion of all work thoroughly clean fixtures, exposed materials and equipment.
- I. Concrete and Grout: Concrete and shrink compensating grout 25 MPa (3000 psi) minimum. Gages, thermometers, valves and other devices shall be installed with due regard for ease in reading or operating and maintaining said devices. Thermometers and gages shall be located and positioned to be easily read by operator or staff standing on floor or walkway provided. Servicing shall not require dismantling adjacent equipment or pipe work.
- J. Interconnection of Controls and Instruments: Electrical interconnection is generally not shown but shall be provided. This includes interconnections of sensors, transmitters, transducers, control devices, control and instrumentation panels, instruments and computer workstations. Comply with NFPA-70.
- K. Many plumbing systems interface with the HVAC control system. See the HVAC control points list and section 23 09 23 DIRECT DIGITAL CONTROLS FOR HVAC
- L. Work in Existing Building:
1. Perform as specified in Article, OPERATIONS AND STORAGE AREAS, Article, ALTERATIONS, and Article, RESTORATION of the Section 01 00 00, GENERAL REQUIREMENTS for relocation of existing equipment, alterations and restoration of existing building(s).



2. As specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, OPERATIONS AND STORAGE AREAS, make alterations to existing service piping at times that will cause the least interfere with normal operation of the facility.
- M. Work in bathrooms, restrooms, housekeeping closets: All pipe penetrations behind escutcheons shall be sealed with plumbers putty.
- N. Switchgear Drip Protection: Every effort shall be made to eliminate the installation of pipe above electrical and telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints.
- O. Inaccessible Equipment:
  1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, equipment shall be removed and reinstalled or remedial action performed as directed at no additional cost to the Government.
  2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as electrical conduit, motors, fans, pumps, belt guards, transformers, high voltage lines, piping, and ductwork.

### **3.2 TEMPORARY PIPING AND EQUIPMENT**

- A. Continuity of operation of existing facilities may require temporary installation or relocation of equipment and piping. Temporary equipment or pipe installation or relocation shall be provided to maintain continuity of operation of existing facilities.
- B. The Contractor shall provide all required facilities in accordance with the requirements of phased construction and maintenance of service. All piping and equipment shall be properly supported, sloped to drain, operate without excessive stress, and shall be insulated where injury can occur to personnel by contact with operating facilities. The requirements of Para. 3.1 shall apply.
- C. Temporary facilities and piping shall be completely removed and any openings in structures sealed. Necessary blind flanges and caps shall be provided to seal open piping remaining in service.

### **3.3 RIGGING**

- A. Openings in building structures shall be planned to accommodate design scheme.

- B. Alternative methods of equipment delivery may be offered and will be considered by Government under specified restrictions of phasing and service requirements as well as structural integrity of the building.
- C. All openings in the building shall be closed when not required for rigging operations to maintain proper environment in the facility for Government operation and maintenance of service.
- D. Contractor shall provide all facilities required to deliver specified equipment and place on foundations. Attachments to structures for rigging purposes and support of equipment on structures shall be Contractor's full responsibility.
- E. Contractor shall check all clearances, weight limitations and shall provide a rigging plan designed by a Registered Professional Engineer. All modifications to structures, including reinforcement thereof, shall be at Contractor's cost, time and responsibility.
- F. Rigging plan and methods shall be referred to COR for evaluation prior to actual work.

#### **3.4 PIPE AND EQUIPMENT SUPPORTS**

- A. Where hanger spacing does not correspond with joist or rib spacing, use structural steel channels secured directly to joist and rib structure that will correspond to the required hanger spacing, and then suspend the equipment and piping from the channels. Holes shall be drilled or burned in structural steel ONLY with the prior written approval of the COR.
- B. The use of chain pipe supports, wire or strap hangers; wood for blocking, stays and bracing, or hangers suspended from piping above shall not be permitted. Rusty products shall be replaced.
- C. Hanger rods shall be used that are straight and vertical. Turnbuckles for vertical adjustments may be omitted where limited space prevents use. A minimum of 15 mm (1/2-inch) clearance between pipe or piping covering and adjacent work shall be provided.
- D. For horizontal and vertical plumbing pipe supports, refer to the International Plumbing Code (IPC), latest edition, and these specifications.
- E. Overhead Supports:
  - 1. The basic structural system of the building is designed to sustain the loads imposed by equipment and piping to be supported overhead.

2. Provide steel structural members, in addition to those shown, of adequate capability to support the imposed loads, located in accordance with the final approved layout of equipment and piping.
3. Tubing and capillary systems shall be supported in channel troughs.

F. Floor Supports:

1. Provide concrete bases, concrete anchor blocks and pedestals, and structural steel systems for support of equipment and piping. Concrete bases and structural systems shall be anchored and doweled to resist forces under operating and seismic conditions (if applicable) without excessive displacement or structural failure.
2. Bases and supports shall not be located and installed until equipment mounted thereon has been approved. Bases shall be sized to match equipment mounted thereon plus 50 mm (2 inch) excess on all edges. Structural drawings shall be reviewed for additional requirements. Bases shall be neatly finished and smoothed, shall have chamfered edges at the top, and shall be suitable for painting.
3. All equipment shall be shimmed, leveled, firmly anchored, and grouted with epoxy grout. Anchor bolts shall be placed in sleeves, anchored to the bases. Fill the annular space between sleeves and bolts with a grout material to permit alignment and realignment.

**3.6 PLUMBING SYSTEMS DEMOLITION**

- A. Rigging access, other than indicated on the drawings, shall be provided after approval for structural integrity by the COR. Such access shall be provided without additional cost or time to the Government. Where work is in an operating plant, approved protection from dust and debris shall be provided at all times for the safety of plant personnel and maintenance of plant operation and environment of the plant.
- B. In an operating plant, cleanliness and safety shall be maintained. The plant shall be kept in an operating condition. Government personnel will be carrying on their normal duties of operating, cleaning and maintaining equipment and plant operation. Work shall be confined to the immediate area concerned; maintain cleanliness and wet down demolished materials to eliminate dust. Dust and debris shall not be permitted to accumulate in the area to the detriment of plant operation. All flame cutting shall be performed to maintain the fire safety integrity of this plant. Adequate fire extinguishing facilities shall be available at all times. All work shall be performed in

accordance with recognized fire protection standards. Inspections will be made by personnel of the VA Medical Center, and the Contractor shall follow all directives of the COR with regard to rigging, safety, fire safety, and maintenance of operations.

- C. Unless specified otherwise, all piping, wiring, conduit, and other devices associated with the equipment not re-used in the new work shall be completely removed from Government property. This includes all concrete equipment pads, pipe, valves, fittings, insulation, and all hangers including the top connection and any fastenings to building structural systems. All openings shall be sealed after removal of equipment, pipes, ducts, and other penetrations in roof, walls, floors, in an approved manner and in accordance with plans and specifications where specifically covered. Structural integrity of the building system shall be maintained. Reference shall also be made to the drawings and specifications of the other disciplines in the project for additional facilities to be demolished or handled.
- D. All valves including gate, globe, ball, butterfly and check, all pressure gages and thermometers with wells shall remain Government property and shall be removed and delivered to COR and stored as directed. The Contractor shall remove all other material and equipment, devices and demolition debris under these plans and specifications. Such material shall be removed from Government property expeditiously and shall not be allowed to accumulate.

### **3.7 CLEANING AND PAINTING**

- A. Prior to final inspection and acceptance of the plant and facilities for beneficial use by the Government, the plant facilities, equipment and systems shall be thoroughly cleaned and painted. Refer to Section 09 91 00, PAINTING.
- B. In addition, the following special conditions apply:
  - 1. Cleaning shall be thorough. Solvents, cleaning materials and methods recommended by the manufacturers shall be used for the specific tasks. All rust shall be removed prior to painting and from surfaces to remain unpainted. Scratches, scuffs, and abrasions shall be repaired prior to applying prime and finish coats.
  - 2. The following Material And Equipment shall NOT be painted::
    - a. Motors, controllers, control switches, and safety switches.
    - b. Control and interlock devices.

- c. Regulators.
  - d. Pressure reducing valves.
  - e. Control valves and thermostatic elements.
  - f. Lubrication devices and grease fittings.
  - g. Copper, brass, aluminum, stainless steel and bronze surfaces.
  - h. Valve stems and rotating shafts.
  - i. Pressure gages and thermometers.
  - j. Glass.
  - k. Name plates.
- 3. Control and instrument panels shall be cleaned and damaged surfaces repaired. Touch-up painting shall be made with matching paint obtained from manufacturer or computer matched.
  - 4. Temporary Facilities: Apply paint to surfaces that do not have existing finish coats.
  - 5. The final result shall be a smooth, even-colored, even-textured factory finish on all items. The entire piece of equipment shall be repainted, if necessary, to achieve this.

### **3.8 IDENTIFICATION SIGNS**

- A. Laminated plastic signs, with engraved lettering not less than 5 mm (3/16-inch) high, shall be provided that designates equipment function, for all equipment, switches, motor controllers, relays, meters, control devices, including automatic control valves. Nomenclature and identification symbols shall correspond to that used in maintenance manual, and in diagrams specified elsewhere. Attach by chain, adhesive, or screws.
- B. Factory Built Equipment: Metal plate, securely attached, with name and address of manufacturer, serial number, model number, size, performance shall be placed on factory built equipment.
- C. Pipe Identification: Refer to Section 09 91 00, PAINTING.

### **3.9 STARTUP AND TEMPORARY OPERATION**

- A. Start up of equipment shall be performed as described in the equipment specifications. Vibration within specified tolerance shall be verified prior to extended operation. Temporary use of equipment is specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT.

### **3.10 OPERATING AND PERFORMANCE TESTS**

- A. Prior to the final inspection, all required tests shall be performed as specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TESTS and submit the test reports and records to the COR .
- B. Should evidence of malfunction in any tested system, or piece of equipment or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost to the Government.
- C. When completion of certain work or system occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then make performance tests such systems respectively during first actual seasonal use of respective systems following completion of work.

### **3.11 OPERATION AND MAINTENANCE MANUALS**

- A. Provide four bound copies. The Operations and maintenance manuals shall be delivered to COR not less than 30 days prior to completion of a phase or final inspection.
- B. All new and temporary equipment and all elements of each assembly shall be included.
- C. Data sheet on each device listing model, size, capacity, pressure, speed, horsepower, impeller size, and other information shall be included.
- D. Manufacturer's installation, maintenance, repair, and operation instructions for each device shall be included. Assembly drawings and parts lists shall also be included. A summary of operating precautions and reasons for precautions shall be included in the Operations and Maintenance Manual.
- E. Lubrication instructions, type and quantity of lubricant shall be included.
- F. Schematic diagrams and wiring diagrams of all control systems corrected to include all field modifications shall be included.
- G. Set points of all interlock devices shall be listed.
- H. Trouble-shooting guide for the control system troubleshooting guide shall be inserted into the Operations and Maintenance Manual.
- I. The combustion control system sequence of operation corrected with submittal review comments shall be inserted into the Operations and Maintenance Manual.

J. Emergency procedures.

**3.12 INSTRUCTIONS TO VA PERSONNEL**

Instructions shall be provided in accordance with Article,  
INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.

- - - E N D - - -





**SECTION 22 05 19**  
**METERS AND GAGES FOR PLUMBING PIPING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

This section describes the requirements for pressure gages.

**1.2 RELATED WORK**

Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

**1.3 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
  - 1. Pressure Gages.
  - 2. Product certificates for each type of meter and gauge
- C. Operations and Maintenance manual shall include:
  - 1. System Description
  - 2. Major assembly block diagrams
  - 3. Troubleshooting and preventive maintenance guidelines
  - 4. Spare parts information.
- D. Shop Drawings shall include the following:
  - 1. One line, wiring and terminal diagrams including terminals identified, protocol or communication modules, and Ethernet connections.

**1.4 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standards Institute (ANSI):
  - American Society of Mechanical Engineers (ASME): (Copyrighted Society)
  - B40.1-05.....Gauges-Pressure Indicating Dial Type-Elastic
- C. International Code Council (ICC):
  - IPC-12.....International Plumbing Code

**1.5 AS-BUILT DOCUMENTATION**

- A. The electronic documentation and copies of the Operations and Maintenance Manual, approved submittals, shop drawings, and other closeout documentation shall be prepared by a computer software program complying with Section 508 of the Rehabilitation Act of 1973, as

amended (29 U.S.C 794d). The manufacturer or vendor of the software used to prepare the electronic documentation shall have a Voluntary Product Accessibility Template made available for review and included as part of the Operations and Maintenance Manual or closeout documentation. All available accessibility functions listed in the Voluntary Accessibility Template shall be enabled in the prepared electronic files. As Adobe Acrobat is a common industry format for such documentation, following the document, "Creating Accessible Adobe PDF files, A Guide for Document Authors" that is maintained and made available by Adobe free of charge is recommended."

- B. Four sets of manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.
- C. Four sets of operation and maintenance data updated to include submittal review comments shall be inserted into a three ring binder. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices such as damper and door closure interlocks shall be included. A List of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.

## **PART 2 - PRODUCTS**

### **2.1 PRESSURE GAGES FOR WATER AND SEWAGE USAGE**

- A. ANSI B40.1 all metal case 114 mm (4-1/2 inches) diameter, bottom connected throughout, graduated as required for service, and identity labeled. Range shall be 0 to 1375 kPa (0 to 200 psi) gauge.
- B. The pressure element assembly shall be bourdon tube. The mechanical movement shall be lined to pressure element and connected to pointer.
- C. The dial shall be non-reflective aluminum with permanently etched scale markings graduated in kPa and psi.
- D. The pointer shall be dark colored metal.
- E. The window shall be glass.
- F. The ring shall be brass or stainless steel.

- G. The accuracy shall be grade A, plus or minus 1 percent of middle half of scale range.

**PART 3 - EXECUTION**

**3.1 INSTALLATION**

- A. Direct mounted pressure gages shall be installed in piping tees with pressure gage located on pipe at the most readable position.
- B. Valves and snubbers shall be installed in piping for each pressure gage.
- C. Test plugs shall be installed on the inlet and outlet pipes all heat exchangers or water heaters serving more than one plumbing fixture.
- D. Pressure gages shall be installed where indicated on the drawings and at the following locations:
  - 1. Inlet and outlet of each pressure reducing valve
  - 2. Suction and discharge of each domestic water pump or re-circulating hot water return pump.

- - - E N D - - -



**SECTION 22 05 23**  
**GENERAL-DUTY VALVES FOR PLUMBING PIPING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section describes the requirements for general-duty valves for domestic water and sewer systems.

**1.2 RELATED WORK**

- A. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

**1.3 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
1. Valves.
  2. Backflow Preventers.
  3. Pressure Reducing Valves.
  4. All items listed in Part 2 - Products.

**1.4 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):A536-84(R 2004)  
Standard Specification for Ductile Iron Castings
- C. American Society of Sanitary Engineering (ASSE)  
ASSE 1003-01 (R 2003)...Performance Requirements for Water Pressure Reducing Valves  
ASSE 1012-02.....Backflow Preventer with Intermediate Atmospheric Vent  
ASSE 1013-05.....Reduced Pressure Principle Backflow Preventers and Reduced Pressure Fire Protection Principle Backflow Preventers
- D. International Code Council (ICC)  
IPC-12.....International Plumbing Code
- E. Manufacturers Standardization Society of the Valve and Fittings Industry, Inc. (MSS):  
SP-25-98.....Standard Marking System for Valves, Fittings, Flanges and Unions  
SP-67-02a (R 2004) Butterfly Valve of the Single flange Type (Lug Wafer)

SP-70-06.....Cast Iron Gate Valves, Flanged and Threaded  
Ends.

SP-72-99.....Ball Valves With Flanged or Butt Welding For  
General Purpose

SP-80-03.....Bronze Gate, Globe, Angle and Check Valves.

SP-110-96.....Ball Valve Threaded, Socket Welding, Solder  
Joint, Grooved and Flared Ends

### **1.5 DELIVERY, STORAGE, AND HANDLING**

A. Valves shall be prepared for shipping as follows:

1. Protect internal parts against rust and corrosion.
2. Protect threads, flange faces, grooves, and weld ends.
3. Set angle, gate, and globe valves closed to prevent rattling.
4. Set ball and plug valves open to minimize exposure of functional surfaces
5. Set butterfly valves closed or slightly open.
6. Block check valves in either closed or open position.

B. Valves shall be prepared for storage as follows:

1. Maintain valve end protection.
2. Store valves indoors and maintain at higher than ambient dew point temperature.

C. A sling shall be used for large valves. The sling shall be rigged to avoid damage to exposed parts. Hand wheels or stems shall not be used as lifting or rigging points.

## **PART 2 - PRODUCTS**

### **2.1 VALVES**

- A. Asbestos packing and gaskets are prohibited.
- B. Bronze valves shall be made with dezincification resistant materials. Bronze valves made with copper alloy (brass) containing more than 15 percent zinc shall not be permitted.
- C. Valves in insulated piping shall have 50 mm or DN50 (2 inch) stem extensions and extended handles of non-thermal conductive material that allows operating the valve without breaking the vapor seal or disturbing the insulation. Memory stops shall be fully adjustable after insulation is applied.
- D. Ball valves, pressure regulating valves, gate valves, globe valves, and plug valves used to supply potable water shall meet the requirements of NSF 61.
- E. Shut-off:

1. Cold, Hot and Re-circulating Hot Water:

- a. 50 mm or DN50 (2 inches) and smaller: Ball, MSS SP-72, SP-110, Ball valve shall be full port three piece or two piece with a union design with adjustable stem package. Threaded stem designs are not allowed. The ball valve shall have a SWP rating of 1035 kPa (150 psig) and a CWP rating of 4140 kPa (600 psig). The body material shall be Bronze ASTM B584, Alloy C844. The ends shall be solder,
- b. Less than 100 mm DN100 (4 inches): Butterfly shall have an iron body with EPDM seal and aluminum bronze disc. Butterfly valve shall meet MSS SP-67, type I standard. Butterfly valve shall have a SWP rating of 1380 kPa (200 psig). Valve design shall be lug type suitable for bidirectional dead-end service at rated pressure. Body material shall meet ASTM A 536, ductile iron.

F. Balancing:

1. Hot Water Re-circulating, 80 mm or DN80 (3 inches) and smaller manual balancing valve shall be of bronze body, brass ball construction with glass and carbon filled TFE seat rings and designed for positive shutoff. The manual balancing valve shall have differential pressure read-out ports across the valve seat area. The read out ports shall be fitting with internal EPT inserts and check valves. The valve body shall have 8 mm or DN8 NPT (¼" NPT) tapped drain and purge port. The valves shall have memory stops that allow the valve to close for service and then reopened to set point without disturbing the balance position. All valves shall have calibrated nameplates to assure specific valve settings.

G. Check:

1. Check valves less than 80 mm or DN80 (3 inches) and smaller) shall be class 125, bronze swing check valves with non metallic Buna-N disc. The check valve shall meet MSS SP-80 Type 4 standard. The check valve shall have a CWP rating of 1380 kPa (200 psig). The check valve shall have a Y pattern horizontal body design with bronze body material conforming to ASTM B 62, solder joints, and PTFE or TFE disc.

H. Globe:

1. 80 mm or DN80 (3 inches) or smaller: Class 150, bronze globe valve with non metallic disc. The globe valve shall meet MSS SP-80, Type 2 standard. The globe valve shall have a CWP rating of 2070 kPa

(300 psig). The valve material shall be bronze with integral seal and union ring bonnet conforming to ASTM B 62 with solder ends, copper-silicon bronze stem, TPFPE or TFE disc, malleable iron hand wheel.

## **2.2 WATER PRESSURE REDUCING VALVE AND CONNECTIONS**

- A. 80 mm or DN80 (3 inches) or smaller: The pressure reducing valve shall consist of a bronze body and bell housing, a separate access cover for the plunger, and a bolt to adjust the downstream pressure. The bronze bell housing and access cap shall be threaded to the body and shall not require the use of ferrous screws. The assembly shall be of the balanced piston design and shall reduce pressure in both flow and no flow conditions. The assembly shall be accessible for maintenance without having to remove the body from the line.
- B. The regulator shall have a tap for pressure gauge.
- C. The regulator shall have a temperature rating of 100° C (210° F) for hot water or hot water return service. Pressure regulators shall have accurate pressure regulation to 6.9-kPa (+/- 1 psig).
- D. Setting: Entering water pressure, discharge pressure, capacity, size, and related measurements shall be as shown on the drawings.
- E. Connections Valves and Strainers: shut off valves shall be installed on each side of reducing valve and a bypass line equal in size to the regulator inlet pipe shall be installed with a normally closed globe valve. A strainer shall be installed on inlet side of, and same size as pressure reducing valve. A pressure gage shall be installed on the low pressure side of the line.

## **2.4 BACKFLOW PREVENTERS**

- A. A backflow prevention assembly shall be installed at any point in the plumbing system where the potable water supply comes in contact with a potential source of contamination. The backflow prevention assembly shall be ASSE 1013 listed and certified.
- B. Reduced pressure backflow preventers shall be installed in the following applications.
  - 1. Sterilizers.
  - 2. Water make up to heating systems, cooling tower, chilled water system, generators, and similar equipment consuming water.
- C. Atmospheric Vacuum Breaker: ASSE 1001, shall be installed in the following applications.
  - 1. Hose bibs and sinks w/threaded outlets.



2. Showers (telephone type).
  3. Film processor.
- D. The reduced pressure principle backflow prevention assembly shall be ASSE listed 1013 with full port OS&Y gate valves and an integral relief monitor switch. The main body and access cover shall be epoxy coated duct iron conforming to ASTM A536 grade 4. The seat ring and check valve shall be Noryl (NSF listed). The stem shall be stainless steel conforming to ASTM A276. The seat disc elastomer shall be EPDM. The checks and the relief valve shall be accessible for maintenance without removing the device from the line. An epoxy coated wye type strainer with flanged connections shall be installed on the inlet.
- E. The atmospheric vacuum breaker shall be ASSE listed 1001. The main body shall be either cast bronze. All internal polymers shall be NSF listed. The seat disc elastomer shall be silicone. The device shall be accessible for maintenance without removing the device from the service line. The installation shall not be in a concealed or inaccessible location or where the venting of water from the device during normal operation is deemed objectionable.
- F. The double check detector backflow prevention assembly shall be ASSE listed 1048 and supply with full port OS&Y gate valves. The main body and access cover shall be epoxy coated ductile iron conforming to ASTM A536 grade. Seat ring and check valve shall be Noryl (NSF listed). The stem shall be stainless steel conforming to ASTM A 276. The seat disc elastomers shall be EPDM. The first and second check valve shall be accessible for maintenance without removing the device from the line.

### **PART 3 - EXECUTION**

#### **3.1 EXAMINATION**

- A. Valve interior shall be examined for cleanliness, freedom from foreign matter, and corrosion. Special packing materials shall be removed, such as blocks, used to prevent disc movement during shipping and handling.
- B. Valves shall be operated in positions from fully open to fully closed. Guides and seats shall be examined and made accessible by such operations.
- C. Threads on valve and mating pipe shall be examined for form and cleanliness.
- D. Mating flange faces shall be examined for conditions that might cause leakage. Bolting shall be checked for proper size, length, and

material. Gaskets shall be verified for proper size and that its material composition is suitable for service and free from defects and damage.

E. Do not attempt to repair defective valves; replace with new valves.

### **3.2 VALVE INSTALLATION**

- A. Install valves with unions or flanges at each piece of equipment arranged to allow service, maintenance, and equipment removal without system shutdown.
- B. Valves shall be located for easy access and shall be provide with separate support. Valves shall be accessible with access doors when installed inside partitions or above hard ceilings.
- C. Valves shall be installed in horizontal piping with stem at or above center of pipe
- D. Valves shall be installed in a position to allow full stem movement.
- E. Check valves shall be installed for proper direction of flow and as follows:
  - 1. Swing Check Valves: In horizontal position with hinge pin level.

### **3.3 ADJUSTING**

- A. Valve packing shall be adjusted or replaced after piping systems have been tested and put into service but before final adjusting and balancing. Replace valves shall be replaced if persistent leaking occurs.

- - E N D - - -

**SECTION 22 07 11**  
**PLUMBING INSULATION**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Field applied insulation for thermal efficiency and condensation control for:
  - 1. Plumbing piping and equipment.
- B. Definitions
  - 1. ASJ: All service jacket, white finish facing or jacket.
  - 2. Air conditioned space: Space having air temperature and/or humidity controlled by mechanical equipment.
  - 3. Cold: Equipment or piping handling media at design temperature of 16 degrees C (60 degrees F) or below.
  - 4. Concealed: Piping above ceilings and in chases, and pipe spaces.
  - 5. Exposed: Piping and equipment exposed to view in finished areas including mechanical equipment rooms or exposed to outdoor weather. Shafts and chases are not considered finished areas.
  - 6. Hot: Plumbing equipment or piping handling media above 41 degrees C (105 degrees F).
  - 7. Density:  $\text{kg/m}^3$  - kilograms per cubic meter (Pcf - pounds per cubic foot).
  - 8. Thermal conductance: Heat flow rate through materials.
    - a. Flat surface: Watts per square meter (BTU per hour per square foot).
    - b. Pipe or Cylinder: Watts per square meter (BTU per hour per linear foot).
  - 9. Thermal Conductivity (k): Watt per meter, per degree C (BTU per inch thickness, per hour, per square foot, per degree F temperature difference).
  - 10. Vapor Retarder (Vapor Barrier): A material which retards the transmission (migration) of water vapor. Performance of the vapor retarder is rated in terms of permeance (perms). For the purpose of this specification, vapor retarders shall have a maximum published permeance of 0.1 perms and vapor barriers shall have a maximum published permeance of 0.001 perms.
  - 11. R: Pump recirculation.
  - 12. CW: Cold water.

13. HW: Hot water.

14. PVDC: Polyvinylidene chloride vapor retarder jacketing, white.

## **1.2 RELATED WORK**

- A. Section 07 84 00, FIRESTOPPING: Mineral fiber and bond breaker behind sealant.
- B. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: General mechanical requirements and items, which are common to more than one section of Division 22.
- C. Section 22 05 19, METERS AND GAGES FOR PLUMBING PIPING and Section 22 05 23, GENERAL-DUTY VALVES FOR PLUMBING PIPING: Hot and cold water piping.
- D. Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS. Requirements for commissioning, systems readiness checklists, and training.

## **1.3 QUALITY ASSURANCE**

- A. Refer to article QUALITY ASSURANCE, in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- B. Criteria:
  - 1. Comply with NFPA 90A, particularly paragraphs 4.3.3.1 through 4.3.3.6, 4.3.10.2.6, and 5.4.6.4, parts of which are quoted as follows:
    - 4.3.3.1** Pipe insulation and coverings, vapor retarder facings, adhesives, fasteners, tapes, unless otherwise provided for in 4.3.3.1.12 or 4.3.3.1.2, shall have, in the form in which they are used, a maximum flame spread index of 25 without evidence of continued progressive combustion and a maximum smoke developed index of 50 when tested in accordance with NFPA 255, Standard Method of Test of Surface Burning Characteristics of Building Materials.
    - 4.3.3.1.1** Where these products are to be applied with adhesives, they shall be tested with such adhesives applied, or the adhesives used shall have a maximum flame spread index of 25 and a maximum smoke developed index of 50 when in the final dry state. (See 4.2.4.2.)
    - 4.3.3.3** Pipe insulation and coverings shall not flame, glow, smolder, or smoke when tested in accordance with a similar test for pipe covering, ASTM C 411, Standard Test Method for Hot-Surface Performance of High-Temperature Thermal Insulation, at the temperature to which they are exposed in service.
    - 4.3.3.3.1** In no case shall the test temperature be below 121°C (250°F).
    - 4.3.10.2.6.3** Nonferrous fire sprinkler piping shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread

distance of 1.5 m (5 ft) or less when tested in accordance with UL 1887, Standard for Safety Fire Test of Plastic Sprinkler Pipe for Visible Flame and Smoke Characteristics.

4.3.10.2.6.7 Smoke detectors shall not be required to meet the provisions of this section.

2. Test methods: ASTM E84, UL 723, or NFPA 255.

3. Specified k factors are at 24 degrees C (75 degrees F) mean temperature unless stated otherwise. Where optional thermal insulation material is used, select thickness to provide thermal conductance no greater than that for specified material. For pipe, use insulation manufacturer's published heat flow tables. For domestic hot water supply and return, run out insulation and condensation control insulation, no thickness adjustment need be made.

4. All materials shall be compatible and suitable for service temperature, and shall not contribute to corrosion or otherwise attack surface to which applied in either the wet or dry state.

C. Every package or standard container of insulation or accessories delivered to the job site for use must have a manufacturer's stamp or label giving the name of the manufacturer and description of the material.

#### **1.4 SUBMITTALS**

A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

B. Shop Drawings:

1. All information, clearly presented, shall be included to determine compliance with drawings and specifications and ASTM, federal and military specifications.

a. Insulation materials: Specify each type used and state surface burning characteristics.

b. Insulation facings and jackets: Each type used.

c. Insulation accessory materials: Each type used.

d. Manufacturer's installation and fitting fabrication instructions for flexible unicellular insulation.

e. Make reference to applicable specification paragraph numbers for coordination.

C. Samples:

1. Each type of insulation: Minimum size 100 mm (4 inches) square for board/block/blanket; 150 mm (6 inches) long, full diameter for round types.
2. Each type of facing and jacket: Minimum size 100 mm (4 inches square).
3. Each accessory material: Minimum 120 ML (4 ounce) liquid container or 120 gram (4 ounce) dry weight for adhesives / cement / mastic.

#### **1.5 STORAGE AND HANDLING OF MATERIAL**

Store materials in clean and dry environment, pipe covering jackets shall be clean and unmarred. Place adhesives in original containers. Maintain ambient temperatures and conditions as required by printed instructions of manufacturers of adhesives, mastics and finishing cements.

#### **1.6 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only.
- B. Federal Specifications (Fed. Spec.):  
L-P-535E (2)-91.....Plastic Sheet (Sheeting): Plastic Strip; Poly (Vinyl Chloride) and Poly (Vinyl Chloride - Vinyl Acetate), Rigid.
- C. American Society for Testing and Materials (ASTM):  
A167-04 .....Standard Specification for Stainless and Heat-Resisting Chromium-Nickel Steel Plate, Sheet, and Strip  
B209-07.....Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate  
C411-05.....Standard test method for Hot-Surface Performance of High-Temperature Thermal Insulation  
C449-07.....Standard Specification for Mineral Fiber Hydraulic-Setting Thermal Insulating and Finishing Cement  
C547-07 .....Standard Specification for Mineral Fiber pipe Insulation  
C552-07 .....Standard Specification for Cellular Glass Thermal Insulation

- C553-08 .....Standard Specification for Mineral Fiber  
Blanket Thermal Insulation for Commercial and  
Industrial Applications
- C585-09.....Standard Practice for Inner and Outer Diameters  
of Rigid Thermal Insulation for Nominal Sizes  
of Pipe and Tubing (NPS System) R (1998)
- C612-10 .....Standard Specification for Mineral Fiber Block  
and Board Thermal Insulation
- C1126-10.....Standard Specification for Faced or Unfaced  
Rigid Cellular Phenolic Thermal Insulation
- C1136-10 .....Standard Specification for Flexible, Low  
Permeance Vapor Retarders for Thermal  
Insulation
- D1668-97a (2006).....Standard Specification for Glass Fabrics (Woven  
and Treated) for Roofing and Waterproofing
- E84-10 .....Standard Test Method for Surface Burning  
Characteristics of Building  
Materials
- E119-09C.....Standard Test Method for Fire Tests of Building  
Construction and Materials
- E136-09 b.....Standard Test Methods for Behavior of Materials  
in a Vertical Tube Furnace at 750 degrees C  
(1380 F)
- D. National Fire Protection Association (NFPA):
- 101-12 .....Life Safety Code
- 251-06.....Standard methods of Tests of Fire Endurance of  
Building Construction Materials
- 255-06.....Standard Method of tests of Surface Burning  
Characteristics of Building Materials
- E. Underwriters Laboratories, Inc (UL):
- 723.....UL Standard for Safety Test for Surface Burning  
Characteristics of Building Materials with  
Revision of 08/03
- F. Manufacturer's Standardization Society of the Valve and Fitting  
Industry (MSS):
- SP58-2002.....Pipe Hangers and Supports Materials, Design,  
and Manufacture

## **PART 2 - PRODUCTS**

### **2.1 MINERAL FIBER OR FIBER GLASS**

- A. ASTM C547 (Pipe Fitting Insulation and Preformed Pipe Insulation), Class 1,  $k = 0.037$  (0.26) at 24 degrees C (75 degrees F), for use at temperatures up to 230 degrees C (450 degrees F) with an all service vapor retarder jacket with polyvinyl chloride premolded fitting covering.

### **2.2 MINERAL WOOL OR REFRACTORY FIBER**

- A. Comply with Standard ASTM C612, Class 3, 450 degrees C (850 degrees F).

### **2.3 RIGID CELLULAR PHENOLIC FOAM**

- A. Preformed (molded) pipe insulation, ASTM C1126, type III, grade 1,  $k = 0.021$  (0.15) at 10 degrees C (50 degrees F), for use at temperatures up to 121 degrees C (250 degrees F) with vapor retarder and all service vapor retarder jacket with polyvinyl chloride premolded fitting covering.
- B. Equipment Insulation, ASTM C 1126, type II, grade 1,  $k = 0.021$  (0.15) at 10 degrees C (50 degrees F), for use at temperatures up to 121 degrees C (250 degrees F) with rigid cellular phenolic insulation and covering, and all service vapor retarder jacket.

### **2.4 CELLULAR GLASS CLOSED-CELL**

- A. Comply with Standard ASTM C177, C518, density 120 kg/m<sup>3</sup> (7.5 pcf) nominal,  $k = 0.033$  (0.29) at 24~~0~~ degrees C (75 degrees F).
- B. Pipe insulation for use at temperatures up to 200 degrees C (400 degrees F) with all service vapor retarder jacket.

### **2.5 INSULATION FACINGS AND JACKETS**

- A. Vapor Retarder, higher strength with low water permeance  $\leq 0.02$  or less perm rating, Beach puncture 50 units for insulation facing on pipe insulation jackets. Facings and jackets shall be all service type (ASJ) or PVDC Vapor Retarder jacketing.
- B. ASJ jacket shall be white kraft bonded to 0.025 mm (1 mil) thick aluminum foil, fiberglass reinforced, with pressure sensitive adhesive closure. Comply with ASTM C1136. Beach puncture 50 units, Suitable for painting without sizing. Jackets shall have minimum 40 mm (1-1/2 inch) lap on longitudinal joints and minimum 75mm (3 inch) butt strip on end joints. Butt strip material shall be same as the jacket. Lap and butt strips shall be self-sealing type with factory-applied pressure sensitive adhesive.



- C. Vapor Retarder medium strength with low water vapor permeance of 0.02 or less perm rating), Beach puncture 25 units: PVDC vapor retarder jacketing type for concealed equipment.
- D. Glass Cloth Jackets: Presized, minimum 0.18 kg per square meter (7.8 ounces per square yard), 2000 kPa (300 psig) bursting strength with integral vapor retarder where required or specified. Weather proof if utilized for outside service.
- E. Factory composite materials may be used provided
- F. Pipe fitting insulation covering (jackets): Fitting covering shall be premolded to match shape of fitting and shall be polyvinyl chloride (PVC) conforming to Fed Spec L-P-335, composition A, Type II Grade GU, and Type III, minimum thickness 0.7 mm (0.03 inches). Provide color matching vapor retarder pressure sensitive tape.

## **2.6 PIPE COVERING PROTECTION SADDLES**

- A. Cold pipe support: Premolded pipe insulation 180 degrees (half-shells) on bottom half of pipe at supports. Material shall be cellular glass insulation of the same thickness as adjacent insulation.

<b>Nominal Pipe Size and Accessories Material (Insert Blocks)</b>	
Nominal Pipe Size mm (inches)	Insert Blocks mm (inches)
Up through 125 (5)	150 (6) long
150 (6)	150 (6) long
200 (8), 250 (10), 300 (12)	225 (9) long
350 (14), 400 (16)	300 (12) long
450 through 600 (18 through 24)	350 (14) long

- B. Warm or hot pipe supports: Premolded pipe insulation (180 degree half-shells) on bottom half of pipe at supports. Material shall be cellular glass. Insulation at supports shall have same thickness as adjacent insulation.

## **2.7 ADHESIVE, MASTIC, CEMENT**

- A. ASTM C449: Mineral fiber hydraulic-setting thermal insulating and finishing cement.
- B. Other: Insulation manufacturers' published recommendations.

## **2.8 REINFORCEMENT AND FINISHES**

- A. Glass fabric, open weave: ASTM D1668, Type III (resin treated) and Type I (asphalt treated).

- B. PVC fitting cover: Fed. Spec L-P-535, Composition A, 11-86 Type II, Grade GU, with Form B Mineral Fiber insert, for media temperature 4 degrees C (40 degrees F) to 121 degrees C (250 degrees F). Below 4 degrees C (40 degrees F) and above 121 degrees C (250 degrees F). Provide double layer insert. Provide color matching vapor barrier pressure sensitive tape.

## **2.9 FIRESTOPPING MATERIAL**

Other than pipe insulation, refer to Section 07 84 00 FIRESTOPPING.

## **2.10 FLAME AND SMOKE**

Unless shown otherwise all assembled systems shall meet flame spread 25 and smoke developed 50 rating as developed under ASTM, NFPA and UL standards and specifications. See paragraph 1.3 "Quality Assurance".

## **PART 3 - EXECUTION**

### **3.1 GENERAL REQUIREMENTS**

- A. Required pressure tests of piping joints and connections shall be completed and the work approved by the Contracting Officers Representative (COR) for application of insulation. Surface shall be clean and dry with all foreign materials, such as dirt, oil, loose scale and rust removed.
- B. Except for specific exceptions, insulate all specified equipment, and piping (pipe, fittings, valves, accessories). Insulate each pipe individually. Do not use scrap pieces of insulation where a full length section will fit.
- C. Insulation materials shall be installed in a first class manner with smooth and even surfaces, with jackets and facings drawn tight and smoothly cemented down at all laps. Insulation shall be continuous through all sleeves and openings, except at fire dampers and duct heaters (NFPA 90A). Vapor retarders shall be continuous and uninterrupted throughout systems with operating temperature 16 degrees C (60 degrees F) and below. Lap and seal vapor barrier over ends and exposed edges of insulation. Anchors, supports and other metal projections through insulation on cold surfaces shall be insulated and vapor sealed for a minimum length of 150 mm (6 inches).
- D. Install vapor stops at all insulation terminations on either side of valves, pumps and equipment and particularly in straight lengths of pipe insulation.

- E. Construct insulation on parts of equipment such as cold water pumps and heat exchangers that must be opened periodically for maintenance or repair, so insulation can be removed and replaced without damage.  
Install insulation with bolted 1 mm thick (20 gage) galvanized steel or aluminum covers as complete units, or in sections, with all necessary supports, and split to coincide with flange/split of the equipment.
- F. Insulation on hot piping and equipment shall be terminated square at items not to be insulated, access openings and nameplates. Cover all exposed raw insulation with white sealer or jacket material.
- G. Plumbing work not to be insulated:
  - 1. Piping and valves of fire protection system.
  - 2. Chromium plated brass piping.
  - 3. Small horizontal cold water branch runs in partitions to individual fixtures may be without insulation for maximum distance of (3) feet.
- H. Apply insulation materials subject to the manufacturer's recommended temperature limits. Apply adhesives, mastic and coatings at the manufacturer's recommended minimum coverage.
- I. Elbows, flanges and other fittings shall be insulated with the same material as is used on the pipe straights.  
Use of polyurethane spray-foam to fill a PVC elbow jacket is prohibited on cold applications.
- J. Firestop Pipe insulation:
  - 1. Provide firestopping insulation at fire and smoke barriers through penetrations. Fire stopping insulation shall be UL listed as defines in Section 07 84 00, FIRESTOPPING.
  - 2. Pipe penetrations requiring fire stop insulation including, but not limited to the following:
    - a. Pipe risers through floors
    - b. Pipe chase walls and floors
    - c. Smoke partitions
    - d. Fire partitions
- K. Provide vapor barrier jackets over insulation as follows:
  - 1. All piping exposed to outdoor weather.
  - 2. All interior piping conveying fluids exposed to outdoor air (i.e. in ventilated (not air conditioned) spaces, etc.).

### **3.2 INSULATION INSTALLATION**

- A. Molded Mineral Fiber Pipe and Tubing Covering:

1. Fit insulation to pipe, aligning longitudinal joints. Seal longitudinal joint laps and circumferential butt strips by rubbing hard with a nylon sealing tool to assure a positive seal. Staples may be used to assist in securing insulation. Seal all vapor retarder penetrations on cold piping with a generous application of vapor barrier mastic. Provide inserts and install with metal insulation shields at outside pipe supports. Install freeze protection insulation over heating cable.
  2. Contractor's options for fitting, flange and valve insulation:
    - a. Insulating and finishing cement for sizes less than 100 mm (4 inches) operating at surface temperature of 16 degrees C (61 degrees F) or more.
    - b. Factory premolded, one piece PVC covers with mineral fiber, (Form B), inserts. Provide two insert layers for pipe temperatures below 4 degrees C (40 degrees F), or above 121 degrees C (250 degrees F). Secure first layer of insulation with twine. Seal seam edges with vapor barrier mastic and secure with fitting tape.
    - c. Factory molded, ASTM C547 or field mitered sections, joined with adhesive or wired in place. For hot piping finish with a smoothing coat of finishing cement. For cold fittings, 16 degrees C (60 degrees F) or less, vapor seal with a layer of glass fitting tape imbedded between two 2 mm (1/16 inch) coats of vapor barrier mastic.
    - d. Fitting tape shall extend over the adjacent pipe insulation and overlap on itself at least 50 mm (2 inches).
  3. Nominal thickness in millimeters and inches specified in the schedule at the end of this section.
- B. Rigid Cellular Phenolic Foam:
1. Rigid closed cell phenolic insulation may be provided for piping and equipment for temperatures up to 121 degrees C (250 degrees F).
  2. Note the NFPA 90A burning characteristics requirements of 25/50 in paragraph 1.3.B
  3. Provide secure attachment facilities such as welding pins.
  4. Apply insulation with joints tightly drawn together
  5. Apply adhesives, coverings, neatly finished at fittings, and valves.

6. Final installation shall be smooth, tight, neatly finished at all edges.
7. Minimum thickness in millimeters (inches) specified in the schedule at the end of this section.
8. Condensation control insulation: Minimum 25 mm (1.0 inch) thick for all pipe sizes.
  - a. Plumbing piping as follows:
    - 1) Body of roof and overflow drains horizontal runs and offsets (including elbows) of interior downspout piping in all areas above pipe basement.
    - 2) Waste piping from electric water coolers and icemakers to drainage system.
    - 3) Waste piping located above basement floor from ice making and film developing equipment and air handling units, from equipment (including trap) to main vertical waste pipe.
    - 4) Bedpan sanitizer atmospheric vent
    - 5) Cold water piping.

C. Cellular Glass Insulation:

1. Pipe and tubing, covering nominal thickness in millimeters and inches as specified in the schedule at the end of this section.
2. Cold equipment: 50 mm (2 inch) thick insulation faced with ASJ

### **3.3 COMMISSIONING**

- A. Provide commissioning documentation in accordance with the requirements of section 22 08 00 - COMMISSIONING OF PLUMBING SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to section 22 08 00 - COMMISSIONING OF PLUMBING SYSTEMS and related sections for contractor responsibilities for system commissioning.

### **3.4 PIPE INSULATION SCHEDULE**

Provide insulation for piping systems as scheduled below:

<b>Insulation Thickness Millimeters (Inches)</b>					
		Nominal Pipe Size Millimeters (Inches)			
Operating Temperature Range/Service	Insulation Material	Less than 25 (1)	25 - 32 (1 - 1½)	38 - 75 (1½ - 3)	100 (4) and Above
38-60 degrees C (100-140 degrees F) (Domestic Hot Water Supply and Return)	Mineral Fiber (Above ground piping only)	38 (1.5)	38 (1.5)	50 (2.0)	50 (2.0)
38-60 degrees C (100-140 degrees F) (Domestic Hot Water Supply and Return)	Rigid Cellular Phenolic Foam (Above ground piping only)	38 (1.5)	38 (1.5)	50 (2.0)	50 (2.0)
4-16 degrees C (40-60 degrees F) (Ice water piping )	Rigid Cellular Phenolic Foam (Above ground piping only)	25 (1.0)	25 (1.0)	25 (1.0)	25 (1.0)
4-16 degrees C (40-60 degrees F) (DCW)	Cellular Glass Closed-Cell	38 (1.5)	38 (1.5)	38 (1.5)	38 (1.5)

- - - E N D - - -

## **SECTION 22 08 00**

### **COMMISSIONING OF PLUMBING SYSTEMS**

#### **PART 1 - GENERAL**

##### **1.1 DESCRIPTION**

- A. The requirements of this Section apply to all sections of Division 22.
- B. This project will have selected building systems commissioned. The complete list of equipment and systems to be commissioned are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. The commissioning process, which the Contractor is responsible to execute, is defined in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. A Commissioning Agent (CxA) appointed by the Department of Veterans Affairs will manage the commissioning process.

##### **1.2 RELATED WORK**

- A. Section 01 00 00 GENERAL REQUIREMENTS.
- B. Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.
- C. Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

##### **1.3 SUMMARY**

- A. This Section includes requirements for commissioning plumbing systems, subsystems and equipment. This Section supplements the general requirements specified in Section 01 91 00 General Commissioning Requirements.
- B. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for more specifics regarding processes and procedures as well as roles and responsibilities for all Commissioning Team members.

##### **1.4 DEFINITIONS**

- A. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for definitions.

##### **1.5 COMMISSIONED SYSTEMS**

- A. Commissioning of a system or systems specified in Division 22 is part of the construction process. Documentation and testing of these systems, as well as training of the VA's Operation and Maintenance personnel in accordance with the requirements of Section 01 91 00 and of Division 22, is required in cooperation with the VA and the Commissioning Agent.

- B. The Plumbing systems commissioning will include the systems listed in Section 01 19 00 General Commissioning Requirements:

#### **1.6 SUBMITTALS**

- A. The commissioning process requires review of selected Submittals. The Commissioning Agent will provide a list of submittals that will be reviewed by the Commissioning Agent. This list will be reviewed and approved by the VA prior to forwarding to the Contractor. Refer to Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, and SAMPLES for further details.
- B. The commissioning process requires Submittal review simultaneously with engineering review. Specific submittal requirements related to the commissioning process are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

#### **PART 2 - PRODUCTS (NOT USED)**

#### **PART 3 - EXECUTION**

##### **3.1 CONSTRUCTION INSPECTIONS**

- A. Commissioning of the Building Plumbing Systems will require inspection of individual elements of the Plumbing construction throughout the construction period. The Contractor shall coordinate with the Commissioning Agent in accordance with Section 01 91 00 and the Commissioning Plan to schedule inspections as required to support the commissioning process.

##### **3.2 PRE-FUNCTIONAL CHECKLISTS**

- A. The Contractor shall complete Pre-Functional Checklists to verify systems, subsystems, and equipment installation is complete and systems are ready for Systems Functional Performance Testing. The Commissioning Agent will prepare Pre-Functional Checklists to be used to document equipment installation. The Contractor shall complete the checklists. Completed checklists shall be submitted to the VA and to the Commissioning Agent for review. The Commissioning Agent may spot check a sample of completed checklists. If the Commissioning Agent determines that the information provided on the checklist is not accurate, the Commissioning Agent will return the marked-up checklist to the Contractor for correction and resubmission. If the Commissioning Agent determines that a significant number of completed checklists for similar equipment are not accurate, the Commissioning



Agent will select a broader sample of checklists for review. If the Commissioning Agent determines that a significant number of the broader sample of checklists is also inaccurate, all the checklists for the type of equipment will be returned to the Contractor for correction and resubmission. Refer to SECTION 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for submittal requirements for Pre-Functional Checklists, Equipment Startup Reports, and other commissioning documents.

### **3.3 CONTRACTORS TESTS**

A. Contractor tests as required by other sections of Division 22 shall be scheduled and documented in accordance with Section 01 00 00 GENERAL REQUIREMENTS. All testing shall be incorporated into the project schedule. Contractor shall provide no less than 7 calendar days' notice of testing. The Commissioning Agent will witness selected Contractor tests at the sole discretion of the Commissioning Agent. Contractor tests shall be completed prior to scheduling Systems Functional Performance Testing.

### **3.4 SYSTEMS FUNCTIONAL PERFORMANCE TESTING:**

A. The Commissioning Process includes Systems Functional Performance Testing that is intended to test systems functional performance under steady state conditions, to test system reaction to changes in operating conditions, and system performance under emergency conditions. The Commissioning Agent will prepare detailed Systems Functional Performance Test procedures for review and approval by the Contracting Officer's Representative (COR). The Contractor shall review and comment on the tests prior to approval. The Contractor shall provide the required labor, materials, and test equipment identified in the test procedure to perform the tests. The Commissioning Agent will witness and document the testing. The Contractor shall sign the test reports to verify tests were performed. See Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS, for additional details.

### **3.5 TRAINING OF VA PERSONNEL**

A. Training of the VA operation and maintenance personnel is required in cooperation with the COR and Commissioning Agent. Provide competent, factory authorized personnel to provide instruction to operation and maintenance personnel concerning the location, operation, and

troubleshooting of the installed systems. Contractor shall submit training agendas and trainer resumes in accordance with the requirements of Section 01 19 00. The instruction shall be scheduled in coordination with the COR after submission and approval of formal training plans. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS and Division 22 Sections for additional Contractor training requirements.

----- END -----

**SECTION 22 11 00**  
**FACILITY WATER DISTRIBUTION**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Domestic water systems, including piping, equipment and all necessary accessories as designated in this section.

**1.2 RELATED WORK**

- A. Section 07 84 00, FIRESTOPPING.  
B. Section 09 91 00, PAINTING.  
C. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.  
D. Section 22 07 11, PLUMBING INSULATION, PIPE INSULATION.  
E. SECTION 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS: Requirements for commissioning, systems readiness checklist, and training.

**1.3 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.  
B. Manufacturer's Literature and Data:  
1. All items listed in Part 2 - Products.

**1.4 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.  
B. American National Standards Institute (ANSI):  
American Society of Mechanical Engineers (ASME): (Copyrighted Society)  
A13.1.....Scheme for Identification of Piping Systems  
B16.15-2006 .....Cast Copper Alloy Threaded Fittings Classes 125 and 250  
B16.18-2001 (R2005).....Cast Copper Alloy Solder-Joint Pressure Fittings  
B16.22-2012.....Wrought Copper and Copper Alloy Solder Joint Pressure Fittings  
B16.51-2011.....Copper and Copper Alloy Press-Connect Fittings  
NSF/ANSI 61-2012.....Drinking Water System Components - Health Effects  
C. American Society for Testing and Materials (ASTM):  
A47/A47M-99(2009).....Ferritic Malleable Iron Castings

22 11 00 - 2

### **1.5 QUALITY ASSURANCE**

- A. A certificate of Welder's certification shall be submitted prior to welding of steel piping. The certificate shall be current and no more than one year old.
- B. All grooved joint couplings, fittings, valves, and specialties shall be the products of a single manufacturer. Grooving tools shall be by the same manufacturer as the groove components.
- C. All castings used for coupling housings, fittings, valve bodies, etc., shall be date stamped for quality assurance and traceability.

### **1.6 SPARE PARTS**

- A. For mechanical pressed sealed fittings provide tools required for each pipe size used at the facility.

## **PART 2 - PRODUCTS**

### **2.1 MATERIALS**

- A. Material or equipment containing a weighted average of greater than 0.25 percent lead shall not be used in any potable water system intended for human consumption, and shall be certified in accordance with NSF/ANSI 61 or NSF 372. Endpoint devices used to dispense water for drinking must meet the requirements of NSF/ANSI 61, Section 9.
- B. Plastic pipe, fittings, and solvent cement shall meet NSF/ANSI 14 and shall be NSF listed for the service intended.

### **2.2 ABOVE GROUND (INTERIOR) WATER PIPING**

- A. Pipe: Copper tube, ASTM B88, Type K or L, drawn.
- B. Fittings for Copper Tube:
  - 1. Wrought copper or bronze castings conforming to ANSI B16.18 and B16.22. Unions shall be bronze, MSS SP72 & SP 110, Solder or braze joints. Use 95/5 tin and antimony for all soldered joints.
  - 2. Grooved fittings, 2 to 6 inch (50 to 150 mm) wrought copper ASTM B75 C12200, 5 to 6 inch (125 to 150 mm) bronze casting ASTM B584, CDA 844. Mechanical grooved couplings, ductile iron, ASTM A536 (Grade 65-45-12), or malleable iron, ASTM A47 (Grade 32510) housing, with EPDM gasket, steel track head bolts, ASTM A183, coated with copper colored alkyd enamel.
  - 3. Mechanical press-connect fittings for copper pipe and tube shall conform to the material and sizing requirements of ASME B16.51, NSF/ANSI 61 approved, 2 inch (50 mm) size and smaller mechanical press-connect fittings, double pressed type, with EPDM (ethylene

propylene diene monomer) non-toxic synthetic rubber sealing elements and un-pressed fitting identification feature.

4. Mechanically formed tee connection: Form mechanically extracted collars in a continuous operation by drilling pilot hole and drawing out tube surface to form collar, having a height of not less than three times the thickness of tube wall. Adjustable collaring device shall ensure proper tolerance and complete uniformity of the joint. Notch and dimple joining branch tube in a single process to provide free flow where the branch tube penetrates the fitting. Braze joints.

- D. Adapters: Provide adapters for joining screwed pipe to copper tubing.
- E. Solder: ASTM B32 Composition Sb5 HA or HB. Provide non-corrosive flux.
- F. Brazing alloy: AWS A5.8, Classification BCuP.

### **2.3 EXPOSED WATER PIPING**

- A. Finished Room: Use full iron pipe size chrome plated brass piping for exposed water piping connecting fixtures, casework, cabinets, equipment and reagent racks when not concealed by apron including those furnished by the Government or specified in other sections.
  1. Pipe: Fed. Spec. WW-P-351, standard weight.
  2. Fittings: ANSI B16.15 cast bronze threaded fittings with chrome finish, (125 and 250).
  3. Nipples: ASTM B 687, Chromium-plated.
  4. Unions: Mss SP-72, SP-110, Brass or Bronze with chrome finish. Unions 65 mm (2-1/2 inches) and larger shall be flange type with approved gaskets.
- B. Unfinished Rooms and Mechanical Rooms: Chrome-plated brass piping is not required. Paint piping systems as specified in Section 09 91 00, PAINTING.

### **2.4 TRAP PRIMER WATER PIPING:**

- A. Pipe: Copper tube, ASTM B88, type K, hard drawn.
- B. Fittings: Bronze castings conforming to ANSI B16.18 Solder joints.
- C. Solder: ASTM B32 composition Sb5. Provide non-corrosive flux.

### **2.5 STRAINERS**

- A. Provide on high pressure side of pressure reducing valves, on suction side of pumps, on inlet side of indicating and control instruments and equipment subject to sediment damage and where shown on drawings. Strainer element shall be removable without disconnection of piping.

- B. Water: Basket or "Y" type with easily removable cover and brass strainer basket.
- C. Body: Smaller than 80 mm (3 inches), brass or bronze; 80 mm (3 inches) and larger, cast iron or semi-steel.

## **2.6 DIELECTRIC FITTINGS**

- A. Provide dielectric couplings or unions between ferrous and non-ferrous pipe.

## **2.7 STERILIZATION CHEMICALS**

- A. Hypochlorite: ASTM E1120-08
- B. Liquid Chlorine ASTM: E1229-08

## **2.8 WATER HAMMER ARRESTER:**

- A. Closed copper tube chamber with permanently sealed 410 kPa (60 psig) air charge above a Double O-ring piston. Two high heat Buna-N O-rings pressure packed and lubricated with FDA approved silicone compound. All units shall be designed in accordance with ASSE 1010 for sealed wall installations without an access panel. Size and install in accordance with Plumbing and Drainage Institute requirements (PDI WH 201). Provide water hammer arrestors at:
  - 1. All solenoid valves.
  - 2. All groups of two or more flush valves.
  - 3. All quick opening or closing valves.
  - 4. All medical washing equipment.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. General: Comply with the International Plumbing Code and the following:
  - 1. Install branch piping for water from the piping system and connect to all fixtures, valves, cocks, outlets, casework, cabinets and equipment, including those furnished by the Government or specified in other sections.
  - 2. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe, except for plastic and glass, shall be reamed to full size after cutting.
  - 3. All pipe runs shall be laid out to avoid interference with other work.
  - 4. Install union and shut-off valve on pressure piping at connections to equipment.
  - 5. Pipe Hangers, Supports and Accessories:

- a. All piping shall be supported per the International Plumbing Code.
- b. Shop Painting and Plating: Hangers, supports, rods, inserts and accessories used for pipe supports shall be shop coated with red lead or zinc chromate primer paint. Electroplated copper hanger rods, hangers and accessories may be used with copper tubing.
- c. Floor, Wall and Ceiling Plates, Supports, Hangers:
  - 1) Solid or split unplated cast iron.
  - 2) All plates shall be provided with set screws.
  - 3) Pipe Hangers: Height adjustable clevis type.
  - 4) Adjustable Floor Rests and Base Flanges: Steel.
  - 5) Concrete Inserts: "Universal" or continuous slotted type.
  - 6) Hanger Rods: Mild, low carbon steel, fully threaded or Threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
  - 7) Riser Clamps: Malleable iron or steel.
  - 8) Rollers: Cast iron.
  - 9) Self-drilling type expansion shields shall be "Phillips" type, with case hardened steel expander plugs.
  - 10) Hangers and supports utilized with insulated pipe and tubing shall have 180 degree (min.) metal protection shield Centered on and welded to the hanger and support. The shield shall be 4 inches in length and be 16 gauge steel. The shield shall be sized for the insulation.
  - 11) Miscellaneous Materials: As specified, required, directed or as noted on the drawings for proper installation of hangers, supports and accessories. If the vertical distance exceeds 6 m (20 feet) for cast iron pipe additional support shall be provided in the center of that span. Provide all necessary auxiliary steel to provide that support.
  - 12) With the installation of each flexible expansion joint, provide piping restraints for the upstream and downstream section of the piping at the flexible expansion joint. Provide calculations supporting the restraint length design and type of selected restraints.



6. Install chrome plated cast brass escutcheon with set screw at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.

7. Penetrations:

a. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00. Completely fill and seal clearances between raceways and openings with the fire stopping materials.

b. Waterproofing: At floor penetrations, completely seal clearances around the pipe and make watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS.

B. Piping shall conform to the following:

1. Domestic Water:

a. Grade all lines to facilitate drainage. Provide drain valves at bottom of risers and all low points in system. Design domestic hot water circulating lines with no traps.

b. Connect branch lines at bottom of main serving fixtures below and pitch down so that main may be drained through fixture. Connect branch lines to top of main serving only fixtures located on floor above.

### **3.2 TESTS**

A. General: Test system either in its entirety or in sections.

B. Potable Water System: Test after installation of piping and domestic water heaters, but before piping is concealed, before covering is applied, and before plumbing fixtures are connected. Fill systems with water and maintain hydrostatic pressure of 690 kPa (100 psi) gage for two hours. No decrease in pressure is allowed. Provide a pressure gage with a shutoff and bleeder valve at the highest point of the piping being tested.

C. All Other Piping Tests: Test new installed piping under 1 1/2 times actual operating conditions and prove tight.

### **3.3 STERILIZATION**

A. After tests have been successfully completed, thoroughly flush and sterilize the interior domestic water distribution system in accordance with AWWA C651.

B. Use liquid chlorine or hypochlorites for sterilization.

### **3.4 COMMISSIONING**

- A. Provide commissioning documentation accordance with the requirements of Section 22 08 00 - COMMISSIONING OF PLUMBING SYSTEMS for all inspection, startup, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 22 08 00 - COMMISSIONING OF PLUMBING SYSTEMS and related sections for contractor responsibilities for system commissioning.

- - - E N D - - -

**SECTION 22 13 00**  
**FACILITY SANITARY AND VENT PIPING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

This section pertains to sanitary sewer and vent systems, including piping, equipment and all necessary accessories as designated in this section.

**1.2 RELATED WORK**

- A. Section 07 84 00, FIRESTOPPING: Penetrations in rated enclosures.
- B. Section 09 91 00, PAINTING: Preparation and finish painting and identification of piping systems.
- C. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: Pipe Hangers and Supports, Materials Identification.
- D. Section 22 07 11, PLUMBING INSULATION: Pipe Insulation.
- E. Section 07 92 00 Joint Sealants: Sealant products.

**1.3 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
  - 1. Piping.
  - 2. Floor Drains.
  - 3. Cleanouts.
  - 4. All items listed in Part 2 - Products.
- C. Detailed shop drawing of clamping device and extensions when required in connection with the waterproofing membrane or the floor drain.

**1.4 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME): (Copyrighted Society)
  - A112.6.3-01 (R 2007)....Standard for Floor and Trench Drains
  - A13.1-07.....Scheme for Identification of Piping Systems
  - B16.3-06.....Malleable Iron Threaded Fittings, Classes 150 and 300.
  - B16.4-06.....Standard for Grey Iron Threaded Fittings  
Classes 125 and 250

B16.12-98 (R 2006).....Cast Iron Threaded Drainage Fittings

B16.15-06.....Cast Bronze Threaded Fittings, Classes 125 and  
250

C. American Society for Testing and Materials (ASTM):

A47/A47M-99 (R 2004)....Standard Specification for Steel Sheet,  
Aluminum Coated, by the Hot Dip Process

A53/A53M-07.....Standard Specification for Pipe, Steel, Black  
And Hot-Dipped, Zinc-coated, Welded and  
Seamless

A74-06.....Standard Specification for Cast Iron Soil Pipe  
and Fittings

A183-03.....Standard Specification for Carbon Steel Track  
Bolts and Nuts

A536-84 (R 2004).....Standard Specification for Ductile Iron  
Castings

B32-08.....Standard Specification for Solder Metal

B75-02.....Standard Specification for Seamless Copper Tube

B306-02.....Standard Specification for Copper Drainage Tube  
(DWV)

B584-06a.....Standard Specification for Copper Alloy Sand  
Castings for General Applications

C564-03a.....Standard Specification for Rubber Gaskets for  
Cast Iron Soil Pipe and Fittings

D2000-08.....Standard Classification System for Rubber  
Products in Automotive Applications

D2564-04E1.....Standard Specification for Solvent Cements for  
Poly (Vinyl Chloride) (PVC) Plastic Pipe and  
Fittings

D2665-08.....*Standard Specification for* Poly (Vinyl  
Chloride) (PVC) Plastic Drain, Waste, and Vent  
Pipe and Fittings

D. International Code Council:

IPC-12.....International Plumbing Code

E. Cast Iron Soil Pipe Institute (CISPI):

301-05.....Hubless Cast Iron Soil Pipe and Fittings for  
Sanitary and Storm Drain, Waste, and Vent  
Piping Applications

310-04.....Coupling for Use in Connection with Hubless  
Cast Iron Soil Pipe and Fittings for Sanitary  
and Storm Drain, Waste, and Vent Piping  
Applications

F. American Society of Sanitary Engineers (ASSE):

1018-01.....Trap Seal Primer Valves - Potable, Water  
Supplied

G. Plumbing and Drainage Institute (PDI):

PDI WH-201.....Water Hammer Arrestor

## **PART 2 - PRODUCTS**

### **2.1 SANITARY WASTE, DRAIN, AND VENT PIPING**

A. Cast iron waste, drain, and vent pipe and fittings

1. Cast iron waste, drain, and vent pipe and fittings shall be used for the following applications:
  - a. interior waste and vent piping above grade.
2. Cast iron Pipe shall be bell and spigot or hubless (plain end or no-hub or hubless).
3. The material for all pipe and fittings shall be cast iron soil pipe and fittings and shall conform to the requirements of CISPI Standard 301, ASTM A-888, or ASTM A-74.
4. Joints for hubless pipe and fittings shall conform to the manufacturer's installation instructions. Couplings for hubless joints shall conform to CISPI 310. Joints for hub and spigot pipe shall be installed with compression gaskets conforming to the requirements of ASTM Standard C-564 or be installed with lead and oakum.

B. Copper Tube, (DWV):

1. Copper DWV tube sanitary waste, drain and vent pipe may be used for piping above ground, except for urinal drains.
2. The copper DWV tube shall be drainage type, drawn temper conforming to ASTM B306.
3. The copper drainage fittings shall be cast copper or wrought copper conforming to ASME B16.23 or ASME 16.29.
4. The joints shall be lead free, using a water flushable flux, and conforming to ASTM B32.

## **2.2 EXPOSED WASTE PIPING**

- A. Full iron pipe size chrome plated brass piping shall be used in finished rooms for exposed waste piping connecting fixtures, casework, cabinets, equipment and reagent racks when not concealed by apron including those furnished by the Government or specified in other sections.
1. The Pipe shall meet Fed. Spec. WW-P-351, standard weight.
  2. The Fittings shall conform to ANSI B16.15, cast bronze threaded fittings with chrome finish, (125 and 250).
  3. Nipples shall conform to ASTM B 687, Chromium-plated.
  4. Unions shall be brass or bronze with chrome finish. Unions 65 mm (2-1/2 inches) and larger shall be flange type with approved gaskets.
- B. In unfinished Rooms such as mechanical Rooms, Chrome-plated brass piping is not required. The pipe materials specified under the paragraph "Sanitary Waste, Drain, and Vent Piping" can be used. The sanitary pipe in unfinished rooms shall be painted as specified in Section 09 91 00, PAINTING.

## **2.3 SPECIALTY PIPE FITTINGS**

- A. Transition pipe couplings shall join piping with small differences in outside diameters or different materials. End connections shall be of the same size and compatible with the pipes being joined. The transition coupling shall be elastomeric, sleeve type reducing or transition pattern and include shear and corrosion resistant metal, tension band and tightening mechanism on each end. The transition coupling sleeve coupling shall be of the following material:
1. For cast iron soil pipes, the sleeve material shall be rubber conforming to ASTM C564.
  2. For PVC soil pipes, the sleeve material shall be elastomeric seal or PVC, conforming to ASTM F 477 or ASTM D5926.
  3. For dissimilar pipes, the sleeve material shall be PVC conforming to ASTM D5926, or other material compatible with the pipe materials being joined.
- B. The dielectric fittings shall conform to ASSE 1079 with a pressure rating of 860 kPa (125 psig) at a minimum temperature of 82°C (180°F). The end connection shall be solder joint copper alloy and threaded ferrous.

- C. Dielectric flange insulating kits shall be of non conducting materials for field assembly of companion flanges with a pressure rating of 1035 kPa (150 psig). The gasket shall be neoprene or phenolic. The bolt sleeves shall be phenolic or polyethylene. The washers shall be phenolic with steel backing washers.
- D. The di-electric nipples shall be electroplated steel nipple complying with ASTM F 1545 with a pressure ratings of 2070 kPa (300 psig) at 107°C (225°F). The end connection shall be male threaded. The lining shall be inert and noncorrosive propylene.

#### **2.4 CLEANOUTS**

- A. Cleanouts shall be the same size as the pipe, up to 100 mm (4 inches); and not less than 100 mm (4 inches) for larger pipe. Cleanouts shall be easily accessible and shall be gastight and watertight. Minimum clearance of 600 mm (24 inches) shall be provided for clearing a clogged sanitary line.
- B. Floor cleanouts shall be gray iron housing with clamping device and round, secured, scoriated, gray iron cover conforming to ASME A112.36.2M. A gray iron ferrule with hubless, socket, inside calk or spigot connection and counter sunk, taper-thread, brass or bronze closure plug shall be included. The frame and cover material and finish shall be nickel-bronze copper alloy with a square shape. The cleanout shall be vertically adjustable for a minimum of 50 mm (2 inches). When a waterproof membrane is used in the floor system, clamping collars shall be provided on the cleanouts. Cleanouts shall consist of wye fittings and eighth bends with brass or bronze screw plugs. Cleanouts in the resilient tile floors, quarry tile and ceramic tile floors shall be provided with square top covers recessed for tile insertion. In the carpeted areas, carpet cleanout markers shall be provided. Two way cleanouts shall be provided where indicated on drawings and at every building exit.
- C. Cleanouts shall be provided at or near the base of the vertical stacks with the cleanout plug located approximately 600 mm (24 inches) above the floor. If there are no fixtures installed on the lowest floor, the cleanout shall be installed at the base of the stack. The cleanouts shall be extended to the wall access cover. Cleanout shall consist of sanitary tees. Nickel-bronze square frame and stainless steel cover with minimum opening of 150 by 150 mm (6 by 6 inches) shall be

furnished at each wall cleanout. Where the piping is concealed, a fixture trap or a fixture with integral trap, readily removable without disturbing concealed pipe, shall be accepted as a cleanout equivalent providing the opening to be used as a cleanout opening is the size required.

- D. In horizontal runs above grade, cleanouts shall consist of cast brass tapered screw plug in fitting or caulked/hubless cast iron ferrule. Plain end (hubless) piping in interstitial space or above ceiling may use plain end (hubless) blind plug and clamp.

## **2.5 FLOOR DRAINS**

- A. Type A (FD-A) floor drain shall comply with ANSI A112.6.3. Type A floor drain shall have a cast iron body, caulking flange, inside gasket, or hubless connection shall be provided for connection to cast iron pipe, screwed or no hub outlets for connection to steel pipe. The drain connection shall be bottom outlet. A membrane clamp and extensions shall be provided, if required, where installed in connection with waterproof membrane. Puncturing membrane other than for drain opening will not be permitted. Double drainage pattern floor drains shall have integral seepage pan for embedding into floor construction, and weep holes to provide adequate drainage from pan to drain pipe. For drains not installed in connection with a waterproof membrane, a 2.2 kg (16-ounce) soft copper membrane, 600 mm (24 inches) square or another approved waterproof membrane shall be provided and (6 inch) minimum diameter or square satin nickel bronze or satin bronze strainer.
- B. Type B (FD-B) floor drain shall comply with ANSI A112.6.3. The type B floor drain shall be constructed of galvanized cast iron with medium duty nickel bronze grate, double drainage pattern, clamping device, without sediment bucket but with secondary strainer in bottom. The grate shall be 175 mm (7 inches) minimum.
- C. Type M (FD-M) floor drain shall comply with ANSI A112.6.3. The type M floor drain shall have a cast iron body, nickel bronze adjustable funnel strainer and clamping device. Funnel strainer shall consist of a perforated floor-level square or round grate and funnel extension. Minimum dimensions as follows:
1. Area of strainer and collar - 23 000 square mm (36 square inches).
  2. Height of funnel - 95 mm (3-3/4 inches).
  3. Diameter of lower portion of funnel - 50 mm (2 inches).



4. Diameter of top portion of funnel - 100 mm (4 inches).
5. Provide paper collars for construction purposes.
- D. Type R (FD-R) floor drain shall comply with ANSI A112.6.3. The type R floor drain shall have a cast iron body, double drainage pattern and clamping device, less grate and sediment basket but with dome type secondary strainer. The drain shall be 200 mm (8 inches) in diameter or 200 mm (8 inches) square and approximately 150 mm (6 inches) deep. The interior and exposed exterior surfaces and rim shall have an acid resisting finish.
- E. Open Sight Drains (OSDs) shall be cast iron, constructed as shown by detail.

## **2.6 TRAPS**

- A. Traps shall be provided on all sanitary branch waste connections from fixtures or equipment not provided with traps. Exposed brass shall be polished brass chromium plated with nipple and set screw escutcheons. Concealed traps may be rough cast brass or same material as pipe connected to. Slip joints are not permitted on sewer side of trap. Traps shall correspond to fittings on cast iron soil pipe or steel pipe respectively, and size shall be as required by connected service or fixture.

## **2.7 TRAP SEAL PRIMER VALVES AND TRAP SEAL PRIMER SYSTEMS**

- A. Trap Primer (TP-2): The trap seal primer valve shall be hydraulic, supply type with a pressure rating of 5.98 kPa (125 psig) and conforming to standard ASSE 1018.
  1. The inlet and outlet connections shall be 15 mm or DN15 (NPS ½ inch)
  2. The trap seal primer valve shall be fully automatic with an all brass or bronze body.
  3. The trap seal primer valve shall be activated by a drop in building water pressure, no adjustment required.
  4. The trap seal primer valve shall include a manifold when serving two, three, or four traps.
  5. The manifold shall be omitted when serving only one trap.

## **2.8 WATERPROOFING**

- A. A sleeve flashing device shall be provided at points where pipes pass through membrane waterproofed floors or walls. The sleeve flashing device shall be manufactured, cast iron fitting with clamping device that forms a sleeve for the pipe floor penetration of the floor

membrane. A galvanized steel pipe extension shall be included in the top of the fitting that will extend 50 mm (2 inches) above finished floor and galvanized steel pipe extension in the bottom of the fitting that will extend through the floor slab. A waterproof caulked joint shall be provided at the top hub.

B. Walls: See detail shown on drawings.

### **PART 3 - EXECUTION**

#### **3.1 PIPE INSTALLATION**

- A. The pipe installation shall comply with the requirements of the International Plumbing Code (IPC) and these specifications.
- B. Branch piping shall be installed for waste from the respective piping systems and connect to all fixtures, valves, cocks, outlets, casework, cabinets and equipment, including those furnished by the Government or specified in other sections.
- C. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe shall be reamed to full size after cutting.
- D. All pipe runs shall be laid out to avoid interference with other work.
- E. The piping shall be installed above accessible ceilings where possible.
- F. The piping shall be installed to permit valve servicing or operation.
- G. Unless specifically indicated on the drawings, the minimum slope shall be 2% slope.
- H. The piping shall be installed free of sags and bends.
- I. Seismic restraint shall be installed where required by code.
- J. Changes in direction for soil and waste drainage and vent piping shall be made using appropriate branches, bends and long sweep bends. Sanitary tees and short sweep quarter bends may be used on vertical stacks if change in direction of flow is from horizontal to vertical. Long turn double wye branch and eighth bend fittings shall be used if two fixtures are installed back to back or side by side with common drain pipe. Straight tees, elbows, and crosses may be used on vent lines. Do not change direction of flow more than 90 degrees. Proper size of standard increaser and reducers shall be used if pipes of different sizes are connected. Reducing size of drainage piping in direction of flow is prohibited.
- K. Cast iron piping shall be installed according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook," Chapter IV, "Installation of Cast Iron Soil Pipe and Fittings"

- L. Aboveground copper tubing shall be installed according to CDA's "Copper Tube Handbook".

### **3.2 JOINT CONSTRUCTION**

- A. Hub and spigot, cast iron piping with gasket joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for compression joints.
- B. Hub and spigot, cast iron piping with calked joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for lead and oakum calked joints.
- C. Hubless or No-hub, cast iron piping shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for hubless piping coupling joints.
- D. For threaded joints, thread pipe with tapered pipe threads according to ASME B1.20.1. The threads shall be cut full and clean using sharp disc cutters. Threaded pipe ends shall be reamed to remove burrs and restored to full pipe inside diameter. Pipe fittings and valves shall be joined as follows:
  - 1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is required by the pipe service
  - 2. Pipe sections with damaged threads shall be replaced with new sections of pipe.
- E. Copper tube and fittings with soldered joints shall be joined according to ASTM B828. A water flushable, lead free flux conforming to ASTM B813 and a lead free alloy solder conforming to ASTM B32 shall be used.

### **3.3 SPECIALTY PIPE FITTINGS**

- A. Transition coupling shall be installed at pipe joints with small differences in pipe outside diameters.
- B. Dielectric fittings shall be installed at connections of dissimilar metal piping and tubing.

### **3.4 PIPE HANGERS, SUPPORTS AND ACCESSORIES:**

- A. All piping shall be supported according to the International Plumbing Code (IPC), Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, and these specifications. Where conflicts arise between these the code and Section 22 05 11, the most restrictive or the requirement that specifies supports with highest loading or shortest spacing shall apply.

- B. Hangers, supports, rods, inserts and accessories used for pipe supports shall be shop coated with zinc chromate primer paint. Electroplated copper hanger rods, hangers and accessories may be used with copper tubing.
- C. Horizontal piping and tubing shall be supported within 300 mm (12 inches) of each fitting or coupling.
- D. Horizontal cast iron piping shall be supported with the following maximum horizontal spacing and minimum hanger rod diameters:
  - 1. 40 mm or DN40 to 50 mm or DN50 (NPS 1-1/2 inch to NPS 2 inch): 1500 mm (60 inches) with 10 mm (3/8 inch) rod.
  - 2. 80 mm or DN 80 (NPS 3 inch): 1500 mm (60 inches) with 13 mm (1/2 inch) rod.
  - 3. 100 mm or DN100 to 125 mm or DN125 (NPS 4 to NPS 5): 1500 mm (60 inches) with 16 mm (5/8 inch) rod.
  - 4. 150 mm or DN150 to 200 mm or DN200 (NPS 6 inch to NPS 8 inch): 1500 mm (60 inches) with 19 mm (3/4 inch) rod.
  - 5. 250 mm or DN250 to 300 mm or DN 300 (NPS 10 inch to NPS 12 inch): 1500 mm (60 inch) with 22 mm (7/8 inch) rod.
- E. The maximum spacing for plastic pipe shall be 1.22 m (4 feet).
- F. Vertical piping and tubing shall be supported at the base, at each floor, and at intervals no greater than 4.57 m (15 feet).
- G. In addition to the requirements in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, floor, Wall and Ceiling Plates, Supports, Hangers shall have the following characteristics:
  - 1. Solid or split unplated cast iron.
  - 2. All plates shall be provided with set screws.
  - 3. Height adjustable clevis type pipe hangers.
  - 4. Adjustable floor rests and base flanges shall be steel.
  - 5. Hanger rods shall be low carbon steel, fully threaded or threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
  - 6. Riser clamps shall be malleable iron or steel.
  - 7. Rollers shall be cast iron.
  - 8. See Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, for requirements on insulated pipe protective shields at hanger supports.

- H. Miscellaneous materials shall be provided as specified, required, directed or as noted on the drawings for proper installation of hangers, supports and accessories. If the vertical distance exceeds 6 m (20 feet) for cast iron pipe additional support shall be provided in the center of that span. All necessary auxiliary steel shall be provided to provide that support.
- I. Cast escutcheon with set screw shall be provided at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
- J. Penetrations:
1. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoke partitions, or floors, a fire stop shall be installed that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING. Clearances between raceways and openings shall be completely filled and sealed with the fire stopping materials.
  2. Water proofing: At floor penetrations, clearances shall be completely sealed around the pipe and make watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS.
- K. Piping shall conform to the following:
1. Waste and Vent Drain to main stacks:

Pipe Size	Minimum Pitch
80 mm or DN 80 (3 inches) and smaller	2%
100 mm or DN 100 (4 inches) and larger	1%

2. Exhaust vents shall be extended separately through roof. Sanitary vents shall not connect to exhaust vents.

### 3.5 TESTS

- A. Sanitary waste and drain systems shall be tested either in its entirety or in sections.
- B. Waste System tests shall be conducted before trenches are backfilled or fixtures are connected. A water test or air test shall be conducted, as directed.
1. If entire system is tested for a water test, tightly close all openings in pipes except highest opening, and fill system with water to point of overflow. If the waste system is tested in sections,

- tightly plug each opening except highest opening of section under test, fill each section with water and test with at least a 3 m (10 foot) head of water. In testing successive sections, test at least upper 3 m (10 feet) of next preceding section so that each joint or pipe except upper most 3 m (10 feet) of system has been submitted to a test of at least a 3 m (10 foot) head of water. Water shall be kept in the system, or in portion under test, for at least 15 minutes before inspection starts. System shall then be tight at all joints.
2. For an air test, an air pressure of 35 kPa (5 psig) gage shall be maintained for at least 15 minutes without leakage. A force pump and mercury column gage shall be used for the air test.
  3. After installing all fixtures and equipment, open water supply so that all p-traps can be observed. For 15 minutes of operation, all p-traps shall be inspected for leaks and any leaks found shall be corrected.
  3. Final Tests: Either one of the following tests may be used.
    - a. Smoke Test: After fixtures are permanently connected and traps are filled with water, fill entire drainage and vent systems with smoke under pressure of 1.3 kPa (1 inch of water) with a smoke machine. Chemical smoke is prohibited.
    - b. Peppermint Test: Introduce (2 ounces) of peppermint into each line or stack.

- - - E N D - - -

**SECTION 22 14 00**  
**FACILITY STORM DRAINAGE**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

This section describes the requirements for storm drainage systems, including piping and all necessary accessories as designated in this section.

**1.2 RELATED WORK**

- A. Section 07 84 00, FIRESTOPPING: Penetrations in rated enclosures.
- B. Section 09 91 00, PAINTING: Preparation and finish painting and identification of piping systems.
- C. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: Pipe Hangers and Supports, Materials Identification.
- D. Section 22 07 11, PLUMBING INSULATION: Pipe Insulation.

**1.3 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
  - 1. Piping.
  - 2. Roof Drains.
  - 3. Cleanouts.
  - 4. All items listed in Part 2 - Products.
- C. Detailed shop drawing of clamping device and extensions when required in connection with the waterproofing membrane.

**1.4 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standards Institute (ANSI).
- C. American Society of Mechanical Engineers (ASME): (Copyrighted Society)
  - A112.21.2m-83.....Roof Drains
  - A13.1-07.....Scheme for Identification of Piping Systems
  - B16.3-06.....Malleable Iron Threaded Fittings, Classes 150 and 300. B16.9-07 Factory-Made Wrought Steel Butt welding Fittings

B16.11-05.....Forged Steel Fittings, Socket-Welding and  
Threaded B16.12-98 (R 2006) Cast Iron  
Threaded Drainage Fittings

B16.15-06).....Cast Bronze Threaded Fittings, Class 125 and  
250

B16.18-01 (R 2005).....Cast Copper Alloy Solder-Joint Pressure  
Fittings

B16.22-01 (R 2005).....Wrought Copper and Copper Alloy Solder Joint  
Pressure Fittings

D. American Society for Testing and Materials (ASTM):

A47-99 (R 2004).....Standard Specification for Steel Sheet,  
Aluminum Coated, by the Hot-Dip Process

A74-06.....Standard Specification for Cast Iron Soil Pipe  
and Fittings

A183-03).....Standard Specification for Carbon Steel Track  
Bolts and Nuts

A536-84(R 2004).....Standard Specification for Ductile Iron  
Castings

A733-03.....Standard Specification for Welded and Seamless  
Carbon Steel and Austenitic Stainless Steel  
Pipe Nipples

B32-04.....Standard Specification for Solder Metal

B61-08.....Standard Specification for Steam or Bronze  
Castings

B62-02.....Standard Specification for Composition Bronze  
or Ounce Metal Castings

B75-02.....Standard Specification for Seamless Copper Tube

B88-03.....Standard Specification for Seamless Copper  
Water Tube

B306-02.....Standard Specification for Copper Drainage Tube  
(DWV)

B584-08.....Standard Specification for Copper Alloy Sand  
Castings for General Applications

B687-99.....Standard Specification for Brass, Copper, and  
Chromium-Plated Pipe Nipples

C564-06a.....Standard Specification for Rubber Gaskets for  
Cast Iron Soil Pipe and Fittings



- D2000-08.....Standard Classification System for Rubber  
Products in Automotive Applications
- D4101-07.....Standard Specification for Propylene Plastic  
Injection and Extrusion Materials
- D2564-04e1.....Standard Specification for Solvent Cements for  
Poly (Vinyl Chloride) (PVC) Plastic Pipe and  
Fittings
- D2665-07.....Standard Specification for Poly (Vinyl  
Chloride) (PVC) Plastic Drain, Waste, and Vent  
Pipe and Fittings
- E. American Welding Society (AWS):
- A5.8-04.....Specification for Filler Metals for Brazing and  
Braze Welding
- F. International Code Council (ICC):
- IPC-12.....International Plumbing Code
- G. Cast Iron Soil Pipe Institute (CISPI):
- 301-05.....Hubless Cast Iron Soil and Fittings for  
Sanitary and Storm Drain, Waste, and Vent  
Piping Applications
- 310-04.....Couplings for Use in Connection with Hubless  
Cast Iron Soil and Fittings for Sanitary and  
Storm Drain, Waste, and Vent Piping  
Applications
- H. Manufacturers Standardization Society of the Valve and Fittings  
Industry, Inc. (MSS):
- SP-72-99.....Standard for Ball Valves with Flanged or Butt  
Welding For General Purpose
- SP-110-96.....Ball Valve Threaded, Socket Welding, Solder  
Joint, Grooved and Flared Ends

## **PART 2 - PRODUCTS**

### **2.1 STORM WATER DRAIN PIPING**

- A. Cast Iron Storm Pipe and Fittings:
1. Cast iron storm pipe and fittings shall be used for the following applications:
    - c. Interior storm piping above grade.
    - d. All mechanical equipment rooms or other areas containing mechanical air handling equipment.

2. The cast iron storm Pipe shall be bell and spigot, or hubless (plain end or no-hub) as required by selected jointing method.
  3. The material for all pipe and fittings shall be cast iron soil pipe and fittings and shall conform to the requirements of CISPI Standard 301, ASTM A-888, or ASTM A-74.
  4. Joints for hubless pipe and fittings shall conform to the manufacturer's installation instructions. Couplings for hubless joints shall conform to CISPI 310. Joints for hub and spigot pipe shall be installed with compression gaskets conforming to the requirements of ASTM Standard C-564 or be installed with leak and oakum.
- B. Copper Tube, (DWV): May be used for piping above ground.
1. The copper DWV tube shall be drainage type, drawn temper conforming to ASTM B306.
  2. The Copper drainage fittings shall be cast copper or wrought copper conforming to ASME B16.23 or ASME 16.29.
  3. The joints shall be lead free, using a water flushable flux, and conforming to ASTM B32.
- C. Polyvinyl Chloride (PVC)
1. Polyvinyl chloride storm sewer pipe and fittings where indicated on drawings.
  2. Polyvinyl chloride storm sewer pipe and fittings shall be schedule 40 solid core sewer piping conforming to ASTM D1785 and D 2665, Sewer and Drain Series, with ends for solvent cemented joints.
  3. Polyvinyl chloride joints shall be solvent welded socket type using solvent cement conforming to ASTM D2564.
- C. Roof drain piping in locations where the outdoor conditions are subject to freezing shall be insulated.

### **2.3 SPECIALTY PIPE FITTINGS**

- A. Transition pipe couplings shall join piping with small differences in outside diameters or be of different materials. End connections shall be of the same size and compatible with the pipes being joined. The transition coupling shall be elastomeric, sleeve type reducing or transition pattern and include shear erring and corrosion resistant metal tension band and tightening mechanism on each end. The transition coupling sleeve coupling shall be of the following material:
1. For cast iron soil pipes, the sleeve material shall be rubber conforming to ASTM C564.

2. For PVC soil pipes, the sleeve material shall be elastomeric seal or PVC, conforming to ASTM F 477 or ASTM D5926.
  3. For dissimilar pipes, the sleeve material shall be PVC conforming to ASTM D5926, or other material compatible with the pipe materials being joined.
- B. The dielectric fittings shall conform to ASSE 1079 with a pressure rating of 860 kPa (125 psig) at a minimum temperature of 82°C (180°F). The end connection shall be solder joint copper alloy and threaded ferrous.
- C. Dielectric flange insulating kits shall be of non conducting materials for field assembly of companion flanges with a pressure rating of 1035 kPa (150 psig). The gasket shall be neoprene or phenolic. The bolt sleeves shall be phenolic or polyethylene. The washers shall be phenolic with steel backing washers.
- D. The dielectric nipples shall be electroplated steel nipple comply with ASTM F 1545 with a pressure ratings of 2070 kPa (300 psig) at 107°C (225°F). The end connection shall be male threaded. The lining shall be inert and noncorrosive propylene.

#### **2.4 CLEANOUTS**

- A. Cleanouts shall be the same size as the pipe, up to 100 mm (4 inches); not less than 100 mm (4 inches) for larger pipe. Cleanouts shall be easily accessible and shall be gastight and watertight. A minimum clearance of 600 mm (24 inches) shall be provided for clearing a clogged storm sewer line.
- B. Floor cleanouts shall be gray iron housing with clamping device and round, secured, scoriated, gray iron cover conforming to ASME A112.36.2M. A gray iron ferrule with hubless, socket, inside calk or spigot connection and counter sunk, taper-thread, brass or bronze closure plug shall be included. The frame and cover material and finish shall be nickel-bronze copper alloy with a square shape. The cleanout shall be vertically adjustable for a minimum of 50 mm (2 inches). When a waterproof membrane is used in the floor system, clamping collars shall be provided on the cleanouts. Cleanouts shall consist of wye fittings and eighth bends with brass or bronze screw plugs. Cleanouts in the resilient tile floors, quarry tile and ceramic tile floors shall be provided with square top covers recessed for tile insertion. In the carpeted areas, carpet cleanout markers shall be provided. Two way cleanouts where shall be provided where indicated on

the drawings and at each building exit. The loading classification for cleanouts in sidewalk areas or subject to vehicular traffic shall be heavy duty.

- C. Cleanouts shall be provided at or near the base of the vertical stacks with the cleanout plug located approximately 600 mm (24 inches) above the floor. The cleanouts shall be extended to the wall access cover. Cleanout shall consist of sanitary tees. Nickel bronze square frame and stainless steel cover with minimum opening of 150 mm by 150 mm (6 inch by 6 inch) shall be provided at each wall cleanout.
- D. In horizontal runs above grade, cleanouts shall consist of cast brass tapered screw plug in fitting or caulked/no hub cast iron ferrule. Plain end (no-hub) piping in interstitial space or above ceiling may use plain end (no-hub) blind plug and clamp.

## **2.5 ROOF DRAINS AND CONNECTIONS**

- A. Roof Drains: Roof Drains (RD) shall be cast iron with clamping device for making watertight connection. Free openings through strainer shall be twice area of drain outlet. For roof drains not installed in connection with a waterproof membrane, a soft copper membrane shall be provided 300 mm (12 inches) in diameter greater than outside diameter of drain collar. An integral gravel stop shall be provided for drains installed on roofs having built up roofing covered with gravel or slag. Integral no-hub, soil pipe gasket or threaded outlet connection shall be provided.
- 1. Flat Roofs: The roof drain shall have a beehive or dome shaped strainer with integral flange not less than 300 mm (12 inches) in diameter. For an insulated roof, a roof drain with an adjustable drainage collar shall be provided, which can be raised or lowered to meet required insulation heights, sump receiver and deck clamp. The Bottom section shall serve as roof drain during construction before insulation is installed.
- 2. Protective Roof Membrane Insulation Assembly: The roof drain shall have a perforated stainless steel extension filter, non puncturing clamp ring, large sump with extra wide roof flange and deck clamp.
  - a. Non pedestrian Roofs: The roof drain shall have large polypropylene or aluminum locking dome.
  - b. Pedestrian Roof: The rood drain shall have a bronze promenade top 350 mm (14 inches) square, set in square secured frame support collar.

3. Roof drains in areas subject to freezing shall have heat tape and shall be insulated.
- B. Expansion Joints: Expansions joints shall be heavy cast iron with cast brass or copper expansion sleeve having smooth bearing surface working freely against a packing ring held in place and under pressure of a bolted gland ring, forming a water and air tight flexible joint. Asbestos packing is prohibited.
- C. Interior Downspouts: An expansion joint shall be provided, specified above, at top of run on straight, vertical runs of downspout piping 12 m (40 feet) long or more.

## **2.6 WATERPROOFING**

- A. A sleeve flashing device shall be provided at points where pipes pass through membrane waterproofed floors or walls. The sleeve flashing device shall be manufactured, cast iron fitting with clamping device that forms a sleeve for the pipe floor penetration of the floor membrane. A galvanized steel pipe extension shall be included in the top of the fitting that will extend 50 mm (2 inches) above finished floor and galvanized steel pipe extension in the bottom of the fitting that will extend through the floor slab. A waterproofed caulked joint shall be provided at the top hub.
- B. Walls: See detail shown on drawings.

## **PART 3 - EXECUTION**

### **3.1 PIPE INSTALLATION**

- A. The pipe installation shall comply with the requirements of the International code and these specifications.
- B. Branch piping shall be installed from the piping system and connect to all drains and outlets.
- C. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe shall be reamed to full size after cutting.
- D. All pipe runs shall be laid out to avoid interference with other work.
- E. The piping shall be installed above accessible ceilings to allow for ceiling panel removal.
- F. Unless otherwise stated on the documents, minimum horizontal slope shall be one inch for every 1.22 m (4 feet) of pipe length.
- G. The piping shall be installed free of sags and bends.
- H. Seismic restraint shall be installed where required by code.
- I. Changes in direction for storm drainage piping shall be made using appropriate branches, bends and long sweep bends. Sanitary tees and

short sweep  $\frac{1}{4}$  bends may be used on vertical stacks if change in direction of flow is from horizontal to vertical. Long turn double wye branch and  $\frac{1}{8}$  bend fittings shall be used if two fixtures are installed back to back or side by side with common drain pipe. Do not change direction of flow more than 90 degrees. Proper size of standard increaser and reducers shall be used if pipes of different sizes are connected. Reducing size of drainage piping in direction of flow is prohibited.

- J. Cast iron piping shall be installed according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook," Chapter IV, "Installation of Cast Iron Soil Pipe and Fittings"
- K. Aboveground copper tubing shall be installed according to CDA's "Copper Tube Handbook".

### **3.2 JOINT CONSTRUCTION**

- A. Hub and spigot, cast iron piping with gasket joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for compression joints.
- B. Hub and spigot, cast iron piping with calked joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for lead and oakum calked joints.
- C. Hubless, cast iron piping shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for hubless piping coupling joints.
- D. For threaded joints, thread pipe with tapered pipe threads according to ASME B1.20.1. The threads shall be cut full and clean using sharp disc cutters. Threaded pipe ends shall be reamed to remove burrs and restored to full pipe inside diameter. Pipe fittings and valves shall be joined as follows:
  - 1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is required by the pipe service
  - 2. Pipe sections with damaged threads shall be replaced with new sections of pipe.
- E. Copper tube and fittings with soldered joints shall be joined according to ASTM B828. A water flushable, lead free flux conforming to ASTM B813 and a lead free alloy solder conforming to ASTM B32 shall be used.
- F. for PVC piping, solvent cement joints shall be used for joints. All surfaces shall be cleaned and dry prior to applying the primer and

solvent cement. Installation practices shall comply with ASTM F402.

The joint shall conform to ASTM D2855 and ASTM D2665 appendixes.

### **3.3 SPECIALTY PIPE FITTINGS**

- A. Transition coupling shall be installed at pipe joints with small differences in pipe outside diameters.
- B. Dielectric fittings shall be installed at connections of dissimilar metal piping and tubing.

### **3.4 PIPE HANGERS, SUPPORTS AND ACCESSORIES:**

- A. All piping shall be supported according to the International plumbing code, Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, and these specifications.
- B. Hangers, supports, rods, inserts and accessories used for Pipe supports shall be shop coated with zinc Chromate primer paint. Electroplated copper hanger rods, hangers and accessories may be used with copper tubing.
- C. Horizontal piping and tubing shall be supported within 300 mm (12 inches) of each fitting or coupling.
- D. Horizontal cast iron piping shall be supported with the following maximum horizontal spacing and minimum hanger rod diameters:
  - 1. NPS 1-1/2 to NPS 2 (DN 40 to DN 50): 1500 mm (60 inches) with 10 mm (3/8 inch) rod.
  - 2. NPS 3 (DN 80): 1500 mm (60 inches) with 13 mm (1/2 inch) rod.
  - 3. NPS 4 to NPS 5 (DN 100 to DN 125): 1500 mm (60 inches) with 16 mm (5/8 inch) rod.
  - 4. NPS 6 to NPS 8 (DN 150 to DN 200): 1500 mm (60 inches) with 19 mm (3/4 inch) rod.
  - 5. NPS 10 to NPS 12 (DN 250 to DN 300): 1500 mm (60 inches) with 22 mm (7/8 inch) rod.
- E. The maximum support spacing for horizontal plastic shall be 1.22 m (4 feet).
- F. Vertical piping and tubing shall be supported at the base, at each floor, and at intervals no greater than 4.57 m (15 feet).
- G. In addition to the requirements in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, floor, Wall and Ceiling Plates shall have the following characteristics:
  - 1. Solid or split unplated cast iron.
  - 2. All plates shall be provided with set screws.
  - 3. Height adjustable clevis type pipe hangers.

4. Adjustable Floor Rests and Base Flanges shall be steel.
  5. Hanger Rods shall be low carbon steel, fully threaded or Threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
  6. Riser Clamps shall be malleable iron or steel.
  7. Roller shall be cast iron.
  8. Hangers and supports utilized with insulated pipe and tubing shall have 180 degree (min.) metal protection shield Centered on and welded to the hanger and support. The shield shall be 4 inches in length and be 16 gage steel. The shield shall be sized for the insulation.
- H. Miscellaneous Materials shall be provided as specified, required, directed or as noted on the drawings for proper installation of hangers, supports and accessories. If the vertical distance exceeds 6 m (20 feet) for cast iron pipe additional support shall be provided in the center of that span. All necessary auxiliary steel shall be provided to provide that support.
- I. Cast escutcheon with set screw shall be installed at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
- J. Penetrations:
1. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoke partitions, or floors, a fire stop shall be installed that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING. Clearances between raceways and openings shall be completely filled and sealed with the fire stopping materials.
  2. Water proofing: At floor penetrations, Clearances around the pipe shall be completely sealed and made watertight with sealant as specified in Section 07 92 00, JOINT SEALANTS.
- K. Piping shall conform to the following:
1. Storm Water Drain and Vent Drain to main stacks:

Pipe Size	Minimum Pitch
80 mm (3 inches) and smaller	2%
100 mm (4 inches) (4 inches) and larger	1%



### 3.5 TESTS

- A. Storm sewer system shall be tested either in its entirety or in sections.
- B. Storm Water Drain tests shall be conducted before trenches are backfilled or fixtures are connected. A water test or air test shall be conducted, as directed.
  - 1. If entire system is tested with water, tightly close all openings in pipes except the highest opening, and fill system with water to point of overflow. If system is tested in sections, tightly plug each opening except highest opening of section under test, fill each section with water and test with at least a 3 m (10 foot) head of water. In testing successive sections, test at least upper 3 m (10 feet) of next preceding section so that each joint or pipe except upper most 3 m (10 feet) of system has been submitted to a test of at least a 3 m (10 foot) head of water. Water shall be kept in the system, or in portion under test, for at least 15 minutes before inspection starts. System shall then be tight at all joints.
  - 2. For an air test, an air pressure of 35 kPa (5 psi) gage shall be maintained for at least 15 minutes without leakage. A force pump and mercury column gage shall be used for the test.
  - 3. Final Tests: Either one of the following tests may be used.
    - a. Smoke Test: After fixtures are permanently connected and traps are filled with water, fill entire drainage and vent systems with smoke under pressure of 1.3 kPa (1 inch of water) with a smoke machine. Chemical smoke is prohibited.
    - b. Peppermint Test: Introduce .06 liters (2 ounces) of peppermint into each line or stack.

- - - E N D - - -



**SECTION 22 40 00  
PLUMBING FIXTURES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

Plumbing fixtures, associated trim and fittings necessary to make a complete installation from wall or floor connections to rough piping, and certain accessories.

**1.2 RELATED WORK**

- A. Sealing between fixtures and other finish surfaces: Section 07 92 00, JOINT SEALANTS.
- B. Flush panel access doors: Section 08 31 13, ACCESS DOORS AND FRAMES.
- C. Through bolts: Section 10 21 13, TOILET COMPARTMENTS.
- D. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- E. SECTION 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.  
Requirements for commissioning, systems readiness checklist, and training.

**1.3 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Submit plumbing fixture information in an assembled brochure, showing cuts and full detailed description of each fixture.

**1.4 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standard Institute (ANSI):  
The American Society of Mechanical Engineers (ASME):  
A112.6.1M-02 (R2008).....Floor Affixed Supports for Off-the-Floor  
Plumbing Fixtures for Public Use  
A112.19.1M-08 .....Enameled Cast Iron Plumbing Fixtures  
A112.19.2M-03.....Vitreous China Plumbing Fixtures  
A112.19.3-2001 (R2008)...Stainless Steel Plumbing Fixtures (Designed for  
Residential Use)
- C. American Society for Testing and Materials (ASTM):  
A276-2010 .....Stainless and Heat-Resisting Steel Bars and  
Shapes  
WW-P-541-E/GEN .....Plumbing Fixtures with Amendment 1

- D. National Association of Architectural Metal Manufacturers (NAAMM):  
NAAMM AMP 500-505.....Metal Finishes Manual (1988)
- E. American Society of Sanitary Engineers (ASSE):  
1016-05.....Performance Requirements for Individual  
Thermostatic, Pressure Balancing and Combination  
Pressure Balancing and Thermostatic Control  
Valves for Individual Fixture Fittings
- F. NSF International (NSF)  
NSF/ANSI 14 (2013).....Plastics Piping System Components and Related  
Materials  
NSF/ANSI 61 (2012).....Drinking Water System Components - Health  
Effects  
NSF/ANSI 372 (2011) Drinking Water System Components - Lead Content
- G. American with Disabilities Act (A.D.A) Section 4-19.4 Exposed Pipes and  
Surfaces
- H. Environmental Protection Agency EPA PL 93-523 1974; A 1999) Safe  
Drinking Water Act.
- I. International Building Code, ICC IPC 2012.

## **PART 2 - PRODUCTS**

### **2.1 MATERIALS**

- A. Material or equipment containing a weighted average of greater than 0.25 percent lead shall not be used in any potable water system intended for human consumption, and shall be certified in accordance with NSF/ANSI 61 or NSF 372. Endpoint devices used to dispense water for drinking must meet the requirements of NSF/ANSI 61, Section 9.
- B. Plastic pipe, fittings, and solvent cement shall meet NSF/ANSI 14 and shall be NSF listed for the service intended.

### **2.2 STAINLESS STEEL**

- A. Corrosion-resistant Steel (CRS):
  - 1. Plate, Sheet and Strip: CRS flat products shall conform to chemical composition requirements of any 300 series steel specified in ASTM A276.
  - 2. Finish: Exposed surfaces shall have standard polish (ground and polished) equal to NAAMM finish Number 4.
- B. Die-cast zinc alloy products are prohibited.

### **2.3 STOPS**

- A. Provide lock-shield loose key or screw driver pattern angle stops, straight stops or stops integral with faucet, with each compression type faucet whether specifically called for or not, including sinks in wood

and metal casework, laboratory furniture and pharmacy furniture. Locate stops centrally above or below fixture in accessible location.

- B. Furnish keys for lock shield stops to Contracting Officers Representative (COR).
- C. Supply from stops not integral with faucet shall be chrome plated copper flexible tubing or flexible stainless steel with inner core of non-toxic polymer.
- D. Supply pipe from wall to valve stop shall be rigid threaded IPS copper alloy pipe, i.e. red brass pipe nipple, chrome plated where exposed.

#### **2.4 ESCUTCHEONS**

Heavy type, chrome plated, with set screws. Provide for piping serving plumbing fixtures and at each wall, ceiling and floor penetrations in exposed finished locations and within cabinets and millwork.

#### **2.5 LAMINAR FLOW CONTROL DEVICE**

- A. Smooth, bright stainless steel or satin finish, chrome plated metal laminar flow device shall provide non-aeration, clear, coherent laminar flow that will not splash in basin. Device shall also have a flow control restrictor and have vandal resistant housing.
- B. Flow Control Restrictor:
  - 1. Capable of restricting flow from 0.5 gpm to 1.0 gpm for lavatories; 2.0 gpm to 2.2 gpm for sinks P-505 through P-520, P-524 and P-528; and 2.75 gpm to 3.0 gpm for dietary food preparation and rinse sinks or as specified.
  - 2. Compensates for pressure fluctuation maintaining flow rate specified above within 10 percent between 170 kPa and 550 kPa (25 psi and 80 psi).
  - 3. Operates by expansion and contraction, eliminates mineral/sediment build-up with self-cleaning action, and is capable of easy manual cleaning.

#### **2.6 CARRIERS**

- A. ASME/ANSI A112.6.1M, with adjustable gasket faceplate chair carriers for wall hung closets with auxiliary anchor foot assembly, hanger rod support feet, and rear anchor tie down.
- B. ASME/ANSI A112.6.1M, lavatory, chair carrier for thin wall construction or steel plate as detailed on drawing. All lavatory chair carriers shall be capable of supporting the lavatory with a 250-pound vertical load applied at the front of the fixture.
- C. Where water closets, lavatories or sinks are installed back-to-back and carriers are specified, provide one carrier to serve both fixtures in lieu of individual carriers. The drainage fitting of the back to back

carrier shall be so constructed that it prevents the discharge from one fixture from flowing into the opposite fixture.

## **2.7 FINISH**

Exposed plumbing fixtures surfaces to be provided with a factory applied antimicrobial finish.

## **2.8 WATER CLOSETS**

A. (P-103) Water Closet (Wall Hung, ASME/ANSI A112.19.2M, Figure 9) HET (high efficiency toilet) office and industrial, elongated bowl, siphon jet 4.8 L (1.28 gallons) per flush, wall outlet. Top of rim shall be between 406 mm and 432 mm (16 inches and 17 inches) above finished floor. Handicapped water closet shall have rim set 432 mm (17 inches) above finished floor.

1. Seat: Institutional/Industrial, extra heavy duty, chemical resistant, solid plastic, open front less cover for elongated bowls, integrally molded bumpers, concealed check hinge with stainless steel post. Seat shall be posture contoured body design. Color shall be white.
2. Fittings and Accessories: Gaskets - neoprene; bolts with chromium plated caps nuts and washers.
3. Flush valve: Large chloramines resistant diaphragm, semi-red brass valve body, exposed chrome plated, electronic infra-red sensor for automatic operation with courtesy flush button for manual operation with low voltage wire from transformer HET water saver design 4.8 L (1.28 gallons) per flush with maximum 10 percent variance 25 mm (1 inch) screwdriver back check angle stop with vandal resistant cap, adjustable tailpiece, a high back pressure vacuum breaker, spud coupling for 38 mm (1 1/2 inches) top spud, wall and spud flanges, and sweat solder adapter with cover tube and set screw wall flange. Valve body, cover, tailpiece and control stop shall be in conformance with ASTM alloy classification for semi-red brass. Seat bumpers shall be integral part of flush valve. Set centerline of inlet 292 mm (11 1/2 inches) above rim.

## **2.9 URINALS**

- A. (P-203) Urinal (Wall hung ASME/ANSI A112.19.2M) HEU (high efficiency urinal) bowl with washout flush action, wall to front flare 356 mm (14 inches). Vitreous china, wall hung with integral trap 0.5L (0.125 gallons) per flush with 51 mm (2 inches) back outlet and 19 mm (3/4 inch) back spud inlet. Flush valve 290 mm (11 1/2 inches) above urinal.
1. Support urinal with chair carrier and install with rim at 600 mm (24 inches) above finished floor.

2. Flushing device: Large chloramines resistant diaphragm, semi-red brass bodied, chrome plated exposed HEU water saver design flush valve with 19 mm (3/4 inch) capped screwdriver angle stop, connection for spud connection and metal oscillating chrome plate, electronic sensor operated, active infrared for automatic operation with low voltage wire from transformer.

## **2.10 LAVATORIES**

- A. Dimensions for lavatories are specified, Length by width (distance from wall) and depth.
- B. Brass components in contact with water shall contain no more than 3 percent lead content by dry weight.
- C. (P-404) Lavatory (Bowl Integral with Countertop):
  1. Faucet: Solid cast brass construction, chrome plated, gooseneck spout 102 by 127 mm (4 to 5 inches) above the rim, electronic sensor operated, four-inch center set mounting, wiring box, 120/24 volt remote mounted transformer, thermostatic mixing valve with check valves, inline filter and solenoid valve with timed auto flush. Provide laminar flow control device.
  2. Mixing Valve: Type T/P combination thermostatic and pressure balancing. Valve body shall be copper alloy. Internal parts shall be copper, nickel alloy, CRS or thermostatic material. Valve inlet and outlet shall be 13 mm (1/2 inch) IPS. Provide external screwdriver checkstops and temperature limit stop. Set stops for a maximum temperature of 35 degrees C (95 degrees F).
  3. Drain: Cast or wrought brass with flat grid strainer and offset tailpiece, chrome plated finish.
  4. Stops: Angle type. See paragraph 2.2. Stops
  5. Trap: Cast copper alloy, 38 mm by 32 mm (1 1/2 inches by 1 1/4 inches) P-trap. Adjustable with connected elbow and 1.4 mm thick (17 gauge) tubing extension to wall. Exposed metal trap surface and connection hardware shall be chrome plated with a smooth bright finish. Set trap parallel to wall.
  6. Provide cover for drain, stops and trap per A.D.A 4-19.4.
- D. (P-418) Lavatory (Sensor Control, Gooseneck Spout, ASME/ANSI A112.19.2M, Figure 16) straight back, approximately 508 mm by 457 mm (20 inches by 18 inches) and a 102 mm (4 inches) minimum apron, first quality vitreous china with punching for gooseneck spout. Set rim 864 mm (34 inches) above finished floor.
  1. Faucet: Solid cast brass construction, chrome plated, gooseneck spout with outlet 102 mm to 127 mm (4 inches to 5 inches) above rim.

- Electronic sensor operated, 102 mm (4 inches) center set mounting, wiring box, 120/24 volt remote mounted transformer, and inline filter and solenoid valve with timed auto flush. Provide laminar flow control device. Breaking the light beam shall activate the water flow. Flow shall stop when user moves away from light beam. All connecting wiring between transformer, solenoid valve and sensor shall be cut to length with no excess hanging or wrapped up wiring allowed.
2. Mixing Valve: Type T/P combination thermostatic and pressure balancing. Valve body shall be copper alloy. Internal parts shall be copper, nickel alloy, CRS or thermostatic material. Valve inlet and outlet shall be 13 mm (1/2 inch) IPS. Provide external screwdriver checkstops and temperature limit stop. Set stops for a maximum temperature of 35 degrees C (95 degrees F).
  3. Drain: Cast or wrought brass with flat grid strainer with offset tailpiece, brass, chrome plated.
  4. Stops: Angle type. See paragraph 2.2.Stops
  5. Trap: Cast copper alloy, 38 mm by 32 mm (1 1/2 inches by 1 1/4 inches)P-trap. Adjustable with connected elbow and 17 gage tubing extension to wall. Exposed metal trap surface and connection hardware shall be chrome plated with a smooth bright finish. Set trap parallel to wall.
  6. Provide cover for drain, stops and trap per A.D.A 4-19.4.

## **2.11 SINKS AND LAUNDRY TUBS**

- A. Dimensions for sinks and laundry tubs are specified, length by width (distance from wall) and depth.
  - B. (P-502) Service Sink (Corner, Floor Mounted) stain resistant terrazzo, 711 mm by 711 mm by 305 mm (28 inches by 28 inches by 12 inches) with 152 mm (6 inches) drop front. Terrazzo, composed of marble chips and white Portland cement, shall develop compressive strength of 20684 kPa (3000 psi) seven days after casting. Provide extruded aluminum cap on front side.
1. Faucet: Solid brass construction, combination faucet with replaceable monel seat, removable replacement unit containing all parts subject to wear, integral stops and check valves, mounted on wall above sink. Spout shall have a pail hook, 19 mm (3/4 inch) hose coupling threads, vacuum breaker, and top or bottom brace to wall. Four-arm handles on faucets shall be cast, formed, or drop forged copper alloy. Escutcheons shall be either forged copper alloy or CRS. Exposed metal parts, including exposed part under valve handle when in open



- position, shall have a smooth bright finish. Provide 914 mm (36 inches) hose with wall hook. Centerline of rough in is 1219 mm (48 inches) above finished floor.
2. Drain: Seventy six millimeter (3 inches) cast brass drain with nickel bronze strainer.
  3. Trap: P-trap, drain through floor.
- C. (P-505) Clinic Service Sink (Flushing Rim, Wall Hung) approximately 508 mm by 635 mm (20 inches by 25 inches) by 203 mm (8 inches) deep. Support with ASME/ANSI A112. 6.1M chair carrier and secure with 10 mm (3/8 inch) bracket studs and nuts. Set sink with rim 762 mm (30 inches) above finished floor. Provide 762 mm (30 inches) CRS drainboard where required, without corrugations and with heavy duty CRS brackets.
1. Faucet: Elbow control, wall hung, integral stops, single spout with 19 mm (3/4 inch) hose threaded outlet and pail hook, vacuum breaker and brace to wall. Outlet 356 mm to 381 mm (14 inches to 15 inches) from wall. Exposed metal parts shall be chromium plated with a smooth bright finish. Provide laminar flow control device.
  2. Flush valve: Large diaphragm, semi-red brass body, Foot pedal operated, exposed chromium plated flush valve with screwdriver back check straight stop with cap, union outlet, street ells, elevated high pressure vacuum breaker, casing cover, 32 mm (1 1/4 inches) elbow flush connection from finished wall to 38 mm (1 1/2 inches) top spud. Spud coupling, wall and spud flanges.
  3. Bed Pan Washer: Mechanical pedal mixing valve, wall hung, with double self-closing pedal valve with loose key stops, renewable seats and supply from valve to nozzle with wall hook hose connection; 1219 mm (48 inches) of heavy duty rubber hose, with extended spray outlet elevated vacuum breaker, indexed lift up pedals having clearance of not more than 13 mm (1/2 inch) above the floor and not less than 356 mm (14 inches) from wall when in operation. Supply pipe from wall to valve stop shall be rigid, threaded, IPS copper alloy pipe. Exposed metal parts shall be chromium plated with a smooth bright finish. Provide valve plate for foot control. Provide inline laminar flow control device.
- D. (P-519) Sink (Surgeons Scrub-up, Sensor Control) Double units approximately 1600 mm by 559 mm (63 inches by 22 inches) and 305 mm (12 inches) deep.
1. Construction: Provide a minimum of 16 gage, Type 302/304 stainless steel, with exposed welds grounded and polished to blend with adjacent surfaces. Sound deadened front and back, front access panel,

- splash-retarding angle design. Exterior surfaces shall have a uniformed NAAMM Number 4 finish. Mount sink with wall hanger and stainless steel support brackets and ASME/ANSI A112.6.IM, Type III, heavy duty chair carriers and secure fixture with minimum 3/8-inch bracket studs and nuts. Cove corners with 6 mm (1/4 inch) radius. Set sink rim 914 mm (36 inches) above finished floor as shown.
2. Equip each scrub bay with an infrared photocell sensor to control water flow automatically, solenoid valve and thermostatic valve. Breaking the light beam shall activate the water flow. Flow shall stop when the user moves away from light beam. Sensor may be wall mounted, deck mounted or integral with faucet.
  3. Valve: Type T/P combination thermostatic and pressure balancing with chrome plated metal lever type operating handle and chrome plated metal or CRS face plate. Valve body shall be any suitable copper alloy. Internal parts shall be copper, nickel alloy, CRS or thermoplastic material. Valve inlet and outlet shall be IPS. Provide external screwdriver check stops, and temperature limit stops. Set stops for a maximum temperature of 43 degrees C (110 degrees F). All exposed fasteners shall be vandal resistant. Valve shall provide a minimum of 380 ml/s at 310 kPa (6 gpm at 45 psi) pressure drop.
  4. Gooseneck Spout: For each scrub bay, provide gooseneck spout with laminar flow device. Spout and trim shall be cast or wrought copper alloy and be chrome plated with smooth bright finish.
  5. Grid Drain: Stainless steel stamped drain fitting, 114 mm (4 1/2 inches) top with 76 mm (3 inches) grid and 38 mm (1 1/2 inches) tailpiece.
  6. Trap: Cast copper alloy, 38 mm (1 1/2 inches) P-trap, adjustable with connected elbow and nipple to the wall. Exposed metal trap surfaces and connection hardware shall be chrome plated with smooth bright finish.
  7. Shelf: Surface mounted of Type 304 stainless steel with exposed surface in satin finish and stainless steel support brackets. Shelf shall be 203 mm (8 inches) wide and length as shown on the drawings.
- E. (P-528) Sink (CRS, Single Compartment, Counter Top ASME/ANSI A112.19.2M, Figure 5) under countertop mounted, approximately 533 mm by 559 mm (21 inches by 22 inches) with single compartment inside dimensions approximately 406 mm by 483 mm by 191 mm (16 inches by 19 inches by 7 1/2 inches) deep. Shall be minimum of 1.3 mm thick (18 gauge) CRS. Corners and edges shall be well rounded:

1. Faucet: Solid brass construction, deck mounted combination faucet with monel or ceramic seats, removable replacement unit containing all parts subject to wear, swivel gooseneck spout with approximately 203 mm (8 inches) reach with spout outlet 152 mm (6 inches) above deck and 102 mm (4 inches) wrist blades. Faucet shall be polished chrome plated.
2. Mixing Valve: Type T/P combination thermostatic and pressure balancing with lever operating handle. Valve body shall be copper alloy. Internal parts shall be copper, nickel alloy, CRS or thermostatic material. Valve inlet and outlet shall be 13 mm (1/2 inch) IPS. Provide external screwdriver checkstops and temperature limit stop. Set stops for a maximum temperature of 35 degrees C (95 degrees F).
3. Drain: Drain plug with cup strainer, stainless steel.
4. Trap: Cast copper alloy 38 mm (1 1/2 inches) P-trap with cleanout plug. Provide wall connection and escutcheon.  
Provide cover for drain, stops and trap per A.D.A 4-19.4.

## **2.12 DISPENSER, DRINKING WATER**

- A. (P-609) Electric Water Cooler: Mechanically cooled, self contained, wheel chair, bubbler style fully exposed dual height stainless steel fountain, recessed in wall refrigeration system, stainless steel grille, stainless steel support arm, wall mounting box, energy efficient cooling system consisting of a hermetically sealed reciprocating type compressor, 115v, 60 Hz, single phase, fan cooled condenser, permanently lubricated fan motor. Set highest bubbler 1016 mm (40 inches) above finished floor.

## **2.13 SHOWER BATH FIXTURE**

- A. (P-704) Shower Bath Fixture (Wall Mounted, Concealed Supplies, Hose Spray):
  1. Shower Installation: Wall mounted showerhead connected to shower arm.
  2. Shower Heads: Chrome plated metal head, adjustable ball joint, self cleaning head with automatic flow control device to limit discharge to not more than two (2) gpm. Body, internal parts of shower head and flow control fittings shall be copper alloy or CRS. Install showerhead 1829 mm (72 inches) above finished floor.
  3. Valves: Type T/P combination temperature and pressure balancing, with chrome plated metal lever type operating with adjustment for rough-in variations handle and chrome plated metal or CRS face plate. Install diverter selector valve and elevated vacuum breaker to provide tempered water to shower head and hose spray. Valve body shall be any

- suitable copper alloy. Internal parts shall be copper nickel alloy, CRS or thermoplastic material. Valve inlet and outlet shall be 13 mm (1/2 inch) IPS. Provide external screwdriver check stops, and temperature limit stops. Set stops for a maximum temperature of 105 degrees F. All exposed fasteners shall be vandal resistant. Valve shall provide a minimum of 160 ml/s at 310 kPa (2.5 gpm at 45 psi) pressure drop.
4. Spray Assembly: Shall consist of a 1524 mm (60 inches) length of rubber lined CRS, chrome plated metal flexible, or white vinyl reinforced hose with coupling for connection to 13 mm (1/2 inch) hose supply elbow protruding through wall. Spray shall consist of a self-closing, lever-handle, faucet with thumb control having open-shut positions and intermediate positions for regulating water flow and elevated pressure type vacuum breaker. Provide wall hook for faucet.

#### **2.14 HYDRANT, HOSE BIBB AND MISCELLANEOUS DEVICES**

- A. (P-804) Hose Bibb (Single Faucet, Wall Mounted to Concealed Supply Pipe): Cast or wrought copper alloy, single faucet with replaceable monel seat, removable replacement unit containing all parts subject to wear, mounted on wall 914 mm (36 inches) above floor to concealed supply pipe. Provide faucet with 19 mm (3/4 inch) hose coupling thread on spout and vacuum breaker. Four-arm handle on faucet shall be cast, formed or drop forged copper alloy. Escutcheons shall be either forged copper alloy or CRS. Exposed metal parts, including exposed part under valve handle when in open position, shall have a bright finish.
- B. (P-811) Ice Maker Box: Recessed metal wall box with powder coated white finish. Provide 1/4 inch compression fitting connection supply outlet with quarter turn isolation ball valve.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Fixture Setting: Opening between fixture and floor and wall finish shall be sealed as specified under Section 07 92 00, JOINT SEALANTS.
- B. Supports and Fastening: Secure all fixtures, equipment and trimmings to partitions, walls and related finish surfaces. Exposed heads of bolts and nuts in finished rooms shall be hexagonal, polished chrome plated brass with rounded tops.
- C. Through Bolts: For free standing marble and metal stud partitions refer to Section 10 21 13, TOILET COMPARTMENTS.
- D. Toggle Bolts: For hollow masonry units, finished or unfinished.
- E. Expansion Bolts: For brick or concrete or other solid masonry. Shall be 6 mm (1/4 inch) diameter bolts, and to extend at least 76 mm (3 inches)

into masonry and be fitted with loose tubing or sleeves extending into masonry. Wood plugs, fiber plugs, lead or other soft metal shields are prohibited.

- F. Power Set Fasteners: May be used for concrete walls, shall be 6 mm (1/4 inch) threaded studs, and shall extend at least 32 mm (1 1/4 inches) into wall.
- G. Tightly cover and protect fixtures and equipment against dirt, water and chemical or mechanical injury.
- H. Where water closet waste pipe has to be offset due to beam interference, provide correct and additional piping necessary to eliminate relocation of water closet.
- I. Do not use aerators on lavatories and sinks.

### **3.2 CLEANING**

At completion of all work, fixtures, exposed materials and equipment shall be thoroughly cleaned.

### **3.3 COMMISSIONING**

- A. Provide commissioning documentation in accordance with the requirements of Section 22 08 00 - COMMISSIONING OF PLUMBING SYSTEMS for all inspection, startup, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 22 08 00 - COMMISSIONING OF PLUMBING SYSTEMS and related sections for contractor responsibilities for system commissioning.

- - - E N D - - -



**SECTION 22 62 00**  
**VACUUM SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Central Laboratory and Healthcare Vacuum Systems: This section describes the labor, equipment, and services necessary for and incidental to the installation of piped medical vacuum systems. Medical vacuum systems shall be installed started, tested, and ready for use. The scope of work shall include all necessary piping, fittings, valves, cabinets, station outlets and inlets, rough ins, ceiling services, gages, alarms including low voltage wiring, and all necessary parts, accessories, connections and equipment. Match existing station inlet terminal connections.
- B. The contractor shall provide all elements and accessories required for a complete system according to the most recent edition of NFPA 99C, Gas and Vacuum Systems.
- C. All necessary connections to owner furnished equipment shall be made as indicated on the documents. A separate construction isolation valve shall be made at the point of connection to an existing vacuum system.
- D. Electrical power and control wiring for ceiling columns and equipment booms, alarms wiring from equipment to alarm panels, and modular accessories associated with the system(s) shall be included.
- E. Pressure testing, cross connection testing and final testing per NFPA 99 most recent edition and using procedures shall be performed.
- G. Coordinate with owner retained verifier for final verification of the systems. Make corrections as required, including additional testing if necessary to attain full and unqualified certification.

**1.2 RELATED WORK**

- A. Section 07 84 00, FIRESTOPPING: Sealing around pipe penetrations to maintain the integrity of time rated construction.
- B. Section 07 92 00, JOINT SEALANTS: Sealing around pipe penetrations through the floor to prevent moisture migration.
- C. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: General requirements and items common to more than one section of Division 22.
- D. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Alarm interface with ECC.

- E. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduit.
- F. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Control wiring.
- G. Section 26 27 26, WIRING DEVICES: Electrical wiring and accessories.
- H. Section 10 25 13, PATIENT BED SERVICE WALLS: Prefabricated bedside patient units.
- I. Section 22 63 00, GAS SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES: Laboratory and Healthcare Gases and Vacuum Alarms.
- J. SECTION 22 63 00, GAS SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES: Laboratory and Healthcare Gas Piping and Equipment.

### **1.3 QUALITY ASSURANCE**

- A. Installation and Start-up: The manufacturer will provide factory authorized representatives to review installation and perform initial start up of system.
- B. Contractor shall include with submittals an affidavit attesting to compliance with all relevant paragraphs of NFPA 99 most recent edition. Personnel assembling medical vacuum system shall meet NFPA 99 5.1.10.10.11 "Qualification of Installers" and hold medical gas endorsements as under ASSE 6010. The Contractor shall furnish documentation attesting that all installed piping materials were purchased cleaned and complied with the requirements of NFPA 99 5.1.10.1 and 5.1.10.2. Electrical Control systems and Medical vacuum Alarms are to be UL listed as assemblies with label affixed. Medical vacuum controls are to be wired in accordance with NEC.
- C. Equipment Installer: The equipment installer shall show documentation proving that the personnel installing the equipment meet the standards set by the American Society of Sanitary Engineers (ASSE) 6010 Professional Qualification Standards for Medical Gas System Installers. Show technical qualifications and previous experience in installing medical gas equipment on three similar projects. Submit names and addresses of referenced projects. The equipment install shall perform the following coordination functions:
  - 1. Coordinate with other trades to ensure timely installations and avoid conflicts and interferences.
  - 2. Work with the metal stud partition installer and/or mason to ensure anchors, sleeves and similar items are provided in sufficient time to avoid delays; chases and openings are properly sized and prepared.



3. Coordinate with VA to ensure medical vacuum inlets, whether owner supplied or contractor supplied, in walls, ceiling and all equipment is provided by the same Medical Vacuum Equipment Manufacturer satisfactory to the owner.
  4. The contractor shall coordinate with the Medical Vacuum System Verifier to deliver a complete, tested medical gas installation ready for owner's use.
- D. Equipment Supplier: The Equipment supplier shall demonstrate evidence of installing equivalent product at three installations similar to this project that has been in satisfactory and efficient operation for three years. Names and addresses where the product is installed shall be submitted for verification.
- E. Medical Gas System Testing Organization: The Medical vacuum verifier shall show documentation proving that the medical gas verifier meet the standards set by the American Society of Sanitary Engineers (ASSE) 6010 Professional Qualification Standards for Medical Gas System Verifiers. The testing shall be conducted by a party technically competent and experienced in the field of medical gas pipeline testing. Such testing shall be performed by a party other than the installing contractor.
- F. Names of three projects where testing of vacuum systems has been performed by the testing agency shall be provided. The name of the project, names of such persons at that project who supervised the work for the project owner, or who accepted the report for the project owner, and a written statement that the projects listed required work of similar scope to that set forth in this specification shall be included in the documentation.
- G. The testing agency's detailed procedure which will be followed in the testing of this project shall be submitted. In the testing agency's procedure documentation, include details of the testing sequence, procedures for cross connection tests, outlet function tests, alarm tests, purity tests, etc., as required by this specification. For purity test procedures, data on test methods, types of equipment to be used, calibration sources and method references shall be submitted.
- H. Installation and Start-up: The manufacturer shall provide factory authorized representatives to review the installation and perform the initial startup of the system. The factory authorized representatives shall submit a report to the Contracting Officer Representative and to

the Contractor. The Contractor shall make all corrections identified by the factory authorized representative.

- I. Certification: The Final inspection documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and a certification that all results of tests were within limits allowed by this specification.
- J. The installing contractor shall maintain as-built drawings of each completed phases for verification; and, shall provide the complete set at the time of final systems certification testing, for certification by the Third Party Testing Company. As-built drawings shall be provided, and a copy of them on Auto-Cad version (R-14 or later) provided on compact disk.

#### **1.4 SUBMITTALS**

- A. Submit as one package in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
  - 1. Complete specifications for the product intended to be installed, dimensional drawings, and wiring schematics.
  - 2. Package drawing indicating package style, dimensions when complete, method of disassembly and sizes of subsections for rigging and installation.
  - 3. Piping.
  - 4. Valves.
  - 5. Inlet and outlet cocks
  - 6. Valve cabinets.
  - 7. Gages.
  - 8. Station inlets, and rough in assemblies.
  - 9. Ceiling services.
  - 10. Alarm controls and panels.
  - 11. Vacuum switches.
  - 12. Vacuum bottle brackets.
- C. Station Inlets: A letter from manufacturer shall be submitted stating that inlets are designed and manufactured to comply with NFPA 99. Inlet shall bear label of approval as an assembly, of Underwriters Laboratories, Inc., or Associated Factory Mutual Research Corporation. In lieu of above labels, certificate may be submitted by a nationally recognized independent testing laboratory, satisfactory to the

Contracting Officer, certifying that materials, appliances and assemblies conform to published standards, including methods of tests, of above organizations.

- D. Certification: The completed systems have been installed, tested, purged and analyzed in accordance with the requirements of this specification. Certification shall be submitted to Contracting Officer Representative.
- E. A notarized affidavit from the verifier stating that the verifier undertakes to verify this project and thus agrees to disqualify themselves from supplying any equipment which will be included in the scope of their verification. No verifier who supplies equipment shall be permitted to verify that equipment. Statement declaring that the vacuum system manufacturer has no fiduciary interest in the verifier and that the verifier is not an agent or representative of the vacuum system manufacturer. Statement declaring that the contractor has no fiduciary interest in the third party verifier and that the third party verifier has no fiduciary interest in the contractor.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the test by the basic designation only.
- B. American National Standards Institute (ANSI):
  - A13.1-2007.....Scheme for Identification of Piping Systems
  - B16.22-01 (R2005).....Wrought Copper and Bronze Solder-Joint Pressure Fittings
  - B40.1-(2005)..... Pressure Gauges and Gauge Attachments
- C. American Society for Testing and Materials (ASTM):
  - B819-00 (R2006).....Standard Specification for Seamless Copper Tube for Medical Gas Systems
- D. American Society of Mechanical Engineers (ASME):
  - Section IX-10.....Welding and Brazing Qualifications
- E. American Welding Society (AWS):
  - AWS A5.8/A5.8M-11.....Brazing Filler Metal
  - AWS B2.2/B2.2M-10.....Standard for Brazing Procedure and Performance Qualification (Modified per NFPA 99)
- F. Compressed Gas Association (CGA):
  - P-9-08.....Inert Gases Argon, Nitrogen and Helium
- G. National Electrical Manufacturers Association (NEMA):

ICS-6-1993 (R 2006).....Industrial Controls and Systems Enclosures

H. National Fire Protection Association (NFPA):

99-2012.....Health Care Facilities

I. National Electrical Code 70, edition (2011)

J. United States Pharmacopoeia XXI/National Formulary XVI (USP/NF)

K. Manufacturing Standardization Society (MSS):

MSS-SP-72-99.....Ball Valves With Flanged or Butt Welding For  
General Purpose

MSS-SP-110-96.....Ball Valve Threaded, Socket Welding, Solder  
Joint, Grooved and Flared Ends

MSS-SP-73-03.....Brazing Joints for Copper and Copper Alloy  
Solder Pressure Fittings

## **1.6 WARRANTY**

- A. Warranty will be expressly complete, include all components of the system and be the responsibility of the manufacturer of record only. Warranties which pass through to another manufacturer are not acceptable.
- B. Warranties shall include on site repairs including travel, labor and parts. Warranties requiring return of equipment for adjustment are not acceptable.

## **PART 2 - PRODUCTS**

### **2.1 GENERAL PRODUCT REQUIREMENTS**

- A. One Medical Vacuum Equipment Manufacturer shall supply the medical vacuum equipment to include outlets, valves and gauges, valve boxes, alarm panels, and manifolds.

### **2.2 PIPING**

- A. Copper Tubing: Copper tubing shall be type "K" or "L", ASTM B819, seamless copper tube, hard drawn temper, with wrought copper fittings conforming to ANSI B16.22 or brazing fittings complying with MSS SP-73. The copper tubing size designated reflects nominal inside diameter. All tubing and fittings shall be labeled "ACR/OXY", "OXY", "OXY/MED", "ACR/MED", or "MED".
- B. Brazing Alloy: The brazing alloy shall comply with AWS A5.8, Classification BCuP, greater than 537 °C (1000 °F) melting temperature. Flux shall be strictly prohibited for copper to copper connections.
- C. Screw Joints: Screw joints shall use polytetrafluoroethylene (teflon) tape.

- D. Use only copper or stainless steel pipes for discharge from vacuum product (exhaust pipes).
- E. Memory metal couplings shall have temperature and pressure ratings not less than that of a brazed joint.
- F. Piping identification labels shall be applied at time of installation in accordance with current NFPA. Supplementary color identification shall be in accordance with CGA Pamphlet C-9.
- G. Special Fittings: The following special fittings shall be permitted to be used in lieu of brazed joints:
  - 1. Memory-metal couplings having temperature and pressure ratings joints not less than that of a brazed joint.
  - 2. Listed or approved metallic gas tube fittings that, when made up, provide a permanent joint having the mechanical, thermal, and sealing integrity of a brazed joint.
  - 3. Dielectric fittings where required by the manufacturer of special medical equipment to electrically isolate the equipment from the piping distribution system.
  - 4. Axially swaged, elastic strain preload fittings providing metal to metal seal having pressure and temperature ratings not less than that of a brazed joint and when complete are permanent and non-separable.

### **2.3 EXPOSED LABORATORY AND HEALTHCARE VACUUM PIPING**

- A. Finished Room: Use full iron pipe size chrome plated brass piping shall be used for exposed laboratory and healthcare vacuum piping connecting fixtures, casework, cabinets, equipment and reagent racks when not concealed by apron including those furnished by the Government or specified in other sections.
  - 1. Pipe: Fed. Spec. WW-P-351, standard weight.
  - 2. Fittings: Fittings shall comply with ANSI B16.15 cast bronze threaded fittings with chrome finish, (125 and 250).
  - 3. Nipples: Nipples shall comply with ASTM B 687, Chromium-plated.
  - 4. Unions: Unions shall comply with Mss SP-72, SP-110, Brass or Bronze with chrome finish. Unions 65 mm (2-1/2 inches) and larger shall be flange type with approved gaskets.
  - 5. Valves: Valves shall comply with Mss SP-72, SP-110, Brass or bronze with chrome finish.

### **2.4 VALVES**

- A. Ball: Ball valves shall be in line, other than zone valves in cabinets.

1. Sixty five millimeter or DN65 (2-1/2 inches) and smaller: Ball valves shall be bronze/ brass body, Fed. Spec. MSS SP72 & SP 110 , Type II, Class 150, Style 1, with tubing extensions for brazed connections, full ported, three piece or double union end connections, teflon seat seals, full flow, 4125 kPa (600 psi) WOG minimum working pressure, with locking type handle.

B. Check:

1. Check valves eighty millimeters (DN80) (3 inches) and smaller: brass and Bronze body, straight through design for minimum pressure drop, spring loaded, self aligning with teflon cone seat, vibration free, silent operation, supplied NPT female threads at each end with flow direction arrow permanently cast into, 2750 kPa (400 psi) WOG minimum working pressure.

- C. Zone valve in cabinet shall be ball valve with bronze/ brass body, double seal, three piece or double union end connections, replaceable teflon seat seals, teflon stem seal, 4125 kPa (600 psi) WOG, cold, non shock gas working pressure or vacuum service to 29 inch Hg, blowout proof stem, one quarter turn of handle to completely open or close. Tubing extensions, factory brazed, pressure tested, cleaned for oxygen service shall be provided. A 3 mm (1/8 inches) NPT gauge port shall be provided for a 50mm (2 inch) diameter monitoring gauge downstream of the shut off valve. Zone valves shall be securely attached to the cabinet and provided with type-K copper tube extensions for making connection to system piping outside the cabinet. Zone valves shall be products of one manufacturer, and uniform throughout in pattern, overall size and appearance. Trim with color coded plastic inserts or color coded stick on labels. Valves shall be in cabinets such that cover window cannot be in place when any valve is in the closed position. Color coding for identification plates and labels is as follows:

SERVICE LABEL	IDENTIFICATION COLORS	MFG. STD. CLR.
MEDICAL VACUUM	Black letters on white background	WHITE
Evacuation (Waste Gas)	White letters on purple background	PURPLE

## **2.5 VALVE CABINETS**

- A. Valve cabinets shall be flush mounted, commercially available item for use with medical gas services, constructed from steel not lighter than 1.3 mm (18 gage) steel or extruded aluminum not lighter than 1.9 mm (14 gage). The valve cabinets shall be rigidly assembled, of adequate size to accommodate all valve(s) and fittings indicated. Holes shall be predrilled to receive pipe connections. These pipe connections shall be made outside of the valve box. Anchors shall be provided to secure cabinet to wall construction. Openings in cabinet shall be sealed to be dust tight. Bottom of cabinet shall be located 1375 mm (4 foot 6 inches) above finished floor.
- B. Engraved rigid plastic identification plate shall be mounted on the wall above or adjacent to the cabinet. Color code identification plate to match gas identification colors as indicated above. Identification plate shall be clearly visible at all times. Inscriptions shall be provided on plate to read in substance: "VALVE CONTROL SUPPLY TO ROOMS." The final wording must be approved by the VA project manager.
- C. Cover plate: The cover plate shall be fabricated from 1.3 mm (18 gage) sheet metal with satin chromed finish, extruded anodized aluminum, or .85 mm (22 gage) stainless steel. A cover window shall be provided of replaceable plastic, with a corrosion resistant device or lever secured to window for emergency window removal. The following shall be permanently painted or stenciled on window: "FOR EMERGENCY SHUT-OFF VALVES ONLY, SHUT OFF VALVES FOR PIPED GASES", or equivalent wording. The valve cabinet shall be configured such that it is not possible to install window with any valve in the closed position. Each valve shall have a pressure gauge upstream of valve and this pressure gauge shall be inside valve box.
- D. Cabinets and isolation valves shall be located and piped as shown, and at a minimum, so as to allow the isolation of each smoke compartment separately. Each cabinet shall serve no more than one smoke compartment.

## **2.6 GAGES**

- A. Vacuum Gages:
  - 1. For vacuum service upstream of main shutoff valve: A 40 mm (1-1/2 inches) diameter gage shall be provided with steel case, bourdon tube and brass movement, dial range 0 to -100 kPa (0-30 inches Hg). Compound gages shall be provided for Vacuum system.

## **2.7 STATION INLETS**

### **A. Vacuum Station inlets:**

1. Station inlets shall be for designated service, consisting of a quick coupler, quick disconnect type to match existing inlets type with inlet supply tube.
2. The outlet station shall be made, cleaned, and packaged to NFPA 99 standards and shall be UL listed and CSA certified.
3. A coupler shall be provided that is non-interchangeable with other services, and leak proof under three times normal working pressure.
4. Each station inlet shall be equipped with an automatic valve to conform with NFPA 99. Valves shall be placed in the assembly to provide easy access after installation for servicing and replacement, and to facilitate line blow-out, purging, and testing.
5. Each inlet shall be securely fastened to rough-in to prevent floating and provide each with a capped stub length of 6 mm (1/4 inches) (10 mm outside diameter) (3/8 inches outside diameter) tubing for connection to supply tubing. Stub tubing shall be labeled for appropriate service. Rough in shall be indexed and gas specified latch valve with non-interchangeable safety keying with color coded gas service identification.
6. Rough-in kits and test plugs for Prefabricated Bedside Patient Units (PBPU) shall be furnished under this specification but installed by manufacturer of PBPUs before initial test specified herein.
7. Completion kits (valve body and face plate) shall be installed for the remainder of required tests.

## **2.8 STATION INLET ROUGH-IN**

- A. Station inlet rough in shall be flush mounted, and protected against corrosion. Rough in shall be anchored securely to unit or wall construction.
- B. The modular cover plate shall be constructed from die cast plate, two piece .85 mm (22 gage) stainless steel or 1.6 mm (16 gage) chromium plated metal, secured to rough in with stainless steel or chromium plated countersunk screws. The latch mechanism shall be designed for one handed, single thrust mounting and one handed fingertip release of secondary equipment.
- C. Cover Plate for Prefabricated Bedside Patient Units (PBPU) shall be One piece with construction and material as indicated for modular cover plate.



- D. Permanent, metal or plastic, identification plates shall be provided securely fastened at each inlet opening, with inscription for appropriate service using color coded letters and background. Metal plates shall have letters embossed on baked on enamel background. Color coding for identification plates is as follows:

SERVICE LABEL	IDENTIFICATION PLATE COLORS
MEDICAL VACUUM	Black letters on white background
EVACUATION (Waste Gas)	White letters on purple background

## **2.9 CEILING SERVICES**

- A. Each utility boom, new or existing to be relocated as indicated on drawings, shall be equipped with DISS type connectors for vacuum and anesthesia evacuation service station inlets as specified under Article, STATION INLETS.

## **2.10 VACUUM SWITCHES**

- A. Vacuum switches shall be general purpose, contact or mercury type, allowing both high and low set points, with contact type provided with a protective dust cover. The vacuum switch shall have an adjustable range set by inside or outside adjustment. Vacuum switches shall activate when indicated by alarm requirements. One orifice nipple (or DISS demand check valve) shall be used for each sensor switch.

## **2.11 VACUUM BOTTLE BRACKET**

- A. Vacuum bottle bracket shall be single plate of one piece, .85 mm (22 gage) stainless steel or 1.6 mm (16 gage) chromium plated metal or aluminum, finish matching cover of adjoining vacuum inlet. All components shall be of same material as plate and assembly anchored securely. The bracket shall be provided and plastic vacuum bottle holder for each vacuum wall inlet.

# **PART 3 - EXECUTION**

## **3.1 INSTALLATION**

- A. All installation shall be performed in strict accordance with NFPA 99 5.1.10. Brazing procedures shall be as detailed in NFPA 99 5.1.10.5. Brazing shall be performed only by brazers qualified under NFPA 99 5.1.10.10.11.

- B. Cast escutcheon shall be installed with set screw at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
- C. Open ends of tube shall be capped or plugged at all times or otherwise sealed until final assembly.
- D. Piping shall be cut square and accurately with a tube cutter (sawing not permitted) to measurements determined at place of installation. The tubing shall be reamed to remove burrs, being careful not to expand tube, and so no chips of copper remain in the tube. The tubing shall be worked into place without springing or forcing. The tubing shall be bottomed in socket so there are no gaps between tube and fitting. Care shall be exercised in handling equipment and tools used in cutting or reaming of tube to prevent oil or grease from being introduced into the tubing. Where contamination has occurred, material shall be no longer suitable for vacuum service and new, sealed tube sections used.
- E. Piping shall be supported with pipe trays or hangers at intervals as shown on the drawings or as defined in NFPA 99 Table 5.1.10.10.4.5. Piping shall not be supported by other piping. Isolation of copper piping from dissimilar metals shall be of a firm, positive nature. Duct tape is not acceptable as an isolation material.
- F. Valves and other equipment shall be rigidly supported to prevent strain on tube or joints.
- G. Piping exposed to physical damage shall be protected.
- H. During any brazing operation, the interior of the pipe shall be purged continuously with oil free, dry nitrogen NF, following the procedure in NFPA 99 5.1.10.5.5. At the completion of any section, all open pipe ends shall be capped using an EXTERNAL cap. The flow of purged gas shall be maintained until joint is cool to touch. The use of flux is prohibited when making of joints between copper to copper pipes and fittings.
- I. Threaded joints in piping systems shall be avoided whenever possible. Where unavoidable, make up the male threads with polytetrafluorofethylene (such as Teflon) tape. Liquid sealants shall not be used.
- J. Tubing shall not be bent. Fittings shall be used in all change of direction or angle.
- K. After installation of the piping, but before installation of the outlet valves, blow lines clear using nitrogen NF.

- L. Ceiling boom assembly shall be supported from heavy sub-mounting castings and furnished with the unit as part of rough in. Ceiling columns shall be anchored with 15 mm (1/2-inch) diameter bolts attached to angle iron frame supported from structural ceiling.
- M. Pressure and vacuum switches, transmitter and gauges shall be installed to be easily accessed, and provide access panel where installed above plaster ceiling. Pressure switch and sensors shall be installed with orifice nipple between the pipe line and switches/sensors.
- N. Pipe labeling shall be applied during installation process and not after installation is completed. Size of legend letters shall be in accordance with ANSI A13.1.
- O. After initial leakage testing is completed, the piping shall be allowed to remain pressurized with testing gas until testing agency performs final tests.
- P. Penetrations:
  - 1. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoked partitions, or floors, fire stopping shall be installed that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING, Clearances between raceways and openings with the fire stopping material shall be completely filled and sealed..
- Q. A vacuum gage 40mm (1 1/2 inch) diameter line shall be installed downstream of each zone valve in cabinets.
- R. Zone valves shall be provided in cabinets where indicated and outside each Operating Room and a minimum one zone valve assembly for each 18 outlets.
- S. Piping shall be labeled with name of service, identification color and direction of flow. Where non-standard pressures are piped, pressure shall be labeled. Labels shall be placed at least once every 20 feet of linear run or once in each story (whichever is more frequent). A label shall additionally be placed immediately on each side of all wall or floor penetrations. Pipe labels shall be self adhesive vinyl type or other water resistant material with permanent adhesive colored in accordance with NFPA 99 Table 5.1.11 and shall be visible on all sides of the pipe. Each master alarm signal shall be labeled for function after ring out. Each zone valve shall be labeled and each area alarm labeled for the area of control or surveillance after test. Labels shall be permanent and of a type approved by the VAMC.

T. Alarms and valves shall be labeled for service and areas monitored or controlled. Coordinate with the VAMC for final room or area designations. Valves shall be labeled with name and identification color of the gas and direction of flow.

### **3.2 INSTALLER TESTING**

- A. Prior to declaring the lines ready for final verification, the installing contractor shall strictly follow the procedures for verification as described in NFPA 99 5.1.12.2 and attest in writing over the notarized signature of an officer of the installing company the following;
1. That all brazing was conducted by brazers qualified to ASSE 6010 and holding current medical gas endorsements.
  2. That all brazing was conducted with nitrogen purging. (Procedure per NFPA 99 5.1.10.5.5).
  3. That the lines have been blown clear of any construction debris using oil free dry nitrogen or air are clean and ready for use. (Procedure per NFPA 99 5.1.12.2.2).
  4. That the assembled piping, prior to the installation of any devices, maintained a test pressure 1 1/2 times the standard pressures listed in NFPA 99 Table 5.1.11 without leaks. (Procedure per NFPA 99 5.1.12.2.3).
  5. That after installation of all devices, the pipeline was proven leak free for 24hours at a pressure 20% above the standard pressures listed in NFPA 99 Table 5.1.11. (Procedure per NFPA 99 5.1.12.2.2.6)
  6. That the systems have been checked for cross connections and none were found. (Procedure per NFPA 99 5.1.12.2.4)
- B. Four originals of the affidavit, shall be distributed; (1) to the Contracting Officers Representative (COR), (1) to the general contractor and (1) to the verifier ([www.mgpho.org](http://www.mgpho.org)).

### **3.3 VERIFIER TESTING**

- A. Prior to handing over the systems to VAMC, the contractor shall retain a Verifier acceptable to the engineer and owner who shall follow strictly the procedures for verification as described in NFPA 99 5.1.12.3 and provide a written report and certificate bearing the notarized signature of an officer of the verification company which contains at least the following:
1. A current ACORD insurance certificate indicating professional liability coverage in the minimum amount of \$1 Million per

- occurrence, and general aggregate liability in the minimum amount of \$1 Million, valid and in force when the project is to be verified. General liability insurance is not alone acceptable.
2. An affidavit bearing the notarized signature of an officer of the verification company stating that the verification company is not the supplier of any equipment used on this project or tested in this report and that the verification contractor has no relationship to, or pecuniary interest in, the manufacturer, seller, or installer of any equipment used on this project or tested in this report
  3. A listing of all tests performed, listing each source, outlet, valve and alarm included in the testing.
  4. An assertion that all tests were performed by a Medical Vacuum System Certified Medical Gas or vacuum Verifier or by individuals qualified to perform the work and holding valid qualifications to ASSE 6030 and under the immediate supervision a Verifier. Include the names, credential numbers and expiration dates for all individuals working on the project.
  5. A statement that equipment used was calibrated at least within the last six months by a method traceable to a National Bureau of Standard Reference and enclosing certificates or other evidence of such calibration(s). Where outside laboratories are used in lieu of on site equipment, those laboratories shall be named and their original reports enclosed.
  6. A statement that where and when needed, equipment was re calibrated during the verification process and describing the method(s) used.
  7. A statement that the systems were tested and found to be free of debris to a procedure per NFPA 99 5.1.12.3.7.
  8. The flow from each outlet when tested to a procedure per NFPA 99- 5.1.12.3.10.
  9. A statement that the systems were tested and found to have no cross-connections to a procedure per NFPA 99 5.1.12.3.3.
  10. A statement that the systems were tested and found to be free of contaminants to a procedure per NFPA 99 5.1.12.3.8 except that the purity standard shall be 2 ppm difference for halogenated hydrocarbons and 1 ppm total hydrocarbons (as methane).
  11. Statement that all local signals function as required under NFPA 99 5.1.3.4.7 and as per the relevant NFPA 99 sections relating to the sources.

12. A listing of local alarms, their function and activation per NFPA 99 5.1.12.3.14.
  13. A listing of master alarms, their function and activation, including pressures for high and low alarms per NFPA 99 5.1.12.3.5.2.
  14. A listing of area alarms, their function and activation pressures per NFPA 99 5.1.12.3.5.3.
  15. A statement that the sources include all alarms required by NFPA 99 Table A.5.1.9.5.
  16. The concentration of each component of NFPA 99 Table 5.1.12.3.12 in the medical air after 24hours of operation of the medical air source.
  17. The concentration of each gas at each outlet as specified in NFPA 99 5.1.12.3.11.
  18. A statement that all valves and alarms are accurately labeled as to zone of control.
- B. Perform and document all cross connection tests, labeling verification, supply system operation, and valve and alarm operation tests as required by, and in accordance with, current NFPA and the procedures set forth in pre-qualification documentation.
- C. Verify that the systems, as installed, meet or exceed the requirements of current NFPA, this specification, and that the systems operate as required.
- D. Piping purge test: For each positive pressure gas system, verify cleanliness of piping system. Filter a minimum of 1000 liters (35 cubic feet) of gas through a clean white 0.45 micron filter at a minimum velocity of 100 mps (3.5 fpm). Filter shall show no discoloration, and shall accrue no more than 0.1 mg of matter. Test each zone at the outlet most remote from the source. Perform test with the use of an inert gas as described in CGA P-9.
- E. Inlet flow test:
1. Test all inlets for flow. Perform test with the use of an inert gas as described in CGA P-9.
  2. Needle valve vacuum inlets must draw no less than 1.0 scfm with adjacent inlet flowing, at a dynamic inlet pressure of 40kPa (12-inches Hg), and a static vacuum of 10kPa (15-inches Hg)
  3. Vacuum inlets must draw no less than 85 Lpm (3.0 scfm) with adjacent inlet flowing, at a dynamic inlet pressure of 40 kPa (12-inches Hg), and a static vacuum of 50 kPa (15-inches Hg).

4. Anesthesia evacuation inlets must draw no less than 1 L/mm (1.0 scfm) at a dynamic inlet pressure of 40 kPa (12-inches Hg), and a static vacuum of 50 kPa (15-inches Hg).

**3.4 CONNECTION TO EXISTING VACUUM SYSTEM:**

- A. Contactor shall test the existing system for hydrocarbons, dew point, etc. If problems are present, the COR would notify the facility of the results. The facility would then make the necessary repairs and/ or maintenance.
- B. Double Shut-off valves shall be installed at the connection of new line to existing line.
- C. Time for shut-down of the existing vacuum system shall be coordinated with the VA medical center.
- D. Prior to any work being done, new pipeline shall be checked for particulate or other forms of contamination.
- E. Insure that the correct type of pipe tubing and fittings are being used.
- F. A spot check of the existing pipelines shall be made in the facility to determine the level of cleanness present.
- G. The tie-in shall be made as quickly as possible. A nitrogen purge is not required since this would require another opening in the pipe.
- H. After the tie-in is made and allowed to cool, slowly bleed the source Vacuum back into the pipeline. Test the work area for leaks with soapy water and repair any leaks.
- I. After all leaks, if any, are repaired and the line is fully recharged, perform blow down and testing. Open the zone that is closest to the main to the system, access the closest outlet to the work, and blow the main through the inlet. After the inlet blows clear into a white cloth, make an additional check at a zone most distant from the work. Perform all required current NFPA 99 tests after connection.

- - - E N D - - -





**SECTION 22 63 00**  
**GAS SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Central Laboratory and Healthcare Gas Systems: Consisting of oxygen, nitrous oxide, nitrogen, carbon dioxide and compressed air services; complete, ready for operation, including all necessary piping, fittings, valves, cabinets, station outlets, rough-ins, ceiling services, gages, alarms including low voltage wiring, nitrogen control panels, cylinder manifolds, pressure regulators, and all necessary parts, accessories, connections and equipment. Match existing station outlet and inlet terminal connections.
- B. Oxygen System: Ready for connection to existing outside bulk supply tank supplied distribution system.
- C. Nitrous Oxide, Carbon Dioxide and Nitrogen Systems: Ready for connection to cylinders, but not including cylinders.
- D. Laboratory and healthcare gas system alarm wiring from equipment to alarm panels.

**1.2 RELATED WORK**

- A. Sealing around pipe penetrations to maintain the integrity of time rated construction: Section 07 84 00, FIRESTOPPING.
- B. Sealing around pipe penetrations through the floor to prevent moisture migration: Section 07 92 00, JOINT SEALANTS.
- C. General requirements and items common to more than one section of Division 22. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- D. Alarm interface with ECC. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
- E. Conduit: Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS.
- F. Control wiring: Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES.
- G. Electrical wiring and accessories: Section 26 27 26, WIRING DEVICES.
- H. Prefabricated bedside patient units: Section 10 25 13, PATIENT BED SERVICE WALLS.
- I. Vacuum Piping and Equipment: SECTION 22 62 00, VACUUM SYSTEMS FOR LABORATORY AND HEALTHCARE FACILITIES
- J. SECTION 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS. Requirements for commissioning, systems readiness checklist, and training.

**1.3 QUALITY ASSURANCE**

- A. Materials and Installation: In accordance with NFPA 99, and as specified.

- B. Equipment Installer: Show technical qualifications and previous experience in installing laboratory and healthcare equipment on three similar projects. Submit names and addresses of referenced projects. Installers shall meet the qualifications of ANSI/ASSE Standard 6010.
- C. Equipment Supplier: Show evidence of equivalent product installed at three installations similar to this project that has been in satisfactory and efficient operation for three years. Submit names and addresses where the product is installed.
- D. Laboratory and healthcare System Testing Organization: The testing shall be conducted by a party technically competent and experienced in the field of laboratory and healthcare pipeline testing. Testing and systems verification shall be performed by personnel meeting the qualifications of ANSI/ASSE Standard 6030. Such testing shall be performed by a party other than the installing contractor.
- E. Provide names of three projects where testing of medical or laboratory gases systems has been performed by the testing agency. Include the name of the project, names of such persons at that project who supervised the work for the project owner, or who accepted the report for the project owner, and a written statement that the projects listed required work of similar scope to that set forth in this specification.
- F. Submit the testing agency's detailed procedure which will be followed in the testing of this project. Include details of the testing sequence, procedures for cross connection tests, outlet function tests, alarm tests, purity tests, etc., as required by this specification. For purity test procedures, include data on test methods, types of equipment to be used, calibration sources and method references.
- G. Certification: Provide documentation prior to submitting request for final inspection to include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and a certification that all results of tests were within limits allowed by this specification.
- H. Installing contractor shall maintain as-built drawings of each completed phases for verification; and, shall provide the complete set at the time of final systems certification testing, for certification by the Third Party Testing Company. As-built drawings shall be provided on prints and in digital format. The digital format shall be in the native CAD system required for the project design. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.

- I. "Hot taps" are not permitted for operating medical oxygen systems.  
Methods for connection and extension of active and pressurized medical gas systems without subsequent medical gas testing and verification are not allowed.

#### **1.4 SUBMITTALS**

- A. Submit as one package in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
1. Piping.
  2. Valves.
  3. Inlet and outlet cocks
  4. Valve cabinets.
  5. Gages.
  6. Station outlets and rough-in assemblies.
  7. Ceiling services.
  8. Alarm controls and panels.
  9. Pressure Switches.
  10. Nitrogen control panels.
  11. Manifolds.
- C. Station Outlets: Submit letter from manufacturer stating that outlets are designed and manufactured to comply with NFPA 99. Outlet shall bear label of approval as an assembly, of Underwriters Laboratories, Inc., or Associated Factory Mutual Research Corporation. In lieu of above labels, certificate may be submitted by a nationally recognized independent testing laboratory, satisfactory to the Contracting Officer, certifying that materials, appliances and assemblies conform to published standards, including methods of tests, of above organizations.
- D. Certification: The completed systems have been installed, tested, purged, analyzed and verified in accordance with the requirements of this specification.
- E. Completed System Readiness Checklist provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the test by the basic designation only.
- B. American Society for Testing and Materials (ASTM):  
B819-(R2006).....Seamless Copper Tube for Medical Gas Systems

C. American Society of Mechanical Engineers (ASME):

A13.1-07.....Scheme for Identification of Piping Systems

B16.22-01 (R2005).....Wrought Copper and Bronze Solder-Joint Pressure  
Fittings

B40.100 (2005) .....Pressure Gauges and Gauge Attachments Boiler and  
Pressure Vessel Code -

Section VIII-07.....Pressure Vessels, Division I

Section IX-07.....Welding and Brazing Qualifications

D. American Welding Society (AWS):

AWS A5.8-04.....Brazing Filler Metal

AWS B2.2-91.....Standard for Brazing Procedure and Performance  
Qualification (Modified per NFPA 99)

E. Compressed Gas Association (CGA):

C-9-04.....Standard Color Marking of Compressed Gas  
Cylinders

G-4.1 (2009).....Cleaning Equipment for Oxygen Service

G-10.1 (2008) .....Nitrogen, Commodity

P-9-01.....Inert Gases Argon, Nitrogen and Helium

V-1-05.....Standard for Compressed Gas Cylinder Valve  
Outlet and Inlet Connections

F. National Electrical Manufacturers Association (NEMA):

ICS-6-93 (R2006).....Industrial Controls and Systems Enclosures

G. National Fire Protection Association (NFPA):

99-12.....Health Care Facilities

H. United States Pharmacopoeia XXI/National Formulary XVI (USP/NF)

I. Manufacturing Standardization Society (MSS):

MSS-SP-72-99.....Ball Valves With Flanged or Butt Welding For  
General Purpose

MSS-SP-110-96.....Ball Valve Threaded, Socket Welding, Solder  
Joint, Grooved and Flared Ends

MSS-SP-73-03.....Brazing Joints for Copper and Copper Alloy  
Solder Pressure Fittings

**PART 2 - PRODUCTS**

**2.1 PIPING AND FITTINGS**

- A. Copper Tubing: Type "K", ASTM B819, seamless copper tube, hard drawn temper, with wrought copper fittings conforming to ASME B16.22 or brazing fittings complying with MSS SP-73. Size designated reflecting nominal inside diameter. All tubing and fittings shall be labeled "ACR/OXY", "OXY", "OXY/MED", "ACR/MED", or "MED".

- B. Brazing Alloy: AWS A5.8, Classification BCuP, greater than 537 °C (1000 °F) melting temperature. Flux is strictly prohibited for copper-to-copper connections.
- C. Screw Joints: Polytetrafluoroethylene (teflon) tape.
- D. Memory metal couplings: Temperature and pressure rating shall not be less than that of a brazed joint.
- E. Apply piping identification labels at the time of installation in accordance with current NFPA. Apply supplementary color identification in accordance with CGA Pamphlet C-9.
- F. Special Fittings: The following special fittings shall be permitted to be used in lieu of brazed joints:
  - 1. Memory-metal couplings having temperature and pressure ratings joints not less than that of a brazed joint.
  - 2. Listed or approved metallic gas tube fittings that, when made up, provide a permanent joint having the mechanical, thermal, and sealing integrity of a brazed joint.
  - 3. Dielectric fittings where required by the manufacturer of special medical equipment to electrically isolate the equipment from the piping distribution system.
  - 4. Axially swaged, elastic strain preload fittings providing metal to metal seal having pressure and temperature ratings not less than that of a brazed joint and when complete are permanent and non-separable.

## **2.2 EXPOSED LABORATORY AND HEALTHCARE GASES PIPING**

- A. Finished Room: Use full iron pipe size chrome plated brass piping for exposed laboratory and healthcare gas piping connecting fixtures, casework, cabinets, equipment and reagent racks when not concealed by apron including those furnished by the Government or specified in other sections.
  - 1. Pipe: Fed. Spec. WW-P-351, standard weight.
  - 2. Fittings: ASME B16.15 cast bronze threaded fittings with chrome finish, (125 and 250 PS1 Classes).
  - 3. Nipples: ASTM B 687, Chromium-plated.
  - 4. Unions: Mss SP-72, SP-110, Brass or Bronze with chrome finish. Unions 65 mm (2-1/2 inches) and larger shall be flange type with approved gaskets.
  - 5. Valves: Mss SP-72, SP-110, Brass or bronze with chrome finish.

## 2.3 VALVES

A. Ball: In-line, other than zone valves in cabinets:

1. Seventy five millimeter (2 1/2 inches) and smaller: Bronze/ brass body, Fed. Spec. MSS SP72 & SP 110 , Type II, Class 150, Style 1, with tubing extensions for brazed connections, full port, three-piece or double union end connections, teflon seat seals, full flow, 4125 kPa ( 600 psi) WOG minimum working pressure, with locking type handle, cleaned for oxygen use and labeled for intended service

B. Check:

1. Eighty millimeter (3 inches) and smaller: Bronze/brass body, straight through design for minimum pressure drop, spring loaded, self aligning with teflon cone seat, vibration free, silent operation, supplied NPT female threads at each end with flow direction arrow permanently cast into, cleaned for oxygen use and labeled for intended service, 2750 kPa (400 psi) WOG minimum working pressure.

C. Zone Valve in Cabinet: Ball valve, bronze/ brass body, double seal, three piece or double union end connections, replaceable teflon seat seals, teflon stem seal, 4125 kPa (600 psi) WOG, cold, non-shock gas working pressure service to 100 kPa (29 inch Hg), cleaned for oxygen use and labeled for intended service, blowout proof stem, one quarter turn of handle to completely open or close. Provide tubing extensions factory brazed, and pressure tested. Provide 3 mm (1/8 inch) NPT gauge port for a 50mm (2 inch) diameter monitoring gauge downstream of the shut off valve. Zone valves shall be securely attached to the cabinet and provided with type-K copper tube extensions for making connection to system piping outside the cabinet. Zone valves shall be products of one manufacturer, and uniform throughout in pattern, overall size and appearance. Trim with color coded plastic inserts or color coded stick-on labels. Install valves in cabinets such that cover window cannot be in place when any valve is in the closed position. Color coding for identification plates and labels is as follows:

SERVICE LABEL	IDENTIFICATION COLORS	MFG. STD. CLR.
OXYGEN	White letters on green background	GREEN
NITROUS OXIDE	White letters on blue background	BLUE
NITROGEN	White letters on black background	BLACK
MEDICAL AIR	Black or white letters on yellow background	YELLOW

SERVICE LABEL	IDENTIFICATION COLORS	MFG. STD. CLR.
CARBON DIOXIDE	Black or white letters on gray background	GRAY

#### 2.4 VALVE CABINETS

- A. Flush mounted commercially available item for use with laboratory and healthcare services, not lighter than 1.3 mm (18 gage) steel or 1.9 mm (14 gage) extruded aluminum, rigidly assembled, of adequate size to accommodate valve(s) and fittings. Punch or drill sides to receive tubing. Provide anchors to secure cabinet to wall construction. Seal openings in cabinet to be dust tight. Locate bottom of cabinet 1375 mm (4 foot 6 inches) above floor.
- B. Mount engraved rigid plastic identification plate on wall above or adjacent to cabinet. Color code identification plate to match gas identification colors as indicated above. Identification plate must be clearly visible at all times. Provide inscriptions on plate to read in substance: "VALVE CONTROL SUPPLY TO ROOMS."
- C. Cover plate: Fabricate from 1.3 mm (18 gage) sheet metal with satin chromed finish, extruded anodized aluminum, or .85 mm (22 gage) stainless steel. Provide cover window of replaceable plastic, with a corrosion resistant device or lever secured to window for emergency window removal. Permanently paint or stencil on window: CAUTION-CLOSE ONLY IN EMERGENCY, SHUT-OFF VALVES FOR PIPED GASES", or equivalent wording. Configure such that it is not possible to install window with any valve in the closed position. Each valve shall have gauge upstream of valve inside valve box.
- D. Cabinets and isolation valves shall be located and piped as shown, and at a minimum, so as to allow the isolation of each smoke compartment separately. No cabinet shall serve more than one smoke compartment.

#### 2.5 GAGES

- A. Pressure Gages: Includes gages temporarily supplied for testing purposes.
  1. For line pressure use adjacent to source equipment: ASME B40.1, pressure gage, single, size 115 mm (4-1/2 inches), for nitrogen, nitrous oxide and carbon dioxide, accurate to within two percent, with metal case. Range shall be two times operating pressure. Dial graduations and figures shall be black on a white background, or white on a black background. Gage shall be cleaned for oxygen use, labeled for appropriate service, and marked "USE NO OIL". Install with gage cock.

2. For all services downstream of main shutoff valve: Manufactured for oxygen use, labeled for the appropriate service and marked "USE NO OIL", 40 mm (1-1/2 inch) diameter gage with dial range 1-690 kPa (1-100 psi) for air service, and 1-2050 kPa (1-300 psi) for cylinder gas services.

## **2.6 STATION OUTLETS**

- A. For all services except ceiling hose drops and nitrogen system: For designated service, consisting of a quick coupler to match existing outlets type and supply tube. Provide coupler that is non-interchangeable with other services, and leak proof under three times the normal working pressure. Equip each station outlet with an automatic valve and a secondary check valve to conform with NFPA 99. Equip each station inlet with an automatic valve to conform with NFPA 99. Place valves in the assembly to provide easy access after installation for servicing and replacement, and to facilitate line blow-out, purging, and testing. Fasten each outlet and inlet securely to rough-in to prevent floating and provide each with a capped stub length of 6 mm (1/4-inch) (10 mm outside diameter) (3/8-inch outside diameter) tubing for connection to supply. Identification of each gas service shall be permanently cast into the back plate and shall be visible through a transparent plastic guard. Label stub tubing for appropriate service. Rough-in kits and test plugs for Prefabricated Bedside Patient Units (PBPU) are furnished under this specification but installed by manufacturer of PBPU before initial test specified herein. Install completion kits (valve body and face plate) for the remainder of required tests.

## **2.7 STATION OUTLET ROUGH-IN**

- A. Flush mounted, protected against corrosion. Anchor rough-in securely to unit or wall construction.
- B. Modular Cover Plate: Die cast back plate, two-piece .85 mm (22 gage) stainless steel or 1.6 mm (16 gage) chromium plated metal, with mounting flanges on all four sides, secured to rough-in with stainless steel or chromium plated countersunk screws.
- C. Cover Plate for Prefabricated Bedside Patient Units (PBPU): One-piece with construction and material as indicated for modular cover plate.
- D. Provide permanent, metal or plastic, identification plates securely fastened at each outlet and inlet opening, with inscription for appropriate service using color coded letters and background. Metal plates shall have letters embossed on baked-on enamel background. Color coding for identification plates is as follows:



SERVICE LABEL	IDENTIFICATION PLATE COLORS
OXYGEN	White letters on green background
NITROUS OXIDE	White letters on blue background
NITROGEN	White letters on black background
MEDICAL AIR	Black or white letters on yellow
CARBON DIOXIDE	White letters on gray background

## 2.8 CEILING SERVICES

### A. Articulating Utility Boom:

1. Each utility boom, new or existing to be relocated as indicated on drawings, shall be equipped with DISS type connectors for medical gases as indicated on drawings, service station outlets as specified under Article, STATION INLETS.
2. Ceiling Support: Provide manufacturers standard anchoring device for pendant. Provide all required hardware to support pendant from the building structure.

## 2.9 ALARMS

- ### A. Provide all low voltage control wiring, except for wiring from alarm relay interface control cabinet to ECC, required for complete, proper functioning system, in conformance with Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES. Run wiring in conduit, in conformance with Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS.

### B. Alarm Functions:

1. Oxygen, nitrous oxide, carbon dioxide and compressed air alarms:  
Pressure alarms: Functions when pressure in branch drops below 275 kPa (40 psi), plus/minus 14 kPa (2 psi) or increases above 414 kPa (60 psi), plus/minus 14 kPa (2 psi) set points; operated by pressure switches or transmitters.
2. Nitrogen alarms: Pressure alarms: Functions when pressure in branch drops below 1310 kPa (190 psi), plus/minus 14 kPa (2 psi) or increases above 1500 kPa (220 psi), plus/minus 14 kPa (2 psi) set points; operated by pressure switches or transmitters.
3. Vacuum alarms: Low vacuum alarm: Functions when vacuum in branch drops below 40 kPa (12-inches Hg); operated by vacuum switch.

### C. Alarm Panels:

1. General: Modular design, easily serviced and maintained; alarms operate on alternative current low voltage control circuit; provide required number of transformers for efficient functioning of complete

- system. Alarm panels shall be integral units, reporting oxygen, nitrous oxide, nitrogen, carbon dioxide, compressed air and vacuum services, as required.
2. Box: Flush mounted, sectional or one piece, corrosion protected. Size to accommodate required number of service functions for each location, and for one audible signal in each box. Anchor box securely. Provide spare capacity to accommodate 50% of the number of provided alarm points.
  3. Cover plate: Designed to accommodate required number of signals, visual and audible, for each location, and containing adequate operating instructions within the operator's view. Bezel shall be extruded aluminum, chromium plated metal, or plastic. Secure to the box with chromium plated or stainless steel countersunk screws.
  4. Service indicator lights: Red translucent plastic or LED with proper service identification inscribed thereon. Number of lights and service instruction shall be as required for each location. Provide each panel with a green test button of the same material, inscribed with "PUSH TO TEST" or similar message.
  5. Audible signal: Provide one in each alarm panel and connect electrically with all service indicator light functions.
  6. Controls:
    - a. Visual signal: When the condition occurs which any individual service indicator light is to report, button for particular service shall give a lighted visual signal which cannot be canceled until such condition is corrected.
    - b. Audible signal: Alarm shall give an audible signal upon circuit energization of any visual signal. Audible signal shall be continuous until silenced by pushing a button. This shall cancel and reset audible only, and not affect the visual signal. After silencing, subsequent alarms shall reactivate the audible alarm.
    - c. Signal tester: Test button or separate normal light shall be continuously lighted to indicate electrical circuit serving each individual alarm is energized. Pushing test button shall temporarily activate all visual signals and sound audible signal, thereby providing desired indications of status of system.
  - D. Alarm Relay Interface Control Cabinet: Design cabinet to transfer the closed circuit alarm signals through relays to a set of terminals for monitoring signals at the ECC without interrupting the closed circuit system. Construct of 1.9 mm (14 gage) steel, conforming with NEMA ICS-6, Type 1, enclosures. Provide both normally open and normally closed

contacts for output signals, with number of circuits required for full alarm capability at the ECC. Refer to Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC for compatibility.

- E. Alarm Network Communication: Network communications board shall be installed in local alarm and connected to the facility's Ethernet. Local alarm modules shall send information to the master alarm and the data can be downloaded thru the computer connected to the facility's Ethernet. Master alarm displays the message, sound its alarm and saves the information in an event log. This event log shall be downloaded to a computer file for tracking data and troubleshooting.

## **2.10 PRESSURE SWITCHES**

General purpose, contact or mercury type, allowing both high and low pressure set points, with contact type provided with a protective dust cover; adjustable range set by inside or outside adjustment; switches activate when indicated by alarm requirements. Use one orifice nipple (or DISS demand check valve) for each sensor or pressure switch.

## **2.11 NITROGEN CONTROL PANEL (NCP)**

- A. General: For nitrogen service, consisting of a line pressure control regulator, outlet line pressure gage, DISS service outlet, and supply valve, assembled and rigidly mounted in a roughing-in assembly, and provided with a metal cover plate. Panel shall be designed to deliver 10 L/s (20 SCFM) at 1535 kPa (223 psi). Unit may be recessed wall mounted or integral with the articulating arm or column with individual regulators for each outlet.
- B. Manifold Assembly: Mounted to a steel support bracket, factory assembled and tested, ready for installation in the roughing-in assembly.
1. Supply valve, bronze bodied, double seal, full flow, ball type, designed for working pressure in excess of 1700 kPa (300) psi, with chrome plated brass ball which seals in both directions, requiring only a quarter turn of the knob from open to closed position.
  2. Line pressure control regulator, self-relieving, diaphragm type, with high-flow precision adjustment and working pressure in excess of 1700 kPa (250 psi).
  3. Line pressure gage, to monitor the gas outlet line pressure, calibrated from 0 to 2000 kPa (300 psi) in increments of 100 kPa (10 psi).
  4. Nitrogen service outlet, DISS type as specified under Article, STATION OUTLETS, with a self-sealing dust plug, having a working pressure of 1700 kPa (250 psi) maximum.

5. Two 146 mm (5-3/4 inch) lengths of 10 mm (3/8-inch) outside diameter type "K" copper tubing for connection to gas service supply line and to remote outlet line.
- C. Roughing-In Assembly: Designed for recessed installation, consisting of a prime painted steel fabricated back box with mounting flanges on all four sides, with provisions to securely anchor the back box to wall construction. Equip with a crossover "U" tube to facilitate testing of the nitrogen system prior to the manifold installation, and a plaster shield to prevent dust or other foreign matter from contaminating internal parts prior to final assembly.
- D. Cover plate Assembly: Chromed cast metal or NAAMM Number 4 satin finished stainless steel panel with provisions for line pressure gage(s), nitrogen outlet, regulator and supply valve knobs, attaching directly to the roughing-in assembly by means of four Number 6 - 32 by 40 mm (1-1/2 inch) long mounting screws, with plaster adjustments up to 20 mm (3/4 inch).

## **2.12 CYLINDER GAS SUPPLY MANIFOLDS**

- A. Non-ferrous metal manifold and fittings, valves, parts and connections, suitable for a regular working pressure of 21 MPa (3000 psi). Gas cylinders at manifold shall be individually chained to wall or floor with adequate support.
- B. Duplex arrangement, each bank having number of cylinder connections as required, high pressure copper cylinder connection pigtails with brazed fittings. Shutting of either bank shall not interrupt supply to system.
- C. Provide manifold with two (one for each bank) two-stage pressure regulators with gages and built-in safety valves, manifold header valves and check valves, service line connection valves, relief valves, tank connecting coils and handles, and all required equipment for a complete assembly. Enclose manifold controls in sheet metal cabinet.
- D. Supply pressure for nitrous oxide and carbon dioxide is 50 psig and nitrogen is 160 psig.
- E. Switch-over to full reserve bank shall be automatic when one cylinder bank becomes exhausted, with no fluctuation in pressure, and not require resetting of regulators. After replacement of empty tank, resetting of controls shall be automatic or by single lever. Reserve switch-over shall be actuated by pressure switch; alarm shall be part of manifold control.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Install cast escutcheon with set screw at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.
- B. Keep open ends of tube capped or plugged at all times or otherwise sealed until final assembly.
- C. Cut piping square and accurately with a tube cutter (sawing not permitted) to measurements determined at place of installation. Ream tube to remove burrs, being careful not to expand tube, and so no chips of copper remain in the tube. Work into place without springing or forcing. Bottom tube in socket so there are no gaps between tube and fitting. Exercise care in handling equipment and tools used in cutting or reaming of tube to prevent oil or grease being introduced into tubing. Where contamination has occurred, material is no longer suitable for oxygen service.
- D. Spacing of hangers: Current NFPA.
- E. Rigidly support valves and other equipment to prevent strain on tube or joints.
- F. While being brazed, joints shall be continuously purged with *oil* free nitrogen. The flow of purged gas shall be maintained until joint is cool to touch.
- G. Do not bend tubing. Use fittings.
- H. Support ceiling boom assembly from heavy sub-mounting castings furnished with the unit as part of roughing-in. Anchor with 15 mm (1/2-inch) diameter bolts attached to angle iron frame supported from structural ceiling, unless otherwise indicated.
- I. Install pressure switches, transmitter and gauges to be easily accessed, and provide access panel where installed above plaster ceiling. Install pressure switch and sensors with orifice nipple between the pipe line and switches/sensors.
- J. Apply pipe labeling during installation process and not after installation is completed. Size of legend letters shall be in accordance with ANSI A13.1.
- K. After initial leakage testing is completed, allow piping to remain pressurized with testing gas until testing agency performs final tests.
- L. Penetrations:
  - 1. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoked partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as

- specified in Section 07 84 00, FIRESTOPPING, with intumescent materials only. Completely fill and seal clearances between raceways and openings with the fire stopping material.
- M. Provide 40mm (1 1/2 inch) diameter line pressure gage downstream of zone valve in cabinets.
- N. Provide zone valves in cabinets where indicated and outside each Operating Room and a minimum one zone valve assembly for each 18 outlet set.

### **3.2 TESTS**

- A. Initial Tests: Blow down, and high and low pressure leakage tests as required by current NFPA with documentation.
- B. Laboratory and healthcare testing agency shall perform the following:
1. Perform and document all cross connection tests, labeling verification, supply system operation, and valve and alarm operation tests as required by, and in accordance with, current NFPA and the procedures set forth in pre-qualification documentation.
  2. Verify that the systems, as installed, meet or exceed the requirements of current NFPA, this specification, and that the systems operate as required.
  3. Piping purge test: For each positive pressure gas system, verify cleanliness of piping system. Filter a minimum of 35 cubic feet (1000 liters) of gas through a clean white 0.45 micron filter at a minimum velocity of 3.5 scfm (100 Lpm). Filter shall show no discoloration, and shall accrue no more than 0.1 mg of matter. Test each zone at the outlet most remote from the source. Perform test with the use of an inert gas as described in CGA P-9.
  4. Piping purity test: For each positive pressure system, verify purity of piping system. Test each zone at the most remote outlet for dew point, carbon monoxide, total hydrocarbons (as methane), and halogenated hydrocarbons, and compare with source gas. The two tests must in no case exceed variation as specified in Paragraph, Maximum Allowable Variation. Perform test with the use of an inert gas as described in CGA P-9.
  5. Outlet and inlet flow test:
    - a. Test all outlets for flow. Perform test with the use of an inert gas as described in CGA P-9.
    - b. Oxygen, nitrous oxide, carbon dioxide and air outlets must deliver 100 Lpm (3.5 scfm) with a pressure drop of no more than 35 kPa (5 psi), and static pressure of 350 kPa (50 psi).

- c. Nitrogen outlets must deliver 565 Lpm (20 scfm) with a pressure drop of no more than 35 kPa (5 psi), and static pressure of 1445 kPa (210 psi).
  - d. Needle valve air outlets must deliver 1.5 scfm with a pressure drop of no more than five psi, and static pressure of 350 kPa (50 psi).
6. Source Contamination Test: Analyze each pressure gas source for concentration of contaminants, by volume. Take samples for air system test at the intake and at a point immediately downstream of the final filter outlet. The compared tests must in no case exceed variation as specified in Paragraph, Maximum Allowable Variation. Allowable concentrations are below the following:

Dew point, air	4 degrees C (39 degrees F) pressure dew point at 690 kPa (100 psi)
Carbon monoxide, air	10 mg/L (ppm)
Carbon dioxide, air	500 mg/L (ppm)
Gaseous hydrocarbons as methane, air	25 mg/L (ppm)
Halogenated hydrocarbons, air	2 mg/L (ppm)

7. Analysis Test:
- a. Analyze each pressure gas source and outlet for concentration of gas, by volume.
  - b. Make analysis with instruments designed to measure the specific gas dispensed.
  - c. Allowable concentrations are within the following:

Oxygen	>=97 plus percent oxygen
Nitrous oxide	>=99 plus percent nitrous oxide
Nitrogen	>=99 plus percent nitrogen
Medical air	19.5 percent to 23.5 percent oxygen
Carbon Dioxide	99 plus percent carbon dioxide

8. Maximum Allowable Variation: Between comparative test results required are as follows:

Dew point	2 degrees C (36 degrees F)
Carbon monoxide	2 mg/L (ppm)
Total hydrocarbons as methane	1 mg/L (ppm)

Halogenated hydrocarbons	2 mg/L (ppm)
-----------------------------	--------------

- C. The Commissioning Agent will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with the Contracting Officers Representative (COR) and Commissioning Agent. Provide a minimum of 7 days prior to notice.

### **3.3 CONNECTION TO EXISTING LABORATORY GAS SYSTEM:**

- A. Contactor shall test the existing system for hydrocarbons, dew point, etc. If problems are present, the COR would notify the facility of the results. The facility would then make the necessary repairs and/ or maintenance.
- B. Install shut-off valve at the connection of new line to existing line.
- C. Coordinate time for shut-down of the existing laboratory and healthcare system with the VA medical center.
- D. Shut off all oxygen zone valves and gas riser valves if the section to be connected to cannot be totally isolated from the remainder of the system.
- E. Prior to any work being done, check the new pipeline for particulate or other forms of contamination.
- F. Insure that the correct type of pipe tubing and fittings are being used.
- G. Make a spot check of the existing pipelines in the facility to determine the level of cleanness present.
- H. Reduce the pressure to zero and make the tie-in as quickly as possible. A nitrogen purge is not required since this would require another opening in the pipe.
- I. After the tie-in is made and allowed to cool, slowly bleed the source gas back into the pipeline. Test the work area for leaks with soapy water and repair any leaks.
- J. After all leaks, if any, are repaired and the line is fully recharged, perform blow down and testing. Open the zone that is closest to the main to the system, access the closest outlet to the work, and blow the main through the outlet. After the outlet blows clear into a white cloth, make an additional check at a zone most distant from the work. Perform all required current NFPA tests after connection.

### **3.4 COMMISSIONING**

- A. Provide commissioning documentation accordance with the requirements of Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS for all inspection, startup, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.



B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 22 08 00, COMMISSIONING OF PLUMBING SYSTEMS and related sections for contractor responsibilities for system commissioning.

- - - E N D - - -



**SECTION 23 05 11**  
**COMMON WORK RESULTS FOR HVAC**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. The requirements of this Section apply to all sections of Division 23.
- B. Definitions:
  - 1. Exposed: Piping, ductwork, and equipment exposed to view in finished rooms.
  - 2. Option or optional: Contractor's choice of an alternate material or method.
  - 3. Contracting Officer's Representative (COR)

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES
- D. Section 05 50 00, METAL FABRICATIONS
- E. Section 07 84 00, FIRESTOPPING
- F. Section 07 60 00, FLASHING AND SHEET METAL: Flashing for Wall and Roof Penetrations
- G. Section 07 92 00, JOINT SEALANTS
- H. Section 09 91 00, PAINTING
- K. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT
- L. Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC
- M. Section 23 07 11, HVAC Insulation
- N. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC
- O. Section 23 21 13, HYDRONIC PIPING
- Q. Section 23 22 13, STEAM and CONDENSATE HEATING PIPING
- R. Section 23 25 00, HVAC WATER TREATMENT
- S. Section 23 31 00, HVAC DUCTS and CASINGS
- T. Section 23 34 00, HVAC FANS
- U. Section 23 36 00, AIR TERMINAL UNITS and AIRFLOW CONTROL VALVES
- V. Section 23 37 00, AIR OUTLETS and INLETS
- W. Section 23 40 00, HVAC AIR CLEANING DEVICES
- X. Section 23 74 43, CUSTOM, OUTDOOR, PENTHOUSE EQUIPMENT MODULE/CENTRAL-STATION AIR-HANDLING UNIT
- Y. Section 23 82 00, CONVECTION HEATING and COOLING UNITS
- Z. Section 23 82 16, AIR COILS
- BB. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS: Requirements for commissioning, systems readiness checklists, and training
- CC. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS

DD. Section 26 29 11, MOTOR-CONTROLLERS, VARIABLE FREQUENCY DRIVES

### **1.3 QUALITY ASSURANCE**

- A. Mechanical, electrical and associated systems shall be safe, reliable, efficient, durable, easily and safely operable and maintainable, easily and safely accessible, and in compliance with applicable codes as specified. The systems shall be comprised of high quality institutional-class and industrial-class products of manufacturers that are experienced specialists in the required product lines. All construction firms and personnel shall be experienced and qualified specialists in industrial and institutional HVAC
- B. Flow Rate Tolerance for HVAC Equipment: Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.
- C. Equipment Vibration Tolerance:
  - 1. Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT. Equipment shall be factory-balanced to this tolerance and re-balanced on site, as necessary.
  - 2. After HVAC air balance work is completed and permanent drive sheaves are in place, perform field mechanical balancing and adjustments required to meet the specified vibration tolerance.
- D. Products Criteria:
  - 1. Standard Products: Material and equipment shall be the standard products of a manufacturer regularly engaged in the manufacture of the products for at least 3 years (or longer as specified elsewhere). The design, model and size of each item shall have been in satisfactory and efficient operation on at least three installations for approximately three years. However, digital electronics devices, software and systems such as controls, instruments, computer work station, shall be the current generation of technology and basic design that has a proven satisfactory service record of at least three years. See other specification sections for any exceptions and/or additional requirements.
  - 2. All items furnished shall be free from defects that would adversely affect the performance, maintainability and appearance of individual components and overall assembly.
  - 3. Conform to codes and standards as required by the specifications. Conform to local codes, if required by local authorities such as the natural gas supplier, if the local codes are more stringent than those specified. Refer any conflicts to the COR.

4. Multiple Units: When two or more units of materials or equipment of the same type or class are required, these units shall be products of one manufacturer.
  5. Assembled Units: Manufacturers of equipment assemblies, which use components made by others, assume complete responsibility for the final assembled product.
  6. Nameplates: Nameplate bearing manufacturer's name or identifiable trademark shall be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.
  7. Asbestos products or equipment or materials containing asbestos shall not be used.
- E. Equipment Service Organizations:
1. HVAC: Products and systems shall be supported by service organizations that maintain a complete inventory of repair parts and are located within 50 miles to the site.
- F. HVAC Mechanical Systems Welding: Before any welding is performed, contractor shall submit a certificate certifying that welders comply with the following requirements:
1. Qualify welding processes and operators for piping according to ASME "Boiler and Pressure Vessel Code", Section IX, "Welding and Brazing Qualifications".
  2. Comply with provisions of ASME B31 series "Code for Pressure Piping".
  3. Certify that each welder has passed American Welding Society (AWS) qualification tests for the welding processes involved, and that certification is current.
- G. Execution (Installation, Construction) Quality:
1. Apply and install all items in accordance with manufacturer's written instructions. Refer conflicts between the manufacturer's instructions and the contract drawings and specifications to the COR for resolution. Provide written hard copies or computer files of manufacturer's installation instructions to the COR at least two weeks prior to commencing installation of any item. Installation of the item will not be allowed to proceed until the recommendations are received. Failure to furnish these recommendations is a cause for rejection of the material.
  2. Provide complete layout drawings required by Paragraph, SUBMITTALS. Do not commence construction work on any system until the layout drawings have been approved.

- H. Upon request by Government, provide lists of previous installations for selected items of equipment. Include contact persons who will serve as references, with telephone numbers and e-mail addresses.

#### **1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, and with requirements in the individual specification sections.
- B. Contractor shall make all necessary field measurements and investigations to assure that the equipment and assemblies will meet contract requirements.
- C. If equipment is submitted which differs in arrangement from that shown, provide drawings that show the rearrangement of all associated systems. Approval will be given only if all features of the equipment and associated systems, including accessibility, are equivalent to that required by the contract.
- D. Prior to submitting shop drawings for approval, contractor shall certify in writing that manufacturers of all major items of equipment have each reviewed drawings and specifications, and have jointly coordinated and properly integrated their equipment and controls to provide a complete and efficient installation.
- E. Submittals and shop drawings for interdependent items, containing applicable descriptive information, shall be furnished together and complete in a group. Coordinate and properly integrate materials and equipment in each group to provide a completely compatible and efficient.
- F. Layout/Coordination Drawings:
1. Submit complete consolidated and coordinated layout drawings for all new systems, and for existing systems that are in the same areas.
  2. The drawings shall include plan views, elevations and sections of all systems and shall be on a scale of not less than 1:32 (3/8-inch equal to one foot). Clearly identify and dimension the proposed locations of the principal items of equipment. The drawings shall clearly show locations and adequate clearance for all equipment, piping, valves, control panels and other items. Show the access means for all items requiring access for operations and maintenance. Provide detailed layout drawings of all piping and duct systems.
  3. Do not install equipment foundations, equipment or piping until layout/coordination drawings have been approved.
  4. In addition, for HVAC systems, provide details of the following:
    - a. Mechanical equipment rooms.

- b. Rooftop Equipment, Exhaust Fans, Rooftop Ductwork/Piping Offsets, Penthouse Equipment Module (PEM)
  - c. Hangers, inserts, supports, and bracing. Rooftop duct/piping supports.
  - d. Pipe sleeves.
  - e. Duct, piping or equipment penetrations of floors, walls, ceilings, or roofs.
  - f. Coordination drawings for OR ceilings, including all ductwork, piping, OR ceiling plenum/diffuser system, surgical booms, gas columns, lighting, etc.
- G. Manufacturer's Literature and Data: Submit under the pertinent section rather than under this section.
- 1. Submit belt drive with the driven equipment. Submit selection data for specific drives when requested by the COR.
  - 2. Submit electric motor data and variable speed drive data with the driven equipment.
  - 3. Equipment and materials identification.
  - 4. Fire-stopping materials.
  - 5. Hangers, inserts, supports and bracing. Provide load calculations for variable spring and constant support hangers.
  - 6. Wall, floor, and ceiling plates.
- H. HVAC Maintenance Data and Operating Instructions:
- 1. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Article, INSTRUCTIONS, for systems and equipment.
  - 2. Provide a listing of recommended replacement parts for keeping in stock supply, including sources of supply, for equipment. Include in the listing belts for equipment: Belt manufacturer, model number, size and style, and distinguished whether of multiple belt sets.
- I. Provide copies of approved HVAC equipment submittals to the Testing, Adjusting and Balancing Subcontractor.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Conditioning, Heating and Refrigeration Institute (AHRI):  
430-2009.....Central Station Air-Handling Units
- C. American National Standard Institute (ANSI):  
B31.1-2007.....Power Piping

D. Rubber Manufacturers Association (ANSI/RMA):

IP-20-2007.....Specifications for Drives Using Classical  
V-Belts and Sheaves

IP-21-2009.....Specifications for Drives Using Double-V  
(Hexagonal) Belts

IP-22-2007.....Specifications for Drives Using Narrow V-Belts  
and Sheaves

E. Air Movement and Control Association (AMCA):

410-96.....Recommended Safety Practices for Air Moving  
Devices

F. American Society of Mechanical Engineers (ASME):

Boiler and Pressure Vessel Code (BPVC):

Section I-2007.....Power Boilers

Section IX-2007.....Welding and Brazing Qualifications

Code for Pressure Piping:

B31.1-2007.....Power Piping

G. American Society for Testing and Materials (ASTM):

A36/A36M-08.....Standard Specification for Carbon Structural  
Steel

A575-96(2007).....Standard Specification for Steel Bars, Carbon,  
Merchant Quality, M-Grades

E84-10.....Standard Test Method for Surface Burning  
Characteristics of Building Materials

E119-09c.....Standard Test Methods for Fire Tests of Building  
Construction and Materials

H. Manufacturers Standardization Society (MSS) of the Valve and Fittings  
Industry, Inc:

SP-58-2009.....Pipe Hangers and Supports-Materials, Design and  
Manufacture, Selection, Application, and  
Installation

SP 69-2003.....Pipe Hangers and Supports-Selection and  
Application

SP 127-2001.....Bracing for Piping Systems, Seismic - Wind -  
Dynamic, Design, Selection, Application

I. National Electrical Manufacturers Association (NEMA):

MG-1-2009.....Motors and Generators

J. National Fire Protection Association (NFPA):

31-06.....Standard for Installation of Oil-Burning  
Equipment

54-09.....National Fuel Gas Code





- C. Steam and Condensate Service Interruptions: Limited steam and condensate service interruptions, as required for interconnections of new and existing systems, will be permitted by the COR during periods when the demands are not critical to the operation of the medical center. These non-critical periods are limited to between 8 pm and 5 am in the appropriate off-season (if applicable). Provide at least one week advance notice to the COR.
- D. Phasing of Work: Comply with all requirements shown on drawings or specified.
- E. Building Working Environment: Maintain the architectural and structural integrity of the building and the working environment at all times. Maintain the interior of building at 18 degrees C (65 degrees F) minimum. Limit the opening of doors, windows or other access openings to brief periods as necessary for rigging purposes. No storm water or ground water leakage permitted. Provide daily clean-up of construction and demolition debris on all floor surfaces and on all equipment being operated by VA.
- F. Acceptance of Work for Government Operation: As new facilities are made available for operation and these facilities are of beneficial use to the Government, inspections will be made and tests will be performed. Based on the inspections, a list of contract deficiencies will be issued to the Contractor. After correction of deficiencies as necessary for beneficial use, the Contracting Officer will process necessary acceptance and the equipment will then be under the control and operation of Government personnel.
- G. Temporary Facilities: Refer to Article, TEMPORARY PIPING AND EQUIPMENT in this section.

## **PART 2 - PRODUCTS**

### **2.1 FACTORY-ASSEMBLED PRODUCTS**

- A. Provide maximum standardization of components to reduce spare part requirements.
- B. Manufacturers of equipment assemblies that include components made by others shall assume complete responsibility for final assembled unit.
  - 1. All components of an assembled unit need not be products of same manufacturer.
  - 2. Constituent parts that are alike shall be products of a single manufacturer.
  - 3. Components shall be compatible with each other and with the total assembly for intended service.

4. Contractor shall guarantee performance of assemblies of components, and shall repair or replace elements of the assemblies as required to deliver specified performance of the complete assembly.
- C. Components of equipment shall bear manufacturer's name and trademark, model number, serial number and performance data on a name plate securely affixed in a conspicuous place, or cast integral with, stamped or otherwise permanently marked upon the components of the equipment.
- D. Major items of equipment, which serve the same function, must be the same make and model. Exceptions will be permitted if performance requirements cannot be met.

## **2.2 COMPATIBILITY OF RELATED EQUIPMENT**

- A. Equipment and materials installed shall be compatible in all respects with other items being furnished and with existing items so that the result will be a complete and fully operational plant that conforms to contract requirements.

## **2.3 BELT DRIVES**

- A. Type: ANSI/RMA standard V-belts with proper motor pulley and driven sheave. Belts shall be constructed of reinforced cord and rubber.
- B. Dimensions, rating and selection standards: ANSI/RMA IP-20 and IP-21.
- C. Minimum Horsepower Rating: Motor horsepower plus recommended ANSI/RMA service factor (not less than 20 percent) in addition to the ANSI/RMA allowances for pitch diameter, center distance, and arc of contact.
- D. Maximum Speed: 25 m/s (5000 feet per minute).
- E. Adjustment Provisions: For alignment and ANSI/RMA standard allowances for installation and take-up.
- F. Drives may utilize a single V-Belt (any cross section) when it is the manufacturer's standard.
- G. Multiple Belts: Matched to ANSI/RMA specified limits by measurement on a belt measuring fixture. Seal matched sets together to prevent mixing or partial loss of sets. Replacement, when necessary, shall be an entire set of new matched belts.
- H. Sheaves and Pulleys:
  1. Material: Pressed steel, or close grained cast iron.
  2. Bore: Fixed or bushing type for securing to shaft with keys.
  3. Balanced: Statically and dynamically.
  4. Groove spacing for driving and driven pulleys shall be the same.
- I. Drive Types, Based on ARI 435:
  1. Provide adjustable-pitch drive as follows:
    - a. Fan speeds up to 1800 RPM: 7.5 kW (10 horsepower) and smaller.
    - b. Fan speeds over 1800 RPM: 2.2 kW (3 horsepower) and smaller.

2. Provide fixed-pitch drives for drives larger than those listed above.
3. The final fan speeds required to just meet the system CFM and pressure requirements, without throttling, shall be determined by adjustment of a temporary adjustable-pitch motor sheave or by fan law calculation if a fixed-pitch drive is used initially.

#### **2.4 DRIVE GUARDS**

- A. For machinery and equipment, provide guards as shown in AMCA 410 for belts, chains, couplings, pulleys, sheaves, shafts, gears and other moving parts regardless of height above the floor to prevent damage to equipment and injury to personnel. Drive guards may be excluded where motors and drives are inside factory fabricated air handling unit casings.
- B. Pump shafts and couplings shall be fully guarded by a sheet steel guard, covering coupling and shaft but not bearings. Material shall be minimum 16-gage sheet steel; ends shall be braked and drilled and attached to pump base with minimum of four 6 mm (1/4-inch) bolts. Reinforce guard as necessary to prevent side play forcing guard onto couplings.
- C. V-belt and sheave assemblies shall be totally enclosed, firmly mounted, non-resonant. Guard shall be an assembly of minimum 22-gage sheet steel and expanded or perforated metal to permit observation of belts. 25 mm (one-inch) diameter hole shall be provided at each shaft centerline to permit speed measurement.
- D. Materials: Sheet steel, cast iron, expanded metal or wire mesh rigidly secured so as to be removable without disassembling pipe, duct, or electrical connections to equipment.
- E. Access for Speed Measurement: 25 mm (One inch) diameter hole at each shaft center.

#### **2.5 LIFTING ATTACHMENTS**

- A. Provide equipment with suitable lifting attachments to enable equipment to be lifted in its normal position. Lifting attachments shall withstand any handling conditions that might be encountered, without bending or distortion of shape, such as rapid lowering and braking of load.

#### **2.6 ELECTRIC MOTORS**

- A. All material and equipment furnished and installation methods shall conform to the requirements of Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC EQUIPMENT; Section 26 29 11, MOTOR CONTROLLERS; and, Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES. Provide all electrical wiring, conduit, and devices necessary for the proper connection, protection and operation of the systems.

Provide special energy efficient premium efficiency type motors as scheduled.

## **2.7 VARIABLE SPEED MOTOR CONTROLLERS**

- A. Refer to Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS and Section 26 29 11, MOTOR CONTROLLERS for specifications.
- B. The combination of controller and motor shall be provided by the manufacturer of the driven equipment, such as pumps and fans, and shall be rated for 100 percent output performance. Multiple units of the same class of equipment, i.e. air handlers, fans, pumps, shall be product of a single manufacturer.
- C. Motors shall be premium efficiency type and be approved by the motor controller manufacturer. The controller-motor combination shall be guaranteed to provide full motor nameplate horsepower in variable frequency operation. Both driving and driven motor/fan sheaves shall be fixed pitch.
- D. Controller shall not add any current or voltage transients to the input AC power distribution system, DDC controls, sensitive medical equipment, etc., nor shall be affected from other devices on the AC power system.
- E. Controller shall be provided with the following operating features and accessories:
  - 1. Suitable for variable torque load.
  - 2. Provide thermal magnetic circuit breaker or fused switch with external operator and incoming line fuses. Unit shall be rated for minimum 30,000 AIC. Provide AC input line reactors (3% impedance) on incoming power line. Provide output line reactors on line between drive and motor where the distance between the breaker and motor exceeds 50 feet.

## **2.8 EQUIPMENT AND MATERIALS IDENTIFICATION**

- A. Use symbols, nomenclature and equipment numbers specified, shown on the drawings and shown in the maintenance manuals. Identification for piping is specified in Section 09 91 00, PAINTING.
- B. Interior (Indoor) Equipment: Engraved nameplates, with letters not less than 48 mm (3/16-inch) high of brass with black-filled letters, or rigid black plastic with white letters specified in Section 09 91 00, PAINTING permanently fastened to the equipment. Identify unit components such as coils, filters, fans, etc.
- C. Exterior (Outdoor) Equipment: Brass nameplates, with engraved black filled letters, not less than 48 mm (3/16-inch) high riveted or bolted to the equipment.

- D. Control Items: Label all temperature and humidity sensors, controllers and control dampers. Identify and label each item as they appear on the control diagrams.
- E. Valve Tags and Lists:
1. HVAC: Provide for all valves other than for equipment in Section 23 82 00, CONVECTION HEATING AND COOLING UNITS.
  2. Valve tags: Engraved black filled numbers and letters not less than 13 mm (1/2-inch) high for number designation, and not less than 6.4 mm (1/4-inch) for service designation on 19 gage 38 mm (1-1/2 inches) round brass disc, attached with brass "S" hook or brass chain.
  3. Valve lists: Typed or printed plastic coated card(s), sized 216 mm (8-1/2 inches) by 280 mm (11 inches) showing tag number, valve function and area of control, for each service or system. Punch sheets for a 3-ring notebook.
  4. Provide detailed plan for each floor of the building indicating the location and valve number for each valve. Identify location of each valve with a color coded thumb tack in ceiling.

## **2.9 FIRESTOPPING**

- A. Section 07 84 00, FIRESTOPPING specifies an effective barrier against the spread of fire, smoke and gases where penetrations occur for piping and ductwork. Refer to Section 23 07 11, HVAC, PLUMBING, AND BOILER PLANT INSULATION, for firestop pipe and duct insulation.

## **2.10 GALVANIZED REPAIR COMPOUND**

- A. Mil. Spec. DOD-P-21035B, paint form.

## **2.11 HVAC PIPE AND EQUIPMENT SUPPORTS AND RESTRAINTS**

- A. Vibration Isolators: Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- B. Supports for Roof Mounted Items:
1. Equipment: Equipment rails shall be galvanized steel, minimum 1.3 mm (18 gauge), with integral baseplate, continuous welded corner seams, factory installed 50 mm by 100 mm (2 by 4) treated wood nailer, 1.3 mm (18 gauge) galvanized steel counter flashing cap with screws, built-in cant strip, (except for gypsum or tectum deck), minimum height 280 mm (11 inches). For surface insulated roof deck, provide raised cant strip to start at the upper surface of the insulation.
  2. Pipe/duct pedestals: Provide a galvanized Unistrut channel welded to U-shaped mounting brackets which are secured to side of rail with galvanized lag bolts.
- C. Pipe Supports: Comply with MSS SP-58. Type Numbers specified refer to this standard. For selection and application comply with MSS SP-69.

Refer to Section 05 50 00, METAL FABRICATIONS, for miscellaneous metal support materials and prime coat painting requirements.

D. Attachment to Concrete Building Construction:

1. Concrete insert: MSS SP-58, Type 18.
2. Self-drilling expansion shields and machine bolt expansion anchors:  
Permitted in concrete not less than 102 mm (four inches) thick when approved by the COR for each job condition.
3. Power-driven fasteners: Permitted in existing concrete or masonry not less than 102 mm (four inches) thick when approved by the COR for each job condition.

E. Attachment to Steel Building Construction:

1. Welded attachment: MSS SP-58, Type 22.
2. Beam clamps: MSS SP-58, Types 20, 21, 28 or 29. Type 23 C-clamp may be used for individual copper tubing up to 23mm (7/8-inch) outside diameter.

F. Attachment to Metal Pan or Deck: As required for materials specified in Section 05 31 00, STEEL DECKING

G. Attachment to existing structure: Support from existing floor/roof frame.

H. Attachment to Wood Construction: Wood screws or lag bolts.

I. Hanger Rods: Hot-rolled steel, ASTM A36 or A575 for allowable load listed in MSS SP-58. For piping, provide adjustment means for controlling level or slope. Types 13 or 15 turn-buckles shall provide 38 mm (1-1/2 inches) minimum of adjustment and incorporate locknuts. All-thread rods are acceptable.

J. Hangers Supporting Multiple Pipes (Trapeze Hangers): Galvanized, cold formed, lipped steel channel horizontal member, not less than 41 mm by 41 mm (1-5/8 inches by 1-5/8 inches), 2.7 mm (No. 12 gage), designed to accept special spring held, hardened steel nuts. Not permitted for steam supply and condensate piping.

1. Allowable hanger load: Manufacturers rating less 91kg (200 pounds).
2. Guide individual pipes on the horizontal member of every other trapeze hanger with 6 mm (1/4-inch) U-bolt fabricated from steel rod. Provide Type 40 insulation shield, secured by two 13mm (1/2-inch) galvanized steel bands, or preinsulated calcium silicate shield for insulated piping at each hanger.

K. Supports for Piping Systems:

1. Select hangers sized to encircle insulation on insulated piping. Refer to Section 23 07 11, HVAC INSULATION for insulation thickness. To protect insulation, provide Type 39 saddles for roller type

- supports or preinsulated calcium silicate shields. Provide Type 40 insulation shield or preinsulated calcium silicate shield at all other types of supports and hangers including those for preinsulated piping.
2. Piping Systems except High and Medium Pressure Steam (MSS SP-58):
    - a. Standard clevis hanger: Type 1; provide locknut.
    - b. Riser clamps: Type 8.
    - c. Wall brackets: Types 31, 32 or 33.
    - d. Roller supports: Type 41, 43, 44 and 46.
    - e. Saddle support: Type 36, 37 or 38.
    - f. Turnbuckle: Types 13 or 15. Preinsulate.
    - g. U-bolt clamp: Type 24.
    - h. Copper Tube:
      - 1) Hangers, clamps and other support material in contact with tubing shall be painted with copper colored epoxy paint, plastic coated or taped with non-adhesive isolation tape to prevent electrolysis.
      - 2) For vertical runs use epoxy painted or plastic coated riser clamps.
      - 3) For supporting tube to strut: Provide epoxy painted pipe straps for copper tube or plastic inserted vibration isolation clamps.
      - 4) Insulated Lines: Provide pre-insulated calcium silicate shields sized for copper tube.
    - i. Supports for plastic or glass piping: As recommended by the pipe manufacturer with black rubber tape extending one inch beyond steel support or clamp.
  3. High and Medium Pressure Steam (MSS SP-58):
    - a. Provide eye rod or Type 17 eye nut near the upper attachment.
    - b. Piping 50 mm (2 inches) and larger: Type 43 roller hanger. For roller hangers requiring seismic bracing provide a Type 1 clevis hanger with Type 41 roller attached by flat side bars.
    - c. Piping with Vertical Expansion and Contraction:
      - 1) Movement up to 20 mm (3/4-inch): Type 51 or 52 variable spring unit with integral turn buckle and load indicator.
      - 2) Movement more than 20 mm (3/4-inch): Type 54 or 55 constant support unit with integral adjusting nut, turn buckle and travel position indicator.
  4. Converter and Expansion Tank Hangers: May be Type 1 sized for the shell diameter. Insulation where required will cover the hangers.
  - L. Pre-insulated Calcium Silicate Shields:



1. Provide 360 degree water resistant high density 965 kPa (140 psi) compressive strength calcium silicate shields encased in galvanized metal.
2. Pre-insulated calcium silicate shields to be installed at the point of support during erection.
3. Shield thickness shall match the pipe insulation.
4. The type of shield is selected by the temperature of the pipe, the load it must carry, and the type of support it will be used with.
  - a. Shields for supporting chilled or cold water shall have insulation that extends a minimum of 1 inch past the sheet metal. Provide for an adequate vapor barrier in chilled lines.
  - b. The pre-insulated calcium silicate shield shall support the maximum allowable water filled span as indicated in MSS-SP 69. To support the load, the shields may have one or more of the following features: structural inserts 4138 kPa (600 psi) compressive strength, an extra bottom metal shield, or formed structural steel (ASTM A36) wear plates welded to the bottom sheet metal jacket.
5. Shields may be used on steel clevis hanger type supports, roller supports or flat surfaces.

## **2.12 PIPE PENETRATIONS**

- A. Install sleeves during construction for other than blocked out floor openings for risers in mechanical bays.
- B. To prevent accidental liquid spills from passing to a lower level, provide the following:
  1. For sleeves: Extend sleeve 25 mm (one inch) above finished floor and provide sealant for watertight joint.
  2. For blocked out floor openings: Provide 40 mm (1-1/2 inch) angle set in silicone adhesive around opening.
  3. For drilled penetrations: Provide 40 mm (1-1/2 inch) angle ring or square set in silicone adhesive around penetration.
- C. Penetrations are not allowed through beams or ribs, but may be installed in concrete beam flanges. Any deviation from these requirements must receive prior approval of COR.
- D. Sheet Metal, Plastic, or Moisture-resistant Fiber Sleeves: Provide for pipe passing through floors, interior walls, and partitions, unless brass or steel pipe sleeves are specifically called for below.
- E. Cast Iron or Zinc Coated Pipe Sleeves: Provide for pipe passing through exterior walls below grade. Make space between sleeve and pipe

watertight with a modular or link rubber seal. Seal shall be applied at both ends of sleeve.

- F. Galvanized Steel or an alternate Black Iron Pipe with asphalt coating  
Sleeves: Provide for pipe passing through concrete beam flanges, except where brass pipe sleeves are called for. Provide sleeve for pipe passing through floor of mechanical rooms, laundry work rooms, and animal rooms above basement. Except in mechanical rooms, connect sleeve with floor plate.
- G. Brass Pipe Sleeves: Provide for pipe passing through quarry tile, terrazzo or ceramic tile floors. Connect sleeve with floor plate.
- H. Sleeves are not required for wall hydrants for fire department connections or in drywall construction.
- I. Sleeve Clearance: Sleeve through floors, walls, partitions, and beam flanges shall be one inch greater in diameter than external diameter of pipe. Sleeve for pipe with insulation shall be large enough to accommodate the insulation. Interior openings shall be caulked tight with fire stopping material and sealant to prevent the spread of fire, smoke, and gases.
- J. Sealant and Adhesives: Shall be as specified in Section 07 92 00, JOINT SEALANTS.

## **2.13 DUCT PENETRATIONS**

- A. Provide curbs for roof mounted piping, ductwork and equipment. Curbs shall be 18 inches high with continuously welded seams, built-in cant strip, interior baffle with acoustic insulation, curb bottom, hinged curb adapter.
- B. Provide firestopping for openings through fire and smoke barriers, maintaining minimum required rating of floor, ceiling or wall assembly. See section 07 84 00, FIRESTOPPING.

## **2.14 SPECIAL TOOLS AND LUBRICANTS**

- A. Furnish, and turn over to the COR, tools not readily available commercially, that are required for disassembly or adjustment of equipment and machinery furnished.
- B. Grease Guns with Attachments for Applicable Fittings: One for each type of grease required for each motor or other equipment.
- C. Refrigerant Tools: Provide system charging/Evacuation equipment, gauges, fittings, and tools required for maintenance of furnished equipment.
- D. Tool Containers: Hardwood or metal, permanently identified for intended service and mounted, or located, where directed by the COR.
- E. Lubricants: A minimum of 0.95 L (one quart) of oil, and 0.45 kg (one pound) of grease, of equipment manufacturer's recommended grade and

type, in unopened containers and properly identified as to use for each different application.

#### **2.15 WALL, FLOOR AND CEILING PLATES**

- A. Material and Type: Chrome plated brass or chrome plated steel, one piece or split type with concealed hinge, with set screw for fastening to pipe, or sleeve. Use plates that fit tight around pipes, cover openings around pipes and cover the entire pipe sleeve projection.
- B. Thickness: Not less than 2.4 mm (3/32-inch) for floor plates. For wall and ceiling plates, not less than 0.64 mm (0.025-inch) for up to 80 mm (3-inch pipe), 0.89 mm (0.035-inch) for larger pipe.
- C. Locations: Use where pipe penetrates floors, walls and ceilings in exposed locations, in finished areas only. Provide a watertight joint in spaces where brass or steel pipe sleeves are specified.

#### **2.16 ASBESTOS**

- A. Materials containing asbestos are not permitted.

#### **2.17 ROOFTOP DUCTWORK AND PIPING SUPPORT STEEL**

- A. Provide common duct/pipe support system (composed of multiple structural steel supports) for all high elevation rooftop/outdoor ductwork and piping as referenced on plans and sections (AC-9/RF-9 and chilled water piping offset). System shall be design-build by Division 23. Mechanical contractor shall engage and pay for the services of a licensed structural engineer to design the entire rooftop ductwork and piping support system. Coordinate all stanchion locations with GC, steel contractor and roofing contractor. Refer to plans (architectural, structural and mechanical) for existing roof structure type and locations and design intent for minimum number/locations of supports.
- B. Support system design shall be submitted for review to the Architect. Submitted drawings shall correlate with mechanical contractor's actual ductwork and piping layout, shall match multi-discipline coordination drawing submittal and shall be stamped and sealed by the design structural engineer. Support system shall adequately support all ductwork and piping in accordance with all project specifications (including seismic requirements) and SMACNA Guidelines.
- C. Support system shall take into account all rooftop access and egress requirements. Architectural drawings indicate required access paths/rooftop pavers/walkway/tread locations. These areas must be kept clear (at a minimum clear height of 7'-0") of all support system members and all ductwork/piping/equipment to allow for unobstructed walking/maintenance access/occupant egress.

- D. Support system shall be designed and rated for outdoor/all-weather exposure. Entire system (including attachment hardware) shall be resistant to all elements (including, but not limited to; humidity/moisture, precipitation, heat, cold, sunlight, wind, seismic, etc). Refer also to architectural and structural specifications for priming and painting of system components in accordance with other large outdoor MEP equipment rooftop steel dunnage structures.

### **PART 3 - EXECUTION**

#### **3.1 ARRANGEMENT AND INSTALLATION OF EQUIPMENT AND PIPING**

- A. Coordinate location of piping, sleeves, inserts, hangers, ductwork and equipment. Locate piping, sleeves, inserts, hangers, ductwork and equipment clear of windows, doors, openings, light outlets, and other services and utilities. Prepare equipment layout drawings to coordinate proper location and personnel access of all facilities. Submit the drawings for review as required by Part 1. Follow manufacturer's published recommendations for installation methods not otherwise specified.
- B. Operating Personnel Access and Observation Provisions: Select and arrange all equipment and systems to provide clear view and easy access, without use of portable ladders, for maintenance and operation of all devices including, but not limited to: all equipment items, valves, filters, strainers, transmitters, sensors, control devices. All gages and indicators shall be clearly visible by personnel standing on the floor or on permanent platforms. Do not reduce or change maintenance and operating space and access provisions that are shown on the drawings.
- C. Equipment and Piping Support: Coordinate structural systems necessary for pipe and equipment support with pipe and equipment locations to permit proper installation.
- D. Location of pipe sleeves, trenches and chases shall be accurately coordinated with equipment and piping locations.
- E. Cutting Holes:
1. Cut holes through concrete and masonry by rotary core drill. Pneumatic hammer, impact electric, and hand or manual hammer type drill will not be allowed, except as permitted by COR where working area space is limited.
  2. Locate holes to avoid interference with structural members such as beams or grade beams. Holes shall be laid out in advance and drilling done only after approval by COR. If the Contractor considers it necessary to drill through structural members, this matter shall be referred to COR for approval.

3. Do not penetrate membrane waterproofing.
- F. Interconnection of Instrumentation or Control Devices: Generally, electrical and pneumatic interconnections are not shown but must be provided.
- G. Minor Piping: Generally, small diameter pipe runs from drips and drains, water cooling, and other service are not shown but must be provided.
- H. Electrical and Pneumatic Interconnection of Controls and Instruments: This is generally not shown but must be provided. This includes interconnections of sensors, transmitters, transducers, control devices, control and instrumentation panels, instruments and computer workstations. Comply with NFPA-70. Use of pneumatic controls shall be avoided except where tie-in with existing installations that must remain active is required either during/in between project phases to upgrade from pneumatic to DDC or to maintain pneumatic control of existing equipment/existing elements outside of the project scope boundary. Project intent is to upgrade all existing pneumatic controls within the project boundary to DDC/electronic control. Review drawings and sequences of operation for additional information.
- I. Protection and Cleaning:
  1. Equipment and materials shall be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations and as approved by the COR. Damaged or defective items in the opinion of the COR, shall be replaced.
  2. Protect all finished parts of equipment, such as shafts and bearings where accessible, from rust prior to operation by means of protective grease coating and wrapping. Close pipe openings with caps or plugs during installation. Tightly cover and protect fixtures and equipment against dirt, water chemical, or mechanical injury. At completion of all work thoroughly clean fixtures, exposed materials and equipment.
- J. Install gages, thermometers, valves and other devices with due regard for ease in reading or operating and maintaining said devices. Locate and position thermometers and gages to be easily read by operator or staff standing on floor or walkway provided. Servicing shall not require dismantling adjacent equipment or pipe work.
- K. Install steam piping expansion joints as per manufacturer's recommendations.
- L. Work in Existing Building:
  1. Perform as specified in Article, OPERATIONS AND STORAGE AREAS, Article, ALTERATIONS, and Article, RESTORATION of the Section 01 00

- 00, GENERAL REQUIREMENTS for relocation of existing equipment, alterations and restoration of existing building(s).
2. As specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, OPERATIONS AND STORAGE AREAS, make alterations to existing service piping at times that will least interfere with normal operation of the facility.
  3. Cut required openings through existing masonry and reinforced concrete using diamond core drills. Use of pneumatic hammer type drills, impact type electric drills, and hand or manual hammer type drills, will be permitted only with approval of the COR. Locate openings that will least effect structural slabs, columns, ribs or beams. Refer to the COR for determination of proper design for openings through structural sections and opening layouts approval, prior to cutting or drilling into structure. After COR's approval, carefully cut opening through construction no larger than absolutely necessary for the required installation.
- M. Work in Animal Research Areas: Seal all pipe and duct penetrations with silicone sealant to prevent entrance of insects.
- N. Switchgear/Electrical Equipment Drip Protection: Every effort shall be made to eliminate the installation of pipe above electrical and telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints. Installation of piping, ductwork, leak protection apparatus or other installations foreign to the electrical installation shall be located in the space equal to the width and depth of the equipment and extending from to a height of 1.8 m (6 ft.) above the equipment or to ceiling structure, whichever is lower (NFPA 70).
- O. Inaccessible Equipment:
1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, equipment shall be removed and reinstalled or remedial action performed as directed at no additional cost to the Government.
  2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as motors, fans, pumps, belt guards, transformers, high voltage lines, piping, and ductwork.

### **3.2 TEMPORARY PIPING AND EQUIPMENT**

- A. Continuity of operation of existing facilities will generally require temporary installation or relocation of equipment and piping.
- B. The Contractor shall provide all required facilities in accordance with the requirements of phased construction and maintenance of service. All

piping and equipment shall be properly supported, sloped to drain, operate without excessive stress, and shall be insulated where injury can occur to personnel by contact with operating facilities. The requirements of Paragraph 3.1 apply.

- C. Temporary facilities and piping shall be completely removed and any openings in structures sealed. Provide necessary blind flanges and caps to seal open piping remaining in service.

### **3.3 RIGGING**

- A. Design is based on application of available equipment. Openings in building structures are planned to accommodate design scheme.
- B. Alternative methods of equipment delivery may be offered by Contractor and will be considered by Government under specified restrictions of phasing and maintenance of service as well as structural integrity of the building.
- C. Close all openings in the building when not required for rigging operations to maintain proper environment in the facility for Government operation and maintenance of service.
- D. Contractor shall provide all facilities required to deliver specified equipment and place on foundations. Attachments to structures for rigging purposes and support of equipment on structures shall be Contractor's full responsibility. Upon request, the Government will check structure adequacy and advise Contractor of recommended restrictions.
- E. Contractor shall check all clearances, weight limitations and shall offer a rigging plan designed by a Registered Professional Engineer. All modifications to structures, including reinforcement thereof, shall be at Contractor's cost, time and responsibility.
- F. Rigging plan and methods shall be referred to COR for evaluation prior to actual work.
- G. Restore building to original condition upon completion of rigging work.

### **3.4 PIPE AND EQUIPMENT SUPPORTS**

- A. Where hanger spacing does not correspond with joist or rib spacing, use structural steel channels secured directly to joist and rib structure that will correspond to the required hanger spacing, and then suspend the equipment and piping from the channels. Drill or burn holes in structural steel only with the prior approval of the COR.
- B. Use of chain, wire or strap hangers; wood for blocking, stays and bracing; or, hangers suspended from piping above will not be permitted. Replace or thoroughly clean rusty products and paint with zinc primer.

- C. Use hanger rods that are straight and vertical. Turnbuckles for vertical adjustments may be omitted where limited space prevents use. Provide a minimum of 15 mm (1/2-inch) clearance between pipe or piping covering and adjacent work.
- D. HVAC Horizontal Pipe Support Spacing: Refer to MSS SP-69. Provide additional supports at valves, strainers, in-line pumps and other heavy components. Provide a support within one foot of each elbow.
- E. HVAC Vertical Pipe Supports:
  - 1. Up to 150 mm (6-inch pipe), 9 m (30 feet) long, bolt riser clamps to the pipe below couplings, or welded to the pipe and rests supports securely on the building structure.
  - 2. Vertical pipe larger than the foregoing, support on base elbows or tees, or substantial pipe legs extending to the building structure.
- F. Overhead Supports:
  - 1. The basic structural system of the building is designed to sustain the loads imposed by equipment and piping to be supported overhead.
  - 2. Provide steel structural members, in addition to those shown, of adequate capability to support the imposed loads, located in accordance with the final approved layout of equipment and piping.
  - 3. Tubing and capillary systems shall be supported in channel troughs.
- G. Floor Supports:
  - 1. Provide concrete bases, concrete anchor blocks and pedestals, and structural steel systems for support of equipment and piping. Anchor and dowel concrete bases and structural systems to resist forces under operating and seismic conditions (if applicable) without excessive displacement or structural failure.
  - 2. Do not locate or install bases and supports until equipment mounted thereon has been approved. Size bases to match equipment mounted thereon plus 50 mm (2 inch) excess on all edges. Boiler foundations shall have horizontal dimensions that exceed boiler base frame dimensions by at least 150 mm (6 inches) on all sides. Refer to structural drawings. Bases shall be neatly finished and smoothed, shall have chamfered edges at the top, and shall be suitable for painting.
  - 3. All equipment shall be shimmed, leveled, firmly anchored, and grouted with epoxy grout. Anchor bolts shall be placed in sleeves, anchored to the bases. Fill the annular space between sleeves and bolts with a granular material to permit alignment and realignment.



### **3.5 MECHANICAL DEMOLITION**

- A. Rigging access, other than indicated on the drawings, shall be provided by the Contractor after approval for structural integrity by the COR. Such access shall be provided without additional cost or time to the Government. Where work is in an operating plant, provide approved protection from dust and debris at all times for the safety of plant personnel and maintenance of plant operation and environment of the plant.
- B. In an operating facility, maintain the operation, cleanliness and safety. Government personnel will be carrying on their normal duties of operating, cleaning and maintaining equipment and plant operation. Confine the work to the immediate area concerned; maintain cleanliness and wet down demolished materials to eliminate dust. Do not permit debris to accumulate in the area to the detriment of plant operation. Perform all flame cutting to maintain the fire safety integrity of this plant. Adequate fire extinguishing facilities shall be available at all times. Perform all work in accordance with recognized fire protection standards. Inspection will be made by personnel of the VA Medical Center, and Contractor shall follow all directives of the COR with regard to rigging, safety, fire safety, and maintenance of operations.
- C. Completely remove all piping, wiring, conduit, and other devices associated with the equipment not to be re-used in the new work. This includes all pipe, valves, fittings, insulation, and all hangers including the top connection and any fastenings to building structural systems. Seal all openings, after removal of equipment, pipes, ducts, and other penetrations in roof, walls, floors, in an approved manner and in accordance with plans and specifications where specifically covered. Structural integrity of the building system shall be maintained. Reference shall also be made to the drawings and specifications of the other disciplines in the project for additional facilities to be demolished or handled.
- D. All valves including gate, globe, ball, butterfly and check, all pressure gages and thermometers with wells shall remain Government property and shall be removed and delivered to COR and stored as directed. The Contractor shall remove all other material and equipment, devices and demolition debris under these plans and specifications. Such material shall be removed from Government property expeditiously and shall not be allowed to accumulate.

### 3.6 CLEANING AND PAINTING

- A. Prior to final inspection and acceptance of the plant and facilities for beneficial use by the Government, the plant facilities, equipment and systems shall be thoroughly cleaned and painted. Refer to Section 09 91 00, PAINTING.
- B. In addition, the following special conditions apply:
  1. Cleaning shall be thorough. Use solvents, cleaning materials and methods recommended by the manufacturers for the specific tasks. Remove all rust prior to painting and from surfaces to remain unpainted. Repair scratches, scuffs, and abrasions prior to applying prime and finish coats.
  2. Material And Equipment Not To Be Painted Includes:
    - a. Motors, controllers, control switches, and safety switches.
    - b. Control and interlock devices.
    - c. Regulators.
    - d. Pressure reducing valves.
    - e. Control valves and thermostatic elements.
    - f. Lubrication devices and grease fittings.
    - g. Copper, brass, aluminum, stainless steel and bronze surfaces.
    - h. Valve stems and rotating shafts.
    - i. Pressure gauges and thermometers.
    - j. Glass.
    - k. Name plates.
  3. Control and instrument panels shall be cleaned, damaged surfaces repaired, and shall be touched-up with matching paint obtained from panel manufacturer.
  4. Pumps, motors, steel and cast iron bases, and coupling guards shall be cleaned, and shall be touched-up with the same color as utilized by the pump manufacturer
  5. Temporary Facilities: Apply paint to surfaces that do not have existing finish coats.
  6. Paint shall withstand the following temperatures without peeling or discoloration:
    - a. Condensate and feedwater -- 38 degrees C (100 degrees F) on insulation jacket surface and 120 degrees C (250 degrees F) on metal pipe surface.
    - b. Steam -- 52 degrees C (125 degrees F) on insulation jacket surface and 190 degrees C (375 degrees F) on metal pipe surface.

7. Final result shall be smooth, even-colored, even-textured factory finish on all items. Completely repaint the entire piece of equipment if necessary to achieve this.

### **3.7 IDENTIFICATION SIGNS**

- A. Provide laminated plastic signs, with engraved lettering not less than 5 mm (3/16-inch) high, designating functions, for all equipment, switches, motor controllers, relays, meters, control devices, including automatic control valves. Nomenclature and identification symbols shall correspond to that used in maintenance manual, and in diagrams specified elsewhere. Attach by chain, adhesive, or screws.
- B. Factory Built Equipment: Metal plate, securely attached, with name and address of manufacturer, serial number, model number, size, performance.
- C. Pipe Identification: Refer to Section 09 91 00, PAINTING.

### **3.8 MOTOR AND DRIVE ALIGNMENT**

- A. Belt Drive: Set driving and driven shafts parallel and align so that the corresponding grooves are in the same plane.
- B. Direct-connect Drive: Securely mount motor in accurate alignment so that shafts are free from both angular and parallel misalignment when both motor and driven machine are operating at normal temperatures.

### **3.9 LUBRICATION**

- A. Lubricate all devices requiring lubrication prior to initial operation. Field-check all devices for proper lubrication.
- B. Equip all devices with required lubrication fittings or devices. Provide a minimum of one liter (one quart) of oil and 0.5 kg (one pound) of grease of manufacturer's recommended grade and type for each different application; also provide 12 grease sticks for lubricated plug valves. Deliver all materials to COR in unopened containers that are properly identified as to application.
- C. Provide a separate grease gun with attachments for applicable fittings for each type of grease applied.
- D. All lubrication points shall be accessible without disassembling equipment, except to remove access plates.

### **3.10 COMMISSIONING**

- A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specifications will be tested as part of a larger system. Refer to Section 23 08 00 -

COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

**3.11 STARTUP AND TEMPORARY OPERATION**

- A. Start up equipment as described in equipment specifications. Verify that vibration is within specified tolerance prior to extended operation. Temporary use of equipment is specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TEMPORARY USE OF MECHANICAL AND ELECTRICAL EQUIPMENT.

**3.12 OPERATING AND PERFORMANCE TESTS**

- A. Prior to the final inspection, perform required tests as specified in Section 01 00 00, GENERAL REQUIREMENTS and submit the test reports and records to the COR.
- B. Should evidence of malfunction in any tested system, or piece of equipment or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost to the Government.
- C. When completion of certain work or system occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then make performance tests for heating systems and for cooling systems respectively during first actual seasonal use of respective systems following completion of work.

**3.13 INSTRUCTIONS TO VA PERSONNEL**

- A. Provide in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS, and Section 23 08 00, COMMISSIONING OF HVAC.

- - - E N D - - -

**SECTION 23 05 12**  
**GENERAL MOTOR REQUIREMENTS FOR HVAC EQUIPMENT**

**PART 1 - GENERAL**

**1.1 DESCRIPTION:**

This section specifies the furnishing, installation and connection of motors for HVAC and steam generation equipment.

**1.2 RELATED WORK:**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements common to more than one Section of Division 26.
- B. Section 26 29 11, MOTOR CONTROLLERS: Multiple motor control assemblies, includes motor starters, variable speed/variable frequency drives, etc.
- C. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- E. Section 23 34 00, HVAC FANS.
- F. Section 23 36 00, AIR TERMINAL UNITS.
- G. Section 23 74 43, CUSTOM, OUTDOOR, PENTHOUSE EQUIPMENT MODULE/CENTRAL-STATION AIR-HANDLING UNIT.
- H. Section 23 82 00, CONVECTION HEATING and COOLING UNITS.
- I. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS: Requirements for commissioning, systems readiness checklists, and training.

**1.3 SUBMITTALS:**

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Shop Drawings:
  - 1. Provide documentation to demonstrate compliance with drawings and specifications.
  - 2. Include electrical ratings, efficiency, bearing data, power factor, frame size, dimensions, mounting details, materials, horsepower, voltage, phase, speed (RPM), enclosure, starting characteristics, torque characteristics, code letter, full load and locked rotor current, service factor, and lubrication method.
- C. Manuals:
  - 1. Submit simultaneously with the shop drawings, companion copies of complete installation, maintenance and operating manuals, including technical data sheets and application data.
- D. Certification: Two weeks prior to final inspection, unless otherwise noted, submit four copies of the following certification to the Contracting Officers Representative (COR):
  - 1. Certification that the motors have been applied, installed, adjusted, lubricated, and tested according to manufacturer published recommendations.

- E. Completed System Readiness Checklists provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 23 08 00 COMMISSIONING OF HVAC SYSTEMS.

#### **1.4 APPLICABLE PUBLICATIONS:**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. National Electrical Manufacturers Association (NEMA):  
MG 1-2006 Rev. 1 2009 ..Motors and Generators  
MG 2-2001 Rev. 1 2007...Safety Standard for Construction and Guide for Selection, Installation and Use of Electric Motors and Generators
- C. National Fire Protection Association (NFPA):  
70-2008.....National Electrical Code (NEC)
- D. Institute of Electrical and Electronics Engineers (IEEE):  
112-04.....Standard Test Procedure for Polyphase Induction Motors and Generators
- E. American Society of Heating, Refrigerating and Air-Conditioning Engineers (ASHRAE):  
90.1-2007.....Energy Standard for Buildings Except Low-Rise Residential Buildings

### **PART 2 - PRODUCTS**

#### **2.1 MOTORS:**

- A. For alternating current, fractional and integral horsepower motors, NEMA Publications MG 1 and MG 2 shall apply.
- B. All material and equipment furnished and installation methods shall conform to the requirements of Section 26 29 11, MOTOR CONTROLLERS; and Section 26 05 19 LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES. Provide all electrical wiring, conduit, and devices necessary for the proper connection, protection and operation of the systems. Provide premium efficiency type motors as scheduled. Unless otherwise specified for a particular application, use electric motors with the following requirements.
- C. Single-phase Motors: Motors for centrifugal fans and pumps may be split phase or permanent split capacitor (PSC) type. Provide capacitor-start type for hard starting applications.
1. WHERE SCHEDULED - Electrically Commutated motor (EC Type): Motor shall be brushless DC type specifically designed for applications with heavy duty ball bearings and electronic commutation. The motor

shall be speed controllable down to 20% of full speed and 85% efficient at all speeds.

- D. Poly-phase Motors: NEMA Design B, Squirrel cage, induction type.
  - 1. Two Speed Motors: Each two-speed motor shall have two separate windings. Provide a time- delay (20 seconds minimum) relay for switching from high to low speed.
- E. Voltage ratings shall be as follows:
  - 1. Single phase:
    - a. Motors connected to 120-volt systems: 115 volts.
    - b. Motors connected to 208-volt systems: 200 volts.
    - c. Motors connected to 240 volt or 480 volt systems: 230/460 volts, dual connection.
  - 2. Three phase:
    - a. Motors connected to 208-volt systems: 200 volts.
    - b. Motors, less than 74.6 kW (100 HP), connected to 240 volt or 480 volt systems: 208-230/460 volts, dual connection.
    - c. Motors, 74.6 kW (100 HP) or larger, connected to 240-volt systems: 230 volts.
    - d. Motors, 74.6 kW (100 HP) or larger, connected to 480-volt systems: 460 volts.
    - e. Motors connected to high voltage systems (Over 600V): Shall conform to NEMA Standards for connection to the nominal system voltage shown on the drawings.
- F. Number of phases shall be as follows:
  - 1. Motors, less than 373 W (1/2 HP): Single phase.
  - 2. Motors, 373 W (1/2 HP) and larger: 3 phase.
  - 3. Exceptions:
    - a. Hermetically sealed motors.
    - b. Motors for equipment assemblies, less than 746 W (one HP), may be single phase provided the manufacturer of the proposed assemblies cannot supply the assemblies with three phase motors.
- G. Motors shall be designed for operating the connected loads continuously in a 40°C (104°F) environment, where the motors are installed, without exceeding the NEMA standard temperature rises for the motor insulation. If the motors exceed 40°C (104°F), the motors shall be rated for the actual ambient temperatures.
- H. Motor designs, as indicated by the NEMA code letters, shall be coordinated with the connected loads to assure adequate starting and running torque.
- I. Motor Enclosures:

1. Shall be the NEMA types as specified and/or shown on the drawings.
2. Where the types of motor enclosures are not shown on the drawings, they shall be the NEMA types, which are most suitable for the environmental conditions where the motors are being installed. Enclosure requirements for certain conditions are as follows:
  - a. Motors located outdoors, indoors in wet or high humidity locations, or in unfiltered airstreams shall be totally enclosed type.
  - b. Where motors are located in an NEC 511 classified area, provide TEFC explosion proof motor enclosures.
  - c. Where motors are located in a corrosive environment, provide TEFC enclosures with corrosion resistant finish.
3. Enclosures shall be primed and finish coated at the factory with manufacturer's prime coat and standard finish.

J. Special Requirements:

1. Where motor power requirements of equipment furnished deviate from power shown on plans, provide electrical service designed under the requirements of NFPA 70 without additional time or cost to the Government.
2. Assemblies of motors, starters, controls and interlocks on factory assembled and wired devices shall be in accordance with the requirements of this specification.
3. Wire and cable materials specified in the electrical division of the specifications shall be modified as follows:
  - a. Wiring material located where temperatures can exceed 71 degrees C (160 degrees F) shall be stranded copper with Teflon FEP insulation with jacket. This includes wiring on the boilers.
  - b. Other wiring at boilers and to control panels shall be NFPA 70 designation THWN.
  - c. Provide shielded conductors or wiring in separate conduits for all instrumentation and control systems where recommended by manufacturer of equipment.
4. Select motor sizes so that the motors do not operate into the service factor at maximum required loads on the driven equipment. Motors on pumps shall be sized for non-overloading at all points on the pump performance curves.
5. Motors utilized with variable frequency drives shall be rated "inverter-duty" per NEMA Standard, MG1, Part 31.4.4.2. Provide motor shaft grounding apparatus that will protect bearings from damage from stray currents.



K. Additional requirements for specific motors, as indicated in the other sections listed in Article 1.2, shall also apply.

L. Energy-Efficient Motors (Motor Efficiencies): All permanently wired polyphase motors of 746 Watts (1 HP) or more shall meet the minimum full-load efficiencies as indicated in the following table. Motors of 746 Watts or more with open, drip-proof or totally enclosed fan-cooled enclosures shall be NEMA premium efficiency type, unless otherwise indicated. Motors provided as an integral part of motor driven equipment are excluded from this requirement if a minimum seasonal or overall efficiency requirement is indicated for that equipment by the provisions of another section. Motors not specified as "premium efficiency" shall comply with the Energy Policy Act of 2005 (EPACT).

Minimum Premium Efficiencies Open Drip-Proof				Minimum Premium Efficiencies Totally Enclosed Fan-Cooled			
Rating kW (HP)	1200 RPM	1800 RPM	3600 RPM	Rating kW (HP)	1200 RPM	1800 RPM	3600 RPM
0.746 (1)	82.5%	85.5%	77.0%	0.746 (1)	82.5%	85.5%	77.0%
1.12 (1.5)	86.5%	86.5%	84.0%	1.12 (1.5)	87.5%	86.5%	84.0%
1.49 (2)	87.5%	86.5%	85.5%	1.49 (2)	88.5%	86.5%	85.5%
2.24 (3)	88.5%	89.5%	85.5%	2.24 (3)	89.5%	89.5%	86.5%
3.73 (5)	89.5%	89.5%	86.5%	3.73 (5)	89.5%	89.5%	88.5%
5.60 (7.5)	90.2%	91.0%	88.5%	5.60 (7.5)	91.0%	91.7%	89.5%
7.46 (10)	91.7%	91.7%	89.5%	7.46 (10)	91.0%	91.7%	90.2%
11.2 (15)	91.7%	93.0%	90.2%	11.2 (15)	91.7%	92.4%	91.0%
14.9 (20)	92.4%	93.0%	91.0%	14.9 (20)	91.7%	93.0%	91.0%
18.7 (25)	93.0%	93.6%	91.7%	18.7 (25)	93.0%	93.6%	91.7%
22.4 (30)	93.6%	94.1%	91.7%	22.4 (30)	93.0%	93.6%	91.7%
29.8 (40)	94.1%	94.1%	92.4%	29.8 (40)	94.1%	94.1%	92.4%
37.3 (50)	94.1%	94.5%	93.0%	37.3 (50)	94.1%	94.5%	93.0%
44.8 (60)	94.5%	95.0%	93.6%	44.8 (60)	94.5%	95.0%	93.6%
56.9 (75)	94.5%	95.0%	93.6%	56.9 (75)	94.5%	95.4%	93.6%
74.6 (100)	95.0%	95.4%	93.6%	74.6 (100)	95.0%	95.4%	94.1%
93.3 (125)	95.0%	95.4%	94.1%	93.3 (125)	95.0%	95.4%	95.0%
112 (150)	95.4%	95.8%	94.1%	112 (150)	95.8%	95.8%	95.0%
149.2 (200)	95.4%	95.8%	95.0%	149.2 (200)	95.8%	96.2%	95.4%

M. Minimum Power Factor at Full Load and Rated Voltage: 90 percent at 1200 RPM, 1800 RPM and 3600 RPM.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION:**

Install motors in accordance with manufacturer's recommendations, the NEC, NEMA, as shown on the drawings and/or as required by other sections of these specifications.

#### **3.2 FIELD TESTS**

- A. Perform an electric insulation resistance Test using a megohmmeter on all motors after installation, before start-up. All shall test free from grounds.
- B. Perform Load test in accordance with ANSI/IEEE 112, Test Method B, to determine freedom from electrical or mechanical defects and compliance with performance data.
- C. Insulation Resistance: Not less than one-half meg-ohm between stator conductors and frame, to be determined at the time of final inspection.

#### **3.3 STARTUP AND TESTING**

- A. The Commissioning Agent will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with COR and Commissioning Agent. Provide a minimum of 7 days prior notice.

#### **3.4 COMMISSIONING**

- A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

#### **3.5 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.
- B. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS.

- - - E N D - - -

**SECTION 23 05 41**  
**NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

Noise criteria, seismic restraints for equipment, vibration tolerance and vibration isolation for HVAC and plumbing work.

**1.2 RELATED WORK**

- C. Section 23 05 11, COMMON WORK RESULTS FOR HVAC: General mechanical requirements and items, which are common to more than one section of Division 23.
- D. Section 23 22 13, STEAM and CONDENSATE HEATING PIPING: Requirements for flexible pipe connectors to reciprocating and rotating mechanical equipment.
- E. Section 23 74 43, CUSTOM OUTDOOR PENTHOUSE EQUIPMENT MODULE/CENTRAL-STATION AIR-HANDLING UNIT: Requirements for Air Handling Unit internal vibration isolation.
- F. Section 23 31 00, HVAC DUCTS and CASINGS: requirements for flexible duct connectors, sound attenuators and sound absorbing duct lining.
- G. SECTION 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC: requirements for sound and vibration tests.
- H. SECTION 23 37 00, AIR OUTLETS and INLETS: noise requirements for G-grilles.
- J. SECTION 23 34 00, HVAC FANS: sound and vibration isolation requirements for fans.
- K. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS: Requirements for commissioning, systems readiness checklists, and training.

**1.3 QUALITY ASSURANCE**

- A. Refer to article, QUALITY ASSURANCE in specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Noise Criteria:
  - 1. Noise levels in all 8 octave bands due to equipment and duct systems shall not exceed following NC levels:

TYPE OF ROOM	NC LEVEL
Bathrooms and Toilet Rooms	40
Conference Rooms	35
Corridors (Nurse Stations)	40
Corridors(Public)	40

Examination Rooms	35
Lobbies, Waiting Areas	40
Locker Rooms	45
Offices, Large Open	40
Offices, Small Private	35
Operating Rooms	40
Patient Rooms	35
Treatment Rooms	35

2. For equipment which has no sound power ratings scheduled on the plans, the contractor shall select equipment such that the foregoing noise criteria, local ordinance noise levels, and OSHA requirements are not exceeded. Selection procedure shall be in accordance with ASHRAE Fundamentals Handbook, Chapter 7, Sound and Vibration.
3. An allowance, not to exceed 5db, may be added to the measured value to compensate for the variation of the room attenuating effect between room test condition prior to occupancy and design condition after occupancy which may include the addition of sound absorbing material, such as, furniture. This allowance may not be taken after occupancy. The room attenuating effect is defined as the difference between sound power level emitted to room and sound pressure level in room.
4. In absence of specified measurement requirements, measure equipment noise levels three feet from equipment and at an elevation of maximum noise generation.

C. Seismic Restraint Requirements:

1. Equipment:
  - a. All mechanical equipment not supported with isolators external to the unit shall be securely anchored to the structure. Such mechanical equipment shall be properly supported to resist a horizontal force of 50 percent of the weight of the equipment furnished.
  - b. All mechanical equipment mounted on vibration isolators shall be provided with seismic restraints capable of resisting a horizontal force of 100 percent of the weight of the equipment furnished.

2. Piping: Refer to specification Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
3. Ductwork: Refer to specification Section 23 31 00, HVAC DUCTS AND CASINGS.
- D. Allowable Vibration Tolerances for Rotating, Non-reciprocating Equipment: Not to exceed a self-excited vibration maximum velocity of 5 mm per second (0.20 inch per second) RMS, filter in, when measured with a vibration meter on bearing caps of machine in vertical, horizontal and axial directions or measured at equipment mounting feet if bearings are concealed. Measurements for internally isolated fans and motors may be made at the mounting feet.

#### **1.4 SUBMITTALS**

- A. Submit in accordance with specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
  1. Vibration isolators:
    - a. Floor mountings
    - b. Hangers
    - c. Snubbers
    - d. Thrust restraints
  2. Bases.
  3. Seismic restraint provisions and bolting.
  4. Acoustical enclosures.
- C. Isolator manufacturer shall furnish with submittal load calculations for selection of isolators, including supplemental bases, based on lowest operating speed of equipment supported.
- D. Seismic Requirements: Submittals are required for all equipment anchors, supports and seismic restraints. Submittals shall include weights, dimensions, standard connections, and manufacturer's certification that all specified equipment will withstand seismic Lateral Force requirements as shown on drawings.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc. (ASHRAE):

2009 .....Fundamentals Handbook, Chapter 7, Sound and  
Vibration

C. American Society for Testing and Materials (ASTM):

A123/A123M-09.....Standard Specification for Zinc (Hot-Dip  
Galvanized) Coatings on Iron and Steel Products

A307-07b.....Standard Specification for Carbon Steel Bolts  
and Studs, 60,000 PSI Tensile Strength

D2240-05(2010).....Standard Test Method for Rubber Property -  
Durometer Hardness

D. Manufacturers Standardization (MSS):

SP-58-2009.....Pipe Hangers and Supports-Materials, Design and  
Manufacture

E. Occupational Safety and Health Administration (OSHA):

29 CFR 1910.95.....Occupational Noise Exposure

F. American Society of Civil Engineers (ASCE):

ASCE 7-10 .....Minimum Design Loads for Buildings and Other  
Structures.

G. American National Standards Institute / Sheet Metal and Air

Conditioning Contractor's National Association (ANSI/SMACNA):

001-2008.....Seismic Restraint Manual: Guidelines for  
Mechanical Systems, 3rd Edition.

H. International Code Council (ICC):

2009 IBC.....International Building Code.

I. Department of Veterans Affairs (VA):

H-18-8 2010.....Seismic Design Requirements.

**PART 2 - PRODUCTS**

**2.1 GENERAL REQUIREMENTS**

A. Type of isolator, base, and minimum static deflection shall be as  
required for each specific equipment application as recommended by  
isolator or equipment manufacturer but subject to minimum requirements  
indicated herein and in the schedule on the drawings.

B. Elastometric Isolators shall comply with ASTM D2240 and be oil  
resistant neoprene with a maximum stiffness of 60 durometer and have a  
straight-line deflection curve.

C. Exposure to weather: Isolator housings to be either hot dipped  
galvanized or powder coated to ASTM B117 salt spray testing standards.  
Springs to be powder coated or electro galvanized. All hardware to be  
electro galvanized. In addition provide limit stops to resist wind

velocity. Velocity pressure established by wind shall be calculated in accordance with section 1609 of the International Building Code. A minimum wind velocity of 75 mph shall be employed.

- D. Uniform Loading: Select and locate isolators to produce uniform loading and deflection even when equipment weight is not evenly distributed.
- E. Color code isolators by type and size for easy identification of capacity.

## **2.2 SEISMIC RESTRAINT REQUIREMENTS FOR EQUIPMENTS**

- A. Bolt pad mounted equipment, without vibration isolators, to the floor or other support using ASTM A307 standard bolting material.
- B. Floor mounted equipment, with vibration Isolators: Type SS. Where Type N isolators are used provide channel frame base horizontal restraints bolted to the floor, or other support, on all sides of the equipment. Size and material required for the base shall be as recommended by the isolator manufacturer.
- C. On all sides of suspended equipment, provide bracing for rigid supports and provide restraints for resiliently supported equipment.

## **2.3 VIBRATION ISOLATORS**

- A. Floor Mountings:
  - 1. Double Deflection Neoprene (Type N): Shall include neoprene covered steel support plated (top and bottom), friction pads, and necessary bolt holes.
  - 2. Spring Isolators (Type S): Shall be free-standing, laterally stable and include acoustical friction pads and leveling bolts. Isolators shall have a minimum ratio of spring diameter-to-operating spring height of 1.0 and an additional travel to solid equal to 50 percent of rated deflection.
  - 3. Captive Spring Mount for Seismic Restraint (Type SS):
    - a. Design mounts to resiliently resist seismic forces in all directions. Snubbing shall take place in all modes with adjustment to limit upward, downward, and horizontal travel to a maximum of 6 mm (1/4-inch) before contacting snubbers. Mountings shall have a minimum rating of one G coefficient of gravity as calculated and certified by a registered structural engineer.
    - b. All mountings shall have leveling bolts that must be rigidly bolted to the equipment. Spring diameters shall be no less than 0.8 of the compressed height of the spring at rated load. Springs shall have a minimum additional travel to solid equal to 50

percent of the rated deflection. Mountings shall have ports for spring inspection. Provide an all directional neoprene cushion collar around the equipment bolt.

4. Spring Isolators with Vertical Limit Stops (Type SP): Similar to spring isolators noted above, except include a vertical limit stop to limit upward travel if weight is removed and also to reduce movement and spring extension due to wind loads. Provide clearance around restraining bolts to prevent mechanical short circuiting. Isolators shall have a minimum seismic rating of one G.
  5. Pads (Type D), Washers (Type W), and Bushings (Type L): Pads shall be natural rubber or neoprene waffle, neoprene and steel waffle, or reinforced duck and neoprene. Washers and bushings shall be reinforced duck and neoprene. Washers and bushings shall be reinforced duck and neoprene. Size pads for a maximum load of 345 kPa (50 pounds per square inch).
  6. Seismic Pad (Type DS): Pads shall be natural rubber / neoprene waffle with steel top plate and drilled for an anchor bolt. Washers and bushings shall be reinforced duck and neoprene. Size pads for a maximum load of 345 kPa (50 pounds per square inch).
- B. Hangers: Shall be combination neoprene and springs unless otherwise noted and shall allow for expansion of pipe.
1. Combination Neoprene and Spring (Type H): Vibration hanger shall contain a spring and double deflection neoprene element in series. Spring shall have a diameter not less than 0.8 of compressed operating spring height. Spring shall have a minimum additional travel of 50 percent between design height and solid height. Spring shall permit a 15 degree angular misalignment without rubbing on hanger box.
  2. Spring Position Hanger (Type HP): Similar to combination neoprene and spring hanger except hanger shall hold piping at a fixed elevation during installation and include a secondary adjustment feature to transfer load to spring while maintaining same position.
  3. Neoprene (Type HN): Vibration hanger shall contain a double deflection type neoprene isolation element. Hanger rod shall be separated from contact with hanger bracket by a neoprene grommet.
  4. Spring (Type HS): Vibration hanger shall contain a coiled steel spring in series with a neoprene grommet. Spring shall have a diameter not less than 0.8 of compressed operating spring height.



Spring shall have a minimum additional travel of 50 percent between design height and solid height. Spring shall permit a 15 degree angular misalignment without rubbing on hanger box.

5. Hanger supports for piping 50 mm (2 inches) and larger shall have a pointer and scale deflection indicator.
6. Hangers used in seismic applications shall be provided with neoprene and steel rebound washer, installed  $\frac{1}{4}$ ' clear of bottom of hanger housing in operation to prevent spring from excessive upward travel.

- C. Snubbers: Each spring mounted base shall have a minimum of four all-directional or eight two directional (two per side) seismic snubbers that are double acting. Elastomeric materials shall be shock absorbent neoprene bridge quality bearing pads, maximum 60 durometer, replaceable and have a minimum thickness of 6 mm (1/4 inch). Air gap between hard and resilient material shall be not less than 3 mm (1/8 inch) nor more than 6 mm (1/4 inch). Restraints shall be capable of withstanding design load without permanent deformation.
- D. Thrust Restraints (Type THR): Restraints shall provide a spring element contained in a steel frame with neoprene pads at each end attachment. Restraints shall have factory preset thrust and be field adjustable to allow a maximum movement of 6 mm (1/4 inch) when the fan starts and stops. Restraint assemblies shall include rods, angle brackets and other hardware for field installation.

## **2.4 BASES**

- A. Rails (Type R): Design rails with isolator brackets to reduce mounting height of equipment and cradle machines having legs or bases that do not require a complete supplementary base. To assure adequate stiffness, height of members shall be a minimum of 1/12 of longest base dimension but not less than 100 mm (4 inches). Where rails are used with neoprene mounts for small fans or close coupled pumps, extend rails to compensate overhang of housing.
- B. Integral Structural Steel Base (Type B): Design base with isolator brackets to reduce mounting height of equipment which require a complete supplementary rigid base. To assure adequate stiffness, height of members shall be a minimum of 1/12 of longest base dimension, but not less than 100 mm (four inches).
- C. Inertia Base (Type I): Base shall be a reinforced concrete inertia base. Pour concrete into a welded steel channel frame, incorporating prelocated equipment anchor bolts and pipe sleeves. Level the concrete

to provide a smooth uniform bearing surface for equipment mounting. Provide grout under uneven supports. Channel depth shall be a minimum of 1/12 of longest dimension of base but not less than 150 mm (six inches). Form shall include 13-mm (1/2-inch) reinforcing bars welded in place on minimum of 203 mm (eight inch) centers running both ways in a layer 40 mm (1-1/2 inches) above bottom. Use height saving brackets in all mounting locations. Weight of inertia base shall be equal to or greater than weight of equipment supported to provide a maximum peak-to-peak displacement of 2 mm (1/16 inch).

- D. Curb Mounted Isolation Base (Type CB): Fabricate from aluminum to fit on top of standard curb with overlap to allow water run-off and have wind and water seals which shall not interfere with spring action. Provide resilient snubbers with 6 mm (1/4 inch) clearance for wind resistance. Top and bottom bearing surfaces shall have sponge type weather seals. Integral spring isolators shall comply with Spring Isolator (Type S) requirements.

## **2.5 SOUND ATTENUATING UNITS**

Refer to specification Section 23 31 00, HVAC DUCTS and CASINGS.

## **2.6 ACOUSTICAL ENCLOSURES IN MECHANICAL ROOMS**

Provide where shown on the drawings. Enclosures shall be removable and sectional, of a size and weight that sections can be readily handled with typical lifting and moving equipment available in the equipment room. Enclosures must contain access openings, observation ports, lights, and ventilation where required for normal operation, observation and servicing.

# **PART 3 - EXECUTION**

## **3.1 INSTALLATION**

### **A. Vibration Isolation:**

1. No metal-to-metal contact will be permitted between fixed and floating parts.
2. Connections to Equipment: Allow for deflections equal to or greater than equipment deflections. Electrical, drain, piping connections, and other items made to rotating or reciprocating equipment (pumps, compressors, etc.) which rests on vibration isolators, shall be isolated from building structure for first three hangers or supports with a deflection equal to that used on the corresponding equipment.
3. Common Foundation: Mount each electric motor on same foundation as driven machine. Hold driving motor and driven machine in positive

- rigid alignment with provision for adjusting motor alignment and belt tension. Bases shall be level throughout length and width. Provide shims to facilitate pipe connections, leveling, and bolting.
4. Provide heat shields where elastomers are subject to temperatures over 38 degrees C (100 degrees F).
  5. Extend bases for pipe elbow supports at discharge and suction connections at pumps. Pipe elbow supports shall not short circuit pump vibration to structure.
  6. Non-rotating equipment such as heat exchangers and convertors shall be mounted on isolation units having the same static deflection as the isolation hangers or support of the pipe connected to the equipment.
- B. Inspection and Adjustments: Check for vibration and noise transmission through connections, piping, ductwork, foundations, and walls. Adjust, repair, or replace isolators as required to reduce vibration and noise transmissions to specified levels.

### **3.2 ADJUSTING**

- A. Adjust vibration isolators after piping systems are filled and equipment is at operating weight.
- B. Adjust limit stops on restrained spring isolators to mount equipment at normal operating height. After equipment installation is complete, adjust limit stops so they are out of contact during normal operation.
- C. Attach thrust limits at centerline of thrust and adjust to a maximum of 1/4inch (6-mm) movement during start and stop.
- D. Adjust active height of spring isolators.
- E. Adjust snubbers according to manufacturer's recommendations.
- F. Adjust seismic restraints to permit free movement of equipment within normal mode of operation.
- G. Torque anchor bolts according to equipment manufacturer's recommendations to resist seismic forces.

### **3.3 COMMISSIONING**

- A. Provide commissioning documentation in accordance with the requirements of section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to section 23 08 00 -

VA Medical Center, Huntington, WV

VA Project No. 581-13-101

Renovate Surgical Service & OR

100% Construction Documents: 01/15/16

COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

- - - E N D - - -

**SELECTION GUIDE FOR VIBRATION ISOLATORS**

EQUIPMENT		ON GRADE			20FT FLOOR SPAN			30FT FLOOR SPAN			40FT FLOOR SPAN			50FT FLOOR SPAN		
		BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL
COMPRESSORS AND VACUUM PUMPS																
UP THROUGH 1-1/2 HP		---	D, L, W	0.8	----	D, L, W	0.8	---	D, L, W	1.5	---	D, L, W	1.5	---	D, L, W	---
2 HP AND OVER:																
500 - 750 RPM		---	D	0.8	---	S	0.8	---	S	1.5	---	S	1.5	---	S	2.5
750 RPM & OVER		---	D	0.8	---	S	0.8	---	S	1.5	---	S	1.5	---	S	2.5
PUMPS																
CLOSE COUPLED	UP TO 1-1/2 HP	---	---	---	---	D, L, W	---	---	D, L, W	---	---	D, L, W	---	---	D, L, W	---
	2 HP & OVER	---	---	---	I	S	0.8	I	S	1.5	I	S	1.5	I	S	2.0
LARGE INLINE	Up to 25 HP	---	---	---	---	S	0.75	---	S	1.50	---	S	1.50	---	---	NA
	26 HP THRU 30 HP	---	---	---	---	S	1.0	---	S	1.50	---	S	2.50	---	---	NA
	UP TO 10 HP	---	---	---	---	D, L, W	---	---	D, L, W	---	---	D, L, W	---	---	D, L, W	---

EQUIPMENT		ON GRADE			20FT FLOOR SPAN			30FT FLOOR SPAN			40FT FLOOR SPAN			50FT FLOOR SPAN		
		BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL
BASE MOUNTED	15 HP THRU 40 HP	I	S	1.0	I	S	1.0	I	S	2.0	I	S	2.0	I	S	2.0
	50 HP & OVER	I	S	1.0	I	S	1.0	I	S	2.0	I	S	2.5	I	S	2.5
<b>ROOF FANS</b>																
ABOVE OCCUPIED AREAS:																
5 HP & OVER		---	---	---	CB	S	1.0	CB	S	1.0	CB	S	1.0	CB	S	1.0
<b>CENTRIFUGAL FANS</b>																
UP TO 50 HP:																
UP TO 200 RPM		B	N	0.3	B	S	2.5	B	S	2.5	B	S	3.5	B	S	3.5
201 - 300 RPM		B	N	0.3	B	S	2.0	B	S	2.5	B	S	2.5	B	S	3.5
301 - 500 RPM		B	N	0.3	B	S	2.0	B	S	2.0	B	S	2.5	B	S	3.5
501 RPM & OVER		B	N	0.3	B	S	2.0	B	S	2.0	B	S	2.0	B	S	2.5
60 HP & OVER:																
UP TO 300 RPM		B	S	2.0	I	S	2.5	I	S	3.5	I	S	3.5	I	S	3.5
301 - 500 RPM		B	S	2.0	I	S	2.0	I	S	2.5	I	S	3.5	I	S	3.5
501 RPM & OVER		B	S	1.0	I	S	2.0	I	S	2.0	I	S	2.5	I	S	2.5

EQUIPMENT	ON GRADE			20FT FLOOR SPAN			30FT FLOOR SPAN			40FT FLOOR SPAN			50FT FLOOR SPAN		
	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL
<b>AIR HANDLING UNIT PACKAGES</b>															
SUSPENDED:															
UP THRU 5 HP	---	---	---	---	H	1.0	---	H	1.0	---	H	1.0	---	H	1.0
7-1/2 HP & OVER:															
UP TO 500 RPM	---	---	---	---	H, THR	1.5	---	H, THR	2.5	---	H, THR	2.5	---	H, THR	2.5
501 RPM & OVER	---	---	---	---	H, THR	0.8	---	H, THR	0.8	---	H, TH R	0.8	---	H, TH R	2.0
FLOOR MOUNTED:															
UP THRU 5 HP	---	D	---	---	S	1.0	---	S	1.0	---	S	1.0	---	S	1.0
7-1/2 HP & OVER:															
UP TO 500 RPM	---	D	---	R	S, THR	1.5	R	S, THR	2.5	R	S, THR	2.5	R	S, THR	2.5
501 RPM & OVER	---	D	---	---	S, THR	0.8	---	S, THR	0.8	R	S, THR	1.5	R	S, THR	2.0
<b>IN-LINE CENTRIFUGAL AND VANE AXIAL FANS, FLOOR MOUNTED: (APR 9)</b>															
UP THRU 50 HP:															
UP TO 300 RPM	---	D	---	R	S	2.5	R	S	2.5	R	S	2.5	R	S	3.5
301 - 500 RPM	---	D	---	R	S	2.0	R	S	2.0	R	S	2.5	R	S	2.5
501 - & OVER	---	D	---	---	S	1.0	---	S	1.0	R	S	2.0	R	S	2.5
60 HP AND OVER:															
301 - 500 RPM	R	S	1.0	R	S	2.0	R	S	2.0	R	S	2.5	R	S	3.5

EQUIPMENT	ON GRADE			20FT FLOOR SPAN			30FT FLOOR SPAN			40FT FLOOR SPAN			50FT FLOOR SPAN		
	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL	BASE TYPE	ISOL TYPE	MIN DEFL
501 RPM & OVER	R	S	1.0	R	S	2.0	R	S	2.0	R	S	2.0	R	S	2.5

**NOTES:**

1. For suspended floors lighter than 100 mm (4 inch) thick concrete, select deflection requirements from next higher span.
2. For projects in seismic areas, use only SS & DS type isolators and snubbers.
3. For floor mounted in-line centrifugal blowers (ARR 1): use "B" type in lieu of "R" type base.
4. Suspended: Use "H" isolators of same deflection as floor mounted.



**SECTION 23 05 93**  
**TESTING, ADJUSTING, AND BALANCING FOR HVAC**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

A. Testing, adjusting, and balancing (TAB) of heating, ventilating and air conditioning (HVAC) systems. TAB includes the following:

1. Planning systematic TAB procedures.
2. Design Review Report.
3. Systems Inspection report.
4. Duct Air Leakage test report.
5. Systems Readiness Report (Pre-construction for existing systems).
6. Balancing air and water distribution systems; adjustment of total system to provide design performance; and testing performance of equipment and automatic controls.
7. Vibration and sound measurements.
8. Recording and reporting results.

B. Definitions:

1. Basic TAB used in this Section: Chapter 37, "Testing, Adjusting and Balancing" of 2007 ASHRAE Handbook, "HVAC Applications".
2. TAB: Testing, Adjusting and Balancing; the process of checking and adjusting HVAC systems to meet design objectives.
3. AABC: Associated Air Balance Council.
4. NEBB: National Environmental Balancing Bureau.
5. Hydronic Systems: Includes chilled water, heating hot water (Reheat) and glycol-water systems.
6. Air Systems: Includes all outside air, supply air, return air, exhaust air and relief air systems.
7. Flow rate tolerance: The allowable percentage variation, minus to plus, of actual flow rate from values (design) in the contract documents.

**1.2 RELATED WORK**

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC: General Mechanical Requirements.
- B. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT: Noise and Vibration Requirements.
- C. Section 23 07 11, HVAC INSULATION: Piping and Equipment Insulation.
- D. Section 23 36 00, AIR TERMINAL UNITS: Terminal Units Performance.
- E. Section 23 31 00, HVAC DUCTS AND CASINGS: Duct Leakage.

- F. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Controls and Instrumentation Settings.
- G. Section 23 82 16, AIR COILS
- H. Section 23 82 00, CONVECTION HEATING AND COOLING UNITS
- I. Section 23 74 43, CUSTOM, OUTDOOR, PENTHOUSE EQUIPMENT MODULE/CENTRAL-STATION AIR-HANDLING UNITS
- J. Section 23 34 00, HVAC FANS
- K. Section 23 37 00, AIR OUTLETS AND INLETS
- L. Section 23 21 13, HYDRONIC PIPING
- M. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS. Requirements for commissioning, systems readiness checklists, and training
- N. Section 23 05 12 GENERAL MOTOR REQUIREMENTS FOR HVAC EQUIPMENT

### **1.3 QUALITY ASSURANCE**

- A. Refer to Articles, Quality Assurance and Submittals, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS.
- B. Qualifications:
  - 1. TAB Agency: The TAB agency shall be a subcontractor of the General Contractor and shall report to and be paid by the General Contractor.
  - 2. The TAB agency shall be either a certified member of AABC or certified by the NEBB to perform TAB service for HVAC, water balancing and vibrations and sound testing of equipment. The certification shall be maintained for the entire duration of duties specified herein. If, for any reason, the agency loses subject certification during this period, the General Contractor shall immediately notify the Contracting Officers Representative (COR) and submit another TAB firm for approval. Any agency that has been the subject of disciplinary action by either the AABC or the NEBB within the five years preceding Contract Award shall not be eligible to perform any work related to the TAB. All work performed in this Section and in other related Sections by the TAB agency shall be considered invalid if the TAB agency loses its certification prior to Contract completion, and the successor agency's review shows unsatisfactory work performed by the predecessor agency.
  - 3. TAB Specialist: The TAB specialist shall be either a member of AABC or an experienced technician of the Agency certified by NEBB. The certification shall be maintained for the entire duration of duties

- specified herein. If, for any reason, the Specialist loses subject certification during this period, the General Contractor shall immediately notify the COR and submit another TAB Specialist for approval. Any individual that has been the subject of disciplinary action by either the AABC or the NEBB within the five years preceding Contract Award shall not be eligible to perform any duties related to the HVAC systems, including TAB. All work specified in this Section and in other related Sections performed by the TAB specialist shall be considered invalid if the TAB Specialist loses its certification prior to Contract completion and must be performed by an approved successor.
4. TAB Specialist shall be identified by the General Contractor within 60 days after the notice to proceed. The TAB specialist will be coordinating, scheduling and reporting all TAB work and related activities and will provide necessary information as required by the COR. The responsibilities would specifically include:
    - a. Shall directly supervise all TAB work.
    - b. Shall sign the TAB reports that bear the seal of the TAB standard. The reports shall be accompanied by report forms and schematic drawings required by the TAB standard, AABC or NEBB.
    - c. Would follow all TAB work through its satisfactory completion.
    - d. Shall provide final markings of settings of all HVAC adjustment devices.
    - e. Permanently mark location of duct test ports.
  5. All TAB technicians performing actual TAB work shall be experienced and must have done satisfactory work on a minimum of 3 projects comparable in size and complexity to this project. Qualifications must be certified by the TAB agency in writing. The lead technician shall be certified by AABC or NEBB.
- C. Test Equipment Criteria: The instrumentation shall meet the accuracy/calibration requirements established by AABC National Standards or by NEBB Procedural Standards for Testing, Adjusting and Balancing of Environmental Systems and instrument manufacturer. Provide calibration history of the instruments to be used for test and balance purpose.
- D. Tab Criteria:
1. One or more of the applicable AABC, NEBB or SMACNA publications, supplemented by ASHRAE Handbook "HVAC Applications" Chapter 36, and

- requirements stated herein shall be the basis for planning, procedures, and reports.
2. Flow rate tolerance: Following tolerances are allowed. For tolerances not mentioned herein follow ASHRAE Handbook "HVAC Applications", Chapter 36, as a guideline. Air Filter resistance during tests, artificially imposed if necessary, shall be at least 100 percent of manufacturer recommended change over pressure drop values for pre-filters and after-filters.
    - a. Air handling unit and all other fans, cubic meters/min (cubic feet per minute): Minus 0 percent to plus 10 percent.
    - b. Air terminal units (maximum values): Minus 2 percent to plus 10 percent.
    - c. Exhaust hoods/cabinets: 0 percent to plus 10 percent.
    - d. Minimum outside air: 0 percent to plus 10 percent.
    - e. Individual room air outlets and inlets, and air flow rates not mentioned above: Minus 5 percent to plus 10 percent except if the air to a space is 100 CFM or less the tolerance would be minus 5 to plus 5 percent.
    - f. Heating hot water pumps and hot water coils: Minus 5 percent to plus 5 percent.
    - g. Chilled water and condenser water pumps: Minus 0 percent to plus 5 percent.
    - h. Chilled water coils: Minus 0 percent to plus 5 percent.
  3. Systems shall be adjusted for energy efficient operation as described in PART 3.
  4. Typical TAB procedures and results shall be demonstrated to the COR for one air distribution system (including all fans, three terminal units, three rooms randomly selected by the COR) and one hydronic system (pumps and three coils) as follows:
    - a. When field TAB work begins.
    - b. During each partial final inspection and the final inspection for the project if requested by VA.

#### **1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Submit names and qualifications of TAB agency and TAB specialists within 60 days after the notice to proceed. Submit information on three recently completed projects and a list of proposed test equipment.

C. For use by the COR staff, submit one complete set of applicable AABC or NEBB publications that will be the basis of TAB work.

D. Submit Following for Review and Approval:

1. Design Review Report within 90 days for conventional design projects after the system layout on air and water side is completed by the Contractor.
2. Systems inspection report on equipment and installation for conformance with design.
3. Duct Air Leakage Test Reports by system type (supply, return, exhaust, outdoor air, relief air), air handling unit system, etc.
4. Systems Readiness Report (Pre-construction for existing systems).
5. Intermediate, Phased and Final TAB reports covering flow balance and adjustments, room pressurization / transfer offset airflow and differential pressure, performance tests, vibration tests and sound tests.
6. Include in final reports uncorrected installation deficiencies noted during TAB and applicable explanatory comments on test results that differ from design requirements.

E. Prior to request for Final or Partial Final inspection, submit completed Test and Balance report for the area.

F. All air distribution test and balance reports shall include plan drawings with representative symbols for all installed air inlets and outlets located in ceilings, on walls, in ductwork (sidewalls/direct attachment to ducts as in mechanical equipment rooms, etc.). Plan drawings shall be minimum of  $1/8" = 1'-0"$  or  $3/32" = 1'-0"$  and shall include room names, room numbers, column grids to locate and identify each space, etc. Plan Drawings shall be cross-referenced with tags/identification of each air inlet/outlet to correlate to the test and balance reports for existing, as-found new, phased/temporary and final balanced airflows at each device in accordance with the specific test and balance report that the plan drawing is being submitted with.

#### **1.5 APPLICABLE PUBLICATIONS**

A. The following publications form a part of this specification to the extent indicated by the reference thereto. In text the publications are referenced to by the acronym of the organization.

- B. American Society of Heating, Refrigerating and Air Conditioning Engineers, Inc. (ASHRAE):
  - 2007 .....HVAC Applications ASHRAE Handbook, Chapter 37, Testing, Adjusting, and Balancing and Chapter 47, Sound and Vibration Control
- C. Associated Air Balance Council (AABC):
  - 2002.....AABC National Standards for Total System Balance
- D. National Environmental Balancing Bureau (NEBB):
  - 7<sup>th</sup> Edition 2005 .....Procedural Standards for Testing, Adjusting, Balancing of Environmental Systems
  - 2nd Edition 2006 .....Procedural Standards for the Measurement of Sound and Vibration
  - 3<sup>rd</sup> Edition 2009 .....Procedural Standards for Whole Building Systems Commissioning of New Construction
- E. Sheet Metal and Air Conditioning Contractors National Association (SMACNA):
  - 3<sup>rd</sup> Edition 2002 .....HVAC SYSTEMS Testing, Adjusting and Balancing

## **PART 2 - PRODUCTS**

### **2.1 PLUGS**

Provide plastic plugs to seal holes drilled in ductwork for test purposes.

### **2.2 INSULATION REPAIR MATERIAL**

See Section 23 07 11, HVAC and BOILER PLANT INSULATION Provide for repair of insulation removed or damaged for TAB work.

## **PART 3 - EXECUTION**

### **3.1 GENERAL**

- A. Refer to TAB Criteria in Article, Quality Assurance.
- B. Obtain applicable contract documents and copies of approved submittals for HVAC equipment and automatic control systems.

### **3.2 DESIGN REVIEW REPORT**

The TAB Specialist shall review the Contract Plans and specifications and advise the COR of any design deficiencies that would prevent the HVAC systems from effectively operating in accordance with the sequence of operation specified or prevent the effective and accurate TAB of the system. The TAB Specialist shall provide a report individually listing each deficiency and the corresponding proposed corrective action necessary for proper system operation.

### **3.3 SYSTEMS INSPECTION REPORT**

- A. Inspect equipment and installation for conformance with design.
- B. The inspection and report is to be done after air distribution equipment is on site and duct installation has begun, but well in advance of performance testing and balancing work. The purpose of the inspection is to identify and report deviations from design and ensure that systems will be ready for TAB at the appropriate time.
- C. Reports: Follow check list format developed by AABC, NEBB or SMACNA, supplemented by narrative comments, with emphasis on air handling units and fans. Check for conformance with submittals. Verify that diffuser and register sizes are correct. Check air terminal unit installation including their duct sizes and routing.

### **3.4 DUCT AIR LEAKAGE TEST REPORT**

TAB Agency shall perform the leakage test as outlined in "Duct leakage Tests and Repairs" in Section 23 31 00, HVAC DUCTS and CASINGS for TAB agency's role and responsibilities in witnessing, recording and reporting of deficiencies.

### **3.5 SYSTEM READINESS REPORT**

- A. Prior to the beginning of construction/demolition efforts, the TAB Contractor shall measure existing air and water flow rates associated with existing systems utilized to serve renovated areas as indicated on drawings. Submit report of findings to COR.
- B. Inspect each System to ensure that it is complete including installation and operation of controls. Submit report to COR in standard format and forms prepared and or approved by the Commissioning Agent.
- C. Verify that all items such as ductwork piping, ports, terminals, connectors, etc., that is required for TAB are installed. Provide a report to the COR.

### **3.6 TAB REPORTS**

- A. Submit an intermediate report for 50 percent of systems and equipment tested and balanced to establish satisfactory test results.
- B. The TAB contractor shall provide raw data immediately in writing to the COR if there is a problem in achieving intended results before submitting a formal report.
- C. If over 20 percent of readings in the intermediate report fall outside the acceptable range, the TAB report shall be considered invalid and

all contract TAB work shall be repeated and re-submitted for approval at no additional cost to the owner.

- D. Do not proceed with the remaining systems until intermediate report is approved by the COR.

### **3.7 TAB PROCEDURES**

- A. Tab shall be performed in accordance with the requirement of the Standard under which TAB agency is certified by either AABC or NEBB.
- B. General: During TAB all related system components shall be in full operation. Fan and pump rotation, motor loads and equipment vibration shall be checked and corrected as necessary before proceeding with TAB. Set controls and/or block off parts of distribution systems to simulate design operation of variable volume air or water systems for test and balance work.
- C. Coordinate TAB procedures with existing systems and any phased construction completion requirements for the project. Provide TAB reports for pre-construction air and water flow rate and for each phase of the project prior to partial final inspections of each phase of the project. Return/maintain existing areas outside the work area to pre constructed conditions.
- D. Allow 30 days time in construction schedule for TAB and submission of all reports for an organized and timely correction of deficiencies.
- E. Air Balance and Equipment Test: Include air handling units, fans, terminal units, fan coil units, room diffusers/outlets/inlets, computer room AC units, laboratory fume hoods, and biological safety cabinets.
1. Artificially load air filters by partial blanking to produce air pressure drop of manufacturer's recommended pressure drop.
  2. Adjust fan speeds to provide design air flow. V-belt drives, including fixed pitch pulley requirements, are specified in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
  3. Test and balance systems in all specified modes of operation, including variable volume, economizer, and fire emergency modes. Verify that dampers and other controls function properly.
  4. Variable air volume (VAV) systems:
    - a. Coordinate TAB, including system volumetric controls, with Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
    - b. Section 23 36 00, AIR TERMINAL UNITS, specifies that maximum and minimum flow rates for air terminal units (ATU) be factory set. Check and readjust ATU flow rates if necessary. Balance air



distribution from ATU on full cooling maximum scheduled cubic meters per minute (cubic feet per minute). Reset room thermostats and check ATU operation from maximum to minimum cooling, to the heating mode, and back to cooling. Record and report the heating coil leaving air temperature when the ATU is in the maximum heating mode. Record and report outdoor air flow rates under all operating conditions (The test shall demonstrate that the minimum outdoor air ventilation rate shall remain constant under all operating conditions).

- c. Adjust operating pressure control setpoint to maintain the design flow to each space with the lowest setpoint.
5. Record final measurements for air handling equipment performance data sheets.
- F. Water Balance and Equipment Test: Include circulating pumps, convertors, coils, coolers and condensers:
  1. Coordinate Packaged Heat Transfer and Pumping System and Penthouse Equipment Module AHU/Reheat Coil flow balancing with Section 23 74 43 CUSTOM OUTDOOR PENTHOUSE EQUIPMENT MODULE/CENTRAL STATION AIR HANDLING UNIT.
  2. Adjust flow rates for equipment. Set coils and evaporator to values on equipment submittals, if different from values on contract drawings.
  3. Primary-secondary (variable volume) systems: Coordinate TAB with Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC. Balance systems at design water flow and then verify that variable flow controls function as designed.
  4. Record final measurements for hydronic equipment on performance data sheets. Include entering and leaving water temperatures for heating and cooling coils, convertors and radiant ceiling heating panels, etc. Include entering and leaving air temperatures (DB/WB for cooling coils) for air handling units and reheat coils. Make air and water temperature measurements at the same time.

### **3.8 VIBRATION TESTING**

- A. Furnish instruments and perform vibration measurements as specified in Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT. Field vibration balancing is specified in Section 23 05 11, COMMON WORK RESULTS FOR HVAC. Provide measurements for all rotating

HVAC equipment of 373 watts (1/2 horsepower) and larger, including centrifugal/screw compressors, cooling towers, pumps, fans and motors.

- B. Record initial measurements for each unit of equipment on test forms and submit a report to the COR. Where vibration readings exceed the allowable tolerance Contractor shall be directed to correct the problem. The TAB agency shall verify that the corrections are done and submit a final report to the COR.

### 3.9 SOUND TESTING

- A. Perform and record required sound measurements in accordance with Paragraph, QUALITY ASSURANCE in Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.
1. Take readings in rooms, approximately fifteen (15) percent of all rooms. The COR may designate the specific rooms to be tested.
- B. Take measurements with a calibrated sound level meter and octave band analyzer of the accuracy required by AABC or NEBB.
- C. Sound reference levels, formulas and coefficients shall be according to ASHRAE Handbook, "HVAC Applications", Chapter 46, SOUND AND VIBRATION CONTROL.
- D. Determine compliance with specifications as follows:
1. When sound pressure levels are specified, including the NC Criteria in Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT:
- a. Reduce the background noise as much as possible by shutting off unrelated audible equipment.
- b. Measure octave band sound pressure levels with specified equipment "off."
- c. Measure octave band sound pressure levels with specified equipment "on."
- d. Use the DIFFERENCE in corresponding readings to determine the sound pressure due to equipment.

DIFFERENCE:	0	1	2	3	4	5 to 9	10 or More
FACTOR:	10	7	4	3	2	1	0

Sound pressure level due to equipment equals sound pressure level with equipment "on" minus FACTOR.

- e. Plot octave bands of sound pressure level due to equipment for typical rooms on a graph which also shows noise criteria (NC) curves.
- 2. When sound power levels are specified:
  - a. Perform steps 1.a. thru 1.d., as above.
  - b. For indoor equipment: Determine room attenuating effect, i.e., difference between sound power level and sound pressure level. Determined sound power level will be the sum of sound pressure level due to equipment plus the room attenuating effect.
  - c. For outdoor equipment: Use directivity factor and distance from noise source to determine distance factor, i.e., difference between sound power level and sound pressure level. Measured sound power level will be the sum of sound pressure level due to equipment plus the distance factor. Use 13 meters (40 feet) for sound level location.
- 3. Where sound pressure levels are specified in terms of dB(A), measure sound levels using the "A" scale of meter. Single value readings will be used instead of octave band analysis.
- E. Where measured sound levels exceed specified level, the installing contractor or equipment manufacturer shall take remedial action approved by the COR and the necessary sound tests shall be repeated.
- F. Test readings for sound testing could go higher than 15 percent if determination is made by the COR based on the recorded sound data.

### **3.10 MARKING OF SETTINGS**

Following approval of Tab final Report, the setting of all HVAC adjustment devices including valves, splitters and dampers shall be permanently marked by the TAB Specialist so that adjustment can be restored if disturbed at any time. Style and colors used for markings shall be coordinated with the COR.

### **3.11 IDENTIFICATION OF TEST PORTS**

The TAB Specialist shall permanently and legibly identify the location points of duct test ports. If the ductwork has exterior insulation, the identification shall be made on the exterior side of the insulation. All penetrations through ductwork and ductwork insulation shall be sealed to prevent air leaks and maintain integrity of vapor barrier.

### **3.12 PHASING**

- A. Phased Projects: Testing and Balancing Work to follow project with areas shall be completed per the project phasing. Upon completion of

the project all areas shall have been tested and balanced per the contract documents.

- B. Existing Areas: Systems that serve areas outside of the project scope shall not be adversely affected. Measure existing parameters where shown to document system capacity.

### **3.13 COMMISSIONING**

- A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

- - E N D - -

**SECTION 23 07 11**  
**HVAC INSULATION**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Field applied insulation for thermal efficiency and condensation control for
  - 1. HVAC piping, ductwork and equipment.
- B. Definitions
  - 1. ASJ: All service jacket, white finish facing or jacket.
  - 2. Air conditioned space: Space having air temperature and/or humidity controlled by mechanical equipment.
  - 3. Cold: Equipment, ductwork or piping handling media at design temperature of 16 degrees C (60 degrees F) or below.
  - 4. Concealed: Ductwork and piping above ceilings and in chases, interstitial space, and pipe spaces.
  - 5. Exposed: Piping, ductwork, and equipment exposed to view in finished areas including mechanical, and electrical equipment rooms or exposed to outdoor weather. Attics and crawl spaces where air handling units are located are considered to be mechanical rooms. Shafts, chases, interstitial spaces, unfinished attics, crawl spaces and pipe basements are not considered finished areas.
  - 6. FSK: Foil-scrim-kraft facing.
  - 7. Hot: HVAC Ductwork handling air at design temperature above 16 degrees C (60 degrees F); HVAC equipment or piping handling media above 41 degrees C (105 degrees F); and piping media and equipment 32 to 230 degrees C (90 to 450 degrees F).
  - 8. Density:  $\text{kg/m}^3$  - kilograms per cubic meter (Pcf - pounds per cubic foot).
  - 9. Runouts: Branch pipe connections up to 25-mm (one-inch) nominal size to fan coil units or reheat coils for terminal units.
  - 10. Thermal conductance: Heat flow rate through materials.
    - a. Flat surface: Watt per square meter (BTU per hour per square foot).
    - b. Pipe or Cylinder: Watt per square meter (BTU per hour per linear foot).

11. Thermal Conductivity (k): Watt per meter, per degree C (BTU per inch thickness, per hour, per square foot, per degree F temperature difference).
12. Vapor Retarder (Vapor Barrier): A material which retards the transmission (migration) of water vapor. Performance of the vapor retarder is rated in terms of permeance (perms). For the purpose of this specification, vapor retarders shall have a maximum published permeance of 0.1 perms and vapor barriers shall have a maximum published permeance of 0.001 perms.
13. HPS: High pressure steam (415 kPa [60 psig] and above).
14. HPR: High pressure steam condensate return.
15. MPS: Medium pressure steam (110 kPa [16 psig] thru 414 kPa [59 psig]).
16. MPR: Medium pressure steam condensate return.
17. LPS: Low pressure steam (103 kPa [15 psig] and below).
18. LPR: Low pressure steam condensate gravity return.
19. PC: Pumped condensate.
20. HWH: Hot water heating supply.
21. HWHR: Hot water heating return.
22. GH: Hot glycol-water heating supply.
23. GHR: Hot glycol-water heating return.
24. FWPD: Feedwater pump discharge.
25. FWPS: Feedwater pump suction.
26. CTPD: Condensate transfer pump discharge.
27. CTPS: Condensate transfer pump suction.
28. VR: Vacuum condensate return.
29. CPD: Condensate pump discharge.
30. R: Pump recirculation.
31. FOS: Fuel oil supply.
32. FOR: Fuel oil return.
33. CW: Cold water.
34. SW: Soft water.
35. HW: Hot water.
36. CH: Chilled water supply.
37. CHR: Chilled water return.
38. GC: Chilled glycol-water supply.
39. GCR: Chilled glycol-water return.

40. RS: Refrigerant suction.

41. PVDC: Polyvinylidene chloride vapor retarder jacketing, white.

## **1.2 RELATED WORK**

- A. Section 07 84 00, FIRESTOPPING: Mineral fiber and bond breaker behind sealant.
- B. Section 23 05 11, COMMON WORK RESULTS FOR HVAC: General mechanical requirements and items, which are common to more than one section of Division 23.
- C. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT
- E. Section 23 22 13, STEAM and CONDENSATE HEATING PIPING
- F. Section 23 21 13, HYDRONIC PIPING and Section 23 22 13, STEAM and CONDENSATE HEATING PIPING: Piping and equipment.
- G. Section 23 31 00, HVAC DUCTS AND CASINGS: Ductwork, plenum and fittings.
- H. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS. Requirements for commissioning, systems readiness checklists, and training.

## **1.3 QUALITY ASSURANCE**

- A. Refer to article QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

- B. Criteria:

- 1. Comply with NFPA 90A, particularly paragraphs 4.3.3.1 through 4.3.3.6, 4.3.10.2.6, and 5.4.6.4, parts of which are quoted as follows:

**4.3.3.1** Pipe insulation and coverings, duct coverings, duct linings, vapor retarder facings, adhesives, fasteners, tapes, and supplementary materials added to air ducts, plenums, panels, and duct silencers used in duct systems, unless otherwise provided for in 4.3.3.1.1 or 4.3.3.1.2., shall have, in the form in which they are used, a maximum flame spread index of 25 without evidence of continued progressive combustion and a maximum smoke developed index of 50 when tested in accordance with NFPA 255, *Standard Method of Test of Surface Burning Characteristics of Building Materials*.

**4.3.3.1.1** Where these products are to be applied with adhesives, they shall be tested with such adhesives applied, or the adhesives used shall have a maximum flame spread index of 25 and a maximum smoke developed index of 50 when in the final dry state. (See 4.2.4.2.)

**4.3.3.1.2** The flame spread and smoke developed index requirements of 4.3.3.1.1 shall not apply to air duct weatherproof coverings where they are located entirely outside of a building, do not penetrate a wall or roof, and do not create an exposure hazard.

4.3.3.2 Closure systems for use with rigid and flexible air ducts tested in accordance with UL 181, Standard for Safety Factory-Made Air Ducts and Air Connectors, shall have been tested, listed, and used in accordance with the conditions of their listings, in accordance with one of the following:

- (1) UL 181A, Standard for Safety Closure Systems for Use with Rigid Air Ducts and Air Connectors
- (2) UL 181B, Standard for Safety Closure Systems for Use with Flexible Air Ducts and Air Connectors

4.3.3.3 Air duct, panel, and plenum coverings and linings, and pipe insulation and coverings shall not flame, glow, smolder, or smoke when tested in accordance with a similar test for pipe covering, ASTM C 411, Standard Test Method for Hot-Surface Performance of High-Temperature Thermal Insulation, at the temperature to which they are exposed in service.

4.3.3.3.1 In no case shall the test temperature be below 121°C (250°F).

4.3.3.4 Air duct coverings shall not extend through walls or floors that are required to be fire stopped or required to have a fire resistance rating, unless such coverings meet the requirements of 5.4.6.4.

4.3.3.5\* Air duct linings shall be interrupted at fire dampers to prevent interference with the operation of devices.

4.3.3.6 Air duct coverings shall not be installed so as to conceal or prevent the use of any service opening.

4.3.10.2.6 Materials exposed to the airflow shall be noncombustible or limited combustible and have a maximum smoke developed index of 50 or comply with the following.

4.3.10.2.6.1 Electrical wires and cables and optical fiber cables shall be listed as noncombustible or limited combustible and have a maximum smoke developed index of 50 or shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with NFPA 262, Standard Method of Test for Flame Travel and Smoke of Wires and Cables for Use in Air-Handling Spaces.

4.3.10.2.6.4 Optical-fiber and communication raceways shall be listed as having a maximum peak optical density of 0.5 or less, an average optical density of 0.15 or less, and a maximum flame spread distance of 1.5 m (5 ft) or less when tested in accordance with UL 2024, Standard for Safety Optical-Fiber Cable Raceway.

4.3.10.2.6.6 Supplementary materials for air distribution systems shall be permitted when complying with the provisions of 4.3.3.

5.4.6.4 Where air ducts pass through walls, floors, or partitions that are required to have a fire resistance rating and where fire dampers are not required, the opening in the construction around the air duct shall be as follows:

- (1) Not exceeding a 25.4 mm (1 in.) average clearance on all sides



(2) Filled solid with an approved material capable of preventing the passage of flame and hot gases sufficient to ignite cotton waste when subjected to the time-temperature fire conditions required for fire barrier penetration as specified in NFPA 251, Standard Methods of Tests of Fire Endurance of Building Construction and Materials

2. Test methods: ASTM E84, UL 723, or NFPA 255.
3. Specified k factors are at 24 degrees C (75 degrees F) mean temperature unless stated otherwise. Where optional thermal insulation material is used, select thickness to provide thermal conductance no greater than that for the specified material. For pipe, use insulation manufacturer's published heat flow tables. For domestic hot water supply and return, run out insulation and condensation control insulation, no thickness adjustment need be made.
4. All materials shall be compatible and suitable for service temperature, and shall not contribute to corrosion or otherwise attack surface to which applied in either the wet or dry state.

C. Every package or standard container of insulation or accessories delivered to the job site for use must have a manufacturer's stamp or label giving the name of the manufacturer and description of the material.

#### **1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Shop Drawings:
  1. All information, clearly presented, shall be included to determine compliance with drawings and specifications and ASTM, federal and military specifications.
    - a. Insulation materials: Specify each type used and state surface burning characteristics.
    - b. Insulation facings and jackets: Each type used. Make it clear that white finish will be furnished for exposed ductwork, casings and equipment.
    - c. Insulation accessory materials: Each type used.
    - d. Manufacturer's installation and fitting fabrication instructions for flexible unicellular insulation.
    - e. Make reference to applicable specification paragraph numbers for coordination.

C. Samples:

1. Each type of insulation: Minimum size 100 mm (4 inches) square for board/block/ blanket; 150 mm (6 inches) long, full diameter for round types.
2. Each type of facing and jacket: Minimum size 100 mm (4 inches square).
3. Each accessory material: Minimum 120 ML (4 ounce) liquid container or 120 gram (4 ounce) dry weight for adhesives / cement / mastic.

**1.5 STORAGE AND HANDLING OF MATERIAL**

Store materials in clean and dry environment, pipe covering jackets shall be clean and unmarred. Place adhesives in original containers. Maintain ambient temperatures and conditions as required by printed instructions of manufacturers of adhesives, mastics and finishing cements.

**1.6 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only.
- B. Federal Specifications (Fed. Spec.):
- L-P-535E (2)- 99.....Plastic Sheet (Sheeting): Plastic Strip; Poly (Vinyl Chloride) and Poly (Vinyl Chloride - Vinyl Acetate), Rigid.
- C. Military Specifications (Mil. Spec.):
- MIL-A-3316C (2)-90.....Adhesives, Fire-Resistant, Thermal Insulation
- MIL-A-24179A (1)-87.....Adhesive, Flexible Unicellular-Plastic Thermal Insulation
- MIL-C-19565C (1)-88.....Coating Compounds, Thermal Insulation, Fire-and Water-Resistant, Vapor-Barrier
- MIL-C-20079H-87.....Cloth, Glass; Tape, Textile Glass; and Thread, Glass and Wire-Reinforced Glass
- D. American Society for Testing and Materials (ASTM):
- A167-99(2004).....Standard Specification for Stainless and Heat-Resisting Chromium-Nickel Steel Plate, Sheet, and Strip
- B209-07.....Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate

C411-05.....	Standard test method for Hot-Surface Performance of High-Temperature Thermal Insulation
C449-07.....	Standard Specification for Mineral Fiber Hydraulic-Setting Thermal Insulating and Finishing Cement
C533-09.....	Standard Specification for Calcium Silicate Block and Pipe Thermal Insulation
C534-08.....	Standard Specification for Preformed Flexible Elastomeric Cellular Thermal Insulation in Sheet and Tubular Form
C547-07.....	Standard Specification for Mineral Fiber pipe Insulation
C552-07.....	Standard Specification for Cellular Glass Thermal Insulation
C553-08.....	Standard Specification for Mineral Fiber Blanket Thermal Insulation for Commercial and Industrial Applications
C585-09.....	Standard Practice for Inner and Outer Diameters of Rigid Thermal Insulation for Nominal Sizes of Pipe and Tubing (NPS System) R (1998)
C612-10.....	Standard Specification for Mineral Fiber Block and Board Thermal Insulation
C1126-04.....	Standard Specification for Faced or Unfaced Rigid Cellular Phenolic Thermal Insulation
C1136-10.....	Standard Specification for Flexible, Low Permeance Vapor Retarders for Thermal Insulation
D1668-97a (2006).....	Standard Specification for Glass Fabrics (Woven and Treated) for Roofing and Waterproofing
E84-10.....	Standard Test Method for Surface Burning Characteristics of Building Materials
E119-09c.....	Standard Test Method for Fire Tests of Building Construction and Materials

E136-09b.....Standard Test Methods for Behavior of Materials  
in a Vertical Tube Furnace at 750 degrees C  
(1380 F)

E. National Fire Protection Association (NFPA):

90A-09.....Standard for the Installation of Air  
Conditioning and Ventilating Systems

96-08.....Standards for Ventilation Control and Fire  
Protection of Commercial Cooking Operations

101-09.....Life Safety Code

251-06.....Standard methods of Tests of Fire Endurance of  
Building Construction Materials

255-06.....Standard Method of tests of Surface Burning  
Characteristics of Building Materials

F. Underwriters Laboratories, Inc (UL):

723.....UL Standard for Safety Test for Surface Burning  
Characteristics of Building Materials with  
Revision of 09/08

G. Manufacturer's Standardization Society of the Valve and Fitting  
Industry (MSS):

SP58-2009.....Pipe Hangers and Supports Materials, Design,  
and Manufacture

## **PART 2 - PRODUCTS**

### **2.1 MINERAL FIBER OR FIBER GLASS**

A. ASTM C612 (Board, Block), Class 1 or 2, density 48 kg/m<sup>3</sup> (3 pcf), k = 0.037 (0.26) at 24 degrees C (75 degrees F), external insulation for temperatures up to 204 degrees C (400 degrees F) with foil scrim (FSK) facing.

B. ASTM C553 (Blanket, Flexible) Type I, Class B-5, Density 32 kg/m<sup>3</sup> (2 pcf), k = 0.04 (0.27) at 24 degrees C (75 degrees F), for use at temperatures up to 204 degrees C (400 degrees F) with foil scrim (FSK) facing.

C. ASTM C547 (Pipe Fitting Insulation and Preformed Pipe Insulation), Class 1, k = 0.037 (0.26) at 24 degrees C (75 degrees F), for use at temperatures up to 230 degrees C (450 degrees F) with an all service vapor retarder jacket with polyvinyl chloride pre-molded fitting covering.

## **2.2 MINERAL WOOL OR REFRACTORY FIBER**

- A. Comply with Standard ASTM C612, Class 3, 450 degrees C (850 degrees F).

## **2.3 RIGID CELLULAR PHENOLIC FOAM**

- A. Preformed (molded) pipe insulation, ASTM C1126, type III, grade 1,  $k = 0.021(0.15)$  at 10 degrees C (50 degrees F), for use at temperatures up to 121 degrees C (250 degrees F) with all service vapor retarder jacket with polyvinyl chloride premolded fitting covering.
- B. Equipment and Duct Insulation, ASTM C 1126, type II, grade 1,  $k = 0.021(0.15)$  at 10 degrees C (50 degrees F), for use at temperatures up to 121 degrees C (250 degrees F) with rigid cellular phenolic insulation and covering, and all service vapor retarder jacket.

## **2.4 CELLULAR GLASS CLOSED-CELL**

- A. Comply with Standard ASTM C177, C518, density 120 kg/m<sup>3</sup> (7.5 pcf) nominal,  $k = 0.033(0.29)$  at 24 degrees C (75 degrees F).
- B. Pipe insulation for use at temperatures up to 200 degrees C (400 degrees F) with all service vapor retarder jacket.

## **2.5 POLYISOCYANURATE CLOSED-CELL RIGID**

- A. Preformed (fabricated) pipe insulation, ASTM C591, type IV,  $K=0.027(0.19)$  at 24 degrees C (75 degrees F), flame spread not over 25, smoke developed not over 50, for use at temperatures up to 149 degree C (300 degree F) with factory applied PVDC or all service vapor retarder jacket with polyvinyl chloride premolded fitting covers.
- B. Equipment and duct insulation, ASTM C 591, type IV,  $K=0.027(0.19)$  at 24 degrees C (75 degrees F), for use at temperatures up to 149 degrees C (300 degrees F) with PVDC or all service jacket vapor retarder jacket.

## **2.6 FLEXIBLE ELASTOMERIC CELLULAR THERMAL**

ASTM C177, C518,  $k = 0.039(0.27)$  at 24 degrees C (75 degrees F), flame spread not over 25, smoke developed not over 50, for temperatures from minus 4 degrees C (40 degrees F) to 93 degrees C (200 degrees F). No jacket required.

## **2.7 FIRE-RATED DUCT WRAP FOR LABORATORY FUME HOOD EXHAUST DUCTS**

- A. Light weight, high temperature mineral fiber or ceramic fiber insulating material with low thermal conductivity  $K$  value of 0.060 W/m<sup>2</sup> degrees C (0.417 Btu in/hr ft<sup>2</sup> degrees F) at mean temperature of 260 degrees C (500 degrees F).
- B. Material shall be fully encapsulated by UL classified aluminum foil and tested to ASTM E84 standard.

- C. Material shall be UL tested for internal exhaust fire to 1093 degrees C (2,000 degrees F) with zero clearance and for through-penetration firestop.
- D. Material shall be UL classified for 2 hour fire rating for exhaust duct enclosure, and meet NFPA 96 requirements for direct applied insulating material to exhaust ducts with zero clearance.
- E. Material flame spread and smoke developed ratings shall not be higher than 5, as per ASTM E 84/UL 723 Flammability Test.
- F. Material shall serve as extension of two hour slab rating as exhaust duct offsets through rated floor assemblies. Duct wrap must completely enclose the ductwork and be sealed to provide two hour rated assembly through each rated floor opening continuous from slab penetration up from second floor, through third floor and to deck penetration up to fourth floor. See plan drawings for additional information.

## 2.8 CALCIUM SILICATE

- A. Preformed pipe Insulation: ASTM C533, Type I and Type II with indicator denoting asbestos-free material.
- B. Premolded Pipe Fitting Insulation: ASTM C533, Type I and Type II with indicator denoting asbestos-free material.
- C. Equipment Insulation: ASTM C533, Type I and Type II
- D. Characteristics:

Insulation Characteristics		
ITEMS	TYPE I	TYPE II
Temperature, maximum degrees C (degrees F)	649 (1200)	927 (1700)
Density (dry), Kg/m <sup>3</sup> (lb/ ft <sup>3</sup> )	232 (14.5)	288 (18)
Thermal conductivity: Min W/ m K (Btu in/h ft <sup>2</sup> degrees F)@ mean temperature of 93 degrees C (200 degrees F)	0.059 (0.41)	0.078 (0.540)
Surface burning characteristics: Flame spread Index, Maximum	0	0
Smoke Density index, Maximum	0	0

## **2.9 INSULATION FACINGS AND JACKETS**

- A. Vapor Retarder, higher strength with low water permeance  $\leq 0.02$  or less perm rating, Beach puncture 50 units for insulation facing on exposed ductwork, casings and equipment, and for pipe insulation jackets. Facings and jackets shall be all service type (ASJ) or PVDC Vapor Retarder jacketing.
- B. ASJ jacket shall be white kraft bonded to 0.025 mm (1 mil) thick aluminum foil, fiberglass reinforced, with pressure sensitive adhesive closure. Comply with ASTM C1136. Beach puncture 50 units, Suitable for painting without sizing. Jackets shall have minimum 40 mm (1-1/2 inch) lap on longitudinal joints and minimum 75 mm (3 inch) butt strip on end joints. Butt strip material shall be same as the jacket. Lap and butt strips shall be self-sealing type with factory-applied pressure sensitive adhesive.
- C. Vapor Retarder medium strength with low water vapor permeance of 0.02 or less perm rating), Beach puncture 25 units: Foil-Scrim-Kraft (FSK) or PVDC vapor retarder jacketing type for concealed ductwork and equipment.
- D. Field applied vapor barrier jackets shall be provided, in addition to the specified facings and jackets, on all exterior piping and ductwork as well as on interior piping and ductwork exposed to outdoor air (i.e.; in ventilated attics, piping in ventilated spaces conveying fluids below ambient temperature. The vapor barrier jacket shall consist of a multi-layer laminated cladding with a maximum water vapor permeance of 0.001 perms. The minimum puncture resistance shall be 35 cm-kg (30 inch-pounds) for interior locations and 92 cm-kg (80 inch-pounds) for exterior or exposed locations or where the insulation is subject to damage.
- E. Glass Cloth Jackets: Presized, minimum 0.18 kg per square meter (7.8 ounces per square yard), 2000 kPa (300 psig) bursting strength with integral vapor retarder where required or specified. Weather proof if utilized for outside service.
- F. Factory composite materials may be used provided that they have been tested and certified by the manufacturer.
- G. Pipe fitting insulation covering (jackets): Fitting covering shall be premolded to match shape of fitting and shall be polyvinyl chloride (PVC) conforming to Fed Spec L-P-335, composition A, Type II Grade GU,

and Type III, minimum thickness 0.7 mm (0.03 inches). Provide color matching vapor retarder pressure sensitive tape.

- H. Aluminum Jacket-Piping systems ASTM B209, 3003 alloy, H-14 temper, 0.6 mm (0.023 inch) minimum thickness with locking longitudinal joints. Jackets for elbows, tees and other fittings shall be factory-fabricated to match shape of fitting and of 0.6 mm (0.024) inch minimum thickness aluminum. Fittings shall be of same construction as straight run jackets but need not be of the same alloy. Factory-fabricated stainless steel bands shall be installed on all circumferential joints. Bands shall be 13 mm (0.5 inch) wide on 450 mm (18 inch) centers. System shall be weatherproof if utilized for outside service.
- I. Aluminum jacket-Rectangular breeching: ASTM B209, 3003 alloy, H-14 temper, 0.5 mm (0.020 inches) thick with 32 mm (1-1/4 inch) corrugations or 0.8 mm (0.032 inches) thick with no corrugations. System shall be weatherproof if used for outside service.

## **2.10 REMOVABLE INSULATION JACKETS**

- A. Insulation and Jacket:
1. Non-Asbestos Glass mat, type E needled fiber.
  2. Temperature maximum of 450°F, Maximum water vapor transmission of 0.00 perm, and maximum moisture absorption of 0.2 percent by volume.
  3. Jacket Material: Silicon/fiberglass and LFP 2109 pure PTFE.
  4. Construction: One piece jacket body with three-ply braided pure Teflon or Kevlar thread and insulation sewn as part of jacket. Belt fastened.

## **2.11 PIPE COVERING PROTECTION SADDLES**

- A. Cold pipe support: Premolded pipe insulation 180 degrees (half-shells) on bottom half of pipe at supports. Material shall be cellular glass or high density Polyisocyanurate insulation of the same thickness as adjacent insulation. Density of Polyisocyanurate insulation shall be a minimum of 48 kg/m<sup>3</sup> (3.0 pcf).

<b>Nominal Pipe Size and Accessories Material (Insert Blocks)</b>	
Nominal Pipe Size mm (inches)	Insert Blocks mm (inches)
Up through 125 (5)	150 (6) long
150 (6)	150 (6) long
200 (8), 250 (10), 300 (12)	225 (9) long
350 (14), 400 (16)	300 (12) long



Nominal Pipe Size and Accessories Material (Insert Blocks)	
Nominal Pipe Size mm (inches)	Insert Blocks mm (inches)
450 through 600 (18 through 24)	350 (14) long

B. Warm or hot pipe supports: Premolded pipe insulation (180 degree half-shells) on bottom half of pipe at supports. Material shall be high density Polyisocyanurate (for temperatures up to 149 degrees C [300 degrees F]), cellular glass or calcium silicate. Insulation at supports shall have same thickness as adjacent insulation. Density of Polyisocyanurate insulation shall be a minimum of 48 kg/m<sup>3</sup> (3.0 pcf).

#### **2.12 ADHESIVE, MASTIC, CEMENT**

- A. Mil. Spec. MIL-A-3316, Class 1: Jacket and lap adhesive and protective finish coating for insulation.
- B. Mil. Spec. MIL-A-3316, Class 2: Adhesive forlaps and for adhering insulation to metal surfaces.
- C. Mil. Spec. MIL-A-24179, Type II Class 1: Adhesive for installing flexible unicellular insulation and for laps and general use.
- D. Mil. Spec. MIL-C-19565, Type I: Protective finish for outdoor use.
- E. Mil. Spec. MIL-C-19565, Type I or Type II: Vapor barrier compound for indoor use.
- F. ASTM C449: Mineral fiber hydraulic-setting thermal insulating and finishing cement.
- G. Other: Insulation manufacturers' published recommendations.

#### **2.13 MECHANICAL FASTENERS**

- A. Pins, anchors: Welded pins, or metal or nylon anchors with galvanized steel-coated or fiber washer, or clips. Pin diameter shall be as recommended by the insulation manufacturer.
- B. Staples: Outward clinching monel.
- C. Wire: 1.3 mm thick (18 gage) soft annealed galvanized or 1.9 mm (14 gage) copper clad steel or nickel copper alloy.
- D. Bands: 13 mm (0.5 inch) nominal width, brass, galvanized steel, aluminum or stainless steel.

#### **2.14 REINFORCEMENT AND FINISHES**

- A. Glass fabric, open weave: ASTM D1668, Type III (resin treated) and Type I (asphalt treated).
- B. Glass fiber fitting tape: Mil. Spec MIL-C-20079, Type II, Class 1.

- C. Tape for Flexible Elastomeric Cellular Insulation: As recommended by the insulation manufacturer.
- D. Hexagonal wire netting: 25 mm (one inch) mesh, 0.85 mm thick (22 gage) galvanized steel.
- E. Corner beads: 50 mm (2 inch) by 50 mm (2 inch), 0.55 mm thick (26 gage) galvanized steel; or, 25 mm (1 inch) by 25 mm (1 inch), 0.47 mm thick (28 gage) aluminum angle adhered to 50 mm (2 inch) by 50 mm (2 inch) Kraft paper.
- F. PVC fitting cover: Fed. Spec L-P-535, Composition A, 11-86 Type II, Grade GU, with Form B Mineral Fiber insert, for media temperature 4 degrees C (40 degrees F) to 121 degrees C (250 degrees F). Below 4 degrees C (40 degrees F) and above 121 degrees C (250 degrees F). Provide double layer insert. Provide color matching vapor barrier pressure sensitive tape.

## **2.15 FIRESTOPPING MATERIAL**

Other than pipe and duct insulation, refer to Section 07 84 00  
FIRESTOPPING.

## **2.16 FLAME AND SMOKE**

Unless shown otherwise all assembled systems shall meet flame spread 25 and smoke developed 50 rating as developed under ASTM, NFPA and UL standards and specifications. See paragraph 1.3 "Quality Assurance".

# **PART 3 - EXECUTION**

## **3.1 GENERAL REQUIREMENTS**

- A. Required pressure tests of duct and piping joints and connections shall be completed and the work approved by the Contracting Officers Representative (COR) for application of insulation. Surface shall be clean and dry with all foreign materials, such as dirt, oil, loose scale and rust removed.
- B. Except for specific exceptions, insulate entire specified equipment, piping (pipe, fittings, valves, accessories), and duct systems. Insulate each pipe and duct individually. Do not use scrap pieces of insulation where a full length section will fit.
- C. Insulation materials shall be installed in a first class manner with smooth and even surfaces, with jackets and facings drawn tight and smoothly cemented down at all laps. Insulation shall be continuous through all sleeves and openings, except at fire dampers and duct heaters (NFPA 90A). Vapor retarders shall be continuous and

uninterrupted throughout systems with operating temperature 16 degrees C (60 degrees F) and below. Lap and seal vapor retarder over ends and exposed edges of insulation. Anchors, supports and other metal projections through insulation on cold surfaces shall be insulated and vapor sealed for a minimum length of 150 mm (6 inches).

- D. Install vapor stops at all insulation terminations on either side of valves, pumps and equipment and particularly in straight lengths of pipe insulation.
- E. Construct insulation on parts of equipment such as chilled water pumps and heads of chillers, convertors and heat exchangers that must be opened periodically for maintenance or repair, so insulation can be removed and replaced without damage. Install insulation with bolted 1 mm thick (20 gage) galvanized steel or aluminum covers as complete units, or in sections, with all necessary supports, and split to coincide with flange/split of the equipment.
- F. Insulation on hot piping and equipment shall be terminated square at items not to be insulated, access openings and nameplates. Cover all exposed raw insulation with white sealer or jacket material.
- G. Protect all insulations outside of buildings with aluminum jacket using lock joint or other approved system for a continuous weather tight system. Access doors and other items requiring maintenance or access shall be removable and sealable.
- H. Insulate PRVs, flow meters, and steam traps.
- I. HVAC work not to be insulated:
  - 1. Internally insulated ductwork and air handling units.
  - 2. Relief air ducts (Economizer cycle exhaust air).
  - 3. Exhaust air ducts and exhaust air plenums, and ventilation exhaust air shafts.
  - 4. Equipment: Expansion tanks, flash tanks, hot water pumps.
  - 5. In hot piping: Unions, flexible connectors, control valves, safety valves and discharge vent piping, vacuum breakers, thermostatic vent valves, steam traps 20 mm (3/4 inch) and smaller, exposed piping through floor for convectors and radiators. Insulate piping to within approximately 75 mm (3 inches) of uninsulated items.
- J. Apply insulation materials subject to the manufacturer's recommended temperature limits. Apply adhesives, mastic and coatings at the manufacturer's recommended minimum coverage.

- K. Elbows, flanges and other fittings shall be insulated with the same material as is used on the pipe straights. The elbow/ fitting insulation shall be field-fabricated, mitered or factory prefabricated to the necessary size and shape to fit on the elbow/ fitting. Use of polyurethane spray-foam to fill a PVC elbow jacket is prohibited on cold applications.
- L. Firestop Pipe and Duct insulation:
1. Provide fire stopping insulation at fire and smoke barriers through penetrations. Fire stopping insulation shall be UL listed as defines in Section 07 84 00, FIRESTOPPING.
  2. Pipe and duct penetrations requiring fire stop insulation including, but not limited to the following:
    - a. Pipe risers through floors
    - b. Pipe or duct chase walls and floors
    - c. Smoke partitions
    - d. Fire partitions
- M. Freeze protection of above grade outdoor piping (over heat tracing tape): 26 mm (10 inch) thick insulation, for all pipe sizes 75 mm (3 inches) and smaller and 25 mm (1 inch) thick insulation for larger pipes. Provide metal jackets for all pipes. Provide for cold water make-up to cooling towers and condenser water piping and chilled water piping as described in Section 23 21 13, HYDRONIC PIPING (electrical heat tracing systems).
- N. Provide vapor barrier jackets over insulation as follows:
1. All piping and ductwork exposed to outdoor weather.
  2. All interior piping and ducts conveying fluids exposed to outdoor air (i.e. in attics, ventilated (not air conditioned) spaces, penthouse mechanical equipment rooms, penthouse equipment modules, etc.), below ambient air temperature, in high humidity areas.
- O. Provide metal jackets over insulation as follows:
1. All piping and ducts exposed to outdoor weather.
  2. Piping exposed in building, within 1800 mm (6 feet) of the floor, that connects to sterilizers, kitchen and laundry equipment. Jackets may be applied with pop rivets. Provide aluminum angle ring escutcheons at wall, ceiling or floor penetrations.
  3. A 50 mm (2 inch) overlap is required at longitudinal and circumferential joints.

### 3.2 INSULATION INSTALLATION

#### A. Mineral Fiber Board:

1. Faced board: Apply board on pins spaced not more than 300 mm (12 inches) on center each way, and not less than 75 mm (3 inches) from each edge of board. In addition to pins, apply insulation bonding adhesive to entire underside of horizontal metal surfaces. Butt insulation edges tightly and seal all joints with laps and butt strips. After applying speed clips cut pins off flush and apply vapor seal patches over clips.
2. Plain board:
  - a. Insulation shall be scored, beveled or mitered to provide tight joints and be secured to equipment with bands spaced 225 mm (9 inches) on center for irregular surfaces or with pins and clips on flat surfaces. Use corner beads to protect edges of insulation.
  - b. For hot equipment: Stretch 25 mm (1 inch) mesh wire, with edges wire laced together, over insulation and finish with insulating and finishing cement applied in one coat, 6 mm (1/4 inch) thick, trowel led to a smooth finish.
  - c. For cold equipment: Apply meshed glass fabric in a tack coat 1.5 to 1.7 square meter per liter (60 to 70 square feet per gallon) of vapor mastic and finish with mastic at 0.3 to 0.4 square meter per liter (12 to 15 square feet per gallon) over the entire fabric surface.
  - d. Chilled water pumps: Insulate with removable and replaceable 1 mm thick (20 gage) aluminum or galvanized steel covers lined with insulation. Seal closure joints/flanges of covers with gasket material. Fill void space in enclosure with flexible mineral fiber insulation.
3. Exposed, unlined ductwork and equipment in unfinished areas, mechanical and electrical equipment rooms and attics, interstitial spaces and duct work exposed to outdoor weather:
  - a. 50 mm (2 inch) thick insulation faced with ASJ (white all service jacket): Supply air duct and afterfilter housing.
  - b. 50 mm (2 inch) thick insulation faced with ASJ: Return air duct, mixed air plenums and prefilter housing.

- c. Outside air intake ducts: 25 mm (one inch) thick insulation faced with ASJ.
  - d. Exposed, unlined supply and return ductwork exposed to outdoor weather: 50 mm (2 inch) thick insulation faced with a reinforcing membrane and two coats of vapor barrier mastic or multi-layer vapor barrier with a maximum water vapor permeability of 0.001 perms.
  - 4. Cold equipment: 40 mm (1-1/2 inch) thick insulation faced with ASJ.
    - a. Chilled water pumps, water filter, chemical feeder pot or tank.
    - b. Pneumatic, cold storage water and surge tanks.
  - 5. Hot equipment: 40 mm (1-1/2 inch) thick insulation faced with ASJ.
    - a. Convertors, air separators, steam condensate pump receivers.
    - b. Reheat coil casing and separation chambers on steam humidifiers located above ceilings.
    - c. Domestic water heaters and hot water storage tanks (not factory insulated).
    - d. Booster water heaters for dietetics dish and pot washers and for washdown grease-extracting hoods.
  - 6. Laundry: Hot exhaust ducts from dryers and from ironers, where duct is exposed in the laundry.
- B. Flexible Mineral Fiber Blanket:
- 1. Adhere insulation to metal with 75 mm (3 inch) wide strips of insulation bonding adhesive at 200 mm (8 inches) on center all around duct. Additionally secure insulation to bottom of ducts exceeding 600 mm (24 inches) in width with pins welded or adhered on 450 mm (18 inch) centers. Secure washers on pins. Butt insulation edges and seal joints with laps and butt strips. Staples may be used to assist in securing insulation. Seal all vapor retarder penetrations with mastic. Sagging duct insulation will not be acceptable. Install firestop duct insulation where required.
  - 2. Supply air ductwork to be insulated includes main and branch ducts from AHU discharge to room supply outlets, and the bodies of ceiling outlets to prevent condensation. Insulate sound attenuator units, coil casings and damper frames. To prevent condensation insulate trapeze type supports and angle iron hangers for flat oval ducts that are in direct contact with metal duct.
  - 3. Concealed supply air ductwork.

- a. Above ceilings at a roof level, in attics, and duct work exposed to outdoor weather: 50 mm (2 inch) thick insulation faced with FSK.
- b. Above ceilings for other than roof level: 40 mm (1 ½ inch) thick insulation faced with FSK.
- 4. Concealed return air duct:
  - a. In attics (where not subject to damage) and where exposed to outdoor weather: 50mm (2 inch) thick insulation faced with FSK.
  - b. Above ceilings at a roof level, unconditioned areas, and in chases with external wall or containing steam piping; 40 mm (1-1/2 inch) thick, insulation faced with FSK.
  - c. In interstitial spaces (where not subject to damage): 40 mm (1-1/2 inch thick insulation faced with FSK.
  - d. Concealed return air ductwork in other locations need not be insulated.
- 5. Concealed outside air duct: 40 mm (1-1/2 inch) thick insulation faced with FSK.
- 6. Exhaust air branch duct from autopsy refrigerator to main duct: 40 mm (1-1/2 inch) thick insulation faced with FSK.
- C. Molded Mineral Fiber Pipe and Tubing Covering:
  - 1. Fit insulation to pipe or duct, aligning longitudinal joints. Seal longitudinal joint laps and circumferential butt strips by rubbing hard with a nylon sealing tool to assure a positive seal. Staples may be used to assist in securing insulation. Seal all vapor retarder penetrations on cold piping with a generous application of vapor barrier mastic. Provide inserts and install with metal insulation shields at outside pipe supports. Install freeze protection insulation over heating cable.
  - 2. Contractor's options for fitting, flange and valve insulation:
    - a. Insulating and finishing cement for sizes less than 100 mm (4 inches) operating at surface temperature of 16 degrees C (61 degrees F) or more.
    - b. Factory premolded, one piece PVC covers with mineral fiber, (Form B), inserts. Provide two insert layers for pipe temperatures below 4 degrees C (40 degrees F), or above 121 degrees C (250 degrees F). Secure first layer of insulation with twine. Seal

seam edges with vapor barrier mastic and secure with fitting tape.

- c. Factory molded, ASTM C547 or field mitered sections, joined with adhesive or wired in place. For hot piping finish with a smoothing coat of finishing cement. For cold fittings, 16 degrees C (60 degrees F) or less, vapor seal with a layer of glass fitting tape imbedded between two 2 mm (1/16 inch) coats of vapor barrier mastic.
- d. Fitting tape shall extend over the adjacent pipe insulation and overlap on itself at least 50 mm (2 inches).
3. Nominal thickness in millimeters and inches specified in the schedule at the end of this section.

D. Rigid Cellular Phenolic Foam:

1. Rigid closed cell phenolic insulation may be provided for piping, ductwork and equipment for temperatures up to 121 degrees C (250 degrees F).
2. Note the NFPA 90A burning characteristics requirements of 25/50 in paragraph 1.3.B
3. Provide secure attachment facilities such as welding pins.
4. Apply insulation with joints tightly drawn together
5. Apply adhesives, coverings, neatly finished at fittings, and valves.
6. Final installation shall be smooth, tight, neatly finished at all edges.
7. Minimum thickness in millimeters (inches) specified in the schedule at the end of this section.
8. Exposed, unlined supply and return ductwork exposed to outdoor weather: 50 mm (2 inch) thick insulation faced with a multi-layer vapor barrier with a maximum water vapor permeance of 0.00 perms.
9. Condensation control insulation: Minimum 25 mm (1.0 inch) thick for all pipe sizes.
  - a. HVAC: Cooling coil condensation piping to waste piping fixture or drain inlet. Omit insulation on plastic piping in mechanical rooms.

E. Cellular Glass Insulation:

1. Pipe and tubing, covering nominal thickness in millimeters and inches as specified in the schedule at the end of this section.
2. Underground Piping Other than or in lieu of that Specified in Section 23 21 13, HYDRONIC PIPING: Type II, factory jacketed with a



- 3 mm laminate jacketing consisting of 3000 mm x 3000 mm (10 ft x 10 ft) asphalt impregnated glass fabric, bituminous mastic and outside protective plastic film.
- a. 75 mm (3 inches) thick for hot water piping.
  - b. As scheduled at the end of this section for chilled water piping.
  - c. Underground piping: Apply insulation with joints tightly butted. Seal longitudinal self-sealing lap. Use field fabricated or factory made fittings. Seal butt joints and fitting with jacketing as recommended by the insulation manufacturer. Use 100 mm (4 inch) wide strips to seal butt joints.
  - d. Provide expansion chambers for pipe loops, anchors and wall penetrations as recommended by the insulation manufacturer.
  - e. Underground insulation shall be inspected and approved by the COR as follows:
    - 1) Insulation in place before coating.
    - 2) After coating.
  - f. Sand bed and backfill: Minimum 75 mm (3 inches) all around insulated pipe or tank, applied after coating has dried.
3. Cold equipment: 50 mm (2 inch) thick insulation faced with ASJ for chilled water pumps, water filters, chemical feeder pots or tanks, expansion tanks, air separators and air purgers.
4. Exposed, unlined supply and return ductwork exposed to outdoor weather: 50 mm (2 inch) thick insulation faced with a reinforcing membrane and two coats of vapor barrier mastic or multi-layer vapor barrier with a water vapor permeability of 0.00 perms.
- F. Polyisocyanurate Closed-Cell Rigid Insulation:
- 1. Polyisocyanurate closed-cell rigid insulation (PIR) may be provided for exterior piping, equipment and ductwork for temperature up to 149 degree C (300 degree F).
  - 2. Install insulation, vapor barrier and jacketing per manufacturer's recommendations. Particular attention should be paid to recommendations for joint staggering, adhesive application, external hanger design, expansion/contraction joint design and spacing and vapor barrier integrity.
  - 3. Install insulation with all joints tightly butted (except expansion joints in hot applications).

4. If insulation thickness exceeds 63 mm (2.5 inches), install as a double layer system with longitudinal (lap) and butt joint staggering as recommended by manufacturer.
  5. For cold applications, vapor barrier shall be installed in a continuous manner. No staples, rivets, screws or any other attachment device capable of penetrating the vapor barrier shall be used to attach the vapor barrier or jacketing. No wire ties capable of penetrating the vapor barrier shall be used to hold the insulation in place. Banding shall be used to attach PVC or metal jacketing.
  6. Elbows, flanges and other fittings shall be insulated with the same material as is used on the pipe straights. The elbow/ fitting insulation shall be field-fabricated, mitered or factory prefabricated to the necessary size and shape to fit on the elbow/ fitting. Use of polyurethane spray-foam to fill PVC elbow jacket is prohibited on cold applications.
  7. For cold applications, the vapor barrier on elbows/fittings shall be either mastic-fabric-mastic or 2 mil thick PVDC vapor barrier adhesive tape.
  8. All PVC and metal jacketing shall be installed so as to naturally shed water. Joints shall point down and shall be sealed with either adhesive or caulking (except for periodic slip joints).
  9. Underground piping: Follow instructions for above ground piping but the vapor retarder jacketing shall be 6 mil thick PVDC or minimum 30 mil thick rubberized bituminous membrane. Sand bed and backfill shall be a minimum of 150 mm (6 inches) all around insulated pipe.
  10. Exposed, unlined supply and return ductwork exposed to outdoor weather: 50 mm (2 inch) thick insulation faced with a multi-layer vapor barrier with a water vapor permeance of 0.00 perms.
  11. Note the NFPA 90A burning characteristic requirements of 25/50 in paragraph 1.3B. Refer to paragraph 3.1 for items not to be insulated.
  12. Minimum thickness in millimeter (inches) specified in the schedule at the end of this section.
- G. Flexible Elastomeric Cellular Thermal Insulation:
1. Apply insulation and fabricate fittings in accordance with the manufacturer's installation instructions and finish with two coats

- of weather resistant finish as recommended by the insulation manufacturer.
2. Pipe and tubing insulation:
    - a. Use proper size material. Do not stretch or strain insulation.
    - b. To avoid undue compression of insulation, provide cork stoppers or wood inserts at supports as recommended by the insulation manufacturer. Insulation shields are specified under Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
    - c. Where possible, slip insulation over the pipe or tubing prior to connection, and seal the butt joints with adhesive. Where the slip-on technique is not possible, slit the insulation and apply it to the pipe sealing the seam and joints with contact adhesive. Optional tape sealing, as recommended by the manufacturer, may be employed. Make changes from mineral fiber insulation in a straight run of pipe, not at a fitting. Seal joint with tape.
  3. Apply sheet insulation to flat or large curved surfaces with 100 percent adhesive coverage. For fittings and large pipe, apply adhesive to seams only.
  4. Pipe insulation: nominal thickness in millimeters (inches as specified in the schedule at the end of this section.
  5. Minimum 20 mm (0.75 inch) thick insulation for pneumatic control lines for a minimum distance of 6 m (20 feet) from discharge side of the refrigerated dryer.
  6. Use Class S (Sheet), 20 mm (3/4 inch) thick for the following:
    - a. Chilled water pumps
    - b. Bottom and sides of metal basins for winterized cooling towers (where basin water is heated).
    - c. Chillers, insulate any cold chiller surfaces subject to condensation which has not been factory insulated.
    - d. Piping inside refrigerators and freezers: Provide heat tape under insulation.
  7. Exposed, unlined supply and return ductwork exposed to outdoor weather: 50 mm (2 inch) thick insulation faced with a multi-layer vapor barrier with a water vapor permeance of 0.00 perms.
  - H. Fire-Rated Duct Wrap for Laboratory Fume Hood Exhaust Ducts offsetting through third floor outside of two-hour chase:

1. The insulation thickness, layers and installation method shall be as per recommendations of the manufacturer to maintain the fire integrity and performance rating.

2. Provide stainless steel jacket for all exterior and exposed interior ductwork.

I. Calcium Silicate:

1. Minimum thickness in millimeter (inches) specified in the schedule at the end of this section for piping other than in boiler plant.

### 3.3 COMMISSIONING

A. Provide commissioning documentation in accordance with the requirements of section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.

B. Components provided under this section of the specification will be tested as part of a larger system. Refer to section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

### 3.4 PIPE INSULATION SCHEDULE

Provide insulation for piping systems as scheduled below:

Insulation Thickness Millimeters (Inches)					
		Nominal Pipe Size Millimeters (Inches)			
Operating Temperature Range/Service	Insulation Material	Less than 25 (1)	25 - 32 (1 - 1¼)	38 - 75 (1½ - 3)	100 (4) and Above
122-177 degrees C (251-350 degrees F) (HPS, MPS)	Mineral Fiber (Above ground piping only)	75 (3)	100 (4)	113 (4.5)	113 (4.5)
93-260 degrees C (200-500 degrees F) (HPS, HPR)	Calcium Silicate	100 (4)	125 (5)	150 (6)	150 (6)
100-121 degrees C (212-250 degrees F) (HPR, MPR, LPS, vent piping from PRV Safety Valves, Condensate receivers)	Mineral Fiber (Above ground piping only)	62 (2.5)	62 (2.5)	75 (3.0)	75 (3.0)

and flash tanks)					
100-121 degrees C (212-250 degrees F)  (HPR, MPR, LPS, vent piping from PRV Safety Valves, Condensate receivers and flash tanks)	Rigid Cellular Phenolic Foam	50 (2.0)	50 (2.0)	75 (3.0)	75 (3.0)
38-94 degrees C (100-200 degrees F)  (LPR, PC, HWH, HWHR, GH and GHR)	Mineral Fiber (Above ground piping only)	38 (1.5)	38 (1.5)	50 (2.0)	50 (2.0)
38-99 degrees C (100-211 degrees F)  (LPR, PC, HWH, HWHR, GH and GHR)	Rigid Cellular Phenolic Foam	38 (1.5)	38 (1.5)	50 (2.0)	50 (2.0)
39-99 degrees C (100-211 degrees F)  (LPR, PC, HWH, HWHR, GH and GHR)	Polyiso- cyanurate Closed-Cell Rigid (Exterior Locations only)	38 (1.5)	38 (1.5)	----	----
38-94 degrees C (100-200 degrees F)  (LPR, PC, HWH, HWHR, GH and GHR)	Flexible Elastomeric Cellular Thermal (Above ground piping only)	38 (1.5)	38 (1.5)	----	----
4-16 degrees C (40-60 degrees F)  (CH, CHR, GC, GCR and RS for DX refrigeration)	Rigid Cellular Phenolic Foam	38 (1.5)	38 (1.5)	38 (1.5)	38 (1.5)
4-16 degrees C (40-60 degrees F)  (CH and CHR within chiller room and pipe chase and underground)	Cellular Glass Closed- Cell	50 (2.0)	50 (2.0)	75 (3.0)	75 (3.0)
4-16 degrees C (40-60 degrees F)  (CH, CHR, GC, GCR	Cellular Glass Closed- Cell	38 (1.5)	38 (1.5)	38 (1.5)	38 (1.5)

and RS for DX refrigeration)					
4-16 degrees C (40-60 degrees F) (CH, CHR, GC and GCR (where underground)	Polyiso- cyanurate Closed-Cell Rigid	38 (1.5)	38 (1.5)	50 (2.0)	50 (2.0)
4-16 degrees C (40-60 degrees F) (CH, CHR, GC, GCR and RS for DX refrigeration)	Polyiso- cyanurate Closed-Cell Rigid (Exterior Locations only)	38 (1.5)	38 (1.5)	38 (1.5)	38 (1.5)
(40-60 degrees F) (CH, CHR, GC, GCR and RS for DX refrigeration)	Flexible Elastomeric Cellular Thermal (Above ground piping only)	38 (1.5)	38 (1.5)	38 (1.5)	38 (1.5)

- - - E N D - - -

**SECTION 23 08 00**  
**COMMISSIONING OF HVAC SYSTEMS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. The requirements of this Section apply to all sections of Division 23.
- B. This project will have selected building systems commissioned. The complete list of equipment and systems to be commissioned is specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. The commissioning process, which the Contractor is responsible to execute, is defined in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. A Commissioning Agent (CxA) appointed by the VA will manage the commissioning process.

**1.2 RELATED WORK**

- A. Section 01 00 00 GENERAL REQUIREMENTS.
- B. Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.
- C. Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

**1.3 SUMMARY**

- A. This Section includes requirements for commissioning the Facility exterior closure, related subsystems and related equipment. This Section supplements the general requirements specified in Section 01 91 00 General Commissioning Requirements.
- B. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for more details regarding processes and procedures as well as roles and responsibilities for all Commissioning Team members.

**1.4 DEFINITIONS**

- A. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for definitions.

**1.5 COMMISSIONED SYSTEMS**

- A. Commissioning of a system or systems specified in Division 23 is part of the construction process. Documentation and testing of these systems, as well as training of the VA's Operation and Maintenance personnel in accordance with the requirements of Section 01 91 00 and of Division 23, is required in cooperation with the VA and the Commissioning Agent.

- B. The Facility exterior closure systems commissioning will include the systems listed in Section 01 19 00 General Commissioning Requirements:

#### **1.6 SUBMITTALS**

- A. The commissioning process requires review of selected Submittals that pertain to the systems to be commissioned. The Commissioning Agent will provide a list of submittals that will be reviewed by the Commissioning Agent. This list will be reviewed and approved by the VA prior to forwarding to the Contractor. Refer to Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, and SAMPLES for further details.
- B. The commissioning process requires Submittal review simultaneously with engineering review. Specific submittal requirements related to the commissioning process are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

### **PART 2 - PRODUCTS (NOT USED)**

### **PART 3 - EXECUTION**

#### **3.1 CONSTRUCTION INSPECTIONS**

- A. Commissioning of HVAC systems will require inspection of individual elements of the HVAC systems construction throughout the construction period. The Contractor shall coordinate with the Commissioning Agent in accordance with Section 01 19 00 and the Commissioning plan to schedule HVAC systems inspections as required to support the Commissioning Process.

#### **3.2 PRE-FUNCTIONAL CHECKLISTS**

- A. The Contractor shall complete Pre-Functional Checklists to verify systems, subsystems, and equipment installation is complete and systems are ready for Systems Functional Performance Testing. The Commissioning Agent will prepare Pre-Functional Checklists to be used to document equipment installation. The Contractor shall complete the checklists. Completed checklists shall be submitted to the VA and to the Commissioning Agent for review. The Commissioning Agent may spot check a sample of completed checklists. If the Commissioning Agent determines that the information provided on the checklist is not accurate, the Commissioning Agent will return the marked-up checklist to the Contractor for correction and resubmission. If the Commissioning Agent determines that a significant number of completed checklists for similar equipment are not accurate, the Commissioning



Agent will select a broader sample of checklists for review. If the Commissioning Agent determines that a significant number of the broader sample of checklists is also inaccurate, all the checklists for the type of equipment will be returned to the Contractor for correction and resubmission. Refer to SECTION 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for submittal requirements for Pre-Functional Checklists, Equipment Startup Reports, and other commissioning documents.

### **3.3 CONTRACTORS TESTS**

- A. Contractor tests as required by other sections of Division 23 shall be scheduled and documented in accordance with Section 01 00 00 GENERAL REQUIREMENTS. All testing shall be incorporated into the project schedule. Contractor shall provide no less than 7 calendar days' notice of testing. The Commissioning Agent will witness selected Contractor tests at the sole discretion of the Commissioning Agent. Contractor tests shall be completed prior to scheduling Systems Functional Performance Testing.

### **3.4 SYSTEMS FUNCTIONAL PERFORMANCE TESTING:**

- A. The Commissioning Process includes Systems Functional Performance Testing that is intended to test systems functional performance under steady state conditions, to test system reaction to changes in operating conditions, and system performance under emergency conditions. The Commissioning Agent will prepare detailed Systems Functional Performance Test procedures for review and approval by the Contracting Officer's Representative (COR). The Contractor shall review and comment on the tests prior to approval. The Contractor shall provide the required labor, materials, and test equipment identified in the test procedure to perform the tests. The Commissioning Agent will witness and document the testing. The Contractor shall sign the test reports to verify tests were performed. See Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS, for additional details.

### **3.5 TRAINING OF VA PERSONNEL**

- A. Training of the VA operation and maintenance personnel is required in cooperation with the COR and Commissioning Agent. Provide competent, factory authorized personnel to provide instruction to operation and maintenance personnel concerning the location, operation, and

troubleshooting of the installed systems. Contractor shall submit training agendas and trainer resumes in accordance with the requirements of Section 01 19 00. The instruction shall be scheduled in coordination with the COR after submission and approval of formal training plans. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS and Division 23 Sections for additional Contractor training requirements.

----- END -----

**SECTION 23 09 23**  
**DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

A. Provide (a) direct-digital control system(s) as indicated on the project documents, point lists, interoperability tables, drawings, control diagrams, sequences of operation, and as described in these specifications. Include a complete and working direct-digital control system. Include all engineering, programming, controls and installation materials, installation labor, commissioning and start-up, training, final project documentation and warranty. Project is a substantial size, phased renovation of existing surgery facility. Provide new DDC controls and upgrade/expand existing building level DDC controls to ensure new renovation area controls are seamlessly integrated to existing site-wide medical facility DDC control system. Surgical facility is critical facility and demands the utmost in building automation coordination with all trades, including but not limited to; testing, adjusting and balancing and commissioning efforts. Design intent is to remove, replace and upgrade existing pneumatic and DDC controls within project areas. Contractor shall carefully coordinate with all trades and the VAMC in order to minimize the impact to existing pneumatic and DDC controls outside of the renovation project areas and scope.

1. The direct-digital control system(s) shall consist of high-speed, peer-to-peer network of DDC controllers connected by the Owners local area network (LAN) to an existing control system server, and an Engineering Control Center. Provide a remote user using a standard web browser to access the control system graphics and change adjustable set points with the proper password.
2. The direct-digital control system(s) shall be native BACnet. All new workstations, controllers, devices and components shall be listed by BACnet Testing Laboratories. All new workstations, controller, devices and components shall be accessible using a Web browser interface and shall communicate exclusively using the ASHRAE Standard 135 BACnet communications protocol without the use of gateways, unless otherwise allowed by this Section of the technical

- specifications, specifically shown on the design drawings and specifically requested otherwise by the VA.
- a. If used, gateways shall support the ASHRAE Standard 135 BACnet communications protocol.
  - b. If used, gateways shall provide all object properties and read/write services shown on VA-approved interoperability schedules.
3. The work administered by this Section of the technical specifications shall include all labor, materials, special tools, equipment, enclosures, power supplies, software, software licenses, Project specific software configurations and database entries, interfaces, wiring, tubing, installation, labeling, engineering, calibration, documentation, submittals, testing, verification, training services, permits and licenses, transportation, shipping, handling, administration, supervision, management, insurance, Warranty, specified services and items required for complete and fully functional Controls Systems.
  4. The control systems shall be designed such that each mechanical system shall operate under stand-alone mode. The contractor administered by this Section of the technical specifications shall provide controllers for each mechanical system. In the event of a network communication failure, or the loss of any other controller, the control system shall continue to operate independently. Failure of the ECC shall have no effect on the field controllers, including those involved with global strategies.
  5. The control system shall accommodate 1 Engineering Control Center(s) and the control system shall accommodate 10 web-based Users simultaneously, and the access to the system should be limited only by operator password.
- B. Some controls products are furnished but not installed by the contractor administered by this Section of the technical specifications. The contractor administered by this Section of the technical specifications shall formally coordinate in writing and receive from other contractors formal acknowledgements in writing prior to submission the installation of the products. These products include the following:
1. Control valves.
  2. Flow switches.

3. Flow meters.
  4. Sensor wells and sockets in piping.
  5. Ductwork mounted sensors.
  6. Air Terminal Unit (TUS/TUR/TUE) controllers.
- C. Some products are installed but not furnished by the contractor administered by this Section of the technical specifications. The contractor administered by this Section of the technical specifications shall formally coordinate in writing and receive from other contractors formal acknowledgements in writing prior to submission the procurement of the products. These products include the following:
1. Factory-furnished accessory thermostats and sensors furnished with unitary equipment.
- D. Some products are not provided by, but are nevertheless integrated with the work executed by, the contractor administered by this Section of the technical specifications. The contractor administered by this Section of the technical specifications shall formally coordinate in writing and receive from other contractors formal acknowledgements in writing prior to submission the particulars of the products. These products include the following:
1. Fire alarm systems. If zoned fire alarm is required by the project-specific requirements, this interface shall require multiple relays, which are provided and installed by the fire alarm system contractor, to be monitored.
  2. Terminal units' velocity sensors.
  3. Unitary HVAC equipment (rooftop air conditioning units, split systems, packaged pumping stations) controls. These include:
    - a. Discharge temperature control.
    - b. Economizer control.
    - c. Flowrate control.
    - d. Setpoint reset.
    - e. Time of day indexing.
    - f. Status alarm.
  4. Variable frequency drives. These controls, if not native BACnet, will require a BACnet Gateway.
  5. Room Pressure Monitoring Systems with Key-Switch override for local and BAS room pressure alarms (Positive pressure operating rooms, negative pressure isolation rooms).

6. The following systems have limited control (as individually noted below) from the BAS/ECC:

- a. Medical gas systems (if not bottled at point of use): low pressure and status alarms.
- b. Medical vacuum systems: high pressure and status alarms.
- c. Medical compressed air systems: low pressure and status alarms.
- d. Emergency generators: status alarms.
- e. Automatic Transfer switch: status alarms.
- f. Domestic water heating systems: low temperature, high temperature and status alarms.
- g. Isolation rooms: pressure outside of acceptable limit alarms.
- h. Operating rooms: pressure outside of acceptable limit alarms.
- i. Electric Heat Tracing system malfunctioning.

#### E. Responsibility Table

1. The following table defines the responsibility of the controls contractor administered by this Section of the technical specifications, the mechanical contractor administered by other Sections of Division 23 of the technical specifications, and the electrical contractor administered by Division 26 of the technical specifications.

Work/Item/System	Furnish	Install	Low Voltage Wiring	Line Power
Control system low voltage and communication wiring	23 09 23	23 09 23	23 09 23	N/A
Terminal units (TUS/TUR/TUE)	23	23	23 09 23	N/A
Controllers for terminal units (TUS/TUR/TUE)	23 09 23	23	23 09 23	N/A
LAN conduits and raceway	23 09 23	23 09 23	N/A	N/A
Automatic dampers (not furnished with equipment)	23 09 23	23	N/A	N/A
Automatic damper actuators	23 09 23	23 09 23	23 09 23	23 09 23
Manual valves	23	23	N/A	N/A
Automatic valves	23 09 23	23	23 09 23	23 09 23
Pipe insertion devices and taps, flow and pressure stations.	23	23	N/A	N/A
Thermowells	23 09 23	23	N/A	N/A
Current Switches	23 09 23	23 09 23	23 09 23	N/A

Work/Item/System	Furnish	Install	Low Voltage Wiring	Line Power
Control Relays	23 09 23	23 09 23	23 09 23	N/A
Power distribution system monitoring interfaces	23 09 23	23 09 23	23 09 23	26
Interface/BAS Integration with AHU / HTPS controls	23 09 23	23 09 23	23 09 23	26
All control system nodes, equipment, housings, enclosures and panels.	23 09 23	23 09 23	23 09 23	26
Smoke detectors	28 31 00	28 31 00	28 31 00	28 31 00
Fire/Smoke Dampers	23	23	28 31 00	28 31 00
Smoke Dampers	23	23	28 31 00	28 31 00
Fire Dampers	23	23	N/A	N/A
Water treatment system	23	23	23	26
VFDs	23	26	23 09 23	26
Room Pressure Monitoring Panels, Summary Panel, Room Differential Pressure Sensors, wiring, tubing, local alarm key-switch overrides	23 09 23	23 09 23	23 09 23	26
Occupancy Sensors	23 09 23	23 09 23	23 09 23	26
Medical gas panels	23	23	26	26
Isolation Room Air Valves (Supply/Exhaust) / Surgical Suite Exhaust Air Valves above ceilings/not in PEM	23	23	23 09 23	N/A
Fire Alarm shutdown relay interlock wiring	28	28	28	26
Control system monitoring of Fire Alarm smoke control relay.	28	28	23 09 23	28
Unit Heater controls (not furnished with equipment)	23 09 23	23 09 23	23 09 23	26
Starters, HOA switches	23	23	N/A	26
Control System Monitoring of Electric Heat Tracing for Freeze protection of hydronic piping systems	26	26	23 09 23	26

F. This campus has standardized on an existing standard ASHRAE Standard 135, BACnet/IP Control System supported by Johnson Controls.. This

entity is referred to as the "Control System Integrator" in this Section of the technical specifications. The Control system integrator is responsible for ECC system graphics and expansion. It also prescribes control system-specific commissioning/ verification procedures to the contractor administered by this Section of the technical specification. It lastly provides limited assistance to the contractor administered by this Section of the technical specification in its commissioning/verification work.

1. The General Contractor or Mechanical Subcontractor of this project shall directly hire the Control System Integrator in a contract separate from the contract procuring the controls contractor administered by this Section of the technical specifications.
2. The contractor administered by this Section of the technical specifications shall coordinate all work with the Control System Integrator. The contractor administered by this Section of the technical specifications shall integrate the ASHRAE Standard 135, BACnet/IP control network(s) with the Control System Integrator's area control through an Ethernet connection provided by the Control System Integrator.
3. The contractor administered by this Section of the technical specifications shall provide a peer-to-peer networked, stand-alone, distributed control system. This direct digital control (DDC) system shall include microprocessor-based controllers, instrumentation, end control devices, wiring, piping, software, and related systems. This contractor is responsible for all device mounting and wiring.
4. Responsibility Table (Note: Control System Integrator may be same as specification section 23 09 23 contractor):

Item/Task	Section 23 09 23 contractor	Control System Integrator	VA
ECC expansion		X	
ECC programming		X	
Devices, controllers, control panels and equipment	X		
Point addressing: all hardware and software points including setpoint, calculated point, data point(analog/binary), and reset schedule point	X		
Point mapping		X	
Network Programming	X		
ECC Graphics		X	
Controller programming and sequences	X		
Integrity of LAN communications	X		



Electrical wiring	X		
Operator system training		X	
LAN connections to devices	X		
LAN connections to ECC		X	
IP addresses			X
Overall system verification		X	
Controller and LAN system verification	X		

5. The graphics to be provided at the ECC by the Control System Integrator include the following:

- a. Updated floor plan of area showing new rooms of area and associated distribution terminal devices serving rooms in the project.
- b. Graphic of new rooftop AHU 1S-AC-16 showing each controlled device, sensor, setpoints and dynamically updated sensor readings and status of all devices.

G. Unitary standalone systems including Unit Heaters, Cabinet Unit Heaters, Fan Coil Units, Base Board Heaters, thermal comfort ventilation fans, and similar units for control of room environment conditions may be equipped with integral controls furnished and installed by the equipment manufacturer or field mounted. Refer to equipment specifications and as indicated in project documents. Application of standalone unitary controls is limited to at least those systems wherein remote monitoring, alarm and start-up are not necessary. Examples of such systems include:

1. Light-switch-operated toilet exhaust
2. Vestibule heater
3. Exterior stair heater
4. Attic heating and ventilation
5. Mechanical or electrical room heating and ventilation.

H. The direct-digital control system shall start and stop equipment, move (position) damper actuators and valve actuators, and vary speed of equipment to execute the mission of the control system. Use electricity as the motive force for all damper and valve actuators, unless use of pneumatics as motive force is specifically granted by VA.

## 1.2 RELATED WORK

- A. Section 21 05 11, Common Work Results for Fire Suppression.
- C. Section 22 62 00, Vacuum Systems for Laboratory and Healthcare Facilities.
- D. Section 22 63 00, Gas Systems for Laboratory and Healthcare Facilities.

- E. Section 23 21 13, Hydronic Piping.
- F. Section 23 22 13, Steam and Condensate Heating Piping.
- G. Section 23 31 00, HVAC Ducts and Casings.
- H. Section 23 36 00, Air Terminal Units.
- J. Section 23 74 43, Custom, Outdoor, Penthouse Equipment Module/Central-Station Air-Handling Units.
- K. Section 23 05 11, Common Work Results for HVAC
- L. Section 23 08 00, Commissioning of HVAC
- M. Section 23 05 93, Testing, Adjusting, and Balancing for HVAC
- N. Section 26 05 11, Requirements for Electrical Installations.
- O. Section 26 05 19, Low-Voltage Electrical Power Conductors and Cables.
- P. Section 26 05 26, Grounding and Bonding for Electrical Systems.
- Q. Section 26 05 33, Raceway and Boxes for Electrical Systems.
- R. Section 26 09 23, Lighting Controls.
- S. Section 26 27 26, Wiring Devices.
- T. Section 26 29 11, Motor Controllers.
- U. Section 27 15 00, Communications Horizontal Cabling
- V. Section 28 31 00, Fire Detection and Alarm.

### **1.3 DEFINITION**

- A. Algorithm: A logical procedure for solving a recurrent mathematical problem; A prescribed set of well-defined rules or processes for the solution of a problem in a finite number of steps.
- B. ARCNET: ANSI/ATA 878.1 - Attached Resource Computer Network. ARCNET is a deterministic LAN technology; meaning it's possible to determine the maximum delay before a device is able to transmit a message.
- C. Analog: A continuously varying signal value (e.g., temperature, current, velocity etc.
- D. BACnet: A Data Communication Protocol for Building Automation and Control Networks, ANSI/ASHRAE Standard 135. This communications protocol allows diverse building automation devices to communicate data over and services over a network.
- E. BACnet/IP: Annex J of Standard 135. It defines and allows for using a reserved UDP socket to transmit BACnet messages over IP networks. A BACnet/IP network is a collection of one or more IP sub-networks that share the same BACnet network number.
- F. BACnet Internetwork: Two or more BACnet networks connected with routers. The two networks may sue different LAN technologies.

- G. BACnet Network: One or more BACnet segments that have the same network address and are interconnected by bridges at the physical and data link layers.
- H. BACnet Segment: One or more physical segments of BACnet devices on a BACnet network, connected at the physical layer by repeaters.
- I. BACnet Broadcast Management Device (BBMD): A communications device which broadcasts BACnet messages to all BACnet/IP devices and other BBMDs connected to the same BACnet/IP network.
- J. BACnet Interoperability Building Blocks (BIBBs): BACnet Interoperability Building Blocks (BIBBs) are collections of one or more BACnet services. These are prescribed in terms of an "A" and a "B" device. Both of these devices are nodes on a BACnet internetwork.
- K. BACnet Testing Laboratories (BTL). The organization responsible for testing products for compliance with the BACnet standard, operated under the direction of BACnet International.
- L. Baud: It is a signal change in a communication link. One signal change can represent one or more bits of information depending on type of transmission scheme. Simple peripheral communication is normally one bit per Baud. (e.g., Baud rate = 78,000 Baud/sec is 78,000 bits/sec, if one signal change = 1 bit).
- M. Binary: A two-state system where a high signal level represents an "ON" condition and an "OFF" condition is represented by a low signal level.
- N. BMP or bmp: Suffix, computerized image file, used after the period in a DOS-based computer file to show that the file is an image stored as a series of pixels.
- O. Bus Topology: A network topology that physically interconnects workstations and network devices in parallel on a network segment.
- P. Control Unit (CU): Generic term for any controlling unit, stand-alone, microprocessor based, digital controller residing on secondary LAN or Primary LAN, used for local controls or global controls
- Q. Deadband: A temperature range over which no heating or cooling is supplied, i.e., 22-25 degrees C (72-78 degrees F), as opposed to a single point change over or overlap).
- R. Device: a control system component that contains a BACnet Device Object and uses BACnet to communicate with other devices.
- S. Device Object: Every BACnet device requires one Device Object, whose properties represent the network visible properties of that device. Every Device Object requires a unique Object Identifier number on the

BACnet internetwork. This number is often referred to as the device instance.

- T. Device Profile: A specific group of services describing BACnet capabilities of a device, as defined in ASHRAE Standard 135-2008, Annex L. Standard device profiles include BACnet Operator Workstations (B-OWS), BACnet Building Controllers (B-BC), BACnet Advanced Application Controllers (B-AAC), BACnet Application Specific Controllers (B-ASC), BACnet Smart Actuator (B-SA), and BACnet Smart Sensor (B-SS). Each device used in new construction is required to have a PICS statement listing which service and BIBBs are supported by the device.
- U. Diagnostic Program: A software test program, which is used to detect and report system or peripheral malfunctions and failures. Generally, this system is performed at the initial startup of the system.
- V. Direct Digital Control (DDC): Microprocessor based control including Analog/Digital conversion and program logic. A control loop or subsystem in which digital and analog information is received and processed by a microprocessor, and digital control signals are generated based on control algorithms and transmitted to field devices in order to achieve a set of predefined conditions.
- W. Distributed Control System: A system in which the processing of system data is decentralized and control decisions can and are made at the subsystem level. System operational programs and information are provided to the remote subsystems and status is reported back to the Engineering Control Center. Upon the loss of communication with the Engineering Control center, the subsystems shall be capable of operating in a stand-alone mode using the last best available data.
- X. Download: The electronic transfer of programs and data files from a central computer or operation workstation with secondary memory devices to remote computers in a network (distributed) system.
- Y. DXF: An AutoCAD 2-D graphics file format. Many CAD systems import and export the DXF format for graphics interchange.
- Z. Electrical Control: A control circuit that operates on line or low voltage and uses a mechanical means, such as a temperature sensitive bimetal or bellows, to perform control functions, such as actuating a switch or positioning a potentiometer.
- AA. Electronic Control: A control circuit that operates on low voltage and uses a solid-state components to amplify input signals and perform

control functions, such as operating a relay or providing an output signal to position an actuator.

- BB. Engineering Control Center (ECC): The centralized control point for the intelligent control network. The ECC comprises of personal computer and connected devices to form a single workstation.
- CC. Ethernet: A trademark for a system for exchanging messages between computers on a local area network using coaxial, fiber optic, or twisted-pair cables.
- DD. Firmware: Firmware is software programmed into read only memory (ROM) chips. Software may not be changed without physically altering chip.
- EE. Gateway: Communication hardware connecting two or more different protocols. It translates one protocol into equivalent concepts for the other protocol. In BACnet applications, a gateway has BACnet on one side and non-BACnet (usually proprietary) protocols on the other side.
- FF. GIF: Abbreviation of Graphic interchange format.
- GG. Graphic Program (GP): Program used to produce images of air handler systems, fans, chillers, pumps, and building spaces. These images can be animated and/or color-coded to indicate operation of the equipment.
- HH. Graphic Sequence of Operation: It is a graphical representation of the sequence of operation, showing all inputs and output logical blocks.
- II. I/O Unit: The section of a digital control system through which information is received and transmitted. I/O refers to analog input (AI, digital input (DI), analog output (AO) and digital output (DO). Analog signals are continuous and represent temperature, pressure, flow rate etc, whereas digital signals convert electronic signals to digital pulses (values), represent motor status, filter status, on-off equipment etc.
- JJ. I/P: a method for conveying and routing packets of information over LAN paths. User Datagram Protocol (UDP) conveys information to "sockets" without confirmation of receipt. Transmission Control Protocol (TCP) establishes "sessions", which have end-to-end confirmation and guaranteed sequence of delivery.
- KK. JPEG: A standardized image compression mechanism stands for Joint Photographic Experts Group, the original name of the committee that wrote the standard.
- LL. Local Area Network (LAN): A communication bus that interconnects operator workstation and digital controllers for peer-to-peer communications, sharing resources and exchanging information.

- MM. Network Repeater: A device that receives data packet from one network and rebroadcasts to another network. No routing information is added to the protocol.
- NN. MS/TP: Master-slave/token-passing (ISO/IEC 8802, Part 3). It is not an acceptable LAN option for VA health-care facilities. It uses twisted-pair wiring for relatively low speed and low cost communication.
- OO. Native BACnet Device: A device that uses BACnet as its primary method of communication with other BACnet devices without intermediary gateways. A system that uses native BACnet devices at all levels is a native BACnet system.
- PP. Network Number: A site-specific number assigned to each network segment to identify for routing. This network number must be unique throughout the BACnet internetwork.
- QQ. Object: The concept of organizing BACnet information into standard components with various associated properties. Examples include analog input objects and binary output objects.
- RR. Object Identifier: An object property used to identify the object, including object type and instance. Object Identifiers must be unique within a device.
- SS. Object Properties: Attributes of an object. Examples include present value and high limit properties of an analog input object. Properties are defined in ASHRAE 135; some are optional and some are required. Objects are controlled by reading from and writing to object properties.
- TT. Operating system (OS): Software, which controls the execution of computer application programs.
- UU. PCX: File type for an image file. When photographs are scanned onto a personal computer they can be saved as PCX files and viewed or changed by a special application program as Photo Shop.
- VV. Peripheral: Different components that make the control system function as one unit. Peripherals include monitor, printer, and I/O unit.
- WW. Peer-to-Peer: A networking architecture that treats all network stations as equal partners- any device can initiate and respond to communication with other devices.
- XX. PICS: Protocol Implementation Conformance Statement, describing the BACnet capabilities of a device. All BACnet devices have published PICS.

YY. PID: Proportional, integral, and derivative control, used to control modulating equipment to maintain a setpoint.

ZZ. Repeater: A network component that connects two or more physical segments at the physical layer.

AAA. Router: a component that joins together two or more networks using different LAN technologies. Examples include joining a BACnet Ethernet LAN to a BACnet MS/TP LAN.

BBB. Sensors: devices measuring state points or flows, which are then transmitted back to the DDC system.

CCC. Thermostats: devices measuring temperatures, which are used in control of standalone or unitary systems and equipment not attached to the DDC system.

#### **1.4 QUALITY ASSURANCE**

##### **A. Criteria:**

1. Single Source Responsibility of subcontractor: The Contractor shall obtain hardware and software supplied under this Section and delegate the responsibility to a single source controls installation subcontractor. The controls subcontractor shall be responsible for the complete design, installation, and commissioning of the system. The controls subcontractor shall be in the business of design, installation and service of such building automation control systems similar in size and complexity.
2. Equipment and Materials: Equipment and materials shall be cataloged products of manufacturers regularly engaged in production and installation of HVAC control systems. Products shall be manufacturer's latest standard design and have been tested and proven in actual use.
3. The controls subcontractor shall provide a list of no less than five similar projects which have building control systems as specified in this Section. These projects must be on-line and functional such that the Department of Veterans Affairs (VA) representative would observe the control systems in full operation.
4. The controls subcontractor shall have in-place facility within 50 miles with technical staff, spare parts inventory for the next five (5) years, and necessary test and diagnostic equipment to support the control systems.
5. The controls subcontractor shall have minimum of three years experience in design and installation of building automation systems

similar in performance to those specified in this Section. Provide evidence of experience by submitting resumes of the project manager, the local branch manager, project engineer, the application engineering staff, and the electronic technicians who would be involved with the supervision, the engineering, and the installation of the control systems. Training and experience of these personnel shall not be less than three years. Failure to disclose this information will be a ground for disqualification of the supplier.

6. Provide a competent and experienced Project Manager employed by the Controls Contractor. The Project Manager shall be supported as necessary by other Contractor employees in order to provide professional engineering, technical and management service for the work. The Project Manager shall attend scheduled Project Meetings as required and shall be empowered to make technical, scheduling and related decisions on behalf of the Controls Contractor.

B. Codes and Standards:

1. All work shall conform to the applicable Codes and Standards.
2. Electronic equipment shall conform to the requirements of FCC Regulation, Part 15, Governing Radio Frequency Electromagnetic Interference, and be so labeled.

**1.5 PERFORMANCE**

A. The system shall conform to the following:

1. Graphic Display: The system shall display up to four (4) graphics on a single screen with a minimum of twenty (20) dynamic points per graphic. All current data shall be displayed within ten (10) seconds of the request.
2. Graphic Refresh: The system shall update all dynamic points with current data within eight (8) seconds. Data refresh shall be automatic, without operator intervention.
3. Object Command: The maximum time between the command of a binary object by the operator and the reaction by the device shall be two(2) seconds. Analog objects shall start to adjust within two (2) seconds.
4. Object Scan: All changes of state and change of analog values shall be transmitted over the high-speed network such that any data used or displayed at a controller or work-station will be current, within the prior six (6) seconds.



5. Alarm Response Time: The maximum time from when an object goes into alarm to when it is annunciated at the workstation shall not exceed (10) seconds.
6. Program Execution Frequency: Custom and standard applications shall be capable of running as often as once every (5) seconds. The Contractor shall be responsible for selecting execution times consistent with the mechanical process under control.
7. Multiple Alarm Annunciations: All workstations on the network shall receive alarms within five (5) seconds of each other.
8. Performance: Programmable Controllers shall be able to execute DDC PID control loops at a selectable frequency from at least once every one (1) second. The controller shall scan and update the process value and output generated by this calculation at this same frequency.
9. Reporting Accuracy: Listed below are minimum acceptable reporting end-to-end accuracies for values reported by the specified system:

Measured Variable	Reported Accuracy
Space temperature	$\pm 0.5^{\circ}\text{C}$ ( $\pm 1^{\circ}\text{F}$ )
Ducted air temperature	$\pm 0.5^{\circ}\text{C}$ [ $\pm 1^{\circ}\text{F}$ ]
Outdoor air temperature	$\pm 1.0^{\circ}\text{C}$ [ $\pm 2^{\circ}\text{F}$ ]
Dew Point	$\pm 1.5^{\circ}\text{C}$ [ $\pm 3^{\circ}\text{F}$ ]
Water temperature	$\pm 0.5^{\circ}\text{C}$ [ $\pm 1^{\circ}\text{F}$ ]
Relative humidity	$\pm 2\%$ RH
Water flow	$\pm 1\%$ of reading
Air flow (terminal)	$\pm 10\%$ of reading
Air flow (measuring stations)	$\pm 5\%$ of reading
Carbon Monoxide (CO)	$\pm 5\%$ of reading
Carbon Dioxide (CO <sub>2</sub> )	$\pm 50$ ppm
Air pressure (ducts)	$\pm 25$ Pa [ $\pm 0.1$ "w.c.]
Air pressure (space)	$\pm 0.3$ Pa [ $\pm 0.001$ "w.c.]
Water pressure	$\pm 2\%$ of full scale *Note 1
Electrical Power	$\pm 0.5\%$ of reading

Note 1: for both absolute and differential pressure

10. Control stability and accuracy: Control sequences shall maintain measured variable at setpoint within the following tolerances:

Controlled Variable	Control Accuracy	Range of Medium
Air Pressure	$\pm 50$ Pa ( $\pm 0.2$ in. w.g.)	0-1.5 kPa (0-6 in. w.g.)
Air Pressure	$\pm 3$ Pa ( $\pm 0.01$ in. w.g.)	-25 to 25 Pa (-0.1 to 0.1 in. w.g.)
Airflow	$\pm 10\%$ of full scale	
Space Temperature	$\pm 1.0^{\circ}\text{C}$ ( $\pm 2.0^{\circ}\text{F}$ )	
Duct Temperature	$\pm 1.5^{\circ}\text{C}$ ( $\pm 3^{\circ}\text{F}$ )	
Humidity	$\pm 5\%$ RH	
Fluid Pressure	$\pm 10$ kPa ( $\pm 1.5$ psi)	0-1 MPa (1-150 psi)
Fluid Pressure	$\pm 250$ Pa ( $\pm 1.0$ in. w.g.)	0-12.5 kPa (0-50 in. w.g.) differential

11. Extent of direct digital control: control design shall allow for at least the points indicated on the points lists on the drawings.

#### 1.6 WARRANTY

- A. Labor and materials for control systems shall be warranted for a period as specified under Warranty in FAR clause 52.246-21.
- B. Control system failures during the warranty period shall be adjusted, repaired, or replaced at no cost or reduction in service to the owner. The system includes all computer equipment, transmission equipment, and all sensors and control devices.
- C. The on-line support service shall allow the Controls supplier to dial out over telephone lines to or connect via (through password-limited access) VPN through the internet monitor and control the facility's building automation system. This remote connection to the facility shall be within two (2) hours of the time that the problem is reported. This coverage shall be extended to include normal business hours, after business hours, weekend and holidays. If the problem cannot be resolved with on-line support services, the Controls supplier shall dispatch the qualified personnel to the job site to resolve the problem within 24 hours after the problem is reported.
- D. Controls and Instrumentation subcontractor shall be responsible for temporary operations and maintenance of the control systems during the construction period until final commissioning, training of facility operators and acceptance of the project by VA.

## **1.7 SUBMITTALS**

- A. Submit shop drawings in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's literature and data for all components including the following:
  - 1. A wiring diagram for each type of input device and output device including DDC controllers, modems, repeaters, etc. Diagram shall show how the device is wired and powered, showing typical connections at the digital controllers and each power supply, as well as the device itself. Show for all field connected devices, including but not limited to, control relays, motor starters, electric or electronic actuators, and temperature pressure, flow and humidity sensors and transmitters.
  - 2. A diagram of each terminal strip, including digital controller terminal strips, terminal strip location, termination numbers and the associated point names.
  - 3. Control dampers and control valves schedule, including the size and pressure drop.
  - 4. Control air-supply components, and computations for sizing compressors, receivers and main air-piping, if pneumatic controls are furnished.
  - 5. Catalog cut sheets of all equipment used. This includes, but is not limited to software (by manufacturer and by third parties), DDC controllers, panels, peripherals, airflow measuring stations and associated components, and auxiliary control devices such as sensors, actuators, and control dampers. When manufacturer's cut sheets apply to a product series rather than a specific product, the data specifically applicable to the project shall be highlighted. Each submitted piece of literature and drawings should clearly reference the specification and/or drawings that it supposed to represent.
  - 6. Sequence of operations for each HVAC system and the associated control diagrams. Equipment and control labels shall correspond to those shown on the drawings.
  - 7. Color prints of proposed graphics with a list of points for display.
  - 8. Furnish a BACnet Protocol Implementation Conformance Statement (PICS) for each BACnet-compliant device.

9. Schematic wiring diagrams for all control, communication and power wiring. Provide a schematic drawing of the central system installation. Label all cables and ports with computer manufacturers' model numbers and functions. Show all interface wiring to the control system.
  10. An instrumentation list for each controlled system. Each element of the controlled system shall be listed in table format. The table shall show element name, type of device, manufacturer, model number, and product data sheet number.
  11. Riser diagrams of wiring between central control unit and all control panels.
  12. Scaled plan drawings showing routing of LAN and locations of control panels, controllers, routers, gateways, ECC, and larger controlled devices.
  13. Construction details for all installed conduit, cabling, raceway, cabinets, and similar. Construction details of all penetrations and their protection.
  14. Quantities of submitted items may be reviewed but are the responsibility of the contractor administered by this Section of the technical specifications.
- C. Product Certificates: Compliance with Article, QUALITY ASSURANCE.
- D. Licenses: Provide licenses for all software residing on and used by the Controls Systems and transfer these licenses to the Owner prior to completion.
- E. As Built Control Drawings:
1. Furnish three (3) copies of as-built drawings for each control system. The documents shall be submitted for approval prior to final completion.
  2. Furnish one (1) stick set of applicable control system prints for each mechanical system for wall mounting. The documents shall be submitted for approval prior to final completion.
  3. Furnish one (1) CD-ROM in CAD DWG and/or .DXF format for the drawings noted in subparagraphs above.
- F. Operation and Maintenance (O/M) Manuals):
1. Submit in accordance with Article, INSTRUCTIONS, in Specification Section 01 00 00, GENERAL REQUIREMENTS.
  2. Include the following documentation:

- a. General description and specifications for all components, including logging on/off, alarm handling, producing trend reports, overriding computer control, and changing set points and other variables.
  - b. Detailed illustrations of all the control systems specified for ease of maintenance and repair/replacement procedures, and complete calibration procedures.
  - c. One copy of the final version of all software provided including operating systems, programming language, operator workstation software, and graphics software.
  - d. Complete troubleshooting procedures and guidelines for all systems.
  - e. Complete operating instructions for all systems.
  - f. Recommended preventive maintenance procedures for all system components including a schedule of tasks for inspection, cleaning and calibration. Provide a list of recommended spare parts needed to minimize downtime.
  - g. Training Manuals: Submit the course outline and training material to the Owner for approval three (3) weeks prior to the training to VA facility personnel. These persons will be responsible for maintaining and the operation of the control systems, including programming. The Owner reserves the right to modify any or all of the course outline and training material.
  - h. Licenses, guaranty, and other pertaining documents for all equipment and systems.
- G. Submit Performance Report to Contracting Officers Representative (COR) prior to final inspection.

#### **1.8 INSTRUCTIONS**

- A. Instructions to VA operations personnel: Perform in accordance with Article, INSTRUCTIONS, in Specification Section 01 00 00, GENERAL REQUIREMENTS, and as noted below. Contractor shall also video tape instruction sessions noted below.
1. First Session: Formal instructions to the VA facilities personnel for a total of 48 hours, given in multiple training sessions (each no longer than four hours in length), conducted sometime between the completed installation and prior to the performance test period of the control system, at a time mutually agreeable to the Contractor and the VA.

2. Second Session: This training session shall be comprised of on the job training during start-up, checkout period, and performance test period. VA facilities personnel will work with the Contractor's installation and test personnel on a daily basis during start-up and checkout period. During the performance test period, controls subcontractor will provide 48 hours of instructions, given in multiple training sessions (each no longer than four hours in length), to the VA facilities personnel.
3. The O/M Manuals shall contain approved submittals as outlined in Article 1.7, SUBMITTALS. The Controls subcontractor will review the manual contents with VA facilities personnel during second session of training.
4. Training shall be given by direct employees of the controls system subcontractor.

#### **1.9 PROJECT CONDITIONS (ENVIRONMENTAL CONDITIONS OF OPERATION)**

- A. The ECC and peripheral devices and system support equipment shall be designed to operate in ambient condition of 20 to 35°C (65 to 90°F) at a relative humidity of 20 to 80% non-condensing.
- B. The CUs used outdoors shall be mounted in NEMA 4 waterproof enclosures, and shall be rated for operation at -40 to 65°C (-40 to 150°F).
- C. All electronic equipment shall operate properly with power fluctuations of plus 10 percent to minus 15 percent of nominal supply voltage.
- D. Sensors and controlling devices shall be designed to operate in the environment, which they are sensing or controlling.

#### **1.10 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Heating, Refrigerating, and Air-Conditioning Engineers (ASHRAE):  
Standard 135-10.....BACNET Building Automation and Control Networks
- C. American Society of Mechanical Engineers (ASME):  
B16.18-01.....Cast Copper Alloy Solder Joint Pressure Fittings.  
B16.22-01.....Wrought Copper and Copper Alloy Solder Joint Pressure Fittings.
- D. American Society of Testing Materials (ASTM):  
B32-08.....Standard Specification for Solder Metal

B88-09.....Standard Specifications for Seamless Copper  
Water Tube  
B88M-09.....Standard Specification for Seamless Copper  
Water Tube (Metric)  
B280-08.....Standard Specification for Seamless Copper Tube  
for Air-Conditioning and Refrigeration Field  
Service  
D2737-03.....Standard Specification for Polyethylene (PE)  
Plastic Tubing

E. Federal Communication Commission (FCC):

Rules and Regulations Title 47 Chapter 1-2001 Part 15: Radio Frequency  
Devices.

F. Institute of Electrical and Electronic Engineers (IEEE):

802.3-11.....Information Technology-Telecommunications and  
Information Exchange between Systems-Local and  
Metropolitan Area Networks- Specific  
Requirements-Part 3: Carrier Sense Multiple  
Access with Collision Detection (CSMA/CD)  
Access method and Physical Layer Specifications

G. National Fire Protection Association (NFPA):

70-11.....National Electric Code  
90A-09.....Standard for Installation of Air-Conditioning  
and Ventilation Systems

H. Underwriter Laboratories Inc (UL):

94-10.....Tests for Flammability of Plastic Materials for  
Parts and Devices and Appliances  
294-10.....Access Control System Units  
486A/486B-10.....Wire Connectors  
555S-11.....Standard for Smoke Dampers  
916-10.....Energy Management Equipment  
1076-10.....Proprietary Burglar Alarm Units and Systems

## **PART 2 - PRODUCTS**

### **2.1 MATERIALS**

A. Use new products that the manufacturer is currently manufacturing and  
that have been installed in a minimum of 25 installations. Spare parts  
shall be available for at least five years after completion of this  
contract.

### **2.2 CONTROLS SYSTEM ARCHITECTURE**

A. General

1. The Controls Systems shall consist of multiple Nodes and associated  
equipment connected by industry standard digital and communication  
network arrangements.

2.

2. The networks shall, at minimum, comprise, as necessary, the following:
  - a.
  - b. BACnet-compliant routers, bridges, switches, hubs, modems, gateways, interfaces and similar communication equipment.
  - c. Active processing BACnet-compliant building controllers connected to other BACnet-compliant controllers together with their power supplies and associated equipment.
  - d. Addressable elements, sensors, transducers and end devices.
  - e. Third-party equipment interfaces and gateways as described and required by the Contract Documents.
  - f. Other components required for a complete and working Control Systems as specified.
- B. The Specifications for the individual elements and component subsystems shall be minimum requirements and shall be augmented as necessary by the Contractor to achieve both compliance with all applicable codes, standards and to meet all requirements of the Contract Documents.
- C. Network Architecture
  1. The Controls communication network shall utilize BACnet communications protocol operating over a standard Ethernet LAN and operate at a minimum speed of 100 Mb/sec.
  2. The networks shall utilize only copper and optical fiber communication media as appropriate and shall comply with applicable codes, ordinances and regulations.
  3. All necessary telephone lines, ISDN lines and internet Service Provider services and connections will be provided by the VA.
- D. Third Party Interfaces:
  1. The contractor administered by this Section of the technical specifications shall include necessary hardware, equipment, software and programming to allow data communications between the controls systems and building systems supplied by other trades.
  2. Other manufacturers and contractors supplying other associated systems and equipment shall provide their necessary hardware, software and start-up at their cost and shall cooperate fully with the contractor administered by this Section of the technical specifications in a timely manner and at their cost to ensure complete functional integration.



## **2.3 COMMUNICATION**

- A. Control products, communication media, connectors, repeaters, hubs, and routers shall comprise a BACnet internetwork. Controller and operator interface communication shall conform to ANSI/ASHRAE Standard 135-2008, BACnet.
  - 1. The Data link / physical layer protocol (for communication) acceptable to the VA throughout its facilities is Ethernet (ISO 8802-3) and BACnet/IP.
  - 2. The MS/TP data link / physical layer protocol is not acceptable to the VA in any new BACnet network or sub-network in its healthcare or lab facilities.
- B. Each controller shall have a communication port for connection to an operator interface.
- C. Controllers with real-time clocks shall use the BACnet Time Synchronization service. The system shall automatically synchronize system clocks daily from an operator-designated device via the internetwork. The system shall automatically adjust for daylight savings and standard time as applicable.

## **2.4 NETWORK AND DEVICE NAMING CONVENTION**

- A. Network Numbers
  - 1. BACnet network numbers shall be based on a "facility code, network" concept. The "facility code" is the VAMC's or VA campus' assigned numeric value assigned to a specific facility or building. The "network" typically corresponds to a "floor" or other logical configuration within the building. BACnet allows 65535 network numbers per BACnet internet work.
  - 2. The network numbers are thus formed as follows: "Net #" = "FFFNN" where:
    - a. FFF = Facility code (see below)
    - b. NN = 00-99 This allows up to 100 networks per facility or building
- B. Device Instances
  - 1. BACnet allows 4194305 unique device instances per BACnet internet work. Using Agency's unique device instances are formed as follows: "Dev #" = "FFFNNDD" where
    - a. FFF and N are as above and
    - b. DD = 00-99, this allows up to 100 devices per network.

2. Note Special cases, where the network architecture of limiting device numbering to DD causes excessive subnet works. The device number can be expanded to DDD and the network number N can become a single digit. In NO case shall the network number N and the device number D exceed 4 digits.
3. Facility code assignments:
4. 000-400 Building/facility number
5. Note that some facilities have a facility code with an alphabetic suffix to denote wings, related structures, etc. The suffix will be ignored. Network numbers for facility codes above 400 will be assigned in the range 000-399.

#### C. Device Names

1. Name the control devices based on facility name, location within a facility, the system or systems that the device monitors and/or controls, or the area served. The intent of the device naming is to be easily recognized. Names can be up to 254 characters in length, without embedded spaces. Provide the shortest descriptive, but unambiguous, name. For example, in building #123 prefix the number with a "B" followed by the building number, if there is only one chilled water pump "CHWP-1", a valid name would be "B123.CHWP.1.STARTSTOP". If there are two pumps designated "CHWP-1", one in a basement mechanical room (Room 0001) and one in a penthouse mechanical room (Room PH01), the names could be "B123.R0001.CHWP.1.STARTSTOP" or "B123.RPH01.CHWP.1.STARTSTOP". In the case of unitary controllers, for example a VAV box controller, a name might be "B123.R101.VAV". These names should be used for the value of the "Object\_Name" property of the BACnet Device objects of the controllers involved so that the BACnet name and the EMCS name are the same.

## 2.5 BACNET DEVICES

- A. All BACnet Devices - controllers, gateways, routers, actuators and sensors shall conform to BACnet Device Profiles and shall be BACnet Testing Laboratories (BTL) -Listed as conforming to those Device Profiles. Protocol Implementation Conformance Statements (PICSSs), describing the BACnet capabilities of the Devices shall be published and available of the Devices through links in the BTL website.
1. BACnet Building Controllers, historically referred to as NACs, shall conform to the BACnet B-BC Device Profile, and shall be BTL-Listed

- as conforming to the B-BC Device Profile. The Device's PICS shall be submitted.
2. BACnet Advanced Application Controllers shall conform to the BACnet B-AAC Device Profile, and shall be BTL-Listed as conforming to the B-AAC Device Profile. The Device's PICS shall be submitted.
  3. BACnet Application Specific Controllers shall conform to the BACnet B-ASC Device Profile, and shall be BTL-Listed as conforming to the B-ASC Device Profile. The Device's PICS shall be submitted.
  4. BACnet Smart Actuators shall conform to the BACnet B-SA Device Profile, and shall be BTL-Listed as conforming to the B-SA Device Profile. The Device's PICS shall be submitted.
  5. BACnet Smart Sensors shall conform to the BACnet B-SS Device Profile, and shall be BTL-Listed as conforming to the B-SS Device Profile. The Device's PICS shall be submitted.
  6. BACnet routers and gateways shall conform to the BACnet B-OTH Device Profile, and shall be BTL-Listed as conforming to the B-OTH Device Profile. The Device's PICS shall be submitted.

## **2.6 CONTROLLERS**

- A. General. Provide an adequate number of BTL-Listed B-BC building controllers and an adequate number of BTL-Listed B-AAC advanced application controllers to achieve the performance specified in the Part 1 Article on "System Performance." Each of these controllers shall meet the following requirements.
1. The controller shall have sufficient memory to support its operating system, database, and programming requirements.
  2. The building controller shall share data with the ECC and the other networked building controllers. The advanced application controller shall share data with its building controller and the other networked advanced application controllers.
  3. The operating system of the controller shall manage the input and output communication signals to allow distributed controllers to share real and virtual object information and allow for central monitoring and alarms.
  4. Controllers that perform scheduling shall have a real-time clock.
  5. The controller shall continually check the status of its processor and memory circuits. If an abnormal operation is detected, the controller shall:
    - a. assume a predetermined failure mode, and

- b. generate an alarm notification.
- 6. The controller shall communicate with other BACnet devices on the internetwork using the BACnet Read (Execute and Initiate) and Write (Execute and Initiate) Property services.
- 7. Communication.
  - a. Each controller shall reside on a BACnet network using the ISO 8802-3 (Ethernet) Data Link/Physical layer protocol for its communications. Each building controller also shall perform BACnet routing if connected to a network of custom application and application specific controllers.
  - b. The controller shall provide a service communication port using BACnet Data Link/Physical layer protocol for connection to a portable operator's terminal.
- 8. Keypad. A local keypad and display shall be provided for each controller. The keypad shall be provided for interrogating and editing data. Provide a system security password shall be available to prevent unauthorized use of the keypad and display.
- 9. Serviceability. Provide diagnostic LEDs for power, communication, and processor. All wiring connections shall be made to field-removable, modular terminal strips or to a termination card connected by a ribbon cable.
- 10. Memory. The controller shall maintain all BIOS and programming information in the event of a power loss for at least 72 hours.
- 11. The controller shall be able to operate at 90% to 110% of nominal voltage rating and shall perform an orderly shutdown below 80% nominal voltage. Controller operation shall be protected against electrical noise of 5 to 120 Hz and from keyed radios up to 5 W at 1 m (3 ft).
- B. Provide BTL-Listed B-ASC application specific controllers for each piece of equipment for which they are constructed. Application specific controllers shall communicate with other BACnet devices on the internetwork using the BACnet Read (Execute) Property service.
  - 1. Each B-ASC shall be capable of stand-alone operation and shall continue to provide control functions without being connected to the network.
  - 2. Each B-ASC will contain sufficient I/O capacity to control the target system.
  - 3. Communication.

- a. Each controller shall reside on a BACnet network using the ISO 8802-3 (Ethernet) Data Link/Physical layer protocol for its communications. Each building controller also shall perform BACnet routing if connected to a network of custom application and application specific controllers.
  - b. Each controller shall have a BACnet Data Link/Physical layer compatible connection for a laptop computer or a portable operator's tool. This connection shall be extended to a space temperature sensor port where shown.
4. Serviceability. Provide diagnostic LEDs for power, communication, and processor. All wiring connections shall be made to field-removable, modular terminal strips or to a termination card connected by a ribbon cable.
5. Memory. The application specific controller shall use nonvolatile memory and maintain all BIOS and programming information in the event of a power loss.
6. Immunity to power and noise. Controllers shall be able to operate at 90% to 110% of nominal voltage rating and shall perform an orderly shutdown below 80%. Operation shall be protected against electrical noise of 5-120 Hz and from keyed radios up to 5 W at 1 m (3 ft).
7. Transformer. Power supply for the ASC must be rated at a minimum of 125% of ASC power consumption and shall be of the fused or current limiting type.
- C. Direct Digital Controller Software
  1. The software programs specified in this section shall be commercially available, concurrent, multi-tasking operating system and support the use of software application that operates under DOS or Microsoft Windows.
  2. All points shall be identified by up to 30-character point name and 16-character point descriptor. The same names shall be used at the ECC.
  3. All control functions shall execute within the stand-alone control units via DDC algorithms. The VA shall be able to customize control strategies and sequences of operations defining the appropriate control loop algorithms and choosing the optimum loop parameters.
  4. All controllers shall be capable of being programmed to utilize stored default values for assured fail-safe operation of critical processes. Default values shall be invoked upon sensor failure or,

- if the primary value is normally provided by the central or another CU, or by loss of bus communication. Individual application software packages shall be structured to assume a fail-safe condition upon loss of input sensors. Loss of an input sensor shall result in output of a sensor-failed message at the ECC. Each ACU and RCU shall have capability for local readouts of all functions. The UCUs shall be read remotely.
5. All DDC control loops shall be able to utilize any of the following control modes:
    - a. Two position (on-off, slow-fast) control.
    - b. Proportional control.
    - c. Proportional plus integral (PI) control.
    - d. Proportional plus integral plus derivative (PID) control. All PID programs shall automatically invoke integral wind up prevention routines whenever the controlled unit is off, under manual control of an automation system or time initiated program.
    - e. Automatic tuning of control loops.
  6. System Security: Operator access shall be secured using individual password and operator's name. Passwords shall restrict the operator to the level of object, applications, and system functions assigned to him. A minimum of six (6) levels of security for operator access shall be provided.
  7. Application Software: The controllers shall provide the following programs as a minimum for the purpose of optimizing energy consumption while maintaining comfortable environment for occupants. All application software shall reside and run in the system digital controllers. Editing of the application shall occur at the ECC or via a portable operator's terminal, when it is necessary, to access directly the programmable unit.
    - a. Economizer: An economizer program shall be provided for VAV systems. This program shall control the position of air handler relief, return, and outdoors dampers. If the outdoor air dry bulb temperature and humidity fall below changeover set point the energy control center will modulate the dampers to provide 100 percent outdoor air. The operator shall be able to override the economizer cycle and return to minimum outdoor air operation at any time.

- b. Night Setback/Morning Warm up Control: The system shall provide the ability to automatically adjust set points for this mode of operation.
- c. For surgery facilities, Occupied/Unoccupied mode: The system shall provide the ability to automatically adjust set points for this mode of operation, while maintaining proper space pressurization/room airflow offsets as reviewed and confirmed by Testing, Adjusting and Balancing contractor.
- d. Optimum Start/Stop (OSS): Optimum start/stop program shall automatically be coordinated with event scheduling. The OSS program shall start HVAC equipment at the latest possible time that will allow the equipment to achieve the desired zone condition by the time of occupancy, and it shall also shut down HVAC equipment at the earliest possible time before the end of the occupancy period and still maintain desired comfort conditions. The OSS program shall consider both outside weather conditions and inside zone conditions. The program shall automatically assign longer lead times for weekend and holiday shutdowns. The program shall poll all zones served by the associated AHU and shall select the warmest and coolest zones. These shall be used in the start time calculation. It shall be possible to assign occupancy start times on a per air handler unit basis. The program shall meet the local code requirements for minimum outdoor air while the building is occupied. Modification of assigned occupancy start/stop times shall be possible via the ECC.
- e. Event Scheduling: Provide a comprehensive menu driven program to automatically start and stop designated points or a group of points according to a stored time. This program shall provide the capability to individually command a point or group of points. When points are assigned to one common load group it shall be possible to assign variable time advances/delays between each successive start or stop within that group. Scheduling shall be calendar based and advance schedules may be defined up to one year in advance. Advance schedule shall override the day-to-day schedule. The operator shall be able to define the following information:
  - 1) Time, day.

- 2) Commands such as on, off, auto.
  - 3) Time delays between successive commands.
  - 4) Manual overriding of each schedule.
  - 5) Allow operator intervention.
- f. Alarm Reporting: The operator shall be able to determine the action to be taken in the event of an alarm. Alarms shall be routed to the ECC based on time and events. An alarm shall be able to start programs, login the event, print and display the messages. The system shall allow the operator to prioritize the alarms to minimize nuisance reporting and to speed operator's response to critical alarms. A minimum of six (6) priority levels of alarms shall be provided for each point.
- g. Remote Communications: The system shall have the ability to dial out in the event of an alarm to the ECC and alpha-numeric pagers. The alarm message shall include the name of the calling location, the device that generated the alarm, and the alarm message itself. The operator shall be able to remotely access and operate the system using dial up communications. Remote access shall allow the operator to function the same as local access.
- h. Maintenance Management (PM): The program shall monitor equipment status and generate maintenance messages based upon the operators defined equipment run time, starts, and/or calendar date limits. A preventative maintenance alarm shall be printed indicating maintenance requirements based on pre-defined run time. Each preventive message shall include point description, limit criteria and preventative maintenance instruction assigned to that limit. A minimum of 480-character PM shall be provided for each component of units such as air handling units.

## **2.10 SPECIAL CONTROLLERS**

### **A. Room Differential Pressure Controller:**

1. The differential pressure in laboratory rooms, operating rooms and isolation rooms shall be maintained by controlling the quantity of air exhausted from the room. A sensor-controller shall measure and control the velocity of air flowing into or out of the room through a sampling tube installed in the wall separating the room from the adjacent space, and display the value on its monitor. The sensor-controller shall meet the following as a minimum:
  - a. Operating range: -0.25 to +0.25 inches of water column



- b. Resolution: 5 percent of reading
  - c. Accuracy: +/- 10 percent of reading +/- 0.005 inches of water column
  - d. Analog output: 0-10 VDC or 4-20 ma
  - e. Operating temperature range: 32°F-120°F
2. Display and Alarms, include:
- a. A large, local monitor providing visual indication of room status.
  - b. If pressure is lost, audible and visual alarms shall alert the staff to the alarm condition.
  - c. Adjustable alarm delays to allow avoidance of nuisance alarms.
  - d. Unoccupied mode, deactivating all alarms.
3. BACnet interface for communication with the building DDC control system.

#### Occupancy Sensors

- 1. Combination PIR (passive infrared) and ultrasonic detection sensor.
- 2. Optimized to detect low level movements of sedentary occupants.
- 3. Adjustable delay for switch on and switch off functions up to 60 minutes.
- 4. Suitable for ceiling mounting.

#### **2.11 SENSORS (AIR, WATER AND STEAM)**

- A. Sensors' measurements shall be read back to the DDC system, and shall be visible by the ECC.
- B. Temperature and Humidity Sensors shall be electronic, vibration and corrosion resistant for wall, immersion, and/or duct mounting. Provide all remote sensors as required for the systems.
  - 1. Temperature Sensors: thermistor type for terminal units and Resistance Temperature Device (RTD) with an integral transmitter type for all other sensors.
    - a. Duct sensors shall be rigid or averaging type as shown on drawings. Averaging sensor shall be a minimum of 1 linear ft of sensing element for each sq ft of cooling coil face area.
    - b. Immersion sensors shall be provided with a separable well made of stainless steel, bronze or monel material. Pressure rating of well is to be consistent with the system pressure in which it is to be installed.
    - c. Space sensors shall be equipped with in-space User set-point adjustment, override switch, numerical temperature display on

sensor cover, and communication port. Match room thermostats.  
Provide a tooled-access cover.

- 1) Public space sensor: setpoint adjustment shall be only through the ECC or through the DDC system's diagnostic device/laptop. Do not provide in-space User set-point adjustment. Provide an opaque keyed-entry cover if needed to restrict in-space User set-point adjustment.
- 2) Psychiatric patient room sensor: sensor shall be flush with wall, shall not include an override switch, numerical temperature display on sensor cover, shall not include a communication port and shall not allow in-space User set-point adjustment. Setpoint adjustment shall be only through the ECC or through the DDC system's diagnostic device/laptop. Provide a stainless steel cover plate with an insulated back and security screws.
- d. Outdoor air temperature sensors shall have watertight inlet fittings and be shielded from direct sunlight.
- e. Room security sensors shall have stainless steel cover plate with insulated back and security screws.
- f. Wire: Twisted, shielded-pair cable.
- g. Output Signal: 4-20 ma.
2. Humidity Sensors: Bulk polymer sensing element type.
  - a. Duct and room sensors shall have a sensing range of 20 to 80 percent with accuracy of  $\pm 2$  to  $\pm 5$  percent RH, including hysteresis, linearity, and repeatability.
  - b. Outdoor humidity sensors shall be furnished with element guard and mounting plate and have a sensing range of 0 to 100 percent RH.
  - c. 4-20 ma continuous output signal.
- C. Static Pressure Sensors: Non-directional, temperature compensated.
  1. 4-20 ma output signal.
  2. 0 to 5 inches wg for duct static pressure range.
  3. 0 to 0.25 inch wg for Building static pressure range.
- D. Water flow sensors:
  1. Type: Insertion vortex type with retractable probe assembly and 2 inch full port gate valve.
    - a. Pipe size: 3 to 24 inches.
    - b. Retractor: ASME threaded, non-rising stem type with hand wheel.

- c. Mounting connection: 2 inch 150 PSI flange.
- d. Sensor assembly: Design for expected water flow and pipe size.
- e. Seal: Teflon (PTFE).
- 2. Controller:
  - a. Integral to unit.
  - b. Locally display flow rate and total.
  - c. Output flow signal to BMCS: Digital pulse type.
- 3. Performance:
  - a. Turndown: 20:1
  - b. Response time: Adjustable from 1 to 100 seconds.
  - c. Power: 24 volt DC
- 4. Install flow meters according to manufacturer's recommendations.  
Where recommended by manufacturer because of mounting conditions, provide flow rectifier.
- E. Water Flow Sensors: shall be insertion turbine type with turbine element, retractor and preamplifier/transmitter mounted on a two-inch full port isolation valve; assembly easily removed or installed as a single unit under line pressure through the isolation valve without interference with process flow; calibrated scale shall allow precise positioning of the flow element to the required insertion depth within plus or minute 1 mm (0.05 inch); wetted parts shall be constructed of stainless steel. Operating power shall be nominal 24 VDC. Local instantaneous flow indicator shall be LED type in NEMA 4 enclosure with 3-1/2 digit display, for wall or panel mounting.
  - 1. Performance characteristics:
    - a. Ambient conditions: -40°C to 60°C (-40°F to 140°F), 5 to 100% humidity.
    - b. Operating conditions: 850 kPa (125 psig), 0°C to 120°C (30°F to 250°F), 0.15 to 12 m per second (0.5 to 40 feet per second) velocity.
    - c. Nominal range (turn down ratio): 10 to 1.
    - d. Preamplifier mounted on meter shall provide 4-20 ma divided pulse output or switch closure signal for units of volume or mass per a time base. Signal transmission distance shall be a minimum of 1,800 meters (6,000 feet). Preamplifier for bi-directional flow measurement shall provide a directional contact closure from a relay mounted in the preamplifier.

- e. Pressure Loss: Maximum 1 percent of the line pressure in line sizes above 100 mm (4 inches).
  - f. Ambient temperature effects, less than 0.005 percent calibrated span per °C (°F) temperature change.
  - g. RFI effect - flow meter shall not be affected by RFI.
  - h. Power supply effect less than 0.02 percent of span for a variation of plus or minus 10 percent power supply.
- F. Flow switches:
- 1. Shall be either paddle or differential pressure type.
    - a. Paddle-type switches (liquid service only) shall be UL Listed, SPDT snap-acting, adjustable sensitivity with NEMA 4 enclosure.
    - b. Differential pressure type switches (air or water service) shall be UL listed, SPDT snap acting, NEMA 4 enclosure, with scale range and differential suitable for specified application.
- G. Current Switches: Current operated switches shall be self powered, solid state with adjustable trip current as well as status, power, and relay command status LED indication. The switches shall be selected to match the current of the application and output requirements of the DDC systems.

## **2.12 CONTROL CABLES**

- A. General:
- 1. Ground cable shields, drain conductors, and equipment to eliminate shock hazard and to minimize ground loops, common-mode returns, noise pickup, cross talk, and other impairments. Comply with Sections 27 05 26 and 26 05 26.
  - 2. Cable conductors to provide protection against induction in circuits. Crosstalk attenuation within the System shall be in excess of -80 dB throughout the frequency ranges specified.
  - 3. Minimize the radiation of RF noise generated by the System equipment so as not to interfere with any audio, video, data, computer main distribution frame (MDF), telephone customer service unit (CSU), and electronic private branch exchange (EPBX) equipment the System may service.
  - 4. The as-installed drawings shall identify each cable as labeled, used cable, and bad cable pairs.
  - 5. Label system's cables on each end. Test and certify cables in writing to the VA before conducting proof-of-performance testing. Minimum cable test requirements are for impedance compliance,

inductance, capacitance, signal level compliance, opens, shorts, cross talk, noise, and distortion, and split pairs on all cables in the frequency ranges used. Make available all cable installation and test records at demonstration to the VA. All changes (used pair, failed pair, etc.) shall be posted in these records as the change occurs.

6. Power wiring shall not be run in conduit with communications trunk wiring or signal or control wiring operating at 100 volts or less.
- B. Analogue control cabling shall be not less than No. 18 AWG solid, with thermoplastic insulated conductors as specified in Section 26 05 21.
- C. Copper digital communication cable between the ECC and the B-BC and B-AAC controllers shall be 100BASE-TX Ethernet, Category 5e or 6, not less than minimum 24 American Wire Gauge (AWG) solid, Shielded Twisted Pair (STP) or Unshielded Twisted Pair (UTP), with thermoplastic insulated conductors, enclosed in a thermoplastic outer jacket, as specified in Section 27 15 00.
  1. Other types of media commonly used within IEEE Std 802.3 LANs (e.g., 10Base-T and 10Base-2) shall be used only in cases to interconnect with existing media.
- D. Optical digital communication fiber, if used, shall be Multimode or Singlemode fiber, 62.5/125 micron for multimode or 10/125 micron for singlemode micron with SC or ST connectors as specified in TIA-568-C.1. Terminations, patch panels, and other hardware shall be compatible with the specified fiber and shall be as specified in Section 27 15 00. Fiber-optic cable shall be suitable for use with the 100Base-FX or the 100Base-SX standard (as applicable) as defined in IEEE Std 802.3.

## **2.13 THERMOSTATS AND HUMIDISTATS**

- A. Room thermostats controlling unitary standalone heating and cooling devices not connected to the DDC system shall have three modes of operation (heating - null or dead band - cooling). Thermostats for patient bedrooms shall have capability of being adjusted to eliminate null or dead band. Wall mounted thermostats shall have manufacturer's recommendation finish, setpoint range and temperature display and external adjustment:
  1. Electronic Thermostats: Solid-state, microprocessor based, programmable to daily, weekend, and holiday schedules.
    - a. Public Space Thermostat: Public space thermostat shall have a thermistor sensor and shall not have a visible means of set point

adjustment. Adjustment shall be via the digital controller to which it is connected.

- b. Patient Room Thermostats: thermistor with in-space User set point adjustment and an on-casing room temperature numerical temperature display.
  - c. Psychiatric Patient Room Sensors: Electronic duct sensor as noted under Article 2.4.
  - d. Battery replacement without program loss.
- B. Strap-on thermostats shall be enclosed in a dirt-and-moisture proof housing with fixed temperature switching point and single pole, double throw switch.
- C. Freezestats shall have a minimum of 300 mm (one linear foot) of sensing element for each 0.093 square meter (one square foot) of coil area. A freezing condition at any increment of 300 mm (one foot) anywhere along the sensing element shall be sufficient to operate the thermostatic element. Freezestats shall be manually-reset.
- D. Room Humidistats: Provide fully proportioning humidistat with adjustable throttling range for accuracy of settings and conservation. The humidistat shall have set point scales shown in percent of relative humidity located on the instrument. Systems showing moist/dry or high/low are not acceptable.

#### **2.14 FINAL CONTROL ELEMENTS AND OPERATORS**

- A. Fail Safe Operation: Control valves and dampers shall provide "fail safe" operation in either the normally open or normally closed position as required for freeze, moisture, and smoke or fire protection.
- B. Spring Ranges: Range as required for system sequencing and to provide tight shut-off.
- C. Power Operated Control Dampers (other than VAV Boxes): Factory fabricated, balanced type dampers. All modulating dampers shall be opposed blade type and gasketed. Blades for two-position, duct-mounted dampers shall be parallel, airfoil (streamlined) type for minimum noise generation and pressure drop.
  - 1. Leakage: Maximum leakage in closed position shall not exceed 7 L/S (15 CFMs) differential pressure for outside air and exhaust dampers and 200 L/S/ square meter (40 CFM/sq. ft.) at 50 mm (2 inches) differential pressure for other dampers.
  - 2. Frame shall be galvanized steel channel with seals as required to meet leakage criteria.

3. Blades shall be galvanized steel or aluminum, 200 mm (8 inch) maximum width, with edges sealed as required.
4. Bearing shall be nylon, bronze sleeve or ball type.
5. Hardware shall be zinc-plated steel. Connected rods and linkage shall be non-slip. Working parts of joints shall be brass, bronze, nylon or stainless steel.
6. Maximum air velocity and pressure drop through free area the dampers:
  - a. Smoke damper in air handling unit: 305 meter per minute (1000 fpm).
  - b. Duct mounted damper: 600 meter per minute (2000 fpm).
  - c. Maximum static pressure loss: 50 Pascal (0.20 inches water gage).
- D. Smoke Dampers and Combination Fire/Smoke Dampers: Dampers and operators are specified in Section 23 31 00, HVAC DUCTS AND CASINGS. Control of these dampers is specified under this Section.
- E. Control Valves:
  1. Valves shall be rated for a minimum of 150 percent of system operating pressure at the valve location but not less than 900 kPa (125 psig).
  2. Valves 50 mm (2 inches) and smaller shall be bronze body with threaded or flare connections.
  3. Valves 60 mm (2 1/2 inches) and larger shall be bronze or iron body with flanged connections.
  4. Brass or bronze seats except for valves controlling media above 100 degrees C (210 degrees F), which shall have stainless steel seats.
  5. Flow characteristics:
    - a. Three way modulating valves shall be globe pattern. Position versus flow relation shall be linear relation for steam or equal percentage for water flow control.
    - b. Two-way modulating valves shall be globe pattern. Position versus flow relation shall be linear for steam and equal percentage for water flow control.
    - c. Two-way 2-position valves shall be ball, gate or butterfly type.
  6. Maximum pressure drop:
    - a. Two position steam control: 20 percent of inlet gauge pressure.
    - b. Modulating Steam Control: 80 percent of inlet gauge pressure (acoustic velocity limitation).

- c. Modulating water flow control, greater of 3 meters (10 feet) of water or the pressure drop through the apparatus.
- 7. Two position water valves shall be line size.
- F. Damper and Valve Operators and Relays:
  - 1. Electric operator shall provide full modulating control of dampers and valves. A linkage and pushrod shall be furnished for mounting the actuator on the damper frame internally in the duct or externally in the duct or externally on the duct wall, or shall be furnished with a direct-coupled design. Metal parts shall be aluminum, mill finish galvanized steel, or zinc plated steel or stainless steel. Provide actuator heads which allow for electrical conduit attachment. The motors shall have sufficient closure torque to allow for complete closure of valve or damper under pressure. Provide multiple motors as required to achieve sufficient close-off torque.
    - a. Minimum valve close-off pressure shall be equal to the system pump's dead-head pressure, minimum 50 psig for valves smaller than 4 inches.
  - 3. Electronic damper operators: Metal parts shall be aluminum, mill finish galvanized steel, or zinc plated steel or stainless steel. Provide actuator heads which allow for electrical conduit attachment. The motors shall have sufficient closure torque to allow for complete closure of valve or damper under pressure. Provide multiple motors as required to achieve sufficient close-off torque.
    - a. VAV Box actuator shall be mounted on the damper axle or shall be of the air valve design, and shall provide complete modulating control of the damper. The motor shall have a closure torque of 35-inch pounds minimum with full torque applied at close off to attain minimum leakage.
  - 4. See drawings for required control operation.

## **2.15 AIR FLOW CONTROL**

- A. Airflow and static pressure shall be controlled via digital controllers with inputs from airflow control measuring stations and static pressure inputs as specified. Controller outputs shall be analog or pulse width modulating output signals. The controllers shall include the capability to control via simple proportional (P) control, proportional plus integral (PI), proportional plus integral plus derivative (PID), and on-off. The airflow control programs shall be factory-tested



programs that are documented in the literature of the control manufacturer.

C. Air Flow Measuring Station -- Electronic Thermal Type:

1. Air Flow Sensor Probe:

- a. Each air flow sensor shall contain two individual thermal sensing elements. One element shall determine the velocity of the air stream while the other element shall compensate for changes in temperature. Each thermal flow sensor and its associated control circuit and signal conditioning circuit shall be factory calibrated and be interchangeable to allow replacement of a sensor without recalibration of the entire flow station. The sensor in the array shall be located at the center of equal area segment of the duct and the number of sensors shall be adequate to accommodate the expected velocity profile and variation in flow and temperature. The airflow station shall be of the insertion type in which sensor support structures are inserted from the outside of the ducts to make up the complete electronic velocity array.
- b. Thermal flow sensor shall be constructed of hermetically sealed thermistors or nickel chromium or reference grade platinum wire, wound over an epoxy, stainless steel or ceramic mandrel and coated with a material suitable for the conditions to be encountered. Each dual sensor shall be mounted in an extruded aluminum alloy strut.

2. Air Flow Sensor Grid Array:

- a. Each sensor grid shall consist of a lattice network of temperature sensors and linear integral controllers (ICs) situated inside an aluminum casing suitable for mounting in a duct. Each sensor shall be mounted within a strut facing downstream of the airflow and located so that it is protected on the upstream side. All wiring shall be encased (out of the air stream) to protect against mechanical damage.
- b. The casing shall be made of welded aluminum of sufficient strength to prevent structural bending and bowing. Steel or iron composite shall not be acceptable in the casing material.
- c. Pressure drop through the flow station shall not exceed 4 Pascal (0.015" W.G.) at 1,000 meter per minute (3,000 FPM).

3. Electronics Panel:

- a. Electronics Panel shall consist of a surface mounted enclosure complete with solid-state microprocessor and software.
  - b. Electronics Panel shall be A/C powered 24 VAC and shall have the capability to transmit signals of 0-5 VDC, 0-10 VCD or 4-20 ma for use in control of the HVAC Systems. The electronic panel shall have the capability to accept user defined scaling parameters for all output signals.
  - c. Electronics Panel shall have the capability to digitally display airflow in CFM and temperature in degrees F. The displays shall be provided as an integral part of the electronics panel. The electronic panel shall have the capability to totalize the output flow in CFM for two or more systems, as required. A single output signal may be provided which will equal the sum of the systems totalized. Output signals shall be provided for temperature and airflow. Provide remote mounted air flow or temperature displays where indicated on the plans.
  - d. Electronics Panel shall have the following:
    - 1) Minimum of 12-bit A/D conversion.
    - 2) Field adjustable digital primary output offset and gain.
    - 3) Airflow analog output scaling of 100 to 10,000 FPM.
    - 4) Temperature analog output scaling from -45°C to 70°C (-50°F to 160°F).
    - 5) Analog output resolution (full scale output) of 0.025%.
  - e. All readings shall be in I.P. units.
4. Thermal flow sensors and its electronics shall be installed as per manufacturer's instructions. The probe sensor density shall be as follows:

Probe Sensor Density	
Area (sq.ft.)	Qty. Sensors
<=1	2
>1 to <4	4
4 to <8	6
8 to <12	8
12 to <16	12
>=16	16

- a. Complete installation shall not exhibit more than  $\pm 2.0\%$  error in airflow measurement output for variations in the angle of flow of

up to 10 percent in any direction from its calibrated orientation. Repeatability of readings shall be within  $\pm 0.25\%$ .

- D. Static Pressure Measuring Station: shall consist of one or more static pressure sensors and transmitters along with relays or auxiliary devices as required for a complete functional system. The span of the transmitter shall not exceed two times the design static pressure at the point of measurement. The output of the transmitter shall be true representation of the input pressure with plus or minus 25 Pascal (0.1 inch) W.G. of the true input pressure:
1. Static pressure sensors shall have the same requirements as Airflow Measuring Devices except that total pressure sensors are optional, and only multiple static pressure sensors positioned on an equal area basis connected to a network of headers are required.
  2. For systems with multiple major trunk supply ducts, furnish a static pressure transmitter for each trunk duct. The transmitter signal representing the lowest static pressure shall be selected and this shall be the input signal to the controller.
  3. The controller shall receive the static pressure transmitter signal and CU shall provide a control output signal to the supply fan capacity control device. The control mode shall be proportional plus integral (PI) (automatic reset) and where required shall also include derivative mode.
  4. In systems with multiple static pressure transmitters, provide a switch located near the fan discharge to prevent excessive pressure during abnormal operating conditions. High-limit switches shall be manually-reset.
- E. Constant Volume Control Systems shall consist of an air flow measuring station along with such relays and auxiliary devices as required to produce a complete functional system. The transmitter shall receive its air flow signal and static pressure signal from the flow measuring station and shall have a span not exceeding three times the design flow rate. The CU shall receive the transmitter signal and shall provide an output to the fan volume control device to maintain a constant flow rate. The CU shall provide proportional plus integral (PI) (automatic reset) control mode and where required also inverse derivative mode. Overall system accuracy shall be plus or minus the equivalent of 2 Pascal (0.008 inch) velocity pressure as measured by the flow station.
- F. Airflow Synchronization:

1. Systems shall consist of an air flow measuring station for each supply and return duct, the CU and such relays, as required to provide a complete functional system that will maintain a constant flow rate difference between supply and return air to an accuracy of  $\pm 10\%$ . In systems where there is no suitable location for a flow measuring station that will sense total supply or return flow, provide multiple flow stations with a differential pressure transmitter for each station. Signals from the multiple transmitters shall be added through the CU such that the resultant signal is a true representation of total flow.
2. The total flow signals from supply and return air shall be the input signals to the CU. This CU shall track the return air fan capacity in proportion to the supply air flow under all conditions.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

##### **A. General:**

1. Examine project plans for control devices and equipment locations; and report any discrepancies, conflicts, or omissions to COR for resolution before proceeding for installation.
2. Install equipment, piping, wiring /conduit parallel to or at right angles to building lines.
3. Install all equipment and piping in readily accessible locations. Do not run tubing and conduit concealed under insulation or inside ducts.
4. Mount control devices, tubing and conduit located on ducts and apparatus with external insulation on standoff support to avoid interference with insulation.
5. Provide sufficient slack and flexible connections to allow for vibration of piping and equipment.
6. Run tubing and wire connecting devices on or in control cabinets parallel with the sides of the cabinet neatly racked to permit tracing.
7. Install equipment level and plum.

##### **A. Electrical Wiring Installation:**

1. All wiring cabling shall be installed in conduits. Install conduits and wiring in accordance with Specification Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS. Conduits carrying control wiring and cabling shall be dedicated to the control wiring and

- cabling: these conduits shall not carry power wiring. Provide plastic end sleeves at all conduit terminations to protect wiring from burrs.
2. Install analog signal and communication cables in conduit and in accordance with Specification Section 26 05 21. Install digital communication cables in conduit and in accordance with Specification Section 27 15 00, Communications Horizontal Cabling.
  3. Install conduit and wiring between operator workstation(s), digital controllers, electrical panels, indicating devices, instrumentation, miscellaneous alarm points, thermostats, and relays as shown on the drawings or as required under this section.
  4. Install all electrical work required for a fully functional system and not shown on electrical plans or required by electrical specifications. Where low voltage (less than 50 volt) power is required, provide suitable Class B transformers.
  5. Install all system components in accordance with local Building Code and National Electric Code.
    - a. Splices: Splices in shielded and coaxial cables shall consist of terminations and the use of shielded cable couplers. Terminations shall be in accessible locations. Cables shall be harnessed with cable ties.
    - b. Equipment: Fit all equipment contained in cabinets or panels with service loops, each loop being at least 300 mm (12 inches) long. Equipment for fiber optics system shall be rack mounted, as applicable, in ventilated, self-supporting, code gauge steel enclosure. Cables shall be supported for minimum sag.
    - c. Cable Runs: Keep cable runs as short as possible. Allow extra length for connecting to the terminal board. Do not bend flexible coaxial cables in a radius less than ten times the cable outside diameter.
    - d. Use vinyl tape, sleeves, or grommets to protect cables from vibration at points where they pass around sharp corners, through walls, panel cabinets, etc.
  6. Conceal cables, except in mechanical rooms and areas where other conduits and piping are exposed.
  7. Permanently label or code each point of all field terminal strips to show the instrument or item served. Color-coded cable with cable diagrams may be used to accomplish cable identification.

8. Grounding: ground electrical systems per manufacturer's written requirements for proper and safe operation.

C. Install Sensors and Controls:

1. Temperature Sensors:

- a. Install all sensors and instrumentation according to manufacturer's written instructions. Temperature sensor locations shall be readily accessible, permitting quick replacement and servicing of them without special skills and tools.
- b. Calibrate sensors to accuracy specified, if not factory calibrated.
- c. Use of sensors shall be limited to its duty, e.g., duct sensor shall not be used in lieu of room sensor.
- d. Install room sensors permanently supported on wall frame. They shall be mounted at 1.5 meter (5.0 feet) above the finished floor.
- e. Mount sensors rigidly and adequately for the environment within which the sensor operates. Separate extended-bulb sensors form contact with metal casings and coils using insulated standoffs.
- f. Sensors used in mixing plenum, and hot and cold decks shall be of the averaging of type. Averaging sensors shall be installed in a serpentine manner horizontally across duct. Each bend shall be supported with a capillary clip.
- g. All pipe mounted temperature sensors shall be installed in wells.
- h. All wires attached to sensors shall be air sealed in their conduits or in the wall to stop air transmitted from other areas affecting sensor reading.
- i. Permanently mark terminal blocks for identification. Protect all circuits to avoid interruption of service due to short-circuiting or other conditions. Line-protect all wiring that comes from external sources to the site from lightning and static electricity.

2. Pressure Sensors:

- a. Install duct static pressure sensor tips facing directly downstream of airflow.
- b. Install high-pressure side of the differential switch between the pump discharge and the check valve.
- c. Install snubbers and isolation valves on steam pressure sensing devices.

3. Actuators:

- a. Mount and link damper and valve actuators according to manufacturer's written instructions.
- b. Check operation of damper/actuator combination to confirm that actuator modulates damper smoothly throughout stroke to both open and closed position.
- c. Check operation of valve/actuator combination to confirm that actuator modulates valve smoothly in both open and closed position.

4. Flow Switches:

- a. Install flow switch according to manufacturer's written instructions.
- b. Mount flow switch a minimum of 5 pipe diameters up stream and 5 pipe diameters downstream or 600 mm (2 feet) whichever is greater, from fittings and other obstructions.
- c. Assure correct flow direction and alignment.
- d. Mount in horizontal piping-flow switch on top of the pipe.

D. Installation of network:

1. Ethernet:

- a. The network shall employ Ethernet LAN architecture, as defined by IEEE 802.3. The Network Interface shall be fully Internet Protocol (IP) compliant allowing connection to currently installed IEEE 802.3, Compliant Ethernet Networks.
- b. The network shall directly support connectivity to a variety of cabling types. As a minimum provide the following connectivity: 100 Base TX (Category 5e cabling) for the communications between the ECC and the B-BC and the B-AAC controllers.

2. Third party interfaces: Contractor shall integrate real-time data from building systems by other trades and databases originating from other manufacturers as specified and required to make the system work as one system.

E. Installation of digital controllers and programming:

1. Provide a separate digital control panel for each major piece of equipment, such as air handling unit, chiller, pumping unit etc. Points used for control loop reset such as outdoor air, outdoor humidity, or space temperature could be located on any of the remote control units.

2. Provide sufficient internal memory for the specified control sequences and trend logging. There shall be a minimum of 25 percent of available memory free for future use.
3. System point names shall be modular in design, permitting easy operator interface without the use of a written point index.
4. Provide software programming for the applications intended for the systems specified, and adhere to the strategy algorithms provided.
5. Provide graphics for each piece of equipment and floor plan in the building. This includes each chiller, cooling tower, air handling unit, fan, terminal unit, boiler, pumping unit etc. These graphics shall show all points dynamically as specified in the point list.

### **3.2 SYSTEM VALIDATION AND DEMONSTRATION**

- A. Provide full coordination; including labor and start-stop/support for functional performance testing services, during/throughout project commissioning efforts. Coordinate with all disciplines, including Commissioning Authority/Agent and Testing, Adjusting and Balancing contractor to verify system operation as required in Commissioning specifications.
- B. As part of final system acceptance, a system demonstration is required (see below). Prior to start of this demonstration, the contractor is to perform a complete validation of all aspects of the controls and instrumentation system.
- C. Validation
  1. Prepare and submit for approval a validation test plan including test procedures for the performance verification tests. Test Plan shall address all specified functions of the ECC and all specified sequences of operation. Explain in detail actions and expected results used to demonstrate compliance with the requirements of this specification. Explain the method for simulating the necessary conditions of operation used to demonstrate performance of the system. Test plan shall include a test check list to be used by the Installer's agent to check and initial that each test has been successfully completed. Deliver test plan documentation for the performance verification tests to the owner's representative 30 days prior to start of performance verification tests. Provide draft copy of operation and maintenance manual with performance verification test.



2. After approval of the validation test plan, installer shall carry out all tests and procedures therein. Installer shall completely check out, calibrate, and test all connected hardware and software to insure that system performs in accordance with approved specifications and sequences of operation submitted. Installer shall complete and submit Test Check List.

D. Demonstration

1. System operation and calibration to be demonstrated by the installer in the presence of the Architect or VA's representative on random samples of equipment as dictated by the Architect or VA's representative. Should random sampling indicate improper commissioning, the owner reserves the right to subsequently witness complete calibration of the system at no addition cost to the VA.
2. Demonstrate to authorities that all required safeties and life safety functions are fully functional and complete.
3. Make accessible, personnel to provide necessary adjustments and corrections to systems as directed by balancing agency.
4. The following witnessed demonstrations of field control equipment shall be included:
  - a. Observe HVAC systems in shut down condition. Check dampers and valves for normal position.
  - b. Test application software for its ability to communicate with digital controllers, operator workstation, and uploading and downloading of control programs.
  - c. Demonstrate the software ability to edit the control program off-line.
  - d. Demonstrate reporting of alarm conditions for each alarm and ensure that these alarms are received at the assigned location, including operator workstations.
  - e. Demonstrate ability of software program to function for the intended applications-trend reports, change in status etc.
  - f. Demonstrate via graphed trends to show the sequence of operation is executed in correct manner, and that the HVAC systems operate properly through the complete sequence of operation, e.g., seasonal change, occupied/unoccupied mode, and warm-up condition.
  - g. Demonstrate hardware interlocks and safeties functions, and that the control systems perform the correct sequence of operation after power loss and resumption of power loss.

- h. Prepare and deliver to the VA graphed trends of all control loops to demonstrate that each control loop is stable and the set points are maintained.
  - i. Demonstrate that each control loop responds to set point adjustment and stabilizes within one (1) minute. Control loop trend data shall be instantaneous and the time between data points shall not be greater than one (1) minute.
- 5. Witnessed demonstration of ECC functions shall consist of:
  - a. Running each specified report.
  - b. Display and demonstrate each data entry to show site specific customizing capability. Demonstrate parameter changes.
  - c. Step through penetration tree, display all graphics, demonstrate dynamic update, and direct access to graphics.
  - d. Execute digital and analog commands in graphic mode.
  - e. Demonstrate DDC loop precision and stability via trend logs of inputs and outputs (6 loops minimum).
  - f. Demonstrate EMS performance via trend logs and command trace.
  - g. Demonstrate scan, update, and alarm responsiveness.
  - h. Demonstrate spreadsheet/curve plot software, and its integration with database.
  - i. Demonstrate on-line user guide, and help function and mail facility.
  - j. Demonstrate digital system configuration graphics with interactive upline and downline load, and demonstrate specified diagnostics.
  - k. Demonstrate multitasking by showing dynamic curve plot, and graphic construction operating simultaneously via split screen.
  - l. Demonstrate class programming with point options of beep duration, beep rate, alarm archiving, and color banding.

----- END -----

**SECTION 23 21 13**  
**HYDRONIC PIPING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Water piping to connect HVAC equipment, including the following:
  - 1. Chilled water, heating hot water and drain piping.
  - 2. Extension of domestic water make-up piping.
  - 3. Glycol-water piping.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- E. Section 23 05 11, COMMON WORK RESULTS FOR HVAC: General mechanical requirements and items, which are common to more than one section of Division 23.
- G. Section 23 74 43, CUSTOM, OUTDOOR, PENTHOUSE EQUIPMENT MODULE/CENTRAL STATION AIR HANDLING UNIT.
- H. Section 23 07 11, HVAC INSULATION: Piping insulation.
- I. Section 23 25 00, HVAC WATER TREATMENT: Water treatment for closed systems.
- J. Section 23 82 00, CONVECTION HEATING AND COOLING UNITS: VAV and CV units, unit heaters, and radiant ceiling panels.
- K. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Temperature and pressure sensors and valve operators.

**1.3 QUALITY ASSURANCE**

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC, which includes welding qualifications.
- B. Submit prior to welding of steel piping a certificate of Welder's certification. The certificate shall be current and not more than one year old.
- C. All grooved joint couplings, fittings, valves, and specialties shall be the products of a single manufacturer. Grooving tools shall be the same manufacturer as the grooved components.
  - 1. All castings used for coupling housings, fittings, valve bodies, etc., shall be date stamped for quality assurance and traceability.

#### 1.4 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
  - 1. Pipe and equipment supports. Submit calculations for variable spring and constant support hangers.
  - 2. Pipe and tubing, with specification, class or type, and schedule.
  - 3. Pipe fittings, including miscellaneous adapters and special fittings.
  - 4. Flanges, gaskets and bolting.
  - 5. Grooved joint couplings and fittings.
  - 6. Valves of all types.
  - 7. Strainers.
  - 8. Flexible connectors for water service.
  - 9. Pipe alignment guides.
  - 10. Expansion joints.
  - 11. Expansion compensators.
  - 12. All specified hydronic system components.
  - 13. Water flow measuring devices.
  - 14. Gages.
  - 15. Thermometers and test wells.
  - 16. Electric heat tracing systems.
  - 17. Seismic bracing details for piping.
- C. Manufacturer's certified data report, Form No. U-1, for ASME pressure vessels:
  - 1. Heat Exchangers (Water to Water)
  - 2. Air separators.
  - 3. Expansion tanks.
- D. Submit the welder's qualifications in the form of a current (less than one year old) and formal certificate.
- E. Coordination Drawings: Refer to Article, SUBMITTALS of Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- F. As-Built Piping Diagrams: Provide drawing as follows for chilled water, condenser water, and heating hot water system and other piping systems and equipment.
  - 1. One wall-mounted stick file with complete set of prints. Mount stick file in the chiller plant or control room along with control diagram stick file.

- ## 1.5 APPLICABLE PUBLICATIONS

- 23 21 13-3

A53/A53M-07.....	Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless
A106/A106M-08.....	Standard Specification for Seamless Carbon Steel Pipe for High-Temperature Service
A126-04.....	Standard Specification for Gray Iron Castings for Valves, Flanges, and Pipe Fittings
A183-03 .....	Standard Specification for Carbon Steel Track Bolts and Nuts
A216/A216M-08 .....	Standard Specification for Steel Castings, Carbon, Suitable for Fusion Welding, for High Temperature Service
A234/A234M-07 .....	Piping Fittings of Wrought Carbon Steel and Alloy Steel for Moderate and High Temperature Service
A307-07 .....	Standard Specification for Carbon Steel Bolts and Studs, 60,000 PSI Tensile Strength
A536-84 (2004) .....	Standard Specification for Ductile Iron Castings
A615/A615M-08 .....	Deformed and Plain Carbon Steel Bars for Concrete Reinforcement
A653/A 653M-08 .....	Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy Coated (Galvannealed) By the Hot-Dip Process
B32-08 .....	Standard Specification for Solder Metal
B62-02 .....	Standard Specification for Composition Bronze or Ounce Metal Castings
B88-03 .....	Standard Specification for Seamless Copper Water Tube
B209-07 .....	Aluminum and Aluminum Alloy Sheet and Plate
C177-04 .....	Standard Test Method for Steady State Heat Flux Measurements and Thermal Transmission Properties by Means of the Guarded Hot Plate Apparatus
C478-09 .....	Precast Reinforced Concrete Manhole Sections
C533-07 .....	Calcium Silicate Block and Pipe Thermal Insulation
C552-07 .....	Cellular Glass Thermal Insulation
D3350-08 .....	Polyethylene Plastics Pipe and Fittings Materials

- C591-08 ..... Unfaced Preformed Rigid Cellular  
Polyisocyanurate Thermal Insulation
- D1784-08 ..... Rigid Poly (Vinyl Chloride) (PVC) Compounds and  
Chlorinated Poly (Vinyl Chloride) (CPVC)  
Compound
- D1785-06 ..... Poly (Vinyl Chloride) (PVC) Plastic Pipe,  
Schedules 40, 80 and 120
- D2241-05 ..... Poly (Vinyl Chloride) (PVC) Pressure Rated Pipe  
(SDR Series)
- F439-06 ..... Standard Specification for Chlorinated Poly  
(Vinyl Chloride) (CPVC) Plastic Pipe Fittings,  
Schedule 80
- F441/F441M-02 ..... Standard Specification for Chlorinated Poly  
(Vinyl Chloride) (CPVC) Plastic Pipe, Schedules  
40 and 80
- F477-08 ..... Elastomeric Seals Gaskets) for Joining Plastic  
Pipe
- F. American Water Works Association (AWWA):
  - C110-08.....Ductile Iron and Grey Iron Fittings for Water
  - C203-02.....Coal Tar Protective Coatings and Linings for  
Steel Water Pipe Lines Enamel and Tape Hot  
Applied
- G. American Welding Society (AWS):
  - B2.1-02.....Standard Welding Procedure Specification
- H. Copper Development Association, Inc. (CDA):
  - CDA A4015-06.....Copper Tube Handbook
- I. Expansion Joint Manufacturer's Association, Inc. (EJMA):
  - EMJA-2003.....Expansion Joint Manufacturer's Association  
Standards, Ninth Edition
- J. Manufacturers Standardization Society (MSS) of the Valve and Fitting  
Industry, Inc.:
  - SP-67-02a.....Butterfly Valves
  - SP-70-06.....Gray Iron Gate Valves, Flanged and Threaded  
Ends
  - SP-71-05.....Gray Iron Swing Check Valves, Flanged and  
Threaded Ends
  - SP-80-08.....Bronze Gate, Globe, Angle and Check Valves

SP-85-02.....Cast Iron Globe and Angle Valves, Flanged and  
Threaded Ends

SP-110-96.....Ball Valves Threaded, Socket-Welding, Solder  
Joint, Grooved and Flared Ends

SP-125-00.....Gray Iron and Ductile Iron In-line, Spring  
Loaded, Center-Guided Check Valves

K. National Sanitation Foundation/American National Standards Institute,  
Inc. (NSF/ANSI):

14-06.....Plastic Piping System Components and Related  
Materials

50-2009a.....Equipment for Swimming Pools, Spas, Hot Tubs  
and other Recreational Water Facilities -  
Evaluation criteria for materials, components,  
products, equipment and systems for use at  
recreational water facilities

61-2008.....Drinking Water System Components - Health  
Effects

L. Tubular Exchanger Manufacturers Association: TEMA 9th Edition, 2007

## **1.6 SPARE PARTS**

A. For mechanical pressed sealed fittings provide tools required for each  
pipe size used at the facility.

## **PART 2 - PRODUCTS**

### **2.1 PIPE AND EQUIPMENT SUPPORTS, PIPE SLEEVES, AND WALL AND CEILING PLATES**

A. Provide in accordance with Section 23 05 11, COMMON WORK RESULTS FOR  
HVAC and STEAM GENERATION.

### **2.2 PIPE AND TUBING**

A. Chilled Water, Heating Hot Water, and Glycol-Water, and Vent Piping:

1. Steel: ASTM A53 Grade B, seamless or ERW, Schedule 40.
2. Copper water tube option: ASTM B88, Type K or L, hard drawn.

B. Extension of Domestic Water Make-up Piping: ASTM B88, Type K or L, hard  
drawn copper tubing.

C. Cooling Coil Condensate Drain Piping:

1. From air handling units: Copper water tube, ASTM B88, Type M.
2. From fan coil or other terminal units: Copper water tube, ASTM B88,  
Type L for runouts and Type M for mains.

D. Pipe supports, including insulation shields, for above ground piping:  
Section 23 05 11, COMMON WORK RESULTS FOR HVAC.



## **2.3 FITTINGS FOR STEEL PIPE**

- A. 50 mm (2 inches) and Smaller: Screwed or welded joints.
  - 1. Butt welding: ASME B16.9 with same wall thickness as connecting piping.
  - 2. Forged steel, socket welding or threaded: ASME B16.11.
  - 3. Screwed: 150 pound malleable iron, ASME B16.3. 125 pound cast iron, ASME B16.4, may be used in lieu of malleable iron. Bushing reduction of a single pipe size, or use of close nipples, is not acceptable.
  - 4. Unions: ASME B16.39.
  - 5. Water hose connection adapter: Brass, pipe thread to 20 mm (3/4 inch) garden hose thread, with hose cap nut.
- B. 65 mm (2-1/2 inches) and Larger: Welded or flanged joints. Contractor's option: Grooved mechanical couplings and fittings are optional.
  - 1. Butt welding fittings: ASME B16.9 with same wall thickness as connecting piping. Elbows shall be long radius type, unless otherwise noted.
  - 2. Welding flanges and bolting: ASME B16.5:
    - a. Water service: Weld neck or slip-on, plain face, with 6 mm (1/8 inch) thick full face neoprene gasket suitable for 104 degrees C (220 degrees F).
      - 1) Contractor's option: Convoluted, cold formed 150 pound steel flanges, with teflon gaskets, may be used for water service.
    - b. Flange bolting: Carbon steel machine bolts or studs and nuts, ASTM A307, Grade B.
- C. Welded Branch and Tap Connections: Forged steel weldolets, or branchlets and threadolets may be used for branch connections up to one pipe size smaller than the main. Forged steel half-couplings, ASME B16.11 may be used for drain, vent and gage connections.
- D. Grooved Mechanical Pipe Couplings and Fittings (Contractor's Option): Grooved Mechanical Pipe Couplings and Fittings may be used, with cut or roll grooved pipe, in water service up to 110 degrees C (230 degrees F) in lieu of welded, screwed or flanged connections. All joints must be rigid type.
  - 1. Grooved mechanical couplings: Malleable iron, ASTM A47 or ductile iron, ASTM A536, fabricated in two or more parts, securely held together by two or more track-head, square, or oval-neck bolts, ASTM A449 and A183.

2. Gaskets: Rubber product recommended by the coupling manufacturer for the intended service.
3. Grooved end fittings: Malleable iron, ASTM A47; ductile iron, ASTM A536; or steel, ASTM A53 or A106, designed to accept grooved mechanical couplings. Tap-in type branch connections are acceptable.

#### **2.4 FITTINGS FOR COPPER TUBING**

##### **A. Joints:**

1. Solder Joints: Joints shall be made up in accordance with recommended practices of the materials applied. Apply 95/5 tin and antimony on all copper piping.
2. Mechanically formed tee connection in water and drain piping: Form mechanically extracted collars in a continuous operation by drilling pilot hole and drawing out tube surface to form collar, having a height of not less than three times the thickness of tube wall. Adjustable collaring device shall insure proper tolerance and complete uniformity of the joint. Notch and dimple joining branch tube in a single process to provide free flow where the branch tube penetrates the fitting.

##### **B. Bronze Flanges and Flanged Fittings: ASME B16.24.**

##### **C. Fittings: ANSI/ASME B16.18 cast copper or ANSI/ASME B16.22 solder wrought copper.**

#### **2.5 FITTINGS FOR PLASTIC PIPING**

- A. Schedule 40, socket type for solvent welding.
- B. Schedule 40 PVC drain piping: Drainage pattern.
- C. Chemical feed piping for condenser water treatment: Chlorinated polyvinyl chloride (CPVC), Schedule 80, ASTM F439.

#### **2.6 DIELECTRIC FITTINGS**

- A. Provide where copper tubing and ferrous metal pipe are joined.
- B. 50 mm (2 inches) and Smaller: Threaded dielectric union, ASME B16.39.
- C. 65 mm (2 1/2 inches) and Larger: Flange union with dielectric gasket and bolt sleeves, ASME B16.42.
- D. Temperature Rating, 99 degrees C (210 degrees F).
- E. Contractor's option: On pipe sizes 2" and smaller, screwed end brass ball valves may be used in lieu of dielectric unions.

#### **2.7 SCREWED JOINTS**

- A. Pipe Thread: ANSI B1.20.
- B. Lubricant or Sealant: Oil and graphite or other compound approved for the intended service.

## 2.8 VALVES

- A. Asbestos packing is not acceptable.
- B. All valves of the same type shall be products of a single manufacturer.
- C. Provide chain operators for valves 150 mm (6 inches) and larger when the centerline is located 2400 mm (8 feet) or more above the floor or operating platform.
- D. Shut-Off Valves
  - 1. Ball Valves (Pipe sizes 2" and smaller): MSS-SP 110, screwed or solder connections, brass or bronze body with chrome-plated ball with full port and Teflon seat at (600 psig) working pressure rating. Provide stem extension to allow operation without interfering with pipe insulation.
  - 2. Butterfly Valves (Pipe Sizes 2-1/2" and larger): Provide stem extension to allow 50 mm (2 inches) of pipe insulation without interfering with valve operation. MSS-SP 67, flange lug type or grooved end rated 1205 kPa (175 psig) working pressure at 93 degrees C (200 degrees F). Valves shall be ANSI Leakage Class VI and rated for bubble tight shut-off to full valve pressure rating. Valve shall be rated for dead end service and bi-directional flow capability to full rated pressure. Not permitted for direct buried pipe applications.
    - a. Body: Cast iron, ASTM A126, Class B. Malleable iron, ASTM A47 electro-plated, or ductile iron, ASTM A536, Grade 65-45-12 electro-plated.
    - b. Trim: Bronze, aluminum bronze, or 300 series stainless steel disc, bronze bearings, 316 stainless steel shaft and manufacturer's recommended resilient seat. Resilient seat shall be field replaceable, and fully line the body to completely isolate the body from the product. A phosphate coated steel shaft or stem is acceptable, if the stem is completely isolated from the product.
    - c. Actuators: Field interchangeable. Valves for balancing service shall have adjustable memory stop to limit open position.
      - 1) Valves 150 mm (6 inches) and smaller: Lever actuator with minimum of seven locking positions, except where chain wheel is required.
      - 2) Valves 200 mm (8 inches) and larger: Enclosed worm gear with handwheel, and where required, chain-wheel operator.

3) 3. Gate Valves (Contractor's Option in lieu of Ball or Butterfly Valves):

- a) 50 mm (2 inches) and smaller: MSS-SP 80, Bronze, 1034 kPa (150 psig), wedge disc, rising stem, union bonnet.
- b) 65 mm (2 1/2 inches) and larger: Flanged, outside screw and yoke. MSS-SP 70, iron body, bronze mounted, 861 kPa (125 psig) wedge disc.

E. Globe and Angle Valves

1. Globe Valves

- a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.) Globe valves shall be union bonnet with metal plug type disc.
- b. 65 mm (2 1/2 inches) and larger: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-85 for globe valves.

2. Angle Valves:

- a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.) Angle valves shall be union bonnet with metal plug type disc.
- b. 65 mm (2 1/2 inches) and larger: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-85 for angle.

F. Check Valves

1. Swing Check Valves:

- a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.), 45 degree swing disc.
- b. 65 mm (2 1/2 inches) and larger: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-71 for check valves.

2. Non-Slam or Silent Check Valve: Spring loaded double disc swing check or internally guided flat disc lift type check for bubble tight shut-off. Provide where check valves are shown in chilled water and hot water piping. Check valves incorporating a balancing feature may be used.

- a. Body: MSS-SP 125 cast iron, ASTM A126, Class B, or steel, ASTM A216, Class WCB, or ductile iron, ASTM 536, flanged, grooved, or wafer type.
- b. Seat, disc and spring: 18-8 stainless steel, or bronze, ASTM B62. Seats may be elastomer material.

G. Water Flow Balancing Valves: For flow regulation and shut-off. Valves shall be line size rather than reduced to control valve size.

1. Characteristic Ball or Globe style valve.
  2. A dual purpose flow balancing valve and adjustable flow meter, with bronze or cast iron body, calibrated position pointer, valved pressure taps or quick disconnects with integral check valves and preformed polyurethane insulating enclosure.
  3. Provide a readout kit including flow meter, readout probes, hoses, flow charts or calculator, and carrying case.
- H. Automatic Balancing Control Valves: Factory calibrated to maintain constant flow (plus or minus five percent) over system pressure fluctuations of at least 10 times the minimum required for control. Provide standard pressure taps and four sets of capacity charts. Valves shall be line size and be one of the following designs:
1. Gray iron (ASTM A126) or brass body rated 1205 kPa (175 psig) at 93 degrees C (200 degrees F), with stainless steel piston and spring.
  2. Brass or ferrous body designed for 2067 kPa (300 psig) service at 121 degrees C (250 degrees F), with corrosion resistant, tamper proof, self-cleaning piston/spring assembly that is easily removable for inspection or replacement.
  3. Combination assemblies containing ball type shut-off valves, unions, flow regulators, strainers with blowdown valves and pressure temperature ports shall be acceptable.
  4. Provide a readout kit including flow meter, probes, hoses, flow charts and carrying case.
- I. Manual Radiator/Convactor Valves: Brass, packless, with position indicator.

## **2.9 WATER FLOW MEASURING DEVICES**

- A. Minimum overall accuracy plus or minus three percent over a range of 70 to 110 percent of design flow. Select devices for not less than 110 percent of design flow rate.
- B. Venturi Type: Bronze, steel, or cast iron with bronze throat, with valved pressure sensing taps upstream and at the throat.
- C. Wafer Type Circuit Sensor: Cast iron wafer-type flow meter equipped with readout valves to facilitate the connecting of a differential pressure meter. Each readout valve shall be fitted with an integral check valve designed to minimize system fluid loss during the monitoring process.
- D. Self-Averaging Annular Sensor Type: Brass or stainless steel metering tube, shutoff valves and quick-coupling pressure connections. Metering

tube shall be rotatable so all sensing ports may be pointed down-stream when unit is not in use.

E. Insertion Turbine Type Sensor: Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

F. Flow Measuring Device Identification:

1. Metal tag attached by chain to the device.
2. Include meter or equipment number, manufacturer's name, meter model, flow rate factor and design flow rate in l/m (gpm).

G. Portable Water Flow Indicating Meters:

1. Minimum 150 mm (6 inch) diameter dial, forged brass body, beryllium-copper bellows, designed for 1205 kPa (175 psig) working pressure at 121 degrees C (250 degrees F).
2. Bleed and equalizing valves.
3. Vent and drain hose and two 3000 mm (10 feet) lengths of hose with quick disconnect connections.
4. Factory fabricated carrying case with hose compartment and a bound set of capacity curves showing flow rate versus pressure differential.
5. Provide one portable meter for each range of differential pressure required for the installed flow devices.

H. Permanently Mounted Water Flow Indicating Meters: Minimum 150 mm (6 inch) diameter, or 450 mm (18 inch) long scale, for 120 percent of design flow rate, direct reading in lps (gpm), with three valve manifold and two shut-off valves.

## **2.10 STRAINERS**

A. Basket or Y Type.

1. Screens: Bronze, monel metal or 18-8 stainless steel, free area not less than 2-1/2 times pipe area, with perforations as follows: 1.1 mm (0.045 inch) diameter perforations for 100 mm (4 inches) and larger: 3.2 mm (0.125 inch) diameter perforations.

B. Suction Diffusers: Specified in Section 23 21 23, HYDRONIC PUMPS.

## **2.11 FLEXIBLE CONNECTORS FOR WATER SERVICE**

A. Flanged Spool Connector:

1. Single arch or multiple arch type. Tube and cover shall be constructed of chlorobutyl elastomer with full faced integral flanges to provide a tight seal without gaskets. Connectors shall be internally reinforced with high strength synthetic fibers

impregnated with rubber or synthetic compounds as recommended by connector manufacturer, and steel reinforcing rings.

2. Working pressures and temperatures shall be as follows:

- a. Connector sizes 50 mm to 100 mm (2 inches to 4 inches), 1137 kPa (165psig) at 121 degrees C (250 degrees F).
- b. Connector sizes 125 mm to 300 mm (5 inches to 12 inches), 965 kPa (140 psig) at 121 degrees C (250 degrees F).

3. Provide ductile iron retaining rings and control units.

B. Mechanical Pipe Couplings:

See other fittings specified under Part 2, PRODUCTS.

**2.12 EXPANSION JOINTS**

A. Factory built devices, inserted in the pipe lines, designed to absorb axial cyclical pipe movement which results from thermal expansion and contraction. This includes factory-built or field-fabricated guides located along the pipe lines to restrain lateral pipe motion and direct the axial pipe movement into the expansion joints.

B. Manufacturing Quality Assurance: Conform to Expansion Joints Manufacturers Association Standards.

C. Bellows - Internally Pressurized Type:

1. Multiple corrugations of Type 304 or Type A240-321 stainless steel.
2. Internal stainless steel sleeve entire length of bellows.
3. External cast iron equalizing rings for services exceeding 340 kPa (50 psig).
4. Welded ends.
5. Design shall conform to standards of EJMA and ASME B31.1.
6. External tie rods designed to withstand pressure thrust force upon anchor failure if one or both anchors for the joint are at change in direction of pipeline.
7. Integral external cover.

D. Bellows - Externally Pressurized Type:

1. Multiple corrugations of Type 304 stainless steel.
2. Internal and external guide integral with joint.
3. Design for external pressurization of bellows to eliminate squirm.
4. Welded ends.
5. Conform to the standards of EJMA and ASME B31.1.
6. Threaded connection at bottom, 25 mm (one inch) minimum, for drain or drip point.
7. Integral external cover and internal sleeve.

E. Expansion Compensators:

1. Corrugated bellows, externally pressurized, stainless steel or bronze.
2. Internal guides and anti-torque devices.
3. Threaded ends.
4. External shroud.
5. Conform to standards of EJMA.

F. Expansion Joint (Contractor's Option): 350 psig maximum working pressure, steel pipe fitting consisting of telescoping body and slip-pipe sections, PTFE modified polyphenylene sulfide coated slide section, with grooved ends, suitable for axial end movement to 3 inches.

G. Expansion Joint Identification: Provide stamped brass or stainless steel nameplate on each expansion joint listing the manufacturer, the allowable movement, flow direction, design pressure and temperature, date of manufacture, and identifying the expansion joint by the identification number on the contract drawings.

H. Guides: Provide factory-built guides along the pipe line to permit axial movement only and to restrain lateral and angular movement. Guides must be designed to withstand a minimum of 15 percent of the axial force which will be imposed on the expansion joints and anchors. Field-built guides may be used if detailed on the contract drawings.

I. Supports: Provide saddle supports and frame or hangers for heat exchanger. Mounting height shall be adjusted to facilitate gravity return of steam condensate. Construct supports from steel, weld joints.

## **2.13 HYDRONIC SYSTEM COMPONENTS**

A. Heat Exchanger (Water to Water): Shell and tube type, U-bend removable tube bundle, heating fluid in shell, heated fluid in tubes, equipped with support cradles.

1. Maximum tube velocity: 2.3 m/s (7.5 feet per second).
2. Tube fouling factor: TEMA Standards, but not less than 0.001.
3. Materials:
  - a. Shell: Steel.
  - b. Tube sheet and tube supports: Steel or brass.
  - c. Tubes: 20 mm (3/4 inch) OD copper.
  - d. Head or bonnet: Cast iron or steel.



4. Construction: In accordance with ASME Pressure Vessel Code for 861 kPa (125 psig) working pressure for shell and tubes. Provide manufacturer's certified data report, Form No. U-1.

B. Plate and Frame Heat Exchanger:

1. Fixed frame with bolted removable corrugated channel plate assembly, ASME code stamped for 150 psig working pressure.
2. Corrugated channel plates shall be type 316 or 304 stainless steel.
3. Channel plate ports to be double gasketed to prevent mixing or cross-contamination of hot side and cold side fluids. Gaskets to be EPPM.
4. Channel plate carrying bars to be carbon steel with zinc yellow chromate finish.
5. Fixed frame plates and moveable pressure plates to be corrosion resistant epoxy painted carbon steel.
6. Piping connections 2" and smaller to be carbon steel NPT tappings. Piping connections 4" and larger to be studed port design to accept ANSI flange connections. Connection ports to be integral to the frame or pressure plate.
7. Finished units to be provided with OSHA required, formed aluminum splash guards to enclose exterior channel plate and gasket surfaces.
8. Provide two sets of replacement gaskets and provide one set of wrenches for disassembly of plate type heat exchangers.
9. Performance: As scheduled on drawings.

C. Optional Heat Transfer Package: In lieu of field erected individual components, the Contractor may provide a factory or shop assembled package of converters, pumps, and other components supported on a welded steel frame. Refer to Section 23 22 13, STEAM and STEAM CONDENSATE HEATING PIPING, for additional requirements

D. Air Purger: Cast iron or fabricated steel, 861 kPa (125 psig) water working pressure, for in-line installation.

E. Tangential Air Separator: ASME Pressure Vessel Code construction for 861 kPa (125 psig) working pressure, flanged tangential inlet and outlet connection, internal perforated stainless steel air collector tube designed to direct released air into expansion tank, bottom blowdown connection. Provide Form No. U-1. If scheduled on the drawings, provide a removable stainless steel strainer element having 5 mm (3/16 inch) perforations and free area of not less than five times the cross-sectional area of connecting piping.

- F. Diaphragm Type Pre-Pressurized Expansion Tank: ASME Pressure Vessel Code construction for 861 kPa (125 psig) working pressure, welded steel shell, rust-proof coated, with a flexible elastomeric diaphragm suitable for a maximum operating temperature of 116 degrees C (240 degrees F). Provide Form No. U-1. Tank shall be equipped with system connection, drain connection, standard air fill valve and be factory pre-charged to a minimum of 83 kPa (12 psig).
- H. Pressure Reducing Valve (Water): Diaphragm or bellows operated, spring loaded type, with minimum adjustable range of 28 kPa (4 psig) above and below set point. Bronze, brass or iron body and bronze, brass or stainless steel trim, rated 861 kPa (125 psig) working pressure at 107 degrees C (225 degrees F).
- I. Pressure Relief Valve: Bronze or iron body and bronze or stainless steel trim, with testing lever. Comply with ASME Code for Pressure Vessels, Section 8, and bear ASME stamp.
- J. Automatic Air Vent Valves (where shown): Cast iron or semi-steel body, 1034 kPa (150 psig) working pressure, stainless steel float, valve, valve seat and mechanism, minimum 15 mm (1/2 inch) water connection and 6 mm (1/4 inch) air outlet. Air outlet shall be piped to the nearest floor drain.

#### **2.14 WATER FILTERS AND POT CHEMICAL FEEDERS**

See section 23 25 00, HVAC WATER TREATMENT, Article 2.2, CHEMICAL TREATMENT FOR CLOSED LOOP SYSTEMS.

#### **2.15 GAGES, PRESSURE AND COMPOUND**

- A. ASME B40.100, Accuracy Grade 1A, (pressure, vacuum, or compound for air, oil or water), initial mid-scale accuracy 1 percent of scale (Qualify grade), metal or phenolic case, 115 mm (4-1/2 inches) in diameter, 6 mm (1/4 inch) NPT bottom connection, white dial with black graduations and pointer, clear glass or acrylic plastic window, suitable for board mounting. Provide red "set hand" to indicate normal working pressure.
- B. Provide brass lever handle union cock. Provide brass/bronze pressure snubber for gages in water service.
- C. Range of Gages: Provide range equal to at least 130 percent of normal operating range.
  - 1. For condenser water suction (compound): Minus 100 kPa (30 inches Hg) to plus 700 kPa (100 psig).

## **2.16 PRESSURE/TEMPERATURE TEST PROVISIONS**

- A. Pete's Plug: 6 mm (1/4 inch) MPT by 75 mm (3 inches) long, brass body and cap, with retained safety cap, nordel self-closing valve cores, permanently installed in piping where shown, or in lieu of pressure gage test connections shown on the drawings.
- B. Provide one each of the following test items to the Contracting Officers Representative (COR):
  - 1. 6 mm (1/4 inch) FPT by 3 mm (1/8 inch) diameter stainless steel pressure gage adapter probe for extra long test plug. PETE'S 500 XL is an example.
  - 2. 90 mm (3-1/2 inch) diameter, one percent accuracy, compound gage, -- 100 kPa (30 inches) Hg to 700 kPa (100 psig) range.
  - 3. 0 - 104 degrees C (220 degrees F) pocket thermometer one-half degree accuracy, 25 mm (one inch) dial, 125 mm (5 inch) long stainless steel stem, plastic case.

## **2.17 THERMOMETERS**

- A. Mercury or organic liquid filled type, red or blue column, clear plastic window, with 150 mm (6 inch) brass stem, straight, fixed or adjustable angle as required for each in reading.
- B. Case: Chrome plated brass or aluminum with enamel finish.
- C. Scale: Not less than 225 mm (9 inches), range as described below, two degree graduations.
- D. Separable Socket (Well): Brass, extension neck type to clear pipe insulation.
- E. Scale ranges:
  - 1. Chilled Water and Glycol-Water: 0-38 degrees C (32-100 degrees F).
  - 2. Hot Water and Glycol-Water: -1 - 116 degrees C (30-240 degrees F).

## **2.18 FIRESTOPPING MATERIAL**

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

## **2.19 ELECTRICAL HEAT TRACING SYSTEMS**

- A. Systems shall meet requirements of the National Electrical Code (NEC), Section 427.
- B. Provide tracing for outdoor piping subject to freezing temperatures (Below 38 degrees F) as follows:
  - 1. Make-up water up through curb into Penthouse Equipment Module.
  - 2. Sanitary drain lines up through curb/floor drain bodies within Penthouse Equipment Module.

3. Chilled water routed across open rooftops and portions of piping routed up through curb into Penthouse Equipment Module.
  4. Domestic water lines and cooling coil condensate lines exposed to weather.
- C. Heat tracing shall be provided to the extent shown on the drawings (Floor plans and Elevations). Building Automation system/DDC shall be capable of monitoring status of heat tracing service and alarming within control system when heat tracing malfunctions.
- D. Heating Cable: Flexible, parallel circuit construction consisting of a continuous self-limiting resistance, conductive inner core material between two parallel copper bus wires, designed for cut-to-length at the job site and for wrapping around valves and complex fittings. Self-regulation shall prevent overheating and burnouts even where the cable overlaps itself.
1. Provide end seals at ends of circuits. Wire at the ends of the circuits is not to be tied together.
  2. Provide sufficient cable, as recommended by the manufacturer, to keep the pipe surface at 2.2 degrees C (36 degrees F) minimum during winter outdoor design temperature, but not less than the following:
    - a. 75 mm (3 inch) pipe and smaller with 25 mm (1 inch) thick insulation: 4 watts per foot of pipe.
    - b. 100 mm (4 inch) pipe and larger 38 mm (1-1/2 inch) thick insulation: 8 watts per feet of pipe.
- E. Electrical Heating Tracing Accessories:
1. Provide electrical heat trace for new 6" chilled water supply and return piping that offsets on roof above third floor mechanical equipment room and drops down through roof as indicated during Phase 1B. See Phase 1B newwork piping plans.
  2. Power supply connection fitting and stainless steel mounting brackets. Provide stainless steel worm gear clamp to fasten bracket to pipe.
  3. 13 mm (1/2 inch) wide fiberglass reinforced pressure sensitive cloth tape to fasten cable to pipe at 300 mm (12 inch) intervals.
  4. Pipe surface temperature control thermostat: Cast aluminum, NEMA 4 (watertight) enclosure, 13 mm (1/2 inch) NPT conduit hub, SPST switch rated 20 amps at 480 volts AC, with capillary and copper bulb sensor. Set thermostat to maintain pipe surface temperature at not less than 1.1 degrees C (34 degrees F).

5. Electric heat trace control and monitoring system with BAS/DDC interconnectivity.
6. Signs: Manufacturer's standard (NEC Code), stamped "ELECTRIC TRACED" located on the insulation jacket at 3000 mm (10 feet) intervals along the pipe on alternating sides.

### **PART 3 - EXECUTION**

#### **3.1 GENERAL**

- A. The drawings show the general arrangement of pipe and equipment but do not show all required fittings and offsets that may be necessary to connect pipes to equipment, fan-coils, coils, radiators, etc., and to coordinate with other trades. Provide all necessary fittings, offsets and pipe runs based on field measurements and at no additional cost to the government. Coordinate with other trades for space available and relative location of HVAC equipment and accessories to be connected on ceiling grid. Pipe location on the drawings shall be altered by contractor where necessary to avoid interferences and clearance difficulties.
- B. Store materials to avoid excessive exposure to weather or foreign materials. Keep inside of piping relatively clean during installation and protect open ends when work is not in progress.
- C. Support piping securely. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC. Install heat exchangers at height sufficient to provide gravity flow of condensate to the flash tank and condensate pump.
- D. Install piping generally parallel to walls and column center lines, unless shown otherwise on the drawings. Space piping, including insulation, to provide 25 mm (one inch) minimum clearance between adjacent piping or other surface. Unless shown otherwise, slope drain piping down in the direction of flow not less than 25 mm (one inch) in 12 m (40 feet). Provide eccentric reducers to keep bottom of sloped piping flat.
- E. Locate and orient valves to permit proper operation and access for maintenance of packing, seat and disc. Generally locate valve stems in overhead piping in horizontal position. Provide a union adjacent to one end of all threaded end valves. Control valves usually require reducers to connect to pipe sizes shown on the drawing. Install butterfly valves with the valve open as recommended by the manufacturer to prevent binding of the disc in the seat.

- F. Offset equipment connections to allow valving off for maintenance and repair with minimal removal of piping. Provide flexibility in equipment connections and branch line take-offs with 3-elbow swing joints where noted on the drawings.
- G. Tee water piping runouts or branches into the side of mains or other branches. Avoid bull-head tees, which are two return lines entering opposite ends of a tee and exiting out the common side.
- H. Provide manual or automatic air vent at all piping system high points and drain valves at all low points. Install piping to floor drains from all automatic air vents.
- I. Connect piping to equipment as shown on the drawings. Install components furnished by others such as:
  - 1. Water treatment pot feeders and condenser water treatment systems.
  - 2. Flow elements (orifice unions), control valve bodies, flow switches, pressure taps with valve, and wells for sensors.
- J. Thermometer Wells: In pipes 65 mm (2-1/2 inches) and smaller increase the pipe size to provide free area equal to the upstream pipe area.
- K. Firestopping: Fill openings around uninsulated piping penetrating floors or fire walls, with firestop material. For firestopping insulated piping refer to Section 23 07 11, HVAC INSULATION.
- L. Where copper piping is connected to steel piping, provide dielectric connections.

### **3.2 PIPE JOINTS**

- A. Welded: Beveling, spacing and other details shall conform to ASME B31.1 and AWS B2.1. See Welder's qualification requirements under "Quality Assurance" in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Screwed: Threads shall conform to ASME B1.20; joint compound shall be applied to male threads only and joints made up so no more than three threads show. Coat exposed threads on steel pipe with joint compound, or red lead paint for corrosion protection.
- C. Mechanical Joint: Pipe grooving shall be in accordance with joint manufacturer's specifications. Lubricate gasket exterior including lips, pipe ends and housing interiors to prevent pinching the gasket during installation. Lubricant shall be as recommended by coupling manufacturer.
- D. 125 Pound Cast Iron Flange (Plain Face): Mating flange shall have raised face, if any, removed to avoid overstressing the cast iron flange.

E. Solvent Welded Joints: As recommended by the manufacturer.

### **3.3 EXPANSION JOINTS (BELLOWS AND SLIP TYPE)**

- A. Anchors and Guides: Provide type, quantity and spacing as recommended by manufacturer of expansion joint and as shown. A professional engineer shall verify in writing that anchors and guides are properly designed for forces and moments which will be imposed.
- B. Cold Set: Provide setting of joint travel at installation as recommended by the manufacturer for the ambient temperature during the installation.
- C. Preparation for Service: Remove all apparatus provided to restrain joint during shipping or installation. Representative of manufacturer shall visit the site and verify that installation is proper.
- D. Access: Expansion joints must be located in readily accessible space. Locate joints to permit access without removing piping or other devices. Allow clear space to permit replacement of joints and to permit access to devices for inspection of all surfaces and for adding.

### **3.4 LEAK TESTING ABOVEGROUND PIPING**

- A. Inspect all joints and connections for leaks and workmanship and make corrections as necessary, to the satisfaction of the COR. Tests may be either of those below, or a combination, as approved by the COR.
- B. An operating test at design pressure, and for hot systems, design maximum temperature.
- C. A hydrostatic test at 1.5 times design pressure. For water systems the design maximum pressure would usually be the static head, or expansion tank maximum pressure, plus pump head. Factory tested equipment (convertors, exchangers, coils, etc.) need not be field tested. Isolate equipment where necessary to avoid excessive pressure on mechanical seals and safety devices.

### **3.5 FLUSHING AND CLEANING PIPING SYSTEMS**

- A. Water Piping: Clean systems as recommended by the suppliers of chemicals specified in Section 23 25 00, HVAC WATER TREATMENT.
  - 1. Initial flushing: Remove loose dirt, mill scale, metal chips, weld beads, rust, and like deleterious substances without damage to any system component. Provide temporary piping or hose to bypass coils, control valves, exchangers and other factory cleaned equipment unless acceptable means of protection are provided and subsequent inspection of hide-out areas takes place. Isolate or protect clean system components, including pumps and pressure vessels, and remove

- any component which may be damaged. Open all valves, drains, vents and strainers at all system levels. Remove plugs, caps, spool pieces, and components to facilitate early debris discharge from system. Sectionalize system to obtain debris carrying velocity of 1.8 m/S (6 feet per second), if possible. Connect dead-end supply and return headers as necessary. Flush bottoms of risers. Install temporary strainers where necessary to protect down-stream equipment. Supply and remove flushing water and drainage by various type hose, temporary and permanent piping and Contractor's booster pumps. Flush until clean as approved by the COR.
2. Cleaning: Using products supplied in Section 23 25 00, HVAC WATER TREATMENT, circulate systems at normal temperature to remove adherent organic soil, hydrocarbons, flux, pipe mill varnish, pipe joint compounds, iron oxide, and like deleterious substances not removed by flushing, without chemical or mechanical damage to any system component. Removal of tightly adherent mill scale is not required. Keep isolated equipment which is "clean" and where dead-end debris accumulation cannot occur. Sectionalize system if possible, to circulate at velocities not less than 1.8 m/S (6 feet per second). Circulate each section for not less than four hours. Blow-down all strainers, or remove and clean as frequently as necessary. Drain and prepare for final flushing.
  3. Final Flushing: Return systems to conditions required by initial flushing after all cleaning solution has been displaced by clean make-up. Flush all dead ends and isolated clean equipment. Gently operate all valves to dislodge any debris in valve body by throttling velocity. Flush for not less than one hour.

### **3.6 WATER TREATMENT**

- A. Install water treatment equipment and provide water treatment system piping.
- B. Close and fill system as soon as possible after final flushing to minimize corrosion.
- C. Charge systems with chemicals specified in Section 23 25 00, HVAC WATER TREATMENT.
- D. Utilize this activity, by arrangement with the COR, for instructing VA operating personnel.

### **3.7 ELECTRIC HEAT TRACING**

- A. Install tracing as recommended by the manufacturer.



- B. Coordinate electrical connections. Emergency Power required.
- C. Coordinate BAS/control system monitoring points and alarms. See sequences of operation/points lists for additional requirements.

### **3.8 OPERATING AND PERFORMANCE TEST AND INSTRUCTION**

- A. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Adjust red set hand on pressure gages to normal working pressure.

- - - E N D - - -



**SECTION 23 22 13**  
**STEAM AND CONDENSATE HEATING PIPING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Steam, condensate and vent piping inside buildings.

**1.2 RELATED WORK**

- A. General mechanical requirements and items, which are common to more than one section of Division 23: Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Piping insulation: Section 23 07 11, HVAC INSULATION.
- D. Heating Coils and Humidifiers: Section 23 74 43, CUSTOM, OUTDOOR PENTHOUSE EQUIPMENT MODULE/CENTRAL-STATION AIR-HANDLING UNIT and SECTION 23 31 00, HVAC DUCTS AND CASING.
- E. Heating coils: Section 23 82 16, AIR COILS.
- F. Temperature and pressure sensors and valve operators: Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
- G. Commissioning: Section 23 08 00, COMMISSIONING OF HVAC.

**1.3 QUALITY ASSURANCE**

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC, which includes welding qualifications.

**1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
  - 1. Pipe and equipment supports.
  - 2. Pipe and tubing, with specification, class or type, and schedule.
  - 3. Pipe fittings, including miscellaneous adapters and special fittings.
  - 4. Flanges, gaskets and bolting.
  - 5. Valves of all types.
  - 6. Strainers.
  - 7. Pipe alignment guides.
  - 8. Expansion joints.
  - 9. Expansion compensators.
  - 10. All specified steam system components.
  - 11. Gages.
  - 12. Thermometers and test wells.
  - 13. Electric heat tracing systems.
- C. Coordination Drawings: Refer to Article, SUBMITTALS of Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

D. As-Built Piping Diagrams: Provide drawing as follows for steam and steam condensate piping and other HVAC (heating, ventilating and heating hot water generation) equipment.

1. One wall-mounted stick file for prints. Mount stick file in the chiller plant or adjacent control room along with control diagram stick file.
2. One set of reproducible drawings.

#### **1.5 APPLICABLE PUBLICATIONS**

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. American Society of Mechanical Engineers/American National Standards Institute (ASME/ANSI):

B1.20.1-83(R2006).....Pipe Threads, General Purpose (Inch)

B16.4-2006.....Gray Iron Threaded Fittings

C. American Society of Mechanical Engineers (ASME):

B16.1-2005.....Gray Iron Pipe Flanges and Flanged Fittings

B16.3-2006.....Malleable Iron Threaded Fittings

B16.9-2007.....Factory-Made Wrought Buttwelding Fittings

B16.11-2005.....Forged Fittings, Socket-Welding and Threaded

B16.14-91.....Ferrous Pipe Plugs, Bushings, and Locknuts with  
Pipe Threads

B16.22-2001.....Wrought Copper and Copper Alloy Solder-Joint  
Pressure Fittings

B16.23-2002.....Cast Copper Alloy Solder Joint Drainage Fittings

B16.24-2006.....Cast Copper Alloy Pipe Flanges and Flanged  
Fittings, Class 150, 300, 400, 600, 900, 1500  
and 2500

B16.39-98.....Malleable Iron Threaded Pipe Unions, Classes  
150, 250, and 300

B31.1-2007.....Power Piping

B31.9-2008.....Building Services Piping

B40.100-2005.....Pressure Gauges and Gauge Attachments

Boiler and Pressure Vessel Code: SEC VIII D1-2001, Pressure Vessels,  
Division 1

D. American Society for Testing and Materials (ASTM):

A47-99.....Ferritic Malleable Iron Castings

A53-2007.....Pipe, Steel, Black and Hot-Dipped, Zinc-Coated,  
Welded and Seamless

A106-2008.....Seamless Carbon Steel Pipe for High-Temperature  
Service

- A126-2004.....Standard Specification for Gray Iron Castings  
for Valves, Flanges, and Pipe Fittings
- A181-2006.....Carbon Steel Forgings, for General-Purpose  
Piping
- A183-2003 ..... Carbon Steel Track Bolts and Nuts
- A216-2008 ..... Standard Specification for Steel Castings,  
Carbon, Suitable for Fusion Welding, for High  
Temperature Service
- A285-01 ..... Pressure Vessel Plates, Carbon Steel, Low-and-  
Intermediate-Tensile Strength
- A307-2007 ..... Carbon Steel Bolts and Studs, 60,000 PSI Tensile  
Strength
- A516-2006 ..... Pressure Vessel Plates, Carbon Steel, for  
Moderate-and- Lower Temperature Service
- A536-84(2004)e1 ..... Standard Specification for Ductile Iron Castings
- B32-2008 ..... Solder Metal
- B61-2008 ..... Steam or Valve Bronze Castings
- B62-2009 ..... Composition Bronze or Ounce Metal Castings
- B88-2003 ..... Seamless Copper Water Tube
- F439-06 ..... Socket-Type Chlorinated Poly (Vinyl Chloride)  
(CPVC) Plastic Pipe Fittings, Schedule 80
- F441-02(2008) ..... Chlorinated Poly (Vinyl Chloride) (CPVC) Plastic  
Pipe, Schedules 40 and 80
- E. American Welding Society (AWS):
- A5.8-2004.....Filler Metals for Brazing and Braze Welding
- B2.1-00.....Welding Procedure and Performance Qualifications
- F. Manufacturers Standardization Society (MSS) of the Valve and Fitting  
Industry, Inc.:
- SP-67-95.....Butterfly Valves
- SP-70-98.....Cast Iron Gate Valves, Flanged and Threaded Ends
- SP-71-97.....Gray Iron Swing Check Valves, Flanged and  
Threaded Ends
- SP-72-99.....Ball Valves with Flanged or Butt-Welding Ends  
for General Service
- SP-78-98.....Cast Iron Plug Valves, Flanged and Threaded Ends
- SP-80-97.....Bronze Gate, Globe, Angle and Check Valves
- SP-85-94.....Cast Iron Globe and Angle Valves, Flanged and  
Threaded Ends
- G. Military Specifications (Mil. Spec.):
- MIL-S-901D-1989.....Shock Tests, H.I. (High Impact) Shipboard  
Machinery, Equipment, and Systems

H. National Board of Boiler and Pressure Vessel Inspectors (NB): Relieving Capacities of Safety Valves and Relief Valves

I. Tubular Exchanger Manufacturers Association: TEMA 18th Edition, 2000

## **PART 2 - PRODUCTS**

### **2.1 PIPE AND EQUIPMENT SUPPORTS, PIPE SLEEVES, AND WALL AND CEILING PLATES**

A. Provide in accordance with Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

### **2.2 PIPE AND TUBING**

A. Steam Piping: Steel, ASTM A53, Grade B, seamless or ERW; A106 Grade B, Seamless; Schedule 40.

B. Steam Condensate Piping:

1. Concealed above ceiling, in wall or chase: Copper water tube ASTM B88, Type K, hard drawn.

2. All other locations: Copper water tube ASTM B88, Type K, hard drawn; or steel, ASTM A53, Grade B, Seamless or ERW, or A106 Grade B Seamless, Schedule 80.

C. Vent Piping: Steel, ASTM A53, Grade B, seamless or ERW; A106 Grade B, Seamless; Schedule 40, galvanized.

### **2.3 FITTINGS FOR STEEL PIPE**

A. 50 mm (2 inches) and Smaller: Screwed or welded.

1. Butt welding: ASME B16.9 with same wall thickness as connecting piping.

2. Forged steel, socket welding or threaded: ASME B16.11.

3. Screwed: 150 pound malleable iron, ASME B16.3. 125 pound cast iron, ASME B16.4, may be used in lieu of malleable iron, except for steam and steam condensate piping. Provide 300 pound malleable iron, ASME B16.3 for steam and steam condensate piping. Cast iron fittings or piping is not acceptable for steam and steam condensate piping. Bushing reduction of a single pipe size, or use of close nipples, is not acceptable.

4. Unions: ASME B16.39.

5. Steam line drip station and strainer quick-couple blowdown hose connection: Straight through, plug and socket, screw or cam locking type for 15 mm (1/2 inch) ID hose. No integral shut-off is required.

B. 65 mm (2-1/2 inches) and Larger: Welded or flanged joints.

1. Butt welding fittings: ASME B16.9 with same wall thickness as connecting piping. Elbows shall be long radius type, unless otherwise noted.

2. Welding flanges and bolting: ASME B16.5:

a. Steam service: Weld neck or slip-on, raised face, with non-asbestos gasket. Non-asbestos gasket shall either be stainless

steel spiral wound strip with flexible graphite filler or compressed inorganic fiber with nitrile binder rated for saturated and superheated steam service 750 degrees F and 1500 psi.

- b. Flange bolting: Carbon steel machine bolts or studs and nuts, ASTM A307, Grade B.
- C. Welded Branch and Tap Connections: Forged steel weldolets, or branchlets and threadolets may be used for branch connections up to one pipe size smaller than the main. Forged steel half-couplings, ASME B16.11 may be used for drain, vent and gage connections.

## **2.4 FITTINGS FOR COPPER TUBING**

- A. Solder Joint:
  - 1. Joints shall be made up in accordance with recommended practices of the materials applied. Apply 95/5 tin and antimony on all copper piping.
- B. Bronze Flanges and Flanged Fittings: ASME B16.24.
- C. Fittings: ANSI/ASME B16.18 cast copper or ANSI/ASME B16.22 solder wrought copper.

## **2.5 DIELECTRIC FITTINGS**

- A. Provide where copper tubing and ferrous metal pipe are joined.
- B. 50 mm (2 inches) and Smaller: Threaded dielectric union, ASME B16.39.
- C. 65 mm (2 1/2 inches) and Larger: Flange union with dielectric gasket and bolt sleeves, ASME B16.42.
- D. Temperature Rating, 121 degrees C (250 degrees F) for steam condensate and as required for steam service.
- E. Contractor's option: On pipe sizes 2" and smaller, screwed end brass gate valves may be used in lieu of dielectric unions.

## **2.6 SCREWED JOINTS**

- A. Pipe Thread: ANSI B1.20.
- B. Lubricant or Sealant: Oil and graphite or other compound approved for the intended service.

## **2.7 VALVES**

- A. Asbestos packing is not acceptable.
- B. All valves of the same type shall be products of a single manufacturer.
- C. Provide chain operators for valves 150 mm (6 inches) and larger when the centerline is located 2100 mm (7 feet) or more above the floor or operating platform.
- D. Shut-Off Valves
  - 1. Gate Valves:
    - a. 50 mm (2 inches) and smaller: MSS-SP80, Bronze, 1034 kPa (150 lb.), wedge disc, rising stem, union bonnet.
    - b. 65 mm (2 1/2 inches) and larger: Flanged, outside screw and yoke.

- 1) High pressure steam 413 kPa (60 psig) and above nominal MPS system): Cast steel body, ASTM A216 grade WCB, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel solid disc and seats. Provide 25 mm (1 inch) factory installed bypass with globe valve on valves 100 mm (4 inches) and larger.
- 2) All other services: MSS-SP 70, iron body, bronze mounted, 861 kPa (125 psig) wedge disc.

E. Globe and Angle Valves:

1. Globe Valves:

- a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.) Globe valves shall be union bonnet with metal plug type disc.
- b. 65 mm (2 1/2 inches) and larger:
  - 1) Globe valves for high pressure steam 413 kPa (60 psig) and above nominal MPS system): Cast steel body, ASTM A216 grade WCB, flanged, OS&Y, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel disc and renewable seat rings.
  - 2) All other services: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-85 for globe valves.

2. Angle Valves

- a. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 lb.) Angle valves shall be union bonnet with metal plug type disc.
- b. 65 mm (2 1/2 inches) and larger:
  - 1) Angle valves for high pressure steam 413 kPa (60 psig) and above nominal MPS system): Cast steel body, ASTM A216 grade WCB, flanged, OS&Y, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel disc and renewable seat rings.
  - 2) All other services: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-85 for angle valves.

F. Swing Check Valves

1. 50 mm (2 inches) and smaller: MSS-SP 80, bronze, 1034 kPa (150 psig), 45 degree swing disc.
2. 65 mm (2-1/2 inches) and Larger:
  - a. Check valves for high pressure steam 413 kPa (60 psig) and above nominal MPS system: Cast steel body, ASTM A216 grade WCB, flanged, OS&Y, 1034 kPa (150 psig) at 260 degrees C (500 degrees F), 11-1/2 to 13 percent chrome stainless steel disc and renewable seat rings.



- b. All other services: 861 kPa (125 psig), flanged, iron body, bronze trim, MSS-SP-71 for check valves.

## **2.8 STRAINERS**

- A. Basket or Y Type. Tee type is acceptable for gravity flow and pumped steam condensate service.
- B. All Other Services: Rated 861 kPa (125 psig) saturated steam.
  - 1. 50 mm (2 inches) and smaller: Cast iron or bronze.
  - 2. 65 mm (2-1/2 inches) and larger: Flanged, iron body.
- C. Screens: Bronze, monel metal or 18-8 stainless steel, free area not less than 2-1/2 times pipe area, with perforations as follows:
  - 1. 75 mm (3 inches) and smaller: 20 mesh for steam and 1.1 mm (0.045 inch) diameter perforations for liquids.
  - 2. 100 mm (4 inches) and larger: 1.1 mm (0.045) inch diameter perforations for steam and 3.2 mm (0.125 inch) diameter perforations for liquids.

## **2.9 PIPE ALIGNMENT**

- A. Guides: Provide factory-built guides along the pipe line to permit axial movement only and to restrain lateral and angular movement. Guides must be designed to withstand a minimum of 15 percent of the axial force which will be imposed on the expansion joints and anchors. Field-built guides may be used if detailed on the contract drawings.

## **2.10 STEAM SYSTEM COMPONENTS**

- A. Safety Valves and Accessories: Comply with ASME Boiler and Pressure Vessel Code, Section VIII. Capacities shall be certified by National Board of Boiler and Pressure Vessel Inspectors, maximum accumulation 10 percent. Provide lifting lever. Provide drip pan elbow where shown.
- B. Steam Trap: Each type of trap shall be the product of a single manufacturer. Provide trap sets at all low points and at 61 m (200 feet) intervals on the horizontal main lines.
  - 1. Floats and linkages shall provide sufficient force to open trap valve over full operating pressure range available to the system. Unless otherwise indicated on the drawings, traps shall be sized for capacities indicated at minimum pressure drop as follows:
    - a. For equipment with modulating control valve: 1.7 kPa (1/4 psig), based on a condensate leg of 300 mm (12 inches) at the trap inlet and gravity flow to the receiver.
    - b. For main line drip trap sets and other trap sets at steam pressure: Up to 70 percent of design differential pressure. Condensate may be lifted to the return line.
  - 2. Trap bodies: Bronze, cast iron, or semi-steel, constructed to permit ease of removal and servicing working parts without disturbing

connecting piping. For systems without relief valve traps shall be 5.

Mechanism: Brass, stainless steel or corrosion resistant alloy.  
rated for the pressure upstream of the PRV supplying the system.

3. Balanced pressure thermostatic elements: Phosphor bronze, stainless steel or monel metal.

4. Valves and seats: Suitable hardened corrosion resistant alloy.

5. Floats: Stainless steel.

6. Inverted bucket traps: Provide bi-metallic thermostatic element for rapid release of non-condensables.

C. Thermostatic Air Vent (Steam): Brass or iron body, balanced pressure bellows, stainless steel (renewable) valve and seat, rated 861 kPa (125 psig) working pressure, 20 mm (3/4 inch) screwed connections. Air vents shall be balanced pressure type that responds to steam pressure-temperature curve and vents air at any pressure.

D. Steam Humidifiers: (JACKETED)

1. Steam separator type that discharges steam into the air stream through a steam jacketed distribution manifold or dispersion tube. Humidifiers shall be complete with Y-type steam supply strainer; modulating, normally closed steam control valve; normally closed condensate temperature switch; and manufacturer's standard steam trap.

2. Distribution manifold: Stainless steel, composed of dispersion pipe and surrounding steam jacket, manifold shall span the width of duct or air handler, and shall be multiple manifold type under any of the following conditions:

a. Duct section height exceeds 900 mm (36 inches).

b. Duct air velocity exceeds 5.1 m/s (1000 feet per minute).

c. If within 900 mm (3 feet) upstream of fan, damper or pre-filter.

d. If within 3000 mm (10 feet) upstream of after-filter.

E. Steam Humidifiers (Non-Jacketed - AHU Air Tunnel Mounted)

1. Short Absorption Manifold Designed for atmospheric steam humidifiers to directly inject the steam into AHU air tunnel for humidification.

a. Steam dispersion panel consisting of a horizontal stainless steel header / separator supplying steam to bank of closely spaced vertical tubes as necessary to meet absorption distance requirements, and to reduce condensation losses.

b. Single horizontal stainless steel header to provide steam to vertical distributor tubes and to reduce condensation losses.

Systems needing to be installed on a partition or requiring blank-off plates are not acceptable.

- c. Header / separator design is primarily round tube to minimize pressure drop.
- d. Steam inlet and condensate return located on the same side and at the bottom of the header to allow single point entry and floor mounting.
- e. Headers are of 304 stainless steel construction.
- f. Vertical stainless steel distribution tubes to promote condensate evacuation. Horizontal distributor tubes are not accepted.
- g. All tubes are available in 304 stainless steel construction.
- h. Stainless steel nozzle inserts ensure condensate free steam is discharged from the center of the distribution tubes.  
Systems without nozzle inserts, or other than stainless steel, are not acceptable.
- i. Stainless steel nozzle inserts shall have metered orifices, sized to provide even distribution of the discharged steam, spaced for optimum steam absorption.
- j. Tubes and headers shall accommodate factory installation or field retrofit of optional insulation for increased energy efficiency.

#### **2.11 GAGES, PRESSURE AND COMPOUND**

- A. ASME B40.1, Accuracy Grade 1A, (pressure, vacuum, or compound), initial mid-scale accuracy 1 percent of scale (Qualify grade), metal or phenolic case, 115 mm (4-1/2 inches) in diameter, 6 mm (1/4 inch) NPT bottom connection, white dial with black graduations and pointer, clear glass or acrylic plastic window, suitable for board mounting. Provide red "set hand" to indicate normal working pressure.
- B. Provide brass, lever handle union cock. Provide brass/bronze pressure snubber for gages in water service. Provide brass pigtail syphon for steam gages.
- C. Range of Gages: For services not listed provide range equal to at least 130 percent of normal operating range:

Low pressure steam and steam condensate to 103 kPa(15 psig)	0 to 207 kPa (30 psig).
Medium pressure steam and steam condensate nominal 413 kPa (60 psig)	0 to 689 kPa (100 psig).
Steam condensate, gravity or vacuum (30" HG to 30 psig)	0 to 415 kPa (60 psig)

## **2.12 PRESSURE/TEMPERATURE TEST PROVISIONS**

- A. Provide one each of the following test items to the Resident Engineer:
1. 6 mm (1/4 inch) FPT by 3 mm (1/8 inch) diameter stainless steel pressure gage adapter probe for extralong test plug. PETE'S 500 XL is an example.
  2. 90 mm (3-1/2 inch) diameter, one percent accuracy, compound gage, 762 mm (30 inches) Hg to 689 kPa (100 psig) range.
  3. 0 - 104 degrees C (32-220 degrees F) pocket thermometer one-half degree accuracy, 25 mm (one inch) dial, 125 mm (5 inch) long stainless steel stem, plastic case.

## **2.13 FIRESTOPPING MATERIAL**

- A. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

## **PART 3 - EXECUTION**

### **3.1 GENERAL**

- A. The drawings show general arrangement of pipe and equipment but do not show all required fittings and offsets that may be necessary to connect pipes to equipment, fan-coils, coils, radiators, etc., and to coordinate with other trades. Provide all necessary fittings, offsets and pipe runs based on field measurements and at no additional cost to the government. Coordinate with other trades for space available and relative location of HVAC equipment and accessories to be connected on ceiling grid. Pipe location on the drawings shall be altered by contractor where necessary to avoid interferences and clearance difficulties.
- B. Store materials to avoid excessive exposure to weather or foreign materials. Keep inside of piping relatively clean during installation and protect open ends when work is not in progress.
- C. Support piping securely. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC. Install convertors and other heat exchangers at height sufficient to provide gravity flow of condensate to the flash tank and condensate pump.
- D. Install piping generally parallel to walls and column center lines, unless shown otherwise on the drawings. Space piping, including insulation, to provide 25 mm (one inch) minimum clearance between adjacent piping or other surface. Unless shown otherwise, slope steam, condensate and drain piping down in the direction of flow not less than 25 mm (one inch) in 12 m (40 feet). Provide eccentric reducers to keep bottom of sloped piping flat.
- E. Locate and orient valves to permit proper operation and access for maintenance of packing, seat and disc. Generally locate valve stems in

overhead piping in horizontal position. Provide a union adjacent to one end of all threaded end valves. Control valves usually require reducers to connect to pipe sizes shown on the drawing. Install butterfly valves with the valve open as recommended by the manufacturer to prevent binding of the disc in the seat.

- F. Offset equipment connections to allow valving off for maintenance and repair with minimal removal of piping. Provide flexibility in equipment connections and branch line take-offs with 3-elbow swing joints where noted on the drawings.
- G. Tee water piping runouts or branches into the side of mains or other branches. Avoid bull-head tees, which are two return lines entering opposite ends of a tee and exiting out the common side.
- H. Connect piping to equipment as shown on the drawings. Install components furnished by others such as:
  - 1. Flow elements (orifice unions), control valve bodies, flow switches, pressure taps with valve, and wells for sensors.
- I. Firestopping: Fill openings around uninsulated piping penetrating floors or fire walls, with firestop material. For firestopping insulated piping refer to Section 23 07 11, HVAC, PLUMBING, and BOILER PLANT INSULATION.
- J. Where copper piping is connected to steel piping, provide dielectric connections.
- K. Pipe vents to the exterior. Where a combined vent is provided, the cross sectional area of the combined vent shall be equal to sum of individual vent areas. Slope vent piping one inch in 40 feet (0.25 percent) in direction of flow. Provide a drip trap elbow on relief valve outlets if the vent rises to prevent backpressure. Terminate vent minimum 0.3 M (12 inches) above the roof or through the wall minimum 2.5 M (8 feet) above grade with down turned elbow.
- L. Humidifiers mounted within AHU air tunnels shall be mounted high within the tunnel to allow for proper condensate trapping outside AHU tunnel and within the AHU to AHU drain pan as indicated by humidifier piping details. AHU tunnel shall include 304 stainless steel safing around the humidifier dispersion tube assembly to prevent bypass of air around the humidifier/improve moisture absorption into supply air. Coordinate all piping and safing requirements based on manufacturer recommendations.

### **3.2 PIPE JOINTS**

- A. Welded: Beveling, spacing and other details shall conform to ASME B31.1 and AWS B2.1. See Welder's qualification requirements under "Quality Assurance" in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

- B. Screwed: Threads shall conform to ASME B1.20; joint compound shall be applied to male threads only and joints made up so no more than three threads show. Coat exposed threads on steel pipe with joint compound, or red lead paint for corrosion protection.
- C. 125 Pound Cast Iron Flange (Plain Face): Mating flange shall have raised face, if any, removed to avoid overstressing the cast iron flange.

### **3.3 STEAM TRAP PIPING**

- A. Install to permit gravity flow to the trap. Provide gravity flow (avoid lifting condensate) from the trap where modulating control valves are used. Support traps weighing over 11 kg (25 pounds) independently of connecting piping.

### **3.4 LEAK TESTING**

- A. Inspect all joints and connections for leaks and workmanship and make corrections as necessary, to the satisfaction of the Resident Engineer/COR in accordance with the specified requirements. Testing shall be performed prior to piping insulation in accordance with the specification requirements.
- B. An operating test at design maximum pressure and design maximum temperature.
- C. A hydrostatic test at 1.5 times design pressure. For water systems the design maximum pressure would usually be the static head, or expansion tank maximum pressure, plus pump head. Factory tested equipment (convertors, exchangers, coils, etc.) need not be field tested. Avoid excessive pressure on mechanical seals and safety devices.

### **3.5 FLUSHING AND CLEANING PIPING SYSTEMS**

- A. Steam, Condensate and Vent Piping: No flushing or chemical cleaning required. Accomplish cleaning by pulling all strainer screens and cleaning all scale/dirt legs during start-up operation.

### **3.6 OPERATING AND PERFORMANCE TEST AND INSTRUCTION**

- A. Refer to PART 3, Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Adjust red set hand on pressure gages to normal working pressure.

- - - E N D - - -

**SECTION 23 25 00**  
**HVAC WATER TREATMENT**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies cleaning and treatment of circulating HVAC water systems, including the following.
1. Cleaning compounds.
  2. Chemical treatment for closed loop heat transfer systems.
  3. Glycol-water heat transfer systems.

**1.2 RELATED WORK**

- A. Test requirements and instructions on use of equipment/system: Section 01 00 00, GENERAL REQUIREMENTS.
- B. General mechanical requirements and items, which are common to more than one section of Division 23: Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- C. Piping and valves: Section 23 21 13, HYDRONIC PIPING and Section 23 22 13, STEAM and CONDENSATE HEATING PIPING.
- D. Heating Hot Water and Chilled Water: Section 23 74 43, CUSTOM, OUTDOOR PENTHOUSE EQUIPMENT MODULE/CENTRAL-STATION AIR-HANDLING UNIT.

**1.3 QUALITY ASSURANCE**

- A. Refer to paragraph, QUALITY ASSURANCE in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Technical Services: Provide the services of an experienced water treatment chemical engineer or technical representative to direct flushing, cleaning, pre-treatment, training, debugging, and acceptance testing operations; direct and perform chemical limit control during construction period and monitor systems for a period of 12 months after acceptance, including not less than 6 service calls and written status reports. Emergency calls are not included. Minimum service during construction/start-up shall be 6 hours. Coordinate minimum service requirements during construction/start-up with commissioning efforts and VAMC as specified in Section 23 08 00, COMMISSIONING OF HVAC.
- C. Field Quality Control and Certified Laboratory Reports: During the one year guarantee period, the water treatment laboratory shall provide not less than 12 reports based on on-site periodic visits, as stated in paragraph 1.3.B, sample taking and testing, and review with VA personnel, of water treatment control for the previous period. In

addition to field tests, the water treatment laboratory shall provide certified laboratory test reports. These monitoring reports shall assess chemical treatment accuracy, scale formation, fouling and corrosion control, and shall contain instructions for the correction of any out-of-control condition.

- D. Log Forms: Provide one year supply of preprinted water treatment test log forms.
- E. Chemicals: Chemicals shall be non-toxic approved by local authorities and meeting applicable EPA requirements.

#### **1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data including:
  - 1. Cleaning compounds and recommended procedures for their use.
  - 2. Chemical treatment for closed systems, including installation and operating instructions.
  - 3. Glycol-water system materials, equipment, and installation.
- C. Water analysis verification.
- D. Materials Safety Data Sheet for all proposed chemical compounds, based on U.S. Department of Labor Form No. L5B-005-4.
- E. Maintenance and operating instructions in accordance with Section 01 00 00, GENERAL REQUIREMENTS.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. The publication listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. National Fire Protection Association (NFPA):  
70-2008.....National Electric Code (NEC)
- C. American Society for Testing and Materials (ASTM):  
F441/F441M-02 (2008) ... Standard Specification for Chlorinated Poly  
(Vinyl Chloride) (CPVC) Plastic Pipe, Schedules  
40 and 80

### **PART 2 - PRODUCTS**

#### **2.1 CLEANING COMPOUNDS**

- A. Alkaline phosphate or non-phosphate detergent/surfactant/specific to remove organic soil, hydrocarbons, flux, pipe mill varnish, pipe compounds, iron oxide, and like deleterious substances, with or without



inhibitor, suitable for system wetted metals without deleterious effects.

- B. All chemicals to be acceptable for discharge to sanitary sewer.
- C. Refer to Section 23 21 13, HYDRONIC PIPING and Section 23 22 13, STEAM and CONDENSATE HEATING PIPING, PART 3, for flushing and cleaning procedures.

## **2.2 CHEMICAL TREATMENT FOR CLOSED LOOP SYSTEMS**

- A. Inhibitor: Provide sodium nitrite/borate, molybdate-based inhibitor or other approved compound suitable for make-up quality and make-up rate and which will cause or enhance bacteria/corrosion problems or mechanical seal failure due to excessive total dissolved solids. Shot feed manually. Maintain inhibitor residual as determined by water treatment laboratory, taking into consideration residual and temperature effect on pump mechanical seals.
- B. pH Control: Inhibitor formulation shall include adequate buffer to maintain pH range of 8.0 to 10.5.
- C. Performance: Protect various wetted, coupled, materials of construction including ferrous, and red and yellow metals. Maintain system essentially free of scale, corrosion, and fouling. Corrosion rate of following metals shall not exceed specified mills per year penetration; ferrous, 0-2; brass, 0-1; copper, 0-1. Inhibitor shall be stable at equipment skin surface temperatures and bulk water temperatures of not less than 121 degrees C (250 degrees F) and 52 degrees C (125 degrees Fahrenheit) respectively. Heat exchanger fouling and capacity reduction shall not exceed that allowed by fouling factor 0.0005.
- D. Pot Feeder: By-pass type, complete with necessary shut off valves, drain and air release valves, and system connections, for introducing chemicals into system, cast iron or steel tank with funnel or large opening on top for easy chemical addition. Feeders shall be 18.9 L (five gallon) minimum capacity at 860 kPa (125 psig) minimum working pressure.
- E. Side stream Water Filter for Closed Loop Systems: Stainless steel housing, and polypropylene filter media with stainless steel core. Filter media shall be compatible with antifreeze and water treatment chemicals used in the system. Replaceable filter cartridges for sediment removal service with minimum 20 micrometer particulate at 98 percent efficiency for approximately five (5) percent of system design flow rate. Filter cartridge shall have a maximum pressure drop of 13.8

kPa (2 psig) at design flow rate when clean, and maximum pressure drop of 172 kPa (25 psig) when dirty. A constant flow rate valve shall be provided in the piping to the filter. Inlet and outlet pressure gauges shall be provided to monitor filter condition.

### **2.3 GLYCOL-WATER SYSTEM**

- A. Propylene glycol shall be inhibited with 1.75 percent dipotassium phosphate. Do not use automotive anti-freeze because the inhibitors used are not needed and can cause sludge precipitate that interferes with heat transfer.
- B. Provide and verify the required amount of glycol to obtain the percent by volume for glycol-water systems as follows and to provide one-half tank reserve supply: Coordinate glycol-water percent by volume with VAMC based upon the existing system being extended to the project renovation area or reused to serve the renovation area. Examples: Chilled water extended to new rooftop Penthouse Equipment Module, Existing run-around coil systems for AC-8/EF-8 and AC-10/EF-10 that are to be utilized to serve new PACU and PRE-OP areas of the renovated surgical facility.
- C. Pot Feeder Make-up Unit: By pass type for chemical treatment, schedule 3.5 mm (10 gauge) heads, 20 mm (3/4-inch) system connections and large neck opening for chemical addition. Feeders shall be 19 Liters (5 gallon) minimum size.
- D. Glycol-Water Make-up System:
  - 1. Glycol-Water storage tank: Self-supporting polyethylene, minimum 90 mil thickness, with removable cover or black steel with 90 mil polyethylene insert. Capacity shall be 213 L (55 gallons), with approximate diameter of 584 mm (23 inches) and height of 914 mm (36 inches). Reinforced threaded pipe connections shall be provided for all connections. Provide identification for tank showing name of the contents.
  - 2. Glycol-Water make-up pump: Bronze fitted, self-priming, high head type suitable for pumping a 33 percent to 50 percent glycol-water solution in intermittent service. The pump shall be provided with a mechanical shaft seal and be flange connected to a 1750 rpm NEMA type C motor.
  - 3. Back pressure regulating valve: Spring loaded, diaphragm actuated type with bronze or steel body, stainless steel trim with capacity to relieve 100 percent of pump flow with an allowable rise in the

regulated pressure of 69 kPa (10 psig) above the set point. Set point shall be 103 kPa (15 psig) above system PRV setting.

4. Low water level control: Steel or plastic float housing, stainless steel or plastic float, positive snap-acting SPST switch mechanism, rated 10 amps-120 volt AC, in General Purpose (NEMA 1) enclosure. The control shall be rated for pressures to 1034 kPa (150 psig) and make alarm circuit on low water level. The alarm circuit shall be wired to an alarm light on the nearest local Temperature Control panel (LTCP). Provide remote output relay to indicate alarm condition at the Building Control System specified under Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

## **2.4 EQUIPMENT AND MATERIALS IDENTIFICATION**

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Delivery and Storage: Deliver all chemicals in manufacturer's sealed shipping containers. Store in designated space and protect from deleterious exposure and hazardous spills.
- B. Install equipment furnished by the chemical treatment supplier and charge systems according to the manufacturer's instructions and as directed by the Technical Representative.
- C. Refer to Section 23 21 13 HYDRONIC PIPING for chemical treatment piping, installed as follows:
  1. Provide a by-pass line around water meters and bleed off piping assembly. Provide ball valves to allow for bypassing, isolation, and servicing of components.
  2. Bleed off water piping with bleed off piping assembly shall be piped from pressure side of circulating water piping to a convenient drain. Bleed off connection to main circulating water piping shall be upstream of chemical injection nozzles.
  3. Provide piping for the flow assembly piping to the main control panel and accessories.
    - a. The inlet piping shall connect to the discharge side of the circulating water pump.
    - b. The outlet piping shall connect to the water piping serving the cooling tower downstream of the heat source.

- c. Provide inlet Y-strainer and ball valves to isolate and service main control panel and accessories.
- 4. Provide installation supervision, start-up and operating instruction by manufacturer's technical representative.
- D. Before adding cleaning chemical to the closed system, all air handling coils and fan coil units should be isolated by closing the inlet and outlet valves and opening the bypass valves. This is done to prevent dirt and solids from lodging the coils.
- E. Do not valve in or operate system pumps until after system has been cleaned.
- F. After chemical cleaning is satisfactorily completed, open the inlet and outlet valves to each coil and close the by-pass valves. Also, clean all strainers.
- G. Perform tests and report results in accordance with Section 01 00 00, GENERAL REQUIREMENTS.
- H. After cleaning is complete, and water PH is acceptable to manufacturer of water treatment chemical, add manufacturer-recommended amount of chemicals to systems.
- I. Penthouse Equipment Module manufacturer shall ensure that this specification section is followed for Packaged Heat Transfer and Pumping System (1S-HTPS-16) / heating hot water (reheat) system within the PEM and the extensions of chilled water system supply/return piping up to and within the PEM to the new surgical AHU cooling coils.
- I. Instruct VA personnel in system maintenance and operation in accordance with Section 01 00 00, GENERAL REQUIREMENTS.

- - - E N D - - -

**SECTION 23 31 00**  
**HVAC DUCTS AND CASINGS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Ductwork and accessories for HVAC including the following:
  - 1. Supply air, return air, outside air, exhaust, make-up air, and relief systems.
  - 2. Exhaust duct with HEPA filters for Negative Pressure Isolation Room.
  - 3. Exhaust duct for nuclear medicine laboratory fume hood and "wet exhaust" ducts.
- B. Definitions:
  - 1. SMACNA Standards as used in this specification means the HVAC Duct Construction Standards, Metal and Flexible.
  - 2. Seal or Sealing: Use of liquid or mastic sealant, with or without compatible tape overlay, or gasketing of flanged joints, to keep air leakage at duct joints, seams and connections to an acceptable minimum.
  - 3. Duct Pressure Classification: SMACNA HVAC Duct Construction Standards, Metal and Flexible.
  - 4. Exposed Duct: Exposed to view in a finished room.

**1.2 RELATED WORK**

- A. Fire Stopping Material: Section 07 84 00, FIRESTOPPING.
- B. Outdoor and Exhaust Louvers: Section 08 90 00, LOUVERS and VENTS.
- D. General Mechanical Requirements: Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- E. Noise Level Requirements: Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.
- F. Duct Insulation: Section 23 07 11, HVAC INSULATION
- G. Plumbing Connections: Section 22 11 00, FACILITY WATER DISTRIBUTION
- H. Air Flow Control Valves and Air Terminal Units: Section 23 36 00, AIR TERMINAL UNITS.
- I. Duct Mounted Coils: Section 23 82 16, AIR COILS.
- J. AHU Supply and Return Fans, Section 23 74 43, CUSTOM, OUTDOOR PENTHOUSE EQUIPMENT MODULE/CENTRAL-STATION AIR-HANDLING UNIT.
- K. Return/Relief Air and Exhaust Air Fans: Section 23 34 00, HVAC FANS.
- L. Air Filters and Filters' Efficiencies: Section 23 40 00, HVAC AIR CLEANING DEVICES.
- M. Duct Mounted Instrumentation: Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

N. Testing and Balancing of Air Flows: Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC.

O. Smoke Detectors: Section 28 31 00, FIRE DETECTION and ALARM.

### **1.3 QUALITY ASSURANCE**

- A. Refer to article, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC and STEAM GENERATION.
- B. Fire Safety Code: Comply with NFPA 90A.
- C. Duct System Construction and Installation: Referenced SMACNA Standards are the minimum acceptable quality.
- D. Duct Sealing, Air Leakage Criteria, and Air Leakage Tests: Ducts shall be sealed as per duct sealing requirements of SMACNA HVAC Air Duct Leakage Test Manual for duct pressure classes shown on the drawings.
- E. Duct accessories exposed to the air stream, such as dampers of all types (except smoke dampers) and access openings, shall be of the same material as the duct or provide at least the same level of corrosion resistance.

### **1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
  - 1. Rectangular ducts:
    - a. Schedules of duct systems, materials and selected SMACNA construction alternatives for joints, sealing, gage and reinforcement.
    - b. Duct liner.
    - c. Sealants and gaskets.
    - d. Access doors.
  - 2. Round and flat oval duct construction details:
    - a. Manufacturer's details for duct fittings.
    - b. Duct liner.
    - c. Sealants and gaskets.
    - d. Access sections.
    - e. Installation instructions.
  - 3. Volume dampers, back draft dampers, barometric pressure relief/intake dampers.
  - 4. Upper hanger attachments.
  - 5. Fire dampers, fire doors, and smoke dampers with installation instructions.
  - 6. Sound attenuators, including pressure drop and acoustic performance.
  - 7. Flexible ducts and clamps, with manufacturer's installation instructions.

8. Flexible connections.
  9. Instrument test fittings.
  10. Details and design analysis of alternate or optional duct systems.
  11. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- C. Coordination Drawings: Refer to article, SUBMITTALS, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Civil Engineers (ASCE):
- ASCE7-05.....Minimum Design Loads for Buildings and Other Structures
- C. American Society for Testing and Materials (ASTM):
- A167-99(2009).....Standard Specification for Stainless and Heat-Resisting Chromium-Nickel Steel Plate, Sheet, and Strip
- A653-09.....Standard Specification for Steel Sheet, Zinc-Coated (Galvanized) or Zinc-Iron Alloy coated (Galvannealed) by the Hot-Dip process
- A1011-09a.....Standard Specification for Steel, Sheet and Strip, Hot rolled, Carbon, structural, High-Strength Low-Alloy, High Strength Low-Alloy with Improved Formability, and Ultra-High Strength
- B209-07.....Standard Specification for Aluminum and Aluminum-Alloy Sheet and Plate
- C1071-05e1.....Standard Specification for Fibrous Glass Duct Lining Insulation (Thermal and Sound Absorbing Material)
- E84-09a.....Standard Test Method for Surface Burning Characteristics of Building Materials
- D. National Fire Protection Association (NFPA):
- 90A-09.....Standard for the Installation of Air Conditioning and Ventilating Systems
- 96-08.....Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations
- E. Sheet Metal and Air Conditioning Contractors National Association (SMACNA):
- 2nd Edition - 2005.....HVAC Duct Construction Standards, Metal and Flexible
- 1st Edition - 1985.....HVAC Air Duct Leakage Test Manual

6th Edition - 2003.....Fibrous Glass Duct Construction Standards

F. Underwriters Laboratories, Inc. (UL):

181-08.....Factory-Made Air Ducts and Air Connectors

555-06 .....Standard for Fire Dampers

555S-06 .....Standard for Smoke Dampers

## **PART 2 - PRODUCTS**

### **2.1 DUCT MATERIALS AND SEALANTS**

- A. General: Except for systems specified otherwise, construct ducts, casings, and accessories of galvanized sheet steel, ASTM A653, coating G90; or, aluminum sheet, ASTM B209, alloy 1100, 3003 or 5052.
- B. Specified Corrosion Resistant Systems: Stainless steel sheet, ASTM A167, Class 302 or 304, Condition A (annealed) Finish No. 4 for exposed ducts and Finish No. 2B for concealed duct or ducts located in mechanical rooms.
- C. Optional Duct Materials:
  - 1. Grease Duct: Double wall factory-built grease duct, UL labeled and complying with NFPA 96 may be furnished in lieu of specified materials for kitchen and grill hood exhaust duct. Installation and accessories shall comply with the manufacturers catalog data. Outer jacket of exposed ductwork shall be stainless steel. Square and rectangular duct shown on the drawings will have to be converted to equivalent round size.
- D. Joint Sealing: Refer to SMACNA HVAC Duct Construction Standards, paragraph S1.9.
  - 1. Sealant: Elastomeric compound, gun or brush grade, maximum 25 flame spread and 50 smoke developed (dry state) compounded specifically for sealing ductwork as recommended by the manufacturer. Generally provide liquid sealant, with or without compatible tape, for low clearance slip joints and heavy, permanently elastic, mastic type where clearances are larger. Oil base caulking and glazing compounds are not acceptable because they do not retain elasticity and bond.
  - 2. Tape: Use only tape specifically designated by the sealant manufacturer and apply only over wet sealant. Pressure sensitive tape shall not be used on bare metal or on dry sealant.
  - 3. Gaskets in Flanged Joints: Soft neoprene.
- E. Approved factory made joints may be used.

### **2.2 DUCT CONSTRUCTION AND INSTALLATION**

- A. Regardless of the pressure classifications outlined in the SMACNA Standards, fabricate and seal the ductwork in accordance with the following pressure classifications:
- B. Duct Pressure Classification:



- 0 to 50 mm (2 inch)
- > 50 mm to 75 mm (2 inch to 3 inch)
- > 75 mm to 100 mm (3 inch to 4 inch)

Show pressure classifications on the floor plans.

- C. Seal Class: All ductwork shall receive Class A Seal
- D. Operating Room/Cystoscopy Room Supply Air: All supply air ductwork on the downstream side of the terminal final HEPA filter within the AHU unit serving the serving an operating room or cystoscopy room shall be fabricated from welded stainless steel, including all components of the air distribution system up to and including the point of exit from the Penthouse Equipment Module. Supply Air Ductwork within the building/above the operating room suite may be flanged/gasketed aluminum or flanged/gasketed galvanized steel (see ductwork specs and ductwork material schedule for additional information).
- E. Wet Air Exhaust Ducts and Accessories: Ducts for dishwashers, scullery hood, cart washers, manual cart washers, cage washers, steam sterilizer hoods, orthotics hoods and branch ductwork directly exhausting shower room areas shall be 1.3 mm (18 gage) stainless steel made liquid tight with continuous external weld for all seams and joints. Provide neoprene gaskets at flanged connections. Where ducts are not self draining back to the equipment or shower exhaust inlet/register, provide low point drain pocket with copper drain pipe to sanitary sewer. Provide access door in side of duct at drain pockets.
- F. Kitchen and Grill Hood (Ventilator) Exhaust Ducts: Comply with NFPA 96.
  - 1. Material: 1.6 mm (16 gage) steel sheet (black iron), ASTM A1011, or 1.3 mm (18 gage) stainless steel. Use stainless steel for exposed duct in occupied areas. See Optional Duct Materials.
  - 2. Construction: Liquid tight with continuous external weld for all seams and joints. Where ducts are not self draining back to the equipment, provide low point drain pocket with copper drain pipe to sanitary sewer. Provide access doors or panels for duct cleaning inside of horizontal duct at drain pockets, at 6 m (20 feet) intervals, and at each change of direction.
  - 3. Access doors or panels shall be of the same material and thickness of the duct with gaskets and sealants that are rated 815 degrees C (1500 degrees F) and shall be grease-tight.
  - 4. Grease Duct: Double-wall factory-built grease duct, UL labeled and complying with NFPA 96 may be furnished in lieu of specified materials for kitchen and grill hood exhaust. Installation and accessories shall comply with the manufacturers catalog data. Outer jacket of exposed ductwork shall be stainless steel. Square and

rectangular duct shown in the drawings will have to be converted to equivalent round size.

- G. Radioisotope H3, Hood Exhaust and Associated Ductwork: 1.3 mm (18 gage) all welded stainless steel duct.
- H. Laboratory Hood, Exhaust and Associated Ductwork: 1.3 mm (18 gage) all welded Stainless steel.
- I. Biological Safety Cabinet, H12, Hood Exhaust and Associated Ductwork: 1.3 mm (18 gage) all welded stainless steel.
- J. Perchloric Acid H14, Hood Exhaust: 1.3 mm (18 gage) stainless steel, liquid tight welded construction. Provide water wash down system in the hood and all associated ductwork to the exhaust air outlet. Coordinate the wash down system requirements with the specified hood.
- K. Duct for Negative Pressure Up to 750 Pa (3 inch W.G.): Provide for exhaust duct between HEPA filters and exhaust fan inlet including systems for Autopsy Suite exhaust.
  - 1. Round Duct: Galvanized steel, spiral lock seam construction with standard slip joints.
  - 2. Rectangular Duct: Galvanized steel, minimum 1.0 mm (20 gage), Pittsburgh lock seam, companion angle joints 32 mm by 3.2 mm (1-1/4 by 1/8 inch) minimum at not more than 2.4 m (8 feet) spacing. Approved pre-manufactured joints are acceptable in lieu of companion angles.
- L. Round and Flat Oval Ducts: Furnish duct and fittings made by the same manufacturer to insure good fit of slip joints. When submitted and approved in advance, round and flat oval duct, with size converted on the basis of equal pressure drop, may be furnished in lieu of rectangular duct design shown on the drawings.
  - 1. Elbows: Diameters 80 through 200 mm (3 through 8 inches) shall be two sections die stamped, all others shall be gored construction, maximum 18 degree angle, with all seams continuously welded or standing seam. Coat galvanized areas of fittings damaged by welding with corrosion resistant aluminum paint or galvanized repair compound.
  - 2. Provide bell mouth, conical tees or taps, laterals, reducers, and other low loss fittings as shown in SMACNA HVAC Duct Construction Standards.
  - 3. Ribbed Duct Option: Lighter gage round/oval duct and fittings may be furnished provided certified tests indicating that the rigidity and performance is equivalent to SMACNA standard gage ducts are submitted.
    - a. Ducts: Manufacturer's published standard gage, G90 coating, spiral lock seam construction with an intermediate standing rib.

- b. Fittings: May be manufacturer's standard as shown in published catalogs, fabricated by spot welding and bonding with neoprene base cement or machine formed seam in lieu of continuous welded seams.
- 4. Provide flat side reinforcement of oval ducts as recommended by the manufacturer and SMACNA HVAC Duct Construction Standard S3.13. Because of high pressure loss, do not use internal tie-rod reinforcement unless approved by the Contracting Officers Representative (COR).
- M. VA Type A and B Canopy Hoods, Reagent Grade Water Treatment Room and Battery Charging Room Exhausts: Constructed of 1.3 mm (18 gage) stainless steel.
- N. Casings and Plenums: Construct in accordance with SMACNA HVAC Duct Construction Standards Section 6, including curbs, access doors, pipe penetrations, eliminators and drain pans. Access doors shall be hollow metal, insulated, with latches and door pulls, 500 mm (20 inches) wide by 1200 - 1350 mm (48 - 54 inches) high. Provide view port in the doors where shown. Provide drain for outside air louver plenum. Outside air plenum shall have exterior insulation. Drain piping shall be routed to the nearest floor drain.
- O. Volume Dampers: Single blade or opposed blade, multi-louver type as detailed in SMACNA Standards. Refer to SMACNA Detail Figure 2-12 for Single Blade and Figure 2.13 for Multi-blade Volume Dampers.
- P. Duct Hangers and Supports: Refer to SMACNA Standards Section IV. Avoid use of trapeze hangers for round duct.

### **2.3 DUCT LINER (WHERE INDICATED ON DRAWINGS)**

- A. Duct sizes shown on drawings for lined duct are clear opening inside lining.
- B. Duct liner is only permitted to be used for return, relief and general exhaust ducts. Duct liner is not permitted for outside air ducts, supply air ducts or any other positive pressure ductwork (provide exterior insulation only).
- C. Rectangular Duct or Casing Liner: ASTM C1071, Type I (flexible), or Type II (board), 25 mm (one inch) minimum thickness, applied with mechanical fasteners and 100 percent coverage of adhesive in conformance with SMACNA, Duct Liner Application Standard.
- D. Round and Oval Duct Liner: Factory fabricated double-walled with two inch thick sound insulation and inner perforated galvanized metal liner. Construction shall comply with flame and smoke rating required by NFPA 90A. Metal liner shall be 1.0 to 0.60 mm (20 to 24 gage) having perforations not exceeding 2.4 mm (3/32 inch) diameter and approximately

22 percent free area. Metal liner for fittings need not be perforated. Assemblies shall be complete with continuous sheet Mylar liner, 2 mil thickness, between the perforated liner and the insulation to prevent erosion of the insulation. Provide liner couplings/spacer for metal liner. At the end of insulated sections, provide insulation end fittings to reduce outer shell to liner size. Provide liner spacing/concentricity leaving airway unobstructed.

#### **2.4 DUCT ACCESS DOORS, PANELS AND SECTIONS**

- A. Provide access doors, sized and located for maintenance work, upstream, in the following locations:
  - 1. Each duct mounted coil and humidifier.
  - 2. Each fire damper (for link service), smoke damper and automatic control damper.
  - 3. Each duct mounted smoke detector.
  - 4. For cleaning operating room supply air duct and kitchen hood exhaust duct, locate access doors at 6 m (20 feet) intervals and at each change in duct direction.
- B. Openings shall be as large as feasible in small ducts, 300 mm by 300 mm (12 inch by 12 inch) minimum where possible. Access sections in insulated ducts shall be double-wall, insulated. Transparent shatterproof covers are preferred for uninsulated ducts.
  - 1. For rectangular ducts: Refer to SMACNA HVAC Duct Construction Standards (Figure 2-12).
  - 2. For round and flat oval duct: Refer to SMACNA HVAC duct Construction Standards (Figure 2-11).

#### **2.5 BACKDRAFT DAMPERS**

- A. Dampers shall be low-leakage, parallel-blade type. Damper sizes shall be suitable for duct sizes noted on the contract drawings. The dampers shall be suitable for a minimum 4000 fpm velocity.
- B. Damper frames shall be minimum No. 12 gauge galvanized steel and blades shall be minimum No. 16 gauge galvanized steel or Type 6063T5 aluminum with press-fit ball bearings.
- C. Dampers shall be complete with adjustable counterweights and linkage for the duty. Backdraft dampers in surgical supply air and wet air exhaust shall be of stainless steel. All aluminum or galvanized steel acceptable for other applications.

#### **2.6 BAROMETRIC/PRESSURE RELIEF DAMPERS**

- A. Dampers shall be low-leakage, parallel-blade type. Damper sizes shall be suitable for duct sizes and airflow rates noted on the contract drawings.

- B. The dampers shall be rated for 4000 ft/min., back pressure up to 2 in. w.g. and shall include adjustable start-open pressure (selectable from 0.05 to 0.13 in. w.g.) used for gravity ventilation intake (temporary gas storage room) and pressure relief. Dampers shall be of size and shape to coordinate with other intake/relief components such as intake weather hood/filter plenum assembly (temporary gas storage room) and relief louver/insect screen assembly. Dampers for temporary use shall be galvanized steel.

## **2.7 FIRE DAMPERS**

- A. Fire dampers in surgical supply air and wet air exhaust shall be of stainless steel construction, all others may be galvanized steel.
- B. Galvanized steel or stainless steel, interlocking blade, dynamic type, UL classified and label, 1-1/2 hour rating, fusible link: 74 degrees C (165 degrees F) for standard/supply air dampers, fusible link: 141 degrees C (285 degrees F) for AC-16/surgery AHU smoke control return air fire dampers, 100 percent free opening with no part of the blade stack or damper frame in the air stream.
- C. Minimum requirements for fire dampers:
1. The damper frame may be of design and length as to function as the mounting sleeve, thus eliminating the need for a separate sleeve, as allowed by UL 555. Otherwise provide sleeves and mounting angles, minimum 1.9 mm (14 gage), required to provide installation equivalent to the damper manufacturer's UL test installation.
  2. Submit manufacturer's installation instructions conforming to UL rating test.

## **2.8 SMOKE DAMPERS**

- A. Maximum air velocity, through free area of open damper, and pressure loss: Low pressure and medium pressure duct (supply, return, exhaust, outside air): 450 m/min (1500 fpm). Maximum static pressure loss: 32 Pa (0.13 inch W.G.).
- B. Maximum air leakage, closed damper: 0.32 cubic meters /min/square meter (4.0 CFM per square foot) at 750 Pa (3 inch W.G.) differential pressure.
- C. Minimum requirements for dampers:
1. Shall comply with requirements of Table 6-1 of UL 555S, except for the Fire Endurance and Hose Stream Test.
  2. Frame: Galvanized steel channel with side, top and bottom stops or seals.
  3. Blades: Galvanized steel, parallel type preferably, 300 mm (12 inch) maximum width, edges sealed with neoprene, rubber or felt, if required to meet minimum leakage. Airfoil (streamlined) type for

minimum noise generation and pressure drop are preferred for duct mounted dampers.

4. Shafts: Galvanized steel.
5. Bearings: Nylon, bronze sleeve or ball type.
6. Hardware: Zinc plated.
7. Operation: Automatic open/close. No smoke damper that requires manual reset or link replacement after actuation is acceptable. See drawings for required control operation.

- D. Motor operator (actuator): Provide pneumatic or electric as required by the automatic control system, externally mounted on stand-offs to allow complete insulation coverage.

## **2.9 COMBINATION FIRE AND SMOKE DAMPERS**

Combination fire and smoke dampers: Multi-blade type units meeting all requirements of both fire dampers and smoke dampers shall be used where shown and may be used at the Contractor's option where applicable.

## **2.10 FIRE DOORS**

Galvanized steel, interlocking blade type, UL listing and label, 71 degrees C (160 degrees F) fusible link, 3 hour rating and approved for openings in Class A fire walls with rating up to 4 hours, 100 percent free opening with no part of the blade stack or damper frame in the air stream.

## **2.11 FLEXIBLE AIR DUCT**

- A. General: Factory fabricated, complying with NFPA 90A for connectors not passing through floors of buildings. Flexible ducts shall not penetrate any fire or smoke barrier which is required to have a fire resistance rating of one hour or more. Flexible duct length shall not exceed 1.5 m (5 feet). Provide insulated acoustical air duct connectors in supply air duct systems and elsewhere as shown.
- B. Flexible ducts shall be listed by Underwriters Laboratories, Inc., complying with UL 181. Ducts larger than 200 mm (8 inches) in diameter shall be Class 1. Ducts 200 mm (8 inches) in diameter and smaller may be Class 1 or Class 2.
- C. Insulated Flexible Air Duct: Factory made including mineral fiber insulation with maximum C factor of 0.25 at 24 degrees C (75 degrees F) mean temperature, encased with a low permeability moisture barrier outer jacket, having a puncture resistance of not less than 50 Beach Units. Acoustic insertion loss shall not be less than 3 dB per 300 mm (foot) of straight duct, at 500 Hz, based on 150 mm (6 inch) duct, of 750 m/min (2500 fpm).
- D. Application Criteria:
1. Temperature range: -18 to 93 degrees C (0 to 200 degrees F) internal.

2. Maximum working velocity: 1200 m/min (4000 feet per minute).
  3. Minimum working pressure, inches of water gage: 2500 Pa (10 inches) positive, 500 Pa (2 inches) negative.
- E. Duct Clamps: 100 percent nylon strap, 80 kg (175 pounds) minimum loop tensile strength manufactured for this purpose or stainless steel strap with cadmium plated worm gear tightening device. Apply clamps with sealant and as approved for UL 181, Class 1 installation.

## **2.12 FLEXIBLE DUCT CONNECTIONS**

Where duct connections are made to fans, air terminal units, and air handling units, install a non-combustible flexible connection of 822 g (29 ounce) neoprene coated fiberglass fabric approximately 150 mm (6 inches) wide. For connections exposed to sun and weather provide hypalon coating in lieu of neoprene. Burning characteristics shall conform to NFPA 90A. Securely fasten flexible connections to round ducts with stainless steel or zinc-coated iron draw bands with worm gear fastener. For rectangular connections, crimp fabric to sheet metal and fasten sheet metal to ducts by screws 50 mm (2 inches) on center. Fabric shall not be stressed other than by air pressure. Allow at least 25 mm (one inch) slack to insure that no vibration is transmitted.

## **2.13 SOUND ATTENUATING UNITS**

- A. Non-Surgical Applications: Casing, not less than 20 gage galvanized sheet steel, or 18 gage aluminum fitted with suitable flanges to make clean airtight connections to ductwork. Sound-absorbent material faced with glass fiber cloth and covered with not less than 24 gage or heavier galvanized perforated sheet steel, or 22 gage or heavier perforated aluminum. Perforations shall not exceed 5/32-inch diameter, approximately 25 percent free area. Sound absorbent material shall be long glass fiber acoustic blanket meeting requirements of NFPA 90A fully encapsulated in tedlar film.
- B. Surgical: Units within surgery supply air ductwork shall be constructed of 304 Stainless Steel, minimum 22 gauge. Packing shall be fully encapsulated so that no fibers can be released into the airstream. Units shall be constructed in accordance with the ASHRAE Guide recommendations for high pressure duct work. Seams shall be lock-formed and mastic filled. Rectangular casing seams shall be in the corners of the silencer shell to provide maximum unit strength and rigidity. Interior partitions shall be fabricated from single piece; margin perforated sheets and shall have die-formed entrance and exit shapes so as to provide the maximum aerodynamic efficiency and minimum self-noise characteristics in the sound attenuator. Blunt noses or squared off partitions will not be accepted. The interior partitions shall be attached to the casing by

means of an interlocking track assembly. Tracks shall be solid galvanized steel and shall be welded to the outer casing. Attachment of the interior partitions to the tracks shall be such that a minimum of 4 thicknesses of metal exist at this location. The track assembly shall stiffen the exterior casing, provide a reinforced attachment detail for the interior partitions, and shall maintain a uniform airspace width along the length of the silencer for consistent aerodynamic and acoustic performance.

- C. Sound attenuating units shall not fail structurally when subjected to a differential air pressure of 8 inches water gauge from inside to outside the casing.
- D. Entire unit shall be completely air tight and free of vibration and buckling at internal static pressures up to 2000 Pa (8 inches W.G.) at operating velocities.
- E. Pressure drop through each unit: Not to exceed indicated value at design air quantities indicated.
- F. Submit complete independent laboratory test data showing pressure drop and acoustical performance.
- G. Cap open ends of attenuators at factory with plastic, heavy duty paper, cardboard, or other appropriate material to prevent entrance of dirt, water, or any other foreign matter to inside of attenuator. Caps shall not be removed until attenuator is installed in duct system.

#### **2.14 PREFABRICATED ROOF CURBS AND EQUIPMENT SUPPORTS**

- A. General: Size curbs and/or equipment supports as required to suit roof opening and/or fan or equipment base. Curbs shall be minimum of 12 inches high unless indicated otherwise.
  - 1. Refer to Architectural and Structural drawings for roof slope at curb/support location and for installation details. Construct to fit single or double roof pitches as required.
  - 2. Construct and certify load carrying capacity to suit equipment weight and wind loads with not less than 100% safety factor.
  - 3. Coordinate fan/equipment mounting height on curbs/supports with centerline of ductwork or piping connections to minimize system offsets/pressure drop wherever possible.
- B. Minimum 14 gauge galvanized steel or extruded aluminum minimum 300 mm (12 inches) above finish roof service, continuous welded corner seams, treated wood nailer, 40 mm (1-1/2 inch) thick, 48 kg/cubic meter (3 pound/cubic feet) density rigid mineral fiberboard insulation with metal liner, built-in cant strip (except for gypsum or tectum decks), internal reinforcing supports welded. For surface insulated roof deck, provide raised cant strip (recessed mounting flange) to start at the upper



surface of the insulation. Curbs shall be constructed for pitched roof or ridge mounting as required to keep top of curb level. Curbs shall be of width required to adequately support equipment/attach equipment/duct and/or piping support structures to the prefabricated rail/curb.

#### **2.15 FIRESTOPPING MATERIAL**

Refer to Section 07 84 00, FIRESTOPPING.

#### **2.16 DUCT MOUNTED THERMOMETER (AIR)**

- A. Stem Type Thermometers: ASTM E1, 7 inch scale, red appearing mercury, lens front tube, cast aluminum case with enamel finish and clear glass or polycarbonate window, brass stem, 2 percent of scale accuracy to ASTM E77 scale calibrated in degrees Fahrenheit.
- B. Thermometer Supports:
  - 1. Socket: Brass separable sockets for thermometer stems with or without extensions as required, and with cap and chain.
  - 2. Flange: 3 inch outside diameter reversible flange, designed to fasten to sheet metal air ducts, with brass perforated stem.

#### **2.17 DUCT MOUNTED TEMPERATURE SENSOR (AIR)**

Refer to Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.

#### **2.18 INSTRUMENT TEST FITTINGS**

- A. Manufactured type with a minimum 50 mm (two inch) length for insulated duct, and a minimum 25 mm (one inch) length for duct not insulated. Test hole shall have a flat gasket for rectangular ducts and a concave gasket for round ducts at the base, and a screw cap to prevent air leakage.
- B. Provide instrument test holes at each duct or casing mounted temperature sensor or transmitter, and at entering and leaving side of each heating coil, cooling coil, and heat recovery unit.

#### **2.19 AIR FLOW CONTROL VALVES (SAV/EAV/RAV), AIR TERMINAL UNITS (TUS/TUE/TUR)**

Refer to Section 23 36 00 / 23 82 00, AIR TERMINAL UNITS / CONVECTION HEATING and COOLING UNITS.

#### **2.20 LEAD COVERED DUCT**

- A. Sheet Lead: 3.1 mm (1/8 inch) thick, securely installed, free of waves, lumps or wrinkles and with as few joints as possible.
- B. Joints shall be made to obtain X-ray absorption equivalent to adjacent sheet lead, and finished smooth and neat.

#### **2.21 ELECTROSTATIC SHIELDING**

- A. At the point of penetration of shielded rooms ducts shall be made electrically discontinuous by means of a flexible, nonconductive connection outside shielded room.
- B. Metallic duct portion inside shielded room shall be electrically bonded to shielding.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Comply with provisions of Section 23 05 11, COMMON WORK RESULTS FOR HVAC, particularly regarding coordination with other trades and work in existing buildings.
- B. Fabricate and install ductwork and accessories in accordance with referenced SMACNA Standards:
  - 1. Drawings show the general layout of ductwork and accessories but do not show all required fittings and offsets that may be necessary to connect ducts to equipment, boxes, diffusers, grilles, etc., and to coordinate with other trades. Fabricate ductwork based on field measurements. Provide all necessary fittings and offsets at no additional cost to the government. Coordinate with other trades for space available and relative location of HVAC equipment and accessories on ceiling grid. Duct sizes on the drawings are inside dimensions which shall be altered by Contractor to other dimensions with the same air handling characteristics where necessary to avoid interferences and clearance difficulties.
  - 2. Provide duct transitions, offsets and connections to dampers, coils, and other equipment in accordance with SMACNA Standards, Section II. Provide streamliner, when an obstruction cannot be avoided and must be taken in by a duct. Repair galvanized areas with galvanizing repair compound.
  - 3. Provide bolted construction and tie-rod reinforcement in accordance with SMACNA Standards.
  - 4. Construct casings, eliminators, and pipe penetrations in accordance with SMACNA Standards, Chapter 6. Design casing access doors to swing against air pressure so that pressure helps to maintain a tight seal.
- C. Install duct hangers and supports in accordance with SMACNA Standards, Chapter 4.
- D. Install fire dampers, smoke dampers and combination fire/smoke dampers in accordance with the manufacturer's instructions to conform to the installation used for the rating test. Install fire dampers, smoke dampers and combination fire/smoke dampers at locations indicated and where ducts penetrate fire rated and/or smoke rated walls, shafts and where required by the COR. Install with required perimeter mounting angles, sleeves, breakaway duct connections, corrosion resistant springs, bearings, bushings and hinges per UL and NFPA. Demonstrate re-setting of fire dampers and operation of smoke dampers to the COR.
- E. Seal openings around duct penetrations of floors and fire rated partitions with fire stop material as required by NFPA 90A.

- F. Flexible duct installation: Refer to SMACNA Standards, Chapter 3. Ducts shall be continuous, single pieces not over 1.5 m (5 feet) long (NFPA 90A), as straight and short as feasible, adequately supported. Centerline radius of bends shall be not less than two duct diameters. Make connections with clamps as recommended by SMACNA. Clamp per SMACNA with one clamp on the core duct and one on the insulation jacket. Flexible ducts shall not penetrate floors, or any chase or partition designated as a fire or smoke barrier, including corridor partitions fire rated one hour or two hour. Support ducts SMACNA Standards.
- G. Where diffusers, registers and grilles cannot be installed to avoid seeing inside the duct, paint the inside of the duct with flat black paint to reduce visibility.
- H. Control Damper Installation:
1. Provide necessary blank-off plates required to install dampers that are smaller than duct size. Provide necessary transitions required to install dampers larger than duct size.
  2. Assemble multiple sections dampers with required interconnecting linkage and extend required number of shafts through duct for external mounting of damper motors.
  3. Provide necessary sheet metal baffle plates to eliminate stratification and provide air volumes specified. Locate baffles by experimentation, and affix and seal permanently in place, only after stratification problem has been eliminated.
  4. Install all damper control/adjustment devices on stand-offs to allow complete coverage of insulation.
- I. Air Flow Measuring Devices (AFMD): Install units with minimum straight run distances, upstream and downstream as recommended by the manufacturer.
- J. Low Pressure Duct Liner: Install in accordance with SMACNA, Duct Liner Application Standard.
- K. Protection and Cleaning: Adequately protect equipment and materials against physical damage. Place equipment in first class operating condition, or return to source of supply for repair or replacement, as determined by COR. Protect equipment and ducts during construction against entry of foreign matter to the inside and clean both inside and outside before operation and painting. When new ducts are connected to existing ductwork, clean both new and existing ductwork by mopping and vacuum cleaning inside and outside before operation. All existing/reused AC-8/EF-8, AC-9/RF-9, AC-10/EF-10 ductwork shall be thoroughly pressure tested and cleaned. Ductwork leakage and joints shall be sealed in accordance with specifications. Damaged/missing

ductwork insulation shall be repaired/replaced in accordance with specifications. See ductwork plans, details and insulation specifications for additional information/requirements.

### **3.2 DUCT LEAKAGE TESTS AND REPAIR**

- A. Ductwork leakage testing shall be performed by the Testing and Balancing Contractor directly contracted by the General Contractor and independent of the Sheet Metal Contractor.
- B. Ductwork leakage testing shall be performed for the entire air distribution system (including all supply, return, exhaust and relief ductwork), section by section, including fans, coils and filter sections.
- C. Test procedure, apparatus and report shall conform to SMACNA Leakage Test manual. The maximum leakage rate allowed is 4 percent of the design air flow rate.
- D. All ductwork shall be leak tested first before insulated, enclosed in a shaft or covered in other inaccessible areas.
- E. All site leakage tests shall be performed in the presence of the COR and the Test and Balance agency. The Test and Balance agency shall measure and record duct leakage and report to the COR and identify leakage source with excessive leakage.
- F. If any portion of the duct system tested fails to meet the permissible leakage level, the Contractor shall rectify sealing of ductwork to bring it into compliance and shall retest it until acceptable leakage is demonstrated to the COR.
- G. All tests and necessary repairs shall be completed prior to insulation or concealment of ductwork.
- H. Make sure all openings used for testing flow and temperatures by TAB Contractor are sealed properly.

### **3.3 DUCTWORK EXPOSED TO WIND VELOCITY**

Provide additional support and bracing to all exposed ductwork installed on the roof or outside the building to withstand wind velocity of 145 km/h (90 mph).

### **3.4 TESTING, ADJUSTING AND BALANCING (TAB)**

Refer to Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC.

### **3.5 OPERATING AND PERFORMANCE TESTS**

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

- - - E N D - - -

**SECTION 23 34 00**  
**HVAC FANS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Fans for heating, ventilating and air conditioning.
- B. Product Definitions: AMCA Publication 99, Standard 1-66.

**1.2 RELATED WORK**

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- D. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC.
- E. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- F. Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.
- G. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC.
- H. Section 23 74 43, CUSTOM OUTDOOR PENTHOUSE EQUIPMENT MODULE/CENTRAL-STATION AIR-HANDLING UNITS.
- I. Section 23 82 16, AIR COILS.
- J. Section 23 08 00, Commissioning of HVAC
- K. Section 26 29 11, MOTOR CONTROLLERS.

**1.3 QUALITY ASSURANCE**

- A. Refer to paragraph, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Fans and power ventilators shall be listed in the current edition of AMCA 261, and shall bear the AMCA performance seal.
- C. Operating Limits for Centrifugal Fans: AMCA 99 (Class I, II, and III).
- D. Fans and power ventilators shall comply with the following standards:
  - 1. Testing and Rating: AMCA 210.
  - 2. Sound Rating: AMCA 300.
- E. Vibration Tolerance for Fans and Power Ventilators: Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- F. Performance Criteria:
  - 1. The fan schedule shall show the design air volume and static pressure. Select the fan motor HP by increasing the fan BHP by 10 percent to account for the drive losses and field conditions.
  - 2. Select the fan operating point as follows:
    - a. Forward Curve and Axial Flow Fans: Right hand side of peak pressure point
    - b. Air Foil, Backward Inclined, or Tubular: At or near the peak static efficiency

- G. Safety Criteria: Provide manufacturer's standard screen on fan inlet and discharge where exposed to operating and maintenance personnel.
- H. Corrosion Protection:
  - 1. Except for fans in fume hood exhaust service, all steel shall be mill-galvanized, or phosphatized and coated with minimum two coats, corrosion resistant enamel paint. Manufacturers paint and paint system shall meet the minimum specifications of: ASTM D1735 water fog; ASTM B117 salt spray; ASTM D3359 adhesion; and ASTM G152 and G153 for carbon arc light apparatus for exposure of non-metallic material.
  - 2. Fans for general purpose fume hoods, or chemical hoods, and radioisotope hoods shall be constructed of materials compatible with the chemicals being transported in the air through the fan.
- I. Spark resistant construction: If flammable gas, vapor or combustible dust is present in concentrations above 20% of the Lower Explosive Limit (LEL), the fan construction shall be as recommended by AMCA's Classification for Spark Resistant Construction. Drive set shall be comprised of non-static belts for use in an explosive.

#### **1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturers Literature and Data:
  - 1. Fan sections, motors and drives.
  - 2. Centrifugal fans, motors, drives, accessories and coatings.
    - a. In-line centrifugal fans.
    - b. Tubular Centrifugal Fans.
    - c. Industrial fans.
    - d. Utility fans and vent sets.
  - 3. Mixed-Flow fans.
  - 4. Prefabricated roof curbs.
  - 5. Power roof and wall ventilators.
  - 6. Propeller fans.
- C. Certified Sound power levels for each fan.
- D. Motor ratings, types, electrical characteristics and accessories.
- E. Roof curbs.
- F. Belt guards.
- G. Maintenance and Operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS.
- H. Certified fan performance curves for each fan showing cubic feet per minute (CFM) versus static pressure, efficiency, and horsepower for design point of operation. Provide performance curves for maximum

design airflow/static pressure and minimum design airflow/static pressure (e.g. UNOCC mode for new surgery AHU).

- I. Confirmation that fans powered by Variable Frequency Drives (VFD) include inverter duty motors.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Movement and Control Association International, Inc. (AMCA):
- 99-86.....Standards Handbook
  - 210-06.....Laboratory Methods of Testing Fans for  
Aerodynamic Performance Rating
  - 261-09.....Directory of Products Licensed to bear the AMCA  
Certified Ratings Seal - Published Annually
  - 300-08.....Reverberant Room Method for Sound Testing of  
Fans
- C. American Society for Testing and Materials (ASTM):
- B117-07a.....Standard Practice for Operating Salt Spray (Fog)  
Apparatus
  - D1735-08.....Standard Practice for Testing Water Resistance  
of Coatings Using Water Fog Apparatus
  - D3359-08.....Standard Test Methods for Measuring Adhesion by  
Tape Test
  - G152-06.....Standard Practice for Operating Open Flame  
Carbon Arc Light Apparatus for Exposure of Non-  
Metallic Materials
  - G153-04.....Standard Practice for Operating Enclosed Carbon  
Arc Light Apparatus for Exposure of Non-Metallic  
Materials
- D. National Fire Protection Association (NFPA):
- NFPA 96-08.....Standard for Ventilation Control and Fire  
Protection of Commercial Cooking Operations
- E. National Sanitation Foundation (NSF):
- 37-07.....Air Curtains for Entrance Ways in Food and Food  
Service Establishments
- F. Underwriters Laboratories, Inc. (UL):
- 181-2005.....Factory Made Air Ducts and Air Connectors

#### **1.6 EXTRA MATERIALS**

- A. Provide one additional set of belts for all belt-driven fans.

## **PART 2 - PRODUCTS**

### **2.1 FAN SECTION (CENTRIFUGAL PLENUM FAN)**

Refer to specification Section 23 74 43, CUSTOM OUTDOOR PENTHOUSE  
EQUIPMENT MODULE/CENTRAL-STATION AIR-HANDLING UNITS.

### **2.2 CENTRIFUGAL FANS**

- A. Standards and Performance Criteria: Refer to Paragraph, QUALITY ASSURANCE. Record factory vibration test results on the fan or furnish to the Contractor.
- B. Fan arrangement, unless noted or approved otherwise:
  - 1. DWD1 fans: Arrangement 3.
  - 2. SWS1 fans: Arrangement 1, 3, 9 or 10
- C. Construction: Wheel diameters and outlet areas shall be in accordance with AMCA standards.
  - 1. Housing: Low carbon steel, arc welded throughout, braced and supported by structural channel or angle iron to prevent vibration or pulsation, flanged outlet, inlet fully streamlined. Provide lifting clips, and casing drain. Provide manufacturer's standard access door. Provide 12.5 mm (1/2 inches) wire mesh screens for fan inlets without duct connections.
  - 2. Wheel: Steel plate with die formed blades welded or riveted in place, factory balanced statically and dynamically.
  - 3. Shaft: Designed to operate at no more than 70 percent of the first critical speed at the top of the speed range of the fans class.
  - 4. Bearings: Heavy duty ball or roller type sized to produce a B10 life of not less than 50,000 hours, and an average fatigue life of 200,000 hours. Extend filled lubrication tubes for interior bearings or ducted units to outside of housing.
  - 5. Belts: Oil resistant, non-sparking and non-static.
  - 6. Belt Drives: Factory installed with final alignment belt adjustment made after installation.
  - 7. Motors and Fan Wheel Pulleys: Adjustable pitch for use with motors through 15HP, fixed pitch for use with motors larger than 15HP. Select pulleys so that pitch adjustment is at the middle of the adjustment range at fan design conditions.
  - 8. Motor, adjustable motor base, drive and guard: Furnish from factory with fan. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC for specifications. Provide protective sheet metal enclosure for fans located outdoors.
  - 9. Furnish variable speed fan motor controllers where shown on the drawings. Refer to Section 26 29 11, MOTOR CONTROLLERS. Refer to



Section 23 05 11, COMMON WORK RESULTS FOR HVAC for controller/motor combination requirements.

- D. In-line Centrifugal Fans: In addition to the requirements of paragraphs A and 2.2.C3 thru 2.2.C9, provide minimum 18 Gauge galvanized steel housing with inlet and outlet flanges, backward inclined aluminum centrifugal fan wheel, bolted access door and supports as required. Motors shall be factory pre-wired to an external junction box.
- E. Tubular Centrifugal Fans: In addition to the requirements of paragraphs A and 2.2.C2 thru 2.2.C9 provide;
1. Housings: Hot rolled steel, one-piece design, incorporating integral guide vanes, motor mounts, bolted access hatch and end flanges. Provide spun inlet bell and screen for unducted inlet and screen for unducted outlet. Provide welded steel, flanged inlet and outlet cones for ducted connection. Provide mounting legs or suspension brackets as required for support. Guide vanes shall straighten the discharge air pattern to provide linear flow.
- F. Mixed-Flow Fans:
1. General: Inline, belt-driven centrifugal fans consisting of tubular housing, wheel, outlet guide vanes, fan shaft, bearings, drive assembly, motor, mounting brackets and accessories. Where specified/scheduled mixed flow fans for surgery AHU return/relief shall be suitable for emergency smoke evacuation. Fan assembly, belts, drives, all components and accessories shall be UL listed and rated for service as indicated on plans and equipment schedule drawings.
  2. Motor Mount: Motor externally mounted with adjustable sheave and base. Lubricating tubes shall be provided from the shaft bearing to the housing for lubrication. All units shall have support brackets standard with the manufacturer for mounting the unit.
  3. Wheels: Steel multi-blade, welded to shroud, with backplate and inlet backplate keyed to shaft, and spun wheel inlet shroud operating at close tolerance to deep spun inlet cone. Blades shall be backward-curved airfoil (AF) or mixed flow type.
  4. Scroll: Reinforced, galvanized steel, formed housing with welded seams.
  5. Access Door: Furnish gasketed, hinged with latch-type handles for inspection and maintenance of fan wheel.
  6. Drilled Companion Flanges: Furnish to receive sheet metal duct or flexible connectors. Companion flanges shall be of the same thickness as the fan flanges.
  7. Fan Mounting:

- a. Ceiling Hung Fans: Furnish four (4) suspension clips welded to fan housing. Coordinate and provide mounting with vibration isolation as specified/per details.
  - b. Floor or Wall Mounted Fans: Furnish support legs at each end. Coordinate and provide mounting with vibration isolation as specified/per details.
  - c. Vertically Mounted Fans: Furnish four (4) vertical brackets welded to either end of the fan housing. Coordinate and provide mounting with vibration isolation as specified/per details.
8. Accessories, where indicated on drawings, furnish the following:
- a. Roof Curb Cap, Roof Curb and Stack Cap: Furnish roof curb cap, roof curb and stack cap with built-in butterfly backdraft damper. Roof curbs as specified elsewhere in this section.
  - b. Corrosion-Resistant Finish (CRF): As specified in Article 2.01. Furnish backdraft dampers and inlet vanes of Type 304 stainless steel.
  - c. Spark-Resistant Construction (SRC): AMCA construction option A, B or C as indicated. Bearings shall not be placed in the air or gas stream.
  - d. UL Emergency Smoke Evacuation: Surgical return/relief fans for emergency smoke evacuation from operating rooms. Fans tested and rated for design time and temperature associated with emergency heat and smoke exhaust applications.
- G. Industrial Fans: Use where scheduled or in lieu of centrifugal fans for low volume high static service (e.g. Isolation room exhaust with integral bag-in-bag-out HEPA filter assembly). Construction specifications paragraphs A and C for centrifugal fans shall apply. Provide material handling flat blade type fan wheel.
- H. Utility Fans, Vent Sets and Small Capacity Fans: Class 1 design, arc welded housing, spun intake cone. Applicable construction specification, paragraphs A and C, for centrifugal fans shall apply for wheel diameters 300 mm (12 inches) and larger. Requirement for AMCA seal is waived for wheel diameters less than 300 mm (12 inches) and housings may be cast iron.

### **2.3 POWER ROOF VENTILATOR**

- A. Standards and Performance Criteria: Refer to Paragraph, QUALITY ASSURANCE.
- B. Type: Centrifugal fan, backward inclined blades. Provide down-blast or up-blast type as indicated.
- C. Construction: Steel or aluminum, completely weatherproof, for curb mounting, exhaust cowl or entire drive assembly readily removable for

servicing, aluminum bird screen on discharge, UL approved safety disconnect switch, conduit for wiring, vibration isolators for wheel, motor and drive assembly. Provide self acting back draft damper.

- D. Motor and Drive: Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC. Bearings shall be pillow block ball type with a minimum L-50 life of 200,000 hours. Motor shall be located out of air stream.
- E. Prefabricated Roof Curb: As specified in paragraph 2.3 of this section.
- F. Up-blast Type: Top discharge exhauster, motor out of air stream.

#### **2.4 POWER WALL VENTILATOR**

- A. Standards and Performance Criteria: Refer to Paragraph, QUALITY ASSURANCE.
- B. Type: Centrifugal fan, backward inclined blades.
- C. Construction: Steel or aluminum, completely weatherproof, for wall mounting, exhaust cowl or entire drive assembly readily removable for servicing, aluminum bird screen on discharge, UL approved safety disconnect switch, conduit for wiring, vibration isolators for wheel, motor and drive assembly. Provide self-acting back draft damper.
- D. Motor and Drive: Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC. Bearings shall be pillow block ball type with a minimum L-50 life of 200,000 hours. Motor shall be located out of air stream.

#### **2.5 PROPELLER FANS**

- A. Standards and Performance Criteria: Refer to Paragraph, QUALITY ASSURANCE.
- B. Belt-driven or direct-driven fans as indicated on drawings.
- C. Square steel panel, deep drawn venturi, arc welded to support arms and fan/motor support brackets, baked enamel finish. Provide wall collar for thru-wall installations.
- D. Motor, Motor Base and Drive: Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC. Motor shall be totally enclosed type.
- E. Wall Shutter: Fan manufacturer's standard, steel frame, aluminum blades, heavy duty stall type electric damper motor, spring closed.
- F. Wire Safety Guards: Provide on exposed inlet and outlet.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Install fan, motor and drive in accordance with manufacturer's instructions.
- B. Align fan and motor sheaves to allow belts to run true and straight.
- C. Bolt equipment to curbs with galvanized lag bolts.

- D. Install vibration control devices as shown on drawings and specified in Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- E. Perform vibration testing on all PEM fans in accordance with specification section 23 74 43, CUSTOM OUTDOOR PENTHOUSE EQUIPMENT MODULE/CENTRAL-STATION AIR-HANDLING UNITS.

### **3.2 PRE-OPERATION MAINTENANCE**

- A. Lubricate bearings, pulleys, belts and other moving parts with manufacturer recommended lubricants.
- B. Rotate impeller by hand and check for shifting during shipment and check all bolts, collars, and other parts for tightness.
- C. Clean fan interiors to remove foreign material and construction dirt and dust.

### **3.3 START-UP AND INSTRUCTIONS**

- A. Verify operation of motor, drive system and fan wheel according to the drawings and specifications. Include coordination efforts for Phased project fan testing, adjusting and balancing to support project commissioning as per specifications. Refer to specification section 23 74 43, CUSTOM OUTDOOR PENTHOUSE EQUIPMENT MODULE/CENTRAL-STATION AIR-HANDLING UNITS for additional factory and site acceptance testing associated with supply, return/relief and ventilation fans located in new rooftop Custom Outdoor Penthouse Equipment Module/Central Station Air Handling Unit.
- B. Verify mixed flow fan performance as part of Emergency Smoke Evacuation of newly renovated surgical suite and coordinate/support testing and verification of operating room smoke purge sequence of operation as part of project commissioning as per specifications.
- B. Check vibration and correct as necessary for air balance work.
- C. After air balancing is complete and permanent sheaves are in place perform necessary field mechanical balancing to meet vibration tolerance in Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.

- - - E N D - - -

**SECTION 23 36 00**  
**AIR TERMINAL UNITS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

Air terminal units, air flow control valves.

**1.2 RELATED WORK**

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC: General mechanical requirements and items, which are common to more than one section of Division 23.
- B. Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT: Noise requirements.
- C. Section 23 31 00, HVAC DUCTS AND CASINGS: Ducts and flexible connectors.
- D. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Valve operators.
- E. Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC: Flow rates adjusting and balancing.
- F. Section 23 82 16, AIR COILS: Heating and Cooling Coils pressure ratings.
- G. Section 23 74 43, CUSTOM, OUTDOOR, PENTHOUSE EQUIPMENT MODULE/CENTRAL STATION AIR HANDLING UNIT.

**1.3 QUALITY ASSURANCE**

Refer to Paragraph, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

**1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
  - 1. Air Terminal Units: Submit test data.
  - 2. Air flow control valves: Submit test data.
- C. Samples: Provide one typical air terminal unit and one typical air flow control valve for approval by the Contracting Officers Representative (COR). This unit will be returned to the Contractor after all similar units have been shipped and deemed acceptable at the job site.
- D. Certificates:
  - 1. Compliance with paragraph, QUALITY ASSURANCE.
  - 2. Compliance with specified standards.

E. Operation and Maintenance Manuals: Submit in accordance with paragraph, INSTRUCTIONS, in Section 01 00 00, GENERAL REQUIREMENTS.

### **1.5 APPLICABLE PUBLICATIONS**

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. Air Conditioning and Refrigeration Institute (AHRI)/(ARI):  
880-08.....Air Terminals Addendum to ARI 888-98  
incorporated into standard posted 15<sup>th</sup> December  
2002

C. National Fire Protection Association (NFPA):  
90A-09.....Standard for the Installation of Air  
Conditioning and Ventilating Systems

D. Underwriters Laboratories, Inc. (UL):  
181-08.....Standard for Factory-Made Air Ducts and Air  
Connectors

E. American Society for Testing and Materials (ASTM):  
C 665-06.....Standard Specification for Mineral-Fiber  
Blanket Thermal Insulation for Light Frame  
Construction and Manufactured Housing

### **1.6 GUARANTY**

In accordance with the GENERAL CONDITIONS

## **PART 2 - PRODUCTS**

### **2.1 GENERAL**

A. Coils:

1. New Surgical Suite AHU: Provide copper fins and copper coils for all hot water reheat coils serving surgical suite.
2. Non-Surgical Suite/Existing Air-Handling Units: Provide aluminum fins and copper coils for all hot water reheat coils.
3. Water Heating Coils:
  - a. ARI certified, continuous plate or spiral fin type, leak tested at 2070 kPa (300 PSI).
  - b. Capacity: As indicated, based on scheduled entering water temperature.
  - c. Headers: Copper or Brass.
  - d. Fins: Aluminum (Copper for surgical AHU service), maximum 315 fins per meter (8 fins per inch).

- e. Tubes: Copper, arrange for counter-flow of heating water.
  - f. Water Flow Rate: Minimum 0.032 Liters/second (0.5 GPM).
  - g. Provide vent and drain connection at high and low point, respectively of each coil.
  - h. Coils shall be guaranteed to drain.
- B. Labeling: Control box shall be clearly marked with an identification label that lists such information as nominal CFM, maximum and minimum factory-set airflow limits, coil type and coil connection orientation, where applicable.
- C. Factory calibrate air terminal units and airflow control valves to air flow rate indicated. All settings including maximum and minimum air flow shall be field adjustable.
- D. Dampers with internal air volume control: See section 23 31 00 HVAC DUCTS and CASINGS.
- E. Terminal Sound Attenuators: See Section 23 31 00 (HVAC DUCTS AND CASINGS).

## **2.2 AIR TERMINAL UNITS (BOXES - TUS/TUR/TUE)**

- A. Installation/use intended for renovated areas outside of the new surgical suite (outside of new surgery AHU, AC-16 service) and excluding Airborne Infection Isolation rooms where active room pressure differential monitoring/linear airflow control is required. Refer to drawings and equipment schedules for additional information. Boxes intended to serve renovated PACU, Pre-Op, and surgical support areas served by existing AC-8/EF-8, AC-9/RF-9, AC-10/EF-10 and new EF-19.
- B. General: Factory built, pressure independent units, factory set-field adjustable air flow rate, suitable for single duct applications. Use of dual-duct air terminal units is not permitted. Clearly show on each unit the unit number and factory set air volumes corresponding to the contract drawings. Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC work assumes factory set air volumes. Coordinate flow controller sequence and damper operation details with the drawings and Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC. All air terminal units shall be brand new products of the same manufacturer.
- B. Capacity and Performance: The Maximum Capacity of a single terminal unit shall not exceed 566 Liters/second (1,200 CFM).
- C. Sound Power Levels:

Acoustic performance of the air terminal units shall be based on the design noise levels for the spaces stipulated in Section 23 05 41 (Noise and Vibration Control for HVAC Piping and Equipment). Submitted equipment schedule shall show the sound power levels in all octave bands. Terminal sound attenuators shall be provided, as required, to meet the intent of the design.

- D. Casing: Unit casing shall be constructed of galvanized steel no lighter than 0.85 mm (22 Gauge). Double-wall casing with solid metal internal lining or perforated internal lining with fully encapsulated insulation is preferred. Internal lining for air terminal units shall only be permitted such that there is no direct fibrous material exposure to the airstream. Foam insulation materials are not acceptable. Proposed lining materials shall be reviewed and approved by VAMC COR and must be completely suitable for health care/patient/administrative area applications as noted herein. No exposed lining materials/methods shall be allowed without approval of VAMC COR and design engineering team. Provide hanger brackets for attachment of supports. Sound attenuators shall be provided where required to meet intent of the acoustic performance design intent.

1. Access panels (or doors): Provide panels large enough for inspection, adjustment and maintenance without disconnecting ducts, and for cleaning heating coils attached to unit, even if there are no moving parts. Panels shall be insulated to same standards as the rest of the casing and shall be secured and gasketed airtight. It shall require no tool other than a screwdriver to remove.
2. Total leakage from casing: Not to exceed 2 percent of the nominal capacity of the unit when subjected to a static pressure of 750 Pa (3 inch WG), with all outlets sealed shut and inlets fully open.

- E. Construct dampers and other internal devices of corrosion resisting materials which do not require lubrication or other periodic maintenance.

1. Damper Leakage: Not greater than 2 percent of maximum rated capacity, when closed against inlet static pressure of 1 kPa (4 inch WG).

- F. Provide multi-point velocity pressure sensors with external pressure taps.

1. Provide direct reading air flow rate table pasted to box.



- G. Provide static pressure tubes.
- H. Externally powered DDC variable air volume controller and damper actuator to be furnished under Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC for factory mounting on air terminal units. The DDC controller shall be electrically actuated.

### **2.3 AIR FLOW CONTROL VALVE (SAV/RAV/EAV)**

- A. General: Airflow control device serving Surgical/Operating Room suite (New surgery AHU service: supply, return and exhaust air valves) and Airborne Infection Isolations room (supply and exhaust air valves) shall be low pressure drop air flow control valve with vortex airflow measurement. No internal lining allowed. Factory-installed external insulation required for all supply air valves.
- B. Supply Air, Return Air, Surgical Suite Exhaust Air, Isolation Room Exhaust Air Valves:
  - 1. Consists of airflow control valve with vortex airflow sensor and high speed electric actuator. The Airflow Control Valve shall consist of a compression section, two airflow control surfaces, factory-mounted digital vortex airflow measuring device, factory-mounted high speed electric actuator and integral access panel (and/or)
  - 2. Where shown/scheduled consists of airflow control valve with integrated high performance closed loop feedback controller, vortex airflow sensor and high speed electric actuator. The Airflow Control Valve shall consist of a compression section, two airflow control surfaces, factory-mounted digital vortex airflow measuring device factory-mounted high speed electric actuator, integral access panel and integrated high performance closed-loop feedback controller with native BACnet.
  - 3. Supply air valves for surgical service (new surgery AHU service) shall be 304 stainless steel. Other service airflow control valves may be galvanized steel.
- C. Supply Air, Return Air, Surgical Suite Exhaust Air, Isolation Room Exhaust Air Valves:
  - 1. The compression section shall divide the airstream into at least two separate airstreams. Each airstream shall be approximately equal in size and the total open area shall be approximately 50% of the duct open area. The divided sections shall cause compression therefore

- creating a more laminar flow for better airflow measurement and turndown. The compression section shall be of an aerodynamic shape with a static regain section to insure minimal pressure drop. The valve shall not require any duct straight runs either upstream or downstream of the airflow valve to achieve required specified performance.
2. Airflow control valves shall be a linear type and shall operate with a minimum turndown ratio of 8 to 1. Accuracy of the airflow valve shall be 5% of reading in the 8 to 1 range of the damper.
  3. The airflow control valve shall respond within one second of a change in duct static pressure when provided with factory controls.
  4. The airflow control valve shall be capable of being mounted in any position (360° mounting plane) in ductwork without the need for recalibration. It shall not be required to specify mounting plane when ordering valve.
  5. Airflow control valves shall operate without linkages, springs, levers, or bearings, in the airstream and shall exhibit no deadband or hysteresis. Airflow control valves shall be field selectable fail-safe to either the last position, open or closed positions depending on the application.
  6. All critical components of the airflow control valve shall be easily accessible from one side of the valve.
  7. Airflow control valves shall be of a low pressure drop design for energy efficiency. Valves shall not require greater pressure drop than listed at "Max CFM" on project valve schedule or 0.3", whichever is less.
  8. The airflow valve shall be complete with a digital vortex type airflow sensing device providing true airflow feedback for the system. Airflow measuring devices shall be of the Vortex Shedding type, capable of continuously monitoring the airflow volume of the duct served and electronically transmitting a signal linear to the airflow volume.
  9. Individual airflow sensors shall be of rugged construction, and shall not require special handling during installation. Sensors shall be mounted on support bars. Standard materials shall be manufactured of corrosion resistant plastic.

10. Individual velocity sensors shall not be affected by dust, temperature, pressure, or humidity. The sensors shall be passive in nature, with no active parts within the air stream. The output from individual sensors shall be linear with respect to airflow velocity and shall be capable of sensing airflow in one direction only. The velocity sensors shall not require calibration.
11. The airflow sensors shall be easily accessible in the valve for inspection without removing valve from the duct.
12. Airflow Control Valve shall have factory installed high speed electric actuator specifically adapted to the stroke of the valve which shall operate on 24VAC. Power requirement for each airflow valve actuator shall not exceed 24VA.
13. Airflow Control Valve (where required/scheduled) shall have an integral closed-loop feedback controller. Airflow measurement through the vortex airflow sensor shall send the digital signal to the controller which modulates the high speed electric actuator to maintain desired airflow setpoint. The airflow setpoint shall have the capability of being provided through analog input, digital input, and communications over BACnet MS/TP or AVC internal program memory. Analog output signal shall be provided for airflow and alarm outputs must be provided to indicate abnormal airflow conditions.
14. Airflow Control Valve integral controller shall provide an EIA-485 port supporting BACnet MS/TP as a Full Master Node state machine. Field programming shall be accomplished through an intuitive PC based UI (User Interface) tool. Connection between the integral controller and the computer shall be provided through a USB port located on the AVC control module.
15. Power requirement for each airflow valve with integral controller shall not exceed 27VA for all single valves and 50VA for dual valves.
16. The airflow control valve shall not exceed the NC levels shown in the Table 1. NC levels are calculated based on the octave band sound attenuation factors shown in Table 2.
  - a. If the airflow control device cannot meet the NC levels specified a properly sized silencer or sound attenuator must be used.

- b. All silencers must be of a packless design (constructed of at least 18 gauge 316L stainless steel when used for surgery suite supply/surgery AHU supply) with a maximum pressure drop at the device's maximum rated flow rate not to exceed 0.20 inches of water.

**Table 1: Maximum NC Levels of Supply, Radiated and Exhaust airflow control valves:**

Valve Size inches	Airflow CFM	Pressure Drop (" wg)		Maximum NC Level		
		AccuValve	Venturi	Supply	Radiated	Exhaust
6	290	1.0	2.0	<20	<20	51
8	700	1.0	2.0	23	27	49
10	1000	1.0	2.0	23	22	41
12	1500	1.0	2.0	25	21	52
14	2200	1.0	2.0	22	23	51
12x18	2000	1.0	2.0	29	27	47
12x24	3000	1.0	2.0	25	26	44
12x36	4500	1.0	2.0	33	31	51
12x48	6000	1.0	2.0	29	30	47

**Table 2: Octave Band Sound Attenuation Factors**

Radiated Sound	Octave Band					
	2	3	4	5	6	7
Environmental Effect	2	1	0	0	0	0
Ceiling/Space Effect	16	18	20	26	31	36
Total dB Reduction	18	19	20	26	31	36

Discharge Sound	Octave Band					
	2	3	4	5	6	7
Environmental Effect	2	1	0	0	0	0
Duct Lining	2	6	12	25	29	18
End Reflection	9	5	2	0	0	0
5 ft., 8 in Flex Duct	6	10	18	20	21	12
Space Effect	5	6	7	8	9	10
Total dB Reduction	24	28	39	53	59	40

Exhaust Sound	Octave Band					
	2	3	4	5	6	7
Environmental Effect	2	1	0	0	0	0
Space Effect	5	6	7	8	9	10
Total dB Reduction	7	7	7	8	9	10

The following dB adjustments are used, per ARI 885-98 for the calculation of NC above 300 CFM						
	Octave Band					
	2	3	4	5	6	7
300-700 CFM	2	1	1	-2	-5	-1
Over 700 CFM	4	3	2	-2	-7	-1

### PART 3 - EXECUTION

#### 3.1 INSTALLATION

- A. Work shall be installed as shown and according to the manufacturer's diagrams and recommendations.
- B. Handle and install units in accordance with manufacturer's written instructions.
- C. Support units rigidly so they remain stationary at all times.  
Cross-bracing or other means of stiffening shall be provided as necessary. Method of support shall be such that distortion and malfunction of units cannot occur.
- D. Locate air terminal units and airflow control valves to provide a straight section of inlet duct for proper functioning of volume controls.
- E. Coordinate the access side of the terminal units and airflow control valves to ensure clear access is maintained to the terminal unit control enclosure and any associated heating hot water (reheat coil) control valve. Coordinate work of all trades to ensure that control enclosures and access doors are not blocked/preventing the required inspection and maintenance.

#### 3.2 OPERATIONAL TEST

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

- - - E N D - - -



**SECTION 23 37 00**  
**AIR OUTLETS AND INLETS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Roof Curbs
- B. Air Outlets and Inlets: Diffusers, Registers, and Grilles.
- C. Integrated Operating Room Laminar Ceiling Ventilation System and Air Distribution Devices.

**1.2 RELATED WORK**

- A. Outdoor and Exhaust Louvers: Section 08 90 00, LOUVERS AND VENTS.
- B. General Mechanical Requirements: Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- C. Noise Level Requirements: Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
- D. Outdoor Air Intake and Relief/Exhaust Air for Penthouse Equipment Module/Central Station Air Handling Unit: Section 23 74 43, CUSTOM OUTDOOR PENTHOUSE EQUIPMENT MODULE/CENTRAL STATION AIR HANDLING UNIT.
- E. Testing and Balancing of Air Flows: Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.

**1.3 QUALITY ASSURANCE**

- A. Refer to article, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.
- B. Fire Safety Code: Comply with NFPA 90A.

**1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
  - 1. Air intake/exhaust/relief hoods.
  - 2. Diffusers, registers, grilles and accessories.
- C. Coordination Drawings: Refer to article, SUBMITTALS, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

**1.5 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Diffusion Council Test Code:  
1062 GRD-84.....Certification, Rating, and Test Manual 4<sup>th</sup>  
Edition
- C. American Society of Civil Engineers (ASCE):

ASCE7-05.....Minimum Design Loads for Buildings and Other  
Structures

D. American Society for Testing and Materials (ASTM):

A167-99 (2004).....Standard Specification for Stainless and  
Heat-Resisting Chromium-Nickel Steel Plate,  
Sheet and Strip

B209-07.....Standard Specification for Aluminum and  
Aluminum-Alloy Sheet and Plate

E. National Fire Protection Association (NFPA):

90A-09.....Standard for the Installation of Air  
Conditioning and Ventilating Systems

F. Underwriters Laboratories, Inc. (UL):

181-08.....UL Standard for Safety Factory-Made Air Ducts  
and Connectors

## **PART 2 - PRODUCTS**

### **2.1 GRAVITY INTAKE/EXHAUST VENTILATORS (ROOF MOUNTED)**

A. Aluminum, ASTM B209, louvered, spun, or fabricated using panel sections with roll-formed edges, 13 mm (1/2 inch) mesh aluminum welded wire bird screen, with gravity or motorized dampers where shown, accessible interior, designed for wind velocity specified in Paragraph 3.3.

1. Spun Intake/Exhaust Ventilators: Spun aluminum structural components shall be constructed of minimum 1.3 mm (16 Gauge) marine alloy aluminum, bolted to a rigid aluminum support structure. The aluminum base shall have continuously welded curb cap corners for maximum leak protection. The spun aluminum baffle shall have a rolled bead for added strength.
2. Louvered Intake/Exhaust Hoods: Louvered hood constructed from 0.081 Gauge extruded aluminum tiers welded to a minimum 3.3 mm (8 Gauge) aluminum support structure. The aluminum hood shall be constructed of a minimum 0.064 marine alloy aluminum and provided with a layer of anti-condensate coating. The aluminum base shall have continuously welded curb cap corners for maximum leak protection.
3. Low Silhouette Intake/Exhaust Ventilator: The unit shall be of bolted and welded construction utilizing corrosion resistant fasteners. The aluminum hood shall be constructed of minimum 1.60 mm (14 Gauge) marine alloy aluminum, bolted to a minimum 3.25 mm (8 Gauge) aluminum support structure. The aluminum base shall have continuously welded curb cap corners for maximum leak protection. Birdscreen constructed of 13 mm (1/2 inch) mesh shall be mounted across the relief opening.



- B. See ventilator schedule on the drawings. Sizes shown on the drawings designate throat size. Area of ventilator perimeter opening shall be not less than the throat area.
- C. Dampers for Gravity Ventilators without Duct Connection: Construct damper of the same material as the ventilator and of the design to completely close opening or remain wide open. Hold damper in closed position by a brass chain and catch. Extend chains 300 mm (12 inches) below and engage catch when damper is closed.
- D. See paragraph 3.3 for Intake/Exhaust exposed to high wind velocities.
- E. Provide Roof Curb by unit manufacturer. Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC for additional requirements.

## **2.2 EQUIPMENT SUPPORTS**

Refer to Section 21 05 11, COMMON WORK RESULTS FOR FIRE SUPPRESSION, Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, and Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

## **2.3 AIR OUTLETS AND INLETS**

### **A. Materials:**

- 1. Steel or aluminum except that all supply air outlets and inlets installed in Operating rooms and Cystoscopy rooms (see Article 2.3 C.3 for OR supply outlets) shall be aluminum with white baked enamel of suitable quality to withstand typical cleaning solutions and normal scrubbing commonly used in hospital operating rooms. Use aluminum air outlets and inlets for facilities located in high-humidity areas. Exhaust air registers located in shower areas and combination toilets/shower stalls shall be constructed from aluminum. Provide manufacturer's standard gasket.
- 2. Exposed Fastenings: The same material as the respective inlet or outlet. Fasteners for aluminum may be stainless steel.
- 3. Contractor shall review all ceiling drawings and details and provide all ceiling mounted devices with appropriate dimensions and trim for the specific locations.

B. Performance Test Data: In accordance with Air Diffusion Council Code 1062GRD. Refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT for NC criteria.

### **C. Air Supply Outlets:**

- 1. Ceiling Diffusers: Suitable for surface mounting, exposed T-bar or special tile ceilings, off-white finish, square or round neck connection as shown on the drawings. Provide plaster frame for units in plaster ceilings.

- a. Square, louver, fully adjustable pattern: Round neck, surface mounting unless shown otherwise on the drawings. Provide equalizing or control grid and volume control damper.
  - b. Louver face type: Square or rectangular, removable core for 1, 2, 3, or 4 way directional pattern. Provide equalizing or control grid and opposed blade damper.
  - c. Perforated face type: Manual adjustment for one-, two-, three-, or four-way horizontal air distribution pattern without change of air volume or pressure. Provide equalizing or control grid and opposed blade over overlapping blade damper. Perforated face diffusers for VAV systems shall have the pattern controller on the inner face, rather than in the neck and designed to discharge air horizontally at the ceiling maintaining a Coanda effect.
  - d. Slot diffuser/plenum:
    - 1) Diffuser: Frame and support bars shall be constructed of heavy gauge extruded aluminum. Form slots or use adjustable pattern controllers, to provide stable, horizontal air flow pattern over a wide range of operating conditions.
    - 2) Galvanized steel boot lined with 13 mm (1/2 inch) thick fiberglass conforming to NFPA 90A and complying with UL 181 for erosion. The internal lining shall be factory-fabricated, anti-microbial, and non-friable.
    - 3) Provide inlet connection diameter equal to duct diameter shown on drawings or provide transition coupling if necessary. Inlet duct and plenum size shall be as recommended by the manufacturer.
    - 4) Maximum pressure drop at design flow rate: 37 Pa (0.15 inch W.G.)
2. Linear Bar Grilles and Diffusers: Extruded aluminum, manufacturer's standard finish, and positive holding concealed fasteners.
- a. Margin Frame: Flat, 20 mm (3/4 inch) wide.
  - b. Bars: Minimum 5 mm (3/16 inch) wide by 20 mm (3/4 inch) deep, zero deflection unless otherwise shown. Bar spacing shall be a minimum of 3 mm (1/8 inch) on center. Reinforce bars on 450 mm (18 inch) center for sidewall units and on 150 mm (6 inch) center for units installed in floor or sills.
  - c. Provide opposed blade damper and equalizing or control grid where shown.
3. Integrated Operating Room Laminar Ceiling Ventilation System and Air Distribution Devices:

- a. Devices shall consist of a non-aspirating perforated panel laminar flow air supply providing downward airflow over the operating table and the area surrounding the operating table. Velocity of air distribution at operating table height shall not exceed 12 m/min (40 feet per minute). Perforated pressure plates shall be provided over the perimeter and center air distribution faces to equalize pressure and airflow throughout the system.
- b. Laminar Airflow Diffuser - Special perforated panel diffuser to be non-aspirating, laminar flow type in accordance with ASHRAE Standard 170. Diffuser shall utilize a two chamber plenum design to deliver air to the space with zero aspiration at the face of the perforated plate.
- c. Diffuser shall utilize a two chamber plenum design. Air shall be admitted to the top chamber through an inlet collar and inverse conical balancing mechanism. The balancing mechanism shall be adjustable by turning a screw from the room side of the diffuser. The diffuser plenum shall be constructed of 0.063" extruded aluminum with mitered, back-welded corners and 0.040" aluminum top plate. No cracks or gaps in the sides of diffuser plenum will be allowed. Manufacturer shall provide hanging tabs for independent suspension. A solid, 0.040" aluminum plate with two rectangular cutouts located directly above a V-shaped diffusion basket shall separate the top and bottom chambers. The lower chamber shall have a V-shaped, perforated diffusion basket mounted within a rectangular, perforated diffusion basket to evenly distribute air over the entire face of the diffuser. Single chamber designs or designs utilizing flat or perforated plates to equalize flow are not acceptable. Manufacturer shall provide four (4) hanging tabs welded to the side of diffuser plenum for independent suspension from above.
- d. Perforated distribution plate shall be 0.050" aluminum. Plate shall extend over and wrap around plate frame on all four sides to assure continuous perforated surface appearance between ceiling tee frames. Perforations to be 16% open area for 40 or less CFM per square ft. of module, 23% open area for 45-65 CFM per square ft. of module, or 33% open area for higher velocities. Plate shall be retained to the diffuser frame through use of captive, quarter-turn fasteners. Manufacturer shall provide vinyl-coated stainless steel cable safety retainers on two opposite sides to prevent accidental dropping of faceplate. No diffusion component

may be affixed to the back side of the faceplate frame. The back side of faceplate shall be easily accessible for ease of cleaning.

- e. All diffuser/airflow components of the system inside the operating room shall be fabricated of aluminum with white baked enamel finish of suitable quality to withstand typical cleaning solutions and normal scrubbing commonly used in hospital operating rooms. All distribution components and pressure plates shall be attached to the face panels at both the perimeter and center. The face panels shall be retained with 1/4 turn fasteners. Integral Aluminum Plenums (0.060" aluminum with with min. (2) P-4000-TEA aluminum Unistrut channels factory-welded to top of plenum for suspension of the plenum assembly from above) shall be supplied by the manufacturer and shall be sized to permit them to be easily wiped out by hand with germicidal solution for sterilization purposes and all horizontal corners of the plenums shall have a minimum radius of 20 mm (3/4 inch). Connecting elbows shall be radialized and be sized to permit manual sterilization of the plenums.
- f. Manufacturer shall provide removable plug button in center of diffuser's faceplate to gain access to volume adjustment valve without removal of faceplate. Plug button to match material of diffuser finish.
- g. Installing contractor shall field-insulate integrated plenums after installation into ceiling and connection to adjacent plenums. Insulation shall be 1-1/2" duct wrap FSK-backed insulation of 0.75lb/c. ft. density to prevent condensation of moisture and heat gain. Diffuser manufacturer shall factory insulate any individual laminar diffusers with same to prevent condensation of moisture and heat gain.
- h. Manufacturer shall furnish solid face aluminum blank-off/access panels where indicated on the drawings and where columns may penetrate the ceiling or where interstitial access is required. Blank-off/Access Panels to be 0.080" aluminum with white baked enamel finish of suitable quality to withstand typical cleaning solutions and normal scrubbing commonly used in hospital operating rooms. The installing contractor shall cut all fill-in panel(s) for the surgical light column(s), medical gas column(s), and other ceiling mounted apparatus/service access to above ceiling areas as required on the drawings after this equipment located.

- i. Laminar flow diffuser manufacturer shall furnish extruded aluminum tee and angle frame assembly suspension system to support diffusers, fill-in panels and light fixtures. The face of the tee shall be 1-1/2" wide x 1-7/16" high and angles shall be 3/4" wide x 1-7/16" high. Minimum wall thickness of the tees and angles shall be 0.125" with a minimum weight of 0.43 lbs. per linear ft. Centerline to centerline dimension of each framing section shall be 0.125" per lineal foot added to the nominal size of the diffuser. Verify exact locations of diffusers, lights, fill-in panels & framing with architectural reflected ceiling plans.
- n. The suspension system shall be factory-welded in sub-assemblies not larger than 6' x 12'. Where framing sub-assemblies butt together for field assembly, the butting angles shall be half tees mechanically-fastened with self-tapping wafer head screws.
- o. All tees and angles shall be pre-punched on 6" centers for attachment to suspending hanger wires or 3/4" threaded rod attached on 2'-0" centers at minimum in two directions to structural support members. Systems shall be designed for minimum weight of 10 lbs. per square ft. Systems are not intended to support gas columns, surgical booms, etc. these elements shall be supported by gas column/boom manufacturer independently from diffusers system.
- p. Manufacturer shall furnish 1/8" thick closed cell polyethylene gasket tape to be field installed on the frame assembly to provide an airtight seal between diffuser/tee grid or blank-off panel/tee grid interface. Gasket tape shall be field installed by contractor after framing surfaced have been wiped clean, free from any construction dust.
- q. The ceiling framing system shall have a white baked enamel aluminum finish of suitable quality to withstand typical cleaning solutions and normal scrubbing commonly used in hospital operating rooms.
- j. Framing members shall be 1-1/2" wide x 1-7/16" tall, pre-punched every 12" on center with 3/4" slotted holes for suspension from building structure by 12 ga. galvanized steel hanger wire supplied by installing contractor and spaced not more than 2' on center. Centerline to centerline dimension of each framing section shall be 0.125" per lineal foot added to the nominal size of the diffuser. Ceiling grid shall be furnished in factory-welded sub-sections not larger than 4'x 8' with cross-members provided to mechanically fasten sub-assemblies together in field as required.

- k. Verify exact locations of diffusers, integral supply air plenums, lights, surgical booms, gas columns, fill-in/access panels and framing with architectural reflected ceiling. Integrated ceiling system manufacturer to provide rough gypsum ceiling opening sizes in submittal for trade coordination with Div. 9/Divs. 21,23,26 and dimensioned reflected ceiling plan for coordination of all trades with boom/gas column locations. Suspension system shall be installed level and true, ready for installation of laminar flow diffusers, integral supply air plenums, blank-off/access panels, surgical booms/gas columns and lights.
- 4. Supply Registers: Double deflection type with horizontal face bars and opposed blade damper with removable key operator.
  - a. Margin: Flat, 30 mm (1 - 1/4 inches) wide.
  - b. Bar spacing: 20 mm (3/4 inch) maximum.
  - c. Finish: Off white baked enamel for ceiling mounted units. Wall units shall have a prime coat for field painting, or shall be extruded with manufacturer's standard finish.
- 5. Supply Grilles: Same as registers but without the opposed blade damper.
- D. Return and Exhaust Registers and Grilles: Provide opposed blade damper without removable key operator for registers.
  - 1. Finish: Off-white baked enamel for ceiling mounted units. Wall units shall have a prime coat for field painting, or shall be extruded aluminum with manufacturer's standard aluminum finish.
  - 2. Standard Type: Fixed horizontal face bars set at 30 to 45 degrees, approximately 30 mm (1-1/4 inch) margin.
  - 3. Perforated Face Type: To match supply units.
  - 4. Grid Core Type: 13 mm by 13 mm (1/2 inch by 1/2 inch) core with 30 mm (1-1/4 inch) margin.
  - 5. Linear Type: To match supply units.
  - 6. Door Grilles: Are furnished with the doors.
  - 7. Egg Crate Grilles: Aluminum or Painted Steel 1/2 by 1/2 by 1/2 inch grid providing 90% free area.
    - a. Heavy extruded aluminum frame shall have countersunk screw mounting. Unless otherwise indicated, register blades and frame shall have factory applied white finish.
    - b. Grille shall be suitable for duct or surface mounting as indicated on drawings. All necessary appurtenances shall be provided to allow for mounting.

- E. Supply Registers in Psychiatric Rooms: Supply air registers shall be security type, steel with perforated faceplate, flat surface margin, extension sleeve, opposed blade damper and back mounting flanges. Faceplate shall be 5 mm (3/16 inch) (minimum) with 5x5 mm holes on 7 mm (3/16 by 3/16 inch holes on 9/32 inch) spacing and a minimum free area of 45 percent. Wall sleeve shall be 5 mm (3/16 inch) thick (minimum).
- F. Air Inlet Registers in Psychiatric Rooms: Return, exhaust, transfer and relief air registers shall be security type, steel with perforated faceplate, flat surface margin, wall sleeve, opposed blade damper and back mounting flanges. Faceplate shall be 5 mm (3/16 inch) (minimum) with 5x5 mm holes on 7 mm (3/16 by 3/16 inch holes on 9/32 inch) spacing and a minimum free area of 45 percent. Wall sleeve shall be 5 mm (3/16 inch) thick (minimum).
- G. Acoustic Transfer Grille: Aluminum, suitable for partition or wall mounting.

#### **2.4 WIRE MESH GRILLE**

- A. Fabricate grille with 2 x 2 mesh 13 mm (1/2 inch) galvanized steel or aluminum hardware cloth in a spot welded galvanized steel frame with approximately 40 mm (1-1/2 inch) margin.
- B. Use grilles where shown in unfinished areas such as mechanical rooms.

#### **2.5 FILTER RETURN/EXHAUST GRILLE**

- A. Provide grille with in stream 1-inch deep MERV 4 filter and removable face.
  - 1. Finish: Off-white baked enamel for ceiling mounted units. Wall units shall have a prime coat for field painting, or shall be extruded aluminum with manufacturer's standard aluminum finish or 304 Stainless Steel. Stainless Steel shall be No. 4 finish.
  - 2. Standard Type: Fixed horizontal face bars set at 30 to 45 degrees, approximately 30 mm (1-1/4 inch) margin.
  - 3. Aluminum or Stainless steel as scheduled.
  - 4. Standard face connected to a mounting frame with space for a throwaway filter. Hold face closed by a locking screw. Provide retaining clips to hold filter in place. Provide fiberglass throwaway filter.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Comply with provisions of Section 23 05 11, COMMON WORK RESULTS FOR HVAC, particularly regarding coordination with other trades and work in existing buildings.

- B. Protection and Cleaning: Protect equipment and materials against physical damage. Place equipment in first class operating condition, or return to source of supply for repair or replacement, as determined by Contracting Officers Representative (COR). Protect equipment during construction against entry of foreign matter to the inside and clean both inside and outside before operation and painting.
- C. Integrated Operating Room Laminar Ceiling Ventilation System and Air Distribution Devices:
1. The installing contractor shall examine all openings, mechanical and electrical work, and adjoining and adjacent construction to receive Integrated Ceiling System prior to commencing this Work.
  2. The installing contractor shall field verify rough hard ceiling opening dimensions are as required in submittals and hard ceiling conditions to be plumb and level with square corners to receive Integrated Ceiling Systems.
  3. Openings not acceptable for Integrated Ceiling System installations shall be corrected by the appropriate contractor until conditions are satisfactory to installing contractor
  4. Contractor shall coordinate corrective/remedial work promptly.
  5. Proceeding with the installation of the Ceiling System indicates the installing contractor accepts the openings and conditions.
  6. Verify exact diffuser, blank panel and accessory locations as shown on the Contract Drawings.
  7. Provide balancing dampers on duct take-off to diffusers, and grilles and registers, despite whether dampers are specified as part of the diffuser, or grille and register assembly.
  8. Install 1/8-inch-thick closed cell polyethylene gasket tape on the top side of all horizontal ceiling grid surfaces as shown in manufacturer's submittal.
  9. Assemble framing sections in accordance with manufacturer's installation instructions. Self-tapping sheet metal screws shall be utilized for mechanical fastening of butting welded framing subsections.
  10. Provide inserts, power-driven type anchors, hangers or other Architect / Engineer approved hanger anchoring and suspension system devices and methods.
  11. Install suspended ceiling hangers plumb and free from contact with insulation or other objects within ceiling plenum not part of supporting structural or ceiling suspension systems. Splay hangers only where required to avoid obstructions and offset resulting



- horizontal forces by bracing, counter splaying, or other Architect / Engineer approved methods.
12. Where width of ducts, cable trays and other construction within ceiling plenums causes hanger spacing to interfere with the location of hangers required to support suspension system members, install supplemental suspension members and hangers in the form of trapeze or equivalent Architect / Engineer approved devices. Size supplemental suspension members and hangers to support ceiling loads within performance limits established by referenced standards.
  13. Secure wire hangers to structure by looping and wire-tying, either directly to structures or to inserts, eye screws, or other devices and fasteners appropriate for the substrates.
  14. Coordinate insert and hanger location with other Work.
  15. Hanger wires for framing shall be installed a maximum 2'-0" on center in both directions and a maximum 6 inches from framing ends.
  16. Hangers shall not penetrate ductwork/plenum connection, ductwork/plenum connection insulation or piping insulation. Integrated Ceiling System shall not be suspended from ductwork, conduit, pipes or plumbing equipment. Hangers shall not interfere with heating and ventilating equipment and their maintenance.
  17. The Electrical Contractor will utilize the Integrated Ceiling System for lay-in type lighting fixtures. The Electrical Contractor shall provide any separate primary support or secondary frame members required to anchor and support lighting fixtures and equipment and to supplement and strengthen the standard suspension system in conformance with N.E.C. requirements. Provide openings for flush down-lighting fixtures located within blank-off panels as shown on Electrical Drawings and reflected ceiling plans.
  18. Installing contractor shall coordinate ceiling support system with structural support requirements of surgical lighting booms, surgical equipment booms, anesthesia booms and/or medical gas columns, etc. as indicated by contractor drawings and related discipline specifications.

### **3.2 INTAKE/EXHAUST HOODS EXPOSED TO WIND VELOCITY**

Provide additional support and bracing to all exposed ductwork installed on the roof or outside the building to withstand wind velocity of 145 km/h (90 mph).

### **3.3 TESTING, ADJUSTING AND BALANCING (TAB)**

Refer to Section 23 05 93, TESTING, ADJUSTING, AND BALANCING FOR HVAC.

### **3.4 OPERATING AND PERFORMANCE TESTS**

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

- - - E N D - - -

**SECTION 23 40 00**  
**HVAC AIR CLEANING DEVICES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Air filters for heating, ventilating and air conditioning.
- B. Definitions: Refer to ASHRAE Standard 52.2 for definitions of face velocity, net effective filtering area, media velocity, initial resistance (pressure drop), MERV (Minimum Efficiency Reporting Value), PSE (Particle Size Efficiency), particle size ranges for each MERV number, dust holding capacity and explanation of electrostatic media based filtration products versus mechanical filtration products. Refer to ASHRAE Standard 52.2 Appendix J for definition of MERV-A.

**1.2 RELATED WORK**

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION: General mechanical requirements and items, which are common to more than one section of Division 23.
- B. Section 23 74 43, CUSTOM, OUTDOOR, PENTHOUSE EQUIPMENT MODULE/CENTRAL-STATION AIR-HANDLING UNITS: Filter housing and racks.
- C. Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS: Requirements for commissioning, systems readiness checklists, and training.

**1.3 QUALITY ASSURANCE**

- A. Air Filter Performance Report for Extended Surface Filters:
  - 1. Submit a test report for each Grade of filter being offered. The report shall not be more than three (3) years old and prepared by using test equipment, method and duct section as specified by ASHRAE Standard 52.2 for type filter under test and acceptable to Contracting Officers Representative (COR), indicating that filters comply with the requirements of this specification. Filters utilizing partial or complete synthetic media will be tested in compliance with pre-conditioning steps as stated in Appendix J. All testing is to be conducted on filters with a nominal 24 inch by 24 inch face dimension. Test for 150 m/min (500 fpm) will be accepted for lower velocity rated filters provided the test report of an independent testing laboratory complies with all the requirements of this specification.
  - 2. Government Option: The Government at its option may take one of the filters for each different type submitted and run an independent test to determine if the filter meets the requirements of this

specification. When the filter meets the requirements, the Government will pay for the test. When the filter does not meet the specification requirements, the manufacturer will be required to pay for the test and replace the filters with filters that will perform as required by the specifications.

3. Guarantee Performance: The manufacturer shall supply ASHRAE 52.2 test reports on each filter type submitted. Any filter supplied will be required to maintain the minimum efficiency shown on the ASHRAE Standard 52.2 report throughout the time the filter is in service. Within the first 6-12 weeks of service a filter may be pulled out of service and sent to an independent laboratory for ASHRAE Standard 52.2 testing for initial efficiency only. If this filter fails to meet the minimum level of efficiency shown in the previously submitted reports, the filter manufacturer/distributor shall take back all filters and refund the owner all monies paid for the filters, cost of installation, cost of freight and cost of testing.
- B. Filter Warranty for Extended Surface Filters: Guarantee the filters against leakage, blow-outs, and other deficiencies during their normal useful life, up to the time that the filter reaches the final pressure drop. Defective filters shall be replaced at no cost to the Government.
- C. Comply with UL Standard 900 for flame test.
- D. Nameplates: Each filter shall bear a label or name plate indicating manufacturer's name, filter size, rated efficiency, UL classification, and file number.

#### **1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
  1. Extended surface filters.
  2. Panel filters.
  3. Holding frames. Identify locations.
  4. Side access housings. Identify locations, verify insulated doors.
  5. HEPA filters.
  6. Magnehelic gages.
  7. Air handling unit air purification system: GAPC - Ultraviolet Germicidal Irradiation (UVGI) using UVC lamps and Photocatalytic Oxidation Package (PCP) using TiO<sub>2</sub> coated media:
    - a. Product data: Include dimensions; shipping installed weights; required clearances and rated flow capacity.
    - b. Submittals shall also include the following:

- 1) System schematic
  - 2) Wiring Diagram
  - 3) Equipment Schedule
  - 4) Control Diagram and Sequence of Operations
- C. Air Filter performance reports.
- D. Suppliers warranty.
- E. Field test results for HEPA filters as per paragraphs 2.5 and 2.6.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by basic designation only.
- B. American Society of Heating, Refrigerating and Air-conditioning Engineers, Inc. (ASHRAE):  
52.2-2007.....Method of Testing General Ventilation Air-Cleaning Devices for Removal Efficiency by Particle Size, including Appendix J
- C. American Society of Mechanical Engineers (ASME):  
NQA-1-2008.....Quality Assurance Requirements for Nuclear Facilities Applications
- D. Underwriters Laboratories, Inc. (UL):  
900; Revision 15 July 2009 Test Performance of Air Filter Units

### **PART 2 - PRODUCTS**

#### **2.1 REPLACEMENT FILTER ELEMENTS TO BE FURNISHED**

- A. To allow temporary use of HVAC systems for testing and in accordance with Paragraph, TEMPORARY USE OF MECHANICAL AND ELECTRICAL SYSTEMS in Section 01 00 00, GENERAL REQUIREMENTS, provide one complete set of additional filters to the COR.
- B. The COR will direct whether these additional filters will either be installed as replacements for dirty units or turned over to VA for future use as replacements.

#### **2.2 EXTENDED SURFACE AIR FILTERS**

- A. Use factory assembled air filters of the extended surface type with supported or non-supported cartridges for removal of particulate matter in air conditioning, heating and ventilating systems. Filter units shall be of the extended surface type fabricated for disposal when the contaminant load limit is reached as indicated by maximum (final) pressure drop.
- B. Filter Classification: UL listed and approved conforming to UL Standard 900.

C. HVAC Filter Types (See also Equipment Schedules)

HVAC Filter Types Table 2.2C				
MERV Value ASHRAE 52.2	MERV-A Value ASHRAE 62.2 Appendix J	Application	Particle Size	Thickness /Type
8	8-A	Pre-Filter	3 to 10 Microns	50 mm (2-inch) Throwaway
11	11-A	After-Filter	1 to 3 Microns	150 mm (6-inch) or 300 mm (12-inch) Rigid Cartridge
13	13-A	After-Filter	0.3 to 1 Microns	150 mm (6-inch) or 300 mm (12-inch) Rigid Cartridge
14	14-A	After-Filter	0.3 to 1 Microns	150 mm (6-inch) or 300 mm (12-inch) Rigid Cartridge

D. HEPA Filters (See also Equipment Schedules)

HEPA Filters Table 2.2D				
Efficiency at 0.3 Micron	Application	Initial Resistance (inches w.g.)	Rated CFM	Construction
99.97	Final Filter	1.35	1100	Stainless Steel Frame X-Body
99.97	Final Filter	1.18	2000	16 ga. 304 SS frame
99.97	Final Filter	1.00	2000	Aluminum Frame V-Bank

**2.3 MEDIUM EFFICIENCY PLEATED PANEL PRE-FILTERS (2"; MERV 8; UL 900 CLASS 2):**

- A. Construction: Air filters shall be medium efficiency ASHRAE pleated panels consisting of cotton and synthetic or 100% virgin synthetic media, self supporting media with required media stabilizers, and beverage board enclosing frame. Filter media shall be lofted to a uniform depth and formed into a uniform radial pleat. The media stabilizers shall be bonded to the downstream side of the media to maintain radial pleats and prevent media oscillation. An enclosing frame of no less than 28-point high wet-strength beverage board shall provide a rigid and durable enclosure. The frame shall be bonded to the media on all sides to prevent air bypass. Integral diagonal support members on the air entering and air exiting side shall be bonded to the apex of each pleat to maintain uniform pleat spacing in varying airflows.
- B. Performance: The filter shall have a Minimum Efficiency Reporting Value of MERV 8 when evaluated under the guidelines of ASHRAE Standard 52.2. It shall also have a MERV-A of 8 when tested per Appendix J of the same

standard. The media shall maintain or increase in efficiency over the life of the filter. Pertinent tolerances specified in Section 7.4 of the Air-Conditioning and Refrigeration Institute (ARI) Standard 850-93 shall apply to the performance ratings. All testing is to be conducted on filters with a nominal 24" x 24" face dimension.

Minimum Efficiency Reporting (MERV)	8
Dust Holding Capacity (Grams)	105
Nominal Size (Width x Height x Depth)	24x24x2
Rated Air Flow Capacity (Cubic Feet per Minute)	2,000
Rated Air Flow Rate (Feet per Minute)	500
Final Resistance (Inches w.g.)	1.0
Maximum Recommended Change-Out Resistance (Inches w.g.)	0.66
Rated Initial Resistance (Inches w.g.)	0.33

C. Filters shall be approved and listed by Underwriters' Laboratories, Inc. as Class 2 when tested according to U. L. Standard 900 and CAN 4-5111.

**2.4 HIGH EFFICIENCY EXTENDED SURFACE (INTERMEDIATE/AFTER (FINAL)) CARTRIDGE FILTERS (12"; MERV 14/13/11; UL 900 CLASS 2):**

- A. Construction: Air filters shall consist of 8 pleated media packs assembled into 4 V-banks within a totally plastic frame. The filters shall be capable of operating at temperatures up to 80 degrees C (176 degrees F). The filters must either fit without modification or be adaptable to the existing holding frames. The molded end panels are to be made of high impact polystyrene plastic. The center support members shall be made of ABS plastic. No metal components are to be used.
- B. Media: The media shall be made of micro glass fibers with a water repellent binder. The media shall be a dual density construction, with coarser fibers on the air entering side and finer fibers on the air leaving side. The media shall be pleated using separators made of continuous beads of low profile thermoplastic material. The media packs shall be bonded to the structural support members at all points of contact, this improves the rigidity as well as eliminates potential air bypass in the filter
- C. Performance: Filters of the size, air flow capacity and nominal efficiency (MERV) shall meet the following rated performance specifications based on the ASHRAE 52.2-1999 test method. Where applicable, performance tolerance specified in Section 7.4 of the Air-Conditioning and Refrigeration Institute (ARI) Standard 850-93 shall

apply to the performance ratings. All testing is to be conducted on filters with a nominal 24"x24" header dimension.

Minimum Efficiency Reporting Value (MERV)	14	13	11
Gross Media Area (Sq. Ft.)	197	197	197
Dust Holding Capacity (Grams)	486	430	465
Nominal Size (Width x Height x Depth)	24x24x12	24x24x12	24x24x12
Rated Air Flow Capacity (cubic feet per minute)	2,000	2,000	2,000
Rated Air Flow Rate (feet per minute)	500	500	500
Final Resistance (inches w.g.)	2.0	2.0	2.0
Maximum Recommended Change-Out Resistance (Inches w.g.)	0.74	0.68	0.54
Rated Initial Resistance (inches w.g.)	0.37	0.34	0.27

## **2.5 HIGH EFFICIENCY PARTICULATE AIR (HEPA) FILTERS STANDARD CAPACITY (FINAL FILTER APPLICATION)**

- A. Air filters shall be HEPA grade standard capacity air filters with waterproof micro glass fiber media, corrugated aluminum separators, urethane sealant, 16-gauge 304 stainless steel enclosing frame and fluid sealing gasket. Sizes shall be as noted on drawings or other supporting materials. Filters shall be suitable for location downstream of AHU cooling coils, dispersion tube humidifier assemblies, etc. Filter materials shall be resistant to moisture absorption/filter pressure drop increase due to invisible vapor / supply air near saturation point.
- B. Construction: Filter media shall be one continuous pleating of microfine glass fiber media. Pleats shall be uniformly separated by corrugated aluminum separators incorporating a hemmed edge to prevent damage to the media. The media pack shall be potted into the enclosing frame with a fire-retardant urethane sealant. The enclosing frame shall be of 16-gauge 304 stainless steel and shall be bonded to the media pack to form a rugged and durable enclosure. The filter shall be assembled without the use of fasteners to ensure no frame penetrations. Overall dimensional tolerance shall be correct within  $-1/8"$ ,  $+0"$ , and square within  $1/8"$ . A poured-in-place seamless sealing gasket shall be included on the downstream side of the enclosing frame to form a positive seal upon installation.
- C. Performance: The filter shall have a tested efficiency of 99.97% when evaluated according to IEST Recommended Practice. Initial resistance to airflow shall not exceed  $1.18"$  w.g. at rated capacity. Filter shall be listed by Underwriters Laboratories as UL 900 and UL586. The filter



shall be capable of withstanding 10" w.g. without failure of the media pack. Manufacturer shall provide evidence of facility certification to ISO 9001:2000.

HEPA Performance (Standard Capacity) Table 2.5A		
Nominal Size (inches)	Airflow Capacity (cfm)	Media Area (Square Feet)
24H by 24W by 12D	1080 at 1.0" w.g.	153
24H by 12W by 12D	500 at 1.0" w.g.	33
Follow manufacturers' recommendation for change out resistance, typically double the initial.		

- D. Supporting Data: The filter shall be labeled as to tested efficiency, rated/tested cfm, pressure drop and shall be serialized for identification. The manufacturer shall supply a Certificate of Conformance for each HEPA filter supplied to the facility.

## **2.6 HEPA FILTERS HIGH CAPACITY V-BANK HIGH CAPACITY FILTERS (FINAL FILTER APPLICATION)**

- A. Air filters shall be absolute grade HEPA filters consisting of pleated media packs assembled in a V-bank configuration, polyurethane sealant, anodized aluminum enclosure and seamless fluid sealing gasket. Sizes shall be as noted on enclosed drawings or other supporting materials. Filters shall be suitable for location downstream of AHU cooling coils, dispersion tube humidifier assemblies, etc. Filter materials shall be resistant to moisture absorption/filter pressure drop increase due to invisible vapor / supply air near saturation point.
- B. Construction: Filter media shall be micro fiber glass formed into mini-pleat pleat-in-pleat V-bank design. The media packs shall be potted into the enclosing frame with fire retardant polyurethane sealant. An enclosing frame of anodized extruded aluminum shall form a rugged and durable enclosure. A seamless sealing gasket shall be included on the downstream side of the filter to form a positive seal upon installation.
- C. Performance: Filter efficiency at 0.3 micron shall be 99.99% when evaluated according to the IEST Recommended Practice for applicable type. Each filter shall be labeled as to tested performance. Initial resistance target shall not exceed 1.18" w.g. at rated airflow.

HEPA Performance V-Bank Style (High Capacity) Table 2.5B		
Nominal Size (inches)	Airflow Capacity (cfm)	Media Area (Square Feet)
24H by 24W by 12D	2000 at 1.0" w.g.	390
24H by 12W by 12D	900 at 1.0" w.g.	174
Follow manufacturers' recommendation for change out resistance, typically double the initial.		

- D. Supporting Data: The filter shall be labeled as to tested efficiency, rated/tested cfm, pressure drop and shall be serialized for identification. The manufacturer shall supply a Certificate of Conformance for each HEPA filter supplied to the facility.
- E. Filter must be listed as UL 586 and UL 900 per Underwriters Laboratories. Manufacturer shall provide evidence of facility certification to ISO 9001: 2000.

## **2.7 FILTER HOUSINGS/SUPPORT FRAMES**

- A. Side Servicing Housings (HVAC Grade)
  - 1. Filter housing shall be two-stage filter system consisting of 16-gauge galvanized steel enclosure, aluminum filter mounting track, universal filter holding frame, insulated dual-access doors, static pressure tap, filter gaskets and seals. In-line housing depth shall not exceed 21". Sizes shall be as noted on enclosed drawings or other supporting materials.
  - 2. Construction: The housing shall be constructed of 16-gauge galvanized steel with pre-drilled standing flanges to facilitate attachment to other system components. Corner posts of Z-channel construction shall ensure dimensional adherence. Where installed outdoors, the housing shall be weatherproof and suitable for rooftop/outdoor installation. The housing shall incorporate the capability of two stages of filtration without modification to the housing. A filter track, of aluminum construction shall be an integral component of housing construction. The track shall accommodate a 2" deep prefilter, a 6" or 12" deep rigid final filter, or a pocket filter with header. Insulated dual access doors, swing-open type, shall include high-memory sponge neoprene gasket to facilitate a door-to-filter seal. Each door shall be equipped with adjustable and replaceable positive sealing UV-resistant star-style knobs and replaceable door hinges. A universal holding frame constructed of 18-gauge galvanized steel, equipped with centering dimples, multiple fastener lances, and polyurethane filter sealing gasket, shall be included to facilitate installation of high-efficiency filters. The housing shall include a pneumatic fitting to allow the installation of a static pressure gauge to evaluate pressure drop across a single filter or any combination of installed filters.
  - 3. Performance: Leakage at rated airflow, upstream to downstream of filter, holding frame, and slide mechanism shall be less than 1% at 3.0" w.g. Leakage in to or out of the housing shall be less than one half of 1% at 3.0" w.g. Accuracy of pneumatic pressure fitting, when

to evaluate a single-stage, or multiple filter stages, shall be accurate within  $\pm 3\%$  at 0.6" w.g.

4. Manufacturer shall provide evidence of facility certification to ISO 9001:2000.

B. Holding Frame System (HVAC Grade-Temporary Gas Storage Room - Temporary OA Intake Air Plenum/Louver Assembly Only):

1. Air filter-holding frames shall be 16-gauge galvanized steel with filter sealing flange, centering dimples, sealing gasket and lances for appropriate air filter fasteners. Sizes shall be noted on drawings or other supporting materials.
2. Construction: Filter holding frame shall be constructed of 16-gauge galvanized steel. The frame shall be assembled from two corner sections and welded to assure a rigid and durable frame assembly. The frame shall include a variety of pre-punched lances for filter fastener attachment. Fastener shall be capable of being installed without the use of tools, nuts or bolts. Lance penetrations shall be upstream of filter flange to assure leak-free integrity. The frame shall include filter-centering dimples on each frame wall to facilitate ease of filter installation and assure filter centering against filter sealing flange. A 3/4" filter-sealing flange shall be an integral component of the holding frame. All corners shall be flush mitered and a permanently mounted polyurethane foam gasket shall be mounted on the sealing flange to assure filter to frame sealing integrity.
3. Manufacturer shall provide evidence of facility certification to ISO 9001:2000.

C. Built-up Bank AHU CARTRIDGE FILTER and HEPA Holding Frames

1. Holding frames shall be constructed of 14-gauge galvanized steel. Frames shall be welded and include centering dimples, pre-drilled mounting holes, filter sealing flange and swing bolt assemblies. An appropriate number of swing bolts to match air filters shall also be included. Sizes shall be as noted on drawings or other supporting materials.
2. Construction: Filter frame shall be all-welded construction of 14-gauge galvanized steel. The frame shall include pre-drilled mounting holes to align frame-to-frame and ensure built-up bank support. Annular based centering dimples shall be an integral component to assist in proper seating of filter gasket to filter sealing flange. Assembly holes shall be within dimples to recess assembly bolts. Filter securing swing bolt assemblies, of the same construction as

- the frame, shall be offset to facilitate multiple filter installations. The assembly shall include appropriate swing bolts to match filter depth and equi-bearing clamps to allow uniform filter gasket sealing.
3. Performance: The sealing assembly shall be capable of sealing each element with 30 inch/lbs. of torque to 50% filter gasket compression. Manufacturer shall provide evidence of facility certification to ISO 9001:2000.
- D. Bag-in/Bag-out (BIBO) HEPA Air Filter Housing - RECOMMENDED REPLACEMENT OF EXISTING ROOFTOP EF-16 AND EXISTING SIXTH FLOOR PENTHOUSE ISOLATION ROOM SIDE ACCESS HEPA FILTER HOUSING - CURRENTLY NOT IN SCOPE - REPLACEMENT OF THIS FAN/FILTER TO UPGRADE TO NEW ROOFTOP FAN/BIBO HEPA FILTER ASSEMBLY IS NOT INCLUDED IN THIS PROJECT.
1. Housing shall be side-access bag-in/bag-out, fluid seal housing. The housing shall be adequately reinforced to withstand a negative or positive pressure of 15" water gage. Housing design and filter arrangement shall allow air to enter and exit housing without changing direction. The housing shall accommodate standard size filters that do not require any special attachments or devices to function properly in the housing. The housing shall accommodate fluid seal filters which require a penetrating knife edge installed on all filter sealing surfaces. The knife edge shall insert into the fluid filled perimeter channel located on the face of the filter. By engaging the filter seal/release mechanism the filter shall move (push) the fluid filled channel to the sealed position. For removal of the air filters the filter seal/release mechanism shall remove (pull) the filter free of the blade type knife edge. This entire process is performed from inside the filter change out bag.
2. Construction:
- a. Housing shall be constructed of 14 gauge and 11 gauge T-304 stainless steel metal. All pressure retaining joints and seams shall be continuously welded with no porosities. Joints and seams requiring intermittent welds, such as reinforcement members, shall be intermittently welded. Housing shall be free of burrs and sharp edges. All weld joints and seams that are a portion of any gasket setting surface, and duct connection flanges, shall be ground smooth and flush with adjacent base metals. All welded joints and seams shall be wire brushed to remove heat discoloration. The housing shall be reinforced to withstand a positive or negative

pressure of 15" w.g. The upstream and downstream ductwork connections shall have 1 1/2" outward-turned flanges.

- b. The housing shall have a bagging ring around each filter access port that is sealed by a gasketed filter access door. The filter access door gasket shall be silicone and shall be replaceable, if necessary. The bagging ring shall have two (2) continuous formed raised ridges to secure the PVC change-out bag. The bagging ring shall be hemmed on the outer edge to prevent the change-out bag from tearing.
  - c. Ancillary hardware including filter seal/release mechanism, door handles, door studs and labels shall be 300 series stainless steel. Filter access door knobs shall be cast aluminum and designed to prevent galling of threads.
  - d. One (1) PVC change-out bag shall be furnished with each filter access port. Change-out bags shall be 8-mil. thick with a yellow translucent, non-sticking, matte finish. It shall include a 1/4" diameter elastic shock cord hemmed into the opening of the bag so when stretched around the housing bagging ring flange, a secure fit is created. The bag shall include three (3) integral glove ports to assist in filter change-out. One (1) nylon security strap shall be included per filter access port to prevent the bag from sliding off the bagging flange during the change-out process. Design of components shall be such that all change-out operations shall be within the bag so there is a barrier between the worker and the filter at all times.
3. Performance: All welding procedures, welders, and welder operators shall be qualified in accordance with ASME Boiler and Pressure Vessel Code, Section IX. All production welds shall be visually inspected by qualified personnel, incorporating the workmanship acceptance criteria described in Section 5 & 6 of AWS D9.1-1990, Specification for Welding of Sheet Metal.
4. The filter housing shall be factory tested for filter fit, alignment of filter sealing knife edge and operation of filter clamping mechanism. The filter sealing surface and the complete assembly pressure boundary shall be leak tested by the pressure decay method as defined in ASME N510-1995 Reaffirmed., Testing of Nuclear Air Cleaning Systems, paragraphs 6 and 7. The filter sealing surface shall be tested at +10" water gage and have a maximum leak rate of 0.0005 cfm per cubic foot of housing volume. The overall system

- pressure boundary shall be leak tested at +15" water gage and have a maximum leak rate of 0.0005 cfm per cubic foot of housing volume.
5. Filter bags shall be capable of continuous operating to temperature extremes of -18°C to 66°C (0°F to 150°F).
  6. Multi-wide housing shall be equipped with a filter removal rod to pull the filters to the change-out position. The removal rod shall operate from the inside of the filter change out bag.
  7. Manufacturer shall provide evidence of facility certification to ISO 9001:2000.
- F. Equipment Identification: Section 23 05 11, COMMON WORK RESULTS FOR HVAC AND STEAM GENERATION.

## **2.8 AIR HANDLING UNIT - AIR PURIFICATION SYSTEM**

- A. The air purification system will be mounted in the air handling unit within the new Penthouse Equipment Module as shown on the project drawings. The system shall utilize both Ultraviolet Germicidal Irradiation (UVGI) using UVC lamps and Photocatalytic Oxidation (PCO) using TiO<sub>2</sub> coated media.
- B. The assemblies shall be housed in self-contained stainless steel casings with all ballasts prewired for installation into the air handling unit filter accessory section.
- C. The system is being installed to control odors (especially total volatile organic compound (TVOC) odors, pollen, mold spores, mildew and irritants. The system shall also decrease airborne bacteria, and microbes. The system provider must submit documentation showing proof of the system effectiveness.
- D. The unit casing shall be of single wall construction, fabricated of stainless steel sheet metal. All portions of the casing shall be free from sharp edges and burs. The casing depth shall be nominally six (6) inches.
- E. The unit shall be rated for a maximum velocity across the face of 500 feet per minute. Pressure drop through the unit shall not exceed 0.25 in. wg.
- F. UVGI Lamps and ballasts shall be designed specifically to provide type-C ultraviolet light with a wavelength at or near 25.37 Angstroms. Lamps shall be non-ozone-producing. Sufficient lamps shall be provided and positioned as to achieve a minimum coverage of 5 milliwatts per square inch of UVC light across all exposed surfaces of the PCO media.
- G. PCO Media shall consist of six-inch non-metallic media with face area to match casing opening, pleated at one pleat per inch (nominal) with a 40-

200 nanometer TiO<sub>2</sub> coating. PCO media shall be placed perpendicular to the air stream in the unit casing.

- H. Electrical/Control: The unit(s) will be constructed to function on standard 120 VAC. The penthouse equipment module manufacturer/electrical contractor/installer shall provide a junction box at the point of connection. The unit(s) shall be capable of being shut down as part of an AHU shutdown command and/or AHU failure and proven shut down in DDC / building automation control system (BAS). Unit(s) operating status must be monitored and alarmed in DDC / BAS. Unit is intended to be operational continuously with the AHU operation. Safety switch(es) at AHU door(s) required to ensure purification unit shut down upon entry to AHU. Refer to AHU details, AHU sequences of operation and equipment schedules for additional information/requirements.

## **2.9 INSTRUMENTATION**

- A. Magnehelic Differential Pressure Filter Gages: Nominal 100 mm (four inch) diameter, zero to 500 Pa (zero to two inch water gage), three inch for HEPA) range, except for MERV 17 HEPA Final Filters, where the range shall be zero to 750 Pa (zero to three inch water gage). Gauges shall be flush-mounted in aluminum panel board, complete with static tips, copper or aluminum tubing, and accessory items to provide zero adjustment.
- B. DDC static (differential) air pressure measuring station. Measure and alarm differential pressure across each filter stage within the BAS. Refer to Specification Section 23 09 23 DIRECT DIGITAL CONTROL SYSTEM FOR HVAC and control diagrams/sequences of operation for additional requirements.
- C. Provide one DDC sensor across each extended surface filter. Provide Petcocks for each gauge or sensor.
- D. Provide one common local filter gauge for two-stage filter banks with isolation valves to allow differential pressure measurement.

## **2.10 HVAC EQUIPMENT FACTORY FILTERS**

- A. Manufacturer standard filters within fabricated packaged equipment should be specified with the equipment and should adhere to industry standard.
- B. Cleanable filters are not permitted.
- C. Automatic Roll Type filters are not permitted.

## **2.11 FILTER RETURN GRILLES**

Refer to Section 23 37 00 AIR OUTLETS AND INLETS.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Install supports, filters and gages in accordance with manufacturer's instructions.
- B. Label clearly with words "Contaminated Air" on exhaust ducts leading to the Isolation room exhaust HEPA filter housing.
- C. Air Handling Unit - Air Purification System:
  - 1. The AHU manufacturer shall coordinate the installation of the air purification system equipment with the purification system manufacturer and the electrical contractor/installer.
  - 2. The AHU manufacturer shall install the outline frames of the modules per the manufacturer's instructions.
  - 3. The AHU manufacturer electrical contractor/installer shall supply a single phase 120 VAC, where shown on the drawings. Maximum current draw for each of the two units is 60 AMPS.
  - 4. Electrical wiring and connections are specified in Division 26 Sections.
  - 5. Install air purification equipment and controls per manufacturer's instructions

### **3.2 START-UP AND TEMPORARY USE**

- A. Clean and vacuum air handling units and plenums prior to starting air handling systems.
- B. Replace Pre-filters and install clean filter units prior to final inspection as directed by the COR.
- C. A factory-authorized representative of the air purification equipment manufacturer shall provide installation of sensors and system start-up. AHU manufacturer shall coordinate AHU factory installation and verification of the air purification system operation.
- D. A factory-authorized representative will produce system function test verifying system operation at project site as part of commissioning efforts prior to AHU start up at the completion of project Phase 2 (prior to serving active Operating rooms) and as final system verification prior to overall project completion/turn-over to the client.

### **3.3 COMMISSIONING**

- A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.



B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

C. DEMONSTRATION AND TRAINING - Air Purification System

1. Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.
2. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS.

- - E N D - -



**SECTION 23 74 43**  
**CUSTOM, OUTDOOR, AIR-HANDLING UNITS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Roof top air handling units including integral components specified herein. Unit to be designed to be curb mounted and curb is to be provided under this section.
- B. Definition of Roof Top Air Handling Unit (Roof Top Units, RTU): A factory fabricated assembly consisting of fan, coils, filters, and other necessary equipment to perform one or more of the following functions of circulating, cleaning, heating, cooling, humidifying, dehumidifying, and mixing of air. Design capacities of units shall be as scheduled on the drawings.

**1.2 SEISMIC PERFORMANCE:**

- A. Units shall withstand effects of earthquake motions determined according to SEI/ASCE7.
- B. Seismic requirements apply to all unit components including fans, coils, humidifier, all piping, pumps, heat exchanger system components, electrical systems and roof curb.
- C. The term "withstand" means "the unit will remain in place without separation of any parts from the device when subjected to the seismic forces specified."
- D. Each unit shall have a prominently displayed IBC 20012 Seismic Compliance Label issued by an independent third party approval agency.

**1.3 RELATED WORK**

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC: General mechanical requirements and items, which are common to more than one section of Division 23.
- B. Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT: Sound and vibration requirements.
- C. Section 23 07 11, HVAC and BOILER PLANT INSULATION: Piping and duct insulation.
- D. Section 23 21 13, HYDRONIC PIPING and Section 23 22 13, STEAM and CONDENSATE HEATING PIPING: Piping and valves.
- E. Section 23 82 16, AIR COILS: Heating and cooling coils and pressure requirements.

- F. Section 23 34 00, HVAC FANS: Return and exhaust fans.
- G. Section 23 31 00, HVAC DUCTS and CASINGS: Requirements for flexible duct connectors, sound attenuators and sound absorbing duct lining.
- H. Section 23 40 00, HVAC AIR CLEANING DEVICES: Air filters and filters' efficiency.
- I. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: HVAC controls.
- J. Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC: Testing, adjusting and balancing of air and water flows.
- K. Section 23 05 12, GENERAL MOTOR REQUIREMENTS FOR HVAC and STEAM GENERATION EQUIPMENT: Types of motors.
- L. Section 26 29 11, LOW-VOLTAGE MOTOR STARTERS: Types of motor starters.
- M. Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS:
- N. Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS: Requirements for commissioning, systems readiness checklists, and training.

#### **1.4 QUALITY ASSURANCE**

- A. Refer to Article, Quality Assurance, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Air Handling Units Certification
  - 1. Air Handling Units with Housed Centrifugal Fans: The air handling units shall be certified in accordance with AHRI 430 and tested/rated in accordance with AHRI 260.
  - 2. Air Handling Units with Plenum Fans:
    - a. Air Handling Units with a single Plenum Fan shall be certified in accordance with AHRI 430 and tested/rated in accordance with AHRI 260.
    - b. Air handling Units with Multiple Fans in an Array shall be tested and rated in accordance with AHRI 430 and AHRI 260.
- C. Heating, Cooling, and Air Handling Capacity and Performance Standards: AHRI 430, AHRI 410, ASHRAE 51, and AMCA 210.
- D. Performance Criteria:
  - 1. The fan BHP shall include all system effects for all fans and v-belt drive losses for housed centrifugal fans.
  - 2. The fan motor shall be selected within the rated nameplate capacity, without relying upon NEMA Standard Service Factor.
  - 3. Select the fan operating point as follows:

- a. Forward Curve and Axial Flow Fans: Right hand side of peak pressure point.
  - b. Air Foil, Backward Inclined, or Tubular Fans Including Plenum Fans: At or near the peak static efficiency but at an appropriate distance from the stall line.
4. Operating Limits: AMCA 99 and Manufacturer's Recommendations.
- E. Units shall be factory-fabricated, assembled, and tested by a manufacturer, in business of manufacturing similar air-handling units for at least five (5) years.

**1.5 SUBMITTALS:**

- A. The contractor shall, in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES, furnish a complete submission for all roof top units covered in the project. The submission shall include all information listed below. Partial and incomplete submissions shall be rejected without reviews.
- B. Manufacturer's Literature and Data:
1. Submittals for RTUs shall include fans, drives, motors, coils, humidifiers, mixing box with outside/return air dampers, filter housings, and all other related accessories. The contractor shall provide custom drawings showing total air handling unit assembly including dimensions, operating weight, access sections, flexible connections, door swings, controls penetrations, electrical disconnect, lights, duplex receptacles, switches, wiring, utility connection points, unit support system, vibration isolators, drain pan, pressure drops through each component (filter, coil etc) and rigging points.
  2. Submittal drawings of section or component only, will not be acceptable. Contractor shall also submit performance data including performance test results, charts, curves or certified computer selection data; data sheets; fabrication and insulation details; if the unit cannot be shipped in one piece, the contractor shall indicate the number of pieces that each unit will have to be broken into to meet shipping and job site rigging requirements. This data shall be submitted in hard copies and in electronic version compatible to AutoCAD version used by the VA at the time of submission.

3. Submit sound power levels in each octave band for fan and at entrance and discharge of RTUs at scheduled conditions. Include sound attenuator capacities and itemized internal component attenuation. Internal lining of supply air ductwork with sound absorbing material is not permitted. In absence of sound power ratings refer to Section 23 05 41, NOISE AND VIBRATION CONTROL FOR HVAC PIPING AND EQUIPMENT.
4. Provide fan curves showing Liters/Second (cubic feet per minute), static pressure, efficiency, and horsepower for design point of operation and at maximum design Liters/Second (cubic feet per minute) and 110 percent of design static pressure.
5. Submit total fan static pressure, external static pressure, for RTU including total, inlet and discharge pressures, and itemized specified internal losses and unspecified internal losses. Refer to air handling unit schedule on drawings.
- C. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS. Include instructions for lubrication, filter replacement, motor and drive replacement, spare part lists, and wiring diagrams.
- D. Submit written test procedures two weeks prior to factory testing. Submit written results of factory tests for approval prior to shipping.
- E. Completed System Readiness Checklists provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 23 08 00 COMMISSIONING OF HVAC SYSTEMS.
- F. Submit shipping information that clearly indicates how the units will be shipped in compliance with the descriptions below.
  1. Units shall be shipped in one (1) piece where possible and in shrink wrapping to protect the unit from dirt, moisture and/or road salt.
  2. If not shipped in one (1) piece, provide manufacturer approved shipping splits where required for installation or to meet shipping and/or job site rigging requirements in modular sections. Indicate clearly that the shipping splits shown in the submittals have been verified to accommodate the construction constraints for rigging as required to complete installation and removal of any section for replacement through available access without adversely affecting other sections.

3. If shipping splits are provided, each component shall be individually shrink wrapped to protect the unit and all necessary hardware (e.g. bolts, gaskets etc.) will be included to assemble unit on site (see section 2.1.A4).
4. Lifting lugs will be provided to facilitate rigging on shipping splits and joining of segments. If the unit cannot be shipped in one piece, the contractor shall indicate the number of pieces that each unit will have to be broken into to meet shipping and job site rigging requirements.

#### **1.6 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air-Conditioning, Heating, and Refrigeration Institute (AHRI):
  - 260-01.....Sound Rating of Ducted Air Moving and  
Conditioning Equipment
  - 410-01.....Standard for Forced-Circulation Air-Heating and  
Air-Cooling Coils
  - 430-09.....Standard for Central Station Air Handling Units
  - AHRI-DCAACP.....Directory of Certified Applied Air Conditioning  
Products
- C. Air Moving and Conditioning Association (AMCA):
  - 210-07.....Laboratory Methods of Testing Fans for Rating
- D. Anti-Friction Bearing Manufacturer's Association, Inc. (AFBMA):
  - 9-90 (R2008).....Load Ratings and Fatigue life for Ball Bearings
- E. American Society of Heating, Refrigerating and Air Conditioning  
Engineers (ASHRAE):
  - 51-2007.....Laboratory Methods of Testing Fans for Rating
- F. American Society for Testing and Materials (ASTM):
  - A653/653M-02.....Steel Sheet, Zinc-Coated (Galvanized) or Zinc-  
Iron Alloy-Coated (Galvannealed) by the Hot-Dip  
Process
  - B117-07a.....Salt Spray (Fog) Testing
  - C1071-05e1.....Standard Specification for Fibrous Glass Duct  
Lining Insulation (Thermal and Sound Absorbing  
Material)

- D1654-08.....Standard Method for Evaluation of Painted or  
Coated Specimens Subjected to Corrosive  
Environments
- D1735-08.....Water Resistance of Coatings Using Water Fog  
Apparatus
- D3359-08.....Standard Test Methods for Measuring Adhesion by  
Tape Test
- E84-10.....Standard Test Method for Surface Burning  
Characteristics of Building Materials
- G. Anti-Friction Bearing Manufacturer's Association, Inc. (AFBMA):  
9-90.....Load Ratings and Fatigue life for Ball Bearings
- H. Military Specifications (Mil. Spec.):  
DOD-P-21035A-2003.....Paint, High Zinc Dust Content, Galvanizing  
Repair
- I. National Fire Protection Association (NFPA):  
NFPA 90A.....Standard for Installation of Air Conditioning  
and Ventilating Systems, 2009
- J. Energy Policy Act of 2005 (P.L.109-58

## **PART 2 - PRODUCTS**

### **2.1 ROOF TOP AIR HANDLING UNITS**

- A. Units shall be factory-fabricated, custom type, factory prewired for single-point field power connection (Main Electrical Service, and single-point 120V Circuit for the service receptacles, lights and miscellaneous fractional horsepower loads. and prepared for field furnished and wired controls.
1. Provide all electrical wiring, devices and equipment as documented and specified by Divisions 23 and 26.
  2. When shipped in sections, ship each section complete with all interconnecting wiring and accessories required for installation.
  3. Custom air handling units, consisting of all sections equipment, ladders, stairs and flooring indicated on the Drawings and specified in this Section shall have a total unit leakage, including infiltration cfm plus exfiltration cfm, of 1/2 percent of design cfm airflow at 1.25 X design static pressure.
- B. UNIT BASE
1. Construct each section on a minimum 6 inch high aluminum or painted G90 galvanized HSS steel structural base.



2. Base construction unit floor plate material shall be 10 gauge aluminum checker plate, consisting of electrically welded.
    - a. Flooring plate members are to 2 inch turn up and seams fully welded along outside wall and vestibule and active sections of the unit interface to provide a watertight surface for wash down of interior of unit.
  3. Deductive alternate unit flooring is to have flooring constructed of 16 gauge minimum galvanized plates.
  4. Base is to be clean shot or sandblasted primed with rust-inhibiting primer, and finished with exterior enamel paint or epoxy mastic.
  5. The base of each shipping section shall have removable lifting lugs. Indicate balance point on section bases.
- C. DOUBLE-WALL INSULATED HOUSING (WALL, ROOF AND PARTITION)
1. Exterior Panels: 16 gauge textured aluminum for poured-in-place foam panel units.
  2. Interior liners shall be constructed of 20 gauge stainless steel 12 inches upstream and 30 inches downstream from cooling coil and humidifier.
  3. Limit wall, roof and floor deflection to not exceed an L/240 ratio when the unit casing is pressurized to  $\pm 10$  in. w.g. Deflection shall be measured at the midpoint of the panel height. Total housing leakage shall not exceed 1% of rated cfm when the unit casing is pressurized to  $\pm 10$  in. w.g.
  4. Insulation shall be injected CFC free polyurethane foam encased in double-wall casing between exterior and interior panels such that no insulation can erode to the air stream. Insulation shall be 2 inch thick, minimum, and 3.0 lb/ft<sup>3</sup> density with a total thermal resistance (R-value) of approximately 13.0 hr-ft<sup>2</sup> °F/BTU. Units with less than 3 inch of insulation in any part of the walls, floor, roof or drain pan shall not be acceptable. The insulation shall comply with NFPA 90-A for the flame and smoke generation requirements.
  6. Housing Framing Type: Support interior and exterior sheets by continuous galvanized steel or aluminum extended internal members spanning between the floor and the roof, spanning across roof, and spaced to limit sheet deflections to 1/200th of span at design differential pressure across the housing.
    - a. Panel and framing design, by using "no thru-metal" type

construction, shall not permit exterior surface temperature to fall below dew point of 72 deg F at design ambient conditions of 95 deg F DB/78 deg F WB, when air within unit is 50 deg F.

7. Housing Assembly: Fasten sheets to internal support members with stainless steel sheet metal screws, plated bolts or by spot-welding not to exceed 9 inches on centers.
  8. Electrostatically and thermally isolate dissimilar metals.
  9. Roof shall pitch 1/4-inch per foot to the side opposite service compartment if installed, or to the side of unit without access doors, or shall be peaked on the centerline. Construct housing to simultaneously withstand specified differential pressure load, required snow load of 31 lb/ft<sup>2</sup> and wind load of 90 mph wind speed/1.15 importance factor/Exposure B.
    - a. The roof shall be a standing-seam metal type.
  10. Seal wall piping and conduit penetrations using a cast packing gland, such that a compression seal within the gland provides a removable-airtight seal around the pipe-conduit.
  11. Coordinate with Division 23 Mechanical, Division 26 Electrical and Division 23 Building Automation Systems Contractors the exact location of ductwork, piping, electrical conduit and control wiring entering and exiting the custom penthouse unit.
  12. Provide flanged openings for airtight attachment of field ductwork.
- D. INSULATION
1. Install insulation to completely fill space between exterior and interior sheets and within framing members, such that the entire wall surface is totally insulated without voids.
  2. Insulation Thickness and Type:
    - a. Roof: 2 inch thick polyurethane foam.
    - b. Walls, Exterior-to-Outside: 2 inch thick polyurethane foam.
    - c. Service Corridor Walls, Interior: 2 inch thick polyurethane foam
    - d. Partitions and Floor between Supply Air, Outdoor Air and Exhaust Air: 2 inch thick polyurethane foam.
    - e. Floor of unit: 2 inch thick polyurethane foam.
- E. FLASHINGS AND CLOSURES
1. Provide flashings, corner moldings and metal closures to weatherproof the unit. Material and finish shall be same as

adjacent sheets.

F. FASTENERS

1. Manufacture fasteners from Type 304 stainless steel or 5/16" plated bolt. Sheet metal screws shall not penetrate the casing in a manner that could allow air or water leakage over the life of the unit.

G. PLENUM SECTIONS

1. Discharge plenum sections shall be as indicated on Drawings. Provide duct flanged collars of sizes to match the connecting duct sizes indicated on Drawings. Construct discharge plenums as described above for housings. Provide access doors where indicated on Drawings. Floor opening to have framed, grated opening.
2. Plenum sections (without access doors) shall be suitable for installation between any two unit components. Width shall be as indicated on Drawings. Where no width is indicated, width shall be 18 inches. Use shorter sections as required to connect unit components with minor size differences. Construct plenum sections as described above for housings.
3. In order to reduce airflow pressure losses, provide 45 deg., multi-sided flare outs, minimum 6 inches deep, for entry and exit openings into and from plenums and ductwork.

H. ACCESS SECTIONS

1. Access sections shall be suitable for installation between any two unit components and shall be at least 30 inches wide. Construct access sections as described above for housings. Provide access doors as indicated on Drawings. Construct access doors as described above.

I. SERVICE CORRIDOR FLOORS

1. Floors shall be aluminum tread plate, with welded seams to produce a watertight floor system. The perimeter of the floor-plate shall have a 2 inch lip turned up and seam welded.
  - a. Underside of the floor plate shall be welded to the structural base frame to prevent "oil-canning" or objectionable deflection.
2. Holes provided in floor for pipe entry shall be neatly cut, and exposed edges framed by structural angles for large openings, or by metallic sleeves welded in place for smaller openings.
  - a. Floor opening framing and sleeves shall extend up into the unit

two inches and be fully seam welded to form a dam.

2. Insulate under the floor with 2 inch thick foam insulation.  
Insulation on top of the floor is not acceptable.
3. The maximum live load floor deflection shall not exceed the lesser of  $L/360$  and 1/2 inch.

J. ACCESS PANELS

1. Provide removable, bolted, gasketed access panels where indicated on Drawings and as required for removal of equipment. Size and locate panels for removal of largest piece of equipment in section which panel serves.
  - a. Provide panels with lifting lugs and handles.

K. ACCESS DOORS

1. Provide access doors where indicated on Drawings, and for sections which require regular inspection or maintenance, and for service compartments or closets.
2. Doors shall be of the same construction as the housing. Door and frame assembly shall utilize a true "no thru metal" construction, and shall not allow condensation on exterior surfaces at design operating conditions.
3. Doors shall have stainless steel strap hinges for the full height of the door, an extruded aluminum door frame and shall seal against 2 separate but continuous surfaces (double-gasketed) using a adhesive backed closed cell foam gasket. Provide doors accessing sections containing rotating equipment, or containing fume-laden or contaminated air, with special tool or common key for locking. Arrange door swing so that differential pressure across door shall assist in compress the gasket on two surfaces.
  - a. Provide two chrome-plated brass handles for each side of each door which shall open from both sides.
  - b. Approved Door Handle Manufacturer: Ventlok Model 310.
4. Doors shall be 72 inches high. If the unit height is smaller than 72 inches, doors shall be equal to the unit height. Minimum door clear-openings width shall be 20-inches. For fan sections, the door width shall be at least 4-inches wider than the width of the fan motor.
  - a. Provide a rain lip above each outdoor access door.
5. Access doors shall have been tested in an independent laboratory in

accordance with the referenced ASTM standard E283. A 24 inch wide by 60 inch high assembly shall withstand 25" of water column test chamber pressure. Air infiltration shall not exceed 0.41 cfm/lineal foot of panel frame opening at 11 inches water column.

L. ROOF CURB

1. Furnish curbs constructed of heavy gage galvanized steel.
2. Build roof curb in sections.
3. Curb shall be constructed with bracing to meet seismic requirements for whole rooftop air handling unit.
4. Insulate roof curb with minimum 1.5 inch rigid fiberglass insulation.
5. Provide wood nailer top rail to attach roofing membrane.
6. Furnish gasket to be installed between unit and curb to provide a weather-tight seal.
7. Interior Height: Minimum unobstructed clear height of 18 inches.
8. Roof curb shall be fully enclosed with sheetmetal on all sides, including the bottom.
9. Provide required counterflashing.

M. FILTER SECTIONS

1. Provide filters as specified in Section 234000, arranged as indicated on Drawings and with performance scheduled on Drawings.
2. Provide air filter gauges for each bank of filters. The filter gauge shall be a diaphragm actuated, dial type gauge with zero adjustment, 3-way vent valves, static pressure taps, integral compression fittings on both valves and taps, and aluminum surface mounting bracket with screws.
  - a. Approved Manufacturer: Dwyer Series 2000 Magnehelic.
3. Air Purification-Filtration System (Specialty Filter/UV system) - refer to specification section 23 40 00, HVAC AIR CLEANING DEVICES for requirements. Refer to AHU configuration drawing, equipment schedules and details for additional information.

N. AUTOMATIC CONTROL DAMPERS

1. General:

- a. Provide dampers with static pressure ratings that comply with the rating of the ductwork or system in which they are installed.
  - b. Damper Configuration:
    - 1) Dampers for modulating service shall be opposed blade design.
    - 2) Dampers for two-position service shall be parallel blade design.
    - 3) Dampers for Air Handling Unit mixing box applications shall be parallel blade design.
  - c. The BAS Contractor shall field furnish and install electronic damper actuators, as specified elsewhere, of sufficient capacity to ensure smooth operation under all design loading conditions.
    - 1) Actuators shall be capable of providing 125 percent of the required maximum opening torque.
    - 2) Provide hardware for mounting actuators.
2. Control Dampers - 2 to 10 Inch W.C. Service
- a. Damper construction:
    - 1) Blades: 16 Gage galvanized steel, airfoil type double skinned, maximum length 48 inches, maximum width 6 inches.
    - 2) Axles shall be 1/2-inch diameter, plated steel.
    - 3) Blade edge seals: EPDM.
    - 4) Bearings: Stainless steel.
    - 5) Frame: 12 Gage galvanized steel high hat channel.
    - 6) Jamb seals: Stainless steel compression type.
    - 7) Finish: Rust-resistant enamel.
  - b. Leakage rate shall not exceed 0.07 percent of maximum flow, at 10 inches W.C. differential for 48 in. damper width.
  - c. Operating temperature limits shall be minus 10 deg F. to plus 250 deg F., minimum.
  - d. Dampers shall be Ruskin CD30AF1 Ultra-Low Leakage or approved equivalent, subject to compliance with requirements.
  - e. Outdoor Air and Relief Air Control Dampers; Furnish opposed blade design dampers (OBD).
  - f. Return Air Control Dampers: Furnish parallel blade design dampers (PBD). Dampers to close directing return airflow

toward the outdoor air intake.

- g. Supply Air Discharge Dampers: Furnish opposed blade design dampers (OBD). If installed at fan discharge furnish vertical-blade type, not horizontal-blade.
  - h. Exhaust Air Inlet Dampers: Furnish opposed blade design dampers (OBD).
3. Dampers shall utilize linkages concealed in the frame such that no blade linkages or connecting rods are located in the airstream.
- a. Coordinate damper installation such that all bearings and linkages are accessible for maintenance.
  - b. Do not use concealed frame linkages when more than two sections are required.
4. Automatic damper assemblies, consisting of multiple automatic damper sections, shall be sized (maximum blade width) to meet the maximum duct velocity in which the individual automatic damper assembly is to be installed, and under no circumstances shall the maximum individual automatic damper blade length (maximum damper section width) exceed 60 inches.
- a. Dampers shall be capable of withstanding up to 4000 fpm with a 12 inch damper blade width.
5. Louvers: Provide outside air openings with stormproof louvers and birdscreens. Intake louver face velocities not to exceed 375 fpm. Relief louver face velocity not to exceed 450 fpm.

O. FAN SECTION

1. Supply and return fans are to be an array of multiple plenum fans with the following features:
- a. Piezometer type air flow sensor with transducer to interface with the BAS.
  - b. Inertia base and 2 inch deflection spring vibration isolators
  - c. Five year warranty on all moving parts.
  - d. Automatic, normally closed, 120 V, spring return, parallel blade isolation dampers for each fan with a maximum face velocity of 2000 FPM maximum.
  - e. Two fans maximum, are permitted to be driven by one Variable Frequency Drive.
  - f. Fans are to be direct drive.
2. Provide fans of type and with performance scheduled on Drawings and

as specified in Section 233400, and arranged as indicated on Drawings.

3. Plenum Fans:

- a. Center fans in the vertical plane within the unit.
  - b. When multiple fans are called for on the drawings, inlet automatic isolation dampers are required for each fans. Face velocity of the inlet damper shall be 2000 FPM maximum.
  - c. Provide piezometer type flow sensor in the inlet bell for each fan.
  - d. Two fans maximum, are permitted to be driven by one Variable Frequency Drive.
  - e. Fans are to be direct drive.
4. Provide vibration isolation devices as specified in Section 230541. Isolate fan discharge by a flexible duct connection. Statically and dynamically balance fans after installation in fan section.
5. Motor and motor drives shall comply with Section 230512.
6. Provide an automatic grease dispensing unit with all required accessories for bearing lubrication.
7. Arrange the fan compartment so that the space between the fan inlets and the housing or previous component is a minimum of 75% of one fan diameter.

P. HEATING AND COOLING COIL SECTIONS

1. Provide coils with copper tubes and copper fins and as specified in Section 238216, as arranged on Drawings, and with performance scheduled on Drawings.
2. Support coils on Type 304L stainless steel tracks extending continuously full width of unit to allow coils to be readily slipped in or out of unit.
3. Cooling Coil Drain Pans:
  - a. Where coils are stacked, provide an intermediate drain pan for each bank of coils, with factory-piped Type 304L stainless steel drain tubes at both housing ends piped to the main drain pan.
  - 1) Intermediate drain pans shall be Type 304L stainless steel, two inches deep and shall extend 12 inches downstream and 4-inches upstream of the coil. Intermediate drain pans shall extend over entire width of coil bank including



return bends and headers.

- b. Main drain pan shall extend over entire width of coil section including return bends and headers, shall be 4-inches deep and shall extend full depth of coil section and downstream access section. Main drain pan shall be of double-wall insulated construction with Type 304L stainless steel liner or an extension of the aluminum floor plate formed to provide a 2 inch deep pan.
- c. Double-slope main and intermediate drain pans in the direction of airflow toward a drain outlet located at lowest point of pan. For horizontal outlets, the drain invert shall be below the lowest point of pan wetted surface.
- d. For units wider than 12 feet, provide a quadruple-sloped drain pan (i.e., double-sloped to two sides).
4. Provide gasketed and caulked safe-off panels between coils and casing walls to prevent air bypass. Safeing shall be of 16 ga 304 ss double walled and insulated.
5. Coil headers shall be within coil section. Header connection piping shall extend through casing walls and be sealed airtight. Provide piping as specified in Section 232113.
6. Interior sheets of coil and access sections with drain pans shall be solid Type 304 stainless steel.
7. Fasteners in coil sections shall be Type 304 stainless steel.
8. Primary and secondary pans shall extend 1" beyond headers and U-bends on each side of coils.

#### Q. HUMIDIFIER SECTION

1. Provide humidifiers as specified in Section 232213, as arranged on Drawings, and with performance scheduled on Drawings. Connection piping shall extend through casing walls and be sealed airtight. Provide piping as specified in Section 232113.
2. Length of humidifier section extending downstream of dispersion tube bank shall permit total absorption of injected steam.
3. Interior sheets of humidifier section shall be solid Type 304 stainless steel.

#### R. STEAM TO HOT WATER GENERATION SYSTEM

1. Provide a complete system consisting of medium pressure steam inlet piping, steam pressure reducing station, low pressure steam

distribution, steam control valves, steam to hot water heat exchangers, system condensate trapping and condensate return system, hot water piping and components, pumps, valves and other components and necessary support of the system components to provide system as indicated on the drawings.

S. INSTRUMENT TEST PORTS

1. Provide two instrument test ports at each access section.
2. Ports shall be PVC with a full sleeve and threaded plug. The port shall accommodate the insulation thickness of the panel in which it is installed.

T. ELECTRICAL

1. Mount motors internally on vibration isolation bases.
2. Wire each motor to its variable frequency drive..
3. Lights and Electrical Outlets:
  - a. Units shall have factory installed light fixtures in each compartment having an access door. These shall not obstruct filter removal. For units wider than 12 feet, provide two lights per compartment. These fixtures shall be pre-wired to individual switches on the outside of each section. Seal the conduit penetration of the casing to prevent air leakage through the conduit.
  - b. Light fixtures shall be:
    - 1) Vapor tight incandescent marine fixture with gasketed glass globe, cast aluminum guard, and 100 watt long life bulb, or
    - 2) Four foot single tube, gasketed, outdoor grade, fluorescent with low temperature ballast. Approved Model: Lithonia DMW-140.
  - c. Provide one 120 volt, weather-tight, duplex GFCI electrical outlet at each access section.
  - d. Conduit for lights and outlets shall be electrical metallic tube (EMT). Flexible conduit connections shall be liquid tight.
  - e. Provide gasketed junction boxes.
4. Provide panel for single point of 480V/3Ø electrical power. Provide electrical feeds to all VFDs and items requiring either 480 or 277 volt power. Provide a 120 volt transformer for all lighting and

receptacle loads as well as the field installed DDC control system.

- a. Provide a thermal break between the receptacle and the light switch compartment when they are adjacent to each other to prevent condensation in the light switch compartment.
- b. Provide wiring accordance with Division 26 requirements.

U. VARIABLE FREQUENCY DRIVES (VFD)

4. Provide a variable frequency drive for each fan as specified in Division 26.

V. SERVICE CORRIDOR UNIT HEATERS AND VENTILATION.

1. Provide steam unit heater as scheduled on the drawings. Provide steam, normally closed, two position control valve.
2. Provide electrical connection to electric distribution panel and snap acting thermostatic local control for unit heater..

W. FIELD PIPING

1. Steam, condensate and chilled water piping is to be brought to the unit from below the roof. Provide bottom of unit outlet of these services with flanged termination.
2. Construct unit with adequate space in service corridor for field furnished and mounted control valves, piping for each coil, including but not limited to heating coil, cooling coil, drain piping, for unit heater and for humidifier and floor drain piping.

X. SMOKE DETECTORS

- a. Smoke detectors will be field furnished and installed.

Y. FACTORY PERFORMANCE TESTING

1. Factory run test unit after unit has been fully assembled. The factory run test shall be conducted to examine unit operation, and verify minimum vibration levels as specified. Include test results in report.
  - a. Provide a static pressure profile through each unit for each supply and exhaust air path at design airflows. Simulate dirty "loaded" filters.
  - b. Modify internal unit construction, as required, to reduce unusually high airflow pressure losses due to construction, at no additional cost to the Owner.
2. The AHU manufacturer shall conduct a factory casing air leak test (FAT) for each unit prior to shipment. Unit sections shall be subjected to negative pressure upstream of supply fans and positive

pressure downstream of the supply fans. Maximum air leakage rate shall be 0.5 percent of design CFM at 150 percent of the design static pressure, or fan shutoff pressure, whichever is greater. Air leakage to be measured with a calibrated orifice plate or flow tube.

- a. If a unit fails to meet the test requirements, make corrections at no additional expense to Owner, including travel and accommodation expenses resulting from multiple witness tests.
    - 1) Caulking of interior or exterior surfaces is not an acceptable solution to fixing an air leak.
  - b. If a unit fails the FAT at any point or requires modification to pass the FAT, the manufacturer shall bear the cost of mandatory field testing after the unit has been installed to prove it conforms with requirements.
3. Each fan shall be factory run tested in accordance with Section 233416 to ensure structural integrity.
    - a. Measure fan vibration in accordance with ANSI Standard S2.19, Grade G6.3.
    - b. Maximum fan vibration, measured on fan bearings, shall be 0.20-inches per second.
  4. All coils shall be factory pressure tested in accordance with Section 238216.
  5. Sign and submit test reports.
  6. The completed unit shall pass all test requirements and bear an ETL label.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Install roof top unit in conformance with ARI 435.
- B. Assemble roof top unit components following manufacturer's instructions for handling, testing and operation. Repair damaged galvanized areas with paint in accordance with Military Spec. DOD-P-21035A. Repair painted units by touch up of all scratches with finish paint material. Vacuum the interior of air-handling units clean prior to operation.
- C. Leakage and test requirements for roof top units shall be the same as specified for ductwork in Specification Section 23 31 00, HVAC DUCTS AND CASINGS except leakage shall not exceed Leakage Class ( $C_L$ ) 12 listed in SMACNA HVAC Air Duct Leakage Test Manual when tested at 1.5

times the design static pressure. Repair casing air leaks that can be heard or felt during normal operation and to meet test requirements.

- D. Perform field mechanical (vibration) balancing in accordance with Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT.
- E. Seal and/or fill all openings between the casing and RTU components and utility connections to prevent air leakage or bypass.

### **3.2 STARTUP SERVICES**

- A. The air handling unit shall not be operated for any purpose, temporary or permanent, until ductwork is clean, filters are in place, bearings are lubricated and fan has been test run under observation.
- B. After the air handling unit is installed and tested, provide startup and operating instructions to VA personnel.
- C. An authorized factory representative should start up, test and certify the final installation and application specific calibration of control components. Items to be verified include fan performance over entire operating range, noise and vibration testing, verification of proper alignment, overall inspection of the installation, Owner/Operator training, etc.

### **3.3 COMMISSIONING**

- A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

- - - E N D - - -



**SECTION 23 82 00**  
**CONVECTION HEATING AND COOLING UNITS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

Radiant ceiling panels (for patient recovery bed areas at perimeter walls), unit heaters, and cabinet unit heaters

**1.2 RELATED WORK**

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC: General mechanical requirements and items, which are common to more than one section of Division 23.
- B. Section 23 05 41, NOISE and VIBRATION CONTROL FOR HVAC PIPING and EQUIPMENT: Noise requirements.
- C. Section 23 21 13, HYDRONIC PIPING: Heating hot water and chilled water piping.
- D. Section 23 31 00, HVAC DUCTS and CASINGS: Ducts and flexible connectors.
- E. Section 23 09 23, DIRECT-DIGITAL CONTROL SYSTEM FOR HVAC: Valve operators.
- F. Section 23 05 93, TESTING, ADJUSTING, and BALANCING FOR HVAC: Flow rates adjusting and balancing.
- G. Section 23 82 16, AIR COILS: Additional coil requirements.
- H. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS: Requirements for commissioning, systems readiness checklists, and training.
- I. Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS

**1.3 QUALITY ASSURANCE**

Refer to Paragraph, QUALITY ASSURANCE, in Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

**1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data:
  - 1. Unit heaters.
  - 2. Cabinet unit heaters.
  - 3. Radiant ceiling panels.
- C. Certificates:
  - 1. Compliance with paragraph, QUALITY ASSURANCE.

2. Compliance with specified standards.

D. Operation and Maintenance Manuals: Submit in accordance with paragraph, INSTRUCTIONS, in Section 01 00 00, GENERAL REQUIREMENTS.

E. Completed System Readiness Checklists provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 23 08 00 COMMISSIONING OF HVAC SYSTEMS.

#### **1.5 APPLICABLE PUBLICATIONS**

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. American National Standards Institute / Air Conditioning, Heating and Refrigeration Institute (ANSI/AHRI):

440-08.....Performance Rating of Room Fan Coils

National Fire Protection Association (NFPA):

90A-09.....Standard for the Installation of Air  
Conditioning and Ventilating Systems

70-11.....National Electrical Code

C. Underwriters Laboratories, Inc. (UL):

181-08.....Standard for Factory-Made Air Ducts and Air  
Connectors

1995-05.....Heating and Cooling Equipment

#### **1.6 GUARANTY**

In accordance with FAR clause 52.246-21

### **PART 2 - PRODUCTS**

#### **2.1 UNIT HEATERS**

A. General: Horizontal or vertical discharge type for steam, hot water or electric heating medium, as indicated.

B. Casing: Steel sheet, phosphatized to resist rust and finished in baked enamel. Provide hanger supports.

C. Fan: Propeller type, direct driven by manufacturer's standard electric motor. Provide resilient mounting. Provide fan guard for horizontal discharge units.

D. Discharge Air Control:

1. Horizontal discharge: Horizontal, adjustable louvers.

2. Vertical discharge: Radial louver diffuser.



- E. Steam or Hot Water Coil: Aluminum fins bonded to seamless copper tubing by mechanical expansion of the tubing, designed for 517 kPa (75 psig) steam working pressure.
  - 1. Corrosion Control: Provide corrosion control for coils in high-humidity locations by using a multi-stage, epoxy immersion coating (electrically deposited) process fully described in Section 23 82 16 - Air Coils.
- F. Electric Units: UL listed, factory wired to terminal strips for field connection of power and control wiring.
  - 1. Heating elements: Nickel chromium alloy resistance wire embedded in a magnesium oxide insulating refractory and sealed in corrosion resisting metallic sheath with fins. Three phase heaters shall have balanced phases.
  - 2. Thermal cutout: Manual reset type, which disconnects elements, and motor in the event normal operating temperatures are exceeded.
  - 3. Magnetic contactor: Factory installed with low voltage relay for remote pilot duty thermostat operation.
- G. Controls: Provide field installed remote wall mounted line voltage electric space thermostats or unit mounted return air thermostats, where shown or specified. Provide an aquastat on steam and hot water units to prevent fan operation when the heating system is off.

## **2.2 CABINET UNIT HEATERS**

- A. General: Vertical or horizontal type for steam, hot water or electric heating medium, as indicated.
- B. Cabinet: Not less than 1.3 mm (18 gage) steel with front panel for vertical units and hinged front panel for horizontal units. Finish on exposed cabinet shall be factory-baked enamel in manufacturer's standard color as selected by the Architect. Provide 76 mm (3-inch) high sub-base for vertical floor mounted units.
- C. Fan: Centrifugal blower, direct driven by a single phase, two-speed, electric motor with inherent overload protection. Provide resilient motor/fan mount.
- D. Filter: Manufacturer's standard, one inch thick, throwaway type MERV 7 filters.
- E. Steam or Hot Water Coil: Aluminum fins bonded to seamless copper tubing by mechanical expansion of the tubing, designed for 517 kPa (75 psi) steam working pressure.

1. Provide corrosion control for coils in high-humidity locations by using a multi-stage, epoxy immersion coating (electrically deposited) process fully described in Section 23 82 16, AIR COILS.

F. Electric Coil: Spiral sheath or finned-tube construction with Cal-rod resistance elements in aluminum tubes. Units shall be UL listed and factory wired with unit mounted heat switch, magnetic contactors, high temperature cutout safety control, and fan override thermostat.

G. Factory Mounted Controls: Manual fan starter and three-position (low, high and off) fan speed switch. Provide field installed remote wall mounted line voltage electric space thermostats or unit mounted return air thermostats, where shown/specified. Provide aquastat on steam and hot water units to prevent fan operation when heating system is off.

### **2.3 WALL-MOUNTED UNIT HEATER**

A. General: Electric heat, fan driven, thermostatic control, UL listed.

B. Enclosure:

1. Wall box: Not less than 1.3 mm (18 gage) steel, recessed type.
2. Ribbed 1.6 mm (16 gage) steel front cover.
3. Closely spaced discharge louvers.
4. Concealed screws for locking trim frame to front cover.
5. Finished in baked enamel of manufacturer's standard color with satin finish anodized aluminum trim frame.

C. Heating Elements: Steel sheath enclosed finned-tube type.

D. Integral Controls:

1. Two-pole terminal block.
2. Built-in fan delay switch.
3. Automatic reset line voltage internal thermal overheats protection.
4. Built-in thermostat comfort control with adjustment range between -1 to 32 degree C (30-90 degrees F), and manually set "No Heat" position; tamper resistant adjustment by inserting screwdriver through front cover louvers.

### **2.4 RADIANT CEILING PANELS:**

A. Hydronic Radiant Panels: Lay-in type, 1.00 mm (0.040) inch aluminum faceplate with 13 mm (1/2-inch) I.D copper serpentine water coil mechanically bonded to faceplate, finished with two coats baked white polyester finish with a light reflection value of 70 to 80 percent. Panels shall weigh no more than 0.68 kg (1.5 pounds) per square foot when filled with water. Provide 75 mm (3-inch) un-faced fiberglass

blanket insulation pre-cut for installation above panels. Panels shall be arranged and sized as shown on the drawings and equipment schedules.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Work shall be installed as shown and according to the manufacturer's diagrams and recommendations.
- B. Handle and install units in accordance with manufacturer's written instructions.
- C. Support units rigidly so they remain stationary at all times. Cross-bracing or other means of stiffening shall be provided as necessary. Method of support shall be such that distortion and malfunction of units cannot occur.
- D. Install fiberglass blanket insulation with a minimum R value of 8 above hydronic radiant panels.

#### **3.2 OPERATIONAL TEST**

Refer to Section 23 05 11, COMMON WORK RESULTS FOR HVAC.

#### **3.3 STARTUP AND TESTING**

- A. The Commissioning Agent will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with the Contracting Officers Representative (COR) and Commissioning Agent. Provide a minimum of 7 days prior notice.

#### **3.4 COMMISSIONING**

- A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

#### **3.5 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.
- B. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS.

- - - E N D - - -



**SECTION 23 82 16**  
**AIR COILS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

Heating and cooling coils for air handling unit and duct applications

**1.2 RELATED WORK**

- A. Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Section 23 31 00, HVAC DUCTS AND CASINGS
- C. Section 23 36 00, AIR TERMINAL UNITS: Reheat coils for VAV/CV terminals.
- D. Section 23 74 43, CUSTOM, OUTDOOR, PENTHOUSE EQUIPMENT MODULE/CENTRAL-STATION AIR-HANDLING UNIT
- E. Section 23 82 00, CONVECTION HEATING AND COOLING UNITS
- F. Section 23 08 00, COMMISSIONING OF HVAC SYSTEMS: Requirements for commissioning, systems readiness checklists, and training.
- G. Section 01 91 00, GENERAL COMMISSIONING REQUIREMENTS

**1.3 QUALITY ASSURANCE**

- A. Refer to paragraph, QUALITY ASSURANCE, Section 23 05 11, COMMON WORK RESULTS FOR HVAC.
- B. Unless specifically exempted by these specifications, heating and cooling coils shall be tested, rated, and certified in accordance with AHRI Standard 410 and shall bear the AHRI certification label.

**1.4 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Manufacturer's Literature and Data for Heating and Cooling Coils: Submit type, size, arrangements and performance details. Present application ratings in the form of tables, charts or curves.
- C. Provide installation, operating and maintenance instructions.
- D. Certification Compliance: Evidence of listing in current ARI Directory of Certified Applied Air Conditioning Products.
- E. Coils may be submitted with Section 23 74 43, CUSTOM, OUTDOOR, AIR-HANDLING UNIT, Section 23 36 00, AIR TERMINAL UNITS, or Section 23 82 00, CONVECTION HEATING AND COOLING UNITS.
- F. Completed System Readiness Checklists provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 23 08 00 COMMISSIONING OF HVAC SYSTEMS.

## **1.5 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. Air Conditioning and Refrigeration Institute (AHRI):  
Directory of Certified Applied Air Conditioning Products  
AHRI 410-01.....Forced-Circulation Air-Cooling and Air-Heating Coils
- C. American Society for Testing and Materials (ASTM):  
B75/75M-02.....Standard Specifications for Seamless Copper Tube
- D. National Fire Protection Association (NFPA):  
70-11.....National Electric Code
- E. National Electric Manufacturers Association (NEMA):  
250-11.....Enclosures for Electrical Equipment (1,000 Volts Maximum)
- F. Underwriters Laboratories, Inc. (UL):  
1996-09.....Electric Duct Heaters

## **PART 2 - PRODUCTS**

### **2.1 HEATING AND COOLING COILS**

- A. Conform to ASTM B75 and AHRI 410.
- B. Surgical Suites - All Locations: All coils installed in the air handling units serving surgical suites, duct-mounted reheat coils, and air terminal unit-mounted reheat coils shall be equipped with copper fins.
- C. High Humidity Locations: For air-handling unit mounted coils provide the following corrosion treatment:
  - 1. Epoxy Immersion Coating - Electrically Deposited: The multi-stage corrosion-resistant coating application comprises of cleaning (heated alkaline immersion bath) and reverse-osmosis immersion rinse prior to the start of the coating process. The coating thickness shall be maintained between 0.6-mil and 1.2-mil. Before the coils are subjected to high-temperature oven cure, they are treated to permeate immersion rinse and spray. Where the coils are subject to UV exposure, UV protection spray treatment comprising of UV-resistant urethane mastic topcoat shall be applied. Provide complete coating process traceability for each coil and minimum five years of limited warranty.
  - 2. The coating process shall such that uniform coating thickness is maintained at the fin edges. The quality control shall be maintained

- by ensuring compliance to the applicable ASTM Standards for the following:
- a. Salt Spray Resistance (Minimum 6,000 Hours)
  - b. Humidity Resistance (Minimum 1,000 Hours)
  - c. Water Immersion (Minimum 260 Hours)
  - d. Cross-Hatch Adhesion (Minimum 4B-5B Rating)
  - e. Impact Resistance (Up to 160 Inch/Pound)
- D. Tubes: Minimum 16 mm (0.625 inch) tube diameter; Seamless copper tubing.
- E. Fins: 0.1143 mm (0.0045 inch) copper mechanically bonded or soldered or helically wound around tubing.
- F. Headers: Copper, welded steel or cast iron.
- G. "U" Bends, Where Used: Machine die-formed, silver brazed to tube ends.
- H. Coil Casing: Minimum 1.6 mm (16 gage) stainless steel with tube supports at 1200 mm (48 inch) maximum spacing. Construct casing to eliminate air bypass and moisture carry-over. Provide duct connection flanges.
- I. Pressures kPa (PSIG):

Pressure	Water Coil	Steam Coil	Refrigerant Coil
Test	2070 (300)	1725 (250)	2070 (300)
Working	1380 (200)	520 (75)	1725 (250)

- J. Protection: Unless protected by the coil casing, provide cardboard, plywood, or plastic material at the factory to protect tube and finned surfaces during shipping and construction activities.
- K. Vents and Drain: Coils that are not vented or drainable by the piping system shall have capped vent/drain connections extended through coil casing.
- L. Cooling Coil Condensate Drain Pan: Section 23 74 43  
CUSTOM, OUTDOOR, AIR-HANDLING UNITS. 304 Stainless steel.
- M. Steam Distributing Coils: Conform to ASTM B75 and ARI 410. Minimum 9.5 mm (3/8-inch) steam distributing tubing installed concentrically in 25 mm (one-inch) OD condensing coil tubes.

## **2.2 REHEAT COILS, DUCT MOUNTED**

The coils shall be continuous circuit booster type for hot water as shown on drawings. Use the same coil material as listed in Paragraphs 2.1. Surgical service duct mounted reheat coils (located in penthouse equipment module) shall have copper fins.

## **2.3 WATER COILS, INCLUDING GLYCOL-WATER**

- A. Use the same coil material as listed in Paragraphs 2.1.
- B. Drainable Type (Self Draining, Self Venting); Manufacturer standard:

1. Cooling, all types.
2. Heating or preheat.
3. Runaround energy recovery. ARI certification of capacity adjustment is waived. See Section 23 72 00, AIR-TO-AIR ENERGY RECOVERY EQUIPMENT.

C. Cleanable Tube Type; manufacturer standard:

1. Well water applications.
2. Waste water applications.

**PART 3 - EXECUTION**

**3.1 INSTALLATION**

- A. Follow coil manufacturer's instructions for handling, cleaning, installation and piping connections.
- B. Comb fins, if damaged. Eliminate air bypass or leakage at coil sections.

**3.2 STARTUP AND TESTING**

- A. The Commissioning Agent will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with the Contracting Officers Representative (COR) and Commissioning Agent. Provide a minimum of 7 days prior notice.

**3.3 COMMISSIONING**

- A. Provide commissioning documentation in accordance with the requirements of Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS and related sections for contractor responsibilities for system commissioning.

**3.4 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.
- B. Submit training plans and instructor qualifications in accordance with the requirements of Section 23 08 00 - COMMISSIONING OF HVAC SYSTEMS.

- - - E N D - - -



**SECTION 26 05 11**  
**REQUIREMENTS FOR ELECTRICAL INSTALLATIONS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section applies to all sections of Division 26.
- B. Furnish and install electrical systems, materials, equipment, and accessories in accordance with the specifications and drawings. Capacities and ratings of motors, transformers, conductors and cable, panelboards, automatic transfer switches, and other items and arrangements for the specified items are shown on the drawings.
- C. Conductor ampacities specified or shown on the drawings are based on copper conductors, with the conduit and raceways sized per NEC. Aluminum conductors are prohibited.

**1.2 MINIMUM REQUIREMENTS**

- A. The International Building Code (IBC), National Electrical Code (NEC), Underwriters Laboratories, Inc. (UL), and National Fire Protection Association (NFPA) codes and standards are the minimum requirements for materials and installation.
- B. The drawings and specifications shall govern in those instances where requirements are greater than those stated in the above codes and standards.

**1.3 TEST STANDARDS**

- A. All materials and equipment shall be listed, labeled, or certified by a Nationally Recognized Testing Laboratory (NRTL) to meet Underwriters Laboratories, Inc. (UL), standards where test standards have been established. Materials and equipment which are not covered by UL standards will be accepted, providing that materials and equipment are listed, labeled, certified or otherwise determined to meet the safety requirements of a NRTL. Materials and equipment which no NRTL accepts, certifies, lists, labels, or determines to be safe, will be considered if inspected or tested in accordance with national industrial standards, such as ANSI, NEMA, and NETA. Evidence of compliance shall include certified test reports and definitive shop drawings.
- B. Definitions:
  - 1. Listed: Materials and equipment included in a list published by an organization that is acceptable to the Authority Having Jurisdiction

- and concerned with evaluation of products or services, that maintains periodic inspection of production or listed materials and equipment or periodic evaluation of services, and whose listing states that the materials and equipment either meets appropriate designated standards or has been tested and found suitable for a specified purpose.
2. Labeled: Materials and equipment to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the Authority Having Jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled materials and equipment, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.
  3. Certified: Materials and equipment which:
    - a. Have been tested and found by a NRTL to meet nationally recognized standards or to be safe for use in a specified manner.
    - b. Are periodically inspected by a NRTL.
    - c. Bear a label, tag, or other record of certification.
  4. Nationally Recognized Testing Laboratory: Testing laboratory which is recognized and approved by the Secretary of Labor in accordance with OSHA regulations.

#### **1.4 QUALIFICATIONS (PRODUCTS AND SERVICES)**

- A. Manufacturer's Qualifications: The manufacturer shall regularly and currently produce, as one of the manufacturer's principal products, the materials and equipment specified for this project, and shall have manufactured the materials and equipment for at least three years.
- B. Product Qualification:
  1. Manufacturer's materials and equipment shall have been in satisfactory operation, on three installations of similar size and type as this project, for at least three years.
  2. The Government reserves the right to require the Contractor to submit a list of installations where the materials and equipment have been in operation before approval.
- C. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within eight hours of receipt

of notification that service is needed. Submit name and address of service organizations.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. Applicable publications listed in all Sections of Division 26 are the latest issue, unless otherwise noted.
- B. Products specified in all sections of Division 26 shall comply with the applicable publications listed in each section.

#### **1.6 MANUFACTURED PRODUCTS**

- A. Materials and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items, and for which replacement parts shall be available.
- B. When more than one unit of the same class or type of materials and equipment is required, such units shall be the product of a single manufacturer.
- C. Equipment Assemblies and Components:
  - 1. Components of an assembled unit need not be products of the same manufacturer.
  - 2. Manufacturers of equipment assemblies, which include components made by others, shall assume complete responsibility for the final assembled unit.
  - 3. Components shall be compatible with each other and with the total assembly for the intended service.
  - 4. Constituent parts which are similar shall be the product of a single manufacturer.
- D. Factory wiring and terminals shall be identified on the equipment being furnished and on all wiring diagrams.
- E. When Factory Testing Is Specified:
  - 1. The Government shall have the option of witnessing factory tests. The Contractor shall notify the Government through the Contracting Officers Representative (COR) a minimum of 15 working days prior to the manufacturer's performing the factory tests.
  - 2. Four copies of certified test reports shall be furnished to the COR two weeks prior to final inspection and not more than 90 days after completion of the tests.
  - 3. When materials and equipment fail factory tests, and re-testing and re-inspection is required, the Contractor shall be liable for all additional expenses for the Government to witness re-testing.

### **1.7 VARIATIONS FROM CONTRACT REQUIREMENTS**

- A. Where the Government or the Contractor requests variations from the contract requirements, the connecting work and related components shall include, but not be limited to additions or changes to branch circuits, circuit protective devices, conduits, wire, feeders, controls, panels and installation methods.

### **1.8 MATERIALS AND EQUIPMENT PROTECTION**

- A. Materials and equipment shall be protected during shipment and storage against physical damage, vermin, dirt, corrosive substances, fumes, moisture, cold and rain.
1. Store materials and equipment indoors in clean dry space with uniform temperature to prevent condensation.
  2. During installation, equipment shall be protected against entry of foreign matter, and be vacuum-cleaned both inside and outside before testing and operating. Compressed air shall not be used to clean equipment. Remove loose packing and flammable materials from inside equipment.
  3. Damaged equipment shall be repaired or replaced, as determined by the COR.
  4. Painted surfaces shall be protected with factory installed removable heavy kraft paper, sheet vinyl or equal.
  5. Damaged paint on equipment shall be refinished with the same quality of paint and workmanship as used by the manufacturer so repaired areas are not obvious.

### **1.9 WORK PERFORMANCE**

- A. All electrical work shall comply with the requirements of NFPA 70 (NEC), NFPA 70B, NFPA 70E, OSHA Part 1910 subpart J - General Environmental Controls, OSHA Part 1910 subpart K - Medical and First Aid, and OSHA Part 1910 subpart S - Electrical, in addition to other references required by contract.
- B. Job site safety and worker safety is the responsibility of the Contractor.
- C. Electrical work shall be accomplished with all affected circuits or equipment de-energized. When an electrical outage cannot be accomplished in this manner for the required work, the following requirements are mandatory:

1. Electricians must use full protective equipment (i.e., certified and tested insulating material to cover exposed energized electrical components, certified and tested insulated tools, etc.) while working on energized systems in accordance with NFPA 70E.
2. Before initiating any work, a job specific work plan must be developed by the Contractor with a peer review conducted and documented by the COR and Medical Center staff. The work plan must include procedures to be used on and near the live electrical equipment, barriers to be installed, safety equipment to be used, and exit pathways.
3. Work on energized circuits or equipment cannot begin until prior written approval is obtained from the COR.
- D. For work that affects existing electrical systems, arrange, phase and perform work to assure minimal interference with normal functioning of the facility. Refer to Article OPERATIONS AND STORAGE AREAS under Section 01 00 00, GENERAL REQUIREMENTS.
- E. New work shall be installed and connected to existing work neatly, safely and professionally. Disturbed or damaged work shall be replaced or repaired to its prior conditions, as required by Section 01 00 00, GENERAL REQUIREMENTS.
- F. Coordinate location of equipment and conduit with other trades to minimize interference.

#### **1.10 EQUIPMENT INSTALLATION AND REQUIREMENTS**

- A. Equipment location shall be as close as practical to locations shown on the drawings.
- B. Working clearances shall not be less than specified in the NEC.
- C. Inaccessible Equipment:
  1. Where the Government determines that the Contractor has installed equipment not readily accessible for operation and maintenance, the equipment shall be removed and reinstalled as directed at no additional cost to the Government.
  2. "Readily accessible" is defined as being capable of being reached quickly for operation, maintenance, or inspections without the use of ladders, or without climbing or crawling under or over obstacles such as, but not limited to, motors, pumps, belt guards, transformers, piping, ductwork, conduit and raceways.

### **1.11 EQUIPMENT IDENTIFICATION**

- A. In addition to the requirements of the NEC, install an identification sign which clearly indicates information required for use and maintenance of items such as panelboards, cabinets, motor controllers, fused and non-fused safety switches, automatic transfer switches, separately enclosed circuit breakers, individual breakers and controllers in switchboards, switchgear and motor control assemblies, control devices and other significant equipment.
- B. Identification signs for Normal Power System equipment shall be laminated black phenolic resin with a white core with engraved lettering. Identification signs for Essential Electrical System (EES) equipment, as defined in the NEC, shall be laminated red phenolic resin with a white core with engraved lettering. Lettering shall be a minimum of 12 mm (1/2 inch) high. Identification signs shall indicate equipment designation, rated bus amperage, voltage, number of phases, number of wires, and type of EES power branch as applicable. Secure nameplates with screws.
- C. Install adhesive arc flash warning labels on all equipment as required by NFPA 70E. Label shall indicate the arc hazard boundary (inches), working distance (inches), arc flash incident energy at the working distance (calories/cm<sup>2</sup>), required PPE category and description including the glove rating, voltage rating of the equipment, limited approach distance (inches), restricted approach distance (inches), prohibited approach distance (inches), equipment/bus name, date prepared, and manufacturer name and address.

### **1.12 SUBMITTALS**

- A. Submit to the COR in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. The Government's approval shall be obtained for all materials and equipment before delivery to the job site. Delivery, storage or installation of materials and equipment which has not had prior approval will not be permitted.
- C. All submittals shall include six copies of adequate descriptive literature, catalog cuts, shop drawings, test reports, certifications, samples, and other data necessary for the Government to ascertain that the proposed materials and equipment comply with drawing and specification requirements. Catalog cuts submitted for approval shall

be legible and clearly identify specific materials and equipment being submitted.

- D. Submittals for individual systems and equipment assemblies which consist of more than one item or component shall be made for the system or assembly as a whole. Partial submittals will not be considered for approval.

1. Mark the submittals, "SUBMITTED UNDER SECTION \_\_\_\_\_".
2. Submittals shall be marked to show specification reference including the section and paragraph numbers.
3. Submit each section separately.

- E. The submittals shall include the following:

1. Information that confirms compliance with contract requirements. Include the manufacturer's name, model or catalog numbers, catalog information, technical data sheets, shop drawings, manuals, pictures, nameplate data, and test reports as required.
2. Elementary and interconnection wiring diagrams for communication and signal systems, control systems, and equipment assemblies. All terminal points and wiring shall be identified on wiring diagrams.
3. Parts list which shall include information for replacement parts and ordering instructions, as recommended by the equipment manufacturer.

- F. Maintenance and Operation Manuals:

1. Submit as required for systems and equipment specified in the technical sections. Furnish in hardcover binders or an approved equivalent.
2. Inscribe the following identification on the cover: the words "MAINTENANCE AND OPERATION MANUAL," the name and location of the system, material, equipment, building, name of Contractor, and contract name and number. Include in the manual the names, addresses, and telephone numbers of each subcontractor installing the system or equipment and the local representatives for the material or equipment.
3. Provide a table of contents and assemble the manual to conform to the table of contents, with tab sheets placed before instructions covering the subject. The instructions shall be legible and easily read, with large sheets of drawings folded in.
4. The manuals shall include:

- a. Internal and interconnecting wiring and control diagrams with data to explain detailed operation and control of the equipment.
  - b. A control sequence describing start-up, operation, and shutdown.
  - c. Description of the function of each principal item of equipment.
  - d. Installation instructions.
  - e. Safety precautions for operation and maintenance.
  - f. Diagrams and illustrations.
  - g. Periodic maintenance and testing procedures and frequencies, including replacement parts numbers.
  - h. Performance data.
  - i. Pictorial "exploded" parts list with part numbers. Emphasis shall be placed on the use of special tools and instruments. The list shall indicate sources of supply, recommended spare and replacement parts, and name of servicing organization.
  - j. List of factory approved or qualified permanent servicing organizations for equipment repair and periodic testing and maintenance, including addresses and factory certification qualifications.
- G. Approvals will be based on complete submission of shop drawings, manuals, test reports, certifications, and samples as applicable.
- H. After approval and prior to installation, furnish the COR with one sample of each of the following:
- 1. A minimum 300 mm (12 inches) length of each type and size of wire and cable along with the tag from the coils or reels from which the sample was taken. The length of the sample shall be sufficient to show all markings provided by the manufacturer.
  - 2. Each type of conduit coupling, bushing, and termination fitting.
  - 3. Conduit hangers, clamps, and supports.
  - 4. Duct sealing compound.
  - 5. Each type of receptacle, toggle switch, lighting control sensor, outlet box, manual motor starter, device wall plate, engraved nameplate, wire and cable splicing and terminating material, and branch circuit single pole molded case circuit breaker.

#### **1.13 SINGULAR NUMBER**

- A. Where any device or part of equipment is referred to in these specifications in the singular number (e.g., "the switch"), this



reference shall be deemed to apply to as many such devices as are required to complete the installation as shown on the drawings.

**1.14 ACCEPTANCE CHECKS AND TESTS**

- A. The Contractor shall furnish the instruments, materials, and labor for tests.
- B. Where systems are comprised of components specified in more than one section of Division 26, the Contractor shall coordinate the installation, testing, and adjustment of all components between various manufacturer's representatives and technicians so that a complete, functional, and operational system is delivered to the Government.
- C. When test results indicate any defects, the Contractor shall repair or replace the defective materials or equipment, and repeat the tests. Repair, replacement, and retesting shall be accomplished at no additional cost to the Government.

**1.15 WARRANTY**

- A. All work performed and all equipment and material furnished under this Division shall be free from defects and shall remain so for a period of one year from the date of acceptance of the entire installation by the Contracting Officer for the Government.

**1.16 INSTRUCTION**

- A. Instruction to designated Government personnel shall be provided for the particular equipment or system as required in each associated technical specification section.
- B. Furnish the services of competent instructors to give full instruction in the adjustment, operation, and maintenance of the specified equipment and system, including pertinent safety requirements. Instructors shall be thoroughly familiar with all aspects of the installation, and shall be trained in operating theory as well as practical operation and maintenance procedures.
- C. A training schedule shall be developed and submitted by the Contractor and approved by the COR at least 30 days prior to the planned training.

**PART 2 - PRODUCTS (NOT USED)**

**PART 3 - EXECUTION (NOT USED)**

---END---



**SECTION 26 05 19**

**LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, connection, and testing of the electrical conductors and cables for use in electrical systems rated 600 V and below, indicated as cable(s), conductor(s), wire, or wiring in this section.

**1.2 RELATED WORK**

- A. Section 07 84 00, FIRESTOPPING: Sealing around penetrations to maintain the integrity of fire-resistant rated construction.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits for conductors and cables.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 FACTORY TESTS**

- A. Conductors and cables shall be thoroughly tested at the factory per NEMA to ensure that there are no electrical defects. Factory tests shall be certified.

**1.5 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
1. Shop Drawings:
- a. Submit sufficient information to demonstrate compliance with drawings and specifications.
  - b. Submit the following data for approval:
    - 1) Electrical ratings and insulation type for each conductor and cable.
    - 2) Splicing materials and pulling lubricant.

2. Certifications: Two weeks prior to final inspection, submit the following.

- a. Certification by the manufacturer that the conductors and cables conform to the requirements of the drawings and specifications.
- b. Certification by the Contractor that the conductors and cables have been properly installed, adjusted, and tested.

#### **1.6 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are reference in the text by designation only.
- B. American Society of Testing Material (ASTM):
  - D2301-10.....Standard Specification for Vinyl Chloride  
Plastic Pressure-Sensitive Electrical  
Insulating Tape
  - D2304-10.....Test Method for Thermal Endurance of Rigid  
Electrical Insulating Materials
  - D3005-10.....Low-Temperature Resistant Vinyl Chloride  
Plastic Pressure-Sensitive Electrical  
Insulating Tape
- C. National Electrical Manufacturers Association (NEMA):
  - WC 70-09.....Power Cables Rated 2000 Volts or Less for the  
Distribution of Electrical Energy
- D. National Fire Protection Association (NFPA):
  - 70-11.....National Electrical Code (NEC)
- E. Underwriters Laboratories, Inc. (UL):
  - 44-10.....Thermoset-Insulated Wires and Cables
  - 83-08.....Thermoplastic-Insulated Wires and Cables
  - 467-07.....Grounding and Bonding Equipment
  - 486A-486B-03.....Wire Connectors
  - 486C-04.....Splicing Wire Connectors
  - 486D-05.....Sealed Wire Connector Systems
  - 486E-09.....Equipment Wiring Terminals for Use with  
Aluminum and/or Copper Conductors
  - 493-07.....Thermoplastic-Insulated Underground Feeder and  
Branch Circuit Cables
  - 514B-04.....Conduit, Tubing, and Cable Fittings

## **PART 2 - PRODUCTS**

### **2.1 CONDUCTORS AND CABLES**

- A. Conductors and cables shall be in accordance with NEMA, UL, as specified herein, and as shown on the drawings.
- B. All conductors shall be copper.
- C. Single Conductor and Cable:
  - 1. No. 12 AWG: Minimum size, except where smaller sizes are specified herein or shown on the drawings.
  - 2. No. 8 AWG and larger: Stranded.
  - 3. No. 10 AWG and smaller: Solid; except shall be stranded for final connection to motors, transformers, and vibrating equipment.
  - 4. Insulation: THHN-THWN and XHHW-2. XHHW-2 shall be used for isolated power systems.
- D. Color Code:
  - 1. No. 10 AWG and smaller: Solid color insulation or solid color coating.
  - 2. No. 8 AWG and larger: Color-coded using one of the following methods:
    - a. Solid color insulation or solid color coating.
    - b. Stripes, bands, or hash marks of color specified.
    - c. Color using 19 mm (0.75 inches) wide tape.
  - 4. For modifications and additions to existing wiring systems, color coding shall conform to the existing wiring system.
  - 5. Conductors shall be color-coded as follows:

208/120 V	Phase	480/277 V
Black	A	Brown
Red	B	Orange
Blue	C	Yellow
White	Neutral	Gray *
* or white with colored (other than green) tracer.		

- 6. Lighting circuit "switch legs", and 3-way and 4-way switch "traveling wires," shall have color coding that is unique and distinct (e.g., pink and purple) from the color coding indicated above. The unique color codes shall be solid and in accordance with the NEC. Coordinate color coding in the field with the Contracting Officers Representative (COR).

7. Color code for isolated power system wiring shall be in accordance with the NEC.

## **2.2 SPLICES**

- A. Splices shall be in accordance with NEC and UL.
- B. Above Ground Splices for No. 10 AWG and Smaller:
  1. Solderless, screw-on, reusable pressure cable type, with integral insulation, approved for copper and aluminum conductors.
  2. The integral insulator shall have a skirt to completely cover the stripped conductors.
  3. The number, size, and combination of conductors used with the connector, as listed on the manufacturer's packaging, shall be strictly followed.
- C. Above Ground Splices for No. 8 AWG to No. 4/0 AWG:
  1. Compression, hex screw, or bolt clamp-type of high conductivity and corrosion-resistant material, listed for use with copper and aluminum conductors.
  2. Insulate with materials approved for the particular use, location, voltage, and temperature. Insulation level shall be not less than the insulation level of the conductors being joined.
  3. Splice and insulation shall be product of the same manufacturer.
  4. All bolts, nuts, and washers used with splices shall be zinc-plated steel.
- D. Above Ground Splices for 250 kcmil and Larger:
  1. Long barrel "butt-splice" or "sleeve" type compression connectors, with minimum of two compression indents per wire, listed for use with copper and aluminum conductors.
  2. Insulate with materials approved for the particular use, location, voltage, and temperature. Insulation level shall be not less than the insulation level of the conductors being joined.
  3. Splice and insulation shall be product of the same manufacturer.
- E. Plastic electrical insulating tape: Per ASTM D2304, flame-retardant, cold and weather resistant.

## **2.3 CONNECTORS AND TERMINATIONS**

- A. Mechanical type of high conductivity and corrosion-resistant material, listed for use with copper and aluminum conductors.
- B. Long barrel compression type of high conductivity and corrosion-resistant material, with minimum of two compression indents per wire, listed for use with copper and aluminum conductors.

- C. All bolts, nuts, and washers used to connect connections and terminations to bus bars or other termination points shall be zinc-plated steel.

## **2.4 CONTROL WIRING**

- A. Unless otherwise specified elsewhere in these specifications, control wiring shall be as specified herein, except that the minimum size shall be not less than No. 14 AWG.
- B. Control wiring shall be sized such that the voltage drop under in-rush conditions does not adversely affect operation of the controls.

## **2.5 WIRE LUBRICATING COMPOUND**

- A. Lubricating compound shall be suitable for the wire insulation and conduit, and shall not harden or become adhesive.
- B. Shall not be used on conductors for isolated power systems.

## **PART 3 - EXECUTION**

### **3.1 GENERAL**

- A. Install conductors in accordance with the NEC, as specified, and as shown on the drawings.
- B. Install all conductors in raceway systems.
- C. Splice conductors only in outlet boxes, junction boxes, or pullboxes.
- D. Conductors of different systems (e.g., 120 V and 277 V) shall not be installed in the same raceway.
- E. Install cable supports for all vertical feeders in accordance with the NEC. Provide split wedge type which firmly clamps each individual cable and tightens due to cable weight.
- F. In panelboards, cabinets, wireways, switches, enclosures, and equipment assemblies, neatly form, train, and tie the conductors with non-metallic ties.
- G. For connections to motors, transformers, and vibrating equipment, stranded conductors shall be used only from the last fixed point of connection to the motors, transformers, or vibrating equipment.
- H. Use expanding foam or non-hardening duct-seal to seal conduits entering a building, after installation of conductors.
- I. Conductor and Cable Pulling:
  - 1. Provide installation equipment that will prevent the cutting or abrasion of insulation during pulling. Use lubricants approved for the cable.
  - 2. Use nonmetallic pull ropes.

3. Attach pull ropes by means of either woven basket grips or pulling eyes attached directly to the conductors.
  4. All conductors in a single conduit shall be pulled simultaneously.
  5. Do not exceed manufacturer's recommended maximum pulling tensions and sidewall pressure values.
- J. No more than three branch circuits shall be installed in any one conduit.
- K. When stripping stranded conductors, use a tool that does not damage the conductor or remove conductor strands.

### **3.2 SPLICE AND TERMINATION INSTALLATION**

- A. Splices and terminations shall be mechanically and electrically secure, and tightened to manufacturer's published torque values using a torque screwdriver or wrench.
- B. Where the Government determines that unsatisfactory splices or terminations have been installed, replace the splices or terminations at no additional cost to the Government.

### **3.3 CONDUCTOR IDENTIFICATION**

- A. When using colored tape to identify phase, neutral, and ground conductors larger than No. 8 AWG, apply tape in half-overlapping turns for a minimum of 75 mm (3 inches) from terminal points, and in junction boxes and pullboxes. Apply the last two laps of tape with no tension to prevent possible unwinding. Where cable markings are covered by tape, apply tags to cable, stating size and insulation type.

### **3.4 FEEDER CONDUCTOR IDENTIFICATION**

- A. In each interior pullbox, install brass tags on all feeder conductors to clearly designate their circuit identification and voltage. The tags shall be the embossed type, 40 mm (1-1/2 inches) in diameter and 40 mils thick. Attach tags with plastic ties.

### **3.5 EXISTING CONDUCTORS**

- A. Unless specifically indicated on the plans, existing conductors shall not be reused.

### **3.6 CONTROL WIRING INSTALLATION**

- A. Unless otherwise specified in other sections, install control wiring and connect to equipment to perform the required functions as specified or as shown on the drawings.
- B. Install a separate power supply circuit for each system, except where otherwise shown on the drawings.



### **3.7 CONTROL WIRING IDENTIFICATION**

- A. Install a permanent wire marker on each wire at each termination.
- B. Identifying numbers and letters on the wire markers shall correspond to those on the wiring diagrams used for installing the systems.
- C. Wire markers shall retain their markings after cleaning.

### **3.8 ACCEPTANCE CHECKS AND TESTS**

- A. Perform in accordance with the manufacturer's recommendations. In addition, include the following:
  - 1. Visual Inspection and Tests: Inspect physical condition.
  - 2. Electrical tests:
    - a. After installation but before connection to utilization devices, such as fixtures, motors, or appliances, test conductors phase-to-phase and phase-to-ground resistance with an insulation resistance tester. Existing conductors to be reused shall also be tested.
    - b. Applied voltage shall be 500 V DC for 300 V rated cable, and 1000 V DC for 600 V rated cable. Apply test for one minute or until reading is constant for 15 seconds, whichever is longer. Minimum insulation resistance values shall not be less than 25 megohms for 300 V rated cable and 100 megohms for 600 V rated cable.
    - c. Perform phase rotation test on all three-phase circuits.

---END---



**SECTION 26 05 26**  
**GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, connection, and testing of grounding and bonding equipment, indicated as grounding equipment in this section.
- B. "Grounding electrode system" refers to grounding electrode conductors and all electrodes required or allowed by NEC, as well as made, supplementary, and lightning protection system grounding electrodes.
- C. The terms "connect" and "bond" are used interchangeably in this section and have the same meaning.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Low-voltage conductors.
- C. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduit and boxes.
- D. Section 26 22 00, LOW-VOLTAGE TRANSFORMERS: Low-voltage transformers.
- E. Section 26 24 16, PANELBOARDS: Low-voltage panelboards.
- F. Section 26 36 23, AUTOMATIC TRANSFER SWITCHES: Automatic transfer switches.
- G. Section 26 41 00, FACILITY LIGHTNING PROTECTION: Lightning protection.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
  - 1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Submit plans showing the location of system grounding electrodes and connections, and the routing of grounding electrode conductors.
  - 2. Certifications:

- a. Certification by the Contractor that the grounding equipment has been properly installed and tested.

### **1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American Society for Testing and Materials (ASTM):
- B1-07.....Standard Specification for Hard-Drawn Copper Wire
- B3-07.....Standard Specification for Soft or Annealed Copper Wire
- B8-11.....Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft
- C. Institute of Electrical and Electronics Engineers, Inc. (IEEE):
- 81-83.....IEEE Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Ground System Part 1: Normal Measurements
- D. National Fire Protection Association (NFPA):
- 70-11.....National Electrical Code (NEC)
- 70E-12.....National Electrical Safety Code
- 99-12.....Health Care Facilities
- E. Underwriters Laboratories, Inc. (UL):
- 44-10 .....Thermoset-Insulated Wires and Cables
- 83-08 .....Thermoplastic-Insulated Wires and Cables
- 467-07 .....Grounding and Bonding Equipment

## **PART 2 - PRODUCTS**

### **2.1 GROUNDING AND BONDING CONDUCTORS**

- A. Equipment grounding conductors shall be insulated stranded copper, except that sizes No. 10 AWG and smaller shall be solid copper. Insulation color shall be continuous green for all equipment grounding conductors, except that wire sizes No. 4 AWG and larger shall be identified per NEC.
- B. Bonding conductors shall be bare stranded copper, except that sizes No. 10 AWG and smaller shall be bare solid copper. Bonding conductors shall be stranded for final connection to motors, transformers, and vibrating equipment.

- C. Conductor sizes shall not be less than shown on the drawings, or not less than required by the NEC, whichever is greater.
- D. Insulation: THHN-THWN and XHHW-2. XHHW-2 shall be used for isolated power systems.

## **2.2 GROUND CONNECTIONS**

### **A. Above Grade:**

- 1. Bonding Jumpers: Listed for use with aluminum and copper conductors. For wire sizes No. 8 AWG and larger, use compression-type connectors. For wire sizes smaller than No. 8 AWG, use mechanical type lugs. Connectors or lugs shall use zinc-plated steel bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.
- 2. Connection to Building Steel: Exothermic-welded type connectors.
- 3. Connection to Grounding Bus Bars: Listed for use with aluminum and copper conductors. Use mechanical type lugs, with zinc-plated steel bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.
- 4. Connection to Equipment Rack and Cabinet Ground Bars: Listed for use with aluminum and copper conductors. Use mechanical type lugs, with zinc-plated steel bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.

## **2.3 EQUIPMENT RACK AND CABINET GROUND BARS**

- A. Provide solid copper ground bars designed for mounting on the framework of open or cabinet-enclosed equipment racks. Ground bars shall have minimum dimensions of 6.3 mm (0.25 inch) thick x 19 mm (0.75 inch) wide, with length as required or as shown on the drawings. Provide insulators and mounting brackets.

## **2.4 GROUND TERMINAL BLOCKS**

- A. At any equipment mounting location (e.g., backboards and hinged cover enclosures) where rack-type ground bars cannot be mounted, provide mechanical type lugs, with zinc-plated steel bolts, nuts, and washers. Bolts shall be torqued to the values recommended by the manufacturer.

## **2.5 GROUNDING BUS BAR**

- A. Pre-drilled rectangular copper bar with stand-off insulators, minimum 6.3 mm (0.25 inch) thick x 100 mm (4 inches) high in cross-section, length as shown on the drawings, with hole size, quantity, and spacing per detail shown on the drawings. Provide insulators and mounting brackets.

### **PART 3 - EXECUTION**

#### **3.1 GENERAL**

- A. Install grounding equipment in accordance with the NEC, as shown on the drawings, and as specified herein.
- B. System Grounding:
  - 1. Separately derived systems (transformers downstream from the service entrance): Ground the secondary neutral.
  - 2. Isolation transformers and isolated power systems shall not be system grounded.
- C. Equipment Grounding: Metallic piping, building structural steel, electrical enclosures, raceways, junction boxes, outlet boxes, cabinets, machine frames, and other conductive items in close proximity with electrical circuits, shall be bonded and grounded.
- D. For patient care area electrical power system grounding, conform to NFPA 99 and NEC.

#### **3.2 INACCESSIBLE GROUNDING CONNECTIONS**

- A. Make grounding connections, which are normally buried or otherwise inaccessible, by exothermic weld.

#### **3.3 SECONDARY VOLTAGE EQUIPMENT AND CIRCUITS**

- A. Metallic Piping, Building Structural Steel, and Supplemental Electrode(s):
  - 1. Provide a supplemental ground electrode as shown on the drawings and bond to the grounding electrode system.
- B. Panelboards, Motor Control Centers, Automatic Transfer Switches, and other electrical equipment:
  - 1. Connect the equipment grounding conductors to the ground bus.
  - 2. Connect metallic conduits by grounding bushings and equipment grounding conductor to the equipment ground bus.
- C. Transformers:
  - 1. Separately derived systems (transformers downstream from service equipment): Ground the secondary neutral at the transformer. Provide a grounding electrode conductor from the transformer to the nearest component of the grounding electrode system.

#### **3.4 RACEWAY**

- A. Conduit Systems:
  - 1. Ground all metallic conduit systems. All metallic conduit systems shall contain an equipment grounding conductor.

2. Non-metallic conduit systems, except non-metallic feeder conduits that carry a grounded conductor from exterior transformers to interior or building-mounted service entrance equipment, shall contain an equipment grounding conductor.
  3. Metallic conduit that only contains a grounding conductor, and is provided for its mechanical protection, shall be bonded to that conductor at the entrance and exit from the conduit.
  4. Metallic conduits which terminate without mechanical connection to an electrical equipment housing by means of locknut and bushings or adapters, shall be provided with grounding bushings. Connect bushings with a equipment grounding conductor to the equipment ground bus.
- B. Feeders and Branch Circuits: Install equipment grounding conductors with all feeders, and power and lighting branch circuits.
- C. Boxes, Cabinets, Enclosures, and Panelboards:
1. Bond the equipment grounding conductor to each pullbox, junction box, outlet box, device box, cabinets, and other enclosures through which the conductor passes (except for special grounding systems for intensive care units and other critical units shown).
  2. Provide lugs in each box and enclosure for equipment grounding conductor termination.
- D. Wireway Systems:
1. Bond the metallic structures of wireway to provide electrical continuity throughout the wireway system, by connecting a No. 6 AWG bonding jumper at all intermediate metallic enclosures and across all section junctions.
  2. Install insulated No. 6 AWG bonding jumpers between the wireway system, bonded as required above, and the closest building ground at each end and approximately every 16 M (50 feet).
  3. Use insulated No. 6 AWG bonding jumpers to ground or bond metallic wireway at each end for all intermediate metallic enclosures and across all section junctions.
  4. Use insulated No. 6 AWG bonding jumpers to ground cable tray to column-mounted building ground plates (pads) at each end and approximately every 15 M (49 feet).
- E. Receptacles shall not be grounded through their mounting screws. Ground receptacles with a jumper from the receptacle green ground terminal to

the device box ground screw and a jumper to the branch circuit equipment grounding conductor.

- F. Ground lighting fixtures to the equipment grounding conductor of the wiring system. Fixtures connected with flexible conduit shall have a green ground wire included with the power wires from the fixture through the flexible conduit to the first outlet box.
- G. Fixed electrical appliances and equipment shall be provided with a ground lug for termination of the equipment grounding conductor.
- H. Panelboard Bonding in Patient Care Areas: The equipment grounding terminal buses of the normal and essential branch circuit panel boards serving the same individual patient vicinity shall be bonded together with an insulated continuous copper conductor not less than No. 10 AWG, installed in rigid metal conduit.

### **3.5 CORROSION INHIBITORS**

- A. When making grounding and bonding connections, apply a corrosion inhibitor to all contact surfaces. Use corrosion inhibitor appropriate for protecting a connection between the metals used.

### **3.6 CONDUCTIVE PIPING**

- A. Bond all conductive piping systems, interior and exterior, to the grounding electrode system. Bonding connections shall be made as close as practical to the equipment ground bus.
- B. In operating rooms and at intensive care and coronary care type beds, bond the medical gas piping and medical vacuum piping at the outlets directly to the patient ground bus.

### **3.7 LIGHTNING PROTECTION SYSTEM**

- A. Bond the lightning protection system to the electrical grounding electrode system.

### **3.8 ACCEPTANCE CHECKS AND TESTS**

- A. Resistance of the grounding electrode system shall be measured using a four-terminal fall-of-potential method as defined in IEEE 81.
- B. Resistance measurements of separate grounding electrode systems shall be made before the systems are bonded together. The combined resistance of separate systems may be used to meet the required resistance, but the specified number of electrodes must still be provided.

---END---



## **SECTION 26 05 33**

### **RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS**

#### **PART 1 - GENERAL**

##### **1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, and connection of conduit, fittings, and boxes, to form complete, coordinated, grounded raceway systems. Raceways are required for all wiring unless shown or specified otherwise.
- B. Definitions: The term conduit, as used in this specification, shall mean any or all of the raceway types specified.

##### **1.2 RELATED WORK**

- A. Section 07 60 00, FLASHING AND SHEET METAL: Fabrications for the deflection of water away from the building envelope at penetrations.
- B. Section 07 84 00, FIRESTOPPING: Sealing around penetrations to maintain the integrity of fire rated construction.
- C. Section 07 92 00, JOINT SEALANTS: Sealing around conduit penetrations through the building envelope to prevent moisture migration into the building.
- D. Section 09 91 00, PAINTING: Identification and painting of conduit and other devices.
- E. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- F. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- G. Section 26 05 41, UNDERGROUND ELECTRICAL CONSTRUCTION: Underground conduits.

##### **1.3 QUALITY ASSURANCE**

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

##### **1.4 SUBMITTALS**

In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:

- A. Manufacturer's Literature and Data: Showing each cable type and rating. The specific item proposed and its area of application shall be identified on the catalog cuts.
- B. Shop Drawings:

1. Size and location of main feeders.
2. Size and location of panels and pull-boxes.
3. Layout of required conduit penetrations through structural elements.

C. Certifications:

1. Two weeks prior to the final inspection, submit four copies of the following certifications to the Contracting Officers Representative (COR):
  - a. Certification by the manufacturer that the material conforms to the requirements of the drawings and specifications.
  - b. Certification by the contractor that the material has been properly installed.

**1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American National Standards Institute (ANSI):
- C80.1-05.....Electrical Rigid Steel Conduit
  - C80.3-05.....Steel Electrical Metal Tubing
  - C80.6-05.....Electrical Intermediate Metal Conduit
- C. National Fire Protection Association (NFPA):
- 70-08.....National Electrical Code (NEC)
- D. Underwriters Laboratories, Inc. (UL):
- 1-05.....Flexible Metal Conduit
  - 5-04.....Surface Metal Raceway and Fittings
  - 6-07.....Electrical Rigid Metal Conduit - Steel
  - 50-95.....Enclosures for Electrical Equipment
  - 360-093.....Liquid-Tight Flexible Steel Conduit
  - 467-07.....Grounding and Bonding Equipment
  - 514A-04.....Metallic Outlet Boxes
  - 514B-04.....Conduit, Tubing, and Cable Fittings
  - 514C-96.....Nonmetallic Outlet Boxes, Flush-Device Boxes and Covers
  - 651-05.....Schedule 40 and 80 Rigid PVC Conduit and Fittings
  - 651A-00.....Type EB and A Rigid PVC Conduit and HDPE Conduit
  - 797-07.....Electrical Metallic Tubing
  - 1242-06.....Electrical Intermediate Metal Conduit - Steel
- E. National Electrical Manufacturers Association (NEMA):
- TC-2-03.....Electrical Polyvinyl Chloride (PVC) Tubing and Conduit

TC-3-04.....PVC Fittings for Use with Rigid PVC Conduit and  
Tubing

FB1-07.....Fittings, Cast Metal Boxes and Conduit Bodies  
for Conduit, Electrical Metallic Tubing and  
Cable

## **PART 2 - PRODUCTS**

### **2.1 MATERIAL**

- A. Conduit Size: In accordance with the NEC, but not less than 0.5 in [13 mm] unless otherwise shown. Where permitted by the NEC, 0.5 in [13 mm] flexible conduit may be used for tap connections to recessed lighting fixtures.
- B. Conduit:
  - 1. Rigid steel: Shall conform to UL 6 and ANSI C80.1.
  - 2. Rigid intermediate steel conduit (IMC): Shall conform to UL 1242 and ANSI C80.6.
  - 3. Electrical metallic tubing (EMT): Shall conform to UL 797 and ANSI C80.3. Maximum size not to exceed 4 in [105 mm] and shall be permitted only with cable rated 600 V or less.
  - 4. Flexible galvanized steel conduit: Shall conform to UL 1.
  - 5. Liquid-tight flexible metal conduit: Shall conform to UL 360.
  - 6. Surface metal raceway: Shall conform to UL 5.
- C. Conduit Fittings:
  - 1. Rigid steel and IMC conduit fittings:
    - a. Fittings shall meet the requirements of UL 514B and NEMA FB1.
    - b. Standard threaded couplings, locknuts, bushings, conduit bodies, and elbows: Only steel or malleable iron materials are acceptable. Integral retractable type IMC couplings are also acceptable.
    - c. Locknuts: Bonding type with sharp edges for digging into the metal wall of an enclosure.
    - d. Bushings: Metallic insulating type, consisting of an insulating insert, molded or locked into the metallic body of the fitting. Bushings made entirely of metal or nonmetallic material are not permitted.
    - e. Erickson (union-type) and set screw type couplings: Approved for use in concrete are permitted for use to complete a conduit run where conduit is installed in concrete. Use set screws of case-hardened steel with hex head and cup point to firmly seat in conduit wall for positive ground. Tightening of set screws with pliers is prohibited.

- f. Sealing fittings: Threaded cast iron type. Use continuous drain-type sealing fittings to prevent passage of water vapor. In concealed work, install fittings in flush steel boxes with blank cover plates having the same finishes as that of other electrical plates in the room.
- 2. Electrical metallic tubing fittings:
  - a. Fittings and conduit bodies shall meet the requirements of UL 514B, ANSI C80.3, and NEMA FB1.
  - b. Only steel or malleable iron materials are acceptable.
  - c. Compression couplings and connectors: Concrete-tight and rain-tight, with connectors having insulated throats.
  - d. Indent-type connectors or couplings are prohibited.
  - e. Die-cast or pressure-cast zinc-alloy fittings or fittings made of "pot metal" are prohibited.
- 3. Flexible steel conduit fittings:
  - a. Conform to UL 514B. Only steel or malleable iron materials are acceptable.
  - b. Clamp-type, with insulated throat.
- 4. Liquid-tight flexible metal conduit fittings:
  - a. Fittings shall meet the requirements of UL 514B and NEMA FB1.
  - b. Only steel or malleable iron materials are acceptable.
  - c. Fittings must incorporate a threaded grounding cone, a steel or plastic compression ring, and a gland for tightening. Connectors shall have insulated throats.
- 5. Surface metal raceway fittings: As recommended by the raceway manufacturer. Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, conduit entry fittings, accessories, and other fittings as required for complete system.
- 6. Expansion and deflection couplings:
  - a. Conform to UL 467 and UL 514B.
  - b. Accommodate a 0.75 in [19 mm] deflection, expansion, or contraction in any direction, and allow 30 degree angular deflections.
  - c. Include internal flexible metal braid, sized to guarantee conduit ground continuity and a low-impedance path for fault currents, in accordance with UL 467 and the NEC tables for equipment grounding conductors.
  - d. Jacket: Flexible, corrosion-resistant, watertight, moisture and heat-resistant molded rubber material with stainless steel jacket clamps.

D. Conduit Supports:

1. Parts and hardware: Zinc-coat or provide equivalent corrosion protection.
2. Individual Conduit Hangers: Designed for the purpose, having a pre-assembled closure bolt and nut, and provisions for receiving a hanger rod.
3. Multiple conduit (trapeze) hangers: Not less than 1.5 x 1.5 in [38 mm x 38 mm], 12-gauge steel, cold-formed, lipped channels; with not less than 0.375 in [9 mm] diameter steel hanger rods.
4. Solid Masonry and Concrete Anchors: Self-drilling expansion shields, or machine bolt expansion.

E. Outlet, Junction, and Pull Boxes:

1. UL-50 and UL-514A.
2. Cast metal where required by the NEC or shown, and equipped with rustproof boxes.
3. Sheet metal boxes: Galvanized steel, except where otherwise shown.
4. Flush-mounted wall or ceiling boxes shall be installed with raised covers so that the front face of raised cover is flush with the wall. Surface-mounted wall or ceiling boxes shall be installed with surface-style flat or raised covers.

F. Wireways: Equip with hinged covers, except where removable covers are shown. Include couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, and other fittings to match and mate with wireways as required for a complete system.

**PART 3 - EXECUTION**

**3.1 PENETRATIONS**

A. Cutting or Holes:

1. Cut holes in advance where they should be placed in the structural elements, such as ribs or beams. Obtain the approval of the Contracting Officers Representative (COR) prior to drilling through structural elements.
2. Cut holes through concrete and masonry in new and existing structures with a diamond core drill or concrete saw. Pneumatic hammers, impact electric, hand, or manual hammer-type drills are not allowed, except where permitted by the COR as required by limited working space.

B. Firestop: Where conduits, wireways, and other electrical raceways pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING.

- C. Waterproofing: At floor, exterior wall, and roof conduit penetrations, completely seal clearances around the conduit and make watertight, as specified in Section 07 92 00, JOINT SEALANTS.

### **3.2 INSTALLATION, GENERAL**

- A. In accordance with UL, NEC, as shown, and as specified herein.
- B. Essential (Emergency) raceway systems shall be entirely independent of other raceway systems, except where shown on drawings.
- C. Install conduit as follows:
1. In complete mechanically and electrically continuous runs before pulling in cables or wires.
  2. Unless otherwise indicated on the drawings or specified herein, installation of all conduits shall be concealed within finished walls, floors, and ceilings.
  3. Flattened, dented, or deformed conduit is not permitted. Remove and replace the damaged conduits with new undamaged material.
  4. Assure conduit installation does not encroach into the ceiling height head room, walkways, or doorways.
  5. Cut square, ream, remove burrs, and draw up tight.
  6. Independently support conduit at 8 ft [2.4 M] on centers. Do not use other supports, i.e., suspended ceilings, suspended ceiling supporting members, lighting fixtures, conduits, mechanical piping, or mechanical ducts.
  7. Support within 12 in [300 mm] of changes of direction, and within 12 in [300 mm] of each enclosure to which connected.
  8. Close ends of empty conduit with plugs or caps at the rough-in stage until wires are pulled in, to prevent entry of debris.
  9. Conduit installations under fume and vent hoods are prohibited.
  10. Secure conduits to cabinets, junction boxes, pull-boxes, and outlet boxes with bonding type locknuts. For rigid and IMC conduit installations, provide a locknut on the inside of the enclosure, made up wrench tight. Do not make conduit connections to junction box covers.
  11. Flashing of penetrations of the roof membrane is specified in Section 07 60 00, FLASHING AND SHEET METAL.
  12. Conduit bodies shall only be used for changes in direction, and shall not contain splices.
- D. Conduit Bends:
1. Make bends with standard conduit bending machines.
  2. Conduit hickey may be used for slight offsets and for straightening stubbed out conduits.

3. Bending of conduits with a pipe tee or vise is prohibited.

E. Layout and Homeruns:

1. Install conduit with wiring, including homeruns, as shown on drawings.
2. Deviations: Make only where necessary to avoid interferences and only after drawings showing the proposed deviations have been submitted approved by the COR.

### **3.3 CONCEALED WORK INSTALLATION**

A. In Concrete:

1. Conduit: Rigid steel, IMC, or EMT. Do not install EMT in concrete slabs that are in contact with soil, gravel, or vapor barriers.
2. Align and run conduit in direct lines.
3. Installation of conduit in concrete that is less than 3 in [75 mm] thick is prohibited.
  - a. Conduit outside diameter larger than one-third of the slab thickness is prohibited.
  - b. Space between conduits in slabs: Approximately six conduit diameters apart, and one conduit diameter at conduit crossings.
  - c. Install conduits approximately in the center of the slab so that there will be a minimum of 0.75 in [19 mm] of concrete around the conduits.
4. Make couplings and connections watertight. Use thread compounds that are UL approved conductive type to ensure low resistance ground continuity through the conduits. Tightening setscrews with pliers is prohibited.

B. Above Furred or Suspended Ceilings and in Walls:

1. Conduit for conductors 600 V and below: Rigid steel, IMC or EMT. Mixing different types of conduits indiscriminately in the same system is prohibited.
2. Align and run conduit parallel or perpendicular to the building lines.
3. Connect recessed lighting fixtures to conduit runs with maximum 6 ft [1.8 M] of flexible metal conduit extending from a junction box to the fixture.
4. Tightening setscrews with pliers is prohibited.

### **3.4 EXPOSED WORK INSTALLATION**

- A. Unless otherwise indicated on the drawings, exposed conduit is only permitted in mechanical and electrical rooms.

- B. Conduit for Conductors 600 V and Below: Rigid steel, IMC, or EMT. Mixing different types of conduits indiscriminately in the system is prohibited.
- C. Align and run conduit parallel or perpendicular to the building lines.
- D. Install horizontal runs close to the ceiling or beams and secure with conduit straps.
- E. Support horizontal or vertical runs at not over 8 ft [2.4 M] intervals.
- F. Surface metal raceways: Use only where shown.
- G. Painting:
  - 1. Paint exposed conduit as specified in Section 09 91 00, PAINTING.

### **3.5 DIRECT BURIAL INSTALLATION**

Refer to Section 26 05 41, UNDERGROUND ELECTRICAL CONSTRUCTION.

### **3.6 WET OR DAMP LOCATIONS**

- A. Unless otherwise shown, use conduits of rigid steel or IMC.
- B. Provide sealing fittings to prevent passage of water vapor where conduits pass from warm to cold locations, i.e., refrigerated spaces, constant-temperature rooms, air-conditioned spaces, building exterior walls, roofs, or similar spaces.
- C. Unless otherwise shown, use rigid steel or IMC conduit within 5 ft [1.5 M] of the exterior and below concrete building slabs in contact with soil, gravel, or vapor barriers. Conduit shall be half-lapped with 10 mil PVC tape before installation. After installation, completely recoat or retape any damaged areas of coating.

### **3.7 MOTORS AND VIBRATING EQUIPMENT**

- A. Use flexible metal conduit for connections to motors and other electrical equipment subject to movement, vibration, misalignment, cramped quarters, or noise transmission.
- B. Use liquid-tight flexible metal conduit for installation in exterior locations, moisture or humidity laden atmosphere, corrosive atmosphere, water or spray wash-down operations, inside airstream of HVAC units, and locations subject to seepage or dripping of oil, grease, or water. Provide a green equipment grounding conductor with flexible metal conduit.

### **3.8 EXPANSION JOINTS**

- A. Conduits 3 in [75 mm] and larger that are secured to the building structure on opposite sides of a building expansion joint require expansion and deflection couplings. Install the couplings in accordance with the manufacturer's recommendations.
- B. Provide conduits smaller than 3 in [75 mm] with junction boxes on both sides of the expansion joint. Connect conduits to junction boxes with



sufficient slack of flexible conduit to produce 5 in [125 mm] vertical drop midway between the ends. Flexible conduit shall have a bonding jumper installed. In lieu of this flexible conduit, expansion and deflection couplings as specified above for conduits 15 in [375 mm] and larger are acceptable.

C. Install expansion and deflection couplings where shown.

### **3.9 CONDUIT SUPPORTS, INSTALLATION**

- A. Safe working load shall not exceed one-quarter of proof test load of fastening devices.
- B. Use pipe straps or individual conduit hangers for supporting individual conduits.
- C. Support multiple conduit runs with trapeze hangers. Use trapeze hangers that are designed to support a load equal to or greater than the sum of the weights of the conduits, wires, hanger itself, and 200 lbs [90 kg]. Attach each conduit with U-bolts or other approved fasteners.
- D. Support conduit independently of junction boxes, pull-boxes, fixtures, suspended ceiling T-bars, angle supports, and similar items.
- E. Fasteners and Supports in Solid Masonry and Concrete:
  - 1. New Construction: Use steel or malleable iron concrete inserts set in place prior to placing the concrete.
  - 2. Existing Construction:
    - a. Steel expansion anchors not less than 0.25 in [6 mm] bolt size and not less than 1.125 in [28 mm] embedment.
    - b. Power set fasteners not less than 0.25 in [6 mm] diameter with depth of penetration not less than 3 in [75 mm].
    - c. Use vibration and shock-resistant anchors and fasteners for attaching to concrete ceilings.
- F. Hollow Masonry: Toggle bolts.
- G. Bolts supported only by plaster or gypsum wallboard are not acceptable.
- H. Metal Structures: Use machine screw fasteners or other devices specifically designed and approved for the application.
- I. Attachment by wood plugs, rawl plug, plastic, lead or soft metal anchors, or wood blocking and bolts supported only by plaster is prohibited.
- J. Chain, wire, or perforated strap shall not be used to support or fasten conduit.
- K. Spring steel type supports or fasteners are prohibited for all uses except horizontal and vertical supports/fasteners within walls.
- L. Vertical Supports: Vertical conduit runs shall have riser clamps and supports in accordance with the NEC and as shown. Provide supports for

cable and wire with fittings that include internal wedges and retaining collars.

### **3.10 BOX INSTALLATION**

- A. Boxes for Concealed Conduits:
  - 1. Flush-mounted.
  - 2. Provide raised covers for boxes to suit the wall or ceiling, construction, and finish.
- B. In addition to boxes shown, install additional boxes where needed to prevent damage to cables and wires during pulling-in operations.
- C. Remove only knockouts as required and plug unused openings. Use threaded plugs for cast metal boxes and snap-in metal covers for sheet metal boxes.
- D. Outlet boxes mounted back-to-back in the same wall are prohibited. A minimum 24 in [600 mm] center-to-center lateral spacing shall be maintained between boxes.
- E. Minimum size of outlet boxes for ground fault interrupter (GFI) receptacles is 4 in [100 mm] square x 2.125 in [55 mm] deep, with device covers for the wall material and thickness involved.
- F. Stencil or install phenolic nameplates on covers of the boxes identified on riser diagrams; for example "SIG-FA JB No. 1."
- G. On all branch circuit junction box covers, identify the circuits with black marker.

- - - E N D - - -

**SECTION 26 05 41**  
**UNDERGROUND ELECTRICAL CONSTRUCTION**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, and connection of underground raceways to form a complete underground electrical raceway system.
- B. The terms "duct" and "conduit" are used interchangeably in this section.

**1.2 RELATED WORK**

- A. Section 07 92 00, JOINT SEALANTS: Sealing of conduit penetrations.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Coordinate layout and installation of conduit and pullboxes with final arrangement of other utilities, site grading, and surface features.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
  - 1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Submit information on pullboxes, ducts, and hardware.
    - c. Proposed deviations from the drawings shall be clearly marked on the submittals. If it is necessary to locate pullboxes at locations other than shown on the drawings, show the proposed locations accurately on scaled site drawings, and submit to the Contracting Officers Representative (COR) for approval prior to construction.
  - 2. Certifications: Two weeks prior to the final inspection, submit the following.

- a. Certification by the manufacturer that the materials conform to the requirements of the drawings and specifications.
- b. Certification by the Contractor that the materials have been properly installed, connected, and tested.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American Concrete Institute (ACI):
  - Building Code Requirements for Structural Concrete
  - 318-11/318M-11.....Building Code Requirements for Structural Concrete & Commentary
  - SP-66-04.....ACI Detailing Manual
- C. American National Standards Institute (ANSI):
  - 77-10.....Underground Enclosure Integrity
- D. American Society for Testing and Materials (ASTM):
  - C478-12.....Standard Specification for Precast Reinforced Concrete Manhole Sections
  - C858-10e1.....Underground Precast Concrete Utility Structures
  - C990-09.....Joints for Concrete Pipe, Manholes and Precast Box Sections Using Preformed Flexible Joint Sealants.
- E. National Electrical Manufacturers Association (NEMA):
  - TC 2-03.....Electrical Polyvinyl Chloride (PVC) Conduit
  - TC 3-04.....Polyvinyl Chloride (PVC) Fittings for Use With Rigid PVC Conduit And Tubing
  - TC 6 & 8-03.....Polyvinyl Chloride (PVC) Plastic Utilities Duct For Underground Installations
  - TC 9-04.....Fittings For Polyvinyl Chloride (PVC) Plastic Utilities Duct For Underground Installation
- F. National Fire Protection Association (NFPA):
  - 70-11.....National Electrical Code (NEC)
  - 70E-12.....National Electrical Safety Code
- G. Underwriters Laboratories, Inc. (UL):
  - 6-07.....Electrical Rigid Metal Conduit-Steel
  - 467-07.....Grounding and Bonding Equipment

651-11.....Schedule 40, 80, Type EB and A Rigid PVC  
Conduit and Fittings

651A-11.....Schedule 40 and 80 High Density Polyethylene  
(HDPE) Conduit

651B-07.....Continuous Length HDPE Conduit

## **PART 2 - PRODUCTS**

### **2.1 PULLBOXES**

- A. General: Size as indicated on the drawings. Provide pullboxes with weatherproof, non-skid covers with recessed hook eyes, secured with corrosion- and tamper-resistant hardware. Cover material shall be identical to pullbox material. Covers shall have molded lettering, ELECTRIC or SIGNAL as applicable. Pullboxes shall comply with the requirements of ANSI 77 Tier 5 loading. Provide pulling irons, 22 mm (0.875 inch) diameter galvanized steel bar with exposed triangular-shaped opening.
- B. Fiberglass Pullboxes: Shall be sheet-molded, fiberglass-reinforced, polyester resin enclosure joined to polymer concrete top ring or frame.

### **2.2 DUCTS**

- A. Number and sizes shall be as shown on the drawings.
- B. Ducts:
  - 1. Rigid metal conduit: UL6 and NEMA RN1 galvanized rigid metal, half-lap wrapped with 10 mil PVC tape.

### **2.3 GROUNDING**

- A. Ground Rods and Ground Wire: Per Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.

## **PART 3 - EXECUTION**

### **3.1 PULLBOX INSTALLATION**

- A. Assembly and installation shall be per the requirements of the manufacturer.
  - 1. Install pullboxes level and plumb.
  - 2. Units shall be installed on a 300 mm (12 inches) thick level bed of 90% compacted granular fill, well-graded from the 25 mm (1 inches) sieve to the No. 4 sieve. Granular fill shall be compacted with a minimum of four passes with a plate compactor.
- B. Access: Ensure the top of frames and covers are flush with finished grade.

### **3.2 TRENCHING**

- A. Before performing trenching work at existing facilities, a Ground Penetrating Radar Survey shall be carefully performed by a certified technician to reveal all existing underground ducts, conduits, cables, and other utility systems.
- B. Work with extreme care near existing ducts, conduits, and other utilities to avoid damaging them.
- C. Cut the trenches neatly and uniformly.

### **3.3 DUCT INSTALLATION**

- A. General Requirements:
  - 1. Ducts shall be in accordance with the NEC, as shown on the drawings, and as specified.
  - 2. Join and terminate ducts with fittings recommended by the manufacturer.
  - 3. Slope ducts to drain towards pullboxes, and away from building and equipment entrances. Pitch not less than 100 mm (4 inch) in 30 M (100 feet).
  - 4. Underground conduit stub-ups and sweeps to equipment inside of buildings shall be galvanized rigid metal conduit half-lap wrapped with PVC tape, and shall extend a minimum of 1.5 M (5 feet) outside the building foundation. Tops of conduits below building slab shall be minimum 610 mm (24 inches) below bottom of slab.
  - 5. Install insulated grounding bushings on the conduit terminations.
  - 6. Radius for sweeps shall be sufficient to accomplish pulls without damage. Minimum radius shall be six times conduit diameter.
  - 7. All multiple conduit runs shall have conduit spacers. Spacers shall securely support and maintain uniform spacing of the duct assembly a minimum of 75 mm (3 inches) above the bottom of the trench during the concrete pour. Spacer spacing shall not exceed 1.5 M (5 feet). Secure spacers to ducts and earth to prevent floating during concrete pour. Provide nonferrous tie wires to prevent displacement of the ducts during concrete pour. Tie wires shall not act as substitute for spacers.
  - 8. Duct lines shall be installed no less than 300 mm (12 inches) from other utility systems, such as water, sewer, chilled water.
  - 9. Clearances between individual ducts:
    - a. For similar services, not less than 75 mm (3 inches).

- b. For power and signal services, not less than 150 mm (6 inches).
  - 10. Keep ducts clean of earth, sand, or gravel, and seal with tapered plugs upon completion of each portion of the work.
  - 11. Duct Sealing: Seal ducts, including spare ducts, at building entrances and at outdoor terminations for equipment, with a suitable non-hardening compound to prevent the entrance of foreign objects and material, moisture, and gases.
  - 12. Use plastic ties to secure cables to insulators on cable arms. Use minimum two ties per cable per insulator.
- B. Concrete-Encased Ducts:
- 1. Install concrete-encased ducts for low-voltage systems and signal systems, unless otherwise shown on the drawings.
  - 2. Duct banks shall be single or multiple duct assemblies encased in concrete. Ducts shall be uniform in size and material throughout the installation.
  - 3. Tops of concrete-encased ducts shall be:
    - a. Not less than 600 mm (24 inches) and not less than shown on the drawings, below finished grade.
    - b. Not less than 750 mm (30 inches) and not less than shown on the drawings, below roads and other paved surfaces.
    - c. Additional burial depth shall be required in order to accomplish NEC-required minimum bend radius of ducts.
    - d. Conduits crossing under grade slab construction joints shall be installed a minimum of 1.2 M (4 feet) below slab.
  - 4. Extend the concrete envelope encasing the ducts not less than 75 mm (3 inches) beyond the outside walls of the outer ducts.
  - 5. Within 3 M (10 feet) of building and pullbox wall penetrations, install reinforcing steel bars at the top and bottom of each concrete envelope to provide protection against vertical shearing.
  - 6. Install reinforcing steel bars at the top and bottom of each concrete envelope of all ducts underneath roadways and parking areas.
  - 7. Duct joints in concrete may be placed side by side horizontally, but shall be staggered at least 150 mm (6 inches) vertically.
  - 8. Pour each run of concrete one continuous pour. If more than one pour is necessary, terminate each pour in a vertical plane and install 19

mm (0.75 inch) reinforcing rod dowels extending 450 mm (18 inches) into concrete on both sides of joint near corners of envelope.

9. Pour concrete so that open spaces are uniformly filled. Do not agitate with power equipment unless approved by COR.

C. Direct-Burial Ducts:

1. Install direct-burial ducts only where shown on the drawings. Provide direct-burial ducts only for low-voltage power and lighting branch circuits.

2. Tops of ducts shall be:

- a. Not less than 600 mm (24 inches) and not less than shown on the drawings, below finished grade.
- b. Not less than 750 mm (30 inches) and not less than shown on the drawings, below roads and other paved surfaces.
- c. Additional burial depth shall be required in order to accomplish NEC-required minimum bend radius of ducts.

3. Do not kink the ducts. Compaction shall not deform the ducts.

- D. Connections to Pullboxes: Ducts connecting to pullboxes shall be flared to have an enlarged cross-section to provide additional shear strength. Dimensions of the flared cross-section shall be larger than the corresponding pullbox opening dimensions by no less than 300 mm (12 inches) in each direction. Perimeter of the duct bank opening in the pullbox shall be flared toward the inside or keyed to provide a positive interlock between the duct and the wall of the pullbox. Use vibrators when this portion of the encasement is poured to ensure a seal between the envelope and the wall of the structure.

### **3.4 ACCEPTANCE CHECKS AND TESTS**

A. Duct Testing and Cleaning:

1. Upon completion of the duct installation, a standard flexible mandrel shall be pulled through each duct to loosen particles of earth, sand, or foreign material left in the duct, and to test for out-of-round conditions.
2. The mandrel shall be not less than 300 mm (12 inches) long, and shall have a diameter not less than 13 mm (0.5 inch) less than the inside diameter of the duct. A brush with stiff bristles shall then be pulled through each duct to remove the loosened particles. The diameter of the brush shall be the same as, or slightly larger than, the diameter of the duct.



3. If testing reveals obstructions or out-of-round conditions, the Contractor shall replace affected section(s) of duct and retest to the satisfaction of the COR at no cost to the Government.
4. Mandrel pulls shall be witnessed by the COR.

---END---



## **SECTION 26 08 00**

### **COMMISSIONING OF ELECTRICAL SYSTEMS**

#### **PART 1 - GENERAL**

##### **1.1 DESCRIPTION**

- A. The requirements of this Section apply to all sections of Division 26.
- B. This project will have selected building systems commissioned. The complete list of equipment and systems to be commissioned are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. The commissioning process, which the Contractor is responsible to execute, is defined in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. A Commissioning Agent (CxA) appointed by the Department of Veterans Affairs will manage the commissioning process.

##### **1.2 RELATED WORK**

- A. Section 01 00 00 GENERAL REQUIREMENTS.
- B. Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.
- C. Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

##### **1.3 SUMMARY**

- A. This Section includes requirements for commissioning the Facility electrical systems, related subsystems and related equipment. This Section supplements the general requirements specified in Section 01 91 00 General Commissioning Requirements.
- B. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for more details regarding processes and procedures as well as roles and responsibilities for all Commissioning Team members.

##### **1.4 DEFINITIONS**

- A. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for definitions.

##### **1.5 COMMISSIONED SYSTEMS**

- A. Commissioning of a system or systems specified in Division 26 is part of the construction process. Documentation and testing of these systems, as well as training of the VA's Operation and Maintenance personnel in accordance with the requirements of Section 01 91 00 and of Division 26, is required in cooperation with the VA and the Commissioning Agent.
- B. The Facility electrical systems commissioning will include the systems listed in Section 01 19 00 General Commissioning Requirements:

## **1.6 SUBMITTALS**

- A. The commissioning process requires review of selected Submittals. The Commissioning Agent will provide a list of submittals that will be reviewed by the Commissioning Agent. This list will be reviewed and approved by the Contracting Officers Representative (COR) prior to forwarding to the Contractor. Refer to Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, and SAMPLES for further details.
- B. The commissioning process requires Submittal review simultaneously with engineering review. Specific submittal requirements related to the commissioning process are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

## **PART 2 - PRODUCTS (NOT USED)**

## **PART 3 - EXECUTION**

### **3.1 CONSTRUCTION INSPECTIONS**

- A. Commissioning of Electrical systems will require inspection of individual elements of the electrical systems construction throughout the construction period. The Contractor shall coordinate with the Commissioning Agent in accordance with Section 01 19 00 and the Commissioning plan to schedule electrical systems inspections as required to support the Commissioning Process.

### **3.2 PRE-FUNCTIONAL CHECKLISTS**

- A. The Contractor shall complete Pre-Functional Checklists to verify systems, subsystems, and equipment installation is complete and systems are ready for Systems Functional Performance Testing. The Commissioning Agent will prepare Pre-Functional Checklists to be used to document equipment installation. The Contractor shall complete the checklists. Completed checklists shall be submitted to the VA and to the Commissioning Agent for review. The Commissioning Agent may spot check a sample of completed checklists. If the Commissioning Agent determines that the information provided on the checklist is not accurate, the Commissioning Agent will return the marked-up checklist to the Contractor for correction and resubmission. If the Commissioning Agent determines that a significant number of completed checklists for similar equipment are not accurate, the Commissioning Agent will select a broader sample of checklists for review. If the Commissioning Agent determines that a significant number of the broader sample of checklists is also inaccurate, all the checklists for the type of equipment will be returned to the Contractor for correction and

resubmission. Refer to SECTION 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for submittal requirements for Pre-Functional Checklists, Equipment Startup Reports, and other commissioning documents.

### **3.3 CONTRACTORS TESTS**

- A. Contractor tests as required by other sections of Division 26 shall be scheduled and documented in accordance with Section 01 00 00 GENERAL REQUIREMENTS. All testing shall be incorporated into the project schedule. Contractor shall provide no less than 7 calendar days' notice of testing. The Commissioning Agent will witness selected Contractor tests at the sole discretion of the Commissioning Agent. Contractor tests shall be completed prior to scheduling Systems Functional Performance Testing.

### **3.4 SYSTEMS FUNCTIONAL PERFORMANCE TESTING:**

- A. The Commissioning Process includes Systems Functional Performance Testing that is intended to test systems functional performance under steady state conditions, to test system reaction to changes in operating conditions, and system performance under emergency conditions. The Commissioning Agent will prepare detailed Systems Functional Performance Test procedures for review and approval by the COR. The Contractor shall review and comment on the tests prior to approval. The Contractor shall provide the required labor, materials, and test equipment identified in the test procedure to perform the tests. The Commissioning Agent will witness and document the testing. The Contractor shall sign the test reports to verify tests were performed. See Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS, for additional details.

### **3.5 TRAINING OF VA PERSONNEL**

- A. Training of the VA's operation and maintenance personnel is required in cooperation with the COR and Commissioning Agent. Provide competent, factory authorized personnel to provide instruction to operation and maintenance personnel concerning the location, operation, and troubleshooting of the installed systems. The instruction shall be scheduled in coordination with the COR after submission and approval of formal training plans. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS and Division 26 Sections for additional Contractor training requirements.

----- END -----



**SECTION 26 09 23**  
**LIGHTING CONTROLS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

This section specifies the furnishing, installation and connection of the lighting controls.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General requirements that are common to more than one section of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Cables and wiring.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.
- D. Section 26 24 16, PANELBOARDS: panelboard enclosure and interior bussing used for lighting control panels.
- E. Section 26 27 26, WIRING DEVICES: Wiring devices used for control of the lighting systems.

**1.3 QUALITY ASSURANCE**

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. In accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS, submit the following:
- B. Product Data: For each type of lighting control, submit the following information.
  - 1. Manufacturer's catalog data.
  - 2. Wiring schematic and connection diagram.
  - 3. Installation details.
- C. Manuals:
  - 1. Submit, simultaneously with the shop drawings companion copies of complete maintenance and operating manuals including technical data sheets, and information for ordering replacement parts.
  - 2. Two weeks prior to the final inspection, submit four copies of the final updated maintenance and operating manuals, including any changes, to the Contracting Officers Representative (COR).
- D. Certifications:
  - 1. Two weeks prior to final inspection, submit four copies of the following certifications to the COR:

- a. Certification by the Contractor that the equipment has been properly installed, adjusted, and tested.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. Green Seal (GS):  
GC-12.....Occupancy Sensors
- C. Illuminating Engineering Society of North America (IESNA):  
IESNA LM-48.....Guide for Calibration of Photoelectric Control Devices
- D. National Electrical Manufacturer's Association (NEMA)  
C136.10.....American National Standard for Roadway Lighting Equipment-Locking-Type Photocontrol Devices and Mating Receptacles - Physical and Electrical Interchangeability and Testing  
ICS-1.....Standard for Industrial Control and Systems General Requirements  
ICS-2.....Standard for Industrial Control and Systems: Controllers, Contractors, and Overload Relays Rated Not More than 2000 Volts AC or 750 Volts DC: Part 8 - Disconnect Devices for Use in Industrial Control Equipment  
ICS-6.....Standard for Industrial Controls and Systems Enclosures
- E. Underwriters Laboratories, Inc. (UL):  
20.....Standard for General-Use Snap Switches  
773.....Standard for Plug-In Locking Type Photocontrols for Use with Area Lighting  
773A .....Nonindustrial Photoelectric Switches for Lighting Control  
98.....Enclosed and Dead-Front Switches  
917.....Clock Operated Switches

#### **PART 2 - PRODUCTS**

##### **2.1 INDOOR OCCUPANCY SENSORS**

- A. Wall- or ceiling-mounting, solid-state units with a power supply and relay unit, suitable for the environmental conditions in which installed.
1. Operation: Unless otherwise indicated, turn lights on when covered area is occupied and off when unoccupied; with a 1 to 15 minute adjustable time delay for turning lights off.



2. Sensor Output: Contacts rated to operate the connected relay.  
Sensor shall be powered from the relay unit.
3. Relay Unit: Dry contacts rated for 20A ballast load at 120V and 277V, for 13A tungsten at 120V, and for 1 hp at 120V.
4. Mounting:
  - a. Sensor: Suitable for mounting in any position on a standard outlet box.
  - b. Time-Delay and Sensitivity Adjustments: Recessed and concealed behind hinged door.
5. Indicator: LED, to show when motion is being detected during testing and normal operation of the sensor.
6. Bypass Switch: Override the on function in case of sensor failure.
7. Manual/automatic selector switch.
8. Automatic Light-Level Sensor: Adjustable from 2 to 200 fc [21.5 to 2152 lx]; keep lighting off when selected lighting level is present.
9. Faceplate for Wall-Switch Replacement Type: Refer to wall plate material and color requirements for toggle switches, as specified in Section 26 27 26, WIRING DEVICES.
- B. Dual-technology Type: Ceiling mounting; combination PIR and ultrasonic detection methods, field-selectable.
  1. Sensitivity Adjustment: Separate for each sensing technology.
  2. Detector Sensitivity: Detect occurrences of 6-inch [150mm] minimum movement of any portion of a human body that presents a target of not less than 36 sq. in. [232 sq. cm], and detect a person of average size and weight moving not less than 12 inches [305 mm] in either a horizontal or a vertical manner at an approximate speed of 12 inches/s [305 mm/s].
  3. Detection Coverage: as scheduled on drawings.

## **2.2 LIGHTING CONTROL PANEL - RELAY TYPE**

- A. Controller: Comply with UL 508; programmable, solid-state, astronomic 365-day control unit with non-volatile memory, mounted in preassembled relay panel with low-voltage-controlled, latching-type, single-pole lighting circuit relays. Controller shall be capable of receiving inputs from sensors and other sources, and capable of timed overrides and/or blink-warning on a per-circuit basis. Where indicated, a limited number of digital or analog, low-voltage control-circuit outputs shall be supported by control unit and circuit boards associated with relays.
- B. Cabinet: Steel with hinged, locking door. Barriers separate low-voltage and line-voltage components.
- C. Directory: Identifies each relay as to load controlled.

- D. Control Power Supply: Transformer and full-wave rectifier with filtered dc output.
- E. Single-Pole Relays: Mechanically held unless otherwise indicated; split-coil, momentary-pulsed type, rated 20 A, 125-V ac for tungsten filaments and 20 A, 277-V ac for ballasts, 50,000 cycles at rated capacity.
- F. Micro-panels: Compact lighting controller, suitable for mounting above accessible ceiling, with 8-relay outputs.
  - 1. Rated for normal and emergency power with barriers provided between normal and emergency sources.
  - 2. Integration to main relay panel made through low voltage wiring.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION:**

- A. Installation shall be in accordance with the NEC, manufacturer's instructions and as shown on the drawings or specified.
- B. Aiming for wall-mounted and ceiling-mounted motion sensor switches shall be per manufacturer's recommendations.
- C. Set occupancy sensor "on" duration to 5 minutes.

#### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Perform in accordance with the manufacturer's recommendations.
- B. Upon completion of installation, conduct an operating test to show that equipment operates in accordance with requirements of this section.
- C. Test for full range of dimming ballast and dimming controls capability. Observe for visually detectable flicker over full dimming range.
- D. Test occupancy sensors for proper operation. Observe for light control over entire area being covered.
- E. Program lighting control panels per schedule on drawings.
- F. Upon completion of the installation, the system shall be commissioned by the manufacturer's factory-authorized technician who will verify all adjustments and sensor placements.

#### **3.3 FOLLOW-UP VERIFICATION**

Upon completion of acceptance checks and tests, the Contractor shall show by demonstration in service that the lighting control devices are in good operating condition and properly performing the intended function.

- - - E N D - - -

**SECTION 26 20 11**  
**ISOLATED POWER SYSTEMS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, connection, and testing of isolated power systems.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS:  
Requirements that apply to all sections of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES:  
Low-voltage conductors.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS:  
Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
  - 1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Include electrical ratings, dimensions, weights, mounting details, front view, side view, equipment and device arrangement, main and branch circuit overcurrent protection, wiring diagrams, materials, and connection diagrams.
  - 2. Manuals:
    - a. Submit, simultaneously with the shop drawings, complete maintenance and operating manuals, including technical data sheets, wiring diagrams, and information for ordering replacement parts.
    - b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.

3. Test Reports:

- a. Two weeks prior to the final inspection, submit field test reports.

4. Certifications:

- a. Certification by the manufacturer that the isolated power systems conform to the requirements of the drawings and specifications.
- b. Certification by the manufacturer that the isolation transformers have been tested and conform to the leakage current and sound level requirements specified.
- c. Certification by the Contractor that the isolated power systems have been properly installed, adjusted, and tested.

5. Product Data:

- a. Provide dimensions, knockout sizes and locations, materials, fabrication details, finishes, and accessories.

**1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by basic designation only.
- B. National Fire Protection Association (NFPA):
  - 70-11.....National Electrical Code (NEC)
  - 99-12.....Health Care Facilities
- C. Underwriters Laboratories, Inc. (UL):
  - 50-07.....Enclosures for Electrical Equipment
  - 797-07.....Electrical Metallic Tubing-Steel
  - 1022-12.....Line Isolation Monitors
  - 1047-10.....Isolated Power Systems Equipment

**PART 2 - PRODUCTS**

**2.1 EQUIPMENT**

- A. Isolated power systems shall be in accordance with ANSI/NFPA and UL.
- B. Isolated power systems shall be flush mounted, as shown on the drawings, and include isolated power units (IPUs), power receptacles, grounding receptacles, equipotential ground bus modules with power and grounding receptacles, line isolation monitors and remote line isolation monitors, and related circuitry.

- C. Incorporate the IPUs in factory-assembled units. House the isolation transformer, line isolation monitor, and circuit breaker panelboard in each IPU.
- D. Line isolation monitors shall be in accordance with the following:
1. Shall be capable of detecting any combination of resistive and/or capacitive faults, including balanced, unbalanced, and hybrid faults.
  2. Shall incorporate in each line isolation monitor, or on the front trim of the IPU, a hazard meter or digital display, indicator lights, an audible alarm with a local silencing switch, a test switch, and provisions for transmitting the alarm signals to a remote location. Transmission of the alarm signals to remote locations up to several hundred feet from the monitor shall not unduly increase the leakage current for the system.
  3. The LIM used in these units shall indicate alarm when the total hazard current exceeds 5 mA. The remote indicator alarm unit shall be located in the operating room and connected to the panel supplying power to the circuits in that room. The panel shall be placed so its bottom edge is 61 inches above the finished operating room floor if the room is rated for flammable anesthetics. Location within the operating room is as indicated on the drawings.
  4. The LIM shall use microprocessor-based digital signal processing to continually monitor the impedance from all secondary conductors of the isolated power systems to ground. The LIM shall be capable of measuring all combinations of capacitive and resistive faults including balanced, unbalanced and hybrid faults. LIMs which internally switch between either line and ground will not be accepted. The LIM shall not contribute more than 15 □A to the tot  
hazard current of the system being monitored.
  5. All of the listed specifications shall be contained within one unit and be user selectable thus allowing the LIM to be interchanged from system to system.
  6. The LIM shall incorporate a momentary test switch. When pressed, it shall check and recalibrate the unit. Additionally, the test switch shall perform a complete test of all indicating lamps and meters on the face of the LIM and at any remote indicating stations.

7. The LIM shall use digital signal processing to determine the hazard current of the system being monitored. The algorithms used to determine the system hazard current shall be preprogrammed into the LIM's microprocessor. At least every 65 minutes, the unit shall recheck its calibration and recalibrate the system to original performance specifications. Additionally, by pressing the LIM's momentary test switch, an immediate check and recalibration of the LIM shall be performed.
8. If internal components are more than 30% out of original specifications because of aging or failure, the LIM shall notify the user by displaying a unique error code thus eliminating the need for periodic manual testing to determine the unit's integrity. LIMs which use analog signal processing technology and/or require manual testing or recalibration will not be accepted.
9. The LIM shall have an optical infrared LED type serial port on the face of the unit for transmitting pertinent LIM and isolated power system data directly to a personal computer (PC). The transmission of data shall not require any mechanical or direct electrical connection to the LIM. The protocol of data transmission shall be compatible with all Hewlett Packard palmtop personal computers including Hewlett Packard models HP95LX , HP100LX, and HP200LX.
10. The LIM shall provide both analog and digital indication of the isolated power system's hazard current. Digital indication shall be provided by a digital meter and analog indication shall be provided by an LED bar graph type meter calibrated from 0 (zero) to 160% of the alarm setting of the LIM. LIMs with only analog or only digital indicating will not be accepted.
11. The LIM shall have a green safe light and red hazard light on the front panel. The red hazard light shall remain illuminated for the duration when the isolated power system hazard current is above the selected alarm level of the LIM. An audible alarm shall be incorporated into the unit and shall activate in conjunction with the red hazard light. The audible alarm shall have high, low, and off settings. A silence button shall be provided on the face of the unit to silence the audible alarm during fault conditions. Upon silencing the audible alarm, a yellow indicating light shall illuminate to indicate the audible alarm has been silenced. The red

- hazard light and yellow silence light shall automatically reset when the fault condition is eliminated. During fault conditions, the red hazard light and all red segments to the LED bar graph shall blink at a constant rate. All lamps are to be long life LED type.
12. A set of normally open and normally closed contacts, rated 3 amperes at 120 VAC shall be provided on the LIM for use with external alarm systems. The LIM shall also provide a 12 VAC output signal rated at 10 VA to power remote indicator alarm units. This 12 VAC output signal shall not increase the hazard current of the system being monitored. Provisions for connection of the remote metering shall also be provided as part of the LIM. These connections shall have the ability to operate either an analog or digital type remote meter.
  13. The LIM shall incorporate a loss-of-ground feature which will activate the audible and visual alarms when connection is lost with the reference ground of the isolated power system being monitored. In addition to activating the alarm, the unit shall display an error code in the digital display of the LIM.
  14. All switches, meters, and indicating lamps shall be flush with the face of the LIM to provide a neat and clean appearance. The entire front face of the unit shall have a polymer overlay that protects the unit from the intrusion of housekeeping cleaning agents. LIMs with exposed fuses, meters, switches, or circuit breakers will not be accepted.
  15. The design of the LIM shall consist of two circuit boards interconnected by a ribbon connector. The two boards shall contain all of the unit's electrical components and be mounted in the rear housing of the LIM. A phenolic cover shall complete the assembly. The unit shall not contain any components, such as circuit breakers, meter, switches or indicating lamps, which are mounted on or attached to the front cover of the LIM. Access to the inside of the LIM shall be through the front of the unit thus eliminating the need to remove the unit from its mounting position to change any of the settings. Unique fasteners shall attach to the front cover of the unit to prevent unauthorized access to the interior of the LIM.
  16. The LIM shall be manufactured by Square D Company, UL component recognized under UL1022 Standard for Line Isolation Monitors.

E. Isolation transformers shall be in accordance with the following:

1. Single phase with kVA rating, and primary and secondary voltages as shown on the drawings. These ratings are for continuous duty without the use of cooling fans.
2. Self-cooled by natural convection, dry, isolated windings, conventional (stacked design) type, with a grounded electrostatic shield between the primary and secondary windings.
3. Cores shall be grain-oriented silicon steel.
4. Sound levels shall not exceed the following in accordance with NEMA standards:
  - a. 5 kVA transformers or fewer: 28 dB.
  - b. 7.5 kVA transformers: 32 dB.
5. Each nameplate shall include the wiring diagram, leakage current, and sound level.
6. Transformer shall be a shielded low-leakage isolating transformer, specifically manufactured for the use in hospital isolated systems.
7. The transformer shall be wound with an electrostatic shield between the primary and secondary windings. The shield shall be grounded to the enclosure. The electrostatic shield will be designed to prevent direct shorting of the primary winding to the secondary winding, and to reduce the coupling of harmonic distortions between the primary and secondary circuits.
8. The total leakage current to ground from the transformer shall not exceed the values shown in Table 29.2 of UL 1047.
9. Regulation to be certified not to exceed 2.5% at 0.8 power factor (PF) at 20°C above the full load continuous operating temperature in accordance with NEMA-ANSI standards.
10. The transformer is to be single-phase, 60 Hz with primary and secondary voltages as listed in the drawings and/or schedule.
11. Class H rated insulation shall be used in the manufacture of the transformer and the temperature rise will be limited to 55°C above ambient under full load conditions, when tested in accordance with NEMA-ANSI standards. Transformers must have a 220°C, UL recognized insulation system.
12. The core shall be of stacked design and securely clamped and bolted. The core and coils shall be internally isolated from the enclosure by means of a suitable vibration dampening system; varnish



- impregnated, and shall have a final wrap of insulating material to prevent exposure of bare conductors.
- F. Circuit breaker panels shall be in accordance with the following:
1. Dead-front, with protection for the breaker handles.
  2. Bus bars:
    - a. Shall be copper with silver-plated joints.
    - b. Panel to include ground bus.
  3. Only the handles of the breakers shall be accessible.
  4. Molded Case Circuit Breakers:
    - a. A rugged, integral housing of molded insulating material.
    - b. Silver alloy contacts.
    - c. Arc quenchers and phase barriers for each pole.
    - d. Quick-make, quick-break, operating mechanisms.
    - e. A trip element for each pole, a common trip bar for all poles, and molded insulating material handle.
    - f. Electrically and mechanically trip-free.
    - g. Indicating operating handle showing the ON, TRIPPED, and OFF positions.
  5. All circuit breakers must be 2-pole with a minimum interrupting capacity of 22,000 amperes. Panels shall have a minimum capacity of 16 secondary circuit breakers. Refer to the panelboard schedule for quantity and sizes of breakers. All circuit breakers shall be thermal-magnetic type. Thermal-only type circuit breakers will not be considered as equal.
- G. Power receptacles shall be hospital grade, NEMA 5-20R unless otherwise indicated.
- H. Remote line isolation monitor panel shall be in accordance with the following:
1. Monitor all of the isolated power systems as shown on the drawings.
  2. Include a set of red and green indicator lights and an audible alarm with a local silencing switch for each of the isolated power systems monitored by the panel. All of the items shall operate in the same manner as the corresponding items at the line isolation monitor for the same isolated power system.
  3. The remote indicator alarm shall be flush mounted and have a brushed stainless steel front trim. When the hazard current is within the predetermined limit for the circuits being monitored, a constant

- green light will remain illuminated. When the limit is exceeded, the green light will extinguish, a red indicator will illuminate, and an audible signal will sound.
4. A silencing switch for the audible signal shall be provided. When pressed, it will cause a yellow warning light to illuminate, indicating that the audible signal has been silenced. When the current flow to ground returns to an acceptable level, the unit will automatically reset. The wiring from the LIM to the indicator alarm shall not contribute any leakage current to the isolated system.
- I. Clearly identify individual devices on the faceplates of all equipment. Method of identification shall be permanent and shall not be effected by hospital-type cleaning materials.
- J. Use stainless steel for exposed faceplate surfaces of isolated power systems equipment in operating rooms.
- K. Dual display timepiece clock timer designed for surgical areas. Time clock and display elapsed timer to be controlled on face of each unit with the option of being controlled by remote control panel. Control panel that contains a set of controls for the timer and two push buttons to set the clock time display to be provided with 2-gang back box.
- L. Power Ground Modules:
1. Power ground Modules with power receptacles and twist-to-lock ground jacks as indicated on drawings. The unit shall be factory wired and only field power connections and ground connections are necessary. Front trim shall be stainless steel with #4 brushed finish.
  2. For the correct location and quantity of modules, refer to the drawings. The module backbox shall be fabricated of mild steel.
  3. The only exposed screws on the trim shall be the four screws holding the trim to the backbox. All receptacles shall be firmly attached with concealed fasteners that do not appear on the surface of the trim. The ground bus contained in these modules shall be of heavy copper bar, and it shall contain lugs suitable for connection of up to #1/0 wire. These are for connection and grounding of non-electrical conductive surfaces in the area, as well as connection of the ground terminal on all power receptacles within the module or in the area. All wiring in the module shall be color-coded in compliance with the NEC and NFPA No. 99. The module shall be

capable of containing 30A. Green ground jacks, hospital grade duplex receptacles or locking hospital type receptacles.

M. Enclosure:

1. The enclosure shall be 14-gauge steel which is degreased, phosphatized, primed, and finish baked enamel paint. The front trim shall be type 304 stainless steel with a #4 brushed finish. The enclosure will be flush mounted unless otherwise stated on the plans; units through 5 kVA shall have a maximum depth of eight inches; 7.5 kVA through 10 kVA shall have a maximum depth of twelve inches. The flush trim panels shall have a hinged door, with keyed lock, to give access to the circuit breakers and LIM, and to provide for testing.
2. The front panel shall not contain any type of grille or louver for ventilation. The panel and transformer shall be so designed that heat generated by the transformer under full load conditions shall not affect the normal operation of the circuit breakers and LIM. The maximum front panel temperature shall not exceed 30 □□ C rise under full load continuous operation. Certification of this temperature test shall be provided to the consulting engineer upon request. The entire section behind the hinged door shall be of a dead front design. All hinges will be concealed.

**PART 3 - EXECUTION**

**3.1 INSTALLATION**

- A. Install isolated power systems in accordance with the NEC, as shown on the drawings, and as recommended by the manufacturer.
- B. Branch circuits that are energized by the isolated power system shall conform to the following requirements:
  1. Shall not be grounded, but shall be protected by circuit breakers with one pole for each circuit conductor.
  2. Shall comply with applicable paragraphs in specification Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES.
  3. Branch circuits shall be as short as practical to minimize leakage currents.
  4. Identical receptacle poles shall be connected to the same isolation transformer terminal.

5. Install the branch circuit wiring in rigid steel conduit or electrical metallic tubing. Do not use wire lubricating compound on branch circuits connected to an isolated power system.
- C. Install a printed schedule of circuits in each IPU after approval by the Contracting officers Representative (COR) Schedules shall reflect final load descriptions connected to each circuit breaker.
- D. The panel(s) shall be factory wired and tested and include a shielded low leakage isolation transformer, primary and secondary circuit breakers, and LIM.

### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Once the isolated power systems and all branch circuits and control wiring have been completely installed, furnish factory-certified test equipment and perform the following tests in the presence of the COR. An authorized representative of the manufacturer shall perform acceptance checks and tests.
- B. Perform manufacturer's required field tests in accordance with the manufacturer's recommendations. In addition, include the following:
  1. Test to verify that wiring is properly connected and clear of ground faults, shorts, and open circuits.
  2. Test to verify that isolated power systems are operating properly.
  3. Tests:
    - a. Perform a calibration test on each of the micro-ammeters. The tests shall be accurate within 3%.
    - b. With all of the circuit breakers closed and without any equipment plugged into the receptacles, read and record the inherent total leakage current indicated by the micro-ammeter. The leakage currents shall be small enough to indicate that all of the equipment and circuits are satisfactory for proper operation of the equipment.
    - c. With an electrical test, demonstrate that identical poles of power receptacles for each of the isolated power systems are connected to the same terminal of the isolation transformer.
    - d. Demonstrate that either terminal of each of the isolation transformers, when shorted to ground in one of the power receptacles, will activate the line isolation monitor alarm without tripping the circuit breaker.

- e. Coordinate with the COR, and successively connect not fewer than eight pieces of typical medical equipment to the power receptacles for each of the isolated power systems. As each item is connected, read and record the total leakage current. Each of the readings should be equal to or larger than the preceding reading.
- 4. When any defects are detected, correct the defects and repeat the tests as requested by the COR at no additional cost to the Government.
- 5. The contractor shall include the cost of, and make all arrangements for, testing all underground isolated systems in the hospital by a qualified factory technician provided by the manufacturer of the isolation systems. The testing shall include a complete inspection of all connections and materials used. The contractor shall be prepared to demonstrate to the factory technician that proper polarity was observed, and installation practices were in accordance with the drawings and specifications for these systems.
- 6. The factory technician shall check and record system current leakages. The factory technician shall further simulate faults on the isolated system of a magnitude high enough to bring the total system leakage, which the LIM detects, above the calibrated point, thus verifying correct operation of the LIM. The faults simulated shall be combinations of resistive and capacitive faults.
- 7. The factory technician shall check the resistance between the ground point of each receptacle and the reference point, and it shall be less than 0.1 ohms. The voltage potential difference between any exposed conductive surfaces in the patient vicinity shall be checked, the difference to be no more than 40 millivolts. These tests are required by NFPA No. 99 for new construction areas.
- 8. The factory technician shall instruct the hospital maintenance staff in the use of the following:
  - a. The panel and LIM as a leakage measuring device
  - b. How instrument leakage areas can be measured and labeled
  - c. How to perform leakage tests
- 9. The technician shall also test the system impedance of the entire isolated power system to ensure compliance with the applicable

sections of NFPA No. 99, Chapter 3. The measured system impedance shall become part of the permanent logged records of each panel.

10. After all tests are complete, a letter shall be given to the hospital and the COR. The letter shall state that the system conforms to all codes, good installation practices, and the specifications.
11. Upon completion of all tests, the factory technician shall meet with hospital medical and maintenance staff to thoroughly explain the operation of the equipment installed, and the need and procedure for periodically testing and logging test results. The technician shall furnish log books to the maintenance department, enter the first readings of all panels in these log books, and clearly instruct the hospital maintenance staff how to enter future readings.
12. All questions from the hospital staff shall be answered completely and thoroughly at this time. The consulting engineer shall be notified of the dates and times of all tests so the consulting engineer may witness any of the tests or meetings conducted by the factory technician.

### **3.3 WIRING**

- A. Wiring within all panels shall meet all applicable NEC standards. Low leakage insulation shall be used on all secondary wiring. The total leakage for all panel types shall not exceed the values shown in table 29.1 of UL 1047.
- B. The panel manufacturer shall provide certified test data on each individual panel as to maximum leakage of each complete assembly.
- C. The contractor shall wire all external receptacles to the panels using copper stranded conductor having a cross-linked polyethylene insulation or equivalent with a dielectric constant of 3.5 or less. Under no circumstances shall wire pulling compound be used when pulling the wire for isolated circuits. All wiring shall be color-coded in accordance with NEC and appropriate NFPA standards.

### **3.4 FOLLOW-UP VERIFICATION**

- A. Upon completion of acceptance checks and tests, the Contractor shall show by demonstration in service that the isolated power systems are in good operating condition and properly performing the intended function.

### **3.5 INSTRUCTION**

- A. Furnish the services of a factory-trained technician for one 4-hour training period for instructing personnel in the maintenance and operation of the isolated power systems, on the dates requested by the COR.

---END---





**SECTION 26 22 00**  
**LOW-VOLTAGE TRANSFORMERS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, connection, and testing of low-voltage dry-type general-purpose transformers, indicated as transformers in this section.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS:  
Requirements that apply to all sections of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES:  
Low-voltage conductors.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS:  
Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduit.

**1.3 QUALITY ASSURANCE**

Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Include electrical ratings, dimensions, mounting details, materials, required clearances, terminations, weight, temperature rise, wiring and connection diagrams, plan, front, side, and rear elevations, accessories, and device nameplate data.
  2. Manuals:
    - a. Submit, simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals including technical data sheets and wiring diagrams.
      - 1) Schematic signal and control diagrams, with all terminals identified, matching terminal identification in the transformers.

- 2) Include information for testing, repair, troubleshooting, assembly, disassembly, and factory recommended/required periodic maintenance procedures and frequency.
- b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
3. Certifications: Two weeks prior to final inspection, submit the following.
  - a. Certification by the manufacturer that the transformers conform to the requirements of the drawings and specifications.
  - b. Certification by the Contractor that the transformers have been properly installed, adjusted, and tested.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. International Code Council (ICC):  
IBC-12.....International Building Code
- C. National Fire Protection Association (NFPA):  
70-11.....National Electrical Code (NEC)
- D. National Electrical Manufacturers Association (NEMA):  
TP1-02.....Guide for Determining Energy Efficiency for  
Distribution Transformers  
TR1-00.....Transformers, Regulators, and Reactors
- E. Underwriters Laboratories, Inc. (UL):  
UL 506-08.....Standard for Specialty Transformers  
UL 1561-11.....Dry-Type General Purpose and Power Transformers
- F. United States Department of Energy  
10 CFR Part 431.....Energy Efficiency Program for Certain  
Commercial and Industrial Equipment

### **PART 2 - PRODUCTS**

#### **2.1 TRANSFORMERS**

- A. Unless otherwise specified, transformers shall be in accordance with NEMA, NEC, UL and as shown on the drawings.
- B. Transformers shall have the following features:

1. Self-cooled by natural convection, isolating windings, indoor dry-type. Autotransformers will not be accepted, except as specifically allowed for buck-boost applications.
2. Rating and winding connections shall be as shown on the drawings.
3. Ratings shown on the drawings are for continuous duty without the use of cooling fans.
4. Copper windings.
5. Insulation systems:
  - a. Transformers 30 kVA and larger: UL rated 428 °F system with an average maximum rise by resistance of 302 °F in a maximum ambient of 104 °F.
  - b. Transformers below 30 kVA: Same as for 30 kVA and larger or UL rated 365 °F system with average maximum rise by resistance of 239 °F in maximum ambient of 104 °F.
6. Core and coil assemblies:
  - a. Rigidly braced to withstand the stresses caused by short-circuit currents and rough handling during shipment.
  - b. Cores shall be grain-oriented, non-aging, and silicon steel.
  - c. Coils shall be continuous windings without splices except for taps.
  - d. Coil loss and core loss shall be minimized for efficient operation.
  - e. Primary and secondary tap connections shall be brazed or pressure type.
  - f. Coil windings shall have end filters or tie-downs for maximum strength.
7. Certified sound levels, determined in accordance with NEMA, shall not exceed the following:

Transformer Rating	Sound Level Rating
0 - 9 KVA	40 dB
10 - 50 KVA	45 dB
51 - 150 KVA	50 dB
151 - 300 KVA	55 dB
301 - 500 KVA	60 dB

8. If not shown on drawings, nominal impedance shall be as permitted by NEMA.

9. Core assemblies shall be grounded to their enclosures with adequate flexible ground straps.
10. Enclosures:
  - a. Comprised of not less than code gauge steel.
  - b. Temperature rise at hottest spot shall conform to NEMA Standards, and shall not bake and peel off the enclosure paint after the transformer has been placed in service.
  - c. Ventilation openings shall prevent accidental access to live components.
  - d. The enclosure at the factory shall be thoroughly cleaned and painted with manufacturer's prime coat and standard finish.
11. Standard NEMA features and accessories, including ground pad, lifting provisions, and nameplate with the wiring diagram and sound level indicated.
12. Dimensions and configurations shall conform to the spaces designated for their installations.
13. Transformers shall meet the minimum energy efficiency values per NEMA TP1 as listed below:

kVA Rating	Output efficiency (%)
15	97
30	97.5
45	97.7
75	98
112.5	98.2

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Installation of transformers shall be in accordance with the NEC, as recommended by the equipment manufacturer and as shown on the drawings.
- B. Anchor transformers with rustproof bolts, nuts, and washers, in accordance with manufacturer's instructions, and as shown on drawings.
- C. Install transformers with manufacturer's recommended clearance from wall and adjacent equipment for air circulation. Minimum clearance shall be 150 mm (6 inches).
- D. Install transformers on vibration pads designed to suppress transformer noise and vibrations.

### **3.2 ACCEPTANCE CHECKS AND TESTS**

A. Perform tests in accordance with the manufacturer's recommendations.

In addition, include the following:

1. Visual Inspection and Tests:

- a. Compare equipment nameplate data with specifications and approved shop drawings.
- b. Inspect physical and mechanical condition.
- c. Inspect all field-installed bolted electrical connections, using the calibrated torque-wrench method to verify tightness of accessible bolted electrical connections.
- d. Perform specific inspections and mechanical tests as recommended by manufacturer.
- e. Verify correct equipment grounding.
- f. Verify proper secondary phase-to-phase and phase-to-neutral voltage after energization and prior to connection to loads.

### **3.3 FOLLOW-UP VERIFICATION**

A. Upon completion of acceptance checks, settings, and tests, the contractor shall demonstrate that the transformers are in good operating condition, and properly performing the intended function.

--- END ---



## **SECTION 26 24 16**

### **PANELBOARDS**

#### **PART 1 - GENERAL**

##### **1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, and connection of panelboards.

##### **1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS:  
Requirements that apply to all sections of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES:  
Low-voltage conductors.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS:  
Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits.

##### **1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

##### **1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
  - 1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Include electrical ratings, dimensions, mounting details, materials, required clearances, terminations, weight, circuit breakers, wiring and connection diagrams, accessories, and nameplate data.
  - 2. Manuals:
    - a. Submit, simultaneously with the shop drawings, complete maintenance and operating manuals including technical data sheets, wiring diagrams, and information for ordering circuit breakers and replacement parts.
      - 1) Include schematic diagrams, with all terminals identified, matching terminal identification in the panelboards.
      - 2) Include information for testing, repair, troubleshooting, assembly, and disassembly.

- b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
- 3. Certifications: Two weeks prior to final inspection, submit the following.
  - a. Certification by the manufacturer that the panelboards conform to the requirements of the drawings and specifications.
  - b. Certification by the Contractor that the panelboards have been properly installed, adjusted, and tested.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. International Code Council (ICC):
  - IBC-12.....International Building Code
- C. National Electrical Manufacturers Association (NEMA):
  - PB 1-11.....Panelboards
  - 250-08.....Enclosures for Electrical Equipment (1,000V Maximum)
- D. National Fire Protection Association (NFPA):
  - 70-11.....National Electrical Code (NEC)
  - 70E-12.....Standard for Electrical Safety in the Workplace
- E. Underwriters Laboratories, Inc. (UL):
  - 50-95.....Enclosures for Electrical Equipment
  - 67-09.....Panelboards
  - 489-09.....Molded Case Circuit Breakers and Circuit Breaker Enclosures

### **PART 2 - PRODUCTS**

#### **2.1 GENERAL REQUIREMENTS**

- A. Panelboards shall be in accordance with NEC, NEMA, UL, as specified, and as shown on the drawings.
- B. Panelboards shall have main breaker or main lugs, bus size, voltage, phases, number of circuit breaker mounting spaces, top or bottom feed, flush or surface mounting, branch circuit breakers, and accessories as shown on the drawings.
- C. Panelboards shall be completely factory-assembled with molded case circuit breakers and integral accessories as shown on the drawings or specified herein.



- D. Non-reduced size copper bus bars, rigidly supported on molded insulators, and fabricated for bolt-on type circuit breakers.
- E. Bus bar connections to the branch circuit breakers shall be the "distributed phase" or "phase sequence" type.
- F. Mechanical lugs furnished with panelboards shall be cast, stamped, or machined metal alloys listed for use with the conductors to which they will be connected.
- G. Neutral bus shall be 100% rated, mounted on insulated supports.
- H. Grounding bus bar shall be equipped with screws or lugs for the connection of equipment grounding conductors.
- I. Bus bars shall be braced for the available short-circuit current as shown on the drawings, but not be less than 10,000 A symmetrical for 120/208 V and 120/240 V panelboards, and 14,000 A symmetrical for 277/480 V panelboards.
- J. In two-section panelboards, the main bus in each section shall be full size. The first section shall be furnished with subfeed lugs on the line side of main lugs only, or through-feed lugs for main breaker type panelboards, and have field-installed cable connections to the second section as shown on the drawings. Panelboard sections with tapped bus or crossover bus are not acceptable.
- K. Series-rated panelboards are not permitted.

## **2.2 ENCLOSURES AND TRIMS**

### **A. Enclosures:**

- 1. Provide galvanized steel enclosures, with NEMA rating as shown on the drawings or as required for the environmental conditions in which installed.
- 2. Enclosures shall not have ventilating openings.
- 3. Enclosures may be of one-piece formed steel or of formed sheet steel with end and side panels welded, riveted, or bolted as required.
- 4. Provide manufacturer's standard option for prepunched knockouts on top and bottom endwalls.
- 5. Include removable inner dead front cover, independent of the panelboard cover.

### **B. Trims:**

- 1. Hinged "door-in-door" type.
- 2. Interior hinged door with hand-operated latch or latches, as required to provide access only to circuit breaker operating handles, not to energized parts.

3. Outer hinged door shall be securely mounted to the panelboard enclosure with factory bolts, screws, clips, or other fasteners, requiring a key or tool for entry. Hand-operated latches are not acceptable.
4. Inner and outer doors shall open left to right.
5. Trims shall be flush or surface type as shown on the drawings.

### **2.3 MOLDED CASE CIRCUIT BREAKERS**

- A. Circuit breakers shall be per UL, NEC, as shown on the drawings, and as specified.
- B. Circuit breakers shall be bolt-on type.
- C. Circuit breakers shall have minimum interrupting rating as required to withstand the available fault current, but not less than:
  1. 120/208 V Panelboard: 10,000 A symmetrical.
  2. 120/240 V Panelboard: 10,000 A symmetrical.
  3. 277/480 V Panelboard: 14,000 A symmetrical.
- D. Circuit breakers shall have automatic, trip free, non-adjustable, inverse time, and instantaneous magnetic trips for less than 400 A frame. Circuit breakers with 400 A frames and above shall have magnetic trip, adjustable from 5x to 10x.
- E. Circuit breaker features shall be as follows:
  1. A rugged, integral housing of molded insulating material.
  2. Silver alloy contacts.
  3. Arc quenchers and phase barriers for each pole.
  4. Quick-make, quick-break, operating mechanisms.
  5. A trip element for each pole, thermal magnetic type with long time delay and instantaneous characteristics, a common trip bar for all poles and a single operator.
  6. Electrically and mechanically trip free.
  7. An operating handle which indicates closed, tripped, and open positions.
  8. An overload on one pole of a multi-pole breaker shall automatically cause all the poles of the breaker to open.
  9. Ground fault current interrupting breakers, shunt trip breakers, lighting control breakers (including accessories to switch line currents), or other accessory devices or functions shall be provided where shown on the drawings.
  10. For circuit breakers being added to existing panelboards, coordinate the breaker type with existing panelboards. Modify the panel directory accordingly.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Installation shall be in accordance with the manufacturer's instructions, the NEC, as shown on the drawings, and as specified.
- B. Locate panelboards so that the present and future conduits can be conveniently connected.
- C. Install a printed schedule of circuits in each panelboard after approval by the Contracting Officers Representative (COR). Schedules shall reflect final load descriptions, room numbers, and room names connected to each circuit breaker. Schedules shall be printed on the panelboard directory cards and be installed in the appropriate panelboards
- D. Mount panelboards such that the maximum height of the top circuit breaker above the finished floor shall not exceed 1980 mm (78 inches).
- E. Provide blank cover for each unused circuit breaker mounting space.

#### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Perform in accordance with the manufacturer's recommendations. In addition, include the following:
  - 1. Visual Inspection and Tests:
    - a. Compare equipment nameplate data with specifications and approved shop drawings.
    - b. Inspect physical, electrical, and mechanical condition.
    - c. Verify appropriate anchorage and required area clearances.
    - d. Verify that circuit breaker sizes and types correspond to approved shop drawings.
    - e. To verify tightness of accessible bolted electrical connections, use the calibrated torque-wrench method or perform thermographic survey after energization.
    - f. Vacuum-clean enclosure interior. Clean enclosure exterior.

#### **3.3 FOLLOW-UP VERIFICATION**

- A. Upon completion of acceptance checks, settings, and tests, the Contractor shall demonstrate that the panelboards are in good operating condition and properly performing the intended function.

---END---



**SECTION 26 24 19**  
**MOTOR CONTROL CENTERS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

This section specifies the installation of new equipment into existing motor control centers.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Cables and wiring.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.

**1.3 QUALITY ASSURANCE**

Refer to Paragraph, QUALIFICATIONS, in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Catalog Data: Submit catalog data and information as required to demonstrate that materials conform to the specification requirements. Data shall include features, characteristics, ratings, and settings of all adjustable components.
- C. Shop Drawings:
  - 1. Clearly present sufficient information to determine compliance with drawings and specifications.
  - 2. Include electrical ratings, enclosure type, dimensions, weights, mounting details, front view, side view, equipment and device arrangement, running overcurrent protection, branch circuit overcurrent protection, wiring diagrams, materials, connection diagrams for device, and nameplate schedule.
- D. Manuals: Two weeks prior to the final inspection, submit four copies of the following to the COTR:
  - 1. Complete maintenance, operating and testing manuals, including wiring diagrams, technical data sheets, including load current, overload relay and settings of adjustable relays, and information for ordering replacement parts:

- a. Include complete "As Installed" diagrams that indicate all pieces of equipment and their interconnecting wiring.
  - b. Include complete diagrams of the internal wiring for each piece of equipment, including "As Installed" revisions of the diagrams.
  - c. The wiring diagrams shall identify the terminals to facilitate installation, maintenance, operation, and testing.
  - d. Instructions for testing and adjusting overcurrent protective devices.
- E. Certification: Two weeks prior to final inspection, submit four copies of the following to the COTR:
2. Certification by the manufacturer that the motor control centers conform to the requirements of the drawings and specifications.
  3. Certification by the contractor that the motor control centers have been properly installed, adjusted, and tested.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. National Electrical Manufacturers Association (NEMA):
- ICS 1-05.....Industrial Control and Systems: General Requirements
  - ICS 2-05.....Industrial Control and Systems: Controllers, Contactors, and Overhead Relays, Rated 600 volts
  - ICS 6-06.....Industrial Control and Systems: Enclosures
  - FU 1-02.....Low-Voltage Cartridge Fuses
  - 250-03.....Enclosures for Electrical Equipment (1000 Volts Maximum)
- C. National Fire Protection Association (NFPA):
- 70-05.....National Electrical Code (NEC)
- D. Underwriters Laboratories, Inc. (UL):
- 845-05.....Motor Control Centers

#### **PART 2 - PRODUCTS**

##### **2.1 FEEDER UNITS**

- A. Circuit breaker: shall conform to the applicable portions of Section 26 24 16, PANELBOARDS.

#### **PART 3 - EXECUTION**

##### **3.1 INSTALLATION**

- A. Installation shall be in accordance with NEC, written instructions of the manufacturer, and as shown on the drawings.

### **3.2 ACCEPTANCE CHECKS AND TESTS**

A. Perform in accordance with the manufacturer's recommendations. Include the following visual and mechanical inspections and electrical tests:

1. Visual and Mechanical Inspection

- a. Compare equipment nameplate data with specifications and approved shop drawings.
- b. Inspect physical, electrical, and mechanical condition.
- c. Verify required area clearances.
- d. Verify that fuse and circuit breaker sizes and types correspond to approved shop drawings.
- e. Use calibrated torque-wrench method to verify the tightness of accessible bolted electrical connections, or perform a thermographic survey after energization.
- f. Confirm correct operation and sequencing of electrical and mechanical interlock systems.
- g. Clean motor control center.
- h. Inspect insulators for evidence of physical damage or contaminated surfaces.
- i. Exercise all active components.
- j. Verify the correct operation of all sensing devices, alarms, and indicating devices.
- k. If applicable, inspect control power transformers.

2. Electrical Tests

- a. Perform insulation-resistance tests on each bus section.
- b. Perform overpotential tests.
- c. Perform insulation-resistance test on control wiring; do not perform this test on wiring connected to solid-state components.

### **3.3 FOLLOW-UP VERIFICATION**

A. Upon completion of acceptance checks, settings, and tests, the contractor shall demonstrate that the motor control center is in good operating condition and properly performing the intended function.

- - - E N D - - -





**SECTION 26 27 26**  
**WIRING DEVICES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, connection, and testing of wiring devices.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: General electrical requirements that are common to more than one section of Division 26.
- B. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduit and boxes.
- C. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Cables and wiring.
- D. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.
- E. Section 26 51 00, INTERIOR LIGHTING: Fluorescent ballasts and LED drivers for use with manual dimming controls.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
  - 1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Include electrical ratings, dimensions, mounting details, construction materials, grade, and termination information.
  - 2. Manuals:
    - a. Submit, simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals, including technical data sheets and information for ordering replacement parts.

- b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
- 3. Certifications: Two weeks prior to final inspection, submit the following.
  - a. Certification by the manufacturer that the wiring devices conform to the requirements of the drawings and specifications.
  - b. Certification by the Contractor that the wiring devices have been properly installed and adjusted.

### **1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by basic designation only.
- B. National Fire Protection Association (NFPA):
  - 70-11.....National Electrical Code (NEC)
  - 99-12.....Health Care Facilities
- C. National Electrical Manufacturers Association (NEMA):
  - WD 1-10.....General Color Requirements for Wiring Devices
  - WD 6-08 .....Wiring Devices - Dimensional Specifications
- D. Underwriter's Laboratories, Inc. (UL):
  - 5-11.....Surface Metal Raceways and Fittings
  - 20-10.....General-Use Snap Switches
  - 231-07.....Power Outlets
  - 467-07.....Grounding and Bonding Equipment
  - 498-07.....Attachment Plugs and Receptacles
  - 943-11.....Ground-Fault Circuit-Interrupters
  - 1449-07.....Surge Protective Devices
  - 1472-96.....Solid State Dimming Controls

## **PART 2 - PRODUCTS**

### **2.1 RECEPTACLES**

- A. General: All receptacles shall comply with NEMA, NFPA, UL, and as shown on the drawings.
  - 1. Mounting straps shall be plated steel, with break-off plaster ears and shall include a self-grounding feature. Terminal screws shall be brass, brass plated or a copper alloy metal.

2. Receptacles shall have provisions for back wiring with separate metal clamp type terminals (four minimum) and side wiring from four captively held binding screws.
- B. Duplex Receptacles: Hospital-grade, single phase, 20 ampere, 120 volts, 2-pole, 3-wire, NEMA 5-20R, with break-off feature for two-circuit operation.
  1. Bodies shall be ivory in color.
  2. Duplex Receptacles on Emergency Circuit:
    - a. In rooms without emergency powered general lighting, the emergency receptacles shall be of the self-illuminated type.
  3. Ground Fault Interrupter Duplex Receptacles: Shall be an integral unit, hospital-grade, suitable for mounting in a standard outlet box, with end-of-life indication and provisions to isolate the face due to improper wiring.
    - a. Ground fault interrupter shall be consist of a differential current transformer, solid state sensing circuitry and a circuit interrupter switch. Device shall have nominal sensitivity to ground leakage current of 4-6 milliamperes and shall function to interrupt the current supply for any value of ground leakage current above five milliamperes (+ or - 1 milliampere) on the load side of the device. Device shall have a minimum nominal tripping time of 0.025 second.
    - b. Ground Fault Interrupter Duplex Receptacles (not hospital-grade) shall be the same as ground fault interrupter hospital-grade receptacles except for the hospital-grade listing.
  4. Safety Type Duplex Receptacles:
    - a. Bodies shall be gray in color.
      - 1) Shall permit current to flow only while a standard plug is in the proper position in the receptacle.
      - 2) Screws exposed while the wall plates are in place shall be the tamperproof type.
  5. Duplex Receptacles (not hospital grade): Shall be the same as hospital grade duplex receptacles except for the hospital grade listing and as follows.
    - a. Bodies shall be brown nylon.
- C. Receptacles; 20, 30, and 50 ampere, 250 Volts: Shall be complete with appropriate cord grip plug.

- D. Weatherproof Receptacles: Shall consist of a duplex receptacle, mounted in box with a gasketed, weatherproof, cast metal cover plate and cap over each receptacle opening. The cap shall be permanently attached to the cover plate by a spring-hinged flap. The weatherproof integrity shall not be affected when heavy duty specification or hospital grade attachment plug caps are inserted. Cover plates on outlet boxes mounted flush in the wall shall be gasketed to the wall in a watertight manner.

## **2.2 TOGGLE SWITCHES**

- A. Toggle switches shall be totally enclosed tumbler type with nylon bodies. Handles shall be ivory in color unless otherwise specified or shown on the drawings.
1. Switches installed in hazardous areas shall be explosion-proof type in accordance with the NEC and as shown on the drawings.
  2. Shall be single unit toggle, butt contact, quiet AC type, heavy-duty general-purpose use with an integral self grounding mounting strap with break-off plaster ears and provisions for back wiring with separate metal wiring clamps and side wiring with captively held binding screws.
  3. Switches shall be rated 20 amperes at 120-277 Volts AC.

## **2.3 MANUAL DIMMING CONTROL**

- A. Electronic full-wave manual slide dimmer with on/off switch and audible frequency and EMI/RFI suppression filters.
- B. Manual dimming controls shall be fully compatible with fluorescent electronic dimming ballasts and approved by the ballast manufacturer or LED dimming driver and be approved by the driver manufacturer, shall operate over full specified dimming range, and shall not degrade the performance or rated life of the electronic dimming ballast and lamp.
- C. Provide single-pole or three-way, as shown on the drawings.
- D. Manual dimming control and faceplates shall be ivory in color unless otherwise specified.

## **2.4 WALL PLATES**

- A. Wall plates for switches and receptacles shall be type 302 stainless steel or smooth nylon. Oversize plates are not acceptable.
- B. Color shall be ivory unless otherwise specified.
- C. For receptacles or switches mounted adjacent to each other, wall plates shall be common for each group of receptacles or switches.

D. In areas requiring tamperproof wiring devices, wall plates shall be type 302 stainless steel, and shall have tamperproof screws and beveled edges.

E. Duplex Receptacles on Emergency Circuit: Wall plates shall be red nylon with the word "EMERGENCY" engraved in 6 mm (1/4 inch) white letters.

## **2.5 SURFACE MULTIPLE-OUTLET ASSEMBLIES**

A. Shall have the following features:

1. Enclosures:

a. Thickness of steel shall be not less than 1 mm (0.040 inch) for base and cover. Nominal dimensions shall be 40 mm x 70 mm (1-1/2 inches by 2-3/4 inches) with inside cross sectional area not less than 2250 square mm (3-1/2 square inches). The enclosures shall be thoroughly cleaned, phosphatized, and painted at the factory with primer and the manufacturer's standard baked enamel finish.

2. Receptacles shall be duplex, hospital grade. See paragraph 'RECEPTACLES' in this Section. Device cover plates shall be the manufacturer's standard corrosion resistant finish and shall not exceed the dimensions of the enclosure.

3. Unless otherwise shown on drawings, receptacle spacing shall be 600 mm (24 inches) on centers.

4. Conductors shall be as specified in Section 26 05 21, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLE.

5. Installation fittings shall be the manufacturer's standard bends, offsets, device brackets, inside couplings, wire clips, elbows, and other components as required for a complete system.

6. Bond the assemblies to the branch circuit conduit system.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

A. Installation shall be in accordance with the NEC and as shown as on the drawings.

B. Install wiring devices after wall construction and painting is complete.

C. The ground terminal of each wiring device shall be bonded to the outlet box with an approved green bonding jumper, and also connected to the branch circuit equipment grounding conductor.

D. Outlet boxes for toggle switches and manual dimming controls shall be mounted on the strike side of doors.

- E. Provide barriers in multigang outlet boxes to comply with the NEC.
- F. Coordinate the electrical work with the work of other trades to ensure that wiring device flush outlets are positioned with box openings aligned with the face of the surrounding finish material. Pay special attention to installations in cabinet work, and in connection with laboratory equipment.
- G. Exact field locations of floors, walls, partitions, doors, windows, and equipment may vary from locations shown on the drawings. Prior to locating sleeves, boxes and chases for roughing-in of conduit and equipment, the Contractor shall coordinate exact field location of the above items with other trades.
- H. Install wall switches 1.2 M (48 inches) above floor, with the toggle OFF position down.
- I. Install wall dimmers 1.2 M (48 inches) above floor.
- J. Install receptacles 450 mm (18 inches) above floor, and 152 mm (6 inches) above counter backsplash or workbenches. Install specific-use receptacles at heights shown on the drawings.
- K. Install vertically mounted receptacles with the ground pin up. Install horizontally mounted receptacles with the ground pin to the right.
- L. When required or recommended by the manufacturer, use a torque screwdriver. Tighten unused terminal screws.
- M. Label device plates with a permanent adhesive label listing panel and circuit feeding the wiring device.

### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Perform manufacturer's required field checks in accordance with the manufacturer's recommendations. In addition, include the following:
  - 1. Visual Inspection and Tests:
    - a. Inspect physical and electrical condition.
    - b. Vacuum-clean surface metal raceway interior. Clean metal raceway exterior.
    - c. Test wiring devices for damaged conductors, high circuit resistance, poor connections, inadequate fault current path, defective devices, or similar problems using a portable receptacle tester. Correct circuit conditions, remove malfunctioning units and replace with new, and retest as specified above.
    - d. Test GFCI receptacles.

2. Healthcare Occupancy Tests:

- a. Test hospital grade receptacles for retention force per NFPA 99.

---END---





**SECTION 26 29 11**

**MOTOR CONTROLLERS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, connection, and testing of motor controllers, including all low voltage motor controllers and manual motor controllers, indicated as motor controllers in this section, and low-voltage variable speed motor controllers.
- B. Motor controllers, whether furnished with the equipment specified in other sections or otherwise, shall meet this specification and all related specifications.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS:  
Requirements that apply to all sections of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES:  
Low-voltage conductors.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS:  
Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits.
- E. Section 26 24 19, MOTOR CONTROL CENTERS: For multiple motor control assemblies which include motor controllers.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
  - 1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Include electrical ratings, dimensions, weights, mounting details, materials, overcurrent protection devices, overload relays, sizes of enclosures, wiring diagrams, starting characteristics, interlocking, and accessories.

2. Manuals:

- a. Submit, simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals, including technical data sheets, wiring diagrams, and information for ordering replacement parts.
    - 1) Wiring diagrams shall have their terminals identified to facilitate installation, maintenance, and operation.
    - 2) Wiring diagrams shall indicate internal wiring for each item of equipment and interconnections between the items of equipment.
    - 3) Elementary schematic diagrams shall be provided for clarity of operation.
    - 4) Include the catalog numbers for the correct sizes of overload relays for the motor controllers.
  - b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
3. Certifications: Two weeks prior to final inspection, submit the following.
- a. Certification by the manufacturer that the motor controllers conform to the requirements of the drawings and specifications.
  - b. Certification by the Contractor that the motor controllers have been properly installed, adjusted, and tested.

**1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by basic designation only.
- B. Institute of Electrical and Electronic Engineers (IEEE):
  - 519-92.....Recommended Practices and Requirements for Harmonic Control in Electrical Power Systems
  - C37.90.1-02.....Standard Surge Withstand Capability (SWC) Tests for Relays and Relay Systems Associated with Electric Power Apparatus
- C. International Code Council (ICC):
  - IBC-12.....International Building Code
- D. National Electrical Manufacturers Association (NEMA):

- ICS 1-08.....Industrial Control and Systems: General Requirements
- ICS 1.1-09.....Safety Guidelines for the Application, Installation and Maintenance of Solid State Control
- ICS 2-05.....Industrial Control and Systems Controllers, Contactors, and Overload Relays Rated 600 Volts
- ICS 4-05.....Industrial Control and Systems: Terminal Blocks
- ICS 6-06.....Industrial Control and Systems: Enclosures
- ICS 7-06.....Industrial Control and Systems: Adjustable-Speed Drives
- ICS 7.1-06.....Safety Standards for Construction and Guide for Selection, Installation, and Operation of Adjustable-Speed Drive Systems
- MG 1 Part 31.....Inverter Fed Polyphase Motor Standards
- E. National Fire Protection Association (NFPA):
  - 70-11.....National Electrical Code (NEC)
- F. Underwriters Laboratories Inc. (UL):
  - 508A-07.....Industrial Control Panels
  - 508C-07.....Power Conversion Equipment
  - UL 1449-06.....Surge Protective Devices

## **PART 2 - PRODUCTS**

### **2.1 MOTOR CONTROLLERS**

- A. Motor controllers shall comply with IEEE, NEMA, NFPA, UL, and as shown on the drawings.
- B. Motor controllers shall be separately enclosed, unless part of another assembly. For installation in motor control centers, provide plug-in, draw-out type motor controllers up through NEMA size 4. NEMA size 5 and above require bolted connections.
- C. Motor controllers shall be combination type, with magnetic controller per Paragraph 2.3 below and with motor circuit protector disconnecting means, with external operating handle with lock-open padlocking positions and ON-OFF position indicator.
  - 1. Motor Circuit Protectors:
    - a. Magnetic trip only.
    - b. Bolt-on type with a minimum interrupting rating as indicated on the drawings.

- c. Equipped with automatic, adjustable magnetic trip. Magnetic trip shall be adjustable up to 1300% of the motor full load amperes.

D. Enclosures:

1. Enclosures shall be NEMA-type rated 1, 3R, or 12 as indicated on the drawings or as required per the installed environment.
2. Enclosure doors shall be interlocked to prevent opening unless the disconnecting means is open. A "defeater" mechanism shall allow for inspection by qualified personnel with the disconnect means closed. Provide padlocking provisions.
3. All metal surfaces shall be thoroughly cleaned, phosphatized, and factory primed prior to applying light gray baked enamel finish.

E. Motor control circuits:

1. Shall operate at not more than 120 Volts.
2. Shall be grounded, except where the equipment manufacturer recommends that the control circuits be isolated.
3. For each motor operating over 120 Volts, incorporate a separate, heavy duty, control transformer within each motor controller enclosure.
4. Incorporate primary and secondary overcurrent protection for the control power transformers.

F. Overload relays:

1. Thermal type. Devices shall be NEMA type.
2. One for each pole.
3. External overload relay reset pushbutton on the door of each motor controller enclosure.
4. Overload relays shall be matched to nameplate full-load current of actual protected motor and with appropriate adjustment for duty cycle.
5. Thermal overload relays shall be tamperproof, not affected by vibration, manual reset, sensitive to single-phasing, and shall have selectable trip classes of 10, 20 and 30.

G. Hand-Off-Automatic (H-O-A) switch is required unless specifically stated on drawings as not required for a particular controller. H-O-A switch shall be operable without opening enclosure door. H-O-A switch is not required for manual motor controllers.

H. Incorporate into each control circuit a 120 Volt, electronic time-delay relay (ON delay), minimum adjustable range from 0.3 to 10 minutes, with

transient protection. Time-delay relay is not required where H-O-A switch is not required.

- I. Unless noted otherwise, equip each motor controller with not less than two normally open (N.O.) and two normally closed (N.C.) auxiliary contacts.
- J. Provide green (RUN) and red (STOP) pilot lights.
- K. Motor controllers incorporated within equipment assemblies shall also be designed for the specific requirements of the assemblies.
- L. Additional requirements for specific motor controllers, as indicated in other specification sections, shall also apply.

## **2.2 MANUAL MOTOR CONTROLLERS**

- A. Shall be in accordance with applicable requirements of 2.1 above.
- B. Manual motor controllers shall have the following features:
  - 1. Controllers shall be general-purpose Class A, manually operated type with full voltage controller for induction motors, rated in horsepower.
  - 2. Units shall include thermal overload relays, on-off operator, red pilot light, normally open auxiliary contacts.
- C. Fractional horsepower manual motor controllers shall have the following features:
  - 1. Controllers shall be general-purpose Class A, manually operated type with full voltage controller for fractional horsepower induction motors.
  - 2. Units shall include thermal overload relays, red pilot light, and toggle operator.

## **2.3 MAGNETIC MOTOR CONTROLLERS**

- A. Shall be in accordance with applicable requirements of 2.1 above.
- B. Controllers shall be general-purpose, Class A magnetic controllers for induction motors rated in horsepower. Minimum NEMA size 0.
- C. Where combination motor controllers are used, combine controller with protective or disconnect device in a common enclosure.
- D. Provide phase loss protection for each controller, with contacts to de-energize the controller upon loss of any phase.
- E. Unless otherwise indicated, provide full voltage non-reversing across-the-line mechanisms for motors less than 75 HP, closed by coil action and opened by gravity. For motors 75 HP and larger, provide reduced-voltage or variable speed controllers as shown on the drawings. Equip the

controllers with 120 VAC coils and individual control transformer unless otherwise noted.

#### **2.4 LOW-VOLTAGE VARIABLE SPEED MOTOR CONTROLLERS (VSMC)**

- A. VSMC shall be in accordance with applicable portions of 2.1 above.
- B. VSMC shall be electronic, with adjustable frequency and voltage, three phase output, capable of driving standard NEMA B three-phase induction motors at full rated speed. The control technique shall be pulse width modulation (PWM), where the VSMC utilizes a full wave bridge design incorporating diode rectifier circuitry. Silicon controlled rectifiers or other control techniques are not acceptable.
- C. VSMC shall be suitable for variable torque loads, and shall be capable of providing sufficient torque to allow the motor to break away from rest upon first application of power.
- D. VSMC shall be capable of operating within voltage parameters of plus 10 to minus 15 percent of line voltage, and be suitably rated for the full load amps of the maximum watts (HP) within its class.
- E. Minimum efficiency shall be 95 percent at 100 percent speed and 85 percent at 50 percent speed.
- F. The displacement power factor of the VSMC shall not be less than 95 percent under any speed or load condition.
- G. VSMC current and voltage harmonic distortion shall not exceed the values allowed by IEEE 519.
- H. Operating and Design Conditions:
  - 1. Elevation: 700 feet Above Mean Sea Level (AMSL)
  - 2. Temperatures: Maximum +90°F Minimum -10°F
  - 3. Relative Humidity: 95%
  - 4. VSMC Location: Air conditioned space or mechanical penthouse
- I. VSMC shall have the following features:
  - 1. Isolated power for control circuits.
  - 2. Manually resettable overload protection for each phase.
  - 3. Adjustable current limiting circuitry to provide soft motor starting. Maximum starting current shall not exceed 200 percent of motor full load current.
  - 4. Independent acceleration and deceleration time adjustment, manually adjustable from 2 to 2000 seconds. Set timers to the equipment manufacturer's recommended time in the above range.
  - 5. Control input circuitry that will accept 4 to 20 mA current or 0-10 VDC voltage control signals from an external source.

6. Automatic frequency adjustment from 1 Hz to 300 Hz.
7. Circuitry to initiate an orderly shutdown when any of the conditions listed below occur. The VSMC shall not be damaged by any of these electrical disturbances and shall automatically restart when the conditions are corrected. The VSMC shall be able to restart into a rotating motor operating in either the forward or reverse direction and matching that frequency.
  - a. Incorrect phase sequence.
  - b. Single phasing.
  - c. Overvoltage in excess of 10 percent.
  - d. Undervoltage in excess of 15 percent.
  - e. Running overcurrent above 110 percent (VSMC shall not automatically reset for this condition.)
  - f. Instantaneous overcurrent above 150 percent (VSMC shall not automatically reset for this condition).
  - g. Short duration power outages of 12 cycles or less (i.e., distribution line switching, generator testing, and automatic transfer switch operations.)
8. Automatic Reset/Restart: Attempt three restarts after VSMC fault or on return of power after an interruption and before shutting down for manual reset or fault correction, with adjustable delay time between restart attempts.
9. Bidirectional Autospeed Search: Capable of starting VSMC into rotating loads spinning in either direction and returning motor to set speed in proper direction, without causing damage to VSMC, motor, or load.
- J. VSMC shall include an input circuit breaker which will disconnect all input power, interlocked with the door so that the door cannot be opened with the circuit breaker in the closed position.
- K. VSMC shall include a 5% line reactor and a RFI/EMI filter.
- L. Surge Suppression: Provide three-phase protection against damage from supply voltage surges in accordance with UL 1449.
- M. VSMC shall include front-accessible operator station, with sealed keypad and digital display, which allows complete programming, operating, monitoring, and diagnostic capabilities.
  1. Typical control functions shall include but not be limited to:
    - a. HAND-OFF-AUTOMATIC-RESET, with manual speed control in HAND mode.
    - b. NORMAL-BYPASS.

- c. NORMAL-TEST, which allows testing and adjusting of the VSMC while in bypass mode.
- 2. Typical monitoring functions shall include but not be limited to:
  - a. Output frequency (Hz).
  - b. Motor speed and status (run, stop, fault).
  - c. Output voltage and current.
- 3. Typical fault and alarm functions shall include but not be limited to:
  - a. Loss of input signal, under- and over-voltage, inverter overcurrent, motor overload, critical frequency rejection with selectable and adjustable deadbands, instantaneous line-to-line and line-to-ground overcurrent, loss-of-phase, reverse-phase, and short circuit.
  - b. System protection indicators indicating that the system has shutdown and will not automatically restart.
- N. VSMC shall include two N.O. and two N.C. dry contacts rated 120 Volts, 10 amperes, 60 Hz.
- O. Hardware, software, network interfaces, gateways, and programming to control and monitor the VSMC by control systems specified in other specification sections, including but not limited to Divisions 22 and 23.
- P. Network communications ports: As required for connectivity to control systems specified in other specification sections, including but not limited to Divisions 22 and 23.
- Q. Communications protocols: As required for communications with control systems specified in other specification sections, including but not limited to Divisions 22 and 23.
- R. Bypass controller: Provide contactor-style bypass, arranged to bypass the inverter.
  - 1. Inverter Output Contactor and Bypass Contactor: Load-break NEMA-rated contactor.
  - 2. Motor overload relays.
  - 3. HAND-OFF-AUTOMATIC bypass control.
- S. Bypass operation: Transfers motor between inverter output and bypass circuit, manually, automatically, or both. VSMC shall be capable of stable operation (starting, stopping, and running), and control by fire alarm and detection systems, with motor completely disconnected from



the inverter output. Transfer between inverter and bypass contactor and retransfer shall only be allowed with the motor at zero speed.

- T. Inverter Isolating Switch: Provide non-load-break switch arranged to isolate inverter and permit safe troubleshooting and testing of the inverter, both energized and de-energized, while motor is operating in bypass mode. Include padlockable, door-mounted handle mechanism.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Install motor controllers in accordance with the NEC, as shown on the drawings, and as recommended by the manufacturer.
- B. Install manual motor controllers in flush enclosures in finished areas.
- C. Set field-adjustable switches, auxiliary relays, time-delay relays, timers, and electronic overload relay pickup and trip ranges.
- D. Program variable speed motor controllers per the manufacturer's instructions and in coordination with other trades so that a complete and functional system is delivered.
- E. Adjust trip settings of circuit breakers and motor circuit protectors with adjustable instantaneous trip elements. Initially adjust at six times the motor nameplate full-load ampere ratings and attempt to start motors several times, allowing for motor cooldown between starts. If tripping occurs on motor inrush, adjust settings in increments until motors start without tripping. Do not exceed eight times the motor full-load amperes (or 11 times for NEMA Premium Efficiency motors if required). Where these maximum settings do not allow starting of a motor, notify Contracting Officers Representative (COR) before increasing settings.

#### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Perform manufacturer's required field tests in accordance with the manufacturer's recommendations. In addition, include the following:
  - 1. Visual Inspection and Tests:
    - a. Compare equipment nameplate data with specifications and approved shop drawings.
    - b. Inspect physical, electrical, and mechanical condition.
    - c. Verify appropriate anchorage, required area clearances, and correct alignment.
    - d. Verify that circuit breaker, motor circuit protector, and fuse sizes and types correspond to approved shop drawings.
    - e. Verify overload relay ratings are correct.

- f. Vacuum-clean enclosure interior. Clean enclosure exterior.
- g. Verify tightness of accessible bolted electrical connections by calibrated torque-wrench method in accordance with manufacturer's published data.
- h. Test all control and safety features of the motor controllers.
- i. For low-voltage variable speed motor controllers, final programming and connections shall be by a factory-trained technician. Set all programmable functions of the variable speed motor controllers to meet the requirements and conditions of use.

### **3.3 FOLLOW-UP VERIFICATION**

- A. Upon completion of acceptance checks, settings, and tests, the Contractor shall show by demonstration in service that the motor controllers are in good operating condition and properly performing the intended functions.

### **3.4 SPARE PARTS**

- A. Two weeks prior to the final inspection, provide one complete set of spare fuses for each motor controller.

### **3.5 INSTRUCTION**

- A. Furnish the services of a factory-trained technician for two 4-hour training periods for instructing personnel in the maintenance and operation of the motor controllers, on the dates requested by the COR.

---END---

**SECTION 26 29 21**  
**ENCLOSED SWITCHES AND CIRCUIT BREAKERS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, and connection of fused and unfused disconnect switches (indicated as switches in this section), and separately-enclosed circuit breakers for use in electrical systems rated 600 V and below.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS:  
Requirements that apply to all sections of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES:  
Low-voltage conductors.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS:  
Requirements for personnel safety and to provide a low impedance path for possible ground faults.
- D. Section 26 05 33, RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS: Conduits.
- E. Section 26 24 16, PANELBOARDS: Molded-case circuit breakers.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Submit the following data for approval:
      - 1) Electrical ratings, dimensions, mounting details, materials, required clearances, terminations, weight, fuses, circuit breakers, wiring and connection diagrams, accessories, and device nameplate data.
  2. Manuals:
    - a. Submit complete maintenance and operating manuals including technical data sheets, wiring diagrams, and information for ordering fuses, circuit breakers, and replacement parts.

- 1) Include schematic diagrams, with all terminals identified, matching terminal identification in the enclosed switches and circuit breakers.
- 2) Include information for testing, repair, troubleshooting, assembly, and disassembly.
- b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
3. Certifications: Two weeks prior to final inspection, submit the following.
  - a. Certification by the manufacturer that the enclosed switches and circuit breakers conform to the requirements of the drawings and specifications.
  - b. Certification by the Contractor that the enclosed switches and circuit breakers have been properly installed, adjusted, and tested.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. International Code Council (ICC):  
IBC-12.....International Building Code
- C. National Electrical Manufacturers Association (NEMA):  
FU 1-07.....Low Voltage Cartridge Fuses  
KS 1-06.....Enclosed and Miscellaneous Distribution  
Equipment Switches (600 Volts Maximum)
- D. National Fire Protection Association (NFPA):  
70-11.....National Electrical Code (NEC)
- E. Underwriters Laboratories, Inc. (UL):  
98-07.....Enclosed and Dead-Front Switches  
248-00.....Low Voltage Fuses  
489-09.....Molded Case Circuit Breakers and Circuit  
Breaker Enclosures

## **PART 2 - PRODUCTS**

### **2.1 FUSED SWITCHES RATED 600 AMPERES AND LESS**

- A. Switches shall be in accordance with NEMA, NEC, UL, as specified, and as shown on the drawings.
- B. Shall be NEMA classified Heavy Duty (HD) for 240 V switches, and NEMA classified Heavy Duty (HD) for 480 V switches.
- C. Shall be horsepower (HP) rated.
- D. Shall have the following features:
  - 1. Switch mechanism shall be the quick-make, quick-break type.
  - 2. Copper blades, visible in the open position.
  - 3. An arc chute for each pole.
  - 4. External operating handle shall indicate open and closed positions, and have lock-open padlocking provisions.
  - 5. Mechanical interlock shall permit opening of the door only when the switch is in the open position, defeatable to permit inspection.
  - 6. Fuse holders for the sizes and types of fuses specified.
  - 7. Solid neutral for each switch being installed in a circuit which includes a neutral conductor.
  - 8. Ground lugs for each ground conductor.
  - 9. Enclosures:
    - a. Shall be the NEMA types shown on the drawings.
    - b. Where the types of switch enclosures are not shown, they shall be the NEMA types most suitable for the ambient environmental conditions.
    - c. Shall be finished with manufacturer's standard gray baked enamel paint over pretreated steel.

### **2.2 UNFUSED SWITCHES RATED 600 AMPERES AND LESS**

- A. Shall be the same as fused switches, but without provisions for fuses.

### **2.3 MOTOR RATED TOGGLE SWITCHES**

- A. Type 1, general purpose for single-phase motors rated up to 1 horsepower.
- B. Quick-make, quick-break toggle switch with external reset button and thermal overload protection matched to nameplate full-load current of actual protected motor.

### **2.4 CARTRIDGE FUSES**

- A. Shall be in accordance with NEMA FU 1.
- B. Feeders: Class RK1, fast acting.

- C. Motor Branch Circuits: Class RK5, time delay.
- D. Other Branch Circuits: Class J, fast acting.
- E. Control Circuits: Class CC, fast acting.

## **2.5 SEPARATELY-ENCLOSED CIRCUIT BREAKERS**

- A. Provide circuit breakers in accordance with the applicable requirements in Section 26 24 16, PANELBOARDS.
- B. Enclosures shall be the NEMA types shown on the drawings. Where the types are not shown, they shall be the NEMA type most suitable for the ambient environmental conditions.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Installation shall be in accordance with the manufacturer's instructions, the NEC, as shown on the drawings, and as specified.
- B. Fused switches shall be furnished complete with fuses. Arrange fuses such that rating information is readable without removing the fuses.

### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Perform in accordance with the manufacturer's recommendations. In addition, include the following:
  - 1. Visual Inspection and Tests:
    - a. Compare equipment nameplate data with specifications and approved shop drawings.
    - b. Inspect physical, electrical, and mechanical condition.
    - c. Verify tightness of accessible bolted electrical connections by calibrated torque-wrench method.
    - d. Vacuum-clean enclosure interior. Clean enclosure exterior.

### **3.3 SPARE PARTS**

- A. Two weeks prior to the final inspection, furnish one complete set of spare fuses for each fused disconnect switch installed on the project. Deliver the spare fuses to the Contracting Officers Representative (COR).

---END---

**SECTION 26 36 23**  
**AUTOMATIC TRANSFER SWITCHES**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, connection, and testing of open-transition automatic transfer switches with bypass isolation, indicated as automatic transfer switches or ATS in this section.

**1.2 RELATED WORK**

- A. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS:  
Requirements that apply to all sections of Division 26.
- B. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES:  
Low-voltage conductors.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS:  
Requirements for personal safety and to provide a low impedance path for possible ground fault currents.
- D. Section 26 05 33, RACEWAYS AND BOXES FOR ELECTRICAL SYSTEMS: Conduits.
- E. Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS:  
General communications requirements that are common to more than one section in Division 27.
- F. Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATION SYSTEMS:  
Raceways for communications cabling.
- G. SECTION 27 15 00, COMMUNICATIONS HORIZONTAL CABLING: Communications media for interconnecting automatic transfer switches and remote control and annunciation components.

**1.3 QUALITY ASSURANCE**

- A. QUALITY ASSURANCE  
Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. A factory-authorized representative shall be capable of providing emergency maintenance and repairs at the project site within 8 hours maximum of notification.
- C. Automatic transfer switch, bypass/isolation switch, and annunciation control panels shall be products of the same manufacturer.

#### **1.4 FACTORY TESTS**

- A. Automatic transfer switches shall be thoroughly tested at the factory to ensure that there are no electrical or mechanical defects. Tests shall be conducted per UL standards. Factory tests shall be certified, and shall include the following tests:
  - 1. Visual inspection to verify that each ATS is as specified.
  - 2. Mechanical test to verify that ATS sections are free of mechanical hindrances.
  - 3. Insulation resistance test to ensure electrical integrity and continuity of entire system.
  - 4. Main switch contact resistance test.
  - 5. Electrical tests to verify complete system electrical operation.
- B. Furnish four (4) copies of certified manufacturer's factory test reports to the Contracting Officers Representative (COR) prior to shipment of the ATS to ensure that the ATS has been successfully tested as specified.

#### **1.5 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
  - 1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Include voltage rating, continuous current rating, number of phases, withstand and closing rating, dimensions, weights, mounting details, conduit entry provisions, front view, side view, equipment and device arrangement, elementary and interconnection wiring diagrams, factory relay settings, and accessories.
    - c. For automatic transfer switches that are networked together to a common means of annunciation and/or control, submit interconnection diagrams as well as site and building plans, showing connections for normal and emergency sources of power, load, control and annunciation components, and interconnecting communications paths. Equipment locations on the diagrams and plans shall match the site, building, and room designations on the drawings.



- d. Complete nameplate data, including manufacturer's name and catalog number.
  - e. A copy of the markings that are to appear on the automatic transfer switches when installed.
2. Manuals:
- a. Submit, simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals, including technical data sheets, wiring diagrams, and information for ordering replacement parts.
    - 1) Schematic signal and control diagrams, with all terminals identified, matching terminal identification in the automatic transfer switches.
    - 2) Include information for testing, repair, troubleshooting, assembly, disassembly, and factory recommended/required periodic maintenance procedures and frequency.
    - 3) Provide a replacement and spare parts list. Include a list of tools and instruments for testing and maintenance purposes.
  - b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
    - 1) Include complete "As Installed" diagrams that indicate all pieces of equipment and their interconnecting wiring.
    - 2) Include complete diagrams of the internal wiring for each piece of equipment, including "As Installed" revisions of the diagrams.
    - 3) The wiring diagrams shall identify the terminals to facilitate installation, maintenance, operation, and testing.
3. Certifications:
- a. When submitting the shop drawings, submit a certified test report from a recognized independent testing laboratory that a representative sample has passed UL 1008 prototype testing.
  - b. Two weeks prior to final inspection, submit the following.
    - 1) Certification by the manufacturer that the ATS conform to the requirements of the drawings and specifications.
    - 2) Certification by the Contractor that transfer switches have been properly installed, adjusted, and tested.

## 1.6 APPLICABLE PUBLICATIONS

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. Institute of Electrical and Electronic Engineers (IEEE):
- 446-95.....Emergency and Standby Power Systems for  
Industrial and Commercial ApplicationsC37.90.1-  
02 Surge Withstand Capability (SWC) Tests  
for Relays and Relay Systems Associated with  
Electric Power Apparatus
  - C62.41.1-02.....Guide on the Surges Environment in Low-Voltage  
(1000 V and Less) AC Power Circuits
  - C62.41.2-02.....Recommended Practice on Characterization of  
Surges in Low-Voltage (1000 V and Less) AC  
Power Circuits
- C. International Code Council (ICC):
- IBC-12.....International Building Code
- D. National Electrical Manufacturers Association (NEMA):
- 250-08.....Enclosures for Electrical Equipment (1000 Volts  
Maximum)
  - ICS 6-06.....Enclosures
  - ICS 4-10.....Application Guideline for Terminal Blocks
  - MG 1-11.....Motors and Generators
- E. National Fire Protection Association (NFPA):
- 70-11.....National Electrical Code (NEC)
  - 99-12.....Health Care Facilities
  - 110-10.....Emergency and Standby Power Systems
- F. Underwriters Laboratories, Inc. (UL):
- 50-95.....Enclosures for Electrical Equipment
  - 508-99.....Industrial Control Equipment
  - 891-07.....Switchboards
  - 1008-07.....Transfer Switch Equipment

## PART 2 - PRODUCTS

### 2.1 GENERAL REQUIREMENTS

- A. Automatic transfer switches shall comply with UL, NEMA, NEC, ANSI, IEEE, and NFPA, and have the following features:

1. Automatic transfer switches shall be open transition switches, 4-pole, draw-out construction, electrically operated, mechanically held open contact type, without integral overcurrent protection. Automatic transfer switches utilizing automatic or non-automatic molded case circuit breakers, insulated case circuit breakers, or power circuit breakers as switching mechanisms are not acceptable.
2. Automatic transfer switches shall be completely factory-assembled and wired such that only external circuit connections are required in the field.
3. Each automatic transfer switch shall be equipped with an integral bypass/isolation switch.
4. Ratings:
  - a. Phases, voltage, continuous current, poles, and withstand and closing ratings shall be as shown on the drawings.
  - b. Transfer switches are to be rated for continuous duty at specified continuous current rating on 60Hz systems.
  - c. Maximum automatic transfer switch rating: 800 A.
5. Markings:
  - a. Markings shall be in accordance with UL 1008.
6. Tests:
  - a. Automatic transfer switches shall be tested in accordance with UL 1008. The contacts of the transfer switch shall not weld during the performance of withstand and closing tests when used with the upstream overcurrent device and available fault current specified.
7. Surge Withstand Test:
  - a. Automatic transfer switches utilizing solid-state devices in sensing, relaying, operating, or communication equipment or circuits shall comply with IEEE C37.90.1.
8. Housing:
  - a. Enclose automatic transfer switches in wall- or floor-mounted steel cabinets, with metal gauge not less than No. 14, in accordance with UL 508, or in a switchboard assembly in accordance with UL 891, as shown on the drawings.
  - b. Enclosure shall be constructed so that personnel are protected from energized bypass-isolation components during automatic transfer switch maintenance.

- c. Automatic transfer switch components shall be removable without disconnecting external source or load power conductors.
  - d. Finish: Cabinets shall be given a phosphate treatment, painted with rust-inhibiting primer, and finish-painted with the manufacturer's standard enamel or lacquer finish.
  - e. Viewing Ports: Provide viewing ports so that contacts may be inspected without disassembly.
9. Operating Mechanism:
- a. Actuated by an electrical operator.
  - b. Electrically and mechanically interlocked so that the main contact cannot be closed simultaneously in either normal and emergency position.
  - c. Normal and emergency main contacts shall be mechanically locked in position by the operating linkage upon completion of transfer. Release of the locking mechanism shall be possible only by normal operating action.
  - d. Contact transfer time shall not exceed six cycles.
  - e. Operating mechanism components and mechanical interlocks shall be insulated or grounded.
10. Contacts:
- a. Main contacts: Silver alloy.
  - b. Neutral contacts: Silver alloy, with same current rating as phase contacts.
  - c. Current carrying capacity of arcing contacts shall not be used in the determination of the automatic transfer switch rating, and shall be separate from the main contacts.
  - d. Main and arcing contacts shall be visible for inspection with cabinet door open and barrier covers removed.
11. Manual Operator:
- a. Capable of operation by one person in either direction under no load.
12. Replaceable Parts:
- a. Include the main and arcing contacts individually or as units, as well as relays, and control devices.
  - b. Automatic transfer switch contacts and accessories shall be replaceable from the front without removing the switch from the cabinet and without removing main conductors.

13. Sensing Features:

- a. Undervoltage Sensing for Each Phase of Normal Source: Sense low phase-to-ground voltage on each phase. Pickup voltage shall be adjustable from 85 to 100% of nominal, and dropout voltage is adjustable from 75 to 98% of pickup value. Factory set for pickup at 90% and dropout at 85%.
- b. Adjustable Time Delay: For override of normal-source voltage sensing to delay transfer and engine start signals. Adjustable from zero to six seconds, and factory set for one second.
- c. Voltage/Frequency Lockout Relay: Prevent premature transfer to the engine-generator. Pickup voltage shall be adjustable from 85 to 100% of nominal. Factory set for pickup at 90%. Pickup frequency shall be adjustable from 90 to 100% of nominal. Factory set for pickup at 95%.
- d. Time Delay for Retransfer to Normal Source: Adjustable from 0 to 30 minutes, and factory set for 10 minutes to automatically defeat delay on loss of voltage or sustained undervoltage of emergency source, provided normal supply has been restored.
- e. Test Switch: Simulate normal-source failure.
- f. Switch-Position Indication: Indicate source to which load is connected.
- g. Source-Available Indication: Supervise sources via transfer switch normal- and emergency-source sensing circuits.
- h. Normal Power Indication: Indicate "Normal Source Available."
- i. Emergency Power Indication: Indicate "Emergency Source Available."
- j. Transfer Override Control: Overrides automatic retransfer control so that automatic transfer switch shall remain connected to emergency power source regardless of condition of normal source. Control panel shall indicate override status.
- k. Engine Starting Contacts: One isolated and normally closed and one isolated and normally open; rated 5 A at 30 V DC minimum.
- l. Engine Shutdown Contacts: Time delay adjustable from zero to 15 minutes, and factory set for 5 minutes. Contacts shall initiate shutdown at remote engine-generator controls after retransfer of load to normal source.

- m. Engine-Generator Exerciser: Programmable exerciser starts engine-generator(s) and transfers load to them from normal source for a preset time, then retransfers and shuts down engine-generator(s) after a preset cool-down period. Initiates exercise cycle at preset intervals adjustable from 7 to 30 days. Running periods are adjustable from 10 to 30 minutes. Factory settings shall be for 7-day exercise cycle, 20-minute running period, and 5-minute cool-down period.
- 14. Controls:
  - a. Controls shall provide indication of switch status and be equipped with alarm diagnostics.
  - b. Controls shall control operation of the automatic transfer switches.
- 15. Factory Wiring: Train and bundle factory wiring and label either by color-code or by numbered/lettered wire markers. Labels shall match those on the shop drawings.
- 16. Annunciation, Control, and Programming Interface Components:  
Devices for communicating with remote programming devices, annunciators, or control panels shall have open-protocol communication capability matched with remote device.

## **2.2 SEQUENCE OF OPERATION**

- A. The specified voltage decrease in one or more phases of the normal power source shall initiate the transfer sequence. The automatic transfer switch shall start the engine-generator(s) after a specified time delay to permit override of momentary dips in the normal power source.
- B. The automatic transfer switch shall transfer the load from normal to emergency source when the frequency and voltage of the engine-generator(s) have attained the specified percent of rated value.
- C. Engine Start: A voltage decrease, at any automatic transfer switch, in one or more phases of the normal power source to less than the specified value of normal shall start the engine-generator(s) after a specified time delay.
- D. Transfer to Emergency System Loads: Automatic transfer switches for Emergency System loads shall transfer their loads from normal to emergency source when frequency and voltage of the engine-generator(s)

have attained the specified percent of rated value. Only those switches with deficient normal source voltage shall transfer.

- E. Transfer to Equipment Branch Loads: Automatic transfer switches for Equipment Branch loads shall transfer their loads to the engine-generator on a time-delayed, staggered basis, after the Emergency System switches have transferred. Only those switches with deficient normal source voltage shall transfer.
- F. Retransfer to Normal (All Loads): Automatic transfer switches shall retransfer the load from emergency to normal source upon restoration of normal supply in all phases to the specified percent or more of normal voltage, and after a specified time delay. Should the emergency source fail during this time, the automatic transfer switches shall immediately transfer to the normal source whenever it becomes available. After restoring to normal source, engine-generator(s) shall continue to run unloaded for a specified interval before shut-down.

### **2.3 BYPASS-ISOLATION SWITCH**

- A. Provide each automatic transfer switch with two-way bypass-isolation manual type switch. The bypass-isolation switch shall permit load bypass to either normal or emergency power source and complete isolation of the automatic transfer switch, independent of transfer switch position. Bypass and isolation shall be possible under all conditions including when the automatic transfer switch is removed from service.
- B. Operation: The bypass-isolation switch shall have provisions for operation by one person through the movement of a maximum of two handles at a common dead front panel in no more than 15 seconds. Provide a lock, which must energize to unlock the bypass switch, to prevent bypassing to a dead source. Provide means to prevent simultaneous connection between normal and emergency sources.
  - 1. Bypass to normal (or emergency): Operation of bypass handle shall allow direct connection of the load to the normal (or emergency) source, without load interruption or by using a break-before-make design, or provide separate load interrupter contacts to momentarily interrupt the load.
    - a. Ensure continuity of auxiliary circuits necessary for proper operation of the system.
    - b. A red indicating lamp shall light when the automatic transfer switch is bypassed.

- c. Bypassing source to source: If the power source is lost while in the bypass position, bypass to the alternate source shall be achievable without re-energization of the automatic transfer switch service and load connections.
- 2. Isolation: Operation of the isolating handle shall isolate all live power conductors to the automatic transfer switch without interruption of the load.
  - a. Interlocking: Provide interlocking as part of the bypass-isolation switch to eliminate personnel-controlled sequence of operation, and to prevent operation to the isolation position until the bypass function has been completed.
  - b. Padlocking: Include provisions to padlock the isolating handle in the isolated position.
  - c. Visual verification: The isolation blades shall be visible in the isolated position.
- 3. Testing: It shall be possible to test (normal electrical operation) the automatic transfer switch and engine-generator(s) with the isolation contacts closed and the load bypassed without interruption of power to the load.
- C. Ratings: The electrical capabilities and ratings of the bypass-isolation switch shall be compatible with those of the associated automatic transfer switch, including any required additional withstand tests.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Install automatic transfer switches in accordance with the NEC, as shown on the drawings, and as recommended by the manufacturer.
- B. Anchor automatic transfer switches with rustproof bolts, nuts, and washers not less than 12 mm (1/2 inch) diameter, in accordance with manufacturer's instructions, and as shown on drawings.
- C. Mount automatic transfer switches on concrete slab. Unless otherwise indicated, the slab shall be at least 100 mm (4 inches) thick. The top of the concrete slab shall be approximately 100 mm (4 inches) above finished floor. Edges above floor shall have 12.5 mm (1/2 inch) chamfer. The slab shall be of adequate size to project at least 100 mm (8 inches) beyond the equipment. Provide conduit turnups and cable entrance space required by the equipment to be mounted. Seal voids



around conduit openings in slab with water- and oil-resistant caulking or sealant. Cut off and bush conduits 75 mm (3 inches) above slab surface. Concrete work shall be as specified in Section 03 30 00, CAST-IN-PLACE CONCRETE.

### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. An authorized representative of the automatic transfer switch manufacturer shall technically supervise and participate during all of the field adjustments and tests. Major adjustments and field tests shall be witnessed by the COR. The manufacturer's representative shall certify in writing that the equipment has been installed, adjusted and tested in accordance with the manufacturer's recommendations.
- B. Perform manufacturer's required field tests in accordance with the manufacturer's recommendations. In addition, include the following:
  - 1. Visual Inspection and Tests:
    - a. Compare equipment nameplate data with specifications and approved shop drawings.
    - b. Inspect physical, electrical, and mechanical condition.
    - c. Confirm correct application of manufacturer's recommended lubricants.
    - d. Verify appropriate anchorage, required area clearances, and correct alignment.
    - e. Verify tightness of accessible bolted electrical connections by calibrated torque-wrench method, or performing thermographic survey after energization.
    - f. Verify grounding connections.
    - g. Verify ratings of sensors.
    - h. Vacuum-clean enclosure interior. Clean enclosure exterior.
    - i. Exercise all active components.
    - j. Verify that manual transfer warning signs are properly placed.
    - k. Verify the correct operation of all sensing devices, alarms, and indicating devices.
  - 2. Electrical tests:
    - a. Perform insulation-resistance tests.
    - b. After energizing circuits, demonstrate the interlocking sequence and operational function for each automatic transfer switch at least three times.

- 1) Test bypass-isolation unit functional modes and related automatic transfer switch operations.
  - 2) Power failure of normal source shall be simulated by opening upstream protective device. This test shall be performed a minimum of five times.
  - 3) Power failure of emergency source with normal source available shall be simulated by opening upstream protective device for emergency source. This test shall be performed a minimum of five times.
  - 4) Low phase-to-ground voltage shall be simulated for each phase of normal source.
  - 5) Operation and settings shall be verified for specified automatic transfer switch operational feature, such as override time delay, transfer time delay, return time delay, engine shutdown time delay, exerciser, auxiliary contacts, and supplemental features.
  - 6) Verify pickup and dropout voltages by data readout or inspection of control settings.
  - 7) Verify that bypass and isolation functions perform correctly, including the physical removal of the automatic transfer switch while in bypass mode.
- c. When any defects are detected, correct the defects and repeat the tests as requested by the COR at no additional cost to the Government.

### **3.3 FIELD SETTINGS VERIFICATION**

- A. The automatic transfer switch settings shall be verified in the field by an authorized representative of the manufacturer.

### **3.4 FOLLOW-UP VERIFICATION**

- A. Upon completion of acceptance checks and tests, Contractor shall show by demonstration in service that the automatic transfer switches are in good operating condition and properly performing the intended function.

### **3.5 INSTRUCTION**

- A. Furnish the services of a factory-trained technician for one 4-hour training period for instructing personnel in the maintenance and operation of the automatic transfer switches, on the dates requested by the COR.

---END---

**SECTION 26 41 00**  
**FACILITY LIGHTNING PROTECTION**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the installation of lightning protection equipment as an extension of the existing lightning protection system.

**1.2 RELATED WORK**

- A. Section 07 60 00, FLASHING AND SHEET METAL: Penetrations through roof.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS:  
Requirements that apply to all sections of Division 26.
- C. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS:  
Requirements for personnel safety and to provide a low impedance path to ground for possible ground faults.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS, (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
  - 1. Shop Drawings:
    - a. Submit sufficient information to demonstrate compliance with drawings and specifications.
    - b. Show locations of air terminals, connections to required metal surfaces, down conductors, and grounding means.
    - c. Show the mounting hardware and materials used to attach air terminals and conductors to the structure.
  - 2. Certifications: Two weeks prior to final inspection, submit the following.
    - a. Certification by the manufacturer that the lightning protection system conforms to the requirements of the drawings and specifications.
    - b. Certification by the Contractor that the lightning protection system has been properly installed and inspected.
    - c. Certification that the lightning protection system has been inspected by a UL representative and has been approved by UL without variation.

## **1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. National Fire Protection Association (NFPA):
- 70-11.....National Electrical Code (NEC)
  - 780-11.....Standard for the Installation of Lightning Protection Systems
- C. Underwriters Laboratories, Inc. (UL):
- 96-05.....Lightning Protection Components
  - 96A-07.....Installation Requirements for Lightning Protection Systems
  - 467-07.....Standard for Grounding and Bonding Equipment

## **PART 2 - PRODUCTS**

### **2.1 GENERAL REQUIREMENTS**

- A. Lightning protection components shall conform to NFPA 780 and UL 96, for use on Class I structures. Aluminum materials are not allowed.
1. Class I conductors: Copper.
  2. Class I air terminals: Solid copper, 460 mm (18 inches) long, not less than 9.5 mm (3/8 inch) diameter, with sharp nickel-plated points.
  3. Ground plates: Solid copper, not less than 20 gauge.
  4. Bonding plates: Bronze, 50 square cm (8 square inches).
  5. Through roof connectors: Solid copper riser bar, length and type as required to accommodate roof structure and flashing requirements.
  6. Down conductor guards: Stiff copper or brass.
  7. Anchors and fasteners: Bronze bolt and clamp type shall be used for all applications except for membrane roof. Adhesive type are allowed only for attachment to membrane roof materials, using adhesive that is compatible with the membrane material.
  8. Connectors: Bronze clamp-type connectors shall be used for roof conductor splices, and the connection of the roof conductor to air terminals and bonding plates. Crimp-type connectors are not allowed.
  9. Exothermic welds: Exothermic welds shall be used for splicing the roof conductor to the down conductors, splices of the down

conductors, and for connection of the down conductors to ground rods, ground plates, and the ground ring.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Installation shall be coordinated with the roofing manufacturer and installer.
- B. Install the conductors as inconspicuously as practical.
- C. Install the down conductors within the concealed cavity of exterior walls where practical. Run the down conductors to the exterior at elevations below the finished grade.
- D. Make connections of dissimilar metal with bimetallic type fittings to prevent electrolytic action.
- E. Bond down conductors to metal main water piping where applicable.
- F. Bond down conductors to building structural steel.
- G. Connect roof conductors to all metallic projections and equipment above the roof as indicated on the drawings.
- H. Connect exterior metal surfaces, located within 900 mm (3 feet) of the conductors, to the conductors to prevent flashovers.
- I. Maintain horizontal or downward coursing of main conductor and insure that all bends have at least an 200 mm (8 inches) radius and do not exceed 90 degrees.
- J. Conductors shall be rigidly fastened every 900 mm (3 feet) along the roof and down to the building to ground.
- K. Air terminals shall be secured against overturning either by attachment to the object to be protected or by means of a substantial tripod or other braces permanently and rigidly attached to the building or structure.
- L. Install air terminal bases, cable holders and other roof-system supporting means without piercing membrane or metal roofs.
- M. Use through-roof connectors for penetration of the roof system. Flashing shall be provided by roofing contractor in accordance with Section 07 60 00, FLASHING AND SHEET METAL.
- N. Where the drawings show the new lightning protection system connected to an existing lightning protection system with or without a UL master label, the new portion of the lightning protection system requires UL inspection and a Letter of Findings.

### **3.2 ACCEPTANCE CHECKS AND TESTS**

- A. Test the ground resistance to earth by standard methods, and conform to the ground resistance requirements specified in Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
- B. A UL representative shall inspect the lightning protection system. Obtain and install a UL numbered master label for each of the lightning protection systems at the location directed by the UL representative and the COR.

---END---

**SECTION 26 51 00**  
**INTERIOR LIGHTING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION:**

- A. This section specifies the furnishing, installation, and connection of the interior lighting systems. The terms "lighting fixture," "fixture," and "luminaire" are used interchangeably.

**1.2 RELATED WORK**

- A. Section 10 25 13, PATIENT BED SERVICE WALLS: Power and controls for wall-mounted fluorescent bedlight fixtures.
- B. Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS: Requirements that apply to all sections of Division 26.
- C. Section 26 05 19, LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES: Low-voltage conductors.
- D. Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS: Requirements for personnel safety and to provide a low impedance path to ground for possible ground fault currents.
- E. Section 26 27 26, WIRING DEVICES: Wiring devices used for control of the lighting systems.
- F. Section 27 52 23, NURSE CALL AND CODE BLUE SYSTEMS: For pillow speaker control of the wall-mounted fluorescent bedlight fixtures.

**1.3 QUALITY ASSURANCE**

- A. Refer to Paragraph, QUALIFICATIONS (PRODUCTS AND SERVICES), in Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.

**1.4 SUBMITTALS**

- A. Submit six copies of the following in accordance with Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
  - 1. Shop Drawings:
    - a. Submit the following information for each type of lighting fixture designated on the LIGHTING FIXTURE SCHEDULE, arranged in order of lighting fixture designation.
    - b. Material and construction details, include information on housing and optics system.
    - c. Physical dimensions and description.
    - d. Wiring schematic and connection diagram.
    - e. Installation details.
    - f. Energy efficiency data.

- g. Photometric data based on laboratory tests complying with IES Lighting Measurements testing and calculation guides.
  - h. Lamp data including lumen output (initial and mean), color rendition index (CRI), rated life (hours), and color temperature (degrees Kelvin).
  - i. Ballast data including ballast type, starting method, ambient temperature, ballast factor, sound rating, system watts, and total harmonic distortion (THD).
  - j. For LED lighting fixtures, submit US DOE LED Lighting Facts label, and IES L70 rated life.
2. Manuals:
- a. Submit, simultaneously with the shop drawings, complete maintenance and operating manuals, including technical data sheets, wiring diagrams, and information for ordering replacement parts.
  - b. If changes have been made to the maintenance and operating manuals originally submitted, submit updated maintenance and operating manuals two weeks prior to the final inspection.
3. Certifications: Two weeks prior to final inspection, submit the following.
- a. Certification by the Contractor that the interior lighting systems have been properly installed and tested.

#### **1.5 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American National Standards Institute (ANSI):
  - C78.1-91.....Fluorescent Lamps - Rapid-Start Types -  
Dimensional and Electrical Characteristics
  - C78.376-01.....Chromaticity of Fluorescent Lamps
- C. American Society for Testing and Materials (ASTM):
  - C635-07.....Manufacture, Performance, and Testing of Metal  
Suspension Systems for Acoustical Tile and Lay-  
in Panel Ceilings
- D. Environmental Protection Agency (EPA):
  - 40 CFR 261.....Identification and Listing of Hazardous Waste
- E. Federal Communications Commission (FCC):



CFR Title 47, Part 15...Radio Frequency Devices

CFR Title 47, Part 18...Industrial, Scientific, and Medical Equipment

F. Illuminating Engineering Society (IES):

LM-79-08.....Electrical and Photometric Measurements of  
Solid-State Lighting Products

LM-80-08.....Measuring Lumen Maintenance of LED Light  
Sources

LM-82-12.....Characterization of LED Light Engines and LED  
Lamps for Electrical and Photometric Properties  
as a Function of Temperature

G. Institute of Electrical and Electronic Engineers (IEEE):

C62.41-91.....Surge Voltages in Low Voltage AC Power Circuits

H. International Code Council (ICC):

IBC-12.....International Building Code

I. National Fire Protection Association (NFPA):

70-11.....National Electrical Code (NEC)

101-12.....Life Safety Code

J. National Electrical Manufacturer's Association (NEMA):

C82.1-04.....Lamp Ballasts - Line Frequency Fluorescent Lamp  
Ballasts

C82.2-02.....Method of Measurement of Fluorescent Lamp  
Ballasts

C82.4-02.....Lamp Ballasts - Ballasts for High-Intensity  
Discharge and Low-Pressure Sodium (LPS) Lamps  
(Multiple-Supply Type)

C82.11-11.....Lamp Ballasts - High Frequency Fluorescent Lamp  
Ballasts

LL-9-09.....Dimming of T8 Fluorescent Lighting Systems

SSL-1-10.....Electronic Drivers for LED Devices, Arrays, or  
Systems

K. Underwriters Laboratories, Inc. (UL):

496-08.....Lampholders

542-0599.....Fluorescent Lamp Starters

844-12.....Luminaires for Use in Hazardous (Classified)  
Locations

924-12.....Emergency Lighting and Power Equipment

935-01.....Fluorescent-Lamp Ballasts

1029-94.....High-Intensity-Discharge Lamp Ballasts

1029A-06.....Ignitors and Related Auxiliaries for HID Lamp  
Ballasts  
1598-08.....Luminaires  
1574-04.....Track Lighting Systems  
2108-04.....Low-Voltage Lighting Systems  
8750-09.....Light Emitting Diode (LED) Light Sources for  
Use in Lighting Products

## **PART 2 - PRODUCTS**

### **2.1 LIGHTING FIXTURES**

- A. Shall be in accordance with NFPA, UL, as shown on drawings, and as specified.
- B. Sheet Metal:
  - 1. Shall be formed to prevent warping and sagging. Housing, trim and lens frame shall be true, straight (unless intentionally curved), and parallel to each other as designed.
  - 2. Wireways and fittings shall be free of burrs and sharp edges, and shall accommodate internal and branch circuit wiring without damage to the wiring.
  - 3. When installed, any exposed fixture housing surface, trim frame, door frame, and lens frame shall be free of light leaks.
  - 4. Hinged door frames shall operate smoothly without binding. Latches shall function easily by finger action without the use of tools.
- C. Ballasts and lamps shall be serviceable while the fixture is in its normally installed position. Ballasts shall not be mounted to removable reflectors or wireway covers unless so specified.
- D. Lamp Sockets:
  - 1. Fluorescent: Single slot entry type, requiring a one-quarter turn of the lamp after insertion. Lampholder contacts shall be the biting edge type.
  - 2. Compact Fluorescent: 4-pin.
- E. Mechanical Safety: Lighting fixture closures (lens doors, trim frame, hinged housings, etc.) shall be retained in a secure manner by captive screws, chains, aircraft cable, captive hinges, or fasteners such that they cannot be accidentally dislodged during normal operation or routine maintenance.
- F. Metal Finishes:
  - 1. The manufacturer shall apply standard finish (unless otherwise specified) over a corrosion-resistant primer, after cleaning to free

- the metal surfaces of rust, grease, dirt and other deposits. Edges of pre-finished sheet metal exposed during forming, stamping or shearing processes shall be finished in a similar corrosion resistant manner to match the adjacent surface(s). Fixture finish shall be free of stains or evidence of rusting, blistering, or flaking, and shall be applied after fabrication.
2. Interior light reflecting finishes shall be white with not less than 85 percent reflectances, except where otherwise shown on the drawing.
  3. Exterior finishes shall be as shown on the drawings.
- G. Lighting fixtures shall have a specific means for grounding metallic wireways and housings to an equipment grounding conductor.
- H. Light Transmitting Components for Fluorescent Fixtures:
1. Shall be 100 percent virgin acrylic.
  2. Flat lens panels shall have not less than 3 mm (1/8 inch) of average thickness.
  3. Unless otherwise specified, lenses, reflectors, diffusers, and louvers shall be retained firmly in a metal frame by clips or clamping ring in such a manner as to allow expansion and contraction without distortion or cracking.
- I. Lighting fixtures in hazardous areas shall be suitable for installation in Class and Division areas as defined in NFPA 70.
- J. Compact fluorescent fixtures shall be manufactured specifically for compact fluorescent lamps with ballast integral to the fixture. Assemblies designed to retrofit incandescent fixtures are prohibited except when specifically indicated for renovation of existing fixtures.

## **2.2 BALLASTS**

- A. Linear Fluorescent Lamp Ballasts: Multi-voltage (120 - 277V), electronic programmed-start type, designed for type and quantity of lamps indicated. Ballasts shall be designed for full light output unless dimmer or bi-level control is indicated. Ballasts shall include the following features:
1. Lamp end-of-life detection and shutdown circuit (T5 lamps only).
  2. Automatic lamp starting after lamp replacement.
  3. Sound Rating: Class A.
  4. Total Harmonic Distortion (THD): 10 percent or less.
  5. Transient Voltage Protection: IEEE C62.41.1 and IEEE C62.41.2, Category A or better.

6. Operating Frequency: 20 kHz or higher.
  7. Lamp Current Crest Factor: 1.7 or less.
  8. Ballast Factor: 0.87 or higher unless otherwise indicated.
  9. Power Factor: 0.98 or higher.
  10. EMR/RFI Interference: Comply with CFR Title 47 Part 18 for limitations on electromagnetic and radio-frequency interference for non-consumer equipment.
  11. To facilitate multi-level lamp switching, lamps within fixture shall be wired with the outermost lamp at both sides of the fixture on the same ballast, the next inward pair on another ballast and so on to the innermost lamp (or pair of lamps). Within a given room, each switch shall uniformly control the same corresponding lamp (or lamp pairs) in all fixture units that are being controlled.
  12. Where three-lamp fixtures are indicated, unless switching arrangements dictate otherwise, utilize a common two-lamp ballast to operate the center lamp in pairs of adjacent units that are mounted in a continuous row. The ballast fixture and slave-lamp fixture shall be factory wired with leads or plug devices to facilitate this circuiting. Individually mounted fixtures and the odd fixture in a row shall utilize a single-lamp ballast for operation of the center lamp.
  13. Dimming ballasts shall be as per above, except dimmable from 100% to 5% of rated lamp lumens. Dimming ballasts shall be fully compatible with the dimming controls.
- B. Low-Frequency Linear T8 Fluorescent Lamp Ballasts (allowed for Surgery Suites, Critical Care Units, and Animal Labs): Multi-voltage (120 - 277V), hybrid electronic-electromagnetic rapid-start type, designed for type and quantity of lamps indicated. Ballast shall be designed for full light output. Ballasts shall include the following features:
1. Automatic lamp starting after lamp replacement.
  2. Sound Rating: Class A.
  3. Total Harmonic Distortion (THD): 20 percent or less.
  4. Transient Voltage Protection: IEEE C62.41.1 and IEEE C62.41.2, Category A or better.
  5. Operating Frequency: 60 Hz.
  6. Lamp Current Crest Factor: 1.7 or less.
  7. Ballast Factor: 0.85 or higher unless otherwise indicated.
  8. Power Factor: 0.90 or higher.

9. Interference: Comply with CFR Title 47 Part 18 for limitations on electromagnetic and radio-frequency interference for non-consumer equipment.
  10. To facilitate multi-level lamp switching, lamps within fixture shall be wired with the outermost lamp at both sides of the fixture on the same ballast, the next inward pair on another ballast and so on to the innermost lamp (or pair of lamps). Within a given room, each switch shall uniformly control the same corresponding lamp (or lamp pairs) in all fixture units that are being controlled.
  11. Where three-lamp fixtures are indicated, unless switching arrangements dictate otherwise, utilize a common two-lamp ballast to operate the center lamp in pairs of adjacent units that are mounted in a continuous row. The ballast fixture and slave-lamp fixture shall be factory wired with leads or plug devices to facilitate this circuiting. Individually mounted fixtures and the odd fixture in a row shall utilize a single-lamp ballast for operation of the center lamp.
- C. Compact Fluorescent Lamp Ballasts: Multi-voltage (120 - 277V), electronic programmed rapid-start type, designed for type and quantity of lamps indicated. Ballast shall be designed for full light output unless dimmer or bi-level control is indicated. Ballasts shall include the following features:
1. Lamp end-of-life detection and shutdown circuit.
  2. Automatic lamp starting after lamp replacement.
  3. Sound Rating: Class A.
  4. Total Harmonic Distortion (THD): 10 percent or less.
  5. Transient Voltage Protection: IEEE C62.41.1 and IEEE C62.41.2, Category A or better.
  6. Operating Frequency: 20 kHz or higher.
  7. Lamp Current Crest Factor: 1.7 or less.
  8. Ballast Factor: 0.95 or higher unless otherwise indicated.
  9. Power Factor: 0.98 or higher.
  10. Interference: Comply with CFR Title 47 Part 18 for limitations on electromagnetic and radio-frequency interference for non-consumer equipment.
  11. Dimming ballasts shall be as per above, except dimmable from 100% to 5% of rated lamp lumens. Dimming ballasts shall be fully compatible with the dimming controls.

### **2.3 LAMPS**

#### **A. Linear and U-shaped T5 and T8 Fluorescent Lamps:**

1. Except as indicated below, lamps shall be low-mercury energy saving type, have a color temperature between 3500° and 4100°K, a Color Rendering Index (CRI) equal or greater than 80, average rated life equal to or greater than 24,000 hours when used with an instant start ballast and 30,000 hours when used with a programmed or rapid start ballast (based on 3 hour starts), and be suitable for use with dimming ballasts, unless otherwise indicated.
  - a. Over the beds in Intensive Care, Coronary Care, Recovery, Life Support, and Observation and Treatment areas; Electromyographic, Autopsy (Necropsy), Surgery, and certain dental rooms (Examination, Oral Hygiene, Oral Surgery, Recovery, Labs, Treatment, and X-Ray) use color corrected lamps having a CRI of 85 or above and a correlated color temperature between 5000 and 6000°K, as shown on the drawings.
  - b. Other areas as shown on the drawings.
2. Lamps shall comply with EPA Toxicity Characteristic Leachate Procedure (TCLP) requirements.

#### **B. Compact Fluorescent Lamps:**

1. T4, CRI 80 (minimum), color temperature 3500°K, average rated life equal to or greater than 12,000 hours (based on 3 hour starts), and suitable for use with dimming ballasts, unless otherwise indicated.
2. Lamps shall comply with EPA Toxicity Characteristic Leachate Procedure (TCLP) requirements.

### **2.4 CEILING MOUNTED FLUORESCENT BEDLIGHT FIXTURES**

- A. Fixtures shall be lensed.
- B. Provide low-voltage relays and switching integration with patient bed controls.

### **2.5 X-RAY FILM ILLUMINATORS**

- A. Shall be the high-intensity type, flush-mounted in the walls. Multiples of the basic unit may be combined in a common housing.
- B. Shall have the following features:
  1. Fluorescent lighting, designed to provide uniform diffusion of the light.
  2. Box dimensions approximately 530 mm (21 inches) high, 355 mm (14 inches) wide and 100 mm (4 inches) deep.

3. Housing shall be steel. Trim shall be stainless steel and shall extend approximately 40 mm (1-1/2 inches) from the edges of the housing.
4. Viewing panel shall thermoplastic, not less than 3 mm (1/8 inch) thick.
5. Viewing panel shall have adequate dimensions so the films will not overlap the frame and will be positioned with respect to the light source for even illumination without shadows.
6. An ON-OFF double-pole, double-throw switch.

## **2.6 LED EXIT LIGHT FIXTURES**

- A. Exit light fixtures shall meet applicable requirements of NFPA and UL.
- B. Housing and door shall be die-cast aluminum.
- C. For general purpose exit light fixtures, door frame shall be hinged, with latch. For vandal-resistant exit light fixtures, door frame shall be secured with tamper-resistant screws.
- D. Finish shall be satin or fine-grain brushed aluminum.
- E. There shall be no radioactive material used in the fixtures.
- F. Fixtures:
  1. Inscription panels shall be cast or stamped aluminum a minimum of 2.25 mm (0.090 inch) thick, stenciled with 150 mm (6 inch) high letters, baked with red color stable plastic or fiberglass. Lamps shall be luminous Light Emitting Diodes (LED) mounted in center of letters on red color stable plastic or fiberglass.
  2. Double-Faced Fixtures: Provide double-faced fixtures where required or as shown on drawings.
  3. Directional Arrows: Provide directional arrows as part of the inscription panel where required or as shown on drawings. Directional arrows shall be the "chevron-type" of similar size and width as the letters and meet the requirements of NFPA 101.
- G. Voltage: Multi-voltage (120 - 277V).

## **2.7 LED LIGHT FIXTURES**

- A. General:
  1. LED light fixtures shall be in accordance with IES, NFPA, UL, as shown on the drawings, and as specified.
  2. LED light fixtures shall be Reduction of Hazardous Substances (RoHS)-compliant.
  3. LED drivers shall include the following features unless otherwise indicated:

- a. Minimum efficiency: 85% at full load.
  - b. Minimum Operating Ambient Temperature: -20° C. (-4° F.)
  - c. Input Voltage: 120 - 277V (±10%) at 60 Hz.
  - d. Integral short circuit, open circuit, and overload protection.
  - e. Power Factor:  $\geq 0.95$ .
  - f. Total Harmonic Distortion:  $\leq 20\%$ .
  - g. Comply with FCC 47 CFR Part 15.
4. LED modules shall include the following features unless otherwise indicated:
- a. Comply with IES LM-79 and LM-80 requirements.
  - b. Minimum CRI 80 and color temperature 3000° K unless otherwise specified in LIGHTING FIXTURE SCHEDULE.
  - c. Minimum Rated Life: 50,000 hours per IES L70.
  - d. Light output lumens as indicated in the LIGHTING FIXTURE SCHEDULE.
- B. LED Downlights:
1. Housing, LED driver, and LED module shall be products of the same manufacturer.
- C. LED Troffers:
1. LED drivers, modules, and reflector shall be accessible, serviceable, and replaceable from below the ceiling.
  2. Housing, LED driver, and LED module shall be products of the same manufacturer.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION**

- A. Installation shall be in accordance with the NEC, manufacturer's instructions, and as shown on the drawings or specified.
- B. Align, mount, and level the lighting fixtures uniformly.
- C. Wall-mounted fixtures shall be attached to the studs in walls, or to 20 gauge metal backing plate that is attached to the studs in the walls. Lighting fixtures shall not be attached directly to gypsum board.
- D. Lighting Fixture Supports:
  1. Shall provide support for all of the fixtures. Supports may be anchored to channels of the ceiling construction, to the structural slab or to structural members within a partition, or above a suspended ceiling.
  2. Shall maintain the fixture positions after cleaning and relamping.



3. Shall support the lighting fixtures without causing the ceiling or partition to deflect.
4. Hardware for recessed fluorescent fixtures:
  - a. Where the suspended ceiling system is supported at the four corners of the fixture opening, hardware devices shall clamp the fixture to the ceiling system structural members, or plaster frame at not less than four points in such a manner as to resist spreading of the support members and safely lock the fixture into the ceiling system.
  - b. Where the suspended ceiling system is not supported at the four corners of the fixture opening, hardware devices shall independently support the fixture from the building structure at four points.
5. Hardware for surface mounting fluorescent fixtures to suspended ceilings:
  - a. In addition to being secured to any required outlet box, fixtures shall be bolted to a grid ceiling system at four points spaced near the corners of each fixture. The bolts shall be not less than 6 mm (1/4 inch) secured to channel members attached to and spanning the tops of the ceiling structural grid members. Non-turning studs may be attached to the ceiling structural grid members or spanning channels by special clips designed for the purpose, provided they lock into place and require simple tools for removal.
  - b. In addition to being secured to any required outlet box, fixtures shall be bolted to ceiling structural members at four points spaced near the corners of each fixture. Pre-positioned 6 mm (1/4 inch) studs or threaded plaster inserts secured to ceiling structural members shall be used to bolt the fixtures to the ceiling. In lieu of the above, 6 mm (1/4 inch) toggle bolts may be used on new or existing ceiling provided the plaster and lath can safely support the fixtures without sagging or cracking.
- E. Furnish and install the new lamps as specified for all lighting fixtures installed under this project, and for all existing lighting fixtures reused under this project.
- F. The electrical and ceiling trades shall coordinate to ascertain that approved lighting fixtures are furnished in the proper sizes and

installed with the proper devices (hangers, clips, trim frames, flanges, etc.), to match the ceiling system being installed.

- G. Bond lighting fixtures to the grounding system as specified in Section 26 05 26, GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS.
- H. At completion of project, replace all defective components of the lighting fixtures at no cost to the Government.
- I. Dispose of lamps per requirements of Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT.

### **3.2 ACCEPTANCE CHECKS AND TESTS**

A. Perform the following:

1. Visual Inspection:

- a. Verify proper operation by operating the lighting controls.
- b. Visually inspect for damage to fixtures, lenses, reflectors, diffusers, and louvers. Clean fixtures, lenses, reflectors, diffusers, and louvers that have accumulated dust, dirt, or fingerprints during construction.

2. Electrical tests:

- a. Exercise dimming components of the lighting fixtures over full range of dimming capability by operating the control devices(s) in the presence of the Contracting Officers Representative (COR) Observe for visually detectable flicker over full dimming range, and replace defective components at no cost to the Government.
- b. Burn-in all lamps that require specific aging period to operate properly, prior to occupancy by Government. Burn-in period to be 40 hours minimum, unless specifically recommended otherwise by the lamp manufacturer. Burn-in dimmed fluorescent and compact fluorescent lamps for at least 100 hours at full voltage, unless specifically recommended otherwise by the lamp manufacturer.  
Replace any lamps and ballasts which fail during burn-in.

### **3.3 FOLLOW-UP VERIFICATION**

- A. Upon completion of acceptance checks and tests, the Contractor shall show by demonstration in service that the lighting systems are in good operating condition and properly performing the intended function.

---END---

**SECTION 27 05 11**  
**REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This Section, Requirements for Communications Installations, applies to all sections of Division 27.
- B. Furnish and install communications cabling, systems, equipment, and accessories in accordance with the specifications and drawings. Capacities and ratings of transformers, cable, and other items and arrangements for the specified items are shown on drawings.

**1.2 MINIMUM REQUIREMENTS**

- A. References to industry and trade association standards and codes are minimum installation requirement standards.
- B. Drawings and other specification sections shall govern in those instances where requirements are greater than those specified in the above standards.

**1.3 QUALIFICATIONS (PRODUCTS AND SERVICES)**

- A. Manufacturers Qualifications: The manufacturer shall regularly and presently produce, as one of the manufacturer's principal products, the equipment and material specified for this project, and shall have manufactured the item for at least three years.
- B. Product Qualification:
  - 1. Manufacturer's product shall have been in satisfactory operation, on three installations of similar size and type as this project, for approximately three years.
  - 2. The Government reserves the right to require the Contractor to submit a list of installations where the products have been in operation before approval.
- C. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within eight hours of receipt of notification that service is needed. Submit name and address of service organizations.

**1.4 MANUFACTURED PRODUCTS**

- A. Materials and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items, for which replacement parts shall be available.

- B. When more than one unit of the same class of equipment is required, such units shall be the product of a single manufacturer.
- C. Equipment Assemblies and Components:
  - 1. Components of an assembled unit need not be products of the same manufacturer.
  - 2. Manufacturers of equipment assemblies, which include components made by others, shall assume complete responsibility for the final assembled unit.
  - 3. Components shall be compatible with each other and with the total assembly for the intended service.
  - 4. Constituent parts which are similar shall be the product of a single manufacturer.
- D. Factory wiring shall be identified on the equipment being furnished and on all wiring diagrams.
- E. When Factory Testing Is Specified:
  - 1. The Government shall have the option of witnessing factory tests. The contractor shall notify the VA through the Contracting Officers Representative (COR) a minimum of 15 working days prior to the manufacturers making the factory tests.
  - 2. Four copies of certified test reports containing all test data shall be furnished to the COR prior to final inspection and not more than 90 days after completion of the tests.
  - 3. When equipment fails to meet factory test and re-inspection is required, the contractor shall be liable for all additional expenses, including expenses of the Government.

#### **1.5 EQUIPMENT REQUIREMENTS**

Where variations from the contract requirements are requested in accordance with the GENERAL CONDITIONS and Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, the connecting work and related components shall include, but not be limited to additions or changes to branch circuits, circuit protective devices, conduits, wire, feeders, controls, panels and installation methods.

#### **1.6 EQUIPMENT PROTECTION**

- A. Equipment and materials shall be protected during shipment and storage against physical damage, dirt, moisture, cold and rain:
  - 1. During installation, enclosures, equipment, controls, controllers, circuit protective devices, and other like items, shall be protected against entry of foreign matter; and be vacuum cleaned both inside and outside before testing and operating and repainting if required.

2. Damaged equipment shall be, as determined by the COR, placed in first class operating condition or be returned to the source of supply for repair or replacement.
3. Painted surfaces shall be protected with factory installed removable heavy kraft paper, sheet vinyl or equal.
4. Damaged paint on equipment and materials shall be refinished with the same quality of paint and workmanship as used by the manufacturer so repaired areas are not obvious.

#### **1.7 WORK PERFORMANCE**

- A. Job site safety and worker safety is the responsibility of the contractor.
- B. For work on existing stations, arrange, phase and perform work to assure communications service for other buildings at all times. Refer to Article OPERATIONS AND STORAGE AREAS under Section 01 00 00, GENERAL REQUIREMENTS.
- C. New work shall be installed and connected to existing work neatly and carefully. Disturbed or damaged work shall be replaced or repaired to its prior conditions, as required by Section 01 00 00, GENERAL REQUIREMENTS.
- D. Coordinate location of equipment and pathways with other trades to minimize interferences. See the GENERAL CONDITIONS.

#### **1.8 EQUIPMENT INSTALLATION AND REQUIREMENTS**

- A. Equipment location shall be as close as practical to locations shown on the drawings.
- B. Inaccessible Equipment:
  1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, the equipment shall be removed and reinstalled as directed at no additional cost to the Government.
  2. "Conveniently accessible" is defined as being capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as, but not limited to, motors, pumps, belt guards, transformers, piping, ductwork, conduit and raceways.

#### **1.9 EQUIPMENT IDENTIFICATION**

- A. Install an identification sign which clearly indicates information required for use and maintenance of equipment.
- B. Nameplates shall be laminated black phenolic resin with a white core with engraved lettering, a minimum of 6 mm (1/4 inch) high. Secure nameplates with screws. Nameplates that are furnished by manufacturer as

a standard catalog item, or where other method of identification is herein specified, are exceptions.

#### **1.10 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. The Government's approval shall be obtained for all equipment and material before delivery to the job site. Delivery, storage, or installation of equipment or material which has not had prior approval will not be permitted at the job site.
- C. All submittals shall include adequate descriptive literature, catalog cuts, shop drawings, and other data necessary for the Government to ascertain that the proposed equipment and materials comply with specification requirements. Catalog cuts submitted for approval shall be legible and clearly identify equipment being submitted.
- D. Submittals for individual systems and equipment assemblies which consist of more than one item or component shall be made for the system or assembly as a whole. Partial submittals will not be considered for approval.
  - 1. Mark the submittals, "SUBMITTED UNDER SECTION \_\_\_\_\_".
  - 2. Submittals shall be marked to show specification reference including the section and paragraph numbers.
  - 3. Submit each section separately.
- E. The submittals shall include the following:
  - 1. Information that confirms compliance with contract requirements. Include the manufacturer's name, model or catalog numbers, catalog information, technical data sheets, shop drawings, pictures, nameplate data and test reports as required.
  - 2. Elementary and interconnection wiring diagrams for communication and signal systems, control system and equipment assemblies. All terminal points and wiring shall be identified on wiring diagrams.
  - 3. Parts list which shall include those replacement parts recommended by the equipment manufacturer, quantity of parts, current price and availability of each part.
- F. Manuals: Submit in accordance with Section 01 00 00, GENERAL REQUIREMENTS.
  - 1. Maintenance and Operation Manuals: Submit as required for systems and equipment specified in the technical sections. Furnish four copies, bound in hardback binders, (manufacturer's standard binders) or an approved equivalent. Furnish one complete manual as specified in the technical section but in no case later than prior to performance of

- systems or equipment test, and furnish the remaining manuals prior to contract completion.
2. Inscribe the following identification on the cover: the words "MAINTENANCE AND OPERATION MANUAL," the name and location of the system, equipment, building, name of Contractor, and contract number. Include in the manual the names, addresses, and telephone numbers of each subcontractor installing the system or equipment and the local representatives for the system or equipment.
  3. Provide a "Table of Contents" and assemble the manual to conform to the table of contents, with tab sheets placed before instructions covering the subject. The instructions shall be legible and easily read, with large sheets of drawings folded in.
  4. The manuals shall include:
    - a. Internal and interconnecting wiring and control diagrams with data to explain detailed operation and control of the equipment.
    - b. A control sequence describing start-up, operation, and shutdown.
    - c. Description of the function of each principal item of equipment.
    - d. Installation and maintenance instructions.
    - e. Safety precautions.
    - f. Diagrams and illustrations.
    - g. Testing methods.
    - h. Performance data.
    - i. Pictorial "exploded" parts list with part numbers. Emphasis shall be placed on the use of special tools and instruments. The list shall indicate sources of supply, recommended spare parts, and name of servicing organization.
    - j. Appendix; list qualified permanent servicing organizations for support of the equipment, including addresses and certified qualifications.
- G. Approvals will be based on complete submission of manuals together with shop drawings.
- H. After approval and prior to installation, furnish the COR with one sample of each of the following:
1. A 300 mm (12 inch) length of each type and size of wire and cable along with the tag from the coils of reels from which the samples were taken.
  2. Each type of conduit and pathway coupling, bushing and termination fitting.
  3. Raceway and pathway hangers, clamps and supports.
  4. Duct sealing compound.

I. In addition to the requirement of SUBMITTALS, the VA reserves the right to request the manufacturer to arrange for a VA representative to see typical active systems in operation, when there has been no prior experience with the manufacturer or the type of equipment being submitted.

**1.11 SINGULAR NUMBER**

Where any device or part of equipment is referred to in these specifications in the singular number (e.g., "the switch"), this reference shall be deemed to apply to as many such devices as are required to complete the installation as shown on the drawings.

**1.12 TRAINING**

- A. Training shall be provided in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.
- B. Training shall be provided for the particular equipment or system as required in each associated specification.
- C. A training schedule shall be developed and submitted by the contractor and approved by the COR at least 30 days prior to the planned training.

- - - E N D - - -



**SECTION 27 05 26**  
**GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies general grounding and bonding requirements of telecommunication installations for equipment operations.
- B. "Grounding electrode system" refers to all electrodes required by NEC, as well as including made, supplementary, telecommunications system grounding electrodes.
- C. The terms "connect" and "bond" are used interchangeably in this specification and have the same meaning.

**1.2 RELATED WORK**

- A. Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS: General electrical requirements and items that are common to more than one section of Division 27.
- B. Section 27 10 00, STRUCTURED CABLING: Low Voltage power and lighting wiring.
- C. Section 26 41 00, FACILITY LIGHTNING PROTECTION: Requirements for a lightning protection system.

**1.3 SUBMITTALS**

- A. Submit in accordance with Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.
- B. Shop Drawings:
  - 1. Sufficient information, clearly presented, shall be included to determine compliance with drawings and specifications.
  - 2. Include the location of system grounding electrode connections and the routing of aboveground and underground grounding electrode conductors.
- C. Test Reports: Provide certified test reports of ground resistance.
- D. Certifications: Two weeks prior to final inspection, submit four copies of the following to the Contracting Officers Representative (COR):
  - 1. Certification that the materials and installation is in accordance with the drawings and specifications.
  - 2. Certification, by the Contractor, that the complete installation has been properly installed and tested.

#### 1.4 APPLICABLE PUBLICATIONS

Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.

A. American Society for Testing and Materials (ASTM):

B1-2001.....Standard Specification for Hard-Drawn Copper  
Wire

B8-2004.....Standard Specification for Concentric-Lay-  
Stranded Copper Conductors, Hard, Medium-Hard,  
or Soft

B. Institute of Electrical and Electronics Engineers, Inc. (IEEE):

81-1983.....IEEE Guide for Measuring Earth Resistivity,  
Ground Impedance, and Earth Surface Potentials  
of a Ground System

C. National Fire Protection Association (NFPA):

70-2005.....National Electrical Code (NEC)

D. Telecommunications Industry Association, (TIA)

J-STO-607-A-2002.....Commercial Building Grounding (Earthing) and  
Bonding Requirements for Telecommunications

E. Underwriters Laboratories, Inc. (UL):

44-2005 .....Thermoset-Insulated Wires and Cables

83-2003 .....Thermoplastic-Insulated Wires and Cables

467-2004 .....Grounding and Bonding Equipment

486A-486B-2003 .....Wire Connectors

#### PART 2 - PRODUCTS

##### 2.1 GROUNDING AND BONDING CONDUCTORS

A. Equipment grounding conductors shall be UL 83 insulated stranded copper, except that sizes 6 mm<sup>2</sup> (10 AWG) and smaller shall be solid copper. Insulation color shall be continuous green for all equipment grounding conductors, except that wire sizes 25 mm<sup>2</sup> (4 AWG) and larger shall be permitted to be identified per NEC.

B. Bonding conductors shall be ASTM B8 bare stranded copper, except that sizes 6 mm<sup>2</sup> (10 AWG) and smaller shall be ASTM B1 solid bare copper wire.

C. Isolated Power System: Type XHHW-2 insulation with a dielectric constant of 3.5 or less.

- D. Telecom System Grounding Riser Conductor: Telecommunications Grounding Riser shall be in accordance with J STO-607A. Use a minimum 50mm<sup>2</sup> (1/0 AWG) insulated stranded copper grounding conductor unless indicated otherwise.

## **2.2 SPLICES AND TERMINATION COMPONENTS**

Components shall meet or exceed UL 467 and be clearly marked with the manufacturer, catalog number, and permitted conductor size(s).

## **2.3 TELECOMMUNICATION SYSTEM GROUND BUSBARS**

- A. Provide solid copper busbar, pre-drilled from two-hole lug connections with a minimum thickness of 6 mm (1/4 inch) for wall and backboard mounting using standard insulators sized as follows:
1. Room Signal Grounding: 300 mm x 100 mm (12 inches x 4 inch).
  2. Master Signal Ground: 600 mm x 100 mm (24 inches x 4 inch).

## **2.4 GROUND CONNECTIONS**

- A. Above Grade:
1. Bonding Jumpers: compression type connectors, using zinc-plated fasteners and external tooth lockwashers.
  2. Ground Busbars: Two-hole compression type lugs using tin-plated copper or copper alloy bolts and nuts.
  3. Rack and Cabinet Ground Bars: one-hole compression-type lugs using zinc-plated or copper alloy fasteners.
- B. Cable Shields: Make ground connections to multipair communications cables with metallic shields using shield bonding connectors with screw stud connection.

## **2.5 EQUIPMENT RACK AND CABINET GROUND BARS**

Provide solid copper ground bars designed for mounting on the framework of open or cabinet-enclosed equipment racks with minimum dimensions of 4 mm thick by 19 mm wide (3/8 inch x 3/4 inch).

## **2.6 GROUND TERMINAL BLOCKS**

At any equipment mounting location (e.g. backboards and hinged cover enclosures) where rack-type ground bars cannot be mounted, provide screw lug-type terminal blocks.

## **2.7 SPLICE CASE GROUND ACCESSORIES**

Splice case grounding and bonding accessories shall be supplied by the splice case manufacturer when available. Otherwise, use 16 mm<sup>2</sup> (6 AWG) insulated ground wire with shield bonding connectors.

## **PART 3 - EXECUTION**

### **3.1 GENERAL**

- A. Ground in accordance with the NEC, as shown on drawings, and as hereinafter specified.
- B. System Grounding:
  - 1. Secondary service neutrals: Ground at the supply side of the secondary disconnecting means and at the related transformers.
  - 2. Separately derived systems (transformers downstream from the service entrance): Ground the secondary neutral.
  - 3. Isolation transformers and isolated power systems shall not be system grounded.
- C. Equipment Grounding: Metallic structures (including ductwork and building steel), enclosures, raceways, junction boxes, outlet boxes, cabinets, machine frames, and other conductive items in close proximity with electrical circuits shall be bonded and grounded.

### **3.2 INACCESSIBLE GROUNDING CONNECTIONS**

- A. Make grounding connections, which are buried or otherwise normally inaccessible (except connections for which periodic testing access is required) by exothermic weld.

### **3.3 SECONDARY EQUIPMENT AND CIRCUITS**

- A. Metallic Piping, Building Steel, and Supplemental Electrode(s):
  - 1. Provide a supplemental ground electrode and bond to the grounding electrode system.
- B. Conduit Systems:
  - 1. Ground all metallic conduit systems. All metallic conduit systems shall contain an equipment grounding conductor.
  - 2. Non-metallic conduit systems shall contain an equipment grounding conductor, except that non-metallic feeder conduits which carry a grounded conductor from exterior transformers to interior or building-mounted service entrance equipment need not contain an equipment grounding conductor.
  - 3. Conduit containing only a grounding conductor, and which is provided for mechanical protection of the conductor, shall be bonded to that conductor at the entrance and exit from the conduit.
- C. Feeders and Branch Circuits: Install equipment grounding conductors with all feeders and power and lighting branch circuits.
- D. Boxes, Cabinets, Enclosures, and Panelboards:

1. Bond the equipment grounding conductor to each pullbox, junction box, outlet box, device box, cabinets, and other enclosures through which the conductor passes (except for special grounding systems for intensive care units and other critical units shown).
  2. Provide lugs in each box and enclosure for equipment grounding conductor termination.
  3. Provide ground bars in panelboards, bolted to the housing, with sufficient lugs to terminate the equipment grounding conductors.
- E. Receptacles shall not be grounded through their mounting screws. Ground with a jumper from the receptacle green ground terminal to the device box ground screw and the branch circuit equipment grounding conductor.

### **3.4 CORROSION INHIBITORS**

- A. When making ground and ground bonding connections, apply a corrosion inhibitor to all contact surfaces. Use corrosion inhibitor appropriate for protecting a connection between the metals used.

### **3.5 CONDUCTIVE PIPING**

- A. Bond all conductive piping systems, interior and exterior, to the building to the grounding electrode system. Bonding connections shall be made as close as practical to the equipment ground bus.
- B. In operating rooms and at intensive care and coronary care type beds, bond the gases and suction piping, at the outlets, directly to the room or patient ground bus.

### **3.6 TELECOMMUNICATIONS SYSTEM**

- A. Bond telecommunications system grounding equipment to the electrical grounding electrode system.
- B. Furnish and install all wire and hardware required to properly ground, bond and connect communications raceway, cable tray, metallic cable shields, and equipment to a ground source.
- C. Ground bonding jumpers shall be continuous with no splices. Use the shortest length of bonding jumper possible.
- D. Provide ground paths that are permanent and continuous with a resistance of 1 ohm or less from raceway, cable tray, and equipment connections to the building grounding electrode. The resistance across individual bonding connections shall be 10 milli ohms or less.
- E. Above-Grade Grounding Connections: When making bolted or screwed connections to attach bonding jumpers, remove paint to expose the entire contact surface by grinding where necessary; thoroughly clean

all connector, plate and other contact surfaces; and apply an appropriate corrosion inhibitor to all surfaces before joining.

F. Bonding Jumpers:

1. Use insulated ground wire of the size and type shown on drawings or use a minimum of 16 mm<sup>2</sup> (6 AWG) insulated copper wire.
2. Assemble bonding jumpers using insulated ground wire terminated with compression connectors.
3. Use compression connectors of proper size for conductors specified. Use connector manufacturer's compression tool.

G. Bonding Jumper Fasteners:

1. Conduit: Fasten bonding jumpers using screw lugs on grounding bushings or conduit strut clamps, or the clamp pads on push-type conduit fasteners. When screw lug connection to a conduit strut clamp is not possible, fasten the plain end of a bonding jumper wire by slipping the plain end under the conduit strut clamp pad; tighten the clamp screw firmly. Where appropriate, use zinc-plated external tooth lockwashers.
2. Wireway and Cable Tray: Fasten bonding jumpers using zinc-plated bolts, external tooth lockwashers, and nuts. Install protective cover, e.g., zinc-plated acorn nuts on any bolts extending into wireway or cable tray to prevent cable damage.
3. Ground Plates and Busbars: Fasten bonding jumpers using two-hole compression lugs. Use tin-plated copper or copper alloy bolts, external tooth lockwashers, and nuts.
4. Unistrut and Raised Floor Stringers: Fasten bonding jumpers using zinc-plated, self-drill screws and external tooth lockwashers.

### 3.7 COMMUNICATION ROOM GROUNDING

A. Telecommunications Ground Busbars:

1. Provide communications room telecommunications ground busbar hardware at 950 mm (18 inches) at locations indicated on the Drawings.
2. Connect the telecommunications room ground busbars to other room grounding busbars as indicated on the Grounding Riser diagram.

B. Telephone-Type Cable Rack Systems: aluminum pan installed on telephone-type cable rack serves as the primary ground conductor within the communications room. Make ground connections by installing the following bonding jumpers:

1. Install a 16 mm<sup>2</sup> (6 AWG) bonding between the telecommunications ground busbar and the nearest access to the aluminum pan installed on the cable rack.
  2. Use 16 mm<sup>2</sup> (6 AWG) bonding jumpers across aluminum pan junctions.
- C. Self-Supporting and Cabinet-Mounted Equipment Rack Ground Bars:
1. When ground bars are provided at the rear of lineup of bolted together equipment racks, bond the copper ground bars together using solid copper splice plates supplied by the ground bar manufacturer.
  2. Bond together nonadjacent ground bars on equipment racks and cabinets with 16 mm<sup>2</sup> (6 AWG) insulated copper wire bonding jumpers attached at each end with compression-type connectors and mounting bolts.
  3. Provide a 16 mm<sup>2</sup> (6 AWG) bonding jumper between the rack and/or cabinet ground busbar and the aluminum pan of an overhead cable tray or the raised floor stringer as appropriate.
- D. Backboards: Provide a screw lug-type terminal block or drilled and tapped copper strip near the top of backboards used for communications cross-connect systems. Connect backboard ground terminals to the aluminum pan in the telephone-type cable tray using an insulated 16 mm<sup>2</sup> (16 AWG) bonding jumper.
- E. Other Communication Room Ground Systems: Ground all metallic conduit, wireways, and other metallic equipment located away from equipment racks or cabinets to the cable tray pan or the telecommunications ground busbar, whichever is closer, using insulated 16 mm<sup>2</sup> (6 AWG) ground wire bonding jumpers.

### **3.8 COMMUNICATIONS CABLE GROUNDING**

- A. Bond all metallic cable sheaths in multipair communications cables together at each splicing and/or terminating location to provide 100 percent metallic sheath continuity throughout the communications distribution system.
1. At terminal points, install a cable shield bonding connector provide a screw stud connection for ground wire. Use a bonding jumper to connect the cable shield connector to an appropriate ground source like the rack or cabinet ground bar.
  2. Bond all metallic cable shields together within splice closures using cable shield bonding connectors or the splice case grounding and bonding accessories provided by the splice case manufacturer.

When an external ground connection is provided as part of splice closure, connect to an approved ground source and all other metallic components and equipment at that location.

### **3.9 COMMUNICATIONS CABLE TRAY SYSTEMS:**

- A. Bond the metallic structures of one cable tray in each tray run following the same path to provide 100 percent electrical continuity throughout this cable tray systems as follows:
  - 1. Splice plates provided by the cable tray manufacturer can be used for providing a ground bonding connection between cable tray sections when the resistance across a bolted connection is 10 milliohms or less. The Subcontractor shall verify this loss by testing across one splice plate connection in the presence of the Contractor.
  - 2. Install a 16 mm<sup>2</sup> (6 AWG) bonding jumper across each cable tray splice or junction where splice plates cannot be used.
  - 3. When cable tray terminations to cable rack, install 16 mm<sup>2</sup> (6 AWG) bonding jumper between cable tray and cable rack pan.

### **3.10 COMMUNICATIONS RACEWAY GROUNDING**

- A. Conduit: Use insulated 16 mm<sup>2</sup> (6 AWG) bonding jumpers to ground metallic conduit at each end and to bond at all intermediate metallic enclosures.
- B. Wireway: use insulated 16 mm<sup>2</sup> (6 AWG) bonding jumpers to ground or bond metallic wireway at each end at all intermediate metallic enclosures and across all section junctions.
- C. Cable Tray Systems: Use insulated 16 mm<sup>2</sup> (6 AWG) bonding jumpers to ground cable tray to column-mounted building ground plates (pads) at each end and approximately every 16 meters (50 feet).

### **3.11 GROUND RESISTANCE**

- A. Grounding system resistance to ground shall not exceed 5 ohms. Make necessary modifications or additions to the grounding electrode system for compliance without additional cost to the Government. Final tests shall assure that this requirement is met.
- B. Resistance of the grounding electrode system shall be measured using a four-terminal fall-of-potential method as defined in IEEE 81. Ground resistance measurements shall be made before the electrical distribution system is energized and shall be made in normally dry conditions not less than 48 hours after the last rainfall. Resistance



measurements of separate grounding electrode systems shall be made before the systems are bonded together below grade. The combined resistance of separate systems may be used to meet the required resistance, but the specified number of electrodes must still be provided.

- - - E N D - - -



**SECTION 27 05 33**  
**RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, and connection of conduit, fittings, and boxes to form complete, coordinated, raceway systems. Raceways are required for all communications cabling unless shown or specified otherwise.
- B. Definitions: The term conduit, as used in this specification, shall mean any or all of the raceway types specified.

**1.2 RELATED WORK**

- A. Mounting board for communication closets: Section 06 10 00, ROUGH CARPENTRY.
- B. Sealing around penetrations to maintain the integrity of fire rated construction: Section 07 84 00, FIRESTOPPING.
- C. Fabrications for the deflection of water away from the building envelope at penetrations: Section 07 60 00, FLASHING AND SHEET METAL.
- D. Sealing around conduit penetrations through building envelope to prevent moisture migration into the building: Section 07 92 00, JOINT SEALANTS.
- E. Identification and painting of conduit and other devices: Section 09 91 00, PAINTING.
- F. General electrical requirements and items that is common to more than one section of Division 27: Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.
- G. Requirements for personnel safety and to provide a low impedance path for possible ground fault currents: Section 27 05 26, GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS.

**1.3 SUBMITTALS**

In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish the following:

- A. Shop Drawings:
  - 1. Size and location of panels and pull boxes
  - 2. Layout of required conduit penetrations through structural elements.
  - 3. The specific item proposed and its area of application shall be identified on the catalog cuts.
- B. Certification: Prior to final inspection, deliver to the Contracting Officers Representative (COR) four copies of the certification that the material is in accordance with the drawings and specifications and has been properly installed.

#### **1.4 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.
- B. National Fire Protection Association (NFPA):  
70-05.....National Electrical Code (NEC)
- C. Underwriters Laboratories, Inc. (UL):  
1-03.....Flexible Metal Conduit  
5-01.....Surface Metal Raceway and Fittings  
6-03.....Rigid Metal Conduit  
50-03.....Enclosures for Electrical Equipment  
360-03.....Liquid-Tight Flexible Steel Conduit  
467-01.....Grounding and Bonding Equipment  
514A-01.....Metallic Outlet Boxes  
514B-02.....Fittings for Cable and Conduit  
514C-05.....Nonmetallic Outlet Boxes, Flush-Device Boxes and  
Covers  
651-02.....Schedule 40 and 80 Rigid PVC Conduit  
651A-03.....Type EB and A Rigid PVC Conduit and HDPE Conduit  
797-03.....Electrical Metallic Tubing  
1242-00.....Intermediate Metal Conduit
- D. National Electrical Manufacturers Association (NEMA):  
TC-3-04.....PVC Fittings for Use with Rigid PVC Conduit and  
Tubing  
FB1-03.....Fittings, Cast Metal Boxes and Conduit Bodies  
for Conduit, Electrical Metallic Tubing and  
Cable

### **PART 2 - PRODUCTS**

#### **2.1 MATERIAL**

- A. Conduit Size: In accordance with the NEC, but not less than 1/2 inch unless otherwise shown. Where permitted by the NEC, 1/2 inch flexible conduit may be used for tap connections to recessed lighting fixtures.
- B. Conduit:
1. Rigid galvanized steel: Shall Conform to UL 6, ANSI C80.1.
  2. Rigid intermediate steel conduit (IMC): Shall Conform to UL 1242, ANSI C80.6.
  3. Electrical metallic tubing (EMT): Shall Conform to UL 797, ANSI C80.3. Maximum size not to exceed 4 inch and shall be permitted only with cable rated 600 volts or less.

4. Flexible galvanized steel conduit: Shall Conform to UL 1.
5. Liquid-tight flexible metal conduit: Shall Conform to UL 360.
6. Surface metal raceway: Shall Conform to UL 5.

C. Conduit Fittings:

1. Rigid steel and IMC conduit fittings:

- a. Fittings shall meet requirements of UL 514B and ANSI/ NEMA FB1.
- a. Standard threaded couplings, locknuts, bushings, and elbows: Only steel or malleable iron materials are acceptable. Integral retractable type IMC couplings are also acceptable.
- b. Locknuts: Bonding type with sharp edges for digging into the metal wall of an enclosure.
- c. Bushings: Metallic insulating type, consisting of an insulating insert molded or locked into the metallic body of the fitting. Bushings made entirely of metal or nonmetallic material are not permitted.
- d. Erickson (union-type) and set screw type couplings: Approved for use in concrete are permitted for use to complete a conduit run where conduit is installed in concrete. Use set screws of case hardened steel with hex head and cup point to firmly seat in conduit wall for positive ground. Tightening of set screws with pliers is prohibited.
- e. Sealing fittings: Threaded cast iron type. Use continuous drain type sealing fittings to prevent passage of water vapor. In concealed work, install fittings in flush steel boxes with blank cover plates having the same finishes as that of other electrical plates in the room.

2. Electrical metallic tubing fittings:

- a. Fittings shall meet requirements of UL 514B and ANSI/ NEMA FB1.
- b. Only steel or malleable iron materials are acceptable.
- c. Couplings and connectors: Concrete tight and rain tight, with connectors having insulated throats. Use gland and ring compression type couplings and connectors for conduit sizes 2 inches and smaller. Use set screw type couplings with four set screws each for conduit sizes over 2 inches. Use set screws of case-hardened steel with hex head and cup point to firmly seat in wall of conduit for positive grounding.
- d. Indent type connectors or couplings are prohibited.
- e. Die-cast or pressure-cast zinc-alloy fittings or fittings made of "pot metal" are prohibited.

3. Flexible steel conduit fittings:

- a. Conform to UL 514B. Only steel or malleable iron materials are acceptable.
  - b. Clamp type, with insulated throat.
- 4. Liquid-tight flexible metal conduit fittings:
  - a. Fittings shall meet requirements of UL 514B and ANSI/ NEMA FB1.
  - b. Only steel or malleable iron materials are acceptable.
  - c. Fittings must incorporate a threaded grounding cone, a steel or plastic compression ring, and a gland for tightening. Connectors shall have insulated throats.
- 5. Surface metal raceway fittings: As recommended by the raceway manufacturer.
- 6. Expansion and deflection couplings:
  - a. Conform to UL 467 and UL 514B.
  - b. Accommodate, 0.75 inch deflection, expansion, or contraction in any direction, and allow 30 degree angular deflections.
  - c. Include internal flexible metal braid sized to guarantee conduit ground continuity and fault currents in accordance with UL 467, and the NEC code tables for ground conductors.
  - d. Jacket: Flexible, corrosion-resistant, watertight, moisture and heat resistant molded rubber material with stainless steel jacket clamps.
- D. Conduit Supports:
  - 1. Parts and hardware: Zinc-coat or provide equivalent corrosion protection.
  - 2. Individual Conduit Hangers: Designed for the purpose, having a pre-assembled closure bolt and nut, and provisions for receiving a hanger rod.
  - 3. Multiple conduit (trapeze) hangers: Not less than 1-1/2 by 1-1/2 inch, 12 gage steel, cold formed, lipped channels; with not less than 3/8 inch diameter steel hanger rods.
  - 4. Solid Masonry and Concrete Anchors: Self-drilling expansion shields, or machine bolt expansion.
- E. Outlet, Junction, and Pull Boxes:
  - 1. UL-50 and UL-514A.
  - 2. Cast metal where required by the NEC or shown, and equipped with rustproof boxes.
  - 3. Sheet metal boxes: Galvanized steel, except where otherwise shown.
  - 4. Flush mounted wall or ceiling boxes shall be installed with raised covers so that front face of raised cover is flush with the wall.

Surface mounted wall or ceiling boxes shall be installed with surface style flat or raised covers.

F. Wireways: Equip with hinged covers, except where removable covers are shown.

### **PART 3 - EXECUTION**

#### **3.1 PENETRATIONS**

A. Cutting or Holes:

1. Locate holes in advance where they are proposed in the structural sections such as ribs or beams. Obtain the approval of the COR prior to drilling through structural sections.
2. Cut holes through concrete and masonry in new and existing structures with a diamond core drill or concrete saw. Pneumatic hammer, impact electric, hand or manual hammer type drills are not allowed, except where permitted by the COR as required by limited working space.

B. Fire Stop: Where conduits, wireways, and other communications raceways pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING, with rock wool fiber or silicone foam sealant only. Completely fill and seal clearances between raceways and openings with the fire stop material.

C. Waterproofing: At floor, exterior wall, and roof conduit penetrations, completely seal clearances around the conduit and make watertight as specified in Section 07 92 00, JOINT SEALANTS.

#### **3.2 INSTALLATION, GENERAL**

A. Install conduit as follows:

1. In complete runs before pulling in cables or wires.
2. Flattened, dented, or deformed conduit is not permitted. Remove and replace the damaged conduits with new undamaged material.
3. Assure conduit installation does not encroach into the ceiling height head room, walkways, or doorways.
4. Cut square with a hacksaw, ream, remove burrs, and draw up tight.
5. Mechanically continuous.
6. Independently support conduit at 8'0" on center. Do not use other supports i.e., (suspended ceilings, suspended ceiling supporting members, lighting fixtures, conduits, mechanical piping, or mechanical ducts).
7. Support within 1 foot of changes of direction, and within 1 foot of each enclosure to which connected.

8. Close ends of empty conduit with plugs or caps at the rough-in stage to prevent entry of debris, until wires are pulled in.
  9. Conduit installations under fume and vent hoods are prohibited.
  10. Secure conduits to cabinets, junction boxes, pull boxes and outlet boxes with bonding type locknuts. For rigid and IMC conduit installations, provide a locknut on the inside of the enclosure, made up wrench tight. Do not make conduit connections to junction box covers.
  11. Flashing of penetrations of the roof membrane is specified in Section 07 60 00, FLASHING AND SHEET METAL.
  12. Do not use aluminum conduits in wet locations.
  13. Unless otherwise indicated on the drawings or specified herein, all conduits shall be installed concealed within finished walls, floors and ceilings.
- B. Conduit Bends:
1. Make bends with standard conduit bending machines.
  2. Conduit hickey may be used for slight offsets, and for straightening stubbed out conduits.
  3. Bending of conduits with a pipe tee or vise is prohibited.
- C. Layout and Homeruns:
2. Deviations: Make only where necessary to avoid interferences and only after drawings showing the proposed deviations have been submitted approved by the COR.

### **3.3 CONCEALED WORK INSTALLATION**

- A. Furred or Suspended Ceilings and in Walls:
1. Conduit for conductors 600 volts and below:
    - a. Rigid steel, IMC, rigid aluminum, or EMT. Different type conduits mixed indiscriminately in the same system is prohibited.
  2. Align and run conduit parallel or perpendicular to the building lines.
  3. Tightening set screws with pliers is prohibited.

### **3.4 EXPOSED WORK INSTALLATION**

- A. Unless otherwise indicated on the drawings, exposed conduit is only permitted in mechanical and electrical rooms.
- B. Conduit for conductors above 600 volts:
1. Rigid steel or rigid aluminum.
  2. Aluminum conduit mixed indiscriminately with other types in the same system is prohibited.
- C. Conduit for Conductors 600 volts and below:



1. Rigid steel, IMC, or EMT. Different type of conduits mixed indiscriminately in the system is prohibited.
- D. Align and run conduit parallel or perpendicular to the building lines.
- E. Install horizontal runs close to the ceiling or beams and secure with conduit straps.
- F. Support horizontal or vertical runs at not over 2400 mm (eight foot) intervals.
- G. Surface metal raceways: Use only where shown.
- H. Painting:
  1. Paint exposed conduit as specified in Section 09 91 00, PAINTING.
  2. Paint all conduits containing cables rated over 600 volts safety orange. Refer to Section 09 91 00, PAINTING for preparation, paint type, and exact color. In addition, paint legends, using two inch high black numerals and letters, showing the cable voltage rating. Provide legends where conduits pass through walls and floors and at maximum 20 foot intervals in between.

### **3.5 EXPANSION JOINTS**

- A. Conduits 3 inches and larger, that are secured to the building structure on opposite sides of a building expansion joint, require expansion and deflection couplings. Install the couplings in accordance with the manufacturer's recommendations.
- B. Provide conduits smaller than 3 inches with junction boxes on both sides of the expansion joint. Connect conduits to junction boxes with sufficient slack of flexible conduit to produce 125 mm (5 inch) vertical drop midway between the ends. Flexible conduit shall have a copper green ground bonding jumper installed. In lieu of this flexible conduit, expansion and deflection couplings as specified above for 15 inches and larger conduits are acceptable.
- C. Install expansion and deflection couplings where shown.

### **3.6 CONDUIT SUPPORTS, INSTALLATION**

- A. Safe working load shall not exceed 1/4 of proof test load of fastening devices.
- B. Use pipe straps or individual conduit hangers for supporting individual conduits. Maximum distance between supports is 8 foot on center.
- C. Support multiple conduit runs with trapeze hangers. Use trapeze hangers that are designed to support a load equal to or greater than the sum of the weights of the conduits, wires, hanger itself, and 200 pounds. Attach each conduit with U-bolts or other approved fasteners.
- D. Support conduit independently of junction boxes, pull boxes, fixtures, suspended ceiling T-bars, angle supports, and similar items.

E. Fasteners and Supports in Solid Masonry and Concrete:

1. New Construction: Use steel or malleable iron concrete inserts set in place prior to placing the concrete.
2. Existing Construction:
  - a. Steel expansion anchors not less than 1/4 inch bolt size and not less than 1-1/8 inch embedment.
  - b. Power set fasteners not less than 1/4 inch diameter with depth of penetration not less than 3 inches.
  - c. Use vibration and shock resistant anchors and fasteners for attaching to concrete ceilings.

F. Hollow Masonry: Toggle bolts are permitted.

G. Bolts supported only by plaster or gypsum wallboard are not acceptable.

H. Metal Structures: Use machine screw fasteners or other devices specifically designed and approved for the application.

I. Attachment by wood plugs, rawl plug, plastic, lead or soft metal anchors, or wood blocking and bolts supported only by plaster is prohibited.

J. Chain, wire, or perforated strap shall not be used to support or fasten conduit.

K. Spring steel type supports or fasteners are prohibited for all uses except: Horizontal and vertical supports/fasteners within walls.

L. Vertical Supports: Vertical conduit runs shall have riser clamps and supports in accordance with the NEC and as shown. Provide supports for cable and wire with fittings that include internal wedges and retaining collars.

### **3.7 BOX INSTALLATION**

A. Boxes for Concealed Conduits:

1. Flush mounted.
2. Provide raised covers for boxes to suit the wall or ceiling, construction and finish.

B. In addition to boxes shown, install additional boxes where needed to prevent damage to cables and wires during pulling in operations.

C. Remove only knockouts as required and plug unused openings. Use threaded plugs for cast metal boxes and snap-in metal covers for sheet metal boxes.

D. Stencil or install phenolic nameplates on covers of the boxes identified on riser diagrams; for example "SIG-FA JB No. 1".

### **3.11 COMMUNICATION SYSTEM CONDUIT**

A. Install the communication raceway system as shown on drawings.

- B. Minimum conduit size of 3/4 inch, but not less than the size shown on the drawings.
- C. All conduit ends shall be equipped with insulated bushings.
- D. All 4 inch conduits within buildings shall include pull boxes after every two 90 degree bends. Size boxes per the NEC.
- E. Vertical conduits/sleeves through closets floors shall terminate not less than 3 inches below the floor and not less than 3 inches below the ceiling of the floor below.
- F. Terminate conduit runs to/from a backboard in a closet or interstitial space at the top or bottom of the backboard. Conduits shall enter communication closets next to the wall and be flush with the backboard.
- G. Where drilling is necessary for vertical conduits, locate holes so as not to affect structural sections such as ribs or beams.
- H. All empty conduits located in communication closets or on backboards shall be sealed with a standard non-hardening duct seal compound to prevent the entrance of moisture and gases and to meet fire resistance requirements.
- I. Conduit runs shall contain no more than four quarter turns (90 degree bends) between pull boxes/backboards. Minimum radius of communication conduit bends shall be as follows (special long radius):

Sizes of Conduit Trade Size	Radius of Conduit Bends Inches
3/4	6
1	9
1-1/4	14
1-1/2	17
2	21
2-1/2	25
3	31
3-1/2	36
4	45

- J. Furnish and install 3/4 inch thick fire retardant plywood specified in Section 06 10 00, ROUGH CARPENTRY on the wall of communication closets where shown on drawings. Mount the plywood with the bottom edge one foot above the finished floor.
- K. Furnish and pull wire in all empty conduits. (Sleeves through floor are exceptions).

- - - E N D - - -



## **SECTION 27 08 00**

### **COMMISSIONING OF COMMUNICATIONS SYSTEMS**

#### **PAET 1 - GENERAL**

##### **1.1 DESCRIPTION**

- A. The requirements of this Section apply to all sections of Division 27.
- B. This project will have selected building systems commissioned. The complete list of equipment and systems to be commissioned are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. The commissioning process, which the Contractor is responsible to execute, is defined in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. A Commissioning Agent (CxA) appointed by the Department of Veterans Affairs will manage the commissioning process.

##### **1.2 RELATED WORK**

- A. Section 01 00 00 GENERAL REQUIREMENTS.
- B. Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.
- C. Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

##### **1.3 SUMMARY**

- A. This Section includes requirements for commissioning the Facility communications systems, related subsystems and related equipment. This Section supplements the general requirements specified in Section 01 91 00 General Commissioning Requirements.
- B. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for more details regarding processes and procedures as well as roles and responsibilities for all Commissioning Team members.

##### **1.4 DEFINITIONS**

- A. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for definitions.

##### **1.5 COMMISSIONED SYSTEMS**

- A. Commissioning of a system or systems specified in Division 27 is part of the construction process. Documentation and testing of these systems, as well as training of the VA's Operation and Maintenance personnel in accordance with the requirements of Section 01 91 00 and of Division 27, is required in cooperation with the VA and the Commissioning Agent.
- B. The Facility exterior closure systems commissioning will include the systems listed in Section 01 19 00 General Commissioning Requirements:

## **1.6 SUBMITTALS**

- A. The commissioning process requires review of selected Submittals. The Commissioning Agent will provide a list of submittals that will be reviewed by the Commissioning Agent. This list will be reviewed and approved by the Contracting Officers Representative (COR) prior to forwarding to the Contractor. Refer to Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, and SAMPLES for further details.
- B. The commissioning process requires Submittal review simultaneously with engineering review. Specific submittal requirements related to the commissioning process are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

## **PART 2 - PRODUCTS (NOT USED)**

## **PART 3 - EXECUTION**

### **3.1 CONSTRUCTION INSPECTIONS**

- A. Commissioning of Communications systems will require inspection of individual elements of the communications system construction throughout the construction period. The Contractor shall coordinate with the Commissioning Agent in accordance with Section 01 19 00 and the Commissioning plan to schedule communications systems inspections as required to support the Commissioning Process.

### **3.2 PRE-FUNCTIONAL CHECKLISTS**

- A. The Contractor shall complete Pre-Functional Checklists to verify systems, subsystems, and equipment installation is complete and systems are ready for Systems Functional Performance Testing. The Commissioning Agent will prepare Pre-Functional Checklists to be used to document equipment installation. The Contractor shall complete the checklists. Completed checklists shall be submitted to the VA and to the Commissioning Agent for review. The Commissioning Agent may spot check a sample of completed checklists. If the Commissioning Agent determines that the information provided on the checklist is not accurate, the Commissioning Agent will return the marked-up checklist to the Contractor for correction and resubmission. If the Commissioning Agent determines that a significant number of completed checklists for similar equipment are not accurate, the Commissioning Agent will select a broader sample of checklists for review. If the Commissioning Agent determines that a significant number of the broader sample of checklists is also inaccurate, all the checklists for the type of equipment will be returned to the Contractor for correction and

resubmission. Refer to SECTION 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for submittal requirements for Pre-Functional Checklists, Equipment Startup Reports, and other commissioning documents.

### **3.3 CONTRACTORS TESTS**

- A. Contractor tests as required by other sections of Division 27 shall be scheduled and documented in accordance with Section 01 00 00 GENERAL REQUIREMENTS. All testing shall be incorporated into the project schedule. Contractor shall provide no less than 7 calendar days' notice of testing. The Commissioning Agent will witness selected Contractor tests at the sole discretion of the Commissioning Agent. Contractor tests shall be completed prior to scheduling Systems Functional Performance Testing.

### **3.4 SYSTEMS FUNCTIONAL PERFORMANCE TESTING:**

- A. The Commissioning Process includes Systems Functional Performance Testing that is intended to test systems functional performance under steady state conditions, to test system reaction to changes in operating conditions, and system performance under emergency conditions. The Commissioning Agent will prepare detailed Systems Functional Performance Test procedures for review and approval by the COR. The Contractor shall review and comment on the tests prior to approval. The Contractor shall provide the required labor, materials, and test equipment identified in the test procedure to perform the tests. The Commissioning Agent will witness and document the testing. The Contractor shall sign the test reports to verify tests were performed. See Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS, for additional details.

### **3.5 TRAINING OF VA PERSONNEL**

- A. Training of the VA operation and maintenance personnel is required in cooperation with the COR and Commissioning Agent. Provide competent, factory authorized personnel to provide instruction to operation and maintenance personnel concerning the location, operation, and troubleshooting of the installed systems. The instruction shall be scheduled in coordination with the COR after submission and approval of formal training plans. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS and Division 27 Sections for additional Contractor training requirements.

----- END -----





**SECTION 27 10 00**  
**STRUCTURED CABLING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the furnishing, installation, and connection of the structured cabling system to provide a comprehensive telecommunications infrastructure.

**1.2 RELATED WORK**

- A. Sealing around penetrations to maintain the integrity of time rated construction: Section 07 84 00, FIRESTOPPING.
- B. General electrical requirements that are common to more than one section in Division 27: Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.
- C. Conduits for cables and wiring: Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS.
- D. Requirements for personnel safety and to provide a low impedance path for possible ground fault currents: Section 27 05 26, GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS.

**1.3 SUBMITTALS**

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish the following:
1. Manufacturer's Literature and Data: Showing each cable type and rating.
  2. Certificates: Two weeks prior to final inspection, deliver to the Contracting Officers Representative (COR) four copies of the certification that the material is in accordance with the drawings and specifications and has been properly installed.

**1.4 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are reference in the text by the basic designation only.
- B. American Society of Testing Material (ASTM):  
D2301-04.....Standard Specification for Vinyl Chloride  
Plastic Pressure Sensitive Electrical Insulating  
Tape
- C. Federal Specifications (Fed. Spec.):  
A-A-59544-00.....Cable and Wire, Electrical (Power, Fixed  
Installation)

D. National Fire Protection Association (NFPA):

70-05.....National Electrical Code (NEC)

E. Underwriters Laboratories, Inc. (UL):

44-02.....Thermoset-Insulated Wires and Cables

83-03.....Thermoplastic-Insulated Wires and Cables

467-01.....Electrical Grounding and Bonding Equipment

486A-01.....Wire Connectors and Soldering Lugs for Use with  
Copper Conductors

486C-02.....Splicing Wire Connectors

486D-02.....Insulated Wire Connector Systems for Underground  
Use or in Damp or Wet Locations

486E-00.....Equipment Wiring Terminals for Use with Aluminum  
and/or Copper Conductors

493-01.....Thermoplastic-Insulated Underground Feeder and  
Branch Circuit Cable

514B-02.....Fittings for Cable and Conduit

1479-03.....Fire Tests of Through-Penetration Fire Stops

**PART 2 - PRODUCTS**

**2.1 CONTROL WIRING**

- A. Unless otherwise specified in other sections of these specifications, control wiring shall be as specified for power and lighting wiring, except the minimum size shall be not less than No. 14 AWG.
- B. Control wiring shall be large enough so that the voltage drop under inrush conditions does not adversely affect operation of the controls.

**2.2 COMMUNICATION AND SIGNAL WIRING**

- A. Shall conform to the recommendations of the manufacturers of the communication and signal systems; however, not less than what is shown.
- B. Wiring shown is for typical systems. Provide wiring as required for the systems being furnished.
- C. Multi-conductor cables shall have the conductors color coded.

**2.3 WIRE LUBRICATING COMPOUND**

- A. Suitable for the wire insulation and conduit it is used with, and shall not harden or become adhesive.
- B. Shall not be used on wire for isolated type electrical power systems.

**2.4 FIREPROOFING TAPE**

- A. The tape shall consist of a flexible, conformable fabric of organic composition coated one side with flame-retardant elastomer.
- B. The tape shall be self-extinguishing and shall not support combustion. It shall be arc-proof and fireproof.

- C. The tape shall not deteriorate when subjected to water, gases, salt water, sewage, or fungus and be resistant to sunlight and ultraviolet light.
- D. The finished application shall withstand a 200-ampere arc for not less than 30 seconds.
- E. Securing tape: Glass cloth electrical tape not less than 0.18 mm (7 mils) thick, and 19 mm (3/4 inch) wide.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION, GENERAL**

- A. Install all wiring in raceway systems.
- B. Wire Pulling:
  - 1. Provide installation equipment that will prevent the cutting or abrasion of insulation during pulling of cables.
  - 2. Use ropes made of nonmetallic material for pulling feeders.
  - 3. Attach pulling lines for feeders by means of either woven basket grips or pulling eyes attached directly to the conductors, as approved by the COR.
  - 4. Pull in multiple cables together in a single conduit.

#### **3.2 CONTROL, COMMUNICATION AND SIGNAL WIRING INSTALLATION**

- A. Unless otherwise specified in other sections, install wiring and connect to equipment/devices to perform the required functions as shown and specified.
- B. Except where otherwise required, install a separate power supply circuit for each system so that malfunctions in any system will not affect other systems.
- C. Where separate power supply circuits are not shown, connect the systems to the nearest panelboards of suitable voltages, which are intended to supply such systems and have suitable spare circuit breakers or space for installation.
- D. Install a red warning indicator on the handle of the branch circuit breaker for the power supply circuit for each system to prevent accidental de-energizing of the systems.
- E. System voltages shall be 120 volts or lower where shown on the drawings or as required by the NEC.

#### **3.3 CONTROL, COMMUNICATION AND SIGNAL SYSTEM IDENTIFICATION**

- A. Install a permanent wire marker on each wire at each termination.
- B. Identifying numbers and letters on the wire markers shall correspond to those on the wiring diagrams used for installing the systems.
- C. Wire markers shall retain their markings after cleaning.

#### **3.4 EXISITNG WIRING**

Unless specifically indicated on the plans, existing wiring shall not be reused for the new installation. Only wiring that conforms to the specifications and applicable codes may be reused. If existing wiring does not meet these requirements, existing wiring may not be reused and new wires shall be installed.

- - - E N D - - -

**SECTION 27 11 00**  
**COMMUNICATIONS EQUIPMENT ROOM FITTINGS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This Section specifies the furnishing, installing, certification, testing, and guaranty of a complete and operating Voice and Digital Cable Distribution System (here-in-after referred to as "*the System*"), and associated equipment and hardware to be installed in the VA Medical Center here-in-after referred to as "the Facility". The System shall include, but not be limited to: equipment cabinets, interface enclosures, and relay racks; necessary combiners, traps, and filters; and necessary passive devices such as: splitters, couplers, cable "patch", "punch down", and cross-connector blocks or devices, voice and data distribution sub-systems, and associated hardware. The System shall additionally include, but not be limited to: telecommunication closets (TC); telecommunications outlets (TCO); copper and fiber optic distribution cables, connectors, "patch" cables, and/or "break out" devices.
- B. The System shall be delivered free of engineering, manufacturing, installation, and functional defects. It shall be designed, engineered and installed for ease of operation, maintenance, and testing.
- C. The term "provide", as used herein, shall be defined as: designed, engineered, furnished, installed, certified, and tested, by the Contractor.
- D. The Voice and Digital Telecommunication Distribution Cable Equipment and System provides the media which voice and data information travels over and connects to the Telephone System which is defined as an Emergency Critical Care Communication System by the National Fire Protection Association (NFPA). Therefore, since the System connects to or extends the telephone system, the System's installation and operation shall adhere to all appropriate National, Government, and/or Local Life Safety and/or Support Codes, which ever are the more stringent for this Facility. At a minimum , the System shall be installed according to NFPA, Section 70, National Electrical Code (NEC), Article 517 and Chapter 7; NFPA, Section 99, Health Care Facilities, Chapter 3-4; NFPA, Section 101, Life Safety Code, Chapters 7, 12, and/or 13; Joint Commission on Accreditation of Health Care

Organization (JCAHCO), Manual for Health Care Facilities, all necessary Life Safety and/or Support guidelines; this specification; and the original equipment manufacturer's (OEM) suggested installation design, recommendations, and instructions. The OEM and Contractor shall ensure that all management, sales, engineering, and installation personnel have read and understand the requirements of this specification before the System is designed, engineered, delivered, and provided.

- E. The VA Project Manager (PM) and/or if delegated, Contracting Officers Representative (COR) are the approving authorities for all contractual and mechanical changes to the System. The Contractor is cautioned to obtain in writing, all approvals for system changes relating to the published contract specifications and drawings, from the PM and/or the COR before proceeding with the change.
- F. System Performance:
1. At a minimum, the System shall be able to support the following voice and data operations for Category 6 Certified Telecommunication Service:
    - a. Provide the following interchange (or interface) capabilities:
      - 1) Basic Rate (BRI).
      - 2) Primary Rate (PRI).
    - b. ISDN measured at new rack in room 3B-162.:
      - 1) Narrow Band BRI:
        - a) B Channel: 64 kilo-Bits per second (kBps), minimum.
        - b) D Channel: 16 kBps, minimum.
        - c) H Channel: 384 kBps, minimum.
      - 2) Narrow Band PRI:
        - a) B Channel: 64 kBps, minimum.
        - b) D Channel: 64 kBps, minimum.
        - c) H Channel: 1,920 kBps, minimum.
      - 3) Wide (or Broad) Band: All channels: 140 mega(m)-Bps, minimum, capable to 565 mBps at "T" reference.
    - c. ATM operation and interface: ATM 155 mBps measured at new rack in room 3B-162.
    - d. Frame Relay: All stated compliance's measured at new rack in room 3B-162.
    - e. Integrated Data Communications Utility (IDCU) operation and interface: Measured at new rack in room 3B-162.

- f. Government Open Systems Interconnection Profile (GOSSIP)  
compliant: Measured at new rack in room 3B-162.
  - g. Fiberoptic Distributed Data Interface (FDDI): A minimum 100 mBps  
to a maximum of 1.8 giga(g)-Bps data bit stream speed measured at  
new rack in room 3B-162. (shall be Synchronous Optical Network  
[SONET] compliant).
  - h. System Sensitivity: Satisfactory service shall be provided for at  
least 3,000 feet for all voice and data locations.
2. At a minimum the System shall support the following operating  
parameters:
- a. EPBX connection:
    - 1) System speed: 1.0 gBps per second, minimum.
    - 2) Impedance: 600 Ohms.
    - 3) Cross Modulation: -60 deci-Bel (dB).
    - 4) Hum Modulation: -55 dB.
    - 5) System data error: 10 to the -10 Bps, minimum.
    - 6) Loss: Measured at the frame output with reference Zero (0)  
decibel measured (dBm) at 1,000 Hertz (Hz) applied to the  
frame input.
      - a) Trunk to station: 1.5 dB, maximum.
      - b) Station to station: 3.0 dB, maximum.
      - c) Internal switch crosstalk: -60 dB when a signal of  $\pm 10$   
decibel measured (dBm), 500-2,500 Hz range is applied to the  
primary path.
      - d) Idle channel noise: 25 dBm "C" or 3.0 dBm "O" above  
reference (terminated) ground noise, whichever is greater.
    - e) Traffic Grade of Service for Voice and Data:
      - (1) A minimum grade of service of P-01 with an average  
traffic load of 7.0 CCS per station per hour and a traffic  
overload in the data circuits will not interfere with, or  
degrade, the voice service.
      - (2) Average CCS per voice station: The average CCS capacity  
per voice station shall be maintained at 7.0 CCS when the  
EPBX is expanded up to the projected maximum growth as  
stated herein.
  - b. Telecommunications Outlet (TCO):
    - 1) Voice:

- a) Isolation (outlet-outlet): 24 dB.
  - b) Impedance: 600 Ohms, balanced (BAL).
  - c) Signal Level: 0 deciBel per mili-Volt (dBmV)  $\pm$  0.1 dBmV.
  - d) System speed: 100 mBps, minimum.
  - e) System data error: 10 to the -6 Bps, minimum.
- 2) Data:
- a) Isolation (outlet-outlet): 24 dB.
  - b) Impedance: 600 Ohms, BAL.
  - c) Signal Level: 0 dBmV  $\pm$  0.1 dBmV.
  - d) System speed: 120 mBps, minimum.
  - e) System data error: 10 to the -8 Bps, minimum.

## 1.2 RELATED WORK

- A. Specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Specification Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.
- C. Specification Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS.
- D. Specification Section 27 10 00, STRUCTURED CABLING.
- E. Specification Section 26 27 26, WIRING DEVICES.
- F. Specification Section 27 05 26, GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS.
- G. Specification Section 26 41 00, FACILITY LIGHTNING PROTECTION.
- H. Specification Section 27 51 16, PUBLIC ADDRESS AND MASS NOTIFICATION SYSTEMS.
- I. H-088-C3, VA HANDBOOK DESIGN FOR TELEPHONE SYSTEMS

## 1.3 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in text by basic designation only. Except for a specific date given the issue in effect (including amendments, addenda, revisions, supplements, and errata) on the date the system's submittal is technically approved by VA, shall be enforced.
- B. National Fire Protection Association (NFPA):

70	NATIONAL ELECTRICAL CODE (NEC)
75	Protection of Electronic Computer/Data Processing Equipment



77	Recommended Practice on Static Electricity
	Standard for Health Care Facilities
101	Life Safety Code
1221	Emergency Services Communication Systems

C. Underwriters Laboratories, Inc. (UL):

65	Wired Cabinets
96	Lightning Protection Components
96A	INSTALLATION REQUIREMENTS FOR LIGHTNING PROTECTION SYSTEMS
467	Grounding and Bonding Equipment
497/497A/497B	PROTECTORS FOR PAIRED CONDUCTORS/ COMMUNICATIONS CIRCUITS/DATA COMMUNICATIONS AND FIRE ALARM CIRCUITS
884	Underfloor Raceways and Fittings

D. ANSI/EIA/TIA Publications:

568B	Commercial Building Telecommunications Wiring Standard
569B	Commercial Building Standard for Telecommunications Pathways and Spaces
606A	ADMINISTRATION STANDARD FOR THE TELECOMMUNICATIONS INFRASTRUCTURE OF COMMERCIAL BUILDINGS
607A	Grounding and Bonding Requirements for Telecommunications in Commercial Buildings
758	Grounding and Bonding Requirements for Telecommunications in Commercial Buildings

E. Lucent Technologies: Document 900-200-318 "Outside Plant Engineering Handbook".

F. International Telecommunication Union - Telecommunication Standardization Sector (ITU-T).

G. Federal Information Processing Standards (FIPS) Publications.

H. Federal Communications Commission (FCC) Publications: Standards for telephone equipment and systems.

I. United States Air Force: Technical Order 33K-1-100 Test Measurement and Diagnostic Equipment (TMDE) Interval Reference Guide.

J. Joint Commission on Accreditation of Health Care Organization (JCAHO): Comprehensive Accreditation Manual for Hospitals.

K. National and/or Government Life Safety Code(s): The more stringent of each listed code.

#### **1.4 QUALITY ASSURANCE**

- A. The authorized representative of the OEM, shall be responsible for the design, satisfactory total operation of the System, and its certification.
- B. The OEM shall meet the minimum requirements identified in Paragraph 2.1.A. Additionally, the Contractor shall have had experience with three or more installations of systems of comparable size and complexity with regards to coordinating, engineering, testing, certifying, supervising, training, and documentation. Identification of these installations shall be provided as a part of the submittal as identified in Paragraph 1.5.
- C. The System Contractor shall submit certified documentation that they have been an authorized distributor and service organization for the OEM for a minimum of three (3) years. The System Contractor shall be authorized by the OEM to certify and warranty the installed equipment. In addition, the OEM and System Contractor shall accept complete responsibility for the design, installation, certification, operation, and physical support for the System. This documentation, along with the System Contractor and OEM certification must be provided in writing as part of the Contractor's Technical Submittal.
- D. All equipment, cabling, terminating hardware, TCOs, and patch cords shall be sourced from the certifying OEM or at the OEM's direction, and support the System design, the OEM's quality control and validity of the OEM's warranty.
- E. The Contractor's Telecommunications Technicians assigned to the System shall be fully trained, qualified, and certified by the OEM on the engineering, installation, and testing of the System. The Contractor shall provide formal written evidence of current OEM certification(s) for the installer(s) as a part of the submittal or to the COR before being allowed to commence work on the System.

#### **1.5 SUBMITTALS**

- A. Provide submittals in accordance with Specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. The COR shall retain one copy for review and approval.

1. If the submittal is approved the COR shall retain one copy for Official Records and return three (3) copies to the Contractor.
  2. If the submittal is disapproved, three (3) copies will be returned to the Contractor with a written explanation attached that indicates the areas the submittal deviated from the System specifications. The COR shall retain one copy for Official Records.
- B. Environmental Requirements: Technical submittals shall confirm the environmental specifications for physical TC areas occupied by the System. These environmental specifications shall identify the requirements for initial and expanded system configurations for:
1. Floor loading for batteries and cabinets.
  2. Minimum floor space and ceiling heights.
  3. Minimum size of doors for equipment passage.
  4. Power requirements: The Contractor shall provide the specific voltage, amperage, phases, and quantities of circuits required.
  5. Main trunk line and riser pathways, cable duct, and conduit requirements between each MTC, TC, and TCO.
- C. Documents: The submittal shall be separated into sections for each subsystem and shall contain the following:
1. Title page to include:
    - a. VA Medical Center.
    - b. Contractor's name, address, and telephone (including FAX) numbers.
    - c. Date of Submittal.
    - d. VA Project No.
  2. List containing a minimum of three locations of installations of similar size and complexity as identified herein. These locations shall contain the following:
    - a. Installation Location and Name.
    - b. Owner's or User's name, address, and telephone (including FAX) numbers.
    - c. Date of Project Start and Date of Final Acceptance by Owner.
    - d. System Project Number.
    - e. Brief (three paragraphs minimum) description of each system's function, operation, and installation.
  3. Narrative Description of the system.

4. A List of the equipment to be furnished. The quantity, make, and model number of each item is required.
  5. Pictorial layouts of each each distribution cabinet layout drawing and TCO as each is expected to be installed and configured.
  6. Equipment technical literature detailing the electrical and technical characteristics of each item of equipment to be furnished.
  7. List of test equipment as per paragraph 1.5.D. below.
  8. Letter certifying that the Contractor understands the requirements of the SAMPLES Paragraph 1.5.E.
  9. Letter certifying that the Contractor understands the requirements of Section 3.2 concerning acceptance tests.
- D. Test Equipment List:
1. The Contractor is responsible for furnishing all test equipment required to test the system in accordance with the parameters specified. Unless otherwise stated, the test equipment shall not be considered part of the system. The Contractor shall furnish test equipment of accuracy better than the parameters to be tested.
  2. The test equipment furnished by the Contractor shall have a calibration tag of an acceptable calibration service dated not more than 12 months prior to the test. As part of the submittal, a test equipment list shall be furnished that includes the make and model number of the following type of equipment as a minimum:
    - a. Spectrum Analyzer.
    - b. Signal Level Meter.
    - c. Volt-Ohm Meter.
    - d. Time Domain Reflectometer (TDR) with strip chart recorder (Data and Optical Measuring).
    - e. Bit Error Test Set (BERT).
    - f. Camera with a minimum of 60 pictures to that will develop immediately to include appropriate test equipment adapters. A video camera in VHS format is an acceptable alternate.
- E. Samples: A sample of each of the following items shall be furnished to the COR for approval prior to installation.
1. TCO Wall Outlet Box 4" x 4"x 2.5" with:
    - a. One each telephone (or voice) rj45 jack installed.
    - b. Two each multi pin data rj45 jacks installed.
    - c. Cover Plate installed.

2. Data CCS patch panel, punch block or connection device with RJ45 connectors installed.
3. Telephone CCS system with IDC and/or RJ45 connectors and cable terminal equipment installed.
4. Fiber optic CCS patch panel or breakout box with cable management equipment and "ST" connectors installed.
5. 610 mm (2 ft.) section of each copper cable to be used with cable sweep tags as specified in paragraph 2.4.H and connectors installed.
6. 610 mm (2 ft.) section of each fiber optic cable to be used with cable sweep tags as specified in paragraph 2.4.H and connectors installed.

F. Certifications:

1. Submit written certification from the OEM indicating that the proposed supervisor of the installation and the proposed provider of the contract maintenance are authorized representatives of the OEM. Include the individual's exact name and address and OEM credentials in the certification.
2. Submit written certification from the OEM that the wiring and connection diagrams meet National and/or Government Life Safety Guidelines, NFPA, NEC, UL, this specification, and JCAHCO requirements and instructions, requirements, recommendations, and guidance set forth by the OEM for the proper performance of the System as described herein. The VA will not approve any submittal without this certification.
3. Preacceptance Certification: This certification shall be made in accordance with the test procedure outlined in paragraph 3.2.B.

G. Equipment Manuals: Fifteen (15) working days prior to the scheduled acceptance test, the Contractor shall deliver four complete sets of commercial operation and maintenance manuals for each item of equipment furnished as part of the System to the RE. The manuals shall detail the theory of operation and shall include narrative descriptions, pictorial illustrations, block and schematic diagrams, and parts list.

H. Record Wiring Diagrams:

1. Fifteen (15) working days prior to the acceptance test, the Contractor shall deliver four complete sets of the Record Wiring Diagrams of the System to the RE. The diagrams shall show all inputs and outputs of electronic and passive equipment correctly identified

according to the markers installed on the interconnecting cables, Equipment and room/area locations.

2. The Record Wiring Diagrams shall be in hard copy and two compact disk (CD) copies properly formatted to match the Facility's current operating version of Computer Aided Drafting (AutoCAD) system. The COR shall verify and inform the Contractor of the version of AutoCAD being used by the Facility.

## **PART 2 - PRODUCTS**

### **2.1 EQUIPMENT AND MATERIALS**

#### **A. System Requirements:**

1. The System shall provide the following minimum services that are designed in accordance with and supported by an Original Equipment Manufacturer (OEM), and as specified herein. System shall provide continuous voice and data, service. System shall be capacity sized so that loss of connectivity to external telephone systems shall not affect Facilities operation in specific designated locations. System shall:
  - a. Be capable of inter-connecting and functioning fully with the existing Local Telephone Exchange (LEC) Network(s), Federal Telephone System (FTS) Inter-city Network(s), Inter-exchange Carriers, Integrated Services Digital Network (ISDN), Electronic Private Branch Exchange (EPBX) switches, asynchronous/synchronous data terminals and circuits including Automatic Transfer Mode (ATM), Frame Relay, and local area networks (LAN), at a minimum.
  - b. Be a voice and data cable distribution system that is based on a physical "Star" Topology.
  - c. Be compatible with and able to provide direct digital connection to trunk level equipment including, but, not limited to: directly accessing trunk level equipment including the telephone system, audio paging, Industry Standard "T" and/or "DS" carrier services and external protocol converters. Additionally, connections to "T" and/or "DS" access/equipment or Customer Service Units (CSU) that are used in FTS and other trunk applications shall be included in the System design. Provide T-1 access/equipment (or CSU), as required for use, in FTS and other trunk applications by system design if this equipment is not provided by the existing telephone system and/or will be deactivated by the installation of the System. The

Contractor shall provide all T-1 equipment necessary to terminate and make operational the quantity of circuits designated. The CSU's shall be connected to the System's emergency battery power supply. The System shall be fully capable of operating in the Industry Standard "DS" protocol and provide that service when required.

B. System Performance:

1. At a minimum, the System shall be able to support the following voice and data operations for Category 6 Certified Telecommunication Service:
  - a. Provide the following interchange (or interface) capabilities:
    - 1) Basic Rate (BRI).
    - 2) Primary Rate (PRI).
  - b. ISDN measured at new rack in room 3B-162.:
    - 1) Narrow Band BRI:
      - a) B Channel: 64 kilo-Bits per second (kBps), minimum.
      - b) D Channel: 16 kBps, minimum.
      - c) H Channel: 384 kBps, minimum.
    - 2) Narrow Band PRI:
      - a) B Channel: 64 kBps, minimum.
      - b) D Channel: 64 kBps, minimum.
      - c) H Channel: 1,920 kBps, minimum.
    - 3) Wide (or Broad) Band:
      - a) All channels: 140 mega (m)-Bps, minimum, capable to 565 mBps at "T" reference.
  - c. ATM operation and interface: ATM 155 mBps measured at new rack in room 3B-162.
  - d. Frame Relay: All stated compliance's measured at at new rack in room 3B-162.
  - e. Integrated Data Communications Utility (IDCU) operation and interface: Measured at new rack in room 3B-162..
  - f. Government Open Systems Interconnection Profile (GOSSIP) compliant: Measured at new rack in room 3B-162..
  - g. Fiberoptic Distributed Data Interface (FDDI): A minimum 100 mBps to a maximum of 1.8 giga(g)-Bps data bit stream speed measured at new rack in room 3B-162.. (shall be Synchronous Optical Network [Sonet] compliant).

- h. System Sensitivity: Satisfactory service shall be provided for at least 3,000 feet for all voice and data locations.
- 2. At a minimum the System shall support the following operating parameters:
  - a. EPBX connection:
    - 1) System speed: 1.0 gBps per second, minimum.
    - 2) Impedance: 600 Ohms.
    - 3) Cross Modulation: -60 deci-Bel (dB).
    - 4) Hum Modulation: -55 Db.
    - 5) System data error: 10 to the -10 Bps, minimum loss measured at the frame output with reference Zero (0) deciBel measured (dBm) at 1,000 Hertz (Hz) applied to the frame input.
      - a) Trunk to station: 1.5 dB, maximum.
      - b) Station to station: 3.0 dB, maximum.
      - c) Internal switch crosstalk: -60 dB when a signal of  $\pm 10$  deciBel measured (dBm), 500-2,500 Hz range is applied to the primary path.
      - d) Idle channel noise: 25 dBm "C" or 3.0 dBm "O" above reference (terminated) ground noise, whichever is greater.
    - e) Traffic Grade of Service for Voice and Data:
      - (1) A minimum grade of service of P-01 with an average traffic load of 7.0 CCS per station per hour and a traffic overload in the data circuits will not interfere with, or degrade, the voice service.
      - (2) Average CCS per voice station: The average CCS capacity per voice station shall be maintained at 7.0 CCS when the EPBX is expanded up to the projected maximum growth as stated herein.
  - b. Telecommunications Outlet (TCO):
    - 1) Voice:
      - a) Isolation (outlet-outlet): 24 dB.
      - b) Impedance: 600 Ohms, balanced (BAL).
      - c) Signal Level: 0 deciBel per mili-Volt (dBmV)  $\pm 0.1$  dBmV.
      - d) System speed: 100 mBps, minimum.
      - e) System data error: 10 to the -6 Bps, minimum.
    - 2) Data:
      - a) Isolation (outlet-outlet): 24 dB.



- b) Impedance: 600 Ohms, BAL.
- c) Signal Level: 0 dBmV  $\pm$  0.1 dBmV.
- d) System speed: 120 mBps, minimum.
- e) System data error: 10 to the -8 Bps, minimum.

C. General:

1. All equipment to be supplied under this specification shall be new and the current model of a standard product of an OEM or record. An OEM of record shall be defined as a company whose main occupation is the manufacture for sale of the items of equipment supplied and which:
  - a. Maintains a stock of replacement parts for the item submitted.
  - b. Maintains engineering drawings, specifications, and operating manuals for the items submitted.
  - c. Has published and distributed descriptive literature and equipment specifications on the items of equipment submitted at least 30 days prior to the Invitation for Bid.
2. Specifications of equipment as set forth in this document are minimum requirements, unless otherwise stated, and shall not be construed as limiting the overall quality, quantity, or performance characteristics of items furnished in the System. When the Contractor furnishes an item of equipment for which there is a specification contained herein, the item of equipment shall meet or exceed the specification for that item of equipment.
3. The Contractor shall provide written verification, in writing to the COR at time of installation, that the type of wire/cable being provided is recommended and approved by the OEM. The Contractor is responsible for providing the proper size and type of cable duct and/or conduit and wiring even though the actual installation may be by another subcontractor.
4. The Telephone Contractor is responsible for providing interfacing cable connections for the telephone and PA systems with the System.
5. The telephone equipment and PA interface shall be the interface points for connection of the PA interface cabling from the telephone switch via the system telephone interface unit.
6. Active electronic component equipment shall consist of solid state components, be rated for continuous duty service, comply with the

requirements of FCC standards for telephone equipment, systems, and service.

7. All passive distribution equipment shall meet or exceed -80 dB radiation shielding specifications.
8. All interconnecting twisted pair, fiber-optic cables shall be terminated on equipment terminal boards, punch blocks, breakout boxes, splice blocks, and unused equipment ports/taps shall be terminated according to the OEM's instructions for telephone cable systems without adapters. The Contractor shall not leave unused or spare twisted pair wire, fiber-optic cable unterminated, unconnected, loose or unsecured.
9. Color code all distribution wiring to conform to the Telephone Industry standard, EIA/TIA, and this document, which ever is the more stringent. At a minimum, all equipment, cable duct and/or conduit, enclosures, wiring, terminals, and cables shall be clearly and permanently labeled according to and using the provided record drawings, to facilitate installation and maintenance. Reference Specification Section 27 10 00, STRUCTURED CABLING.
10. Connect the System's primary input AC power to the Facility's Critical Branch of the Emergency AC power distribution system as shown on the plans or if not shown on the plans consult with COR regarding a suitable circuit location prior to bidding.
11. Plug-in connectors shall be provided to connect all equipment, except coaxial cables and interface points. Coaxial cable distribution points and RF transmission lines shall use coaxial cable connections recommended by the cable OEM and approved by the System OEM. Base- band cable systems shall utilize barrier terminal screw type connectors, at a minimum. Crimp type connectors installed with a ratchet type installation tool are and acceptable alternate as long as the cable dress, pairs, shielding, grounding, and connections and labeling are provided the same as the barrier terminal strip connectors. Tape of any type, wire nuts, or solder type connections are unacceptable and will not be approved.
12. All equipment faceplates utilized in the System shall be stainless steel, anodized aluminum, or UL approved cycolac plastic for the areas where provided.

13. Noise filters and surge protectors shall be provided for each equipment interface cabinet, switch equipment cabinet, control console, local, and remote active equipment locations to ensure protection from input primary AC power surges and noise glitches are not induced into low Voltage data circuits.

D. Equipment Functional Characteristics:

FUNCTIONS	CHARACTERISTICS
Input Voltage	105 to 130 VAC
POWER LINE FREQUENCY	60 HZ $\pm$ 2.0 HZ
Operating Temperature	0 to 50 degrees (°) Centigrade (C)
Humidity	80 percent (%) minimum rating

E. Equipment Standards and Testing:

1. The System has been defined herein as connected to systems identified as Critical Care performing Life Support Functions. Therefore, at a minimum, the system shall conform to all aforementioned National and/or Local Life Safety Codes (which ever are the more stringent), NFPA, NEC, this specification, JCAHCO Life Safety Accreditation requirements, and the OEM recommendations, instructions, and guidelines.
2. All supplies and materials shall be listed, labeled or certified by UL or a nationally recognized testing laboratory where such standards have been established for the supplies, materials or equipment. See paragraph minimum requirements Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS, and the guidelines listed in paragraph 2.J.2.
3. The provided active and passive equipment required by the System design and approved technical submittal must conform with each UL standard in effect for the equipment, as of the date of the technical submittal (or the date when the COR approved system equipment necessary to be replaced) was technically reviewed and approved by VA. Where a UL standard is in existence for equipment to be used in completion of this contract, the equipment must bear the approved UL seal.
4. Each item of electronic equipment to be provided under this contract must bear the approved UL seal or the seal of the testing laboratory

that warrants the equipment has been tested in accordance with, and conforms to the specified standards.

## 2.2 EQUIPMENT ITEMS

### A. Stand Alone Equipment Rack:

1. The rack shall be constructed of heavy 16 gauge cold rolled steel and have fully adjustable equipment front mounting rails that allows front panel equipment mounting and access. It shall have baked-on iron phosphate primer and baked enamel paint finish in a color to be selected by the using Facility Service Chief or the RE. It shall be floor or wall mounted or mounted on casters as directed by the RE.
2. Technical Characteristics:

Overall Height	2180 mm (85 7/8in.), maximum
Overall Depth	650 mm (25 1/2in.), maximum
Overall Width	535 mm (21 1/16in.), maximum
Front Panel Opening	480 mm (19in.), EIA horizontal width
Hole Spacing	per EIA and Industry Standards

### B. Cross-Connection System (CCS) Equipment Breakout, Termination Connector (or Bulkhead), and Patch Panels:

1. The connector panel(s) shall be made of flat smooth 3.175 mm (1/8 in.) thick solid aluminum, custom designed, fitted and installed in the cabinet. Bulkhead equipment connectors shall be mounted on the panel to enable all cabinet equipment's signal, control, and coaxial cables to be connected through the panel. Each panel shall be color matched to the cabinet installed.

#### a. Voice (or Telephone):

- 1) The CSS for voice or telephone service shall be Industry Standard type 110 (minimum) punch blocks for voice or telephone, and control wiring in lieu of patch panels, each being certified for category six service. IDC punch blocks (with internal RJ45 jacks) are acceptable for use in all CCS and shall be specifically designed for category six telecommunications service and the size and type of UTP cable used as described herein. As a minimum, punch block strips shall be secured to an OEM designed physical anchoring unit on a wall location in the MTC, IMTC, RTC, and TC. However, console, cabinet, rail, panel, etc. mounting is allowed at the OEM recommendation and as approved by the RE. Punch blocks shall not be used for Class II or 120 VAC power wiring.

2) Technical Characteristics:

Number of horizontal rows	100, MINIMUM
Number of terminals per row	4, minimum
Terminal protector	required for each used or unused terminal
Insulation splicing	required between each row of terminals

b. Digital or High Speed Data:

- 1) The CSS for digital or high-speed data service shall be a patch panel with modular female RJ45 jacks installed in rows. Patch panels and RJ45 jacks shall be specifically designed for category six telecommunications service and the size and type of UTP or STP cable used. Each panel shall be 480 mm (19in.) horizontal EIA rack mountable dimensions with EIA standard spaced vertical mounting holes.

2) Technical Characteristics:

Number of horizontal rows	2, minimum
Number of jacks per row	24, MINIMUM
Type of jacks	RJ45
Terminal protector	required for each used or unused jack
Insulation	required between each row of jacks

c. Fiber optic:

- 1) Product reference of a Government Approved (US State Department) type is Telewire, PUP-17 with pre-punched chassis mounting holes arranged in two horizontal rows. This panel may be used for fiber optic, audio, control cable, and Class II Low Voltage Wiring installations when provided with the proper connectors. This panel is not allowed to be used for 120 VAC power connections.

2) Technical Characteristics:

Height	Two rack units (RUs), 88 mm (3.5in.) minimum
Width	484 mm (19 1/16in.), EIA minimum
Number of	12 pairs, minimum

connections	
Connectors	
Audio Service	Use RCA 6.35 mm (1/4in.) Phono, XL or Barrier Strips, surface mounted with spade lugs (punch block or wire wrap type strips are acceptable alternates for barrier strips as long as system design is maintained and COR approved)
Control Signal Service	Barrier strips surface mounted with spade lugs (punch block or wire wrap type strips are acceptable alternates for barrier strips as long as system design is maintained and COR approved)
Low voltage power (class II)	Barrier strips with spade lugs and clear full length plastic cover, surfaced mounted
Fiber optic	"ST" Stainless steel, female

d. Mounting Strips and Blocks:

- 1) Barrier Strips: Barrier strips are approved for AC power, data, voice, and control cable or wires. Barrier strips shall accommodate the size and type of audio spade (or fork type) lugs used with insulating and separating strips between the terminals for securing separate wires in a neat and orderly fashion. Each cable or wire end shall be provided with an audio spade lug, which is connected to an individual screw terminal on the barrier strip. The barrier strips shall be surface secured to a console, cabinet, rail, panel, etc. 120 VAC power wires shall not be connected to signal barrier strips.

2) Technical Characteristics:

Terminal size	6-32, minimum
Terminal Count	ANY COMBINATION
Wire size	20 AWG, minimum
Voltage handling	100 V, minimum
Protective connector cover	Required for Class II and 120 VAC power connections

2. Solderless Connectors: The connectors (or fork connectors) shall be crimp-on insulated lug to fit a 6-32 minimum screw terminal. The

fork connector shall be installed using a standard lug-crimping tool.

3. Punch Blocks: As a minimum, Industry Standard 110 type punch blocks are approved for data, voice, and control wiring. Punch blocks shall be specifically designed for the size and type of wire used. Punch block strips shall be secured to a console, cabinet, rail, panel, etc. Punch blocks shall not be used for Class II or 120 VAC power wiring.
4. Wire Wrap Strips: Industry Standard wire wrap strips (16.5 mm (0.065in.) wire wrap minimum) are approved for data, voice and control wiring. Wire wrap strips shall be secured to a cabinet, rail, panel, etc. Wire wrap strips shall not be used for Class II or 120 VAC power wiring.

C. Wire Management System and Equipment:

1. Wire Management System: The system(s) shall be provided as the management center of the respective cable system, CCS, and TC it is incorporated. It shall perform as a platform to house peripheral equipment in a standard relay rack or equipment cabinet. It shall be arranged in a manner as to provide convenient access to all installed management and other equipment. All cables and connections shall be at the rear of each system interface to IDC and/or patch panels, punch blocks, wire wrap strips, and/or barrier strip.
2. Wire Management Equipment: The wire management equipment shall be the focal point of each wire management system. It shall provide an orderly interface between outside and inside wires and cables (where used), distribution and interface wires and cables, interconnection wires and cables and associated equipment, jumper cables, and provide a uniform connection media for all system fire retardant wires and cables and other subsystems. It shall be fully compatible and interface to each cable tray, duct, wireway, or conduit used in the system. All interconnection or distribution wires and cables shall enter the system at the top (or from a wireway in the floor) via a overhead protection system and be uniformly routed down either side (or both at the same time) of the frames side protection system then laterally via a anchoring or routing shelf for termination on the rear of each respective terminating assembly. Each system shall be custom configured to meet the System design and user needs.

### **2.3 ENVIRONMENTAL REQUIREMENTS**

Technical submittals shall identify the environmental specifications for housing the system. These environmental specifications shall identify the requirements for initial and expanded system configurations for:

- A. Floor loading for batteries and cabinets.
- B. Minimum floor space and ceiling heights.
- C. Minimum size of doors for equipment passage.
- D. Power requirements: The bidders shall provide the specific voltage, amperage, phases, and quantities of circuits required.

### **2.4 INSTALLATION KIT**

The kit shall be provided that, at a minimum, includes all connectors and terminals, labeling systems, audio spade lugs, barrier strips, punch blocks or wire wrap terminals, heat shrink tubing, cable ties, solder, hangers, clamps, bolts, conduit, cable duct, and/or cable tray, etc., required to accomplish a neat and secure installation. All wires shall terminate in a spade lug and barrier strip, wire wrap terminal or punch block. Unfinished or unlabeled wire connections shall not be allowed. Turn over to the COR all unused and partially opened installation kit boxes, coaxial, fiberoptic, and twisted pair cable reels, conduit, cable tray, and/or cable duct bundles, wire rolls, physical installation hardware. The following are the minimum required installation sub-kits:

- A. System Grounding:
  - 1. The grounding kit shall include all cable and installation hardware required. All radio equipment shall be connected to earth ground via internal building wiring, according to the NEC.
  - 2. This includes, but is not limited to:
    - a. Coaxial Cable Shields.
    - b. Control Cable Shields.
    - c. Data Cable Shields.
    - d. Equipment Racks.
    - e. Equipment Cabinets.
    - f. Conduits.
    - g. Duct.
    - h. Cable Trays.
    - i. Power Panels.
    - j. Connector Panels.



k. Grounding Blocks.

- B. Coaxial Cable: The coaxial cable kit shall include all coaxial connectors, cable tying straps, heat shrink tabbing, hangers, clamps, etc., required to accomplish a neat and secure installation.
- C. Wire and Cable: The wire and cable kit shall include all connectors and terminals, audio spade lugs, barrier straps, punch blocks, wire wrap strips, heat shrink tubing, tie wraps, solder, hangers, clamps, labels etc., required to accomplish a neat and orderly installation.
- D. Conduit, Cable Duct, and Cable Tray: The kit shall include all conduit, duct, trays, junction boxes, back boxes, cover plates, feed through nipples, hangers, clamps, other hardware required to accomplish a neat and secure conduit, cable duct, and/or cable tray installation in accordance with the NEC and this document.
- E. Equipment Interface: The equipment kit shall include any item or quantity of equipment, cable, mounting hardware and materials needed to interface the systems with the identified sub-system(s) according to the OEM requirements and this document.
- F. Labels: The labeling kit shall include any item or quantity of labels, tools, stencils, and materials needed to completely and correctly label each subsystem according to the OEM requirements, as-installed drawings, and this document.
- G. Documentation: The documentation kit shall include any item or quantity of items, computer discs, as installed drawings, equipment, maintenance, and operation manuals, and OEM materials needed to completely and correctly provide the system documentation as required by this document and explained herein.

**PART 3 - EXECUTION**

**3.1 INSTALLATION**

- A. Product Delivery, Storage and Handling:
  - 1. Delivery: Deliver materials to the job site in OEM's original unopened containers, clearly labeled with the OEM's name and equipment catalog numbers, model and serial identification numbers. The COR may inventory the cable, patch panels, and related equipment.
  - 2. Storage and Handling: Store and protect equipment in a manner, which will preclude damage as directed by the COR.
- B. System Installation:

1. After the contract's been awarded, and within the time period specified in the contract, the Contractor shall deliver the total system in a manner that fully complies with the requirements of this specification. The Contractor shall make no substitutions or changes in the System without written approval from the COR and PM.
2. The Contractor shall install all equipment and systems in a manner that complies with accepted industry standards of good practice, OEM instructions, the requirements of this specification, and in a manner which does not constitute a safety hazard. The Contractor shall insure that all installation personnel understands and complies with all the requirements of this specification.
3. The Contractor shall install suitable filters, traps, directional couplers, splitters, TC's, and pads for minimizing interference and for balancing the System. Items used for balancing and minimizing interference shall be able to pass telephone and data signals in the frequency bands selected, in the direction specified, with low loss, and high isolation, and with minimal delay of specified frequencies and signals. The Contractor shall provide all equipment necessary to meet the requirements of Paragraph 2.1.C and the System performance standards.
4. All passive equipment shall be connected according to the OEM's specifications to insure future correct termination, isolation, impedance match, and signal level balance at each telephone/data outlet.
5. Where TCOs are installed adjacent to each other, install one outlet for each instrument.
6. All lines shall be terminated in a suitable manner to facilitate future expansion of the System. There shall be a minimum of one spare 25 pair cable at each distribution point on each floor.
7. All vertical copper and fiber optic cables shall be terminated so any future changes only requires modifications of the EPBX or signal closet equipment only.
8. Terminating resistors or devices shall be used to terminate all unused branches, outlets, equipment ports of the System, and shall be devices designed for the purpose of terminating fiber optic or twisted pair cables carrying telephone and data systems.

C. Conduit and Signal Ducts:

1. Conduit:

- a. The Contractor shall employ the latest installation practices and materials. The Contractor shall provide conduit, junction boxes, connectors, sleeves, weatherheads, pitch pockets, and associated sealing materials not specifically identified in this document as GFE. Conduit penetrations of walls, ceilings, floors, interstitial space, fire barriers, etc., shall be sleeved and sealed. The minimum conduit size shall be 19 mm (3/4 in.).
- b. All cables shall be installed in separate conduit and/or signal ducts (exception from the separate conduit requirement to allow telephone cables to be installed in partitioned cable tray with data cables may be granted in writing by the COR if requested.) Conduits shall be provided in accordance with Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and NEC Articles 517 for Critical Care and 800 for Communications systems, at a minimum.
- c. When metal, plastic covered, etc., flexible cable protective armor or systems are specifically authorized to be provided for use in the System, their installation guidelines and standards shall be as specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.
- d. When "innerduct" flexible cable protective systems is specifically authorized to be provided for use in the System, it's installation guidelines and standards shall be as the specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.
- e. Conduit (including GFE) fill shall not exceed 40%. Each conduit end shall be equipped with a protective insulator or sleeve to cover the conduit end, connection nut or clamp, to protect the wire or cable during installation and remaining in the conduit. Electrical power conduit shall be installed in accordance with the NEC. AC power conduit shall be run separate from signal conduit.
- f. When metal, plastic covered, etc., flexible cable protective armor or systems are specifically authorized to be provided for use in the System, their installation guidelines and standards

shall be as specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.

- g. Ensure that Critical Care Nurse Call , and PA , Systems (as identified by NEC Section 517) are completely separated and protected from all other systems.
2. Signal Duct, Cable Duct, or Cable Tray:
- a. The Contractor shall use existing signal duct, cable duct, and/or cable tray, when identified and approved by the COR.
  - b. Approved signal and/or cable duct shall be a minimum size of 100 mm x 100 mm (4 in. X 4 in.) inside diameter with removable tops or sides, as appropriate. Protective sleeves, guides or barriers are required on all sharp corners, openings, anchors, bolts or screw ends, junction, interface and connection points.
  - c. Approved cable tray shall be fully covered, mechanically and physically partitioned for multiple electronic circuit use, and be UL certified and labeled for use with telecommunication circuits and/or systems. The COR shall approve width and height dimensions.
- F. Connectors: Circuits, transmission lines, and signal extensions shall have continuity, correct connection and polarity. A uniform polarity shall be maintained between all points in the system.
1. Wires:
- a. Wire ends shall be neatly formed and where insulation has been cut, heat shrink tubing shall be employed to secure the insulation on each wire. Tape of any type is not acceptable.
  - b. Audio spade lugs shall be installed on each wire (including spare or unused) end and connect to screw terminals of appropriate size barrier strips. AC barrier strips shall be provided with a protective cover to prevent accidental contact with wires carrying live AC current. Punch blocks are approved for signal, not AC wires. Wire Nut or "Scotch Lock" connectors are not acceptable for signal wire installation.
2. Cables: Each connector shall be designed for the specific size cable being used and installed with the OEM's approved installation tool. Typical system cable connectors include; but, are not limited to: Audio spade lug, punch block, wirewrap, etc.

3. Line or Microphone Audio: Each connector shall be installed according to the cable or connector OEM's instructions and use the OEM's approved installation tool. Install the connector's to provide and maintain the following audio signal polarity:
  - a. XLR type connectors Signal or positive conductor is pin 3; common or neutral conductor is pin 2; ground conductor is pin 1.
  - b. Two and 3 conductor 1/4" Signal or positive conductor is tip; neutral or 1/8" phono plugs conductor is ring and ground or shield and jacks conductor is sleeve.
  - c. RCA Phono Plugs the Signal or positive conductor is tip; and Jacks neutral or shield conductor is sleeve.

4. Speaker Line Audio:
  - a. Each connector shall be installed according to the cable, transformer or speaker OEM instructions and using the OEM's approved installation tool. The Contractor shall ensure each speaker is properly phased and connected in the same manner throughout the System using two conductor type wires.
  - b. One of the conductors shall be color coded to aid in establishing speaker signal polarity. Each speaker line shall be permanently soldered or audio spade lug connected to each appropriate speaker or line matching transformer connection terminal. Speaker line connection to each audio amplifier shall use audio spade lugs, as described herein.

G. AC Power: AC power wiring shall be run separately from signal cable.

H. Grounding:

1. General: The Contractor shall ground all Contractor Installed Equipment and identified Government Furnished Equipment to eliminate all shock hazards and to minimize, to the maximum extent possible, all ground loops, common mode returns, noise pickup, crosstalk, etc. The total ground resistance shall be 0.1 Ohm or less.
  - a. The Contractor shall install lightning arrestors and grounding in accordance with the NFPA and this specification.
  - b. Under no conditions shall the AC neutral, either in a power panel or in a receptacle outlet, be used for system control, subcarrier or audio reference ground.
  - c. The use of conduit, signal duct or cable trays as system or electrical ground is not acceptable and will not be permitted.

These items may be used only for the dissipation of internally generated static charges (not to be confused with externally generated lightning) that may applied or generated outside the mechanical and/or physical confines of the System to earth ground. The discovery of improper system grounding shall be grounds to declare the System unacceptable and the termination of all system acceptance testing.

2. Cabinet Buss: A common ground buss of at least #10 AWG solid copper wire shall extend throughout each equipment cabinet and be connected to the system ground. Provide a separate isolated ground connection from each equipment cabinet ground buss to the system ground. Do not tie equipment ground busses together.
3. Equipment: Equipment shall be bonded to the cabinet bus with copper braid equivalent to at least #12 AWG. Self grounding equipment enclosures, racks or cabinets, that provide OEM certified functional ground connections through physical contact with installed equipment, are acceptable alternates.
4. Cable Shields: Cable shields shall be bonded to the cabinet ground buss with #12 AWG minimum stranded copper wire at only one end of the cable run. Cable shields shall be insulated from each other, faceplates, equipment racks, consoles, enclosures or cabinets; except, at the system common ground point. Coaxial and audio cables, shall have one ground connection at the source; in all cases, cable shield ground connections shall be kept to a minimum.

I. Equipment Assembly:

1. Cabinets:

- a. Each enclosure shall be: floor or wall mounted with standard knockout holes for conduit connections or cable entrance; provide for ventilation of the equipment; have front and rear locking doors (except wall mounted cabinets that require only a front locking door); power outlet strip(s), and connector or patch panel(s).
- b. Rack (including freestanding radio relay) mounted equipment shall be installed in the enclosure's equipment adjustable mounting racks with equipment normally requiring adjustment or observation mounted so operational adjustment(s) can be conveniently made. Heavy equipment shall be mounted with rack slides or rails

allowing servicing from the front of the enclosure. Heavy equipment shall not depend only upon front panel mounting screws for support. Equipment shall be provided with sufficient cable slack to permit servicing by removal of the installed equipment from the front of the enclosure. A color matched blank panel (spacer) of 44 mm (1.75 in.) high, shall be installed between each piece of equipment (active or passive) to insure adequate air circulation. The enclosure shall be designed for efficient equipment cooling and air ventilation. Each console or cabinet shall be equipped with a quiet fan and nondisposable air filter.

- c. Enclosures and racks shall be installed plumb and square. Each shall be permanently attached to the building structure and held firmly in place. Fifteen inches of front vertical space opening shall be provided for additional equipment.
- d. Signal connector, patch, and bulkhead panels (i.e.: audio, data, control, analog video, etc.) shall be connected so that outputs from each source, device or system component shall enter the panel at the top row of jacks, beginning left to right as viewed from the front, which will be called "inputs". Each connection to a load, device or system component shall exit the panel at the bottom row of jacks, beginning left to right as viewed from the front, which will be called "outputs".
  - 1) Equipment located indoors shall be installed in metal racks or enclosures with hinged doors to allow access for maintenance without causing interference to other nearby equipment.
  - 2) Cables shall enter the equipment racks or enclosures in such a manner that allows all doors or access panels to open and close without disturbing or damaging the cables.
  - 3) All distribution hardware shall be securely mounted in a manner that allows access to the connections for testing and provides sufficient room for the doors or access panels to open and close without disturbing the cables.
- J. Labeling: Provide labeling in accordance with ANSI/EIA/TIA-606-A. All lettering for voice and data circuits shall be stenciled using laser printers. Handwritten labels are not acceptable.
  - 1. Cable and Wires (Hereinafter referred to as "Cable"): Cables shall be labeled at both ends in accordance with ANSI/EIA/TIA-606-A.

Labels shall be permanent in contrasting colors. Cables shall be identified according to the System "Record Wiring Diagrams".

2. Equipment: System equipment shall be permanently labeled with contrasting plastic laminate or bakelite material. System equipment shall be labeled on the face of the unit corresponding to its source.
3. Conduit, Cable Duct, and/or Cable Tray: The Contractor shall label all conduit, duct and tray, including utilized GFE, with permanent marking devices or spray painted stenciling a minimum of 3 meters (10 ft.) identifying it as the System. In addition, each enclosure shall be labeled according to this standard.
4. Termination Hardware: The Contractor shall label workstation outlets and patch panel connections using color coded labels with identifiers in accordance with ANSI/EIA/TIA-606-A and the "Record Wiring Diagrams".

### **3.2 TESTS**

#### **A. Pretesting:**

1. Upon completing the installation of the System, the Contractor shall align and balance the system. The Contractor shall pretest the entire system.
2. Pretesting Procedure:
  - a. During the system pretest, the Contractor shall verify (utilizing the approved spectrum analyzer and test equipment) that the System is fully operational and meets all the system performance requirements of this standard.
  - b. The Contractor shall pretest and verify that all System functions and specification requirements are met and operational, no unwanted aural effects, such as signal distortion, noise pulses, glitches, audio hum, poling noise, etc. are present. The Contractor shall measure and record the aural carrier levels of each system telephone and data channel, at each of the following points in the system:
    - 1) Local Telephone Company Interfaces or Inputs.
    - 2) EPBX interfaces or inputs and outputs.
    - 3) MDF interfaces or inputs and outputs.
    - 4) EPBX output S/NR for each telephone and data channel.



5) Signal Level at each interface point to the distribution system, the last outlet on each trunk line plus all outlets installed as part of this contract.

3. The Contractor shall provide four (4) copies of the recorded system pretest measurements and the written certification that the System is ready for the formal acceptance test shall be submitted to the RE.

B. Acceptance Test:

1. After the System has been pretested and the Contractor has submitted the pretest results and certification to the RE, then the Contractor shall schedule an acceptance test date and give the COR 30 days written notice prior to the date the acceptance test is expected to begin. The System shall be tested in the presence of a Government Representative and an OEM certified representative. The System shall be tested utilizing the approved test equipment to certify proof of performance and Life Safety compliance. The test shall verify that the total System meets the requirements of this specification. The notification of the acceptance test shall include the expected length (in time) of the test.

C. Performance Testing:

1. Perform Category 6 tests in accordance with ANSI/EIA/TIA-568-B.1 and ANSI/EIA/TIA-568-B.2. Test shall include the following: wire map, length, insertion loss, return loss, NEXT, PSNEXT, ELFEXT, PSELFEXT, propagation delay and delay skew.
2. Fiber Optic Links: Perform end-to-end fiber optic cable link tests in accordance with ANSI/EIA/TIA-568-B.3.

D. Total System Acceptance Test: The Contractor shall perform verification tests for UTP copper cabling system(s) and the single mode fiber optic cabling system(s) after the complete telecommunication distribution system and workstation outlet are installed.

1. Voice Testing: Connect to the network interface device at the demarcation point. Go off-hook and receive dial tone from the LEC. If a test number is available, place and receive a local, long distance, and FTS telephone call.
2. Data Testing: Connect to the network interface device at the demarcation point. Log onto the network to ensure proper connection to the network is achieved.

### **3.3 TRAINING**

- A. Furnish the services of a factory-trained engineer or technician for a total of two four hour classes to instruct designated Facility IRM personnel. Instruction shall include cross connection, corrective, and preventive maintenance of the System and equipment.
- B. Before the System can be accepted by the VA, this training must be accomplished. Training will be scheduled at the convenience of the Facilities Contracting Officer and Chief of Engineering Service.

### **3.4 WARRANTY**

- A. Comply with FAR clause 52.246-21, except that warranty shall be as follows:
  - 1. The Contractor shall warranty that all installed material and equipment will be free from defects, workmanship, and will remain so for a period of one year from date of final acceptance of the System by the VA. The Contractor shall provide OEM's equipment warranty documents, to the COR, that certifies each item of equipment installed conforms to OEM published specifications.
  - 2. The Contractor's maintenance personnel shall have the ability to contact the Contractor and OEM for emergency maintenance and logistic assistance, remote diagnostic testing, and assistance in resolving technical problems at any time. The Contractor and OEM shall provide this contact capability at no additional cost to the VA.
  - 3. All Contractor installation, maintenance, and supervisor personnel shall be fully qualified by the OEM and must provide two (2) copies of current and qualified OEM training certificates and OEM certification upon request.
  - 4. Additionally, the Contractor shall accomplish the following minimum requirements during the one year warranty period:
    - a. Response Time:
      - 1) The COR is the Contractor's reporting and contact officials for the System trouble calls, during the guarantee period.
      - 2) A standard workweek is considered 8:00 A.M. to 5:00 P.M., Monday through Friday exclusive of Federal Holidays.
      - 3) The Contractor shall respond and correct on-site trouble calls, during the standard work week to:

- a) A routine trouble call within one working days of its report. A routine trouble is considered a trouble which causes a system outlet, station, or patch cord to be inoperable.
  - b) An emergency trouble call within 6 hours of its report. An emergency trouble is considered a trouble which causes a subsystem or distribution point to be inoperable at anytime. Additionally, the loss of a minimum of 50 station or system lines shall be deemed as this type of a trouble call.
- 4) The Contractor shall respond on-site to a catastrophic trouble call within 4 hours of its report. A catastrophic trouble call is considered total system failure.
- a) If a system failure cannot be corrected within four hours (exclusive of the standard work time limits), the Contractor shall be responsible for providing alternate system CSS or TCO equipment, or cables. The alternate equipment and/or cables shall be operational within four hours after the four hour trouble shooting time.
  - b) Routine or emergency trouble calls in critical emergency health care facilities (i.e., cardiac arrest, intensive care units, etc.) shall also be deemed as a catastrophic trouble call if so determined by the COR. The COR shall notify the Contractor of this type of trouble call at the direction of the Facilities Director.
- b. Required on-site visits during the one year warranty period
- 1) The Contractor shall visit, on-site, for a minimum of eight hours, once every 12 weeks, during the guarantee period, to perform system preventive maintenance, equipment cleaning, and operational adjustments to maintain the System according the descriptions identified in this SPEC.
    - a) The Contractor shall arrange all Facility visits with the COR prior to performing the required maintenance visits.
    - b) The Contractor in accordance with the OEM's recommended practice and service intervals shall perform preventive maintenance during a non-busy time agreed to by the COR and the Contractor.

- c) The preventive maintenance schedule, functions and reports shall be provided to and approved by the COR.
  - 2) The Contractor shall provide the COR a type written report itemizing each deficiency found and the corrective action performed during each required visit or official reported trouble call. The Contractor shall provide the COR with sample copies of these reports for review and approval at the beginning of the Total System Acceptance Test. The following reports are the minimum required:
    - a) Monthly Report: The Contractor shall provide a monthly summary all equipment and sub-systems serviced during this guarantee period to COR by the fifth working day after the end of each month. The report shall clearly and concisely describe the services rendered, parts replaced and repairs performed. The report shall prescribe anticipated future needs of the equipment and Systems for preventive and predictive maintenance
    - b) Contractor Log: The Contractor shall maintain a separate log entry for each item of equipment and each sub-system of the System. The log shall list dates and times of all scheduled, routine, and emergency calls. Each emergency call shall be described with details of the nature and causes of emergency steps taken to rectify the situation and specific recommendations to avoid such conditions in the future.
  - 3) The COR shall provide the Facility Engineering Officer, two (2) copies of actual reports for evaluation.
    - a) The COR shall ensure copies of these reports are entered into the System's official acquisition documents.
    - b) The Facilities Chief Engineer shall ensure copies of these reports are entered into the System's official technical as-installed documents.
- B. Work Not Included: Maintenance and repair service shall not include the performance of any work due to improper use, accidents, other vendor, contractor, owner tampering or negligence, for which the Contractor is not directly responsible and does not control. The Contractor shall immediately notify the COR in writing upon the discovery of these

incidents. The COR will investigate all reported incidents and render findings concerning any Contractor's responsibility.

- - - E N D - - -



**SECTION 27 15 00**  
**COMMUNICATIONS HORIZONTAL CABLING**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This Section specifies the furnishing, installing, certification, testing, and guaranty of a complete and operating Voice and Digital Cable Distribution System (here-in-after referred to as "*the System*"), and associated equipment and hardware to be installed in the VA Medical Center here-in-after referred to as "the Facility". The System shall include, but not be limited to: equipment cabinets, interface enclosures, and relay racks; necessary combiners, traps, and filters; and necessary passive devices such as: splitters, couplers, cable "patch", "punch down", and cross-connector blocks or devices, voice and data distribution sub-systems, and associated hardware. The System shall additionally include, but not be limited to: telecommunication closets (TC); telecommunications outlets (TCO); copper and fiber optic distribution cables, connectors, "patch" cables, and/or "break out" devices.
- B. The System shall be delivered free of engineering, manufacturing, installation, and functional defects. It shall be designed, engineered and installed for ease of operation, maintenance, and testing.
- C. The term "provide", as used herein, shall be defined as: designed, engineered, furnished, installed, certified, and tested, by the Contractor.
- D. The Voice and Digital Telecommunication Distribution Cable Equipment and System provides the media which voice and data information travels over and connects to the Telephone System which is defined as an Emergency Critical Care Communication System by the National Fire Protection Association (NFPA). Therefore, since the System connects to or extends the telephone system, the System's installation and operation shall adhere to all appropriate National, Government, and/or Local Life Safety and/or Support Codes, which ever are the more stringent for this Facility. At a minimum , the System shall be installed according to NFPA, Section 70, National Electrical Code (NEC), Article 517 and Chapter 7; NFPA, Section 99, Health Care Facilities, Chapter 3-4; NFPA, Section 101, Life Safety Code, Chapters 7, 12, and/or 13; Joint Commission on Accreditation of Health Care

Organization (JCAHCO), Manual for Health Care Facilities, all necessary Life Safety and/or Support guidelines; this specification; and the original equipment manufacturer's (OEM) suggested installation design, recommendations, and instructions. The OEM and Contractor shall ensure that all management, sales, engineering, and installation personnel have read and understand the requirements of this specification before the System is designed, engineered, delivered, and provided.

- E. The VA Project Manager (PM) and/or if delegated, Contracting Officers Representative (COR) are the approving authorities for all contractual and mechanical changes to the System. The Contractor is cautioned to obtain in writing, all approvals for system changes relating to the published contract specifications and drawings, from the PM and/or the COR before proceeding with the change.
- F. System Performance:
1. At a minimum, the System shall be able to support the following voice and data operations for Category 6 Certified Telecommunication Service:
    - a. Provide the following interchange (or interface) capabilities:
      - 1) Basic Rate (BRI).
      - 2) Primary Rate (PRI).
    - b. ISDN measured at the new rack in room 3B-162:
      - 1) Narrow Band BRI:
        - a) B Channel: 64 kilo-Bits per second (kBps), minimum.
        - b) D Channel: 16 kBps, minimum.
        - c) H Channel: 384 kBps, minimum.
      - 2) Narrow Band PRI:
        - a) B Channel: 64 kBps, minimum.
        - b) D Channel: 64 kBps, minimum.
        - c) H Channel: 1,920 kBps, minimum.
      - 3) Wide (or Broad) Band: All channels: 140 mega(m)-Bps, minimum, capable to 565 mBps at "T" reference.
    - c. ATM operation and interface: ATM 155 mBps measured at new rack in existing telecom room.
    - d. Frame Relay: All stated compliance's measured at new rack in existing telecom room.
    - e. Integrated Data Communications Utility (IDCU) operation and interface: Measured at new rack in existing telecom room.



- f. Government Open Systems Interconnection Profile (GOSSIP)  
compliant: Measured at new rack in existing telecom room.
  - g. Fiberoptic Distributed Data Interface (FDDI): A minimum 100 mBps  
to a maximum of 1.8 giga(g)-Bps data bit stream speed measured at  
new rack in existing telecom room (shall be Synchronous Optical  
Network [SONET] compliant).
  - h. System Sensitivity: Satisfactory service shall be provided for at  
least 3,000 feet for all voice and data locations.
2. At a minimum the System shall support the following operating  
parameters:
- a. EPBX connection:
    - 1) System speed: 1.0 gBps per second, minimum.
    - 2) Impedance: 600 Ohms.
    - 3) Cross Modulation: -60 deci-Bel (dB).
    - 4) Hum Modulation: -55 dB.
    - 5) System data error: 10 to the -10 Bps, minimum.
    - 6) Loss: Measured at the frame output with reference Zero (0)  
decibel measured (dBm) at 1,000 Hertz (Hz) applied to the  
frame input.
      - a) Trunk to station: 1.5 dB, maximum.
      - b) Station to station: 3.0 dB, maximum.
      - c) Internal switch crosstalk: -60 dB when a signal of  $\pm 10$   
decibel measured (dBm), 500-2,500 Hz range is applied to  
the primary path.
      - d) Idle channel noise: 25 dBm "C" or 3.0 dBm "O" above  
reference (terminated) ground noise, whichever is greater.
    - e) Traffic Grade of Service for Voice and Data:
      - (1) A minimum grade of service of P-01 with an average  
traffic load of 7.0 CCS per station per hour and a traffic  
overload in the data circuits will not interfere with, or  
degrade, the voice service.
      - (2) Average CCS per voice station: The average CCS capacity  
per voice station shall be maintained at 7.0 CCS when the  
EPBX is expanded up to the projected maximum growth as  
stated herein.
  - b. Telecommunications Outlet (TCO):
    - 1) Voice:
      - a) Isolation (outlet-outlet): 24 dB.

- b) Impedance: 600 Ohms, balanced (BAL).
- c) Signal Level: 0 deciBel per mili-Volt (dBmV)  $\pm$  0.1 dBmV.
- d) System speed: 100 mBps, minimum.
- e) System data error: 10 to the -6 Bps, minimum.

2) Data:

- a) Isolation (outlet-outlet): 24 dB.
- b) Impedance: 600 Ohms, BAL.
- c) Signal Level: 0 dBmV  $\pm$  0.1 dBmV.
- d) System speed: 120 mBps, minimum.
- e) System data error: 10 to the -8 Bps, minimum.

**1.2 RELATED WORK**

- A. Specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Specification Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS.
- C. Specification Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS.
- D. Specification Section 27 10 00, STRUCTURED CABLING.
- E. Specification Section 26 27 26, WIRING DEVICES.
- F. Specification Section 27 05 26, GROUNDING AND BONDING FOR COMMUNICATIONS SYSTEMS.
- G. Specification Section 27 51 16, PUBLIC ADDRESS AND MASS NOTIFICATION SYSTEMS.

**1.3 APPLICABLE PUBLICATIONS**

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in text by basic designation only. Except for a specific date given the issue in effect (including amendments, addenda, revisions, supplements, and errata) on the date the system's submittal is technically approved by VA, shall be enforced.
- B. National Fire Protection Association (NFPA):

70	NATIONAL ELECTRICAL CODE (NEC)
75	Protection of Electronic Computer/Data Processing Equipment
77	Recommended Practice on Static Electricity
	Standard for Health Care Facilities
101	Life Safety Code
1221	Emergency Services Communication Systems

C. Underwriters Laboratories, Inc. (UL):

65	Wired Cabinets
96	Lightning Protection Components
96A	INSTALLATION REQUIREMENTS FOR LIGHTNING PROTECTION SYSTEMS
467	Grounding and Bonding Equipment
497/497A/497B	PROTECTORS FOR PAIRED CONDUCTORS/ COMMUNICATIONS CIRCUITS/DATA COMMUNICATIONS AND FIRE ALARM CIRCUITS
884	Underfloor Raceways and Fittings

D. ANSI/EIA/TIA Publications:

568B	Commercial Building Telecommunications Wiring Standard
569B	Commercial Building Standard for Telecommunications Pathways and Spaces
606A	ADMINISTRATION STANDARD FOR THE TELECOMMUNICATIONS INFRASTRUCTURE OF COMMERCIAL BUILDINGS
607A	Grounding and Bonding Requirements for Telecommunications in Commercial Buildings
758	Grounding and Bonding Requirements for Telecommunications in Commercial Buildings

E. Lucent Technologies: Document 900-200-318 "Outside Plant Engineering Handbook".

F. International Telecommunication Union - Telecommunication Standardization Sector (ITU-T).

G. Federal Information Processing Standards (FIPS) Publications.

H. Federal Communications Commission (FCC) Publications: Standards for telephone equipment and systems.

I. United States Air Force: Technical Order 33K-1-100 Test Measurement and Diagnostic Equipment (TMDE) Interval Reference Guide.

J. Joint Commission on Accreditation of Health Care Organization (JCAHO): Comprehensive Accreditation Manual for Hospitals.

K. National and/or Government Life Safety Code(s): The more stringent of each listed code.

#### **1.4 QUALITY ASSURANCE**

- A. The authorized representative of the OEM, shall be responsible for the design, satisfactory total operation of the System, and its certification.
- B. The OEM shall meet the minimum requirements identified in Paragraph 2.1.A. Additionally, the Contractor shall have had experience with three or more installations of systems of comparable size and complexity with regards to coordinating, engineering, testing, certifying, supervising, training, and documentation. Identification of these installations shall be provided as a part of the submittal as identified in Paragraph 1.5.
- C. The System Contractor shall submit certified documentation that they have been an authorized distributor and service organization for the OEM for a minimum of three (3) years. The System Contractor shall be authorized by the OEM to certify and warranty the installed equipment. In addition, the OEM and System Contractor shall accept complete responsibility for the design, installation, certification, operation, and physical support for the System. This documentation, along with the System Contractor and OEM certification must be provided in writing as part of the Contractor's Technical Submittal.
- D. All equipment, cabling, terminating hardware, TCOs, and patch cords shall be sourced from the certifying OEM or at the OEM's direction, and support the System design, the OEM's quality control and validity of the OEM's warranty.
- E. The Contractor's Telecommunications Technicians assigned to the System shall be fully trained, qualified, and certified by the OEM on the engineering, installation, and testing of the System. The Contractor shall provide formal written evidence of current OEM certification(s) for the installer(s) as a part of the submittal or to the COR before being allowed to commence work on the System.

#### **1.5 SUBMITTALS**

- A. Provide submittals in accordance with Specification Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. The COR shall retain one copy for review and approval.
  - 1. If the submittal is approved the COR shall retain one copy for Official Records and return three (3) copies to the Contractor.
  - 2. If the submittal is disapproved, three (3) copies will be returned to the Contractor with a written explanation attached that indicates

the areas the submittal deviated from the System specifications. The COR shall retain one copy for Official Records.

- B. Environmental Requirements: Technical submittals shall confirm the environmental specifications for physical TC areas occupied by the System. These environmental specifications shall identify the requirements for initial and expanded system configurations for:
1. Minimum floor space and ceiling heights.
  2. Power requirements: The Contractor shall provide the specific voltage, amperage, phases, and quantities of circuits required.
  3. Main backbone, trunk line, riser, and horizontal cable pathways, cable duct, and conduit requirements between each MTC, TC, and TCO.
- C. Documents: The submittal shall be separated into sections for each subsystem and shall contain the following:
1. Title page to include:
    - a. VA Medical Center.
    - b. Contractor's name, address, and telephone (including FAX) numbers.
    - c. Date of Submittal.
    - d. VA Project No.
  2. List containing a minimum of three locations of installations of similar size and complexity as identified herein. These locations shall contain the following:
    - a. Installation Location and Name.
    - b. Owner's or User's name, address, and telephone (including FAX) numbers.
    - c. Date of Project Start and Date of Final Acceptance by Owner.
    - d. System Project Number.
    - e. Brief (three paragraphs minimum) description of each system's function, operation, and installation.
  3. Narrative Description of the system.
  4. A List of the equipment to be furnished. The quantity, make, and model number of each item is required.
  5. Pictorial layouts of each distribution cabinet layout drawing and TCO as each is expected to be installed and configured.
  6. Equipment technical literature detailing the electrical and technical characteristics of each item of equipment to be furnished.

7. Engineering drawings of the System, showing calculated signal levels at the EPBX output, each input and output distribution point, proposed TCO values, and signal level at each TCO multipin, fiberoptic, jack.
8. List of test equipment as per paragraph 1.5.D. below.
9. Letter certifying that the Contractor understands the requirements of the SAMPLES Paragraph 1.5.E.
10. Letter certifying that the Contractor understands the requirements of Section 3.2 concerning acceptance tests.

D. Test Equipment List:

1. The Contractor is responsible for furnishing all test equipment required to test the system in accordance with the parameters specified. Unless otherwise stated, the test equipment shall not be considered part of the system. The Contractor shall furnish test equipment of accuracy better than the parameters to be tested.
  2. The test equipment furnished by the Contractor shall have a calibration tag of an acceptable calibration service dated not more than 12 months prior to the test. As part of the submittal, a test equipment list shall be furnished that includes the make and model number of the following type of equipment as a minimum:
    - a. Spectrum Analyzer.
    - b. Signal Level Meter.
    - c. Volt-Ohm Meter.
    - d. Time Domain Reflectometer (TDR) with strip chart recorder (Data and Optical Measuring).
    - e. Bit Error Test Set (BERT).
    - f. Camera with a minimum of 60 pictures to that will develop immediately to include appropriate test equipment adapters. A video camera in VHS format is an acceptable alternate.
- E. Samples: A sample of each of the following items shall be furnished to the COR for approval prior to installation.
1. TCO Wall Outlet Box 4" x 4"x 2.5" with:
    - a. One each telephone (or voice) rj45 jack installed.
    - b. Two each multi pin data rj45 jacks installed.
    - c. Cover Plate installed.
  2. Data CCS patch panel, punch block or connection device with RJ45 connectors installed.

3. Telephone CCS system with IDC and/or RJ45 connectors and cable terminal equipment installed.
4. Fiber optic CCS patch panel or breakout box with cable management equipment and "ST" connectors installed.
5. 610 mm (2 ft.) section of each copper cable to be used with cable sweep tags as specified in paragraph 2.4.H and connectors installed.
6. 610 mm (2 ft.) section of each fiber optic cable to be used with cable sweep tags as specified in paragraph 2.4.H and connectors installed.

F. Certifications:

1. Submit written certification from the OEM indicating that the proposed supervisor of the installation and the proposed provider of the contract maintenance are authorized representatives of the OEM. Include the individual's exact name and address and OEM credentials in the certification.
2. Submit written certification from the OEM that the wiring and connection diagrams meet National and/or Government Life Safety Guidelines, NFPA, NEC, UL, this specification, and JCAHCO requirements and instructions, requirements, recommendations, and guidance set forth by the OEM for the proper performance of the System as described herein. The VA will not approve any submittal without this certification.
3. Preacceptance Certification: This certification shall be made in accordance with the test procedure outlined in paragraph 3.2.B.

G. Equipment Manuals: Fifteen (15) working days prior to the scheduled acceptance test, the Contractor shall deliver four complete sets of commercial operation and maintenance manuals for each item of equipment furnished as part of the System to the RE. The manuals shall detail the theory of operation and shall include narrative descriptions, pictorial illustrations, block and schematic diagrams, and parts list.

H. Record Wiring Diagrams:

1. Fifteen (15) working days prior to the acceptance test, the Contractor shall deliver four complete sets of the Record Wiring Diagrams of the System to the RE. The diagrams shall show all inputs and outputs of electronic and passive equipment correctly identified according to the markers installed on the interconnecting cables, Equipment and room/area locations.

2. The Record Wiring Diagrams shall be in hard copy and two compact disk (CD) copies properly formatted to match the Facility's current operating version of Computer Aided Drafting (AutoCAD) system. The COR shall verify and inform the Contractor of the version of AutoCAD being used by the Facility.

## **PART 2 - PRODUCTS**

### **2.1 EQUIPMENT AND MATERIALS**

#### **A. System Requirements:**

1. The System shall provide the following minimum services that are designed in accordance with and supported by an Original Equipment Manufacturer (OEM), and as specified herein. The System shall provide continuous inter-Facility voice and data, service. The System shall be capacity sized so that loss of connectivity to external telephone systems shall not affect the Facilities operation in specific designated locations. The System shall:
  - a. Be capable of inter-connecting and functioning fully with the existing Local Telephone Exchange (LEC) Network(s), Federal Telephone System (FTS) Inter-city Network(s), Inter-exchange Carriers, Integrated Services Digital Network (ISDN), Electronic Private Branch Exchange (EPBX) switches, asynchronous/synchronous data terminals and circuits including Automatic Transfer Mode (ATM), Frame Relay, and local area networks (LAN), at a minimum.
  - b. Be a voice and data cable distribution system that is based on a physical "Star" and/or "Bus" Topology.
  - c. Be compatible with and able to provide direct digital connection to trunk level equipment including, but, not limited to: directly accessing trunk level equipment including the telephone system, audio paging, Industry Standard "T" and/or "DS" carrier services and external protocol converters. Additionally, connections to "T" and/or "DS" access/equipment or Customer Service Units (CSU) that are used in FTS and other trunk applications shall be included in the System design. Provide T-1 access/equipment (or CSU), as required for use, in FTS and other trunk applications by system design if this equipment is not provided by the existing telephone system and/or will be deactivated by the installation of the System. The Contractor shall provide all T-1 equipment necessary to terminate and make operational the quantity of circuits designated. The CSU's shall be connected to the System's



emergency battery power supply. The System shall be fully capable of operating in the Industry Standard "DS" protocol and provide that service when required.

2. Cable Systems - Twisted Pair and Fiber optic:

a. General:

- 1) The Contractor shall be responsible for providing a new system conforming to current and accepted telephone and digital industrial/commercial cable distribution standards. The distribution cable installation shall be fully coordinated with the Facility, the PM, the COR and the Contractor prior to the start of installation.
- 2) The Contractor is responsible for complete knowledge of the space and cable pathways (i.e. equipment rooms, TCs, conduits, wireways, etc.) of the Facility. The Contractor shall at a minimum design and install the System using the Pathway Design Handbook H-088C3, TIA/EIA Telecommunications Building Wiring Standards, and Facility Chief of Information Resource Management's (IRM) instructions, as approved in writing by the PM and/or RE.
- 3) The System cables shall be fully protected by cable duct, trays, wireways, conduit (rigid, thin wall, or flex), and when specifically approved, flexible innerduct. It is the responsibility of the Contractor to confirm all contract drawings and the Facility's physical layout to determine the necessary cable protective devices to be provided. If flexible innerduct is used, it shall be installed in the same manner as conduit.
- 4) Cable provided in the system (i.e. backbone, outside plant, inside plant, and station cabling) shall conform to accepted industry and OEM standards with regards to size, color code, and insulation. The pair twists of any pair shall not be exactly the same as any other pair within any unit or sub-unit of cables that are bundled in twenty-five (25) pairs or less. The absence of specifications regarding details shall imply that best general industry practices shall prevail and that first quality material and workmanship shall be provided. Certification Standards, (i.e., EIA, CCITT, FIPPS, and NFPA) shall prevail.

- 5) Some areas of this Facility may be considered "plenum". All wire and cable used in support of the installation in those areas (if any) shall be in compliance with national and local codes pertaining to plenum environments. It is the responsibility of the Contractor to review the VA's cable and wire requirements with the COR and the IRM prior to installation to confirm the type of environment present at each location.
- 6) The Contractor shall provide outside and inside plant cables that furnishes the number of cable pairs required in accordance with the System requirements described herein. The Contractor shall fully coordinate and obtain approval of the design with the OEM, COR and the IRM prior to installation.
- 7) All metallic cable sheaths, etc. shall be grounded by the Contractor (i.e.: risers, underground, station wiring, etc.) as described herein.
- 8) If temporary cable and wire pairs are used, they shall be installed so as to not present a pedestrian safety hazard and the Contractor shall be responsible for all work associated with the temporary installation and for their removal when no longer necessary. Temporary cable installations are not required to meet Industry Standards; but, must be reviewed and approved by the COR and the IRM prior to installation.
- 9) Conductors shall be cabled to provide protection against induction in voice and data circuits. Crosstalk attenuation within the System shall be in excess of -80 dB throughout the frequency ranges specified.
- 10) Measures shall be employed by the Contractor to minimize the radiation of RF noise generated by the System equipment so as not to interfere with audio, video, data, computer main distribution frame (MDF), telephone customer service unit (CSU), and electronic private branch exchange (EPBX) equipment the System may service.
- 11) The System's cables shall be labeled on each end and been fully tested and certified in writing by the Contractor to the COR before proof of performance testing can be conducted. The as-installed drawings shall identify each cable as labeled, used cable, and bad cable pairs. Minimum test requirements are

for impedance compliance, inductance, capacitance, signal level compliance, opens, shorts, cross talk, noise, and distortion, and split pairs on all cables in the frequency ranges specified. The tests required for data cable must be made to guarantee the operation of this cable at not less than 10 mega (m) Hertz (Hz) full bandwidth, fully channel loaded and a Bit Error Rate of a minimum of  $10^{-6}$  at the maximum rate of speed. All cable installation and test records shall be made available at acceptance testing by the COR or Contractor and thereafter maintained in the Facility's Telephone Switch Room. All changes (used pair, failed pair, etc.) shall be posted in these records as the change occurs.

- 12) The Contractor shall coordinate with the COR and the IRM to install the computer interface cable to the Facility Telephone Switch Room from the Facility's Computer Room for all data, DHCP, FTS, ATM, Frame Relay, and telephone circuits and as shown on the drawings.
- 13) The Contractor shall coordinate with the COR and the IRM to provide all cable pairs/circuits from the Facility Telephone Switch Room and establish circuits throughout the Facility for all voice, data, computer alarm (except fire alarm), private maintenance line, Radio Paging, PA, LAN, DHCP, and any low voltage circuits as described herein.
- 14) The Contractor shall provide proper test equipment to guarantee that cable pairs meet each OEM's standard transmission requirements, and guarantee the cable will carry data transmissions at the required speeds, frequencies, and fully loaded bandwidth.

b. Telecommunications Closets (TC): In TC's that are served with both a UTP backbone cable and a fiber optic backbone cable, the UTP cable shall be terminated on separate RJ-45, 8-pin connectors with 110A or equivalent type punch down blocks located on the back or front of a 48-port modular patch panel dedicated to data applications. Only the UTP backbone cable pairs, identified as being connected to the fiber optic backbone, shall be extended to the fiber optic interface device. All connecting cables required to extend these cables (i.e. patch cords, twenty-five pair connectors, etc.), to the fiber optic interface device, in the

TC's shall also be provided by the Contractor to insure a complete and operational fiber optic distribution system:

- 1) In TC's, which are only served by a UTP backbone cable, the cable shall be terminated on separate modular connecting devices (110A or equivalent) that are dedicated to data applications. In order to provide full service to all data cable pairs as identified in each TC/cabinet including spare capacity noted herein, the size of all vertical (riser) cables and/or outside cables serving these TC's shall be increased as required.

c. Horizontal and Station Cable:

- 1) A Four (4) UTP 24 AWG station wiring cable shall be installed from the top TCO jack to the TC and shall be of a type designed to support Category 6 communications (250 mega-Hertz [mHz] or above). At the jack location, terminate all four pair on the RJ-45/11 jack. At the signal closet, all four pair shall be terminated on the modular punch down blocks dedicated to telephone applications.
- 2) A Four (4) UTP 24 AWG (in thermoplastic jacket unless otherwise specified by RE) station wiring cable shall be installed from each of the two (2) bottom TCO RJ-45 jacks (shall conform to EIA/TIA 568 Standard "T568A" and NFPA) to the TC and shall be of a type designed to support Category 6 communications (250 mHz or above).

d. Telecommunication Outlets (TCO), Jacks: All TCO's shall have a minimum of three (3) RJ-45 type jacks. The top jack shall be an eight pin RJ-45/11 compatible jack, labeled, and designated for telephone applications only. The bottom two jacks shall be eight pin RJ-45 type unkeyed (sometimes called center keyed) jacks, labeled, and designated for data.

e. Patient Bedside Prefabricated Units (PBPU): Where PBPU's exist in the Facility, the Contractor shall identify the single gang "box" location on the PBPU designated for installation of the telephone jack. This location shall here-in-after be identified as the PBTCO. The Contractor shall be responsible for obtaining written approval and specific instructions from the PBPU OEM regarding the necessary disassembly and reassembly of each PBPU to the extent necessary to pull wire from above the ceiling junction box

to the PBPB box reserved for the PBTCO. A Contractor provided stainless steel cover plate approved for use by the PBPB OEM and Facility IRM Chief shall finish out the jack installation. Under no circumstances shall the Contractor proceed with the PBPB installations without the written approval of the PBPB OEM and the specific instructions regarding the attachment to or modifying of the PBPB. The COR shall be available to assist the Contractor in obtaining these approvals and instructions in a timely manner as related to the project's time constraints. It is the responsibility of the Contractor to maintain the UL integrity of each PBPB. If the Contractor violates that integrity, it shall be the responsibility of the Contractor to obtain on site UL re-certification of the violated PBPB at the direction of the COR and at the Contractor's expense.

f. Fiber Optics:

- 1) A complete fiber optic cable distribution system shall be provided as a part of the System. The Contractor shall provide a fiber optic cable that meets the minimum bandwidth requirements for FDDI, ATM, and Frame Relay services. This fiber optic cable shall be a 62.5/125 micron multi-mode, containing a minimum of 18 strands of fiber, unless otherwise specified, and shall not exceed a distance of 2,000 Meters (M), or 6,560 feet (ft.) in a single run. Loose tube cable, which separates the individual fibers from the environment, shall be installed for all outdoor runs or for any area which includes an outdoor run. Tight buffered fiber cable shall be used for indoor runs. The multimode fibers shall be terminated and secured at both ends in "ST" type female stainless steel connectors installed in an appropriate patch or breakout panel with a cable management system. A 610 mm (2 ft.) cable loop (minimum) shall be provided at each end to allow for future movement.
- 2) In addition, a 12 strand (minimum), 8.3 mm single mode fiber optic cable shall be provided. Single mode fibers shall be terminated and secured at both ends with "ST" type female stainless steel connectors installed in an appropriate patch or breakout panel. The panel shall be provided with a cable

management system. A 610 mm (2 ft.) cable loop (minimum) shall be provided at each end to allow for future movement.

- 3) The fiber optic backbone shall use a conventional hierarchical "star" design where each TC is wired to the primary hub (main cross-connect system) or a secondary hub (intermediate cross-connect system) and then to the primary hub. There shall be no more than two hierarchical levels of cross-connects in the backbone wiring. Each primary hub shall be connected and terminated to a CCS in the Telephone Switch Room. Additionally, a parallel separate fiber optic interconnection shall be provided between the Telephone Switch Room CCS and the MDF in the Main Computer Room.
  - 4) In the TC's, Telephone Switch Room, and Main Computer Room, all fiber optic cables shall be installed in a CCS and/or MDF rack mounted fiber optic cable distribution component/splice case (Contractor provided and installed rack), patch, or breakout panel in accordance with industry standards. Female "ST" connectors shall be provided and installed on the appropriate panel for termination of each strand.
  - 5) The Contractor shall test each fiber optic strand. Cable transmission performance specifications shall be in accordance with EIA/TIA standards. Attenuation shall be measured in accordance with EIA fiber optic test procedures EIA/TIA-455-46, -61, or -53 and NFPA. Information transmission capacity shall be measured in accordance with EIA/TIA-455-51 or -30 and NFPA. The written results shall be provided to the COR for review and approval.
3. Specific Subsystem Requirements: The System shall consist, as a minimum, of the following independent sub-systems to comprise a complete and functional voice and digital telecommunications cabling system: "Main" (MTC), "intermediate" (IMTC), and "riser" (RTC) TC's; "backbone" cabling (BC) system; "vertical" (or "riser") trunk cabling system; "horizontal" (or "lateral") sub-trunk cabling system, vertical and horizontal cross-connection (VCC and HCC respectively) cabling systems, and TCO's with a minimum of three (3) RJ-45 jacks for the appropriate telephone, Data connections, and additional jacks, connectors, drop and patch cords, terminators, and adapters provided.

a. Telecommunication Closet (TC):

1) TC may house nurses call, code one (or blue), video, public address, radio entertainment, intercom, and radio paging equipment. Regardless of the method of installation, mounting, termination, or cross-connecting used, all backbone, vertical, and horizontal copper and fiber optic cables shall be terminated on appropriate cross-connection systems (CCS) containing patch panel(s), punch blocks, and/or breakout devices provided in enclosures and tested as described herein. A cable and/or wire management system shall be a part of each CCS.

a) A minimum of three 110-120 VAC active quad outlets shall be provided, each with "U" grounded receptacles at a minimum of one outlet for each front, side and back wall. These outlets shall be separately protected by an AC circuit breaker provided in the designated Government Emergency Critical Care AC power panel, that is connected to the Facilities Emergency AC Power Distribution System. For larger building TC applications, a minimum of one additional quad AC outlet shall be provided for every 800M<sup>2</sup> (or 8,000 ft<sup>2</sup>) of useable floor space. Additional outlets shall be equally spaced along the wall.

b. Cross-connect Systems (CCS):

- 1) The CCS shall be selected based on the following criteria: requires the use of a single tool, has the fewest amount of parts, and requires the least amount of assembly or projected trouble shooting time during the life of the system.
- 2) The CCS system used at the MTC, each IMTC, and each TC shall force cross-connect cable slack management through adherence to the OEM's installation methods, provided cable management systems, and as described herein, so that moves, adds, and changes can be administered easily and cost effectively.
- 3) Copper Cables: The MTC, each IMTC, and TC shall contain a copper CCS sized to support the System TCO's and connections served by each individual TC and as shown on the drawings. The System layout shall allow for a minimum of 50% anticipated growth. Additionally, each CCS must provide maximum flexibility, while maintaining performance, in order to meet

system-changing requirements that are likely to occur throughout its useful life.

4) Fiber Optic Cables:

- a) The MTC and each TC shall contain a fiber CCS sized to support the System TCO's and connections served by each individual TC and as shown on the drawings. The System layout shall allow for a minimum of 50% anticipated growth.
- b) Each fiber CCS must provide maximum flexibility and cable management while maintaining performance in order to meet changing requirements that are likely to occur throughout the expected life of the system. All fiber optic cable slack shall be stored in protective enclosures.
- c) If it is determined that a fiber optic distribution system is not necessary for the immediate system needs. Each TC shall be provided with fiber optic cable(s) that contain a minimum of 12 strands "dark" multimode fiber and 12 strands "dark" single mode fiber, each fiber properly terminated on its respective female stainless steel connector mounted in an appropriate fiber termination enclosure provided in each TC.

5) The Contractor shall not "cross-connect" the copper or fiber optic cabling systems and subsystems even though appropriate "patch" cords are to be provided for each "patch", "punch", or "breakout" panel. In addition, the Contractor shall not provide active electronic distribution or interface equipment as a part of the System.

6) Grounding: Proper grounding and bonding shall be provided for each TC and all internal equipment. Reference shall be made to proper codes and standards, such that all grounding systems must comply with all applicable National, Regional, and Local Building and Electrical codes. The most stringent code of these governing bodies shall apply.

- a) If local grounding codes do not exist for the System location, then at a minimum, a #6 American Wire Gauge (AWG) stranded copper wire, or equivalent copper braid, shall be connected to a separate earth grounding system for each TC (the looping of TC's in a general location is allowed as long as the specifications contained herein are met). Under



no circumstance shall the AC neutral be used for this ground. See PART 3 - EXECUTION for specific grounding instructions.

- b) Each copper UTP or STP cable that enters a TC from the outside of a building (regardless if the cable is installed underground or aerial) shall be provided with a surge protector and grounded an to earth ground at each cable's entry point in and out of the MTC and each IMTC.
- c. Main Cross-connection Subsystem (MCCS): The MCCS shall be located in the MTC and it shall be the common point of appearance for inter and intra-building copper and fiber optic "backbone" system cables, and connections to the telephone and data cable systems. The MTC usually houses telephone EPBX, public address, radio paging interface, routers, and main hierarchical data LAN concentrating equipment. Additionally, it shall provide a single administration and management point for the entire System.
- d. Voice (or Telephone) Cable Cross-Connection Subsystem:
  - 1) Due to the usually high number of copper cable termination's required at the MCCS, Insulation Displacement Connection (IDC) hardware shall be used. Termination options shall include the following for a Category 6 Cabling System: IDC termination of cross-connection wire(s), IDC patch cord connector to IDC patch cord connector, and hybrid modular cord to IDC patch cord connector shall be the minimum provided.
  - 2) Additionally, due to the large or many MCCS (at initial installation and over the life of the System) copper termination points, the CCS that makes the best use of real estate while still following the OEM design and installation guidelines, and meeting the specifications described herein, shall be provided.
  - 3) For ease of maintenance purposes, all terminations shall be accessible without need for disassembly of the IDC wafer. IDC wafers shall be removable from their mounts to facilitate testing on either side of connector. Designation strips or labels shall be removable to allow for inspection of terminations. The maximum number of terminations on a wall or on a rack frame or panel shall comply with OEM recommendations

and guidelines, and as described herein. A cable management system shall be provided as a part of the IDC.

- 4) IDC connectors shall be capable of supporting cable re-terminations without damaging the connector and shall support a minimum of 200 (telephone equipment standard compliant) IDC insertions or withdrawals on either side of the connector panel.
- 5) A non-impact termination method using a full-cycle terminating tool having both a tactile and an audible feedback to indicate proper termination is required. For personnel safety and ease of use in day to day administration, high impact installation tools shall not be used.
- 6) All system "inputs" from the EPBX, FTS, Local Telephone System, or diverse routed voice distribution systems shall appear on the "left" side of the IDC (110A blocks with RJ45 connections are acceptable alternates to the IDC) of the MCCS.
- 7) All system "outputs" from the MCCS to the voice backbone cable distribution system shall appear on the "right" side of the same IDC (or 110A blocks) of the MCCS.
- 8) The splitting of pairs within cables between different jacks or connections shall not be allowed. In the case of ISDN and/or ATM and /or Frame Relay applications, terminating resistors shall be provided externally to the patch panel connector or jack.
- 9) UTP or STP cross connecting wires shall be provided for each "pair" of connection terminals plus an additional 50% spare.

e. Data Cross-Connection Subsystems:

- 1) The MCCS shall be a Main Distribution Terminating (MDT) data unit and shall be provided in the MTC. The MDT shall consist of a "patch" panel(s) provided with modular RJ45 female connectors for cross-connection of all copper data cable terminations. The panels shall provide for system grounding (where no dielectric cables are used) and be provided with a cable management system.
- 2) Each panel shall conform to EIA dimensions and be suitable for mounting in standard equipment racks, have the RJ45 jacks aligned in two horizontal rows (up to a maximum of 48 jacks per panel), and shall not exceed the OEM's recommendations.

Each RJ45 jack shall be of modular design and capable of accepting and functioning with other modular (i.e. RJ11) plugs without damaging the jack. It is not necessary to provide a jack for unused positions that are not part of the 50% expansion requirement.

- a) All data system inputs from the server(s), data LAN, bridge, or interface distribution systems shall appear on the "top" row of jacks of the appropriate patch panel.
  - b) All System outputs or backbone cable connections shall appear on "bottom" row of jacks of the same patch panel.
  - c) The splitting of pairs within cables between different jacks is not allowed. In cases of ISDN and/or ATM and/or Frame Relay applications, terminating resistors shall be provided externally to patch panel connector or jack.
- 3) A patch cord shall be provided for each system "pair" of connection jacks. Each patch cord shall have modular RJ45 connectors provided on each end to match the panel's modular RJ45 female jack's being provided.
- f. Fiber optic Cross-Connection Subsystems: The MTC shall be provided with a separate fiber MCCC. Each TC shall be provided with a rack mounted patch or distribution panel that is installed inside a lockable cabinet or "breakout enclosure" that accommodates a minimum of 12 strands multimode fiber and 12 strand single mode fiber (these counts shall not be included the 50% spare requirement). Two of the single mode fibers shall be designated for educational analog video applications. A cable management system shall be provided for each panel.
- 1) The panel(s) shall contain a minimum of 24 female "ST" connectors, be able to accommodate splices and field mountable connectors and have capacity for additional connectors to be added up to the OEM's maximum standard panel size for this type of use. All patch panel sides, including the front and back, shall be protected by a cabinet or enclosure.
  - 2) The panel(s) shall conform to EIA dimensions and be suitable for installation in standard racks, cabinets, and enclosures. The panels shall provide for system grounding (where no dielectric cables are used).

- 3) The patch panel with the highest OEM approved density of fiber "ST" termination's (maximum of 72 each), while maintaining a high level of manageability, shall be selected. Patch cables, with proper "ST" connectors installed on each end shall be provided for each pair of fiber optic cable "ST" connectors.
  - a) All System "inputs" from interface equipment or distribution systems shall appear on the "top" row of connectors of the appropriate patch panel.
  - b) All System "outputs" or backbone cable connections shall appear on the "bottom" row of connectors of the same patch panel.
- 4) In order to achieve a high level of reliability that approximates that of an OEM connector, field installable connectors shall have an OEM specified physical contact polish. Every fiber cable shall be terminated with the appropriate connector, and tested to ensure compliance to OEM and specifications outlines herein. Where a local fiber optic system connector standard, Industry Standard fiber optic "ST" female connector terminated with a fiber optic cable, shall be used. But, if the fiber optic cable is not used (or "dark"), a "ST" male terminating "cap" shall be provided for each unused "ST" female connector.
- g. Distribution (Common to Intra-Building) Cabling Systems: The intra-building trunk cabling system provides for connection between the IMCCS and each Riser TC's provided vertical cross-connecting system (VCCS) within a building. The media (copper, fiber optic ) used in the intra-building backbone cabling system shall be designed according to the system requirements, OEM standards and guidelines, and as described herein. A multi-pair copper for voice and data, and separate multiple fiber optic trunk system shall be provided as a part of the System.
  - 1) Category 6 UTP or STP multi-pair trunk cable(s) shall be used in the voice and data trunk-line-cabling systems. A minimum of eight pairs per circuit, plus an additional 50% spare for growth shall be provided.
  - 2) Where the distance limitations of UTP and/or STP will be exceeded, multimode (or single mode) fiber optic cable shall be used in the voice and/or trunk cabling systems. The total

loss of the fiber trunks shall not exceed 12 dB at 850 nM , 11 dB at 1,300 nM, or 10 dB at 1,500 nM.

- a) All voice system "outputs" from the IMCCS to the trunk-line distribution system shall appear on the "right" side of IDC (minimum 110A blocks) punch terminals of the IMCCS.
  - b) All data system "outputs" from the IMCCS to the trunk-line distribution system shall appear on the "bottom" row of jacks of the same IDC (minimum 110A blocks) of the IMCCS.
  - c) The splitting of pairs within cables between different jacks is shall not be allowed. In the case of ISDN and/or ATM and/or Frame Relay applications, terminating resistors shall be provided externally to the patch panel connector or jack.
  - d) A patch cord shall be provided for each system "pair" of connection jacks. Each patch cord shall have modular connectors provided on each end to match the panel's modular female jack.
- 3) The fiber optic trunk line system shall be configured as a "Buss" Topology with separate dedicated fibers between the IMCCS and each RCS. The System shall be sized to meet the System requirements with a expansion capability of 50% provided. Separate individual fiber optic cable(s) with a minimum of 18 strands multimode fiber and/or 12 strands single mode fiber shall be provided. Two of the single mode fibers shall be designated for analog video service.
- 4) All trunk lines shall be identified with permanent labels at both ends. Labels will indicate system, floor, closet, and zone. The label designations shall match those used for cross-connects and patch panels.
- a) All System outputs from the IMCCS to the trunk-line distribution system shall appear on the "bottom" row of "ST" connectors in the appropriate patch panel.
  - b) A patch cord shall be provided for each system "pair" of connection "ST" connectors. As a minimum, each patch cord shall have "ST" male connectors provided on each end to match the panel's female "ST" connector provided.
- h. Horizontal (or Station) Cabling (HC): The HC distribution cabling system connects the distribution field of the voice and data

HCCS, in a "Star" Topology, to each TCO or connector and as shown on the drawings via the sub-trunk system.

- 1) Horizontal cables shall consist of insulated, UTP or STP conductors that are rated for Category 6 telecommunications service for voice and data systems.
- 2) The number of UTP or STP distribution pairs dedicated to each floor from the HC shall be sufficient to accommodate all the horizontal voice and data circuits served by the distribution cable to each TCO.
  - a) A minimum of four pairs for voice shall be connected to the "right" side of the IDC (or 110A block) that the VCCS "input" connections appear in the RTC.
  - b) A minimum of two separate sets of four pairs each for data shall be connected to the "bottom" row of RJ45 jacks that the VCCS "input" connections appear in the RTC.
- 3) The horizontal cable length to the farthest system outlet shall be limited to a maximum of 90M (or 295 ft). These maximum lengths must be derated, adjusted and reduced to include cross-connection and distribution system losses. Additional TC(s) shall be provided on large floor areas of buildings to limit the horizontal distribution to a maximum of 90M (or 295 ft).
- 4) The splitting of pairs within a cable between different jacks shall not be permitted.
- 5) The installation of the HC shall conform to appropriate OEM recommendations and standards outlined herein. This requirement will insure adequate protection for Electro-Magnetic Interference (EMI) sources.
- 6) A system design where "looping" the HC distribution cables from room to room shall not be permitted.
- i. System Telecommunication Outlets (TCO): The System shall be capable of receiving the specified telephone (or voice) and data signals acquired from the LEC, FTS contracted carrier and computer system, and shall process and distribute them to the designated TCO's and as shown on the drawings. At a minimum, one TCO shall be provided on each room wall, associated with an active 120 VAC shall be provided and as shown on the drawings. The only exception to the general rule, of one outlet per wall,

shall be those "special" locations (e.g., surgical suites, radiology MRI rooms, labs, patient bed rooms, warehouse, loading docks, storage rooms, etc.) where there is usually only one TCO provided as designated on the drawings.

- 1) Each TCO shall consist of three multipin modular RJ45 jacks, one designated for telephone and two for data service. Each TCO with appropriate jacks installed shall be provided by the Contractor in each designated location and as shown on the drawings.
- 2) The Contractor shall connect each telephone multipin modular RJ45 jack to a separate "right side as you look at it" telephone HC distribution system HCCS "punch down" 110A block or approved IDC terminating device in each associated RTC. The modular RJ45 jack shall be able to accept and operate with smaller modular RJ11 plugs while providing proper connection and not damaging the modular jack. The OEM shall warrant all modular RJ45/11 jacks in such a manner to be usable for modular RJ11 plugs.
- 3) The Contractor shall connect each TCO data multipin modular RJ45 jack to a separate lower row jack on the HCCS "patch panel" in each associated RTC. The Contractor is not to "cross-connect" VCCS and HCCS data distribution cables or provides active electronic data distribution equipment as a part of the System.
- 4) A non-impact termination method, using either a stuffer cap with installation tool or full-cycle terminating tool having both tactile and audible feedback to indicate proper termination shall be used. High impact installation tools shall not be used.
- 5) Each terminated conductor end shall be properly trimmed to assure a minimum clearance of 6.35 mm (0.250 in) clearance between the conductors of adjacent modules.
- 6) The multipin RJ45 jack shall be modular in construction that will accept and operate with a modular UTP and STP RJ45 connector and its pin assignments.

B. System Performance:

1. At a minimum, the System shall be able to support the following voice and data operations for Category 6 Certified Telecommunication Service:
  - a. Provide the following interchange (or interface) capabilities:
    - 1) Basic Rate (BRI).
    - 2) Primary Rate (PRI).
  - b. ISDN measured at the new rack in room 3B-162:
    - 1) Narrow Band BRI.
      - a) B Channel: 64 kilo-Bits per second (kBps), minimum.
      - b) D Channel: 16 kBps, minimum.
      - c) H Channel: 384 kBps, minimum.
    - 2) Narrow Band PRI:
      - a) B Channel: 64 kBps, minimum.
      - b) D Channel: 64 kBps, minimum.
      - c) H Channel: 1,920 kBps, minimum.
    - 3) Wide (or Broad) Band:
      - a) All channels: 140 mega(m)-Bps, minimum, capable to 565 mBps at "T" reference.
  - c. ATM operation and interface: ATM 155 mBps measured at the new rack in room 3B-162.
  - d. Frame Relay: All stated compliance's measured at the new rack in room 3B-162.
  - e. Integrated Data Communications Utility (IDCU) operation and interface: Measured at the new rack in room 3B-162.
  - f. Government Open Systems Interconnection Profile (GOSSIP) compliant: Measured at the new rack in room 3B-162.
  - g. Fiberoptic Distributed Data Interface (FDDI): A minimum 100 mBps to a maximum of 1.8 giga(g)-Bps data bit stream speed measured at the new rack in room 3B-162 (shall be Synchronous Optical Network [Sonet] compliant).
  - h. System Sensitivity: Satisfactory service shall be provided for at least 3,000 feet for all voice and data locations.
2. At a minimum the System shall support the following operating parameters:
  - a. EPBX connection:
    - 1) System speed: 1.0 gBps per second, minimum.
    - 2) Impedance: 600 Ohms.
    - 3) Cross Modulation: -60 deci-Bel (dB).



- 4) Hum Modulation: -55 Db.
- 5) System data error: 10 to the -10 Bps, minimum loss measured at the frame output with reference Zero (0) deciBel measured (dBm) at 1,000 Hertz (Hz) applied to the frame input.
  - a) Trunk to station: 1.5 dB, maximum.
  - b) Station to station: 3.0 dB, maximum.
  - c) Internal switch crosstalk: -60 dB when a signal of  $\pm 10$  deciBel measured (dBm), 500-2,500 Hz range is applied to the primary path.
  - d) Idle channel noise: 25 dBm "C" or 3.0 dBm "O" above reference (terminated) ground noise, whichever is greater.
  - e) Traffic Grade of Service for Voice and Data:
    - (1) A minimum grade of service of P-01 with an average traffic load of 7.0 CCS per station per hour and a traffic overload in the data circuits will not interfere with, or degrade, the voice service.
    - (2) Average CCS per voice station: The average CCS capacity per voice station shall be maintained at 7.0 CCS when the EPBX is expanded up to the projected maximum growth as stated herein.

b. Telecommunications Outlet (TCO):

- 1) Voice:
  - a) Isolation (outlet-outlet): 24 dB.
  - b) Impedance: 600 Ohms, balanced (BAL).
  - c) Signal Level: 0 deciBel per mili-Volt (dBmV)  $\pm 0.1$  dBmV.
  - d) System speed: 100 mBps, minimum.
  - e) System data error: 10 to the -6 Bps, minimum.
- 2) Data:
  - a) Isolation (outlet-outlet): 24 dB.
  - b) Impedance: 600 Ohms, BAL.
  - c) Signal Level: 0 dBmV  $\pm 0.1$  dBmV.
  - d) System speed: 120 mBps, minimum.
  - e) System data error: 10 to the -8 Bps, minimum.

C. General:

- 1. All equipment to be supplied under this specification shall be new and the current model of a standard product of an OEM or record. An OEM of record shall be defined as a company whose main occupation is

- the manufacture for sale of the items of equipment supplied and which:
- a. Maintains a stock of replacement parts for the item submitted.
  - b. Maintains engineering drawings, specifications, and operating manuals for the items submitted.
  - c. Has published and distributed descriptive literature and equipment specifications on the items of equipment submitted at least 30 days prior to the Invitation for Bid.
2. Specifications of equipment as set forth in this document are minimum requirements, unless otherwise stated, and shall not be construed as limiting the overall quality, quantity, or performance characteristics of items furnished in the System. When the Contractor furnishes an item of equipment for which there is a specification contained herein, the item of equipment shall meet or exceed the specification for that item of equipment.
  3. The Contractor shall provide written verification, in writing to the COR at time of installation, that the type of wire/cable being provided is recommended and approved by the OEM. The Contractor is responsible for providing the proper size and type of cable duct and/or conduit and wiring even though the actual installation may be by another subcontractor.
  4. The Telephone Contractor is responsible for providing interfacing cable connections for the telephone and PA systems with the System.
  5. The telephone equipment and PA interface shall be the interface points for connection of the PA interface cabling from the telephone switch via the system telephone interface unit.
  6. Active electronic component equipment shall consist of solid state components, be rated for continuous duty service, comply with the requirements of FCC standards for telephone equipment, systems, and service.
  7. All passive distribution equipment shall meet or exceed -80 dB radiation shielding specifications.
  8. All interconnecting twisted pair, fiber-optic cables shall be terminated on equipment terminal boards, punch blocks, breakout boxes, splice blocks, and unused equipment ports/taps shall be terminated according to the OEM's instructions for telephone cable systems without adapters. The Contractor shall not leave unused or

- spare twisted pair wire, fiber-optic cable unterminated, unconnected, loose or unsecured.
9. Color code all distribution wiring to conform to the Telephone Industry standard, EIA/TIA, and this document, which ever is the more stringent. At a minimum, all equipment, cable duct and/or conduit, enclosures, wiring, terminals, and cables shall be clearly and permanently labeled according to and using the provided record drawings, to facilitate installation and maintenance. Reference Specification Section 27 10 00, STRUCTURED CABLING.
  10. Connect the System's primary input AC power to the Facility' Critical Branch of the Emergency AC power distribution system as shown on the plans or if not shown on the plans consult with COR regarding a suitable circuit location prior to bidding.
  11. Plug-in connectors shall be provided to connect all equipment, except coaxial cables and interface points. Coaxial cable distribution points and RF transmission lines shall use coaxial cable connections recommended by the cable OEM and approved by the System OEM. Base- band cable systems shall utilize barrier terminal screw type connectors, at a minimum. Crimp type connectors installed with a ratchet type installation tool are and acceptable alternate as long as the cable dress, pairs, shielding, grounding, and connections and labeling are provided the same as the barrier terminal strip connectors. Tape of any type, wire nuts, or solder type connections are unacceptable and will not be approved.
  12. All equipment faceplates utilized in the System shall be stainless steel, anodized aluminum, or UL approved cycolac plastic for the areas where provided.
  13. Noise filters and surge protectors shall be provided for each equipment interface cabinet, switch equipment cabinet, control console, local, and remote active equipment locations to ensure protection from input primary AC power surges and noise glitches are not induced into low Voltage data circuits.

D. Equipment Functional Characteristics:

FUNCTIONS	CHARACTERISTICS
Input Voltage	105 to 130 VAC
POWER LINE FREQUENCY	60 HZ $\pm$ 2.0 HZ
Operating Temperature	0 to 50 degrees (°) Centigrade (C)

Humidity	80 percent (%) minimum rating
----------	-------------------------------

E. Equipment Standards and Testing:

1. The System has been defined herein as connected to systems identified as Critical Care performing Life Support Functions. Therefore, at a minimum, the system shall conform to all aforementioned National and/or Local Life Safety Codes (which ever are the more stringent), NFPA, NEC, this specification, JCAHCO Life Safety Accreditation requirements, and the OEM recommendations, instructions, and guidelines.
2. All supplies and materials shall be listed, labeled or certified by UL or a nationally recognized testing laboratory where such standards have been established for the supplies, materials or equipment. See paragraph minimum requirements Section 27 05 11, REQUIREMENTS FOR COMMUNICATIONS INSTALLATIONS, and the guidelines listed in paragraph 2.J.2.
3. The provided active and passive equipment required by the System design and approved technical submittal must conform with each UL standard in effect for the equipment, as of the date of the technical submittal (or the date when the COR approved system equipment necessary to be replaced) was technically reviewed and approved by VA. Where a UL standard is in existence for equipment to be used in completion of this contract, the equipment must bear the approved UL seal.
4. Each item of electronic equipment to be provided under this contract must bear the approved UL seal or the seal of the testing laboratory that warrants the equipment has been tested in accordance with, and conforms to the specified standards.

**2.2 DISTRIBUTION EQUIPMENT AND SYSTEMS**

A. Telecommunication Outlet (TCO):

1. The TCO shall consist of one telephone multipin jack and two data multipin jacks mounted in a steel outlet box. A separate 100mm (4in.) x 100mm (4in.) x 63mm (2.5in.) steel outlet box with a labeled stainless steel faceplate will be used. A second 100mm (4in.) x 100mm (4in.) x 63mm (2.5in.) steel outlet box with a labeled faceplate shall be provided as required adjacent to the first box to ensure system connections and expandability requirements are met.

2. All telephone multipin connections shall be RJ-45/11 compatible female types. All data multipin connections shall be RJ-45 female types.
  3. The TCO shall be fed from the appropriate CCS located in the respective RTC in a manner to provide a uniform and balanced distribution system.
  4. Interface of the data multipin jacks to appropriate patch panels (or approved "punch down" blocks) in the associated RTC, is the responsibility of the Contractor. The Contractor shall not extend data cables from the RTCs to data terminal equipment or install data terminal equipment.
  5. The wall outlet shall be provided with a stainless steel or approve alternate cover plate to fit the telephone multipin jack, data multi-pin jacks and the outlet box provided (100mm (4in.) x 100mm (4in.) for single and 100mm (4in.) x 200mm (8in.) for dual outlet box applications). For PBPV installations, the cover plate shall be stainless steel.
- B. Distribution Cables: Each cable shall meet or exceed the following specifications for the specific type of cable. Each cable reel shall be sweep tested and certified by the OEM by tags affixed to each reel. The Contractor shall turn over all sweep tags to the COR or PM. Additionally, the Contractor shall provide a 610 mm (2 ft.) sample of each provided cable, to the COR and receive approval before installation. Cables installed in any outside location (i.e. above ground, under ground in conduit, ducts, pathways, etc.) shall be filled with a waterproofing compound between outside jacket (not immediately touching any provided armor) and inter conductors to seal punctures in the jacket and protect the conductors from moisture.
1. Remote Control:
    - a. The remote control cable shall be multi-conductor with stranded (solid is permissible) conductors. The cable shall be able to handle the power and voltage necessary to control specified system equipment from a remote location. The cable shall be UL listed and pass the FR-1 vertical flame test, at a minimum. Each conductor shall be color-coded. Combined multi-conductor and coaxial cables are acceptable for this installation, as long as all system performance standards are met.

b. Technical Characteristics:

Length	As required, in 1K (3,000 ft.) reels minimum
Connectors	As required by system design
Size	18 AWG, minimum, Outside 20 AWG, minimum, Inside
Color coding	Required, EIA industry standard
Bend radius	10X the cable outside diameter
Impedance	As required
Shield coverage	As required by OEM specification
Attenuation	
Frequency in MHz	dB per 305 M (1,000ft.), maximum
0.7	5.2
1.0	6.5
4.0	14.0
8.0	19.0
16.0	26.0
20.0	29.0
25.0	33.0
31.0	36.0
50.0	52.0

2. Telephone:

- a. The System cable shall be provided by the Contractor to meet the minimum system requirements of Category Six service. The cable shall interconnect each part of the system. The cable shall be completely survivable in areas where it is installed.

b. Technical Characteristics:

Length	As required, in 1K (3,000 ft.) reels minimum
Cable	Voice grade category six
Connectors	As required by system design
Size	22 AWG, minimum, Outside 24 AWG, minimum, Inside
Color coding	Required, telephone industry standard
Bend radius	10X the cable outside diameter
Impedance	120 Ohms $\pm$ 15%, BAL

Shield coverage	As required by OEM specification
Attenuation	
Frequency in mHz	dB per 305 M (1,000ft.), maximum
0.7	5.2
1.0	6.5
4.0	14.0
8.0	19.0
16.0	26.0
20.0	29.0
25.0	33.0
31.0	36.0
62.0	52.0
100.0	68.0

3. Data Multi-Conductor:

- a. The cable shall be multi-conductor, shielded or unshielded cable with stranded conductors. The cable shall be able to handle the power and voltage used over the distance required. It shall meet Category Six service at a minimum.

b. Technical Characteristics:

Wire size	22 AWG, minimum
Working shield	350 V
Bend radius	10X the cable outside diameter
Impedance	100 Ohms $\pm$ 15%, BAL
Bandwidth	100 mHz, minimum
DC RESISTANCE	10.0 Ohms/100M, maximum
Shield coverage	
Overall Outside (if OEM specified)	100%
Individual Pairs (if OEM specified)	100%
Attenuation	
Frequency in mHz	dB per 305 M (1,000ft.), maximum
0.7	5.2
1.0	6.5
4.0	14.0
8.0	19.0

16.0	26.0
20.0	29.0
25.0	33.0
31.0	36.0
62.0	52.0
100.0	68.0

4. Fiber Optic:

a. Multimode Fiber:

- 1) The general purpose multimode fiber optic cable shall be a dual window type installed in conduit for all system locations. A load-bearing support braid shall surround the inner tube for strength during cable installation.

2) Technical Characteristics:

Bend radius	6.0", minimum Outer jacket, As required
FIBER DIAMETER	62.5 MICRONS
Cladding	125 microns
Attenuation	
850 nM	4.0 dB per kM, maximum
1,300 nM	2.0 dB per kM, maximum
Bandwidth	
850 nM	160 MHz, minimum
1,300 nM	500 MHz, minimum
Connectors	Stainless steel

b. Single mode Fiber:

- 1) The general purpose single mode fiber optic cable shall be a dual window type installed in conduit for all system locations. A load-bearing support braid shall surround the inner tube for strength during cable installation.

2) Technical Characteristics:

Bend radius	100 mm (4 in.) minimum
Outer jacket	PVC
Fiber diameter	8.7 microns
Cladding	125 microns



Attenuation at 850 nM	1.0 dBm per km
Connectors	Stainless Steel

5. AC Power Cable: AC power cable(s) shall be 3-conductor, no. 12 AWG minimum, rated for 13A-125V and 1,625W. Master AC power, install specification and requirements are given in NEC and herein.

6. Public Address and/or General Purpose Audio:

a. The audio cable shall be two-conductor, STP cable with stranded conductors. The cable shall be able to handle the power used for the load impedance over the distance required, with not more than 5% power loss. This cable is to be provided in local PA areas only and is not to be used as a part of the telephone system.

b. Technical Characteristics:

Impedance	70.7VRMS audio signal
Wire size	20 AWG, minimum
Working shield	350 V
Color coding	Required, EIA audio industry standard
Connectors	As required
Bend radius	10X the cable outside diameter
Impedance	100 Ohms $\pm$ 15%, BAL
Bandwidth	20 mHz, minimum
DC resistance	10.0 Ohms/100M (330 ft.), maximum
Shield coverage	
Overall Outside (if OEM specified)	100%
Individual Pairs (if OEM specified)	100%
Attenuation	
Frequency in mHz	dB per 305 M (1,000ft.), maximum
0.7	5.2
1.0	6.5
4.0	14.0
8.0	19.0
16.0	26.0
20.0	29.0

C. Outlet Connection Cables:

1. Telephone:

- a. The Contractor shall provide a connection cable for each TCO telephone jack in the System with 10% spares. The telephone connection cable shall connect the telephone instrument to the TCO telephone jack. The Contractor shall not provide telephone instrument(s) or equipment.

b. Technical Characteristics:

Length	1.8M (6ft.), minimum
Cable	Voice Grade
Connector	RJ-11/45 compatible male on each end
Size	24 AWG, minimum
Color coding	Required, telephone industry standard

2. Data:

- a. The Contractor shall provide a connection cable for each TCO data jack in the system with 10% spares. The data connection cable shall connect a data instrument to the TCO data jack. The Contractor shall not provide data terminal(s)/equipment.

b. Technical Characteristics:

Length	1.8M (6 ft.), minimum
Cable	Data grade Category Six
Connector	RJ-45 male on each end
Color coding	Required, data industry standard
Size	24 AWG, minimum

D. System Connectors:

1. Solderless (Forked Connector):

- a. The connector shall have a crimp-on coupling for quick connect/disconnect of wires or cables. The crimp-on connector shall be designed to fit the wire or cable furnished. The connector barrel shall be insulated and color-coded.

b. Technical Characteristics:

Impedance	As required
Working Voltage	500 V

2. Multipin:

- a. The connector shall have a crimp-on coupling for quick connect/disconnect of wires or cables. The crimp-on connector shall be designed to fit the wire or cable furnished. The connector housing shall be fully enclosed and shielded. It shall be secured to the cable group by screw type compression sleeves.

b. Technical Characteristics:

Impedance	As required
Working Voltage	500 V
Number of pins	As requires, usually 25 pairs minimum

3. Modular (RJ-45/11 and RJ-45): The connectors shall be commercial types for voice and high speed data transmission applications. The connector shall be compatible with telephone instruments, computer terminals, and other type devices requiring linking through the modular telecommunications outlet to the System. The connector shall be compatible with UTP and STP cables.

a. Technical Characteristics:

Type	Number of Pins
RJ-11/45	Compatible with RJ45
RJ-45	Eight
Dielectric	Surge
Voltage	1,000V RMS, 60 Hz @ one minute, minimum
Current	2.2A RMS @ 30 Minutes or 7.0A RMS @ 5.0 seconds
Leakage	100 $\mu$ A, maximum
Connectability	
Initial contact resistance	20 mili-Ohms, maximum
Insulation displacement	10 mili-Ohms, maximum
Interface	Must interface with modular jacks from a variety of OEMs. RJ-11/45 plugs shall provide connection when used in RJ-45 jacks.
Durability	200 insertions/withdrawals, minimum

4. Fiber Optic: The connectors shall be commercial types for voice and high speed data transmission applications. The connector shall be compatible with telephone instruments, computer terminals, and other

type devices requiring linking through the modular telecommunications outlet to the system. The connector shall be compatible with UTP and STP cables.

E. Terminators:

1. Coaxial:

- a. These units shall be metal-housed precision types in the frequency ranges selected. They shall be the screw-on type that has low VSWR when installed and the proper impedance to terminate the required system unit or coaxial cable.

b. Technical Characteristics:

Frequency	0-1 GHz
Power blocking	As required
Return loss	25 dB
Connectors	"F", "BNC", minimum
Impedance	50 or 75 Ohms, UNBAL

2. Audio:

- a. These units shall be metal-housed precision types in the frequency ranges selected. They shall be the screw-on audio spade lug, twin plug, XL types that has low VSWR when installed and the proper impedance to terminate the required system unit or coaxial cable.

b. Technical Characteristics:

Frequency	20-20 kHz, minimum
Power blocking	As required
Return loss	15 dB
Connectors	"Audio spade lug", "1/4", "1/8", "XL" or "RCA"
Impedance	
Bal	100 Ohms, minimum
Unbal	75 Ohm, minimum

3. Fiber Optic:

- a. These units shall be metal-housed precision types in the frequency ranges selected. They shall be the screw-on type that has low VSWR when installed and the proper impedance to terminate the required system unit or fiber optic cable.

b. Technical Characteristics:

Frequency	Lightwave
Power blocking	As required
Return loss	25 dB
Connectors	"ST", minimum
Construction	Stainless steel
Impedance	As required

F. Distribution Frames:

1. A new stand-alone (i.e., self supporting, free standing) MDF shall be provided as an extension of the existing system and connected to the existing rack. The MDF shall be modular and equipped with modular terminating mini blocks (i.e. Ericsson, 3M, etc.), and patch panels that are as small as possible and provide all the requirements of this specifications as described herein.
2. Technical Characteristics:

Telephone	
IDC type unit	As described in Part 2
Contact wires	50 micron of Gold over Nickel
Contact pressure	100 Grams, MIN
110A Punch blocks	Acceptable alternate to IDC
Data	110A blocks as described in Part 2
Fiber optic	Patch panel as described in Part 2
Analog Video	Patch panel as described in Part 2

**2.3 TELECOMMUNICATIONS CLOSET REQUIREMENTS**

Refer to VA Handbook H-088C3, Telephone System Requirements, for specific TC guidelines for size, power input, security, and backboard mounting requirements. It is the Contractors responsibility to ensure TC compliance with the System Requirements.

**2.4 ENVIRONMENTAL REQUIREMENTS**

Technical submittals shall identify the environmental specifications for housing the system. These environmental specifications shall identify the requirements for initial and expanded system configurations for:

- A. Floor loading for batteries and cabinets.
- B. Minimum floor space and ceiling heights.

- C. Minimum size of doors for equipment passage.
- D. Power requirements: The bidders shall provide the specific voltage, amperage, phases, and quantities of circuits required.

## **2.5 INSTALLATION KIT**

The kit shall be provided that, at a minimum, includes all connectors and terminals, labeling systems, audio spade lugs, barrier strips, punch blocks or wire wrap terminals, heat shrink tubing, cable ties, solder, hangers, clamps, bolts, conduit, cable duct, and/or cable tray, etc., required to accomplish a neat and secure installation. All wires shall terminate in a spade lug and barrier strip, wire wrap terminal or punch block. Unfinished or unlabeled wire connections shall not be allowed. Turn over to the COR all unused and partially opened installation kit boxes, coaxial, fiberoptic, and twisted pair cable reels, conduit, cable tray, and/or cable duct bundles, wire rolls, physical installation hardware. The following are the minimum required installation sub-kits:

### **A. System Grounding:**

1. The grounding kit shall include all cable and installation hardware required. All radio equipment shall be connected to earth ground via internal building wiring, according to the NEC.
2. This includes, but is not limited to:
  - a. Coaxial Cable Shields.
  - b. Control Cable Shields.
  - c. Data Cable Shields.
  - d. Equipment Racks.
  - e. Equipment Cabinets.
  - f. Conduits.
  - g. Duct.
  - h. Cable Trays.
  - i. Power Panels.
  - j. Connector Panels.
  - k. Grounding Blocks.

B. Coaxial Cable: The coaxial cable kit shall include all coaxial connectors, cable tying straps, heat shrink tabbing, hangers, clamps, etc., required to accomplish a neat and secure installation.

C. Wire and Cable: The wire and cable kit shall include all connectors and terminals, audio spade lugs, barrier straps, punch blocks, wire wrap

strips, heat shrink tubing, tie wraps, solder, hangers, clamps, labels etc., required to accomplish a neat and orderly installation.

- D. Conduit, Cable Duct, and Cable Tray: The kit shall include all conduit, duct, trays, junction boxes, back boxes, cover plates, feed through nipples, hangers, clamps, other hardware required to accomplish a neat and secure conduit, cable duct, and/or cable tray installation in accordance with the NEC and this document.
- E. Equipment Interface: The equipment kit shall include any item or quantity of equipment, cable, mounting hardware and materials needed to interface the systems with the identified sub-system(s) according to the OEM requirements and this document.
- F. Labels: The labeling kit shall include any item or quantity of labels, tools, stencils, and materials needed to completely and correctly label each subsystem according to the OEM requirements, as-installed drawings, and this document.
- G. Documentation: The documentation kit shall include any item or quantity of items, computer discs, as installed drawings, equipment, maintenance, and operation manuals, and OEM materials needed to completely and correctly provide the system documentation as required by this document and explained herein.

### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION**

- A. Product Delivery, Storage and Handling:
  - 1. Delivery: Deliver materials to the job site in OEM's original unopened containers, clearly labeled with the OEM's name and equipment catalog numbers, model and serial identification numbers. The COR may inventory the cable, patch panels, and related equipment.
  - 2. Storage and Handling: Store and protect equipment in a manner, which will preclude damage as directed by the RE.
- B. System Installation:
  - 1. After the contract's been awarded, and within the time period specified in the contract, the Contractor shall deliver the total system in a manner that fully complies with the requirements of this specification. The Contractor shall make no substitutions or changes in the System without written approval from the COR and PM.
  - 2. The Contractor shall install all equipment and systems in a manner that complies with accepted industry standards of good practice, OEM

- instructions, the requirements of this specification, and in a manner which does not constitute a safety hazard. The Contractor shall insure that all installation personnel understands and complies with all the requirements of this specification.
3. The Contractor shall install suitable filters, traps, directional couplers, splitters, TC's, and pads for minimizing interference and for balancing the System. Items used for balancing and minimizing interference shall be able to pass telephone and data signals in the frequency bands selected, in the direction specified, with low loss, and high isolation, and with minimal delay of specified frequencies and signals. The Contractor shall provide all equipment necessary to meet the requirements of Paragraph 2.1.C and the System performance standards.
  4. All passive equipment shall be connected according to the OEM's specifications to insure future correct termination, isolation, impedance match, and signal level balance at each telephone/data outlet.
  5. Where TCOs are installed adjacent to each other, install one outlet for each instrument.
  6. All lines shall be terminated in a suitable manner to facilitate future expansion of the System. There shall be a minimum of 50% capacity for future expansion.
  7. All vertical and horizontal copper and fiber optic cables shall be terminated so any future changes only requires modifications of the EPBX or signal closet equipment only.
  8. Terminating resistors or devices shall be used to terminate all unused branches, outlets, equipment ports of the System, and shall be devices designed for the purpose of terminating fiber optic or twisted pair cables carrying telephone and data systems.
- C. Conduit and Signal Ducts:
1. Conduit:
    - a. The Contractor shall employ the latest installation practices and materials. The Contractor shall provide conduit, junction boxes, connectors, sleeves, weatherheads, pitch pockets, and associated sealing materials not specifically identified in this document as GFE. Conduit penetrations of walls, ceilings, floors, interstitial space, fire barriers, etc., shall be sleeved and sealed. The minimum conduit size shall be 19 mm (3/4 in.).



- b. All cables shall be installed in separate conduit and/or signal ducts (exception from the separate conduit requirement to allow telephone cables to be installed in partitioned cable tray with data cables may be granted in writing by the COR if requested.) Conduits shall be provided in accordance with Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and NEC Articles 517 for Critical Care and 800 for Communications systems, at a minimum.
  - c. When metal, plastic covered, etc., flexible cable protective armor or systems are specifically authorized to be provided for use in the System, their installation guidelines and standards shall be as specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.
  - d. When "innerduct" flexible cable protective systems is specifically authorized to be provided for use in the System, it's installation guidelines and standards shall be as the specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.
  - e. Conduit (including GFE) fill shall not exceed 40%. Each conduit end shall be equipped with protective insulator or sleeve to cover conduit end, connection nut or clamp, to protect wire or cable during installation and remaining in the conduit.  
Electrical power conduit shall be installed in accordance with NEC. AC power conduit shall be run separate from signal conduit.
  - f. When metal, plastic covered, etc., flexible cable protective armor or systems are specifically authorized to be provided for use in the System, their installation guidelines and standards shall be as specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.
  - g. Ensure that Critical Care Nurse Call and PA Systems (as identified by NEC Section 517) are completely separated and protected from all other systems.
2. Signal Duct, Cable Duct, or Cable Tray:
- a. The Contractor shall use new cable tray, when identified and approved by the RE.
  - b. Approved signal and/or cable duct shall be a minimum size of 100 mm x 100 mm (4 in. X 4 in.) inside diameter with removable tops or sides, as appropriate. Protective sleeves, guides or barriers

are required on all sharp corners, openings, anchors, bolts or screw ends, junction, interface and connection points.

D. Distribution System Signal Wires and Cables:

1. Wires and cables shall be provided in the same manner and use like construction practices as Fire Protective and other Emergency Systems that are identified and outlined in NFPA 101, Life Safety Code, Chapters 7, 12, and/or 13, NFPA 70, National Electrical Code, Chapter 7, Special Conditions. The wires and cables shall be able to withstand adverse environmental conditions in their respective location without deterioration. Wires and cables shall enter each equipment enclosure, console, cabinet or rack in such a manner that all doors or access panels can be opened and closed without removal or disruption of the cables.
  - a. Each wire and cable shall terminate on an item of equipment by direct connection. Spare or unused wire and cable shall be provided with appropriate connectors (female types) that are installed in appropriate punch blocks, barrier strips, patch, or bulkhead connector panels.
  - b. Fiber optic cables that are spare, unused or dark shall be provided with Industry Standard "ST" type female connectors installed in appropriate break out, patch, or bulkhead connector panels provided in enclosure(s) and shall be protected from the environment.
  - c. Coaxial cables that are spare, unused or dark shall be provided with the cable OEM specified type female connectors installed in appropriate break out, patch, or bulkhead connector panels provided in enclosure(s) and shall be protected from the environment.
  - d. All cable junctions and taps shall be accessible. Provide an 8" X 8" X 4" (minimum) junction box attached to the cable duct or raceway for installation of distribution system passive equipment. Ensure all equipment and tap junctions are accessible.
2. Routing and Interconnection:
  - a. Wires or cables between consoles, cabinets, racks and other equipment shall be in an approved conduit, signal duct, cable duct, or cable tray that is secured to building structure.
  - b. Wires and cables shall be insulated to prevent contact with signal or current carrying conductors. Wires or cables used in

assembling consoles, panels, equipment cabinets and racks shall be formed into harnesses that are bundled and tied. Harnessed wires or cables shall be combed straight, formed and dressed in either a vertical or horizontal relationship to equipment, controls, components or terminations.

- c. Harnesses with intertwined members are not acceptable. Each wire or cable that breaks out from a harness for connection or termination shall have been tied off at that harness or bundle point, and be provided with a neatly formed service loop.
- d. Wires and cables shall be grouped according to service (i.e.: AC, grounds, signal, DC, control, etc.). DC, control and signal cables may be included with any group. Wires and cables shall be neatly formed and shall not change position in the group throughout the conduit run. Wires and cables in approved signal duct, conduit, cable ducts, or cable trays shall be neatly formed, bundled, tied off in 600 mm to 900 mm (24 in. to 36 in.) lengths and shall not change position in the group throughout the run. Concealed splices are not allowed.
- e. Separate, organize, bundle, and route wires or cables to restrict EMI, channel crosstalk, or feedback oscillation inside any enclosure. Looking at any enclosure from the rear (wall mounted enclosures, junction, pull or interface boxes from the front), locate AC power, DC and speaker wires or cables on the left; coaxial, control, microphone and line level audio and data wires or cables, on the right. This installation shall be accomplished with ties and/or fasteners that will not damage or distort the wires or cables. Limit spacing between tied off points to a maximum of 150 mm (6 inches).
- f. Do not pull wire or cable through any box, fitting or enclosure where change of cable tray or signal or cable duct alignment or direction occurs. Ensure the proper bend radius is maintained for each wire or cable as specified by its OEM.
- g. Employ temporary guides, sheaves, rollers, and other necessary items to protect the wire or cable from excess tension or damage from bending during installation. Abrasion to wire or cable jackets is not acceptable and not allowed. Replace all cables whose jacket has been abraded. The discovery of any abraded and/or damaged cables during the proof of performance test shall

be grounds for declaring the entire system unacceptable and the termination of the proof of performance test. Completely cover edges of wire or cable passing through holes in chassis, cabinets or racks, enclosures, pull or junction boxes, conduit, etc., with plastic or nylon grommeting.

- h. Cable runs shall be splice free between conduit junction and interface boxes and equipment locations.
- i. Cables shall be installed and fastened without causing sharp bends or rubbing of the cables against sharp edges. Cables shall be fastened with hardware that will not damage or distort them.
- j. Cables shall be labeled with permanent markers at the terminals of the electronic and passive equipment and at each junction point in the System. The lettering on the cables shall correspond with the lettering on the record diagrams.
- k. Completely test all of the cables after installation and replace any defective cables.
- l. Wires or cables installed outside of conduit, cable trays, wireways, cable duct, etc.
  - 1) Only when specifically authorized as described herein, will wires or cables be identified and approved to be installed outside of conduit. The wire or cable runs shall be UL rated plenum and OEM certified for use in air plenums.
  - 2) Wires and cables shall be hidden, protected, fastened and tied at 600 mm (24 in.) intervals, maximum, as described herein to building structure.
  - 3) Closer wire or cable fastening intervals may be required to prevent sagging, maintain clearance above suspended ceilings, remove unsightly wiring and cabling from view and discourage tampering and vandalism. Wire or cable runs, not provided in conduit, that penetrate outside building walls, supporting walls, and two hour fire barriers shall be sleeved and sealed with an approved fire retardant sealant.
  - 4) Wire or cable runs to system components installed in walls (i.e.: volume attenuators, circuit controllers, signal, or data outlets, etc.) may, when specifically authorized by the RE, be fished through hollow spaces in walls and shall be certified for use in air plenum areas.

E. Outlet Boxes, Back Boxes, and Faceplates:

1. Outlet Boxes: Signal, power, interface, connection, distribution, and junction boxes shall be provided as required by the system design, on-site inspection, and review of the contract drawings.
  2. Back Boxes: Back boxes shall be provided as directed by the OEM as required by the approved system design, on-site inspection, and review of the contract drawings.
  3. Face Plates (or Cover Plates): Faceplates shall be of a standard type, stainless steel, anodized aluminum or UL approved cyclac plastic construction and provided by the Contractor for each identified system outlet location. Connectors and jacks appearing on the faceplate shall be clearly and permanently marked.
- F. Connectors: Circuits, transmission lines, and signal extensions shall have continuity, correct connection and polarity. A uniform polarity shall be maintained between all points in the system.
1. Wires:
    - a. Wire ends shall be neatly formed and where insulation has been cut, heat shrink tubing shall be employed to secure the insulation on each wire. Tape of any type is not acceptable.
    - b. Audio spade lugs shall be installed on each wire (including spare or unused) end and connect to screw terminals of appropriate size barrier strips. AC barrier strips shall be provided with a protective cover to prevent accidental contact with wires carrying live AC current. Punch blocks are approved for signal, not AC wires. Wire Nut or "Scotch Lock" connectors are not acceptable for signal wire installation.
  2. Cables: Each connector shall be designed for the specific size cable being used and installed with the OEM's approved installation tool. Typical system cable connectors include; but, are not limited to: Audio spade lug, punch block, wirewrap, etc.
  3. Line or Microphone Audio: Each connector shall be installed according to the cable or connector OEM's instructions and use the OEM's approved installation tool. Install the connector's to provide and maintain the following audio signal polarity:
    - a. XLR type connectors Signal or positive conductor is pin 3; common or neutral conductor is pin 2; ground conductor is pin 1.
    - b. Two and 3 conductor 1/4" Signal or positive conductor is tip; neutral or 1/8" phono plugs conductor is ring and ground or shield and jacks conductor is sleeve.

- c. RCA Phono Plugs the Signal or positive conductor is tip; and  
Jacks neutral or shield conductor is sleeve.

4. Speaker Line Audio:

- a. Each connector shall be installed according to the cable, transformer or speaker OEM instructions and using the OEM's approved installation tool. The Contractor shall ensure each speaker is properly phased and connected in the same manner throughout the System using two conductor type wires.
- b. One of the conductors shall be color coded to aid in establishing speaker signal polarity. Each speaker line shall be permanently soldered or audio spade lug connected to each appropriate speaker or line matching transformer connection terminal. Speaker line connection to each audio amplifier shall use audio spade lugs, as described herein.

G. AC Power: AC power wiring shall be run separately from signal cable.

H. Grounding:

- 1. General: The Contractor shall ground all Contractor Installed Equipment and identified Government Furnished Equipment to eliminate all shock hazards and to minimize, to the maximum extent possible, all ground loops, common mode returns, noise pickup, crosstalk, etc. The total ground resistance shall be 0.1 Ohm or less.
  - a. The Contractor shall install lightning arrestors and grounding in accordance with the NFPA and this specification.
  - b. Under no conditions shall the AC neutral, either in a power panel or in a receptacle outlet, be used for system control, subcarrier or audio reference ground.
  - c. The use of conduit, signal duct or cable trays as system or electrical ground is not acceptable and will not be permitted. These items may be used only for the dissipation of internally generated static charges (not to be confused with externally generated lightning) that may be applied or generated outside the mechanical and/or physical confines of the System to earth ground. The discovery of improper system grounding shall be grounds to declare the System unacceptable and the termination of all system acceptance testing.
- 2. Cabinet Buss: A common ground buss of at least #10 AWG solid copper wire shall extend throughout each equipment cabinet and be connected to the system ground. Provide a separate isolated ground connection

from each equipment cabinet ground buss to the system ground. Do not tie equipment ground busses together.

3. Equipment: Equipment shall be bonded to the cabinet bus with copper braid equivalent to at least #12 AWG. Self grounding equipment enclosures, racks or cabinets, that provide OEM certified functional ground connections through physical contact with installed equipment, are acceptable alternates.
  4. Cable Shields: Cable shields shall be bonded to the cabinet ground buss with #12 AWG minimum stranded copper wire at only one end of the cable run. Cable shields shall be insulated from each other, faceplates, equipment racks, consoles, enclosures or cabinets; except, at the system common ground point. Coaxial and audio cables, shall have one ground connection at the source; in all cases, cable shield ground connections shall be kept to a minimum.
- I. Labeling: Provide labeling in accordance with ANSI/EIA/TIA-606-A. All lettering for voice and data circuits shall be stenciled using laser printers. Handwritten labels are not acceptable.
1. Cable and Wires (Hereinafter referred to as "Cable"): Cables shall be labeled at both ends in accordance with ANSI/EIA/TIA-606-A. Labels shall be permanent in contrasting colors. Cables shall be identified according to the System "Record Wiring Diagrams".
  2. Equipment: System equipment shall be permanently labeled with contrasting plastic laminate or bakelite material. System equipment shall be labeled on the face of unit corresponding to its source.
  3. Conduit, Cable Duct, and/or Cable Tray: The Contractor shall label all conduit, duct and tray, including utilized GFE, with permanent marking devices or spray painted stenciling a minimum of 3 meters (10 ft.) identifying it as the System. In addition, each enclosure shall be labeled according to this standard.
  4. Termination Hardware: The Contractor shall label workstation outlets and patch panel connections using color coded labels with identifiers in accordance with ANSI/EIA/TIA-606-A and the "Record Wiring Diagrams".

### **3.2 TESTS**

#### **A. Pretesting:**

1. Upon completing the installation of the System, the Contractor shall align and balance the system. The Contractor shall pretest the entire system.

2. Pretesting Procedure:

- a. During the system pretest, the Contractor shall verify (utilizing the approved spectrum analyzer and test equipment) that the System is fully operational and meets all the system performance requirements of this standard.
- b. The Contractor shall pretest and verify that all System functions and specification requirements are met and operational, no unwanted aural effects, such as signal distortion, noise pulses, glitches, audio hum, poling noise, etc. are present.

3. The Contractor shall provide four (4) copies of recorded system pretest measurements and written certification that the System is ready for the formal acceptance test shall be submitted to the COR.

B. Acceptance Test: After the System has been pretested and the Contractor has submitted the pretest results and certification to the COR, then the Contractor shall schedule an acceptance test date and give the COR 30 days written notice prior to the date the acceptance test is expected to begin. The System shall be tested in the presence of a Government Representative and an OEM certified representative. The System shall be tested utilizing the approved test equipment to certify proof of performance and Life Safety compliance. The test shall verify that the total System meets the requirements of this specification. The notification of the acceptance test shall include the expected length (in time) of the test.

C. Performance Testing:

1. Perform Category 6 tests in accordance with ANSI/EIA/TIA-568-B.1 and ANSI/EIA/TIA-568-B.2. Test shall include the following: wire map, length, insertion loss, return loss, NEXT, PSNEXT, ELFEXT, PSELFEXT, propagation delay and delay skew.
2. Fiber Optic Links: Perform end-to-end fiber optic cable link tests in accordance with ANSI/EIA/TIA-568-B.3.

D. Total System Acceptance Test: The Contractor shall perform verification tests for UTP copper cabling system(s) and the multimode fiber optic cabling system(s) after the complete telecommunication distribution system and workstation outlet are installed.

1. Voice Testing: Connect to the network interface device at the demarcation point. Go off-hook and receive dial tone from the LEC. If a test number is available, place and receive a local, long distance, and FTS telephone call.



2. Data Testing: Connect to the network interface device at the demarcation point. Log onto the network to ensure proper connection to the network is achieved.

### **3.3 TRAINING**

- A. Furnish the services of a factory-trained engineer or technician for a total of two four hour classes to instruct designated Facility IRM personnel. Instruction shall include cross connection, corrective, and preventive maintenance of the System and equipment.
- B. Before the System can be accepted by the VA, this training must be accomplished. Training will be scheduled at the convenience of the Facilities Contracting Officer and Chief of Engineering Service.

### **3.4 WARRANTY**

- A. Comply with FAR clause 52.246-21, except that warranty shall be as follows:
  1. The Contractor shall warranty that all installed material and equipment will be free from defects, workmanship, and will remain so for a period of one year from date of final acceptance of the System by the VA. The Contractor shall provide OEM's equipment warranty documents, to the COR has taken possession of the building(s)), that certifies each item of equipment installed conforms to OEM published specifications.
  2. The Contractor's maintenance personnel shall have the ability to contact Contractor and OEM for emergency maintenance and logistic assistance, remote diagnostic testing, and assistance in resolving technical problems at any time. The Contractor and OEM shall provide this contact capability at no additional cost to the VA.
  3. All Contractor installation, maintenance, and supervisor personnel shall be fully qualified by the OEM and must provide two (2) copies of current and qualified OEM training certificates and OEM certification upon request.
  4. Additionally, the Contractor shall accomplish the following minimum requirements during the one year warranty period:
    - a. Response Time:
      - 1) The COR is the Contractor's reporting and contact official for the System trouble calls, during the warranty period.
      - 2) A standard workweek is considered 8:00 A.M. to 5:00 P.M., Monday through Friday exclusive of Federal Holidays.

- 3) The Contractor shall respond and correct on-site trouble calls, during the standard work week to:
  - a) A routine trouble call within one working days of its report. A routine trouble is considered a trouble which causes a system outlet, station, or patch cord to be inoperable.
  - b) An emergency trouble call within 6 hours of its report. An emergency trouble is considered a trouble which causes a subsystem or distribution point to be inoperable at anytime. Additionally, a loss of a minimum of 50 station or system lines shall be deemed as this type of a trouble call.
- 4) The Contractor shall respond on-site to a catastrophic trouble call within 4 hours of its report. A catastrophic trouble call is considered total system failure.
  - a) If a system failure cannot be corrected within four hours (exclusive of the standard work time limits), the Contractor shall be responsible for providing alternate system CSS or TCO equipment, or cables. The alternate equipment and/or cables shall be operational within four hours after the four hour trouble shooting time.
  - b) Routine or emergency trouble calls in critical emergency health care facilities (i.e., cardiac arrest, intensive care units, etc.) shall also be deemed as a catastrophic trouble call if so determined by the COR. The COR shall notify the Contractor of this type of trouble call at the direction of the Facilities Director.
- b. Required on-site visits during the one year warranty period
  - 1) The Contractor shall visit, on-site, for a minimum of eight hours, once every 12 weeks, during the warranty period, to perform system preventive maintenance, equipment cleaning, and operational adjustments to maintain the System according the descriptions identified in this SPEC.
    - a) The Contractor shall arrange all Facility visits with the COR prior to performing the required maintenance visits.
    - b) The Contractor in accordance with the OEM's recommended practice and service intervals shall perform preventive

maintenance during a non-busy time agreed to by the COR or Facility Contracting Officer and the Contractor.

- c) The preventive maintenance schedule, functions and reports shall be provided to and approved by the COR.
- 2) The Contractor shall provide the COR a type written report itemizing each deficiency found and the corrective action performed during each required visit or official reported trouble call. The Contractor shall provide the COR with sample copies of these reports for review and approval at the beginning of the Total System Acceptance Test. The following reports are the minimum required:
  - a) Monthly Report: The Contractor shall provide a monthly summary all equipment and sub-systems serviced during this warranty period to COR by the fifth working day after the end of each month. The report shall clearly and concisely describe the services rendered, parts replaced and repairs performed. The report shall prescribe anticipated future needs of the equipment and Systems for preventive and predictive maintenance.
  - b) Contractor Log: The Contractor shall maintain a separate log entry for each item of equipment and each sub-system of the System. The log shall list dates and times of all scheduled, routine, and emergency calls. Each emergency call shall be described with details of the nature and causes of emergency steps taken to rectify the situation and specific recommendations to avoid such conditions in the future.
- 3) The COR shall provide the Facility Engineering Officer, two (2) copies of actual reports for evaluation.
  - a) The COR shall ensure copies of these reports are entered into the System's official acquisition documents.
  - b) The Facilities Chief Engineer shall ensure copies of these reports are entered into the System's official technical as-installed documents.
- B. Work Not Included: Maintenance and repair service shall not include the performance of any work due to improper use, accidents, other vendor, contractor, owner tampering or negligence, for which the Contractor is not directly responsible and does not control. The Contractor shall

immediately notify the COR in writing upon the discovery of these incidents. The COR will investigate all reported incidents and render findings concerning any Contractor's responsibility.

- - - E N D - - -

**SECTION 27 51 16**

**PUBLIC ADDRESS AND MASS NOTIFICATION SYSTEMS**

**PART 1 - GENERAL**

**1.1 SECTION SUMMARY**

- A. Work covered by this document includes design, engineering, labor, material and products, equipment warranty and system guarantee, training and services for, and incidental to, the complete installation of an extension to the existing facility Emergency Service Public Address System (PAS) and associated equipment (here-in-after referred to as the System) in approved locations indicated on the contract drawings. These items shall be tested and certified capable of receiving, distributing, interconnecting and supporting PAS communications signals generated local and remotely as detailed herein.
- B. Work shall be complete, Occupational Safety and Health Administration (OSHA), National Recognized Testing Laboratory (NRTL - i.e. Underwriters Laboratory [UL]) Listed and Labeled; and VA Central Office (VACO), Telecommunications Voice Engineering (TVE 0050P3B) tested, certified and ready for operation.
- C. The System shall be delivered free of engineering, manufacturing, installation, and functional defects. It shall be designed, engineered and installed for ease of operation, maintenance, and testing.
- D. The term "provide", as used herein, shall be defined as: designed, engineered, furnished, installed, certified, and tested, by the Contractor.
- E. Specification Order of Precedence: In the event of a conflict between the text of this document and the Project's Contract Drawings outlined and/or cited herein; THE TEXT OF THIS DOCUMENT TAKES PRECEDENCE.  
*HOWEVER, NOTHING IN THIS DOCUMENT WILL SUPERSEDE APPLICABLE EMERGENCY LAWS AND REGULATIONS, SPECIFICALLY NATIONAL AND/OR LOCAL LIFE AND PUBLIC SAFETY CODES. The Local Fire Marshall and/or VA Public Safety Officer are the only authorities that may modify this document's EMERGENCY CODE COMPLIANCE REQUIREMENTS, on a case by case basis, in writing and confirmed by VA's PM, COR and TVE-0050P3B. The VA CO is the only approving authority for other amendments to this document that may be granted, on a case by case basis, in writhing with technical*

concurrencies by VA's RE, TVE-0050P3B and identified Facility Project Personnel.

- F. The Original Equipment Manufacturer (OEM) and Contractor shall ensure that all management, sales, engineering and installation personnel have read and understand the requirements of this specification before the system is designed, engineered, delivered and provided. The Contractor shall furnish a written statement attesting this requirement as a part of the technical submittal that includes each name and certification, including the OEMs.

## **1.2 RELATED SECTIONS**

- A. 01 33 23 - Shop Drawings, Product Data and Samples.
- B. 07 84 00 - Firestopping.
- C. 26 05 19 - Low - Voltage Electrical Power Conductors and Cables.
- D. 27 05 11 - Requirements for Communications Installations.
- E. 27 05 26 - Grounding and Bonding for Communications Systems.
- F. 27 05 33 - Raceways and Boxes for Communications Systems.
- G. 27 11 00 - Communications Cabling Interface and Equipment Rooms Fittings.
- H. 27 15 00 - Horizontal and Vertical Communications Cabling Equipment and Systems.

## **1.3 DEFINITIONS**

- A. Provide: Design, engineer, furnish, install, connect complete, test, certify and guarantee.
- B. Work: Materials furnished and completely installed.
- C. Review of contract drawings: A service by the engineer to reduce the possibility of materials being ordered which do not comply with contract documents. The engineer's review shall not relieve the Contractor of responsibility for dimensions or compliance with the contract documents. The reviewer's failure to detect an error does not constitute permission for the Contractor to proceed in error.
- D. Headquarters Technical Review, for National and VA communications and security, codes, frequency licensing, standards, guidelines compliance:

Office of Telecommunications

Special Communications Team (0050P2B)

1335 East West Highway - 3rd Floor

Silver Spring, Maryland 20910

(O) 301-734-0350, (F) 301-734-0360

#### 1.4 REFERENCES

A. The installation shall comply fully with all governing authorities, laws and ordinances, regulations, codes and standards, including, but not limited to:

1. United States Federal Law:

a. Departments of:

1) Commerce, Consolidated Federal Regulations (CFR), Title 15 - Under the Information Technology Management Reform Act (Public Law 104-106), the Secretary of Commerce approves standards and guidelines that are developed by the:

a) Chapter II, National Institute of Standards Technology (NIST - formerly the National Bureau of Standards). Under Section 5131 of the Information Technology Management Reform Act of 1996 and the Federal Information Security Management Act of 2002 (Public Law 107-347), NIST develops - Federal Information Processing Standards Publication (FIPS) 140-2-Security Requirements for Cryptographic Modules.

b) Chapter XXIII, National Telecommunications and Information Administration (NTIA - aka 'Red Book') Chapter 7.8 / 9; CFR, Title 47 Federal communications Commission (FCC) Part 15, Radio Frequency Restriction of Use and Compliance in "Safety of Life" Functions & Locations

2) FCC - Communications Act of 1934, as amended, CFR, Title 47 - Telecommunications, in addition to Part 15 - Restrictions of use for Part 15 listed Radio Equipment in Safety of Life / Emergency Functions / Equipment/ Locations (also see CFR, Title 15 - Department of Commerce, Chapter XXIII - NTIA):

a) Part 15 - Restrictions of use for Part 15 listed Radio Equipment in Safety of Life / Emergency Functions / Equipment/Locations.

b) Part 58 - Television Broadcast Service.

c) Part 90 - Rules and Regulations, Appendix C.

d) Form 854 - Antenna Structure Registration.

3) Health, (Public Law 96-88), CFR, Title 42, Chapter IV Health & Human Services, CFR, Title 46, Subpart 1395(a)(b) JCAHO "a hospital that meets JCAHO accreditation is deemed to meet the

Medicare conditions of Participation by meeting Federal Directives:"

- a) All guidelines for Life, Personal and Public Safety; and, Essential and Emergency Communications.
- 4) Labor, CFR, Title 29, Part 1910, Chapter XVII - Occupational Safety and Health Administration (OSHA), Occupational Safety and Health Standard:
  - a) Subpart 7 - Definition and requirements (for a NRTL - 15 Laboratory's, for complete list, contact ([http://www.osha.gov/dts/otpca/nrtl/faq\\_nrtl.html](http://www.osha.gov/dts/otpca/nrtl/faq_nrtl.html))):
    - 1) UL:
      - a) 44-02 - Standard for Thermoset-Insulated Wires and Cables.
      - b) 65 - Standard for Wired Cabinets.
      - c) 83-03 - Standard for Thermoplastic-Insulated Wires and Cables.
      - d) 467-01 - Standard for Electrical Grounding and Bonding Equipment
      - e) 468 - Standard for Grounding and Bonding Equipment.
      - f) 486A-01 - Standard for Wire Connectors and Soldering Lugs for Use with Copper Conductors
      - g) 486C-02 - Standard for Splicing Wire Connectors.
      - h) 486D-02 - Standard for Insulated Wire Connector Systems for Underground Use or in Damp or Wet Locations.
      - i) 486E-00 - Standard for Equipment Wiring Terminals for Use with Aluminum and/or Copper Conductors.
      - j) 493-01 - Standard for Thermoplastic-Insulated Underground Feeder and Branch Circuit Cable.
      - k) 514B-02 - Standard for Fittings for Cable and Conduit.
      - l) 1069 - Hospital Signaling and Nurse Call Equipment.
      - m) 1333 - Vertical (Riser) Fire Rating.
      - n) 1449 - Standard for Transient Voltage Surge Suppressors.
      - o) 1479-03 - Standard for Fire Tests of Through-Penetration Fire Stops.



- p) 1863 - Standard for Safety, Communications Circuits Accessories.
- q) 2024 - Standard for Optical Fiber Raceways.
- r) 60950-1/2 - Information Technology Equipment - Safety.
- 2) Canadian Standards Association (CSA): same tests as for UL.
- 3) Communications Certifications Laboratory (CCL): same tests as for UL.
- 4) Intertek Testing Services NA, Inc. (ITSNA formerly Edison Testing Laboratory [ETL]): same tests as for UL.
- b) Subpart 35 - Compliance with NFPA 101 - Life Safety Code.
- c) Subpart 36 - Design and construction requirements for exit routes.
- d) Subpart 268 - Telecommunications.
- e) Subpart 305 - Wiring methods, components, and equipment for general use.
- 5) Department of Transportation, CFR, Title 49 (Public Law 89-670), Part 1, Subpart C - Federal Aviation Administration (FAA):
  - a) Standards AC 110/460-ID & AC 707 / 460-2E - Advisory Circulars for Construction of Antenna Towers.
  - b) Forms 7450 and 7460-2 - Antenna Construction Registration.
- 6) Veterans Affairs (Public Law No. 100-527), CFR, Title 38, Volumes I & II:
  - a) Office of Telecommunications:
    - 1) Handbook 6100 - Telecommunications.
      - a) Spectrum Management FCC & NTIA Radio Frequency Compliance and Licensing Program.
      - b) Special Communications Proof of Performance Testing, VACO Compliance and Life Safety Certification(s).
  - b) Office of Cyber and Information Security (OCIS):
    - 1) Handbook 6500 - Information Security Program.
    - 2) Wireless and Handheld Device Security Guideline Version 3.2, August 15, 2005.
  - c) VA's National Center for Patient Safety - Veterans Health Administration Warning System, Failure of Medical Alarm

Systems using Paging Technology to Notify Clinical Staff,  
July 2004.

- d) VA's Center for Engineering Occupational Safety and Health,  
concurrence with warning identified in VA Directive 7700.
- e) Office of Construction and Facilities Management (CFM):
  - 1) Master Construction Specifications (PG-18-1).
  - 2) Standard Detail and CAD Standards (PG-18-4).
  - 3) Equipment Guide List (PG-18-5).
  - 4) Electrical Design Manual for VA Facilities (PG 18-10),  
Articles 7 & 8.
  - 5) Minimum Requirements of A/E Submissions (PG 18-15):
    - a) Volume B, Major New Facilities, Major Additions; and  
Major Renovations, Article VI, Paragraph B.
    - b) Volume C - Minor and NRM Projects, Article III,  
Paragraph S.
    - c) Volume E - Request for Proposals Design/Build  
Projects, Article II, Paragraph F.
  - 6) Mission Critical Facilities Design Manual (Final Draft -  
2007).
  - 7) Life Safety Protected Design Manual (Final Draft -  
2007).
  - 8) Solicitation for Offerors (SFO) for Lease Based Clinics  
- (05-2009).
- b. Federal Specifications (Fed. Specs.):
  - 1) A-A-59544-00 - Cable and Wire, Electrical (Power, Fixed  
Installation).
- 2. United States National Codes:
  - a. American Institute of Architects (AIA): Guidelines for Healthcare  
Facilities.
  - b. American National Standards Institute/Electronic Industries  
Association/Telecommunications Industry Association  
(ANSI/EIA/TIA):
    - 1) 568-B - Commercial Building Telecommunications Wiring  
Standards:
      - a) B-1 - General Requirements.
      - b) B-2 - Balanced twisted-pair cable systems.
      - c) B-3 - Fiber optic cable systems.

- 2) 569 - Commercial Building Standard for Telecommunications Pathways and Spaces.
- 3) 606 - Administration Standard for the Telecommunications Infrastructure of Communications Buildings.
- 4) 607 - Commercial Building Grounding and Bonding Requirements for Telecommunications.
- 5) REC 127-49 - Power Supplies.
- 6) RS 160-51 - Sound systems.
- 7) RS 270 - Tools, Crimping, Solderless Wiring Devices, Recommended Procedures for User Certification.
- 8) SE 101-A49 - Amplifier for Sound Equipment
- 9) SE 103-49 - Speakers for Sound Equipment
- c. American Society of Mechanical Engineers (ASME):
  - 1) Standard 17.4 - Guide for Emergency Personnel.
  - 2) Standard 17.5 - Elevator & Escalator Equipment (prohibition of installing non-elevator equipment in Elevator Equipment Room / Mechanical Penthouse).
- d. American Society of Testing Material (ASTM):
  - 1) D2301-04 - Standard Specification for Vinyl Chloride Plastic Pressure Sensitive Electrical Insulating Tape.
- e. Building Industries Communications Services Installation (BICSI):
  - 1) All standards for smart building wiring, connections and devices for commercial and medical facilities.
  - 2) Structured Building Cable Topologies.
  - 3) In consort with ANSI/EIA/TIA.
- f. Institute of Electrical and Electronics Engineers (IEEE):
  - 1) SO/TR 21730:2007 - Use of mobile wireless communication and computing technology in healthcare facilities - Recommendations for electromagnetic compatibility (management of unintentional electromagnetic interference) with medical devices.
  - 2) 0739-5175/08/@2008 IEEE - Medical Grade - Mission Critical - Wireless Networks.
  - 3) C62.41 - Surge Voltages in Low-Voltage AC Power Circuits.
- g. NFPA:
  - 1) 70 - National Electrical Code (current date of issue) - Articles 517, 645 & 800.

- 2) 75 - Standard for Protection of Electronic Computer Data-Processing Equipment.
  - 3) 77 - Recommended Practice on Static Electricity.
  - 4) 99 - Healthcare Facilities.
  - 5) 101 - Life Safety Code.
  - 6) 1600 - Disaster Management, Chapter 5.9 - Communications and Warning
3. State Hospital Code(s).
  4. Local Town, City and/or County Codes.
  5. Accreditation Organization(s):
    - a. Joint Commission on Accreditation of Hospitals Organization (JCAHO) - Section VI, Part 3a - Operating Features.

#### **1.5 QUALIFICATIONS**

- A. The OEM shall have had experience with three (3) or more installations of systems of comparable size and complexity with regards to type and design as specified herein. Each of these installations shall have performed satisfactorily for at least one (1) year after final acceptance by the user. Include the names, locations and point of contact for these installations as a part of the submittal.
- B. The Contractor shall submit certified documentation that they have been an authorized distributor and service organization for the OEM for a minimum of three (3) years. The Contractor shall be authorized by the OEM to pass thru the OEM's warranty of the installed equipment to VA. In addition, the OEM and Contractor shall accept complete responsibility for the design, installation, certification, operation, and physical support for the System. This documentation, along with the System Contractor and OEM certifications must be provided in writing as part of the Contractor's Technical submittal.
- C. The Contractor's Communications Technicians assigned to the System shall be fully trained, qualified, and certified by the OEM on the engineering, installation, operation, and testing of the System. The Contractor shall provide formal written evidence of current OEM certification(s) for the installer(s) as a part of the submittal or to the COR before being allowed to commence work on the System.
- D. The Contractor shall display all applicable national, state and local licenses.

- E. The Contractor shall submit copy (s) of Certificate of successful completion of OEM's installation/training school for installing technicians of the System's PA equipment being proposed.

#### **1.6 CODES AND PERMITS**

- A. Provide all necessary permits and schedule all inspections as identified in the contract's milestone chart, so that the system is proof of performance tested and ready for operation on a date directed by the Owner.
- B. The contractor is responsible to adhere to all codes described herein and associated contractual, state and local codes.
- C. The Contractor shall display all applicable national, state and local licenses and permits.

#### **1.7 SCHEDULING**

- A. It is the responsibility of the Contractor to coordinate all work with the other trades for scheduling, rough-in, and finishing all work specified. The owner will not be liable for any additional costs due to missed dates or poor coordination of the supplying contractor with other trades.

#### **1.8 REVIEW OF CONTRACT DRAWINGS AND EQUIPMENT DATA SUBMITTALS**

(Note: The Contractor is encouraged, but not required, to submit separate technical submittal(s) outlining alternate technical approach(s) to the system requirements stated here-in as long as each alternate technical document(s) is complete, separate, and submitted in precisely the same manner as outlined herein. VA will review and rate each received alternate submittal, which follows this requirement, in exactly the same procedure as outlined herein. Partial, add-on, or addenda type alternates will not be accepted or reviewed.)

- A. Submit at one time within 10 days of contract awarding, drawings and product data on all proposed equipment and system. Check for compliance with contract documents and certify compliance with Contractor's "APPROVED" stamp and signature.
- B. Support all submittals with descriptive materials, i.e., catalog sheets, product data sheets, diagrams, and charts published by the manufacturer. These materials shall show conformance to specification and drawing requirements.
- C. Where multiple products are listed on a single cut-sheet, circle or highlight the one that you propose to use. Provide a complete and

through equipment list of equipment expected to be installed in the system, with spares, as a part of the submittal. Special Communications (TVE-0050P3B) will not review any submittal that does not have this list.

- D. Provide four (4) copies to the PM for technical review. The PM will provide a copy to the offices identified in Paragraph 1.3.C & D, at a minimum for compliance review as described herein where each responsible individual(s) shall respond to the PM within 10 days of receipt of their acceptance or rejection of the submittal(s).
- E. Provide interconnection methods, conduit (where not already installed), junction boxes (J-Boxes), cable, interface fixtures and equipment lists for the: ENR(s) ( aka DMARC), TER, TCR, MCR, MCOR, PCR, ECR, Stacked Telecommunications Rooms (STR), Nurses Stations (NS), Head End Room (HER), Head End Cabinet (HEC), Head End Interface Cabinet (HEIC) and approved TCO locations Telecommunications Infrastructure Plant (TIP) interface distribution layout drawing, as they are to be installed and interconnected to teach other (REFER TO APPENDIX B - SUGGESTED TELECOMMUNI-CAITONS ONE LINE TOPOLOGY pull-out drawing).
- F. Equipment OEM technical literature detailing the electrical and technical characteristics of each item of equipment to be furnished.
- G. Surveys Required as a Part of The Technical Submittal:
  - 1. The Contractor shall provide the following System survey(s) that depict various system features and capacities required in addition to the on-site survey requirements described herein. Each survey shall be in writing and contain the following information (the formats are suggestions and may be used for the initial Technical Submittal Survey requirements), as a minimum:
    - a. PA Cable System Design Plan:
      - 1) An OEM and contractor designed functioning PA System cable plan to populate the entire TIP empty conduit/pathway distribution systems provided as a part of Specification 27 11 00 shall be provided as a part of the technical proposal. A specific functioning PA: cable, interfaces, J-boxes and back boxes shall coincide with the total growth items as described herein. It is the Contractor's responsibility to provide the Systems' entire PA cable and accessory requirements and

engineer a functioning PA distribution system and equipment requirement plan.

2) The Required PA Equipment locations.

#### **1.9 PROJECT RECORD DOCUMENTS (AS BUILTS)**

- A. Throughout progress of the Work, maintain an accurate record of changes in Contract Documents. Upon completion of Work, transfer recorded changes to a set of Project Record Documents.
- B. The floorplans shall be marked in pen to include the following:
  - 1. All device locations with UL labels affixed.
  - 2. Conduit locations.
  - 3. Each interface and equipment specific location.
  - 5. Telecommunication Outlet (s -TCO) equipment and specific location
  - 6. TIP Wiring diagram(s).
  - 7. Warranty certificate.
  - 8. System test results.
  - 9. System Completion Document(s) or MOU.

#### **1.10 WARRANTIES / GUARANTY**

- A. The Contractor shall warrant the installation to be free from defect in material and workmanship for a period of two (2) years from the date of acceptance of the project by the owner. The Contractor shall agree to remedy covered defects within four (4) hours of notification of major failures or within twenty-four (24) hours of notification for individual station related problems.
- B. The Contractor shall agree to grantee the system according to the guidelines outlined in Article 4 herein.

#### **1.11 USE OF THE SITE**

- A. Use of the site shall be at the GC's direction.
- B. Coordinate with the GC for lay-down areas for product storage and administration areas.
- C. Coordinate work with the GC and their sub-contractors.
- D. Access to buildings wherein the work is performed shall be directed by the GC.

#### **1.12 DELIVERY, STORAGE, AND HANDLING**

- A. Deliver, store, and handle products using means and methods that will prevent damage, deterioration, and loss, including theft.
- B. Store products in original containers.

- C. Coordinate with the GC for product storage. There may be little or no storage space available on site. Plan to potentially store materials off site.
- D. Do not install damaged products. Remove damaged products from the site and replaced with new product at no cost to the Owner.

#### **1.13 PROJECT CLOSE-OUT**

- A. Prior to final inspection and acceptance of the work, remove all debris, rubbish, waste material, tools, construction equipment, machinery and surplus materials from the project site and thoroughly clean your work area.
- B. Before the project closeout date, the Contractor shall submit:
  - 1. Warranty certificate.
  - 2. Evidence of compliance with requirements of governing authorities such as the Low Voltage Certificate of Inspection.
  - 3. Project record documents.
  - 4. Instruction manuals and software that is a part of the system.
- C. Contractor shall submit written notice that:
  - 1. Contract Documents have been reviewed.
  - 2. Project has been inspected for compliance with contract.
  - 3. Work has been completed in accordance with the contract.

### **PART 2 - PRODUCTS / FUNCTIONAL REQUIREMENTS**

#### **2.0 GENERAL REQUIREMENTS FOR EQUIPMENT AND MATERIALS**

- A. The specific location for the PA equipment is shown on the Drawings.
- B. Coordinate features and select interface components to form an integrated PA system. Match components and interconnections between the systems for optimum performance of specified functions. Provide all new equipment necessary for a fully functional system, including but not limited to amplifiers, headends, etc.
- C. Expansion Capability: The PA equipment interfaces and cables shall be able to increase number of enunciation points in the future by a minimum of 50 percent (%) above those indicated without adding any internal or external components or main trunk cable conductors.
- D. Equipment: Active electronic type shall use solid-state components, fully rated for continuous duty unless otherwise indicated. Select equipment for normal operation on input power usually supplied between 110 to 130 VAC, 60 Hz.



- E. Meet all FCC requirements regarding low radiation and/or interference of RF signal(s). The system shall be designed to prevent direct pickup of signals from within and outside the building structure.
- F. Deliver a fully functioning and operable PA in the specific locations shown on the drawings.

## **2.1 SYSTEM DESCRIPTION**

- A. Furnish and install a complete and fully functional and operable PA system as an extension of the existing building system. Provide all new equipment necessary for a fully functional system, including but not limited to amplifiers, headends, etc. Provide additional require conduit(s) according to Specification 27 11 00.
- B. The Contractor shall continually employ interfacing methods that are approved by the OEM and VA. At a minimum, an acceptable interfacing method requires not only a physical and mechanical connection, but also a matching of signal, voltage, and processing levels with regard to signal quality and impedance. The total PA system shall be configured and installed so that the combination of equipment actually employed does not produce any undesirable visual or aural effects such as signal distortions, noise pulses, glitches, hum, transients, images, etc. The interface points must adhere to all standards described herein for the full separation of Critical Care and Life Safety systems.
- C. It is not acceptable to utilize the telephone cable system for the control of radio signals and equipment. The System Contractor shall connect the Telephone System Remote Control System to the Radio System Paging Control Unit ensuring that all NFPA and UL Critical Care and Life Safety Circuit and System separation guidelines are satisfied. The System Contractor is not allowed to make any connections to the Telephone System. The Owner shall arrange for the interconnection between the PA and Telephone Systems with the appropriate responsible parties.
- D. The System shall interface with the Facility's existing PAS so that a global page (aka "all call" page) is communicated to the existing PAS and the new System of this project. Arrangements for interconnection of the System and the telephone system(s) shall be coordinated with the owner and the PBX provider.

- E. All passive distribution equipment shall meet or exceed -80 dB radiation shielding (aka RFI) shielding specifications and be provided with screw type audio connectors.
- F. All equipment face plates utilized in the system shall be stainless steel, anodized aluminum or UL approved cycolac plastic for the areas where provided.
- G. All trunk, branch, and interconnecting cables and unused equipment ports or taps shall be terminated with proper terminating resistors designed for RF, audio and digital cable systems without adapters.
- H. Noise filters and surge protectors shall be provided for each equipment interface cabinet, headend cabinet, control console and local and remote amplifier locations to insure protection from input primary AC power surges and to insure noise glitches are not induced into low voltage data circuits.
- I. Plug-in connectors shall be provided to connect all equipment, except coaxial cables and RF transmission line interface points. Coaxial cable distribution points and RF transmission lines shall use coaxial cable connections recommended by the cable OEM and approved by the system OEM. Base band cable systems shall utilize barrier terminal screw type connectors, at a minimum. As an alternate, crimp type connectors installed with a ratchet type installation tool are acceptable provided the cable dress, pairs, shielding, grounding, connections and labeling are the same as the barrier terminal strip connectors. Tape of any type, wire nuts or solder type connections are unacceptable and will not be approved.
- J. Contractor is responsible for pricing all accessories and miscellaneous equipment required to form a complete and operating system. Unless otherwise noted in this Part, equipment quantities shall be as indicated on the drawings.

## **2.2 SYSTEM PERFORMANCE:**

- A. At a minimum, each distribution, interconnection, interface, terminating point and TCO shall be capable of supporting the Facility's PA system voice and data service as follows:
  - 1. Shall be compliant with and not degrade the operating parameters of the Public Switched Telephone Network (PSTN) and the Federal Telecommunications System (FTS) at each PSTN and FTS interface, interconnection and terminating locations in the TERS.

2. Audio Input: The signal level of each audio input channel at each input point shall be a MINIMUM of zero decibels measured (dBm), +0.10 dBm across 150 Ohms, balanced.
3. Audio Output: The audio signal level at each speaker shall be a MINIMUM of +0.25 Watt (W) and a maximum of +20 W, 600 Ohms balanced impedance, on a 70.7 V audio distribution line Contractor to determine and set each speaker's proper audio signal level (top) based on speaker location and the ambient noise level in speaker coverage area.
4. The system shall meet the following MINIMUM parameters at each speaker:
  - a. Cross Modulation: -46 dB
  - b. Hum Modulation: -55 dB
  - c. Isolation (outlet-outlet): 24 dB
  - d. Impedance:
    - 1) Distribution: 600 Ohm balanced @ 70.7 V audio line level.
    - 2) Speaker: Selectable, as required.
  - e. Audio Gain: 10 dB minimum @ mid-range measured with a sound pressure level meter (SPL)
  - f. Signal to noise (S/N) ratio: 35 dB, minimum
- B. Audio Level Processing: The head-end equipment shall consist of audio mixer(s), volume limiter(s) and/or compressor(s), and power amplifier(s) to process, adjust, equalize, isolate, filter, and amplify each audio channel for each zone or sub-zone in the system and distribute them into the system's distribution trunks. It is acceptable to use identified telephone system cable pairs designated for PA use or identified as spare telephone cable pairs by the Facility's Telephone System Contractor.
  1. THE USE OF TELEPHONE CABLE TO DISTRIBUTE PA SIGNALS CARRYING AC OR DC VOLTAGE IS NOT ACCEPTABLE AND WILL NOT BE APPROVED.
  2. Additionally, each remote location shall be provided with the equipment required to ensure the system supervision and designed audio channel capacity at each speaker identified on the contract drawings.

## 2.3 MANUFACTURERS

- A. All products shall be fully compatible with the existing PA system. The products specified shall be new, FCC and UL Listed, labeled and

produced by OEM of record. An OEM of record shall be defined as a company whose main occupation is the manufacture for sale of the items of equipment supplied and which:

1. Maintains a stock of replacement parts for the item submitted,
2. Maintains engineering drawings, specifications, and operating manuals for the items submitted, and
3. Has published and distributed descriptive literature and equipment specifications on the items of equipment submitted at least 30 days prior to the Invitation for Bid (IFB).

B. Specifications contained herein as set forth in this document detail the salient operating and performance characteristics of equipment in order for VA to distinguish acceptable items of equipment from unacceptable items of equipment. When an item of equipment is offered or furnished for which there is a specification contained herein, the item of equipment offered or furnished shall meet or exceed the specification for that item of equipment.

C. Equipment Standards and Testing:

1. The System has been defined herein as connected to systems identified as an Emergency performing Public Safety Support Functions. Therefore, at a minimum, the system shall conform to all aforementioned National and/or Local Public and Life Safety Codes (which ever are the more stringent), NFPA, NEC, this specification, JCAHCO Life Safety Accreditation requirements, and the OEM recommendations, instructions, and guidelines.
2. All supplies and materials shall be listed, labeled or certified by UL or a nationally recognized testing laboratory (NRTL) where such standards have been established for the supplies, materials or equipment.
3. The provided equipment required by the System design and approved technical submittal must conform with each UL standard in effect for the equipment, as of the date of the technical submittal (or the date when the COR approved system equipment necessary to be replaced) was technically reviewed and approved by VA. Where a UL standard is in existence for equipment to be used in completion of this contract, the equipment must bear the approved UL seal.
4. Each item of electronic equipment to be provided under this contract must bear the approved UL seal or the seal of the testing laboratory

that warrants the equipment has been tested in accordance with, and conforms to the specified standards. The placement of the UL Seal shall be a permanent part of the electronic equipment that is not capable of being transportable from one equipment item to another.

## **2.4 PRODUCTS**

### **A. General.**

1. Contractor is responsible for pricing all accessories and miscellaneous equipment required to form a complete and operating system. The equipment quantities provided herein shall be as indicated on the drawings with the exception of the indicated spare equipment.
2. Contractor Furnished Equipment List (CFEs):
  - a. The Contractor is required to provide a list of the CFE equipment to be furnished. The quantity, make and model number of each item is required. Select the required equipment items quantities that will satisfy the needs of the system as described herein and with the OEM's concurrence applied to the list(s), in writing.

### **B. TER, TCR, TR, SCC, PCR, STR, HER Rooms and Equipment:**

Refer to CFM Physical Security Manual (07-2007) for VA Facilities, Chapters 9.3 & 1) and PG 18-10, EDM, Chapters 7- Table 7-1, 8 & Appendix B, Telecommunications One Line Topology for specific Room and TIP Connection Requirements.

#### **1. Interface Equipment:**

##### **a. TER:**

##### **1) Head-End Equipment**

- a) Provide all required power supplies, communications hubs, network switches, intelligent controllers and other devices necessary to form a complete system listed herein. Head-end components may be rack mounted or wall mounted in a metal enclosure.
- b) Provide the head end equipment in the closed telecommunications closet where the PA system is installed to include the minimum equipment listed herein.
- c) Provide minimum of 30 minute battery back-up to system components.

##### **2) Amplifier Equipment:**

- a) Paging (aka zone):

- 1) Inputs for 600-ohm balanced telephone line, LO-Z balanced microphone, and background music.
- 2) Input Sensitivity: Compatible with master stations and central equipment so amplifier delivers full rated output with sound-pressure level of less than 10 dynes/sq. cm impinging on master stations speaker microphones, or handset transmitters
- 3) Automatic Level Control (ALC) for pages, adjustable adjustable background music muting level during page, wall or rack mountable.
- 4) 16-ohm, 25V, 25V center tapped (CT), and 70V outputs. Amplifier quantity and size (output power) as needed. Continuous amplifier power rating shall exceed loudspeaker load on amplifier by at least 25%.
- 5) Output Power: 70-V balanced line. 80 percent of the sum of wattage settings of connected for each station and speaker connected in all-call mode of operation, plus an allowance for future stations.
- 6) Total Harmonic Distortion: Less than 5 percent at rated output power with load equivalent to quantity of stations connected in all-call mode of operation.
- 7) Minimum Signal-to-Noise Ratio: 45 dB, at rated output.
- 8) Frequency Response: Within plus or minus 3 dB from 70 to 12,000 Hz.
- b) Output Regulation: Maintains output level within 2 dB from full to no load.
- c) Amplifier Protection: Prevents damage from shorted or open output.
- d) Be provided with electronic supervision function(s).
- e) Provide one spare amplifier.

C. TIP DISTRIBUTION SYSTEM:

1. System Speakers:

a. Ceiling Cone-Type:

- 1) Minimum Axial Sensitivity: 91 dB at one meter, with 1-W input.
- 2) Frequency Response: Within plus or minus 3 dB from 70 to 15,000 Hz.
- 3) Minimum Dispersion Angle: 100 degrees.

- 4) Line Transformer: Maximum insertion loss of 0.5 dB, power rating equal to speaker's, and at least four level taps.
  - 5) Enclosures: Steel housings or back boxes, acoustically dampened, with front face of at least 0.0478-inch steel and whole assembly rust proofed and factory primed; complete with mounting assembly and suitable for surface ceiling, flush ceiling, pendant or wall mounting; with relief of back pressure.
  - 6) Baffle: For flush speakers, minimum thickness of 0.032-inch aluminum with textured white finish. Completely fill the baffle with fiberglass.
  - 7) Vandal-Proof, High-Strength Baffle: For flush-mounted speakers, self-aging cast aluminum with tensile strength of 44,000 psi, 0.025-inch minimum thickness; countersunk heat-treated alloy mounting screws; and textured white epoxy finish.
  - 8) Size: 8 inches with 1-inch voice coil and minimum 5-oz. ceramic magnet.
  - 9) Have a minimum of two (2) safety wires installed to a solid surface or use a flexible conduit from ceiling / wall back box to the speaker back box.
  - 10) The speakers and mounting shall be self contained and wall mounted with flush back box at a minimum of 10 meter intervals and shall match (or contrast with, at the direction of the RE) the color of the adjacent surfaces.
  - 11) Provide one spare speaker, mount, and back box for each 50 speakers or portion thereof.
- b. System Cables: In addition to the TIP provided under Specification Section 27 15 00 - TIP Horizontal and Vertical Communications Cabling, provide the following additional TIP installation and testing requirements, provide the following minimum System TIP cables & interconnections:
- 1) Line Level Audio and Microphone Cable:
    - a) Line level audio and microphone cable for inside racks and conduit.

- b) Shielded, twisted pair Minimum 22 American Wire Gauge (AWG), stranded conductors and 24 AWG drain wire with overall jacket.
  - 2) Speaker Level (Audio 70.7Volt [V]) Cable, Riser Rated:
    - a) For use with 70.7 V audio speaker circuits.
    - b) 18 AWG stranded pair, minimum.
    - c) UL-1333 listed.
  - 3) Speaker Level Audio Cable, Plenum Rated (70.7V):
    - a) For use with 70.7 V audio speaker circuits.
    - b) 18 AWG stranded pair, minimum.
  - 4) All cabling shall be riser rated.
  - 5) Provide one (1) spare 1,000 foot roll of approved System (not microphone) cable only.
2. Raceways, Back Boxes and conduit:
- a. Raceways:
    - 1) In addition to the Raceways, Equipment Room Fittings provided under Specification Sections 27 15 00 TIP Communication Room Fittings and 27 15 00 - TIP Communications Horizontal and Vertical Cabling, provide the following additional TIP raceway and fittings:
    - 2) Each raceway that is open top, shall be: UL certified for telecommunications systems, partitioned with metal partitions in order to comply with NEC Parts 517 & 800 to "mechanically separate telecommunications systems of different service, protect the installed cables from falling out when vertically mounted and allow junction boxes to be attached to the side to interface "drop" type conduit cable feeds.
    - 3) Intercommunication System cable infrastructure: EMT or in J-hooks above accessible ceilings, 24 inches on center.
    - 4) Junction boxes shall be not less than 2-1/2 inches deep and 6 inches wide by 6 inches long.
    - 5) Flexible metal conduit is prohibited unless specifically approved by 0050P3B.
  - b. System Conduit:
    - 1) The PA system is NFPA listed as Emergency / Public Safety Communication System which requires the entire system to be installed in a separate conduit system.



2) The use of centralized mechanically partitioned wireways may be used to augment main distribution conduit on a case by case basis when specifically approved by VA Headquarters (0050P3B).

3) Conduit Sleeves:

a) The AE has made a good effort to identify where conduit sleeves through full-height and fire rated walls on the drawings, and has instructed the electrician to provide the sleeves as shown on the drawings.

b) While the sleeves shown on the drawings will be provided by others, the contractor is responsible for installing conduit sleeves and fire-proofing where necessary. It is often the case, that due to field conditions, the nurse-call cable may have to be installed through an alternate route. Any conduit sleeves required due to field conditions or those omitted by the engineer shall be provided by the cabling contractor.

3. Device Back Boxes:

a. Furnish to the electrical contractor all back boxes required for the PA system devices.

b. The electrical contractor shall install the back boxes as well as the system conduit. Coordinate the delivery of the back boxes with the construction schedule.

D. Installation Kit:

1. General: The kit shall be provided that, at a minimum, includes all connectors and terminals, labeling systems, audio spade lugs, barrier strips, punch blocks or wire wrap terminals, heat shrink tubing, cable ties, solder, hangers, clamps, bolts, conduit, cable duct, and/or cable tray, etc., required to accomplish a neat and secure installation. All wires shall terminate in a spade lug and barrier strip, wire wrap terminal or punch block. Unfinished or unlabeled wire connections shall not be allowed. Turn over to the COR all unused and partially opened installation kit boxes, coaxial, fiberoptic, and twisted pair cable reels, conduit, cable tray, and/or cable duct bundles, wire rolls, physical installation hardware. The following are the minimum required installation sub-kits:

2. System Grounding:

- a. The grounding kit shall include all cable and installation hardware required. All radio equipment shall be connected to earth ground via internal building wiring, according to the NEC.
- b. This includes, but is not limited to:
  - 1) Coaxial Cable Shields.
  - 2) Control Cable Shields.
  - 3) Data Cable Shields.
  - 4) Equipment Racks.
  - 5) Equipment Cabinets.
  - 6) Conduits.
  - 7) Duct.
  - 8) Cable Trays.
  - 9) Power Panels.
  - 10) Connector Panels.
  - 11) Grounding Blocks.
3. Coaxial Cable: The coaxial cable kit shall include all coaxial connectors, cable tying straps, heat shrink tabbing, hangers, clamps, etc., required to accomplish a neat and secure installation.
4. Wire and Cable: The wire and cable kit shall include all connectors and terminals, audio spade lugs, barrier straps, punch blocks, wire wrap strips, heat shrink tubing, tie wraps, solder, hangers, clamps, labels etc., required to accomplish a neat and orderly installation.
5. Conduit, Cable Duct, and Cable Tray: The kit shall include all conduit, duct, trays, junction boxes, back boxes, cover plates, feed through nipples, hangers, clamps, other hardware required to accomplish a neat and secure conduit, cable duct, and/or cable tray installation in accordance with the NEC and this document.
6. Equipment Interface: The equipment kit shall include any item or quantity of equipment, cable, mounting hardware and materials needed to interface the systems with the identified sub-system(s) according to the OEM requirements and this document.
7. Labels: The labeling kit shall include any item or quantity of labels, tools, stencils, and materials needed to completely and correctly label each subsystem according to the OEM requirements, as-installed drawings, and this document.
8. Documentation: The documentation kit shall include any item or quantity of items, computer discs, as installed drawings, equipment,

maintenance, and operation manuals, and OEM materials needed to completely and correctly provide the system documentation as required by this document and explained herein.

### **PART 3 - EXECUTION**

#### **3.1 PROJECT MANAGEMENT**

- A. Assign a single project manager to this project who will serve as the point of contact for the Owner, the General Contractor, and the Engineer.
- B. The Contractor shall be proactive in scheduling work at the hospital, specifically the Contractor will initiate and maintain discussion with the general contractor regarding the schedule for ceiling cover up and install cables to meet that schedule.
- C. Contact the Office of Telecommunications, Special Communications Team (0050P3B) at (301) 734-0350 to have a VA Certified Telecommunications Representative assigned to the project for telecommunications review, equipment and system approval and co-ordination with VA's Spectrum Management and OCIS Teams.

#### **3.2 COORDINATION WITH OTHER TRADES**

- A. Coordinate with the VA the location of the PA system faceplate and the faceplate opening for the PA system back boxes.
- B. Before beginning work, verify the location, quantity, size and access for the following:
  - 1. Junction boxes, wall boxes, wire troughs, conduit stubs and other related infrastructure for the systems.
  - 2. System components installed by others.
  - 3. Overhead supports and rigging hardware installed by others.
- C. Immediately notify the Owner, GC and Consultant(s) in writing of any discrepancies

#### **3.3 NEEDS ASSESSMENT**

Provide a one-on-one meeting with the particular manager of each unit affected by the installation of the new PA system. Review the floor plan drawing, educate the nursing manager with the functions of the equipment that is being provided and gather details specific to the individual units; coverage and priorities of calls; staffing patterns; and other pertinent details that will affect system programming and training.

### **3.4 INSTALLATION**

#### **A. General**

1. Execute work in accordance with National, State and local codes, regulations and ordinances.
2. Install work neatly, plumb and square and in a manner consistent with standard industry practice. Carefully protect work from dust, paint and moisture as dictated by site conditions. The Contractor will be fully responsible for protection of his work during the construction phase up until final acceptance by the Owner.
3. Install equipment according to OEM's recommendations. Provide any hardware, adaptors, brackets, rack mount kits or other accessories recommended by OEM for correct assembly and installation.
4. Secure equipment firmly in place, including receptacles, speakers, system cables, etc.
  - a. All supports, mounts, fasteners, attachments and attachment points shall support their loads with a safety factor of at least 5:1.
  - b. Do not impose the weight of equipment or fixtures on supports provided for other trades or systems.
  - c. Any suspended equipment or associated hardware must be certified by the OEM for overhead suspension.
  - d. The Contractor is responsible for means and methods in the design, fabrication, installation and certification of any supports, mounts, fasteners and attachments.
5. Locate overhead ceiling-mounted loudspeakers as shown on drawings, with minor changes not to exceed 12" in any direction.
  - a. Mount transformers securely to speaker brackets or enclosures using screws. Adjust torsion springs as needed to securely support speaker assembly.
  - b. Speaker back boxes shall be completely filled with fiberglass insulation.
  - c. Seal cone speakers to their enclosures to prevent air passing from one side of the speaker to the other.
6. Finishes for any exposed work such as plates, racks, panels, speakers, etc. shall be approved by the Architect, Owner and 0050P3B.

7. Coordinate cover plates with field conditions. Size and install cover plates as necessary to hide joints between back boxes and surrounding wall. Where cover plates are not fitted with connectors, provide grommets in size and quantity required. Do not allow cable to leave or enter boxes without cover plates installed.
  8. Active electronic component equipment shall consist of solid state components, be rated for continuous duty service, comply with the requirements of FCC standards for telephone and data equipment, systems, and service.
  9. Color code all distribution wiring to conform to the PA Industry Standard, EIA/TIA, and this document, whichever is the more stringent. At a minimum, all equipment, cable duct and/or conduit, enclosures, wiring, terminals, and cables shall be clearly and permanently labeled according to and using the provided record drawings, to facilitate installation and maintenance.
  10. Connect the System's primary input AC power to the Facility's Critical Branch of the Emergency AC power distribution system as shown on the plans or if not shown on the plans consult with COR regarding a suitable circuit location prior to bidding.
  11. Product Delivery, Storage and Handling:
    - a. Delivery: Deliver materials to the job site in OEM's original unopened containers, clearly labeled with the OEM's name and equipment catalog numbers, model and serial identification numbers. The COR may inventory the cable, patch panels, and related equipment.
    - b. Storage and Handling: Store and protect equipment in a manner, which will preclude damage as directed by the RE.
  12. Where TCOs are installed adjacent to each other, install one outlet for each instrument.
  13. Equipment installed outdoors shall be weatherproof or installed in weatherproof enclosures with hinged doors and locks with two keys.
- B. Wiring Practice - in addition to the MANDATORY infrastructure requirements outlined in VA Construction Specifications 27 10 00 - TIP Structured Communications Cabling, 27 11 00 - TIP Communications Rooms Fittings and 27 15 00 - TIP Horizontal and Vertical Communicators Cabling, the following additional practices shall be adhered to:

1. Comply with requirements for raceways and boxes specified in Division 26 Section "Raceway and Boxes for Electrical Systems."
2. Execute all wiring in strict adherence to the National Electrical Code, applicable local building codes and standard industry practices.
3. Wiring shall be classified according to the following low voltage signal types:
  - a. Balanced microphone level audio (below -20dBm) or Balanced line level audio (-20dBm to +30dBm)
  - b. 70V audio speaker level audio.
  - c. Low voltage DC control or power (less than 48VDC)
4. Where raceway is to be EMT (conduit), wiring of differing classifications shall be run in separate conduit. Where raceway is to be an enclosure (rack, tray, wire trough, utility box) wiring of differing classifications which share the same enclosure shall be mechanically partitioned and separated by at least four (4) inches. Where Wiring of differing classifications must cross, they shall cross perpendicular to one another.
5. Do not splice wiring anywhere along the entire length of the run. Make sure cables are fully insulated and shielded from each other and from the raceway for the entire length of the run.
6. Do not pull wire through any enclosure where a change of raceway alignment or direction occurs. Do not bend wires to less than radius recommended by manufacturer.
7. Replace the entire length of the run of any wire or cable that is damaged or abraided during installation. There are no acceptable methods of repairing damaged or abraided wiring.
8. Use wire pulling lubricants and pulling tensions as recommended by the OEM.
9. Use grommets around cut-outs and knock-outs where conduit or chase nipples are not installed.
10. Do not use tape-based or glue-based cable anchors.
11. Ground shields and drain wires to the Facility's signal ground system as indicated by the drawings.
12. Field wiring entering equipment racks shall be terminated as follows:

- a. Provide ample service loops at harness break-outs and at plates, panels and equipment. Loops should be sufficient to allow plates, panels and equipment to be removed for service and inspection.
  - b. Line level and speaker level wiring may be terminated inside the equipment rack using specified terminal blocks (see "Products.") Provide 15% spare terminals inside each rack. Microphone level wiring may only be terminated at the equipment served.
  - c. If specified terminal blocks are not designed for rack mounting, utilize  $\frac{3}{4}$ " plywood or  $\frac{1}{8}$ " thick aluminum plates/blank panels as a mounting surface. Do not mount on the bottom of the rack.
  - d. Employ permanent strain relief for any cable with an outside diameter of 1" or greater.
13. Use only balanced audio circuits unless noted otherwise
14. Make all connections as follows:
- a. Make all connections using rosin-core solder or mechanical connectors appropriate to the application.
  - b. For crimp-type connections, use only tools that are specified by the manufacturer for the application.
  - c. Use only insulated spade lugs on screw terminals. Spade lugs shall be sized to fit the wire gauge. Do not exceed two lugs per terminal.
  - d. Wire nuts, electrical tape or "Scotch Lock" connections are not acceptable for any application.
15. Make all connections as follows:
- a. Make all connections using rosin-core solder or mechanical connectors appropriate to the application.
  - b. For crimp-type connections, use only tools that are specified by the manufacturer for the application.
  - c. Use only insulated spade lugs on screw terminals. Spade lugs shall be sized to fit the wire gauge. Do not exceed two lugs per terminal.
  - d. Wire nuts, electrical tape or "Scotch Lock" connections are not acceptable for any application.
16. Noise filters and surge protectors shall be provided for each equipment interface cabinet, switch equipment cabinet, control console, local, and remote active equipment locations to ensure

protection from input primary AC power surges and noise glitches are not induced into low Voltage data circuits.

17. Wires or cables previously approved to be installed outside of conduit, cable trays, wireways, cable duct, etc:
  - a. Only when specifically authorized as described herein, will wires or cables be identified and approved to be installed outside of conduit. The wire or cable runs shall be UL rated plenum and OEM certified for use in air plenums.
  - b. Wires and cables shall be hidden, protected, fastened and tied at 600 mm (24 in.) intervals, maximum, as described herein to building structure.
  - c. Closer wire or cable fastening intervals may be required to prevents sagging, maintain clearance above suspended ceilings, remove unsightly wiring and cabling from view and discourage tampering and vandalism. Wire or cable runs, not provided in conduit, that penetrate outside building walls, supporting walls, and two hour fire barriers shall be sleeved and sealed with an approved fire retardant sealant.
  - d. Wire or cable runs to system components installed in walls (i.e.: volume attenuators, circuit controllers, signal, or data outlets, etc.) may, when specifically authorized by the RE, be fished through hollow spaces in walls and shall be certified for use in air plenum areas.
  - e. Completely test all of the cables after installation and replace any defective cables.
  - f. Wires or cables that are installed outside of buildings shall be in conduit, secured to solid building structures. If specifically approved, on a case by case basis, to be run outside of conduit, the wires or cables shall be installed, as described herein. The bundled wires or cables must: Be tied at not less than 460 mm (18 in.) intervals to a solid building structure; have ultra violet protection and be totally waterproof (including all connections). The laying of wires or cables directly on roof tops, ladders, drooping down walls, walkways, floors, etc. is not allowed and will not be approved.

E. Cable Installation - In addition to the MANDATORY infrastructure requirements outlined in VA Construction Specifications 27 10 00 -



Structured TIP Communications Cabling, 27 11 00 - TIP Communications Rooms and Fittings and 27 15 00 - TIP Communications Horizontal and Vertical Cabling and the following additional practices shall be adhered too:

1. Support cable on maximum 2'-0" centers. Acceptable means of cable support are cable tray, j-hooks, and bridal rings. Velcro wrap cable bundles loosely to the means of support with plenum rated Velcro straps. Plastic tie wraps are not acceptable as a means to bundle cables.
2. Run cables parallel to walls.
3. Install maximum of 10 cables in a single row of J-hooks. Provide necessary rows of J-hooks as required by the number of cables.
4. Do not lay cables on top of light fixtures, ceiling tiles, mechanical equipment, or ductwork. Maintain at least 2'-0" clearance from all shielded electrical apparatus.
5. All cables shall be tested after the total installation is fully complete. All test results are to be documented. All cables shall pass acceptable test requirements and levels. Contractor shall remedy any cabling problems or defects in order to pass or comply with testing. This includes the re-pull of new cable as required at no additional cost to the Owner.
6. Ends of cables shall be properly terminated on both ends per industry and OEM's recommendations.
7. Provide proper temporary protection of cable after pulling is complete before final dressing and terminations are complete. Do not leave cable lying on floor. Bundle and tie wrap up off of the floor until you are ready to terminate.
8. Terminate all conductors; no cable shall contain unterminated elements. Make terminations only at outlets and terminals.
9. Splices, Taps, and Terminations: Arrange on numbered terminal strips in junction, pull, and outlet boxes; terminal cabinets; and equipment enclosures. Cables may not be spliced.
10. Bundle, lace, and train conductors to terminal points without exceeding OEM's limitations on bending radii. Install lacing bars and distribution spools.
11. Cold-Weather Installation: Bring cable to room temperature before dereeling. Heat lamps shall not be used.

12. Cable shall not be run through structural members or be in contact with pipes, ducts, or other potentially damaging items.

13. Separation of Wires: (REFER TO RACEWAY INSTALLATION) Separate speaker-microphone, line-level, speaker-level, and power wiring runs. Install in separate raceways or, where exposed or in same enclosure, separate conductors at least 12 inches apart for speaker microphones and adjacent parallel power and telephone wiring. Separate other intercommunication equipment conductors as recommended by equipment manufacturer.

14. Serve all cables as follows:

- a. Cover the end of the overall jacket with a 1" (minimum) length of transparent heat-shrink tubing. Cut unused insulated conductors 2" (minimum) past the heat-shrink, fold back over jacket and secure with cable-tie. Cut unused shield/drain wires 2" (minimum) past the Heatshrink and serve as indicated below.
- b. Cover shield/drain wires with heat-shrink tubing extending back to the overall jacket. Extend tubing ¼" past the end of unused wires, fold back over jacket and secure with cable tie.
- c. For each solder-type connection, cover the bare wire and solder connection with heat-shrink tubing.

F. Labeling: Provide labeling in accordance with ANSI/EIA/TIA-606-A. All lettering for PA circuits shall be stenciled using laser printer.

1. Cable and Wires (Hereinafter referred to as "Cable"): Cables shall be labeled at both ends in accordance with ANSI/EIA/TIA-606-A. Labels shall be permanent in contrasting colors. Cables shall be identified according to the System "Record Wiring Diagrams."

2. Equipment: System equipment shall be permanently labeled with contrasting plastic laminate or Bakelite material. System equipment shall be labeled on the face of the unit corresponding to its source.

- a. Clearly, consistently, logically and permanently mark switches, connectors, jacks, relays, receptacles and electronic and other equipment.
- b. Engrave and paint fill all receptacle panels using 1/8" (minimum) high lettering and contrasting paint.

- c. For rack-mounted equipment, use engraved Lamacoid labels with white 1/8" (minimum) high lettering on black background. Label the front and back of all rack-mounted equipment.
3. Conduit, Cable Duct, and/or Cable Tray: The Contractor shall label all conduit, duct and tray, including utilized GFE, with permanent marking devices or spray painted stenciling a minimum of 3 meters (10 ft.) identifying it as the System. In addition, each enclosure shall be labeled according to this standard.
4. Termination Hardware: The Contractor shall label TCOs and patch panel connections using color coded labels with identifiers in accordance with ANSI/EIA/TIA-606-A and the "Record Wiring Diagrams."
5. Where multiple pieces of equipment reside in the same rack group, clearly and logically label each indicating to which room, channel, receptacle location, etc. they correspond.
6. Permanently label cables at each end, including intra-rack connections. Labels shall be covered by the same, transparent heat-shrink tubing covering the end of the overall jacket. Alternatively, computer generated labels of the type which include a clear protective wrap may be used.
7. Contractor's name shall appear no more than once on each continuous set of racks. The Contractor's name shall not appear on wall plates or portable equipment.
8. Ensure each OEM supplied item of equipment has appropriate UL Labels / Marks for the service the equipment is performed permanently attached / marked. SYSTEM EQUIPMENT INSTALLED NOT BEARING THESE UL MARKS WILL NOT BE ALLOWED TO BE A PART OF THE SYSTEM. THE CONTRACTOR SHALL BEAR ALL COSTS REQUIRED TO PROVIDE REPLACEMENT EQUIPMENT WITH APPROVED UL MARKS.
- G. Conduit and Signal Ducts: When the Contractor and/or OEM determines additional system conduits and/or signal ducts are required in order to meet the system minimum performance standards outlined herein, the contractor shall provide these items as follows:
  1. Conduit:
    - a. The Contractor shall employ the latest installation practices and materials. The Contractor shall provide conduit, junction boxes, connectors, sleeves, weather heads, pitch pockets, and associated sealing materials not specifically identified in this document as

GFE. Conduit penetrations of walls, ceilings, floors, interstitial space, fire barriers, etc., shall be sleeved and sealed.

- b. All cables shall be installed in separate conduit and/or signal ducts (exception from the separate conduit requirement to allow PA cables to be installed in partitioned cable tray with voice cables may be granted in writing by the COR if requested). Conduits shall be provided in accordance with Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and NEC Articles 517 for Critical Care and 800 for Communications systems, at a minimum.
  - c. When metal, plastic covered, etc., flexible cable protective armor or systems are specifically authorized to be provided for use in the System, their installation guidelines and standards shall be as specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.
  - d. When "interduct" flexible cable protective systems is specifically authorized to be provided for use in the System, it's installation guidelines and standards shall be as the specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.
  - e. Conduit fill (including GFE approved to be used in the system) shall not exceed 40%. Each conduit end shall be equipped with a protective insulator or sleeve to cover the conduit end, connection nut or clamp, to protect the wire or cable during installation and remaining in the conduit. Electrical power conduit shall be installed in accordance with the NEC. AC power conduit shall be run separate from signal conduit.
  - f. Ensure that Critical Care PA and Nurse Call Systems (as identified by NEC Section 517) are completely separated and protected from all other systems.
2. Signal Duct, Cable Duct, or Cable Tray:
- a. The Contractor shall use GFE signal duct, cable duct, and/or cable tray, when identified and approved by the RE.
  - b. Approved signal and/or cable duct shall be a minimum size of 100 mm x 100 mm (4 in. X 4 in.) inside diameter with removable tops or sides, as appropriate. Protective sleeves, guides or barriers

are required on all sharp corners, openings, anchors, bolts or screw ends, junction, interface and connection points.

- c. Approved cable tray shall be fully covered, mechanically and physically partitioned for multiple electronic circuit use, and be UL certified and labeled for use with telecommunication circuits and/or systems. The COR shall approve width and height dimensions.
- d. All cable junctions and taps shall be accessible. Provide an 8" X 8" X 4" (minimum) junction box attached to the cable duct or raceway for installation of distribution system passive equipment. Ensure all equipment and tap junctions are accessible

### **3.5 PROTECTION OF NETWORK DEVICES**

Contractor shall protect network devices during unpacking and installation by wearing manufacturer approved electrostatic discharge (ESD) wrist straps tied to chassis ground. The wrist strap shall meet OSHA requirements for prevention of electrical shock, should technician come in contact with high voltage.

### **3.6 CUTTING, CLEANING AND PATCHING**

- A. It shall be the responsibility of the contractor to keep their work area clear of debris and clean area daily at completion of work.
- B. It shall be the responsibility of the contractor to patch and paint any wall or surface that has been disturbed by the execution of this work.
- C. The Contractor shall be responsible for providing any additional cutting, drilling, fitting or patching required that is not indicated as provided by others to complete the Work or to make its parts fit together properly.
- D. The Contractor shall not damage or endanger a portion of the Work or fully or partially completed construction of the Owner or separate contractors by cutting, patching or otherwise altering such construction, or by excavation. The Contractor shall not cut or otherwise alter such construction by the Owner or a separate contractor except with written consent of the Owner and of such separate contractor; such consent shall not be unreasonably withheld. The Contractor shall not unreasonably withhold from the Owner or a separate Contractor the Contractor's consent to cutting or otherwise altering the Work.

- E. Where coring of existing (previously installed) concrete is specified or required, including coring indicated under unit prices, the location of such coring shall be clearly identified in the field and the location shall be approved by the Project Manager prior to commencement of coring work.

### **3.7 FIREPROOFING**

- A. Where PA wires, cables and conduit penetrate fire rated walls, floors and ceilings, fireproof the opening.
- B. Provide conduit sleeves (if not already provided by electrical contractor) for cables that penetrate fire rated walls and Telecommunications Rooms floors and ceilings. After the cabling installation is complete, install fire proofing material in and around all conduit sleeves and openings. Install fire proofing material thoroughly and neatly. Seal all floor and ceiling penetrations.
- C. Use only materials and methods that preserve the integrity of the fire stopping system and its rating.
- D. Install fireproofing where low voltage cables are installed in the same manholes with high voltage cables; also cover the low voltage cables with arc proof and fireproof tape.
- E. Use approved fireproofing tape of the same type as used for the high voltage cables, and apply the tape in a single layer, one-half lapped or as recommended by the manufacturer. Install the tape with the coated side towards the cable and extend it not less than 25 mm (one inch) into each duct.
- F. Secure the tape in place by a random wrap of glass cloth tape.

### **3.8 GROUNDING**

- A. Ground PA cable shields and equipment to eliminate shock hazard and to minimize ground loops, commonmode returns, noise pickup, cross talk, and other impairments as specified in CFM Division 27, Section 27 05 26 - Grounding and Bonding for Communications Systems.
- B. Facility Signal Ground Terminal: Locate at main room or area signal ground within the room (i.e. head end and telecommunications rooms) or area(s) and indicate each signal ground location on the drawings.
- C. Extend the signal ground to inside each equipment cabinet and/or rack. Ensure each cabinet and/or rack installed item of equipment is connected to the extended signal ground. Isolate the signal ground from power and major equipment grounding systems.

- D. When required, install grounding electrodes as specified in CFM Division 26, Section 26 05 26 -Grounding and Bonding for Electrical Systems.
- E. Do not use "3<sup>rd</sup> or 4<sup>th</sup>" wire internal electrical system conductors for communications signal ground.
- F. Do not connect the signal ground to the building's external lightning protection system.
- G. Do Not "mix grounds" of different systems.
- H. Insure grounds of different systems are installed as to not violate OSHA Safety and NEC installation requirements for protection of personnel.

#### **PART 4 - TESTING / GUARANTY / TRAINING**

##### **4.0 SYSTEM LISTING**

The PA System is NFPA listed as an "Emergency / Public Safety" Communications system. Therefore, the following testing and guaranty provisions are the minimum to be performed and provided by the contractor and OEM.

##### **4.1 PROOF OF PERFORMANCE TESTING**

###### **A. Pretesting:**

- 1. Upon completing installation of the speakers, the Contractor shall align, balance, and completely pretest the entire system under full operating conditions.
- 2. Pretesting Procedure:
  - a. During the System Pretest the Contractor shall verify (utilizing approved test equipment) that the System is fully operational and meets all the System performance requirements of this standard.
- 3. The Contractor shall provide four (4) copies of the recorded system pretest measurements and the written certification that the System is ready for the formal acceptance test shall be submitted to the RE.

###### **B. Acceptance Test:**

- 1. After the PA System has been pretested and the Contractor has submitted the pretest results and certification to the RE, then the Contractor shall schedule an acceptance test date and give the COR 30 day's written notice prior to the date the acceptance test is expected to begin. The System shall be tested in the presence of TVE 0050P3B and an OEM certified representatives. The System shall be

- tested utilizing the approved test equipment to certify proof of performance and Emergency / Public Safety compliance. The tests shall verify that the total System meets all the requirements of this specification. The notification of the acceptance test shall include the expected length (in time) of the test.
2. The acceptance test shall be performed on a "go-no-go" basis. Only those operator adjustments required to show proof of performance shall be allowed. The test shall demonstrate and verify that the installed System does comply with all requirements of this specification under operating conditions. The System shall be rated as either acceptable or unacceptable at the conclusion of the test. Failure of any part of the System that precludes completion of system testing, and which cannot be repaired in four (4) hours, shall be cause for terminating the acceptance test of the System. Repeated failures that result in a cumulative time of eight (8) hours to affect repairs shall cause the entire System to be declared unacceptable. Retesting of the entire System shall be rescheduled at the convenience of the Government.
  3. Retesting of the entire System shall be rescheduled at the convenience of the Government and costs borne by the Contractor at the direction of the SRE.

C. Acceptance Test Procedure:

1. Physical and Mechanical Inspection:
  - a. The TVE 0050P3B Representative will tour all areas where the PA system and all sub-systems are completely and properly installed to insure they are operationally ready for proof of performance testing. A system inventory including available spare parts will be taken at this time. Each item of installed equipment shall be checked to ensure appropriate UL certification labels are affixed.
  - b. The System diagrams, record drawings, equipment manuals, TIP Auto CAD Disks, intermediate, and pretest results shall be formally inventoried and reviewed.
  - c. Failure of the System to meet the installation requirements of this specification shall be grounds for terminating all testing.
2. Operational Test:



- a. After the Physical and Mechanical Inspection, the system head end equipment shall be checked to verify that it meets all performance requirements outlined herein. A spectrum analyzer and sound level meter may be utilized to accomplish this requirement.
  - b. Following the head end equipment test, each speaker (or on board speaker) shall be inspected to ensure there are no signal distortions such as intermodulation, data noise, popping sounds, erratic system functions, on any function.
  - c. The distribution system shall be checked at each interface, junction, and distribution point, first, middle, and last speaker in each leg to verify the PA distribution system meets all system performance standards.
  - d. If the RED system is a part of the system, each volume stepper switches shall be checked to insure proper operation of the pillow speaker, the volume stepper and the RED system (if installed).
  - e. Additionally, each installed head end equipment, microphone console; amplifier, mixer, distributed speaker/amplifier, monitor speaker, telephone interface, power supply and remote amplifiers shall be checked insuring they meet the requirements of this specification.
  - f. Once these tests have been completed, each installed sub-system function shall be tested as a unified, functioning and fully operating system. The typical functions are: "all call," three sub-zoned, minimum of 15 minutes of UPS operation, electrical supervision, trouble panel, corridor speakers and audio paging.
  - h. Individual Item Test: The TVE 0050P3B Representative will select individual items of equipment for detailed proof of performance testing until 100% of the System has been tested and found to meet the contents of this specification. Each item shall meet or exceed the minimum requirements of this document.
3. Test Conclusion:
- a. At the conclusion of the Acceptance Test, using the generated punch list (or discrepancy list) the VA and the Contractor shall jointly agree to the results of the test, and reschedule testing on deficiencies and shortages with the RE. Any retesting to

comply with these specifications will be done at the Contractor's expense.

- b. If the System is declared unacceptable without conditions, all rescheduled testing expenses will be borne by the Contractor.
- D. Acceptable Test Equipment: The test equipment shall furnished by the Contractor shall have a calibration tag of an acceptable calibration service dated not more than 12 months prior to the test. As part of the submittal, a test equipment list shall be furnished that includes the make and model number of the following type of equipment as a minimum:
1. Spectrum Analyzer.
  2. Signal Level Meter.
  3. Volt-Ohm Meter.
  4. Sound Pressure Level (SPL) Meter.
  5. Oscilloscope.
  6. Random Noise Generator.
  7. Audio Amplifier with External Speaker.

- - - E N D - - -

**SECTION 27 52 23**  
**NURSE CALL AND CODE BLUE SYSTEMS**

**PART 1 - GENERAL**

**1.1 SECTION SUMMARY**

- A. Work covered by this document includes design, engineering, labor, material and products, equipment warranty and system guarantee, training and services for, and incidental to, the complete installation of new and fully operating National Fire Protection Association (NFPA) - Life Safety Code 101.3-2 (a) Labeled and (b) Listed, Emergency Service Nurse-Call and/or Life Safety listed Code Blue Communication System and associated equipment (here-in-after referred to as the System) provided in approved locations indicated on the contract drawings. These items shall be tested and certified capable of receiving, distributing, interconnecting and supporting Nurse-Call and/or Code Blue communications signals generated local and remotely as detailed herein.
- B. Work shall be complete, Occupational Safety and Health Administration (OSHA), National Recognized Testing Laboratory (NRTL - i.e. Underwriters Laboratory [UL]) Listed and Labeled; and VA Central Office (VACO), Telecommunications Voice Engineering (TVE 005OP3B) tested, certified and ready for operation.
- C. The System shall be delivered free of engineering, manufacturing, installation, and functional defects. It shall be designed, engineered and installed for ease of operation, maintenance, and testing.
- D. The term "provide", as used herein, shall be defined as: designed, engineered, furnished, installed, certified, tested, and guaranteed by the Contractor.
- E. Specification Order of Precedence: In the event of a conflict between the text of this document and the Project's Contract Drawings outlined and/or cited herein; THE TEXT OF THIS DOCUMENT TAKES PRECEDENCE.  
*HOWEVER, NOTHING IN THIS DOCUMENT WILL SUPERSEDE APPLICABLE EMERGENCY LAWS AND REGULATIONS, SPECIFICALLY NATIONAL AND/OR LOCAL LIFE AND PUBLIC SAFETY CODES. The Local Fire Marshall and/or VA Public Safety Officer are the only authorities that may modify this document's EMERGENCY CODE COMPLIANCE REQUIREMENTS, on a case by case basis, in writing and confirmed by VA's Project Manager (PM), Contracting*

Officers Representative (COR) and TVE-005OP3B. The VA PM is the only approving authority for other amendments to this document that may be granted, on a case by case basis, in writhing with technical concurrencies by VA's PM, RE, TVE-005OP3B and identified Facility Project Personnel.

- F. The Original Equipment Manufacturer (OEM) and Contractor shall ensure **that all** management, sales, engineering and installation personnel have read and understand the requirements of this specification **before** the system is designed, engineered, delivered and provided. The Contractor shall furnish a written statement stating this requirement as a part of the technical submittal that includes each name and certification, including the OEMs. The Contractor is cautioned to obtain **in writing, all approvals for system changes relating to the published contract specifications and drawings, from COR before proceeding with change.**

## 1.2 RELATED SECTIONS

- A. 01 33 23 - Shop Drawings, Product Data and Samples.
- B. 07 84 00 - Firestopping.
- C. 26 05 19 - Low - Voltage Electrical Power Conductors and Cables.
- D. 26 41 00 - Facility Lightning Protection.
- E. 27 05 11 - Requirements for Communications Installations.
- F. 27 05 26 - Grounding and Bonding for Communications Systems.
- G. 27 05 33 - Raceways and Boxes for Communications Systems.
- H. 27 10 00 - TIP Structured Communications Systems Cabling.
- I. 27 11 00 - TIP Communications Interface and Equipment Rooms Fittings.
- J. 27 15 00 - TIP Communications Horizontal and Vertical Cabling.
- K. 27 51 16 - Public Address & Mass Notification System (PA).
- L. 10 25 13 - PATIENT BED SERVICE WALLS.

## 1.3 DEFINITION

- A. Provide: Design, engineer, furnish, install, connect complete, test, certify and guarantee.
- B. Work: Materials furnished and completely installed.
- C. Review of contract drawings: A service by the engineer to reduce the possibility of materials being ordered which do not comply with contract documents. The engineer's review shall not relieve the Contractor of responsibility for dimensions or compliance with the contract documents. The reviewer's failure to detect an error does not constitute permission for the Contractor to proceed in error.

D. Headquarters (aka VACO) Technical Review, for National and VA  
Communications and Security, Codes, Frequency Licensing Standards,  
Guidelines and Compliance:

Office of Telecommunications  
Special Communications Team (0050P3B)  
1335 East West Highway - 3rd Floor  
Silver Spring, Maryland 20910,  
(O) 301-734-0350, (F) 301-734-0360

#### **1.4 REFERENCES**

A. The installation shall comply fully with all governing authorities,  
laws and ordinances, regulations, codes and standards, including, but  
not limited to:

1. United States Federal Law:

a. Departments of:

1) Commerce, Consolidated Federal Regulations (CFR), Title 15 -  
Under the Information Technology Management Reform Act (Public  
Law 104-106), the Secretary of Commerce approves standards and  
guidelines that are developed by the:

a) Chapter II, National Institute of Standards Technology  
(NIST - formerly the National Bureau of Standards). Under  
Section 5131 of the Information Technology Management  
Reform Act of 1996 and the Federal Information Security  
Management Act of 2002 (Public Law 107-347), NIST develops  
- Federal Information Processing Standards Publication  
(FIPS) 140-2-Security Requirements for Cryptographic  
Modules.

b) Chapter XXIII, National Telecommunications and Information  
Administration (NTIA - aka 'Red Book') Chapter 7.8 / 9;  
CFR, Title 47 Federal communications Commission (FCC) Part  
15, Radio Frequency Restriction of Use and Compliance in  
"Safety of Life" Functions & Locations.

2) FCC - Communications Act of 1934, as amended, CFR, Title 47 -  
Telecommunications, in addition to Part 15 - Restrictions of  
use for Part 15 listed Radio Equipment in Safety of Life /  
Emergency Functions / Equipment/ Locations (also see CFR,  
Title 15 - Department of Commerce, Chapter XXIII - NTIA):

- a) Part 15 - Restrictions of use for Part 15 listed Radio Equipment in Safety of Life / Emergency Functions / Equipment/Locations.
  - b) Part 58 - Television Broadcast Service.
  - c) Part 90 - Rules and Regulations, Appendix C.
- 3) Health, (Public Law 96-88), CFR, Title 42, Chapter IV Health & Human Services, CFR, Title 46, Subpart 1395(a)(b) JCAHO "a hospital that meets JCAHO accreditation is deemed to meet the Medicare conditions of Participation by meeting Federal Directives:"
- a) All guidelines for Life, Personal and Public Safety; and, Essential and Emergency Communications.
- 4) Labor, CFR, Title 29, Part 1910, Chapter XVII - Occupational Safety and Health Administration (OSHA), Occupational Safety and Health Standard:
- a) Subpart 7 - Definition and requirements (for a NRTL - 15 Laboratory's, for complete list, contact [http://www.osha.gov/dts/otpca/nrtl/faq\\_nrtl.html](http://www.osha.gov/dts/otpca/nrtl/faq_nrtl.html)):
- 1) UL:
- a) 44-02 - Standard for Thermoset-Insulated Wires and Cables.
  - b) 65 - Standard for Wired Cabinets.
  - c) 83-03 - Standard for Thermoplastic-Insulated Wires and Cables.
  - d) 467-01 - Standard for Electrical Grounding and Bonding Equipment
  - e) 468 - Standard for Grounding and Bonding Equipment.
  - f) 486A-01 - Standard for Wire Connectors and Soldering Lugs for Use with Copper Conductors
  - g) 486C-02 - Standard for Splicing Wire Connectors.
  - h) 486D-02 - Standard for Insulated Wire Connector Systems for Underground Use or in Damp or Wet Locations.
  - i) 486E-00 - Standard for Equipment Wiring Terminals for Use with Aluminum and/or Copper Conductors.
  - j) 493-01 - Standard for Thermoplastic-Insulated Underground Feeder and Branch Circuit Cable.

- k) 514B-02 - Standard for Fittings for Cable and Conduit.
- l) 1069 - Hospital Signaling and Nurse Call Equipment.
- m) 1449 - Standard for Transient Voltage Surge Suppressors.
- n) 1479-03 - Standard for Fire Tests of Through-Penetration Fire Stops.
- o) 1666 - Standard for Wire/Cable Vertical (Riser) Tray Flame Tests.
- p) 1863 - Standard for Safety, Communications Circuits Accessories.
- q) 2024 - Standard for Optical Fiber Raceways.
- r) 60950-1/2 - Information Technology Equipment - Safety.
- 2) Canadian Standards Association (CSA): same tests as for UL.
- 3) Communications Certifications Laboratory (CCL): same tests as for UL.
- 4) Intertek Testing Services NA, Inc. (ITSNA formerly Edison Testing Laboratory [ETL]): same tests as for UL.
- b) Subpart 35 - Compliance with NFPA 101 - Life Safety Code.
- c) Subpart 36 - Design and construction requirements for exit routes.
- d) Subpart 268 - Telecommunications.
- e) Subpart 305 - Wiring methods, components, and equipment for general use.
- 5) Department of Transportation, CFR, Title 49 (Public Law 89-670), Part 1, Subpart C - Federal Aviation Administration (FAA):
  - a) Standards AC 110/460-ID & AC 707 / 460-2E - Advisory Circulars for Construction of Antenna Towers.
  - b) Forms 7450 and 7460-2 - Antenna Construction Registration.
- 6) Veterans Affairs (Public Law No. 100-527), CFR, Title 38, Volumes I & II:
  - a) Office of Telecommunications:
    - 1) Handbook 6100 - Telecommunications.
      - a) Spectrum Management FCC & NTIA Radio Frequency

Compliance and Licensing Program.

- b) Special Communications Proof of Performance Testing,  
VACO Compliance and Life Safety Certification(s).
  - b) Office of Cyber and Information Security (OCIS):
    - 1) Handbook 6500 - Information Security Program.
    - 2) Wireless and Handheld Device Security Guideline Version 3.2, August 15, 2005.
  - c) VA's National Center for Patient Safety - Veterans Health Administration Warning System, Failure of Medical Alarm Systems using Paging Technology to Notify Clinical Staff, July 2004.
  - d) VA's Center for Engineering Occupational Safety and Health, concurrence with warning identified in VA Directive 7700.
  - e) Office of Construction and Facilities Management (CFM):
    - 1) Master Construction Specifications (PG-18-1).
    - 2) Standard Detail and CAD Standards (PG-18-4).
    - 3) Equipment Guide List (PG-18-5).
    - 4) Electrical Design Manual for VA Facilities (PG 18-10), Articles 7 & 8.
    - 5) Minimum Requirements of A/E Submissions (PG 18-15):
      - a) Volume B, Major New Facilities, Major Additions; and Major Renovations, Article VI, Paragraph B.
      - b) Volume C - Minor and NRM Projects, Article III, Paragraph S.
      - c) Volume E - Request for Proposals Design/Build Projects, Article II, Paragraph F.
    - 6) Mission Critical Facilities Design Manual (Final Draft - 2007).
    - 7) Life Safety Protected Design Manual (Final Draft - 2007).
    - 8) Solicitation for Offerors (SFO) for Lease Based Clinics - (05-2009).
  - b. Federal Specifications (Fed. Specs.):
    - 1) A-A-59544-00 - Cable and Wire, Electrical (Power, Fixed Installation).
2. National Codes:



- a. American Institute of Architects (AIA): Guidelines for Healthcare Facilities.
- b. American National Standards Institute/Electronic Industries Association/Telecommunications Industry Association (ANSI/EIA/TIA):
  - 1) 568-B - Commercial Building Telecommunications Wiring Standards:
    - a) B-1 - General Requirements.
    - b) B-2 - Balanced twisted-pair cable systems.
    - c) B-3 - Fiber optic cable systems.
  - 2) 569 - Commercial Building Standard for Telecommunications Pathways and Spaces.
  - 3) 606 - Administration Standard for the Telecommunications Infrastructure of Communications Buildings.
  - 4) 607 - Commercial Building Grounding and Bonding Requirements for Telecommunications.
  - 5) REC 127-49 - Power Supplies.
  - 6) RS 270 - Tools, Crimping, Solderless Wiring Devices, Recommended Procedures for User Certification.
- c. American Society of Mechanical Engineers (ASME):
  - 1) Standard 17.4 - Guide for Emergency Personnel.
  - 2) Standard 17.5 - Elevator & Escalator Equipment (prohibition of installing non-elevator equipment in Elevator Equipment Room / Mechanical Penthouse).
- d. American Society of Testing Material (ASTM):
  - 1) D2301-04 - Standard Specification for Vinyl Chloride Plastic Pressure Sensitive Electrical Insulating Tape.
- e. Building Industries Communications Services Installation (BICSI):
  - 1) All standards for smart building wiring, connections and devices for commercial and medical facilities.
  - 2) Structured Building Cable Topologies.
  - 3) In consort with ANSI/EIA/TIA.
- f. Institute of Electrical and Electronics Engineers (IEEE):
  - 1) SO/TR 21730:2007 - Use of mobile wireless communication and computing technology in healthcare facilities - Recommendations for electromagnetic compatibility (management

of unintentional electromagnetic interference) with medical devices.

2) 0739-5175/08/©2008 IEEE - Medical Grade - Mission Critical - Wireless Networks.

3) C62.41 - Surge Voltages in Low-Voltage AC Power Circuits.

g. NFPA:

1) 70 - National Electrical Code (current date of issue) - Articles 517, 645 & 800.

2) 75 - Standard for Protection of Electronic Computer Data-Processing Equipment.

3) 77 - Recommended Practice on Static Electricity.

4) 99 - Healthcare Facilities.

5) 101 - Life Safety Code.

3. State Hospital Code(s).

4. Local Town, City and/or County Codes.

5. Accreditation Organization(s):

a. Joint Commission on Accreditation of Hospitals Organization (JCAHO) - Section VI, Part 3a - Operating Features.

## **1.5 QUALIFICATIONS**

- A. The OEM shall have had experience with three or more installations of Nurse Call systems of comparable size and interfacing complexity with regards to type and design as specified herein. Each of these installations shall have performed satisfactorily for at least one year after final acceptance by the user. Include the names, locations and point of contact for these installations as a part of the submittal.
- B. Contractor shall submit certified documentation that they have been an authorized distributor and service organization for the OEM for a minimum of three (3) years. The Contractor shall be authorized by the OEM to pass thru the OEM's warranty of the installed equipment to VA. In addition, the OEM and Contractor shall accept complete responsibility for the design, installation, certification, operation, and physical support for the System. This documentation, along with the System Contractor and OEM certifications must be provided in writing as part of the Contractor's Technical submittal.
- C. Contractor's Communications Technicians assigned to the System shall be fully trained, qualified, and certified by the OEM on the engineering, installation, operation, and testing of the System. The Contractor

shall provide formal written evidence of current OEM certification(s) for the installer(s) as a part of the submittal or to the COR before being allowed to commence work on the System.

- D. Contractor shall display all applicable national, state and local licenses.
- E. Contractor shall submit copy (s) of Certificate of successful completion of OEM's installation/training school for installing technicians of System's Nurse Call and/or Code Blue equipment being proposed.

#### **1.6 CODES AND PERMITS**

- A. Provide all necessary permits and schedule all inspections as identified in the contract's milestone chart, so that the system is proof of performance tested, certified and approved by VA and ready for operation on a date directed by the Owner.
- B. The contractor is responsible to adhere to all codes described herein and associated contractual, state and local codes.

#### **1.7 SCHEDULING**

- A. After the award of contract, the Contractor shall prepare a detailed schedule (aka milestone chart) using "Microsoft Project" software or equivalent. The Contractor Project Schedule (CPS) shall indicate detailed activities for the projected life of the project. The CPS shall consist of detailed activities and their restraining relationships. It will also detail manpower usage throughout the project.
- B. It is the responsibility of the Contractor to coordinate all work with the other trades for scheduling, rough-in, and finishing all work specified. The owner will not be liable for any additional costs due to missed dates or poor coordination of the supplying contractor with other trades.

#### **1.8 REVIEW OF CONTRACT DRAWINGS AND EQUIPMENT DATA SUBMITTALS (AKA TECHNICAL SUBMITTAL[S])**

(Note: The Contractor is encouraged, but not required, to submit separate technical submittal(s) outlining alternate technical approach(s) to the system requirements stated here-in as long as each alternate technical document(s) is complete, separate, and submitted in precisely the same manner as outlined herein. VA will review and rate each received alternate submittal, which follows this requirement, in exactly the same procedure

as outlined herein. Partial, add-on, or addenda type alternates will not be accepted or reviewed.)

- A. Submit at one time within 10 days of contract awarding, drawings and product data on all proposed equipment and system. Check for compliance with contract documents and certify compliance with Contractor's "APPROVED" stamp and signature.
- B. Support all submittals with descriptive materials, i.e., catalog sheets, product data sheets, diagrams, and charts published by the manufacturer. These materials shall show conformance to specification and drawing requirements.
- C. Where multiple products are listed on a single cut-sheet, circle or highlight the one that you propose to use. Provide a complete and through equipment list of equipment expected to be installed in the system, with spares, as a part of the submittal. Special Communications (TVE-0050P3B) will not review any submittal that does not have this list.
- D. Provide four (4) copies to the PM for technical review. The PM will provide a copy to the offices identified in Paragraph 1.3.C & D, at a minimum for compliance review as described herein where each responsible individual(s) shall respond to the PM within 10 days of receipt of their acceptance or rejection of the submittal(s).
- E. Provide interconnection methods, conduit (where not already installed), junction boxes (J-Boxes), cable, interface fixtures and equipment lists for the: ENR(s) ( aka DMARC), TER, TCR, MCR, MCOR, PCR, ECR, Stacked Telecommunications Rooms (STR), Nurses Stations (NS), Head End Room (HER), Head End Cabinet (HEC), Head End Interface Cabinet (HEIC) and approved TCO locations TIP interface distribution layout drawing, as they are to be installed and interconnected to teach other (REFER TO APPENDIX B - SUGGESTED TELECOMMUNI-CAITONS ONE LINE TOPOLOGY pull-out drawing).
- F. Equipment technical literature detailing the electrical and technical characteristics of each item of equipment to be furnished.
- G. Engineering drawings of the System, showing calculated of expected signal levels at the headend input and output, each input and output distribution point, and signal level at each telecommunications outlet.
- H. Surveys Required as a Part of The Technical Submittal:

1. The Contractor shall provide the following System surveys that depict various system features and capacities required **in addition to** the on-site survey requirements described herein (***see Paragraph 2.4.3***). Each survey shall be in writing and contain the following information (the formats are suggestions and may be used for the initial Technical Submittal Survey requirements), as a minimum:
  - a. Nurse Call Cable System Design Plan: An OEM and contractor designed functioning Nurse Call System cable plan to populate the entire TIP empty conduit/pathway distribution systems provided as a part of Specification 27 11 00 shall be provided as a part of the technical proposal.
  - b. A specific functioning Nurse Call: cable, interfaces, J-boxes and back boxes shall coincide with total growth items as described herein. It is the Contractor's responsibility to provide Systems' entire Nurse Call cable and accessory requirements and engineer a functioning Nurse Call distribution system.

#### **1.9 PROJECT RECORD DOCUMENTS (AS BUILTS)**

- A. Throughout progress of the Work, maintain an accurate record of changes in Contract Documents. Upon completion of Work, transfer recorded changes to a set of Project Record Documents.
- B. The floorplans shall be marked in pen to include the following:
  1. Each device specific locations with UL labels affixed.
  2. Conduit locations.
  3. Each interface and equipment specific location.
  4. Head-end equipment and specific location.
  5. Wiring diagram.
  6. Labeling and administration documentation.
  7. Warranty certificate.
  8. System test results.

#### **1.10 WARRANTIES / GUARANTEE**

- A. The Contractor shall warrant the installation to be free from defect in material and workmanship for a period of two (2) years from the date of acceptance of the project by the owner. The Contractor shall agree to remedy covered defects within four (4) hours of notification of major failures or within twenty-four (24) hours of notification for individual station related problems.

- B. The Contractor shall agree to grantee the system according to the guidelines outlined in Article 4 herein.

**1.11 USE OF THE SITE**

- A. Use of the site shall be at the GC's direction.
- B. Coordinate with the GC for lay-down areas for product storage and administration areas.
- C. Coordinate work with the GC and their sub-contractors.
- D. Access to buildings wherein the work is performed shall be directed by the GC.

**1.12 DELIVERY, STORAGE, AND HANDLING**

- A. Deliver, store, and handle products using means and methods that will prevent damage, deterioration, and loss, including theft.
- B. Store products in original containers.
- C. Coordinate with the GC for product storage. There may be little or no storage space available on site. Plan to potentially store materials off site.
- D. Do not install damaged products. Remove damaged products from the site and replaced with new product at no cost to the Owner.

**1.13 PROJECT CLOSE-OUT**

- A. Prior to final inspection and acceptance of the work, remove all debris, rubbish, waste material, tools, construction equipment, machinery and surplus materials from the project site and thoroughly clean your work area.
- B. Before the project closeout date, the Contractor shall submit:
  - 1. OEM Equipment Warranty Certificates.
  - 2. Evidence of compliance with requirements of governing authorities such as the Low Voltage Certificate of Inspection.
  - 3. Project record documents.
  - 4. Instruction manuals and software that is a part of the system.
  - 5. System Guarantee Certificate.
- C. Contractor shall submit written notice that:
  - 1. Contract Documents have been reviewed.
  - 2. Project has been inspected for compliance with contract.
  - 3. Work has been completed in accordance with the contract.

## **PART 2 - PRODUCTS / FUNCTIONAL REQUIREMENTS**

### **2.1 GENERAL REQUIREMENTS FOR EQUIPMENT AND MATERIALS**

- A. Furnish and install a complete and fully functional and operable Nurse Call System for each location shown on contract drawings and TCOs WHOSE EMPTY CONDUIT SYSTEM WAS PROVIDED AS A PART OF SPECIFICATION 27 11 00.
- B. The specific location for each Nurse Call: See Drawings.
- C. Coordinate features and select interface components to form an integrated Nurse Call system. Match components and interconnections between the systems for optimum performance of specified functions.
- D. Expansion Capability: The Nurse Call equipment interfaces and cables shall be able to increase number of enunciation points in the future by a minimum of 50 percent (%) above those indicated without adding any internal or external components or main trunk cable conductors.
- E. Equipment: Active electronic type shall use solid-state components, fully rated for continuous duty unless otherwise indicated. Select equipment for normal operation on input power usually supplied between 110 to 130 VAC, 60 Hz supplied from the Facility's Emergency Electrical Power System.
- F. Meet all FCC requirements regarding equipment listing, low radiation and/or interference of RF signal(s). The system shall be designed to prevent direct pickup of signals from within and outside the building structure.
- G. Weather/Water Proof Equipment: Listed and labeled by an OSHA certified NRTL (i.e. UL) for duty outdoors or in damp locations.

### **2.2 SYSTEM DESCRIPTION**

- A. Furnish and install a complete and fully functional and operable Nurse Call and/or Code Blue System WHOSE EMPTY CONDUIT SYSTEM WAS PROVIDED AS A PART OF SPECIFICATION 27 11 00.
- B. The Contractor is responsible for interfacing the PA system with the System.
- C. The Contractor shall continually employ interfacing methods that are approved by the OEM and VA. At a minimum, an acceptable interfacing method requires not only a physical and mechanical connection, but also a matching of signal, voltage, and processing levels with regard to signal quality and impedance. The interface point must adhere to all standards described herein for the full separation of Critical Care and Life Safety systems.

- D. The System Contractor shall connect the System ensuring that all NFPA and UL Critical Care and Life Safety Circuit and System separation guidelines are satisfied. The System Contractor is not allowed to make any connections to the Telephone System. VA shall arrange for the interconnection between the PA System with the appropriate responsible parties.
- E. System hardware shall consist of a *standalone (separate)* nurse call and Code Blue patient communications network comprised of nurse consoles, control stations, staff and duty stations, room and corridor dome lights, pillow speakers/call cords, pull cord and/or emergency push button stations, wiring. And, other options such as, *pocket page interfaces*, computer interfaces, printer interfaces, wireless / telephone network interfaces, and nurse locating system interface (when specifically approved first by TVE 0050P3B) and as shown on drawings. All necessary equipment required to meet the intent of these specifications, whether or not enumerated within these specifications, shall be supplied and installed to provide a complete and operating nurse call and Code Blue patient communications network. *It is not acceptable to utilize the telephone cable system for the control and distribution of nurse call (code Blue) signals and equipment.*
- F. System firmware shall be the product of a reputable firmware OEM of record with a proven history of product reliability and sole control over all source code. Manufacturer shall provide, free of charge, product firmware/software upgrades for a period of two (2) years from date of acceptance by VA for any product feature enhancements. System configuration programming changes shall not require any exchange of parts and shall be capable of being executed remotely via a modem connection (when specifically approved first by TVE 0050P3B).
- G. The Nurse Call Head End Equipment shall be located in new low voltage room as shown on Drawings. The Nurse Call/Code Blue System may interface the PA system when specifically approved by VA Headquarters TVE 0050P3B during project approval process prior to contract bidding.
- H. The System shall utilize microprocessor components for all signaling and programming circuits and functions. Self contained or on board system program memory shall be non-volatile and protected from erasure from power outages for a minimum of 12 hours.



- I. Provide a backup battery or UPS for the System (including each distribution cabinet/point, CRT and Monitor) to allow normal operation and function (as if there was no AC power failure) in the event of an AC power failure or during input power fluctuations for a minimum of 30 minutes.
- J. The System is defined as Critical Service and the Code Blue functions is defined as Life Safety/Support by NFPA (re Part 1.1.A) and so evaluated by JCAHCO. Therefore, the system shall have a minimum of two (2) additional remote enunciation points in order to satisfy NFPA's Life Safety Code 101 (the typical secondary locations are Telephone Operators Room, MAS ER Desk, Boiler Plant, etc; AND the primary location is required to be in the SCC Room.
  1. These two (2) additional remote locations shall be fully manned:
    - a. 24/7/365 for certified Hospital.
    - b. As long as other identified VA Medical / Servicing Facilities are open for servicing patients.
    - c. At a minimum, Code Blue Functions shall be provided in all Recovery (Medical and Surgical) Rooms, Intensive Care Units (ICU), Cardiac Care Units (CCU), Step Down Room, Life Support / Monitoring Rooms, Oncology / Radiology Procedure Rooms, Dialysis Areas.
    - d. The minimum remote enunciation locations shall be:
      - 1) The Telephone / PBX Operator Room.
      - 2) The Police Control / Operations Room.
      - 3) Other location(s) that is specifically approved by VA Headquarters TVE - 0050P3B DURING THE PROJECT DEVELOPMENT STAGES AND PRIOR TO EQUIPMENT PURCHASE.
  2. In addition to the two (2) remote locations afore described, the following locations are the minimum required for additional Nurse Call /Code Blue Annunciation:
    - a. "On Call" Rooms.
    - b. Each Nurse Master Station.
    - c. Each Staff Station.
    - d. Each Duty Station.
  3. The MAXIMUM enunciation time period from placement of the Code Blue Call to enunciation at each remote locations is 10 seconds; and, 15

seconds to the subsequent enunciating media stations (i.e. PA, Radio Paging, Emergency Telephone or Radio Backup, etc.).

- K. Each Code Blue System shall be designed to provide continuous electrical supervision of the complete and entire system (i.e. dome light bulbs [each light will be considered supervised if they use any one or a combination of (UL) approved electrical supervision alternates, as identified in UL-1069, 1992 revision], wires, contact switch connections, circuit boards, data, audio, and communication busses, main and UPS power, etc.). All alarm initiating and signaling circuits shall be supervised for open circuits, short circuits, and system grounds. Main and UPS power circuits shall be supervised for a change in state (i.e. primary to backup, low battery, UPS on line, etc.). When an open, short or ground occurs in any system circuit, an audible and visual fault alarm signal shall be initiated at the nurse control station and all remote locations.
- L. When the System is approved to connect to a separate communications system (i.e. LAN, WAN, Telephone, Public Address, radio raging, wireless systems, etc) the connection point shall meet the following minimum requirements for each hard wired / wireless connection (note each wireless system connection MUST BE APPROVED PRIOR TO CONTRACT BID BY VA HEADQUARTERS TVE - 0050P3B AND SPECTRUM MANAGEMENT - 0050P2B - hereinafter referred to as SM - 0050P2B):
1. UL 60950-1/2.
  2. FIPS 142.
  3. FCC Part 15 Listed Radio Equipment restriction compliance approved by SM - 0050P2B.
- M. All passive distribution equipment shall meet or exceed -80 dB radiation shielding (aka RFI) shielding specifications and be provided with connectors specified by the OEM.
- N. All equipment face plates utilized in the system shall be stainless steel, anodized aluminum or UL approved cycolac plastic for the areas where provided.
- O. Noise filters and surge protectors shall be provided for each equipment interface cabinet, headend cabinet, control console and local and remote amplifier locations to insure protection from input primary AC power surges and to insure noise glitches are not induced into low voltage data circuits.

- P. Plug-in connectors shall be provided to connect all equipment, except coaxial cables. Coaxial cable distribution points shall use coaxial cable connections recommended by the cable OEM and approved by the system OEM. Base band cable systems shall utilize barrier terminal screw type connectors, at a minimum. As an alternate, crimp type connectors installed with a ratchet type installation tool are acceptable provided the cable dress, pairs, shielding, grounding, connections and labeling are the same as the barrier terminal strip connectors. Tape of any type, wire nuts or solder type connections are unacceptable and will not be approved.
- Q. Audio Level Processing: The control equipment shall consist of audio mixer(s), volume limiter(s) and/or compressor(s), and power amplifier(s) to process, adjust, equalize, isolate, filter, and amplify each audio channel for each sub-zone in the system and distribute them into the System's RF interfacing distribution trunks and amplification circuits. It is acceptable to use identified Telephone System cable pairs designated for Two-Way Radio interface and control use or identified as spare telephone cable pairs by the Facility's Telephone System Contractor. The use of telephone cable to distribute RF signals, carrying system or sub-system AC or DC voltage is not acceptable and will not be approved. Additionally, each control location shall be provided with the equipment required to insure the system can produce its designed audio channel capacity at each speaker identified on the contract drawings. The Contractor shall provide: a spare set of telephone paging modules as recommended by the OEM (as a minimum provide one spare module for each installed module); one spare audio power amplifier, one spare audio mixer, one spare audio volume limiter and/or compressor, and one spare audio automatic gain adjusting device, and minimum RF equipment recommended by the OEM.
- R. Contractor is responsible for pricing all accessories and miscellaneous equipment required to form a complete and operating system. Unless otherwise noted in this Part, equipment quantities shall be as indicated on the drawings.
- S. System Performance:
1. At a minimum, each distribution, interconnection, interface, terminating point and TCO shall be capable of supporting the

Facility's Nurse Call and/or Code Blue System voice and data service as follows:

- a. Shall be compliant with and not degrade the operating parameters of the Public Switched Telephone Network (PSTN) and the Federal Telecommunications System (FTS) at each PSTN and FTS interface (if attachment is permitted by TVE 0050P3B), interconnection and TCO terminating locations detailed on the contract drawings.
- b. The System shall provide the following minimum operational functions:
  - 1) Code Blue calls shall be cancelable at the calling station only. The nurse call master station (s) that a managing Code Blue functions shall not have the ability to cancel Code Blue calls.
  - 2) Each Code Blue system shall be able to receive audio calls from all bedside stations simultaneously.
  - 3) Calls placed from any Code Blue station shall generate Code Blue emergency type audible and visual signals at each associated nurse control and duty station, respective dome lights and all local and remote annunciator panels. Calls placed from a bedside station shall generate emergency type visual signals at the bedside station and associated dome light(s) in addition to the previous stated stations and panels.
  - 4) Activating the silencing device at any location, while a Code Blue call or system fault is occurring shall mute the audible signals at the alarm location.
    - a) The audible alarm shall regenerate at the end of the selected time-out period until the call or fault is corrected.
    - b) The visual signals shall continue until the call is canceled and/or a fault is corrected. When the fault is corrected, all signals generated by the fault shall automatically cease, returning the System to a standby status.
    - c) Audible signals shall be regenerated in any local or remote annunciator panel that is in the silence mode, in the event

an additional Code Blue call is placed in any Code Blue system.

- d) The additional Code Blue call shall also generate visual signals at all annunciators to identify the location of the call.

2. Each System Nurse Call location shall generate a minimum of distinct calls:

- a. Routine: single flashing dome lights & master station color and audio tone,
- b. Staff Assist: rapid flashing dome lights & master station color and audio tone,
- c. Emergency: Red flashing dome lights & master station color and audio tone,
- d. Code Blue (if equipped): Blue flashing dome lights and master station color and audio tone,
- e. Each generated call shall be cancelable at ONLY the originating location,
- f. Staff Locator: Green Flashing dome lights & master station color and audio tone, and

### **2.3 MANUFACTURERS**

- A. The products shall match the system currently used at the VAMC. The products specified shall be new, FCC and UL Listed, labeled and produced by OEM manufacturer of record. An OEM of record shall be defined as a company whose main occupation is the manufacture for sale of the items of equipment supplied and which:
  - 1. Maintains a stock of replacement parts for the item submitted,
  - 2. Maintains engineering drawings, specifications, and operating manuals for the items submitted, and
  - 3. Has published and distributed descriptive literature and equipment specifications on the items of equipment submitted at least 30 days prior to the Invitation for Bid.
- B. Specifications contained herein as set forth in this document detail the salient operating and performance characteristics of equipment in order for VA to distinguish acceptable items of equipment from unacceptable items of equipment. When an item of equipment is offered or furnished for which there is a specification contained herein, the

item of equipment offered or furnished shall meet or exceed the specification for that item of equipment.

C. Equipment Standards and Testing:

1. The System has been defined herein as connected to systems identified as Critical Service performing various Emergency and Life Support Functions. Therefore, at a minimum, the system shall conform to all aforementioned National and/or Local Life Safety Codes (which ever are the more stringent), NFPA, NEC, this specification, JCAHCO Life Safety Accreditation requirements, and the OEM recommendations, instructions, and guidelines.
2. All supplies and materials shall be listed, labeled or certified by UL or a NRTL where such standards have been established for the supplies, materials or equipment.
3. The provided equipment required by the System design and approved technical submittal must conform with each UL standard in effect for the equipment, as of the date of the technical submittal (or the date when the COR approved system equipment necessary to be replaced) was technically reviewed and approved by VA. Where a UL standard is in existence for equipment to be used in completion of this contract, the equipment must bear the approved UL seal.
4. Each item of electronic equipment to be provided under this contract must bear the approved UL seal or the seal of the testing laboratory that warrants the equipment has been tested in accordance with, and conforms to the specified standards. The placement of the UL Seal shall be a permanent part of the electronic equipment that is not capable of being transportable from one equipment item to another.

**2.4 PRODUCTS**

A. General.

1. Contractor is responsible for pricing all accessories and miscellaneous equipment required to form a complete and operating system. The equipment quantities provided herein shall be as indicated on the drawings with the exception of the indicated spare equipment.
2. Contractor Furnished Equipment List (CFEs):
  - a. The Contractor is required to provide a list of the CFE equipment to be furnished. The quantity, make and model number of each item is required. Select the required equipment items quantities that

will satisfy the needs of the system as described herein and with the OEM's concurrence applied to the list(s), in writing.

<u>Item</u>	<u>Quantity</u>	<u>Unit</u>
1.	As required	Interface Panel(s)
1.a	As required	Electrical Supervision Trouble Enunciator
1.a.1	As required	Equipment Back Box(s)
1.b	As required	Telephone
1.c	As required	Public Address
1.d	As required	Radio Paging/Equipment
1.e	As required	Wireless/Equipment
1.f.	As required	Radio Pager/Equipment
1.g	As required	Wireless/Equipment
1.f	As required	Personal Communicator/Equipment
2.	As required	Lightning Arrestor
3.	As required	Head End Equipment/Locations
3.a	As required	Cabinet(s)
3.a.1	As required	AC Power Conditioner & Filter
3.a.2	As required	AC Power Strip
3.a.3	As required	UPS
3.a.4	As required	Interconnecting Wire/Cables
3.a.5	As required	Wire/Cable Connector(s)
3.a.6	As required	Wire/Cable Terminator(s)
3.b	As required	Wire Management System
3.b	As required	Head End Function(s)
3.b.1	As required	H7 Interface
3.b.2	As required	Nurse Locator
3.b.3	As required	Staff Locator
4.	As required	Master Station(s)
4.a	As required	Nurse Locator
4.b	As required	Staff Locator
5.	As required	Distribution System(s)
5.a	As required	Staff Station
5.a.1	As required	Equipment Back Box(s)
5.b	As required	Duty Station
5.b.1	As required	Equipment Back Box(s)
5.c	As required	Code Blue Station
5.c.1	As required	Equipment Back Box(s)
5.c.2	2 (MIN)	Remote Station(s)
5.d	As required	Patient Station(s)
5.d.1	As required	Equipment Back Box(s)
5.d.2	As required	Bed Interface(s)
5.d.3	As required	Pillow Speaker
5.d.4	As required	Push Button Cordset
5.d.5	As required	Dummy Plugs
5.d.6	As required	Bed Integrated Control
5.d.7	As required	Lighting Interface Module
5.d.8	As required	TV Control Interface
5.d.9	As required	TV Control Jack
5.d.10	As required	TV Interconnection Cables
5.d.11	As required	HDTV Coaxial
5.d.12	As required	HDTV/Nurses Call Interface/Control
5.d.13	As required	Auxiliary Mounting Interface

5.e	As required	Emergency Station(s)
5.e.1	As required	Equipment Back Box(s)
5.e.2	As required	Toilet Emergency Station (waterproof)
5.e.3	As required	Shower Emergency Station (waterproof)
5.e.4	As required	Lavatory Emergency Station(waterproof)
5.f.	As required	Room Dome Light
5.f.1	As required	Equipment Back Box(s)
5.g	As required	Other Dome Light(s)
5.g.1	As required	Equipment Back Box(s)
5.g.2	As required	Corridor Dome Light
5.g.3	As required	Intersectional Dome Light
5.h	As required	System Cable(s)
5.h.1	As required	Coaxial
5.h.2	As required	System Pin
5.h.3	As required	Audio
5.h.4	As required	Control
5.h.5	As required	Video
5.i	As required	System Connector(s)
5.i.1	As required	Coaxial
5.i.2	As required	System Pin
5.i.2	As required	Audio
5.i.3	As required	Control
5.i.4	As required	Video
5.j	As required	Wire Management-Required as described herein

B. TER, SCC, PCR, STR, HER Rooms and Equipment:

Refer to CFM Physical Security Manual (07-2007) for VA Facilities, Chapters 9.3 & 1) and PG 18-10, EDM, Chapters 7- Table 7-1, 8 & Appendix B, Telecommunications One Line Topology for specific Room and TIP Connection Requirements.

C. Telecommunications Room(s) (TR):

1. Locate the Nurse Call and/or Code Blue floor distribution equipment as required by system design and OEM direction. Provide secured and lockable cabinet/rack(s) as required.
2. Head-End Equipment:
  - a. Provide all required power supplies, communications hubs, network switches, intelligent controllers and other devices necessary to form a complete system. Head-end components may be rack mounted or wall mounted in an enclosed metal enclosure.
  - b. Provide the head end equipment in the closest Telecommunications Room where the System is installed.
  - c. Provide the System UPS inside the cabinet or in a separate cabinet adjacent to the head end cabinet that shall maintain a minimum of 30 minute battery back-up to all system components.



- d. Equipment Cabinet: Comply with TIA/EIA-310-D. Lockable, ventilated metal cabinet houses terminal strips, power supplies, amplifiers, system volume control, and other switching and control devices required for conversation channels and control functions. See Paragraph 2.5.E for the Cabinet's minimum internal items that are in addition to the installed System equipment.
  - e. Vertical Equipment Rack, Wall Mounted (to be included inside of the Equipment Cabinet) containing the following minimum items:
    - 1) 36" (28RU) internal rack space, welded steel construction, minimum 20" usable depth, adjustable front mounting rails.
    - 2) Install the following products in rack provided by same manufacturer or as specified:
      - a) Security screws w/ nylon isolation bushings.
      - b) Textured blank panels.
      - c) Custom mounts for components without rack mount kits.
      - d) Security covers.
      - e) Internal system ground copper buss (may be substituted with a bare #0 AWG copper wire or equivalent size copper mesh strip connected to ONLY THE FACILITY'S SIGNAL GROUNDING SYSTEM.
      - f) Power Sequencer- rack-mounted power conditioner and (provide as-needed) delayed sequencer(s) with (2) unswitched outlets each and contact closure control inputs. Connect the conditioner to one of the dual duplex outlets.
      - g) Two (2) each 120VAC @ 20A dual duplex outlets, connected via conduit to the nearest Electrical Service Panel that is supplied by the Facility's Essential Electrical System.
      - h) One (1) each 120VAC @ 15A Power Distribution Strip(s). Connect each strip to the unstitched outlet on the power conditioner.
3. HL7 Interface:
- a. The system may support downloading and updating of patient data from the hospital admission system (or other database) via the HL7 standard. The data only has to travel one way, i.e. from the admission system to the nurse-call system.

- b. Coordinate with the Owner the exact fields that will be populated from the admissions system in the nurse-call system.
  - c. The Facility's LAN/WAN is not allowed for Nurses Call/Code Blue main wiring / function that must be a "stand alone primary cable infrastructure" as described herein.
  - d. Connections to the VA LAN/WAN for functional or operable conditions will be allowed ONLY when the LAN/WAN system has been demonstrated and NFPA (at a minimum by TVE-0050P3B) Certified meeting Life Safety Standards.
  - e. Provide one (1) spare HL Interface unit.
- D. TIP Cable Systems:
- Connect the system to the TIP system provided as a part of Speciation Section 27 15 00. Provide additional TIP equipment, interfaces and connections as required by System design. Provide secured pathway(s) and lockable cabinet/rack(s) as required.
- E. Interface Equipment:
- 1. TCR:
    - a. Code Blue Annunciation Station:
      - 1) The Code Blue Remote Annunciation Station shall be located in the Telephone Operators Room.
      - 2) The Annunciation Station shall be connected to the System via hard wire connection(s) that shall contain all the electrical supervisory tone signals, visual bulbs, read out panel to indicate the location of the Code and system troubles.
      - 3) The System shall not be connected to the Telephone system unless specifically APPROVED BY VA HEADQUARTERS (0050P3B) and (0050P2B) PRIOR TO CONTRACT BID.
      - 4) The Annunciation Station shall be installed in a location directly viewable and the readout is completely readable from the Public Address Microphone Control Console.
      - 5) Provide one (1) spare panel.
    - b. Electrical Supervision Trouble Annunciator Panel:
      - 1) The Electrical Supervision Trouble Annunciation Panel shall be located in the Telephone Operators Room, associate Nurses Station(s)
      - 2) The panel(s) shall be compatible with the generated electrical and/or electronic supervising signals to continuously monitor

the operating condition for the System head-end processing equipment, master stations, staff stations, patient stations, duty stations, audio power amplifier(s), UPS, power supplies, dome lights and interconnecting trunks. The panels shall generate an audible and visual signal when the System's supervising system detects a system and equipment trouble or trunk-line is malfunctioning.

3) Provide one (1) spare panel.

2. Hospital Bed Interface (s):

- a. Provide a multi-pin receptacle for bed connection.
- b. Connect cable from the multi-pin receptacle to the nurse-call system, so that alarms, such as bed exit, shall be monitored by the nurse-call system.
- c. Connect cable from the multi-pin receptacle to the nurse-call system, so that the bedside control buttons, such as nurse call, and television controls are functional and monitored.
- d. Provide one (1) spare interface for each ten (10) interfaces installed.

3. Nurse (aka Staff) Locator Interface:

- a. The System must be capable of performing nurse-locator functions.
- b. The System must be capable of performing staff-locator functions
- c. These functions may be combined into one operation.
- d. Provide two (2) spare interfaces.

F. Call Initiation, Annunciation and Response:

1. Light and Tones:

- a. Calls may be initiated through:
  - 1) Patient station.
  - 2) Staff station.
  - 3) Code Blue station.
  - 4) Toilet Emergency Station pull cord / push button.
  - 5) Shower Emergency Station pull cord.
- b. Once a call is initiated, it must be annunciated at the following locations:
  - 1) The Corridor, Intersectional and Room dome light associated with the initiating device.
  - 2) A local master control station indicating the call location and priority.

- 3) Each duty station.
  - 4) Each staff station.
  - 5) Each remote location.
  - c) All calls must be displayed until they are cleared by the nursing staff ONLY from the initiating device location.
2. Voice:
  - a Calls may be initiated through:
    - 1) Patient station.
    - 2) Staff station.
    - 3) Code Blue station.
    - 4) Toilet Emergency pull cord / push button station.
    - 5) Shower Emergency pull cord station.
    - 6) Master Station.
  - b. Once a call is initiated, it must be annunciated at the following locations:
    - 1) The Corridor, Intersectional and Room dome light associated with the initiating device.
    - 2) A master station indicating the call location and priority.
    - 3) Any duty stations associated with the unit.
    - 4) Any staff Stations associated with the unit.
    - 5) Each remote location.
  - c. All calls must be displayed until they are cleared by the nursing staff ONLY from the initiating device location.
3. Provide two-way voice communication between a master station and patient, staff, duty and each of the two (2) remote stations.
4. Failure of voice intercom portion of system shall not interfere with visual and audible signal systems.
5. All calls must be displayed on the master station until they are cleared by the nursing staff at ONLY the originating station. If multiple calls are received at the master station within a short period of time, they shall be stacked based on priority and wait time. If there are more calls than the master station screen can display at one time (four [4] minimum), the system must provide a simple scrolling feature. The nurse must be able to answer any call in any order at the master station. The nurse must also be able to forward calls to staff members. If a call is not answered within a programmable time period, then the system must forward the call to

appropriate back-up staff identified by each shift supervisor in a manner technically approved by VA Headquarters 0050P3B.

G. Reports:

1. The system's generated reports logging all calls, alarms, response time, bed, and staff assignments may be allowed to transmit these reports to a central archiving entity.
2. Reports function shall be limited by passwords and security tier level access, so that only supervisors may access it when desired.
3. Provide instructions to the owner on how to enable/disable the reporting functions.
4. The Facility's LAN/WAN IS NOT ALLOWED for Nurses Call/Code Blue main wiring that must be a "stand alone primary cable infrastructure." Connections to the VA LAN/WAN will be allowed ONLY when the system has been demonstrated and certified by 0050P2B meeting the minimum guidelines and requirements of the Life Safety Code.

H. System/Management Software:

1. Provide and install system/management software on minimum of three (3) owner-provided computers.
  - a. The management software shall at a minimum provide all historical reporting features of the system as well as real-time monitoring of events.
  - b. The system software shall at a minimum provide the system's operating and functioning parameters and script. The OEM shall provide VA with access to the software's script writing and functions.
2. Provide two (2) spare CD's with the software installed and operable.
3. Rights in Data: VA shall have the right to all script and programming language of system management software. If commercial off the shelf (COTS) or a memorandum of understanding (MOU) is required for follow-on maintenance, the Contractor is required to accomplish the COTS Survey document and the COR is required to accomplish the COTS Acquisition document supplied in Part 5 Attachments herein.

I. System Functional Station:

1. Master Control:
  - a. Simple Tone and Light:

- 1) A visual / aural (tone only) system shall be provided, protected and located in the Day Hospital, Mental Health & Blind Rehabilitation Areas, OPC where surgery or procedures are not performed. The System shall include a push-button emergency station (with an associated corridor dome light in each dressing room (OPC) and toilet (OPC, Day Hospital, Mental Health, Blind Rehabilitation.
- 2) The visual / aural (tone only) system shall also include a power supply and a visual / aural (tone only) display panel in the respective OPC receptionist / secretary's office and the Day Hospital area and as shown on the drawings. The visual / tone display panel shall generate audible and visual emergency signals to indicate the location of a placed call.
- 3) The Visual Display Panel shall be a digital readout touch screen to visually announce the location of incoming calls placed in the System including room and bed number and priority of the call. Identify each calling station with an individual display, including separate displays for each patient sharing a dual bedside station. If a digital readout touch screen standard is not required or approved by the Facility during the project design phase, an alpha - numeric scheme shall be provided that identifies the: ward, room and bed (i.e. Ward 2a, Room 201, Bed A (or 1) shall read 2A201A - or- 2A201-1. Equivalent readouts are acceptable as long as TVE 0050P3B and the Facility approve the readout).
  - a) Calls placed at emergency stations located in toilets and baths inside bedrooms shall be displayed for the bed closest to the nurse control station. Beds in multi-bed bedrooms shall be identified in a clock-wise pattern upon entering the bedroom.
  - b) It shall display a minimum of four incoming calls. Additional placed calls shall be stored in order of placement and priority.
- 4) The visual / aural (tone only) system shall be installed according to the same Procedures, guidelines and standards outlined for a regular Nurse Call System for emergency *NOT CODE BLUE OPERATION*.

- 5) Speakerphone and handset communication.
  - 6) Provide one (1) spare station for each ten (1) stations installed.
  - b. Touch Screen:
    - 1) Provide a touch screen master station with 15" minimum monitor size.
    - 2) The master station shall have a full control capability over staff assignment to patients and beds as well as pagers and wireless personal communication devices (when specifically approved by 0050P3B on a case by case basis).
    - 3) Speakerphone and handset communication.
    - 4) Provide one (1) spare station for each ten (1) stations installed.
  2. Staff:
    - a. Light and Tine Only.
    - b. Voice Communications Enabled.
    - c. Provide one (1) spare station for each twenty (20) stations installed.
  3. Duty:
    - a. Light and Tine Only.
    - b. Voice Communications Enabled.
    - c. Provide one (1) spare station for each twenty (20) stations installed.
  4. Patient:
    - a. Single & Dual:
      - 1) Provide each patient station with the following minimum Feature.
        - a) Call button.
        - b) Call answered button.
        - c) Pillow speaker jack.
        - d) Auxiliary alarm monitoring jack.
        - e) Hospital bed interface jack (when specially approved by TVE - 0050P3B).
        - f) Provide one (1) spare station for each twenty (20) stations installed.
- J. Distribution System: Refer to Specification Sections 27 11 00, Structured TIP Communications Cables; 27 11 00, TIP Communications

Interface and Equipment Rooms Fittings and 27 15 00, HORIZONTAL and Vertical TIP Communications Cabling for additional specific TIP wire and cable standards and installation requirements used to install the Facility's TIP network.

1. In addition to the TIP provided under the aforementioned Specification Sections, the contractor shall provide the following additional TIP installation and testing requirements, provide the following minimum additional System TIP requirements, cables & interconnections:
  - a. Each wire and cable used in the System shall be specifically OEM certified by tags on each reel and recommended and approved for installation in the Facility.
  - b. The Contractor shall provide the COR a 610 mm (2 foot) sample of each wire and/or cable actually employed in the System and each certification tag for approval before continuing with the installation as described herein.
  - c. Fiber optic Cables: Refer to Specification Section 27 15 00, Horizontal and Vertical TIP Communications Cabling; Paragraph 2.4.C12.d. Fiber optic Cables - for minimum technical standards and requirements for additional System cables.
  - d. Copper Cables: Refer to Specification Section 27 15 00, Horizontal and Vertical TIP Communications Cabling; Paragraph 2.4.C12.c. Copper Cables - for minimum technical standards and requirements for additional System voice and data cables.
  - e. Line Level Audio and Microphone Cable:
    - 1) Line level audio and microphone cable for inside racks and conduit.
    - 2) Shielded, twisted pair Minimum 22AWG, stranded conductors and 24AWG drain wire with overall jacket.
  - f. Speaker Level Audio (70.7Volt RMS):
    - 1) For use with 70.7V speaker circuits.
    - 2) 18AWG stranded pair, minimum.
  - g. All cabling shall be plenum rated.
  - h. Provide one (1) spare 1,000 foot roll of approved System (not microphone) cable only.
2. Raceways, Back Boxes and conduit:



- a. In addition to the Raceways, Equipment Room Fittings provided under Specification Sections 27 15 00 TIP Communication Room Fittings and 27 15 00 - TIP Communications Horizontal and Vertical Cabling, provide the following additional TIP raceway and fittings:
- b. Each raceway that is open top, shall be: UL certified for telecommunications systems, partitioned with metal partitions in order to comply with NEC Parts 517 & 800 to "mechanically separate telecommunications systems of different service, protect the installed cables from falling out when vertically mounted and allow junction boxes to be attached to the side to interface "drop" type conduit cable feeds.
- c. Intercommunication System cable infrastructure: EMT or in J-hooks above accessible ceilings, 24 inches on center.
- d. Junction boxes shall be not less than 2-1/2 inches deep and 6 inches wide by 6 inches long.
- e. Flexible metal conduit is prohibited unless specifically approved by 0050P3B.
- f. System Conduit:
  - 1) The PA system is NFPA listed as Emergency / Public Safety Communication System which requires the entire system to be installed in a separate conduit system.
  - 2) The use of centralized mechanically partitioned wireways may be used to augment main distribution conduit on a case by case basis when specifically approved by VA Headquarters (0050P3B).
  - 3) Conduit Sleeves:
    - a) The AE has made a good effort to identify where conduit sleeves through full-height and fire rated walls on the drawings, and has instructed the electrician to provide the sleeves as shown on the drawings.
    - b) While the sleeves shown on the drawings will be provided by others, the contractor is responsible for installing conduit sleeves and fire-proofing where necessary. It is often the case, that due to field conditions, the nurse-call cable may have to be installed through an alternate route. Any conduit sleeves required due to field

conditions or those omitted by the engineer shall be provided by the cabling contractor.

g. Device Back Boxes:

- 1) Furnish to the electrical contractor all back boxes required for the PA system devices.
- 2) The electrical contractor shall install the back boxes as well as the system conduit. Coordinate the delivery of the back boxes with the construction schedule.

3. UPS:

- a. Provide a backup battery or a UPS for the System to allow normal operation and function (as if there was no AC power failure) in the event of an AC power failure or during input power fluctuations for a minimum of 30 minutes.
- b. As an alternate solution, the telephone system UPS may be utilized to meet this requirement at the headend location, as long as this function is specifically approved by the Telephone Contractor and the RE.
- c. The Nurse Call Contractor shall not make any attachments or connection to the telephone system until specifically directed to do so, in writing, by the RE.
- d. Provide UPS for all active system components including but not limited to:
  - 1) System Amplifiers.
  - 2) Microphone Consoles.
  - 3) Telephone Interface Units.
  - 4) TER, TR & Headend Equipment Rack(s).

K. Patient Bedside Prefabricated Units (PBPU):

1. Where PBPU's exist in the Facility; the Contractor shall identify the "gang box" location on the PBPU designated for installation of the telephone jack. This location shall here-in-after be identified as the unit's TCO. The Contractor shall be responsible for obtaining written approval and specific instructions from the PBPU OEM regarding the necessary disassembly and reassembly of each PBPU to the extent necessary to pull wire from above the TIP ceiling junction box to the PBPU's reserved gang box for the unit's TCO. A Contractor provided stainless steel cover plate approved for use by

the PBPUE OEM and Facility IRM Chief shall finish out the jack installation.

2. Under no circumstances shall the Contractor proceed with the PBPUE installations without the written approval of the PBPUE OEM and the specific instructions regarding the attachment to or modifying of the PBPUE. The COR shall be available to assist the Contractor in obtaining approvals and instructions in a timely manner as related to the project's time constraints.
3. It is the responsibility of the Contractor to maintain the UL integrity of each PBPUE. If the Contractor violates that integrity, it shall be the responsibility of the Contractor to obtain on site UL re-certification of the violated PBPUE at the direction of the COR and at the Contractor's expense.

L. Installation Kit:

1. General: The kit shall be provided that, at a minimum, includes all connectors and terminals, labeling systems, audio spade lugs, barrier strips, punch blocks or wire wrap terminals, heat shrink tubing, cable ties, solder, hangers, clamps, bolts, conduit, cable duct, and/or cable tray, etc., required to accomplish a neat and secure installation. All wires shall terminate in a spade lug and barrier strip, wire wrap terminal or punch block. Unfinished or unlabeled wire connections shall not be allowed. Turn over to the COR all unused and partially opened installation kit boxes, coaxial, fiberoptic, and twisted pair cable reels, conduit, cable tray, and/or cable duct bundles, wire rolls, physical installation hardware. The following are the minimum required installation sub-kits:
  2. System Grounding:
    - a. The grounding kit shall include all cable and installation hardware required. All radio equipment shall be connected to earth ground via internal building wiring, according to the NEC.
    - b. This includes, but is not limited to:
      - 1) Fiberoptic Optic Cable Armor/External Braid
      - 2) Coaxial Cable Shields.
      - 3) Control Cable Shields.
      - 4) Data Cable Shields.
      - 5) Equipment Racks.

- 6) Equipment Cabinets.
  - 7) Conduits.
  - 8) Cable Duct.
  - 9) Cable Trays.
  - 10) Interduct
  - 11) Power Panels.
  - 12) Connector Panels.
  - 15) Grounding Blocks.
3. Fiberoptic Cable: The fiberoptic cable kit shall include all fiberoptic connectors, cable tying straps, interduct, heat shrink tubing, hangers, clamps, etc. required to accomplish a neat and secure installation.
  4. Coaxial Cable: The coaxial cable kit shall include all coaxial connectors, cable tying straps, heat shrink tubing, hangers, clamps, etc., required to accomplish a neat and secure installation.
  5. Wire and Cable: The wire and cable kit shall include all connectors and terminals, audio spade lugs, barrier straps, punch blocks, wire wrap strips, heat shrink tubing, tie wraps, solder, hangers, clamps, labels etc., required to accomplish a neat and orderly installation.
  6. Conduit, Cable Duct, and Cable Tray: The kit shall include all conduit, duct, trays, junction boxes, back boxes, cover plates, feed through nipples, hangers, clamps, other hardware required to accomplish a neat and secure conduit, cable duct, and/or cable tray installation in accordance with the NEC and this document.
  7. Equipment Interface: The equipment kit shall include any item or quantity of equipment, cable, mounting hardware and materials needed to interface the systems with the identified sub-system(s) according to the OEM requirements and this document.
  8. Labels: The labeling kit shall include any item or quantity of labels, tools, stencils, and materials needed to completely and correctly label each subsystem according to the OEM requirements, as-installed drawings, and this document.
  9. Documentation: The documentation kit shall include any item or quantity of items, computer discs, as installed drawings, equipment, maintenance, and operation manuals, and OEM materials needed to completely and correctly provide the system documentation as required by this document and explained herein.

### **PART 3 - EXECUTION**

#### **3.1 PROJECT MANAGEMENT**

- A. Assign a single project manager to this project who will serve as the point of contact for the Owner, the General Contractor, and the Engineer.
- B. The Contractor shall be proactive in scheduling work at the hospital, specifically the Contractor will initiate and maintain discussion with the general contractor regarding the schedule for ceiling cover up and install cables to meet that schedule.
- C. Contact the Office of Telecommunications, Special Communications Team (0050P2B) at (301) 734-0350 to have a VA Certified Telecommunications Representative assigned to the project for telecommunications review, equipment and system approval and co-ordination with VA's Spectrum Management and OCIS Teams.

#### **3.2 COORDINATION WITH OTHER TRADES**

- A. Coordinate with the cabling contractor the location of the TV faceplate and the faceplate opening for the nurse call TV control jack.
- B. Coordinate with the cabling contractor the location of TIP equipment in the TER, TCR, PCR, SCC, ECR, STRs, NSs, and TCOs in order to connect to the TIP cable network that was installed as a part of Section Specification 27 11 00. Contact the COR immediately, in writing, if additional location(s) are discovered to be activated that was not previously provided.
- C. Before beginning work, verify the location, quantity, size and access for the following:
  - 1. Isolated ground AC power circuits provided for systems.
  - 2. Primary, emergency and extra auxiliary AC power generator requirements.
  - 3. Junction boxes, wall boxes, wire troughs, conduit stubs and other related infrastructure for the systems.
  - 4. System components installed by others.
  - 5. Overhead supports and rigging hardware installed by others.
- D. Immediately notify the Owner, GC and Consultant(s) in writing of any discrepancies.

#### **3.3 NEEDS ASSESSMENT**

Provide a one-on-one meeting with the particular nursing manager of each unit affected by the installation of the new nurse call/code blue

system. Review the floor plan drawing, educate the nursing manager with the functions of the equipment that is being provided and gather details specific to the individual units; coverage and priorities of calls; staffing patterns; and other pertinent details that will affect system programming and training.

### **3.4 INSTALLATION**

#### **A. General:**

1. Execute work in accordance with National, State and local codes, regulations and ordinances.
2. Install work neatly, plumb and square and in a manner consistent with standard industry practice. Carefully protect work from dust, paint and moisture as dictated by site conditions. The Contractor will be fully responsible for protection of his work during the construction phase up until final acceptance by the Owner.
3. Install equipment according to OEM's recommendations. Provide any hardware, adaptors, brackets, rack mount kits or other accessories recommended by OEM for correct assembly and installation.
4. Secure equipment firmly in place, including receptacles, speakers, equipment racks, system cables, etc.
  - a. All supports, mounts, fasteners, attachments and attachment points shall support their loads with a safety factor of at least 5:1.
  - b. Do not impose the weight of equipment or fixtures on supports provided for other trades or systems.
  - c. Any suspended equipment or associated hardware must be certified by the OEM for overhead suspension.
  - d. The Contractor is responsible for means and methods in the design, fabrication, installation and certification of any supports, mounts, fasteners and attachments.
5. Finishes for any exposed work such as plates, racks, panels, speakers, etc. shall be approved by the Architect, Owner and TVE 0050P3B.
6. Coordinate cover plates with field conditions. Size and install cover plates as necessary to hide joints between back boxes and surrounding wall. Where cover plates are not fitted with connectors, provide grommets in size and quantity required.

Do not allow cable to leave or enter boxes without cover plates installed.

7. Active electronic component equipment shall consist of solid state components, be rated for continuous duty service, comply with the requirements of FCC standards for telephone and data equipment, systems, and service.
  8. Color code all distribution wiring to conform to the Nurse Call Industry Standard, EIA/TIA, and this document, whichever is the more stringent. At a minimum, all equipment, cable duct and/or conduit, enclosures, wiring, terminals, and cables shall be clearly and permanently labeled according to and using the provided record drawings, to facilitate installation and maintenance.
  9. Connect the System's primary input AC power to the Facility's Critical Branch of the Emergency AC power distribution system as shown on the plans or if not shown on the plans consult with COR regarding a suitable circuit location prior to bidding.
  10. Product Delivery, Storage and Handling:
    - a. Delivery: Deliver materials to the job site in OEM's original unopened containers, clearly labeled with the OEM's name and equipment catalog numbers, model and serial identification numbers. The COR may inventory the cable, patch panels, and related equipment.
    - b. Storage and Handling: Store and protect equipment in a manner, which will preclude damage as directed by the RE.
  11. Where TCOs are installed adjacent to each other, install one outlet for each instrument.
  12. Equipment installed outdoors shall be weatherproof or installed in weatherproof enclosures with hinged doors and locks with two keys.
- B. Equipment Racks/Cabinets:
1. Fill unused equipment mounting spaces with blank panels or vent panels. Match color to equipment racks/cabinets.
  2. Provide security covers for all devices not requiring routine operator control.
  3. Provide vent panels and cooling fans as required for the operation of equipment within the OEM' specified temperature limits. Provide adequate ventilation space between equipment for cooling. Follow

manufacturer's recommendations regarding ventilation space between amplifiers.

4. Provide insulated connections of the electrical raceway to equipment racks.
5. Provide continuous raceway/conduit with no more than 40% fill between wire troughs and equipment racks/cabinets for all non-plenum-rated cable. Ensure each system is mechanically separated from each other in the wireway.
6. Ensure a minimum of 36 inches around each cabinet and/or rack to comply with OSHA Safety Standards. Cabinets and/or Racks installed side by side - the 36" rule applies to around the entire assembly

C. Distribution Frames.

1. A new stand-alone (i.e., self supporting, free standing) PA rack/frame may be provided in each TR to interconnect the TCR, PCR, SCC, NS, STRs & ECRs. Rack/frames shall be wired in accordance with industry standards and shall employ "latest state-of-the-art" modular cross-connect devices. The PA riser cable shall be sized to satisfy all voice/digital requirements plus not less than 50% spare (growth) capacity in each TR which includes a fiber optic backbone.
2. The frames/racks shall be connected to the TER/MCR system ground.

D. Wiring Practice - in addition to the MANDATORY infrastructure requirements outlined in VA Construction Specifications 27 10 00 - TIP Structured Communications Cabling, 27 11 00 - TIP Communications Rooms Fittings and 27 15 00 - TIP Horizontal and Vertical Communicators Cabling, the following additional practices shall be adhered too:

1. Comply with requirements for raceways and boxes specified in Division 26 Section "Raceway and Boxes for Electrical Systems."
2. Execute all wiring in strict adherence to the National Electrical Code, applicable local building codes and standard industry practices.
3. Wiring shall be classified according to the following low voltage signal types:
  - a. Balanced microphone level audio (below -20dBm) or Balanced line level audio (-20dBm to +30dBm)
  - b. 70V audio speaker level audio.
  - c. Low voltage DC control or power (less than 48VDC)



4. Where raceway is to be EMT (conduit), wiring of differing classifications shall be run in separate conduit. Where raceway is to be an enclosure (rack, tray, wire trough, utility box) wiring of differing classifications which share the same enclosure shall be mechanically partitioned and separated by at least four (4) inches. Where Wiring of differing classifications must cross, they shall cross perpendicular to one another.
5. Do not splice wiring anywhere along the entire length of the run. Make sure cables are fully insulated and shielded from each other and from the raceway for the entire length of the run.
6. Do not pull wire through any enclosure where a change of raceway alignment or direction occurs. Do not bend wires to less than radius recommended by manufacturer.
7. Replace the entire length of the run of any wire or cable that is damaged or abraided during installation. There are no acceptable methods of repairing damaged or abraided wiring.
8. Use wire pulling lubricants and pulling tensions as recommended by the OEM.
9. Use grommets around cut-outs and knock-outs where conduit or chase nipples are not installed.
10. Do not use tape-based or glue-based cable anchors.
11. Ground shields and drain wires to the Facility's signal ground system as indicated by the drawings.
12. Field wiring entering equipment racks shall be terminated as follows:
  - a. Provide OEM directed service loops at harness break-outs and at plates, panels and equipment. Loops should be sufficient to allow plates, panels and equipment to be removed for service and inspection.
  - b. Line level and speaker level wiring may be terminated inside the equipment rack using specified terminal blocks (see "Products.") Provide 15% spare terminals inside each rack. Microphone level wiring may only be terminated at the equipment served.
  - c. If specified terminal blocks are not designed for rack mounting, utilize  $\frac{3}{4}$ " plywood or  $\frac{1}{8}$ " thick aluminum plates/blank panels as a mounting surface. Do not mount on the bottom of the rack.

- d. Employ permanent strain relief for any cable with an outside diameter of 1" or greater.
- 13. Use only balanced audio circuits unless noted otherwise directed and indicated on the drawings.
- 14. Make all connections as follows:
  - a. Make all connections using rosin-core solder or mechanical connectors appropriate to the application.
  - b. For crimp-type connections, use only tools that are specified by the manufacturer for the application.
  - c. Use only insulated spade lugs on screw terminals. Spade lugs shall be sized to fit the wire gauge. Do not exceed two lugs per terminal.
  - d. Wire nuts, electrical tape or "Scotch Lock" connections are not acceptable for any application.
- 15. Noise filters and surge protectors shall be provided for each equipment interface cabinet, switch equipment cabinet, control console, local, and remote active equipment locations to ensure protection from input primary AC power surges and noise glitches are not induced into low Voltage data circuits.
- 16. Wires or cables previously approved to be installed outside of conduit, cable trays, wireways, cable duct, etc:
  - a Only when specifically authorized as described herein, will wires or cables be identified and approved to be installed outside of conduit. The wire or cable runs shall be UL rated plenum and OEM certified for use in air plenums.
  - b Wires and cables shall be hidden, protected, fastened and tied at 600 mm (24 in.) intervals, maximum, as described herein to building structure.
  - c Closer wire or cable fastening intervals may be required to prevents sagging, maintain clearance above suspended ceilings, remove unsightly wiring and cabling from view and discourage tampering and vandalism. Wire or cable runs, not provided in conduit, that penetrate outside building walls, supporting walls, and two hour fire barriers shall be sleeved and sealed with an approved fire retardant sealant.
  - d Wire or cable runs to system components installed in walls (i.e.: volume attenuators, circuit controllers, signal, or data outlets,

etc.) may, when specifically authorized by the RE, be fished through hollow spaces in walls and shall be certified for use in air plenum areas.

- e Completely test all of the cables after installation and replace any defective cables.
- f Wires or cables that are installed outside of buildings shall be in conduit, secured to solid building structures. If specifically approved, on a case by case basis, to be run outside of conduit, the wires or cables shall be installed, as described herein. The bundled wires or cables must: Be tied at not less than 460 mm (18 in.) intervals to a solid building structure; have ultra violet protection and be totally waterproof (including all connections). The laying of wires or cables directly on roof tops, ladders, drooping down walls, walkways, floors, etc. is not allowed and will not be approved.

E. Cable Installation - Cable Installation - In addition to the **MANDATORY** infrastructure requirements outlined in VA Construction Specifications 27 10 00 - Structured TIP Communications Cabling, 27 11 00 - TIP Communications Rooms and Fittings and 27 15 00 - TIP Communications Horizontal and Vertical Cabling and the following additional practices shall be adhered too:

1. Support cable on maximum 2'-0" centers. Acceptable means of cable support are cable tray, j-hooks, and bridal rings. Velcro wrap cable bundles loosely to the means of support with plenum rated Velcro straps. Plastic tie wraps are not acceptable as a means to bundle cables.
2. Run cables parallel to walls.
3. Install maximum of 10 cables in a single row of J-hooks. Provide necessary rows of J-hooks as required by the number of cables.
4. Do not lay cables on top of light fixtures, ceiling tiles, mechanical equipment, or ductwork. Maintain at least 2'-0" clearance from all shielded electrical apparatus.
5. All cables shall be tested after the total installation is fully complete. All test results are to be documented. All cables shall pass acceptable test requirements and levels. Contractor shall remedy any cabling problems or defects in order to pass or comply

- with testing. This includes the re-pull of new cable as required at no additional cost to the Owner.
6. Ends of cables shall be properly terminated on both ends per industry and OEM's recommendations.
  7. Provide proper temporary protection of cable after pulling is complete before final dressing and terminations are complete. Do not leave cable lying on floor. Bundle and tie wrap up off of the floor until you are ready to terminate.
  8. Terminate all conductors; no cable shall contain unterminated elements. Make terminations only at outlets and terminals.
  9. Splices, Taps, and Terminations: Arrange on numbered terminal strips in junction, pull, and outlet boxes; terminal cabinets; and equipment enclosures. Cables may not be spliced.
  10. Bundle, lace, and train conductors to terminal points without exceeding OEM's limitations on bending radii. Install lacing bars and distribution spools.
  11. Cold-Weather Installation: Bring cable to room temperature before dereeling. Heat lamps shall not be used.
  12. Cable shall not be run through structural members or be in contact with pipes, ducts, or other potentially damaging items.
  13. Separation of Wires: (REFER TO RACEWAY INSTALLATION) Separate speaker-microphone, line-level, speaker-level, and power wiring runs. Install in separate raceways or, where exposed or in same enclosure, separate conductors at least 12 inches apart for speaker microphones and adjacent parallel power and telephone wiring. Separate other intercommunication equipment conductors as recommended by equipment manufacturer.
  14. Serve all cables as follows:
    - a. Cover the end of the overall jacket with a 1" (minimum) length of transparent heat-shrink tubing. Cut unused insulated conductors 2" (minimum) past the heat-shrink, fold back over jacket and secure with cable-tie. Cut unused shield/drain wires 2" (minimum) past the Heatshrink and serve as indicated below.
    - b. Cover shield/drain wires with heat-shrink tubing extending back to the overall jacket. Extend tubing  $\frac{1}{4}$ " past the end of unused wires, fold back over jacket and secure with cable tie.

- c. For each solder-type connection, cover the bare wire and solder connection with heat-shrink tubing.
- F. Labeling: Provide labeling in accordance with ANSI/EIA/TIA-606-A. All lettering for Nurse Call and/or Code Blue circuits shall be stenciled using laser printers.
- 1. Cable and Wires (Hereinafter referred to as "Cable"): Cables shall be labeled at both ends in accordance with ANSI/EIA/TIA-606-A. Labels shall be permanent in contrasting colors. Cables shall be identified according to the System "Record Wiring Diagrams."
  - 2. Equipment: System equipment shall be permanently labeled with contrasting plastic laminate or Bakelite material. System equipment shall be labeled on the face of the unit corresponding to its source.
    - a. Clearly, consistently, logically and permanently mark switches, connectors, jacks, relays, receptacles and electronic and other equipment.
    - b. Engrave and paint fill all receptacle panels using 1/8" (minimum) high lettering and contrasting paint.
    - c. For rack-mounted equipment, use engraved Lamacoid labels with white 1/8" (minimum) high lettering on black background. Label the front and back of all rack-mounted equipment.
  - 3. Conduit, Cable Duct, and/or Cable Tray: The Contractor shall label all conduit, duct and tray, including utilized GFE, with permanent marking devices or spray painted stenciling a minimum of 3 meters (10 ft.) identifying it as the System. In addition, each enclosure shall be labeled according to this standard.
  - 4. Termination Hardware: The Contractor shall label TCOs and patch panel connections using color coded labels with identifiers in accordance with ANSI/EIA/TIA-606-A and the "Record Wiring Diagrams."
  - 5. Where multiple pieces of equipment reside in the same rack group, clearly and logically label each indicating to which room, channel, receptacle location, etc. they correspond.
  - 6. Permanently label cables at each end, including intra-rack connections. Labels shall be covered by the same, transparent heat-shrink tubing covering the end of the overall jacket. Alternatively, computer generated labels of the type which include a clear protective wrap may be used.

7. Contractor's name shall appear no more than once on each continuous set of racks. The Contractor's name shall not appear on wall plates or portable equipment.
  8. Ensure each OEM supplied item of equipment has appropriate UL Labels / Marks for the service the equipment is performed permanently attached / marked to a non-removal board in the unit. EQUIPMENT INSTALLED NOT BEARING THESE UL MARKS WILL NOT BE ALLOWED TO BE A PART OF THE SYSTEM. THE CONTRACTOR SHALL BEAR ALL COSTS REQUIRED TO PROVIDE REPLACEMENT EQUIPMENT WITH APPROVED UL MARKS.
- G. Conduit and Signal Ducts: When the Contractor and/or OEM determines additional system conduits and/or signal ducts are required in order to meet the system minimum performance standards outlined herein, the contractor shall provide these items as follows:
1. Conduit:
    - a. The Contractor shall employ the latest installation practices and materials. The Contractor shall provide conduit, junction boxes, connectors, sleeves, weather heads, pitch pockets, and associated sealing materials not specifically identified in this document as GFE. Conduit penetrations of walls, ceilings, floors, interstitial space, fire barriers, etc., shall be sleeved and sealed.
    - b. All cables shall be installed in separate conduit and/or signal ducts (exception from the separate conduit requirement to allow Nurse Call and/or Code Blue cables to be installed in partitioned cable tray with voice cables may be granted in writing by the COR if requested). Conduits shall be provided in accordance with Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and NEC Articles 517 for Critical Care and 800 for Communications systems, at a minimum.
    - c. When metal, plastic covered, etc., flexible cable protective armor or systems are specifically authorized to be provided for use in the System, their installation guidelines and standards shall be as specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.
    - d. When "interduct" flexible cable protective systems is specifically authorized to be provided for use in the System, it's installation guidelines and standards shall be as the

specified herein, Section 27 05 33, RACEWAYS AND BOXES FOR COMMUNICATIONS SYSTEMS, and the NEC.

- e. Conduit fill (including GFE approved to be used in the system) shall not exceed 40%. Each conduit end shall be equipped with a protective insulator or sleeve to cover the conduit end, connection nut or clamp, to protect the wire or cable during installation and remaining in the conduit. Electrical power conduit shall be installed in accordance with the NEC. AC power conduit shall be run separate from signal conduit.
  - f. Ensure that Critical Care Nurse Call and/or Code Systems (as identified by NEC Section 517) are completely separated and protected from all other systems.
2. Signal Duct, Cable Duct, or Cable Tray:
- a. The Contractor shall use GFE signal duct, cable duct, and/or cable tray, when identified and approved by the RE.
  - b. Approved signal and/or cable duct shall be a minimum size of 100 mm x 100 mm (4 in. X 4 in.) inside diameter with removable tops or sides, as appropriate. Protective sleeves, guides or barriers are required on all sharp corners, openings, anchors, bolts or screw ends, junction, interface and connection points.
  - c. Approved cable tray shall be fully covered, mechanically and physically partitioned for multiple electronic circuit use, and be UL certified and labeled for use with telecommunication circuits and/or systems. The COR shall approve width and height dimensions.
  - d. All cable junctions and taps shall be accessible. Provide an 8" X 8" X 4" (minimum) junction box attached to the cable duct or raceway for installation of distribution system passive equipment. Ensure all equipment and tap junctions are accessible

### **3.5 PROTECTION OF NETWORK DEVICES**

- A. Contractor shall protect network devices during unpacking and installation by wearing manufacturer approved electrostatic discharge (ESD) wrist straps tied to chassis ground. The wrist strap shall meet OSHA requirements for prevention of electrical shock, should technician come in contact with high voltage.

### **3.6 CUTTING, CLEANING AND PATCHING**

- A. It shall be the responsibility of the contractor to keep their work area clear of debris and clean area daily at completion of work.
- B. It shall be the responsibility of the contractor to patch and paint any wall or surface that has been disturbed by the execution of this work.
- C. The Contractor shall be responsible for providing any additional cutting, drilling, fitting or patching required that is not indicated as provided by others to complete the Work or to make its parts fit together properly.
- D. The Contractor shall not damage or endanger a portion of the Work or fully or partially completed construction of the Owner or separate contractors by cutting, patching or otherwise altering such construction, or by excavation. The Contractor shall not cut or otherwise alter such construction by the Owner or a separate contractor except with written consent of the Owner and of such separate contractor; such consent shall not be unreasonably withheld. The Contractor shall not unreasonably withhold from the Owner or a separate Contractor the Contractor's consent to cutting or otherwise altering the Work.
- E. Where coring of existing (previously installed) concrete is specified or required, including coring indicated under unit prices, the location of such coring shall be clearly identified in the field and the location shall be approved by the Project Manager prior to commencement of coring work.

### **3.7 FIREPROOFING**

- A. Where Nurse Call and/or Code Blue wires, cables and conduit penetrate fire rated walls, floors and ceilings, fireproof the opening.
- B. Provide conduit sleeves (if not already provided by electrical contractor) for cables that penetrate fire rated walls and Telecommunications Rooms floors and ceilings. After the cabling installation is complete, install fire proofing material in and around all conduit sleeves and openings. Install fire proofing material thoroughly and neatly. Seal all floor and ceiling penetrations.
- C. Use only materials and methods that preserve the integrity of the fire stopping system and its rating.



- D. Install fireproofing where low voltage cables are installed in the same manholes with high voltage cables; also cover the low voltage cables with arc proof and fireproof tape.
- E. Use approved fireproofing tape of the same type as used for the high voltage cables, and apply the tape in a single layer, one-half lapped or as recommended by the manufacturer. Install the tape with the coated side towards the cable and extend it not less than 25 mm (one inch) into each duct.
- F. Secure the tape in place by a random wrap of glass cloth tape.

### **3.8 GROUNDING**

- A. Ground Nurse Call and/or Code Blue cable shields and equipment to eliminate shock hazard and to minimize ground loops, commonmode returns, noise pickup, cross talk, and other impairments as specified in CFM Division 27, Section 27 05 26 - Grounding and Bonding for Communications Systems.
- B. Facility Signal Ground Terminal: Locate at main room or area signal ground within the room (i.e. head end and telecommunications rooms) or area(s) and indicate each signal ground location on the drawings.
- C. Extend the signal ground to inside each equipment cabinet and/or rack. Ensure each cabinet and/or rack installed item of equipment is connected to the extended signal ground. Isolate the signal ground from power and major equipment grounding systems.
- D. When required, install grounding electrodes as specified in CFM Division 26, Section 26 05 26 -Grounding and Bonding for Electrical Systems.
- E. Do not use "3<sup>rd</sup> or 4<sup>th</sup>" wire internal electrical system conductors for communications signal ground.
- F. Do not connect the signal ground to the building's external lightning protection system.
- G. Do Not "mix grounds" of different systems.
- H. Ensure grounds of different systems are installed as to not violate OSHA Safety and NEC installation requirements for protection of personnel.

## **PART 4 - TESTING / GUARANTY / TRAINING**

### **4.0 SYSTEM LISTING**

The Nurses Call System is NFPA listed as an "Emergency" Communication system. Where Code Blue signals are transmitted, that listing is elevated

to "Life Support/Safety." Therefore, the following testing and guaranty provisions are the minimum to be performed and provided by the contractor and Warranted by the OEM.

#### **4.1 PROOF OF PERFORMANCE TESTING**

##### **A. Intermediate Testing:**

1. After completion of 30 - 40% of the installation of a head end cabinet(s) and equipment, one master stations, local and remote stations, treatment rooms, and prior to any further work, this portion of the system must be pretested, inspected, and certified. Each item of installed equipment shall be checked to ensure appropriate UL Listing and Certification Labels are affixed as required by NFPA -Life Safety Code 101-3.2 (a) & (b), UL Nurse Call Standard 1069 and JCHCO evaluation guidelines, and proper installation practices are followed. The intermediate test shall include a full operational test.
2. All inspections and tests shall be conducted by an OEM-certified contractor representative and witnessed by TVE-0050P3B if there is no local Government Representative that processes OEM and VA approved Credentials to inspect and certify the system. The results of the inspection will be officially recorded by the Government Representative and maintained on file by the COR, until completion of the entire project. The results will be compared to the Acceptance Test results. An identical inspection may be conducted between the 65 - 75% of the system construction phase, at the direction of the COR.

##### **B. Pretesting:**

1. Upon completing installation of the Nurse Call and/or Code Blue System, the Contractor shall align, balance, and completely pretest the entire system under full operating conditions.
2. Pretesting Procedure:
  - a. During the System Pretest the Contractor shall verify (utilizing approved test equipment) that the System is fully operational and meets all the System performance requirements of this standard.
  - b. The Contractor shall pretest and verify that all PSM System functions and specification requirements are met and operational, no unwanted aural effects, such as signal distortion, noise pulses, glitches, audio hum, poling noise, etc. are present. At a

minimum, each of the following locations shall be fully pretested:

- 1) Central Control Cabinets.
  - 2) Nurse Control Stations.
    - a) Master Stations
    - b) Patient Stations
    - c) Staff Stations
    - d) Emergency Stations
    - e) Code Blue Stations
  - 3) Dome Lights.
    - a) Patient Rooms
    - b) Corridors
    - c) Intersectional
  - 4) STRs
  - 5) Local and Remote Enunciation Panels (code blue).
  - 6) Electrical Supervision Panels/Functions/locations.
  - 7) All Networked locations.
  - 8) System interface locations (i.e. wireless, PA, telephone, etc.).
  - 9) System trouble reporting.
  - 10) System electrical supervision.
  - 11) UPS operation.
  - 12) Primary / Emergency AC Power Requirements
  - 13) Extra Auxiliary Generator Requirements.
  - 14) NSs.
3. Contractor shall provide four (4) copies of the recorded system pretest measurements and the written certification that the System is ready for the formal acceptance test shall be submitted to the COR.

C. Acceptance Test:

1. After the Nurse Call and/or Code Blue System has been pretested and the Contractor has submitted the pretest results and certification to the COR, then the Contractor shall schedule an acceptance test date and give the COR 15 working days written notice prior to the date the acceptance test is expected to begin. The System shall be tested in the presence of a TVE 0050P3B and OEM certified representatives. The System shall be tested utilizing the approved

- test equipment to certify proof of performance and Life Safety / Critical Service compliance. The tests shall verify that the total System meets all the requirements of this specification. The notification of the acceptance test shall include the expected length (in time) of the test.
2. The acceptance test shall be performed on a "go-no-go" basis. Only those operator adjustments required to show proof of performance shall be allowed. The test shall demonstrate and verify that the installed System does comply with all requirements of this specification under operating conditions. The System shall be rated as either acceptable or unacceptable at the conclusion of the test. Failure of any part of the System that precludes completion of system testing, and which cannot be repaired in four (4) hours, shall be cause for terminating the acceptance test of the System. Repeated failures that result in a cumulative time of eight (8) hours to affect repairs shall cause the entire System to be declared unacceptable.
  3. Retesting of the entire System shall be rescheduled at the convenience of the Government and costs borne by the Contractor at the direction of the SRE.
- D. Acceptance Test Procedure:
1. Physical and Mechanical Inspection:
    - a. The TVE 0050P3B Representative will tour all major areas where the Nurse Call and/or Code Blue System and all sub-systems are completely and properly installed to insure they are operationally ready for proof of performance testing. A system inventory including available spare parts will be taken at this time. Each item of installed equipment shall be checked to ensure appropriate UL certification labels are affixed.
    - b. The System diagrams, record drawings, equipment manuals, TIP Auto CAD Disks, intermediate, and pretest results shall be formally inventoried and reviewed.
    - c. Failure of the System to meet the installation requirements of this specification shall be grounds for terminating all testing.
  2. Operational Test:
    - a. After the Physical and Mechanical Inspection, the central terminating and nurse call master control equipment shall be

checked to verify that it meets all performance requirements outlined herein. A spectrum analyzer and sound level meter may be utilized to accomplish this requirement.

- b. Following the central equipment test, a pillow speaker (or on board speaker) shall be connected to the central terminating and nurse call master control equipment's output tap to ensure there are no signal distortions such as intermodulation, data noise, popping sounds, erratic system functions, on any function.
- c. The distribution system shall be checked at each interface, junction, and distribution point, first, middle, and last intersectional, room, and bed dome light in each leg to verify that the nurse call distribution system meets all system performance standards.
- d. Each MATV outlet that is controlled by a nurse call pillow speaker shall be functionally tested at the same time utilizing the Contractor's approved hospital grade HDTV receiver and TV remote control cable.
- e. The RED system and volume stepper switches shall be checked to insure proper operation of the pillow speaker, the volume stepper and the RED system (if installed).
- f. Additionally, each installed emergency, patient, staff, duty, panic station, intersectional, room, and bed dome light, power supply, code one, and remote annunciator panels shall be checked insuring they meet the requirements of this specification.
- g. Once these tests have been completed, each installed sub-system function shall be tested as a unified, functioning and fully operating system. The typical functions are: nurse follower, three levels of emergency signaling (i.e. flashing red emergency, flashing white patient emergency, flashing white or combination lights for staff emergency, separate flashing code blue), minimum of 10 minutes of UPS operation, memory saving, minimum of ten station audio paging, canceling emergency calls at each originating station only, and storage and prioritizing of calls.
- h. Individual Item Test: The TVE 0050P3B Representative will select individual items of equipment for detailed proof of performance testing until 100% of the System has been tested and found to

meet the contents of this specification. Each item shall meet or exceed the minimum requirements of this document.

3. Test Conclusion:

- a. At the conclusion of the Acceptance Test, using the generated punch list (or discrepancy list) the VA and the Contractor shall jointly agree to the results of the test, and reschedule testing on deficiencies and shortages with the RE. Any retesting to comply with these specifications will be done at the Contractor's expense.
- b. If the System is declared unacceptable without conditions, all rescheduled testing expenses will be borne by the Contractor.

E. Acceptable Test Equipment: The test equipment shall furnished by the Contractor shall have a calibration tag of an acceptable calibration service dated not more than 12 months prior to the test. As part of the submittal, a test equipment list shall be furnished that includes the make and model number of the following type of equipment as a minimum:

1. Spectrum Analyzer.
2. Signal Level Meter.
3. Volt-Ohm Meter.
4. Sound Pressure Level (SPL) Meter.
5. Oscilloscope.
6. Pillow Speaker Test Set (Pillow Speaker with appropriate load and cross connections in lieu of the set is acceptable).
7. Patient Push Button Cord Test Set.
8. Patient Bed with connecting multiple conductor cord.

**4.2 WARRANTY**

A. Comply with FAR 52.246-21, except that warranty shall be as follows:

B. Contractor's Responsibility:

1. The Contractor shall warranty that all provided material and equipment will be free from defects, workmanship and will remain so for a period of one year from date of final acceptance of the System by the VA. The Contractor shall provide OEM's equipment warranty documents, to the COR, that certifies each item of equipment installed conforms to OEM published specifications.
2. The Contractor's maintenance personnel shall have the ability to contact the Contractor and OEM for emergency maintenance and logistic assistance, remote diagnostic testing, and assistance in

resolving technical problems at any time. This contact capability shall be provided by the Contractor and OEM at no additional cost to the VA.

3. All Contractor maintenance and supervisor personnel shall be fully qualified by the OEM and must provide two (2) copies of current and qualified OEM training certificates and OEM certification upon request.
4. Additionally, the Contractor shall accomplish the following minimum requirements during the two year guaranty period:
  - a. Response Time during the Two Year Guaranty Period:
    - 1) The RE (or Facility Contracting Officer if the system has been turned over to the Facility) is the Contractor's ONLY OFFICIAL reporting and contact official for nurse call system trouble calls, during the guaranty period.
    - 2) A standard work week is considered 8:00 A.M. to 5:00 P.M. or as designated by the RE (or Facility Contracting Officer), Monday through Friday exclusive of Federal Holidays.
  - 3) The Contractor shall respond and correct on-site trouble calls, during the standard work week to:
    - a) A routine trouble call within one (1) working day of its report. A routine trouble is considered a trouble which causes a pillow speaker or cordset, one (1) master nurse control station, patient station, emergency station, or dome light to be inoperable.
    - b) Routine trouble calls in critical emergency health care facilities (i.e., cardiac arrest, intensive care units, etc.) shall also be deemed as an emergency trouble call. The COR shall notify the Contractor of this type of trouble call.
    - c) An emergency trouble call within four hours of its report. An emergency trouble is considered a trouble which causes a sub-system (ward), distribution point, terminal cabinet, or code one system to be inoperable at anytime.
  - 4) If a Nurse Call and/or Code Blue/ component failure cannot be corrected within four (4) hours (exclusive of the standard work time limits), the Contractor shall be responsible for providing alternate nurse call equipment. The alternate

equipment/system shall be operational within a maximum of 20 hours after the four (4) hour trouble shooting time and restore the effected location operation to meet the System performance standards. If any sub-system or major system trouble cannot be corrected within one working day, the Contractor shall furnish and install compatible substitute equipment returning the System or sub-system to full operational capability, as described herein, until repairs are complete.

b. Required On-Site Visits during the Two Year Guaranty Period

- 1) The Contractor shall visit, on-site, for a minimum of eight (8) hours, once every 12 weeks, during the guaranty period, to perform system preventive maintenance, equipment cleaning, and operational adjustments to maintain the System according the descriptions identified in this document.
- 2) The Contractor shall arrange all Facility visits with the COR prior to performing the required maintenance visits.
- 3) Preventive maintenance shall be performed by the Contractor in accordance with the OEM's recommended practice and service intervals during non-busy time agreed to by the COR and Contractor.
- 4) The preventive maintenance schedule, functions and reports shall be provided to and approved by the COR.
- 5) The Contractor shall provide the COR a type written report itemizing each deficiency found and the corrective action performed during each required visit or official reported trouble call. The Contractor shall provide the RE with sample copies of these reports for review and approval at the beginning of the Acceptance Test. The following reports are the minimum required:
  - a) The Contractor shall provide a monthly summary all equipment and sub-systems serviced during this warranty period to COR by the fifth working day after the end of each month. The report shall clearly and concisely describe the services rendered, parts replaced and repairs performed. The report shall prescribe anticipated future



needs of the equipment and systems for preventive and predictive maintenance.

- b) The Contractor shall maintain a separate log entry for each item of equipment and each sub-system of the System. The log shall list dates and times of all scheduled, routine, and emergency calls. Each emergency call shall be described with details of the nature and causes of emergency steps taken to rectify the situation and specific recommendations to avoid such conditions in the future.

- 6) The COR shall convey to the Facility Engineering Officer, two (2) copies of actual reports for evaluation.

- a) The COR shall ensure a copy of these reports is entered into the System's official acquisition documents.
- b) The Facility Chief Engineer shall ensure a copy of these reports is entered into the System's official technical record documents.

C. Work Not Included: Maintenance and repair service shall not include the performance of any work due to improper use; accidents; other vendor, contractor, or owner tampering or negligence, for which the Contractor is not directly responsible and does not control. The Contractor shall immediately notify the COR in writing upon the discovery of these incidents. The COR will investigate all reported incidents and render an official opinion in writing concerning the supplied information.

#### **4.3 TRAINING**

A. Provide thorough training of all nursing staff assigned to those nursing units receiving new networked nurse/patient communications equipment. This training shall be developed and implemented to address two different types of staff. Floor nurses/staff shall receive training from their perspective, and likewise, unit secretaries (or any person whose specific responsibilities include answering patient calls and dispatching staff) shall receive operational training from their perspective. A separate training room will be set up that allows this type of individualized training utilizing in-service training unit, prior to cut over of the new system.

#### **5.0 ATTACHMENTS**

- A. The following items are required as a part of the system:
  - 1. COTS Documents:

**CHECKLIST FOR SOFTWARE LICENSING AGREEMENTS**  
(For use in commercial item acquisition [COTS] conforming to – FAR Part 12)

<b>The Government may not be able to accept standard commercial licensing agreement without modification; <u>you must</u> negotiate terms and conditions so it is consistent with the FAR and the VAAR.</b>		
<b>Is the license (check all that apply):</b>	<b>Yes</b>	<b>No</b>
Exclusive		
Non-exclusive		
Perpetual		
Limited term		
If limited term, state the period (months or years):		
If limited term, is there an automatic renewal provision?		
CPU based		
If CPU based, state number of machines and whether simultaneous use is permitted:		
Site license		
If site license, state the site/location:		
Network license		
Other basis (e.g., # of users, # of transactions, etc.) (state specifics)		
Applicable to only the current version (doesn't apply to future versions)		
Software maintenance included at no extra cost		
Allow for office relocation or transfer		
Allow copying for backup or archival purpose		
Allow no cost copy at disaster recovery site		
Restricted on Use: (see note below)		
Restricted on the processing of data by or for user's subsidiaries and affiliates		
Restricted on processing of third party data (or use in service bureau)		
Restricted on network use		
Restricted on site and equipment limitations		
Restricted on number of users (e.g., cannot exceed _____ # of users)		
<b>Terms and Conditions that may need to be negotiated:</b>	<b>Yes</b>	<b>No</b>
Does the license prohibit use of the software outside of the Government? If yes, this needs to be deleted/modified if other Government contractors need access to the software (as GFP) to fulfill obligations of their own contracts.		
Does license state that the software is Year 2000 compliant or include a Year 2000 warranty? If no, must ensure it is compliant per FAR 39 or include a Y2K warranty.		
Does the license state that it provides no warranties or guarantees of any kind? If yes, need to determine whether additional warranty would be in the best interest of the Government.		
Does the license warrant that the software does not contain any code (e.g., virus) that will disable the software, and if such code exists, that Licensor agrees to indemnify the licensee (user) for all damages suffered as a result of such code? If no, need to negotiate for such warranty.		
Does the license allow access to source code? If no, negotiate for access if software will be modified or customized for the Government's needs or if the Government intends to maintain the software itself.		
Does the license require Licensor to deposit source code in escrow account? If no and source code is needed, consider negotiating for this provision, and state what "release conditions" are.		
Does the license allow the Government to hold the rights to customized code and to the data that the software manipulates? If no, negotiate for the rights if the Government (customer) requires them.		
Does the license authorize us to copy user manuals for internal purposes? If no, negotiate for authorization if multiple copies must be made for our internal use or ensure that the vendor supplies adequate number of copies. May also negotiate for updated manuals at periodic intervals, e.g., with each major update.		
Does the license state that licensee modifications to the software void all warranties? If yes, ensure that the vendor still warrants the unmodified portions.		
Does the license include clauses that prohibit needed uses of software, restrict the use of output from the software, or inappropriately burden the operation of the computer facilities? If yes, need to negotiate better terms and conditions.		
Is the dispute clause in the license consistent with FAR 52.233-1, Disputes Clause? If no, then need to modify license to be consistent with FAR.		
Does the default clause in the license allow for the Government to terminate for convenience or for cause, consistent with FAR 52.212-4(l) or FAR 52.212-4(m)? If no, then need to modify license to be consistent with FAR Part 12 (not FAR Part 49).		

b.

<b>SOLICITATION/CONTRACT/ORDER FOR COMMERCIAL ITEMS</b>				1. REQUISITION NUMBER		PAGE 1 OF 7		
OFFEROR TO COMPLETE BLOCKS 12, 17, 23, 24, & 30								
2. CONTRACT NO.		3. AWARD/EFFECTIVE DATE SEE BLOCK 31C		4. ORDER NUMBER		5. SOLICITATION NO.		
7. FOR SOLICITATION INFORMATION		a. NAME			b. TELEPHONE NUMBER (No collect calls)		6. SOLICITATION ISSUE DATE 8. OFFER DUE DATE/ LOCAL TIME	
9. ISSUED BY:		CODE		10. THIS ACQUISITION IS <input type="checkbox"/> UNRESTRICTED <input type="checkbox"/> SETASIDE: 100 % FOR <input type="checkbox"/> SMALL BUSINESS <input type="checkbox"/> HUBZONE SMALL BUSINESS <input type="checkbox"/> 8 (A) NAICS: 541511 SIZE STANDARD:		11. DELIVERY FOR FOB DESTINATION UNLESS BLOCK IS MARKED <input type="checkbox"/> SEE SCHEDULE <input type="checkbox"/> 13a. THIS CONTRACT IS A RATED ORDER UNDER DPAS (15 CFR 700) 13b. RATING 14. METHOD OF SOLICITATION <input checked="" type="checkbox"/> RFQ <input type="checkbox"/> IFB <input type="checkbox"/> RFP		
15. DELIVER TO		CODE		16. ADMINISTERED BY		CODE		
				See #9 above				
17a. CONTRACTOR/ CODE		FACILITY CODE		18a. PAYMENT WILL BE MADE BY		CODE		
OFFEROR				UNITED STATES OF AMERICA Department of Veterans Affairs FMS P.O. Box 149971 Austin, TX 78714-8971				
TELEPHONE NO: 703.246-0392				18b. SUBMIT INVOICES TO ADDRESS SHOWN IN BLOCK 18a. UNLESS BLOCK BELOW IS CHECKED <input checked="" type="checkbox"/> SEE ADDENDUM				
<input type="checkbox"/> 17b. CHECK IF REMITTANCE IS DIFFERENT AND PUT SUCH ADDRESS IN OFFER								

19. ITEM NO.	20. SCHEDULE OF SUPPLIES/SERVICES	21. QUANTI TY	22. UNI T	23. UNIT PRICE	24. AMOUNT
	See page 2  Use Reverse and/or (Attach Additional Sheets as Necessary)				
25. ACCOUNTING AND APPROPRIATION DATA				26. TOTAL AWARD AMOUNT (For Govt. Use Only)	

☐ 27a. SOLICITATION INCORPORATES BY REFERENCE FAR 52.212-1, 52.212-4. ☐ ARE NOT  
FAR 52.212-3 AND 52.212-5 ARE ATTACHED. ADDENDA ARE ATTACHED.

☒ 27b. CONTRACT/PURCHASE ORDER INCORPORATES BY REFERENCE FAR 52.212-4, ☒ ARE ☐ ARE NOT  
52.227-14, 52.227-16, and 52.227-19. ADDENDA ATTACHED.

<input checked="" type="checkbox"/> 28. CONTRACTOR IS REQUIRED TO SIGN THIS DOCUMENT AND RETURN <u>1</u> COPIES TO ISSUING OFFICE. CONTRACTOR AGREES TO FURNISH AND DELIVER ALL ITEMS SET FORTH OR OTHERWISE IDENTIFIED ABOVE AND ON ANY ADDITIONAL SHEETS SUBJECT TO THE TERMS AND CONDITIONS SPECIFIED HEREIN.		<input type="checkbox"/> 29. AWARD OF CONTRACT: REF. _____ OFFER DATED _____. YOUR OFFER ON SOLICITATION (BLOCK 5), INCLUDING ANY ADDITIONS OR CHANGES WHICH ARE SET FORTH HEREIN, IS ACCEPTED AS TO ITEMS:	
30A. SIGNATURE OF OFFEROR/CONTRACTOR		31a. UNITED STATES OF AMERICA (SIGNATURE OF CONTRACTING OFFICER)	
30b. NAME AND TITLE OF SIGNER (Type or Print)	30c. DATE SIGNED	31b. NAME OF CONTRACTING OFFICER (Type or Print)  Contracting Officer	31c. DATE SIGNED

AUTHORIZED FOR LOCAL  
REPRODUCTION  
PREVIOUS EDITION IS NOT  
USABLE

COMPUTER-GENERATED

**STANDARD FORM 1449**

(REV. 4/2002)

Prescribed By GSA  
- FAR (48CFR) 53.212

19. ITEM NO.	20. SCHEDULE OF SUPPLIES/SERVICES	21. QUANTI TY	22. UNI T	23. UNIT PRICE	24. AMOUNT
-----------------	--------------------------------------	---------------------	-----------------	----------------------	---------------

This Contract is Firm Fixed Price (FFP). The Contractor is required to provide the software, software license, and software maintenance services for the computer software identified below. Distribution of maintenance copies shall be accomplished by using an appropriate magnetic, electronic or printed media. Software maintenance includes periodic updates, enhancements and corrections to the software, and reasonable technical support, all of which are customarily provided by the Contractor to its customers.

The name of the software is: Word 2008  
License Type: Perpetual or Term????  
Software Manufacturer: Microsoft

**Governing Law.** Federal law and regulations, including the Federal Acquisition Regulations ("FAR"), shall govern this Contract or Order (Contract/Order). Commercial license agreements may be made a part of this Contract/Order but only if both parties expressly make them an addendum. If the commercial license agreement is not made an addendum, it shall not apply, govern, be a part of or have any effect whatsoever on this Contract/Order; this includes, but is not limited to, any agreement embedded in the computer software (clickwrap) or any agreement that is otherwise delivered with or provided to the Government with the commercial computer software or documentation (shrinkwrap), or any other license agreement otherwise referred to in any document. If a commercial license agreement is made an addendum, only those provisions addressing data rights regarding the Government's use, duplication and disclosure of data (e.g., restricted computer software) are included and made a part of this Contract/Order, and only to the extent that those provisions are not duplicative or inconsistent with Federal law, Federal regulation or the incorporated FAR clauses; those provisions in the commercial license agreement that do not address data rights regarding the Government's use, duplication and disclosure of data shall not be included or made a part of the Contract/Order. Federal law and regulation, including without limitation, the Contract Disputes Act (41 U.S.C. §601-613), the Anti-Deficiency Act (31 U.S.C. §1341 et seq.), the Competition in Contracting Act (41 U.S.C. §251, et seq), the Prompt Payment Act (31 U.S.C. §3901, et seq.) and FAR clauses 52.212-4, 52.227-14, 52.227-19 shall supersede, control and render ineffective any inconsistent, conflicting or duplicative provision in any commercial license agreement. In the event of conflict between this clause and any provision in the Contract/Order or the commercial license agreement or elsewhere, the terms of this clause shall prevail. Claims of patent or copyright infringement brought against the Government as a party shall be defended by the U.S. Department of Justice (DOJ). 28 U.S.C. § 516. At the discretion of DOJ, the Contractor may be allowed reasonable participation in the defense of the litigation. Any additional changes to the Contract/Order must be made by contract modification (Standard Form 30). Nothing

1	Microsoft Word 2008 Software License, Part No. 9891-7069. Software may be installed on four separate personal computers and be used by any VA employee or support service contractor. Licenses are perpetual. 12 months of Standard Microsoft Word Software Maintenance and Technical Support Services for the software being acquired under CLIN 1; Part No. 9891-7069.	4	EA	\$10,000.00	\$40,000.00
2		4	EA	\$2,500.00	\$10,000.00
	Total				\$50,000.00

32a. QUANTITY IN COLUMN 21 HAS BEEN  
☐ RECEIVED ☐ INSPECTED ☐ ACCEPTED, AND CONFORMS TO THE CONTRACT,  
EXCEPT AS NOTED:

32b. SIGNATURE OF AUTHORIZED GOVT. REPRESENTATIVE	32c. DATE	32d. PRINTED NAME AND TITLE OF AUTHORIZED GOVERNMENT REPRESENTATIVE
32e. MAILING ADDRESS OF AUTHORIZED GOVERNMENT REPRESENTATIVE		32f. TELEPHONE NO. OF AUTHORIZED GOVERNMENT REPRESENTATIVE
		32g. E-MAIL OF AUTHORIZED GOVERNMENT REPRESENTATIVE

33. SHIP NUMBER	34. VOUCHER NUMBER	35. AMOUNT VERIFIED CORRECT FOR	36. PAYMENT <input type="checkbox"/> COMPLETE <input type="checkbox"/> PARTIAL <input type="checkbox"/> FINAL	37. CHECK NUMBER
-----------------	--------------------	---------------------------------	--	------------------

☐ PARTIAL  
☐ FINAL

38. S/R ACCOUNT NUMBER	39. S/R VOUCHER NUMBER	40. PAID BY
41a. I CERTIFY THIS ACCOUNT IS CORRECT AND PROPER FOR PAYMENT		42a. RECEIVED BY (Print)
41b. SIGNATURE AND TITLE OF CERTIFYING OFFICER		42b. RECEIVED AT (Location)
		42c. DATE REC'D (YY/MM/DD)
		42d. TOTAL CONTAINERS

**ADDENDUM A -ADDITIONAL TERMS AND CONDITIONS FOR CONTRACT # \_\_\_\_\_ OR  
ORDER# \_\_\_\_\_**

**A.1 Federal Acquisition Regulation (FAR) Incorporated by Reference.** The Contractor agrees to comply with the following FAR clauses, which the Contracting Officer has indicated as being incorporated in this Contract/Order by reference, to implement provisions of law or executive orders applicable to acquisitions of this nature, to implement department policy or to clarify the Government's requirement. Copies of clauses in full text will be provided on request. FAR Clauses can be viewed at <http://www.arinet.gov/far/>.

- 1) FAR 52.212-4, Contract Terms and Conditions-Commercial Items (Oct 2003)
- 2) FAR 52.227-14, Rights in Data-General (Dec 2007), Alt III
- 3) FAR 52.227-16, Additional Data Requirements (Jun 1987)
- 4) FAR 52.227-19, Commercial Computer Software License (Dec 2007)

**A.2 Contracting Officer's Authority.** The Contracting Officer is the only person authorized to make or approve any changes in any of the requirements of this Contract, and notwithstanding any provisions contained elsewhere in this Contract/Order, the said authority remains solely within the Contracting Officer. In the event the Contractor makes any changes at the direction of any person other than the Contracting Officer, the changes will be considered to have been made without authority and no adjustment will be made in the contract price to cover any increase in costs incurred as a result thereof.

**A.3 VAAR 852.270-1 Representatives of Contracting Officers (APR 1984).** The Contracting Officer reserves the right to designate representatives to act for him/her in furnishing technical guidance and advice or generally supervise the work to be performed under this Contract/Order. Such designation will be in writing and will define the scope and limitations of the designee's authority. A copy of the designation shall be furnished the Contractor.

**A.4 VAAR 852.270-4 Commercial Advertising (NOV 1984).** The Contractor will not advertise the award of this Contract/Order in his/her commercial advertising in such a manner as to state or imply that the Department of Veterans Affairs endorses a product, project or commercial line of endeavor.

**A.5 VAAR 852.237-70 Contractor Responsibilities (APR 1984)** The Contractor shall obtain all necessary licenses and/or permits required to perform this work. He/she shall take all reasonable precautions necessary to protect persons and property from injury or damage during the performance of the Contract/Order. He/she shall be responsible for any injury to himself/herself, his/her employees, as well as for any damage to personal or public property that occurs during the performance of the Contract/Order that is caused by his/her employees fault or negligence, and shall maintain personal liability and property damage insurance having coverage for a limit as required by the laws of the state where services are performed. Further, it is agreed that any negligence of the Government, its officers, agents, servants and employees, shall not be the responsibility of the Contractor hereunder with the regard to any claims, loss, damage, injury, and liability resulting there from.

**A.6 Indemnification.** The Contractor shall save and hold harmless and indemnify the Government against any and all liability claims, and cost of whatsoever kind and nature for injury to or death of any person or persons and for loss or damage to any Contractor property or property owned by a third party occurring in connection with or in any way incident to or arising out of the occupancy, use service, operation, or performance of work under the terms of the Contract/Order, resulting in whole or in part from the acts or omissions of the Contractor, any subcontractor, or any employee, agent, or representative of the Contractor or subcontractor.

**A.7 Government's Liability.** The Government shall not be liable for any injury to the Contractor's personnel or damage to the Contractor's property unless such injury or damage is due to negligence on the part of the Government and is recoverable under the Federal Torts Claims Act, or pursuant to other Federal statutory authority.

**A.10 Uniform Computer Information Transaction Act (UCITA).** UCITA is not applicable to the Contract/Order.

**A.11 Software License and Software Maintenance Subscription and Technical Support.**

(1) Definitions.

- (a) Licensee. The term "licensee" shall mean the U.S. Department of Veterans Affairs ("VA") and is synonymous with "Government."
- (b) Licensor. The term "licensor" shall mean the software manufacturer of the computer software being acquired. The term "Contractor" is the company identified in Block 17a on the SF1449. If the Contractor is a reseller and not the Licensor, the Contractor remains responsible for performance under this Contract.
- (c) Software. The term "software" shall mean the licensed computer software product(s) cited in the Schedule of Supplies (Page 2).
- (d) Maintenance. The term "maintenance" is the process of enhancing and optimizing software, as well as remedying defects. It shall include all new fixes, patches, releases, updates, versions and upgrades, as further defined below.
- (e) Technical Support. The term "technical support" refers to the range of services providing assistance for the software via the telephone, email, a website or otherwise.
- (f) Release or Update. The term "release" or "update" are terms that refer to a revision of software that contains defect corrections, minor enhancements or improvements of the software's functionality. This is usually designated by a change in the number to the right of the decimal point (e.g., from Version 5.3 to 5.4). An example of an update is the addition of new hardware.
- (g) Version or Upgrade. The term "version" or "upgrade" are terms that refer to a revision of software that contains new or improved functionality. This is usually designated by a change in the number to the left of the decimal point (e.g., from Version 5.4 to 6).

(2) License. Grant of License and Term.



- (a) See also Addendum B.
- (b) Unless otherwise stated in the Schedule of Supplies/Services, the software license provided to the Government is a perpetual, nonexclusive license to use the software.
- (c) The license authorizes the Government to use the software in processing data for other federal agencies.
- (d) If the licensed software requires a password (or license key) to be operational, it shall be delivered with the software media and have no expiration date.
- (e) If the Government decides to outsource or contract its services, the Government may allow the outsourcer to use the licensed software solely to provide the services on its behalf. The outsourcer shall be bound by the provisions of this Contract relating to the use of the software.
- (f) If the software is for use in a networked environment, as may be reflected by the number of servers or users described in the Contract/Order, the license grant provided by the Contractor includes the Government's use of the software in such environment.
- (g) Any dispute regarding the license grant or usage limitations shall be resolved in accordance with the Disputes Clause incorporated in FAR 52.212-4(d).
- (h) If the Government purchases additional licenses, the terms and conditions for those additional licenses (including technical support and upgrade subscription) shall be the same as agreed to in this Contract/Order, unless negotiated otherwise by mutual agreement of the parties.
- (i) The licensed software contains critical product functionality that meets the minimum needs of the Government and is the basis for the Government's procurement of the software; consequently, the Contractor agrees that the Government has the right to successor products at no additional cost when functionality is later unbundled from the product licensed herein and bundled into a new or different product, provided the Government is current on maintenance.
- (j) If the Contractor is a reseller for the computer software being acquired under this Contract/Order, it is permissible for the actual software manufacturer (Licensor) to deliver the software directly to the Government.
- (k) All limitations of software usage are expressly stated in the SF 1449 and Addendum A and Addendum B.

(3) Software Maintenance Subscription and Technical Support.

- (a) See also Addendum B.
- (b) Software maintenance and technical support are included at the agreed upon price. However, if additional charges are assessed during the maintenance and technical support period as a result of negotiated changes in the license (e.g., CPU upgrades), the fee shall be by mutual agreement of the parties and any dispute thereof shall be resolved in accordance with the Disputes Clause incorporated herein at FAR 52.212-4(g).
- (c) If the Government desires to continue software maintenance and support beyond the period identified in this Contract/Order, the Government will issue a separate contract or order to renew

annual maintenance and technical support. Conversely, if an order or contract to renew software maintenance and technical support is not received, no assumption by the Contractor shall be made that it has been renewed. It shall not be automatically renewed.

- (d) Unless otherwise agreed, for any new additional software that may be licensed, the Contractor shall provide for software maintenance and technical support for the first year of the license at no additional cost.
- (e) Unless otherwise agreed, the Contractor shall provide VA with software maintenance, which includes periodic updates, upgrades, enhancements and corrections to the software, and reasonable technical support, all of which are customarily provided by the Contractor to its customers so as to cause the software to perform according to its specifications, documentation or demonstrated claims.
- (f) Any telephone support provided by Contractor shall be at no additional cost.
- (g) All technical support services will be provided in a timely manner in accordance with the Contractor's customary practice. However, prolonged delay in resolving software problems will be noted in the Government's various past performance records on the Contractor (e.g., [www.ppirs.gov](http://www.ppirs.gov)).
- (h) If the Government allows the maintenance and/or technical support to lapse and subsequently wishes to reinstate maintenance and technical support, any reinstatement fee charged shall not exceed the amounts that would have been charged if the Government had not allowed it to lapse.

**A.12 Disabling Software Code.** The Government requires delivery of computer software that does not contain any code that will, upon the occurrence or the nonoccurrence of any event, disable the software. Such code includes but is not limited to a computer virus, restrictive key, node lock, time-out or other function, whether implemented by electronic, mechanical, or other means, which limits or hinders the use or access to any computer software based on residency on a specific hardware configuration, frequency of duration of use, or other limiting criteria. If any such code is present, the Contractor agrees to indemnify the Government for all damages suffered as a result of a disabling caused by such code, and the Contractor agrees to remove such code upon the Government's request at no extra cost to the Government. Inability of the Contractor to remove the disabling software code will be considered an inexcusable delay and a material breach of contract, and the Government may exercise its right to terminate for cause. In addition, the Government is permitted to remove the code as it deems appropriate and charge the Contractor for consideration for the time and effort in removing the code.

**A.13 Disaster Recovery Clause.** Government hereby certifies to Contractor that it has a bona fide disaster plan with respect to the computer software programs used in its operations. The Contract/Order authorizes the Government's operation to maintain a second copy of software on tape for use at loading at sites that are not live (e.g. subscription-based disaster recovery services) for the sole purpose of duplicating or mirroring the software environment of the "primary" licenses at the designated licensed site and as described herein. Additionally, use of the software at the

contingency sites must not include general access or any processing for program development or production. Contractor shall permit operation and testing of all licensed programs at the contingency sites as designated by the Government without prior approval and at no additional cost to the Government solely for the purpose of maintaining or implementing disaster recovery readiness including continuity of business operations. CPU's, MIPS or MSU's at these contingency sites are excluded from the total CPU's, MIPS or MSU's count included elsewhere in the Contract/Order and are not separately billable. Activation of operations at a contingency site shall be at Government's discretion. Government is authorized to install all software at the contingency sites for testing, problem resolution purposes, and to ensure there will be no operational delays in association with transition of workload from the designated licensed site to the contingency sites. Use of the software at the contingency sites in the event of a disaster shall continue until such time as normal processing can be resumed at the "primary" site regardless of the duration required. Nothing in the Contract/Order diminishes the Government's rights in accordance with the data rights clause(s). Any license keys, codes, or passwords required by the Contractor in order to use the software at the contingency sites shall be provided to the Government within 10 days of the Government's request.

**A.14 NOTICE OF THE FEDERAL ACCESSIBILITY LAW AFFECTING ALL ELECTRONIC AND INFORMATION TECHNOLOGY PROCUREMENTS (SECTION 508)**

On August 7, 1998, Section 508 of the Rehabilitation Act of 1973 was amended to require that when Federal departments or agencies develop, procure, maintain, or use Electronic and Information Technology, that they shall ensure it allows Federal employees with disabilities to have access to and use of information and data that is comparable to the access to and use of information and data by other Federal employees.

Section 508 required the Architectural and Transportation Barriers Compliance Board (Access Board) to publish standards setting forth a definition of electronic and information technology and the technical and functional criteria for such technology to comply with Section 508. These standards have been developed and published with an effective date of December 21, 2000. Federal departments and agencies must develop all Electronic and Information Technology requirements to comply with the standards found in 36 CFR 1194 .\_\_\_\_\_\*\_\_\_\_ in performing this contract. **(Fill in Section Number and Title)**

**ADDENDUM B - STATEMENT OF WORK FOR CONTRACT # \_\_\_\_\_ or  
ORDER# \_\_\_\_\_**

**B.1 License.** BROADLY DESCRIBE COMPUTING ENVIRONMENT AND HOW VA INTENDS TO USE THE SOFTWARE, HOW ITS LICENSED, WHAT THE SOFTWARE IS EXPECTED TO DO, ETC. TO GET YOU STARTED: The Department of Veterans Affairs (VA) has a need for the computer software identified on the Schedule of Supplies/Services (page 2) (software media and license) and software support services. The software will be installed **onto multiple servers** at the ITAC in Austin Texas for support/training/staging of the \_\_\_\_\_ Project. These are processor-based licenses that allow for unlimited users utilizing the processor(s). Contractor shall grant the Government the necessary license to accommodate this need. VA may move the software to any other location or hardware at any time.

**B.2 Maintenance.** The Contractor will provide software maintenance services, which includes periodic updates, enhancements and corrections to the software, and reasonable technical support, all of which are customarily provided by the Contractor to its customers so as to cause the software to perform according to its specifications, documentation or demonstrated claims. Add detailed, specific maintenance and support information here. The Contractor will distribute maintenance updates or releases by using an appropriate magnetic, electronic, or printed media to the address in Block 15 of page one, but to the attention of Joe Smith. Alternatively, the Contractor may offer access to maintenance copies through its website. All maintenance services will be provided in a timely manner in accordance with the Contractor's customary practice. However, prolonged delay in resolving software problems will be noted in the Government's various past performance records on the Contractor (e.g., [www.ppirs.gov](http://www.ppirs.gov)).

## Department of Veterans Affairs

# Memorandum

**Date:** (Current Date)

**From:** Department of Veterans Affairs  
Office of Telecommunications (005OP)  
Spectrum Management (005OP2H3 – Room 047))  
Telecommunications Voice Engineering (005OP2H2)  
810 Vermont Avenue, NW  
Washington, DC 20420

**Subj:** Memorandum of Understanding (MOU) for Non - VA Licensed Wireless Operations

**To:** Facility Director (00)  
(Address)  
(Address)

1. The following circumstances are the minimum necessary for conditional use of Wireless Equipment / System (s) in VA Owned or Leased Facilities (here-in after referred to as 'the Facility'). VA Headquarters OI&T's (005) Spectrum Management (005OP2H3), Telecommunications Voice Engineering, Special Communications (TVE - 005OP2H2) and Office of Cyber Security (OCIS – 0050P2) are the responsible entities insuring conformity of each requirement:
  - a. Each item of equipment or system whose Radio Frequency (RF) equipment is listed under Consolidated Federal Regulations (CFR), Title 47 – Federal Communications Commission (FCC), Part 15, Chapter 7, Use of Non Licensed Devices must be installed and operated in a manner consistent with Part 15's "Safety of Life" restrictions. This information is re-emphasized in CFR, Title 15 – Department of Commerce, Under the Information Technology Management Reform Act (Public Law 104-106), National Telecommunications Information Administration (NTIA) Manual of Regulations and Procedures for Federal Radio Frequency Management (aka 'The Red Book').
  - b. FCC Part 15 listed RF devices ***shall not*** be Installed or used in areas where "Safety of Life" functions / operations are accomplished or where a 'Code Blue' enunciation may occur. A list of the minimum areas affected by this statement is provided as Attachment One.
  - c. If external or internal interference is detected and cannot be corrected, ***the FCC Part 15 Listed RF Equipment affected must be turned off until corrections and/or substitutions can be made.*** Contact VA's Office of Spectrum Management (OSM – 005OP2H3), 202 461-5301 for specific conditional approval(s) concerning this issue.

### B3. Risk Assessment

Department of  
Veterans Affairs

#### Memorandum

**Date:** (current date)

**From:** Director (XXXXXX)  
Address  
Address  
Address

**Subj:** VA Headquarters (VACO) Memorandum of Understanding (MOU) for Federal Communications Commission (FCC) Part 15 Listed "Non-Regulated Equipment Wireless Operations"

**To:** Department of Veterans Affairs  
Office of Telecommunications (0050P)  
Spectrum Management (0050P2H3)  
Telecommunications Voice Engineering (0050P2H2)  
1335 East West Highway, 3<sup>rd</sup> Floor  
Silver Spring, Maryland 20420

1. We have received the subject VACO MOU (signed copy attached), and are pleased to provide the following information and comments for your review that includes our risks and risk-mitigation factors that prompted our Facility's decision:

a. RISK ASSESSMENT AND MITIGATION:

(1) Background:

(a) (name) VAMC (here-in-after referred to as "the Facility") has used (OEM Mdl Nr©) for over 10 years to allow nurses in the telemetry studio to communicate with nurses at the patients' bedside. This communication medium is a vital patient safety tool that allows for rapid response to the development of a potentially fatal arrhythmia such as ventricular tachycardia. The only information the telemetry technician states on the phone is "bed 109-2 Smith has an alarm for XXXXX." Last four is never communicated. In terms of the pager we have limited the information on the pager to sector, bed number and last name. We must include the last name as occasionally the patients are moved without the knowledge of the telemetry technician, if we were to have a patient mix up the page must contain the last name for safety reasons. Facility Management Services (FMS) has restricted paging access to the telemetry system only. Because pager access is restricted, only an administrator from Technology and Information Management (TIM) or FMS can troubleshoot a pager malfunction.

VAMC (City), (State - ZIP Code), Unregulated FCC Equipment Use, Risk Assessment and Mitigation, Page Two

(b) Because the phones are used 24X7 and have exceeded their life expectancy, many of them have begun to fail which creates a need to purchase newer models that will continue to insure system integrity.

(c) Our Facility has been prevented from purchasing replacement phones because VACO now has updated security and Information Technology (IT) connection controls along with continuing FCC Part 15 restrictions (described in the attached MOU) on devices of which these wireless phones are but one example. These updated security and connection controls are in place to address risks related life safety, information security, personal privacy and IT system integrity. The FCC restrictions continue to warn against the use of "non-regulated radio / wireless based equipment in safety of life locations and functions." Of note, these controls are intended to prevent use of these devices in areas especially where a code-blue announcement might occur, yet our devices have been used in such areas for over 10 years and so far has not prevented a code-blue announcement from happening.

(d) Because the Facility does not have a near-term alternative to the current wireless phones, it now faces a set of competing risks. On the one hand are the risks of privacy, connection and interference or security breach(s) that are behind the controls in place for these devices. On the other hand are risks to patient safety if the current phones were to fail and telemetry nurses would lose the ability to rapidly communicate with nurses at the bedside. Our Facility does have a Life Safety approved Nurses Call / Code Blue hardwired system that is installed in those affected areas as the primary Code Blue Enunciation media.

## (2) SECURITY:

(a) NEC provides a proprietary scrambling algorithm that is applied to handset registration / authentication and all communications. Every time a (OEM Mdl Nr©) user enters a designated area within the systems' coverage; an automatic user authentication process is performed to confirm the device is authorized for service on the system. This information is scrambled using a proprietary coding scheme to prevent duplication. All voice conversations are also scrambled to enhance security.

(b) The (OEM Mdl Nr©) has several built in security features in each of the wireless handsets are administered through the Facility's Telephone Private Branch Exchange (PBX) administration tool; therefore, the PBX Administrator has full control over the (OEM Mdl Nr©) wireless phones, if one gets lost or stolen it can be disabled immediately. Because of this feature you cannot purchase a similar wireless phone and have it work on our network. These phones have a 50 ft radius from the Zone radio frequency (RF) transceiver;

they can only be used within the hospital as there is no handoff via other cellular networks.

(c) These items are not NIST FIPS compliant; but based on the aforementioned facts, we feel patient / staff privacy and HIPAA instructions have been and will continue to be met.

(d) Our Facility will work with (OEM) and VACO's Office of Cyber Security (Name and Phone Nr) to secure the appropriate NIST FIPS certifications will allow VA to issue a Official Approvals from the onset in the IT equipment / system procurement process.

VAMC (City), (State - ZIP Code), Unregulated FCC Equipment Use, Risk Assessment and Mitigation, Page Three

(3) RADIO FREQUENCY (RF) INTERFERENCE:

(a) (OEM) engineers provided us with extensive information on the potential for RF along with electromagnetic (EM) interference to medical equipment within our Facility from the (OEM System) Wireless radio transceivers.

1) Field Experience: Since introduction of the (OEM System) Wireless product in 1996, NEC has installed this system at many health care institutions across the spectrum of medical departments. In all this time there have been zero reports of either suspected or actual RF and EM interference. This includes the experience using these devices at Portland VAMC and our continued testing documentation is available for review if requested.

2) Potential interference called Near Field Coupling: In these cases, an EM field emanating from one device may cause another device within its field area to malfunction. Typically the distances for these fields are less than six (6) inches. In attempts to mitigate these sources of interference, standards have been put in place, namely IEC 60601. This standard calls for devices susceptible to interference to provide shielding against fields of up to three (3) Volts per Meter. In contrast, the (OEM System) wireless products are classified under the FCC Part 15 rules as Class B unlicensed devices, and as such must meet very tight restrictions regarding field emissions of a maximum of from 100 to 500 micro ( $\mu$ ) Volts per Meter across the band of RFs from 30 Hz to 18 GHz. Thus, any medical device even marginally meeting the IEC Standard has not had problems with any near field emissions.

3) Potential phenomenon known as Far Field Induced RFI: should be considered when studying RF and EM interference sources. In this case, a part of the device subject to interference (e.g., a wire, probe, or the casing itself) can inadvertently act as a receiving antenna for a signal transmitted from another device within close proximity (within 6 to 18 inches, depending on the source power levels). To realize this type of interference, the source transmitter power must be fairly strong to conduct through the inefficient nature of the unintended antenna of the receiving device, and the material



acting as the antenna must be of a shape and length that matches or is a near multiple of the wavelength of the transmitted RF signal. Finally, this unintentional antenna must not have the typical shielding between it and the subject device's electronics, which if present would prevent such a received signal from causing interference. In the case of the (OEM System) Wireless transmission, which operates between 1,920 MHz and 1,930 MHz, a probe or such piece of any medical device measuring at about six (6) inches would match the wavelength of the RF carrier, and if not properly shielded from the units electronics may indeed conduct the RF energy within. However, even in this case, one must consider the power level at the so-called antenna receiving the signal. The average output of the (OEM Mdl Nr©) handset is approximately 10 mili (m) Watts when in use. This very low power, even further reduced by the distance between any handset in use and the subject receiving equipment, considered along with the high loss of the "antenna", results in a very low probability of actual interference. These facts, along with the standard procedures of your engineering department's efforts to check the medical equipment for such shielding and filtering defects, should mitigate this potential source.

4) Potential interference between intentional radiators operating in the RF band. Known as either in-band or out-of-band interference, these are cases where a transmitter broadcasts a signal of significant power at the other device's receiver to either overload the receiving radio or mix with the subject's transmitted signal to cause an interfered signal to be received. In-band interference  
VAMC (City), (State - ZIP Code), Unregulated FCC Equipment Use, Risk Assessment and Mitigation, Page Four

in the Unlicensed PCS band of which the (OEM System) Wireless system operates is prevented by the FCC rules requiring our equipment to monitor the carrier on which a device intends to transmit on before doing so, so as to sense any current use by another device. If such a signal is received during monitoring, we move to another carrier and try again. This protocol has been demonstrated many times within the FCC labs as well as at many industry trade shows where 5 or more vendors with U-PCS devices have operated in booths close to each other without interference. As for out-of-band interference, because of the extremely low power our devices operate with and the very strict out-of-band emission requirements placed upon the U-PCS devices, and the additional factor of a wide separation in the operating frequencies of our system and the typical radio telemetry equipment used in many hospital environments, such interference is very remote and would require extremely close proximity of the two devices.

5) All of our (OEM Mdl Nr©) are FCC listed and has not interfered with other traffic within the same band. We expect the FCC listed (OEM Mdl Nr©) equipment will perform in the same manner.

(b) Our Facility will work with (OEM) and VACO's Spectrum Management (0050P2H3) to find a RF band that can be utilized for this operation that will allow VA to issue a formal and Official Radio Use Permit that will negate the "unregulated equipment use" issues.

(4) CONNECTION TO IT/CABLE NETWORKS:

(a) Each item or system that attaches to a VA IT Network (telephone or data) must be Department of Commerce's National Recognized Testing Laboratory (NRTL) Underwriters Laboratory (UL) 60950-1/2; Information Technology Equipment - Safety listed and bears UL's mark.

1) Paragraph 1.1.1; Equipment Covered by this Standard specifically identifies these systems / networks as one affected system.

2) Paragraph 1.1.2; Additional Requirements further identifies this requirement for electromedical applications with physical connections to the patient be met.

(b) This requirement is paramount since the Facility's Telephone PABX and associated system is listed by the National Fire Protection Association as Critical Service. Additionally, since it carries our Code Blue Radio and Overhead Audio Paging Signals, VA elevates it to Life Safety Service.

(c) Presently the (OEM Mdl Nr©) wireless phones are UL Listed but does not have the aforementioned specific UL certification. Our Facility is working with (The OEM) in this arena to have them meet or exceed this UL requirement. In the meantime we will abide within the confines outlined in the attached MOU for insuring an approved IT Network / System connection is maintained until the appropriate UL certification has been obtained allowing it to be directly connected to our telephone system.

b. The Facility Director after careful review of the attached MOU and consultation with the Facility's CIO, (OEM) engineers, Biomedical and NFPA Engineers, ISO, HIPAA / Privacy Officer, Clinical Staff and JACHAO Officials has decided this risk-benefit analysis strongly favors purchasing replacement (OEM Mdl Nr) phones.

VAMC (City), (State - ZIP Code), Unregulated FCC Equipment Use, Risk Assessment and Mitigation, Page Four

2. Please feel free to contact me concerning the contents of this document.

DIRECTOR's NAME IN CAPS

cc: Office of General Consul  
Office of Telecommunications (05)  
VA Enterprise Infrastructure Engineering  
Telecommunications Engineering and Design  
Office of Cyber Security

Attachment: VACO MOU

- - - E N D - - -

**SECTION 28 05 00**

**COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This Section, Common Work Results for Electronic Safety and Security (ESS), applies to all sections of Division 28.
- B. Furnish and install fully functional electronic safety and security cabling system(s), equipment and approved accessories in accordance with the specification section(s), drawing(s), and referenced publications. Capacities and ratings of cable and other items and arrangements for the specified items are shown on each system's required Bill of Materials (BOM) and verified on the approved system drawing(s). If there is a conflict between contract's specification(s) and drawings(s), the contract's specification requirements shall prevail.
- C. The Contractor shall provide a fully functional and operating ESS, programmed, configured, documented, and tested as required herein and the respective Safety and Security System Specification(s). The Contractor shall provide calculations and analysis to support design and engineering decisions as specified in submittals. The Contractor shall provide and pay all labor, materials, and equipment, sales and gross receipts and other taxes. The Contractor shall secure and pay for plan check fees, permits, other fees, and licenses necessary for the execution of work as applicable for the project. Give required notices; the Contractor will comply with codes, ordinances, regulations, and other legal requirements of public authorities, which bear on the performance of work.
- D. The Contractor shall provide an ESS, installed, programmed, configured, documented, and tested. The security system shall include but not limited to: physical access control, video surveillance, fire alarm interface, equipment cabinetry, and uninterruptible power supplies (UPS) interface. Operator training shall not be required as part of the Security Contractors scope and shall be provided by the Owner. The Security Contractor shall still be required to provide necessary maintenance and troubleshooting manuals as well as submittals as identified herein. The work shall include the procurement and installation of electrical wire and cables, the installation and testing of all system components. Inspection, testing, demonstration, and acceptance of equipment, software, materials, installation, documentation, and workmanship, shall be as specified herein. The

Contractor shall provide all associated installation support, including the provision of primary electrical input power circuits.

- E. Repair Service Replacement Parts On-site service during the warranty period shall be provided as specified under "Emergency Service". The Contractor shall guarantee all parts and labor for a term of one (1) year, unless dictated otherwise in this specification from the acceptance date of the system as described in Part 5 of this Specification. The Contractor shall be responsible for all equipment, software, shipping, transportation charges, and expenses associated with the service of the system for one (1) year. The Contractor shall provide 24-hour telephone support for the software program at no additional charge to the owner. Software support shall include all software updates that occur during the warranty period.
- F. Section Includes:
1. Description of Work for Electronic Security Systems,
  2. Electronic security equipment coordination with relating Divisions,
  3. Submittal Requirements for Electronic Security,
  4. Miscellaneous Supporting equipment and materials for Electronic Security,
  5. Electronic security installation requirements.

## **1.2 RELATED WORK**

- A. Section 01 00 00 - GENERAL REQUIREMENTS. For General Requirements.
- B. Section 07 84 00 - FIRESTOPPING. Requirements for firestopping application and use.
- C. Section 26 05 11 - REQUIREMENTS FOR ELECTRICAL INSTALLATIONS. Requirements for connection of high voltage.
- D. Section 26 05 21 - LOW VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW). Requirements for power cables.
- E. Section 26 05 33 - RACEWAY AND BOXES FOR ELECTRICAL SYSTEMS. Requirements for infrastructure.
- F. Section 28 05 13 - CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for conductors and cables.
- G. Section 28 05 26 - GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY. Requirements for grounding of equipment.
- H. Section 28 05 28.33 - CONDUITS AND BOXES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for infrastructure.
- I. Section 28 08 00 - COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS. Requirements for Commissioning.
- J. Section 28 13 00 - PHYSICAL ACCESS CONTROL SYSTEMS (PACS). For physical access control integration.

K. Section 28 23 00 - VIDEO SURVEILLANCE. Requirements for security camera systems.

### **1.3 DEFINITIONS**

- A. AGC: Automatic Gain Control.
- B. Basket Cable Tray: A fabricated structure consisting of wire mesh bottom and side rails.
- C. BICSI: Building Industry Consulting Service International.
- D. CCD: Charge-coupled device.
- E. Central Station: A PC with software designated as the main controlling PC of the security access system. Where this term is presented with initial capital letters, this definition applies.
- F. Channel Cable Tray: A fabricated structure consisting of a one-piece, ventilated-bottom or solid-bottom channel section.
- G. Controller: An intelligent peripheral control unit that uses a computer for controlling its operation. Where this term is presented with an initial capital letter, this definition applies.
- H. CPU: Central processing unit.
- I. Credential: Data assigned to an entity and used to identify that entity.
- J. DGP: Data Gathering Panel - component of the Physical Access Control System capable to communicate, store and process information received from readers, reader modules, input modules, output modules, and Security Management System.
- K. DTS: Digital Termination Service: A microwave-based, line-of-sight communications provided directly to the end user.
- L. EMI: Electromagnetic interference.
- M. EMT: Electric Metallic Tubing.
- N. ESS: Electronic Security System.
- O. File Server: A PC in a network that stores the programs and data files shared by users.
- P. GFI: Ground fault interrupter.
- Q. IDC: Insulation displacement connector.
- R. Identifier: A credential card, keypad personal identification number or code, biometric characteristic, or other unique identification entered as data into the entry-control database for the purpose of identifying an individual. Where this term is presented with an initial capital letter, this definition applies.
- S. I/O: Input/Output.
- T. Intrusion Zone: A space or area for which an intrusion must be detected and uniquely identified, the sensor or group of sensors assigned to

perform the detection, and any interface equipment between sensors and communication link to central-station control unit.

- U. Ladder Cable Tray: A fabricated structure consisting of two longitudinal side rails connected by individual transverse members (rungs).
- V. LAN: Local area network.
- W. LCD: Liquid-crystal display.
- X. LED: Light-emitting diode.
- Y. Location: A Location on the network having a PC-to-Controller communications link, with additional Controllers at the Location connected to the PC-to-Controller link with RS-485 communications loop. Where this term is presented with an initial capital letter, this definition applies.
- Z. Low Voltage: As defined in NFPA 70 for circuits and equipment operating at less than 50 V or for remote-control and signaling power-limited circuits.
- AA. M-JPEG: Motion - Joint Photographic Experts Group.
- BB. MPEG: Moving picture experts group.
- CC. NEC: National Electric Code
- DD. NEMA: National Electrical Manufacturers Association
- EE. NFPA: National Fire Protection Association
- FF. NTSC: National Television System Committee.
- GG. NRTL: Nationally Recognized Testing Laboratory.
- HH. Open Cabling: Passing telecommunications cabling through open space (e.g., between the studs of a wall cavity).
- II. PACS: Physical Access Control System; A system comprised of cards, readers, door controllers, servers and software to control the physical ingress and egress of people within a given space
- JJ. PC: Personal computer. This acronym applies to the Central Station, workstations, and file servers.
- KK. PCI Bus: Peripheral component interconnect; a peripheral bus providing a high-speed data path between the CPU and peripheral devices (such as monitor, disk drive, or network).
- LL. PDF: (Portable Document Format.) The file format used by the Acrobat document exchange system software from Adobe.
- MM. RCDD: Registered Communications Distribution Designer.
- NN. RFI: Radio-frequency interference.
- OO. RIGID: Rigid conduit is galvanized steel tubing, with a tubing wall that is thick enough to allow it to be threaded.

- PP. RS-232: An TIA/EIA standard for asynchronous serial data communications between terminal devices. This standard defines a 25-pin connector and certain signal characteristics for interfacing computer equipment.
- QQ. RS-485: An TIA/EIA standard for multipoint communications.
- RR. Solid-Bottom or Non-ventilated Cable Tray: A fabricated structure consisting of integral or separate longitudinal side rails, and a bottom without ventilation openings.
- SS. SMS: Security Management System - A SMS is software that incorporates multiple security subsystems (e.g., physical access control, intrusion detection, closed circuit television, intercom) into a single platform and graphical user interface.
- TT. TCP/IP: Transport control protocol/Internet protocol incorporated into Microsoft Windows.
- UU. Trough or Ventilated Cable Tray: A fabricated structure consisting of integral or separate longitudinal rails and a bottom having openings sufficient for the passage of air and using 75 percent or less of the plan area of the surface to support cables.
- VV. UPS: Uninterruptible Power Supply
- XX. UTP: Unshielded Twisted Pair
- YY. Workstation: A PC with software that is configured for specific limited security system functions.

#### **1.4 QUALITY ASSURANCE**

- A. Manufacturers Qualifications: The manufacturer shall regularly and presently produce, as one of the manufacturer's principal products, the equipment and material specified for this project, and shall have manufactured the item for at least three years.
- B. Product Qualification:
1. Manufacturer's product shall have been in satisfactory operation, on three installations of similar size and type as this project, for approximately three years.
  2. The Government reserves the right to require the Contractor to submit a list of installations where the products have been in operation before approval.
- C. Contractor Qualification:
1. The Contractor or security sub-contractor shall be a licensed security Contractor with a minimum of five (5) years experience installing and servicing systems of similar scope and complexity. The Contractor shall be an authorized regional representative of the Security Management System's (PACS) manufacturer. The Contractor shall provide four (4) current references from clients with systems of similar scope and complexity which became operational in the past

- three (3) years. At least three (3) of the references shall be utilizing the same system components, in a similar configuration as the proposed system. The references must include a current point of contact, company or agency name, address, telephone number, complete system description, date of completion, and approximate cost of the project. The owner reserves the option to visit the reference sites, with the site owner's permission and representative, to verify the quality of installation and the references' level of satisfaction with the system. The Contractor shall provide copies of system manufacturer certification for all technicians. The Contractor shall only utilize factory-trained technicians to install, program, and service the PACS. The Contractor shall only utilize factory-trained technicians to install, terminate and service controller/field panels and reader modules. The technicians shall have a minimum of five (5) continuous years of technical experience in electronic security systems. The Contractor shall have a local service facility. The facility shall be located within [60] <insert number> miles of the project site. The local facility shall include sufficient spare parts inventory to support the service requirements associated with this contract. The facility shall also include appropriate diagnostic equipment to perform diagnostic procedures. The CORs Representative (COR) reserves the option of surveying the company's facility to verify the service inventory and presence of a local service organization.
2. The Contractor shall provide proof project superintendent with BICSI Certified Commercial Installer Level 1, Level 2, or Technician to provide oversight of the project.
  3. Cable installer must have on staff a Registered Communication Distribution Designer (RCDD) certified by Building Industry Consulting Service International. The staff member shall provide consistent oversight of the project cabling throughout design, layout, installation, termination and testing.
- D. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within eight hours of receipt of notification that service is needed. Submit name and address of service organizations.

#### **1.5 GENERAL ARRANGEMENT OF CONTRACT DOCUMENTS**

- A. The Contract Documents supplement to this specification indicates approximate locations of equipment. The installation and/or locations of the equipment and devices shall be governed by the intent of the



design; specification and Contract Documents, with due regard to actual site conditions, recommendations, ambient factors affecting the equipment and operations in the vicinity. The Contract Documents are diagrammatic and do not reveal all offsets, bends, elbows, components, materials, and other specific elements that may be required for proper installation. If any departure from the contract documents is deemed necessary, or in the event of conflicts, the Contractor shall submit details of such departures or conflicts in writing to the owner or owner's representative for his or her comment and/or approval before initiating work.

- B. Anything called for by one of the Contract Documents and not called for by the others shall be of like effect as if required or called by all, except if a provision clearly designed to negate or alter a provision contained in one or more of the other Contract Documents shall have the intended effect. In the event of conflicts among the Contract Documents, the Contract Documents shall take precedence in the following order: the Form of Agreement; the Supplemental General Conditions; the Special Conditions; the Specifications with attachments; and the drawings.

#### **1.6 SUBMITTALS**

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. The Government's approval shall be obtained for all equipment and material before delivery to the job site. Delivery, storage or installation of equipment or material which has not had prior approval will not be permitted at the job site.
- C. Submittals for individual systems and equipment assemblies which consist of more than one item or component shall be made for the system or assembly as a whole. Partial submittals will not be considered for approval.
1. Mark the submittals, "SUBMITTED UNDER SECTION \_\_\_\_\_".
  2. Submittals shall be marked to show specification reference including the section and paragraph numbers.
  3. Submit each section separately.
- D. The submittals shall include the following:
1. Information that confirms compliance with contract requirements. Include the manufacturer's name, model or catalog numbers, catalog information, technical data sheets, shop drawings, pictures, nameplate data and test reports as required.
  3. Parts list which shall include those replacement parts recommended by the equipment manufacturer, quantity of parts, current price and availability of each part.

E. Submittals shall be in full compliance of the Contract Documents. All submittals shall be provided in accordance with this section.

Submittals lacking the breath or depth these requirements will be considered incomplete and rejected. Submissions are considered multidisciplinary and shall require coordination with applicable divisions to provide a complete and comprehensive submission package. All submittals shall include adequate descriptive literature, catalog cuts, shop drawings and other data necessary for the Government to ascertain that the proposed equipment and materials comply with specification requirements. Catalog cuts submitted for approval shall be legible and clearly identify equipment being submitted. Additional general provisions are as follows:

1. The Contractor shall schedule submittals in order to maintain the project schedule. For coordination drawings refer to Specification Section 01 33 10 - Design Submittal Procedures, which outline basic submittal requirements and coordination. Section 01 33 10 shall be used in conjunction with this section.
2. The Contractor shall identify variations from requirements of Contract Documents and state product and system limitations, which may be detrimental to successful performance of the completed work or system.
3. Each package shall be submitted at one (1) time for each review and include components from applicable disciplines (e.g., electrical work, architectural finishes, door hardware, etc.) which are required to produce an accurate and detailed depiction of the project.
4. Manufacturer's information used for submittal shall have pages with items for approval tagged, items on pages shall be identified, and capacities and performance parameters for review shall be clearly marked through use of an arrow or highlighting. Provide space for COR and Contractor review stamps.
5. Technical Data Drawings shall be in the latest version of AutoCAD®, drawn accurately, and in accordance with VA CAD Standards CAD Standard Application Guide, and VA BIM Guide. FREEHAND SKETCHES OR COPIED VERSIONS OF THE CONSTRUCTION DOCUMENTS WILL NOT BE ACCEPTED. The Contractor shall not reproduce Contract Documents or copy standard information as the basis of the Technical Data Drawings. If departures from the technical data drawings are subsequently deemed necessary by the Contractor, details of such departures and the reasons thereof shall be submitted in writing to the COR for approval before the initiation of work.

6. Packaging: The Contractor shall organize the submissions according to the following packaging requirements.
- a. Binders: For each manual, provide heavy duty, commercial quality, durable three (3) ring vinyl covered loose leaf binders, sized to receive 8.5 x 11 in paper, and appropriate capacity to accommodate the contents. Provide a clear plastic sleeve on the spine to hold labels describing the contents. Provide pockets in the covers to receive folded sheets.
    - 1) Where two (2) or more binders are necessary to accommodate data; correlate data in each binder into related groupings according to the Project Manual table of contents. Cross-referencing other binders where necessary to provide essential information for communication of proper operation and/or maintenance of the component or system.
    - 2) Identify each binder on the front and spine with printed binder title, Project title or name, and subject matter covered. Indicate the volume number if applicable.
  - b. Dividers: Provide heavy paper dividers with celluloid tabs for each Section. Mark each tab to indicate contents.
  - c. Protective Plastic Jackets: Provide protective transparent plastic jackets designed to enclose diagnostic software for computerized electronic equipment.
  - d. Text Material: Where written material is required as part of the manual use the manufacturer's standard printed material, or if not available, specially prepared data, neatly typewritten on 8.5 inches by 11 inches 20 pound white bond paper.
  - e. Drawings: Where drawings and/or diagrams are required as part of the manual, provide reinforced punched binder tabs on the drawings and bind them with the text.
    - 1) Where oversized drawings are necessary, fold the drawings to the same size as the text pages and use as a foldout.
    - 2) If drawings are too large to be used practically as a foldout, place the drawing, neatly folded, in the front or rear pocket of the binder. Insert a type written page indicating the drawing title, description of contents and drawing location at the appropriate location of the manual.
    - 3) Drawings shall be sized to ensure details and text is of legible size. Text shall be no less than 1/16" tall.
  - f. Manual Content: Submit in accordance with Section 01 00 00, GENERAL REQUIREMENTS.

- 1) Maintenance and Operation Manuals: Submit as required for systems and equipment specified in the technical sections. Furnish four copies, bound in hardback binders, (manufacturer's standard binders) or an approved equivalent. Furnish one complete manual as specified in the technical section but in no case later than prior to performance of systems or equipment test, and furnish the remaining manuals prior to contract completion.
- 2) Inscribe the following identification on the cover: the words "MAINTENANCE AND OPERATION MANUAL," the name and location of the system, equipment, building, name of Contractor, and contract number. Include in the manual the names, addresses, and telephone numbers of each subcontractor installing the system or equipment and the local representatives for the system or equipment.
- 3) The manuals shall include:
  - a) Internal and interconnecting wiring and control diagrams with data to explain detailed operation and control of the equipment.
  - b) A control sequence describing start-up, operation, and shutdown.
  - c) Description of the function of each principal item of equipment.
  - d) Installation and maintenance instructions.
  - e) Safety precautions.
  - f) Diagrams and illustrations.
  - g) Testing methods.
  - h) Performance data.
  - i) Pictorial "exploded" parts list with part numbers. Emphasis shall be placed on the use of special tools and instruments. The list shall indicate sources of supply, recommended spare parts, and name of servicing organization.
  - j) Appendix; list qualified permanent servicing organizations for support of the equipment, including addresses and certified qualifications.
- g. Binder Organization: Organize each manual into separate sections for each piece of related equipment. At a minimum, each manual shall contain a title page, table of contents, copies of Product Data supplemented by drawings and written text, and copies of each warranty, bond, certifications, and service Contract issued. Refer

to Group I through V Technical Data Package Submittal requirements for required section content.

- h. Title Page: Provide a title page as the first sheet of each manual to include the following information; project name and address, subject matter covered by the manual, name and address of the Project, date of the submittal, name, address, and telephone number of the Contractor, and cross references to related systems in other operating and/or maintenance manuals.
- i. Table of Contents: After the title page, include a type written table of contents for each volume, arranged systematically according to the Project Manual format. Provide a list of each product included, identified by product name or other appropriate identifying symbols and indexed to the content of the volume. Where more than one (1) volume is required to hold data for a particular system, provide a comprehensive table of contents for all volumes in each volume of the set.
- j. General Information Section: Provide a general information section immediately following the table of contents, listing each product included in the manual, identified by product name. Under each product, list the name, address, and telephone number of the installer and maintenance Contractor. In addition, list a local source for replacement parts and equipment.
- k. Drawings: Provide specially prepared drawings where necessary to supplement the manufacturers printed data to illustrate the relationship between components of equipment or systems, or provide control or flow diagrams. Coordinate these drawings with information contained in Project Record Drawings to assure correct illustration of the completed installation.
- l. Manufacturer's Data: Where manufacturer's standard printed data is included in the manuals, include only those sheets that are pertinent to the part or product installed. Mark each sheet to identify each part or product included in the installation. Where more than one (1) item in tabular format is included, identify each item, using appropriate references from the Contract Documents. Identify data that is applicable to the installation and delete references to information which is not applicable.
- m. Where manufacturer's standard printed data is not available and the information is necessary for proper operation and maintenance of equipment or systems, or it is necessary to provide additional information to supplement the data included in the manual, prepare written text to provide the necessary information. Organize the

text in a consistent format under a separate heading for different procedures. Where necessary, provide a logical sequence of instruction for each operating or maintenance procedure. Where similar or more than one product is listed on the submittal the Contractor shall differentiate by highlighting the specific product to be utilized.

- n. Calculations: Provide a section for circuit and panel calculations.
  - o. Loading Sheets: Provide a section for DGP Loading Sheets.
  - p. Certifications: Provide section for Contractor's manufacturer certifications.
7. Contractor Review: Review submittals prior to transmittal. Determine and verify field measurements and field construction criteria. Verify manufacturer's catalog numbers and conformance of submittal with requirements of contract documents. Return non-conforming or incomplete submittals with requirements of the work and contract documents. Apply Contractor's stamp with signature certifying the review and verification of products occurred, and the field dimensions, adjacent construction, and coordination of information is in accordance with the requirements of the contract documents.
8. Resubmission: Revise and resubmit submittals as required within 15 calendar days of return of submittal. Make resubmissions under procedures specified for initial submittals. Identify all changes made since previous submittal.
9. Product Data: Within 15 calendar days after execution of the contract, the Contractor shall submit for approval a complete list of all of major products proposed for use. The data shall include name of manufacturer, trade name, model number, the associated contract document section number, paragraph number, and the referenced standards for each listed product.
- F. Group 1 Technical Data Package: Group I Technical Data Package shall be one submittal consisting of the following content and organization. Refer to VA Special Conditions Document for drawing format and content requirements. The data package shall include the following:
- 1. Section I - Drawings:
    - a. General - Drawings shall conform to VA CAD Standards Guide. All text associated with security details shall be 1/8" tall and meet VA text standard for AutoCAD™ drawings.
    - b. Cover Sheet - Cover sheet shall consist of Project Title and Address, Project Number, Area and Vicinity Maps.

- c. General Information Sheets - General Information Sheets shall consist of General Notes, Abbreviations, Symbols, Wire and Cable Schedule, Project Phasing, and Sheet Index.
- d. Floor Plans - Floor plans shall be produced from the Architectural backgrounds issued in the Construction Documents. The contractor shall receive floor plans from the prime A/E to develop these drawing sets. Security devices shall be placed on drawings in scale. All text associated with security details shall be 1/8" tall and meet VA text standard for AutoCAD™ drawings. Floor plans shall identify the following:
  - 1) Security devices by symbol,
  - 2) The associated device point number (derived from the loading sheets),
  - 3) Wire & cable types and counts
  - 4) Conduit sizing and routing
  - 5) Conduit riser systems
  - 6) Device and area detail call outs
- e. Architectural details - Architectural details shall be produced for each device mounting type (door details for EECS and IDS, Intrusion Detection system (motion sensor, vibration, microwave Motion Sensor and Camera mounting,
- f. Riser Diagrams - Contractor shall provide a riser diagram indicating riser architecture and distribution of the SMS throughout the facility (or area in scope).
- g. Block Diagrams - Contractor shall provide a block diagram for the entire system architecture and interconnections with SMS subsystems. Block diagram shall identify SMS subsystem (e.g., electronic entry control, intrusion detection, closed circuit television, intercom, and other associated subsystems) integration; and data transmission and media conversion methodologies.
- h. Interconnection Diagrams - Contractor shall provide interconnection diagram for each sensor, and device component. Interconnection diagram shall identify termination locations, standard wire detail to include termination schedule. Diagram shall also identify interfaces to other systems such as elevator control, fire alarm systems, and security management systems.
- i. Security Details:
  - 1) Panel Assembly Detail - For each panel assembly, a panel assembly details shall be provided identifying individual panel component size and content.

- 2) Panel Details - Provide security panel details identify general arrangement of the security system components, backboard size, wire through size and location, and power circuit requirements.
- 3) Device Mounting Details - Provide mounting detailed drawing for each security device (physical access control system, intrusion detection, video surveillance and assessment, and intercom systems) for each type of wall and ceiling configuration in project. Device details shall include device, mounting detail, wiring and conduit routing.
- 4) Details of connections to power supplies and grounding
- 5) Details of surge protection device installation
- 6) Sensor detection patterns - Each system sensor shall have associated detection patterns.
- 7) Equipment Rack Detail - For each equipment rack, provide a scaled detail of the equipment rack location and rack space utilization. Use of BISCII wire management standards shall be employed to identify wire management methodology. Transitions between equipment racks shall be shown to include use vertical and horizontal latter rack system.
- 8) Security Control Room - The contractor shall provide a layout plan for the Security Control Room. The layout plan shall identify all equipment and details associated with the installation.
- 9) Operator Console - The contractor shall provide a layout plan for the Operator Console. The layout plan shall identify all equipment and details associated with the installation.  
Equipment room - the contractor shall provide a layout plan for the equipment room. The layout plan shall identify all equipment and details associated with the installation.
- 10) Equipment Room- Equipment room details shall provide architectural, electrical, mechanical, plumbing, IT/Data and associated equipment and device placements both vertical and horizontally.
- j. Electrical Panel Schedule - Electrical Panel Details shall be provided for all SMS systems electrical power circuits. Panel details shall be provided identifying panel type (Standard, Emergency Power, Emergency/Uninterrupted Power Source, and Uninterrupted Power Source Only), panel location, circuit number, and circuit amperage rating.
- k. Door Schedule - A door schedule shall be developed for each door equipped with electronic security components. At a minimum, the



door schedule shall be coordinated with Division 08 work and include the following information:

- 1) Item Number
  - 2) Door Number (Derived from A/E Drawings)
  - 3) Floor Plan Sheet Number
  - 4) Standard Detail Number
  - 5) Door Description (Derived from Loading Sheets)
  - 6) Data Gathering Panel Input Number
  - 7) Door Position or Monitoring Device Type & Model Number
  - 8) Lock Type, Model Number & Power Input/Draw (standby/active)
  - 9) Card Reader Type & Model Number
  - 10) Shunting Device Type & Model Number
  - 11) Sounder Type & Model Number
  - 12) Manufacturer
  - 13) Misc. devices as required
    - a) Delayed Egress Type & Model Number
    - b) Intercom
    - c) Camera
    - d) Electric Transfer Hinge
    - e) Electric Pass-through device
  - 14) Remarks column indicating special notes or door configurations
2. Camera Schedule - A camera schedule shall be developed for each camera. Contractors shall coordinate with the COR to determine camera starting numbers and naming conventions. All drawings shall identify wire and cable standardization methodology. Color coding of all wiring conductors and jackets is required and shall be communicated consistently throughout the drawings package submittal.
- At a minimum, the camera schedule shall include the following information:
- a. Item Number
  - b. Camera Number
  - c. Naming Conventions
  - d. Description of Camera Coverage
  - e. Camera Location
  - f. Floor Plan Sheet Number
  - g. Camera Type
  - h. Mounting Type
  - i. Standard Detail Reference
  - j. Power Input & Draw
  - k. Power Panel Location
  - l. Remarks Column for Camera

3. Section IV - Manufacturers' Data: The data package shall include manufacturers' data for all materials and equipment, including sensors, local processors and console equipment provided under this specification.
4. Section V - System Description and Analysis: The data package shall include system descriptions, analysis, and calculations used in sizing equipment required by these specifications. Descriptions and calculations shall show how the equipment will operate as a system to meet the performance requirements of this specification. The data package shall include the following:
  - a. Central processor memory size; communication speed and protocol description; rigid disk system size and configuration; flexible disk system size and configuration; back-up media size and configuration; alarm response time calculations; command response time calculations; start-up operations; expansion capability and method of implementation; sample copy of each report specified; and color photographs representative of typical graphics.
  - b. Software Data: The data package shall consist of descriptions of the operation and capability of the system, and application software as specified.
  - c. Overall System Reliability Calculations: The data package shall include all manufacturers' reliability data and calculations required to show compliance with the specified reliability.
5. Section VI - Certifications & References: All specified manufacturer's certifications shall be included with the data package. Contractor shall provide Project references as outlined in Paragraph 1.4 "Quality Assurance".

G. Group II Technical Data Package

1. The Contractor shall prepare a report of "Current Site Conditions" and submit a report to the COR documenting changes to the site, particularly those conditions that affect performance of the system to be installed. The Contractor shall provide specification sheets, or written functional requirements to support the findings, and a cost estimate to correct those site changes or conditions which affect the installation of the system or its performance. The Contractor shall not correct any deficiency without written permission from the COR.
2. System Configuration and Functionality: The contractor shall provide the results of the meeting with VA to develop system requirements and functionality including but not limited to:
  - a. Baseline configuration

- b. Access levels
  - c. Schedules (intrusion detection, physical access control, holidays, etc.)
  - d. Badge database
  - e. System monitoring and reporting (unit level and central control)
  - f. Naming conventions and descriptors
- H. Group III Technical Data Package
- 1. Development of Test Procedures: The Contractor will prepare performance test procedures for the system testing. The test procedures shall follow the format of the VA Testing procedures and be customized to the contract requirements. The Contractor will deliver the test procedures to the COR for approval at least 60 calendar days prior to the requested test date.
- I. Group IV Technical Data Package
- 1. Performance Verification Test
    - a. Based on the successful completion of the pre-delivery test, the Contractor shall finalize the test procedures and report forms for the performance verification test (PVT) and the endurance test. The PVT shall follow the format, layout and content of the pre-delivery test. The Contractor shall deliver the PVT and endurance test procedures to the COR for approval. The Contractor may schedule the PVT after receiving written approval of the test procedures. The Contractor shall deliver the final PVT and endurance test reports within 14 calendar days from completion of the tests. Refer to Part 3 of this section for System Testing and Acceptance requirements.
  - 2. Training Documentation
    - a. New Facilities and Major Renovations: Familiarization training shall be provided for new equipment or systems. Training can include site familiarization training for VA technicians and administrative personnel. Training shall include general information on new system layout including closet locations, turnover of the completed system including all documentation, including manuals, software, key systems, and full system administration rights. Lesson plans and training manuals training shall be oriented to type of training to be provided.
    - b. New Unit Control Room:
      - 1) Provide the security personnel with training in the use, operation, and maintenance of the entire control room system (Unit Control and Equipment Rooms). The training documentation must include the operation and maintenance. The first of the

training sessions shall take place prior to system turnover and the second immediately after turnover. Coordinate the training sessions with the Owner. Completed classroom sessions will be witnessed and documented by the Architect/Engineer, and approved by the COR. Instruction is not to begin until the system is operational as designed.

- 2) The training documents will cover the operation and the maintenance manuals and the control console operators' manuals and service manuals in detail, stressing all important operational and service diagnostic information necessary for the maintenance and operations personnel to efficiently use and maintain all systems.
- 3) Provide an illustrated control console operator's manual and service manual. The operator's manual shall be written in laymen's language and printed so as to become a permanent reference document for the operators, describing all control panel switch operations, graphic symbol definitions and all indicating functions and a complete explanation of all software.
- 4) The service manual shall be written in laymen's language and printed so as to become a permanent reference document for maintenance personnel, describing how to run internal self diagnostic software programs, troubleshoot head end hardware and field devices with a complete scenario simulation of all possible system malfunctions and the appropriate corrective measures.
- 5) Provide a professional color DVD instructional recording of all the operational procedures described in the operator's manual. All charts used in the training session shall be clearly presented on the video. Any DVD found to be inferior in recording or material content shall be reproduced at no cost until an acceptable DVD is submitted. Provide four copies of the training DVD, one to the architect/engineer and three to the owner.

3. System Configuration and Data Entry:

- a. The contractor is responsible for providing all system configuration and data entry for the SMS and subsystems (e.g., video matrix switch, intercom, digital video recorders, network video recorders). All data entry shall be performed per VA standards & guidelines. The Contractor is responsible for participating in all meetings with the client to compile the

information needed for data entry. These meetings shall be established at the beginning of the project and incorporated in to the project schedule as a milestone task. The contractor shall be responsible for all data collection, data entry, and system configuration. The contractor shall collect, enter, & program and/or configure the following components:

- 1) Physical Access control system components,
- 2) All intrusion detection system components,
- 3) Video surveillance, control and recording systems,
- 4) Intercom systems components,
- 5) All other security subsystems shown in the contract documents.

- b. The Contractor is responsible for compiling the card access database for the VA employees, including programming reader configurations, access shifts, schedules, exceptions, card classes and card enrollment databases.
  - c. Refer to Part 3 for system programming requirements and planning guidelines.
4. Graphics: Based on CAD as-built drawings developed for the construction project, create all map sets showing locations of all alarms and field devices. Graphical maps of all alarm points installed under this contract including perimeter and exterior alarm points shall be delivered with the system. The Contractor shall create and install all graphics needed to make the system operational. The Contractor shall utilize data from the contract documents, Contractor's field surveys, and all other pertinent information in the Contractor's possession to complete the graphics. The Contractor shall identify and request from the COR, any additional data needed to provide a complete graphics package. Graphics shall have sufficient level of detail for the system operator to assess the alarm. The Contractor shall supply hard copy, color examples at least 203.2 x 254 mm (8 x 10 in) of each type of graphic to be used for the completed Security system. The graphics examples shall be delivered to the COR for review and approval at least 90 calendar days prior to the scheduled date the Contractor requires them.
- J. Group V Technical Data Package: Final copies of the manuals shall be delivered to the COR as part of the acceptance test. The draft copy used during site testing shall be updated with any changes required prior to final delivery of the manuals. Each manual's contents shall be identified on the cover. The manual shall include names, addresses, and telephone numbers of each sub-contractor installing equipment or

systems, as well as the nearest service representatives for each item of equipment for each system. The manuals shall include a table of contents and tab sheets. Tab sheets shall be placed at the beginning of each chapter or section and at the beginning of each appendix. The final copies delivered after completion of the endurance test shall include all modifications made during installation, checkout, and acceptance. Six (6) hard-copies and one (1) soft copy on CD of each item listed below shall be delivered as a part of final systems acceptance.

1. Functional Design Manual: The functional design manual shall identify the operational requirements for the entire system and explain the theory of operation, design philosophy, and specific functions. A description of hardware and software functions, interfaces, and requirements shall be included for all system operating modes. Manufacturer developed literature may be used; however, shall be produced to match the project requirements.
2. Equipment Manual: A manual describing all equipment furnished including:
  - a. General description and specifications; installation and checkout procedures; equipment electrical schematics and layout drawings; system schematics and layout drawings; alignment and calibration procedures; manufacturer's repair list indicating sources of supply; and interface definition.
3. Software Manual: The software manual shall describe the functions of all software and include all other information necessary to enable proper loading, testing, and operation. The manual shall include:
  - a. Definition of terms and functions; use of system and applications software; procedures for system initialization, start-up, and shutdown; alarm reports; reports generation, database format and data entry requirements; directory of all disk files; and description of all communications protocols including data formats, command characters, and a sample of each type of data transfer.
4. Operator's Manual: The operator's manual shall fully explain all procedures and instructions for the operation of the system, including:
  - a. Computers and peripherals; system start-up and shutdown procedures; use of system, command, and applications software; recovery and restart procedures; graphic alarm presentation; use of report generator and generation of reports; data entry;

operator commands' alarm messages, and printing formats; and  
system access requirements.

5. Maintenance Manual: The maintenance manual shall include descriptions of maintenance for all equipment including inspection, recommend schedules, periodic preventive maintenance, fault diagnosis, and repair or replacement of defective components.
6. Spare Parts & Components Data: At the conclusion of the Contractor's work, the Contractor shall submit to the COR a complete list of the manufacturer's recommended spare parts and components required to satisfactorily maintain and service the systems, as well as unit pricing for those parts and components.
7. Operation, Maintenance & Service Manuals: The Contractor shall provide two (2) complete sets of operating and maintenance manuals in the form of an instructional manual for use by the VA Security Guard Force personnel. The manuals shall be organized into suitable sets of manageable size. Where possible, assemble instructions for similar equipment into a single binder. If multiple volumes are required, each volume shall be fully indexed and coordinated.
8. Equipment and Systems Maintenance Manual: The Contractor shall provide the following descriptive information for each piece of equipment, operating system, and electronic system:
  - a. Equipment and/or system function.
  - b. Operating characteristics.
  - c. Limiting conditions.
  - d. Performance curves.
  - e. Engineering data and test.
  - f. Complete nomenclature and number of replacement parts.
  - g. Provide operating and maintenance instructions including assembly drawings and diagrams required for maintenance and a list of items recommended to stock as spare parts.
  - h. Provide information detailing essential maintenance procedures including the following: routine operations, trouble shooting guide, disassembly, repair and re-assembly, alignment, adjusting, and checking.
  - i. Provide information on equipment and system operating procedures, including the following; start-up procedures, routine and normal operating instructions, regulation and control procedures, instructions on stopping, shut-down and emergency instructions, required sequences for electric and electronic systems, and special operating instructions.

- j. Manufacturer equipment and systems maintenance manuals are permissible.
9. Project Redlines: During construction, the Contractor shall maintain an up-to-date set of construction redlines detailing current location and configuration of the project components. The redline documents shall be marked with the words 'Master Redlines' on the cover sheet and be maintained by the Contractor in the project office. The Contractor will provide access to redline documents anytime during the project for review and inspection by the COR or authorized Office of Protection Services representative. Master redlines shall be neatly maintained throughout the project and secured under lock and key in the contractor's onsite project office. Any project component or assembly that is not installed in strict accordance with the drawings shall be so noted on the drawings. Prior to producing Record Construction Documents, the contractor will submit the Master Redline document to the COR for review and approval of all changes or modifications to the documents. Each sheet shall have COR initials indicating authorization to produce "As Built" documents. Field drawings shall be used for data gathering & field changes. These changes shall be made to the master redline documents daily. Field drawings shall not be considered "master redlines".
10. Record Specifications: The Contractor shall maintain one (1) copy of the Project Specifications, including addenda and modifications issued, for Project Record Documents. The Contractor shall mark the Specifications to indicate the actual installation where the installation varies substantially from that indicated in the Contract Specifications and modifications issued. (Note related Project Record Drawing information where applicable). The Contractor shall pay particular attention to substitutions, selection of product options, and information on concealed installations that would be difficult to identify or measure and record later. Upon completion of the mark ups, the Contractor shall submit record Specifications to the COR. As with master relines, Contractor shall maintain record specifications for COR review and inspection at anytime.
11. Record Product Data: The Contractor shall maintain one (1) copy of each Product Data submittal for Project Record Document purposes. The Data shall be marked to indicate the actual product installed where the installation varies substantially from that indicated in the Product Data submitted. Significant changes in the product delivered to the site and changes in manufacturer's instructions and recommendations for installation shall be included. Particular



attention will be given to information on concealed products and installations that cannot be readily identified or recorded later. Note related Change Orders and mark up of Record Construction Documents, where applicable. Upon completion of mark up, submit a complete set of Record Product Data to the COR.

12. Miscellaneous Records: The Contractor shall maintain one (1) copy of miscellaneous records for Project Record Document purposes. Refer to other Specifications for miscellaneous record-keeping requirements and submittals concerning various construction activities. Before substantial completion, complete miscellaneous records and place in good order, properly identified and bound or filed, ready for use and reference. Categories of requirements resulting in miscellaneous records include a minimum of the following:
  - a. Certificates received instead of labels on bulk products.
  - b. Testing and qualification of tradesmen. ("Contractor's Qualifications")
  - c. Documented qualification of installation firms.
  - d. Load and performance testing.
  - e. Inspections and certifications.
  - f. Final inspection and correction procedures.
  - g. Project schedule
13. Record Construction Documents (Record As-Built)
  - a. Upon project completion, the contractor shall submit the project master redlines to the COR prior to development of Record construction documents. The COR shall be given a minimum of a thirty (30) day review period to determine the adequacy of the master redlines. If the master redlines are found suitable by the COR, the COR will initial and date each sheet and turn redlines over to the contractor for as built development.
  - b. The Contractor shall provide the COR a complete set of "as-built" drawings and original master redlined marked "as-built" blue-line in the latest version of AutoCAD drawings unlocked on CD or DVD. The as-built drawing shall include security device number, security closet connection location, data gathering panel number, and input or output number as applicable. All corrective notations made by the Contractor shall be legible when submitted to the COR. If, in the opinion of the COR, any redlined notation is not legible, it shall be returned to the Contractor for re-submission at no extra cost to the Owner. The Contractor shall organize the Record Drawing sheets into manageable sets bound with durable paper cover sheets with suitable titles, dates, and other

identifications printed on the cover. The submitted as built shall be in editable formats and the ownership of the drawings shall be fully relinquished to the owner.

- c. Where feasible, the individual or entity that obtained record data, whether the individual or entity is the installer, sub-contractor, or similar entity, is required to prepare the mark up on Record Drawings. Accurately record the information in a comprehensive drawing technique. Record the data when possible after it has been obtained. For concealed installations, record and check the mark up before concealment. At the time of substantial completion, submit the Record Construction Documents to the COR. The Contractor shall organize into bound and labeled sets for the COR's continued usage. Provide device, conduit, and cable lengths on the conduit drawings. Exact in-field conduit placement/routings shall be shown. All conduits shall be illustrated in their entire length from termination in security closets; no arrowed conduit runs shall be shown. Pull box and junction box sizes are to be shown if larger than 100mm (4 inch).

K. FIPS 201 Compliance Certificates

1. Provide Certificates for all software components and device types utilizing credential verification. Provide certificates for:
  - a. Fingerprint Capture Station
  - b. Card Readers
  - c. Facial Image Capturing Camera
  - d. PIV Middleware
  - e. Template Matcher
  - f. Electromagnetically Opaque Sleeve
  - g. Certificate Management
    - 1) CAK Authentication System
    - 2) PIV Authentication System
    - 3) Certificate Validator
    - 4) Cryptographic Module

L. Approvals will be based on complete submission of manuals together with shop drawings.

M. After approval and prior to installation, furnish the COR with one sample of each of the following:

1. A 300 mm (12 inch) length of each type and size of wire and cable along with the tag from the coils of reels from which the samples were taken.
2. Each type of conduit and pathway coupling, bushing and termination fitting.

3. Conduit hangers, clamps and supports.
4. Duct sealing compound.
- N. Completed System Readiness Checklists provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 28 08 00 COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS.
- O. In addition to the requirement of SUBMITTALS, the VA reserves the right to request the manufacturer to arrange for a VA representative to see typical active systems in operation, when there has been no prior experience with the manufacturer or the type of equipment being submitted.

#### **1.7 APPLICABLE PUBLICATIONS**

- A. The publications listed below (including amendments, addenda, revisions, supplement, and errata) form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standards Institute (ANSI)/ International Code Council (ICC):  
A117.1.....Standard on Accessible and Usable Buildings and Facilities
- C. American National Standards Institute (ANSI)/ Security Industry Association (SIA):  
AC-03.....Access Control: Access Control Guideline Dye Sublimation Printing Practices for PVC Access Control Cards  
CP-01-00.....Control Panel Standard-Features for False Alarm Reduction  
PIR-01-00.....Passive Infrared Motion Detector Standard - Features for Enhancing False Alarm Immunity  
TVAC-01.....CCTV to Access Control Standard - Message Set for System Integration
- D. American National Standards Institute (ANSI)/Electronic Industries Alliance (EIA):  
330-09.....Electrical Performance Standards for CCTV Cameras  
375A-76.....Electrical Performance Standards for CCTV Monitors
- E. American National Standards Institute (ANSI):  
ANSI S3.2-99.....Method for measuring the Intelligibility of Speech over Communications Systems

F. American Society for Testing and Materials (ASTM)

B1-07.....Standard Specification for Hard-Drawn Copper  
Wire

B3-07.....Standard Specification for Soft or Annealed  
Copper Wire

B8-04.....Standard Specification for Concentric-Lay-  
Stranded Copper Conductors, Hard, Medium-Hard,  
or Soft

C1238-97 (R03).....Standard Guide for Installation of Walk-Through  
Metal Detectors

D2301-04.....Standard Specification for Vinyl Chloride  
Plastic Pressure Sensitive Electrical Insulating  
Tape

G. Architectural Barriers Act (ABA), 1968

H. Department of Justice: American Disability Act (ADA)  
28 CFR Part 36-2010 ADA Standards for Accessible Design

I. Department of Veterans Affairs:  
VHA National CAD Standard Application Guide, 2006  
VA BIM Guide, V1.0 10

J. Federal Communications Commission (FCC):  
(47 CFR 15) Part 15              Limitations on the Use of Wireless  
Equipment/Systems

K. Federal Information Processing Standards (FIPS):  
FIPS-201-1.....Personal Identity Verification (PIV) of Federal  
Employees and Contractors

L. Federal Specifications (Fed. Spec.):  
A-A-59544-08.....Cable and Wire, Electrical (Power, Fixed  
Installation)

M. Government Accountability Office (GAO):  
GAO-03-8-02.....Security Responsibilities for Federally Owned  
and Leased Facilities

N. Homeland Security Presidential Directive (HSPD):  
HSPD-12.....Policy for a Common Identification Standard for  
Federal Employees and Contractors

O. Institute of Electrical and Electronics Engineers (IEEE):  
81-1983.....IEEE Guide for Measuring Earth Resistivity,  
Ground Impedance, and Earth Surface Potentials  
of a Ground System

802.3af-08.....Power over Ethernet Standard

802.3at-09 .....Power over Ethernet (PoE) Plus Standard

C2-07.....National Electrical Safety Code

C62.41-02.....IEEE Recommended Practice on Surge Voltages in  
Low-Voltage AC Power Circuits

C95.1-05.....Standards for Safety Levels with Respect to  
Human Exposure in Radio Frequency  
Electromagnetic Fields

P. International Organization for Standardization (ISO):

7810.....Identification cards - Physical characteristics

7811.....Physical Characteristics for Magnetic Stripe  
Cards

7816-1.....Identification cards - Integrated circuit(s)  
cards with contacts - Part 1: Physical  
characteristics

7816-2.....Identification cards - Integrated circuit cards  
- Part 2: Cards with contacts -Dimensions and  
location of the contacts

7816-3.....Identification cards - Integrated circuit cards  
- Part 3: Cards with contacts - Electrical  
interface and transmission protocols

7816-4.....Identification cards - Integrated circuit cards  
- Part 11: Personal verification through  
biometric methods

7816-10.....Identification cards - Integrated circuit cards  
- Part 4: Organization, security and commands  
for interchange

14443.....Identification cards - Contactless integrated  
circuit cards; Contactless Proximity Cards  
Operating at 13.56 MHz in up to 5 inches  
distance

15693.....Identification cards -- Contactless integrated  
circuit cards - Vicinity cards; Contactless  
Vicinity Cards Operating at 13.56 MHz in up to  
50 inches distance

19794.....Information technology - Biometric data  
interchange formats

Q. National Electrical Contractors Association

303-2005.....Installing Closed Circuit Television (CCTV)  
Systems

R. National Electrical Manufacturers Association (NEMA):

250-08.....Enclosures for Electrical Equipment (1000 Volts  
Maximum)

TC-3-04.....PVC Fittings for Use with Rigid PVC Conduit and  
Tubing

FB1-07.....Fittings, Cast Metal Boxes and Conduit Bodies  
for Conduit, Electrical Metallic Tubing and  
Cable

S. National Fire Protection Association (NFPA):

70-11..... National Electrical Code (NEC)

731-08.....Standards for the Installation of Electric  
Premises Security Systems

99-2005.....Health Care Facilities

T. National Institute of Justice (NIJ)

0601.02-03.....Standards for Walk-Through Metal Detectors for  
use in Weapons Detection

0602.02-03.....Hand-Held Metal Detectors for Use in Concealed  
Weapon and Contraband Detection

U. National Institute of Standards and Technology (NIST):

IR 6887 V2.1.....Government Smart Card Interoperability  
Specification (GSC-IS)

Special Pub 800-37.....Guide for Applying the Risk Management Framework  
to Federal Information Systems

Special Pub 800-63.....Electronic Authentication Guideline

Special Pub 800-73-3....Interfaces for Personal Identity Verification (4  
Parts)

.....Pt. 1- End Point PIV Card Application Namespace,  
Data Model & Representation

.....Pt. 2- PIV Card Application Card Command  
Interface

.....Pt. 3- PIV Client Application Programming  
Interface

.....Pt. 4- The PIV Transitional Interfaces & Data  
Model Specification

Special Pub 800-76-1....Biometric Data Specification for Personal  
Identity Verification

Special Pub 800-78-2....Cryptographic Algorithms and Key Sizes for  
Personal Identity Verification

Special Pub 800-79-1....Guidelines for the Accreditation of Personal  
Identity Verification Card Issuers

Special Pub 800-85B-1...DRAFTPIV Data Model Test Guidelines

Special Pub 800-85A-2...PIV Card Application and Middleware Interface  
Test Guidelines (SP 800-73-3 compliance)

Special Pub 800-96.....PIV Card Reader Interoperability Guidelines

Special Pub 800-104A....Scheme for PIV Visual Card Topography

V. Occupational and Safety Health Administration (OSHA):

29 CFR 1910.97.....Nonionizing radiation

W. Section 508 of the Rehabilitation Act of 1973

X. Security Industry Association (SIA):

AG-01 .....Security CAD Symbols Standards

Y. Underwriters Laboratories, Inc. (UL):

1-05.....Flexible Metal Conduit

5-04.....Surface Metal Raceway and Fittings

6-07.....Rigid Metal Conduit

44-05.....Thermoset-Insulated Wires and Cables

50-07.....Enclosures for Electrical Equipment

83-08.....Thermoplastic-Insulated Wires and Cables

294-99.....The Standard of Safety for Access Control System  
Units

305-08.....Standard for Panic Hardware

360-09.....Liquid-Tight Flexible Steel Conduit

444-08.....Safety Communications Cables

464-09.....Audible Signal Appliances

467-07.....Electrical Grounding and Bonding Equipment

486A-03.....Wire Connectors and Soldering Lugs for Use with  
Copper Conductors

486C-04.....Splicing Wire Connectors

486D-05.....Insulated Wire Connector Systems for Underground  
Use or in Damp or Wet Locations

486E-00.....Equipment Wiring Terminals for Use with Aluminum  
and/or Copper Conductors

493-07.....Thermoplastic-Insulated Underground Feeder and  
Branch Circuit Cable

514A-04.....Metallic Outlet Boxes

514B-04.....Fittings for Cable and Conduit

51-05.....Schedule 40 and 80 Rigid PVC Conduit

609-96.....Local Burglar Alarm Units and Systems

634-07.....Standards for Connectors with Burglar-Alarm  
Systems

636-01.....Standard for Holdup Alarm Units and Systems

639-97.....Standard for Intrusion-Detection Units

651-05.....Schedule 40 and 80 Rigid PVC Conduit

651A-07.....Type EB and A Rigid PVC Conduit and HDPE Conduit

752-05.....Standard for Bullet-Resisting Equipment

797-07.....Electrical Metallic Tubing

827-08.....	Central Station Alarm Services
1037-09.....	Standard for Anti-theft Alarms and Devices
1635-10.....	Digital Alarm Communicator System Units
1076-95.....	Standards for Proprietary Burglar Alarm Units and Systems
1242-06.....	Intermediate Metal Conduit
1479-03.....	Fire Tests of Through-Penetration Fire Stops
1981-03.....	Central Station Automation System
2058-05.....	High Security Electronic Locks
60950.....	Safety of Information Technology Equipment
60950-1.....	Information Technology Equipment - Safety - Part 1: General Requirements

## Z. Uniform Federal Accessibility Standards (UFAS) 1984

AA. United States Department of Commerce:

Special Pub 500-101 Care and Handling of Computer Magnetic Storage Media

## 1.8 COORDINATION

A. Coordinate arrangement, mounting, and support of electronic safety and security equipment:

1. To allow maximum possible headroom unless specific mounting heights that reduce headroom are indicated.
2. To provide for ease of disconnecting the equipment with minimum interference to other installations.
3. To allow right of way for piping and conduit installed at required slope.
4. So connecting raceways, cables, wireways, cable trays, and busways will be clear of obstructions and of the working and access space of other equipment.

B. Coordinate installation of required supporting devices and set sleeves in cast-in-place concrete, masonry walls, and other structural components as they are constructed.

C. Coordinate location of access panels and doors for electronic safety and security items that are behind finished surfaces or otherwise concealed.

## 1.9 MAINTENANCE & SERVICE

### A. General Requirements

1. The Contractor shall provide all services required and equipment necessary to maintain the entire integrated electronic security system in an operational state as specified for a period of one (1) year after formal written acceptance of the system. The Contractor shall provide all necessary material required for performing scheduled adjustments or other non-scheduled work. Impacts on facility operations shall be minimized when performing scheduled



adjustments or other non-scheduled work. See also General Project Requirements.

B. Description of Work

1. The adjustment and repair of the security system includes all software updates, panel firmware, and the following new items: computers equipment, communications transmission equipment and data transmission media (DTM), local processors, security system sensors, physical access control equipment, facility interface, signal transmission equipment, and video equipment.

C. Personnel

1. Service personnel shall be certified in the maintenance and repair of the selected type of equipment and qualified to accomplish all work promptly and satisfactorily. The COR shall be advised in writing of the name of the designated service representative, and of any change in personnel. The COR shall be provided copies of system manufacturer certification for the designated service representative.

D. Schedule of Work

1. The work shall be performed during regular working hours, Monday through Friday, excluding federal holidays.

E. System Inspections

1. These inspections shall include:
  - a. The Contractor shall perform two (2) minor inspections at six (6) month intervals or more if required by the manufacturer, and two (2) major inspections offset equally between the minor inspections to effect quarterly inspection of alternating magnitude.
    - 1) Minor Inspections shall include visual checks and operational tests of all console equipment, peripheral equipment, local processors, sensors, electrical and mechanical controls, and adjustments on printers.
    - 2) Major Inspections shall include all work described for Minor Inspections and the following: clean all system equipment and local processors including interior and exterior surfaces; perform diagnostics on all equipment; operational tests of the CPU, switcher, peripheral equipment, recording devices, monitors, picture quality from each camera; check, walk test, and calibrate each sensor; run all system software diagnostics and correct all problems; and resolve any previous outstanding problems.

F. Emergency Service

1. The owner shall initiate service calls whenever the system is not functioning properly. The Contractor shall provide the Owner with an

emergency service center telephone number. The emergency service center shall be staffed 24 hours a day 365 days a year. The Owner shall have sole authority for determining catastrophic and non-catastrophic system failures within parameters stated in General Project Requirements.

- a. For catastrophic system failures, the Contractor shall provide same day four (4) hour service response with a defect correction time not to exceed eight (8) hours from [notification] [arrival on site]. Catastrophic system failures are defined as any system failure that the Owner determines will place the facility(s) at increased risk.
- b. For non-catastrophic failures, the Contractor within eight (8) hours with a defect correction time not to exceed 24 hours from notification.

#### G. Operation

1. Performance of scheduled adjustments and repair shall verify operation of the system as demonstrated by the applicable portions of the performance verification test.

#### H. Records & Logs

1. The Contractor shall maintain records and logs of each task and organize cumulative records for each component and for the complete system chronologically. A continuous log shall be submitted for all devices. The log shall contain all initial settings, calibration, repair, and programming data. Complete logs shall be maintained and available for inspection on site, demonstrating planned and systematic adjustments and repairs have been accomplished for the system.

#### I. Work Request

1. The Contractor shall separately record each service call request, as received. The record shall include the serial number identifying the component involved, its location, date and time the call was received, specific nature of trouble, names of service personnel assigned to the task, instructions describing the action taken, the amount and nature of the materials used, and the date and time of commencement and completion. The Contractor shall deliver a record of the work performed within five (5) working days after the work was completed.

#### J. System Modifications

1. The Contractor shall make any recommendations for system modification in writing to the COR. No system modifications, including operating parameters and control settings, shall be made without prior written

approval from the COR. Any modifications made to the system shall be incorporated into the operation and maintenance manuals and other documentation affected.

K. Software

1. The Contractor shall provide all software updates when approved by the Owner from the manufacturer during the installation and 12-month warranty period and verify operation of the system. These updates shall be accomplished in a timely manner, fully coordinated with the system operators, and incorporated into the operations and maintenance manuals and software documentation. There shall be at least one (1) scheduled update near the end of the first year's warranty period, at which time the Contractor shall install and validate the latest released version of the Manufacturer's software.

All software changes shall be recorded in a log maintained in the unit control room. An electronic copy of the software update shall be maintained within the log. At a minimum, the contractor shall provide a description of the modification, when the modification occurred, and name and contact information of the individual performing the modification. The log shall be maintained in a white 3 ring binder and the cover marked "SOFTWARE CHANGE LOG".

**1.10 MINIMUM REQUIREMENTS**

- A. References to industry and trade association standards and codes are minimum installation requirement standards.
- B. Drawings and other specification sections shall govern in those instances where requirements are greater than those specified in the above standards.

**1.11 DELIVERY, STORAGE, & HANDLING**

- A. Equipment and materials shall be protected during shipment and storage against physical damage, dirt, moisture, cold and rain:
  1. During installation, enclosures, equipment, controls, controllers, circuit protective devices, and other like items, shall be protected against entry of foreign matter; and be vacuum cleaned both inside and outside before testing and operating and repainting if required.
  2. Damaged equipment shall be, as determined by the COR, placed in first class operating condition or be returned to the source of supply for repair or replacement.
  3. Painted surfaces shall be protected with factory installed removable heavy craft paper, sheet vinyl or equal.
  4. Damaged paint on equipment and materials shall be refinished with the same quality of paint and workmanship as used by the manufacturer so repaired areas are not obvious.

B. Central Station, Workstations, and Controllers:

1. Store in temperature and humidity controlled environment in original manufacturer's sealed containers. Maintain ambient temperature between 10 to 30 deg C (50 to 85 deg F), and not more than 80 percent relative humidity, non-condensing.
2. Open each container; verify contents against packing list, and file copy of packing list, complete with container identification for inclusion in operation and maintenance data.
3. Mark packing list with designations which have been assigned to materials and equipment for recording in the system labeling schedules generated by cable and asset management system.
4. Save original manufacturer's containers and packing materials and deliver as directed under provisions covering extra materials.

**1.12 PROJECT CONDITIONS**

A. Environmental Conditions: System shall be capable of withstanding the following environmental conditions without mechanical or electrical damage or degradation of operating capability:

1. Interior, Controlled Environment: System components, except central-station control unit, installed in temperature-controlled interior environments shall be rated for continuous operation in ambient conditions of 2 to 50 deg C (36 to 122 deg F) dry bulb and 20 to 90 percent relative humidity, non-condensing. NEMA 250, Type 1 enclosure.
2. Interior, Uncontrolled Environment: System components installed in non-temperature-controlled interior environments shall be rated for continuous operation in ambient conditions of -18 to 50 deg C (0 to 122 deg F) dry bulb and 20 to 90 percent relative humidity, non-condensing. NEMA 250, Type 4X enclosures.
3. Exterior Environment: System components installed in locations exposed to weather shall be rated for continuous operation in ambient conditions of -34 to 50 deg C (-30 to 122 deg F) dry bulb and 20 to 90 percent relative humidity, condensing. Rate for continuous operation where exposed to rain as specified in NEMA 250, winds up to 137 km/h (85 mph) and snow cover up to 610 mm (24 in) thick. NEMA 250, Type 4X enclosures.
4. Hazardous Environment: System components located in areas where fire or explosion hazards may exist because of flammable gases or vapors, flammable liquids, combustible dust, or ignitable fibers shall be rated, listed, and installed according to NFPA 70.

- 5. Corrosive Environment: For system components subjected to corrosive fumes, vapors, and wind-driven salt spray in coastal zones, provide NEMA 250, Type 4X enclosures.
- B. Security Environment: Use vandal resistant enclosures in high-risk areas where equipment may be subject to damage.
- C. Console: All console equipment shall, unless noted otherwise, be rated for continuous operation under ambient environmental conditions of 15.6 to 29.4 deg C (60 to 85 deg F) and a relative humidity of 20 to 80 percent.

#### **1.13 EQUIPMENT AND MATERIALS**

- A. Materials and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items, for which replacement parts shall be available.
- B. When more than one unit of the same class of equipment is required, such units shall be the product of a single manufacturer.
- C. Equipment Assemblies and Components:
  - 1. Components of an assembled unit need not be products of the same manufacturer.
  - 2. Manufacturers of equipment assemblies, which include components made by others, shall assume complete responsibility for the final assembled unit.
  - 3. Components shall be compatible with each other and with the total assembly for the intended service.
  - 4. Constituent parts which are similar shall be the product of a single manufacturer.
- D. Factory wiring shall be identified on the equipment being furnished and on all wiring diagrams.
- E. When Factory Testing Is Specified:
  - 1. The Government shall have the option of witnessing factory tests. The contractor shall notify the VA through the COR a minimum of 15 working days prior to the manufacturers making the factory tests.
  - 2. Four copies of certified test reports containing all test data shall be furnished to the COR prior to final inspection and not more than 90 days after completion of the tests.
  - 3. When equipment fails to meet factory test and re-inspection is required, the contractor shall be liable for all additional expenses, including expenses of the Government.

#### **1.14 ELECTRICAL POWER**

- A. Electrical power of 120 Volts Alternating Current (VAC) shall be indicated on the Division 26 drawings. Additional locations requiring primary power required by the security system shall be shown as part of

these contract documents. Primary power for the security system shall be configured to switch to emergency backup sources automatically if interrupted without degradation of any critical system function. Alarms shall not be generated as a result of power switching, however, an indication of power switching on (on-line source) shall be provided to the alarm monitor. The Security Contractor shall provide an interface (dry contact closure) between the PACS and the Uninterruptible Power Supply (UPS) system so the UPS trouble signals and main power fail appear on the PACS operator terminal as alarms.

- B. Failure of any on-line battery shall be detected and reported as a fault condition. Battery backed-up power supplies shall be provided sized for 8 hours of operation at actual connected load. Requirements for additional power or locations shall be included with the contract to support equipment and systems offered. The following minimum requirements shall be provided for power sources and equipment.

1. Emergency Generator

- a. Report Printers: Unit Control Room
- b. Video Monitors: Unit Control Room
- c. Intercom Stations
- d. Radio System
- e. Lights: Unit Control Room, Equipment Rooms, & Security Offices
- f. Outlets: Security Outlets dedicated to security equipment racks or security enclosure assemblies.
- g. Security Device Power Supplies (DGP, VASS, Card Access, Lock Power, etc.) powered from the security closets or remotely: various locations
- h. Telephone/Radio Recording Equipment: Unit Control Room.
- i. VASS Camera Power Supplies: Security Closets
- j. VASS Pan/Tilt Units: Various Locations
- k. VASS Outdoor Housing Heaters and Blowers: Various Sites
- l. Intercom Master Control System
- m. Fiber Optic Receivers/Transmitters
- n. Security office Weapons Storage
- o. Outlets that charge handheld radios

2. Uninterruptible Power Supply (UPS) on Emergency Power

- a. The following 120VAC circuits shall be provided by others. The Security Contractor shall coordinate exact locations with the Electrical Contractor:
  - 1) Security System Monitors and Keyboards: Control Room
  - 2) CPU: Control Equipment Room

- 3) Communications equipment: Control Equipment Room and various sites.
- 4) VASS Matrix Switcher: Control Equipment Room
- 5) VASS: Control Equipment Room
- 6) Digital Video Recorders, encoders & decoders: Control Room
- 7) All equipment Room racked equipment.
- 8) Network switches

#### **1.15 TRANSIENT VOLTAGE SUPPRESSION, POWER SURGE SUPPLESION, & GROUNDING**

- A. Transient Voltage Surge Suppression: All cables and conductors extending beyond building façade, except fiber optic cables, which serve as communication, control, or signal lines shall be protected against Transient Voltage surges and have Transient Voltage Surge Suppression (TVSS) protection. The TVSS device shall be UL listed in accordance with Standard TIA 497B installed at each end. Lighting and surge suppression shall be a multi-strike variety and include a fault indicator. Protection shall be furnished at the equipment and additional triple solid state surge protectors rated for the application on each wire line circuit shall be installed within 914.4 mm (3 ft) of the building cable entrance. Fuses shall not be used for surge protection. The inputs and outputs shall be tested in both normal mode and common mode to verify there is no interference.
  1. A 10-microsecond rise time by 1000 microsecond pulse width waveform with a peak voltage of 1500 volts and a peak current of 60 amperes.
  2. An 8-microsecond rise time by 20-microsecond pulse width waveform with a peak voltage of 1000 volts and a peak current of 500 amperes.
  3. Maximum series current: 2 AMPS. Provide units manufactured by Advanced Protection Technologies, model # TE/FA 10B or TE/FA 20B.
  4. Operating Temperature and Humidity: -40 to 85 deg C (-40 to 185 deg F), 0 to 95 percent relative humidity.
- B. Grounding and Surge Suppression
  1. The Security Contractor shall provide grounding and surge suppression to stabilize the voltage under normal operating conditions. To ensure the operation of over current devices, such as fuses, circuit breakers, and relays, under ground-fault conditions.
  2. Security Contractor shall engineer and provide proper grounding and surge suppression as required by local jurisdiction and prevailing codes and standards referenced in this document.
  3. Principal grounding components and features. Include main grounding buses and grounding and bonding connections to service equipment.

4. Details of interconnection with other grounding systems. The lightning protection system shall be provided by the Security Contractor.
5. Locations and sizes of grounding conductors and grounding buses in electrical, data, and communication equipment rooms and closets.
6. AC power receptacles are not to be used as a ground reference point.
7. Any cable that is shielded shall require a ground in accordance with the best practices of the trade and manufactures installation instructions.
8. Protection should be provided at both ends of cabling.

#### **1.16 COMPONENT ENCLOSURES**

##### **A. Construction of Enclosures**

1. Consoles, power supply enclosures, detector control and terminal cabinets, control units, wiring gutters, and other component housings, collectively referred to as enclosures, shall be so formed and assembled as to be sturdy and rigid.
2. Thickness of metal in-cast and sheet metal enclosures of all types shall not be less than those in Tables I and II, UL 611. Sheet steel used in fabrication of enclosures shall be not less than 14 gauge. Consoles shall be 16-gauge.
3. Doors and covers shall be flanged. Enclosures shall not have pre-punched knockouts. Where doors are mounted on hinges with exposed pins, the hinges shall be of the tight pin type or the ends of hinge pins shall be tack welded to prevent removal. Doors having a latch edge length of less than 609.6 mm (24 in) shall be provided with a single construction core. Where the latch edge of a hinged door is more than 609.6 mm (24 in) or more in length, the door shall be provided with a three-point latching device with construction core; or alternatively with two, one located near each end.
4. Any ventilator openings in enclosures and cabinets shall conform to the requirements of UL 611. Unless otherwise indicated, sheet metal enclosures shall be designed for wall mounting with tip holes slotted. Mounting holes shall be in positions that remain accessible when all major operating components are in place and the door is open, but shall be in accessible when the door is closed.
5. Covers of pull and junction boxes provided to facilitate initial installation of the system shall be held in place by tamper proof Torx Center post security screws. Stenciled or painted labels shall be affixed to such boxes indicating they contain no connections. These labels shall not indicate the box is part of the Electronic Security System (ESS).



B. Consoles & Equipment Racks: All consoles and vertical equipment racks shall include a forced air-cooling system to be provided by others.

1. Vertical Equipment Racks:

- a. The forced air blowers shall be installed in the vented top of each cabinet and shall not reduce usable rack space.
- b. The forced air fan shall consist of one fan rated at 105 CFM per rack bay and noise level shall not exceed 55 decibels.
- c. d. Vertical equipment racks are to be provided with full sized clear plastic locking doors and vented top panels as shown on contract drawings.

2. Console racks:

- a. Forced air fans shall be installed in the top rear of each console bay. The forced air fan shall consist of one fan rated at 105 CFM mounted to a 133mm vented blank panel the noise level of each fan shall not exceed 55 decibels. The fans shall be installed so air is pulled from the bottom of the rack or cabinet and exhausted out the top.
- b. Console racks are to be provided with flush mounted hinged rear doors with recessed locking latch on the bottom and middle sections of the consoles. Provide code access to support wiring for devices located on the work surfaces.

C. Tamper Provisions and Tamper Switches:

1. Enclosures, cabinets, housings, boxes and fittings or every product description having hinged doors or removable covers and which contain circuits, or the integrated security system and its power supplies shall be provided with cover operated, corrosion-resistant tamper switches.
2. Tamper switches shall be arranged to initiate an alarm signal that will report to the monitoring station when the door or cover is moved. Tamper switches shall be mechanically mounted to maximize the defeat time when enclosure covers are opened or removed. It shall take longer than 1 second to depress or defeat the tamper switch after opening or removing the cover. The enclosure and tamper switch shall function together in such a manner as to prohibit direct line of sight to any internal component before the switch activates.
3. Tamper switches shall be inaccessible until the switch is activated. Have mounting hardware concealed so the location of the switch cannot be observed from the exterior of the enclosure. Be connected to circuits which are under electrical supervision at all times, irrespective of the protection mode in which the circuit is operating. Be spring-loaded and held in the closed position by the

- door or cover and be wired so they break the circuit when the door cover is disturbed. Tamper circuits shall be adjustable type screw sets and shall be adjusted by the contractor to eliminate nuisance alarms associated with incorrectly mounted tamper device shall annunciate prior to the enclosure door opening (within 1/4 " tolerance. The tamper device or its components shall not be visible or accessing with common tools to bypass when the enclosure is in the secured mode.
4. The single gang junction boxes for the portrait alarming and pull boxes with less than 102 square mm will not require tamper switches.
  5. All enclosures over 305 square mm shall be hinged with an enclosure lock.
  6. Control Enclosures: Maintenance/Safety switches on control enclosures, which must be opened to make routing maintenance adjustments to the system and to service the power supplies, shall be push/pull-set automatic reset type.
  7. Provide one (1) enclosure tamper switch for each 609 linear mm of enclosure lock side opening evenly spaced.
  8. All security screws shall be Torx-Post Security Screws.
  9. The contractor shall provide the owner with two (2) torx-post screwdrivers.

#### **1.17 ELECTRONIC COMPONENTS**

- A. All electronic components of the system shall be of the solid-state type, mounted on printed circuit boards conforming to UL 796. Boards shall be plug-in, quick-disconnect type. Circuitry shall not be so densely placed as to impede maintenance. All power-dissipating components shall incorporate safety margins of not less than 25 percent with respect to dissipation ratings, maximum voltages, and current-carrying capacity.

#### **1.18 SUBSTITUTE MATERIALS & EQUIPMENT**

- A. Where variations from the contract requirements are requested in accordance with the GENERAL CONDITIONS and Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, the connecting work and related components shall include, but not be limited to additions or changes to branch circuits, circuit protective devices, conduits, wire, feeders, controls, panels and installation methods.
- B. In addition to this Section the Security Contractor shall also reference Section II, Products and associated divisions. The COR shall have final authority on the authorization or refusal of substitutions. If there are no proposed substitutions, a statement in writing from the Contractor shall be submitted to the COR stating same. In the

preparation of a list of substitutions, the following information shall be included, as a minimum:

1. Identity of the material or devices specified for which there is a proposed substitution.
2. Description of the segment of the specification where the material or devices are referenced.
3. Identity of the proposed substitute by manufacturer, brand name, catalog or model number and the manufacturer's product name.
4. A technical statement of all operational characteristic expressing equivalence to items to be substituted and comparison, feature-by-feature, between specification requirements and the material or devices called for in the specification; and Price differential.

C. Materials Not Listed: Furnish all necessary hardware, software, programming materials, and supporting equipment required to place the specified major subsystems in full operation. Note that some supporting equipment, materials, and hardware may not be described herein.

Depending on the manufacturers selected by the COR, some equipment, materials and hardware may not be contained in either the Contract Documents or these written specifications, but are required by the manufacturer for complete operation according to the intent of the design and these specifications. In such cases, the COR shall be given the opportunity to approve the additional equipment, hardware and materials that shall be fully identified in the bid and in the equipment list submittal. The COR shall be consulted in the event there is any question about which supporting equipment, materials, or hardware is intended to be included.

D. Response to Specification: The Contractor shall submit a point-by-point statement of compliance with each paragraph of the security specification. The statement of compliance shall list each paragraph by number and indicate "COMPLY" opposite the number for each paragraph where the Contractor fully complies with the specification. Where the proposed system cannot meet the requirements of the paragraph, and does not offer an equivalent solution, the offers shall indicate "DOES NOT COMPLY" opposite the paragraph number. Where the proposed system does not comply with the paragraph as written, but the bidder feels it will accomplish the intent of the paragraph in a manner different from that described, the offers shall indicate "COMPARABLE". The offers shall include a statement fully describing the "comparable" method of satisfying the requirement. Where a full and concise description is not provided, the offered system shall be considered as not complying with the specification. Any submission that does not include a point-by-

point statement of compliance, as described above, shall be disqualified. Submittals for products shall be in precise order with the product section of the specification. Submittals not in proper sequence will be rejected.

**1.19 LIKE ITEMS**

- A. Where two or more items of equipment performing the same function are required, they shall be exact duplicates produced by one manufacturer. All equipment provided shall be complete, new, and free of any defects.

**1.20 WARRANTY**

- A. The Contractor shall, as a condition precedent to the final payment, execute a written guarantee (warranty) to the COR certifying all contract requirements have been completed according to the final specifications. Contract drawings and the warranty of all materials and equipment furnished under this contract are to remain in satisfactory operating condition (ordinary wear and tear, abuse and causes beyond his control for this work accepted) for one (1) year from the date the Contractor received written notification of final acceptance from the COR. Demonstration and training shall be performed prior to system acceptance. All defects or damages due to faulty materials or workmanship shall be repaired or replaced without delay, to the COR's satisfaction, and at the Contractor's expense. The Contractor shall provide quarterly inspections during the warranty period. The contractor shall provide written documentation to the COR on conditions and findings of the system and device(s). In addition, the contractor shall provide written documentation of test results and stating what was done to correct any deficiencies. The first inspection shall occur 90 calendar days after the acceptance date. The last inspection shall occur 30 calendar days prior to the end of the warranty. The warranty period shall be extended until the last inspection and associated corrective actions are complete. When equipment and labor covered by the Contractor's warranty, or by a manufacturer's warranty, have been replaced or restored because of it's failure during the warranty period, the warranty period for the replaced or repaired equipment or restored work shall be reinstated for a period equal to the original warranty period, and commencing with the date of completion of the replacement or restoration work. In the event any manufacturer customarily provides a warranty period greater than one (1) year, the Contractor's warranty shall be for the same duration for that component.

**1.21 SINGULAR NUMBER**

Where any device or part of equipment is referred to in these specifications in the singular number (e.g., "the switch"), this

reference shall be deemed to apply to as many such devices as are required to complete the installation as shown on the drawings.

## **PART 2 - PRODUCTS**

### **2.1 EQUIPMENT AND MATERIALS**

- A. All equipment associated within the Security Control Room, Security Console and Security Equipment Room shall be UL 827, UL 1981, and UL 60950 compliant and rated for continuous operation. Environmental conditions (i.e. temperature, humidity, wind, and seismic activity) shall be taken under consideration at each facility and site location prior to installation of the equipment.
- B. All equipment shall operate on a 120 or 240 volts alternating current (VAC); 50 Hz or 60 Hz AC power system unless documented otherwise in subsequent sections listed within this specification. All equipment shall have a back-up source of power that will provide a minimum of 8 hours of run time in the event of a loss of primary power to the facility.
- C. The system shall be designed, installed, and programmed in a manner that will allow for ease of operation, programming, servicing, maintenance, testing, and upgrading of the system.
- D. All equipment and materials for the system will be compatible to ensure correct operation.

### **2.2 EQUIPMENT ITEMS**

- A. Wires and Cables:
  - 1. Shall meet or exceed the manufactures recommendation for power and signals.
  - 2. Shall be carried in an enclosed conduit system, utilizing electromagnetic tubing (EMT) to include the equivalent in flexible metal, rigid galvanized steel (RGS) to include the equivalent of liquid tight, polyvinylchloride (PVC) schedule 40 or 80.
  - 3. All conduits will be sized and installed per the NEC. All security system signal and power cables that traverse or originate in a high security office space will be contained in either EMT or RGS conduit.
  - 4. All conduit, pull boxes, and junction boxes shall be marked with colored permanent tape or paint that will allow it to be distinguished from all other infrastructure conduit.
  - 5. Conduit fills shall not exceed 50 percent unless otherwise documented.
  - 6. A pull string shall be pulled along and provided with signal and power cables to assist in future installations.

7. At all locations where there is a wall penetration or core drilling is conducted to allow for conduit to be installed, fire stopping materials shall be applied to that area.
8. High voltage and signal cables shall not share the same conduit and shall be kept separate up to the point of connection. High voltage for the security subsystems shall be any cable or sets of cables carrying 30 VDC/VAC or higher.
9. For all equipment that is carrying digital data between the Security Control Room, Security Equipment Room, Security Console, or at a remote monitoring station, it shall not be less than 20 AWG and stranded copper wire for each conductor. The cable or each individual conductor within the cable shall have a shield that provides 100% coverage. Cables with a single overall shield shall have a tinned copper shield drain wire.

### **2.3 FIBER OPTIC EQUIPMENT**

#### **A. 8 Channel Fiber Optic Transceivers (Video&PTZ Control)**

1. The field-located and central-located fiber optic transceivers shall utilize wave division multiplexing to transmit and receive video and data pan-tilt-zoom control signals over two standard 62.5/125 multimode fibers.
2. The units shall be capable of operating over a range of 2 km.
3. The units shall be NTSC color compatible.
4. The units shall support data rates up to 64 Kbps.
5. The units shall be surface or rack mountable.
6. The units shall be UL listed.
7. The units shall meet or exceed the following specifications:
  - a. Video
    - 1) Input/Output: 1 volt pk-pk (75 ohms)
    - 2) Input/Output Channels: 8
    - 3) Bandwidth: 10 Hz - 6.5 MHz per channel
    - 4) Differential Gain: <2%
    - 5) Differential Phase: <0.7°
    - 6) Tilt: <1%
    - 7) Signal to Noise Ratio: 60 dB
  - b. Data (Control)
    - 1) Data Channels: 2
    - 2) Data Format: RS-232, RS-422, 2 wire or 4 wire RS-485 with Tri-State Manchester Bi-Phase and Sensornet
    - 3) Data Rate: DC - 100 kbps (NRZ)
    - 4) Bit Error Rate: < 1 in 10<sup>-9</sup> @ Maximum Optical Loss Budget
    - 5) Operating Mode: Simplex or Full-Duplex

- 6) Wavelength: 1310/1550 nm, Multimode or Singlemode
- 7) Optical Emitter: Laser Diode
- 8) Number of Fibers: 1
- c. Connectors
  - 1) Optical: ST
  - 2) Power and Data: Terminal Block with Screw Clamps
  - 3) Video: BNC (Gold Plated Center-Pin)
- d. Electrical and Mechanical
  - 1) Power: 12 VDC @ 500 mA (stand-alone)
  - 3) Current Protection: Automatic Resettable Solid-State Current Limiters
- e. Environmental
  - 1) MTBF: > 100,000 hours
  - 2) Operating Temp: -40 to 74 deg C (-40 to 165 deg F)
  - 3) Storage Temp: -40 to 85 deg C (-40 to 185 deg F)
  - 4) Relative Humidity: 0% to 95% (non-condensing)
- B. Fiber Optic Transmitters: The central-located fiber optic transmitters shall utilize wave division multiplexing to transmit video and signals over standard 62.5/125 multimode fibers.
  - 1. The units shall be capable of operating over a range of 4.8 km.
  - 2. The units shall be NTSC color compatible.
  - 3. The units shall support data rates up to 64 Kbps.
  - 4. The units shall be surface or rack mountable.
  - 5. The units shall be UL listed.
  - 6. The units shall meet or exceed the following specifications:
    - a. Video
      - 1) Input: 1 volt pk-pk (75 ohms)
      - 2) Bandwidth: 5MHz - 10 MHz
      - 3) Differential Gain: <5%
      - 4) Tilt: <1%
      - 5) Signal-Noise: 60db
      - 6) Wavelength: 850nm
      - 7) Number of Fibers: 1
      - 8) Operating Temp: -20 to 70 deg C (-4 to 158 deg F)
      - 9) Connectors:
        - a) Power: Female plug with screw clamps
        - b) Video: BNC
        - c) Optical: ST
      - 10) Power: 12 VDC

C. Fiber Optic Receivers: The field-located fiber optic receivers shall utilize wave division multiplexing to receive video signals over standard 62.5/125 multimode fiber.

1. The units shall be capable of operating over a range of 4.8 km.
2. The units shall be NTSC color compatible.
3. The units shall support data rates up to 64 Kbps.
4. The units shall be surface or rack mountable.
5. The units shall be UL listed.
6. The units shall meet or exceed the following specifications:

a. Video

- 1) Output: 1 volt pk-pk (75 ohms)
- 2) Bandwidth: 5MHz - 10 MHz
- 3) Differential Gain: <5%
- 4) Tilt: <1%
- 5) Signal-Noise: 60dB
- 6) Wavelength: 850nm
- 7) Number of Fibers: 1
- 8) Surface Mount: 106.7 x 88.9 x 25.4 mm (4.2 x 3.5 x 1 in)
- 9) Operating Temp: -20 to 70 deg C (-4 to 158 deg F)
- 10) Connectors:
- 11) Power: Female plug block with screw clamps
- 12) Video: BNC
- 13) Optical: ST
- 14) Power: 12 VAC 8 Channel Fiber Optic Transceivers (Video&PTZ Control)

D. Fiber Optic Sub Rack with Power Supply

1. The Card Cage Rack shall provide high-density racking for fiber-optic modules. The unit shall be designed to mount in standard 483 mm (19 in) instrument racks and to accommodate the equivalent of 15 1-inch modules.

a. Specifications

- 1) Card Orientation: Vertical
- 2) Construction: Aluminum
- 3) Current Consumption: 0.99 A
- 4) Humidity: 95.0 % RH
- 5) Input Power: 100-240 VAC, 60/50 Hz
- 6) Mounting: Mounts in standard 483 mm (19 in) rack using four (4) screws (optional wall brackets purchased separately)
- 7) Number of Outputs: 1.0
- 8) Number of Slots 15.0
- 9) Operating Temperature: -40 to +75 deg C (-40.0 to 167.0 deg F)



- 10) Output Voltage: 13.5 V
- 11) Output Current 6.0 A
- 12) Power Dissipation: 28.0 W
- 13) Power Factor: 48.0
- 14) Power Supply: (built-in)
- 15) Rack Units: 3RU
- 16) Redundant Capability: Yes
- 17) Weight: 2.43 kg (5.35 lb)
- 18) Width: 483 mm (19.0 in)

## **2.4 INSTALLATION KIT**

### **A. General:**

1. The kit shall be provided that, at a minimum, includes all connectors and terminals, labeling systems, audio spade lugs, barrier strips, punch blocks or wire wrap terminals, heat shrink tubing, cable ties, solder, hangers, clamps, bolts, conduit, cable duct, and/or cable tray, etc., required to accomplish a neat and secure installation. All wires shall terminate in a spade lug and barrier strip, wire wrap terminal or punch block. Unfinished or unlabeled wire connections shall not be allowed. All unused and partially opened installation kit boxes, coaxial, fiber-optic, and twisted pair cable reels, conduit, cable tray, and/or cable duct bundles, wire rolls, physical installation hardware shall be turned over to the COR. The following sections outline the minimum required installation sub-kits to be used:

### **2. System Grounding:**

- a. The grounding kit shall include all cable and installation hardware required. All head end equipment and power supplies shall be connected to earth ground via internal building wiring, according to the NEC.
- b. This includes, but is not limited to:
  - 1) Coaxial Cable Shields
  - 2) Control Cable Shields
  - 3) Data Cable Shields
  - 4) Equipment Racks
  - 5) Equipment Cabinets
  - 6) Conduits
  - 7) Cable Duct blocks
  - 8) Cable Trays
  - 9) Power Panels
  - 10) Grounding
  - 11) Connector Panels

3. Coaxial Cable: The coaxial cable kit shall include all coaxial connectors, cable tying straps, heat shrink tabbing, hangers, clamps, etc., required to accomplish a neat and secure installation.
4. Wire and Cable: The wire and cable kit shall include all connectors and terminals, audio spade lugs, barrier straps, punch blocks, wire wrap strips, heat shrink tubing, tie wraps, solder, hangers, clamps, labels etc., required to accomplish a neat and orderly installation.
5. Conduit, Cable Duct, and Cable Tray: The kit shall include all conduit, duct, trays, junction boxes, back boxes, cover plates, feed through nipples, hangers, clamps, other hardware required to accomplish a neat and secure conduit, cable duct, and/or cable tray installation in accordance with the NEC and this document.
6. Equipment Interface: The equipment kit shall include any item or quantity of equipment, cable, mounting hardware and materials needed to interface the systems with the identified sub-system(s) according to the OEM requirements and this document.
7. Labels: The labeling kit shall include any item or quantity of labels, tools, stencils, and materials needed to label each subsystem according to the OEM requirements, as-installed drawings, and this document.
8. Documentation: The documentation kit shall include any item or quantity of items, computer discs, as installed drawings, equipment, maintenance, and operation manuals, and OEM materials needed to provide the system documentation as required by this document and explained herein.

### **PART 3 - EXECUTION**

#### **3.1 COMMON REQUIREMENTS FOR ELECTRONIC SAFETY AND SECURITY INSTALLATION**

- A. Comply with NECA 1.
- B. Measure indicated mounting heights to bottom of unit for suspended items and to center of unit for wall-mounting items.
- C. Headroom Maintenance: If mounting heights or other location criteria are not indicated, arrange and install components and equipment to provide maximum possible headroom consistent with these requirements.
- D. Equipment: Install to facilitate service, maintenance, and repair or replacement of components of both electronic safety and security equipment and other nearby installations. Connect in such a way as to facilitate future disconnecting with minimum interference with other items in the vicinity.
- E. Right of Way: Give to piping systems installed at a required slope.
- F. Equipment location shall be as close as practical to locations shown on the drawings.

G. Inaccessible Equipment:

1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, the equipment shall be removed and reinstalled as directed at no additional cost to the Government.
2. "Conveniently accessible" is defined as being capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as, but not limited to, motors, pumps, belt guards, transformers, piping, ductwork, conduit and raceways.

**3.2 FIRESTOPPING**

- A. Apply firestopping to penetrations of fire-rated floor and wall assemblies for electronic safety and security installations to restore original fire-resistance rating of assembly. Firestopping materials and installation requirements are specified in Division 07 Section 07 84 00, FIRESTOPPING.

**3.3 COMMISSIONING**

- A. Provide commissioning documentation in accordance with the requirements of Section 28 08 00 - COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to section 28 08 00 - COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS and related sections for contractor responsibilities for system commissioning.

**3.4 DEMONSTRATION AND TRAINING**

- A. Training shall be provided in accordance with Article, INSTRUCTIONS, of Section 01 00 00, GENERAL REQUIREMENTS.
- B. Training shall be provided for the particular equipment or system as required in each associated specification.
- C. A training schedule shall be developed and submitted by the contractor and approved by the COR at least 30 days prior to the planned training.
- D. Provide services of manufacturer's technical representative for 2 hours to instruct VA personnel in operation and maintenance of units.
- E. Submit training plans and instructor qualifications in accordance with the requirements of Section 28 08 00 - COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS.

**3.5 WORK PERFORMANCE**

- A. Job site safety and worker safety is the responsibility of the contractor.

- B. For work on existing stations, arrange, phase and perform work to assure electronic safety and security service for other buildings at all times. Refer to Article OPERATIONS AND STORAGE AREAS under Section 01 00 00, GENERAL REQUIREMENTS.
- C. New work shall be installed and connected to existing work neatly and carefully. Disturbed or damaged work shall be replaced or repaired to its prior conditions, as required by Section 01 00 00, GENERAL REQUIREMENTS.
- D. Coordinate location of equipment and conduit with other trades to minimize interferences. See the GENERAL CONDITIONS.

### **3.6 SYSTEM PROGRAMMING**

#### **A. General Programming Requirements**

- 1. This following section shall be used by the contractor to identify the anticipated level of effort (LOE) required setup, program, and configure the Electronic Security System (ESS). The contractor shall be responsible for providing all setup, configuration, and programming to include data entry for the Security Management System (SMS) and subsystems [(e.g., video matrix switch, intercoms, digital video recorders, intrusion devices, including integration of subsystems to the SMS (e.g., camera call up, time synchronization, intercoms)]. System programming for existing or new SMS servers shall not be conducted at the project site.

#### **B. Level of Effort for Programming**

- 1. The Contractor shall perform and complete system programming (including all data entry) at an offsite location using the Contractor's own copy of the SMS software. The Contractor's copy of the SMS software shall be of the Owners current version. Once system programming has been completed, the Contractor shall deliver the data to the COR on data entry forms and an approved electronic medium, utilizing data from the contract documents. The completed forms shall be delivered to the COR for review and approval at least 90 calendar days prior to the scheduled date the Contractor requires it. The Contractor shall not upload system programming until the COR has provided written approval. The Contractor is responsible for backing up the system prior to uploading new programming data. Additional programming requirements are provided as follows:
  - a. Programming for New SMS Server: The contractor shall provide all other system related programming. The contractor will be responsible for uploading personnel information (e.g., ID Cards backgrounds, names, access privileges, personnel photos, access schedules, personnel groupings) along with coordinating with COR

for device configurations, standards, and groupings. VA shall provide database to support Contractor's data entry tasks. The contractor shall anticipate a weekly coordination meeting and working with COR to ensure data uploading is performed without incident of loss of function or data loss.

- b. Programming for Existing SMS Servers: The contractor shall perform all related system programming except for personnel data as noted. The contractor will not be responsible for uploading personnel information (e.g., ID Cards backgrounds, names, access privileges, access schedules, personnel groupings). The contractor shall anticipate a weekly coordination meeting and working alongside of COR to ensure data uploading is performed without incident of loss of function or data loss. System programming for SMS servers shall be performed by using the Contractor's own server and software. These servers shall not be connected to existing devices or systems at any time.
2. The Contractor shall identify and request from the COR, any additional data needed to provide a complete and operational system as described in the contract documents.
3. Contractor and COR coordination on programming requires a high level of coordination to ensure programming is performed in accordance with VA requirements and programming uploads do not disrupt existing systems functionality. The contractor shall anticipate a minimum of (1) weekly coordination meeting. Contractor shall ensure data uploading is performed without incident of loss of function or data loss. Calculations to determine actual levels of effort shall be confirmed by the contractor before project award.

### **3.7 TESTING AND ACCEPTANCE**

#### **A. Performance Requirements**

##### **1. General:**

- a. The Contractor shall perform contract field, performance verification, and endurance testing and make adjustments of the completed security system when permitted. The Contractor shall provide all personnel, equipment, instrumentation, and supplies necessary to perform all testing. Written notification of planned testing shall be given to the COR at least 60 calendar days prior to the test and after the Contractor has received written approval of the specific test procedures.
- b. The COR shall witness all testing and system adjustments during testing. Written permission shall be obtained from the COR before

proceeding with the next phase of testing. Original copies of all data produced during performance verification and endurance testing shall be turned over to the COR at the conclusion of each phase of testing and prior to COR approval of the test.

2. Test Procedures and Reports: The test procedures, compliant w/ VA standard test procedures, shall explain in detail, step-by-step actions and expected results demonstrating compliance with the requirements of the specification. The test reports shall be used to document results of the tests. The reports shall be delivered to the COR within seven (7) calendar days after completion of each test.

- B. The inspection and test will be conducted by a factory-certified contractor representative and witnessed by a Government Representative.

The results of the inspection will be officially recorded by a designated Government Representative and maintained on file by the COR (RE), until completion of the entire project. The results will be compared to the Acceptance Test results.

- C. Contractor's Field Testing (CFT)

1. The Contractor shall calibrate and test all equipment, verify DTM operation, place the integrated system in service, and test the integrated system. Ground rods installed by this Contractor within the base of camera poles shall be tested as specified in IEEE STD 142. The Contractor shall test all security systems and equipment, and provide written proof of a 100% operational system before a date is established for the system acceptance test. Documentation package for CFT shall include completed (fully annotated details of test details) for each device and system tested, and annotated loading sheets documenting complete testing to COR approval. CFT test documentation package shall conform to submittal requirements outlined in this Section. The Contractor's field testing procedures shall be identical to the COR's acceptance testing procedures. The Contractor shall provide the COR with a written listing of all equipment and software indicating all equipment and components have been tested and passed. The Contractor shall deliver a written report to the COR stating the installed complete system has been calibrated, tested, and is ready to begin performance verification testing; describing the results of the functional tests, diagnostics, and calibrations; and the report shall also include a copy of the approved acceptance test procedure. Performance verification testing shall not take place until written notice by contractor is received certifying that a contractors field test was successful.

- D. Performance Verification Test (PVT)

1. Test team:
  - a. After the system has been pretested and the Contractor has submitted the pretest results and certification to the COR, then the Contractor shall schedule an acceptance test to date and give the COR written, notice as described herein, prior to the date the acceptance test is expected to begin. The system shall be tested in the presence of a Government Representative, an OEM certified representative, representative of the Contractor and other approved by the COR. The system shall be tested utilizing the approved test equipment to certify proof of performance, FCC, UL and Emergency Service compliance. The test shall verify that the total system meets all the requirements of this specification. The notification of the acceptance test shall include the expected length (in time) of the test.
2. The Contractor shall demonstrate the completed Physical Access Control System PACS complies with the contract requirements. In addition, the Contractor shall provide written certification that the system is 100% operational prior to establishing a date for starting PVT. Using approved test procedures, all physical and functional requirements of the project shall be demonstrated and shown. The PVT will be stopped and aborted as soon as 10 technical deficiencies are found requiring correction. The Contractor shall be responsible for all travel and lodging expenses incurred for out-of-town personnel required to be present for resumption of the PVT. If the acceptance test is aborted, the re-test will commence from the beginning with a retest of components previously tested and accepted.
3. The PVT, as specified, shall not begin until receipt of written certification that the Contractors Field Testing was successful. This shall include certification of successful completion of testing as specified in paragraph "Contractor's Field Testing", and upon successful completion of testing at any time when the system fails to perform as specified. Upon termination of testing by the COR or Contractor, the Contractor shall commence an assessment period as described for Endurance Testing Phase II.
4. Upon successful completion of the acceptance test, the Contractor shall deliver test reports and other documentation, as specified, to the COR prior to commencing the endurance test.
5. Additional Components of the PVT shall include:
  - a. System Inventory
    - 1) All Device equipment
    - 2) All Software

- 3) All Logon and Passwords
- 4) All Cabling System Matrices
- 5) All Cable Testing Documents
- 6) All System and Cabinet Keys

b. Inspection

- 1) Contractor shall record an inspection punch list noting all system deficiencies. The contractor shall prepare an inspection punch list format for CORs approval.
  - 2) As a minimum the punch list shall include a listing of punch list items, punch list item location, description of item problem, date noted, date corrected, and details of how item was corrected.
6. Partial PVT - At the discretion of COR, the Performance Verification Test may be performed in part should a 100% compliant CFT be performed. In the event that a partial PVT will be performed instead of a complete PVT; the partial PVT shall be performed by testing 10% of the system. The contractor shall perform a test of each procedure on select devices or equipment.

E. Endurance Test

1. The Contractor shall demonstrate the specified probability of detection and false alarm rate requirements of the completed system. The endurance test shall be conducted in phases as specified below. The endurance test shall not be started until the COR notifies the Contractor, in writing, that the performance verification test is satisfactorily completed, training as specified has been completed, and correction of all outstanding deficiencies has been satisfactorily completed. VA shall operate the system 24 hours per day, including weekends and holidays, during Phase I and Phase III endurance testing. VA will maintain a log of all system deficiencies. The COR may terminate testing at any time the system fails to perform as specified. Upon termination of testing, the Contractor shall commence an assessment period as described for Phase II. During the last day of the test, the Contractor shall verify the appropriate operation of the system. Upon successful completion of the endurance test, the Contractor shall deliver test reports and other documentation as specified to the COR prior to acceptance of the system.
2. Phase I (Testing): The test shall be conducted 24 hours per day for 15 consecutive calendar days, including holidays, and the system shall operate as specified. The Contractor shall make no repairs during this phase of testing unless authorized in writing by the COR.



If the system experiences no failures, the Contractor may proceed directly to Phase III testing after receiving written permission from the COR.

3. Phase II (Assessment):

- a. After the conclusion of Phase I, the Contractor shall identify all failures, determine causes of all failures, repair all failures, and deliver a written report to the COR. The report shall explain in detail the nature of each failure, corrective action taken, results of tests performed, and recommend the point at which testing should be resumed.
- b. After delivering the written report, the Contractor shall convene a test review meeting at the job site to present the results and recommendations to the COR. The meeting shall not be scheduled earlier than five (5) business days after the COR receives the report. As part of this test review meeting, the Contractor shall demonstrate all failures have been corrected by performing appropriate portions of the performance verification test. Based on the Contractor's report and the test review meeting, the COR will provide a written determine of either the restart date or require Phase I be repeated.

4. Phase III (Testing): The test shall be conducted 24 hours per day for 15 consecutive calendar days, including holidays, and the system shall operate as specified. The Contractor shall make no repairs during this phase of testing unless authorized in writing by the COR.

5. Phase IV (Assessment):

1. After the conclusion of Phase III, the Contractor shall identify all failures, determine causes of all failures, repair all failures, and deliver a written report to the COR. The report shall explain in detail the nature of each failure, corrective action taken, results of tests performed, and recommend the point at which testing should be resumed.
2. After delivering the written report, the Contractor shall convene a test review meeting at the job site to present the results and recommendations to the COR. The meeting shall not be scheduled earlier than five (5) business days after receipt of the report by the COR. As a part of this test review meeting, the Contractor shall demonstrate that all failures have been corrected by repeating appropriate portions for the performance verification test. Based on the review meeting the test should not be scheduled earlier than five (5) business days after the COR receives the report. As a part of this test review meeting, the

Contractor shall demonstrate all failures have been corrected by repeating appropriate portions of the performance verification test. Based on the Contractor's report and the test review meeting, the COR will provide a written determine of either the restart date or require Phase III be repeated. After the conclusion of any re-testing which the COR may require, the Phase IV assessment shall be repeated as if Phase III had just been completed.

F. Exclusions

1. The Contractor will not be held responsible for failures in system performance resulting from the following:
  - a. An outage of the main power in excess of the capability of any backup power source provided the automatic initiation of all backup sources was accomplished and that automatic shutdown and restart of the PACS performed as specified.
  - b. Failure of an Owner furnished equipment or communications link, provided the failure was not due to Contractor furnished equipment, installation, or software.
  - c. Failure of existing Owner owned equipment, provided the failure was not due to Contractor furnished equipment, installation, or software.

- - - E N D - - -

**SECTION 28 05 13**  
**CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the finishing, installation, connection, testing and certification the conductors and cables required for a fully functional for electronic safety and security (ESS) system.

**1.2 RELATED WORK**

- A. Section 01 00 00 - GENERAL REQUIREMENTS. For General Requirements.
- B. Section 07 84 00 - FIRESTOPPING. Requirements for firestopping application and use.
- C. Section 28 05 00 - COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY. Requirements for general requirements that are common to more than one section in Division 28.
- D. Section 28 05 26 - GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY. Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- E. Section 28 05 28.33 - CONDUITS AND BOXES FOR ELECTRONIC SECURITY AND SAFETY. Requirements for infrastructure.
- F. Section 28 08 00 - COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS. Requirements for commissioning.

**1.3 DEFINITIONS**

- A. BICSI: Building Industry Consulting Service International.
- B. EMI: Electromagnetic interference.
- C. IDC: Insulation displacement connector.
- D. Ladder Cable Tray: A fabricated structure consisting of two longitudinal side rails connected by individual transverse members (rungs).
- E. Low Voltage: As defined in NFPA 70 for circuits and equipment operating at less than 50 V or for remote-control and signaling power-limited circuits.
- F. Open Cabling: Passing telecommunications cabling through open space (e.g., between the studs of a wall cavity).
- G. RCDD: Registered Communications Distribution Designer.
- H. Solid-Bottom or Nonventilated Cable Tray: A fabricated structure consisting of integral or separate longitudinal side rails, and a bottom without ventilation openings.
- I. Trough or Ventilated Cable Tray: A fabricated structure consisting of integral or separate longitudinal rails and a bottom having openings sufficient for the passage of air and using 75 percent or less of the plan area of the surface to support cables.

J. UTP: Unshielded twisted pair.

#### **1.4 QUALITY ASSURANCE**

- A. See section 28 05 00 - COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY, Paragraph 1.4.

#### **1.5 SUBMITTALS**

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish the following:
1. Manufacturer's Literature and Data: Showing each cable type and rating.
  2. Certificates: Two weeks prior to final inspection, deliver to the COR four copies of the certification that the material is in accordance with the drawings and specifications and diagrams for cable management system.
  3. Shop Drawings: Cable tray layout, showing cable tray route to scale, with relationship between the tray and adjacent structural, electrical, and mechanical elements. Include the following:
    - a. Vertical and horizontal offsets and transitions.
    - b. Clearances for access above and to side of cable trays.
    - c. Vertical elevation of cable trays above the floor or bottom of ceiling structure.
    - d. Load calculations to show dead and live loads as not exceeding manufacturer's rating for tray and its support elements.
    - e. System labeling schedules, including electronic copy of labeling schedules that are part of the cable and asset identification system of the software specified in Parts 2 and 3.
  4. Wiring Diagrams. Show typical wiring schematics including the following:
    - a. Workstation outlets, jacks, and jack assemblies.
    - b. Patch cords.
    - c. Patch panels.
  5. Cable Administration Drawings: As specified in Part 3 "Identification" Article.
  6. Project planning documents as specified in Part 3.
  7. Maintenance Data: For wire and cable to include in maintenance manuals.

#### **1.6 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are reference in the text by the basic designation only.

- B. American Society of Testing Material (ASTM):
  - D2301-04.....Standard Specification for Vinyl Chloride  
Plastic Pressure Sensitive Electrical Insulating  
Tape
- C. Federal Specifications (Fed. Spec.):
  - A-A-59544-08.....Cable and Wire, Electrical (Power, Fixed  
Installation)
- D. National Fire Protection Association (NFPA):
  - 70-11.....National Electrical Code (NEC)
- E. Underwriters Laboratories, Inc. (UL):
  - 44-05.....Thermoset-Insulated Wires and Cables
  - 83-08.....Thermoplastic-Insulated Wires and Cables
  - 467-07.....Electrical Grounding and Bonding Equipment
  - 486A-03.....Wire Connectors and Soldering Lugs for Use with  
Copper Conductors
  - 486C-04.....Splicing Wire Connectors
  - 486D-05.....Insulated Wire Connector Systems for Underground  
Use or in Damp or Wet Locations
  - 486E-00.....Equipment Wiring Terminals for Use with Aluminum  
and/or Copper Conductors
  - 493-07.....Thermoplastic-Insulated Underground Feeder and  
Branch Circuit Cable
  - 514B-04.....Fittings for Cable and Conduit
  - 1479-03.....Fire Tests of Through-Penetration Fire Stops

#### **1.7 DELIVERY, STORAGE, AND HANDLING**

- A. Test cables upon receipt at Project site.
  - 1. Test optical fiber cable to determine the continuity of the strand  
end to end. Use optical-fiber flashlight or optical loss test set.
  - 2. Test optical fiber cable on reels. Use an optical time domain  
reflectometer to verify the cable length and locate cable defects,  
splices, and connector; include the loss value of each. Retain test  
data and include the record in maintenance data.
  - 3. Test each pair of UTP cable for open and short circuits.

#### **1.8 PROJECT CONDITIONS**

- A. Environmental Limitations: Do not deliver or install UTP, optical  
fiber, and coaxial cables and connecting materials until wet work in  
spaces is complete and dry, and temporary HVAC system is operating and  
maintaining ambient temperature and humidity conditions at occupancy  
levels during the remainder of the construction period.

## **PART 2 - PRODUCTS**

### **2.1 GENERAL**

- A. General: All cabling locations shall be in conduit systems as outlined in Division 28 unless a waiver is granted in writing or an exception is noted on the construction drawings.
- B. Support of Open Cabling: NRTL labeled for support of Category 6 cabling, designed to prevent degradation of cable performance and pinch points that could damage cable.
  - 1. Support brackets with cable tie slots for fastening cable ties to brackets.
  - 2. Lacing bars, spools, J-hooks, and D-rings.
  - 3. Straps and other devices.
- C. Cable Trays:
  - 1. Cable Tray Materials: Metal, suitable for indoors, and protected against corrosion by electroplated zinc galvanizing, complying with ASTM B 633, Type 1, not less than 0.000472 inch (0.012 mm) thick.
  - 2. Ladder Cable Trays: See drawings for width. Rung spacing of 12 inches (305 mm).
- D. Conduit and Boxes: Comply with requirements in Division 28 Section "Conduits and Backboxes for Electrical Systems."
  - 1. Outlet boxes shall be no smaller than 2 inches (50 mm) wide, 3 inches (75 mm) high, and 2-1/2 inches (64 mm) deep.

### **2.2 BACKBOARDS**

- A. Backboards: Plywood, fire-retardant treated, 3/4 by 48 by 96 inches (19 by 1220 by 2440 mm). Comply with requirements for plywood backing panels in Division 06 Section "Rough Carpentry".

### **2.3 UTP CABLE**

- A. Description: 100-ohm, 4-pair UTP, formed into 25-pair binder groups covered with a blue thermoplastic jacket.
  - 1. Comply with ICEA S-90-661 for mechanical properties.
  - 2. Comply with TIA/EIA-568-B.1 for performance specifications.
  - 3. Comply with TIA/EIA-568-B.2, Category 6.
  - 4. Listed and labeled by an NRTL acceptable to authorities having jurisdiction as complying with UL 444 and NFPA 70 for the following types:
    - a. Communications, General Purpose: Type CM or CMG.
    - b. Communications, Plenum Rated: Type CMP, complying with NFPA 262.
    - c. Communications, Riser Rated: Type CMR, complying with UL 1666.
    - d. Communications, Limited Purpose: Type CMX.
    - e. Multipurpose: Type MP or MPG.
    - f. Multipurpose, Plenum Rated: Type MPP, complying with NFPA 262.

g. Multipurpose, Riser Rated: Type MPR, complying with UL 1666.

#### **2.4 UTP CABLE HARDWARE**

- A. UTP Cable Connecting Hardware: IDC type, using modules designed for punch-down caps or tools. Cables shall be terminated with connecting hardware of the same category or higher.
- B. Connecting Blocks: 110-style for Category 6. Provide blocks for the number of cables terminated on the block, plus 25 percent spare. Integral with connector bodies, including plugs and jacks where indicated.

#### **2.5 OPTICAL FIBER CABLE**

- A. Description: Multimode, 62.5/125-micrometer, 12-fiber, tight buffer, optical fiber cable.
  - 1. Comply with ICEA S-83-596 for mechanical properties.
  - 2. Comply with TIA/EIA-568-B.3 for performance specifications.
  - 3. Comply with TIA/EIA-492AAAA-B for detailed specifications.
  - 4. Listed and labeled by an NRTL acceptable to authorities having jurisdiction as complying with UL 444, UL 1651, and NFPA 70 for the following types:
    - a. General Purpose, Nonconductive: Type OFN or OFNG.
    - b. Plenum Rated, Nonconductive: Type OFNP, complying with NFPA 262.
    - c. Riser Rated, Nonconductive: Type OFNR, complying with UL 1666.
    - d. General Purpose, Conductive: Type OFC or OFCG.
    - e. Plenum Rated, Conductive: Type OFCP, complying with NFPA 262.
    - f. Riser Rated, Conductive: Type OFCR, complying with UL 1666.
  - 5. Conductive cable shall be steel armored type.
  - 6. Maximum Attenuation: 3.50 dB/km at 850 nm; 1.5 dB/km at 1300 nm.
  - 7. Minimum Modal Bandwidth: 160 MHz-km at 850 nm; 500 MHz-km at 1300 nm.
- B. Jacket:
  - 1. Jacket Color: Orange for 62.5/125-micrometer cable.
  - 2. Cable cordage jacket, fiber, unit, and group color shall be according to TIA/EIA-598-B.
  - 3. Imprinted with fiber count, fiber type, and aggregate length at regular intervals not to exceed 40 inches (1000 mm).

#### **2.6 OPTICAL FIBER CABLE HARDWARE**

- A. Cable Connecting Hardware: Meet the Optical Fiber Connector Intermateability Standards (FOCIS) specifications of TIA/EIA-604-2, TIA/EIA-604-3-A, and TIA/EIA-604-12. Comply with TIA/EIA-568-B.3.
  - 1. Quick-connect, simplex and duplex, Type SC connectors. Insertion loss shall be not more than 0.75 dB.

2. Type SFF connectors may be used in termination racks, panels, and equipment packages.

## **2.7 COAXIAL CABLE**

- A. General Coaxial Cable Requirements: Broadband type, recommended by cable manufacturer specifically for broadband data transmission applications. Coaxial cable and accessories shall have 75-ohm nominal impedance with a return loss of 20 dB maximum from 7 to 806 MHz.
- B. RG-11/U: NFPA 70, Type CATV.
  1. No. 14 AWG, solid, copper-covered steel conductor.
  2. Gas-injected, foam-PE insulation.
  3. Double shielded with 100 percent aluminum polyester tape and 60 percent aluminum braid.
  4. Jacketed with sunlight-resistant, black PVC or PE.
  5. Suitable for outdoor installations in ambient temperatures ranging from minus 40 to plus 85 deg C.
- C. RG59/U: NFPA 70, Type CATVR.
  1. No. 20 AWG, solid, silver-plated, copper-covered steel conductor.
  2. Gas-injected, foam-PE insulation.
  3. Triple shielded with 100 percent aluminum polyester tape and 95 percent aluminum braid; covered by aluminum foil with grounding strip.
  4. Color-coded PVC jacket.
- D. RG-6/U: NFPA 70, Type CATV or CM.
  1. No. 16 AWG, solid, copper-covered steel conductor; gas-injected, foam-PE insulation.
  2. Double shielded with 100 percent aluminum-foil shield and 60 percent aluminum braid.
  3. Jacketed with black PVC or PE.
  4. Suitable for indoor installations.
- E. RG59/U: NFPA 70, Type CATV.
  1. No. 20 AWG, solid, copper-covered steel conductor; gas-injected, foam-PE insulation.
  2. Double shielded with 100 percent aluminum polyester tape and 40 percent aluminum braid.
  3. PVC jacket.
- F. RG59/U (Plenum Rated): NFPA 70, Type CMP.
  1. No. 20 AWG, solid, copper-covered steel conductor; foam fluorinated ethylene propylene insulation.
  2. Double shielded with 100 percent aluminum-foil shield and 65 percent aluminum braid.
  3. Copolymer jacket.



G. NFPA and UL compliance, listed and labeled by an NRTL acceptable to authorities having jurisdiction as complying with UL 1655, and with NFPA 70 "Radio and Television Equipment" and "Community Antenna Television and Radio Distribution" Articles. Types are as follows:

1. CATV Cable: Type CATV.
2. CATV Plenum Rated: Type CATVP, complying with NFPA 262.
3. CATV Limited Rating: Type CATVX.

## **2.8 COAXIAL CABLE HARDWARE**

A. Coaxial-Cable Connectors: Type BNC, 75 ohms.

## **2.9 RS-232 CABLE**

A. Standard Cable: NFPA 70, Type CM.

1. Paired, 2 pairs, No. 22 AWG, stranded (7x30) tinned copper conductors.
2. Polypropylene insulation.
3. Individual aluminum foil-polyester tape shielded pairs with 100 percent shield coverage.
4. PVC jacket.
5. Pairs are cabled on common axis with No. 24 AWG, stranded (7x32) tinned copper drain wire.
6. Flame Resistance: Comply with UL 1581.

B. Plenum-Rated Cable: NFPA 70, Type CMP.

1. Paired, 2 pairs, No. 22 AWG, stranded (7x30) tinned copper conductors.
2. Plastic insulation.
3. Individual aluminum foil-polyester tape shielded pairs with 100 percent shield coverage.
4. Plastic jacket.
5. Pairs are cabled on common axis with No. 24 AWG, stranded (7x32) tinned copper drain wire.
6. Flame Resistance: Comply with NFPA 262.

## **2.10 RS-485 CABLE**

A. Standard Cable: NFPA 70, Type CM.

1. Paired, 2 pairs, twisted, No. 22 AWG, stranded (7x30) tinned copper conductors.
2. PVC insulation.
3. Unshielded.
4. PVC jacket.
5. Flame Resistance: Comply with UL 1581.

B. Plenum-Rated Cable: NFPA 70, Type CMP.

1. Paired, 2 pairs, No. 22 AWG, stranded (7x30) tinned copper conductors.

2. Fluorinated ethylene propylene insulation.
3. Unshielded.
4. Fluorinated ethylene propylene jacket.
5. Flame Resistance: NFPA 262, Flame Test.

## **2.11 LOW-VOLTAGE CONTROL CABLE**

- A. Paired Lock Cable: NFPA 70, Type CMG.
  1. 1 pair, twisted, No. 16 AWG, stranded (19x29) tinned copper conductors.
  2. PVC insulation.
  3. Unshielded.
  4. PVC jacket.
  5. Flame Resistance: Comply with UL 1581.
- B. Plenum-Rated, Paired Lock Cable: NFPA 70, Type CMP.
  1. 1 pair, twisted, No. 16 AWG, stranded (19x29) tinned copper conductors.
  2. PVC insulation.
  3. Unshielded.
  4. PVC jacket.
  5. Flame Resistance: Comply with NFPA 262.
- C. Paired Lock Cable: NFPA 70, Type CMG.
  1. 1 pair, twisted, No. 18 AWG, stranded (19x30) tinned copper conductors.
  2. PVC insulation.
  3. Unshielded.
  4. PVC jacket.
  5. Flame Resistance: Comply with UL 1581.
- D. Plenum-Rated, Paired Lock Cable: NFPA 70, Type CMP.
  1. 1 pair, twisted, No. 18 AWG, stranded (19x30) tinned copper conductors.
  2. Fluorinated ethylene propylene insulation.
  3. Unshielded.
  4. Plastic jacket.
  5. Flame Resistance: NFPA 262, Flame Test.

## **2.12 CONTROL-CIRCUIT CONDUCTORS**

- A. Class 1 Control Circuits: Stranded copper, Type THHN-THWN, in raceway complying with UL 83.
- B. Class 2 Control Circuits: Stranded copper, Type THHN-THWN, in raceway complying with UL 83.
- C. Class 3 Remote-Control and Signal Circuits: Stranded copper, Type TW or TF, complying with UL 83.

### **2.13 FIRE ALARM WIRE AND CABLE**

- A. General Wire and Cable Requirements: NRTL listed and labeled as complying with NFPA 70, Article 760.
- B. Signaling Line Circuits: Twisted, shielded pair, size as recommended by system manufacturer.
  - 1. Circuit Integrity Cable: Twisted shielded pair, NFPA 70, Article 760, Classification CI, for power-limited fire alarm signal service Type FPL. NRTL listed and labeled as complying with UL 1424 and UL 2196 for a 2-hour rating.
- C. Non-Power-Limited Circuits: Solid-copper conductors with 600-V rated, 75 deg C, color-coded insulation.
  - 1. Low-Voltage Circuits: No. 16 AWG, minimum.
  - 2. Line-Voltage Circuits: No. 12 AWG, minimum.
  - 3. Multiconductor Armored Cable: NFPA 70, Type MC, copper conductors, Type TFN/THHN conductor insulation, copper drain wire, copper armor with outer jacket with red identifier stripe, NRTL listed for fire alarm and cable tray installation, plenum rated, and complying with requirements in UL 2196 for a 2-hour rating.

### **2.14 IDENTIFICATION PRODUCTS**

- A. Comply with UL 969 for a system of labeling materials, including label stocks, laminating adhesives, and inks used by label printers.

### **2.15 SOURCE QUALITY CONTROL**

- A. Testing Agency: Engage a qualified testing agency to evaluate cables.
- B. Factory test UTP and optical fiber cables on reels according to TIA/EIA-568-B.1.
- C. Factory test UTP cables according to TIA/EIA-568-B.2.
- D. Factory test multimode optical fiber cables according to TIA/EIA-526-14-A and TIA/EIA-568-B.3.
- E. Factory sweep test coaxial cables at frequencies from 5 MHz to 1 GHz. Sweep test shall test the frequency response, or attenuation over frequency, of a cable by generating a voltage whose frequency is varied through the specified frequency range and graphing the results.
- F. Cable will be considered defective if it does not pass tests and inspections.
- G. Prepare test and inspection reports.

### **2.16 WIRE LUBRICATING COMPOUND**

- A. Suitable for the wire insulation and conduit it is used with, and shall not harden or become adhesive.
- B. Shall not be used on wire for isolated type electrical power systems.

## **2.17 FIREPROOFING TAPE**

- A. The tape shall consist of a flexible, conformable fabric of organic composition coated one side with flame-retardant elastomer.
- B. The tape shall be self-extinguishing and shall not support combustion. It shall be arc-proof and fireproof.
- C. The tape shall not deteriorate when subjected to water, gases, salt water, sewage, or fungus and be resistant to sunlight and ultraviolet light.
- D. The finished application shall withstand a 200-ampere arc for not less than 30 seconds.
- E. Securing tape: Glass cloth electrical tape not less than 0.18 mm (7 mils) thick, and 19 mm (3/4 inch) wide.

## **PART 3 - EXECUTION**

### **3.1 INSTALLATION OF CONDUCTORS AND CABLES**

- A. Comply with NECA 1.
- B. General Requirements for Cabling:
  - 1. Comply with TIA/EIA-568-B.1.
  - 2. Comply with BICSI ITSIM, Ch. 6, "Cable Termination Practices."
  - 3. Install 110-style IDC termination hardware unless otherwise indicated.
  - 4. Terminate all conductors; no cable shall contain un-terminated elements. Make terminations only at indicated outlets, terminals, and cross-connect and patch panels.
  - 5. Cables may not be spliced. Secure and support cables at intervals not exceeding 30 inches (760 mm) and not more than 6 inches (150 mm) from cabinets, boxes, fittings, outlets, racks, frames, and terminals.
  - 6. Bundle, lace, and train conductors to terminal points without exceeding manufacturer's limitations on bending radii, but not less than radii specified in BICSI ITSIM, "Cabling Termination Practices" Chapter. Install lacing bars and distribution spools.
  - 7. Do not install bruised, kinked, scored, deformed, or abraded cable. Do not splice cable between termination, tap, or junction points. Remove and discard cable if damaged during installation and replace it with new cable.
  - 8. Cold-Weather Installation: Bring cable to room temperature before dereeling. Heat lamps shall not be used for heating.
  - 9. Pulling Cable:
    - a. Comply with BICSI ITSIM, Ch. 4, "Pulling Cable." Monitor cable pull tensions.

- b. Provide installation equipment that will prevent the cutting or abrasion of insulation during pulling of cables.
  - c. Use ropes made of nonmetallic material for pulling feeders.
  - d. Attach pulling lines for feeders by means of either woven basket grips or pulling eyes attached directly to the conductors, as approved by the COR.
  - e. Pull in multiple cables together in a single conduit.
- C. Splice cables and wires where necessary only in outlet boxes, junction boxes, or pull boxes.
  - 1. Splices and terminations shall be mechanically and electrically secure.
  - 2. Where the Government determines that unsatisfactory splices or terminations have been installed, remove the devices and install approved devices at no additional cost to the Government.
- D. Seal cable and wire entering a building from underground, between the wire and conduit where the cable exits the conduit, with a non-hardening approved compound.
- E. Unless otherwise specified in other sections install wiring and connect to equipment/devices to perform the required functions as shown and specified.
- F. Except where otherwise required, install a separate power supply circuit for each system so that malfunctions in any system will not affect other systems.
- G. Where separate power supply circuits are not shown, connect the systems to the nearest panel boards of suitable voltages, which are intended to supply such systems and have suitable spare circuit breakers or space for installation.
- H. Install a red warning indicator on the handle of the branch circuit breaker for the power supply circuit for each system to prevent accidental de-energizing of the systems.
- I. System voltages shall be 120 volts or lower where shown on the drawings or as required by the NEC.
- J. UTP Cable Installation:
  - 1. Comply with TIA/EIA-568-B.2.
  - 2. Do not untwist UTP cables more than 1/2 inch (12 mm) from the point of termination to maintain cable geometry.
- K. Optical Fiber Cable Installation:
  - 1. Comply with TIA/EIA-568-B.3.
  - 2. Cable shall be terminated on connecting hardware that is rack or cabinet mounted.
- L. Open-Cable Installation:

1. Install cabling with horizontal and vertical cable guides in telecommunications spaces with terminating hardware and interconnection equipment.
2. Suspend copper cable not in a wireway or pathway a minimum of 8 inches (200 mm) above ceilings by cable supports not more than 60 inches (1525 mm) apart.
3. Cable shall not be run through structural members or in contact with pipes, ducts, or other potentially damaging items.

M. Separation from EMI Sources:

1. Comply with BICSI TDMM and TIA/EIA-569-A recommendations for separating unshielded copper voice and data communication cable from potential EMI sources, including electrical power lines and equipment.
2. Separation between open communications cables or cables in nonmetallic raceways and unshielded power conductors and electrical equipment shall be as follows:
  - a. Electrical Equipment Rating Less Than 2 kVA: A minimum of 5 inches (127 mm).
  - b. Electrical Equipment Rating between 2 and 5 kVA: A minimum of 12 inches (300 mm).
  - c. Electrical Equipment Rating More Than 5 kVA: A minimum of 24 inches (600 mm).
3. Separation between communications cables in grounded metallic raceways and unshielded power lines or electrical equipment shall be as follows:
  - a. Electrical Equipment Rating Less Than 2 kVA: A minimum of 2-1/2 inches (64 mm).
  - b. Electrical Equipment Rating between 2 and 5 kVA: A minimum of 6 inches (150 mm).
  - c. Electrical Equipment Rating More Than 5 kVA: A minimum of 12 inches (300 mm).
4. Separation between communications cables in grounded metallic raceways and power lines and electrical equipment located in grounded metallic conduits or enclosures shall be as follows:
  - a. Electrical Equipment Rating Less Than 2 kVA: No requirement.
  - b. Electrical Equipment Rating between 2 and 5 kVA: A minimum of 3 inches (75 mm).
  - c. Electrical Equipment Rating More Than 5 kVA: A minimum of 6 inches (150 mm).
5. Separation between Cables and Electrical Motors and Transformers, 5 kVA or HP and Larger: A minimum of 48 inches (1200 mm).

6. Separation between Cables and Fluorescent Fixtures: A minimum of 5 inches (127 mm).

### **3.2 FIRE ALARM WIRING INSTALLATION**

- A. Comply with NECA 1 and NFPA 72.
- B. Wiring Method: Install wiring in metal raceway according to Division 28 Section CONDUITS AND BACKBOXES FOR ELECTRICAL SYSTEMS."
  1. Install plenum cable in environmental air spaces, including plenum ceilings.
  2. Fire alarm circuits and equipment control wiring associated with the fire alarm system shall be installed in a dedicated raceway system. This system shall not be used for any other wire or cable.
- C. Wiring Method:
  1. Cables and raceways used for fire alarm circuits, and equipment control wiring associated with the fire alarm system, may not contain any other wire or cable.
  2. Fire-Rated Cables: Use of 2-hour, fire-rated fire alarm cables, NFPA 70, Types MI and CI, is not permitted.
  3. Signaling Line Circuits: Power-limited fire alarm cables may be installed in the same raceway as signaling line circuits.
- D. Wiring within Enclosures: Separate power-limited and non-power-limited conductors as recommended by manufacturer. Install conductors parallel with or at right angles to sides and back of the enclosure. Bundle, lace, and train conductors to terminal points with no excess. Connect conductors that are terminated, spliced, or interrupted in any enclosure associated with the fire alarm system to terminal blocks. Mark each terminal according to the system's wiring diagrams. Make all connections with approved crimp-on terminal spade lugs, pressure-type terminal blocks, or plug connectors.
- E. Cable Taps: Use numbered terminal strips in junction, pull, and outlet boxes, cabinets, or equipment enclosures where circuit connections are made.
- F. Color-Coding: Color-code fire alarm conductors differently from the normal building power wiring. Use one color-code for alarm circuit wiring and another for supervisory circuits. Color-code audible alarm-indicating circuits differently from alarm-initiating circuits. Use different colors for visible alarm-indicating devices. Paint fire alarm system junction boxes and covers red.
- G. Risers: Install at least two vertical cable risers to serve the fire alarm system. Separate risers in close proximity to each other with a minimum one-hour-rated wall, so the loss of one riser does not prevent the receipt or transmission of signals from other floors or zones.

### **3.3 CONTROL CIRCUIT CONDUCTORS**

#### **A. Minimum Conductor Sizes:**

1. Class 1 remote-control and signal circuits, No. 14 AWG.
2. Class 2 low-energy, remote-control and signal circuits, No. 16 AWG.
3. Class 3 low-energy, remote-control, alarm and signal circuits, No. 12 AWG.

### **3.4 CONNECTIONS**

- A. Comply with requirements in Division 28 Section, PHYSICAL ACCESS CONTROL for connecting, terminating, and identifying wires and cables.
- B. Comply with requirements in Division 28 Section "INTRUSION DETECTION" for connecting, terminating, and identifying wires and cables.
- C. Comply with requirements in Division 28 Section "VIDEO SURVEILLANCE" for connecting, terminating, and identifying wires and cables.
- D. Comply with requirements in Division 28 Section "FIRE DETECTION AND ALARM" for connecting, terminating, and identifying wires and cables.

### **3.5 FIRESTOPPING**

- A. Comply with requirements in Division 07 Section "PENETRATION FIRESTOPPING."
- B. Comply with TIA/EIA-569-A, "Firestopping" Annex A.
- C. Comply with BICSI TDMM, "Firestopping Systems" Article.

### **3.6 GROUNDING**

- A. For communications wiring, comply with ANSI-J-STD-607-A and with BICSI TDMM, "Grounding, Bonding, and Electrical Protection" Chapter.
- B. For low-voltage wiring and cabling, comply with requirements in Division 28 Section "GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY."

### **3.7 IDENTIFICATION**

- A. Identify system components, wiring, and cabling complying with TIA/EIA-606-A.
- B. Install a permanent wire marker on each wire at each termination.
- C. Identifying numbers and letters on the wire markers shall correspond to those on the wiring diagrams used for installing the systems.
- D. Wire markers shall retain their markings after cleaning.
- E. In each handhole, install embossed brass tags to identify the system served and function.

### **3.8 FIELD QUALITY CONTROL**

- A. Testing Agency: Engage a qualified testing agency to perform tests and inspections.
- B. Perform tests and inspections.
- C. Tests and Inspections:



1. Visually inspect UTP and optical fiber cable jacket materials for UL or third-party certification markings. Inspect cabling terminations to confirm color-coding for pin assignments, and inspect cabling connections to confirm compliance with TIA/EIA-568-B.1.
2. Visually inspect cable placement, cable termination, grounding and bonding, equipment and patch cords, and labeling of all components.
3. Test UTP cabling for DC loop resistance, shorts, opens, intermittent faults, and polarity between conductors. Test operation of shorting bars in connection blocks. Test cables after termination but not cross connection.
  - a. Test instruments shall meet or exceed applicable requirements in TIA/EIA-568-B.2. Perform tests with a tester that complies with performance requirements in "Test Instruments (Normative)" Annex, complying with measurement accuracy specified in "Measurement Accuracy (Informative)" Annex. Use only test cords and adapters that are qualified by test equipment manufacturer for channel or link test configuration.
4. Optical Fiber Cable Tests:
  - a. Test instruments shall meet or exceed applicable requirements in TIA/EIA-568-B.1. Use only test cords and adapters that are qualified by test equipment manufacturer for channel or link test configuration.
  - b. Link End-to-End Attenuation Tests:
    - 1) Multimode Link Measurements: Test at 850 or 1300 nm in 1 direction according to TIA/EIA-526-14-A, Method B, One Reference Jumper.
    - 2) Attenuation test results for links shall be less than 2.0 dB. Attenuation test results shall be less than that calculated according to equation in TIA/EIA-568-B.1.
5. Coaxial Cable Tests: Comply with requirements in Division 27 Section "Master Antenna Television System."
- D. Document data for each measurement. Print data for submittals in a summary report that is formatted using Table 10.1 in BICSI TDMM as a guide, or transfer the data from the instrument to the computer, save as text files, print, and submit.
- E. End-to-end cabling will be considered defective if it does not pass tests and inspections.
- F. Prepare test and inspection reports.

### **3.9 EXISTING WIRING**

- A. Unless specifically indicated on the plans, existing wiring shall not be reused for the new installation. Only wiring that conforms to the

specifications and applicable codes may be reused. If existing wiring does not meet these requirements, existing wiring may not be reused and new wires shall be installed.

- - - E N D - - -

**SECTION 28 05 26**  
**GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the finishing, installation, connection, testing and certification of the grounding and bonding required for a fully functional Electronic Safety and Security (ESS) system.
- B. "Grounding electrode system" refers to all electrodes required by NEC, as well as including made, supplementary, grounding electrodes.
- C. The terms "connect" and "bond" are used interchangeably in this specification and have the same meaning.

**1.2 RELATED WORK**

- A. Section 01 00 00 - GENERAL REQUIREMENTS. For General Requirements.
- B. Section 26 41 00 - FACILITY LIGHTNING PROTECTION. Requirements for a lightning protection system.
- C. Section 28 05 00 - REQUIREMENTS FOR ELECTRONIC SAFETY AND SECURITY INSTALLATIONS. For general electrical requirements, quality assurance, coordination, and project conditions that are common to more than one section in Division 28.
- D. Section 28 05 13 - CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for low voltage power and lighting wiring.
- E. Section 28 08 00 - COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS. Requirements for commissioning.

**1.3 SUBMITTALS**

- A. Submit in accordance with Section 28 05 00, COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY.
- B. Shop Drawings:
  - 1. Clearly present enough information to determine compliance with drawings and specifications.
  - 2. Include the location of system grounding electrode connections and the routing of aboveground and underground grounding electrode conductors.
- C. Test Reports: Provide certified test reports of ground resistance.
- D. Certifications: Two weeks prior to final inspection, submit four copies of the following to the Contracting Officers Representative (COR):
  - 1. Certification that the materials and installation are in accordance with the drawings and specifications.

2. Certification by the contractor that the complete installation has been properly installed and tested.

#### **1.4 APPLICABLE PUBLICATIONS**

- A. Publications listed below (including amendments, addenda, revisions, supplements, and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by designation only.
- B. American Society for Testing and Materials (ASTM):
  - B1-07.....Standard Specification for Hard-Drawn Copper Wire
  - B3-07.....Standard Specification for Soft or Annealed Copper Wire
  - B8-04.....Standard Specification for Concentric-Lay-Stranded Copper Conductors, Hard, Medium-Hard, or Soft
- C. Institute of Electrical and Electronics Engineers, Inc. (IEEE):
  - 81-1983.....IEEE Guide for Measuring Earth Resistivity, Ground Impedance, and Earth Surface Potentials of a Ground System
  - C2-07.....National Electrical Safety Code
- D. National Fire Protection Association (NFPA):
  - 70-11.....National Electrical Code (NEC)
  - 99-2005.....Health Care Facilities
- E. Underwriters Laboratories, Inc. (UL):
  - 44-05 .....Thermoset-Insulated Wires and Cables
  - 83-08 .....Thermoplastic-Insulated Wires and Cables
  - 467-07 .....Grounding and Bonding Equipment
  - 486A-486B-03 .....Wire Connectors

## **PART 2 - PRODUCTS**

### **2.1 GROUNDING AND BONDING CONDUCTORS**

- A. Equipment grounding conductors shall be UL 83 insulated stranded copper, except that sizes 10 AWG and smaller shall be solid copper. Insulation color shall be continuous green for all equipment grounding conductors, except that wire sizes 4 AWG and larger shall be permitted to be identified per NEC.
- B. Bonding conductors shall be ASTM B8 bare stranded copper, except that sizes 10 AWG and smaller shall be ASTM B1 solid bare copper wire.

## **2.2 SPLICES AND TERMINATION COMPONENTS**

- A. Components shall meet or exceed UL 467 and be clearly marked with the manufacturer, catalog number, and permitted conductor size(s).2.4 ground connections
- B. Listed and labeled by an NRTL acceptable to authorities having jurisdiction for applications in which used and for specific types, sizes, and combinations of conductors and other items connected.
- C. Above Grade:
  - 1. Bonding Jumpers: Compression-type connectors, using zinc-plated fasteners and external tooth lockwashers.
  - 2. Connection to Building Steel: Exothermic-welded type connectors.
  - 3. Ground Busbars: Two-hole compression type lugs, using tin-plated copper or copper alloy bolts and nuts.
  - 4. Rack and Cabinet Ground Bars: One-hole compression-type lugs, using zinc-plated or copper alloy fasteners.
  - 5. Bolted Connectors for Conductors and Pipes: Copper or copper alloy, pressure type with at least two bolts.
    - a) Pipe Connectors: Clamp type, sized for pipe.
  - 6. Welded Connectors: Exothermic-welding kits of types recommended by kit manufacturer for materials being joined and installation conditions.

## **2.3 EQUIPMENT RACK AND CABINET GROUND BARS**

- A. Provide solid copper ground bars designed for mounting on the framework of open or cabinet-enclosed equipment racks with minimum dimensions of 4 mm thick by 19 mm wide (3/8 inch x ¾ inch).

## **2.4 GROUND TERMINAL BLOCKS**

- A. At any equipment mounting location (e.g., backboards and hinged cover enclosures) where rack-type ground bars cannot be mounted, provide screw lug-type terminal blocks.

## **2.5 SPLICE CASE GROUND ACCESSORIES**

- A. Splice case grounding and bonding accessories shall be supplied by the splice case manufacturer when available. Otherwise, use 6 AWG insulated ground wire with shield bonding connectors.

## **2.6 COMPUTER ROOM GROUND**

- A. Provide 1/0 AWG bare copper grounding conductors bolted at mesh intersections to form an equipotential grounding grid. The

equipotential grounding grid shall form a 600mm (24 inch) mesh pattern.  
The grid shall be bonded to each of the access floor pedestals.

### **PART 3 - EXECUTION**

#### **3.1 GENERAL**

- A. Ground in accordance with the NEC, as shown on drawings, and as specified herein.
- B. System Grounding:
  - 1. Secondary service neutrals: Ground at the supply side of the secondary disconnecting means and at the related transformers.
  - 2. Separately derived systems (transformers downstream from the service entrance): Ground the secondary neutral.
- C. Equipment Grounding: Metallic structures, including ductwork and building steel, enclosures, raceways, junction boxes, outlet boxes, cabinets, machine frames, and other conductive items in close proximity with electrical circuits, shall be bonded and grounded.

#### **3.2 INACCESSIBLE GROUNDING CONNECTIONS**

- A. Make grounding connections, which are buried or otherwise normally inaccessible (except connections for which periodic testing access is required) by exothermic weld.

#### **3.3 CORROSION INHIBITORS**

- A. When making ground and ground bonding connections, apply a corrosion inhibitor to all contact surfaces. Use corrosion inhibitor appropriate for protecting a connection between the metals used.

#### **3.4 CONDUCTIVE PIPING**

- A. Bond all conductive piping systems, interior and exterior, to the building to the grounding electrode system. Bonding connections shall be made as close as practical to the equipment ground bus.

#### **3.5 COMPUTER ROOM/SECURITY EQUIPMENT ROOM GROUNDING**

- A. Conduit: Ground and bond metallic conduit systems as follows:
  - 1. Ground metallic service conduit and any pipes entering or being routed within the computer room at each end using 16 mm<sup>2</sup> (6AWG) bonding jumpers.
  - 2. Bond at all intermediate metallic enclosures and across all joints using 16 mm<sup>2</sup> (6 AWG) bonding jumpers.

#### **3.6 WIREWAY GROUNDING**

- A. Ground and Bond Metallic Wireway Systems as follows:

1. Bond the metallic structures of wireway to provide 100 percent electrical continuity throughout the wireway system by connecting a 6 AWG bonding jumper at all intermediate metallic enclosures and across all section junctions.
2. Install insulated 6 AWG bonding jumpers between the wireway system bonded as required in paragraph 1 above, and the closest building ground at each end and approximately every 16 meters (50 feet).
3. Use insulated 6 AWG bonding jumpers to ground or bond metallic wireway at each end at all intermediate metallic enclosures and cross all section junctions.
4. Use insulated 6 AWG bonding jumpers to ground cable tray to column-mounted building ground plates (pads) at each end and approximately every 15 meters.

### **3.7 LIGHTNING PROTECTION SYSTEM**

- A. Bond the lightning protection system to earth ground externally to the building. Under no condition shall the electrical system's third or fourth ground electrode system, or the telecommunications system circulating ground system be connected to the lightning protection system. The Facility's structural steel may be used to connect the lightning protection system at the direction of the COR certified by an independent certified grounding contractor.

### **3.8 LABELING**

- A. Comply with requirements in Division 26 Section "ELECTRICAL IDENTIFICATION" Article for instruction signs. The label or its text shall be green.
- B. Install labels at the telecommunications bonding conductor and grounding equalizer.
  1. Label Text: "If this connector or cable is loose or if it must be removed for any reason, notify the facility manager."

### **3.9 FIELD QUALITY CONTROL**

- A. Perform tests and inspections.
- B. Tests and Inspections:
  1. After installing grounding system but before permanent electrical circuits have been energized, test for compliance with requirements.
  2. Inspect physical and mechanical condition. Verify tightness of accessible, bolted, electrical connections with a calibrated torque wrench according to manufacturer's written instructions.

C. Grounding system will be considered defective if it does not pass tests and inspections.

D. Prepare test and inspection reports.

E. Report measured ground resistances that exceed the following values:

1. Power Distribution Units or Panel boards Serving Electronic Equipment: 3 ohm(s).

- - - E N D - - -



## **SECTION 28 05 28.33**

### **CONDUITS AND BACKBOXES FOR ELECTRONIC SAFETY AND SECURITY**

#### **PART 1 - GENERAL**

##### **1.1 DESCRIPTION**

- A. This section specifies the finishing, installation, connection, testing certification of the conduit, fittings, and boxes to form a complete, coordinated, raceway system(s). Conduits and when approved separate UL Certified and Listed partitioned telecommunications raceways are required for a fully functional Electronic Safety and Security (ESS) system. Raceways are required for all electronic safety and security cabling unless shown or specified otherwise.
- B. Definitions: The term conduit, as used in this specification, shall mean any or all of the raceway types specified.

##### **1.2 RELATED WORK**

- A. Section 01 00 00 - GENERAL REQUIREMENTS. For General Requirements.
- B. Section 06 10 00 - ROUGH CARPENTRY. Requirements for mounting board for communication closets.
- C. Section 07 84 00 - FIRESTOPPING. Requirements for sealing around penetrations to maintain the integrity of fire rated construction.
- D. Section 07 60 00 - FLASHING AND SHEET METAL. Requirements for fabrications for the deflection of water away from the building envelope at penetrations.
- E. Section 07 92 00 - JOINT SEALANTS. Requirements for sealing around conduit penetrations through the building envelope to prevent moisture migration into the building.
- F. Section 09 91 00 - PAINTING. Requirements for identification and painting of conduit and other devices.
- G. Section 28 05 00 - COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY. For general electrical requirements, general arrangement of the contract documents, coordination, quality assurance, project conditions, equipment and materials, and items that is common to more than one section of Division 28.
- H. Section 28 05 26 - GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY. Requirements for personnel safety and to provide a low impedance path for possible ground fault currents.
- I. Section 28 08 00 - COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS. Requirements for commissioning - systems readiness checklists, and training.

### **1.3 DEFINITIONS**

- A. EMT: Electrical metallic tubing.
- B. ENT: Electrical nonmetallic tubing.
- C. EPDM: Ethylene-propylene-diene terpolymer rubber.
- D. FMC: Flexible metal conduit.
- E. IMC: Intermediate metal conduit.
- F. LFMC: Liquidtight flexible metal conduit.
- G. LFNC: Liquidtight flexible nonmetallic conduit.
- H. NBR: Acrylonitrile-butadiene rubber.
- I. RNC: Rigid nonmetallic conduit.

### **1.4 QUALITY ASSURANCE**

- A. Refer to Paragraph 1.4 Quality Assurance, in Section 28 05 00, COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY.

### **1.5 SUBMITTALS**

- A. Submit in accordance with Section 28 05 00, COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY and Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Furnish the following:
- B. Shop Drawings:
  - 1. Size and location of main feeders;
  - 2. Size and location of panels and pull boxes
  - 3. Layout of required conduit penetrations through structural elements.
  - 4. The specific item proposed and its area of application shall be identified on the catalog cuts.
- C. Certification: Prior to final inspection, deliver to the Contracting Officer's Representative (COR) four copies of the certification that the material is in accordance with the drawings and specifications and has been properly installed.
- D. Completed System Readiness Checklists provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 28 08 00, COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS.
- E. Product Data: For surface raceways, wireways and fittings, floor boxes, hinged-cover enclosures, and cabinets.
- F. Shop Drawings: For the following raceway components. Include plans, elevations, sections, details, and attachments to other work.
  - 1. Custom enclosures and cabinets.

G. Coordination Drawings: Conduit routing plans, drawn to scale, on which the following items are shown and coordinated with each other, based on input from installers of the items involved:

1. Structural members in the paths of conduit groups with common supports.
2. HVAC and plumbing items and architectural features in the paths of conduit groups with common supports.

H. Source quality-control test reports.

#### **1.6 APPLICABLE PUBLICATIONS**

A. Publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. Publications are referenced in the text by the basic designation only.

B. National Electrical Manufacturers Association (NEMA):

TC-3-04.....PVC Fittings for Use with Rigid PVC Conduit and  
Tubing

FB1-07.....Fittings, Cast Metal Boxes and Conduit Bodies  
for Conduit, Electrical Metallic Tubing and  
Cable

C. National Fire Protection Association (NFPA):

70-11.....National Electrical Code (NEC)

D. Underwriters Laboratories, Inc. (UL):

1-05.....Flexible Metal Conduit

5-04.....Surface Metal Raceway and Fittings

6-07.....Rigid Metal Conduit

50-07.....Enclosures for Electrical Equipment

360-09.....Liquid-Tight Flexible Steel Conduit

467-07.....Grounding and Bonding Equipment

514A-04.....Metallic Outlet Boxes

514B-04.....Fittings for Cable and Conduit

514C-02.....Nonmetallic Outlet Boxes, Flush-Device Boxes and  
Covers

651-05.....Schedule 40 and 80 Rigid PVC Conduit

651A-07.....Type EB and A Rigid PVC Conduit and HDPE Conduit

797-07.....Electrical Metallic Tubing

1242-06.....Intermediate Metal Conduit

## **PART 2 - PRODUCTS**

### **2.1 GENERAL**

- A. Conduit Size: In accordance with the NEC, but not less than 20 mm (3/4 inch) unless otherwise shown.

### **2.2 CONDUIT**

- A. Rigid galvanized steel: Shall Conform to UL 6, ANSI C80.1.
- B. Rigid intermediate steel conduit (IMC): Shall Conform to UL 1242, ANSI C80.6.
- C. Electrical metallic tubing (EMT): Shall Conform to UL 797, ANSI C80.3. Maximum size not to exceed 105 mm (4 inches) and shall be permitted only with cable rated 600 volts or less.
- D. Flexible galvanized steel conduit: Shall Conform to UL 1.
- E. Liquid-tight flexible metal conduit: Shall Conform to UL 360.
- F. Direct burial plastic conduit: Shall conform to UL 651 and UL 651A, heavy wall PVC or high density polyethylene (PE).

### **2.3 WIREWAYS AND RACEWAYS**

- A. Surface metal raceway: Shall Conform to UL 5.

### **2.4 CONDUIT FITTINGS**

- A. Rigid steel and IMC conduit fittings:
  - 1. Fittings shall meet the requirements of UL 514B and ANSI/ NEMA FB1.
  - 2. Standard threaded couplings, locknuts, bushings, and elbows: Only steel or malleable iron materials are acceptable. Integral retractable type IMC couplings are also acceptable.
  - 3. Locknuts: Bonding type with sharp edges for digging into the metal wall of an enclosure.
  - 4. Bushings: Metallic insulating type, consisting of an insulating insert molded or locked into the metallic body of the fitting. Bushings made entirely of metal or nonmetallic material are not permitted.
  - 5. Erickson (union-type) and set screw type couplings: Approved for use in concrete are permitted for use to complete a conduit run where conduit is installed in concrete. Use set screws of case hardened steel with hex head and cup point to firmly seat in conduit wall for positive ground. Tightening of set screws with pliers is prohibited.
  - 6. Sealing fittings: Threaded cast iron type. Use continuous drain type sealing fittings to prevent passage of water vapor. In concealed work, install fittings in flush steel boxes with blank cover plates having the same finishes as that of other electrical plates in the room.

B. Electrical metallic tubing fittings:

1. Fittings shall meet the requirements of UL 514B and ANSI/ NEMA FB1.
2. Only steel or malleable iron materials are acceptable.
3. Couplings and connectors: Concrete tight and rain tight, with connectors having insulated throats. Use gland and ring compression type couplings and connectors for conduit sizes 50 mm (2 inches) and smaller. Use set screw type couplings with four set screws each for conduit sizes over 50 mm (2 inches). Use set screws of case-hardened steel with hex head and cup point to firmly seat in wall of conduit for positive grounding.
4. Indent type connectors or couplings are prohibited.
5. Die-cast or pressure-cast zinc-alloy fittings or fittings made of "pot metal" are prohibited.

C. Flexible steel conduit fittings:

1. Conform to UL 514B. Only steel or malleable iron materials are acceptable.
2. Clamp type, with insulated throat.

D. Liquid-tight flexible metal conduit fittings:

1. Fittings shall meet the requirements of UL 514B and ANSI/ NEMA FB1.
2. Only steel or malleable iron materials are acceptable.
3. Fittings must incorporate a threaded grounding cone, a steel or plastic compression ring, and a gland for tightening. Connectors shall have insulated throats.

E. Direct burial plastic conduit fittings:

1. Fittings shall meet the requirements of UL 514C and NEMA TC3.
2. As recommended by the conduit manufacturer.

F. Surface metal raceway fittings: As recommended by the raceway manufacturer.

G. Expansion and deflection couplings:

1. Conform to UL 467 and UL 514B.
2. Accommodate, 19 mm (0.75 inch) deflection, expansion, or contraction in any direction, and allow 30 degree angular deflections.
3. Include internal flexible metal braid sized to guarantee conduit ground continuity and fault currents in accordance with UL 467, and the NEC code tables for ground conductors.
4. Jacket: Flexible, corrosion-resistant, watertight, moisture and heat resistant molded rubber material with stainless steel jacket clamps.

## **2.5 CONDUIT SUPPORTS**

- A. Parts and hardware: Zinc-coat or provide equivalent corrosion protection.
- B. Individual Conduit Hangers: Designed for the purpose, having a pre-assembled closure bolt and nut, and provisions for receiving a hanger rod.
- C. Multiple conduit (trapeze) hangers: Not less than 38 mm by 38 mm (1-1/2 by 1-1/2 inch), 12 gage steel, cold formed, lipped channels; with not less than 9 mm (3/8 inch) diameter steel hanger rods.
- D. Solid Masonry and Concrete Anchors: Self-drilling expansion shields, or machine bolt expansion.

## **2.6 OUTLET, JUNCTION, AND PULL BOXES**

- A. UL-50 and UL-514A.
- B. Cast metal where required by the NEC or shown, and equipped with rustproof boxes.
- C. Nonmetallic Outlet and Device Boxes: NEMA OS 2.
- D. Metal Floor Boxes: Cast or sheet metal, semi-adjustable, rectangular.
- E. Sheet metal boxes: Galvanized steel, except where otherwise shown.
- F. Flush mounted wall or ceiling boxes shall be installed with raised covers so that front face of raised cover is flush with the wall. Surface mounted wall or ceiling boxes shall be installed with surface style flat or raised covers.

## **2.7 CABINETS**

- A. NEMA 250, Type 1, galvanized-steel box with removable interior panel and removable front, finished inside and out with manufacturer's standard enamel.
- B. Hinged door in front cover with flush latch and concealed hinge.
- C. Key latch to match panelboards.
- D. Metal barriers to separate wiring of different systems and voltage.
- E. Accessory feet where required for freestanding equipment.

## **2.8 WIREWAYS**

- A. Equip with hinged covers, except where removable covers are shown.

## **2.9 WARNING TAPE**

- A. Standard, 4-Mil polyethylene 76 mm (3 inches) wide tape non-detectable type, red with black letters, and imprinted with "CAUTION BURIED ELECTRONIC SAFETY AND SECURITY CABLE BELOW".

## **2.10 SLEEVES FOR RACEWAYS**

- A. Steel Pipe Sleeves: ASTM A 53/A 53M, Type E, Grade B, Schedule 40, galvanized steel, plain ends.

- B. Cast-Iron Pipe Sleeves: Cast or fabricated "wall pipe," equivalent to ductile-iron pressure pipe, with plain ends and integral waterstop, unless otherwise indicated.
- C. Sleeves for Rectangular Openings: Galvanized sheet steel with minimum 0.052- or 0.138-inch (1.3- or 3.5-mm) thickness as indicated and of length to suit application.
- D. Coordinate sleeve selection and application with selection and application of firestopping specified in Division 07 84 00 "FIRESTOPPING."

## **2.11 SLEEVE SEALS**

- A. Description: Modular sealing device, designed for field assembly, to fill annular space between sleeve and cable.
  - 1. Sealing Elements: EPDM interlocking links shaped to fit surface of cable or conduit. Include type and number required for material and size of raceway or cable.
  - 2. Pressure Plates: Carbon steel. Include two for each sealing element.
  - 3. Connecting Bolts and Nuts: Carbon steel with corrosion-resistant coating of length required to secure pressure plates to sealing elements. Include one for each sealing element.

## **2.12 GROUT**

- A. Nonmetallic, Shrinkage-Resistant Grout: ASTM C 1107, factory-packaged, nonmetallic aggregate grout, noncorrosive, nonstaining, mixed with water to consistency suitable for application and a 30-minute working time.

# **PART 3 - EXECUTION**

## **3.1 PENETRATIONS**

- A. Cutting or Holes:
  - 1. Locate holes in advance where they are proposed in the structural sections such as ribs or beams. Obtain the approval of the COR prior to drilling through structural sections.
  - 2. Cut holes through concrete and masonry in new and existing structures with a diamond core drill or concrete saw. Pneumatic hammer, impact electric, hand or manual hammer type drills are not allowed, except where permitted by the COR as required by limited working space.
- B. Fire Stop: Where conduits, wireways, and other electronic safety and security raceways pass through fire partitions, fire walls, smoke partitions, or floors, install a fire stop that provides an effective barrier against the spread of fire, smoke and gases as specified in Section 07 84 00, FIRESTOPPING, with rock wool fiber or silicone foam

sealant only. Completely fill and seal clearances between raceways and openings with the fire stop material.

- C. Waterproofing: At floor, exterior wall, and roof conduit penetrations, completely seal clearances around the conduit and make watertight as specified in Section 07 92 00, "JOINT SEALANTS".

### **3.2 INSTALLATION, GENERAL**

A. Install conduit as follows:

1. In complete runs before pulling in cables or wires.
2. Flattened, dented, or deformed conduit is not permitted. Remove and replace the damaged conduits with new undamaged material.
3. Assure conduit installation does not encroach into the ceiling height head room, walkways, or doorways.
4. Cut square with a hacksaw, ream, remove burrs, and draw up tight.
5. Mechanically continuous.
6. Independently support conduit at 2.4 m (8 foot) on center. Do not use other supports i.e., (suspended ceilings, suspended ceiling supporting members, lighting fixtures, conduits, mechanical piping, or mechanical ducts).
7. Support within 300 mm (12 inches) of changes of direction, and within 300 mm (12 inches) of each enclosure to which connected.
8. Close ends of empty conduit with plugs or caps at the rough-in stage to prevent entry of debris, until wires are pulled in.
9. Conduit installations under fume and vent hoods are prohibited.
10. Secure conduits to cabinets, junction boxes, pull boxes and outlet boxes with bonding type locknuts. For rigid and IMC conduit installations, provide a locknut on the inside of the enclosure, made up wrench tight. Do not make conduit connections to junction box covers.
11. Flashing of penetrations of the roof membrane is specified in Section 07 60 00, "FLASHING AND SHEET METAL".
12. Do not use aluminum conduits in wet locations.
13. Unless otherwise indicated on the drawings or specified herein, all conduits shall be installed concealed within finished walls, floors and ceilings.

B. Conduit Bends:

1. Make bends with standard conduit bending machines.
2. Conduit hickey may be used for slight offsets, and for straightening stubbed out conduits.
3. Bending of conduits with a pipe tee or vise is prohibited.



C. Layout and Homeruns:

1. Install conduit with wiring, including homeruns, as shown.
2. Deviations: Make only where necessary to avoid interferences and only after drawings showing the proposed deviations have been submitted approved by the COR.

D. Fire Alarm:

1. Fire alarm conduit shall be painted red (a red "top-coated" conduit from the conduit manufacturer may be used in lieu of painted conduit) in accordance with the requirements of Section 28 31 00, "FIRE DETECTION AND ALARM".

**3.3 CONCEALED WORK INSTALLATION**

A. In Concrete:

1. Conduit: Rigid steel, IMC or EMT. Do not install EMT in concrete slabs that are in contact with soil, gravel or vapor barriers.
2. Align and run conduit in direct lines.
3. Install conduit through concrete beams only when the following occurs:
  - a. Where shown on the structural drawings.
  - b. As approved by the COR prior to construction, and after submittal of drawing showing location, size, and position of each penetration.
4. Installation of conduit in concrete that is less than 75 mm (3 inch) thick is prohibited.
  - a. Conduit outside diameter larger than 1/3 of the slab thickness is prohibited.
  - b. Space between conduits in slabs: Approximately six conduit diameters apart, except one conduit diameter at conduit crossings.
  - c. Install conduits approximately in the center of the slab so that there will be a minimum of 19 mm (3/4 inch) of concrete around the conduits.
5. Make couplings and connections watertight. Use thread compounds that are UL approved conductive type to insure low resistance ground continuity through the conduits. Tightening set screws with pliers is prohibited.

B. Furred or Suspended Ceilings and in Walls:

1. Conduit for conductors above 600 volts:
  - a. Rigid steel or rigid aluminum.
  - b. Aluminum conduit mixed indiscriminately with other types in the same system is prohibited.

2. Conduit for conductors 600 volts and below:
  - a. Rigid steel, IMC, rigid aluminum, or EMT. Different type conduits mixed indiscriminately in the same system is prohibited.
3. Align and run conduit parallel or perpendicular to the building lines.
4. Connect recessed lighting fixtures to conduit runs with maximum 1800 mm (6 feet) of flexible metal conduit extending from a junction box to the fixture.
5. Tightening set screws with pliers is prohibited.

### **3.4 EXPOSED WORK INSTALLATION**

- A. Unless otherwise indicated on the drawings, exposed conduit is only permitted in mechanical and electrical rooms.
- B. Conduit for Conductors 600 volts and below:
  1. Rigid steel, IMC, rigid aluminum, or EMT. Different type of conduits mixed indiscriminately in the system is prohibited.
- C. Align and run conduit parallel or perpendicular to the building lines.
- D. Install horizontal runs close to the ceiling or beams and secure with conduit straps.
- E. Support horizontal or vertical runs at not over 2400 mm (eight foot) intervals.
- F. Surface metal raceways: Use only where shown.
- G. Painting:
  1. Paint exposed conduit as specified in Section 09 91 00, "PAINTING".
  2. Paint all conduits containing cables rated over 600 volts safety orange. Refer to Section 09 91 00, "PAINTING" for preparation, paint type, and exact color. In addition, paint legends, using 50 mm (two inch) high black numerals and letters, showing the cable voltage rating. Provide legends where conduits pass through walls and floors and at maximum 6000 mm (20 foot) intervals in between.

### **3.5 EXPANSION JOINTS**

- A. Conduits 75 mm (3 inches) and larger, that are secured to the building structure on opposite sides of a building expansion joint, require expansion and deflection couplings. Install the couplings in accordance with the manufacturer's recommendations.
- B. Provide conduits smaller than 75 mm (3 inches) with junction boxes on both sides of the expansion joint. Connect conduits to junction boxes with sufficient slack of flexible conduit to produce 125 mm (5 inch) vertical drop midway between the ends. Flexible conduit shall have a copper green ground bonding jumper installed. In lieu of this flexible

conduit, expansion and deflection couplings as specified above for 375 mm (15 inches) and larger conduits are acceptable.

C. Install expansion and deflection couplings where shown.

### **3.6 CONDUIT SUPPORTS, INSTALLATION**

- A. Safe working load shall not exceed 1/4 of proof test load of fastening devices.
- B. Use pipe straps or individual conduit hangers for supporting individual conduits. Maximum distance between supports is 2.5 m (8 foot) on center.
- C. Support multiple conduit runs with trapeze hangers. Use trapeze hangers that are designed to support a load equal to or greater than the sum of the weights of the conduits, wires, hanger itself, and 90 kg (200 pounds). Attach each conduit with U-bolts or other approved fasteners.
- D. Support conduit independently of junction boxes, pull boxes, fixtures, suspended ceiling T-bars, angle supports, and similar items.
- E. Fasteners and Supports in Solid Masonry and Concrete:
  - 1. New Construction: Use steel or malleable iron concrete inserts set in place prior to placing the concrete.
  - 2. Existing Construction:
    - a. Steel expansion anchors not less than 6 mm (1/4 inch) bolt size and not less than 28 mm (1-1/8 inch) embedment.
    - b. Power set fasteners not less than 6 mm (1/4 inch) diameter with depth of penetration not less than 75 mm (3 inches).
    - c. Use vibration and shock resistant anchors and fasteners for attaching to concrete ceilings.
- F. Hollow Masonry: Toggle bolts are permitted.
- G. Bolts supported only by plaster or gypsum wallboard are not acceptable.
- H. Metal Structures: Use machine screw fasteners or other devices specifically designed and approved for the application.
- I. Attachment by wood plugs, rawl plug, plastic, lead or soft metal anchors, or wood blocking and bolts supported only by plaster is prohibited.
- J. Chain, wire, or perforated strap shall not be used to support or fasten conduit.
- K. Spring steel type supports or fasteners are prohibited for all uses except: Horizontal and vertical supports/fasteners within walls.
- L. Vertical Supports: Vertical conduit runs shall have riser clamps and supports in accordance with the NEC and as shown. Provide supports for cable and wire with fittings that include internal wedges and retaining collars.

### **3.7 BOX INSTALLATION**

- A. Boxes for Concealed Conduits:
  - 1. Flush mounted.
  - 2. Provide raised covers for boxes to suit the wall or ceiling, construction and finish.
- B. In addition to boxes shown, install additional boxes where needed to prevent damage to cables and wires during pulling in operations.
- C. Remove only knockouts as required and plug unused openings. Use threaded plugs for cast metal boxes and snap-in metal covers for sheet metal boxes.
- D. Outlet boxes in the same wall mounted back-to-back are prohibited. A minimum 600 mm (24 inch), center-to-center lateral spacing shall be maintained between boxes).
- E. Minimum size of outlet boxes for ground fault interrupter (GFI) receptacles is 100 mm (4 inches) square by 55 mm (2-1/8 inches) deep, with device covers for the wall material and thickness involved.
- F. Stencil or install phenolic nameplates on covers of the boxes identified on riser diagrams; for example "SIG-FA JB No. 1".
- G. On all Branch Circuit junction box covers, identify the circuits with black marker.

### **3.8 ELECTRONIC SAFETY AND SECURITY CONDUIT**

- A. Install the electronic safety and security raceway system as shown on drawings.
- B. Minimum conduit size of 19 mm (3/4 inch), but not less than the size shown on the drawings.
- C. All conduit ends shall be equipped with insulated bushings.
- D. All 100 mm (four inch) conduits within buildings shall include pull boxes after every two 90 degree bends. Size boxes per the NEC.
- E. Vertical conduits/sleeves through closets floors shall terminate not less than 75 mm (3 inches) below the floor and not less than 75 mm (3 inches) below the ceiling of the floor below.
- F. Terminate conduit runs to/from a backboard in a closet or interstitial space at the top or bottom of the backboard. Conduits shall enter communication closets next to the wall and be flush with the backboard.
- G. Where drilling is necessary for vertical conduits, locate holes so as not to affect structural sections such as ribs or beams.
- H. All empty conduits located in communications closets or on backboards shall be sealed with a standard non-hardening duct seal compound to

prevent the entrance of moisture and gases and to meet fire resistance requirements.

- I. Conduit runs shall contain no more than four quarter turns (90 degree bends) between pull boxes/backboards. Minimum radius of communication conduit bends shall be as follows (special long radius):

Sizes of Conduit Trade Size	Radius of Conduit Bends mm, Inches
$\frac{3}{4}$	150 (6)
1	230 (9)
1-1/4	350 (14)
1-1/2	430 (17)
2	525 (21)
2-1/2	635 (25)
3	775 (31)
3-1/2	900 (36)
4	1125 (45)

- J. Furnish and install 19 mm (3/4 inch) thick fire retardant plywood specified in on the wall of communication closets where shown on drawings . Mount the plywood with the bottom edge 300 mm (one foot) above the finished floor.
- K. Furnish and pull wire in all empty conduits. (Sleeves through floor are exceptions).

### 3.9 COMMISSIONING

- A. Provide commissioning documentation in accordance with the requirements of Section 28 08 00 - "COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS" for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 28 08 00, "COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS" and related sections for contractor responsibilities for system commissioning.

- - - E N D - - -



**SECTION 28 08 00**

**COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. The requirements of this Section apply to all sections of Division 28.
- B. This project will have selected building systems commissioned. The complete list of equipment and systems to be commissioned are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. The commissioning process, which the Contractor is responsible to execute, is defined in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS. A Commissioning Agent (CxA) appointed by the VA will manage the commissioning process.

**1.2 RELATED WORK**

- A. Section 01 00 00 GENERAL REQUIREMENTS.
- B. Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.
- C. Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.

**1.3 SUMMARY**

- A. This Section includes requirements for commissioning the electronic safety and security systems, subsystems and equipment. This Section supplements the general requirements specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.
- B. The commissioning activities have been developed to support the VA requirements to meet guidelines for Federal Leadership in Environmental, Energy, and Economic Performance.

**1.4 DEFINITIONS**

- A. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS for definitions.

**1.5 COMMISSIONED SYSTEMS**

- A. Commissioning of a system or systems specified in Division 28 is part of the construction process. Documentation and testing of these systems, as well as training of the VA's Operation and Maintenance personnel in accordance with the requirements of Section 01 91 00 and of Division 28, is required in cooperation with the VA and the Commissioning Agent.
- B. The Facility exterior closure systems commissioning will include the systems listed in Section 01 19 00 General Commissioning Requirements:

## **1.6 SUBMITTALS**

- A. The commissioning process requires review of selected Submittals. The Commissioning Agent will provide a list of submittals that will be reviewed by the Commissioning Agent. This list will be reviewed and approved by the VA prior to forwarding to the Contractor. Refer to Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, and SAMPLES for further details.
- B. The commissioning process requires Submittal review simultaneously with engineering review. Specific submittal requirements related to the commissioning process are specified in Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS.

## **PART 2 - PRODUCTS (NOT USED)**

## **PART 3 - EXECUTION**

### **3.1 CONSTRUCTION INSPECTIONS**

- A. Commissioning of Electronic Safety and Security systems will require inspection of individual elements of the electronic safety and security systems throughout the construction period. Contractor shall coordinate with the Commissioning Agent in accordance with Section 01 19 00 and the Commissioning plan to schedule electronic safety and security systems inspections as required to support the Commissioning Process.

### **3.2 PRE-FUNCTIONAL CHECKLISTS**

- A. Contractor shall complete Pre-Functional Checklists to verify systems, subsystems, and equipment installation is complete and systems are ready for Systems Functional Performance Testing. Commissioning Agent will prepare Pre-Functional Checklists to be used to document equipment installation. Contractor shall complete the checklists. Completed checklists shall be submitted to the VA and to Commissioning Agent for review. Commissioning Agent may spot check a sample of completed checklists. If Commissioning Agent determines that the information provided on the checklist is not accurate, Commissioning Agent will return the marked-up checklist to Contractor for correction and resubmission. If Commissioning Agent determines that a significant number of completed checklists for similar equipment are not accurate, Commissioning Agent will select a broader sample of checklists for review. If Commissioning Agent determines that a significant number of the broader sample of checklists is also inaccurate, all the checklists for the type of equipment will be returned to the Contractor for correction and resubmission. Refer to SECTION 01 91 00 GENERAL



COMMISSIONING REQUIREMENTS for submittal requirements for Pre-Functional Checklists, Equipment Startup Reports, and other commissioning documents.

### **3.3 CONTRACTORS TESTS**

- A. Contractor tests as required by other sections of Division 28 shall be scheduled and documented in accordance with Section 01 00 00 GENERAL REQUIREMENTS. All testing shall be incorporated into project schedule. Contractor shall provide no less than 7 calendar days' notice of testing. Commissioning Agent will witness selected Contractor tests at the sole discretion of Commissioning Agent. Contractor tests shall be completed prior to scheduling Systems Functional Performance Testing.

### **3.4 SYSTEMS FUNCTIONAL PERFORMANCE TESTING:**

- A. The Commissioning Process includes Systems Functional Performance Testing that is intended to test systems functional performance under steady state conditions, to test system reaction to changes in operating conditions, and system performance under emergency conditions. Commissioning Agent will prepare detailed Systems Functional Performance Test procedures for review and approval by the Contracting Officer's Representative (COR). Contractor shall review and comment on the tests prior to approval. Contractor shall provide the required labor, materials, and test equipment identified in the test procedure to perform the tests. Commissioning Agent will witness and document the testing. Contractor shall sign the test reports to verify tests were performed. See Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS, for additional details.

### **3.5 TRAINING OF VA PERSONNEL**

- A. Training of the VA's operation and maintenance personnel is required in cooperation with the COR and Commissioning Agent. Provide competent, factory authorized personnel to provide instruction to operation and maintenance personnel concerning the location, operation, and troubleshooting of the installed systems. Contractor shall submit training agendas and trainer resumes in accordance with the requirements of Section 01 19 00. The instruction shall be scheduled in coordination with the COR after submission and approval of formal training plans. Refer to Section 01 91 00 GENERAL COMMISSIONING REQUIREMENTS and Division 28 Sections for additional Contractor training requirements.

----- END -----



**SECTION 28 13 00**  
**PHYSICAL ACCESS CONTROL SYSTEM**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section specifies the finishing, installation, connection, testing and certification of a complete and fully operating Physical Access Control System as an extension of the existing system, hereinafter referred to as the PACS.
- B. This Section includes a Physical Access Control System consisting of a field-installed Controllers connected by a high-speed electronic data transmission network. The PACS shall have the following:
  - 1. Physical Access Control:
    - a. Regulating access through doors.
    - b. Credential cards and readers
    - c. Biometric identity verification equipment
    - d. RS-232 ASCII interface
- C. System Architecture:
  - 1. Criticality, operational requirements, and/or limiting points of failure may dictate the development of an enterprise and regional server architecture as opposed to system capacity. Provide server and workstation configurations with all necessary connectors, interfaces and accessories as shown.
- D. PACS shall provide secure and reliable identification of Federal employees and contractors by utilizing credential authentication per FIPS-201.
- E. Physical Access Control System (PACS) shall consist of:
  - 1. Field installed controllers,
  - 2. Card readers,
  - 3. Biometric identification devices,
  - 4. Door locks and sensors,
  - 5. Power supplies,
  - 6. Interfaces with:
    - a. Video Surveillance and Assessment System,
    - b. Automatic door operators,
- F. Information system supporting PACS, routers and controllers shall comply with FIPS 200 requirements (Minimum Security Requirements for Federal Information and Information Systems) and NIST Special

Publication 800-53 (Recommended Security Controls for Federal Information Systems).

- G. All security relevant decisions shall be made on "secure side of the door". Secure side processing shall include;
  - 1. Challenge/response management,
  - 2. PKI path discovery and validation,
  - 3. Credential identifier processing,
  - 4. Authorization decisions.
- H. System Software: Based on existing central-station, workstation operating system, server operating system, and application software.
- I. Software and controllers shall be capable of matching full 56 bit FASC-N plus minimum of 32 bits of public key certificate data.

## **1.2 RELATED WORK**

- A. Section 01 00 00 - GENERAL REQUIREMENTS. For General Requirements.
- B. Section 07 84 00 - FIRESTOPPING. Requirements for firestopping application and use.
- C. Section 08 71 00 - DOOR HARDWARE. Requirements for door installation.
- D. Section 26 05 11 - REQUIREMENTS FOR ELECTRICAL INSTALLATIONS. Requirements for connection of high voltage.
- E. Section 26 05 21 - LOW VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW). Requirements for power cables.
- F. Section 26 05 33 - RACEWAYS AND BOXES FOR ELECTRICAL SYSTEMS. Requirements for infrastructure.
- G. Section 28 05 00 - COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY. For general requirements that are common to more than one section in Division 28.
- H. Section 28 05 13 - CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for conductors and cables.
- I. Section 28 05 26 - GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY. Requirements for grounding of equipment.
- J. Section 28 05 28.33 - CONDUITS AND BOXES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for infrastructure.
- K. Section 28 08 00 - COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY. For requirements for commissioning, systems readiness checklists, and training.
- L. Section 28 23 00 - VIDEO SURVEILLANCE. Requirements for security camera systems.

### 1.3 QUALITY ASSURANCE

- A. Refer to 25 05 00 COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY, Part 1.
- B. The Contractor shall be responsible for providing, installing, and the operation of the PACS as shown. The Contractor shall also provide certification as required.
- C. The security system will be installed and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the security system is stand-alone or a part of a complete Information Technology (IT) computer network.
- D. Manufacturers Qualifications: The manufacturer shall regularly and presently produce, as one of the manufacturer's principal products, the equipment and material specified for this project, and shall have manufactured the item for at least three years.
- E. Product Qualifications:
  - 1. Manufacturer's product shall have been in satisfactory operation, on three installations of similar size and type as this project, for approximately three years.
  - 2. The Government reserves the right to require the Contractor to submit a list of installations where the products have been in operation before approval.
- F. Contractor Qualifications:
  - 1. The Contractor or security sub-contractor shall be a licensed security Contractor with a minimum of five (5) years experience installing and servicing systems of similar scope and complexity. The Contractor shall be an authorized regional representative of the Security Management System's (PACS) manufacturer. The Contractor shall provide four (4) current references from clients with systems of similar scope and complexity which became operational in the past three (3) years. At least three (3) of the references shall be utilizing the same system components, in a similar configuration as the proposed system. The references must include a current point of contact, company or agency name, address, telephone number, complete system description, date of completion, and approximate cost of the project. The owner reserves the option to visit the reference sites, with the site owner's permission and representative, to

verify the quality of installation and the references' level of satisfaction with the system. The Contractor shall provide copies of system manufacturer certification for all technicians. The Contractor shall only utilize factory-trained technicians to install, program, and service the PACS. The Contractor shall only utilize factory-trained technicians to install, terminate and service controller/field panels and reader modules. The technicians shall have a minimum of five (5) continuous years of technical experience in electronic security systems. The Contractor shall have a local service facility. The facility shall be located within 60 miles of the project site. The local facility shall include sufficient spare parts inventory to support the service requirements associated with this contract. The facility shall also include appropriate diagnostic equipment to perform diagnostic procedures. The Contracting Officers Representative (COR) reserves the option of surveying the company's facility to verify the service inventory and presence of a local service organization.

- a. The Contractor shall provide proof project superintendent with BICSI Certified Commercial Installer Level 1, Level 2, or Technician to provide oversight of the project.
  - b. Cable installer must have on staff a Registered Communication Distribution Designer (RCDD) certified by Building Industry Consulting Service International. The staff member shall provide consistent oversight of the project cabling throughout design, layout, installation, termination and testing.
- G. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within eight hours of receipt of notification that service is needed. Submit name and address of service organizations.

#### **1.4 SUBMITTALS**

- A. Refer to 25 05 00 COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY, Part 1
- B. Submit below items in conjunction with Master Specification Sections 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, Section 02 41 00, DEMOLITION, and Section 28 05 00 COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY.

- C. Provide certificates of compliance with Section 1.3, Quality Assurance.
- D. Provide a complete and thorough pre-installation and as-built design package in both electronic format and on paper, minimum size 48 x 48 inches (1220 x 1220 millimeters); drawing submittals shall be per the established project schedule.
- E. Shop drawing and as-built packages shall include, but not be limited to:
  - 1. Index Sheet that shall:
    - a. Define each page of the design package to include facility name, building name, floor, and sheet number.
    - b. Provide a complete list of all security abbreviations and symbols.
    - c. Reference all general notes that are utilized within the design package.
    - d. Specification and scope of work pages for all individual security systems that are applicable to the design package that will:
      - 1) Outline all general and job specific work required within the design package.
      - 2) Provide a detailed device identification table outlining device Identification (ID) and use for all security systems equipment utilized in the design package.
  - 2. Drawing sheets that will be plotted on the individual floor plans or site plans shall:
    - a. Include a title block as defined above.
    - b. Clearly define the drawings scale in both standard and metric measurements.
    - c. Provide device identification and location.
    - d. Address all signal and power conduit runs and sizes that are associated with the design of the electronic security system and other security elements (e.g., barriers, etc.).
    - e. Identify all pull box and conduit locations, sizes, and fill capacities.
    - f. Address all general and drawing specific notes for a particular drawing sheet.
  - 3. A detailed riser drawing for each applicable security subsystem shall:
    - a. Indicate the sequence of operation.

- b. Relationship of integrated components on one diagram.
  - c. Include the number, size, identification, and maximum lengths of interconnecting wires.
  - d. Wire/cable types shall be defined by a wire and cable schedule.  
The schedule shall utilize a lettering system that will correspond to the wire/cable it represents (example: A = 18 AWG/1 Pair Twisted, Unshielded). This schedule shall also provide the manufacturer's name and part number for the wire/cable being installed.
4. A detailed system drawing for each applicable security system shall:
- a. Clearly identify how all equipment within the system, from main panel to device, shall be laid out and connected.
  - b. Provide full detail of all system components wiring from point-to-point.
  - c. Identify wire types utilized for connection, interconnection with associate security subsystems.
  - d. Show device locations that correspond to the floor plans.
  - e. All general and drawing specific notes shall be included with the system drawings.
5. A detailed schedule for all of the applicable security subsystems shall be included. All schedules shall provide the following information:
- a. Device ID.
  - b. Device Location (e.g. site, building, floor, room number, location, and description).
  - c. Mounting type (e.g. flush, wall, surface, etc.).
  - d. Power supply or circuit breaker and power panel number.
  - e. In addition, for the PACS, provide the door ID, door type (e.g. wood or metal), locking mechanism (e.g. strike or electromagnetic lock) and control device (e.g. card reader or biometrics).
6. Detail and elevation drawings for all devices that define how they were installed and mounted.
- F. Pre-installation design packages shall go through a full review process conducted by the Contractor along with a VA representative to ensure all work has been clearly defined and completed. All reviews shall be conducted in accordance with the project schedule. There shall be four (4) stages to the review process:



1. 35 percent
  2. 65 percent
  3. 90 percent
  4. 100 percent
- G. Provide manufacturer security system product cut-sheets. Submit for approval at least 30 days prior to commencement of formal testing, a Security System Operational Test Plan. Include procedures for operational testing of each component and security subsystem, to include performance of an integrated system test.
- H. Submit manufacture's certification of Underwriters Laboratories, Inc. (UL) listing as specified. Provide all maintenance and operating manuals per Section 01 00 00, GENERAL REQUIREMENTS, and Section 28 05 00 COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY.
- I. Completed System Readiness Checklists provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 28 08 00 COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS.
- J. General: Submittals shall be in full compliance of the Contract Documents. All submittals shall be provided in accordance with this section. Submittals lacking the breath or depth these requirements will be considered incomplete and rejected. Submissions are considered multidisciplinary and shall require coordination with applicable divisions to provide a complete and comprehensive submission package. Additional general provisions are as follows:
1. The Contractor shall schedule submittals in order to maintain the project schedule. For coordination drawings refer to Specification Section 01 33 10 - DESIGN SUBMITTAL PROCEDURES, which outline basic submittal requirements and coordination. Section 01 33 10 shall be used in conjunction with this section.
  2. The Contractor shall identify variations from requirements of Contract Documents and state product and system limitations, which may be detrimental to successful performance of the completed work or system.
  3. Each package shall be submitted at one (1) time for each review and include components from applicable disciplines (e.g., electrical work, architectural finishes, door hardware, etc.) which are

required to produce an accurate and detailed depiction of the project.

4. Manufacturer's information used for submittal shall have pages with items for approval tagged, items on pages shall be identified, and capacities and performance parameters for review shall be clearly marked through use of an arrow or highlighting. Provide space for COR and Contractor review stamps.
5. Technical Data Drawings shall be in the latest version of AutoCAD®, drawn accurately, and in accordance with VA CAD Standards. FREEHAND SKETCHES OR COPIED VERSIONS OF THE CONSTRUCTION DOCUMENTS WILL NOT BE ACCEPTED. The Contractor shall not reproduce Contract Documents or copy standard information as the basis of the Technical Data Drawings. If departures from the technical data drawings are subsequently deemed necessary by the Contractor, details of such departures and the reasons thereof shall be submitted in writing to the COR for approval before the initiation of work.
6. Packaging: The Contractor shall organize the submissions according to the following packaging requirements.
  - a. Binders: For each manual, provide heavy duty, commercial quality, durable three (3) ring vinyl covered loose leaf binders, sized to receive 8.5 x 11 in paper, and appropriate capacity to accommodate the contents. Provide a clear plastic sleeve on the spine to hold labels describing the contents. Provide pockets in the covers to receive folded sheets.
    - 1) Where two (2) or more binders are necessary to accommodate data, correlate data in each binder into related groupings according to the Project Manual table of contents. Cross-referencing other binders where necessary to provide essential information for communication of proper operation and or maintenance of the component or system.
    - 2) Identify each binder on the front and spine with printed binder title, Project title or name, and subject matter covered. Indicate the volume number if applicable.
  - b. Dividers: Provide heavy paper dividers with celluloid tabs for each Section. Mark each tab to indicate contents.

- c. Protective Plastic Jackets: Provide protective transparent plastic jackets designed to enclose diagnostic software for computerized electronic equipment.
- d. Text Material: Where written material is required as part of the manual use the manufacturer's standard printed material, or if not available, specially prepared data, neatly typewritten on 8.5 inches by 11 inches 20 pound white bond paper.
- e. Drawings: Where drawings and/or diagrams are required as part of the manual, provide reinforced punched binder tabs on the drawings and bind them with the text.
  - 1) Where oversized drawings are necessary, fold the drawings to the same size as the text pages and use as a foldout.
  - 2) If drawings are too large to be used practically as a foldout, place the drawing, neatly folded, in the front or rear pocket of the binder. Insert a type written page indicating the drawing title, description of contents and drawing location at the appropriate location of the manual.
  - 3) Drawings shall be sized to ensure details and text is of legible size. Text shall be no less than 1/16" tall.
- f. Manual Content: In each manual include information specified in the individual Specification section, and the following information for each major component of building equipment and controls:
  - 1) General system or equipment description.
  - 2) Design factors and assumptions.
  - 3) Copies of applicable Shop Drawings and Product Data.
  - 4) System or equipment identification including: manufacturer, model and serial numbers of each component, operating instructions, emergency instructions, wiring diagrams, inspection and test procedures, maintenance procedures and schedules, precautions against improper use and maintenance, repair instructions, sources of required maintenance materials and related services, and a manual index.
- g. Binder Organization: Organize each manual into separate sections for each piece of related equipment. At a minimum, each manual shall contain a title page, table of contents, copies of Product Data supplemented by drawings and written text, and copies of

each warranty, bond, certifications, and service Contract issued. Refer to Group I through V Technical Data Package Submittal requirements for required section content.

- h. Title Page: Provide a title page as the first sheet of each manual to include the following information; project name and address, subject matter covered by the manual, name and address of the Project, date of the submittal, name, address, and telephone number of the Contractor, and cross references to related systems in other operating and/or maintenance manuals.
- i. Table of Contents: After the title page, include a type written table of contents for each volume, arranged systematically according to the Project Manual format. Provide a list of each product included, identified by product name or other appropriate identifying symbols and indexed to the content of the volume. Where more than one (1) volume is required to hold data for a particular system, provide a comprehensive table of contents for all volumes in each volume of the set.
- j. General Information Section: Provide a general information section immediately following the table of contents, listing each product included in the manual, identified by product name. Under each product, list the name, address, and telephone number of the installer and maintenance Contractor. In addition, list a local source for replacement parts and equipment.
- k. Drawings: Provide specially prepared drawings where necessary to supplement the manufacturers printed data to illustrate the relationship between components of equipment or systems, or provide control or flow diagrams. Coordinate these drawings with information contained in Project Record Drawings to assure correct illustration of the completed installation.
- l. Manufacturer's Data: Where manufacturer's standard printed data is included in the manuals, include only those sheets that are pertinent to the part or product installed. Mark each sheet to identify each part or product included in the installation. Where more than one (1) item in tabular format is included, identify each item, using appropriate references from the Contract Documents. Identify data that is applicable to the

installation and delete references to information which is not applicable.

- m. Where manufacturer's standard printed data is not available and the information is necessary for proper operation and maintenance of equipment or systems, or it is necessary to provide additional information to supplement the data included in the manual, prepare written text to provide the necessary information. Organize the text in a consistent format under a separate heading for different procedures. Where necessary, provide a logical sequence of instruction for each operating or maintenance procedure. Where similar or more than one product is listed on the submittal the Contractor shall differentiate by highlighting the specific product to be utilized.
  - n. Calculations: Provide a section for circuit and panel calculations.
  - o. Loading Sheets: Provide a section for DGP Loading Sheets.
  - p. Certifications: Provide section for Contractor's manufacturer certifications.
7. Contractor Review: Review submittals prior to transmittal. Determine and verify field measurements and field construction criteria. Verify manufacturer's catalog numbers and conformance of submittal with requirements of contract documents. Return non-conforming or incomplete submittals with requirements of the work and contract documents. Apply Contractor's stamp with signature certifying the review and verification of products occurred, and the field dimensions, adjacent construction, and coordination of information is in accordance with the requirements of the contract documents.
8. Resubmission: Revise and resubmit submittals as required within 15 calendar days of return of submittal. Make resubmissions under procedures specified for initial submittals. Identify all changes made since previous submittal.
9. Product Data: Within 15 calendar days after execution of the contract, the Contractor shall submit for approval a complete list of all of major products proposed for use. The data shall include name of manufacturer, trade name, model number, the associated

contract document section number, paragraph number, and the referenced standards for each listed product.

K. Group 1 Technical Data Package: Group I Technical Data Package shall be one submittal consisting of the following content and organization. Refer to VA Special Conditions Document for drawing format and content requirements. The data package shall include the following:

1. Section I - Drawings:

- a. General - Drawings shall conform to VA Special Conditions and CAD Standards Documents. All text associated with security details shall be 1/8" tall and meet VA text standard for AutoCAD™ drawings.
- b. Cover Sheet - Cover sheet shall consist of Project Title and Address, Project Number, Area and Vicinity Maps.
- c. General Information Sheets - General Information Sheets shall consist of General Notes, Abbreviations, Symbols, Wire and Cable Schedule, Project Phasing, and Sheet Index.
- d. Floor Plans - Floor plans shall be produced from the Architectural backgrounds issued in the Construction Documents. The contractor shall receive floor plans from the prime A/E to develop these drawing sets. Security devices shall be placed on drawings in scale. All text associated with security details shall be 1/8" tall and meet VA text standard for AutoCAD™ drawings. Floor plans shall identify the following:
  - 1) security devices by symbol,
  - 2) the associated device point number (derived from the loading sheets),
  - 3) wire & cable types and counts
  - 4) conduit sizing and routing
  - 5) conduit riser systems
  - 6) device and area detail call outs
- e. Architectural details - Architectural details shall be produced for each device mounting type (door details for doors with physical access control, reader pedestals and mounts, security panel and power supply details).
- f. Riser Diagrams - Contractor shall provide a riser diagram indicating riser architecture and distribution of the physical access control system throughout the facility (or area in scope).

- g. Block Diagrams - Contractor shall provide a block diagram for the entire system architecture and interconnections with SMS subsystems. Block diagram shall identify SMS subsystem (e.g., physical access control, intrusion detection, closed circuit television, intercom, and other associated subsystems) integration; and data transmission and media conversion methodologies.
- h. Interconnection Diagrams - Contractor shall provide interconnection diagram for each sensor, and device component. Interconnection diagram shall identify termination locations, standard wire detail to include termination schedule. Diagram shall also identify interfaces to other systems such as elevator control, fire alarm systems, and security management systems.
- i. Security Details:
  - 1) Panel Assembly Detail - For each panel assembly, a panel assembly details shall be provided identifying individual panel component size and content.
  - 2) Panel Details - Provide security panel details identify general arrangement of the security system components, backboard size, wire through size and location, and power circuit requirements.
  - 3) Device Mounting Details - Provide mounting detailed drawing for each security device (physical access control system, intrusion detection, video surveillance and assessment, and intercom systems) for each type of wall and ceiling configuration in project. Device details shall include device, mounting detail, wiring and conduit routing.
  - 4) Details of connections to power supplies and grounding
  - 5) Details of surge protection device installation
  - 6) Sensor detection patterns - Each system sensor shall have associated detection patterns.
  - 7) Equipment Rack Detail - For each equipment rack, provide a scaled detail of the equipment rack location and rack space utilization. Use of BISCII wire management standards shall be employed to identify wire management methodology. Transitions between equipment racks shall be shown to include use vertical and horizontal latter rack system.

- 8) Security Control Room - The contractor shall provide a layout plan for the Security Control Room. The layout plan shall identify all equipment and details associated with the installation.
- 9) Operator Console - The contractor shall provide a layout plan for the Operator Console. The layout plan shall identify all equipment and details associated with the installation.  
Equipment room - the contractor shall provide a layout plan for the equipment room. The layout plan shall identify all equipment and details associated with the installation.
- 10) Equipment Room - Equipment room details shall provide architectural, electrical, mechanical, plumbing, IT/Data and associated equipment and device placements both vertical and horizontally.
- j. Electrical Panel Schedule - Electrical Panel Details shall be provided for all SMS systems electrical power circuits. Panel details shall be provided identifying panel type (Standard, Emergency Power, Emergency/Uninterrupted Power Source, and Uninterrupted Power Source Only), panel location, circuit number, and circuit amperage rating.
- k. Door Schedule - A door schedule shall be developed for each door equipped with electronic security components. At a minimum, the door schedule shall be coordinated with Division 08 work and include the following information:
  - 1) Item Number
  - 2) Door Number (Derived from A/E Drawings)
  - 3) Floor Plan Sheet Number
  - 4) Standard Detail Number
  - 5) Door Description (Derived from Loading Sheets)
  - 6) Data Gathering Panel Input Number
  - 7) Door Position or Monitoring Device Type & Model Number
  - 8) Lock Type, Model Number & Power Input/Draw (standby/active)
  - 9) Card Reader Type & Model Number
  - 10) Shunting Device Type & Model Number
  - 11) Sounder Type & Model Number
  - 12) Manufacturer
  - 13) Misc. devices as required



- a) Delayed Egress Type & Model Number
  - b) Intercom
  - c) Camera
  - d) Electric Transfer Hinge
  - e) Electric Pass-through device
- 14) Remarks column indicating special notes or door configurations
2. Camera Schedule - A camera schedule shall be developed for each camera. Contractors shall coordinate with the COR to determine camera starting numbers and naming conventions. All drawings shall identify wire and cable standardization methodology. Color coding of all wiring conductors and jackets is required and shall be communicated consistently throughout the drawings package submittal. At a minimum, the camera schedule shall include the following information:
- a. Item Number
  - b. Camera Number
  - c. Naming Conventions
  - d. Description of Camera Coverage
  - e. Camera Location
  - f. Floor Plan Sheet Number
  - g. Camera Type
  - h. Mounting Type
  - i. Standard Detail Reference
  - j. Power Input & Draw
  - k. Power Panel Location
  - l. Remarks Column for Camera
3. Section IV - Manufacturers' Data: The data package shall include manufacturers' data for all materials and equipment, including sensors, local processors and console equipment provided under this specification.
4. Section VI - Certifications & References: All specified manufacturer's certifications shall be included with the data package. Contractor shall provide Project references as outlined in Paragraph 1.4 "Quality Assurance".
- K. Group II Technical Data Package
- 1. The Contractor shall prepare a report of "Current Site Conditions" and submit a report to the COR documenting changes to the site,

particularly those conditions that affect performance of the system to be installed. The Contractor shall provide specification sheets, or written functional requirements to support the findings, and a cost estimate to correct those site changes or conditions which affect the installation of the system or its performance. The Contractor shall not correct any deficiency without written permission from the COR.

2. System Configuration and Functionality: The contractor shall provide the results of the meeting with VA to develop system requirements and functionality including but not limited to:
  - a. Baseline configuration
  - b. Access levels
  - c. Schedules (intrusion detection, physical access control, holidays, etc.)
  - d. Badge database
  - e. System monitoring and reporting (unit level and central control)
  - f. Naming conventions and descriptors

L. Group III Technical Data Package

1. Development of Test Procedures: The Contractor will prepare performance test procedures for the system testing. The test procedures shall follow the format of the VA Testing procedures and be customized to the contract requirements. The Contractor will deliver the test procedures to the COR for approval at least 60 calendar days prior to the requested test date.

M. Group IV Technical Data Package

1. Performance Verification Test
  - a. Based on the successful completion of the pre-delivery test, the Contractor shall finalize the test procedures and report forms for the performance verification test (PVT) and the endurance test. The PVT shall follow the format, layout and content of the pre-delivery test. The Contractor shall deliver the PVT and endurance test procedures to the COR for approval. The Contractor may schedule the PVT after receiving written approval of the test procedures. The Contractor shall deliver the final PVT and endurance test reports within 14 calendar days from completion of the tests. Refer to Part 3 of this section for System Testing and Acceptance requirements.

## 2. Training Documentation

- a. New Facilities and Major Renovations: Familiarization training shall be provided for new equipment or systems. Training can include site familiarization training for VA technicians and administrative personnel. Training shall include general information on new system layout including closet locations, turnover of the completed system including all documentation, including manuals, software, key systems, and full system administration rights. Lesson plans and training manuals training shall be oriented to type of training to be provided.
- N. Group V Technical Data Package: Final copies of the manuals shall be delivered to the COR as part of the acceptance test. The draft copy used during site testing shall be updated with any changes required prior to final delivery of the manuals. Each manual's contents shall be identified on the cover. The manual shall include names, addresses, and telephone numbers of each sub-contractor installing equipment or systems, as well as the nearest service representatives for each item of equipment for each system. The manuals shall include a table of contents and tab sheets. Tab sheets shall be placed at the beginning of each chapter or section and at the beginning of each appendix. The final copies delivered after completion of the endurance test shall include all modifications made during installation, checkout, and acceptance. Six (6) hard-copies and one (1) soft copy on CD of each item listed below shall be delivered as a part of final systems acceptance.
1. Functional Design Manual: The functional design manual shall identify the operational requirements for the entire system and explain the theory of operation, design philosophy, and specific functions. A description of hardware and software functions, interfaces, and requirements shall be included for all system operating modes. Manufacturer developed literature may be used; however, shall be produced to match the project requirements.
  2. Equipment Manual: A manual describing all equipment furnished including:
    - a. General description and specifications; installation and checkout procedures; equipment electrical schematics and layout drawings; system schematics and layout drawings; alignment and calibration

procedures; manufacturer's repair list indicating sources of supply; and interface definition.

3. Software Manual: The software manual shall describe the functions of all software and include all other information necessary to enable proper loading, testing, and operation. The manual shall include:
  - a. Definition of terms and functions; use of system and applications software; procedures for system initialization, start-up, and shutdown; alarm reports; reports generation, database format and data entry requirements; directory of all disk files; and description of all communications protocols including data formats, command characters, and a sample of each type of data transfer.
4. Operator's Manual: The operator's manual shall fully explain all procedures and instructions for the operation of the system, including:
  - a. Computers and peripherals; system start-up and shutdown procedures; use of system, command, and applications software; recovery and restart procedures; graphic alarm presentation; use of report generator and generation of reports; data entry; operator commands' alarm messages, and printing formats; and system access requirements.
5. Maintenance Manual: The maintenance manual shall include descriptions of maintenance for all equipment including inspection, recommend schedules, periodic preventive maintenance, fault diagnosis, and repair or replacement of defective components.
6. Spare Parts & Components Data: At the conclusion of the Contractor's work, the Contractor shall submit to the COR a complete list of the manufacturer's recommended spare parts and components required to satisfactorily maintain and service the systems, as well as unit pricing for those parts and components.
7. Operation, Maintenance & Service Manuals: The Contractor shall provide two (2) complete sets of operating and maintenance manuals in the form of an instructional manual for use by the VA Security Guard Force personnel. The manuals shall be organized into suitable sets of manageable size. Where possible, assemble instructions for

similar equipment into a single binder. If multiple volumes are required, each volume shall be fully indexed and coordinated.

8. Equipment and Systems Maintenance Manual: The Contractor shall provide the following descriptive information for each piece of equipment, operating system, and electronic system:
  - a. Equipment and/or system function.
  - b. Operating characteristics.
  - c. Limiting conditions.
  - d. Performance curves.
  - e. Engineering data and test.
  - f. Complete nomenclature and number of replacement parts.
  - g. Provide operating and maintenance instructions including assembly drawings and diagrams required for maintenance and a list of items recommended to stock as spare parts.
  - h. Provide information detailing essential maintenance procedures including the following: routine operations, trouble shooting guide, disassembly, repair and re-assembly, alignment, adjusting, and checking.
  - i. Provide information on equipment and system operating procedures, including the following; start-up procedures, routine and normal operating instructions, regulation and control procedures, instructions on stopping, shut-down and emergency instructions, required sequences for electric and electronic systems, and special operating instructions.
  - j. Manufacturer equipment and systems maintenance manuals are permissible.
9. Project Redlines: During construction, the Contractor shall maintain an up-to-date set of construction redlines detailing current location and configuration of the project components. The redline documents shall be marked with the words 'Master Redlines' on the cover sheet and be maintained by the Contractor in the project office. The Contractor will provide access to redline documents anytime during the project for review and inspection by the COR or authorized Office of Protection Services representative. Master redlines shall be neatly maintained throughout the project and secured under lock and key in the contractor's onsite project office. Any project component or assembly that is not installed in

- strict accordance with the drawings shall be so noted on the drawings. Prior to producing Record Construction Documents, the contractor will submit the Master Redline document to the COR for review and approval of all changes or modifications to the documents. Each sheet shall have COR initials indicating authorization to produce "As Built" documents. Field drawings shall be used for data gathering & field changes. These changes shall be made to the master redline documents daily. Field drawings shall not be considered "master redlines".
10. Record Specifications: The Contractor shall maintain one (1) copy of the Project Specifications, including addenda and modifications issued, for Project Record Documents. The Contractor shall mark the Specifications to indicate the actual installation where the installation varies substantially from that indicated in the Contract Specifications and modifications issued. (Note related Project Record Drawing information where applicable). The Contractor shall pay particular attention to substitutions, selection of product options, and information on concealed installations that would be difficult to identify or measure and record later. Upon completion of the mark ups, the Contractor shall submit record Specifications to the COR. As with master relines, Contractor shall maintain record specifications for COR review and inspection at anytime.
11. Record Product Data: The Contractor shall maintain one (1) copy of each Product Data submittal for Project Record Document purposes. The Data shall be marked to indicate the actual product installed where the installation varies substantially from that indicated in the Product Data submitted. Significant changes in the product delivered to the site and changes in manufacturer's instructions and recommendations for installation shall be included. Particular attention will be given to information on concealed products and installations that cannot be readily identified or recorded later. Note related Change Orders and mark up of Record Construction Documents, where applicable. Upon completion of mark up, submit a complete set of Record Product Data to the COR.
12. Miscellaneous Records: The Contractor shall maintain one (1) copy of miscellaneous records for Project Record Document purposes.

Refer to other Specifications for miscellaneous record-keeping requirements and submittals concerning various construction activities. Before substantial completion, complete miscellaneous records and place in good order, properly identified and bound or filed, ready for use and reference. Categories of requirements resulting in miscellaneous records include, a minimum of the following:

- a. Certificates received instead of labels on bulk products.
  - b. Testing and qualification of tradesmen. ("Contractor's Qualifications")
  - c. Documented qualification of installation firms.
  - d. Load and performance testing.
  - e. Inspections and certifications.
  - f. Final inspection and correction procedures.
  - g. Project schedule
13. Record Construction Documents (Record As-Built)
- a. Upon project completion, the contractor shall submit the project master redlines to the COR prior to development of Record construction documents. The COR shall be given a minimum of a thirty (30) day review period to determine the adequacy of the master redlines. If the master redlines are found suitable by the COR, the COR will initial and date each sheet and turn redlines over to the contractor for as built development.
  - b. The Contractor shall provide the COR a complete set of "as-built" drawings and original master redlined marked "as-built" blue-line in the latest version of AutoCAD drawings unlocked on CD or DVD. The as-built drawing shall include security device number, security closet connection location, data gathering panel number, and input or output number as applicable. All corrective notations made by the Contractor shall be legible when submitted to the COR. If, in the opinion of the COR, any redlined notation is not legible, it shall be returned to the Contractor for re-submission at no extra cost to the Owner. The Contractor shall organize the Record Drawing sheets into manageable sets bound with durable paper cover sheets with suitable titles, dates, and other identifications printed on the cover. The submitted as

built shall be in editable formats and the ownership of the drawings shall be fully relinquished to the owner.

- c. Where feasible, the individual or entity that obtained record data, whether the individual or entity is the installer, sub-contractor, or similar entity, is required to prepare the mark up on Record Drawings. Accurately record the information in a comprehensive drawing technique. Record the data when possible after it has been obtained. For concealed installations, record and check the mark up before concealment. At the time of substantial completion, submit the Record Construction Documents to the COR. The Contractor shall organize into bound and labeled sets for the COR's continued usage. Provide device, conduit, and cable lengths on the conduit drawings. Exact in-field conduit placement/routings shall be shown. All conduits shall be illustrated in their entire length from termination in security closets; no arrowed conduit runs shall be shown. Pull box and junction box sizes are to be shown if larger than 100mm (4 inch).

O. FIPS 201 Compliance Certificates

1. Provide Certificates for all software components and device types utilizing credential verification. Provide certificates for:

- a. Fingerprint Capture Station
- b. Card Readers
- c. Facial Image Capturing Camera
- d. PIV Middleware
- e. Template Matcher
- f. Electromagnetically Opaque Sleeve
- g. Certificate Management
  - 1) CAK Authentication System
  - 2) PIV Authentication System
  - 3) Certificate Validator
  - 4) Cryptographic Module

P. Approvals will be based on complete submission of manuals together with shop drawings.

Q. Completed System Readiness Checklists provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the



requirements of Section 28 08 00 COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS.

#### 1.5 APPLICABLE PUBLICATIONS

- A. Refer to 25 05 00 COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY, Part 1
- B. The publications listed below (including amendments, addenda, revisions, supplement, and errata) form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- C. American National Standards Institute (ANSI)/ Security Industry Association (SIA):
  - AC-03.....Access Control: Access Control Guideline Dye Sublimation Printing Practices for PVC Access Control Cards
  - TVAC-01.....CCTV to Access Control Standard - Message Set for System Integration
- D. American National Standards Institute (ANSI)/ International Code Council (ICC):
  - A117.1.....Standard on Accessible and Usable Buildings and Facilities
- E. Department of Justice American Disability Act (ADA)
  - 28 CFR Part 36.....ADA Standards for Accessible Design 2010
- F. Department of Veterans Affairs (VA):
  - PACS-R: Physical Access Control System (PACS) Requirements
  - VA Handbook 0730 Security and Law Enforcement
- G. Government Accountability Office (GAO):
  - GAO-03-8-02 Security Responsibilities for Federally Owned and Leased Facilities
- H. National Electrical Contractors Association
  - 303-2005.....Installing Closed Circuit Television (CCTV) Systems
- I. National Electrical Manufacturers Association (NEMA):
  - 250-08.....Enclosures for Electrical Equipment (1000 Volts Maximum)
- J. National Fire Protection Association (NFPA):
  - 70-11..... National Electrical Code
- K. Underwriters Laboratories, Inc. (UL):

- 294-99.....The Standard of Safety for Access Control  
System Units
- 305-08.....Standard for Panic Hardware
- 639-97.....Standard for Intrusion-Detection Units
- 752-05.....Standard for Bullet-Resisting Equipment
- 827-08.....Central Station Alarm Services
- 1076-95.....Standards for Proprietary Burglar Alarm Units  
and Systems
- 1981-03.....Central Station Automation System
- 2058-05.....High Security Electronic Locks
- L. Homeland Security Presidential Directive (HSPD):
  - HSPD-12.....Policy for a Common Identification Standard for  
Federal Employees and Contractors
- M. Federal Communications Commission (FCC):
  - (47 CFR 15) Part 15 Limitations on the Use of Wireless  
Equipment/Systems
- N. Federal Information Processing Standards (FIPS):
  - FIPS-201-1.....Personal Identity Verification (PIV) of Federal  
Employees and Contractors
- O. National Institute of Standards and Technology (NIST):
  - IR 6887 V2.1.....Government Smart Card Interoperability  
Specification (GSC-IS)
  - Special Pub 800-63.....Electronic Authentication Guideline
  - Special Pub 800-96.....PIV Card Reader Interoperability Guidelines
  - Special Pub 800-73-3.....Interfaces for Personal Identity Verification  
(4 Parts)
    - .....Pt. 1- End Point PIV Card Application  
Namespace, Data Model & Representation
    - .....Pt. 2- PIV Card Application Card Command  
Interface
    - .....Pt. 3- PIV Client Application Programming  
Interface
    - .....Pt. 4- The PIV Transitional Interfaces & Data  
Model Specification
  - Special Pub 800-76-1.....Biometric Data Specification for Personal  
Identity Verification

- Special Pub 800-78-2....Cryptographic Algorithms and Key Sizes for  
Personal Identity Verification
- Special Pub 800-79-1....Guidelines for the Accreditation of Personal  
Identity Verification Card Issuers
- Special Pub 800-85B-1...DRAFTPIV Data Model Test Guidelines
- Special Pub 800-85A-2...PIV Card Application and Middleware Interface  
Test Guidelines (SP 800-73-3 compliance)
- Special Pub 800-96.....PIV Card Reader Interoperability Guidelines
- Special Pub 800-37.....Guide for Applying the Risk Management  
Framework to Federal Information Systems
- Special Pub 800-96.....PIV Card Reader Interoperability Guidelines
- Special Pub 800-96.....PIV Card Reader Interoperability Guidelines
- Special Pub 800-104A....Scheme for PIV Visual Card Topography
- Special Pub 800-116.....Recommendation for the Use of PIV Credentials  
in Physical Access Control Systems (PACS)
- P. Institute of Electrical and Electronics Engineers (IEEE):
- C62.41.....IEEE Recommended Practice on Surge Voltages in  
Low-Voltage AC Power Circuits
- Q. International Organization for Standardization (ISO):
- 7810.....Identification cards - Physical characteristics
- 7811.....Physical Characteristics for Magnetic Stripe  
Cards
- 7816-1.....Identification cards - Integrated circuit(s)  
cards with contacts - Part 1: Physical  
characteristics
- 7816-2.....Identification cards - Integrated circuit cards  
- Part 2: Cards with contacts -Dimensions and  
location of the contacts
- 7816-3.....Identification cards - Integrated circuit cards  
- Part 3: Cards with contacts - Electrical  
interface and transmission protocols
- 7816-4.....Identification cards - Integrated circuit cards  
- Part 11: Personal verification through  
biometric methods
- 7816-10.....Identification cards - Integrated circuit cards  
- Part 4: Organization, security and commands  
for interchange

14443.....Identification cards - Contactless integrated  
circuit cards; Contactless Proximity Cards  
Operating at 13.56 MHz in up to 5 inches  
distance

15693.....Identification cards -- Contactless integrated  
circuit cards - Vicinity cards; Contactless  
Vicinity Cards Operating at 13.56 MHz in up to  
50 inches distance

19794.....Information technology - Biometric data  
interchange formats

R. Uniform Federal Accessibility Standards (UFAS) 1984

S. ADA Standards for Accessible Design 2010

T. Section 508 of the Rehabilitation Act of 1973

## **1.6 DEFINITIONS**

A. ABA Track: Magnetic stripe that is encoded on track 2, at 75-bpi density in binary-coded decimal format; for example, 5-bit, 16-character set.

B. Access Control List: A list of (identifier, permissions) pairs associated with a resource or an asset. As an expression of security policy, a person may perform an operation on a resource or asset if and only if the person's identifier is present in the access control list (explicitly or implicitly), and the permissions in the (identifier, permissions) pair include the permission to perform the requested operation.

C. Access Control: A function or a system that restricts access to authorized persons only.

D. API Application Programming Interface

E. Assurance Level (or E-Authentication Assurance Level): A measure of trust or confidence in an authentication mechanism defined in OMB Memorandum M-04-04 and NIST Special Publication (SP) 800-63, in terms of four levels: [M-04-04]

1. Level 1: LITTLE OR NO confidence

2. Level 2: SOME confidence

3. Level 3: HIGH confidence

4. Level 4: VERY HIGH confidence

- F. Authentication: A process that establishes the origin of information, or determines an entity's identity. In this publication, authentication often means the performance of a PIV authentication mechanism.
- G. Authenticator: A memory, possession, or quality of a person that can serve as proof of identity, when presented to a verifier of the appropriate kind. For example, passwords, cryptographic keys, and fingerprints are authenticators.
- H. Authorization: A process that associates permission to access a resource or asset with a person and the person's identifier(s).
- I. BIO or BIO-A: A FIPS 201 authentication mechanism that is implemented by using a Fingerprint data object sent from the PIV Card to the PACS. Note that the short-hand "BIO (-A)" is used throughout the document to represent both BIO and BIO-A authentication mechanisms.
- J. Biometric: An authenticator produced from measurable qualities of a living person.
- K. CAC EP - CAC End Point with end point PIV applet
- L. CAC NG - CAC Next Generation with transitional PIV applet
- M. Card Authentication Key (CAK): A PIV authentication mechanism (or the PIV Card key of the same name) that is implemented by an asymmetric or symmetric key challenge/response protocol. The CAK is an optional mechanism defined in NIST SP 800-73. [SP800-73] NIST strongly recommends that every PIV Card contain an asymmetric CAK and corresponding certificate, and that agencies use the asymmetric CAK protocol, rather than a symmetric CAK protocol, whenever the CAK authentication mechanism is used with PACS.
- N. CCTV: Closed-circuit television.
- O. Central Station: A PC with software designated as the main controlling PC of the PACS. Where this term is presented with initial capital letters, this definition applies.
- P. Controller: An intelligent peripheral control unit that uses a computer for controlling its operation. Where this term is presented with an initial capital letter, this definition applies.
- Q. CPU: Central processing unit.
- R. Credential: Data assigned to an entity and used to identify that entity.
- S. File Server: A PC in a network that stores the programs and data files shared by users.

- T. FIPS Federal Information Processing Standards
- U. FRAC - First Responder Authentication Credential
- V. HSPD Homeland Security Presidential Directive
- W. I/O: Input/Output.
- X. Identifier: A credential card, keypad personal identification number or code, biometric characteristic, or other unique identification entered as data into the entry-control database for the purpose of identifying an individual. Where this term is presented with an initial capital letter, this definition applies.
- Y. IEC International Electrotechnical Commission
- Z. ISO International Organization for Standardization
- AA. KB Kilobyte
- BB. kbit/s Kilobits / second
- CC. LAN: Local area network.
- DD. LED: Light-emitting diode.
- EE. Legacy CAC - Contact only Common Access Card with v1 and v2 applets
- FF. Location: A Location on the network having a PC-to-Controller communications link, with additional Controllers at the Location connected to the PC-to-Controller link with RS-485 communications loop. Where this term is presented with an initial capital letter, this definition applies.
- GG. NIST: National Institute of Standards and Technology
- HH. PACS: Physical Access Control System
- II. PC/SC: Personal Computer / Smart Card
- JJ. PC: Personal computer. This acronym applies to the Central Station, workstations, and file servers.
- KK. PCI Bus: Peripheral component interconnect; a peripheral bus providing a high-speed data path between the CPU and peripheral devices (such as monitor, disk drive, or network).
- LL. PDF: (Portable Document Format.) The file format used by the Acrobat document exchange system software from Adobe.
- MM. PIV: Personal Identification Verification
- NN. PIV-I - PIV Interoperable credential
- OO. PPS: Protocol and Parameters Selection
- PP. RF: Radio frequency.
- QQ. ROM: Read-only memory. ROM data are maintained through losses of power.

RR. RS-232: An TIA/EIA standard for asynchronous serial data communications between terminal devices. This standard defines a 25-pin connector and certain signal characteristics for interfacing computer equipment.

SS. RS-485: An TIA/EIA standard for multipoint communications.

TT. TCP/IP: Transport control protocol/Internet protocol incorporated into Microsoft Windows.

UU. TPDU: Transport Protocol Data Unit

VV. TWIC - Transportation Worker Identification Credential

WW. UPS: Uninterruptible power supply.

XX. Vcc: Voltage at the Common Collector

YY. WAN: Wide area network.

ZZ. WAV: The digital audio format used in Microsoft Windows.

AAA. Wiegand: Patented magnetic principle that uses specially treated wires embedded in the credential card.

BBB. Windows: Operating system by Microsoft Corporation.

CCC. Workstation: A PC with software that is configured for specific limited security system functions.

#### **1.7 COORDINATION**

- A. Coordinate arrangement, mounting, and support of electronic safety and security equipment:
1. To allow maximum possible headroom unless specific mounting heights that reduce headroom are indicated.
  2. To provide for ease of disconnecting the equipment with minimum interference to other installations.
  3. To allow right of way for piping and conduit installed at required slope.
  4. So connecting raceways, cables, wireways, cable trays, and busways will be clear of obstructions and of the working and access space of other equipment.
- B. Coordinate installation of required supporting devices and set sleeves in cast-in-place concrete, masonry walls, and other structural components as they are constructed.
- C. Coordinate location of access panels and doors for electronic safety and security items that are behind finished surfaces or otherwise concealed.

## **1.8 MAINTENANCE & SERVICE**

### **A. General Requirements**

1. The Contractor shall provide all services required and equipment necessary to maintain the entire integrated electronic security system in an operational state as specified for a period of one (1) year after formal written acceptance of the system. The Contractor shall provide all necessary material required for performing scheduled adjustments or other non-scheduled work. Impacts on facility operations shall be minimized when performing scheduled adjustments or other non-scheduled work. See also General Project Requirements.

### **B. Description of Work**

1. The adjustment and repair of the security system includes all software updates, panel firmware, and the following new items computers equipment, communications transmission equipment and data transmission media (DTM), local processors, security system sensors, physical access control equipment, facility interface, signal transmission equipment, and video equipment.

### **C. Personnel**

1. Service personnel shall be certified in the maintenance and repair of the selected type of equipment and qualified to accomplish all work promptly and satisfactorily. The COR shall be advised in writing of the name of the designated service representative, and of any change in personnel. The COR shall be provided copies of system manufacturer certification for the designated service representative.

### **D. Schedule of Work**

1. The work shall be performed during regular working ours, Monday through Friday, excluding federal holidays. These inspections shall include:
  - a) The Contractor shall perform two (2) minor inspections at six (6) month intervals or more if required by the manufacturer, and two (2) major inspections offset equally between the minor inspections to effect quarterly inspection of alternating magnitude.
    - 1) Minor Inspections shall include visual checks and operational tests of all console equipment, peripheral equipment, local



processors, sensors, electrical and mechanical controls, and adjustments on printers.

- 2) Major Inspections shall include all work described for Minor Inspections and the following: clean all system equipment and local processors including interior and exterior surfaces; perform diagnostics on all equipment; operational tests of the CPU, switcher, peripheral equipment, recording devices, monitors, picture quality from each camera; check, walk test, and calibrate each sensor; run all system software diagnostics and correct all problems; and resolve any previous outstanding problems.

#### E. Emergency Service

1. The owner shall initiate service calls whenever the system is not functioning properly. The Contractor shall provide the Owner with an emergency service center telephone number. The emergency service center shall be staffed 24 hours a day 365 days a year. The Owner shall have sole authority for determining catastrophic and non-catastrophic system failures within parameters stated in General Project Requirements.
  - a. For catastrophic system failures, the Contractor shall provide same day four (4) hour service response with a defect correction time not to exceed eight (8) hours from notification.

Catastrophic system failures are defined as any system failure that the Owner determines will place the facility(s) at increased risk.
  - b. For non-catastrophic failures, the Contractor within eight (8) hours with a defect correction time not to exceed 24 hours from notification.

#### F. Operation

1. Performance of scheduled adjustments and repair shall verify operation of the system as demonstrated by the applicable portions of the performance verification test.

#### G. Records & Logs

1. The Contractor shall maintain records and logs of each task and organize cumulative records for each component and for the complete system chronologically. A continuous log shall be submitted for all devices. The log shall contain all initial settings, calibration,

repair, and programming data. Complete logs shall be maintained and available for inspection on site, demonstrating planned and systematic adjustments and repairs have been accomplished for the system.

#### H. Work Request

1. The Contractor shall separately record each service call request, as received. The record shall include the serial number identifying the component involved, its location, date and time the call was received, specific nature of trouble, names of service personnel assigned to the task, instructions describing the action taken, the amount and nature of the materials used, and the date and time of commencement and completion. The Contractor shall deliver a record of the work performed within five (5) working days after the work was completed.

#### I. System Modifications

1. The Contractor shall make any recommendations for system modification in writing to the COR. No system modifications, including operating parameters and control settings, shall be made without prior written approval from the COR. Any modifications made to the system shall be incorporated into the operation and maintenance manuals and other documentation affected.

#### J. Software

1. The Contractor shall provide all software updates when approved by the Owner from the manufacturer during the installation and 12-month warranty period and verify operation of the system. These updates shall be accomplished in a timely manner, fully coordinated with the system operators, and incorporated into the operations and maintenance manuals and software documentation. There shall be at least one (1) scheduled update near the end of the first year's warranty period, at which time the Contractor shall install and validate the latest released version of the Manufacturer's software. All software changes shall be recorded in a log maintained in the unit control room. An electronic copy of the software update shall be maintained within the log. At a minimum, the contractor shall provide a description of the modification, when the modification occurred, and name and contact information of the individual

performing the modification. The log shall be maintained in a white 3 ring binder and the cover marked "SOFTWARE CHANGE LOG".

#### **1.9 PERFORMANCE REQUIREMENTS**

- A. PACS shall provide support for multiple authentication modes and bidirectional communication with the reader. PACS shall provide implementation capability for enterprise security policy and incident response.
- B. All processing of authentication information must occur on the "safe side" of a door
- C. Physical Access Control System shall provide access to following Security Areas:
  - 1. Controlled
  - 2. Limited
  - 3. Exclusion
- D. PACS shall provide:
  - 1. One authentication factor for access to Controlled security areas
  - 2. Two authentication factors for access to Limited security areas
  - 3. Three authentication factors for access to Exclusion security areas
- E. PACS shall provide Credential Validation and Path Validation per NIST 800-116.
- F. Distributed Processing: System shall be a fully distributed processing system so that information, including time, date, valid codes, access levels, and similar data, is downloaded to Controllers so that each Controller makes access-control decisions for that Location. Do not use intermediate Controllers for physical access control. If communications to Central Station are lost, all Controllers shall automatically buffer event transactions until communications are restored, at which time buffered events shall be uploaded to the Central Station.
- G. System Network Requirements:
  - 1. Interconnect system components and provide automatic communication of status changes, commands, field-initiated interrupts, and other communications required for proper system operation.
- H. Field equipment shall include Controllers, sensors, and controls. Controllers shall serve as an interface between the Central Station and sensors and controls. Data exchange between the Central Station and the Controllers shall include down-line transmission of commands, software,

and databases to Controllers. The up-line data exchange from the Controller to the Central Station shall include status data such as intrusion alarms, status reports, and entry-control records.

Controllers are classified as alarm-annunciation or entry-control type.

- I. Door Hardware Interface: Coordinate with Division 08 Sections that specify door hardware required to be monitored or controlled by the PACS. The Controllers in this Section shall have electrical characteristics that match the signal and power requirements of door hardware. Integrate door hardware specified in Division 08 Sections to function with the controls and PC-based software and hardware in this Section.
- J. References to industry and trade association standards and codes are minimum installation requirement standards.
- K. Drawings and other specification sections shall govern in those instances where requirements are greater than those specified in the above standards.

#### **1.10 EQUIPMENT AND MATERIALS**

- A. Materials and equipment furnished shall be of current production by manufacturers regularly engaged in the manufacture of such items, for which replacement parts shall be available.
- B. When more than one unit of the same class of equipment is required, such units shall be the product of a single manufacturer.
- C. Equipment Assemblies and Components:
  - 1. Components of an assembled unit need not be products of the same manufacturer.
  - 2. Manufacturers of equipment assemblies, which include components made by others, shall assume complete responsibility for the final assembled unit.
  - 3. Components shall be compatible with each other and with the total assembly for the intended service.
  - 4. Constituent parts which are similar shall be the product of a single manufacturer.
- D. Factory wiring shall be identified on the equipment being furnished and on all wiring diagrams.
- E. When Factory Testing Is Specified:

1. The Government shall have the option of witnessing factory tests.  
The contractor shall notify the VA through the COR a minimum of 15 working days prior to the manufacturers making the factory tests.
2. Four copies of certified test reports containing all test data shall be furnished to the COR prior to final inspection and not more than 90 days after completion of the tests.
3. When equipment fails to meet factory test and re-inspection is required, the contractor shall be liable for all additional expenses, including expenses of the Government.

#### **1.11 WARRANTY OF CONSTRUCTION.**

- A. Warrant PACS work subject to the Article "Warranty of Construction" of FAR clause 52.246-21.
- B. Demonstration and training shall be performed prior to system acceptance.

#### **1.12 GENERAL REQUIREMENTS**

- A. For general requirements that are common to more than one section in Division 28 refer to Section 28 05 00, REQUIREMENTS FOR ELECTRONIC SAFETY AND SECURITY INSTALLATIONS.
- B. General requirements applicable to this section include:
  1. General Arrangement Of Contract Documents,
  2. Delivery, Handling and Storage,
  3. Project Conditions,
  4. Electrical Power,
  5. Lightning, Power Surge Suppression, and Grounding,
  6. Electronic Components,
  7. Substitute Materials and Equipment, and
  8. Like Items.

### **PART 2 - PRODUCTS**

#### **2.1 GENERAL**

- A. All equipment and materials for the system will be compatible to ensure correct operation as outlined in FIPS 201, March 2006 and HSPD-12.
- B. The security system characteristics listed in this section will serve as a guide in selection of equipment and materials for the PACS. If updated or more suitable versions are available then the Contracting Officer will approve the acceptance of prior to an installation.
- C. PACS equipment shall meet or exceed all requirements listed below.

D. A PACS shall be comprised of, but not limited to, the following components:

1. Controllers (Data Gathering Panel)
2. Card Readers
3. Biometric Identity Verification Equipment
4. Interfaces
5. Door Hardware interface
6. RS-232 ASCII Interface
7. Cables

## **2.2 CONTROLLERS**

- A. Controllers: Intelligent peripheral control unit, complying with UL 294, that stores time, date, valid codes, access levels, and similar data downloaded from the Central Station or workstation for controlling its operation.
- B. Subject to compliance with requirements in this Article, manufacturers may use multipurpose Controllers.
- C. Battery Backup: Sealed, lead acid; sized to provide run time during a power outage of 90 minutes, complying with UL 924.
- D. Alarm Annunciation Controller:
1. The Controller shall automatically restore communication within 10 seconds after an interruption with the field device network[ with dc line supervision on each of its alarm inputs].
    - a. Inputs: Monitor dry contacts for changes of state that reflect alarm conditions. Provides at least eight alarm inputs, which are suitable for wiring as normally open or normally closed contacts for alarm conditions.
    - b. Alarm-Line Supervision:
      - 1) Supervise the alarm lines by monitoring each circuit for changes or disturbances in the signal[, and for conditions as described in UL 1076 for line security equipment] [by monitoring for abnormal open, grounded, or shorted conditions] using dc change measurements. System shall initiate an alarm in response to an abnormal current, which is a dc change of [5] [10] percent or more for longer than 500 ms.
      - 2) Transmit alarm-line-supervision alarm to the Central Station during the next interrogation cycle after the abnormal current condition.

- c. Outputs: Managed by Central Station software.
- 2. Auxiliary Equipment Power: A GFI service outlet inside the Controller enclosure.
- E. Entry-Control Controller:
  - 1. Function: Provide local entry-control functions including one- and two-way communications with access-control devices such as card readers, keypads, biometric personal identity verification devices, door strikes, magnetic latches, gate and door operators, and exit push-buttons.
    - a. Operate as a stand-alone portal Controller using the downloaded database during periods of communication loss between the Controller and the field-device network.
    - b. Accept information generated by the entry-control devices; automatically process this information to determine valid identification of the individual present at the portal:
      - 1) On authentication of the credentials or information presented, check privileges of the identified individual, allowing only those actions granted as privileges.
      - 2) Privileges shall include, but not be limited to, time of day control, day of week control, group control, and visitor escort control.
    - c. Maintain a date-, time-, and Location-stamped record of each transaction. A transaction is defined as any successful or unsuccessful attempt to gain access through a controlled portal by the presentation of credentials or other identifying information.
  - 2. Inputs:
    - a. Data from entry-control devices; use this input to change modes between access and secure.
    - b. Database downloads and updates from the Central Station that include enrollment and privilege information.
  - 3. Outputs:
    - a. Indicate success or failure of attempts to use entry-control devices and make comparisons of presented information with stored identification information.

- b. Grant or deny entry by sending control signals to portal-control devices[ and mask intrusion alarm annunciation from sensors stimulated by authorized entries].
  - c. Maintain a date-, time-, and Location-stamped record of each transaction and transmit transaction records to the Central Station.
  - d. Door Prop Alarm: If a portal is held open for longer than [20 seconds] [time listed in a schedule], alarm sounds.
4. With power supplies sufficient to power at voltage and frequency required for field devices and portal-control devices.
5. Data Line Problems: For periods of loss of communications with Central Station, or when data transmission is degraded and generating continuous checksum errors, the Controller shall continue to control entry by accepting identifying information, making authentication decisions, checking privileges, and controlling portal-control devices.
- a. Store up to 1000 transactions during periods of communication loss between the Controller and access-control devices for subsequent upload to the Central Station on restoration of communication.
6. Controller Power: NFPA 70, Class II power supply transformer, with 12- or 24-V ac secondary, backup battery and charger.
- a. Backup Battery: Premium, valve-regulated, recombinant-sealed, lead-calcium battery; spill proof; with a full 1-year warranty and a pro rata 19-year warranty. With single-stage, constant-voltage-current, limited battery charger, comply with battery manufacturer's written instructions for battery terminal voltage and charging current recommendations for maximum battery life.
  - b. Backup Battery: Valve-regulated, recombinant-sealed, lead-acid battery; spill proof. With single-stage, constant-voltage-current, limited battery charger, comply with battery manufacturer's written instructions for battery terminal voltage and charging current recommendations for maximum battery life.
  - c. Backup Power Supply Capacity: 5 minutes of battery supply. Submit battery and charger calculations.
  - d. Power Monitoring: Provide manual dynamic battery load test, initiated and monitored at the control center; with automatic



disconnection of the Controller when battery voltage drops below Controller limits. Report by using local Controller-mounted LEDs and by communicating status to Central Station. Indicate normal power on and battery charger on trickle charge. Indicate and report the following:

- 1) Trouble Alarm: Normal power off load assumed by battery.
- 2) Trouble Alarm: Low battery.
- 3) Alarm: Power off.

## **2.3 CARD READERS**

- A. Power: Card reader shall be powered from its associated Controller, including its standby power source.
- B. Response Time: Card reader shall respond to passage requests by generating a signal that is sent to the Controller. Response time shall be 800ms or less, from the time the card reader finishes reading the credential card until a response signal is generated.
- C. Enclosure: Suitable for surface, semiflush, or pedestal mounting. Mounting types shall additionally be suitable for installation in the following locations:
  1. Indoors, controlled environment.
  2. Indoors, uncontrolled environment.
  3. Outdoors, with built-in heaters or other cold-weather equipment to extend the operating temperature range as needed for operation at the site.
- D. Display: LED or other type of visual indicator display shall provide visual[ and audible] status indications and user prompts. Indicate power on/off, whether user passage requests have been accepted or rejected, and whether the door is locked or unlocked.
- E. Shall be utilized for controlling the locking hardware on a door and allows for reporting back to the main control panel with the time/date the door was accessed, the name of the person accessing the point of entry, and its location.
- F. Will be fully programmable and addressable, locally and remotely, and hardwired to the system.
- G. Shall be individually home run to the main panel.
- H. Shall be installed in a manner that they comply with:
  1. The Uniform Federal Accessibility Standards (UFAS)
  2. The Americans with Disabilities Act (ADA)

### 3. The ADA Standards for Accessible Design

- I. Shall support a variety of card readers that must encompass a wide functional range. The PACS may combine any of the card readers described below for installations requiring multiple types of card reader capability (i.e., card only, card and/or PIN, card and/or biometrics, card and/or pin and/or biometrics, supervised inputs, etc.). These card readers shall be available in the approved technology to meet FIPS 201, and is ISO 14443 A or B, ISO/IEC 7816 compliant. The reader output can be Wiegand, RS-22, 485 or TCP/IP.
- J. Shall be housed in an aluminum bezel with a wide lead-in for easy card entry.
- K. Shall contain read head electronics, and a sender to encode digital door control signals.
- L. LED's shall be utilized to indicate card reader status and access status.
- M. Shall be able to support a user defined downloadable off-line mode of operation (e.g. locked, unlocked), which will go in effect during loss of communication with the main control panel.
- N. Shall provide audible feedback to indicate access granted/denied decisions. Upon a card swipe, two audible tones or beeps shall indicate access granted and three tones or beeps shall indicate access denied. All keypad buttons shall provide tactile audible feedback.
- O. Shall have a minimum of two programmable inputs and two programmable outputs.
- P. All card readers that utilize keypad controls along with a reader and shall meet the following specifications:
  - 1. Entry control keypads shall use a unique combination of alphanumeric and other symbols as an identifier. Keypads shall contain an integral alphanumeric/special symbols keyboard with symbols arranged in ascending ASCII code ordinal sequence. Communications protocol shall be compatible with the local processor.
- Q. Shall include a Light Emitting Diode (LED) or other type of visual indicator display and provide visual or visual and audible status indications and user prompts. The display shall indicate power on/off, and whether user passage requests have been accepted or rejected. The design of the keypad display or keypad enclosure shall limit the maximum horizontal and vertical viewing angles of the keypad. The

maximum horizontal viewing angle shall be plus and minus five (5) degrees or less off a vertical plane perpendicular to the plane of the face of the keypad display. The maximum vertical viewing angle shall be plus and minus 15 degrees or less off a horizontal plane perpendicular to the plane of the face of the keypad display.

1. Shall respond to passage requests by generating a signal to the local processor. The response time shall be 800 milliseconds or less from the time the last alphanumeric symbol is entered until a response signal is generated.
2. Shall be powered from the source as designed and shall not dissipate more than 150 Watts.
3. Shall be suitable for surface, semi-flush, pedestal, or weatherproof mounting as required.
4. Shall provide a means for users to indicate a duress situation by entering a special code.

R. PIV Contact Card Reader

1. Application Protocol Data Unit (APDU) Support: At a minimum, the contact interface shall support all card commands for contact based access specified in Section 7, End-point PIV Card Application Card Command Interface of SP 800-73-1, Interfaces for Personal Identity Verification.
2. Buffer Size: The reader must contain a buffer large enough to receive the maximum size frame permitted by International Organization for Standardization International Electrotechnical Commission (ISO/IEC) 7816-3:1997, Section 9.4.
3. Programming Voltage: PIV Readers shall not generate a Programming Voltage.
4. Support for Operating Class: PIV Readers shall support cards with Class A Vccs as defined in ISO/IEC 7816-3:1997 and ISO/IEC 7816-3:1997/Amd 1:2002.
5. Retrieval Time: Retrieval time<sup>1</sup> for 12.5 kilobytes (KB) of data through the contact interface of the reader shall not exceed 2.0 seconds.

6. Transmission Protocol: The PIV Reader shall support both the character-based T=0 protocol and block-based T=1 protocol as defined in ISO/IEC 7816-3:1997.
7. Support for PPS Procedure: The reader shall support Protocol and Parameters Selection (PPS) procedure by having the ability to read character TA1 of the Answer to Reset (ATR) sent by the card as defined in ISO/IEC 7816-3:1997.

S. Contactless Smart Cards and Readers

1. Smart card readers shall read credential cards whose characteristics of size and technology meet those defined by ISO/IEC 7816, 14443, 15693.
2. The readers shall have "flash" download capability to accommodate card format changes.
3. The card reader shall have the capability of reading the card data and transmitting the data to the main monitoring panel.
4. The card reader shall be contactless and meet or exceed the following technical characteristics:
  - a. Data Output Formats: FIPS 201 low outputs the FASC-N in an assortment of Wiegand bit formats from 40 - 200 bits. FIPS 201 medium outputs a combination FASC-N and HMAC in an assortment of Wiegand bit formats from 32 - 232 bits. All Wiegand formats or the upgradeability from Low to Medium Levels can be field configured with the use of a command card.
  - b. FIPS 201 readers shall be able to read, but not be limited to, DESfire and iCLASS cards.
  - c. Reader range shall comply with ISO standards 7816, 14443, and 15693, and also take into consideration conditions, are at a minimum 1" to 2" (2.5 - 5 cm).
  - d. APDU Support: At a minimum, the contactless interface shall support all card commands for contactless based access specified in Section 7, End-point PIV Card Application Card Command Interface of SP 800-73-1, Interfaces for Personal Identity Verification.
  - e. Buffer Size: The reader shall contain a buffer large enough to receive the maximum size frame permitted by ISO/IEC 7816-3, Section 9.4.

- f. ISO 14443 Support: The PIV Reader shall support parts (1 through 4) of ISO/IEC 14443 as amended in the References of this publication.
- g. Type A and B Communication Signal Interfaces: The contactless interface of the reader shall support both the Type A and Type B communication signal interfaces as defined in ISO/IEC 14443-2:2001.
- h. Type A and B Initialization and Anti-Collision The contactless interface of the reader shall support both Type A and Type B initialization and anti-collision methods as defined in ISO/IEC 14443-3:2001.
- i. Type A and B Transmission Protocols: The contactless interface of the reader shall support both Type A and Type B transmission protocols as defined in ISO/IEC 14443-4:2001.
- j. Retrieval Time: Retrieval time for 4 KB of data through the contactless interface of the reader shall not exceed 2.0 seconds.
- k. Transmission Speeds: The contactless interface of the reader shall support bit rates of  $fc/128$  (~106 kbits/s),  $fc/64$  (~212 kbits/s), and configurable to allow activation/deactivation.
- l. Readability Range: The reader shall not be able to read PIV card more than 10cm(4inch) from the reader

#### **2.4 BIOMETRIC IDENTITY VERIFICATION EQUIPMENT**

- A. Shall be FIPS 201 and NIST SP 800-76 compliant.
- B. Shall utilize hand/palm, fingerprint, retinal, facial image, or voice verification and could be utilized as secondary authentication in conjunction with card readers in high security area as defined by the VA. (Note: VA policy requires that the use of biometric measurements is limited to secondary authentication in high or medium security applications).
- C. Shall be programmable, addressable, and hardwired directly to the main control panel and individually home run to the main control panel.
- D. Shall be installed in a manner that they comply with:
  - 1. The Uniform Federal Accessibility Standards (UFAS)
  - 2. The Americans with Disabilities Act (ADA)
  - 3. The ADA Standards for Accessible Design
- E. Shall include a means to construct individual templates or profiles based upon measurements taken from the person to be enrolled. This

template shall be stored as part of the System Reference Database Files. The stored template shall be used as a comparative base by the personnel identity verification equipment to generate appropriate signals to the associated local processors.

- F. Shall interface with PACS and SMS and provide the employee's name, contact information, and point of access.
- G. Shall allow for surface, flush, or pedestal mounting.
- H. Shall have communications protocol in place that shall allow for communications with the SMS.
- I. Shall determine when multiple attempts were made for verification, and shall automatically prompt the user for additional attempts up to a maximum of three tries. After a third failed attempt the unit shall generate an entry control alarm. This alarm will report to the SMS and the CCTV system. The camera viewpoint for where the alarm was generated shall automatically be called up onto a monitor and be recorded via the recording equipment. An alarm within the SMS shall also be generated recording, at a minimum, the date, time, and attempted point of entry.
- J. Hand/Palm Geometry Verification:
  - 1. Shall utilize unique human hand measurements to identify authorized, enrolled personnel.
  - 2. During the scan process the hand geometry device, which shall allow the user's hand to remain in full view during the scanning process, shall a three (3) dimensional measurement of the user's hand identifying its size and shape.
  - 3. This scan process shall start automatically once the user's hand is positioned. The hand geometry device shall be able to use either left or right hands for enrollment and verification.
  - 4. Shall include an LED or other type of visual indicator display and provide visual or visual and audible status indications and user prompts. The display shall indicate power on/off, and whether user passage requests have been accepted or rejected.
  - 5. Shall only be updated at the unit itself and automatic updates via the SMS shall not be allowed.
  - 6. Any significant change to the user's hand, scars, loss of digit, or any other change that will alter the three dimension view of the hand shall require an update to the unit and SMS.

7. Shall provide an enrollment, recognition, and code/credential verification mode. The enrollment mode shall create a hand template for new personnel and enter the template into the entry control database file created for that person. Template information shall be compatible with the system application software. The operating mode shall be selectable by the system manager/operator from the central processor. When operating in recognition mode, the hand geometry device shall allow passage when the hand scan data from the verification attempt matches a hand geometry template stored in the database files. When operating in code/credential verification mode, the hand geometry device shall allow passage when the hand scan data from the verification attempt matches the hand geometry template associated with the identification code entered into a keypad; or matches the hand geometry template associated with credential card data read by a card reader.

K. Fingerprint Verification:

1. Shall use a unique human fingerprint pattern to identify authorized, enrolled personnel.
2. Shall allow the user's hand to remain in full view during the scanning process, shall incorporate positive measures to establish that the hand or fingers being scanned by the device belong to a living human being.
3. Shall provide an optical or other type of scan of the user's fingers. The fingerprint verification scanner shall automatically initiate the scan process provided the user's fingers are positioned.
4. LED or other type of visual indicator displays shall provide a visual or visual and audible status indication and enrollee prompts. The display shall indicate power on/off, and whether user passage requests have been accepted or rejected.
5. Any significant change to the user's finger such as scars, loss of digit, or any other change that will alter the finger print shall require an update to the unit and SMS.
6. Shall provide an adjustable acceptance tolerance or template match criteria under system manager/operator control.
7. Shall respond to passage requests by generating signals to the local processor. The verification time shall be 2.0 seconds or less from

the moment the finger print analysis scanner initiates the scan process until the fingerprint analysis scanner generates a response signal.

8. Shall:
    - a. Provide an enrollment mode, recognition mode, and code/credential verification mode. The enrollment mode shall create a fingerprint template for new personnel and enter the template into the system database file created for that person.
    - b. Template information shall be compatible with the system application software.
    - c. The operating mode shall be selectable by the system manager/operator from the central station.
  9. When operating in recognition mode, the fingerprint analysis scanner shall allow passage when the fingerprint data from the verification attempt matches a fingerprint template stored in the database files.
  10. When operating in code/credential verification mode, the fingerprint analysis scanner shall allow passage when the fingerprint data from the verification attempt matches a fingerprint template associated with the identification code. When entered into a keypad or it matches the fingerprint template associated with credential, the card data will then be recognized by the card reader.
  11. Shall store template transactions involving fingerprint scans. The template match scores shall be stored in the matching personnel data file in a format compatible with the system application software, and shall be used for report generation.
  12. Shall be unit listed as FIPS 201 Approved product.
- L. Iris Verification:
1. Shall utilize unique patterns within the human eye to identify authorized, enrolled personnel.
  2. Shall use ambient light to capture an image of the iris of the person presenting themselves for identification. The resulting video image shall be compared against a stored template that was captured during the enrollment process.
  3. Shall utilize a threshold for identification. The efficiency and accuracy of the device shall not be adversely affected by enrollees who wear contact lenses or eye glasses.



4. Shall provide a means for enrollees to align their eye for identification that does not require facial contact with the device.
5. Initiation for the scan should be automatic, but push-button could be provided to initiate the scan process. The device shall include adjustments to accommodate differences in enrollee height and mounting height shall be UFAS compliant.
6. The LED or other type of visual indicator displays shall provide a visual or visual and audible status indication and enrollee prompts. The display shall indicate power on/off, and whether user passage requests have been accepted or rejected.
7. Verification time for the retinal verification unit shall be no greater than 1.5 seconds from the moment the action is initiated until a response signal has been generated.
8. Shall provide an enrollment mode, recognition mode, and code/credential verification mode:
  - a. The enrollment mode shall create an iris template for new personnel and enter the template into the system database file created for that person. Template information shall be compatible with the system application software.
  - b. When operating in recognition mode, the retinal verification unit shall allow passage when the retinal verification data from the verification attempt matches an iris template stored in the database files.
  - c. When operating in code/credential verification mode, the iris scanner shall allow passage when the retinal verification data from the verification attempt matches the retinal verification template. This will occur when the associated information matches the identification code entered into a keypad or matches the retinal verification template associated with the credential card data when recognized by a card reader.
9. Shall store template transactions involving retinal verifications. The template match scores shall be stored in the matching personnel data file in a file format compatible with the system application software, and shall be used for report generation.

M. Voice Verification:

1. Shall utilize unique patterns within the human speech pattern to identify authorized, enrolled personnel.

2. Shall digitize a profile of a person's speech to produce a stored model voice print, or template. Users shall record their full names utilizing their natural voice tendencies. This process shall be initiated by a push to talk button on the voice verification device.
3. Shall utilize a threshold for identification. The efficiency and accuracy of the device shall not be adversely affected by enrollees who have a speech impediment.
4. Shall provide a means for enrollees to align their voice for identification that does not require contact with the device.
5. The LED or other type of visual indicator displays shall provide a visual or visual and audible status indication and enrollee prompts. The display shall indicate power on/off, and whether user passage requests have been accepted or rejected.
6. Verification time for the voice verification unit shall be no greater than 1.5 seconds from the moment the action is initiated until a response signal has been generated.
7. Shall provide an enrollment mode, recognition mode, and code/credential verification mode:
  - a. The enrollment mode shall create a voice template for new personnel and enter the template into the system database file created for that person. Template information shall be compatible with the system application software.
  - b. When operating in recognition mode, the voice verification unit shall allow passage when the voice verification data from the verification attempt matches a voice template stored in the database files.
  - c. When operating in code/credential verification mode, the voice verifier shall allow passage when the voice verification data from the verification attempt matches the voice verification template. This will occur when the associated information of the identification code entered into a keypad matches the voice verification template associated with a credential card data is recognized by a card reader.
8. Shall store template transactions involving voice verifications. The template match scores shall be stored in the matching personnel data file in a file format compatible with the system application

software, MPEG or equivalent, and shall be used for report generation.

## **2.5 SYSTEM SENSORS AND RELATED EQUIPMENT**

A. The PACS (Physical Access Control System) and related Equipment provided by the Contractor shall meet or exceed the following performer specifications:

B. Request to Exit Detectors:

1. Passive Infrared Request to Exit Motion Detector (REX PIR) (1) The Contractor shall provide a surface mounted motion detector to signal the physical access control system request to exit input. The motion detector shall be a passive infrared sensor designed for wall or ceiling mounting 2134 to 4572 mm (7 to 15 ft) height. The detector shall provide two (2) form "C" (SPDT) relays rated one (1) Amp. @ 30 VDC for DC resistive loads. The detectors relays shall be user adjustable with a latch time from 1-60 seconds. The detector shall also include a selectable relay reset mode to follow the timer or absence of motion. The detection pattern shall be adjustable plus or minus fourteen ( $\pm 14$ ) degrees. The detector shall operate on 12 VDC with approximately 26 mA continuous current draw. The detector shall have an externally visible activation LED. The motion detector shall measure approximately 38 mm H x 158 mm W x 38 mm D (1.5 x 6.25 x 1.5 in). The detector shall be immune to radio frequency interference. The detector shall not activate or set-up on critical frequencies in the range 26 to 950 Megahertz using a 50 watt transmitter located 30.5 cm (1 ft) from the unit or attached wiring. The detector shall be available on gray or black enclosures. The color of the housing shall be coordinated with the surrounding surface.

C. Guard tour stations:

1. The guard tour station shall be single gang brushed steel plate flush mounted in a single gang box. The switch shall be a normally open momentary keyed switch.

D. Delayed Egress (DE)

1. General:

- a. The delay egress locking hardware shall provide a method to secure emergency exits and provide an approved delayed emergency exit method. The package shall be Underwriters Laboratories

listed as a delay egress-locking device. The delay egress device shall be available to support configurations with both rated and non-rated fire doors. The delay egress device shall comply with Life Safety Codes (NFPA-101, BOCA) as it applies to special locking arrangements for delay egress locks. Unless specifically identified as a non-fire rated opening, all doors shall be equipped with fire rated door hardware. The Contractor shall be responsible for providing all equipment and installation to provide a fully functioning system. Need to amend to use crashbars type mechanical release switches.

2. The delay-locking device shall include all of the following features:

- a. Delay Egress Mode

- 1) The delayed egress device shall be a SDC 101V Series Exit Check with wall mounted control module. Upon activation of an approved panic bar the delay locking device shall begin a delay sequence of 30 seconds; a flush mounted wall LED panel adjacent to the door will indicate initiation of the countdown time. During the 30 second delay period, a local sounding device shall annunciate a tone activation of the delay cycle and verbal exit instructions. At the end of the delay cycle the locking device shall unlock and allow free egress. The reset of the local sounding device shall be user definable and include options to select either local sound until silenced by reset or local sounder silenced upon opening of the door. Unless otherwise indicated the local delay sounder shall be silenced upon opening of the door. The SDC's device trigger output shall be connected to the SMS DGP alarm panel for pre-activation warning. The contractor shall specify the bond sensor option when ordering the delayed egress hardware; this output shall be wired to the SMS DGP to activate an alarm if the door does not lock. Use of reset panel not top mounted device.

- 2) Delayed egress doors will have bond sensors.

- 3) Delayed egress activation shall also trigger CCTV call -up.

- b. Fire Alarm Mode

- 1) Upon activation of the facility's fire evacuation and water flow alarm signal the delay locking devices shall immediately unlock and provide free egress. The Contractor shall provide any required fire alarm relays or interface devices.
- c. Reset Mode
- 1) The delay egress device shall be manually reset by the Delayed Egress controller located at the door via key switch.
  - 2) The delay egress device shall automatically reset upon fire alarm system reset.
  - 3) The delayed egress shall be resettable through the SMS.
- d. The Contractor shall provide a Master Open Switch for all the facility's delayed egress hardware, with protective cover and permanent labeling in the Unit Control Room. The switch shall be wired into the fire alarm system to activate the evacuation alarms. When the switch is pressed all delayed egress or evacuation doors shall unlock and generate an alarm at the security console monitor showing and recording time and date of when the switch was pressed. The contractor is responsible for coordinating the wiring and connection with the fire alarm contactor. The Master Open Switch shall be linked to the fire alarm panel for the release of doors locks.
- e. Each individual delayed egress door shall have the ability to unlock through a manual action on the SMS.
- f. Unless otherwise indicated the Contractor shall provide all of the above reset methods for each door. All signs will meet the latest ADA requirements.
- g. Signs
- 1) The delay egress package shall be provided with a warning sign complying with local code requirements. The warning sign shall be attached to the interior side of the controlled door. The sign shall be located on the interior side of the door above and within 304 mm (12 in) of the panic bar. The sign shall read:  
EMERGENCY EXIT.  
PUSH UNTIL  
ALARM SOUNDS  
DOOR CAN BE OPENED,

IN 30 SECONDS.

- 2) Signs shall be coordinated and comply with the building's existing sign specifications. Signs shall include grade 2 Braille.
- 3) Signs shall meet the current ADA requirements.
- 4) In instances of code and specification conflicts, the life safety code requirement shall prevail.
- 5) The Division 10 Contractor shall provide samples for approval with their submittal package.

3. Physical Access Control Interface

- a. The delay egress device shall be capable of interface with card access control systems.
- b. The system shall include a bypass feature that is activated via a dry contact relay output from the physical access control system. This bypass shall allow authorized personnel to pass through the controlled portal without creating an alarm condition or activating the delay egress cycle. The bypass shall include internal electronic shunts or door switches to prevent activation (re-arming) until the door returns to the closed position. An unused access event shall not cause a false alarm and shall automatically rearm the delay egress lock upon expiration of the programmed shunt time. The delay egress physical access control interface shall support extended periods of automated and/or manual lock and unlock cycles.

E. Crash Bar:

1. Emergency Exit with Alarm (Panic):

- a. Entry control portals shall include panic bar emergency exit hardware as designed.
- b. Panic bar emergency exit hardware shall provide an alarm shunt signal to the PACS and SMS.
- c. The panic bar shall include a conspicuous warning sign with one (1) inch (2.5 cm) high, red lettering notifying personnel that an alarm will be annunciated if the panic bar is operated.
- d. Operation of the panic bar hardware shall generate an intrusion alarm that reports to both the SMS and Intrusion Detection System. The use of a micro switch installed within the panic bar shall be utilized for this.

- e. The panic bar shall utilize a fully mechanical connection only and shall not depend upon electric power for operation.
- f. The panic bar shall be compatible with mortise or rim mount door hardware and shall operate by retracting the bolt manually by either pressing the panic bar or with a key by-pass. Refer to Section 2.2.I.9 for key-bypass specifications.
- g. Normal Exit:
  - 1) Entry control portals shall include panic bar non-emergency exit hardware as designed.
  - 2) Panic bar non-emergency exit hardware shall be monitored by and report to the SMS.
  - 3) Operation of the panic bar hardware shall not generate a locally audible or an intrusion alarm within the IDS.
  - 4) When exiting, the panic bar shall depend upon a mechanical connection only. The exterior, non-secure side of the door shall be provided with an electrified thumb latch or lever to provide access after the credential I.D. authentication by the SMS.
  - 5) The panic bar shall be compatible with mortise or rim mount door hardware and shall operate by retracting the bolt manually by either pressing the panic bar or with a key by-pass. Refer to Section 2.2.I.9 for key-bypass specifications. The strikes/bolts shall include a micro switch to indicate to the system when the bolt is not engaged or the strike mechanism is unlocked. The signal switches shall report a forced entry to the system in the event the door is left open or accessed without the identification credentials.
- F. Key Bypass:
  - 1. Shall be utilized for all doors that have a mortise or rim mounted door hardware.
  - 2. Each door shall be individually keyed with one master key per secured area.
  - 3. Cylinders shall be six (6)-pin and made of brass or equivalent. Keys for the cylinders shall be constructed of solid material and produced and cut by the same distributor. Keys shall not be purchased, cut, and supplied by multiple dealers.

4. All keys shall have a serial number cut into the key. No two serial numbers shall be the same.
5. All keys and cylinders shall be stored in a secure area that is monitored by the Intrusion Detection System.

G. Automatic Door Opener and Closer:

1. Shall be low energy operators.
2. Door closing force shall be adjustable to ensure adequate closing control.
3. Shall have an adjustable back-check feature to cushion the door opening speed if opened violently.
4. Motor assist shall be adjustable from 0 to 30 seconds in five (5) second increments. Motor assist shall restart the time cycle with each new activation of the initiating device.
5. Unit shall have a three-position selector mode switch that shall permit unit to be switched "ON" to monitor for function activation, switched to "H/O" for indefinite hold open function or switched to "OFF," which shall deactivate all control functions but will allow standard door operation by means of the internal mechanical closer.
6. Door control shall be adjustable to provide compliance with the requirements of the Americans with Disabilities Act (ADA) and ANSI standards A117.1.
7. All automatic door openers and closers shall:
  - a. Meet UL standards.
  - b. Be fire rated.
  - c. Have push and go function to activate power operator or power assist function.
  - d. Have push button controls for setting door close and door open positions.
  - e. Have open obstruction detection and close obstruction detection built into the unit.
  - f. Have door closer assembly with adjustable spring size, back-check valve, sweep valve, latch valve, speed control valve and pressure adjustment valve to control door closing.
  - g. Have motor start-up delay, vestibule interface delay; electric lock delay and door hold open delay up to 30 seconds. All operators shall close door under full spring power when power is removed.



- h. Are to be hard wired with power input of 120 VAC, 60Hz and connected to a dedicated circuit breaker located on a power panel reserved for security equipment.
- H. Door Status Indicators:
  - 1. Shall monitor and report door status to the SMS.
  - 2. Door Position Sensor:
    - a. Shall provide an open or closed indication for all doors operated on the PACS and report directly to the SMS.
    - b. Shall also provide alarm input to the Intrusion Detection System for all doors operated by the PACS and all other doors that require monitoring by the intrusion detection system.
    - c. Switches for doors operated by the PACS shall be double pole double throw (DPDT). One side of the switch shall monitor door position and the other side if the switch shall report to the intrusion detection system. For doors with electromagnetic locks a magnetic bonding sensor (MBS) can be used in place of one side of a DPDT switch, in turn allowing for the use of a single pole double throw (SPDT) switch in it place of a DPDT switch.
    - d. Switches for doors not operated by the PACS shall be SPDT and report directly to the IDS.
    - e. Shall be surface or flush mounted and wide gap with the ability to operate at a maximum distance of up to 2" (5 cm).

## **2.6 PORTAL CONTROL DEVICES**

- A. Shall be used to assist the PACS.
- B. Such devices shall:
  - 1. Provide a means of monitoring the doors status.
  - 2. Allow for exiting a space via either a push button, request to exit, or panic/crash bar.
  - 3. Provide a means of override to the PACS via a keypad or key bypass.
  - 4. Assist door operations utilizing automatic openers and closures.
  - 5. Provide a secondary means of access to a space via a keypad.
- C. Shall be connected to and monitored by the main PACS panel.
- D. Shall be installed in a manner that they comply with:
  - 1. The Uniform Federal Accessibility Standards (UFAS)
  - 2. The Americans with Disabilities Act (ADA)
  - 3. The ADA Standards for Accessible Design

E. Shall provide a secondary means of physical access control within a secure area.

F. Push-Button Switches:

1. Shall be momentary contact, back lighted push buttons, and stainless steel switch enclosures for each push button as shown. Buttons are to be utilized for secondary means of releasing a locking mechanism.
  - a. In an area where a push button is being utilized for remote access of the locking device then no more than two (2) buttons shall operate one door from within one secure space. Buttons will not be wired in series with one other.
  - b. In an area where locally stationed guards control entry to multiple secure points via remote switches. An interface board shall be designed and constructed for only the amount of buttons it shall house. These buttons shall be flush mounted and clearly labeled for ease of use. All buttons shall be connected to the PACS and SMS system for monitoring purposes.
  - c. Shall have double-break silver contacts that will make 720 VA at 60 amperes and break 720 VA at 10 amperes.

G. Entry Control Devices:

1. Shall be hardwired to the PACS main control panel and operated by either a card reader or a biometric device via a relay on the main control panel.
2. Shall be fail-safe in the event of power failure to the PACS system.
3. Shall operate at 24 VCD, with the exception of turnstiles and be powered by a separate power supply dedicated to the door control system. Each power supply shall be rated to operate a minimum of two doors simultaneously without error to the system or overload the power supply unit.
4. Shall have a diode or metal-oxide varistor (MOV) to protect the controller and power supply from reverse current surges or back-check.
5. Electric Strikes/Bolts: Shall be:
  - a. Made of heavy-duty construction and tamper resistant design.
  - b. Tested to over one million cycles.
  - c. Rated for a minimum of 1000 lbs. holding strength.

- d. Utilize an actuating solenoid for the strike/bolt. The solenoid shall move from fully open to fully closed position and back in not more than 500 milliseconds and be rated for continuous duty.
  - e. Utilize a signal switch that will indicate to the system if the strike/bolt is not engaged or is unlocked when it should be secured.
  - f. Flush mounted within the door frame.
6. Electric Mortise Locks: Shall be installed within the door and an electric transfer hinge shall be utilized to allow the wires to be transferred from the door frame to the lock. If utilized with a double door then the lock shall be installed inside the active leaf. Electric Mortise Locks shall:
- a. These locks shall be provided and installed by the Division 8 "DOOR HARDWARE" Contractor.
  - b. Provide integration of the Electric Mortise Locks with the PACS for:
    - 1) Lock Power

## **2.7 VIDEO AND CAMERA CONTROL**

- A. Control station or designated workstation displays live video from a CCTV source.
  - 1. Control Buttons: On the display window, with separate control buttons to represent Left, Right, Up, Down, Zoom In, Zoom Out, Scan, and a minimum of two custom command auxiliary controls.
  - 2. Provide at least seven icons to represent different types of cameras, with ability to import custom icons. Provide option for display of icons on graphic maps to represent their physical location.
  - 3. Provide the alarm-handling window with a command button that will display the camera associated with the alarm point.
- B. Display mouse-selectable icons representing each camera source, to select source to be displayed. For CCTV sources that are connected to a video switcher, control station shall automatically send control commands through a COM port to display the requested camera when the camera icon is selected.
- C. Allow cameras with preset positioning to be defined by displaying a different icon for each of the presets. Provide control with Next and

Previous buttons to allow operator to cycle quickly through the preset positions.

## **2.8 WIRES AND CABLES**

- A. Comply with Division 28 Section "CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY."
- B. PVC-Jacketed, RS-232 Cable: Paired, 2 pairs, No. 22 AWG, stranded (7x30) tinned copper conductors, polypropylene insulation, and individual aluminum foil-polyester tape shielded pairs with 100 percent shield coverage; PVC jacket. Pairs are cabled on common axis with No. 24 AWG, stranded (7x32) tinned copper drain wire.
  - 1. NFPA 70, Type CM.
  - 2. Flame Resistance: UL 1581 Vertical Tray.
- C. Plenum-Type, RS-232 Cable: Paired, 2 pairs, No. 22 AWG, stranded (7x30) tinned copper conductors, plastic insulation, and individual aluminum foil-polyester tape shielded pairs with 100 percent shield coverage; plastic jacket. Pairs are cabled on common axis with No. 24 AWG, stranded (7x32) tinned copper drain wire.
  - 1. NFPA 70, Type CMP.
  - 2. Flame Resistance: NFPA 262 Flame Test.
- D. RS-485 communications require 2 twisted pairs, with a distance limitation of 4000 feet (1220 m).
- E. PVC-Jacketed, RS-485 Cable: Paired, 2 pairs, twisted, No. 22 AWG, stranded (7x30) tinned copper conductors, PVC insulation, unshielded, PVC jacket, and NFPA 70, Type CMG.
- F. Plenum-Type, RS-485 Cable: Paired, 2 pairs, No. 22 AWG, stranded (7x30) tinned copper conductors, fluorinated-ethylene-propylene insulation, unshielded, and fluorinated-ethylene-propylene jacket.
  - 1. NFPA 70, Type CMP.
  - 2. Flame Resistance: NFPA 262 Flame Test.
- G. Multiconductor, Readers and Wiegand Keypads Cables: No. 22 AWG, paired and twisted multiple conductors, stranded (7x30) tinned copper conductors, semirigid PVC insulation, overall aluminum foil-polyester tape shield with 100 percent shield coverage, plus tinned copper braid shield with 65 percent shield coverage, and PVC jacket.
  - 1. NFPA 70, Type CMG.
  - 2. Flame Resistance: UL 1581 Vertical Tray.
  - 3. For TIA/EIA-RS-232 applications.

H. Plenum-Type, Multiconductor, Readers and Keypads Cable: 6 conductors, No. 20 AWG, stranded (7x28) tinned copper conductors, fluorinated-ethylene-propylene insulation, overall aluminum foil-polyester tape shield with 100 percent shield coverage plus tinned copper braid shield with 85 percent shield coverage, and fluorinated-ethylene-propylene jacket.

1. NFPA 70, Type CMP.

2. Flame Resistance: NFPA 262 Flame Test.

I. LAN (Ethernet) Cabling: Comply with Division 28 Section "Conductors and Cables for Electronic Safety and Security."

### **PART 3 - EXECUTION**

#### **3.1 GENERAL**

- A. The Contractor shall install all system components and appurtenances in accordance with the manufacturers' instructions, ANSI C2, and shall furnish all necessary interconnections, services, and adjustments required for a complete and operable system as specified. Control signals, communications, and data transmission lines grounding shall be installed as necessary to preclude ground loops, noise, and surges from affecting system operation. Equipment, materials, installation, workmanship, inspection, and testing shall be in accordance with manufacturers' recommendations and as modified herein.
- B. Consult the manufacturers' installation manuals for all wiring diagrams, schematics, physical equipment sizes, etc., before beginning system installation. Refer to the Riser/Connection diagram for all schematic system installation/termination/wiring data.
- C. All equipment shall be attached to walls and ceiling/floor assemblies and shall be held firmly in place (e.g., sensors shall not be supported solely by suspended ceilings). Fasteners and supports shall be adequate to support the required load.

#### **3.2 CURRENT SITE CONDITIONS**

- A. The Contractor shall visit the site and verify that site conditions are in agreement with the design package. The Contractor shall report all changes to the site or conditions which will affect performance of the system to the Owner in a report as defined in paragraph Group II Technical Data Package. The Contractor shall not take any corrective action without written permission from the Owner.

### **3.3 EXAMINATION**

- A. Examine pathway elements intended for cables. Check raceways, cable trays, and other elements for compliance with space allocations, installation tolerances, hazards to cable installation, and other conditions affecting installation.
- B. Examine roughing-in for LAN and control cable conduit systems to PCs, Controllers, card readers, and other cable-connected devices to verify actual locations of conduit and back boxes before device installation.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

### **3.4 PREPARATION**

- A. Comply with recommendations in SIA CP-01.
- B. Comply with EIA/TIA-606, "Administration Standard for the Telecommunications Infrastructure of Commercial Buildings."
- C. Obtain detailed Project planning forms from manufacturer of access-control system; develop custom forms to suit Project. Fill in all data available from Project plans and specifications and publish as Project planning documents for review and approval.
  - 1. Record setup data for control station and workstations.
  - 2. For each Location, record setup of Controller features and access requirements.
  - 3. Propose start and stop times for time zones and holidays, and match up access levels for doors.
  - 4. Set up groups, linking, and list inputs and outputs for each Controller.
  - 5. Assign action message names and compose messages.
  - 6. Set up alarms. Establish interlocks between alarms, intruder detection, and video surveillance features.
  - 7. Prepare and install alarm graphic maps.
  - 8. Develop user-defined fields.
  - 9. Develop screen layout formats.
  - 10. Propose setups for guard tours and key control.
  - 11. Discuss badge layout options; design badges.
  - 12. Complete system diagnostics and operation verification.
  - 13. Prepare a specific plan for system testing, startup, and demonstration.

14. Develop acceptance test concept and, on approval, develop specifics of the test.
15. Develop cable and asset management system details; input data from construction documents. Include system schematics and Technical Drawings.
- D. In meetings with Architect and Owner, present Project planning documents and review, adjust, and prepare final setup documents. Use final documents to set up system software.

### **3.5 CABLING**

- A. Comply with NECA 1, "Good Workmanship in Electrical Contracting."
- B. Install cables and wiring according to requirements in Division 28 Section "Conductors and Cables for Electronic Safety and Security."
- C. Wiring Method: Install wiring in raceway and cable tray except within consoles, cabinets, desks, and counters and except in accessible ceiling spaces and in gypsum board partitions where unenclosed wiring method may be used. Use NRTL-listed plenum cable in environmental air spaces, including plenum ceilings. Conceal raceway and cables except in unfinished spaces.
- D. Install LAN cables using techniques, practices, and methods consistent with Category 5E rating of components and that ensure Category 5E performance of completed and linked signal paths, end to end.
- E. Install cables without damaging conductors, shield, or jacket.
- F. Boxes and enclosures containing security system components or cabling, and which are easily accessible to employees or to the public, shall be provided with a lock. Boxes above ceiling level in occupied areas of the building shall not be considered to be accessible. Junction boxes and small device enclosures below ceiling level and easily accessible to employees or the public shall be covered with a suitable cover plate and secured with tamperproof screws.
- G. Install end-of-line resistors at the field device location and not at the Controller or panel location.

### **3.6 CABLE APPLICATION**

- A. Comply with EIA/TIA-569, "Commercial Building Standard for Telecommunications Pathways and Spaces."
- B. Cable application requirements are minimum requirements and shall be exceeded if recommended or required by manufacturer of system hardware.
- C. RS-232 Cabling: Install at a maximum distance of 50 feet (15 m).

D. RS-485 Cabling: Install at a maximum distance of 4000 feet (1220 m).

E. Card Readers and Keypads:

1. Install number of conductor pairs recommended by manufacturer for the functions specified.
2. Unless manufacturer recommends larger conductors, install No. 22 AWG wire if maximum distance from Controller to the reader is 250 feet (75 m), and install No. 20 AWG wire if maximum distance is 500 feet (150 m).
3. For greater distances, install "extender" or "repeater" modules recommended by manufacturer of the Controller.
4. Install minimum No. 18 AWG shielded cable to readers and keypads that draw 50 mA or more.

F. Install minimum No. 16 AWG cable from Controller to electrically powered locks. Do not exceed 250 feet (75 m).

G. Install minimum No. 18 AWG ac power wire from transformer to Controller, with a maximum distance of 25 feet (8 m).

### **3.7 GROUNDING**

A. Comply with Division 26 Section "Grounding and Bonding for Electrical Systems."

B. Comply with IEEE 1100, "Power and Grounding Sensitive Electronic Equipment."

C. Ground cable shields, drain conductors, and equipment to eliminate shock hazard and to minimize ground loops, common-mode returns, noise pickup, cross talk, and other impairments.

D. Signal Ground:

1. Terminal: Locate in each equipment room and wiring closet; isolate from power system and equipment grounding.
2. Bus: Mount on wall of main equipment room with standoff insulators.
3. Backbone Cable: Extend from signal ground bus to signal ground terminal in each equipment room and wiring closet.

### **3.8 INSTALLATION**

A. System installation shall be in accordance with UL 294, manufacturer and related documents and references, for each type of security subsystem designed, engineered and installed.

B. Components shall be configured with appropriate "service points" to pinpoint system trouble in less than 30 minutes.



- C. The Contractor shall install all system components including Government furnished equipment, and appurtenances in accordance with the manufacturer's instructions, documentation listed in Sections 1.4 and 1.5 of this document, and shall furnish all necessary connectors, terminators, interconnections, services, and adjustments required for a operable system.
- D. The PACS will be designed, engineered, installed, and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the system is a stand alone or a network.
- E. For integration purposes, the PACS shall be integrated where appropriate with the following associated security subsystems:
  - 1. CCTV:
    - a. Provide 24 hour coverage of all entry points to the perimeter and agency buildings. As well as all emergency exits utilizing a fixed color camera.
    - b. Be able to monitor, control and record cameras on a 24 hours basis.
    - c. Be programmed automatically call up a camera when an access point is but into an alarm state.
    - d. For additional PACS system requirements as they relate to the CCTV, refer to Section 28 23 00, VIDEO SURVEILLANCE.
- F. Integration with these security subsystems shall be achieved by computer programming or the direct hardwiring of the systems.
- G. For programming purposes refer to the manufacturers requirements for correct system operations. Ensure computers being utilized for system integration meet or exceed the minimum system requirements outlined on the systems software packages.
- H. The Contractor shall visit the site and verify that site conditions are in agreement with the design package. The Contractor shall report all changes to the site or conditions that will affect performance of the system. The Contractor shall not take any corrective action without written permission from the Government.
- I. The Contractor shall visit the site and verify that site conditions are in agreement/compliance with the design package. The Contractor shall report all changes to the site or conditions that will affect performance of the system to the Contracting Officer in the form of a

report. The Contractor shall not take any corrective action without written permission received from the Contracting Officer.

J. Existing Equipment:

1. The Contractor shall connect to and utilize existing door equipment, control signal transmission lines, and devices as outlined in the design package. Door equipment and signal lines that are usable in their original configuration without modification may be reused with Contracting Officer approval.
2. The Contractor shall perform a field survey, including testing and inspection of all existing door equipment and signal lines intended to be incorporated into the PACS, and furnish a report to the Contracting Officer as part of the site survey report. For those items considered nonfunctioning, provide (with the report) specification sheets, or written functional requirements to support the findings and the estimated cost to correct the deficiency. As part of the report, the Contractor shall include a schedule for connection to all existing equipment.
3. The Contractor shall make written requests and obtain approval prior to disconnecting any signal lines and equipment, and creating equipment downtime. Such work shall proceed only after receiving Contracting Officer approval of these requests. If any device fails after the Contractor has commenced work on that device, signal or control line, the Contractor shall diagnose the failure and perform any necessary corrections to the equipment.
4. The Contractor shall be held responsible for repair costs due to Contractor negligence, abuse, or improper installation of equipment.
5. The Contracting Officer shall be provided a full list of all equipment that is to be removed or replaced by the Contractor, to include description and serial/manufacturer numbers where possible. The Contractor shall dispose of all equipment that has been removed or replaced based upon approval of the Contracting Officer after reviewing the equipment removal list. In all areas where equipment is removed or replaced the Contractor shall repair those areas to match the current existing conditions.

K. Enclosure Penetrations: All enclosure penetrations shall be from the bottom of the enclosure unless the system design requires penetrations from other directions. Penetrations of interior enclosures involving

transitions of conduit from interior to exterior, and all penetrations on exterior enclosures shall be sealed with rubber silicone sealant to preclude the entry of water and will comply with VA Master Specification 07 84 00, Firestopping. The conduit riser shall terminate in a hot-dipped galvanized metal cable terminator. The terminator shall be filled with an approved sealant as recommended by the cable manufacturer and in such a manner that the cable is not damaged.

- L. Cold Galvanizing: All field welds and brazing on factory galvanized boxes, enclosures, and conduits shall be coated with a cold galvanized paint containing at least 95 percent zinc by weight.
- M. Control Panels:
  - 1. Connect power and signal lines to the controller.
  - 2. Program the panel as outlined by the design and per the manufacturer's programming guidelines.
- N. Card Readers:
  - 1. Connect all signal inputs and outputs as shown and specified.
  - 2. Terminate input signals as required.
  - 3. Program and address the reader as per the design package.
  - 4. Readers shall be surface or flushed mounted and all appropriate hardware shall be provided to ensure the unit is installed in an enclosed conduit system.
- O. Biometrics:
  - 1. Connect all signal input and output cables along with all power cables.
  - 2. Program and ensure the device is in operating order.
- P. Portal Control Devices:
  - 1. Install all signal input and output cables as well as all power cables.
  - 2. Devices shall be surface or flush mounted as per the design package.
  - 3. Program all devices and ensure they are working.
- Q. Door Status Indicators:
  - 1. Install all signal input and output cables as well as all power cables.
  - 2. RTE's shall be surface mounted and angled in a manner that they cannot be compromised from the non-secure side of a windowed door, or allow for easy release of the locking device from a distance no greater than 6 feet from the base of the door.

3. Door position sensors shall be surface or flush mounted and wide gap with the ability to operate at a maximum distance of up to 2".

R. Entry Control Devices:

1. Install all signal input and power cables.
2. Strikes and bolts shall be mounted within the door frame.
3. Mortise locks shall be mounted within the door and an electric transfer hinge shall be utilized to transfer the wire from within the door frame to the mortise lock inside the door.
4. Electromagnetic locks shall be installed with the mag-lock mounted to the door frame and the metal plate mounted to the door.

S. Supplemental Contractor Quality Control:

1. The Contractor shall provide the services of technical representatives who are familiar with all components and installation procedures of the installed PACS; and are approved by the Contracting Officer.
2. The Contractor will be present on the job site during the preparatory and initial phases of quality control to provide technical assistance.
3. The Contractor shall also be available on an as needed basis to provide assistance with follow-up phases of quality control.
4. The Contractor shall participate in the testing and validation of the system and shall provide certification that the system installed is fully operational as all construction document requirements have been fulfilled.

### **3.9 SYSTEM SOFTWARE**

- A. Install, configure, and test software and databases for the complete and proper operation of systems involved. Assign software license to Owner.

### **3.10 FIELD QUALITY CONTROL**

- A. Testing Agency: Engage a qualified testing and inspecting agency to perform field tests and inspections and prepare test reports:
- B. Perform the following field tests and inspections and prepare test reports:
  1. LAN Cable Procedures: Inspect for physical damage and test each conductor signal path for continuity and shorts. Use Class 2, bidirectional, Category 5 tester. Test for faulty connectors, splices, and terminations. Test according to TIA/EIA-568-1,

"Commercial Building Telecommunications Cabling Standards - Part 1 General Requirements." Link performance for UTP cables must comply with minimum criteria in TIA/EIA-568-B.

2. Test each circuit and component of each system. Tests shall include, but are not limited to, measurements of power supply output under maximum load, signal loop resistance, and leakage to ground where applicable. System components with battery backup shall be operated on battery power for a period of not less than 10 percent of the calculated battery operating time. Provide special equipment and software if testing requires special or dedicated equipment.
3. Operational Test: After installation of cables and connectors, demonstrate product capability and compliance with requirements. Test each signal path for end-to-end performance from each end of all pairs installed. Remove temporary connections when tests have been satisfactorily completed.

### **3.11 PROTECTION**

- A. Maintain strict security during the installation of equipment and software. Rooms housing the control station, and workstations that have been powered up shall be locked and secured, with an activated burglar alarm and access-control system reporting to a Central Station complying with UL 1610, "Central-Station Burglar-Alarm Units," during periods when a qualified operator in the employ of Contractor is not present.

### **3.12 COMMISSIONING**

- A. Provide commissioning documentation in accordance with the requirements of Section 28 08 00 - COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 28 08 00 - COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS and related sections for contractor responsibilities for system commissioning.

### **3.13 DEMONSTRATION AND TRAINING**

- A. Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.

- B. Submit training plans and instructor qualifications in accordance with the requirements of Section 28 08 00 - COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS.
- C. Develop separate training modules for the following:
  - 1. Computer system administration personnel to manage and repair the LAN and databases and to update and maintain software.
  - 2. Operators who prepare and input credentials to man the control station and workstations and to enroll personnel.
  - 3. Security personnel.
  - 4. Hardware maintenance personnel.
  - 5. Corporate management.
- D. All testing and training shall be compliant with the VA General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.

-----END-----

**SECTION 28 23 00**  
**VIDEO SURVEILLANCE**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. Provide and install a complete Video Surveillance System as an extension of the existing system, which is identified as the Video Assessment and Surveillance System hereinafter referred to as the VASS System as specified in this section.
- B. This Section includes video surveillance system consisting of cameras, data transmission wiring, and a control station with its associated equipment.
- C. Video surveillance system Video assessment & surveillance system shall be integrated with monitoring and control system specified in Division 28 Section PHYSICAL ACCESS CONTROL that specifies systems integration.

**1.2 RELATED WORK**

- A. Section 01 00 00 - GENERAL REQUIREMENTS. For General Requirements.
- B. Section 07 84 00 - FIRESTOPPING. Requirements for firestopping application and use.
- C. Section 26 05 11 - REQUIREMENTS FOR ELECTRICAL INSTALLATIONS. Requirements for connection of high voltage.
- D. Section 26 05 21 - LOW VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES (600 VOLTS AND BELOW). Requirements for power cables.
- E. Section 28 05 00 - COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY. Requirements for general requirements that are common to more than one section in Division 28.
- F. Section 28 05 13 - CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for conductors and cables.
- G. Section 28 05 26 - GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY. Requirements for grounding of equipment.
- H. Section 28 05 28.33 - CONDUITS AND BACKBOXES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for infrastructure.
- I. Section 28 08 00 - COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY. Requirements for commissioning, systems readiness checklists, and training.
- J. Section 28 13 00 - PHYSICAL ACCESS CONTROL SYSTEM. Requirements for physical access control system integration.

### **1.3 DEFINITIONS**

- A. AGC: Automatic gain control.
- B. B/W: Black and white.
- C. CCD: Charge-coupled device.
- D. CIF: Common Intermediate Format CIF images are 352 pixels wide and 88/240 (PAL/NTSC) pixels tall (352 x 288/240).
- E. 4CIF: resolution is 704 pixels wide and 576/480 (PAL/NTSC) pixels tall (704 x 576/480).
- F. H.264 (also known as MPEG4 Part 10): a encoding format that compresses video much more effectively than older (MPEG4) standards.
- G. IPS: Images per second.
- H. MPEG: Moving picture experts group.
- I. MPEG4: a video encoding and compression standard that uses inter-frame encoding to significantly reduce the size of the video stream being transmitted.
- J. NTSC: National Television System Committee.
- K. UPS: Uninterruptible power supply.
- L. PTZ: refers to a movable camera that has the ability to pan left and right, tilt up and down, and zoom or magnify a scene.

### **1.4 QUALITY ASSURANCE**

- A. The Contractor shall be responsible for providing, installing, and the operation of the VASS System as shown. The Contractor shall also provide certification as required.
- B. The security system shall be installed and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the security system is stand-alone or a part of a complete Information Technology (IT) computer network.
- C. The Contractor or security sub-contractor shall be a licensed security Contractor as required within the state or jurisdiction of where the installation work is being conducted.
- D. Manufacturers Qualifications: The manufacturer shall regularly and presently produce, as one of the manufacturer's principal products, the equipment and material specified for this project, and shall have manufactured the item for at least three years.
- E. Product Qualification:



1. Manufacturer's product shall have been in satisfactory operation, on three installations of similar size and type as this project, for approximately three years.
2. The Government reserves the right to require the Contractor to submit a list of installations where the products have been in operation before approval.

F. Contractor Qualification:

1. The Contractor or security sub-contractor shall be a licensed security Contractor with a minimum of five (5) years experience installing and servicing systems of similar scope and complexity. The Contractor shall be an authorized regional representative of the Video Assessment and Surveillance System's (VASS) manufacturer. The Contractor shall provide four (4) current references from clients with systems of similar scope and complexity which became operational in the past three (3) years. At least three (3) of the references shall be utilizing the same system components, in a similar configuration as the proposed system. The references must include a current point of contact, company or agency name, address, telephone number, complete system description, date of completion, and approximate cost of the project. The owner reserves the option to visit the reference sites, with the site owner's permission and representative, to verify the quality of installation and the references' level of satisfaction with the system. The Contractor shall provide copies of system manufacturer certification for all technicians. The Contractor shall only utilize factory-trained technicians to install, program, and service the VASS. The Contractor shall only utilize factory-trained technicians to install, terminate and service cameras, control, and recording equipment. The technicians shall have a minimum of five (5) continuous years of technical experience in electronic security systems. The Contractor shall have a local service facility. The facility shall be located within 60 miles of the project site. The local facility shall include sufficient spare parts inventory to support the service requirements associated with this contract. The facility shall also include appropriate diagnostic equipment to perform diagnostic procedures. The Contracting Officer's Representative reserves the option of surveying the company's

facility to verify the service inventory and presence of a local service organization.

2. The Contractor shall provide proof project superintendent with BICSI Certified Commercial Installer Level 1, Level 2, or Technician to provide oversight of the project.
3. Cable installer must have on staff a Registered Communication Distribution Designer (RCDD) certified by Building Industry Consulting Service International. The staff member shall provide consistent oversight of the project cabling throughout design, layout, installation, termination and testing.

G. Service Qualifications: There shall be a permanent service organization maintained or trained by the manufacturer which will render satisfactory service to this installation within four hours of receipt of notification that service is needed. Submit name and address of service organizations.

#### **1.5 SUBMITTALS**

- A. Submit below items in conjunction with Master Specification Sections 01 33 23, Shop Drawings, Product Data, and Samples, and Section 02 41 00, Demolition Drawings.
- B. Provide certificates of compliance with Section 1.4, Quality Assurance.
- C. Provide a pre-installation and as-built design package in both electronic format and on paper, minimum size 1220 x 1220 millimeters (48 x 48 inches); drawing submittals shall be per the established project schedule.
- D. Pre-installation design and as-built packages shall include, but not be limited to:
  1. Index Sheet that shall:
    - a. Define each page of the design package to include facility name, building name, floor, and sheet number.
    - b. Provide a list of all security abbreviations and symbols.
    - c. Reference all general notes that are utilized within the design package.
    - d. Specification and scope of work pages for all security systems that are applicable to the design package that will:
      - 1) Outline all general and job specific work required within the design package.

- 2) Provide a device identification table outlining device Identification (ID) and use for all security systems equipment utilized in the design package.
2. Floor plans, site plans, and enlarged plans shall:
  - a. Include a title block as defined above.
  - b. Define the drawings scale in both standard and metric measurements.
  - c. Provide device identification and location.
  - d. Address all signal and power conduit runs and sizes that are associated with the design of the electronic security system and other security elements (e.g., barriers, etc.).
  - e. Identify all pull box and conduit locations, sizes, and fill capacities.
  - f. Address all general and drawing specific notes for a particular drawing sheet.
3. A riser drawing for each applicable security subsystem shall:
  - a. Indicate the sequence of operation.
  - b. Relationship of integrated components on one diagram.
  - c. Include the number, size, identification, and maximum lengths of interconnecting wires.
  - d. Wire/cable types shall be defined by a wire and cable schedule. The schedule shall utilize a lettering system that will correspond to the wire/cable it represents (example: A = 18 AWG/1 Pair Twisted, Unshielded). This schedule shall also provide the manufacturer's name and part number for the wire/cable being installed.
4. A system drawing for each applicable security system shall:
  - a. Identify how all equipment within the system, from main panel to device, shall be laid out and connected.
  - b. Provide full detail of all system components wiring from point-to-point.
  - c. Identify wire types utilized for connection, interconnection with associate security subsystems.
  - d. Show device locations that correspond to the floor plans.
  - e. All general and drawing specific notes shall be included with the system drawings.

5. A schedule for all of the applicable security subsystems shall be included. All schedules shall provide the following information:
  - a. Device ID.
  - b. Device Location (e.g. site, building, floor, room number, location, and description).
  - c. Mounting type (e.g. flush, wall, surface, etc.).
  - d. Power supply or circuit breaker and power panel number.
  - e. In addition, for the VASS Systems, provide the camera ID, camera type (e.g. fixed or pan/tilt/zoom (P/T/Z), lens type (e.g. for fixed cameras only) and housing model number.
6. Detail and elevation drawings for all devices that define how they were installed and mounted.
- E. Pre-installation design packages shall be reviewed by the Contractor along with a VA representative to ensure all work has been clearly defined and completed. All reviews shall be conducted in accordance with the project schedule. There shall be four (4) stages to the review process:
  1. 35 percent
  2. 65 percent
  3. 90 percent
  4. 100 percent
- F. Provide manufacturer security system product cut-sheets. Submit for approval at least 30 days prior to commencement of formal testing, a Security System Operational Test Plan. Include procedures for operational testing of each component and security subsystem, to include performance of an integrated system test.
- G. Submit manufacture's certification of Underwriters Laboratories, Inc. (UL) listing as specified. Provide all maintenance and operating manuals per the VA General Requirements, Section 01 00 00, GENERAL REQUIREMENTS.
- H. Submit completed System Readiness Checklists provided by the Commissioning Agent and completed by the contractor, signed by a qualified technician and dated on the date of completion, in accordance with the requirements of Section 28 08 00 COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS.

## 1.6 APPLICABLE PUBLICATIONS

- A. The publications listed below (including amendments, addenda, revisions, supplement, and errata) form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American National Standards Institute (ANSI)/Electronic Industries Alliance (EIA):
  - 330-09.....Electrical Performance Standards for CCTV  
Cameras
  - 375A-76.....Electrical Performance Standards for CCTV  
Monitors
- C. Institute of Electrical and Electronics Engineers (IEEE):
  - C62.41-02.....IEEE Recommended Practice on Surge Voltages in  
Low-Voltage AC Power Circuits
  - 802.3af-08.....Power over Ethernet Standard
- D. Federal Communications Commission (FCC):
  - (47 CFR 15) Part 15 Limitations on the Use of Wireless  
Equipment/Systems
- E. National Electrical Contractors Association (NECA):
  - 303-2005.....Installing Closed Circuit Television (CCTV)  
Systems
- F. National Fire Protection Association (NFPA):
  - 70-08.....Article 780-National Electrical Code
- G. Federal Information Processing Standard (FIPS):
  - 140-2-02.....Security Requirements for Cryptographic Modules
- H. Underwriters Laboratories, Inc. (UL):
  - 983-06.....Standard for Surveillance Camera Units
  - 3044-01.....Standard for Surveillance Closed Circuit  
Television Equipment

## 1.7 COORDINATION

- A. Coordinate arrangement, mounting, and support of video surveillance equipment:
  - 1. To allow maximum possible headroom unless specific mounting heights that reduce headroom are indicated.
  - 2. To provide for ease of disconnecting the equipment with minimum interference to other installations.

3. To allow right of way for piping and conduit installed at required slope.
  4. So connecting raceways, cables, wireways, cable trays, and busways will be clear of obstructions and of the working and access space of other equipment.
- B. Coordinate installation of required supporting devices and set sleeves in cast-in-place concrete, masonry walls, and other structural components as they are constructed.
- C. Coordinate location of access panels and doors for video surveillance items that are behind finished surfaces or otherwise concealed.

#### **1.8 WARRANTY OF CONSTRUCTION**

- A. Warrant VASS System work subject to the Article "Warranty of Construction" of FAR clause 52.246-21.
- B. Demonstration and training shall be performed prior to system acceptance.

### **PART 2 - PRODUCTS**

#### **2.1 GENERAL**

- A. Video signal format shall comply with NTSC standard composite video, interlaced. Composite video signal termination shall be 75 ohms.
- B. Surge Protection: Protect components from voltage surges originating external to equipment housing and entering through power, communication, signal, control, or sensing leads. Include surge protection for external wiring of each conductor entry connection to components.
- C. Power Connections: Comply with requirements in Section 28 05 00 COMMON WORK REQUIREMENTS FOR ELECTRONIC SAFETY AND SECURITY, Part 2, as recommended by manufacturer for type of line being protected.
- D. Tamper Protection: Tamper switches on enclosures, control units, pull boxes, junction boxes, cabinets, and other system components shall initiate a tamper-alarm signal when unit is opened or partially disassembled. Control-station, control-unit alarm display shall identify tamper alarms and indicate locations.

#### **2.2 CAMERAS**

- A. All Cameras will be EIA 330 and UL 1. Minimum Protection for Power Connections 120 V and more: Auxiliary panel suppressors shall comply with requirements in Section 28 05 00 COMMON WORK REQUIREMENTS FOR ELECTRONIC SAFETY AND SECURITY, Part 2.

B. Minimum Protection for Communication, Signal, Control, and Low-Voltage  
983 compliant as well as:

1. Will be charge coupled device (CCD cameras and shall conform to National Television System Committee (NTSC) formatting.
2. Fixed cameras shall be color and the primary choice for monitoring following the activities described below. Pan/Tilt/Zoom (P/T/Z) cameras shall be color and are to be utilized to complement the fixed cameras.
3. Shall be powered by either 12 volts direct current (VDC) or 24 volts alternate current (VAC). Power supplies shall be Class 2 and UL compliant and have a back-up power source to ensure cameras are still operational in the event of loss of primary power to the VASS System.
4. Shall be powered over Ethernet. Network switches supporting PoE cameras shall have a back-up power source to ensure cameras are still operational in the event of loss of primary power to the VASS System.
5. Shall be rated for continuous operation under the environmental conditions listed in Part 1, Project Conditions.
6. Will be home run to a monitoring and recording device via a controlling device such as a matrix switcher or network server and monitored on a 24 hour basis at a designated Security Management System location.
7. Each function and activity shall be addressed within the system by a unique user defined name, with minimum of twenty (20) characters. The use of codes or mnemonics identifying the VASS action shall not be accepted.
8. Shall come with built-in video motion detection that shall automatically monitor and process information from each camera. The camera motion detection shall detect motion within the camera's field of view and provide automatic visual, remote alarms as a result of detected motion.
9. Shall be programmed to digitally flip from color to black and white at dusk and vice versa at low light conditions.
10. Will be fitted with AI/DC lenses to ensure the image quality under different light conditions.

11. P/T/Z cameras shall be utilized in a manner that they complement fixed cameras and shall not be used as a primary means of monitoring activity.
12. Dummy or fake cameras will not be utilized at any time.
13. Appropriate signage shall be designed, provided, and posted that notifies people that an area is under camera surveillance.

### **2.3 CONTROLLING EQUIPMENT**

- A. Shall be utilized to call up, operate, and program all cameras associated VASS System components.
- B. Will have the ability to operate the cameras locally and remotely. A matrix switcher or a network server shall be utilized as the VASS System controller.
- C. The controller shall be able to fit into a standard 47.5 cm (19 inch) equipment rack.
- D. Control and programming keyboards shall be provided with its own type of switcher. All keyboards shall:
  1. Be located at each monitoring station.
  2. Be addressable for programming purposes.
  3. Provide interface between the operator and the VASS System.
  4. Provide full control and programming of the switcher.
  5. Have the minimum following controls:
    - a. programming
    - b. switching
    - c. lens function
    - d. P/T/Z
    - e. environmental housing
    - f. annotation

### **2.4 VIDEO CAMERAS**

- A. The cameras shall be high-resolution color video cameras with wide dynamic range capturing capability.
- B. The camera shall meet or exceed the following specifications:
  1. The image capturing device shall be a [1/3]/[1/4]-inch image sensor designed for capturing wide dynamic images.
    - a. The image capturing device shall have a separate analog-to-digital converter for every pixel.
    - b. The image capturing device shall sample each pixel multiple times per second.



- c. The dynamic range shall be 95 dB typical and 120 dB maximum.
3. The camera shall optimize each pixel independently.
4. The camera shall have onscreen display menus for programming of the camera's settings.
5. The signal system shall be NTSC.
- C. The camera shall have composite video output.
- D. The camera shall come with a manual varifocal lens.
- E. The video output shall be composite: 1.0 volts peak-to-peak at 75-ohm load.
- F. Fixed Color Camera
  1. The camera shall be a high-resolution color video camera with wide dynamic range capturing capability.
  2. Comply with UL 639.
  3. Pickup Device: 1/3 CCD interline transfer.
  4. Signal-to-Noise Ratio: Not less than 50 dB, with the camera AGC off.
  5. With AGC, manually selectable on or off.
  6. Manually selectable modes for backlight compensation or normal lighting.
  7. Scanning Synchronization: Determined by external synch over the coaxial cable. Camera shall revert to internally generated synchronization on loss of external synch signal.
  8. White Balance: Auto-tracing white balance, with manually selectable fixed balance option.
  9. Fixed Color Cameras Technical Characteristics:

Pickup device	1/3" interline transfer CCD
Total pixels	NTSC: 811(H) x 508(V)
Effective pixels	NTSC: 768(H) x 494(V)
Resolution	500 TV lines
Sync. System	Internal Sync
Scanning system	NTSC: 525 Lines/60 Fields
S/N ratio	More than 48 dB
Electronic shutter	Auto 1/60 (1/50) ~1/100,000 sec.
Min. illumination	0.2 lux F2.0
Video output	Composite 1.0 Vp-p/75 ohm
White balance	Auto

Automatic gain control	ON
Frequency horizontal	NTSC: 15.734 KHz
Frequency vertical	NTSC: 59.94Hz
Lens type	Board lens/[DC]/[AI] varifocal lens
Focal length	[3-12mm]<insert values>
Power source	DC12V/500mA or AC24/500mA
Power consumption	< 3W (Max)

10. Fixed color camera shall be enclosed in dome and have board mounted varifocal lens.

11. Camera accessories shall include:

- a. Surface mount adapter
- b. Wall mount adapter
- c. Flush mount adapter

## **2.5 POWER SUPPLIES**

A. Power supplies shall be a low-voltage power supplies matched for voltage and current requirements of cameras and accessories, type as recommended by camera, infrared illuminator, and lens manufacturer.

B. Technical specifications:

1. Input: 115VAC, 50/60Hz, 2.7 amps
2. Outputs:
  - a. Number of outputs, 16
  - b. Fuse/PTC protected, power limited
  - c. Output voltage & power:
    - 1) 24VAC @ 12.5 amps (300VA) or 28VAC @ 10 amp (280VA) supply current
3. Illuminated power disconnect circuit breaker with manual reset
4. Surge suppression
5. Camera synchronization
6. Wall/Rack mount.
7. Enclosure: NEMA 250, Type 3, 4X.

## **2.6 WIRES AND CABLES**

A. Shall meet or exceed the manufactures recommendation for power and signal.

B. Will be carried in an enclosed conduit system, utilizing electromagnetic tubing (EMT) to include the equivalent in flexible

metal, rigid galvanized steel (RGS) to include the equivalent of liquid tight, polyvinylchloride (PVC) schedule 40 or 80.

- C. All conduits will be sized and installed per the NEC. All security system signal and power cables that traverse or originate in a high security office space will be contained in either EMT or RGS conduit.
- D. All conduit, pull boxes, and junction boxes shall be clearly marked with colored permanent tape or paint that will allow it to be distinguished from all other conduit and infrastructure.
- E. Conduit fills shall not exceed 50 percent unless otherwise documented.
- F. A pull string shall be pulled along and provided with signal and power cables to assist in future installations.
- G. At all locations where there is a wall penetration or core drilling is conducted to allow for conduit to be installed, fire stopping materials shall be applied to that area.
- H. High voltage and signal cables shall not share the same conduit and shall be kept separate up to the point of connection. High voltage for the security system shall be defined as any cable or sets of cables carrying 30 VDC/VAC or higher.
- I. For all equipment that is carrying digital data between the Physical Access Control System and Database Management or at a remote monitoring station, shall not be less than 20 AWG and stranded copper wire for each conductor. The cable or each individual conductor within the cable shall have a shield that provides 100% coverage. Cables with a single overall shield shall have a tinned copper shield drain wire.
- J. All cables and conductors, except fiber optic cables, that act as a control, communication, or signal lines shall include surge protection. Surge protection shall be furnished at the equipment end and additional triple electrode gas surge protectors rated for the application on each wire line circuit shall be installed within 1 m. (3 ft.) of the building cable entrance. The inputs and outputs shall be tested in both normal and common mode using the following wave forms:
  - 1. A 10 microsecond rise time by 1000 microsecond pulse width waveform with a peak voltage of 1500 volts and peak current of 60 amperes.
  - 2. An 8 microsecond rise time by 20 microsecond pulse width waveform with a peak voltage of 1000 volts and peak current of 500 amperes.

K. The surge suppression device shall not attenuate or reduce the video or sync signal under normal conditions. Fuses and relays shall not be used as a means of surge protection.

L. Coaxial Cables

1. All video signal cables for the VASS System, with exception to the PoE cameras, shall be a coaxial cable and have a characteristic impedance of 75 ohms plus or minus 3 ohms.
2. For runs up to 750 feet use of an RG-59/U is required. The RG-59/U shall be shielded which provides a minimum of 95 percent coverage, with a stranded copper center conductor of a minimum 23 AWG, polyethylene insulation, and black non-conductive polyvinylchloride (PVC) jacket.
3. For runs between 750 feet and 1250 feet, RG-6/U is required. RG-6/U shall be shielded which provides a minimum of 95 percent coverage, with a stranded copper center conductor of a minimum 18 AWG, polyethylene insulation, and black non-conductive polyvinylchloride (PVC) jacket.
4. For runs of 1250 to 2750 feet, RG-11/U is required. RG-11/U shall be shielded which provides a minimum of 95 percent coverage, with a stranded copper center conductor of a minimum 14 AWG, polyethylene insulation, and black non-conductive polyvinylchloride (PVC) jacket.
5. All runs greater than 2750 feet will be substituted with a fiber optic cable. If using fiber optics as a signal carrier then the following equipment will be utilized:
  - a. Multimode fiber optic cable a minimum size of 62 microns
  - b. Video transmitter, installed at the camera that utilizes 12 VDC or 24 VAC for power.
  - c. Video receiver, installed at the switcher.

6. RG-59/U Technical Characteristics

AWG	22
Stranding	7x29
Conductor Diameter	.031 in.
Conductor Material	BCC
Insulation Material	Gas-injected FHDPE
Insulation Diameter	.145 in.
Outer Shield Type	Braid/Braid
Outer Jacket Material	PVC

Overall Nominal Diameter	.242 in.
UL Temperature Rating	75°C
Nom. Characteristic Impedance	75 Ohms
Nom. Inductance	0.094 $\mu$ H/ft
Nom. Capacitance	Conductor to Shield 17.0 pF/ft
Nom. Velocity of Propagation	80 %
Nom. Delay	1.3 ns/ft
Nom. Conductor DC Resistance @ 20°C	12.2 Ohms/1000 ft
Nom. Outer Shield DC Resistance @ 20°C	2.4 Ohms/1000 ft
Max. Operating Voltage	UL 300 V RMS

7. RG-6/U Technical Characteristics:

AWG	18
Stranding	7x27
Conductor Diameter	.040 in.
Conductor Material	BC
Insulation Material	Gas-injected FHDPE
Insulation Diameter	.180 in.
Outer Shield Material	Trade Name Duofoil
Outer Shield Type	Tape/Braid
Outer Shield %Coverage	100 %
Outer Jacket Material	PVC
Overall Nominal Diameter	.274 in.
Nom. Characteristic Impedance	75 Ohms
Nom. Inductance	0.106 $\mu$ H/ft
Nom. Capacitance	Conductor to Shield 16.2 pF/ft
Nom. Velocity of Propagation	82 %
Nom. Delay	1.24 ns/ft
Nom. Conductor DC Resistance	6.4 Ohms/1000 ft
Nominal Outer Shield DC Resistance @ 20°C	2.8 Ohms/1000 ft
Max. Operating Voltage	UL 300 V RMS

8. RG-11/U Technical Characteristics:

AWG	15
Stranding	19x27
Conductor Diameter	.064 in.
Conductor Material	BC
Insulation Material	Gas-injected FHDPE
Insulation Diameter	.312 in.
Inner Shield Type	Braid
Inner Shield Material	BC - Bare Copper
Inner Shield %Coverage	95 %
Inner Jacket Material	PE - Polyethylene
Inner Jacket Diameter	.391 in.
Outer Shield Type	Braid
Outer Shield Material	BC - Bare Copper
Outer Shield %Coverage	95 %
Outer Jacket Material	Trade Name Belflex
Outer Jacket Material	PVC Blend
Overall Nominal Diameter	.520 in.
Operating Temperature Range	-35°C To +75°C
Non-UL Temperature Rating	75°C
Nom. Characteristic Impedance	75 Ohms
Nom. Inductance	0.097 $\mu$ H/ft
Nom. Capacitance	Conductor to Shield 17.3 pF/ft
Nom. Velocity of Propagation	78 %
Nom. Delay	1.30 ns/ft
Nom. Conductor DC Resistance	3.1 Ohms/1000 ft
Nom. Inner Shield DC Resistance	1.8 Ohms/1000 ft
Nom. Outer Shield DC Resistance	1.4 Ohms/1000 ft
Max. Operating Voltage Non-UL	300 V RMS

9. Signal Cables:

- a. Signal wiring for PoE cameras depends on the distance the camera is being installed from either a hub or the server.
- b. If the camera is up to 300 ft from a hub or the server, then use a shielded UTP category 5 (CAT-V) cable with standard RJ-45

connector at each end. The cable with comply with the Power over Ethernet, IEEE802.3af, Standard.

- c. If the camera is over 300 ft from a hub or server then utilize a multimode fiber optic cable with a minimum size of 62 microns.
- d. Provide a separate cable for power.
- e. CAT-5 Technical Characteristics:

Number of Pairs	4
Total Number of Conductors	8
AWG	24
Stranding	Solid
Conductor Material	BC - Bare Copper
Insulation Material	PO - Polyolefin
Overall Nominal Diameter	.230 in.
IEC Specification	11801 Category 5
TIA/EIA Specification	568-B.2 Category 5e
Max. Capacitance Unbalance	(pF/100 m) 150 pF/100 m
Nom. Velocity of Propagation	70 %
Max. Delay	(ns/100 m) 538 @ 100MHz
Max. Delay Skew	(ns/100m) 45 ns/100 m
Max. Conductor DC Resistance	9.38 Ohms/100
Max. DCR Unbalance@ 20°C	3 %
Max. Operating Voltage	UL 300 V RMS

10. Fiber Optic Cables Technical Characteristics:

Fiber Type	62.5 Micron
Number of Fibers	4
Core Diameter 6	2.5 +/- 2.5 microns
Core Non-Circularity	5% Maximum
Clad Diameter	125 +/- 2 microns
Clad Non-Circularity	1% Maximum
Core-clad Offset	1.5 Microns Maximum
Primary Coating Material	Acrylate
Primary Coating Diameter	245 +/- 10 microns
Secondary Coating Material	Engineering Thermoplastic
Secondary Coating Diameter	900 +/- 50 microns
Strength Member Material	Aramid Yarn

Outer Jacket Material	PVC
Outer Jacket Color	Orange
Overall Diameter	.200 in.
Numerical Aperture	.275
Maximum Gigabit Ethernet	300 meters
Maximum Gigabit Ethernet	550 meters

#### 11. Power Cables

- a. Will be sized accordingly and shall comply with the NEC. High voltage power cables will be a minimum of three conductors, 14 AWG, stranded, and coated with a non-conductive polyvinylchloride (PVC) jacket. Low voltage cables will be a minimum of 18 AWG, stranded and non-conductive polyvinylchloride (PVC) jacket.
- b. Will be utilized for all components of the VASS System that require either a 110 VAC 60 Hz or 220 VAC 50 Hz input. Each feed will be connected to a dedicated circuit breaker at a power panel that is primarily for the security system.
- c. All equipment connected to AC power shall be protected from surges. Equipment protection shall withstand surge test waveforms described in IEEE C62.41. Fuses shall not be used as a means of surge protection.
- d. Shall be rated for either 110 or 220 VAC, 50 or 60 Hz, and shall comply with VA Master Spec 26 05 21 Low Voltage Electrical Power Conductors and Cables (600 Volts and Below).
- e. Low Voltage Power Cables
  - 1) Shall be a minimum of 18 AWG, Stranded and have a polyvinylchloride outer jacket.
  - 2) Cable size shall determine using a basic voltage over distance calculation and shall comply with the NEC's requirements for low voltage cables.

### **PART 3 - EXECUTION**

#### **3.1. GENERAL**

- A. Installation: Contractor shall install all system components including Owner furnished equipment, and appurtenances in accordance with the manufacturer's instructions, ANSI C2 and as shown, and shall furnish all necessary connectors, terminators, interconnections, services, and



adjustments required for a complete and operable data transmission system.

- B. Identification and Labeling: The Contractor shall supply permanent identification labels for each cable at each end that will appear on the as-built drawings. The labeling format shall be identified and a complete record shall be provided to the Owner with the final documentation. Each cable shall be identified by type or signal being carried and termination points. The labels shall be printed on letter size label sheets that are self laminated vinyl that can be printed from a computer data base or spread sheet. The labels shall be E-Z code WES12112 or equivalent.
1. The Contractor shall provide all personnel, equipment, instrumentation, and supplies necessary to perform all testing.
- C. Contractor's Field Test: The Contractor shall verify the complete operation of the data transmission system during the Contractor's Field Testing. Field test shall include a bit error rate test. The Contractor shall perform the test by sending a minimum of 1,000,000 bits of data on each DTM circuit and measuring the bit error rate. The bit error rate shall not be greater than one (1) bit out of each 100,000 bits sent for each dial-up DTM circuit, and one (1) bit out of 1,000,000 bits sent for each leased or private DTM circuit. The Contractor shall submit a report containing results of the field test.
- D. Acceptance Test and Endurance Test: The wire line data transmission system shall be tested as a part of the completed IDS and EECS during the Acceptance test and Endurance Test as specified.
- E. Identification and Labeling: The Contractor shall supply identification tags or labels for each cable. Cable shall be labeled at both end points and at intermediate hand holes, manholes, and junction boxes. The labeling format shall be identified and a complete record shall be provided to the Owner with the final documentation. Each cable shall be identified with type of signal being carried and termination points.

### **3.2 INSTALLATION**

- A. System installation shall be in accordance with NECA 303, manufacturer and related documents and references, for each type of security subsystem designed, engineered and installed.

- B. Components shall be configured with appropriate "service points" to pinpoint system trouble in less than 30 minutes.
- C. The Contractor shall install all system components including Government furnished equipment, and appurtenances in accordance with the manufacturer's instructions, documentation listed in Sections 1.5 of this document, and shall furnish all necessary connectors, terminators, interconnections, services, and adjustments required for a complete and operable system.
- D. The VASS System will be designed, engineered, installed, and tested to ensure all components are fully compatible as a system and can be integrated with all associated security subsystems, whether the system is a stand alone or a complete network.
- E. For integration purposes, the VASS System shall be integrated where appropriate with the following associated security subsystems:
  - 1. PACS:
    - a. Provide 24 hour coverage of all entry points to the perimeter and agency buildings, as well as all emergency exits utilizing a fixed color camera.
    - b. Record cameras on a 24 hours basis.
    - c. Be programmed go into an alarm state when an emergency exit is opened, and notify the Physical Access Control System and Database Management of an alarm event.
- F. Integration with these security subsystems shall be achieved by computer programming or the direct hardwiring of the systems.
- G. For programming purposes refer to the manufacturers requirements for correct system operations. Ensure computers being utilized for system integration meet or exceed the minimum system requirements outlined on the systems software packages.
- H. A complete VASS System shall be comprised of, but not limited to, the following components:
  - 1. Cameras
  - 2. Lenses
  - 3. Video Display Equipment
  - 4. Camera Housings and Mounts
  - 5. Controlling Equipment
  - 6. Recording Devices
  - 7. Wiring and Cables

I. The Contractor shall visit the site and verify that site conditions are in agreement/compliance with the design package. The Contractor shall report all changes to the site or conditions that will affect performance of the system to the Contracting Officer in the form of a report. The Contractor shall not take any corrective action without written permission received from the Contracting Officer.

J. Existing Equipment

1. The Contractor shall connect to and utilize existing video equipment, video and control signal transmission lines, and devices as outlined in the design package. Video equipment and signal lines that are usable in their original configuration without modification may be reused with Contracting Officer approval.
2. The Contractor shall perform a field survey, including testing and inspection of all existing video equipment and signal lines intended to be incorporated into the VASS System, and furnish a report to the Contracting Officer as part of the site survey report. For those items considered nonfunctioning, provide (with the report) specification sheets, or written functional requirements to support the findings and the estimated cost to correct the deficiency. As part of the report, the Contractor shall include a schedule for connection to all existing equipment.
3. The Contractor shall make written requests and obtain approval prior to disconnecting any signal lines and equipment, and creating equipment downtime. Such work shall proceed only after receiving Contracting Officer approval of these requests. If any device fails after the Contractor has commenced work on that device, signal or control line, the Contractor shall diagnose the failure and perform any necessary corrections to the equipment.
4. The Contractor shall be held responsible for repair costs due to Contractor negligence, abuse, or incorrect installation of equipment.
5. The Contracting Officer shall be provided a full list of all equipment that is to be removed or replaced by the Contractor, to include description and serial/manufacturer numbers where possible. The Contractor shall dispose of all equipment that has been removed or replaced based upon approval of the Contracting Officer after reviewing the equipment removal list. In all areas where equipment

is removed or replaced the Contractor shall repair those areas to match the current existing conditions.

- K. Enclosure Penetrations: All enclosure penetrations shall be from the bottom of the enclosure unless the system design requires penetrations from other directions. Penetrations of interior enclosures involving transitions of conduit from interior to exterior, and all penetrations on exterior enclosures shall be sealed with rubber silicone sealant to preclude the entry of water and will comply with VA Master Specification 07 84 00, Firestopping. The conduit riser shall terminate in a hot-dipped galvanized metal cable terminator. The terminator shall be filled with an approved sealant as recommended by the cable manufacturer and in such a manner that the cable is not damaged.
- L. Cold Galvanizing: All field welds and brazing on factory galvanized boxes, enclosures, and conduits shall be coated with a cold galvanized paint containing at least 95 percent zinc by weight.
- M. Interconnection of Console Video Equipment: The Contractor shall connect signal paths between video equipment as specified by the OEM. Cables shall be as short as practicable for each signal path without causing strain at the connectors. Rack mounted equipment on slide mounts shall have cables of sufficient length to allow full extension of the slide rails from the rack.
- N. Cameras:
1. Install cameras with focal length lens as indicated for each zone.
  2. Connect power and signal lines to the camera.
  3. Aim camera to give field of view as needed to cover the alarm zone.
  4. Aim fixed mounted cameras installed outdoors facing the rising or setting sun sufficiently below the horizon to preclude the camera looking directly at the sun.
  5. Focus the lens to give a sharp picture (to include checking for day and night focus and image quality) over the entire field of view
  6. Synchronize all cameras so the picture does not roll on the monitor when cameras are selected.
  7. PTZ cameras shall have all preset positions and privacy areas defined and programmed.
- O. Monitors:
1. Install the monitors as shown and specified in design and construction documents.

2. Connect all signal inputs and outputs as shown and specified.
3. Terminate video input signals as required.
4. Connect the monitor to AC power.

P. Switcher:

1. Install the switcher as shown in the design and construction documents, and according to the OEM.
2. Connect all subassemblies as specified by the manufacturer and as shown.
3. Connect video signal inputs and outputs as shown and specified; terminate video inputs as required.
4. Connect alarm signal inputs and outputs as shown and specified; connect control signal inputs and outputs for ancillary equipment or secondary control/monitoring sites as specified by the manufacturer and as shown.
5. Connect the switcher CPU and switcher subassemblies to AC power.
6. Load all software as specified and required for an operational VASS System configured for the site and building requirements, including data bases, operational parameters, and system, command, and application programs.
7. Provide the original and 2 backup copies for all accepted software upon successful completion of the endurance test.
8. Program the video annotation for each camera.

Q. Video Encoder/Decoder

1. Install the Video Encoder/Decoder per design and construction documents, and as specified by the OEM.
2. Connect analog camera inputs to video encoder.
3. Connect network camera to video decoder.
4. Connect video encoder to VASS network.
5. Connect video decoder to video matrix, DVR, monitor etc.
6. Connect unit to AC power (UPS).
7. Configure the video encoder/decoder per manufacturer's recommendation and project requirements.

R. Video Recording Equipment:

1. Install the video recording equipment as shown in the design and construction documents, and as specified by the OEM.
2. Connect video signal inputs and outputs as shown and specified.
3. Connect alarm signal inputs and outputs as shown and specified.

4. Connect video recording equipment to AC power.
5. Program the video recording equipment;
  - a. Recording schedules
  - b. Camera caption

S. Video Signal Equipment:

1. Install the video signal equipment as shown in the design and construction documents, and as specified by the OEM.
2. Connect video or signal inputs and outputs as shown and specified.
3. Terminate video inputs as required.
4. Connect alarm signal inputs and outputs as required.
5. Connect control signal inputs and outputs as required
6. Connect electrically powered equipment to AC power.

T. Camera Housings, Mounts, and Poles:

1. Install the camera housings and mounts as specified by the manufacturer and as shown, provide mounting hardware sized appropriately to secure each camera, housing and mount with maximum wind and ice loading encountered at the site.
2. Provide a foundation for each camera pole as specified and shown.
3. Provide a ground rod for each camera pole and connect the camera pole to the ground rod as specified in Division 26 of the VA Master Specification and the VA Electrical Manual 730.
4. Provide electrical and signal transmission cabling to the mount location via a hardened carrier system from the Physical Access Control System and Database Management to the device.
5. Connect signal lines and AC power to the housing interfaces.
6. Connect pole wiring harness to camera.

**3.3 SYSTEM START-UP**

- A. The Contractor shall not apply power to the VASS System until the following items have been completed:
1. VASS System equipment items and have been set up in accordance with manufacturer's instructions.
  2. A visual inspection of the VASS System has been conducted to ensure that defective equipment items have not been installed and that there are no loose connections.
  3. System wiring has been tested and verified as correctly connected as indicated.

4. All system grounding systems have been verified as installed and connected as indicated.
5. Power supplies to be connected to the VASS System have been verified as the correct voltage, phasing, and frequency as indicated.
- B. The Commissioning Agent will observe startup and contractor testing of selected equipment. Coordinate the startup and contractor testing schedules with the Contracting Officer's Representative and Commissioning Agent. Provide a minimum of 7 days prior notice.
- C. Satisfaction of the above requirements shall not relieve the Contractor of responsibility for incorrect installation, defective equipment items, or collateral damage as a result of Contractor work efforts.

### **3.4 SUPPLEMENTAL CONTRACTOR QUALITY CONTROL**

- A. The Contractor shall provide the services of technical representatives who are familiar with all components and installation procedures of the installed VASS System; and are approved by the Contracting Officer.
- B. The Contractor will be present on the job site during the preparatory and initial phases of quality control to provide technical assistance.
- C. The Contractor shall also be available on an as needed basis to provide assistance with follow-up phases of quality control.
- D. The Contractor shall participate in the testing and validation of the system and shall provide certification that the system installed is fully operational as all construction document requirements have been fulfilled.

### **3.5 COMMISSIONING**

- A. Provide commissioning documentation in accordance with the requirements of Section 28 08 00 - COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS for all inspection, start up, and contractor testing required above and required by the System Readiness Checklist provided by the Commissioning Agent.
- B. Components provided under this section of the specification will be tested as part of a larger system. Refer to Section 28 08 00 - "COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS" and related sections for contractor responsibilities for system commissioning.

### **3.6 DEMONSTRATION AND TRAINING**

- A. All testing and training shall be compliant with the VA General Requirements, Section 01 00 00, "GENERAL REQUIREMENTS".

- B. Provide services of manufacturer's technical representative for four hours to instruct VA personnel in operation and maintenance of units.
- C. Submit training plans and instructor qualifications in accordance with the requirements of Section 28 08 00 - "COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS".

-----END-----



**SECTION 28 31 00**  
**FIRE DETECTION AND ALARM**

**PART 1 - GENERAL**

**1.1 DESCRIPTION**

- A. This section of the specifications includes the furnishing, installation, and connection of the new fire alarm equipment to the existing system to form a complete coordinated system ready for operation. It shall include, but not be limited to, alarm initiating devices, alarm notification appliances, control units, fire safety control devices, power supplies, and wiring as shown on the drawings and specified. The fire alarm system shall not be combined with other systems such as building automation, energy management, security, etc.
- B. Fire alarm systems shall comply with requirements of the most recent VA FIRE PROTECTION DESIGN MANUAL and NFPA 72 unless variations to NFPA 72 are specifically identified within these contract documents by the following notation: "variation". The design, system layout, document submittal preparation, and supervision of installation and testing shall be provided by a technician that is certified NICET level III or a registered fire protection engineer. The NICET certified technician shall be on site for the supervision and testing of the system. Factory engineers from the equipment manufacturer, thoroughly familiar and knowledgeable with all equipment utilized, shall provide additional technical support at the site as required by the Contracting Officers Representative (COR) or his authorized representative. Installers shall have a minimum of 2 years experience installing fire alarm systems.
- C. Fire alarm signals:
  - 1. Building shall have an automatic digitized voice fire alarm signal with emergency manual voice override to notify occupants to evacuate. The digitized voice message shall identify the area of the building (smoke zone) from which the alarm was initiated.
  - 2. Building shall have a general evacuation fire alarm signal in accordance with ASA S3.41 to notify all occupants in the respective building to evacuate.
- D. Alarm signals (by device), supervisory signals (by device) and system trouble signals (by device not reporting) shall be distinctly transmitted to the main fire alarm system control unit located in the basement main fire alarm control room.

## 1.2 SCOPE

- A. A fully addressable fire alarm system as an extension of an existing addressable fire alarm system shall be designed and installed in accordance with the specifications and drawings. Device location and wiring runs shown on the drawings are for reference only unless specifically dimensioned. Actual locations shall be in accordance with NFPA 72 and this specification.
- B. All existing fire alarm equipment, wiring, devices and sub-systems that are not shown to be reused shall be removed. All existing fire alarm conduit not reused shall be removed.
- C. Existing fire alarm speakers, combination speaker/strobes, bells, chimes, door holders, 120VAC duct smoke detectors, valve tamper switches and waterflow/pressure switches may be reused only as specifically indicated on the drawings and provided the equipment:
  - 1. Meets this specification section
  - 2. Is UL listed or FM approved
  - 3. Is compatible with new equipment being installed
  - 4. Is verified as operable through contractor testing and inspection
  - 5. Is warranted as new by the contractor.
- D. Existing 120 VAC duct smoke detectors, waterflow/pressure switches, and valve tamper switches reused by the Contractor shall be equipped with an addressable interface device compatible with the new equipment being installed.
- E. Existing reused equipment shall be covered as new equipment under the Warranty specified herein.
- F. Basic Performance:
  - 1. Alarm and trouble signals from each building fire alarm control panel shall be digitally encoded by UL listed electronic devices onto a multiplexed communication system.
  - 2. Response time between alarm initiation (contact closure) and recording at the main fire alarm control unit (appearance on alphanumeric read out) shall not exceed 5 seconds.
  - 3. The signaling line circuits (SLC) between building fire alarm control units shall be wired Class X in accordance with NFPA 72. Isolation shall be provided so that no more than one building can be lost due to a short circuit fault.

4. Initiating device circuits (IDC) shall be wired Class B in accordance with NFPA 72.
5. Signaling line circuits (SLC) within buildings shall be wired Class B in accordance with NFPA 72. Individual signaling line circuits shall be limited to covering 22,500 square feet (2,090 square meters) of floor space or 3 floors whichever is less.
6. Notification appliance circuits (NAC) shall be wired Class B in accordance with NFPA 72.

### **1.3 RELATED WORK**

- A. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES. Requirements for procedures for submittals.
- B. Section 07 84 00 - FIRESTOPPING. Requirements for fire proofing wall penetrations.
- C. Section 28 05 00 - COMMON WORK RESULTS FOR ELECTRONIC SAFETY AND SECURITY. Requirements for general requirements that are common to more than one section in Division 28.
- D. Section 28 05 13 - CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for conductors and cables.
- E. Section 28 05 26 - GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY. Requirements for grounding of equipment.
- F. Section 28 05 28.33 - CONDUITS AND BACKBOXES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for infrastructure.
- G. Section 28 05 13 - CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY. Requirements for conductors and cables.
- H. Section 28 08 00, COMMISSIONING OF ELECTRONIC SAFETY AND SECURITY SYSTEMS. Requirements for commissioning - systems readiness checklists, and training.
- I. Section 28 13 00, PHYSICAL ACCESS CONTROL SYSTEMS (PACS). Requirements for integration with physical access control system.

### **1.4 SUBMITTALS**

- A. General: Submit 5 copies in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, and Section 26 05 11, REQUIREMENTS FOR ELECTRICAL INSTALLATIONS.
- B. Drawings:
  1. Prepare drawings using AutoCAD Release 14 software and include all contractors information. Layering shall be by VA criteria as provided by the Contracting Officer's Technical Representative

- (COR). Bid drawing files will be provided to the Contractor at the pre-construction meeting. The contractor shall be responsible for verifying all critical dimensions shown on the drawings provided by VA.
2. Floor plans: Provide locations of all devices (with device number at each addressable device corresponding to control unit programming), appliances, panels, equipment, junction/terminal cabinets/boxes, risers, electrical power connections, individual circuits and raceway routing, system zoning; number, size, and type of raceways and conductors in each raceway; conduit fill calculations with cross section area percent fill for each type and size of conductor and raceway. Only those devices connected and incorporated into the final system shall be on these floor plans. Do not show any removed devices on the floor plans. Show all interfaces for all fire safety functions.
  3. Riser diagrams: Provide, for the entire system, the number, size and type of riser raceways and conductors in each riser raceway and number of each type device per floor and zone. Show door holder interface, elevator control interface, HVAC shutdown interface, fire extinguishing system interface, and all other fire safety interfaces. Show wiring Styles on the riser diagram for all circuits. Provide diagrams both on a per building and campus wide basis.
  4. Detailed wiring diagrams: Provide for control panels, modules, power supplies, electrical power connections, auxiliary relays and annunciators showing termination identifications, size and type conductors, circuit boards, LED lamps, indicators, adjustable controls, switches, ribbon connectors, wiring harnesses, terminal strips and connectors, spare zones/circuits. Diagrams shall be drawn to a scale sufficient to show spatial relationships between components, enclosures and equipment configuration.
  5. Two weeks prior to final inspection, the Contractor shall deliver to the COR 3 sets of as-built drawings and one set of the as-built drawing computer files using AutoCAD 2007 or later. As-built drawings (floor plans) shall show all new and/or existing conduit used for the fire alarm system.

C. Manuals:

1. Submit simultaneously with the shop drawings, companion copies of complete maintenance and operating manuals including technical data sheets for all items used in the system, power requirements, device wiring diagrams, dimensions, and information for ordering replacement parts.
  - a. Wiring diagrams shall have their terminals identified to facilitate installation, operation, expansion and maintenance.
  - b. Wiring diagrams shall indicate internal wiring for each item of equipment and the interconnections between the items of equipment.
  - c. Include complete listing of all software used and installation and operation instructions including the input/output matrix chart.
  - d. Provide a clear and concise description of operation that gives, in detail, the information required to properly operate, inspect, test and maintain the equipment and system. Provide all manufacturer's installation limitations including but not limited to circuit length limitations.
  - e. Complete listing of all digitized voice messages.
  - f. Provide standby battery calculations under normal operating and alarm modes. Battery calculations shall include the magnets for holding the doors open for one minute.
  - g. Include information indicating who will provide emergency service and perform post contract maintenance.
  - h. Provide a replacement parts list with current prices. Include a list of recommended spare parts, tools, and instruments for testing and maintenance purposes.
  - i. A computerized preventive maintenance schedule for all equipment. The schedule shall be provided on disk in a computer format acceptable to the VAMC and shall describe the protocol for preventive maintenance of all equipment. The schedule shall include the required times for systematic examination, adjustment and cleaning of all equipment. A print out of the schedule shall also be provided in the manual. Provide the disk in a pocket within the manual.

- j. Furnish manuals in 3 ring loose-leaf binder or manufacturer's standard binder.
- k. A print out for all devices proposed on each signaling line circuit with spare capacity indicated.
- 2. Two weeks prior to final inspection, deliver 4 copies of the final updated maintenance and operating manual to the COR.
  - a. The manual shall be updated to include any information necessitated by the maintenance and operating manual approval.
  - b. Complete "As installed" wiring and schematic diagrams shall be included that shows all items of equipment and their interconnecting wiring. Show all final terminal identifications.
  - c. Complete listing of all programming information, including all control events per device including an updated input/output matrix.
  - d. Certificate of Installation as required by NFPA 72 for each building. The certificate shall identify any variations from the National Fire Alarm Code.
  - e. Certificate from equipment manufacturer assuring compliance with all manufacturers installation requirements and satisfactory system operation.
- D. Certifications:
  - 1. Together with the shop drawing submittal, submit the technician's NICET level III fire alarm certification as well as certification from the control unit manufacturer that the proposed performer of contract maintenance is an authorized representative of the major equipment manufacturer. Include in the certification the names and addresses of the proposed supervisor of installation and the proposed performer of contract maintenance. Also include the name and title of the manufacturer's representative who makes the certification.
  - 2. Together with the shop drawing submittal, submit a certification from either the control unit manufacturer or the manufacturer of each component (e.g., smoke detector) that the components being furnished are compatible with the control unit.
  - 3. Together with the shop drawing submittal, submit a certification from the major equipment manufacturer that the wiring and connection diagrams meet this specification, UL and NFPA 72 requirements.

### **1.5 WARRANTY**

All work performed and all material and equipment furnished under this contract shall be free from defects and shall remain so for a period of one year from the date of acceptance of the entire installation by the CO.

### **1.6 GUARANTY PERIOD SERVICES**

- A. Complete inspection, testing, maintenance and repair service for the fire alarm system shall be provided by a factory trained authorized representative of the manufacturer of the major equipment for a period of 5 years from the date of acceptance of the entire installation by the Contracting Officer.
- B. Contractor shall provide all necessary test equipment, parts and labor to perform required inspection, testing, maintenance and repair.
- C. All inspection, testing, maintenance and permanent records required by NFPA 72, and recommended by the equipment manufacturer shall be provided by the contractor. Work shall include operation of sprinkler system alarm and supervisory devices as well as all reused existing equipment connected to the fire alarm system. It shall include all interfaced equipment including but not limited to elevators, HVAC shutdown, and extinguishing systems.
- D. Maintenance and testing shall be performed in accordance with NFPA 72. A computerized preventive maintenance schedule shall be provided and shall describe the protocol for preventive maintenance of equipment. The schedule shall include a systematic examination, adjustment and cleaning of all equipment.
- E. Non-included Work: Repair service shall not include the performance of any work due to improper use, accidents, or negligence for which the contractor is not responsible.
- F. Service and emergency personnel shall report to the Engineering Office or their authorized representative upon arrival at the hospital and again upon the completion of the required work. A copy of the work ticket containing a complete description of the work performed and parts replaced shall be provided to the VA COR or his authorized representative.
- G. Emergency Service:
  - 1. Warranty Period Service: Service other than the preventative maintenance, inspection, and testing required by NFPA 72 shall be considered emergency call-back service and covered under the

2. Normal and overtime emergency call-back service shall consist of an on-site response within 4 hours of notification of a system trouble.
3. Normal emergency call-back service times are between the hours of 7:30 a.m. and 4:00 p.m., Monday through Friday, exclusive of federal holidays. Service performed during all other times shall be considered to be overtime emergency call-back service. The cost of all normal emergency call-back service for years 2 through 5 shall be included in the cost of this contract.
4. Overtime emergency call-back service shall be provided for the system when requested by the Government. The cost of the first 40 manhours per year of overtime call-back service during years 2 through 5 of this contract shall be provided under this contract. Payment for overtime emergency call-back service in excess of the 40 man hours per year requirement will be handled through separate purchase orders. The method of calculating overtime emergency call-back hours is based on actual time spent on site and does not include travel time.

A. The publications listed below (including amendments, addenda, revisions, supplements and errata) form a part of this specification to the extent referenced. The publications are referenced in text by the basic designation only and the latest editions of these publications shall be applicable.

NFPA 14 ..... Standard for the Installation of Standpipes and  
Hose Systems, most recent edition



- NFPA 20 .....Standard for the Installation of Stationary  
Pumps for Fire Protection, most recent edition
- NFPA 70.....National Electrical Code (NEC), most recent  
edition
- NFPA 72.....National Fire Alarm Code, most recent edition
- NFPA 90A.....Standard for the Installation of Air  
Conditioning and Ventilating Systems, most  
recent edition
- NFPA 101.....Life Safety Code, most recent edition
- C. Underwriters Laboratories, Inc. (UL): Fire Protection Equipment  
Directory
- D. Factory Mutual Research Corp (FM): Approval Guide, 2007-2011
- E. American National Standards Institute (ANSI):  
S3.41.....Audible Emergency Evacuation Signal, most  
recent edition
- F. International Code Council, International Building Code (IBC), most  
recent edition

## **PART 2 - PRODUCTS**

### **2.1 EQUIPMENT AND MATERIALS, GENERAL**

- A. Existing addressable equipment may be reused only where indicated on the drawings. All addressable equipment and components shall be new and the manufacturer's current model. All equipment shall be tested and listed by Underwriters Laboratories, Inc. or Factory Mutual Research Corporation for use as part of a fire alarm system. The authorized representative of the manufacturer of the major equipment shall certify that the installation complies with all manufacturer's requirements and that satisfactory total system operation has been achieved.

### **2.2 CONDUIT, BOXES, AND WIRE**

- A. Conduit shall be in accordance with Section 28 05 28.33, CONDUIT AND BACKBOXES FOR ELECTRONIC SAFETY AND SECURITY and as follows:
1. All new conduit shall be installed in accordance with NFPA 70.
  2. Conduit fill shall not exceed 40 percent of interior cross sectional area.
  3. All new conduit shall be 3/4 inch (19 mm) minimum.
- B. Wire:
1. Wiring shall be in accordance with NEC article 760, Section 28 05 13 CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY, and as

- recommended by the manufacturer of the addressable fire alarm system to extend an existing non-addressable system. All wires shall be color coded. Number and size of conductors shall be as recommended by the fire alarm system manufacturer, but not less than 18 AWG for initiating device circuits and 14 AWG for notification device circuits.
2. Any fire alarm system wiring that extends outside of a building shall have additional power surge protection to protect equipment from physical damage and false signals due to lightning, voltage and current induced transients. Protection devices shall be shown on the submittal drawings and shall be UL listed or in accordance with written manufacturer's requirements.
  3. All wire or cable used in underground conduits including those in concrete shall be listed for wet locations.
- C. Terminal Boxes, Junction Boxes, and Cabinets:
1. Shall be galvanized steel in accordance with UL requirements.
  2. All boxes shall be sized and installed in accordance with NFPA 70.
  3. covers shall be repainted red in accordance with Section 09 91 00, PAINTING and shall be identified with white markings as "FA" for junction boxes and as "FIRE ALARM SYSTEM" for cabinets and terminal boxes. Lettering shall be a minimum of 3/4 inch (19 mm) high.
  4. Terminal boxes and cabinets shall have a volume 50 percent greater than required by the NFPA 70. Minimum sized wire shall be considered as 14 AWG for calculation purposes.
  5. Terminal boxes and cabinets shall have identified pressure type terminal strips and shall be located at the base of each riser. Terminal strips shall be labeled as specified or as approved by the COR.

### **2.3 VOICE COMMUNICATION SYSTEM (VCS)**

A. General:

1. An emergency voice communication system shall be an extension of the existing system in the building.
2. Upon receipt of an alarm signal from the building fire alarm system, the VCS shall automatically transmit a pre-recorded fire alarm message throughout the floor in alarm, the floor above, and the floor below.

3. A digitized voice module shall be used to store each prerecorded message.
4. The VCS shall supervise all speaker circuits, control equipment, remote audio control equipment, and amplifiers.

B. Speaker Circuit Control Unit:

1. The speaker circuit control unit shall include switches to manually activate or deactivate speaker circuits grouped by floor in the system.
2. Speaker circuit control switches shall provide on, off, and automatic positions and indications.
3. The speaker circuit control unit shall include visual indication of active or trouble status for each group of speaker circuits in the system.
4. A trouble indication shall be provided if a speaker circuit group is disabled.
5. A lamp test switch shall be provided to test all indicator lamps.
6. A single "all call" switch shall be provided to activate all speaker circuit groups simultaneously.
7. A voice message disconnect switch shall be provided to disconnect automatic digitized voice messages from the system. The system shall be arranged to allow manual voice messages and indicate a system trouble condition when activated.

C. Speaker Circuit Arrangement:

1. Speaker circuits shall be arranged such that there is one speaker circuit per smoke zone.
2. Audio amplifiers and control equipment shall be electrically supervised for normal and abnormal conditions.
3. Speaker circuits shall be either 25 VRMS or 70.7 VRMS with a minimum of 50 percent spare power available.
4. Speaker circuits and control equipment shall be arranged such that loss of any one speaker circuit will not cause the loss of any other speaker circuit in the system.

D. Digitized Voice Module (DVM):

1. The Digitized Voice Module shall provide prerecorded digitized evacuation and instructional messages. The messages shall be professionally recorded and approved by the COR prior to programming.

2. The DVM shall be configured to automatically output to the desired circuits following a 10-second slow whoop alert tone.
3. Prerecorded magnetic taped messages and tape players are not permitted.
4. The digitized message capacity shall be no less than 15 second in length.
5. The digitized message shall be transmitted 3 times.
6. The DVM shall be supervised for operational status.
7. Failure of the DVM shall result in the transmission of a constant alarm tone.
8. The DVM memory shall have a minimum 50 percent spare capacity after those messages identified in this section are recorded. Multiple DVM's may be used to obtain the required capacity.

E. Audio Amplifiers:

1. Audio Amplifiers shall provide a minimum of 50 Watts at either 25 or 70.7 VRMS output voltage levels.
2. Amplifiers shall be continuously supervised for operational status.
3. Amplifiers shall be configured for either single or dual channel application.
4. Each audio output circuit connection shall be configurable for Style X.
5. A minimum of 50 percent spare output capacity shall be available for each amplifier.

F. Tone Generator(s):

1. Tone Generator(s) shall be capable of providing a distinctive 3-pulse temporal pattern fire alarm signal as well as a slow whoop.
2. Tone Generator(s) shall be continuously supervised for operational status.

## **2.4 ALARM NOTIFICATION APPLIANCES**

A. Strobes:

1. Xenon flash tube type minimum 15 candela in toilet rooms and 75 candela in all other areas with a flash rate of 1 HZ. Strobes shall be synchronized where required by NFPA 72.
2. Backplate shall be red with 1/2 inch (13 mm) permanent red letters. Lettering to read "Fire", be oriented on the wall or ceiling properly, and be visible from all viewing directions.

3. Each strobe circuit shall have a minimum of 20 percent spare capacity.
4. Strobes may be combined with the audible notification appliances specified herein.

B. Speakers:

1. Shall operate on either 25 VRMS or 70.7 VRMS with field selectable output taps from 0.5 to 2.0W and originally installed at the 1/2 watt tap. Speakers shall provide a minimum sound output of 80 dBA at 10 feet (3,000 mm) with the 1/2 watt tap.
2. Frequency response shall be a minimum of 400 HZ to 4,000 HZ.
3. Four inches (100 mm) or 8 inches (200 mm) cone type speakers ceiling mounted with white colored baffles in areas with suspended ceilings and wall mounted in areas without ceilings.

**2.5 ALARM INITIATING DEVICES**

A. Manual Fire Alarm Stations:

1. Shall be non-break glass, address reporting type.
2. Station front shall be constructed of a durable material such as cast or extruded metal or high impact plastic. Stations shall be semi-flush type.
3. Stations shall be of single action pull down type with suitable operating instructions provided on front in raised or depressed letters, and clearly labeled "FIRE".
4. Operating handles shall be constructed of a durable material. On operation, the lever shall lock in alarm position and remain so until reset. A key shall be required to gain front access for resetting, or conducting tests and drills.
5. Unless otherwise specified, all exposed parts shall be red in color and have a smooth, hard, durable finish.

B. Smoke Detectors:

1. Smoke detectors shall be photoelectric type and UL listed for use with the fire alarm control unit being furnished.
2. Smoke detectors shall be addressable type complying with applicable UL Standards for system type detectors. Smoke detectors shall be installed in accordance with the manufacturer's recommendations and NFPA 72.
3. Detectors shall have an indication lamp to denote an alarm condition. Provide remote indicator lamps and identification plates

where detectors are concealed from view. Locate the remote indicator lamps and identification plates flush mounted on walls so they can be observed from a normal standing position.

4. All spot type and duct type detectors installed shall be of the photoelectric type.
5. Photoelectric detectors shall be factory calibrated and readily field adjustable. The sensitivity of any photoelectric detector shall be factory set at 3.0 plus or minus 0.25 percent obscuration per foot.
6. Detectors shall provide a visual trouble indication if they drift out of sensitivity range or fail internal diagnostics. Detectors shall also provide visual indication of sensitivity level upon testing. Detectors, along with the fire alarm control units shall be UL listed for testing the sensitivity of the detectors.

C. Heat Detectors:

1. Heat detectors shall be of the addressable restorable rate compensated fixed-temperature spot type.
2. Detectors shall have a minimum smooth ceiling rating of 2,500 square feet (230 square meters).
3. Ordinary temperature (135 degrees F (57 degrees C)) heat detectors shall be utilized in elevator mechanical rooms. Intermediate temperature rated (200 degrees F (93 degrees C)) heat detectors shall be utilized in all other areas.
4. Provide a remote indicator lamp, key test station and identification nameplate (e.g. "Heat Detector - Elevator P-\_\_\_\_\_ ) for each elevator group. Locate key test station in plain view on elevator machine room wall.

## **2.6 SUPERVISORY DEVICES**

A. Duct Smoke Detectors:

1. Duct smoke detectors shall be provided and connected by way of an address reporting interface device. Detectors shall be provided with an approved duct housing mounted exterior to the duct, and shall have perforated sampling tubes extending across the full width of the duct (wall to wall). Detector placement shall be such that there is uniform airflow in the cross section of the duct.
2. Interlocking with fans shall be provided in accordance with NFPA 90A and as specified hereinafter under Part 3.2, "TYPICAL OPERATION".

3. Provide remote indicator lamps, key test stations and identification nameplates (e.g. "DUCT SMOKE DETECTOR AHU-X") for all duct detectors. Locate key test stations in plain view on walls or ceilings so that they can be observed and operated from a normal standing position.

## **2.7 ADDRESS REPORTING INTERFACE DEVICE**

- A. Shall have unique addresses that reports directly to the addressable fire alarm panel.
- B. Shall be configurable to monitor normally open or normally closed devices for both alarm and trouble conditions.
- C. Shall have terminal designations clearly differentiating between the circuit to which they are reporting from and the device that they are monitoring.
- D. Shall be UL listed for fire alarm use and compatibility with the panel to which they are connected.
- E. Shall be mounted in weatherproof housings if mounted exterior to a building.

## **2.8 SMOKE BARRIER DOOR CONTROL**

- A. Electromagnetic Door Holders:
  1. New Door Holders shall be standard wall mounted electromagnetic type. In locations where doors do not come in contact with the wall when in the full open position, an extension post shall be added to the door bracket.
  2. Operation shall be by 24 volt DC supplied from a battery located at the fire alarm control unit. Door holders shall be coordinated as to voltage, ampere drain, and voltage drop with the battery, battery charger, wiring and fire alarm system for operation as specified.
- B. A maximum of twelve door holders shall be provided for each circuit. Door holders shall be wired to allow releasing doors by smoke zone.
- C. Door holder control circuits shall be electrically supervised.
- D. Smoke detectors shall not be incorporated as an integral part of door holders.

## **2.9 UTILITY LOCKS AND KEYS:**

- A. All key operated test switches, control units, annunciator panels and lockable cabinets shall be provided with a single standardized utility lock and key.

- B. Key-operated manual fire alarm stations shall have a single standardized lock and key separate from the control equipment.
- C. All keys shall be delivered to the COR.

#### **2.10 SPARE AND REPLACEMENT PARTS**

- A. Provide spare and replacement parts as follows:
  - 1. Manual pull stations - 1
  - 2. Heat detectors - 1
  - 3. Fire alarm strobes - 1
  - 4. Smoke detectors - 1
  - 5. Control equipment keys - 3
  - 6. Monitor modules - 3
  - 7. Control modules - 3
  - 8. Fire alarm SLC cable (same as installed) - 500 feet (152 m)
- B. Spare and replacement parts shall be in original packaging and submitted to the COR.
- C. Furnish and install a storage cabinet of sufficient size and suitable for storing spare equipment. Doors shall include a pad locking device. Padlock to be provided by the VA. Location of cabinet to be determined by the COR.
- D. Provide to the VA, all hardware, software, programming tools, license and documentation necessary to permanently modify the fire alarm system on site. The minimum level of modification includes addition and deletion of devices, circuits, zones and changes to system description, system operation, and digitized evacuation and instructional messages.

#### **2.11 INSTRUCTION CHART:**

Provide a typewritten instruction card mounted behind a Lexan plastic or glass cover in a stainless steel or aluminum frame with a backplate. Install the frame in a conspicuous location observable from each control unit where operations are performed. The card shall show those steps to be taken by an operator when a signal is received under all conditions, normal, alarm, supervisory, and trouble. Provide an additional copy with the binder for the input output matrix for the sequence of operation. The instructions shall be approved by the COR before being posted.



### **PART 3 - EXECUTION**

#### **3.1 INSTALLATION:**

- A. Installation shall be in accordance with NFPA 70, 72, 90A, and 101 as shown on the drawings, and as recommended by the major equipment manufacturer. Fire alarm wiring shall be installed in conduit. All conduit and wire shall be installed in accordance with, Section 28 05 13 CONDUCTORS AND CABLES FOR ELECTRONIC SAFETY AND SECURITY, Section 28 05 26 GROUNDING AND BONDING FOR ELECTRONIC SAFETY AND SECURITY, Section 28 05 28.33 CONDUIT AND BACKBOXES FOR ELECTRONIC SAFETY AND SECURITY, and all penetrations of smoke and fire barriers shall be protected as required by Section 07 84 00, FIRESTOPPING.
- B. All conduits, junction boxes, conduit supports and hangers shall be concealed in finished areas and may be exposed in unfinished areas.
- C. All new and reused exposed conduits shall be painted in accordance with Section 09 91 00, PAINTING to match surrounding finished areas and red in unfinished areas.
- D. All fire detection and alarm system devices, control units and remote annunciators shall be flush mounted when located in finished areas and may be surface mounted when located in unfinished areas. Exact locations are to be approved by the COR.
- E. Speakers shall be ceiling mounted and fully recessed in areas with suspended ceilings. Speakers shall be wall mounted and recessed in finished areas without suspended ceilings. Speakers may be surface mounted in unfinished areas.
- F. Strobes shall be flush wall mounted with the bottom of the unit located 80 inches (2,000 mm) above the floor or 6 inches (150 mm) below ceiling, whichever is lower. Locate and mount to maintain a minimum 36 inches (900 mm) clearance from side obstructions.
- G. Manual pull stations shall be installed not less than 42 inches (1,050 mm) or more than 48 inches (1,200 mm) from finished floor to bottom of device and within 60 inches (1,500 mm) of a stairway or an exit door.

#### **3.2 TYPICAL OPERATION**

- A. Activation of any manual pull station, heat detector, gaseous suppression system, or smoke detector shall cause the following operations to occur:

1. Operate the emergency voice communication system in Building. For sprinkler protected buildings, flash strobes continuously only in the zone of alarm.
  2. Continuously sound a temporal pattern general alarm and flash all strobes in the building in alarm until reset at the local fire alarm control unit in Building.
  3. Release only the magnetic door holders in the smoke zone after the alert signal.
  4. Transmit a separate alarm signal, via the main fire alarm control unit to the fire department.
  5. Unlock the electrically locked exit doors within the zone of alarm.
- B. Smoke detectors in the primary elevator lobbies of the Building shall, in addition to the above functions, return all elevators in the bank to the secondary floor.
- C. Smoke detectors in the remaining elevator lobbies in addition to the above functions, return all elevators in the bank to the primary floor.
- D. Operation of a smoke detector at a corridor door used for automatic closing shall also release only the magnetic door holders in that smoke zone.
- E. Operation of duct smoke detectors shall cause a system supervisory condition and shut down the ventilation system and close the associated smoke dampers as appropriate.
- F. Operation of any sprinkler or standpipe system valve supervisory switch, high/low air pressure switch, or fire pump alarm switch shall cause a system supervisory condition.
- G. Alarm verification shall not be used for smoke detectors installed for the purpose of early warning.

### **3.3 TESTS**

- A. Provide the service of a NICET level III, competent, factory-trained engineer or technician authorized by the manufacturer of the fire alarm equipment to technically supervise and participate during all of the adjustments and tests for the system. Make all adjustments and tests in the presence of the COR.
- B. When the systems have been completed and prior to the scheduling of the final inspection, furnish testing equipment and perform the following tests in the presence of the COR. When any defects are detected, make repairs or install replacement components, and repeat the tests until

such time that the complete fire alarm systems meets all contract requirements. After the system has passed the initial test and been approved by the COR, the contractor may request a final inspection.

1. Before energizing the cables and wires, check for correct connections and test for short circuits, ground faults, continuity, and insulation.
2. Test the insulation on all installed cable and wiring by standard methods as recommended by the equipment manufacturer.
3. Open each alarm initiating and notification circuit to see if trouble signal actuates.
4. Ground each alarm initiation and notification circuit and verify response of trouble signals.

### **3.4 FINAL INSPECTION AND ACCEPTANCE**

- A. Prior to final acceptance a minimum 30 day "burn-in" period shall be provided. The purpose shall be to allow equipment to stabilize and potential installation and software problems and equipment malfunctions to be identified and corrected. During this diagnostic period, all system operations and malfunctions shall be recorded. Final acceptance will be made upon successful completion of the "burn-in" period and where the last 14 days is without a system or equipment malfunction.
- B. At the final inspection a factory trained representative of the manufacturer of the major equipment shall repeat the tests in Article 3.3 TESTS and those required by NFPA 72. In addition the representative shall demonstrate that the systems function properly in every respect. The demonstration shall be made in the presence of a VA representative.

### **3.5 INSTRUCTION**

- A. The manufacturer's authorized representative shall provide instruction and training to the VA as follows:
  1. Six 1-hour sessions to engineering staff, security police and central attendant personnel for simple operation of the system. Two sessions at the start of installation, 2 sessions at the completion of installation and 2 sessions 3 months after the completion of installation.
  2. Four 2-hour sessions to engineering staff for detailed operation of the system. Two sessions at the completion of installation and 2 sessions 3 months after the completion of installation.

3. Three 8-hour sessions to electrical technicians for maintaining, programming, modifying, and repairing the system at the completion of installation and one 8-hour refresher session 3 months after the completion of installation.
- B. The Contractor and/or the Systems Manufacturer's representative shall provide a typewritten "Sequence of Operation" including a trouble shooting guide of the entire system for submittal to the VA. The sequence of operation will be shown for each input in the system in a matrix format and provided in a loose leaf binder. When reading the sequence of operation, the reader will be able to quickly and easily determine what output will occur upon activation of any input in the system. The INPUT/OUTPUT matrix format shall be as shown in Appendix A to NFPA 72.
- C. Furnish the services of a competent instructor for instructing personnel in the programming requirements necessary for system expansion. Such programming shall include addition or deletion of devices, zones, indicating circuits and printer/display text.

- - END - -