



STORM DRAINAGE KEYED NOTES

KEY NOTE

- 1 INSTALL NEW 4" PVC PERF. PIPE ADJUST LOCATION OR INCREASE PIPE GRADE AS NECESSARY. SLOPE AT 0.5% MIN. SEE DETAIL A1/C-201.
- 2 INSTALL 4" PVC CLEANOUT/INSPECTION PORT WITH THREADED PLUG. FLUSH WITH FINAL GRADE; CONNECT TO DRAIN LINE WITH 4X4 PVC TEE (OR ELL AT ENDS). SEE DETAIL A2/C-201.
- 3 CONSTRUCT NEW 24" X 24" AREA DRAIN IN TURF WITH RIM AND INVERT AS SHOWN. CONNECT NEW 4" PVC PERF. PIPE TO NEW AREA DRAIN. SEE DETAIL A3/C-201.
- 4 INSTALL NEW MANHOLE. CONSTRUCT BASE AROUND EXISTING 15" HDPE SD PIPE THEN CUT PIPE. SEE DETAIL A4/C-201.
- 5 INSTALL NEW 6" HDPE DUAL WALL SOLID PIPE BETWEEN NEW AREA DRAIN AND NEW MANHOLE.
- 6 BACKFILL AND PATCH ASPHALT ROAD CUT. SEE DETAIL A5/C-201.
- 7 CONNECT NEW 4" PVC PERF. PIPE TO EXISTING AREA DRAINS. CUT DIRECTLY INTO SIDE OF DRAIN BOX AND GROUT.

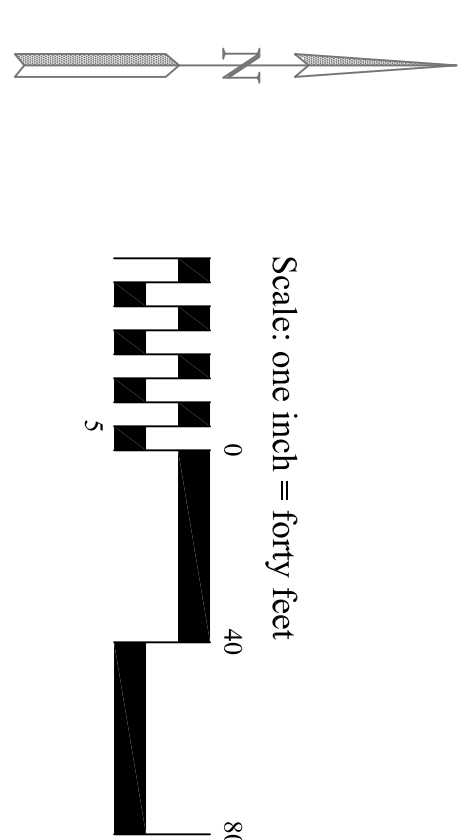

Revisions		Date		<div> NATIONAL CEMETERY ADMINISTRATION</div>		<div>Drawing Title STORM DRAINAGE PLAN</div>		<div>Project Title REPAIR STORM DRAINAGE</div>		<div>Date 03/07/2016</div>	
				Approved: Division Chief		Building Number ****		Checked		Drawn CFC	
				Approved: Service Director		Location BILLOXI NATIONAL CEMETERY		Project No. 832-16-201		Drawing No. C-102	
								Dwg. 4 Of 5			