
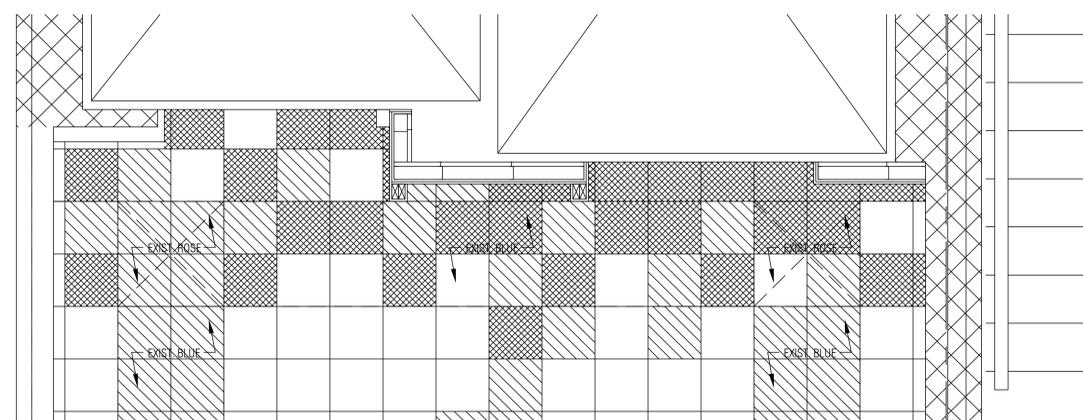
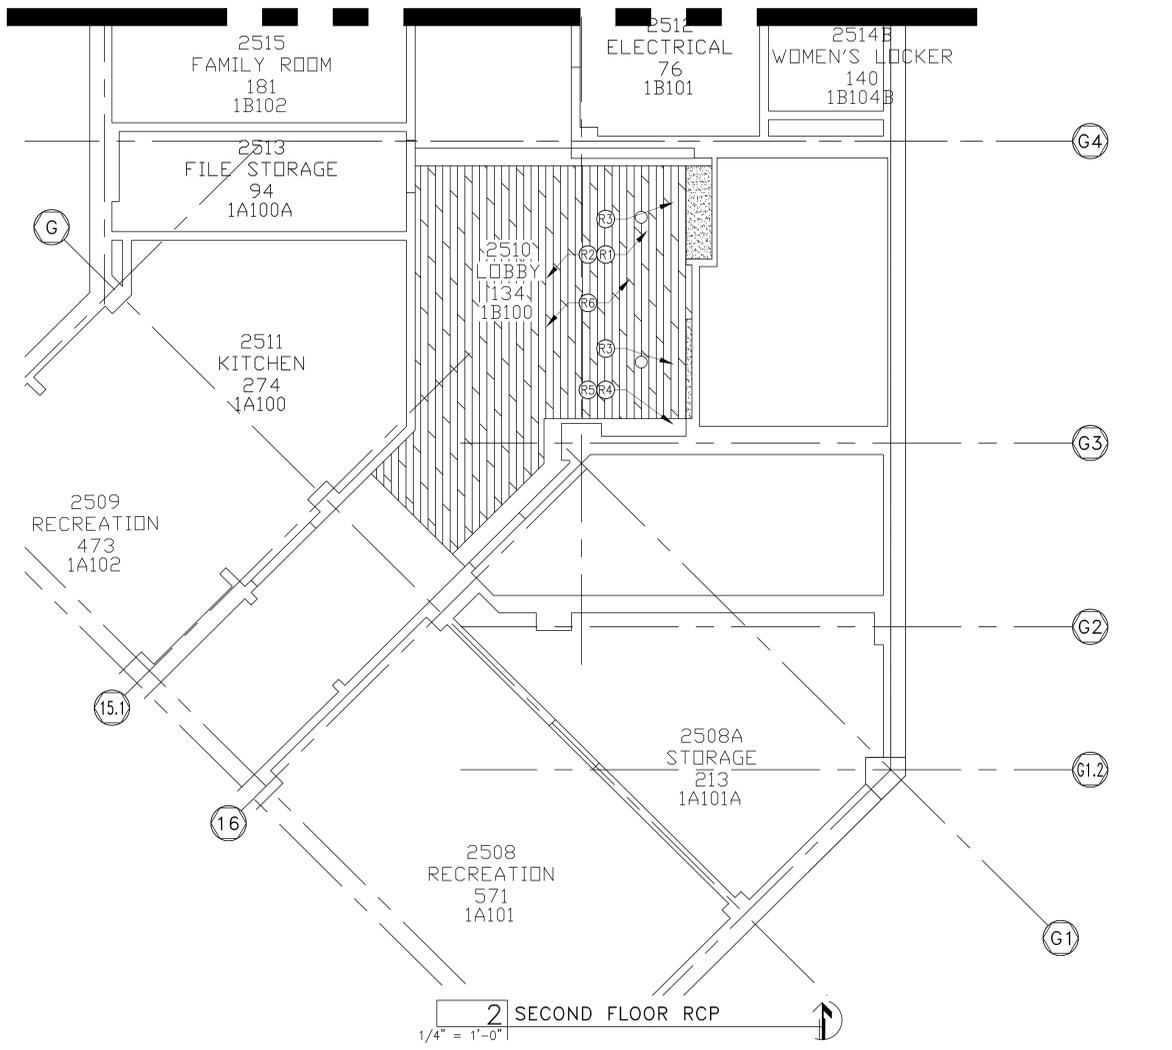


three inches = one foot  
 one and one half inches = one foot  
 one inch = one foot  
 three quarters inch = one foot  
 one half inch = one foot  
 three eighths inch = one foot  
 one quarter inch = one foot  
 one eighth inch = one foot

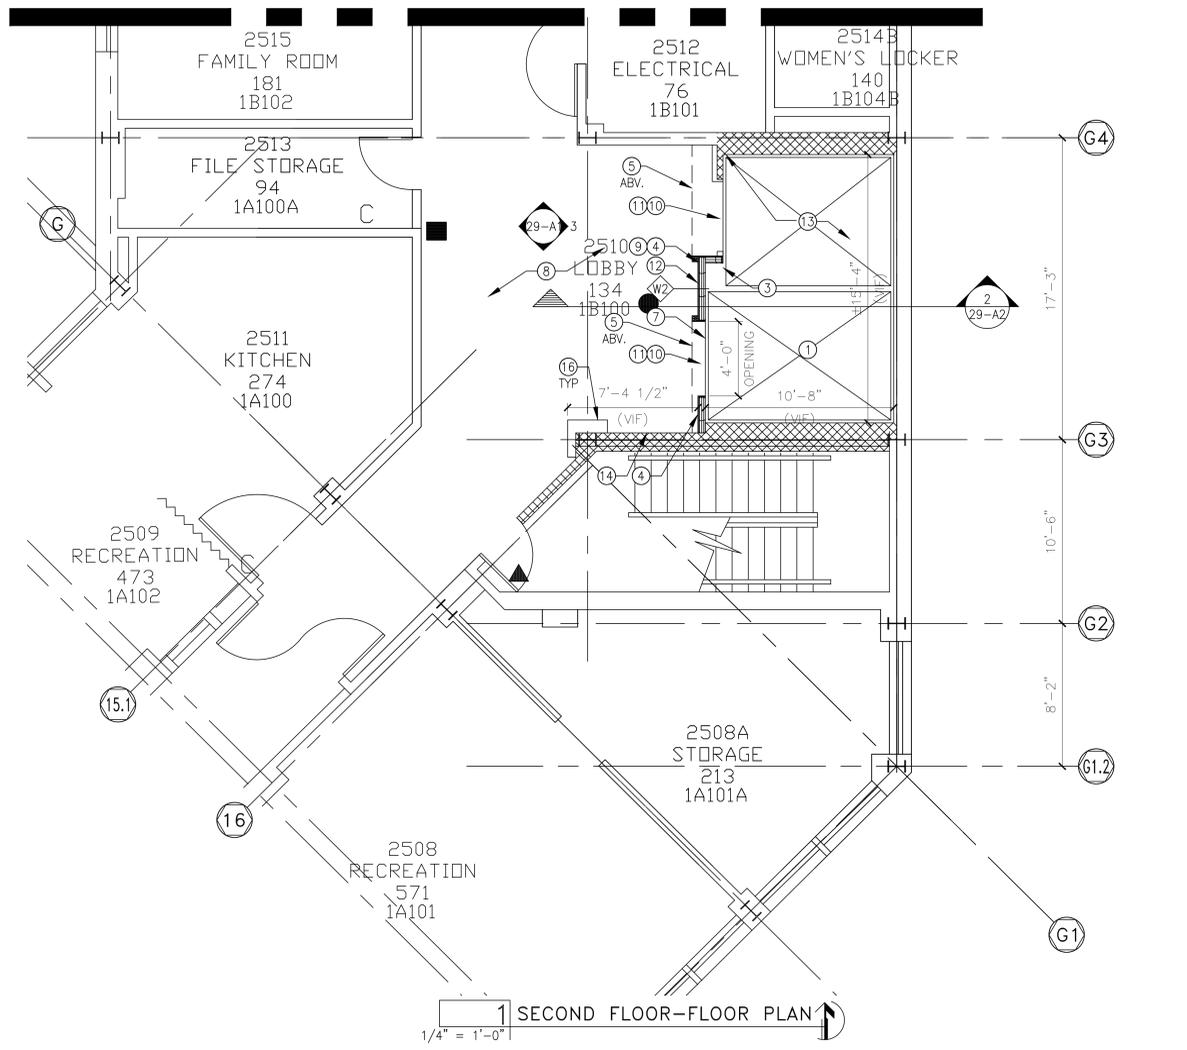

**3 TILE PATTERN LAYOUT**  
 3/4" = 1'-0" TILE LEGEND \*VERIFY IN FIELD THE EXTENT OF DEMOLITION AND ADJUST TILE PATTERN ACCORDINGLY.\*

EXISTING 'BLUE' TILE  
 EXISTING 'FIELD' TILE  
 ARMSTRONG IMPERIAL TEXTURE STANDARD EXCELON, 51884 GREENERY, OR EQUAL.

NOTE: THE LIMITS OF THE NEW TILE PATTERN ARE SUBJECT TO THE REQUIRED DEMOLITION, AND IS TO EXTEND ONLY THE LENGTH OF BOTH ELEVATOR ENTRIES. ADJACENT CORRIDOR FIELD PATTERN IS TO REMAIN.

**GENERAL NOTES:**


- COORDINATE ALL WORK W/ MECHANICAL & ELECTRICAL PLANS FOR ADDITIONAL REQUIREMENTS.
- VERIFY ALL CONDITIONS PRIOR TO START OF WORK.
- DEMOLITION AND NEW CONSTRUCTION SHALL BE COORDINATED WITH MEDICAL FACILITY TO MINIMIZE DISRUPTION DURING NEW WORK.
- PATCHING AND REPLACEMENT OF EXISTING FINISHES SHALL BE OF EQUAL OR GREAT VALUE. MATCH TO EXISTING COLORS AND TEXTURES.
- EXISTING ELEVATOR SHAFT WALLS & WALLS OF EQUIPMENT ROOMS ARE FIRE RATED. ANY PENETRATIONS THROUGH WALL OR FACE OF WALL SHALL BE FIRE STOPPED TO MAINTAIN RATING (2 HR).
- REF. WALL LEGEND, SHEET 29-A4.

**FLOOR PLAN KEYNOTES:**

- NOT ALL KEYNOTES USED
- PROVIDE NEW ELEVATOR. SCHINDLER 330A HOLES HYDRAULIC. HOSPITAL/SERVICE. COORDINATE ALL WORK WITH ELEC., STRUC. AND ELEVATOR MANUF.
  - PROVIDE NEW MASONRY ELEVATOR SHAFT. REF. STRUCTURAL DOCUMENTS FOR ADDITIONAL REQUIREMENTS. REF. 1/52.01.
  - DEMO EXISTING WALL AND SLAB/STRUCTURE. AS REQUIRED TO ENLARGE EXISTING ELEVATOR SHAFT.
  - NEW SHAFT-WALL PARTITION REF. WALL TYPES.
  - NEW ELEVATOR ENTRY. 1/2" GWB ON HC-STUDS AND 2X4 FLOORING. TEXTURE AS COURSE KNOCK-DOWN FRAME AND PAINT AS SPECIFIED. REF. INTERIOR ELEVATIONS FOR LIMITS.
  - REPLACE DOOR TRACK OF EXISTING ELEVATOR. COORD. ALL WORK WITH ELEVATOR MANUF.
  - SAW CUT EXIST CONC./STEEL DECK FLOOR SLAB AS REDD FOR NEW WORK. REF. STRUCT. FOR NEW WORK. PROVIDE NEW STEEL ANGLE EDGE. & PATCH ANY GAPS BETWEEN CONC. & ANGLE FLUSH W/ FINISH FLOOR.
  - REMOVE EXIST. VCT & MASTIC TO BARE CONC. REMOVE TILES TO NEAREST FULL TILE. PROVIDE NEW TILE TO MATCH EXIST. REF. DRAWING 3/A9-A3.
  - PROVIDE NEW BASE TO MATCH EXISTING.
  - PROVIDE NEW HALL LANTERN (LED). CENTERLINE MOUNTED AT 72" A.F.F. MIN. VISUAL ELEMENTS SHALL BE AT LEAST 2-1/2" IN THE SMALLEST DIMENSION. NEW HALL LANTERN SHALL INCORPORATE AUDIBLE SIGNAL AND SHALL SOUND ONCE FOR UP AND TWICE FOR DOWN, OR SHALL HAVE VERBAL ENUNCIATORS THAT SAY "UP" OR "DOWN". COORDINATE HALL LANTERN WITH ELEC DOCUMENTS.
  - EXISTING/NEW RAISED AND BRAILLE CHARACTER SIGNAGE TO BE SALVAGED BUT MUST MEET FOLLOWING REQUIREMENTS. REPLACE AS NECESSARY TO COMPLY:
    - ALL HOISTWAY ENTRANCES SHALL HAVE BRAILLE-SIGNAGE FLOOR DESIGNATORS PROVIDED BOTH JAMS.
    - CENTERLINE OF CHARACTERS SHALL BE MOUNTED AT 60" A.F.F. 2" CHARACTERS.
  - PROVIDE NEW CALL BUTTON. CENTERLINE MOUNTED AT 42" A.F.F. CALL BUTTON SHALL HAVE VISUAL SIGNALS. MIN. 3/4" IN THE SMALLEST DIMENSION.
  - INSTALL NEW ENERGY EFFICIENT LIGHTING WITHIN EXISTING ELEVATOR CAB. COORDINATE WORK WITH ELEVATOR MANUF. REF. ELECTRICAL DOCUMENTS FOR ADDITIONAL REQUIREMENTS. REMOVE AND SALVAGE EXIST. T-12 LIGHTING TO VA FACILITY.
  - RELOCATE FIRE EXTINGUISHER AND F.E. CABINET. COORDINATE WORK WITH EXISTING FIRE ALARMS AND SPRINKLERS WERE NECESSARY. DEMO AND PATCH WALL AS REDD FOR WORK.
  - PROVIDE NEW MECHANICAL FOR NEW ELEVATOR. COORDINATE WORK AND REQUIREMENTS WITH ELEVATOR MANUF., ELEC., AND MECH. RELOCATE ANY EXISTING EQUIPMENT AS NEEDED FOR NEW WORK.
  - EXISTING HAND RAIL AND BUMPER GUARDS. MODIFY FOR NEW WORK. EXISTING HEIGHTS TO REMAIN.

**RCP KEYNOTES:**

- NOT ALL KEYNOTES USED
- REMOVE AND SALVAGE CEILING WOOD FOR REUSE. REINSTALL AS REQUIRED TO FIT NEW LAYOUT. REPLACE DAMAGED WOOD FROM CONSTRUCTION. ANY REMAINING WOOD TO BE SALVAGED TO FACILITY MNGT.
  - MODIFY ELEC., HVAC, PLUMB, SPECIAL SYSTEM FIRE SPRINKLERS ETC. ABOVE CEILING SPACE AS REQUIRED FOR NEW WORK.
  - NEW ELEVATOR ENTRY ELEMENT BELOW. 1/2" GWB ON HC-STUD. TEXTURE WITH COURSE KNOCK-DOWN FINISH AND PAINT AS SPECIFIED. REF. INTERIOR ELEVATIONS FOR LIMITS OF NEW ENTRY.
  - REMOVE AND SALVAGE WOOD TRIM AND SOFFIT TO FACILITY.
  - EXISTING WOOD SOFFIT TO TERMINATE AT NEW ELEVATOR ENTRY ELEMENT. RELOCATE CLOVE LIGHTING AS REQUIRED TO ALLOW FOR NEW OPENING.
  - COORD. ALL FIRE ALARM WORK WITH ELEC., MECH., AND ELEVATOR MANUF.

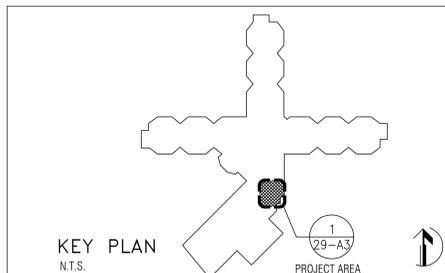

**CONSULTANTS:**

**ARCHITECT/ENGINEERS:**



**SBB** SBB Architecture + Planning  
 1001 North Alvernon Way #105, Tucson, Arizona 85711  
 e: sbbi@sbbi.biz

<b>Drawing Title</b> SECOND-FLOOR-PLAN		<b>Project Title</b> ELEVATOR REPAIRS AND UPGRADES, BUILDINGS 29		<b>Project Number</b> VA 504-11-105		Office of Construction and Facilities Management Department of Veterans Affairs
<b>Approved:</b> CHIEF ENGINEERING ASSOCIATE DIRECTOR FACILITY DIRECTOR		<b>Location</b> VAMC - THOMAS E. CREEK		<b>Building Number</b> 29		
<b>Date</b> 2.18.10		<b>Checked</b> KI		<b>Drawn</b> BM		<b>Drawing Number</b> 29-A3 Dwg. of 8
<b>Revisions:</b>		<b>Date</b>		<b>Date</b>		