
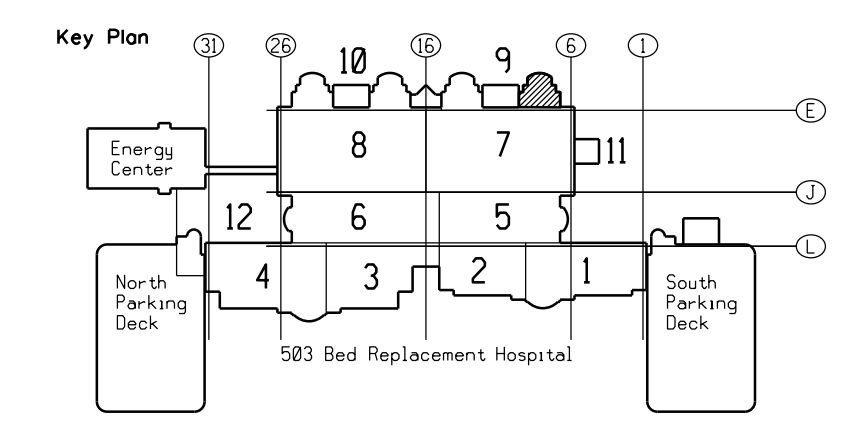


TYPICAL PIPE SPACE ALLOCATION
FOR RISER 40
SCALE: 1/2" = 1'-0"
PROVIDE CAPPED OFF 6" DIAMETER FLOOR SLEEVES
AT ALL FUTURE PIPE LOCATIONS.

- GENERAL NOTES:
- FOR INLINE FAN HANGER DETAIL SEE 5/H2-2.7
 - PROVIDE INLET SCREENS ON ALL UNDUCTED FANS.
 - FOR TYPICAL DUCT FLOOR PENETRATIONS SEE DETAILS.
 - FOR TYPICAL PIPE FLOOR PENETRATIONS SEE DETAILS.
 - FOR PIPE RISER SIZES, SECTIONALIZING VALVES & RUN OUT SHUT-OFF VALVES REFER TO THE FLOW DIAGRAMS.

MECHANICAL EQUIPMENT ROOM LL776
MECHANICAL SYSTEM RISER No. 0040

EXISTING SHEET - FOR REFERENCE ONLY

AMENDMENT NO.  Revisions		FULLY PROTECTED BY AUTOMATIC SPRINKLER SYSTEM FINAL SUBMISSION NOT FOR CONSTRUCTION		SH&G Smith, Hinchman & Grylls Associates, Inc. Architects Engineers Planners 455 West Fort Street, Detroit, Michigan 48226 313/964-3000		 Key Plan		Drawing Title LOWER LEVEL PLAN MECHANICAL ROOM LL776 Scale: 1/4" = 1'-0" Approved: Area Project Manager		Project Title 503 BED REPLACEMENT HOSPITAL Building Number 100 Location Detroit, Michigan		Date 12-29-91 Project No. 553-080 DRAWING NO. H7-4 Dwg. 01		Veterans Administration	
		SH&G Project No. 4999L													