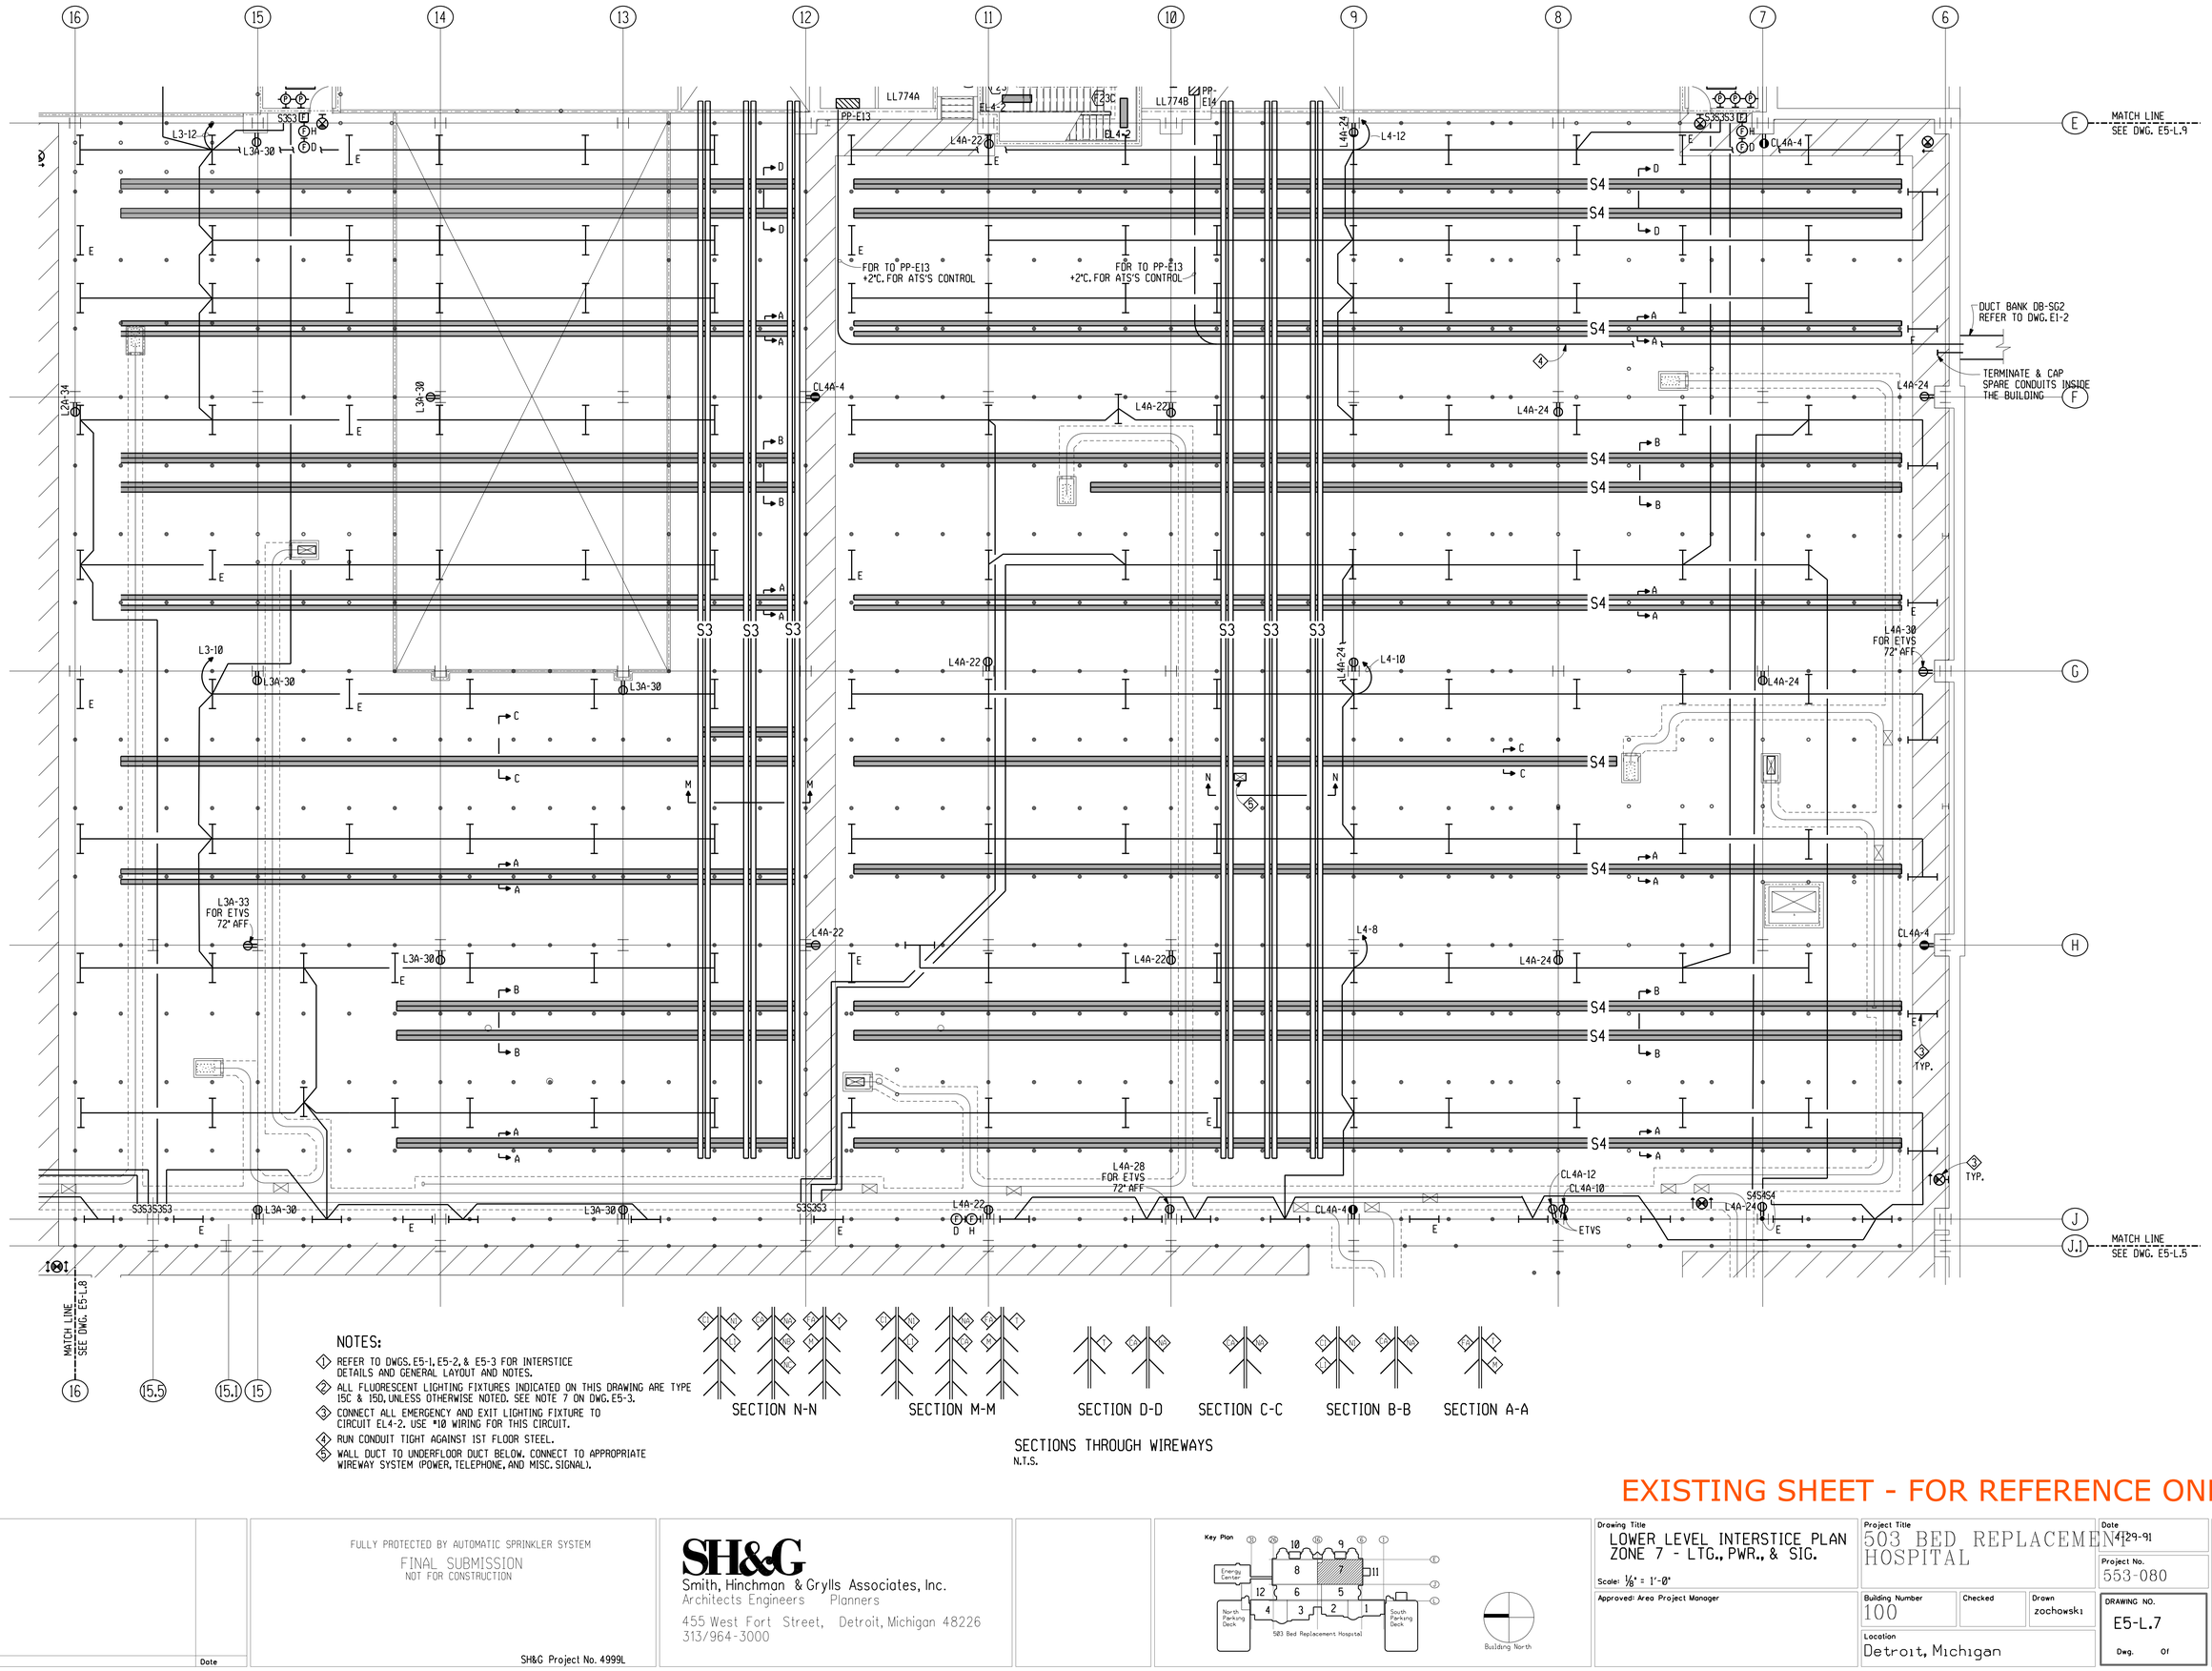

NOTES:

1. REFER TO DWGS. E5-1, E5-2, & E5-3 FOR INTERSTICE DETAILS AND GENERAL LAYOUT AND NOTES.
2. ALL FLUORESCENT LIGHTING FIXTURES INDICATED ON THIS DRAWING ARE TYPE 15C & 15D, UNLESS OTHERWISE NOTED. SEE NOTE 7 ON DWG. E5-3.
3. CONNECT ALL EMERGENCY AND EXIT LIGHTING FIXTURE TO CIRCUIT EL4-2. USE #10 WIRING FOR THIS CIRCUIT.
4. RUN CONDUIT TIGHT AGAINST 1ST FLOOR STEEL.
5. WALL DUCT TO UNDERFLOOR DUCT BELOW. CONNECT TO APPROPRIATE WIREWAY SYSTEM (POWER, TELEPHONE, AND MISC. SIGNAL).

SECTIONS THROUGH WIREWAYS
N.T.S.

EXISTING SHEET - FOR REFERENCE ONLY

FULLY PROTECTED BY AUTOMATIC SPRINKLER SYSTEM

FINAL SUBMISSION
NOT FOR CONSTRUCTION

Revisions | Date

SH&G Project No. 4999L

SH&G
Smith, Hinchman & Grylls Associates, Inc.
Architects Engineers Planners
455 West Fort Street, Detroit, Michigan 48226
313/964-3000

Key Plan

Drawing Title: LOWER LEVEL INTERSTICE PLAN ZONE 7 - LTG., PWR., & SIG.
Scale: 1/8" = 1'-0"
Approved: Area Project Manager

Project Title: 503 BED REPLACEMENT HOSPITAL
Building Number: 100
Location: Detroit, Michigan

Date: 4-29-91
Project No.: 553-080
Checked:
Drawn: zochowski

DRAWING NO.: E5-L.7
Dwg. Of

Veterans Administration

Plot Time: $$$$$$TIME$$$$$$
Plot File: $$$$$$$$$$$$DGNSPEC$$$$$$$$$$$$
Plot Date: $$$$$DATE$$$$$