


NOTES:

- 1 REFER TO DWGS. E5-1, E5-2, & E5-3 FOR INTERSTICE DETAILS AND GENERAL LAYOUT AND NOTES.
- 2 ALL FLUORESCENT LIGHTING FIXTURES INDICATED ON THIS DRAWING ARE TYPE 15C & 15D UNLESS OTHERWISE NOTED. SEE NOTE 7 ON DWG. NO. E5-3.
- 3 CONNECT ALL EMERGENCY AND EXIT LIGHTING FIXTURE TO CIRCUIT E14-5. USE #10 WIRING FOR THIS CIRCUIT.
- 4 3'-2" C. TO SECTION A-A NORTH OF COLUMN LINE H, AND 5'-2" C. TO SECTION B-B SOUTH OF COLUMN LINE F TO BRING SERVICES TO WIREWAYS SOUTH OF COLUMN LINE H. RUN CONDUIT HIGH IN S3 ZONE TO AVOID INTERFERENCE WITH TRASH AND LINEN CHUTES.

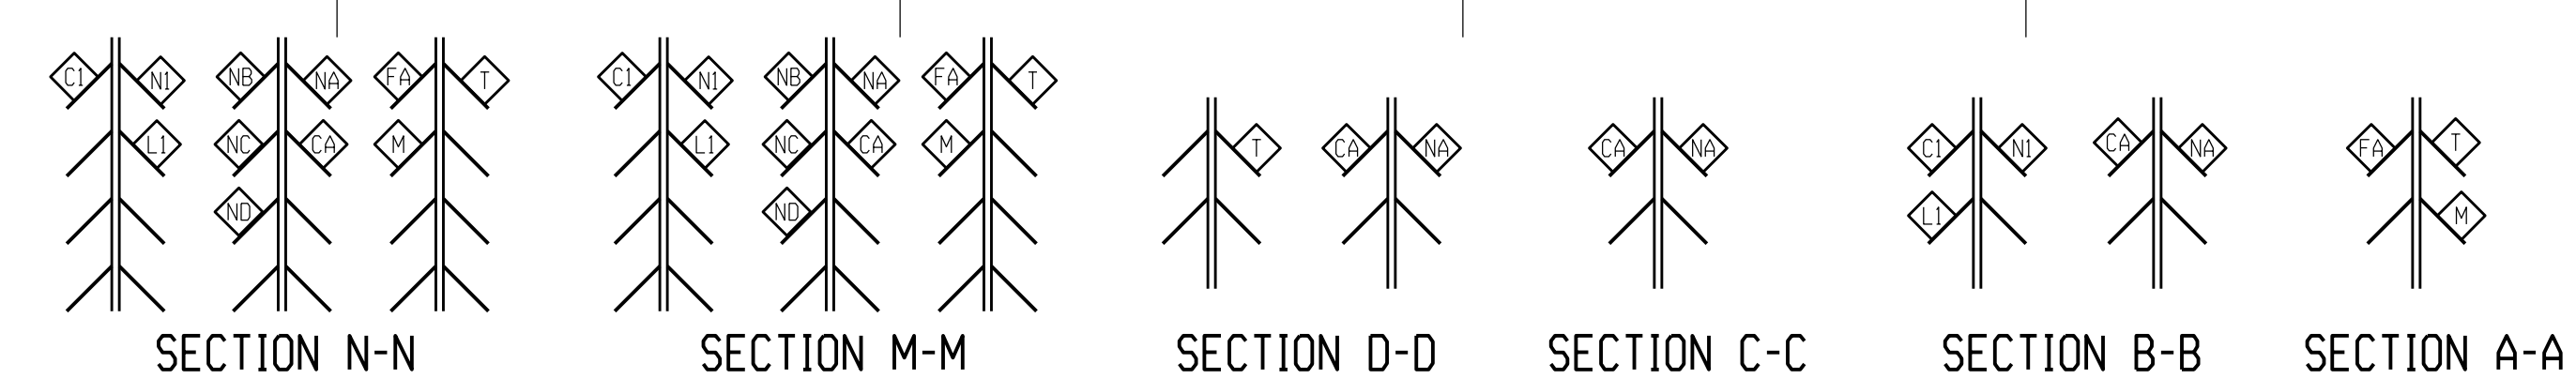

SECTIONS THROUGH WIREWAYS
N.T.S.

EXISTING SHEET - FOR REFERENCE ONLY

<p>Revisions</p>		<p>Date</p>	<p>FULLY PROTECTED BY AUTOMATIC SPRINKLER SYSTEM FINAL SUBMISSION NOT FOR CONSTRUCTION</p>	<p>SH&G Smith, Hinchman & Grylls Associates, Inc. Architects Engineers Planners 455 West Fort Street, Detroit, Michigan 48226 313/964-3000</p>	<p>Key Plan</p>	<p>Drawing Title FIRST FLOOR INTERSTICE PLAN ZONE 7 - LTG., PWR., & SIG.</p> <p>Scale: 1/8" = 1'-0"</p> <p>Approved: Area Project Manager</p>	<p>Project Title 503 BED REPLACEMENT HOSPITAL</p> <p>Building Number 100</p> <p>Location Detroit, Michigan</p>	<p>Date 4/29-91</p> <p>Project No. 553-080</p> <p>DRAWING NO. E5-1.7</p> <p>Dwg. of</p>	<p>Veterans Administration</p>
------------------	--	-------------	--	---	-----------------	--	---	--	---------------------------------------