



EMERGENCY POWER  
IS FROM BUILDING 5

GEN-BLDG 5  
313 kVA  
X'd 0.2 pu

CBL-5 ATS BLDG 5 E0  
(2) Size 500  
Copper THHN, PVC  
14.0 ft  
Ampacity 860.0 A

5-EMER GEN MAIN  
800A

208 V BUS-5EDP3G

5-FDR BLD 3 EMER

CBL -3 EMER  
(1) Size 4/0  
Copper THHN, PVC  
54.0 ft  
Ampacity 260.0 A

BUS-3 EMERG  
208 V  
EMER CIR FUSE

CBL -3 EMER0  
(1) Size 4/0  
Copper THHN, PVC  
54.0 ft  
Ampacity 260.0 A

BUILDING 3

208 V

BUS-MDP3

3-FDR 3LP1

100AT

CBL 3LP1  
(1) Size 2  
Copper THHN, PVC  
8.0 ft  
Ampacity 130.0 A

3LP1  
208 V

3-FDR 3RP1

225AT

CBL 3RP1  
(1) Size 350  
Copper THHN, PVC  
12.0 ft  
Ampacity 350.0 A

3RP1  
208 V

3-FDR 3LP2

100AT

CBL 3LP2  
(1) Size 2  
Copper THWN, 20.0 ft  
Ampacity 115.0 A

3-3LP2 MAIN  
3LP2  
208 V

3-FDR 3RP2

100AT

CBL 3RP2  
(1) Size 2  
Copper THWN, 15.0 ft  
Ampacity 115.0 A

3RP2  
208 V

3-FDR 3LP3

100AT

CBL 3LP3  
(1) Size 2  
Copper THHN, PVC  
30.0 ft  
Ampacity 130.0 A

3-3LP3 MAIN  
3LP3  
208 V

3-FDR 3RP3

100AT

CBL 3RP3  
(1) Size 2  
Copper THHN, PVC  
30.0 ft  
Ampacity 130.0 A

3RP3  
208 V

3-FDR ATS3-T005

225AT

CBL 3ATS-T005  
(1) Size 4/0  
Copper THWN, 30.0 ft  
Ampacity 230.0 A

CUMMINS ATS  
225A  
30KA WITHSTAND

N E

60AT

CBL 3EP1  
(1) Size 4/0  
Copper THWN, 30.0 ft  
Ampacity 230.0 A

3EP1  
208 V  
FDR 3RP5

60AT

CBL 3EP3  
(1) Size 6  
Copper THHN, PVC  
12.0 ft  
Ampacity 75.0 A

3RP4 MAIN0

3EP3  
208 V

3-FDR 3PP4-T301

400AT

CBL 3PP4  
(2) Size 4/0  
Copper THHN, PVC  
45.0 ft  
Ampacity 520.0 A

100AT

3-FDR 3RP4

CBL 3RP4  
(1) Size 2  
Copper THHN, PVC  
12.0 ft  
Ampacity 130.0 A

100AT

3RP4 MAIN

3RP4  
208 V

3-FDR ELEV-T016

200AT


CBL ELEV CONT  
(1) Size 4/0  
Copper THHN, PVC  
45.0 ft  
Ampacity 260.0 A

ELEV CONT  
208 V


3PP4  
208 V

3-FDR AHU-2


3-FDR AHU-3

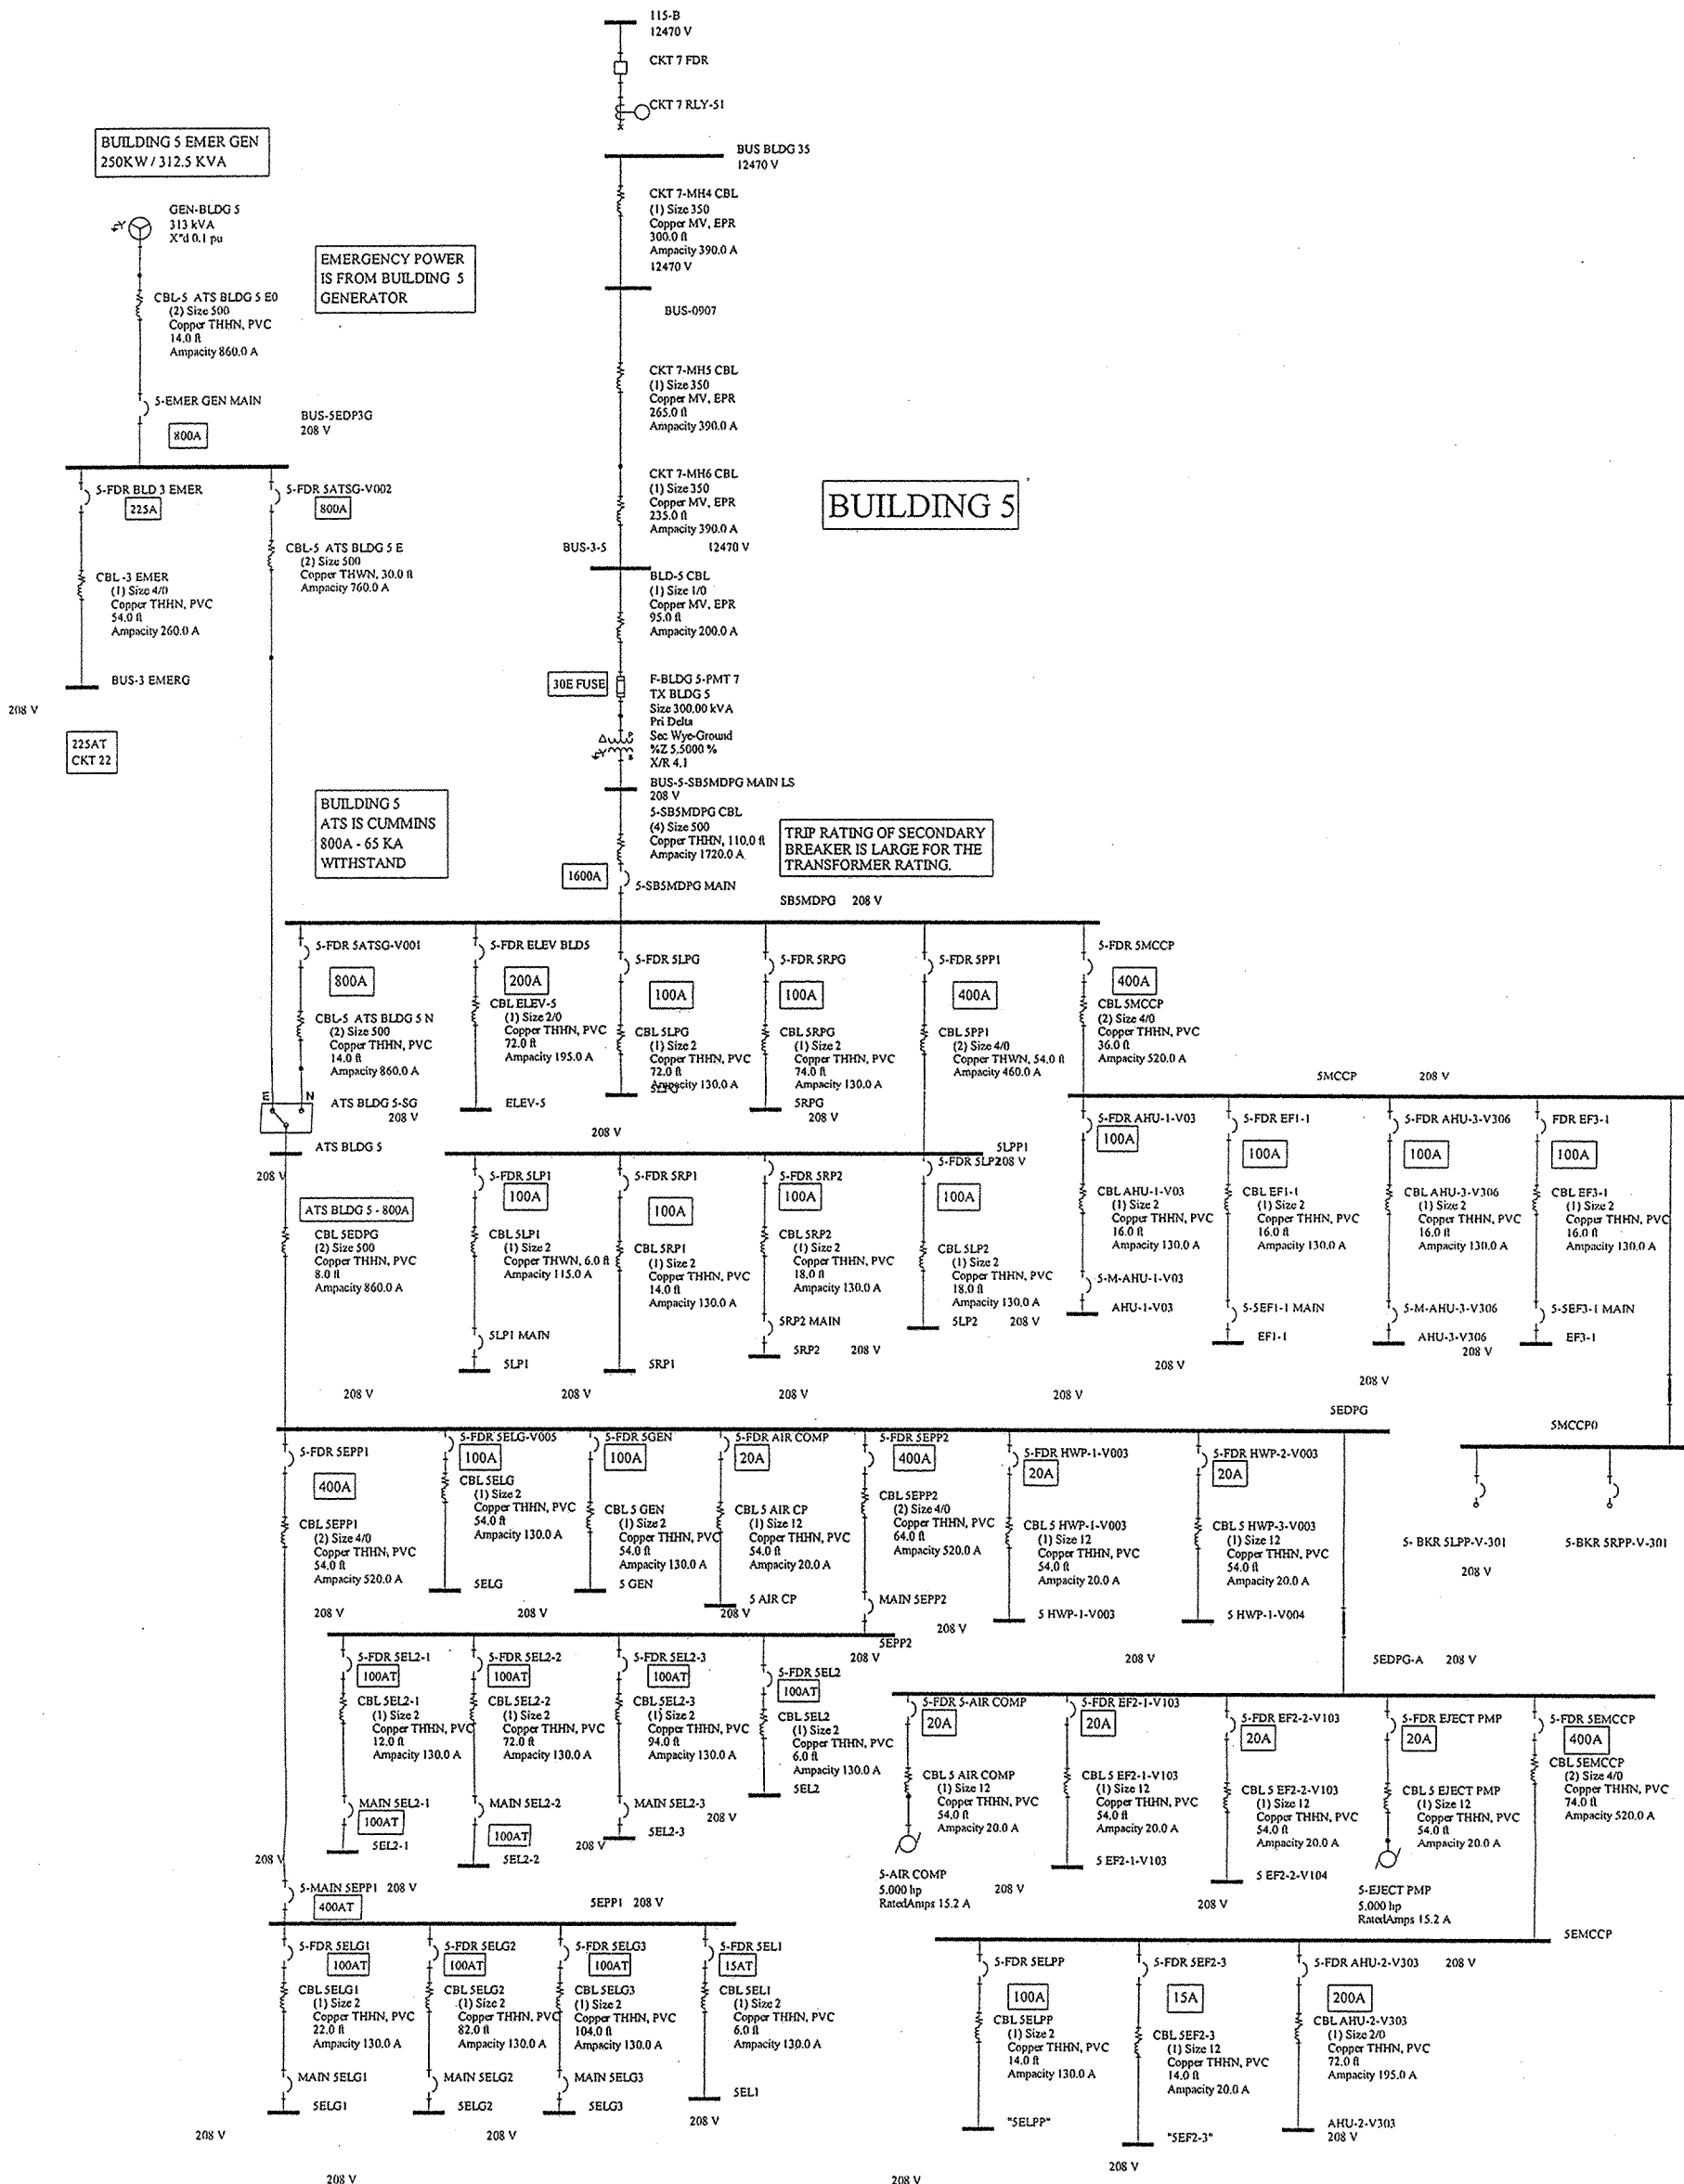





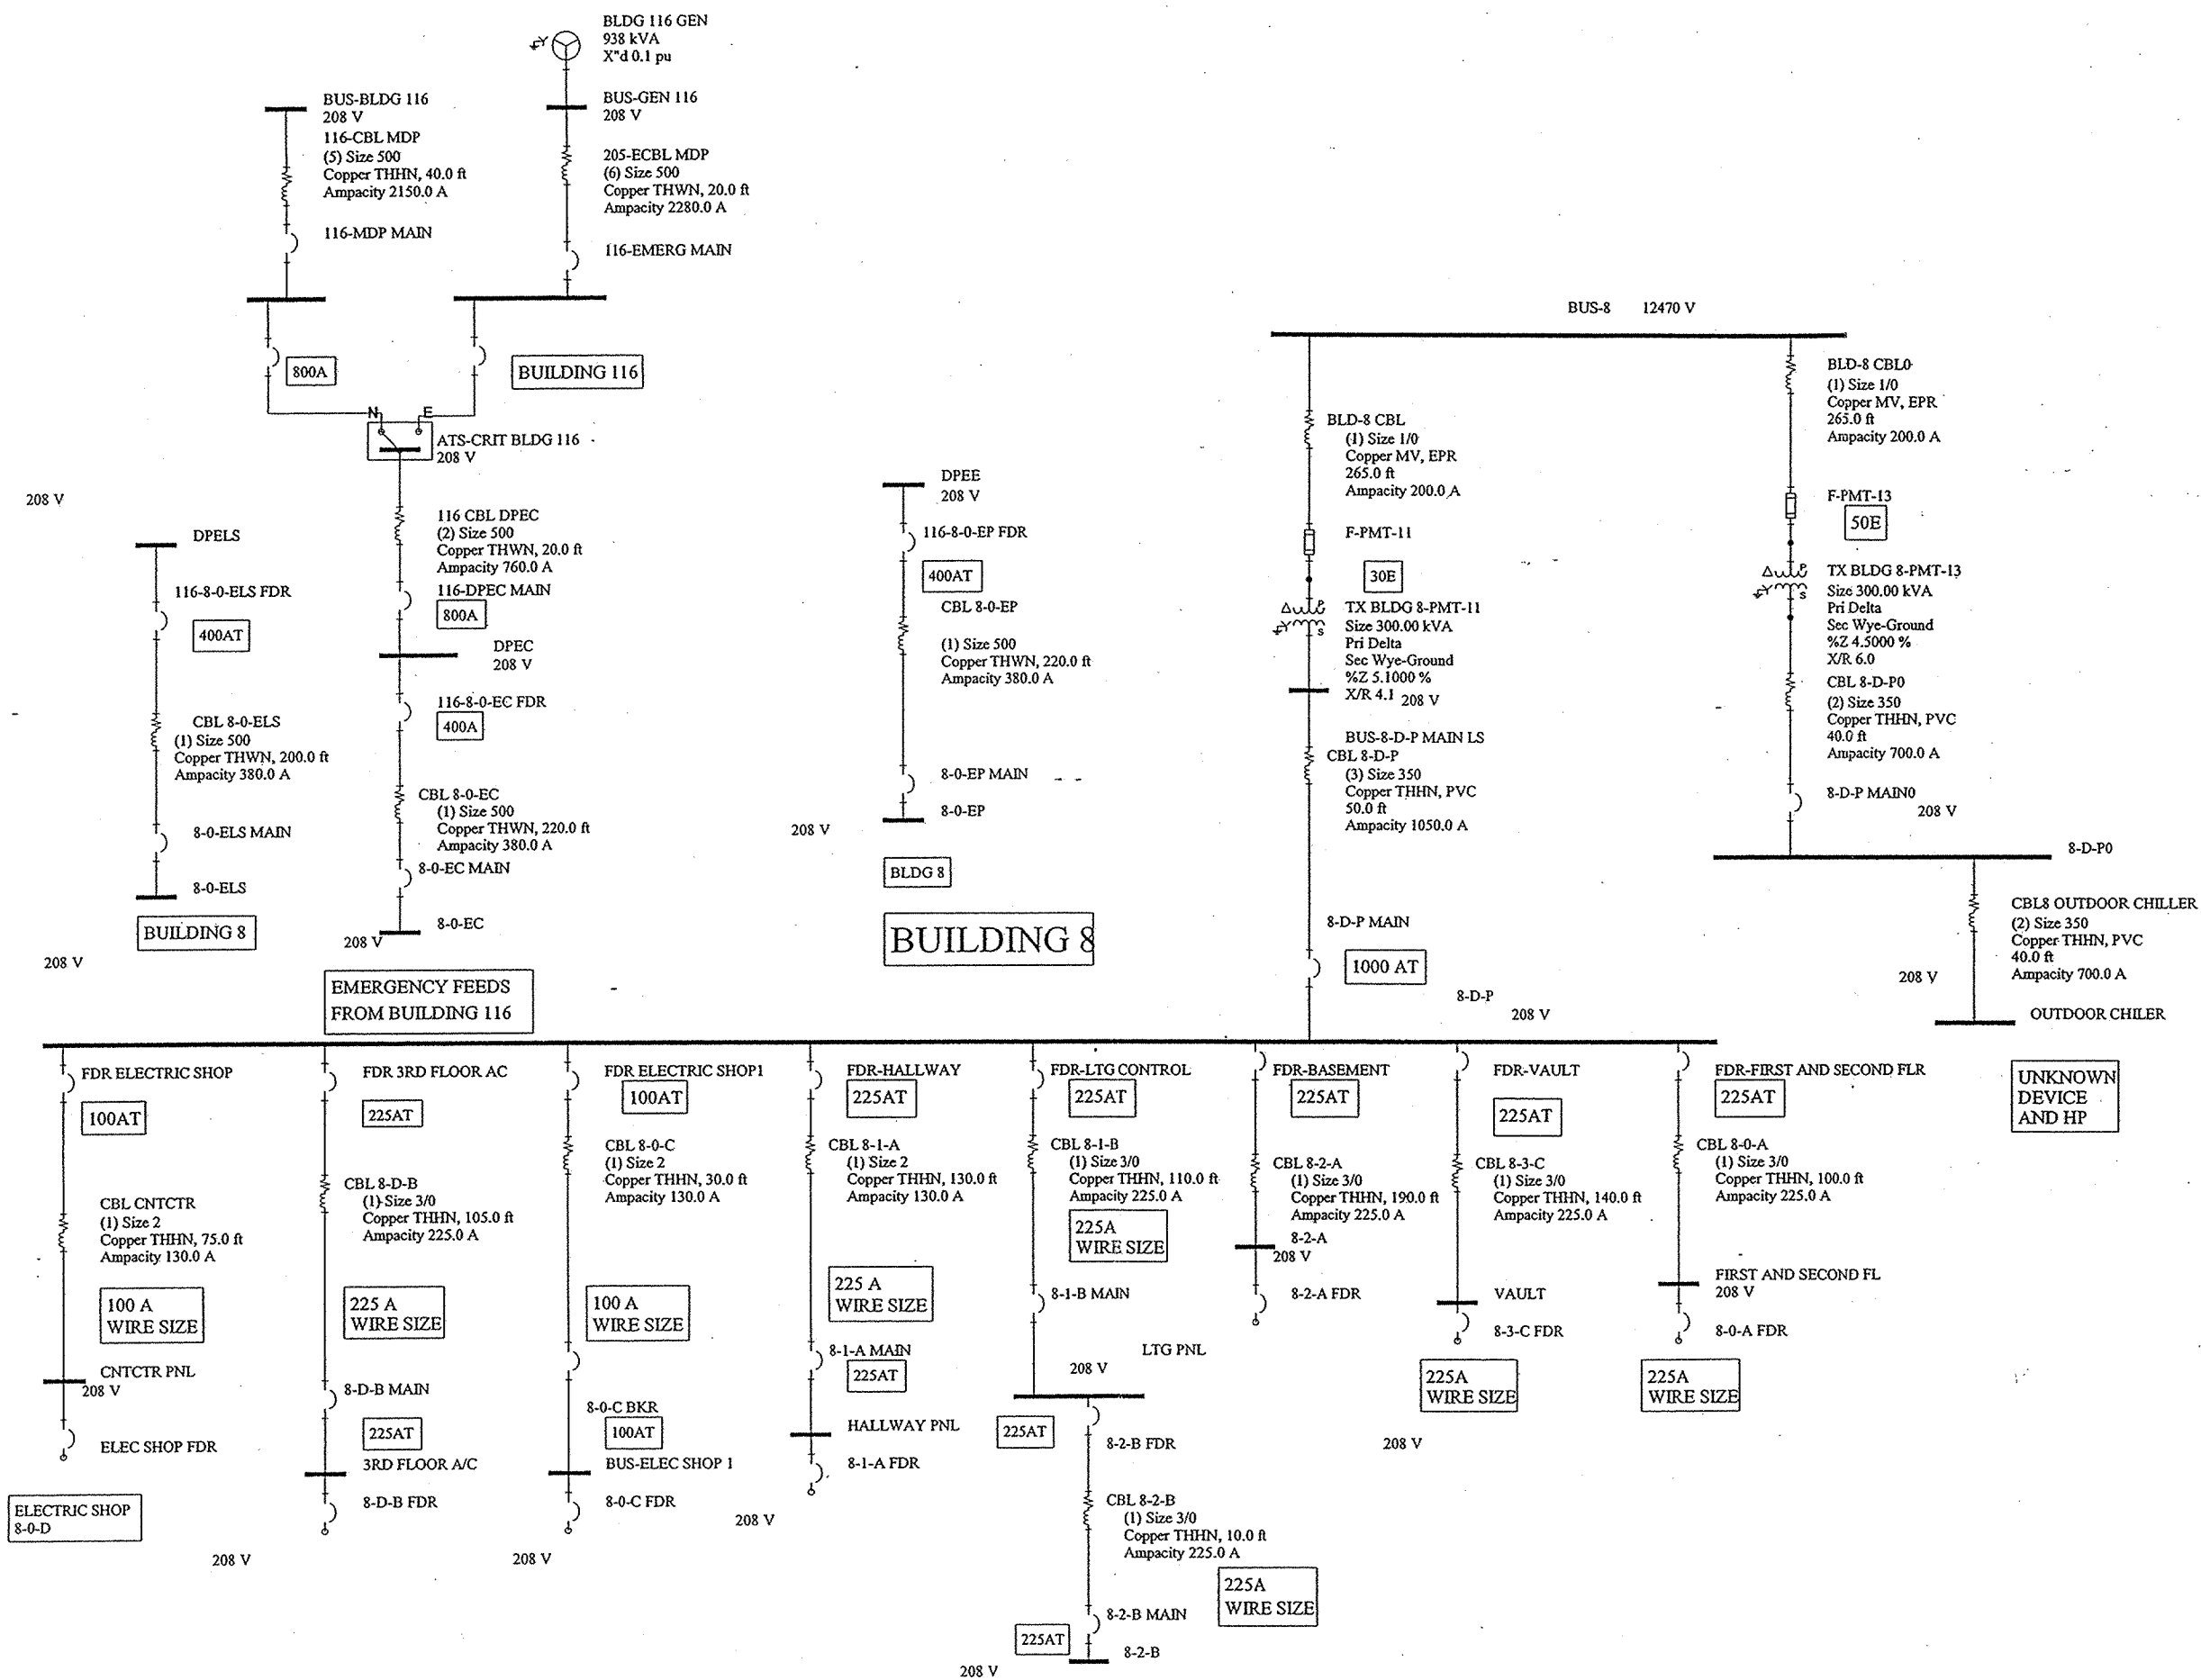


# BUILDING 20

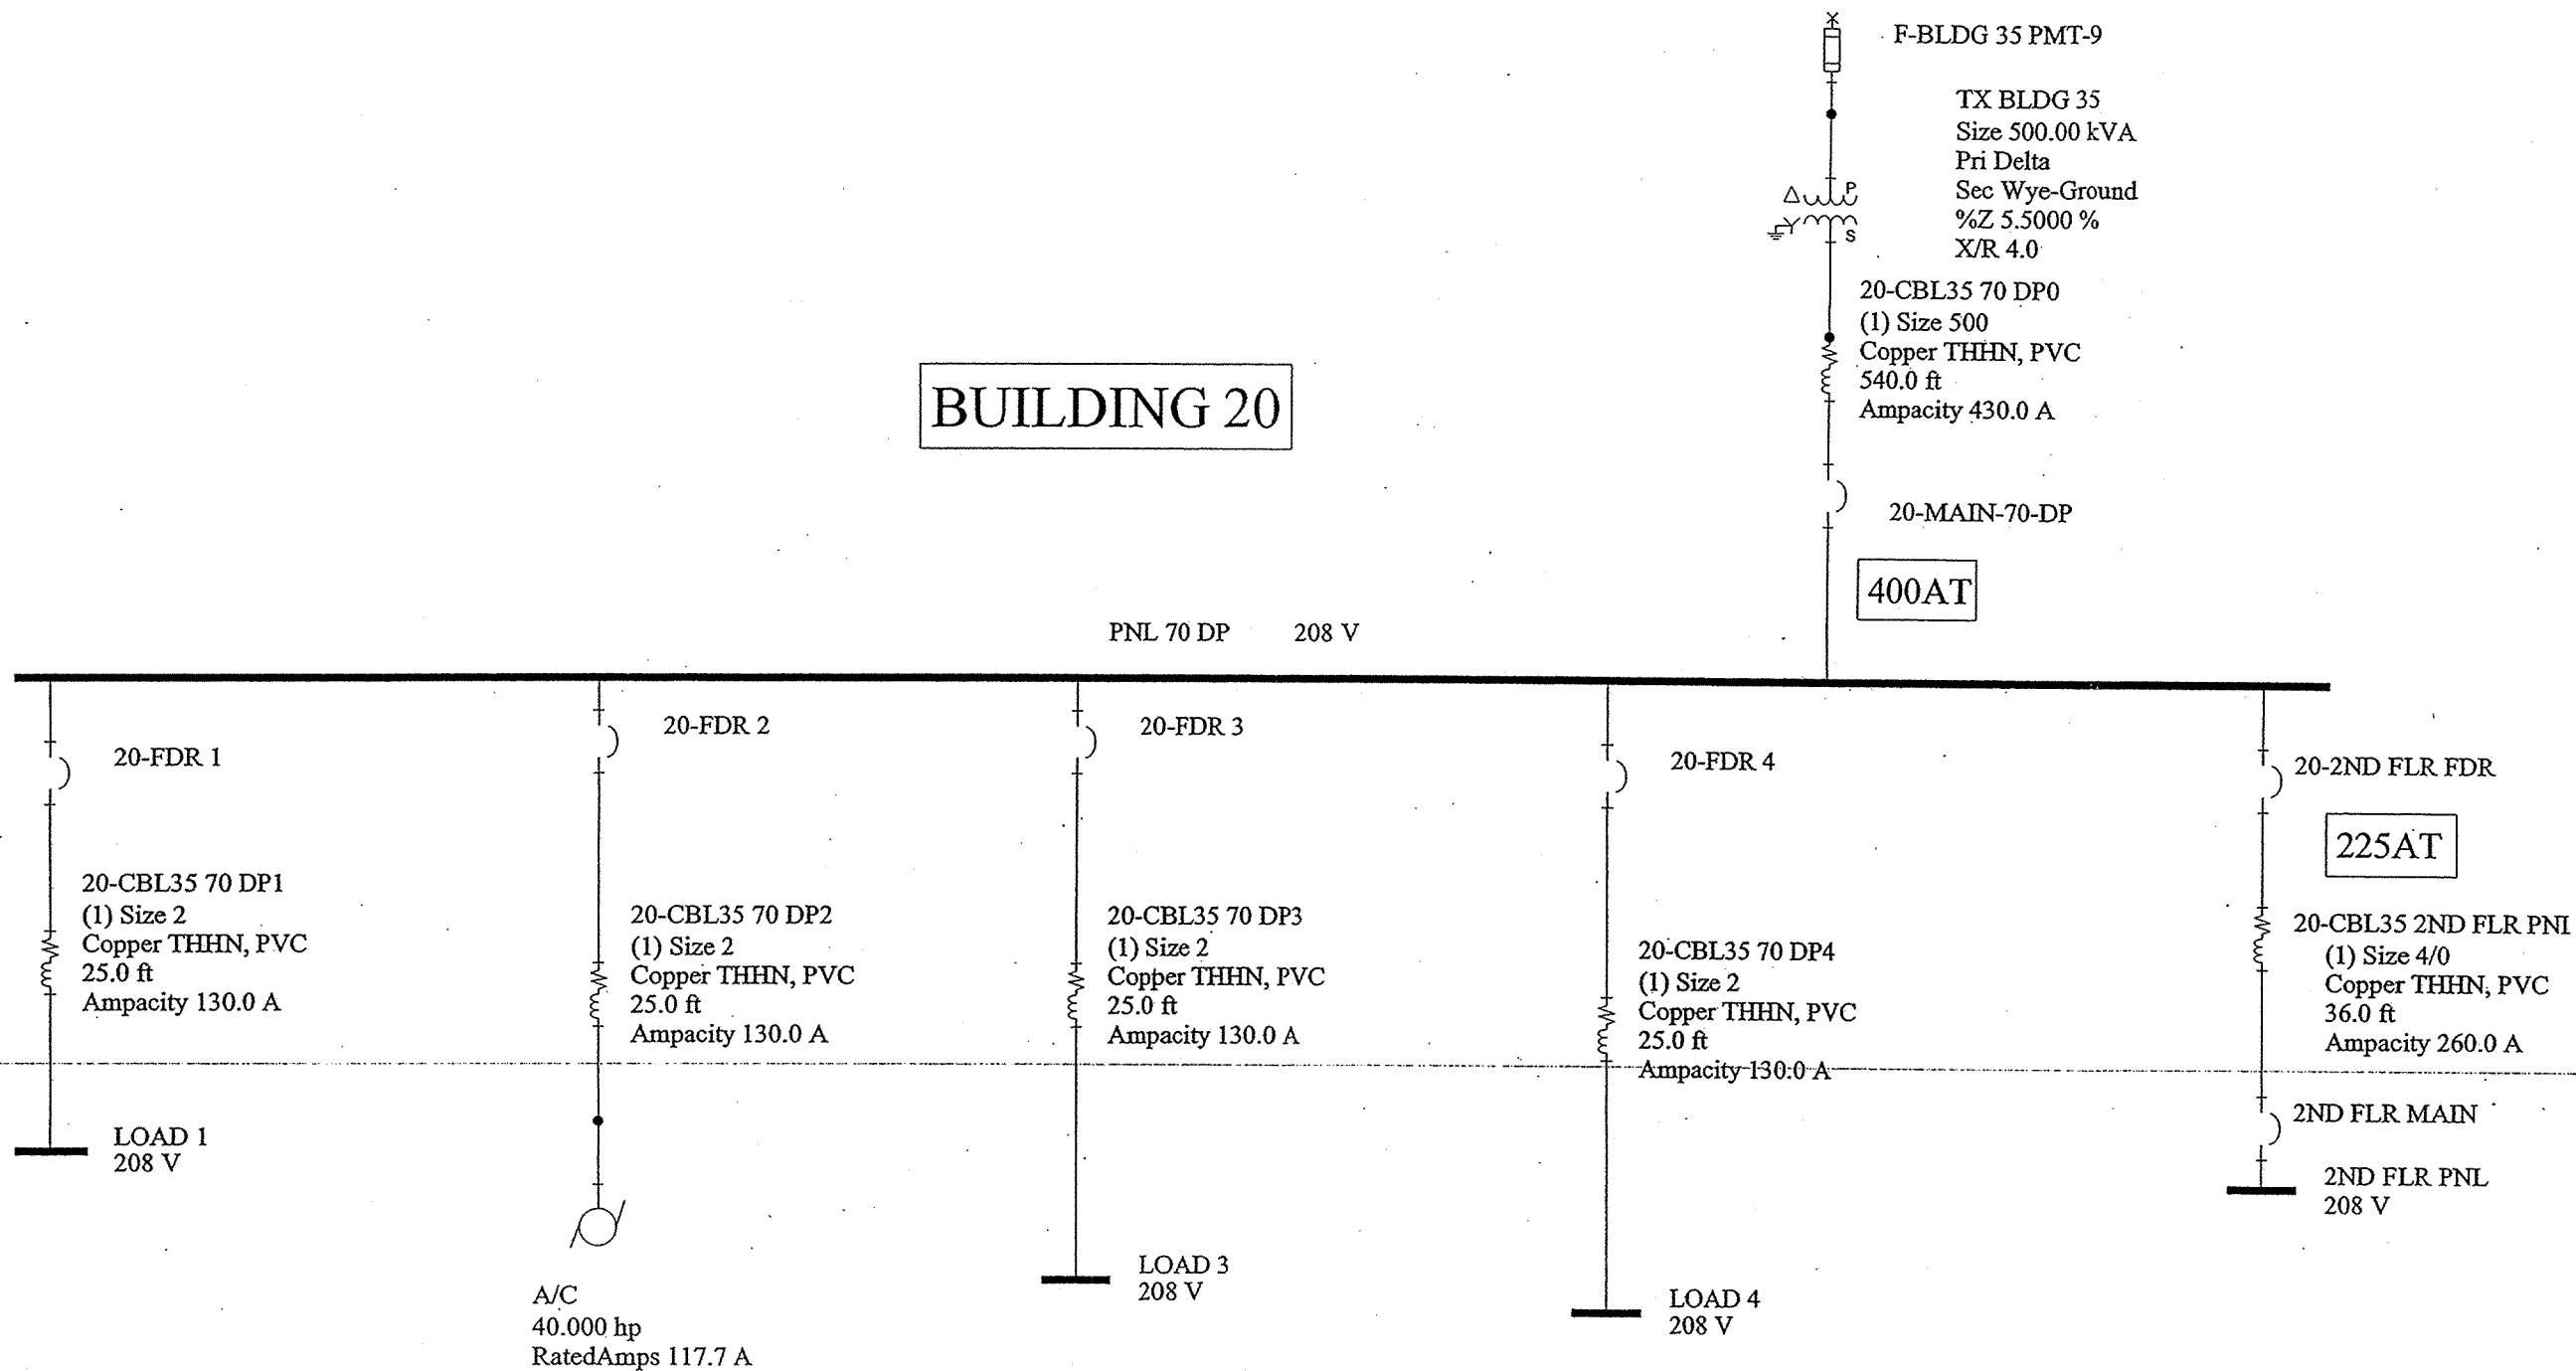


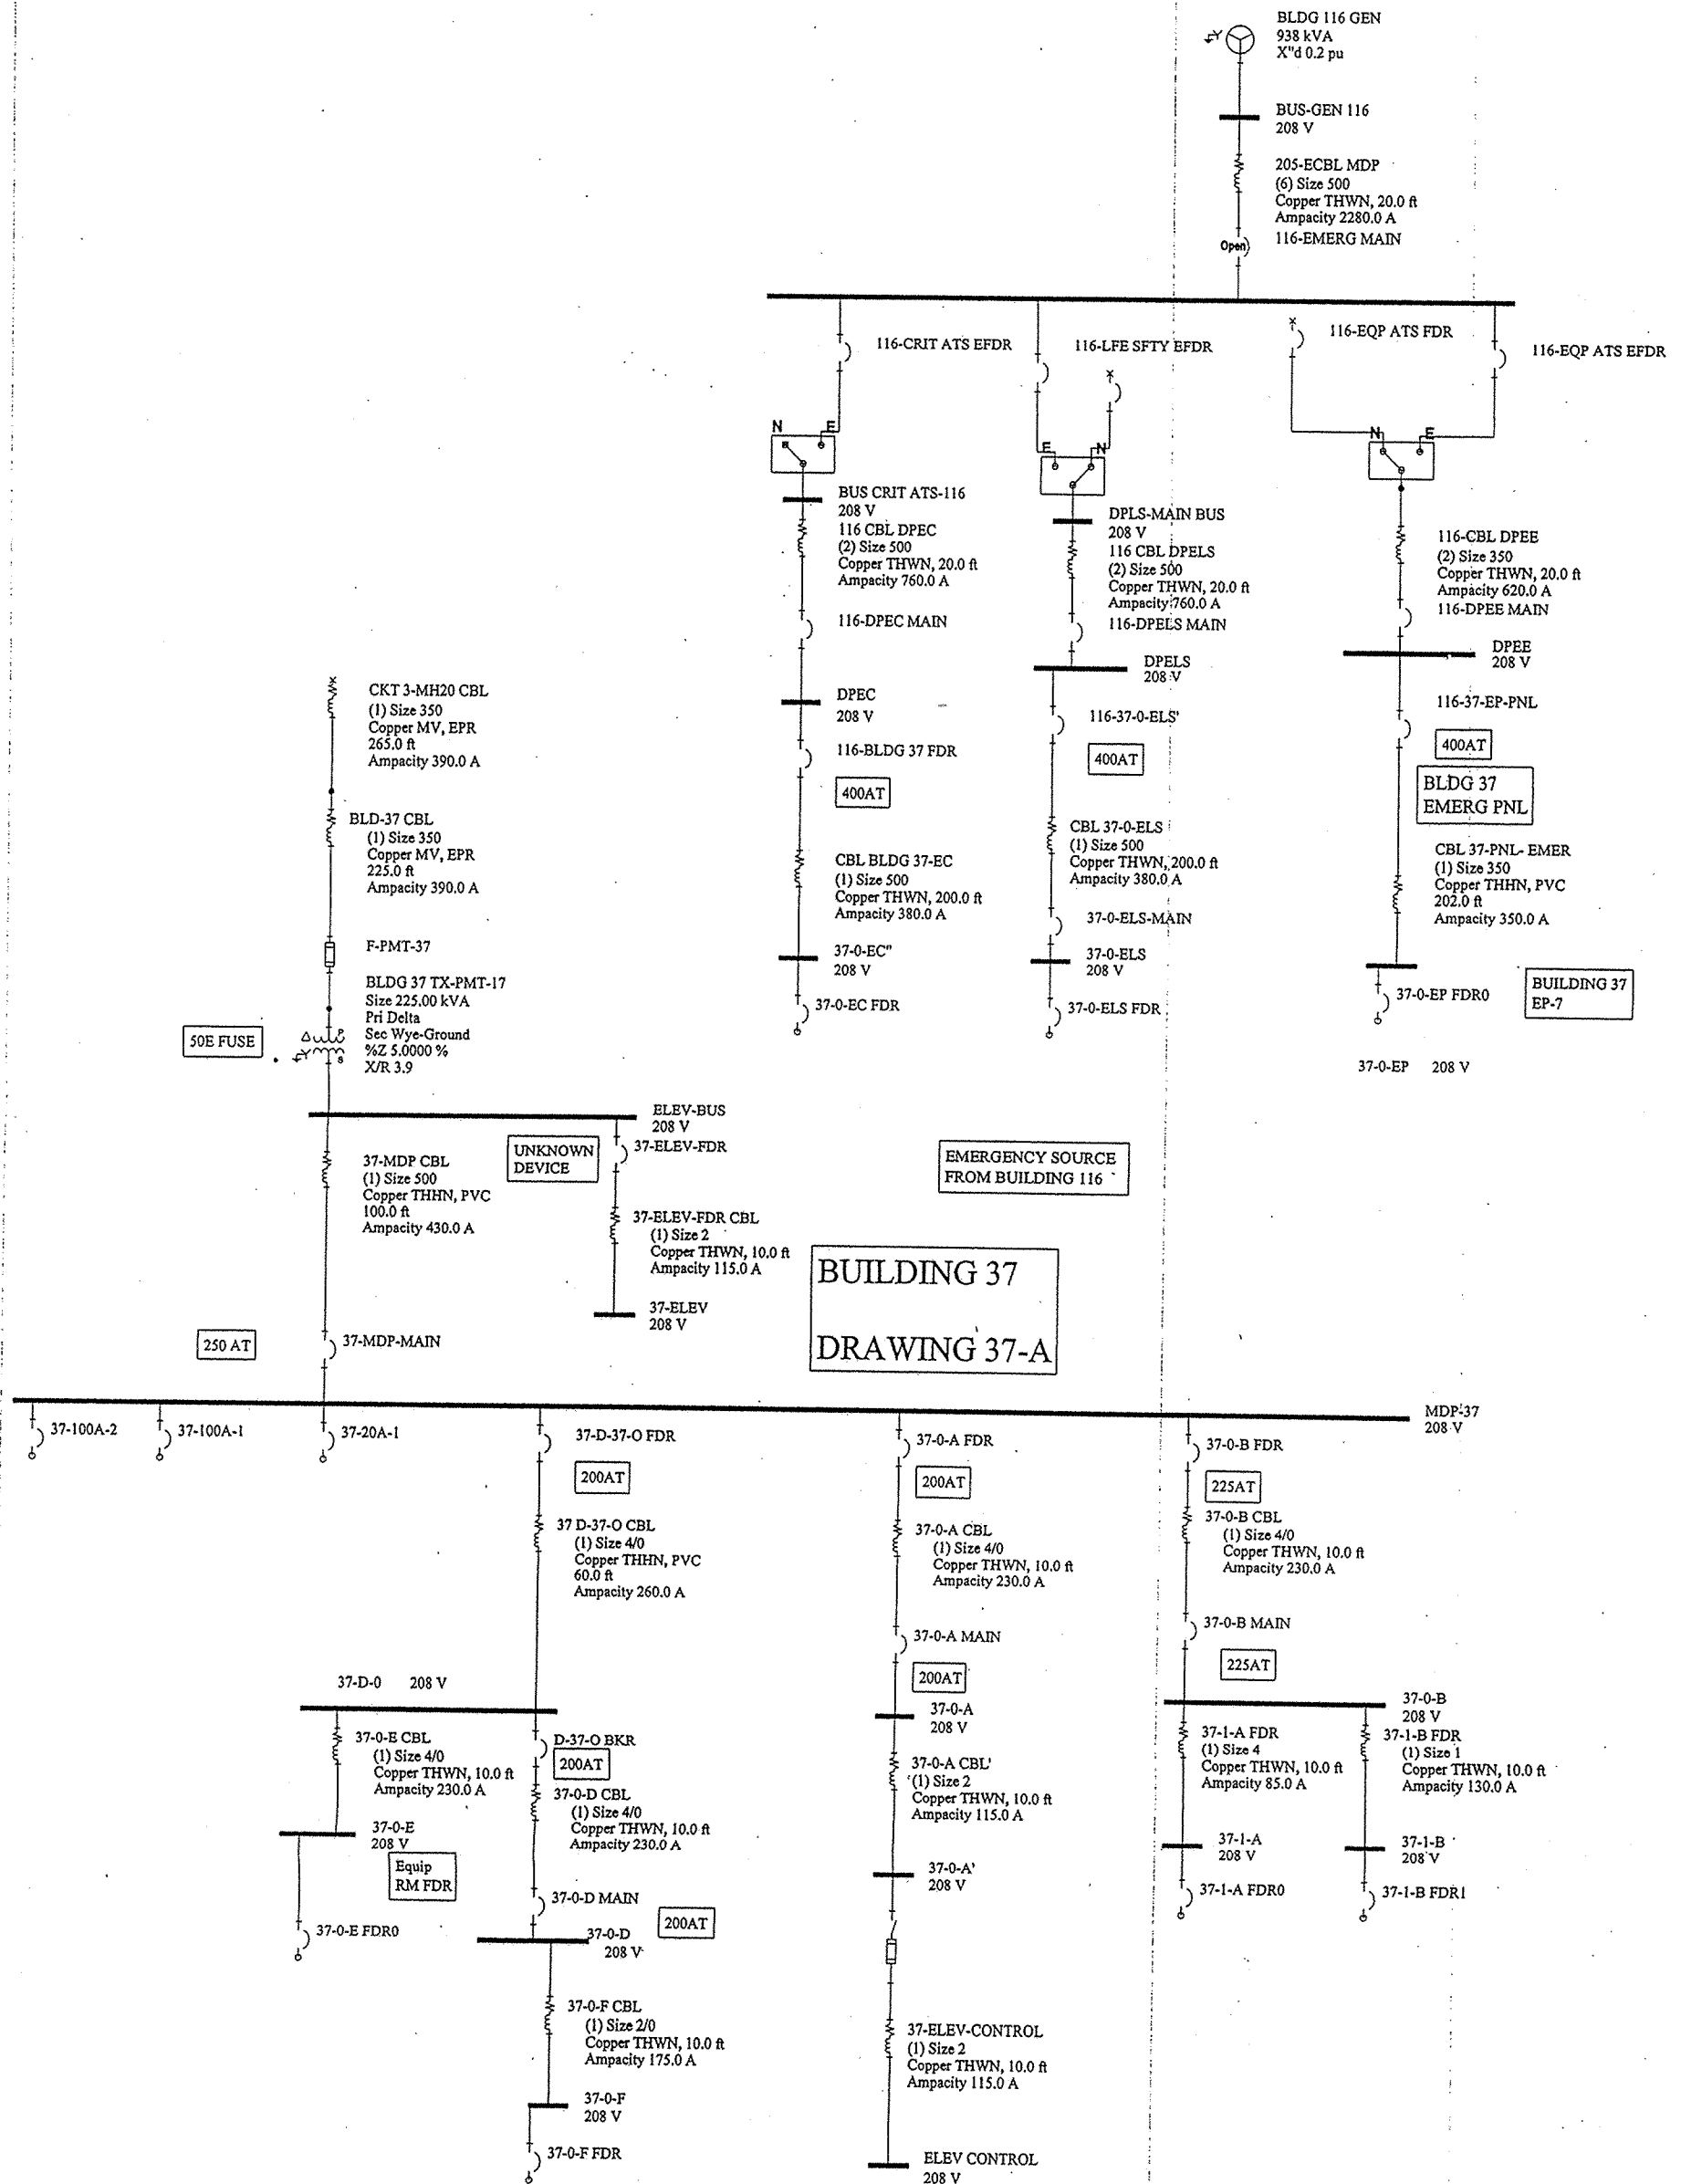


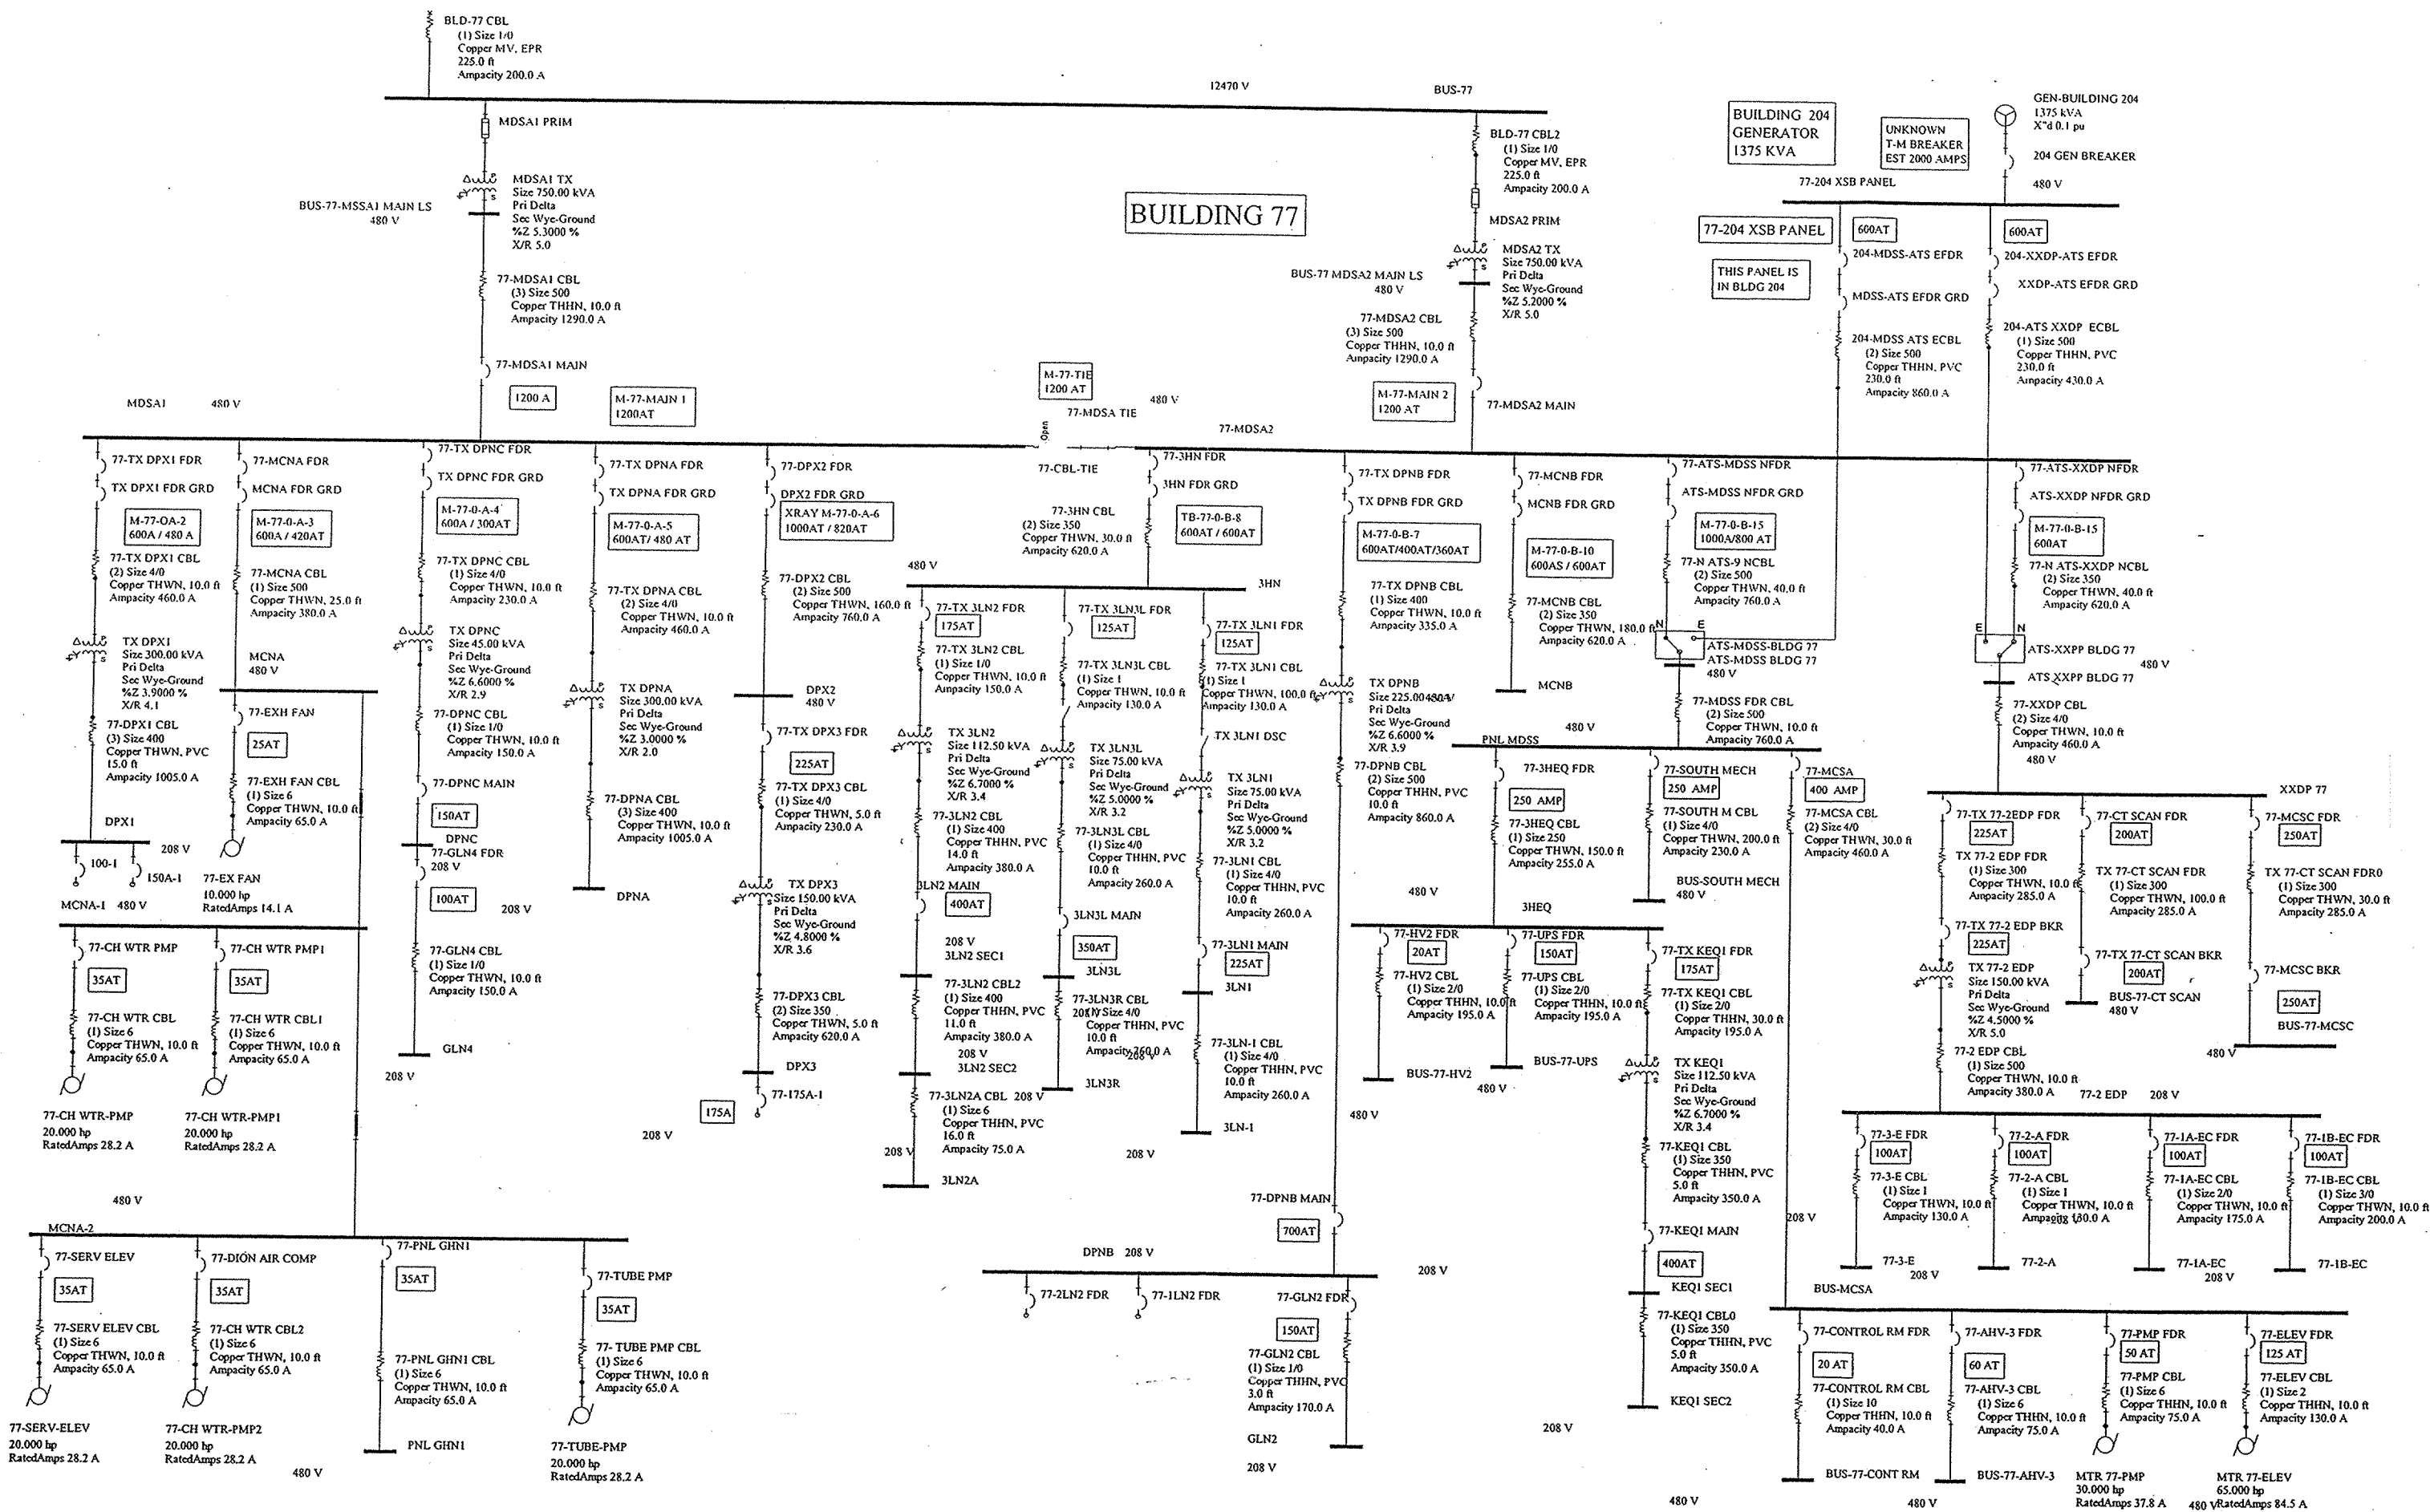

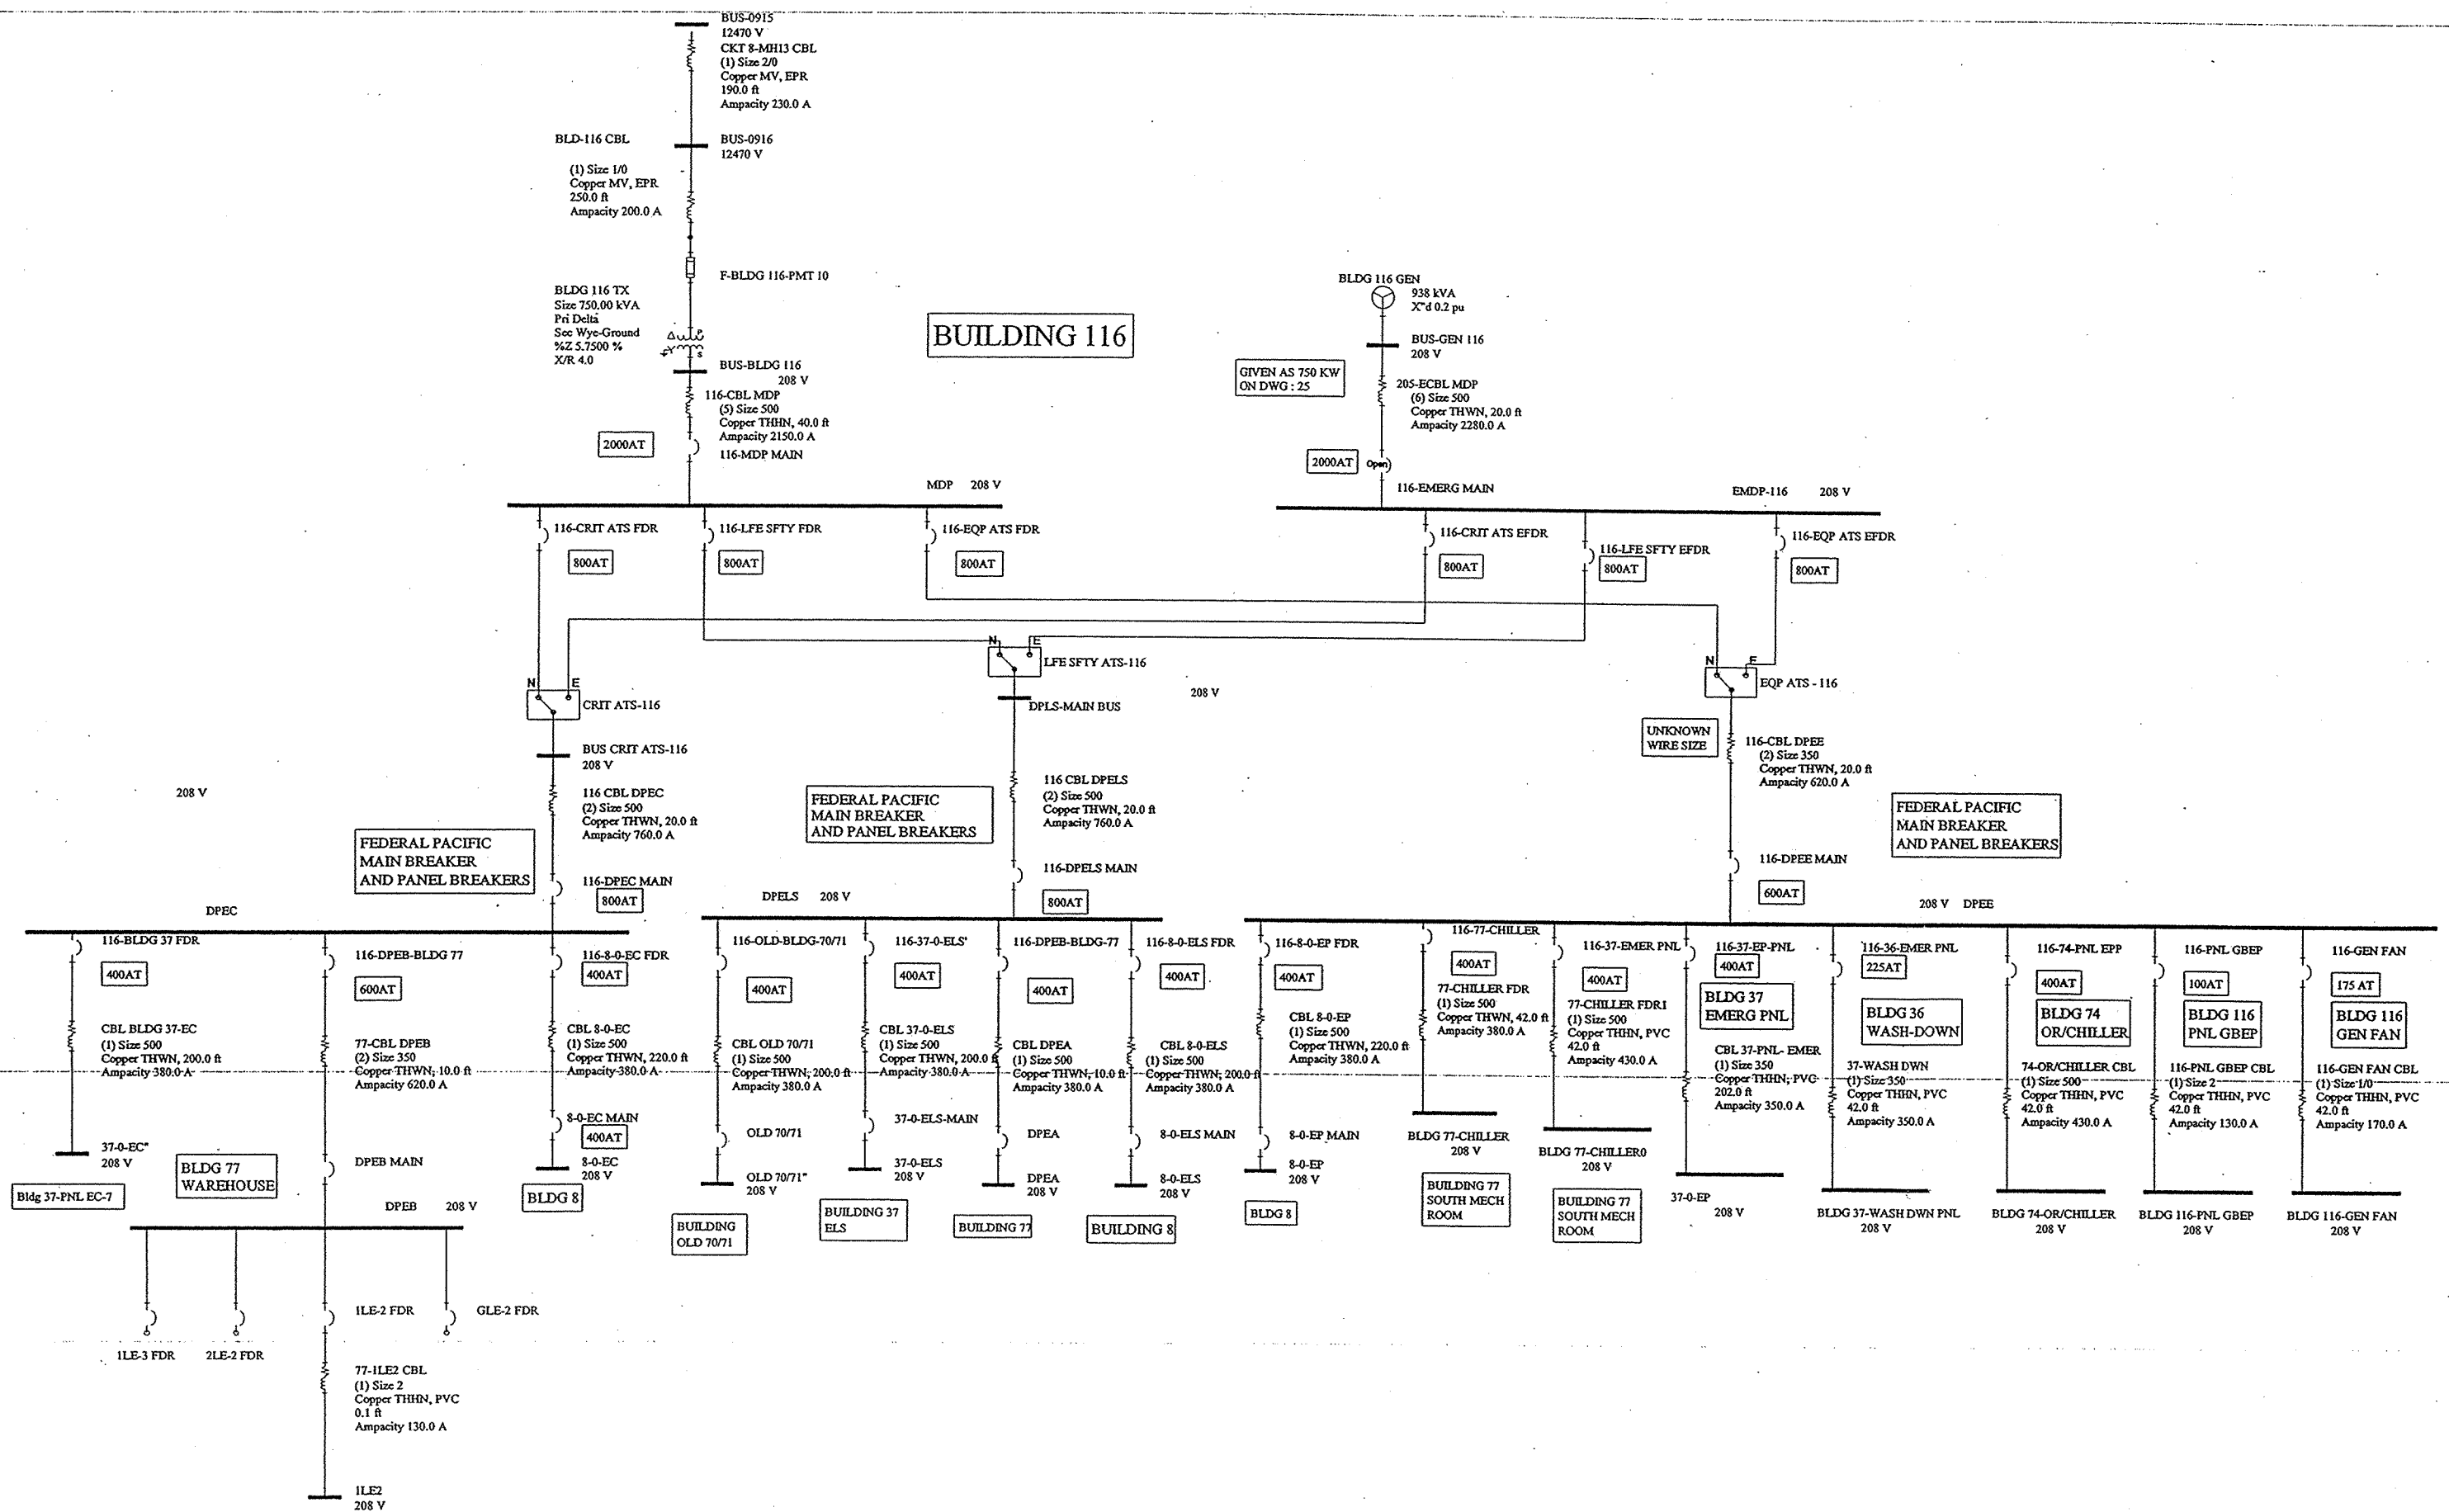





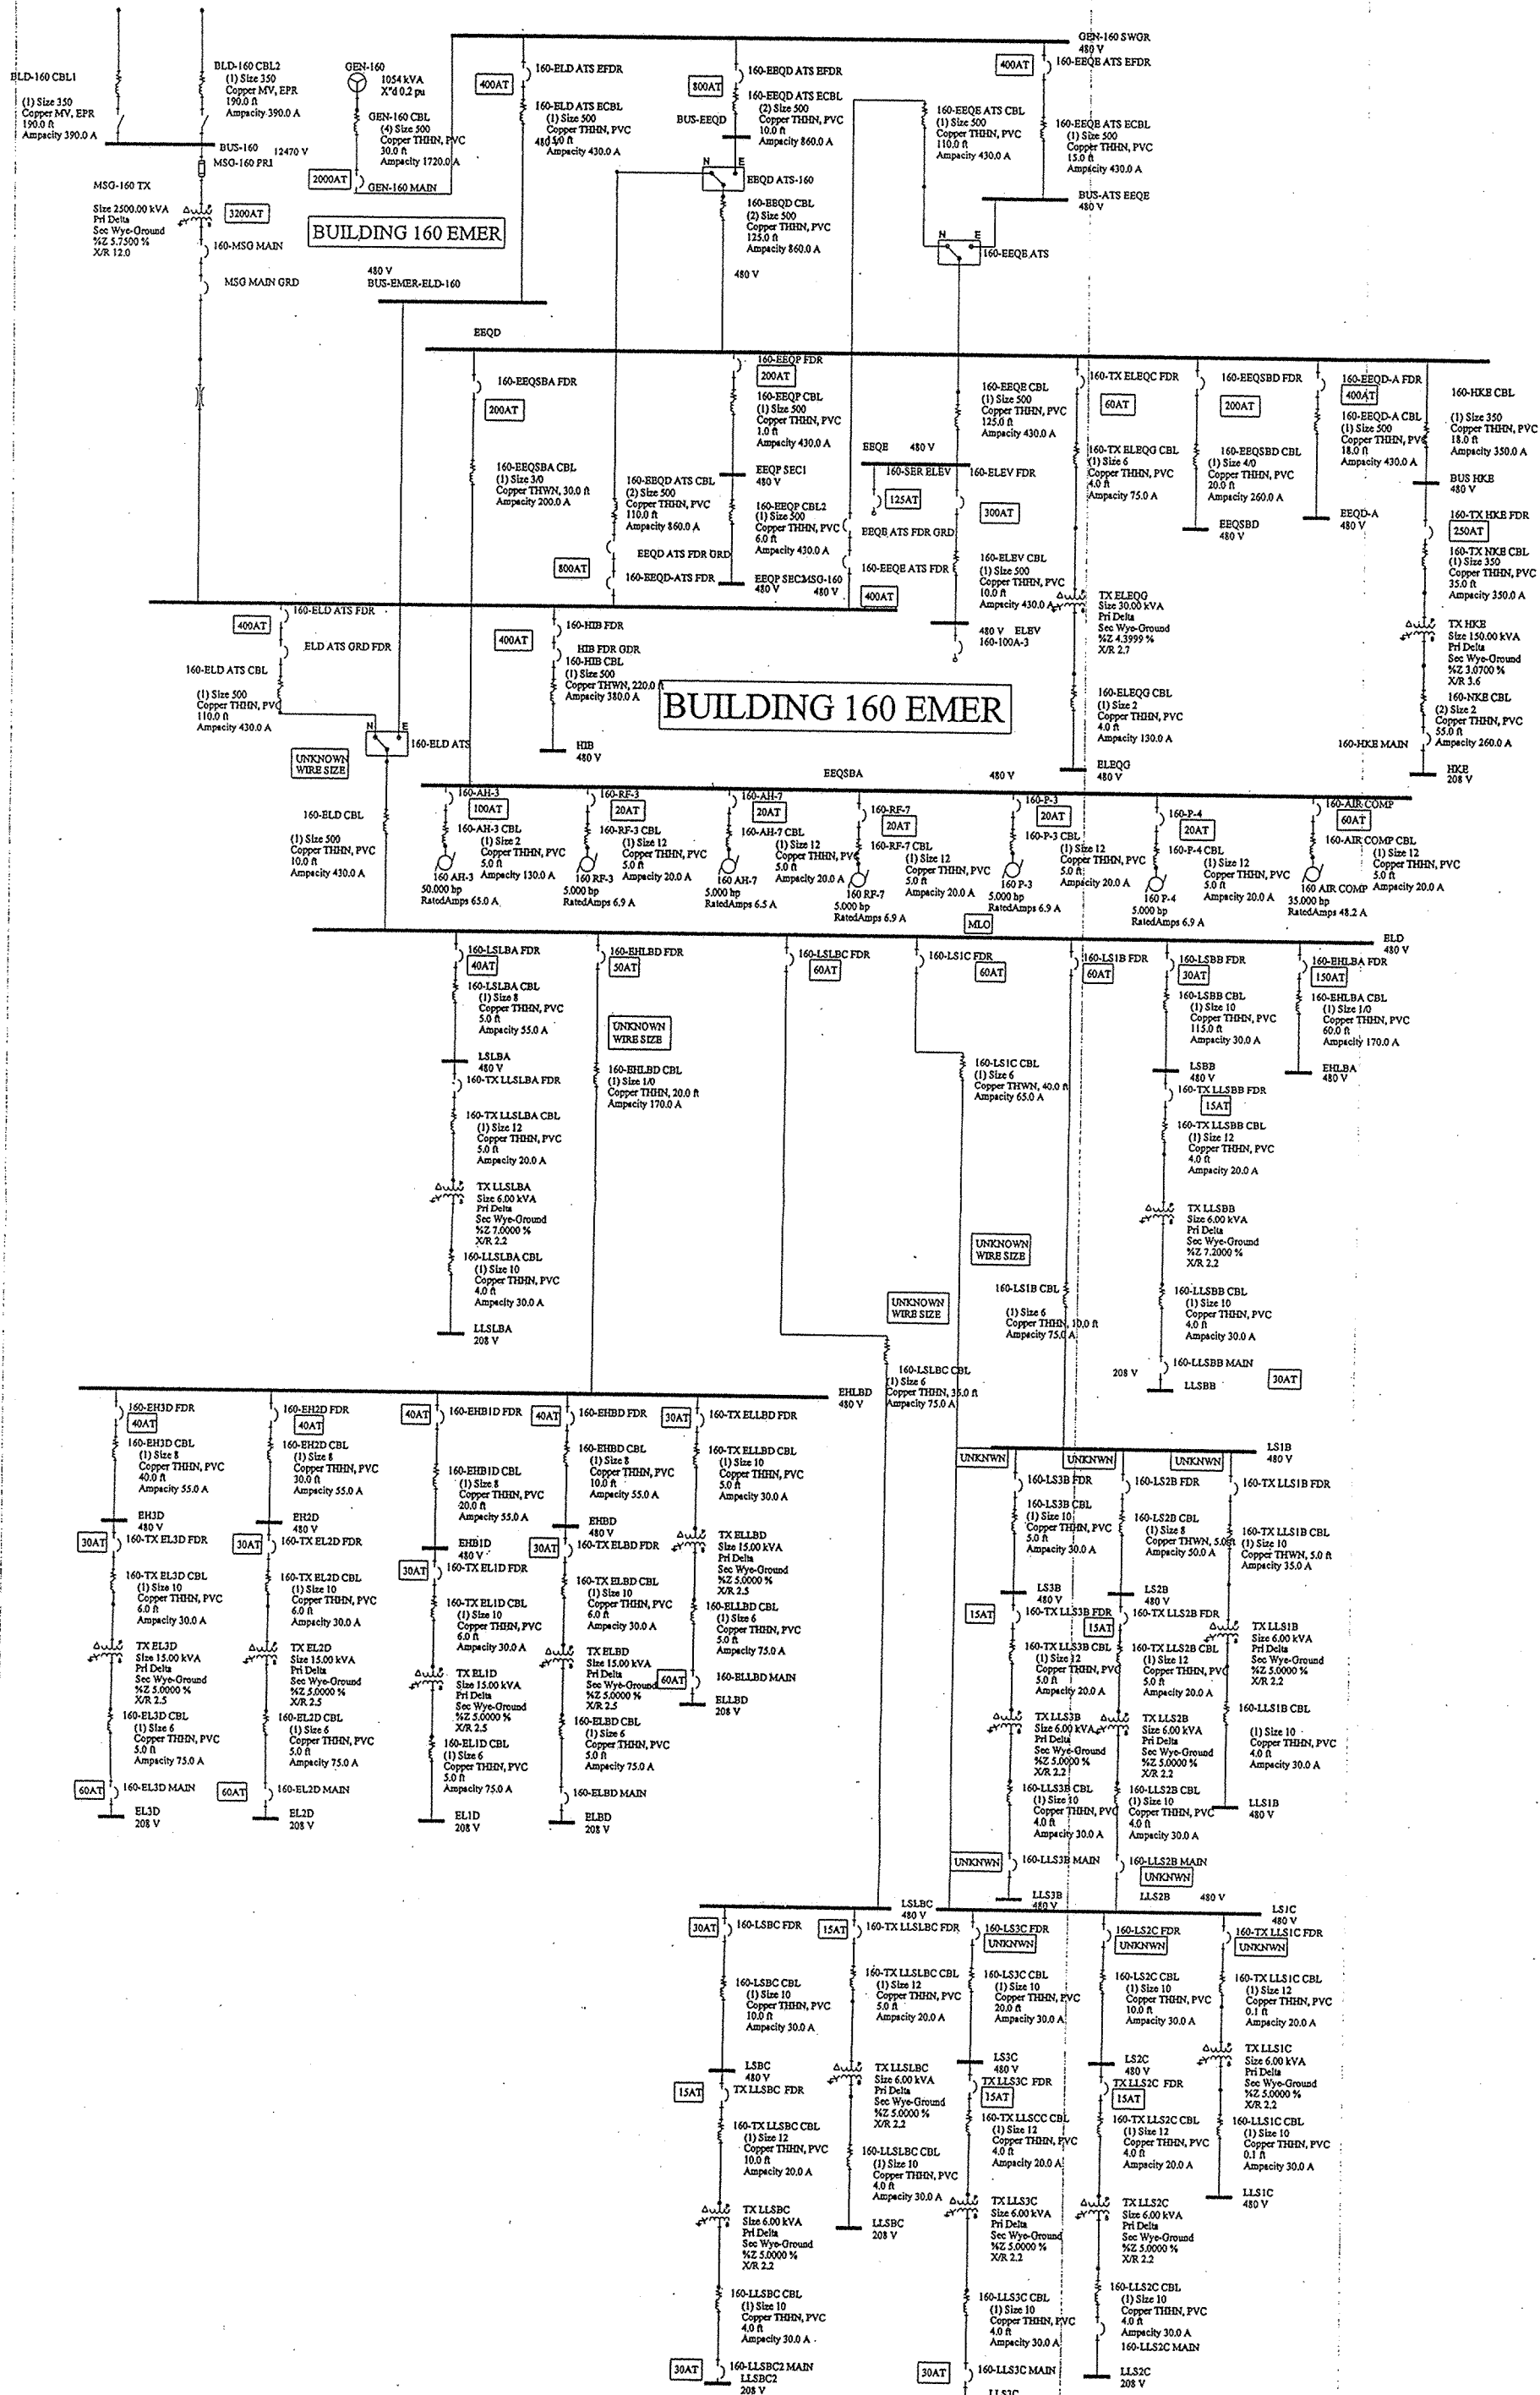

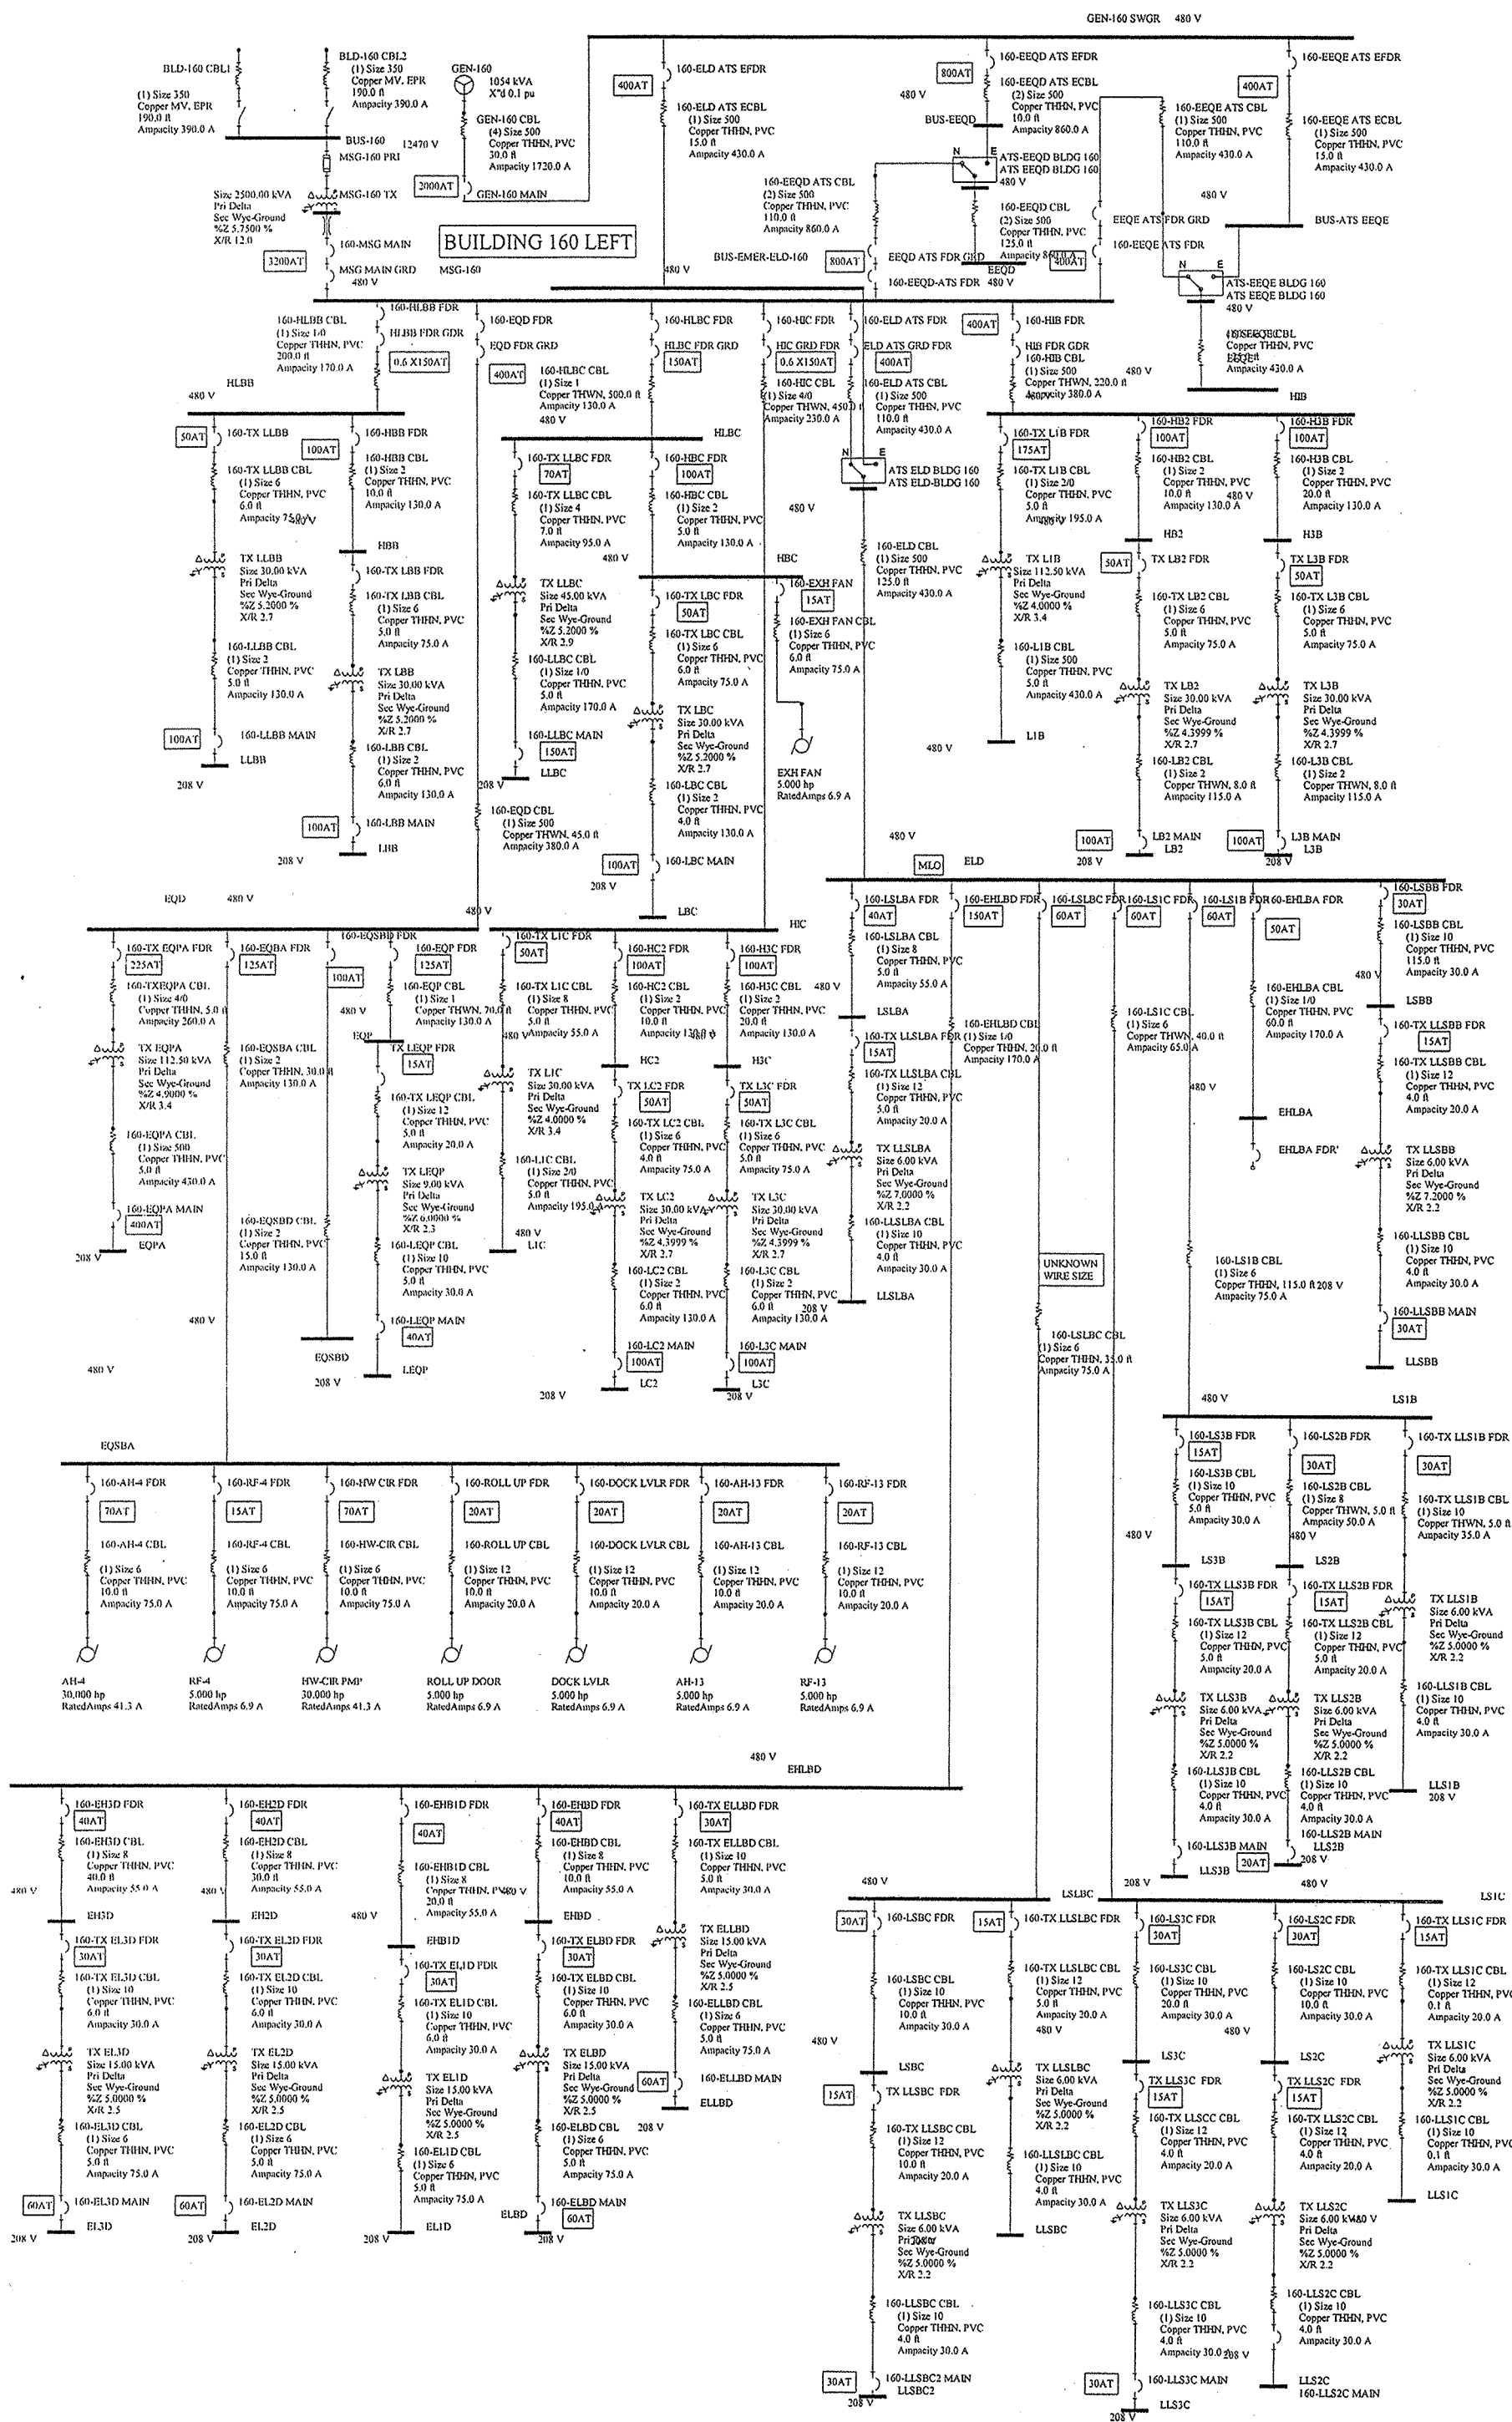


BUILDING 160 RIGHT

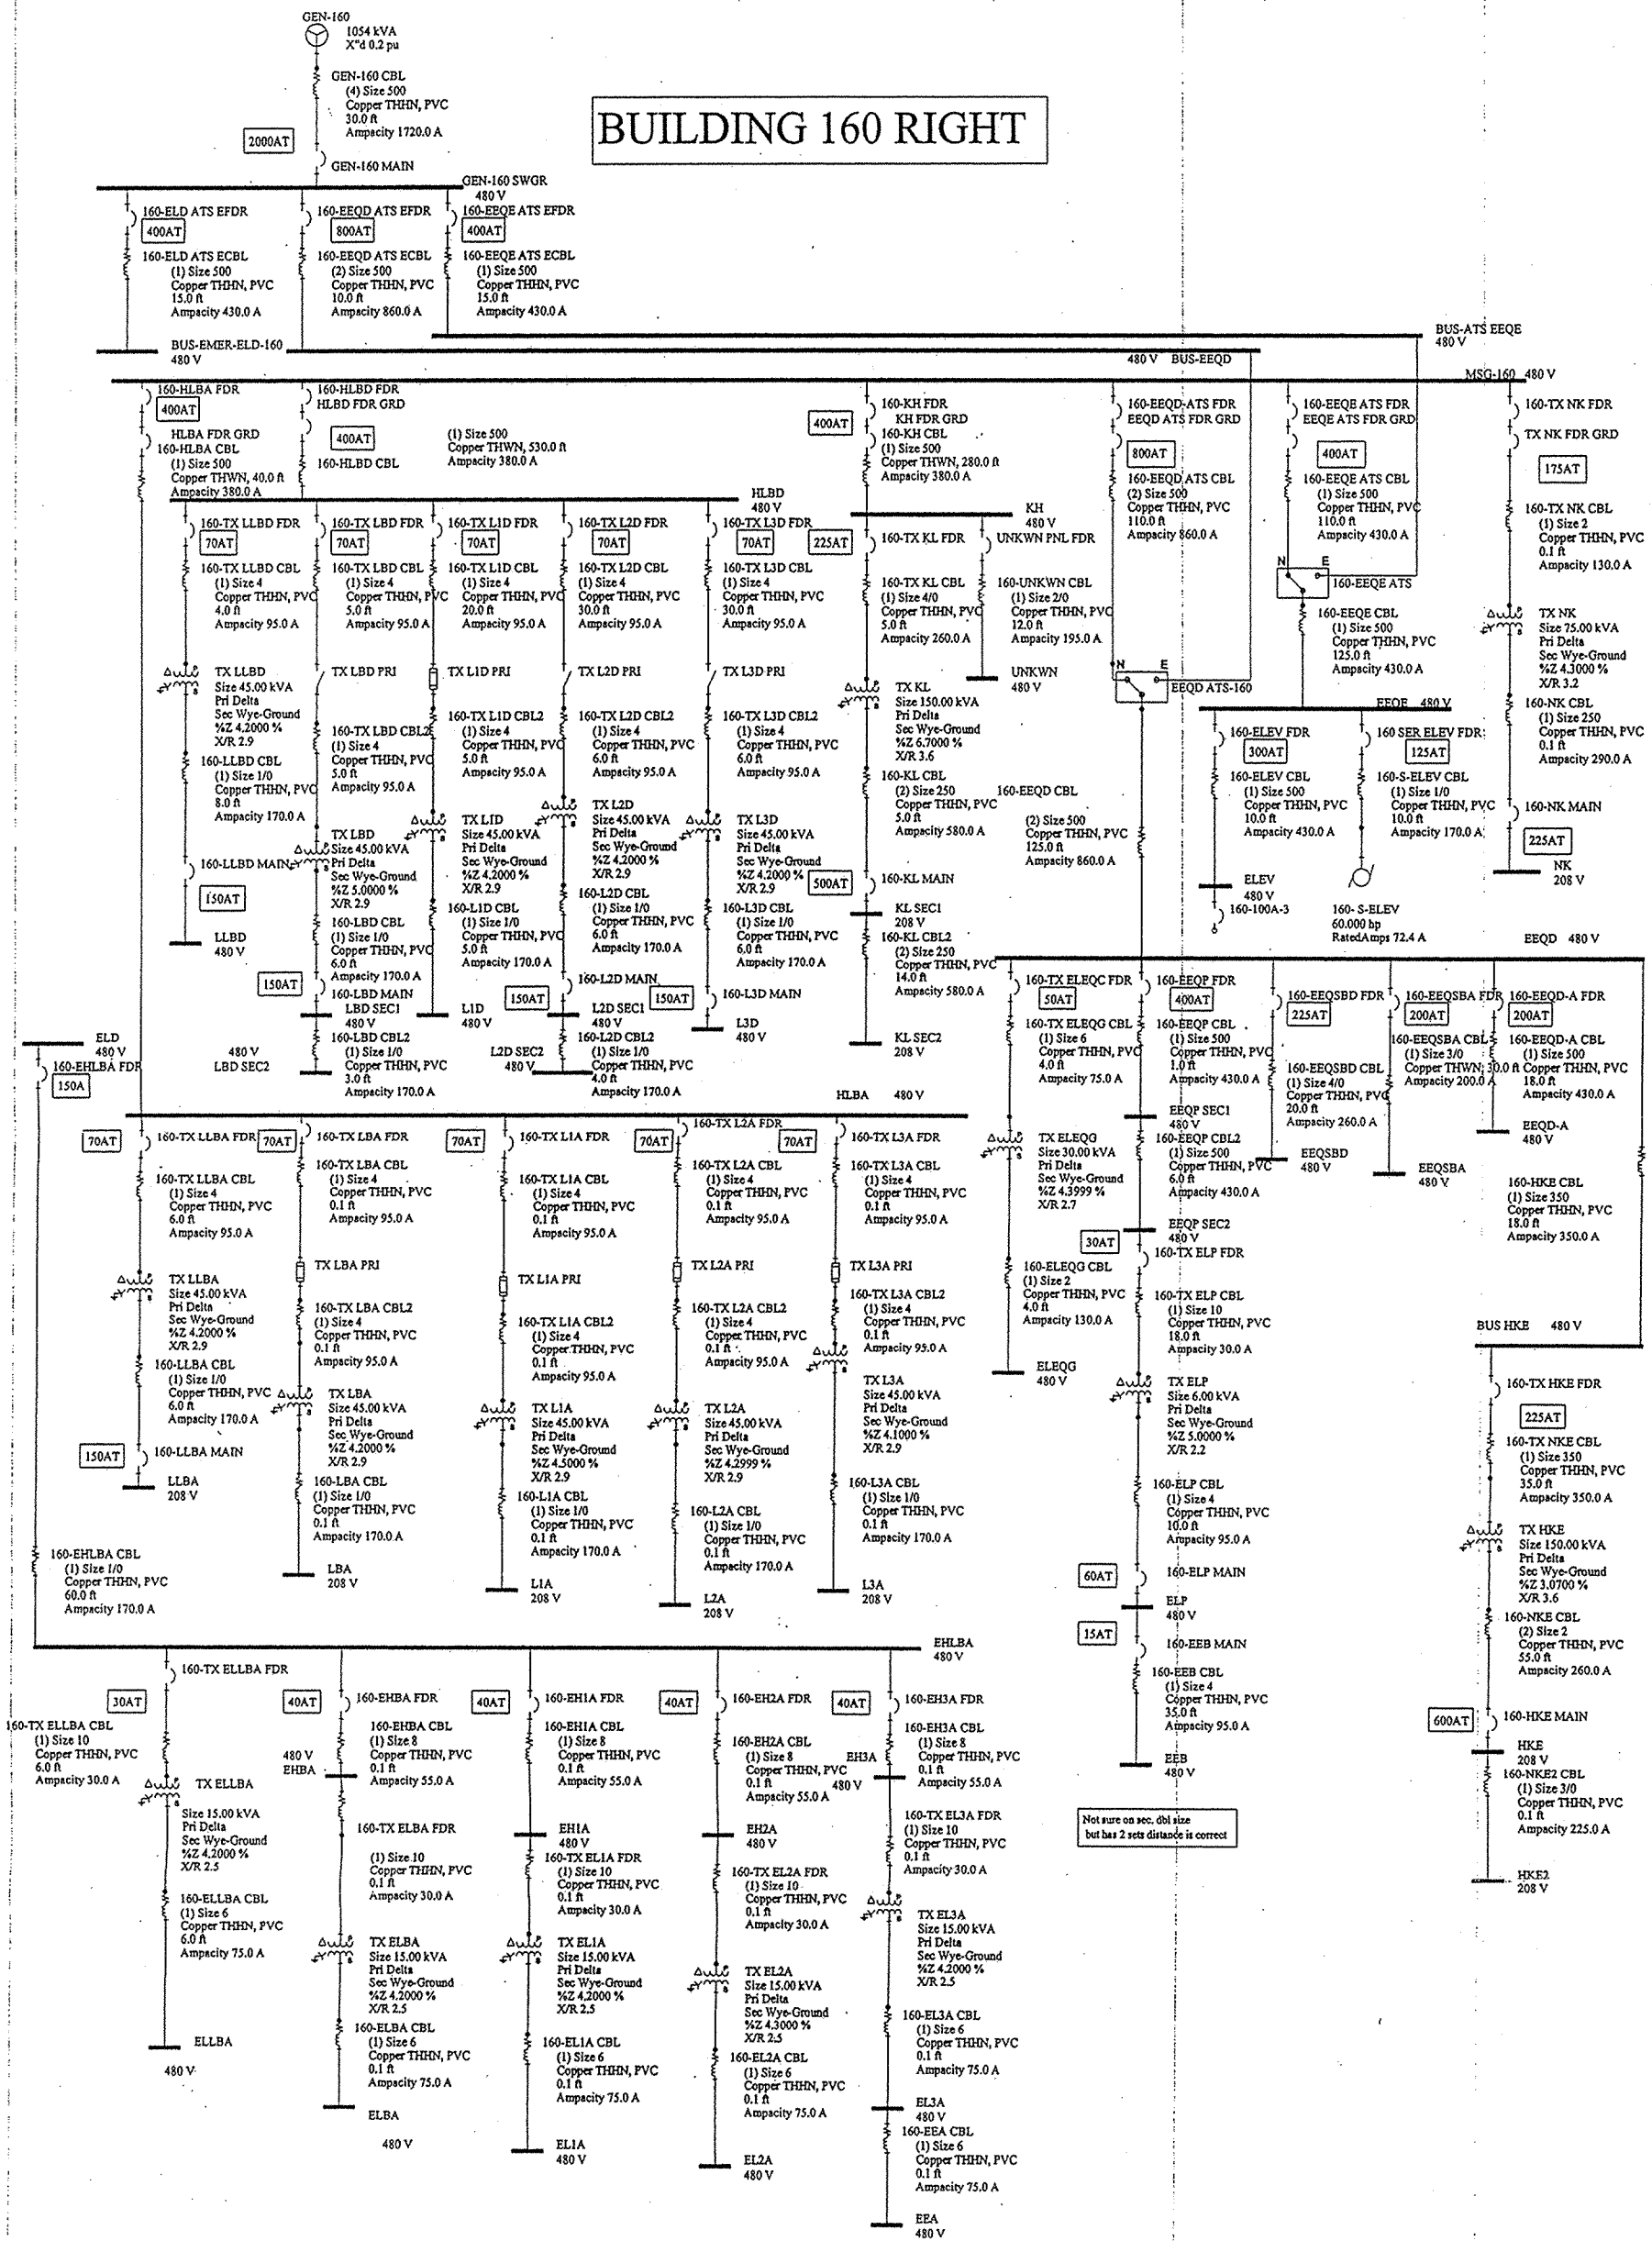


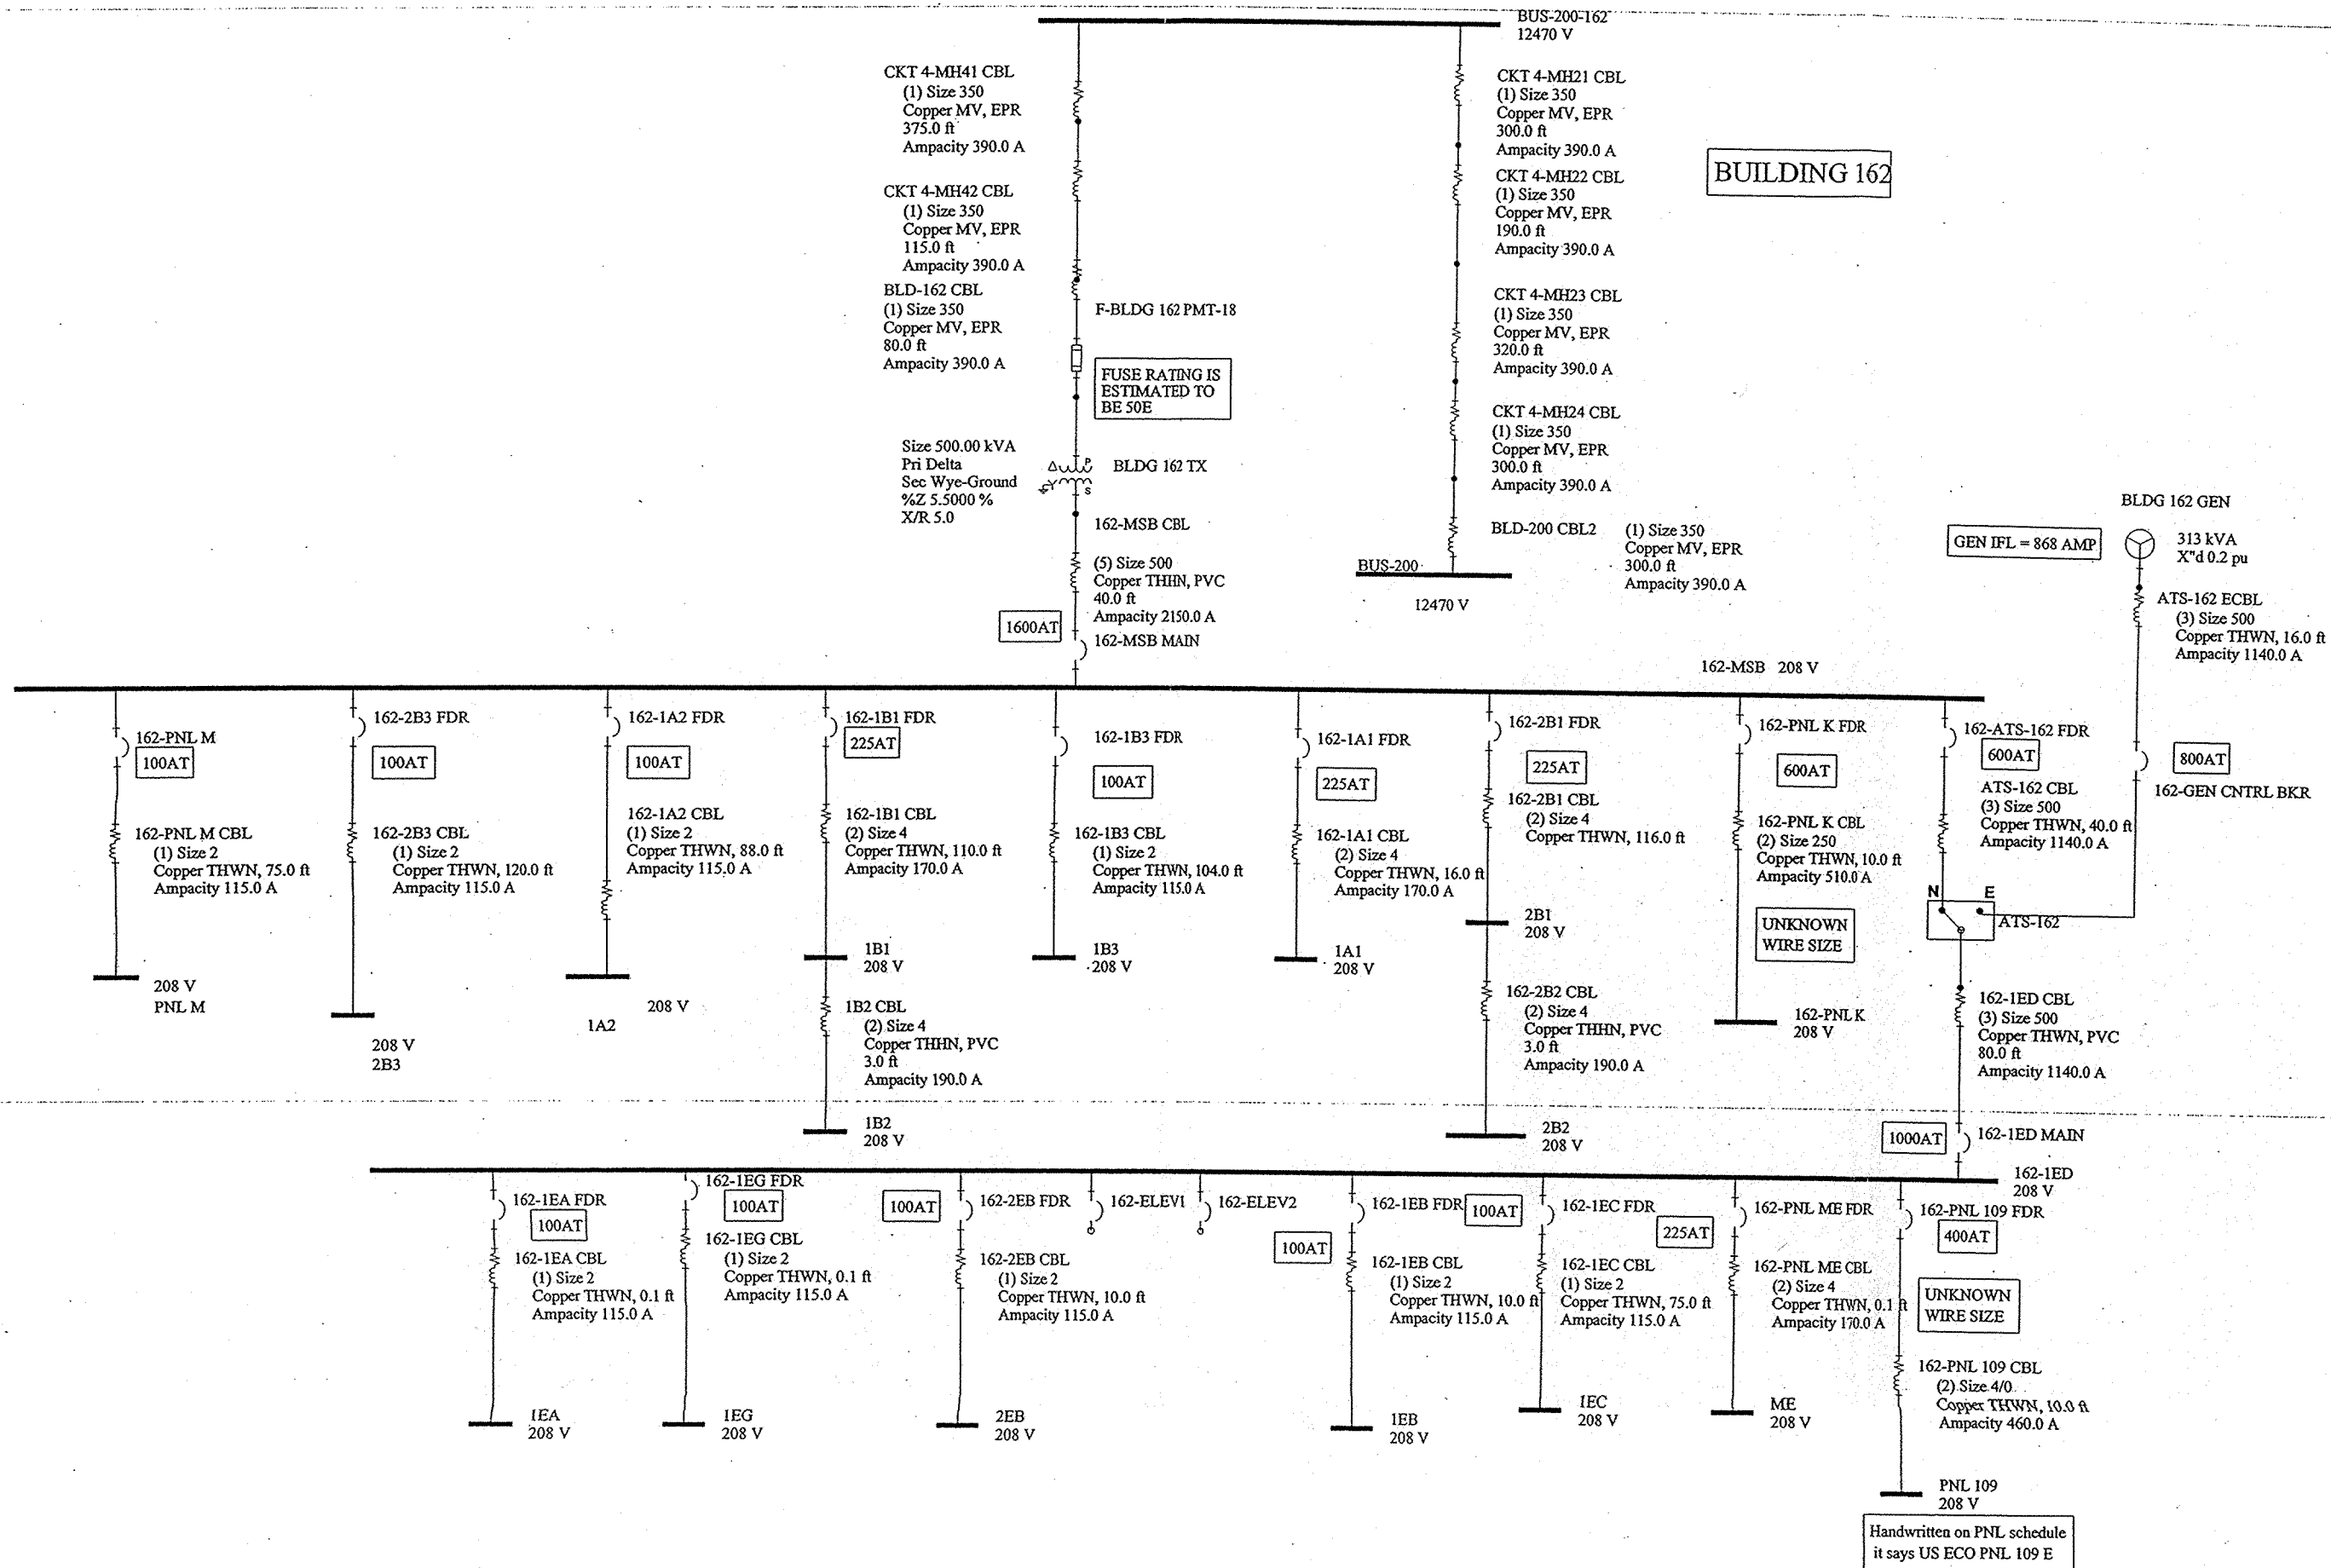


# BUILDING 200 BUS DUCT CONNECTIONS

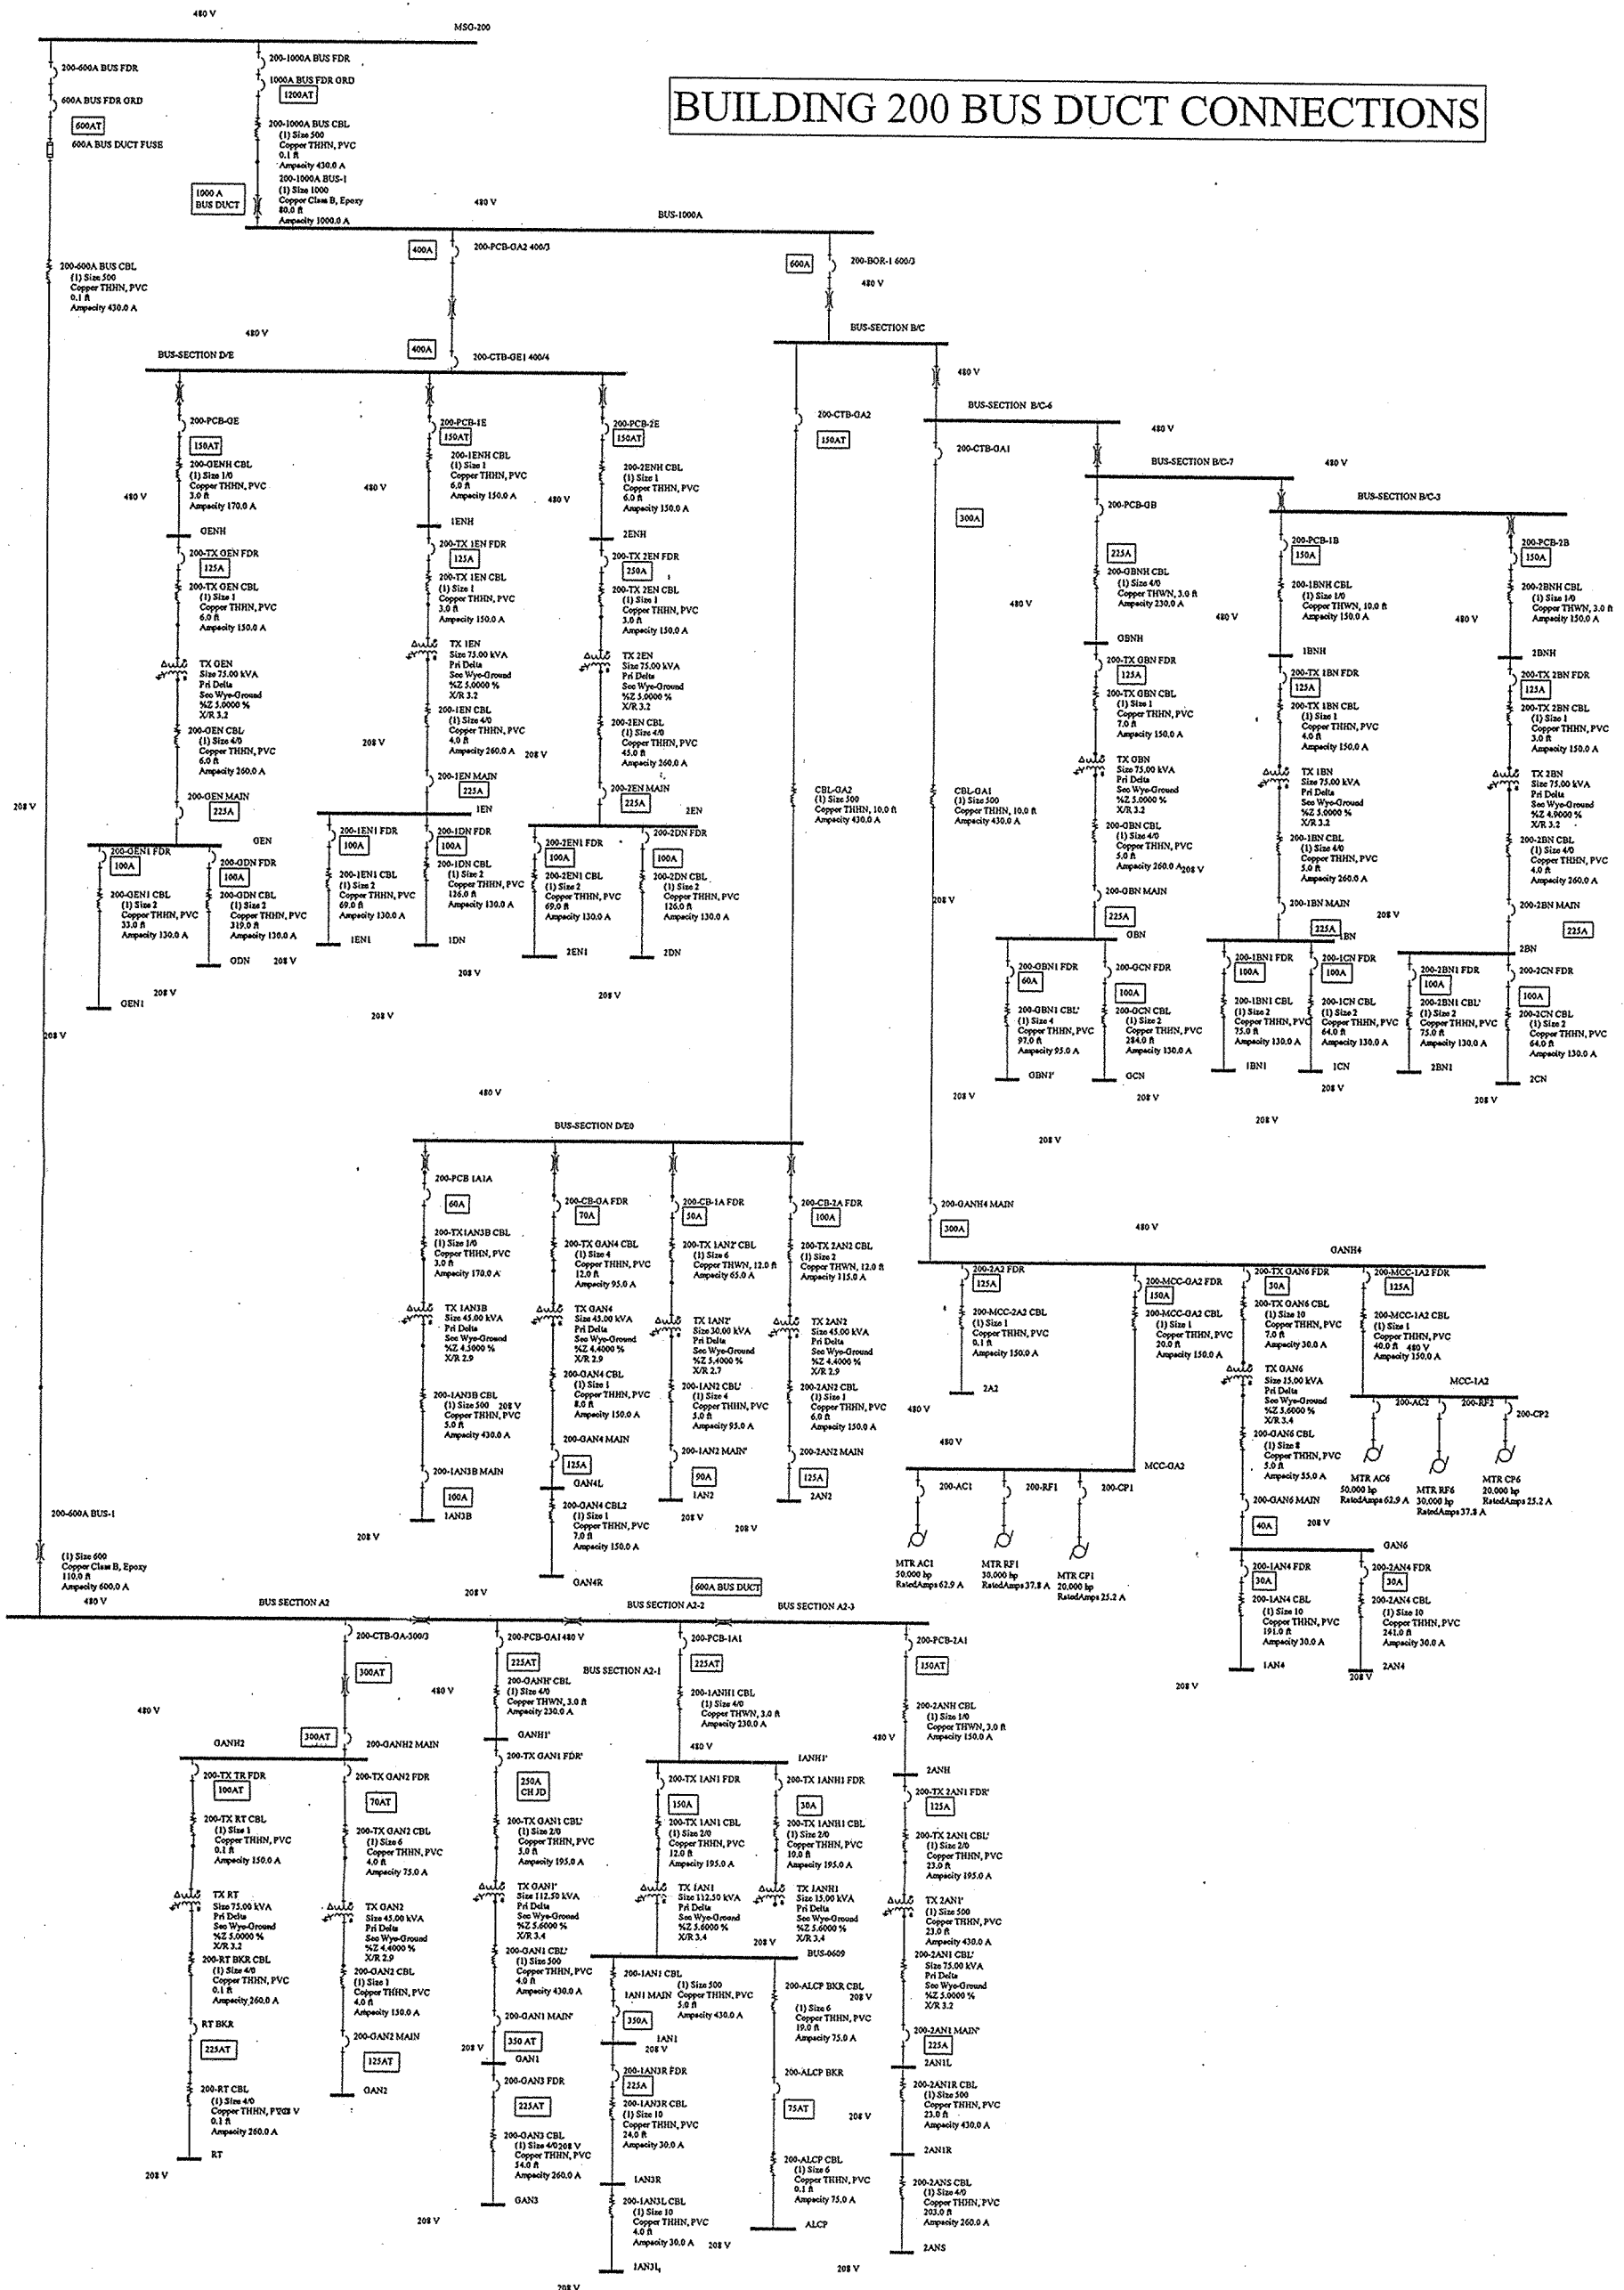




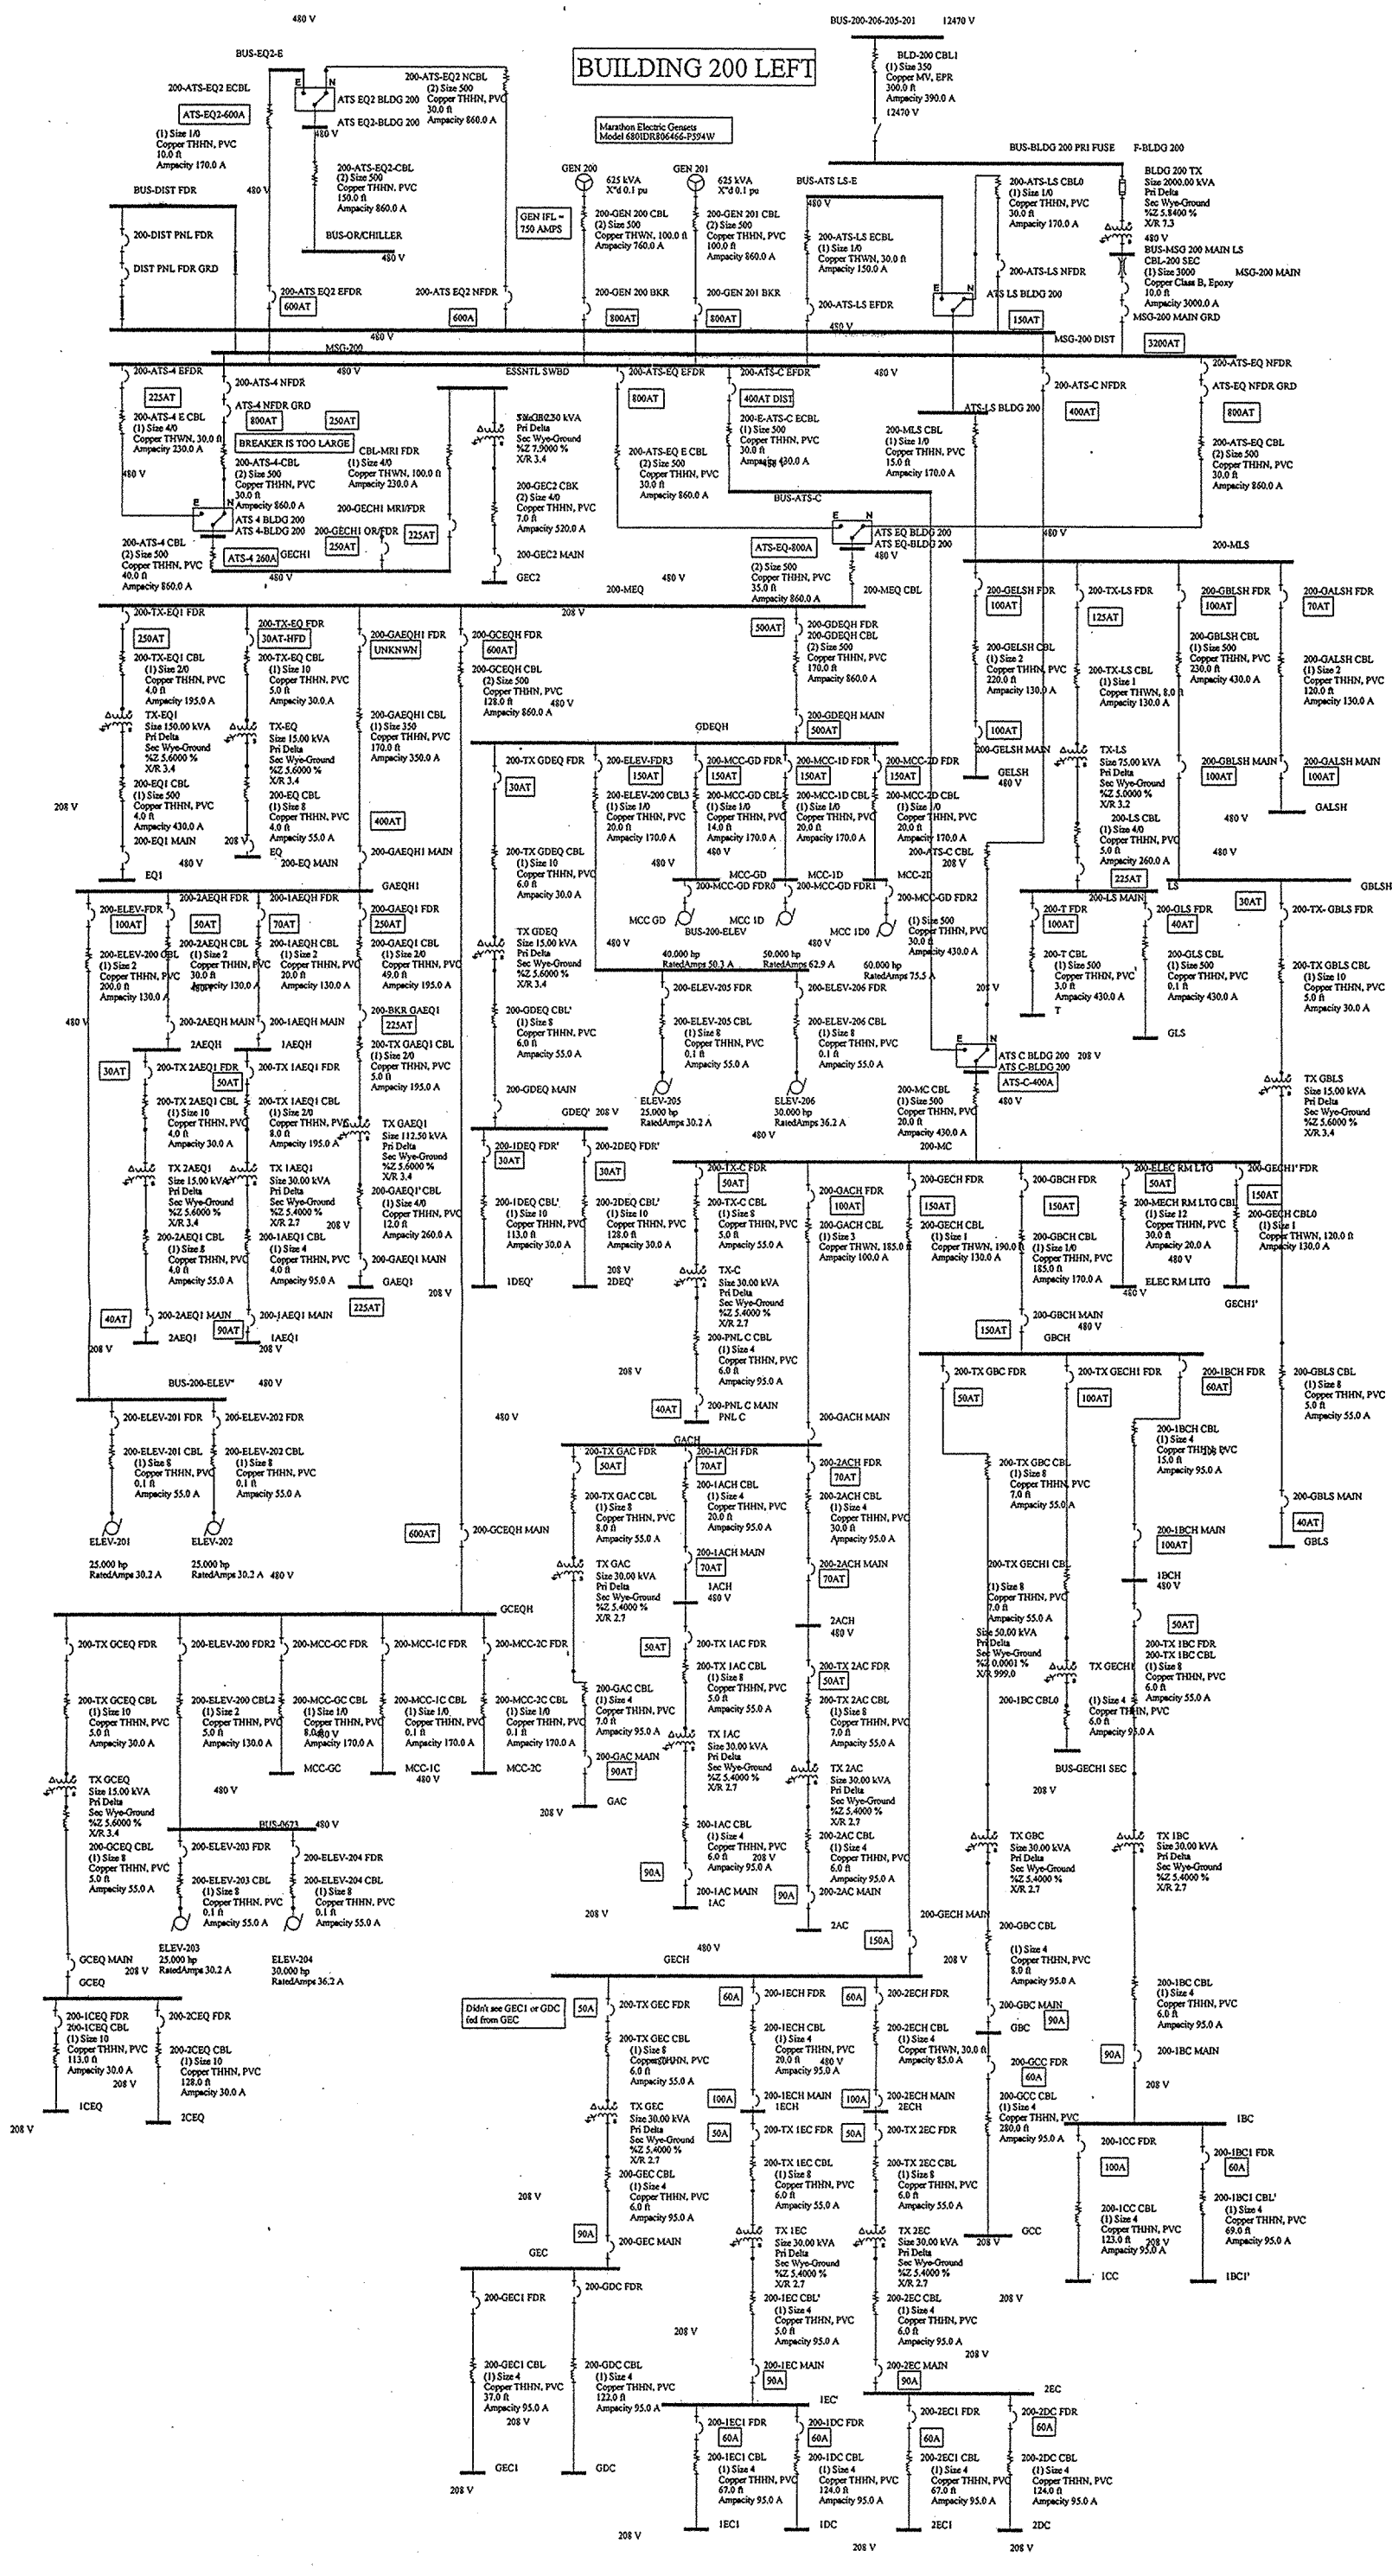


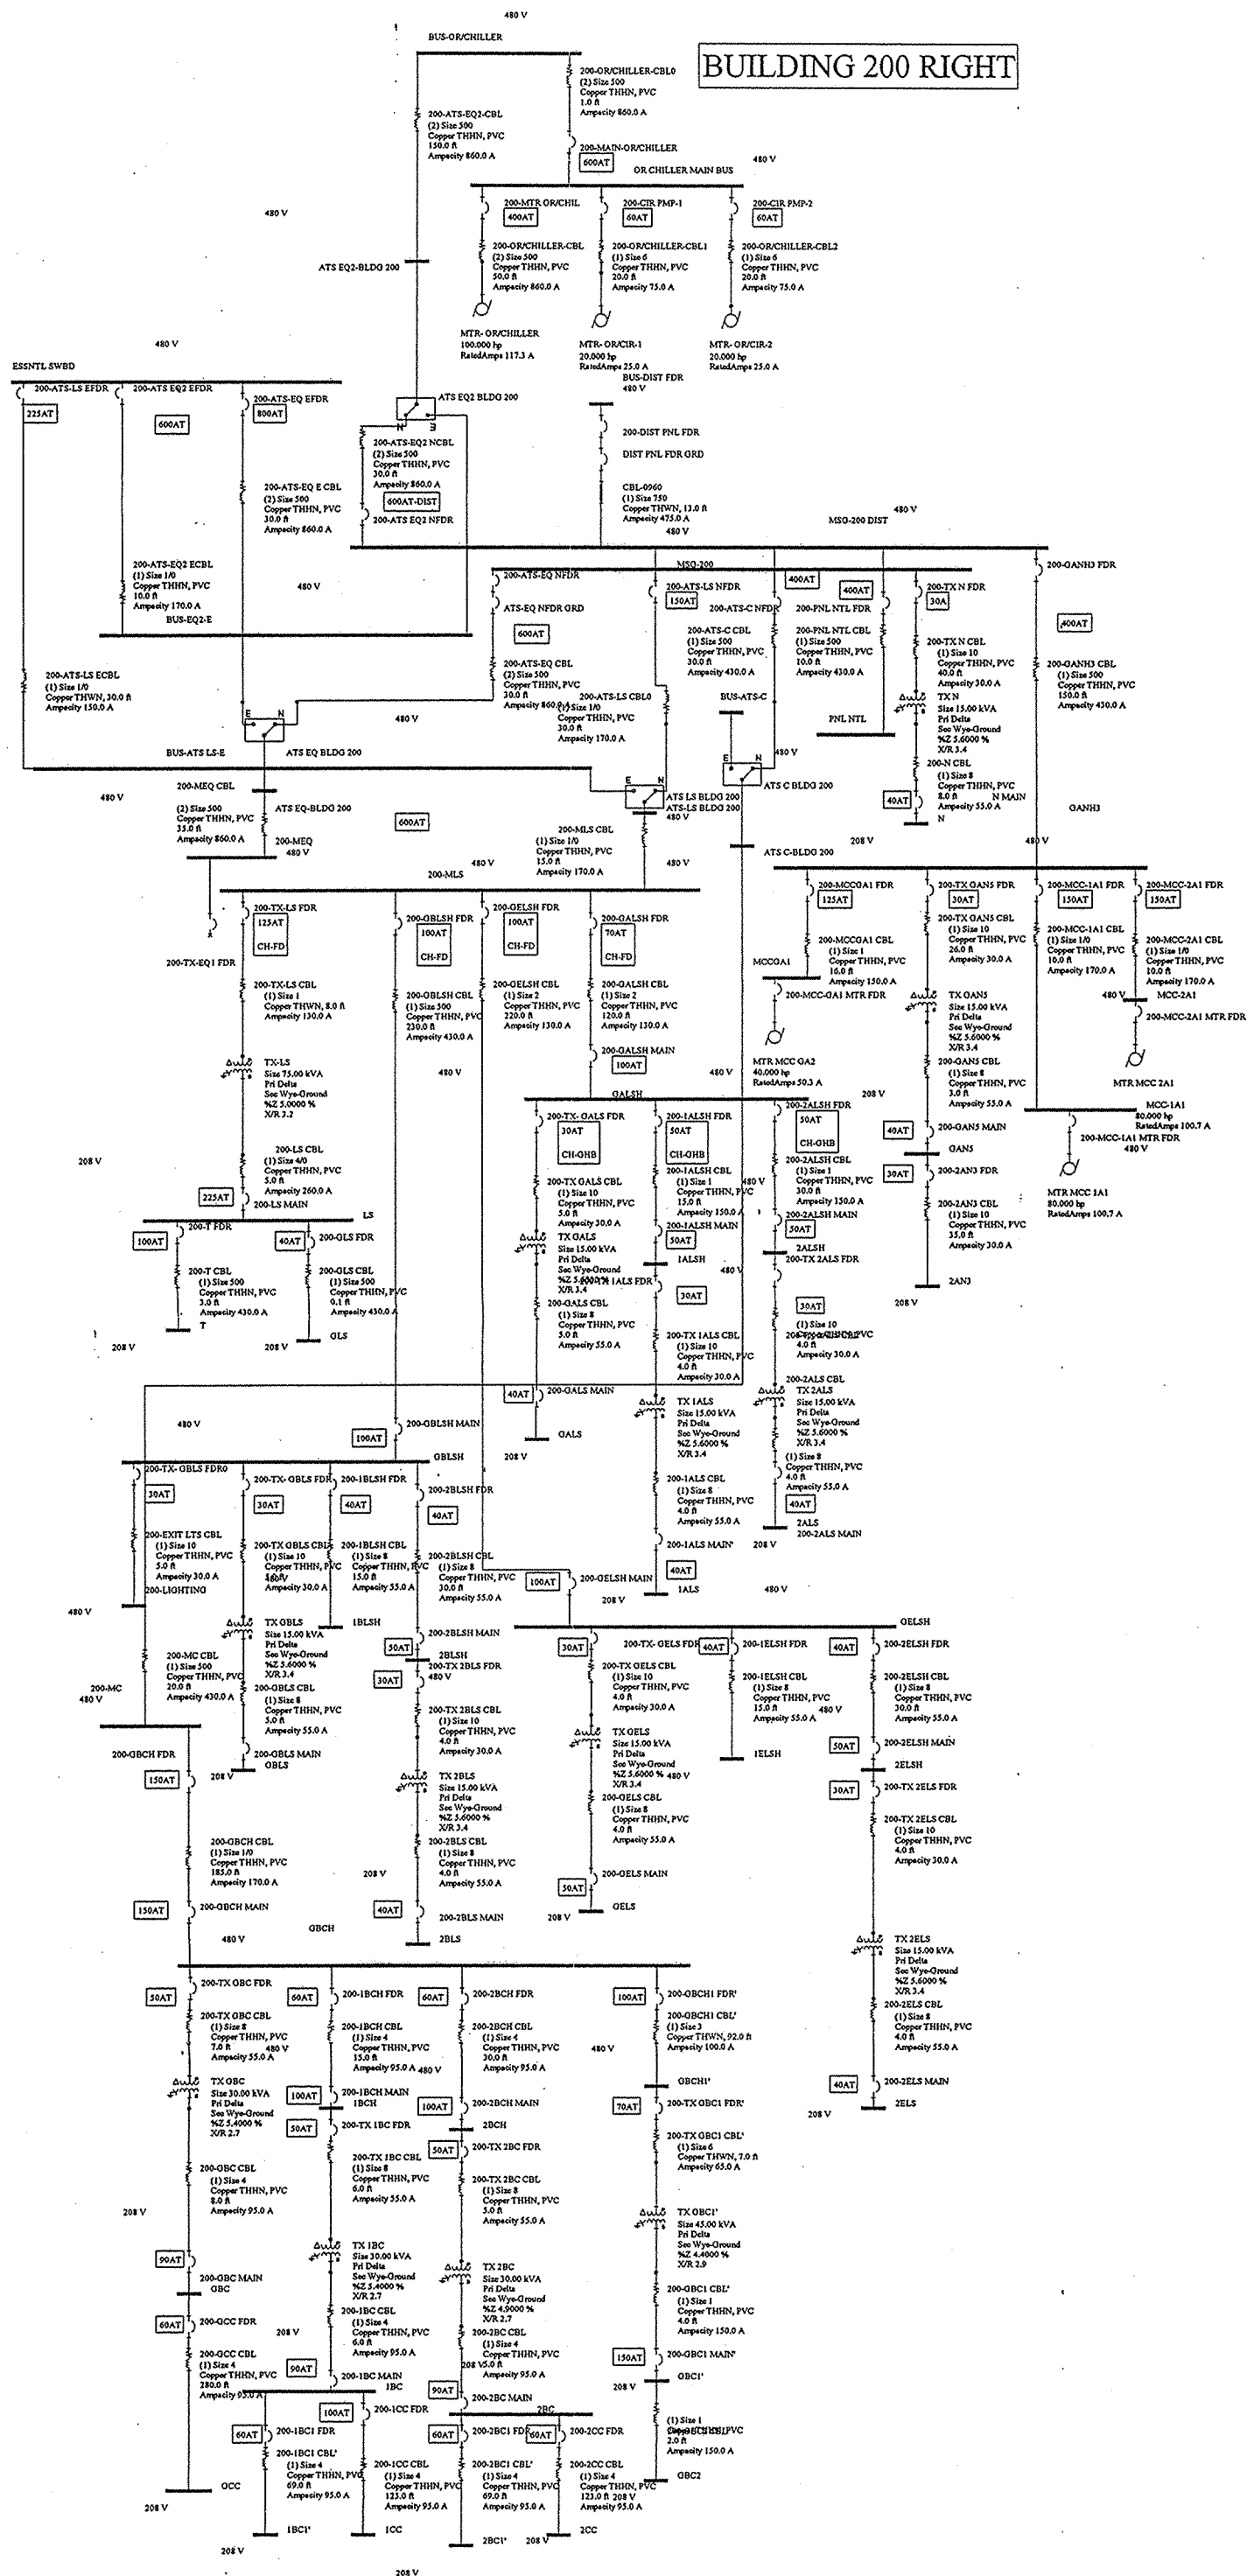

# BUILDING 201

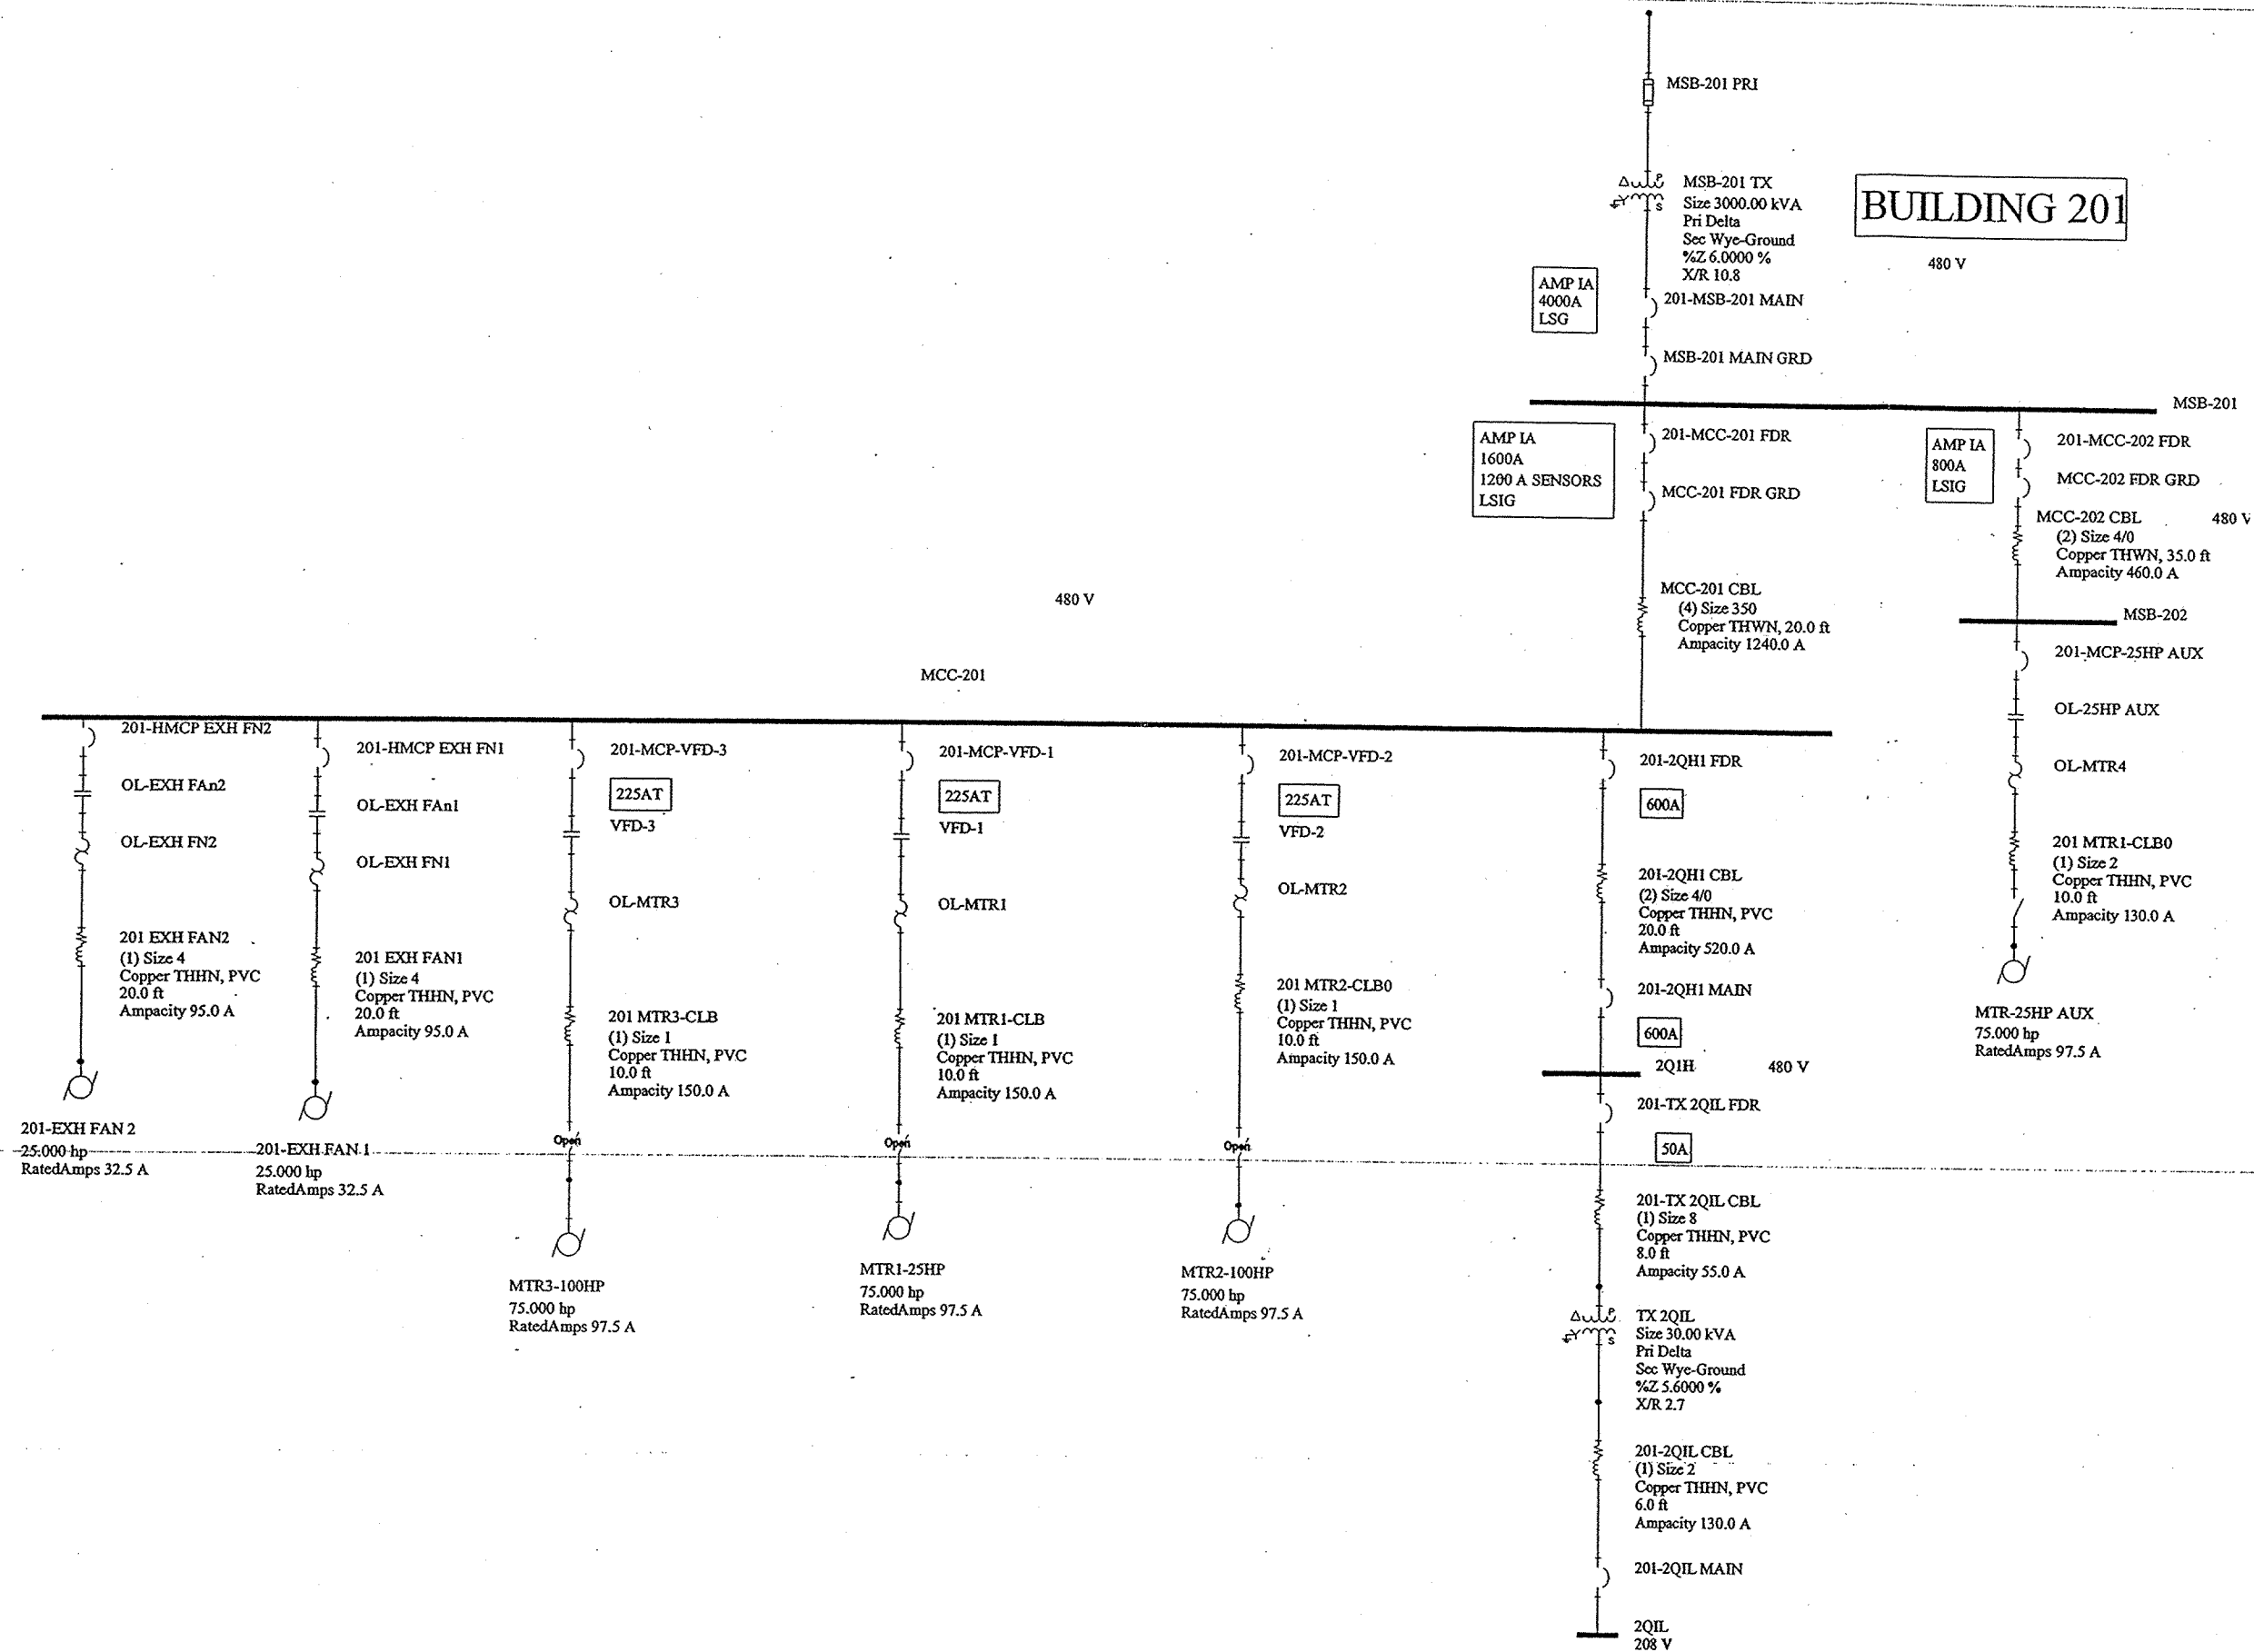




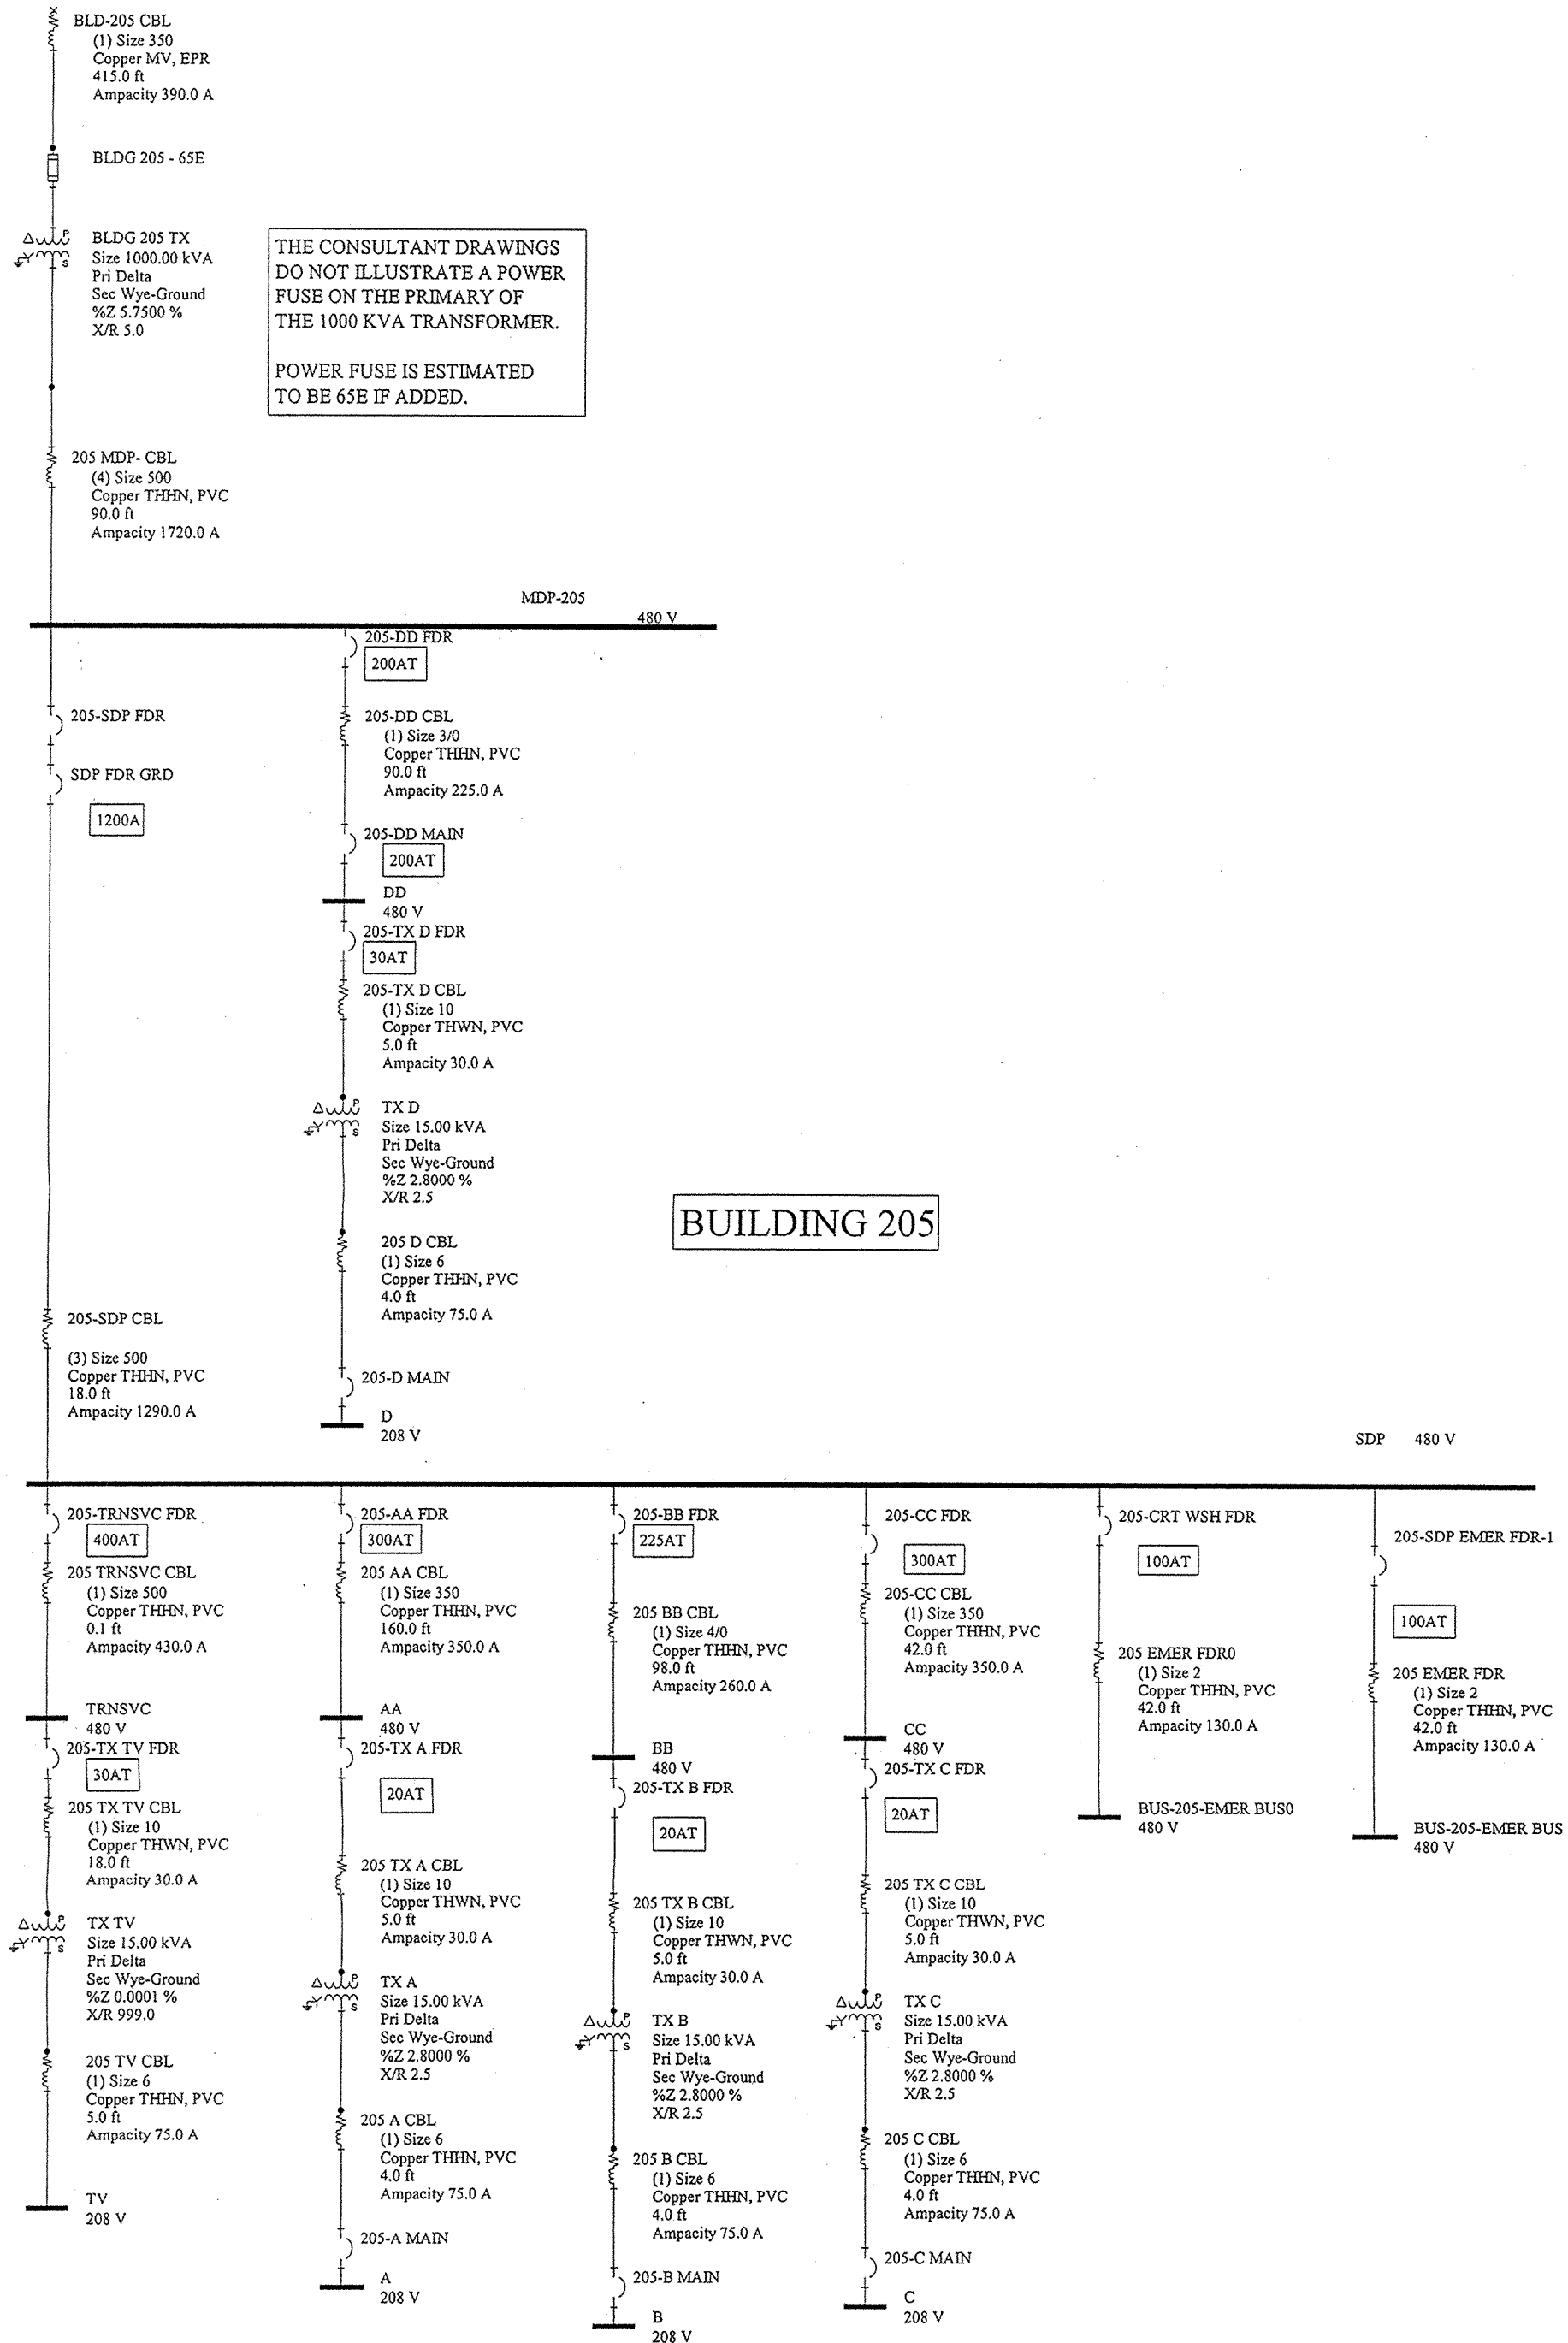

61



# BUILDING 206

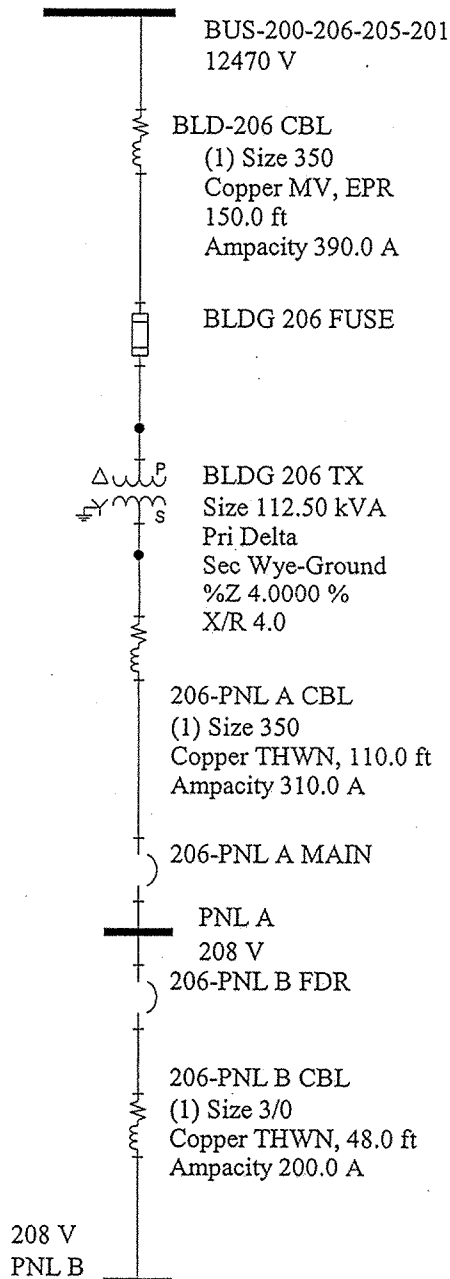

BREAKER  
DATA NOT  
COMPLETE

ASSUMED  
300 AMP

BREAKER  
DATA NOT  
COMPLETE

ASSUMED  
200 AMP