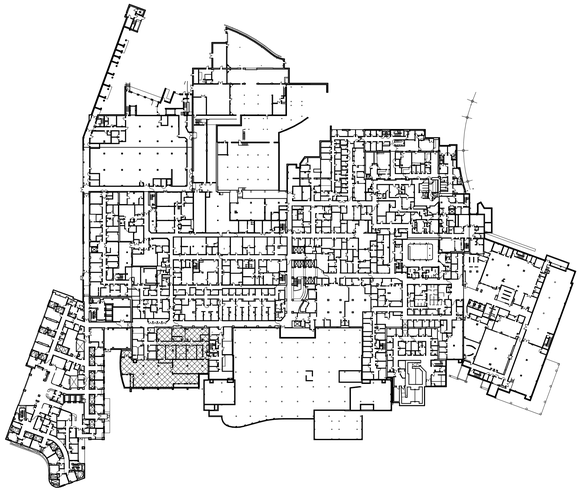

KEY PLAN - MICU B
1" = 100'-0"

SECOND SHIFT WORK NOTE

ALL WORK SHOWN ON THIS FLOOR PLAN SHALL BE COMPLETED AFTER THE DEPARTMENT HAS COMPLETED WORK FOR THE DAY. THE STARTING TIME WILL VARY BY DEPARTMENT AND MUST BE COORDINATED WITH THE COR. IN THE CASE OF A SCHEDULING CONFLICT, THE CONTRACTOR SHALL NOTIFY THE COR OF THE AREA WHERE WORK IS BEING STOPPED AND IDENTIFY THE FLOAT AREA THEY PLAN TO WORK IN FOR THE NIGHT.

DEAD LEG DEMOLITION CODED NOTE

1. CUT AND CAP EXISTING DEAD LEG PIPING AT LIMIT OF DEMOLITION SYMBOL. CONTRACTOR SHALL CAP PIPING, WITHIN TWO PIPE DIAMETERS, OFF OF THE MAIN IT IS CONNECTED TO. CONTRACTOR SHALL DRAIN, CAP AND LABEL REMAINING DEAD LEG PIPING AND ABANDON IN CEILING. BRIGHT YELLOW LABELS SHALL BE PLACED AT BOTH ENDS OF EACH ABANDONED PIPE. LABEL SHALL READ "ABANDONED PIPING". CONTRACTOR SHALL REMOVE AND REPLACE CEILINGS AS NECESSARY TO ACCOMPLISH WORK. CONTRACTOR SHALL VERIFY DEAD LEG IS NOT ACTIVE PRIOR TO REMOVING SECTION OF PIPE.

DEMOLITION CODED NOTE

2. DRAIN EXISTING DOMESTIC WATER PIPING AND LABEL AS "ABANDONED PIPING". CONTRACTOR SHALL TRACE PIPING DOWN TO ORIGIN IN SUB-BASEMENT AND VERIFY THAT PIPING IS CONSIDERED A "DEAD-LEG" PRIOR TO DRAINING AND LABELING.

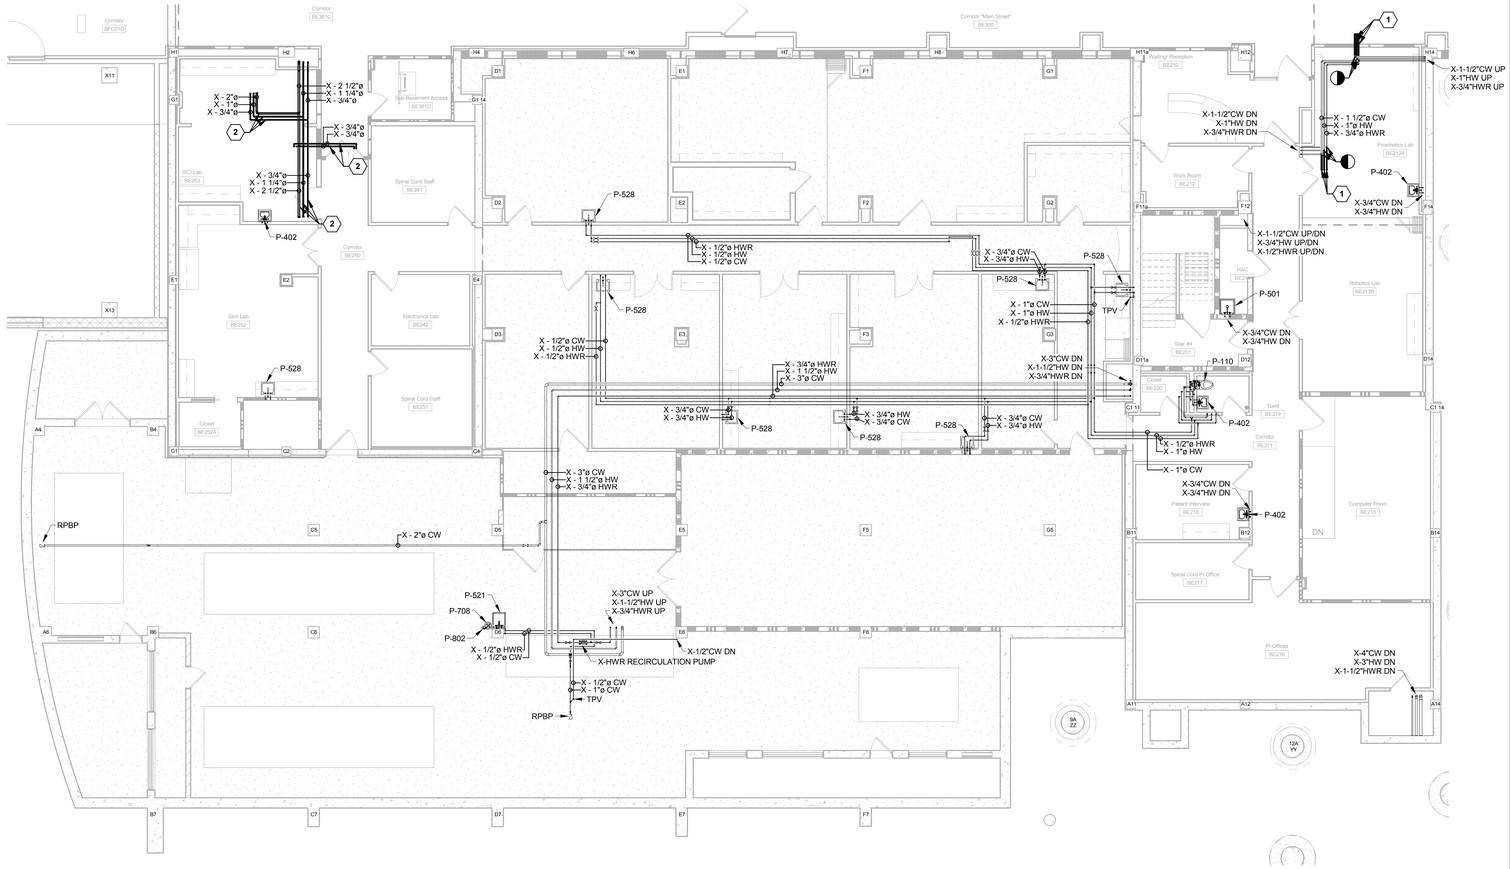

PARTIAL BASEMENT PLUMBING DEMOLITION PLAN - MICU 1

1/8" = 1'-0"

0' 4' 8' 16' 32'

FULLY SPRINKLERED

Revisions:	Date
BID ISSUE	4/29/2016

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
672 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL: (440) 546-9696
FAX: (440) 546-9699

STATE OF OHIO — DAVID A. DOMAL — REGISTERED PROFESSIONAL ENGINEER

ARCHITECT:

Drawing Title: **PARTIAL BASEMENT PLUMBING DEMOLITION PLAN - MICU ADDITION**

Approved:

Project Title: **IMPROVE WATER SYSTEM TO PREVENT LEGIONELLA**

Location: **VAMC - WADE PARK**

Date: 4/29/2016 | Checked: DAD | Drawn: JMC

Project Number: 541-16-101

Building Number: MAIN CAMPUS

Drawing Number: **BD-MICU**

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978

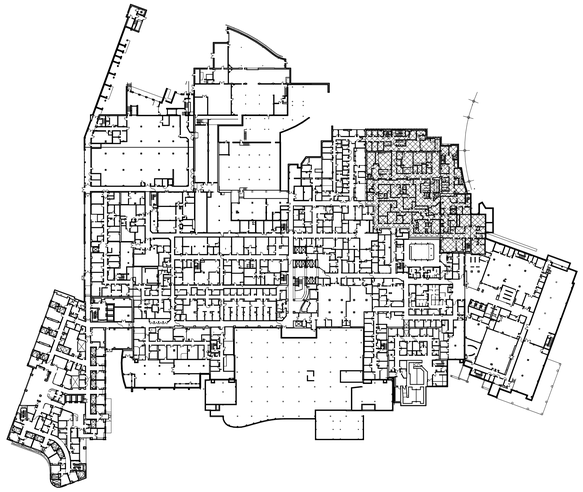

KEY PLAN - RADIOLOGY B EAST
1" = 100'-0"

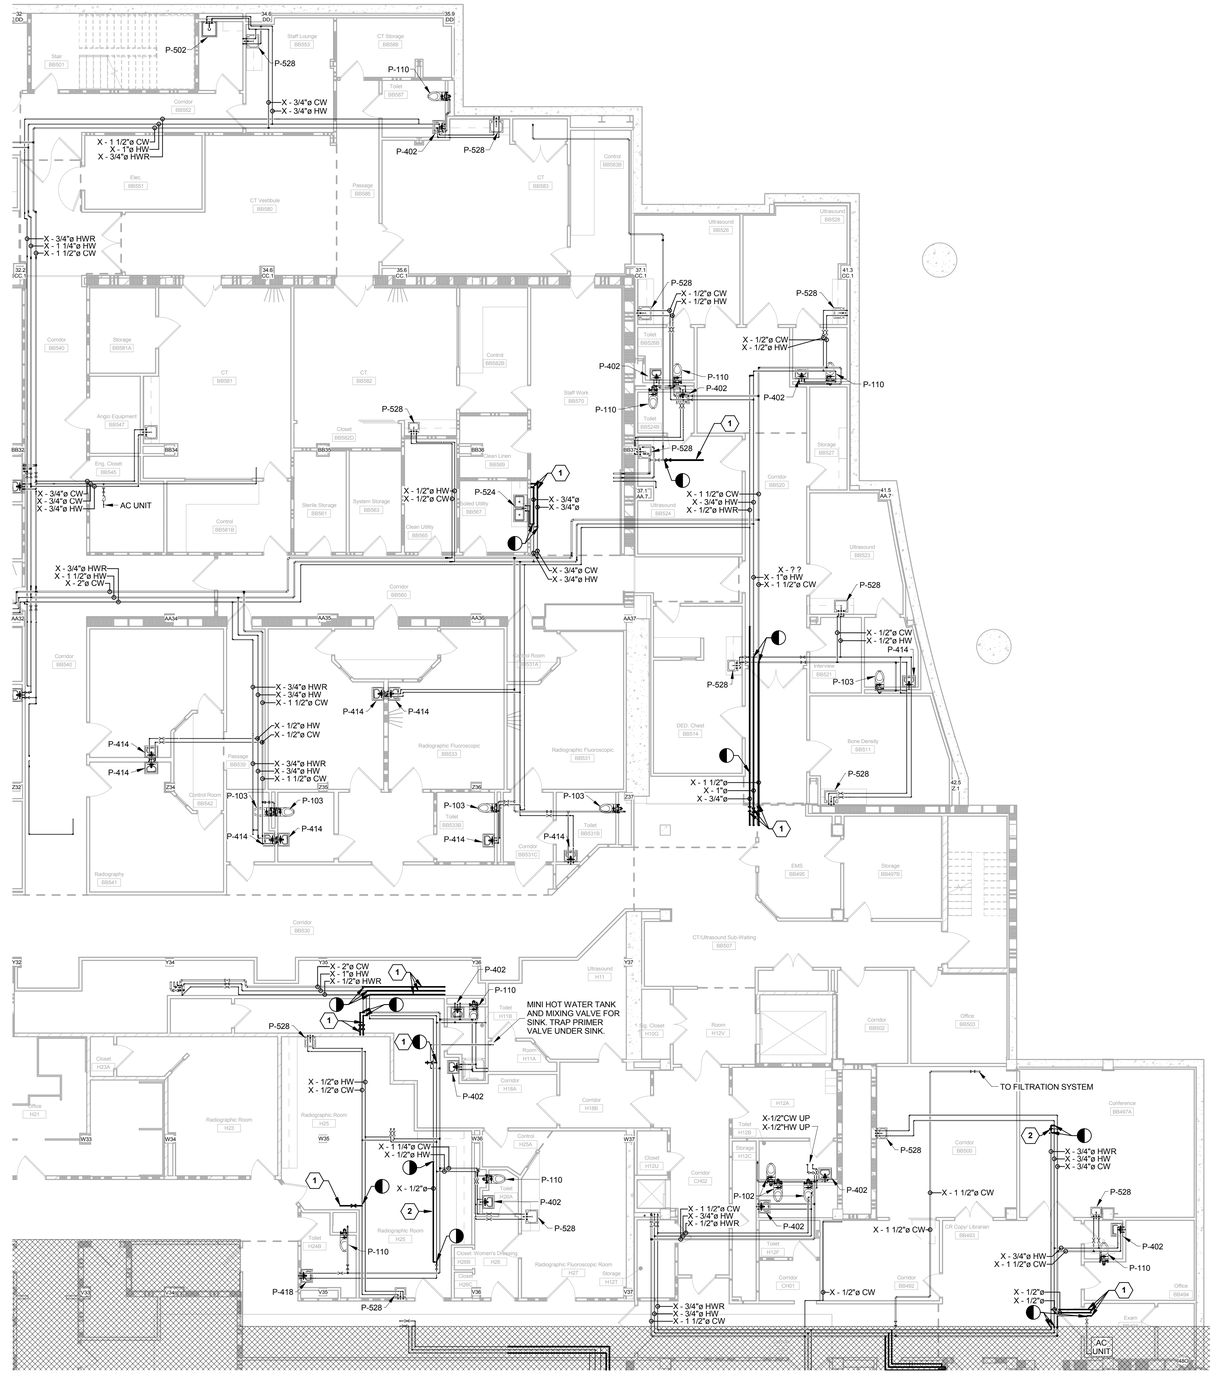

PARTIAL BASEMENT PLUMBING DEMOLITION PLAN - RADIOLOGY EAST 1

1/8" = 1'-0"

0' 4' 8' 16' 32'

SECOND SHIFT WORK NOTE

ALL WORK SHOWN ON THIS FLOOR PLAN SHALL BE COMPLETED AFTER THE DEPARTMENT HAS COMPLETED WORK FOR THE DAY. THE STARTING TIME WILL VARY BY DEPARTMENT AND MUST BE COORDINATED WITH THE COR. IN THE CASE OF A SCHEDULING CONFLICT, THE CONTRACTOR SHALL NOTIFY THE COR OF THE AREA WHERE WORK IS BEING STOPPED AND IDENTIFY THE FLOAT AREA THEY PLAN TO WORK IN FOR THE NIGHT.

PROJECT AREA UNDER CONSTRUCTION NOTES

A. AREAS ON THIS SHEET ARE CURRENTLY UNDER CONSTRUCTION OR ARE BEING DESIGNED UNDER A DIFFERENT CONTRACT. CONDITIONS SHOWN ON THIS DRAWING MAY BE DIFFERENT WHEN THE CONTRACTOR OCCUPIES SPACES SHOWN ON THIS SHEET. CONTRACTOR SHALL REPORT ALL CONDITIONS THAT DO NOT MATCH THE DRAWINGS TO THE COR.

DEAD LEG DEMOLITION CODED NOTE

1 CUT AND CAP EXISTING DEAD LEG PIPING AT LIMIT OF DEMOLITION SYMBOL. CONTRACTOR SHALL CAP PIPING, WITHIN TWO PIPE DIAMETERS, OFF OF THE MAIN IT IS CONNECTED TO. CONTRACTOR SHALL DRAIN, CAP AND LABEL REMAINING DEAD LEG PIPING AND ABANDON IN CEILING. BRIGHT YELLOW LABELS SHALL BE PLACED AT BOTH ENDS OF EACH ABANDONED PIPE. LABEL SHALL READ "ABANDONED PIPING". CONTRACTOR SHALL REMOVE AND REPLACE CEILINGS AS NECESSARY TO ACCOMPLISH WORK. CONTRACTOR SHALL VERIFY DEAD LEG IS NOT ACTIVE PRIOR TO REMOVING SECTION OF PIPE.

DEMOLITION CODED NOTES

2 REMOVE SECTION OF HOT WATER RETURN PIPING TO ALLOW FOR EXTENSION TO NEW LOCATION.

FULLY SPRINKLERED

Revisions:	Date
BID ISSUE	4/29/2016

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
672 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL: (440) 546-9696
FAX: (440) 546-9699

STATE OF OHIO
GARY A. FREDRICK
No. 24142
REGISTERED
PROFESSIONAL ENGINEER

ARCHITECT:

Drawing Title: **PARTIAL BASEMENT PLUMBING DEMOLITION PLAN - RADIOLOGY EAST**

Approved:

Project Title: **IMPROVE WATER SYSTEM TO PREVENT LEGIONELLA**

Location: **VAMC - WADE PARK**

Date: 4/29/2016 | Checked: DAD | Drawn: JMC

Project Number: 541-16-101

Building Number: MAIN CAMPUS

Drawing Number: **BD-RADE**

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978

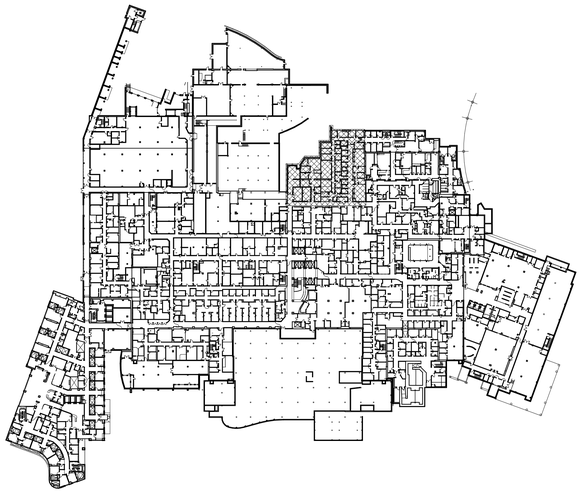

KEY PLAN - RADIOLOGY B WEST
1" = 100'-0"

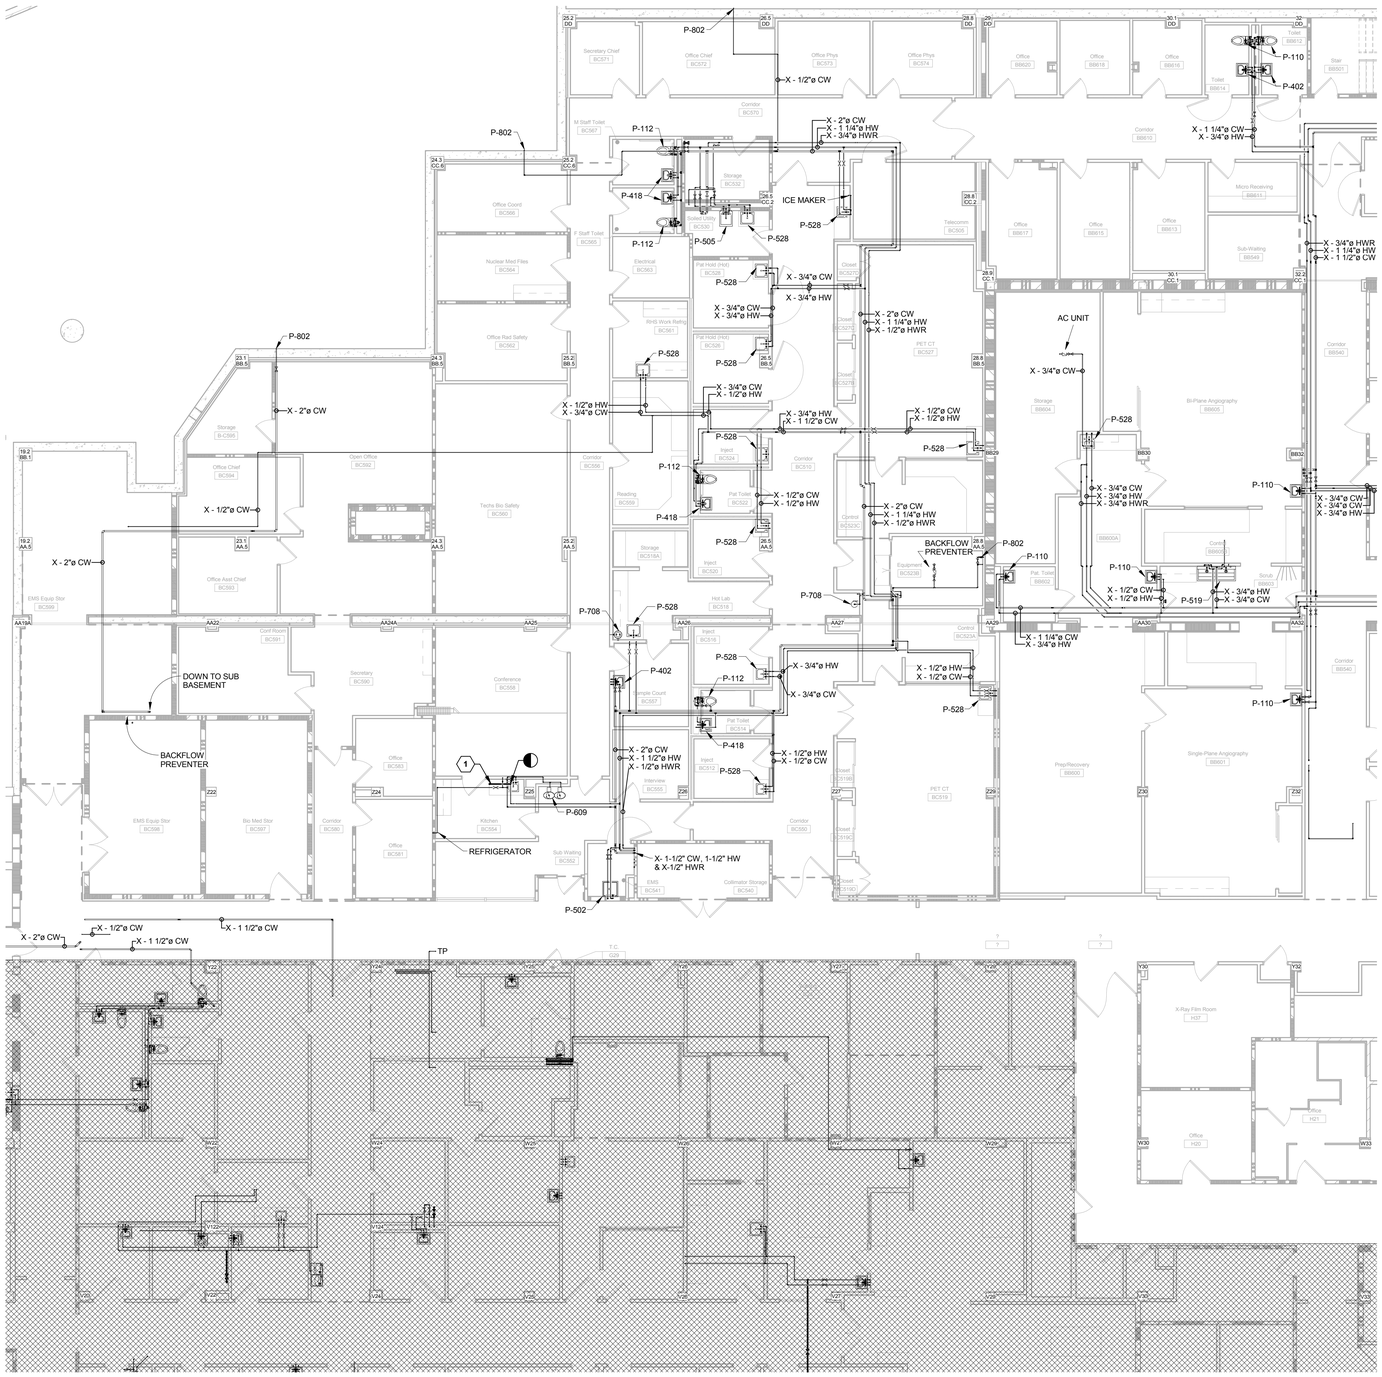

PARTIAL BASEMENT PLUMBING DEMOLITION PLAN - RADIOLOGY WEST 1

1/8" = 1'-0"

0' 4' 8' 16' 32'

SECOND SHIFT WORK NOTE

ALL WORK SHOWN ON THIS FLOOR PLAN SHALL BE COMPLETED AFTER THE DEPARTMENT HAS COMPLETED WORK FOR THE DAY. THE STARTING TIME WILL VARY BY DEPARTMENT AND MUST BE COORDINATED WITH THE COR. IN THE CASE OF A SCHEDULING CONFLICT, THE CONTRACTOR SHALL NOTIFY THE COR OF THE AREA WHERE WORK IS BEING STOPPED AND IDENTIFY THE FLOAT AREA THEY PLAN TO WORK IN FOR THE NIGHT.

PROJECT AREA UNDER CONSTRUCTION NOTES

A. AREAS ON THIS SHEET ARE CURRENTLY UNDER CONSTRUCTION OR ARE BEING DESIGNED UNDER A DIFFERENT CONTRACT. CONDITIONS SHOWN ON THIS DRAWING MAY BE DIFFERENT WHEN THE CONTRACTOR OCCUPIES SPACES SHOWN ON THIS SHEET. CONTRACTOR SHALL REPORT ALL CONDITIONS THAT DO NOT MATCH THE DRAWINGS TO THE COR.

DEAD LEG DEMOLITION CODED NOTE

1 CUT AND CAP EXISTING DEAD LEG PIPING AT LIMIT OF DEMOLITION SYMBOL. CONTRACTOR SHALL CAP PIPING, WITHIN TWO PIPE DIAMETERS, OFF OF THE MAIN IT IS CONNECTED TO. CONTRACTOR SHALL DRAIN, CAP AND LABEL REMAINING DEAD LEG PIPING AND ABANDON IN CEILING. BRIGHT YELLOW LABELS SHALL BE PLACED AT BOTH ENDS OF EACH ABANDONED PIPE. LABEL SHALL READ "ABANDONED PIPING". CONTRACTOR SHALL REMOVE AND REPLACE CEILINGS AS NECESSARY TO ACCOMPLISH WORK. CONTRACTOR SHALL VERIFY DEAD LEG IS NOT ACTIVE PRIOR TO REMOVING SECTION OF PIPE.

FULLY SPRINKLERED

BID ISSUE	4/29/2016
Revisions:	Date

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
672 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL. (440) 546-9696
FAX: (440) 546-9699

ARCHITECT:

Drawing Title: **PARTIAL BASEMENT PLUMBING DEMOLITION PLAN - RADIOLOGY WEST**

Approved:

Project Title: **IMPROVE WATER SYSTEM TO PREVENT LEGIONELLA**

Location: **VAMC - WADE PARK**

Date: 4/29/2016 | Checked: DAD | Drawn: JMC

Project Number: 541-16-101

Building Number: MAIN CAMPUS

Drawing Number: **BD-RADW**

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978

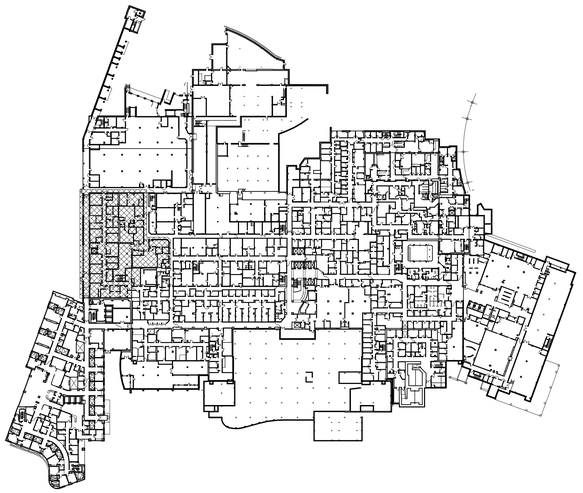

KEY PLAN - RESEARCH ADDITION B
1" = 100'-0"

SECOND SHIFT WORK NOTE

ALL WORK SHOWN ON THIS FLOOR PLAN SHALL BE COMPLETED AFTER THE DEPARTMENT HAS COMPLETED WORK FOR THE DAY. THE STARTING TIME WILL VARY BY DEPARTMENT AND MUST BE COORDINATED WITH THE COR. IN THE CASE OF A SCHEDULING CONFLICT, THE CONTRACTOR SHALL NOTIFY THE COR OF THE AREA WHERE WORK IS BEING STOPPED AND IDENTIFY THE FLOAT AREA THEY PLAN TO WORK IN FOR THE NIGHT.

PROJECT AREA UNDER CONSTRUCTION NOTES

A. AREAS ON THIS SHEET ARE CURRENTLY UNDER CONSTRUCTION OR ARE BEING DESIGNED UNDER A DIFFERENT CONTRACT. CONDITIONS SHOWN ON THIS DRAWING MAY BE DIFFERENT WHEN THE CONTRACTOR OCCUPIES SPACES SHOWN ON THIS SHEET. CONTRACTOR SHALL REPORT ALL CONDITIONS THAT DO NOT MATCH THE DRAWINGS TO THE COR.

DEAD LEG DEMOLITION CODED NOTE

(1) CUT AND CAP EXISTING DEAD LEG PIPING AT LIMIT OF DEMOLITION SYMBOL. CONTRACTOR SHALL CAP PIPING, WITHIN TWO PIPE DIAMETERS, OFF OF THE MAIN IT IS CONNECTED TO. CONTRACTOR SHALL DRAIN, CAP AND LABEL REMAINING DEAD LEG PIPING AND ABANDON IN CEILING. BRIGHT YELLOW LABELS SHALL BE PLACED AT BOTH ENDS OF EACH ABANDONED PIPE. LABEL SHALL READ "ABANDONED PIPING". CONTRACTOR SHALL REMOVE AND REPLACE CEILINGS AS NECESSARY TO ACCOMPLISH WORK. CONTRACTOR SHALL VERIFY DEAD LEG IS NOT ACTIVE PRIOR TO REMOVING SECTION OF PIPE.

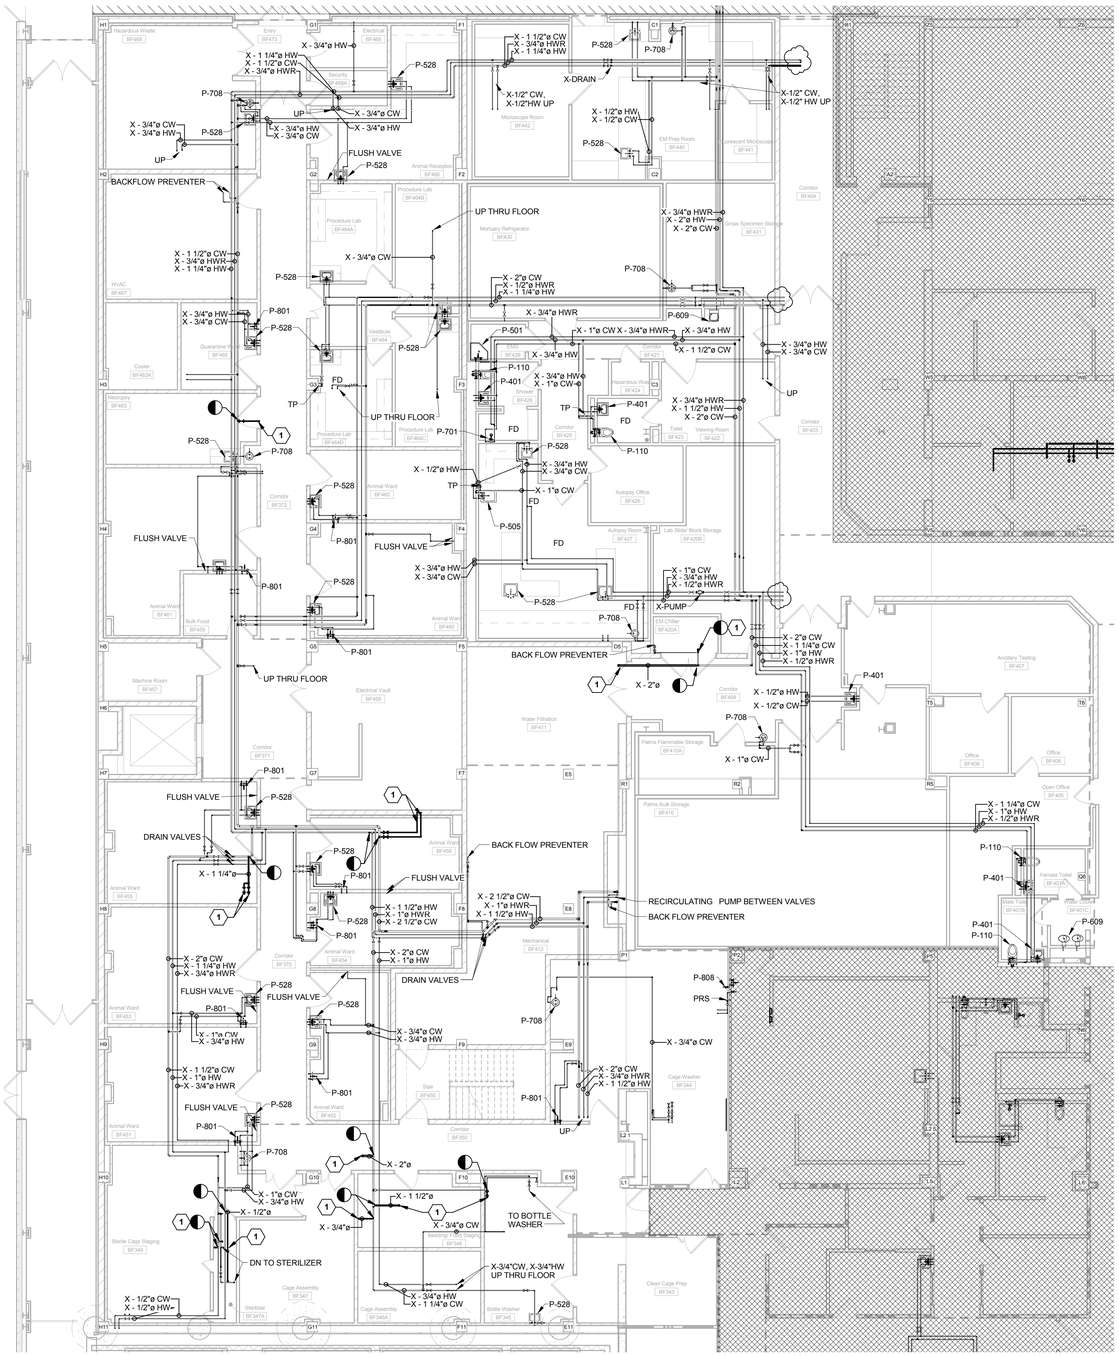

PARTIAL BASEMENT PLUMBING DEMOLITION PLAN - RESEARCH ADDITION (1)
1/8" = 1'-0"
0' 4' 8' 16' 32'

FULLY SPRINKLERED

BID ISSUE	4/29/2016
Revisions:	**Date**

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
672 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL: (440) 546-9696
FAX: (440) 546-9699

STATE OF OHIO — DAVID A. DONALD — REGISTERED PROFESSIONAL ENGINEER

ARCHITECT:

Drawing Title: **PARTIAL BASEMENT PLUMBING DEMOLITION PLAN - RESEARCH ADDITION**

Approved:

Project Title: **IMPROVE WATER SYSTEM TO PREVENT LEGIONELLA**

Location: **VAMC - WADE PARK**

Date	Checked	Drawn
4/29/2016	DAD	JMC

Project Number: 541-16-101

Building Number: MAIN CAMPUS

Drawing Number: **BD-REA**

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978

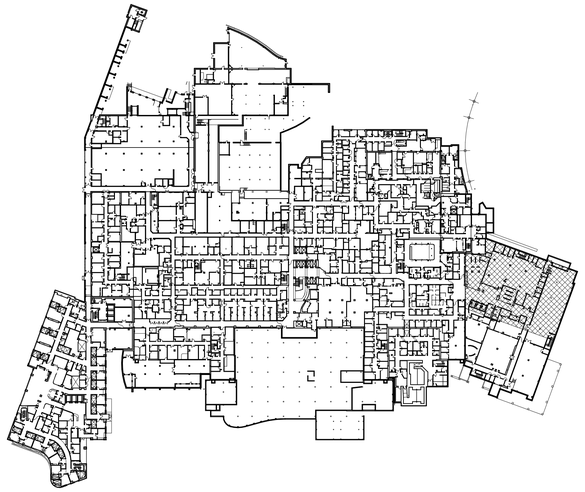

KEY PLAN - ACC B NORTH
1" = 100'-0"

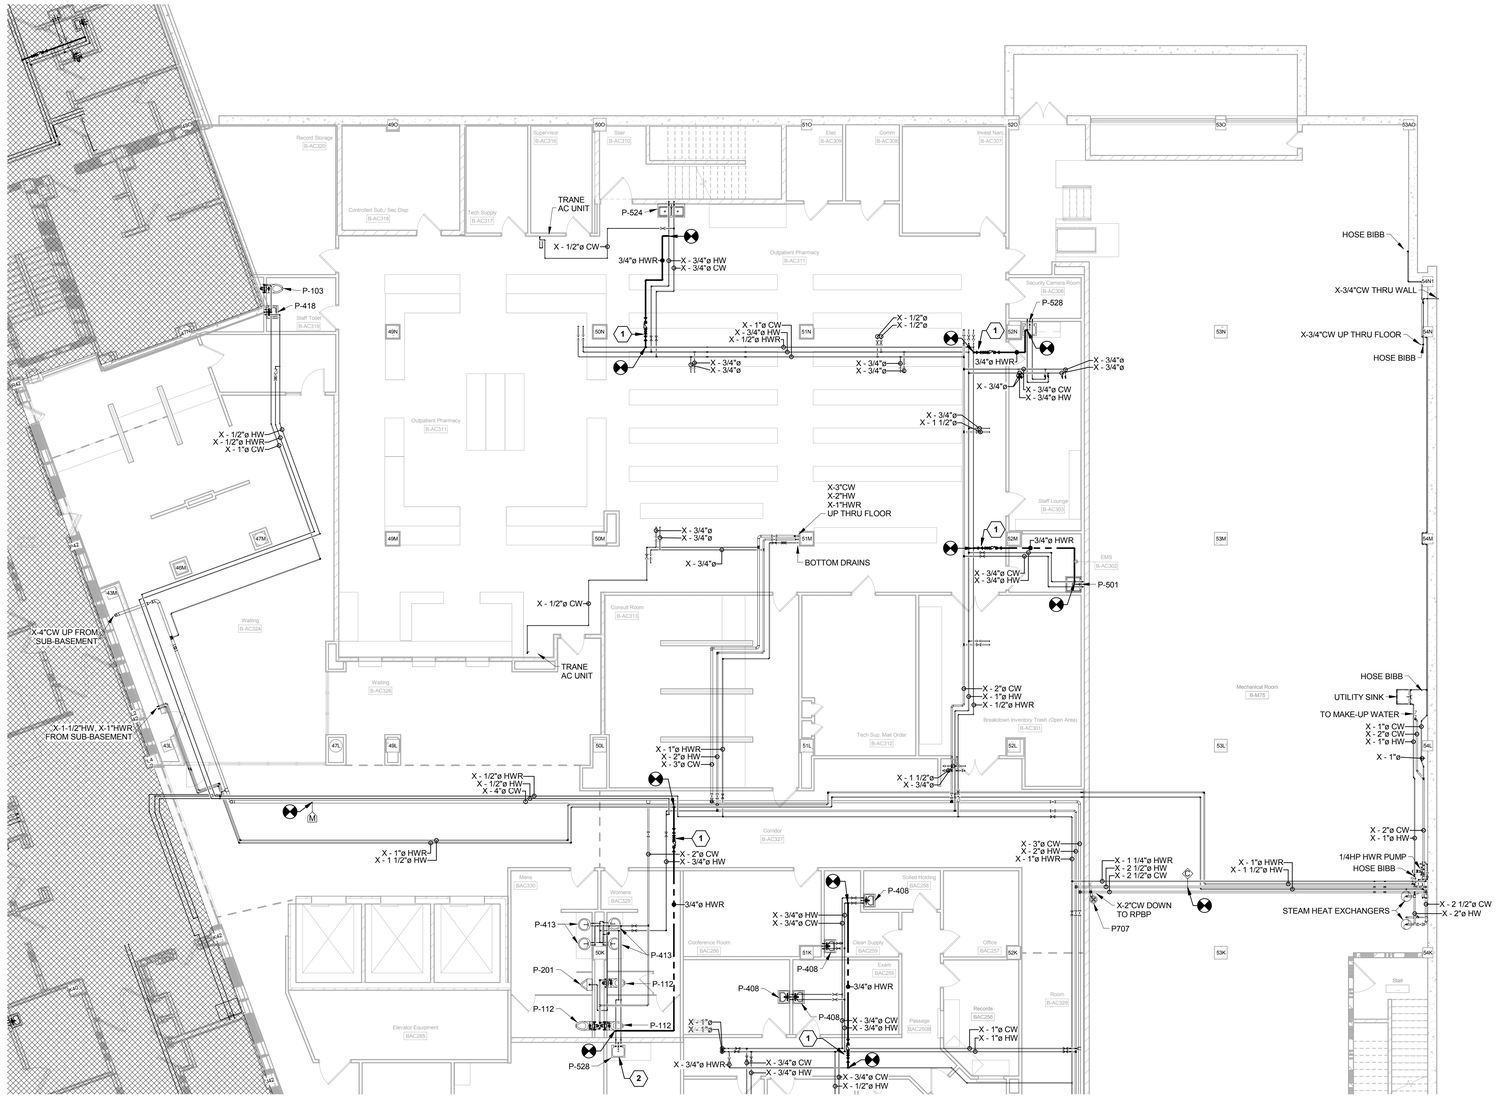

PARTIAL BASEMENT PLUMBING PLAN - ACC NORTH 1

1/8" = 1'-0"

0' 4' 8' 16' 32'

SECOND SHIFT WORK NOTE

ALL WORK SHOWN ON THIS FLOOR PLAN SHALL BE COMPLETED AFTER THE DEPARTMENT HAS COMPLETED WORK FOR THE DAY. THE STARTING TIME WILL VARY BY DEPARTMENT AND MUST BE COORDINATED WITH THE COR. IN THE CASE OF A SCHEDULING CONFLICT, THE CONTRACTOR SHALL NOTIFY THE COR OF THE AREA WHERE WORK IS BEING STOPPED AND IDENTIFY THE FLOAT AREA THEY PLAN TO WORK IN FOR THE NIGHT.

CODED NOTES

1. PROVIDE NEW 3/4" DOMESTIC HOT WATER RETURN LINE WITH HOT WATER RECIRCULATION VALVE ASSEMBLY.
2. REMOVE EXISTING AERATOR IF INSTALLED AND INSTALL LAMINAR FLOW CONTROL DEVICE ON EXISTING FAUCET.

FULLY SPRINKLERED

BID ISSUE	4/29/2016
Revisions:	**Date**

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
4721 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL. (440) 546-9696
FAX: (440) 546-9699

ARCHITECT:

Drawing Title: **PARTIAL BASEMENT PLUMBING PLAN - ACC NORTH**

Approved:

Project Title: **IMPROVE WATER SYSTEM TO PREVENT LEGIONELLA**

Location: **VAMC - WADE PARK**

Date: 4/29/2016 | Checked: DAD | Drawn: JMC

Project Number: 541-16-101

Building Number: MAIN CAMPUS

Drawing Number: **B-ACCN**

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978

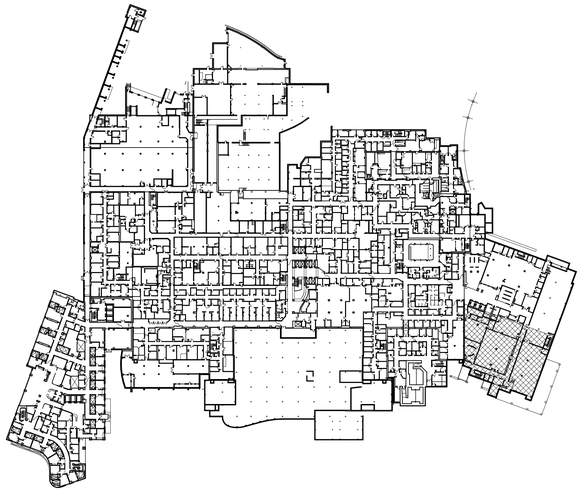

KEY PLAN - ACC B SOUTH
1" = 100'-0"

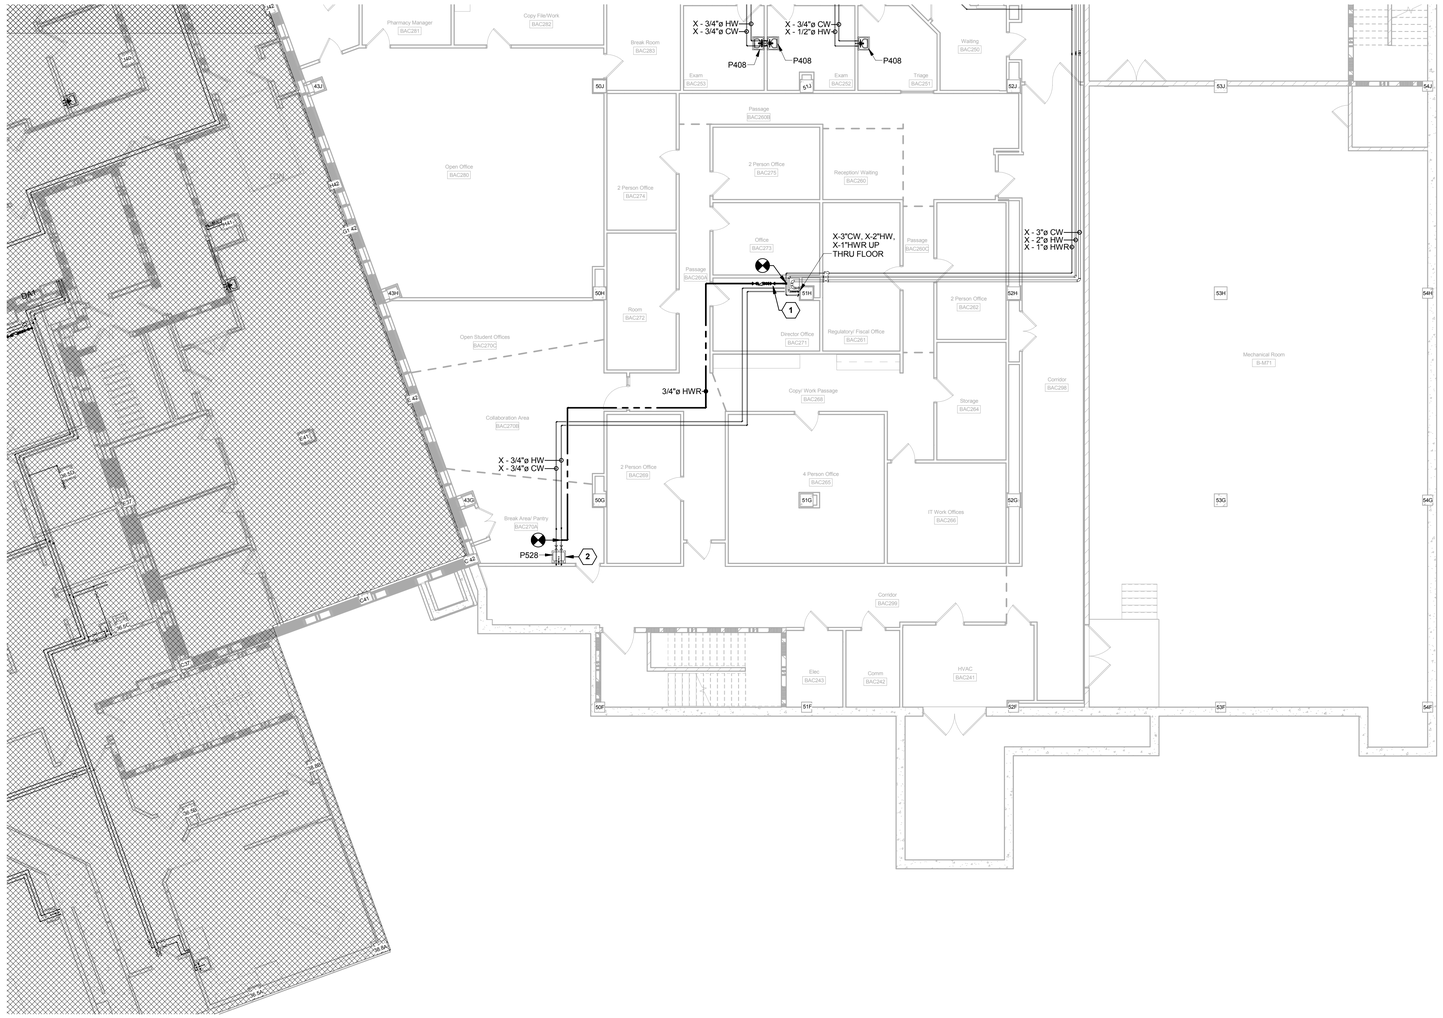

SECOND SHIFT WORK NOTE

ALL WORK SHOWN ON THIS FLOOR PLAN SHALL BE COMPLETED AFTER THE DEPARTMENT HAS COMPLETED WORK FOR THE DAY. THE STARTING TIME WILL VARY BY DEPARTMENT AND MUST BE COORDINATED WITH THE COR. IN THE CASE OF A SCHEDULING CONFLICT, THE CONTRACTOR SHALL NOTIFY THE COR OF THE AREA WHERE WORK IS BEING STOPPED AND IDENTIFY THE FLOAT AREA THEY PLAN TO WORK IN FOR THE NIGHT.

CODED NOTES

1. PROVIDE NEW 3/4" DOMESTIC HOT WATER RETURN LINE WITH HOT WATER RECIRCULATION VALVE ASSEMBLY.
2. REMOVE EXISTING AERATOR IF INSTALLED AND INSTALL LAMINAR FLOW CONTROL DEVICE ON EXISTING FAUCET.

N

PARTIAL BASEMENT PLUMBING PLAN - ACC SOUTH 1

1/8" = 1'-0"

0' 4' 8' 16' 32'

FULLY SPRINKLERED

BID ISSUE	4/29/2016
Revisions:	**Date**

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
672 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL: (440) 546-9696
FAX: (440) 546-9699

ARCHITECT:

Drawing Title: **PARTIAL BASEMENT PLUMBING PLAN - ACC SOUTH**

Approved:

Project Title: **IMPROVE WATER SYSTEM TO PREVENT LEGIONELLA**

Location: **VAMC - WADE PARK**

Date: 4/29/2016 | Checked: DAD | Drawn: JMC

Project Number: 541-16-101

Building Number: MAIN CAMPUS

Drawing Number: **B-ACCS**

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978

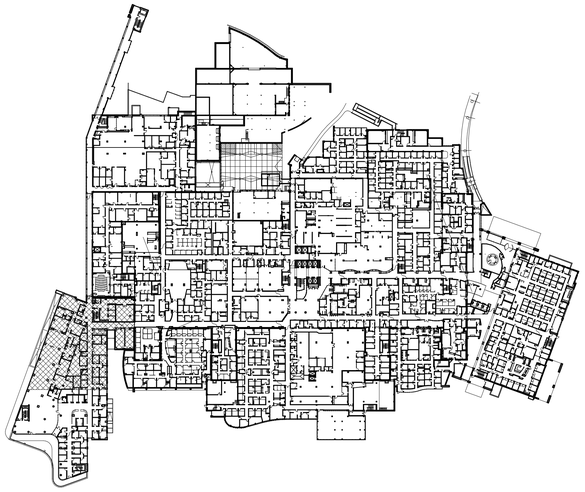

KEY PLAN - CARES TOWER 1 NORTH
1" = 100'-0"

PARTIAL BASEMENT PLUMBING PLAN - CARES TOWER NORTH
1
1/8" = 1'-0"
0' 4' 8' 16' 32'

FIRST SHIFT WORK NOTE

ALL WORK SHOWN ON THIS FLOOR PLAN SHALL BE COMPLETED DURING FIRST SHIFT (7AM-4PM). IN THE CASE OF A SCHEDULING CONFLICT, THE CONTRACTOR SHALL NOTIFY THE COR OF THE AREA WHERE WORK IS BEING STOPPED AND IDENTIFY THE FLOAT AREA THEY PLAN TO WORK IN FOR THE DAY.

DEDUCT ALTERNATE #1 NOTES

BASE BID: INSTALL ALL NEW SENSORS AS SHOWN ON THIS SHEET.

DEDUCT ALTERNATE #1: OMIT ALL (T) SENSORS DENOTED BY "DA1" ON THIS SHEET.

FULLY SPRINKLERED

BID ISSUE	4/29/2016
Revisions:	**Date**

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
672 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL. (440) 546-9696
FAX: (440) 546-9699

ARCHITECT:

Drawing Title: **PARTIAL BASEMENT PLUMBING PLAN - CARES TOWER NORTH**

Approved:

Project Title: **IMPROVE WATER SYSTEM TO PREVENT LEGIONELLA**

Location: **VAMC - WADE PARK**

Date: 4/29/2016 | Checked: DAD | Drawn: JMC

Project Number: 541-16-101

Building Number: MAIN CAMPUS

Drawing Number: **B-CTN**

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978

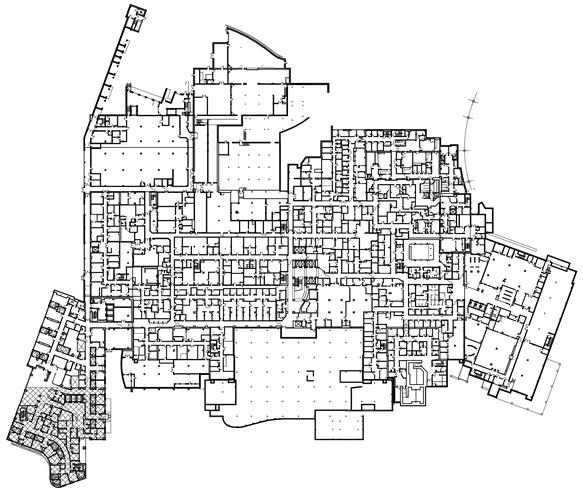

KEY PLAN - CARES TOWER B SOUTH
1" = 100'-0"

FIRST SHIFT WORK NOTE

ALL WORK SHOWN ON THIS FLOOR PLAN SHALL BE COMPLETED DURING FIRST SHIFT (7AM-4PM). IN THE CASE OF A SCHEDULING CONFLICT, THE CONTRACTOR SHALL NOTIFY THE COR OF THE AREA WHERE WORK IS BEING STOPPED AND IDENTIFY THE FLOAT AREA THEY PLAN TO WORK IN FOR THE DAY.

CODED NOTES

1. PROVIDE NEW 3/4" DOMESTIC HOT WATER RETURN LINE. ROUTE UP THRU FLOOR AT LOCATION SHOWN. SEE PARTIAL FIRST FLOOR PLUMBING PLAN - CARES TOWER SOUTH FOR CONTINUATION.

PARTIAL BASEMENT PLUMBING PLAN - CARES TOWER SOUTH 1

1/8" = 1'-0"

0' 4' 8' 16' 32'

FULLY SPRINKLERED

BID ISSUE	4/29/2016
Revisions:	Date

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
672 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL. (440) 546-9696
FAX: (440) 546-9699

ARCHITECT:

Drawing Title: **PARTIAL BASEMENT PLUMBING PLAN - CARES TOWER SOUTH**

Approved:

Project Title: **IMPROVE WATER SYSTEM TO PREVENT LEGIONELLA**

Location: **VAMC - WADE PARK**

Date: 4/29/2016 | Checked: DAD | Drawn: JMC

Project Number: 541-16-101

Building Number: MAIN CAMPUS

Drawing Number: **B-CTS**

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978

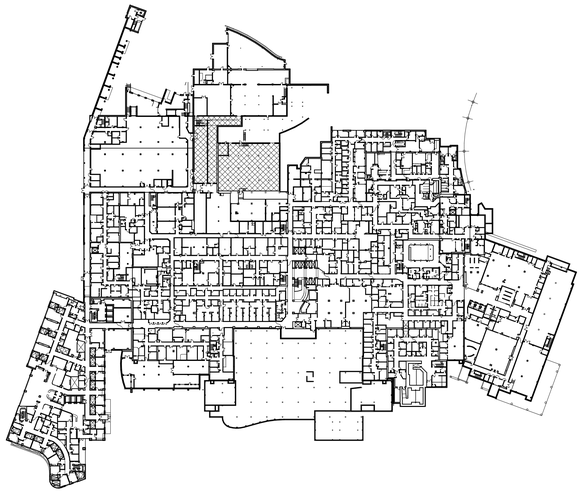

KEY PLAN - ENERGY CENTER B
1" = 100'-0"

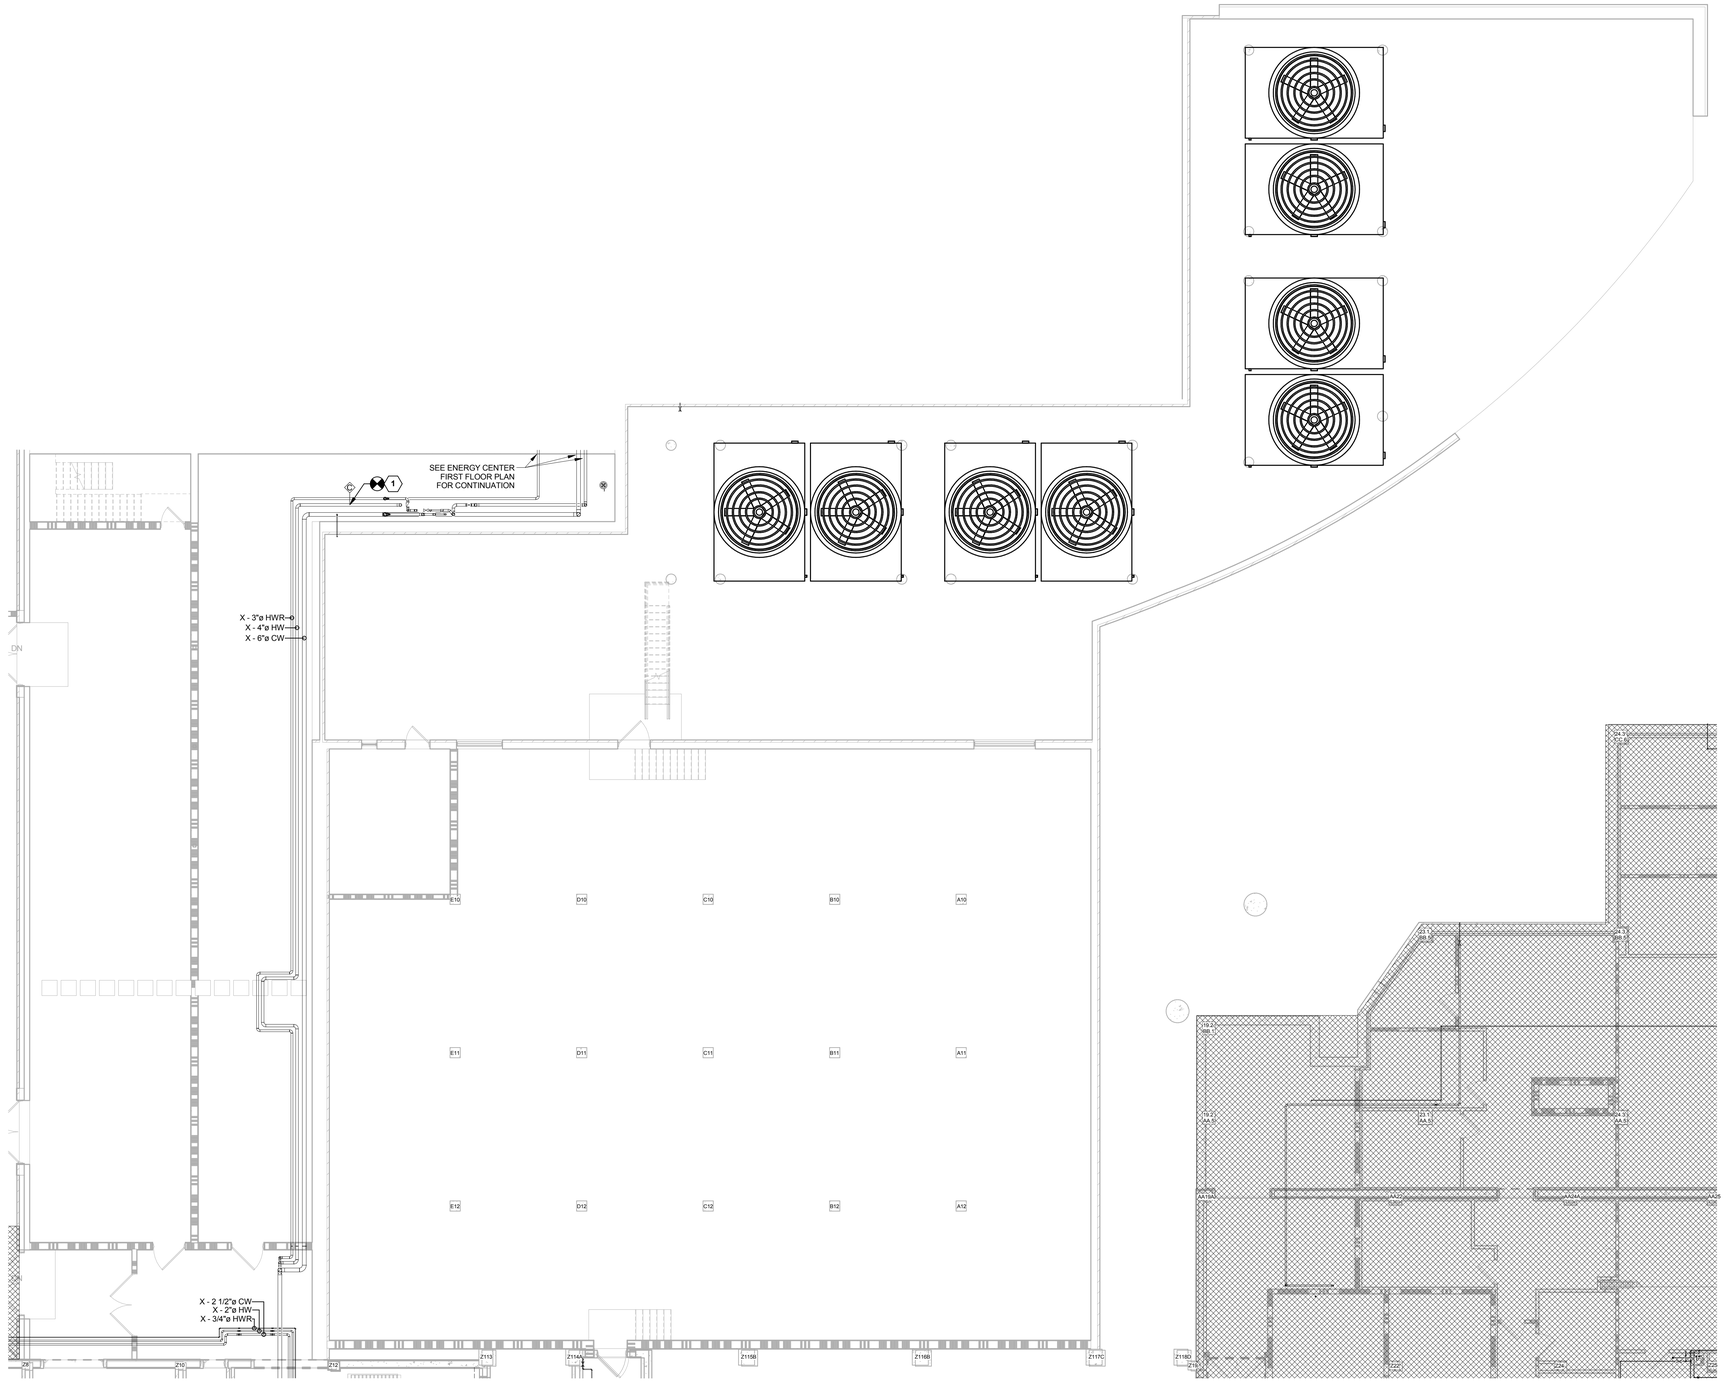

PARTIAL BASEMENT PLUMBING PLAN - ENERGY CENTER 1

1/8" = 1'-0"

0' 4' 8' 16' 32'

FLOAT WORK NOTE

CONTRACTOR MAY WORK IN FLOAT AREAS AFTER ALL FIRST AND SECOND SHIFT WORK HAS BEEN COMPLETED OR THERE IS A SCHEDULING CONFLICT DURING FIRST OR SECOND SHIFT WORK. IN THE CASE OF A SCHEDULING CONFLICT, THE CONTRACTOR SHALL NOTIFY THE COR OF THE AREA WHERE WORK IS BEING STOPPED AND IDENTIFY THE FLOAT AREA THEY PLAN TO WORK IN. CONTRACTOR MUST RECEIVE APPROVAL FROM COR PRIOR TO WORKING IN FLOAT AREAS.

CODED NOTES

1. INSTALL NEW CHLORINE/TEMPERATURE SENSOR ON HOSPITAL SIDE OF MIXING VALVES. SENSOR SHALL BE ON THE DOMESTIC HOT WATER PIPING.

FULLY SPRINKLERED

BID ISSUE	4/29/2016
Revisions:	Date

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
672 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL. (440) 546-9696
FAX: (440) 546-9699

ARCHITECT:

Drawing Title: **PARTIAL BASEMENT PLUMBING PLAN - ENERGY CENTER ADDITION**

Approved:

Project Title: **IMPROVE WATER SYSTEM TO PREVENT LEGIONELLA**

Location: **VAMC - WADE PARK**

Date: 4/29/2016 | Checked: DAD | Drawn: JMC

Project Number: 541-16-101

Building Number: MAIN CAMPUS

Drawing Number: **B-ECA**

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978

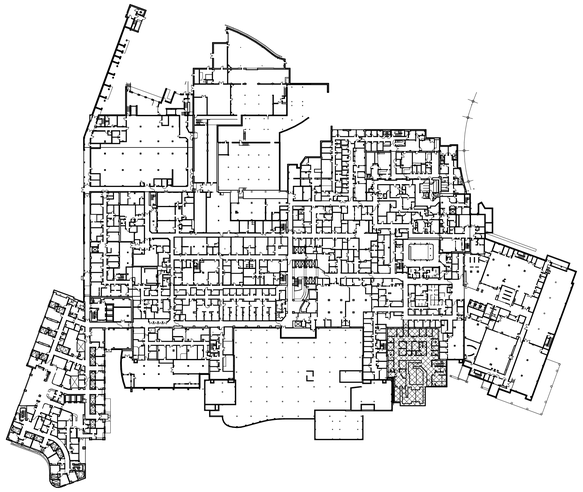

KEY PLAN - MENTAL HEALTH ADDITION B
1" = 100'-0"

SECOND SHIFT WORK NOTE

ALL WORK SHOWN ON THIS FLOOR PLAN SHALL BE COMPLETED AFTER THE DEPARTMENT HAS COMPLETED WORK FOR THE DAY. THE STARTING TIME WILL VARY BY DEPARTMENT AND MUST BE COORDINATED WITH THE COR. IN THE CASE OF A SCHEDULING CONFLICT, THE CONTRACTOR SHALL NOTIFY THE COR OF THE AREA WHERE WORK IS BEING STOPPED AND IDENTIFY THE FLOAT AREA THEY PLAN TO WORK IN FOR THE NIGHT.

DEDUCT ALTERNATE #1 NOTES

BASE BID: INSTALL ALL NEW SENSORS AS SHOWN ON THIS SHEET.

DEDUCT ALTERNATE #1: OMIT ALL (T) SENSORS DENOTED BY "DA1" ON THIS SHEET.

CODED NOTES

1. PROVIDE NEW 3/4" DOMESTIC HOT WATER RETURN LINE WITH HOT WATER RECIRCULATION VALVE ASSEMBLY.
2. EXTEND NEW 3/4" DOMESTIC HOT WATER RETURN PIPING TO LOCATION SHOWN AND CONNECT TO DOMESTIC HOT WATER PIPING.
3. REMOVE EXISTING AERATOR IF INSTALLED AND INSTALL LAMINAR FLOW CONTROL DEVICE ON EXISTING FAUCET.

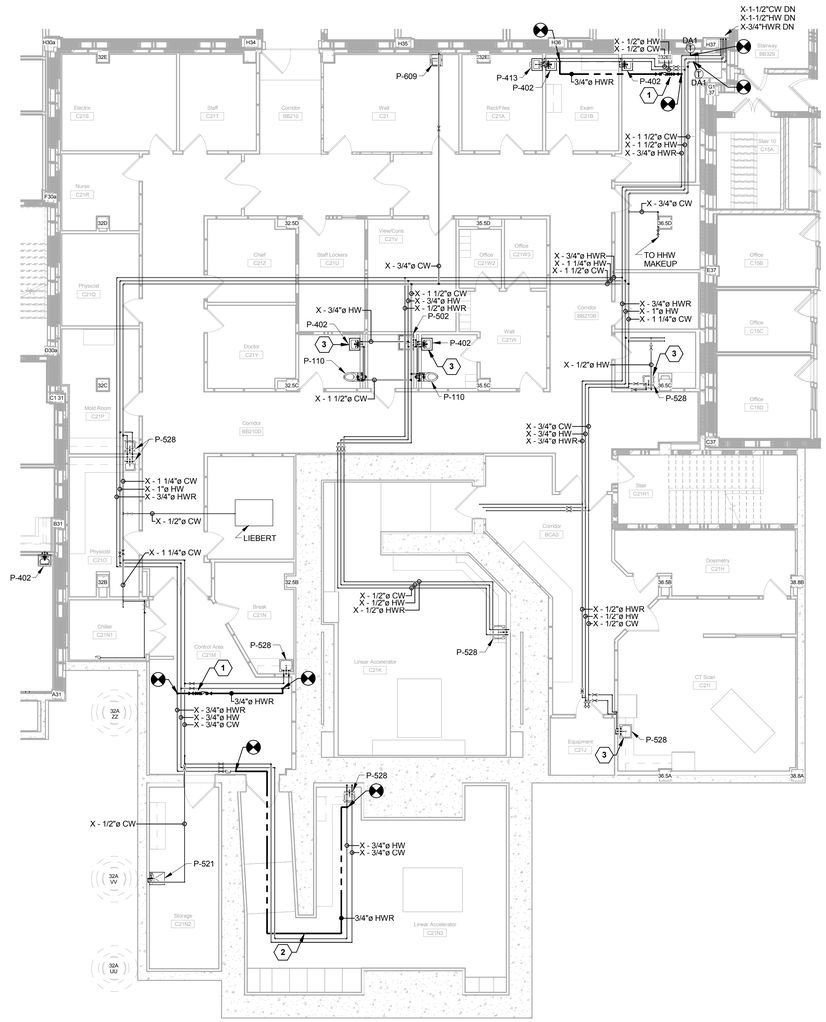

PARTIAL BASEMENT PLUMBING PLAN - LINEAR ACCELERATORS 1

1/8" = 1'-0"

0' 4' 8' 16' 32'

FULLY SPRINKLERED

BID ISSUE	4/29/2016
Revisions:	Date

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
671 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL: (440) 546-9696
FAX: (440) 546-9699

ARCHITECT:

Drawing Title: **PARTIAL BASEMENT PLUMBING PLAN - LINEAR ACCELERATORS**

Approved:

Project Title: **IMPROVE WATER SYSTEM TO PREVENT LEGIONELLA**

Location: **VAMC - WADE PARK**

Date: 4/29/2016 | Checked: DAD | Drawn: JMC

Project Number: 541-16-101

Building Number: MAIN CAMPUS

Drawing Number: **B-LINAC**

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978