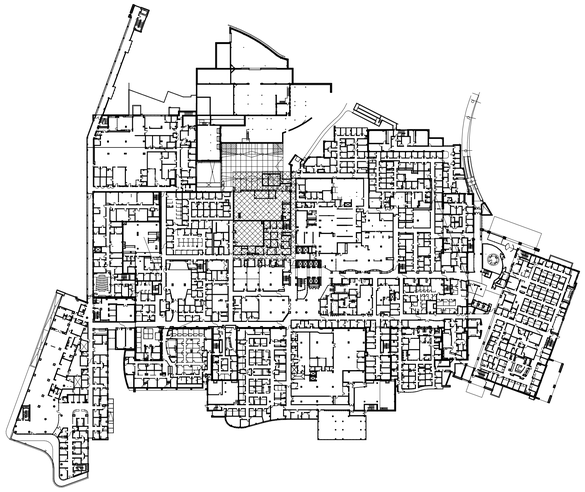

KEY PLAN - MAIN BUILDING 1 (2/9)
1" = 100'-0"

SECOND SHIFT WORK NOTE

ALL WORK SHOWN ON THIS FLOOR PLAN SHALL BE COMPLETED AFTER THE DEPARTMENT HAS COMPLETED WORK FOR THE DAY. THE STARTING TIME WILL VARY BY DEPARTMENT AND MUST BE COORDINATED WITH THE COR. IN THE CASE OF A SCHEDULING CONFLICT, THE CONTRACTOR SHALL NOTIFY THE COR OF THE AREA WHERE WORK IS BEING STOPPED AND IDENTIFY THE FLOAT AREA THEY PLAN TO WORK IN FOR THE NIGHT.

CODED NOTES

1. PROVIDE NEW 3/4" DOMESTIC HOT WATER RETURN LINE WITH HOT WATER RECIRCULATION VALVE ASSEMBLY.
2. EXTEND NEW 3/4" DOMESTIC HOT WATER RETURN PIPING TO LOCATION SHOWN AND CONNECT TO DOMESTIC HOT WATER PIPING.
3. REMOVE EXISTING AERATOR IF INSTALLED AND INSTALL LAMINAR FLOW CONTROL DEVICE ON EXISTING FAUCET.

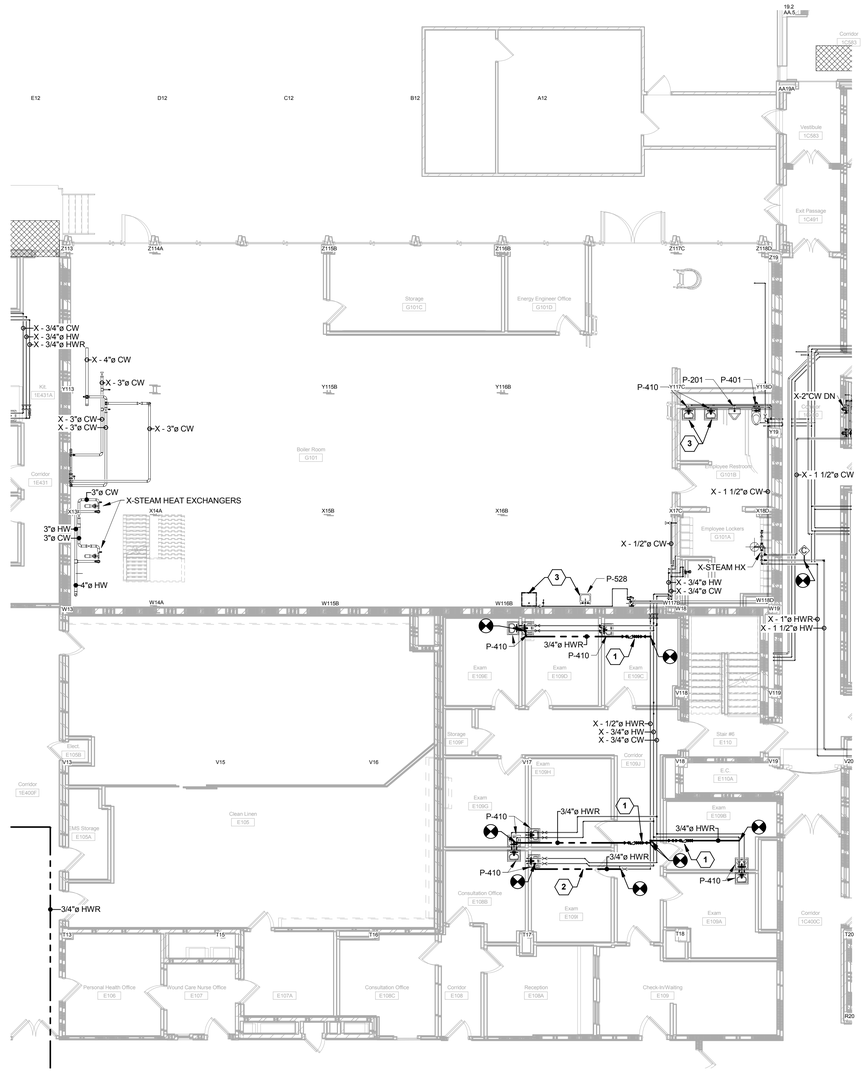

PARTIAL FIRST FLOOR PLUMBING PLAN - M.B.
BOILER PLANT 1

1/8" = 1'-0"
0' 4' 8' 16' 32'

FULLY SPRINKLERED

BID ISSUE	4/29/2016
Revisions:	Date

CONSULTANTS:

FREDERICK, FREDERICK & HELLER ENGINEERS, INC.
672 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL. (440) 546-9696
FAX (440) 546-9699

ARCHITECT:

Drawing Title: **PARTIAL FIRST FLOOR PLUMBING PLAN - M.B. BOILER PLANT**

Approved:

Project Title: **IMPROVE WATER SYSTEM TO PREVENT LEGIONELLA**

Location: **VAMC - WADE PARK**

Date: 4/29/2016 | Checked: DAD | Drawn: JMC

Project Number: 541-16-101

Building Number: MAIN CAMPUS

Drawing Number: **1-MB2/9**

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978

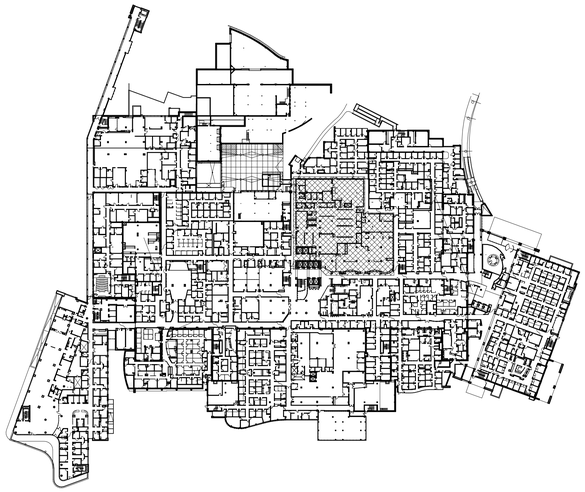

KEY PLAN - MAIN BUILDING 1 (3/9)
1" = 100'-0"

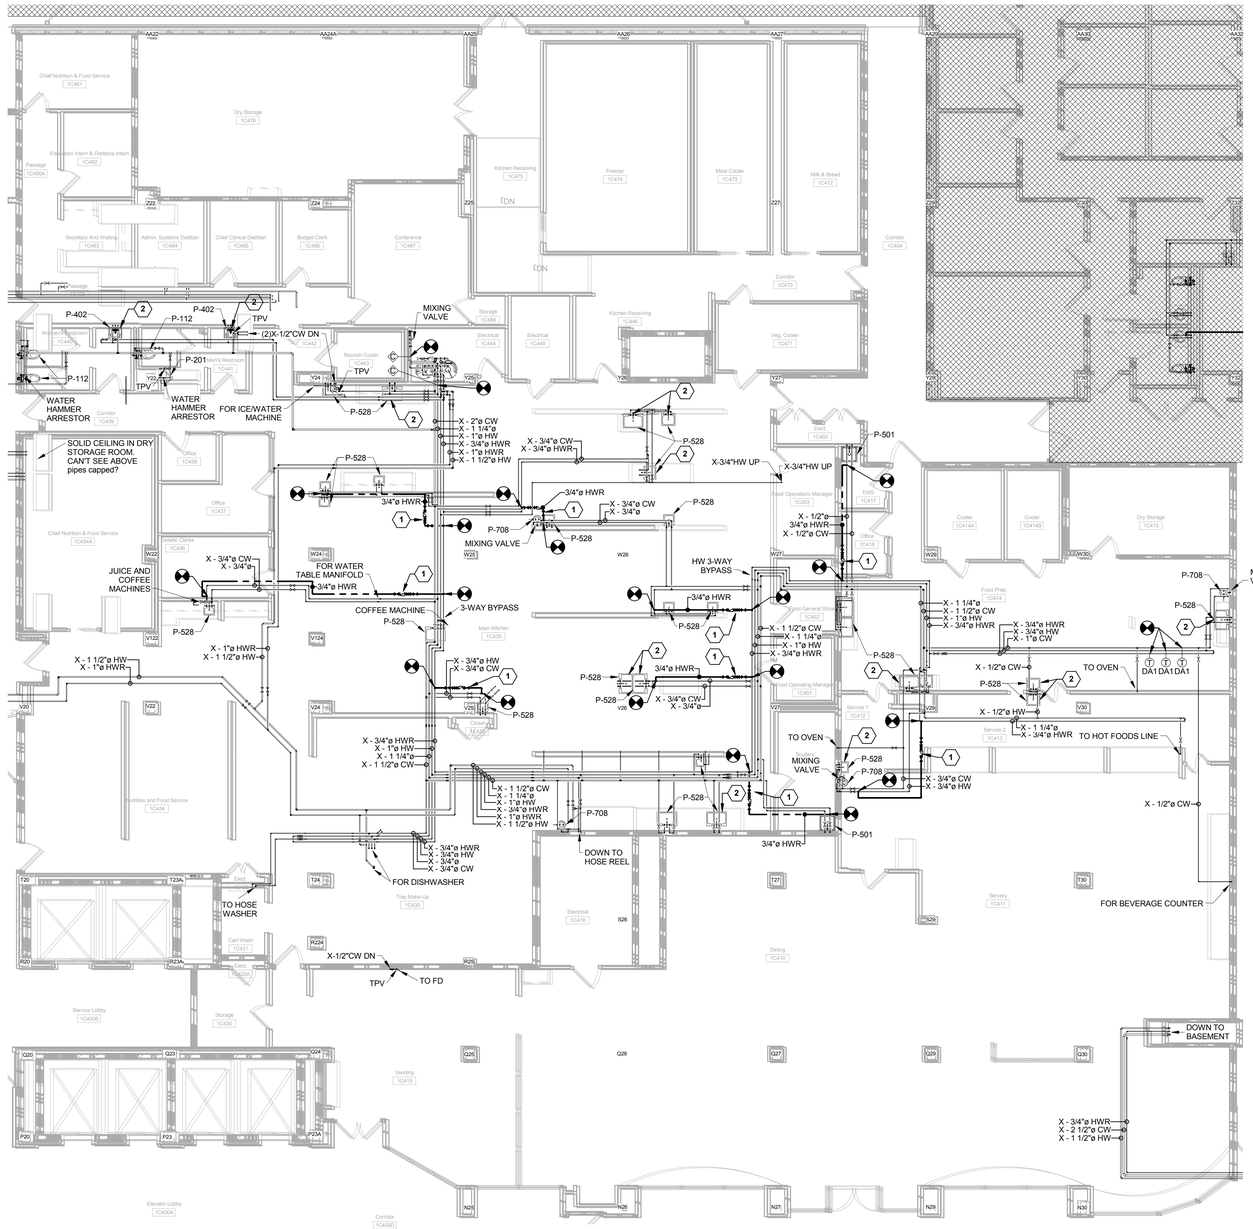

PARTIAL FIRST FLOOR PLUMBING PLAN - M.B. CANTEEN KITCHEN 1

1/8" = 1'-0"

0' 4' 8' 16' 32'

SECOND SHIFT WORK NOTE

ALL WORK SHOWN ON THIS FLOOR PLAN SHALL BE COMPLETED AFTER THE DEPARTMENT HAS COMPLETED WORK FOR THE DAY. THE STARTING TIME WILL VARY BY DEPARTMENT AND MUST BE COORDINATED WITH THE COR. IN THE CASE OF A SCHEDULING CONFLICT, THE CONTRACTOR SHALL NOTIFY THE COR OF THE AREA WHERE WORK IS BEING STOPPED AND IDENTIFY THE FLOAT AREA THEY PLAN TO WORK IN FOR THE NIGHT.

DEDUCT ALTERNATE #1 NOTES

BASE BID: INSTALL ALL NEW SENSORS AS SHOWN ON THIS SHEET.

DEDUCT ALTERNATE #1: OMIT ALL (T) SENSORS DENOTED BY "DA1" ON THIS SHEET.

CODED NOTES

1. PROVIDE NEW 3/4" DOMESTIC HOT WATER RETURN LINE WITH HOT WATER RECIRCULATION VALVE ASSEMBLY.
2. REMOVE EXISTING AERATOR IF INSTALLED AND INSTALL LAMINAR FLOW CONTROL DEVICE ON EXISTING FAUCET.

FULLY SPRINKLERED

BID ISSUE	4/29/2016
Revisions:	**Date**

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
671 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL: (440) 546-9696
FAX: (440) 546-9699

ARCHITECT:

Drawing Title: **PARTIAL FIRST FLOOR PLUMBING PLAN - M.B. CANTEEN KITCHEN**

Approved:

Project Title: **IMPROVE WATER SYSTEM TO PREVENT LEGIONELLA**

Location: **VAMC - WADE PARK**

Date	Checked	Drawn
4/29/2016	DAD	JMC

Project Number: 541-16-101

Building Number: MAIN CAMPUS

Drawing Number: **1-MB3/9**

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978

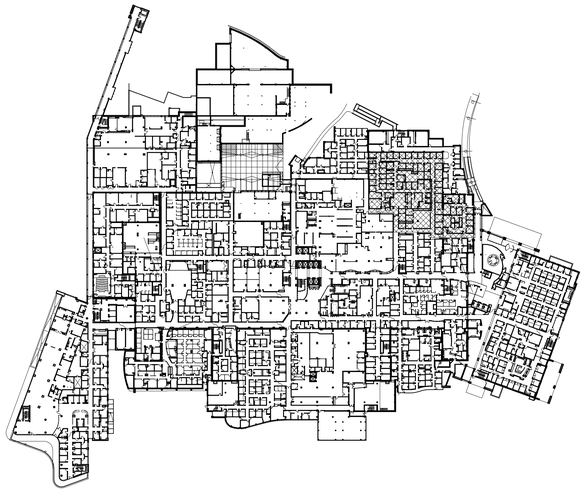

KEY PLAN - MAIN BUILDING 1 (4/9)
1" = 100'-0"

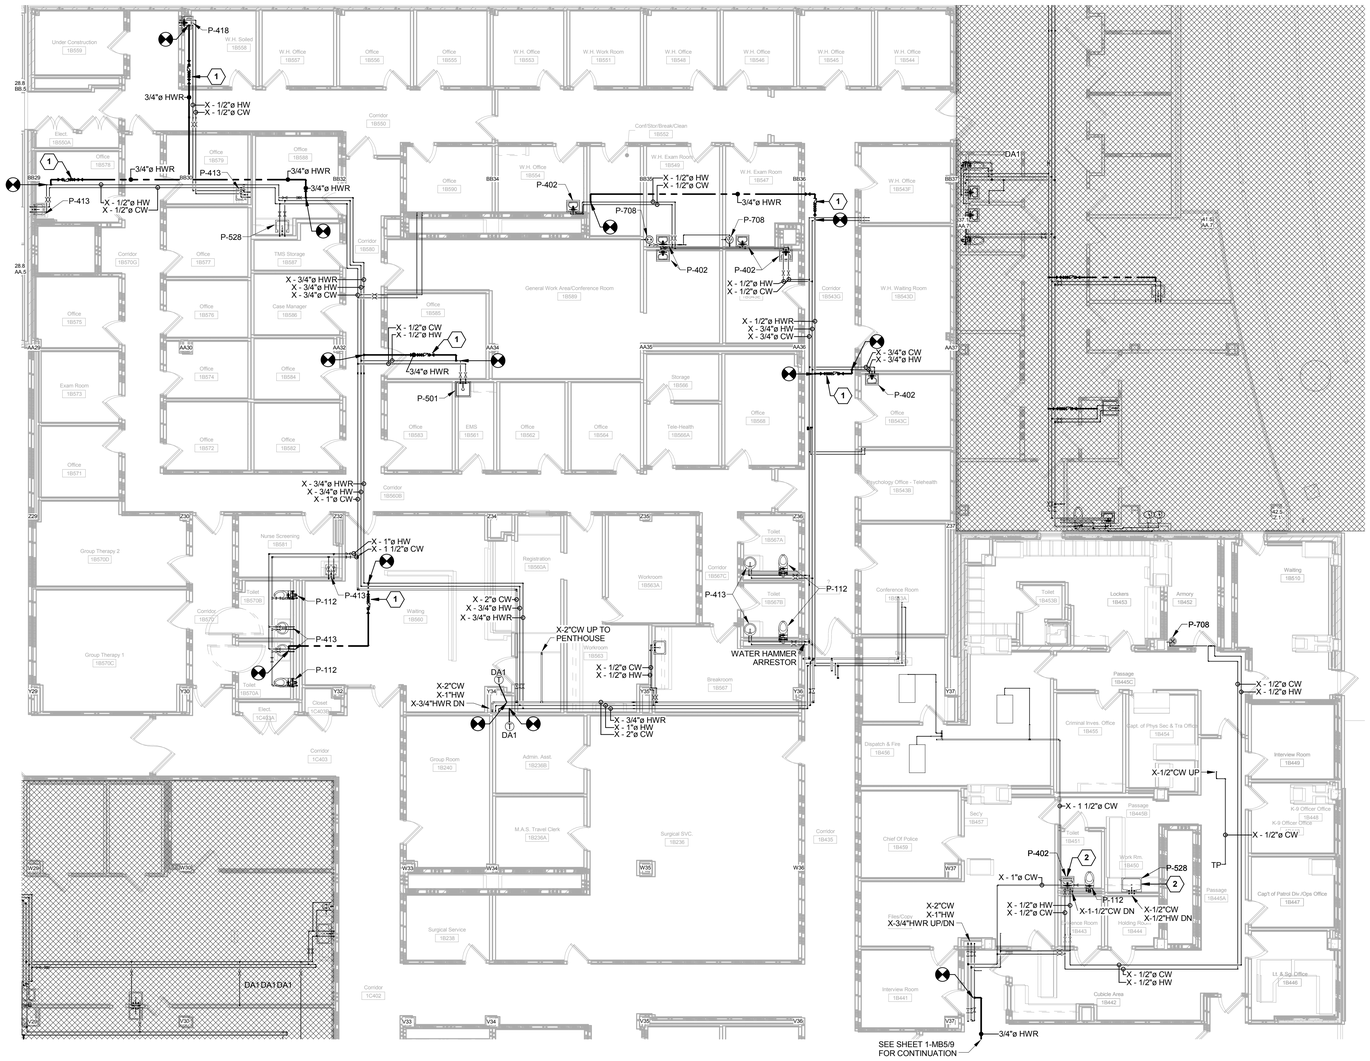

PARTIAL FIRST FLOOR PLUMBING PLAN - M.B. WOMEN'S HEALTH AND POLICE — 1

1/8" = 1'-0"

0' 4' 8' 16' 32'

SECOND SHIFT WORK NOTE

ALL WORK SHOWN ON THIS FLOOR PLAN SHALL BE COMPLETED AFTER THE DEPARTMENT HAS COMPLETED WORK FOR THE DAY. THE STARTING TIME WILL VARY BY DEPARTMENT AND MUST BE COORDINATED WITH THE COR. IN THE CASE OF A SCHEDULING CONFLICT, THE CONTRACTOR SHALL NOTIFY THE COR OF THE AREA WHERE WORK IS BEING STOPPED AND IDENTIFY THE FLOAT AREA THEY PLAN TO WORK IN FOR THE NIGHT.

DEDUCT ALTERNATE #1 NOTES

BASE BID: INSTALL ALL NEW SENSORS AS SHOWN ON THIS SHEET.

DEDUCT ALTERNATE #1: OMIT ALL (T) SENSORS DENOTED BY "DA1" ON THIS SHEET.

CODED NOTES

1. PROVIDE NEW 3/4" DOMESTIC HOT WATER RETURN LINE WITH HOT WATER RECIRCULATION VALVE ASSEMBLY.
2. REMOVE EXISTING AERATOR IF INSTALLED AND INSTALL LAMINAR FLOW CONTROL DEVICE ON EXISTING FAUCET.

FULLY SPRINKLERED

BID ISSUE	4/29/2016
Revisions:	**Date**

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
672 EAST ROYALTON ROAD
BROADVIEW HTS, OHIO 44147
TEL. (440) 546-9696
FAX: (440) 546-9699

STATE OF OHIO — DAVID A. DAGRAS — 19842 — REGISTERED PROFESSIONAL ENGINEER

ARCHITECT:

Drawing Title: **PARTIAL FIRST FLOOR PLUMBING PLAN - M.B. WOMEN'S HEALTH AND POLICE**	Project Title: **IMPROVE WATER SYSTEM TO PREVENT LEGIONELLA**	Project Number: 541-16-101	**Office of Facilities Management**
Approved:	Location: **VAMC - WADE PARK**	Building Number: MAIN CAMPUS	Department of Veterans Affairs
	Date: 4/29/2016 / Checked: DAD / Drawn: JMC	Drawing Number: **1-MB4/9**	

VA FORM 08-6231, OCT 1978

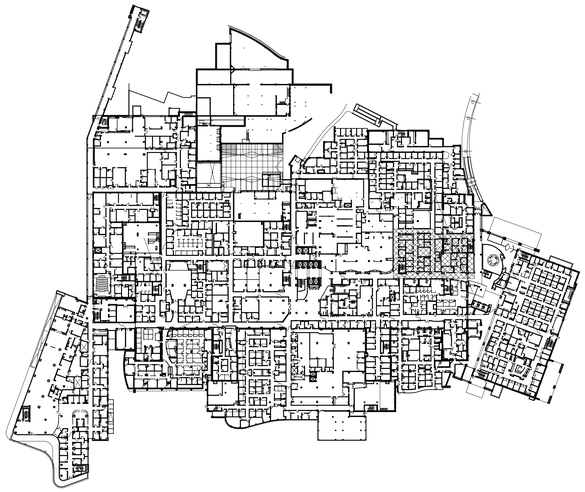

KEY PLAN - MAIN BUILDING 1 (5/9)
1" = 100'-0"

SECOND SHIFT WORK NOTE

ALL WORK SHOWN ON THIS FLOOR PLAN SHALL BE COMPLETED AFTER THE DEPARTMENT HAS COMPLETED WORK FOR THE DAY. THE STARTING TIME WILL VARY BY DEPARTMENT AND MUST BE COORDINATED WITH THE COR. IN THE CASE OF A SCHEDULING CONFLICT, THE CONTRACTOR SHALL NOTIFY THE COR OF THE AREA WHERE WORK IS BEING STOPPED AND IDENTIFY THE FLOAT AREA THEY PLAN TO WORK IN FOR THE NIGHT.

DEDUCT ALTERNATE #1 NOTES

BASE BID: INSTALL ALL NEW SENSORS AS SHOWN ON THIS SHEET.

DEDUCT ALTERNATE #1: OMIT ALL (T) SENSORS DENOTED BY "DA1" ON THIS SHEET.

CODED NOTES

(1) PROVIDE NEW 3/4" DOMESTIC HOT WATER RETURN LINE WITH HOT WATER RECIRCULATION VALVE ASSEMBLY.

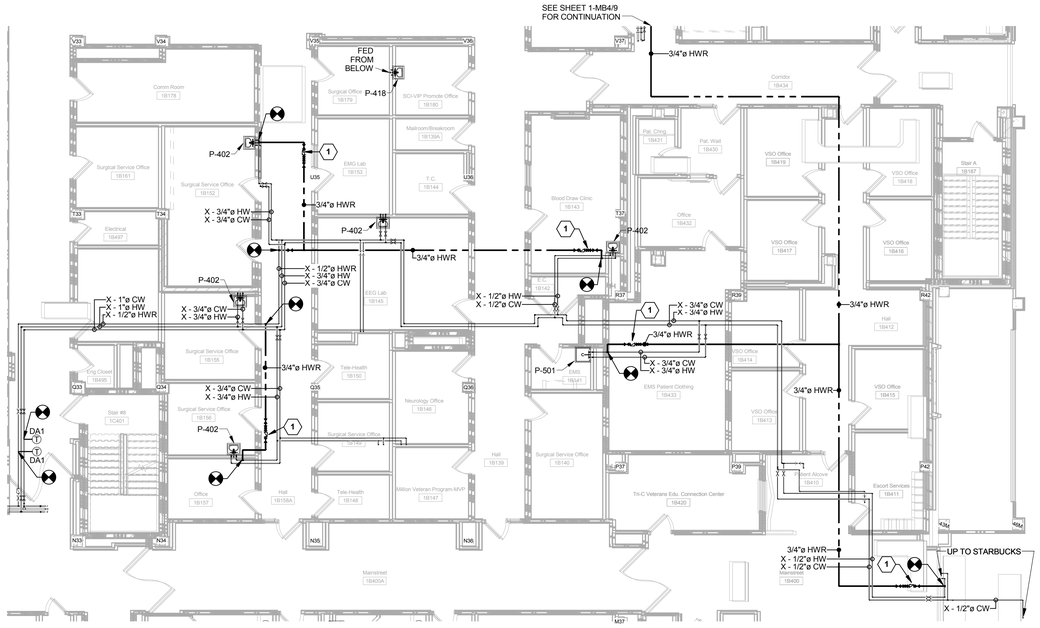

PARTIAL FIRST FLOOR PLUMBING PLAN - M.B. PCAS AND VET OFFICES (1)
1/8" = 1'-0"
0' 4' 8' 16' 32'

FULLY SPRINKLERED

BID ISSUE	4/29/2016
Revisions:	Date

CONSULTANTS:

FREDERICK, FREDERICK & HELLER ENGINEERS, INC.
672 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL. (440) 546-9696
FAX: (440) 546-9699

ARCHITECT:

Drawing Title: **PARTIAL FIRST FLOOR PLUMBING PLAN - M.B. PCAS AND VET OFFICES**

Approved:

Project Title: **IMPROVE WATER SYSTEM TO PREVENT LEGIONELLA**

Location: **VAMC - WADE PARK**

Date: 4/29/2016 | Checked: DAD | Drawn: JMC

Project Number: 541-16-101

Building Number: MAIN CAMPUS

Drawing Number: **1-MB5/9**

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978

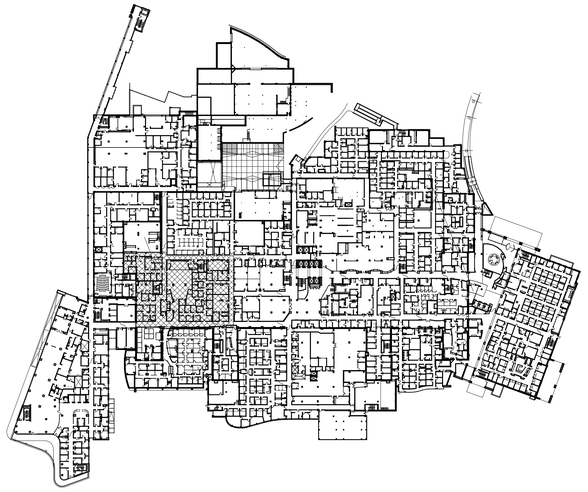

KEY PLAN - MAIN BUILDING 1 (6/9)
1" = 100'-0"

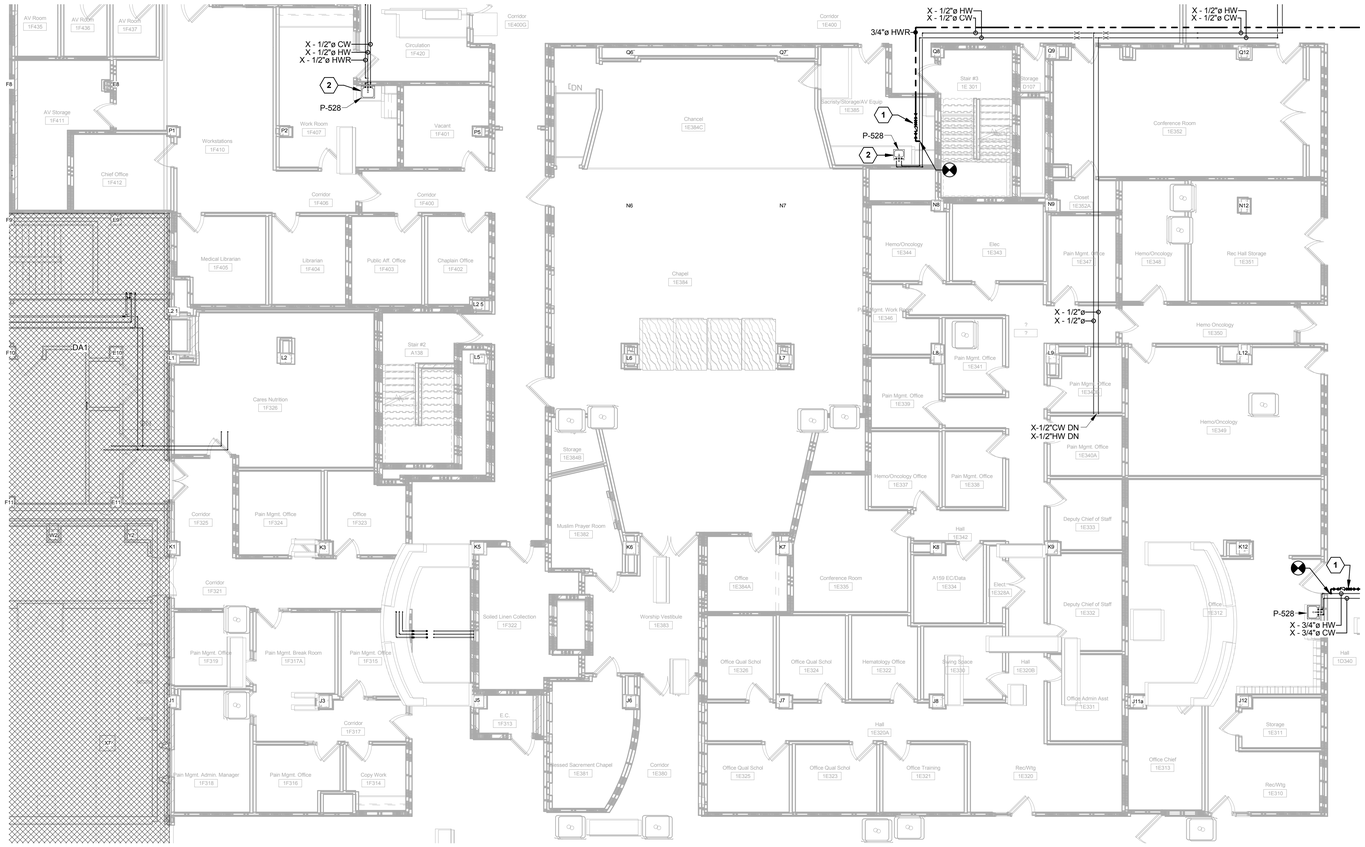

SECOND SHIFT WORK NOTE

ALL WORK SHOWN ON THIS FLOOR PLAN SHALL BE COMPLETED AFTER THE DEPARTMENT HAS COMPLETED WORK FOR THE DAY. THE STARTING TIME WILL VARY BY DEPARTMENT AND MUST BE COORDINATED WITH THE COR. IN THE CASE OF A SCHEDULING CONFLICT, THE CONTRACTOR SHALL NOTIFY THE COR OF THE AREA WHERE WORK IS BEING STOPPED AND IDENTIFY THE FLOAT AREA THEY PLAN TO WORK IN FOR THE NIGHT.

CODED NOTES

1. PROVIDE NEW 3/4" DOMESTIC HOT WATER RETURN LINE WITH HOT WATER RECIRCULATION VALVE ASSEMBLY.
2. REMOVE EXISTING AERATOR IF INSTALLED AND INSTALL LAMINAR FLOW CONTROL DEVICE ON EXISTING FAUCET.

PARTIAL FIRST FLOOR PLUMBING PLAN - M.B. CHAPEL AREA 1

1/8" = 1'-0"

0' 4' 8' 16' 32'

FULLY SPRINKLERED

BID ISSUE	4/29/2016
Revisions:	**Date**

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
672 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL. (440) 546-9696
FAX: (440) 546-9699

ARCHITECT:

Drawing Title: **PARTIAL FIRST FLOOR PLUMBING PLAN - M.B. CHAPEL AREA**

Approved:

Project Title: **IMPROVE WATER SYSTEM TO PREVENT LEGIONELLA**

Location: **VAMC - WADE PARK**

Date: 4/29/2016 | Checked: DAD | Drawn: JMC

Project Number: 541-16-101

Building Number: MAIN CAMPUS

Drawing Number: **1-MB6/9**

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978

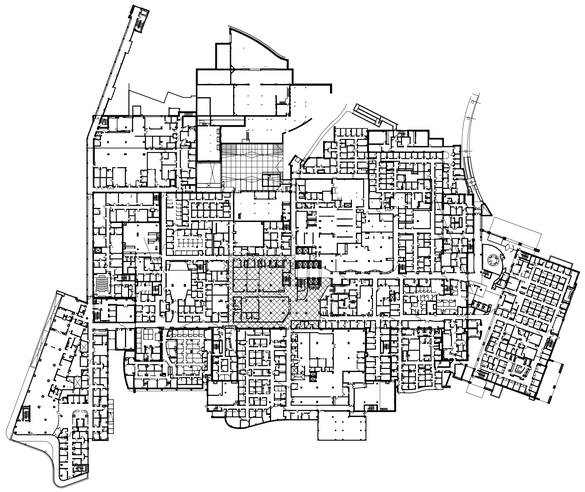

KEY PLAN - MAIN BUILDING 1 (7/9)
1" = 100'-0"

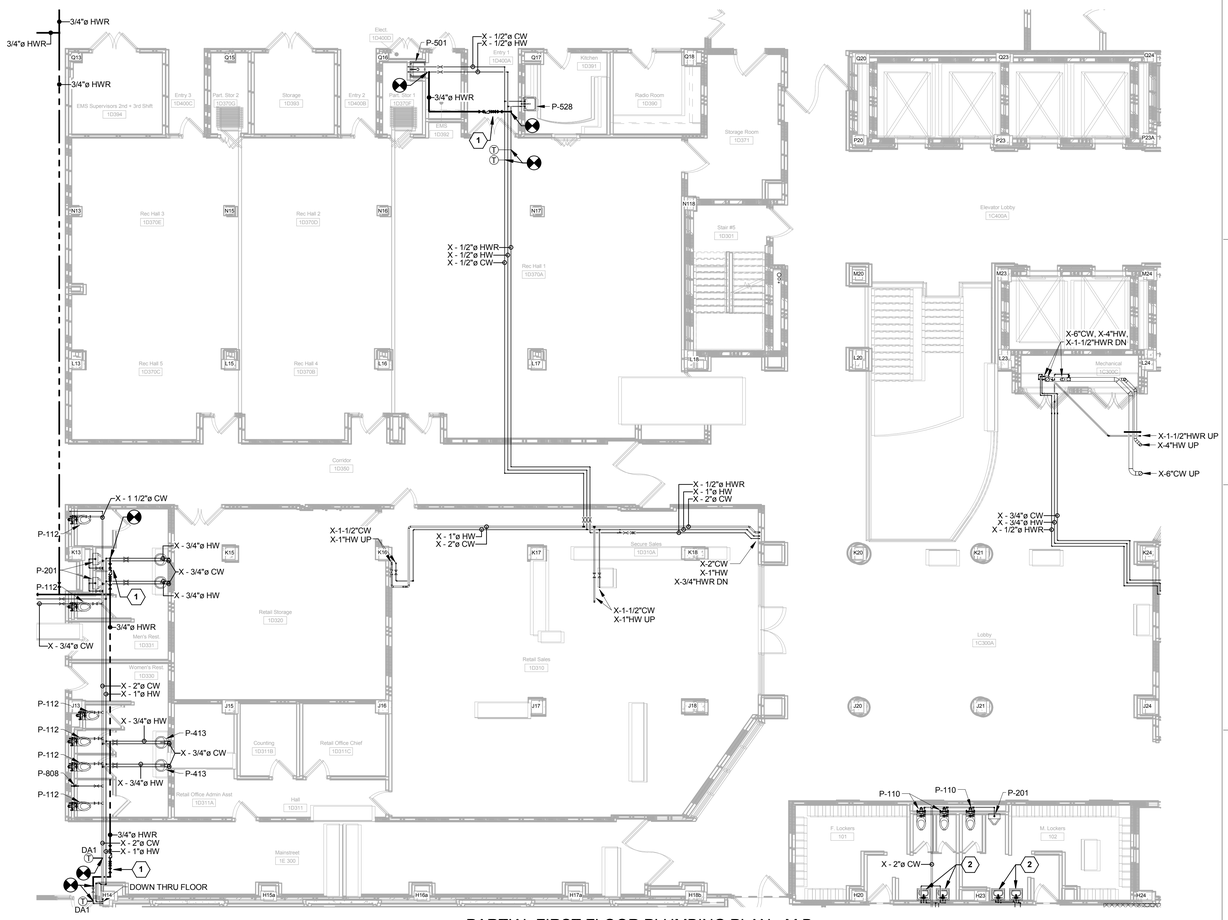

PARTIAL FIRST FLOOR PLUMBING PLAN - M.B.
RETAIL LOBBY
1/8" = 1'-0"
0' 4' 8' 16' 32'

SECOND SHIFT WORK NOTE

ALL WORK SHOWN ON THIS FLOOR PLAN SHALL BE COMPLETED AFTER THE DEPARTMENT HAS COMPLETED WORK FOR THE DAY. THE STARTING TIME WILL VARY BY DEPARTMENT AND MUST BE COORDINATED WITH THE COR. IN THE CASE OF A SCHEDULING CONFLICT, THE CONTRACTOR SHALL NOTIFY THE COR OF THE AREA WHERE WORK IS BEING STOPPED AND IDENTIFY THE FLOAT AREA THEY PLAN TO WORK IN FOR THE NIGHT.

DEDUCT ALTERNATE #1 NOTES

BASE BID: INSTALL ALL NEW SENSORS AS SHOWN ON THIS SHEET.

DEDUCT ALTERNATE #1: OMIT ALL (T) SENSORS DENOTED BY "DA1" ON THIS SHEET.

CODED NOTES

1. PROVIDE NEW 3/4" DOMESTIC HOT WATER RETURN LINE WITH HOT WATER RECIRCULATION VALVE ASSEMBLY.
2. REMOVE EXISTING AERATOR IF INSTALLED AND INSTALL LAMINAR FLOW CONTROL DEVICE ON EXISTING FAUCET.

FULLY SPRINKLERED

BID ISSUE	4/29/2016
Revisions:	Date

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
672 EAST ROYALTON ROAD
BROADVIEW HTS, OHIO 44147
TEL: (440) 546-9696
FAX: (440) 546-9699

ARCHITECT:

Drawing Title: **PARTIAL FIRST FLOOR PLUMBING PLAN - M.B. RETAIL LOBBY**

Approved:

Project Title: **IMPROVE WATER SYSTEM TO PREVENT LEGIONELLA**

Location: **VAMC - WADE PARK**

Date: 4/29/2016 | Checked: DAD | Drawn: JMC

Project Number: 541-16-101

Building Number: MAIN CAMPUS

Drawing Number: **1-MB7/9**

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978

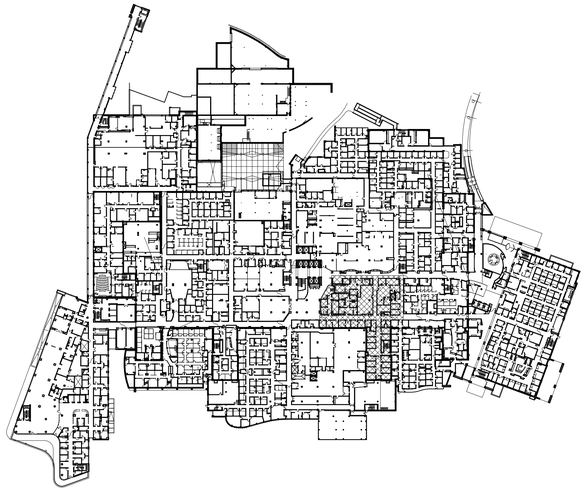

KEY PLAN - MAIN BUILDING 1 (8/9)
1" = 100'-0"

SECOND SHIFT WORK NOTE

ALL WORK SHOWN ON THIS FLOOR PLAN SHALL BE COMPLETED AFTER THE DEPARTMENT HAS COMPLETED WORK FOR THE DAY. THE STARTING TIME WILL VARY BY DEPARTMENT AND MUST BE COORDINATED WITH THE COR. IN THE CASE OF A SCHEDULING CONFLICT, THE CONTRACTOR SHALL NOTIFY THE COR OF THE AREA WHERE WORK IS BEING STOPPED AND IDENTIFY THE FLOAT AREA THEY PLAN TO WORK IN FOR THE NIGHT.

DEDUCT ALTERNATE #1 NOTES

BASE BID: INSTALL ALL NEW SENSORS AS SHOWN ON THIS SHEET.

DEDUCT ALTERNATE #1: OMIT ALL (T) SENSORS DENOTED BY "DA1" ON THIS SHEET.

SPECIAL CONDITION NOTES

A. THE AREAS ON THIS SHEET ARE CURRENTLY UNDER CONSTRUCTION. ANY NEW WORK SHOWN IN THIS AREA SHALL BE COORDINATED WITH THE COR PRIOR TO STARTING WORK.

PARTIAL FIRST FLOOR PLUMBING PLAN - M.B. ACS & PCAS
1
1/8" = 1'-0"
0' 4' 8' 16' 32'

FULLY SPRINKLERED

BID ISSUE	4/29/2016
Revisions:	**Date**

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
672 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL: (440) 546-9696
FAX: (440) 546-9699

ARCHITECT:

Drawing Title: **PARTIAL FIRST FLOOR PLUMBING PLAN - M.B. ACS AND PCAS**

Approved:

Project Title: **IMPROVE WATER SYSTEM TO PREVENT LEGIONELLA**

Location: **VAMC - WADE PARK**

Date: 4/29/2016 | Checked: DAD | Drawn: JMC

Project Number: 541-16-101

Building Number: MAIN CAMPUS

Drawing Number: **1-MB8/9**

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978

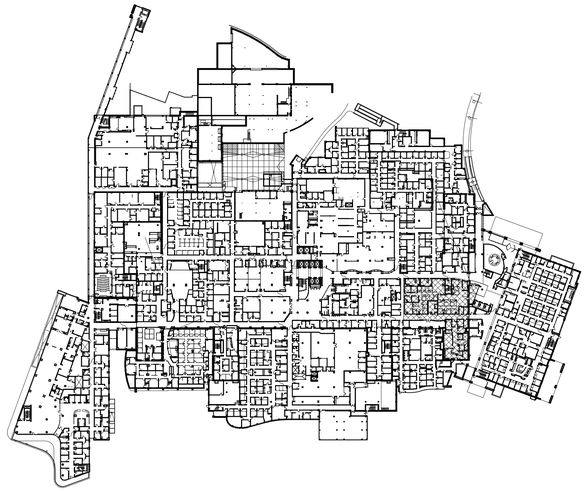

KEY PLAN - MAIN BUILDING 1 (9/9)
1" = 100'-0"

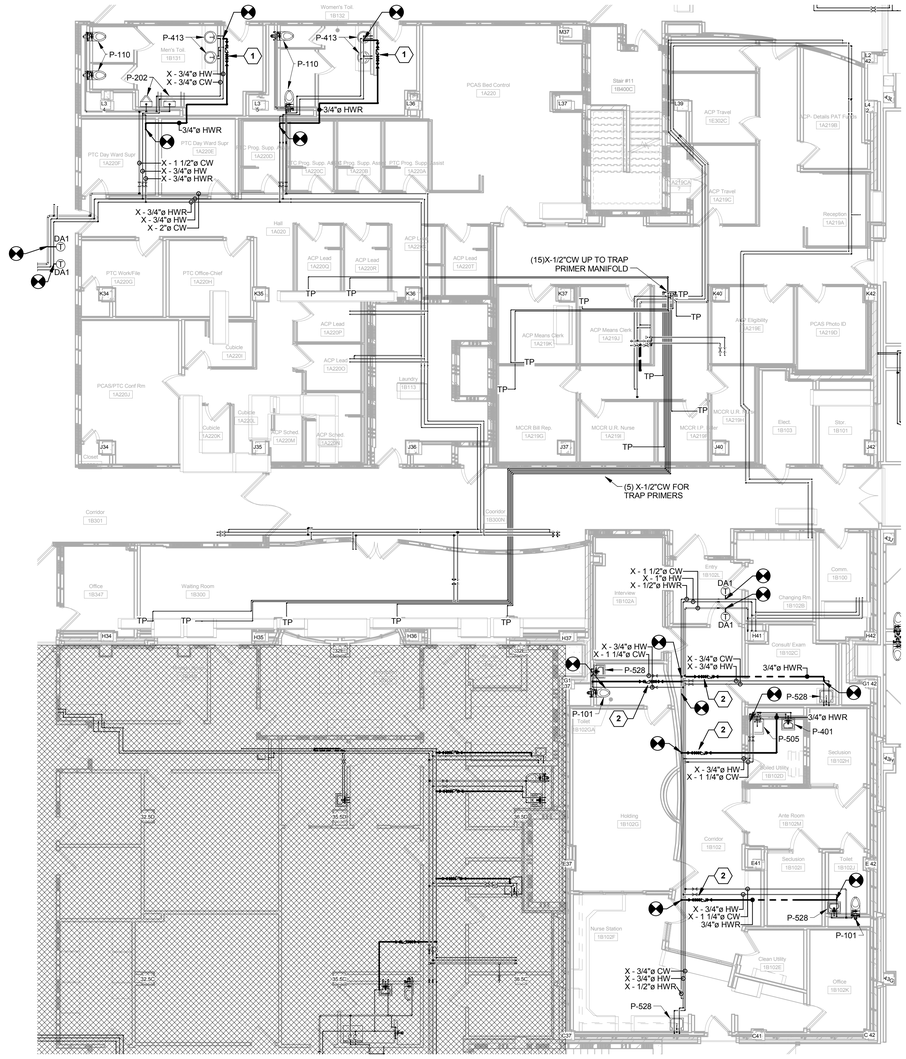

PARTIAL FIRST FLOOR PLUMBING PLAN - M.B. PCAS AND PSYCH
1/8" = 1'-0"
0' 4' 8' 16' 32'

SPECIAL OCCUPANCY FLOAT WORK AREA NOTE

ALL WORK SHOWN ON THIS SHEET SHALL BE CONSIDERED FLOAT WORK FOR SCHEDULING PURPOSES. HOWEVER THIS AREA WILL BE OCCUPIED THROUGHOUT CONSTRUCTION. THE AVAILABILITY OF WORK WILL BE ON A ROOM BY ROOM BASIS AND WILL BE AT THE DISCRETION OF THE DEPARTMENT HEAD AND COR. CONTRACTOR MUST COORDINATE WORK IN A ROOM BY ROOM BASIS.

DEDUCT ALTERNATE #1 NOTES

BASE BID: INSTALL ALL NEW SENSORS AS SHOWN ON THIS SHEET.

DEDUCT ALTERNATE #1: OMIT ALL (T) SENSORS DENOTED BY "DA1" ON THIS SHEET.

CODED NOTES

(1) PROVIDE NEW 3/4" DOMESTIC HOT WATER RETURN LINE WITH HOT WATER RECIRCULATION VALVE ASSEMBLY.

FULLY SPRINKLERED

BID ISSUE	4/29/2016
Revisions:	Date

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
4721 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL. (440) 546-9696
FAX: (440) 546-9699

ARCHITECT:

Drawing Title: **PARTIAL FIRST FLOOR PLUMBING PLAN - M.B. PCAS AND PSYCH**

Approved:

Project Title: **IMPROVE WATER SYSTEM TO PREVENT LEGIONELLA**

Location: **VAMC - WADE PARK**

Date: 4/29/2016 | Checked: DAD | Drawn: JMC

Project Number: 541-16-101

Building Number: MAIN CAMPUS

Drawing Number: **1-MB9/9**

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978

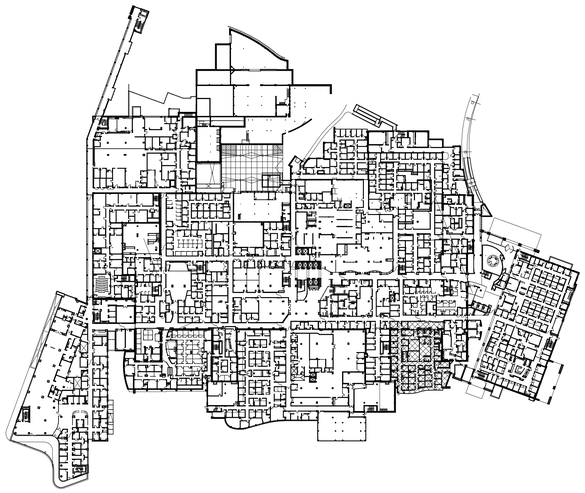

KEY PLAN - MENTAL HEALTH ADDITION 1
1" = 100'-0"

SECOND SHIFT WORK NOTE

ALL WORK SHOWN ON THIS FLOOR PLAN SHALL BE COMPLETED AFTER THE DEPARTMENT HAS COMPLETED WORK FOR THE DAY. THE STARTING TIME WILL VARY BY DEPARTMENT AND MUST BE COORDINATED WITH THE COR. IN THE CASE OF A SCHEDULING CONFLICT, THE CONTRACTOR SHALL NOTIFY THE COR OF THE AREA WHERE WORK IS BEING STOPPED AND IDENTIFY THE FLOAT AREA THEY PLAN TO WORK IN FOR THE NIGHT.

DEDUCT ALTERNATE #1 NOTES

BASE BID: INSTALL ALL NEW SENSORS AS SHOWN ON THIS SHEET.

DEDUCT ALTERNATE #1: OMIT ALL (T) SENSORS DENOTED BY "DA1" ON THIS SHEET.

CODED NOTES

1. PROVIDE NEW 3/4" DOMESTIC HOT WATER RETURN LINE WITH HOT WATER RECIRCULATION VALVE ASSEMBLY.
2. REMOVE EXISTING AERATOR IF INSTALLED AND INSTALL LAMINAR FLOW CONTROL DEVICE ON EXISTING FAUCET.

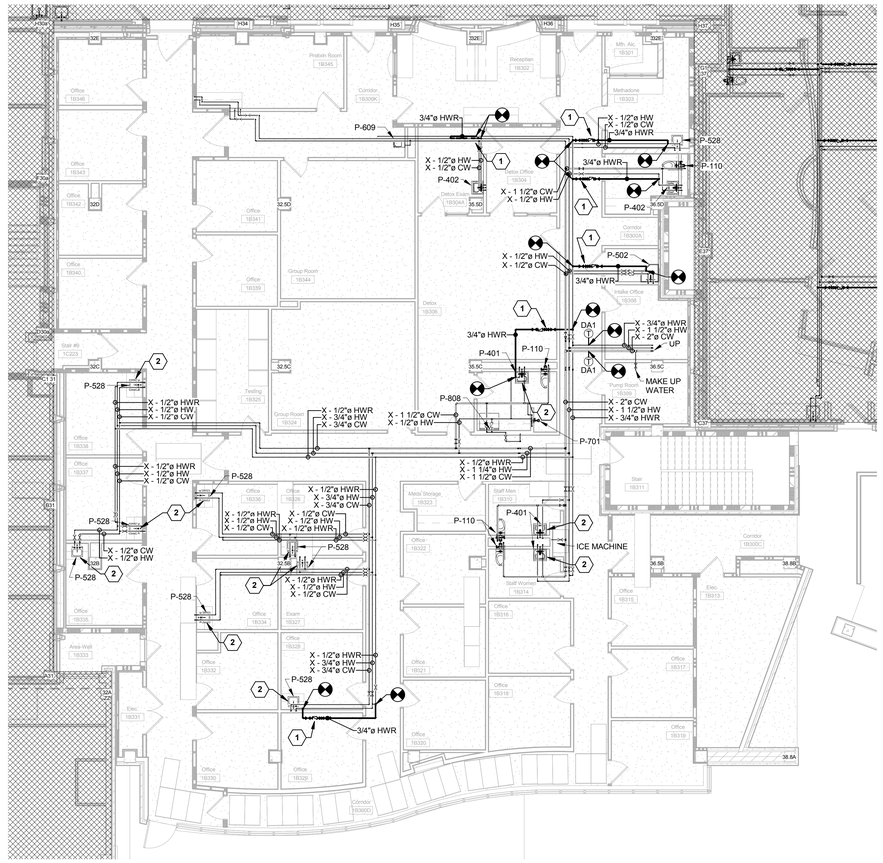

PARTIAL FIRST FLOOR PLUMBING PLAN - MENTAL HEALTH ADDITION 1
1/8" = 1'-0"

0' 4' 8' 16' 32'

FULLY SPRINKLERED

BID ISSUE	4/29/2016
Revisions:	**Date**

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
672 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL: (440) 546-9690
FAX: (440) 546-9699

ARCHITECT:

Drawing Title: **PARTIAL FIRST FLOOR PLUMBING PLAN - MENTAL HEALTH ADDITION**

Approved:

Project Title: **IMPROVE WATER SYSTEM TO PREVENT LEGIONELLA**

Location: **VAMC - WADE PARK**

Date	Checked	Drawn
4/29/2016	DAD	JMC

Project Number: 541-16-101

Building Number: MAIN CAMPUS

Drawing Number: **1-MH**

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978

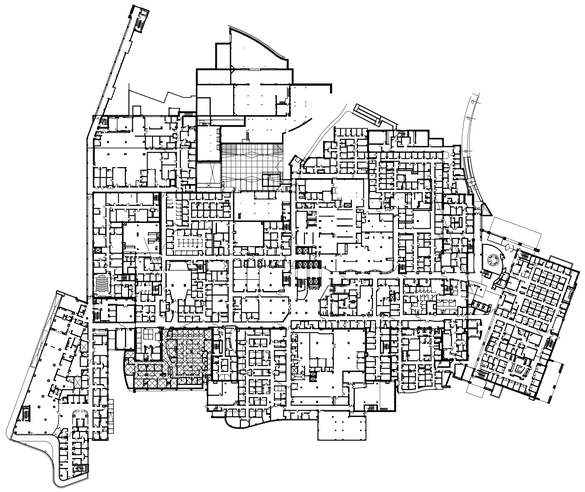

KEY PLAN - MICU 1
1" = 100'-0"

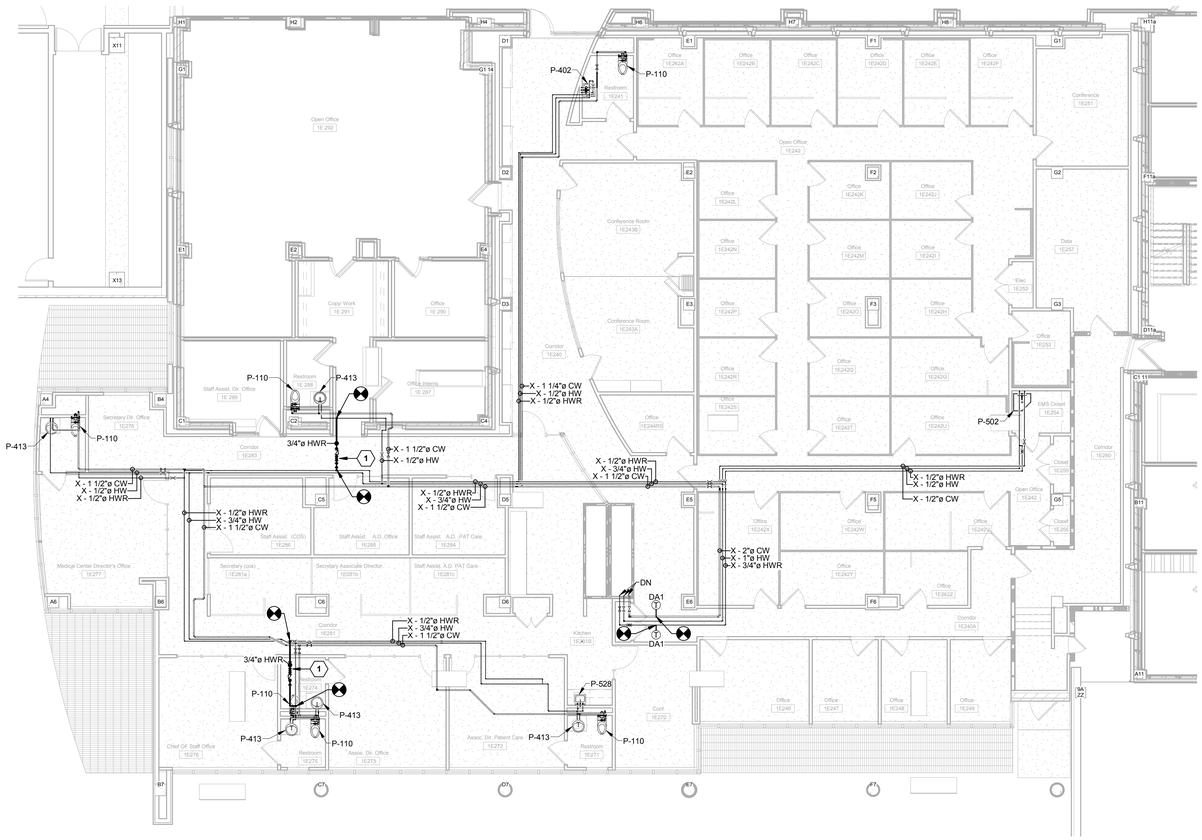

PARTIAL FIRST FLOOR PLUMBING PLAN - MICU ADDITION
1/8" = 1'-0"
1

SECOND SHIFT WORK NOTE

ALL WORK SHOWN ON THIS FLOOR PLAN SHALL BE COMPLETED AFTER THE DEPARTMENT HAS COMPLETED WORK FOR THE DAY. THE STARTING TIME WILL VARY BY DEPARTMENT AND MUST BE COORDINATED WITH THE COR. IN THE CASE OF A SCHEDULING CONFLICT, THE CONTRACTOR SHALL NOTIFY THE COR OF THE AREA WHERE WORK IS BEING STOPPED AND IDENTIFY THE FLOAT AREA THEY PLAN TO WORK IN FOR THE NIGHT.

DEDUCT ALTERNATE #1 NOTES

BASE BID: INSTALL ALL NEW SENSORS AS SHOWN ON THIS SHEET.

DEDUCT ALTERNATE #1: OMIT ALL (T) SENSORS DENOTED BY "DA1" ON THIS SHEET.

CODED NOTES

(1) PROVIDE NEW 3/4" DOMESTIC HOT WATER RETURN LINE WITH HOT WATER RECIRCULATION VALVE ASSEMBLY.

FULLY SPRINKLERED

BID ISSUE	4/29/2016
Revisions:	**Date**

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
672 EAST ROYALTON ROAD
BROADVIEW HTS, OHIO 44147
TEL: (440) 546-9696
FAX: (440) 546-9699

ARCHITECT:

Drawing Title: **PARTIAL FIRST FLOOR PLUMBING PLAN - MICU ADDITION**

Approved:

Project Title: **IMPROVE WATER SYSTEM TO PREVENT LEGIONELLA**

Location: **VAMC - WADE PARK**

Date: 4/29/2016 | Checked: DAD | Drawn: JMC

Project Number: 541-16-101

Building Number: MAIN CAMPUS

Drawing Number: **1-MICU**

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978

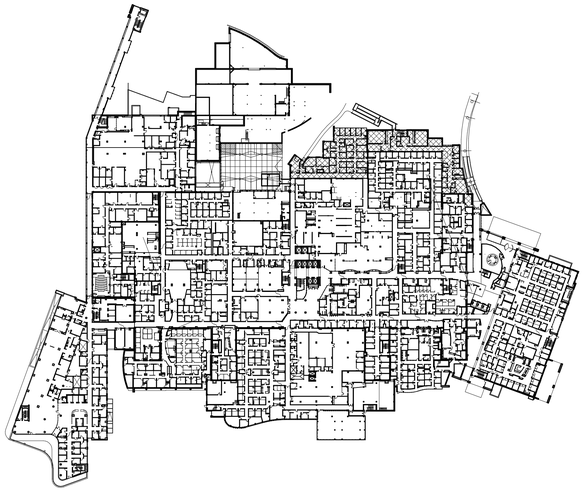

KEY PLAN - RADIOLOGY 1
1" = 100'-0"

SECOND SHIFT WORK NOTE

ALL WORK SHOWN ON THIS FLOOR PLAN SHALL BE COMPLETED AFTER THE DEPARTMENT HAS COMPLETED WORK FOR THE DAY. THE STARTING TIME WILL VARY BY DEPARTMENT AND MUST BE COORDINATED WITH THE COR. IN THE CASE OF A SCHEDULING CONFLICT, THE CONTRACTOR SHALL NOTIFY THE COR OF THE AREA WHERE WORK IS BEING STOPPED AND IDENTIFY THE FLOAT AREA THEY PLAN TO WORK IN FOR THE NIGHT.

DEDUCT ALTERNATE #1 NOTES

BASE BID: INSTALL ALL NEW SENSORS AS SHOWN ON THIS SHEET.

DEDUCT ALTERNATE #1: OMIT ALL (T) SENSORS DENOTED BY "DA1" ON THIS SHEET.

CODED NOTES

1. PROVIDE NEW 3/4" DOMESTIC HOT WATER RETURN LINE WITH HOT WATER RECIRCULATION VALVE ASSEMBLY.
2. EXTEND NEW 3/4" DOMESTIC HOT WATER RETURN PIPING TO LOCATION SHOWN AND CONNECT TO DOMESTIC HOT WATER PIPING.
3. REMOVE EXISTING AERATOR IF INSTALLED AND INSTALL LAMINAR FLOW CONTROL DEVICE ON EXISTING FAUCET.

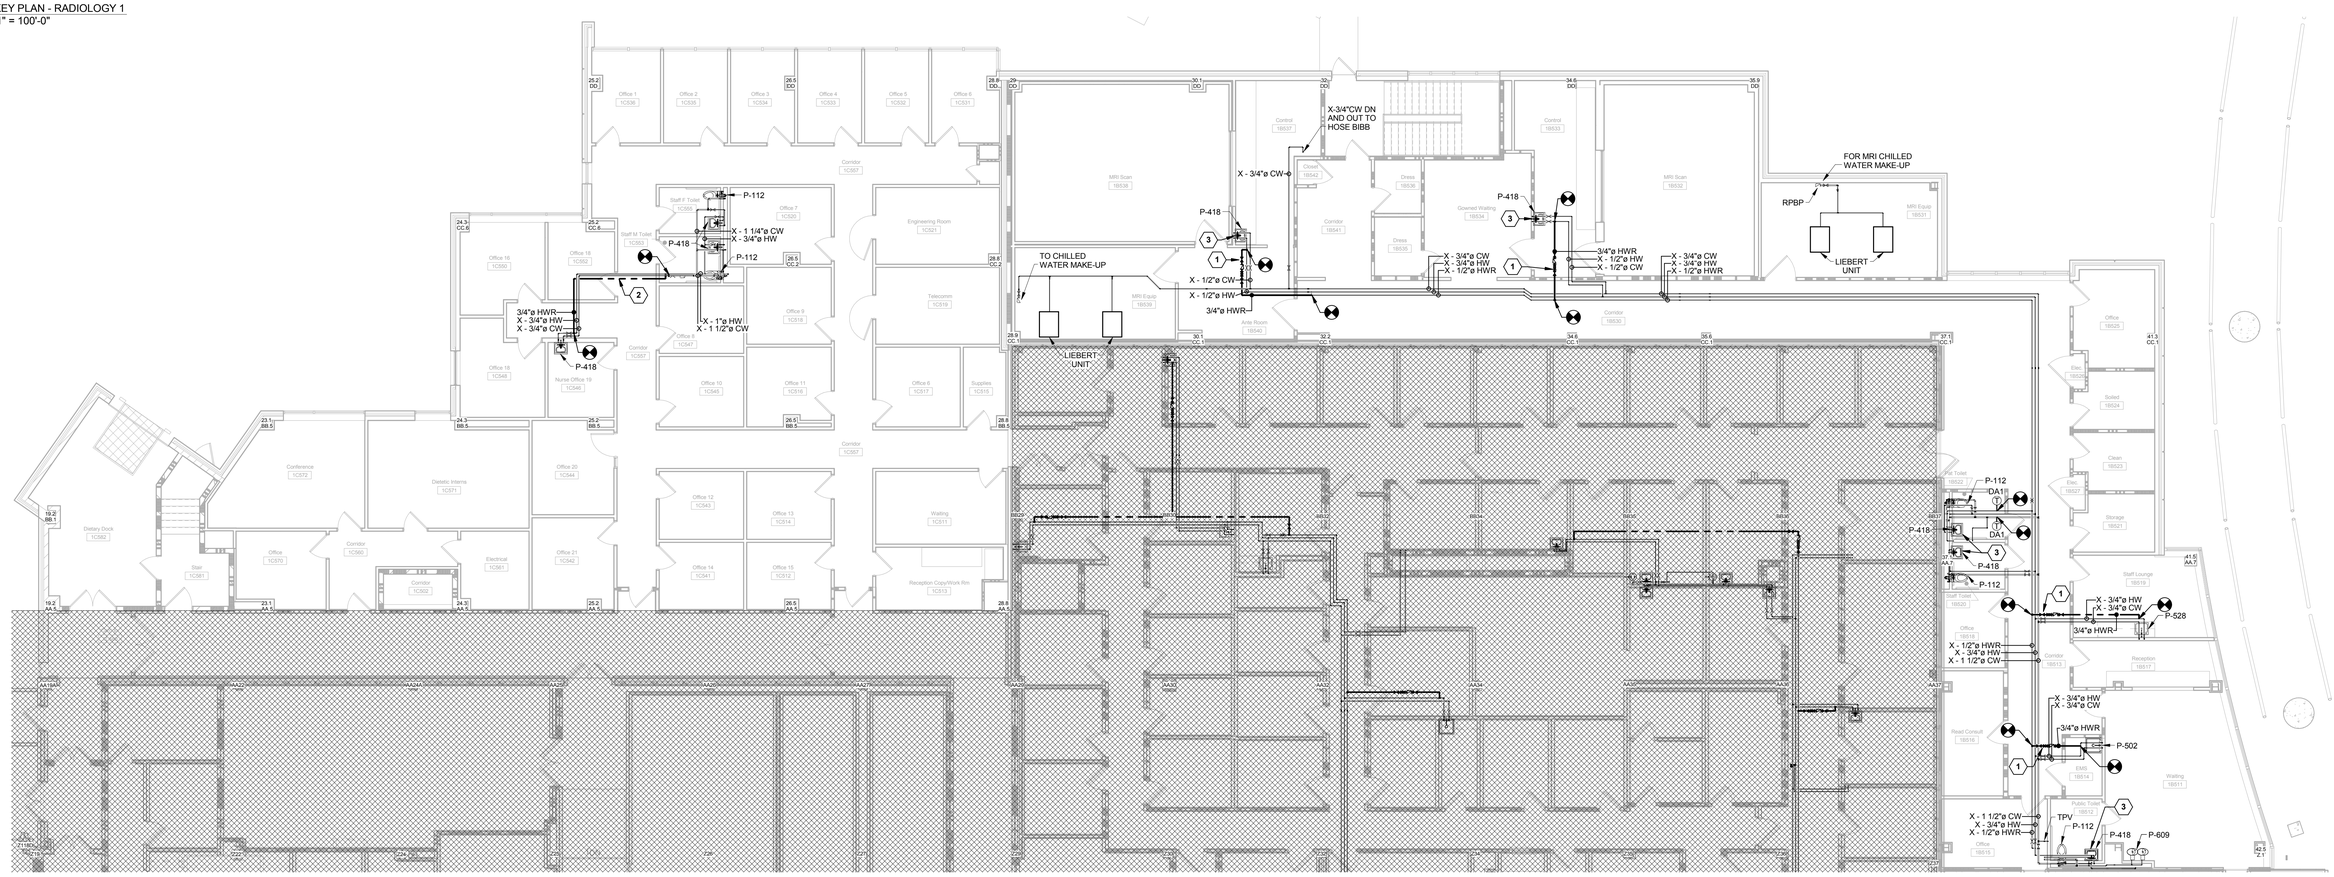

PARTIAL FIRST FLOOR PLUMBING PLAN - RADIOLOGY EAST (1)
1/8" = 1'-0"
0' 4' 8' 16' 32'

FULLY SPRINKLERED

BID ISSUE	4/29/2016
Revisions:	**Date**

CONSULTANTS:

FREDRICK, FREDRICK & HELLER ENGINEERS, INC.
672 EAST ROYALTON ROAD
BROADVIEW HTS., OHIO 44147
TEL. (440) 546-9696
FAX: (440) 546-9699

ARCHITECT:

Drawing Title: **PARTIAL FIRST FLOOR PLUMBING PLAN - RADIOLOGY ADDITION**

Approved:

Project Title: **IMPROVE WATER SYSTEM TO PREVENT LEGIONELLA**

Location: **VAMC - WADE PARK**

Date: 4/29/2016 | Checked: DAD | Drawn: JMC

Project Number: 541-16-101

Building Number: MAIN CAMPUS

Drawing Number: **1-RAD**

Office of Facilities Management

Department of Veterans Affairs

VA FORM 08-6231, OCT 1978