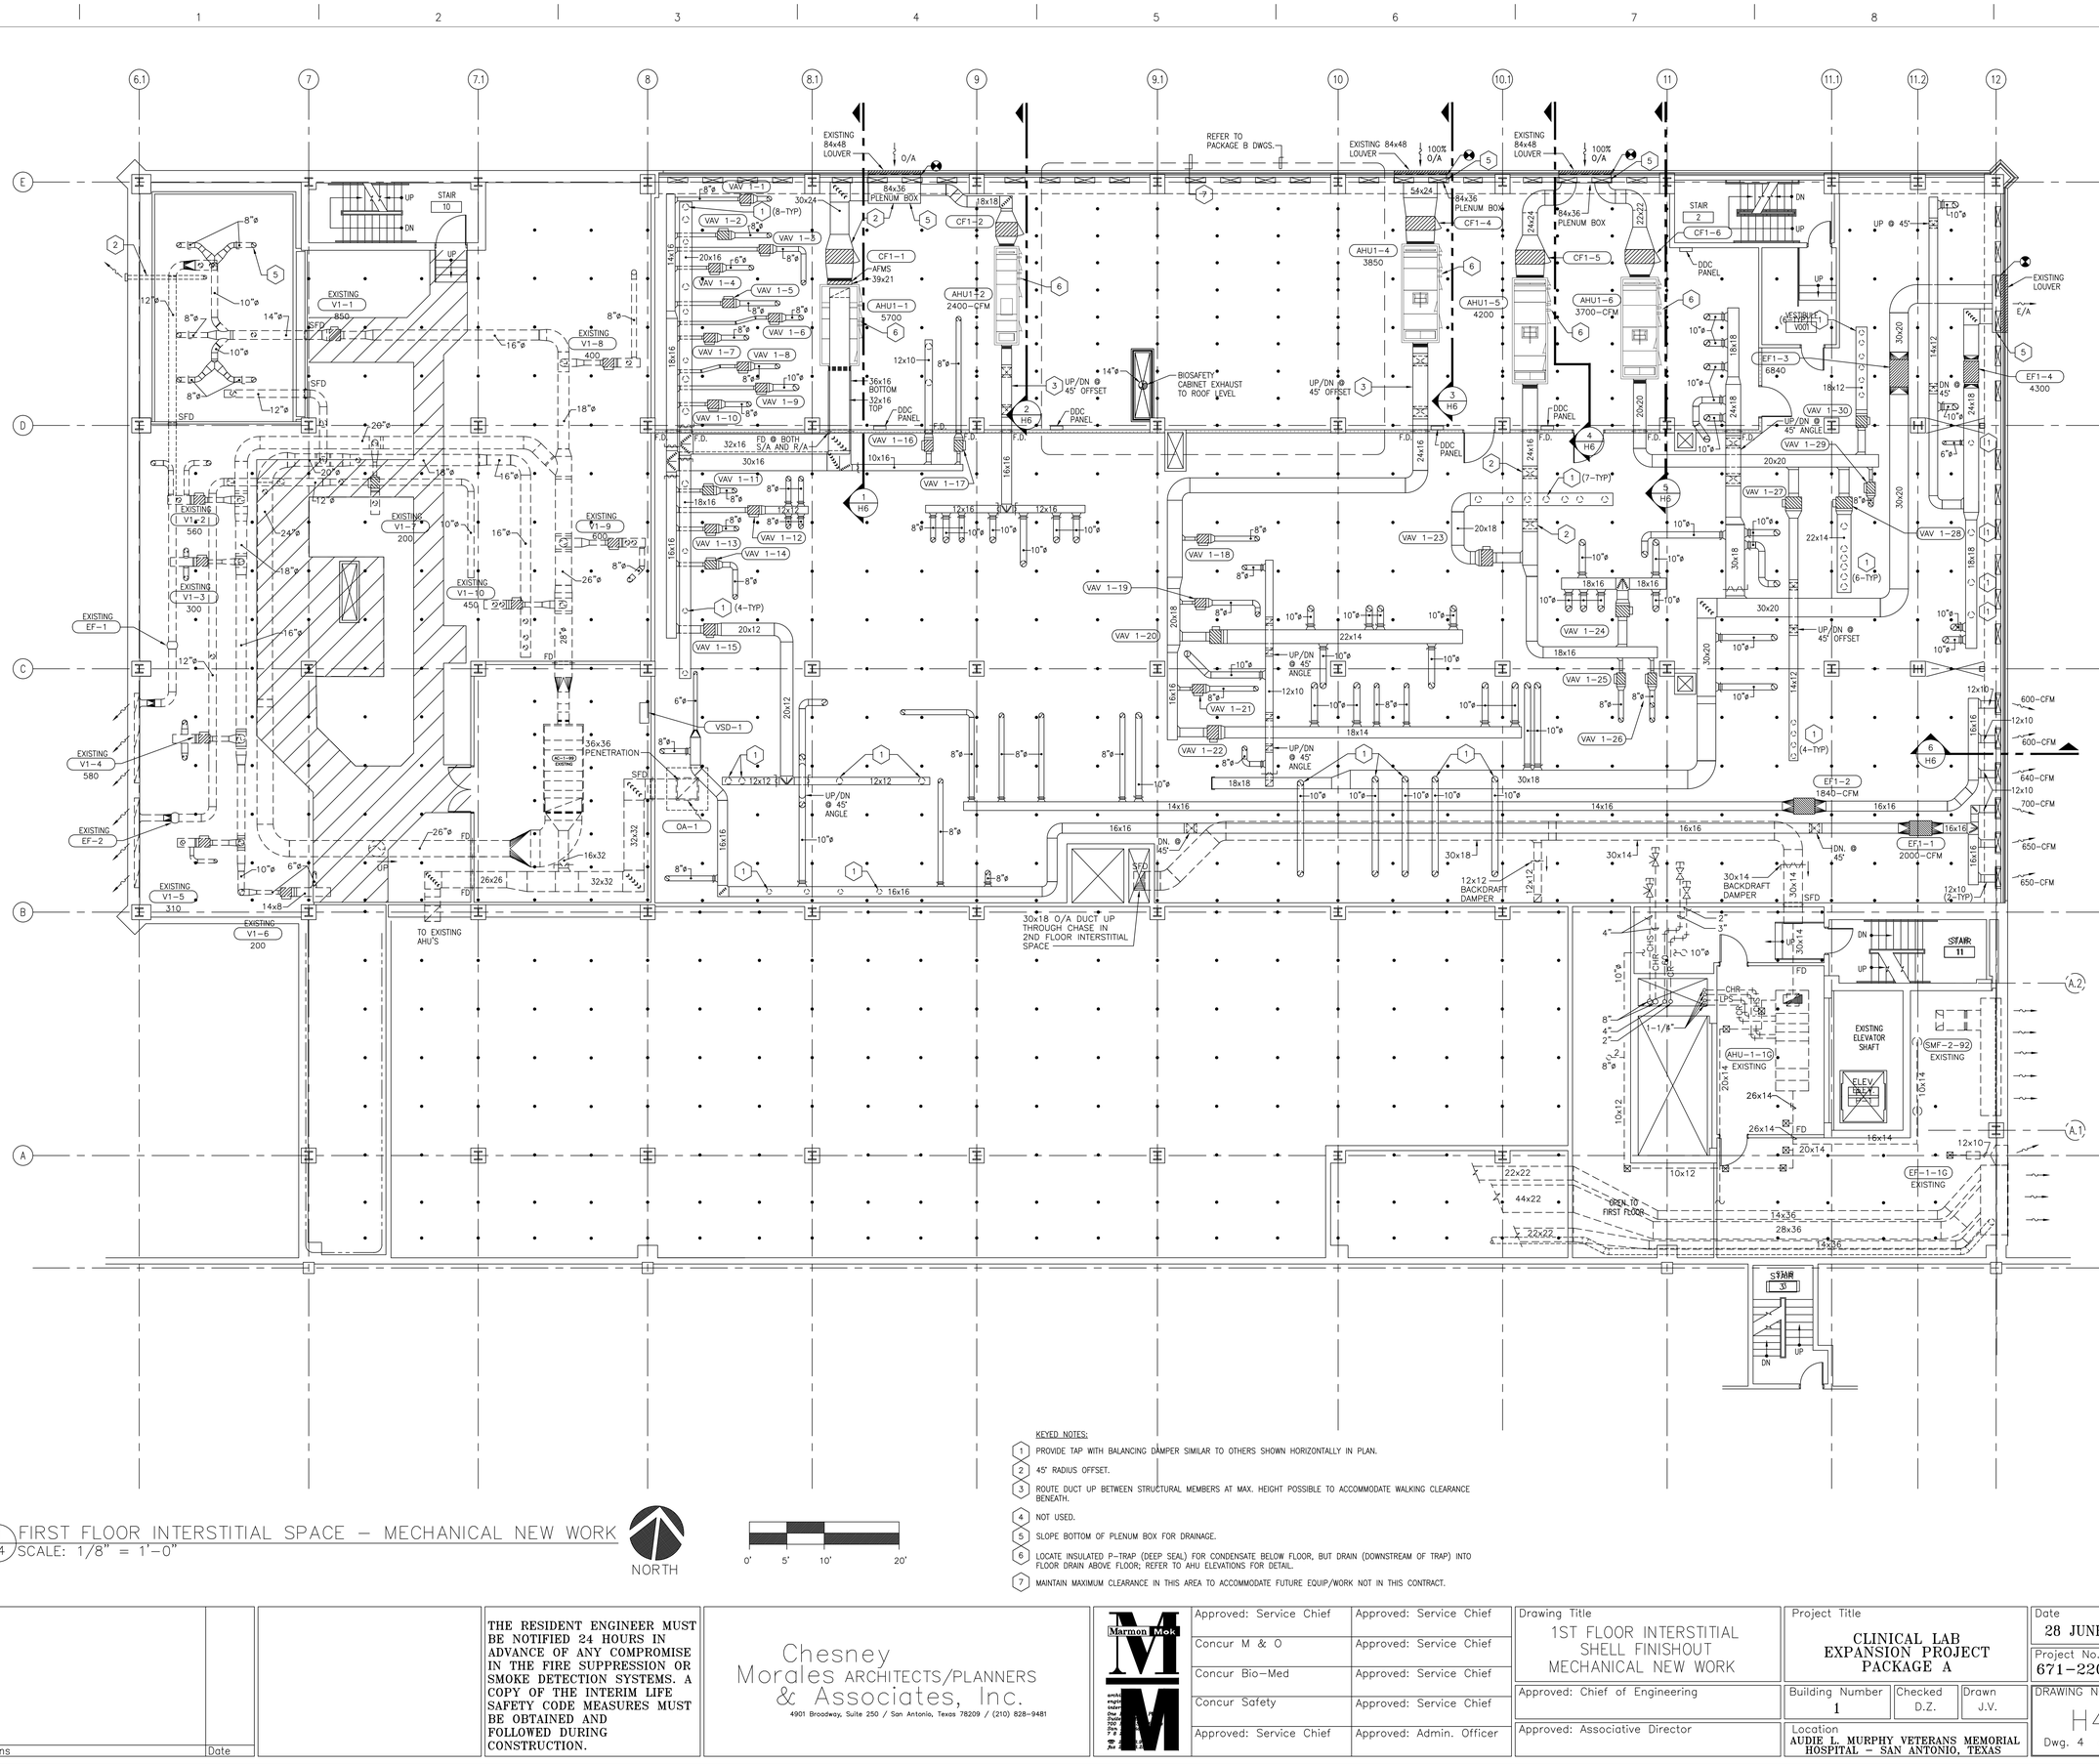

1 H4 FIRST FLOOR INTERSTITIAL SPACE – MECHANICAL NEW WORK
SCALE: 1/8" = 1'-0"

NORTH

0' 5' 10' 20'

KEYED NOTES:

1. PROVIDE TAP WITH BALANCING DAMPER SIMILAR TO OTHERS SHOWN HORIZONTALLY IN PLAN.
2. 45° RADIUS OFFSET.
3. ROUTE DUCT UP BETWEEN STRUCTURAL MEMBERS AT MAX. HEIGHT POSSIBLE TO ACCOMMODATE WALKING CLEARANCE BENEATH.
4. NOT USED.
5. SLOPE BOTTOM OF PLENUM BOX FOR DRAINAGE.
6. LOCATE INSULATED P-TRAP (DEEP SEAL) FOR CONDENSATE BELOW FLOOR, BUT DRAIN (DOWNSTREAM OF TRAP) INTO FLOOR DRAIN ABOVE FLOOR; REFER TO AHU ELEVATIONS FOR DETAIL.
7. MAINTAIN MAXIMUM CLEARANCE IN THIS AREA TO ACCOMMODATE FUTURE EQUIP/WORK NOT IN THIS CONTRACT.

KEY PLAN

Revisions	Date

THE RESIDENT ENGINEER MUST BE NOTIFIED 24 HOURS IN ADVANCE OF ANY COMPROMISE IN THE FIRE SUPPRESSION OR SMOKE DETECTION SYSTEMS. A COPY OF THE INTERIM LIFE SAFETY CODE MEASURES MUST BE OBTAINED AND FOLLOWED DURING CONSTRUCTION.

Chesney Morales ARCHITECTS/PLANNERS & Associates, Inc.
4901 Broadway, Suite 250 / San Antonio, Texas 78209 / (210) 828-9481

Marmon Mok

Approved: Service Chief	Approved: Service Chief
Concur M & O	Approved: Service Chief
Concur Bio-Med	Approved: Service Chief
Concur Safety	Approved: Service Chief
Approved: Service Chief	Approved: Admin. Officer

Drawing Title: 1ST FLOOR INTERSTITIAL SHELL FINISHOUT MECHANICAL NEW WORK

Approved: Chief of Engineering

Approved: Associative Director

Project Title: CLINICAL LAB EXPANSION PROJECT PACKAGE A

Building Number: 1 | Checked: D.Z. | Drawn: J.V.

Location: AUDIE L. MURPHY VETERANS MEMORIAL HOSPITAL – SAN ANTONIO, TEXAS

Date: 28 JUNE 05

Project No.: 671-220

DRAWING NO.: H4 Dwg. 4 of 19

W:\02064\Refr\valogo.jpg

Department of Veterans Affairs

Y:\04027\Refr\PACK-A-01-20-05TTLBK-A.dwg

VA FORM 08-6231, DEC 1989

GPO: 1994-557-740