


GENERAL NOTES

1. PROVIDE VOLUME DAMPERS, PER DETAILS AND AS SHOWN, FOR ALL AIR DEVICES.
2. RESTORE CEILING AREAS ALTERED BY DEMOLITION/INSTALLATION OF DEVICES TO MATCH SURROUNDING CEILING AREA.
3. BALANCE EACH TOILET ROOM EXHAUST AIR DEVICE TO CFM SHOWN.
4. REFER TO 1/M201 FOR AIR DEVICE LOCATIONS.
5. COORDINATE EXACT AIR DEVICE LOCATIONS, AND DUCT DROPS, WITH LIGHTING FIXTURE LOCATIONS.

KEYED NOTES

- ① PROVIDE AND INSTALL NEW DUCT TAP AND FLEX FROM MAIN DUCT TO AIR DEVICE BELOW.
- ② PROVIDE AND INSTALL DUCT BRANCH FROM MAIN DUCT TO AIR DEVICE BELOW.
- ③ ROUTE DUCT BELOW MECHANICAL ROOM.
- ④ PROVIDE AND INSTALL 12X12 PLENUM ON TOP OF AIR DEVICE BELOW. TAP DUCT TO SIDE OF PLENUM AS INDICATED.
- ⑤ PROVIDE AND INSTALL NEW 12X8 RETURN AIR DUCT TAP FROM EXISTING 12X8 RETURN AIR DUCT.
- ⑥ BALANCE AIR ACROSS COIL AT 350 CFM.
- ⑦ ROUTE 6X12 EXHAUST DUCT 6" ABOVE FINISHED FLOOR IN ROOM C406/7. COVER END OF DUCT WITH 1/4" WIRE MESH. SECURE DUCT TO WALL.

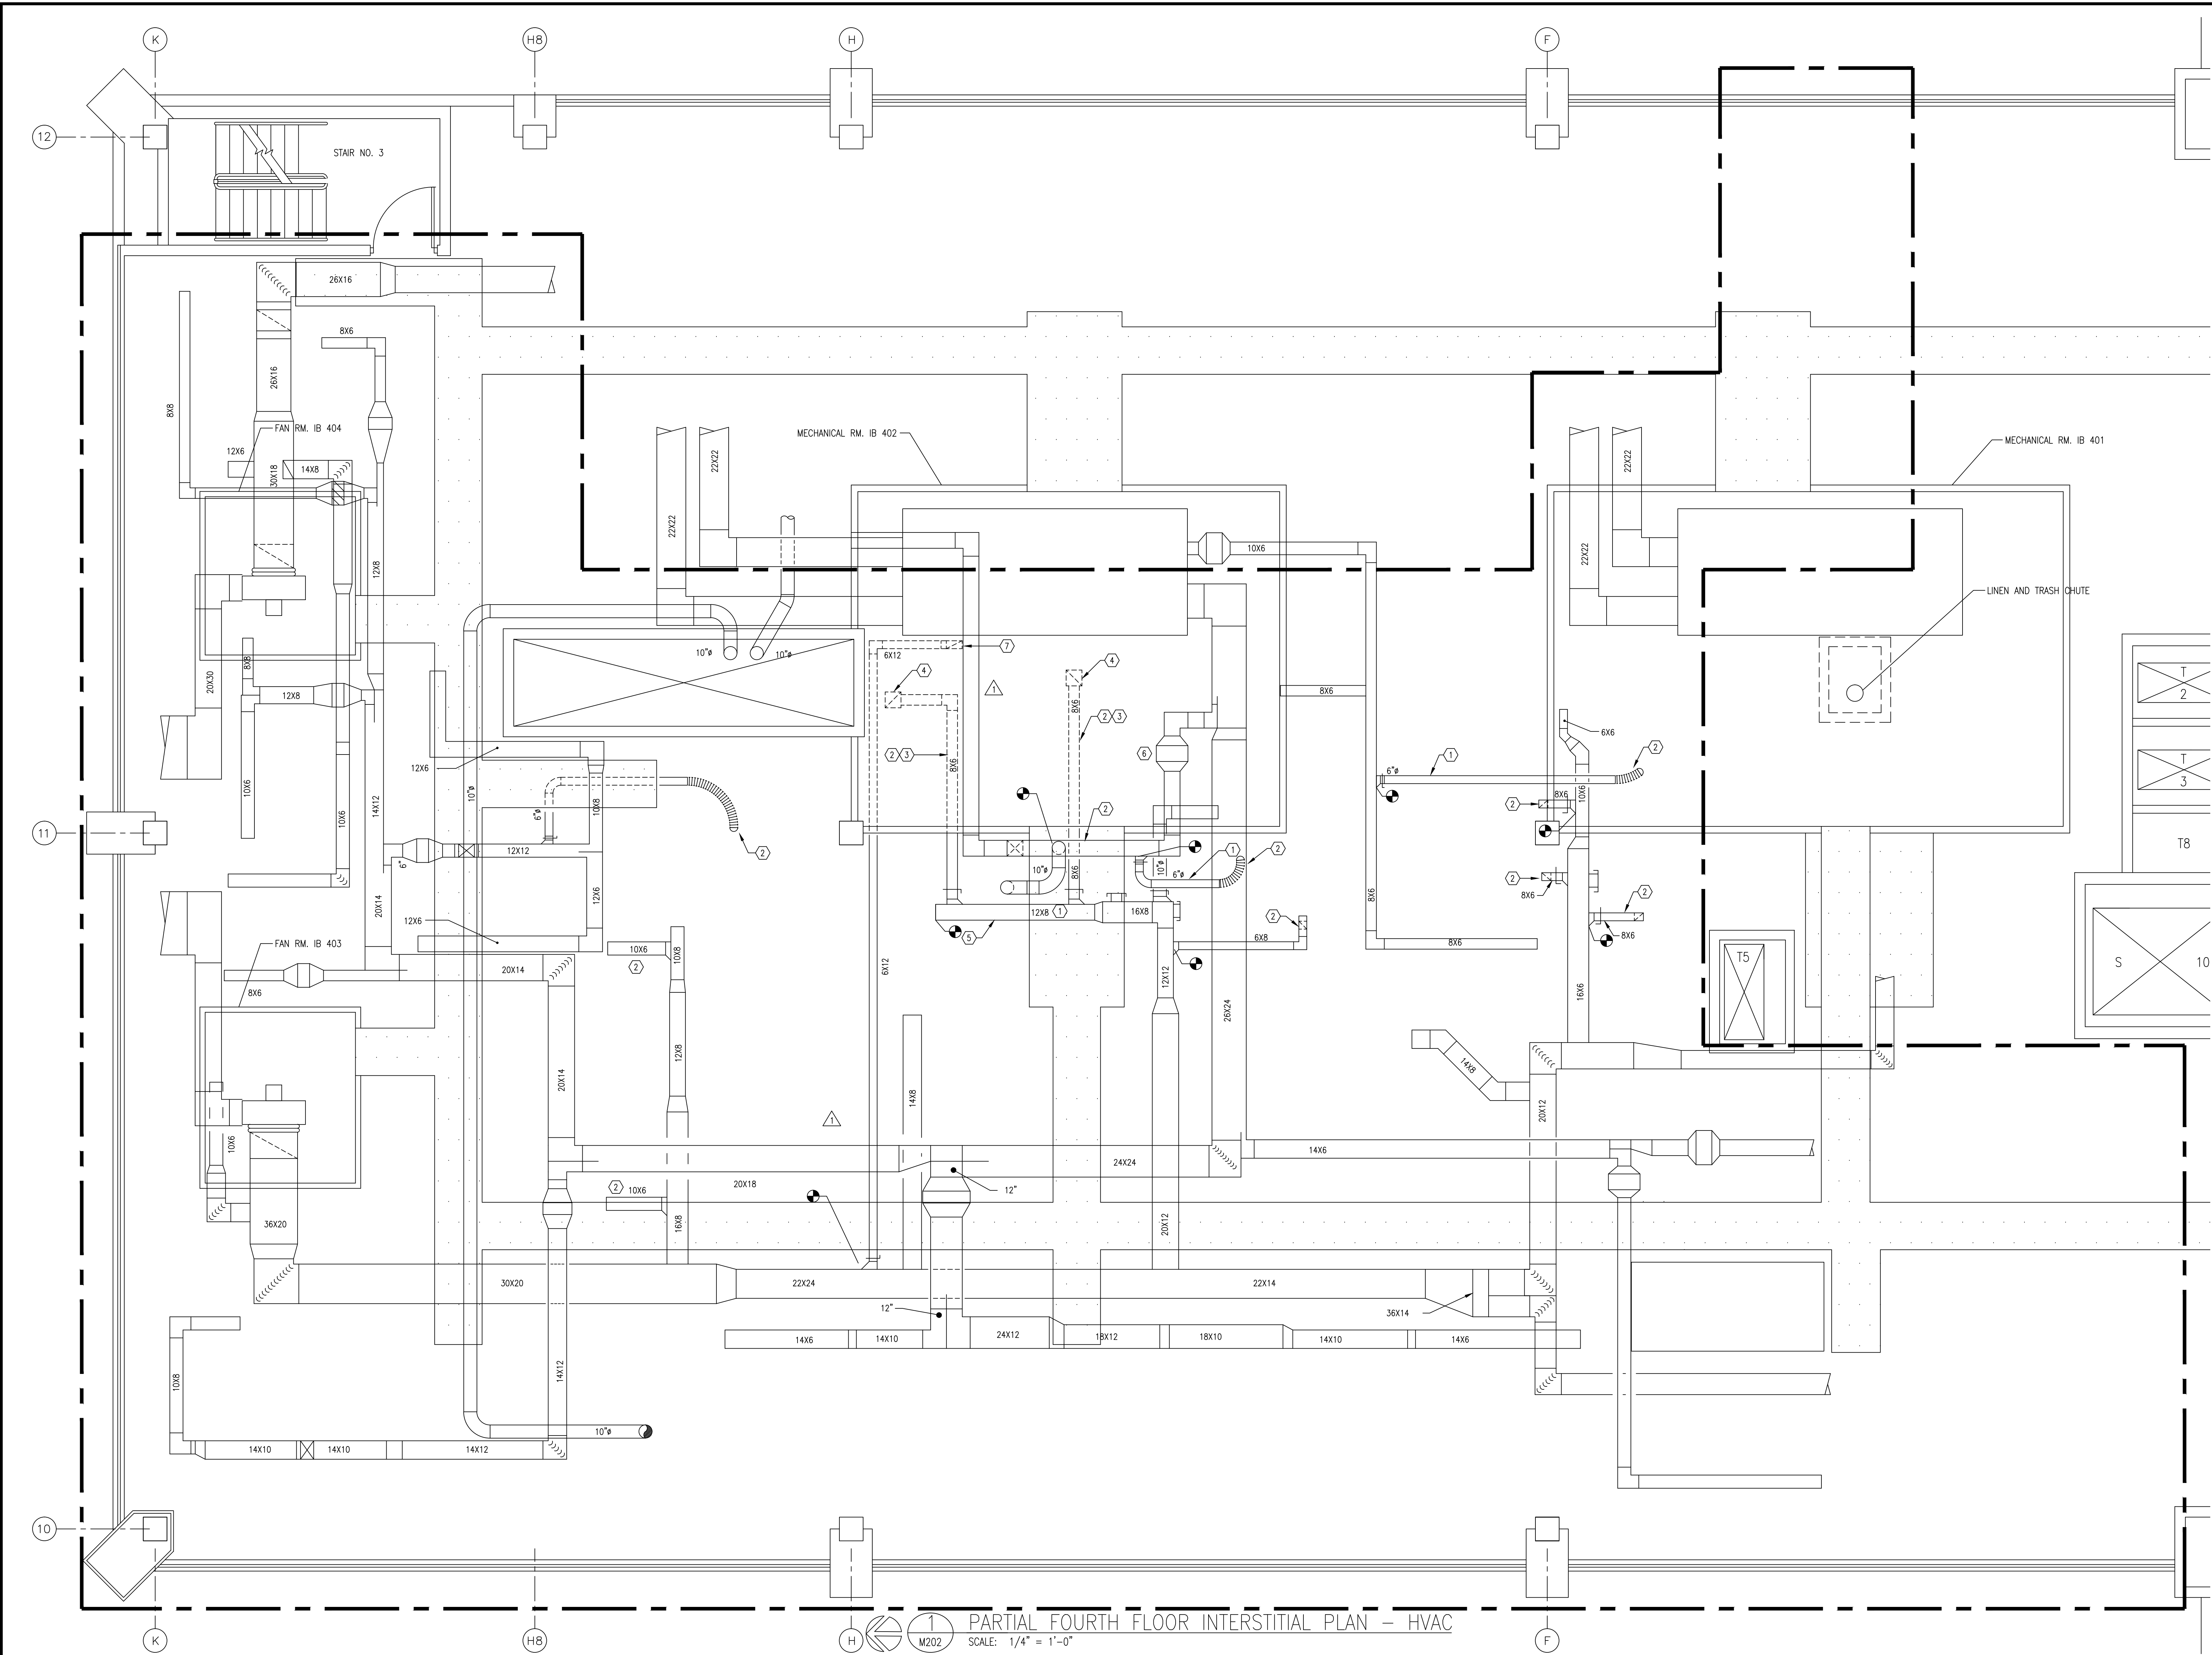

PARTIAL FOURTH FLOOR INTERSTITIAL PLAN - HVAC
SCALE: 1/4" = 1'-0"

Revisions	Date

ENGR :

HMC & ASSOCIATES INC.
Consulting Mechanical - Electrical Engineers

800 N.W. Loop 410, Suite 300 South
San Antonio, Texas 78215
(210) 349-0800
FAX (210) 349-0736
E-Mail: HMC@HMCENGINEERS.COM

Daniel T. Muzquiz & Associates
Architectural Design Group

11314 SIR WINSTON, SUITE-B, SAN ANTONIO, TX (210)340-0077

REGISTERED ARCHITECT
DANIEL T. MUZQUIZ
No. 6673
STATE OF TEXAS

CONCUR: CHIEF BIO-MED	APPROVED: SVC. CHIEF
CONCUR: M & O	APPROVED: SVC. CHIEF
CONCUR: OPER	APPROVED: SVC. CHIEF
CONCUR: SAFETY	APPROVED: CHIEF OF STAFF

Drawing Title
PARTIAL FOURTH FLOOR INTERSTITIAL PLAN - HVAC
Approved Chief Of Engineering
Approved Associate Director

Project Title
RELOCATE DIALYSIS
Building Number
1
Location
Audie L. Murphy Hospital San Antonio, Texas

Date
12-03-03
Project No.
02-111
DRAWING NO.
M202
Dwg. Of

