


1 MECHANICAL/FIRE ALARM PLAN
801-E4.0 SCALE: 1/8"=1'-0"



ELECTRICAL DESIGN ELECTRICAL ENGINEERS
1201 BROAD ST., SUITE 1-A
AUGUSTA, GA 30901
PH: (706) 724-3551
FAX: (706) 724-8807
CONSULTANTS INC. EDC PROJECT # 11033

REVISIONS:	DATE:

DRAWN BY:	S. THOMAS
CHECKED BY:	M. MONGRUE

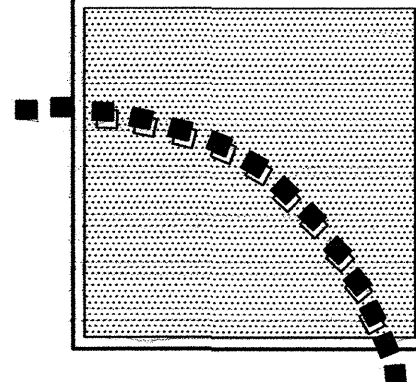


VIRGO GAMBILL
ARCHITECTS
2531 CENTER WEST PARKWAY,
SUITE 200
AUGUSTA, GEORGIA 30909
(706) 736-3661

MEMBERS OF THE
AMERICAN INSTITUTE
OF ARCHITECTS
THIS DOCUMENT IS PROPERTY OF VIRGO
GAMBILL ARCHITECTS. THE UNAUTHORIZED
REPRODUCTION, COPYING, OR OTHERWISE
USE OF THIS DOCUMENT IS STRICTLY
PROHIBITED AND ANY INFRINGEMENT
THEREOF IS SUBJECT TO LEGAL ACTION.
2007 © VIRGO GAMBILL ARCHITECTS

APPROVED BY:	PROJECT TITLE:
MEDICAL CENTER DIRECTOR	RENOVATE "E" WING BUILDING 801, DOWNTOWN DIVISION AUGUSTA, GEORGIA
APPROVED BY:	DRAWING TITLE:
FACILITY MANAGEMENT SERV LINE EXEC	MECHANICAL PLAN

DATE:	APRIL 29, 2011
VA PROJECT NO.	509-318E
DRAWING NO.	801-E4.0
DWG. 41 of 44	

DATE:	APRIL 29, 2011
VA PROJECT NO.	509-318E
DRAWING NO.	801-E4.0
DWG. 41 of 44	

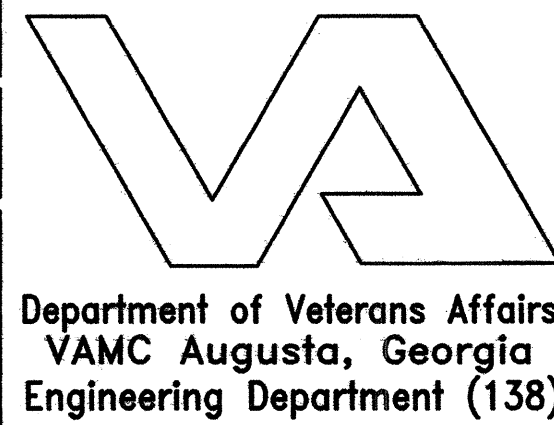

NOTES:

- UTILIZE MECHANICAL CURBING TO ROUTE CONDUIT THRU ROOF
- FOR FIRE/SMOKE DAMPER, COORDINATE LOCATION PRIOR TO INSTALLATION. DAMPER MOTOR SHALL BE CONNECTED TO SAME CIRCUIT AS TERMINAL UNIT CONTROLS
- CONNECT TO SPARE 201 CIRCUIT BREAKER, REVISE DIRECTORY
- FOR DOOR RELEASE
- EXISTING FIRE ALARM CONTROL PANEL
- RELOCATED FIRE ALARM DEVICE
- INTERFACE DOOR CONTROLLER WITH FIRE ALARM SYSTEM TO DE ACTIVATE DOORS WHEN FIRE ALARM SYSTEM IS ACTIVATED

GENERAL NOTES:

- RE PROGRAM EXISTING FIRE ALARM PANEL TO ACCEPT NEW FIRE ALARM DEVICES. PROVIDE ANY HARDWARE REQUIRED AND RE CERTIFY SYSTEM AFTER MODIFICATIONS HAVE BEEN COMPLETED. PROVIDE FIRE ALARM NEW DEVICES TO MATCH EXISTING DEVICES AND MANUFACTURE

