
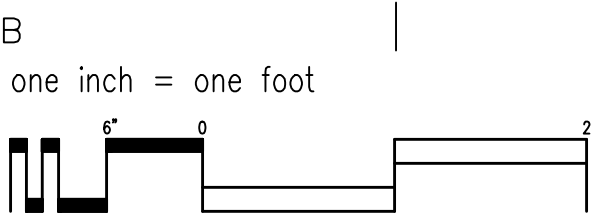
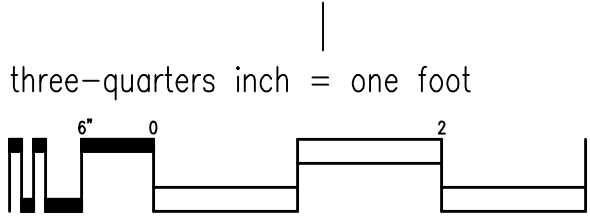
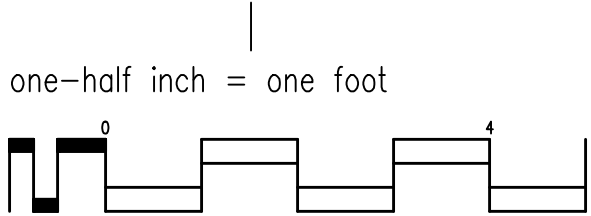
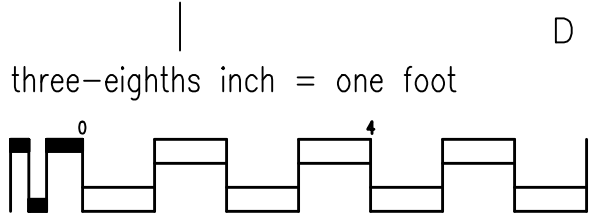
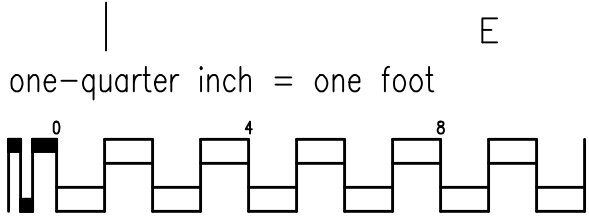


NOTES:

- (THIS SHEET ONLY)
- ① EXPOSED DUCT. INSULATE SUPPLY DUCT PER SPECIFICATIONS. RETURN DUCT UN-INSULATED.
 - ② SMOKE VENT LOUVER. SEE ARCHITECTURAL.
 - ③ LOW LEAKAGE 120" WIDE x 16" HIGH MOTORIZED DAMPER WITH NORMALLY OPEN ACTUATOR. SEE ELECTRICAL FOR CONNECTION TO FIRE ALARM SYSTEM.
 - ④ SHEET METAL BLANK OFF REMAINDER OF LOUVER.

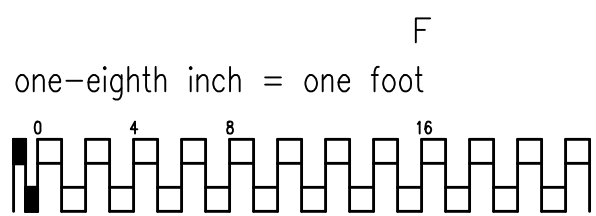


ENLARGED FLOOR PLAN
10th FLOOR STAIRS - MECHANICAL
SCALE: 1/4" = 1'-0"
0 2 4 8'

ENLARGED FLOOR PLAN
ROOF FLOOR STAIRS - MECHANICAL
SCALE: 1/4" = 1'-0"
0 2 4 8'

Revisions	Date

Toland ♦ Mizell ♦ Molnar, LLC
590 MEANS STREET NW,
SUITE 200
ATLANTA, GA, 30318
404-214-9774

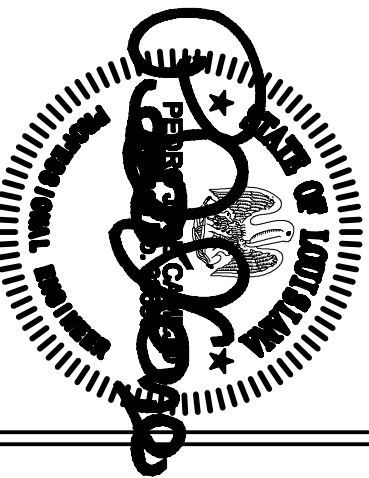

Drawing Title
ENLARGED STAIR DUCTWORK NEW WORK FLOOR PLANS-MECHANICAL
Approved Project Engineer

Project Title
2ND FLOOR OUTPATIENT MENTAL HEALTH
Building Number
BLDG 1 SOUTH WING
Location
VA MEDICAL CENTER SHREVEPORT, LOUISIANA
Checked
PJC
Drawn
JSW

Date
05-25-2011
Project No.
VA256-C-1047
DRAWING NO.
M113
Dwg. of
Veterans Administration

