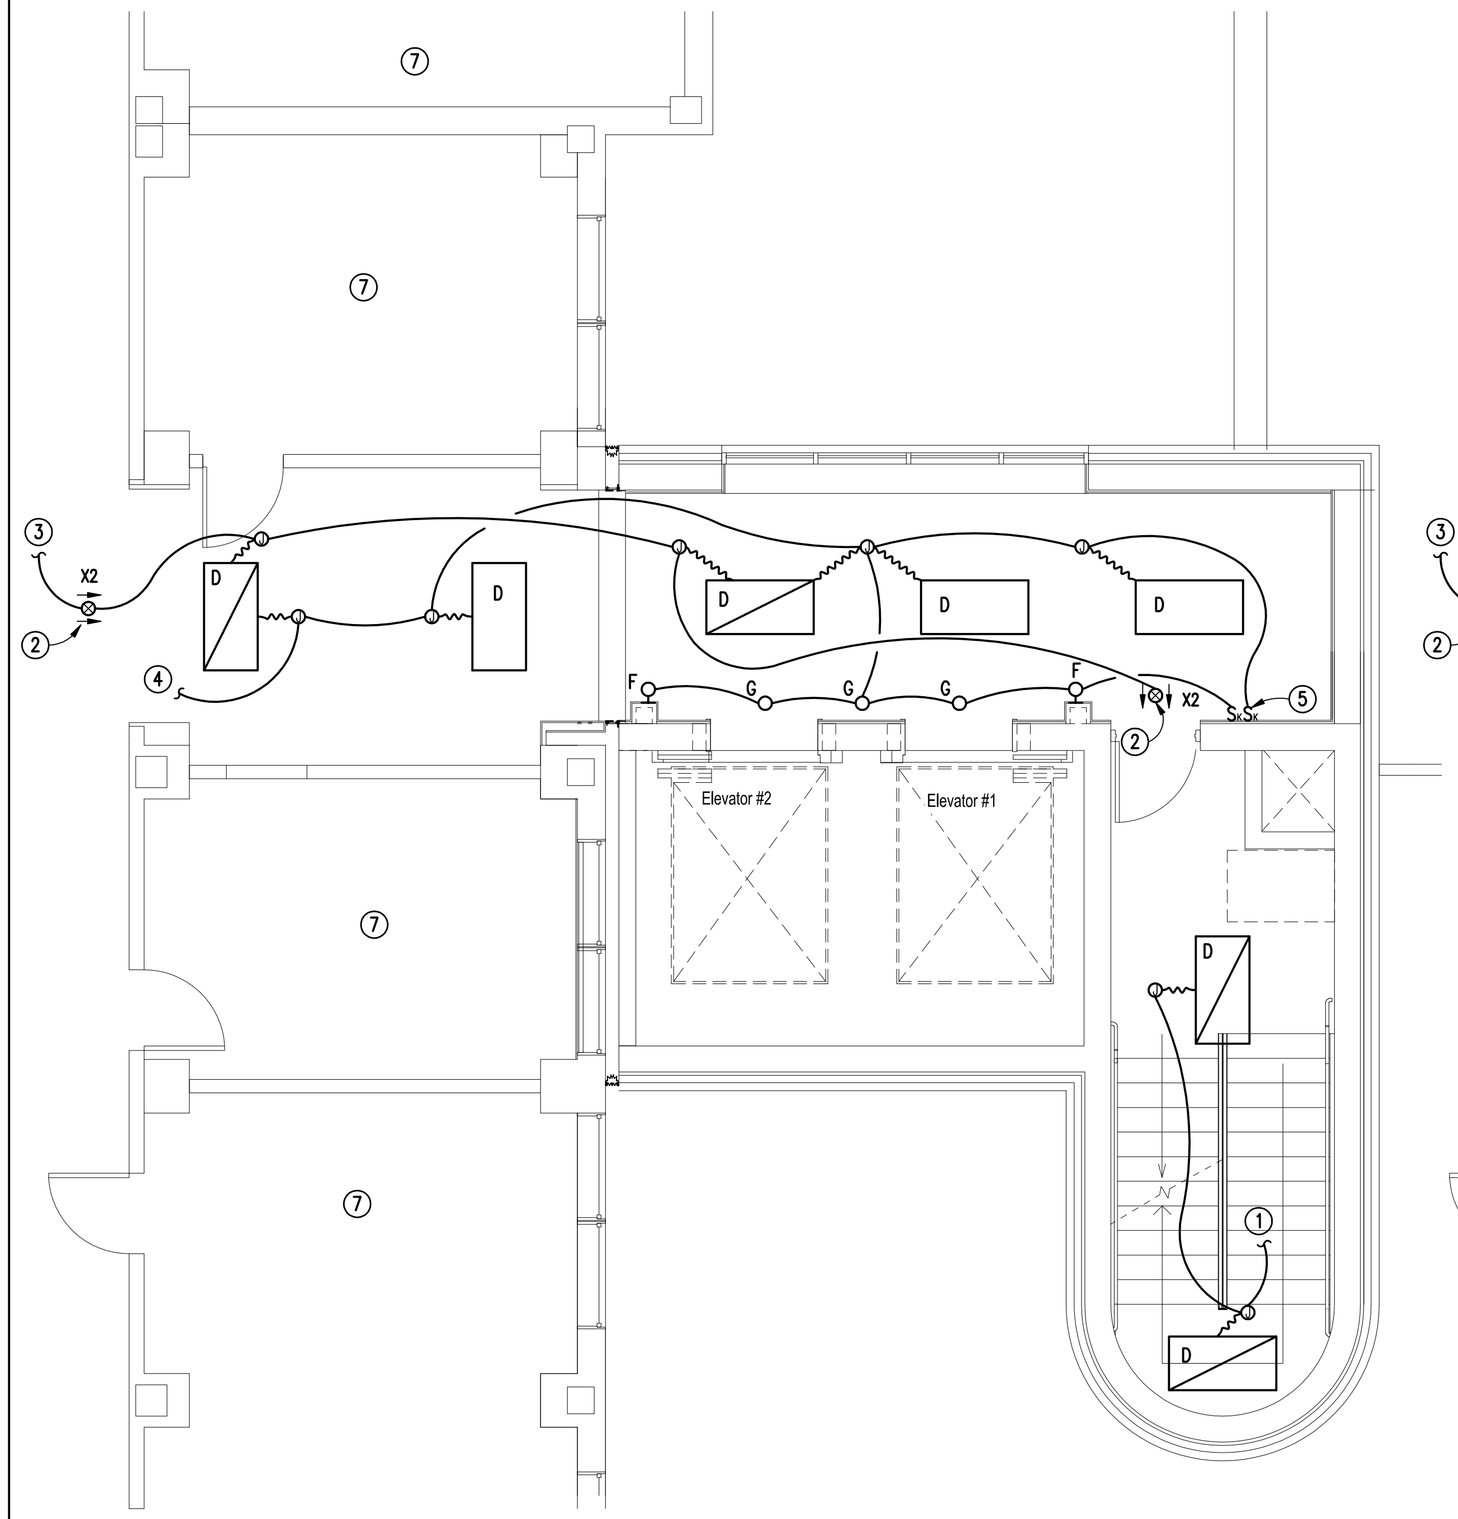

ENLARGED FLOOR PLAN
3RD FLOOR STAIRS – ELECTRICAL LIGHTING
SCALE: 1/4" = 1'-0"

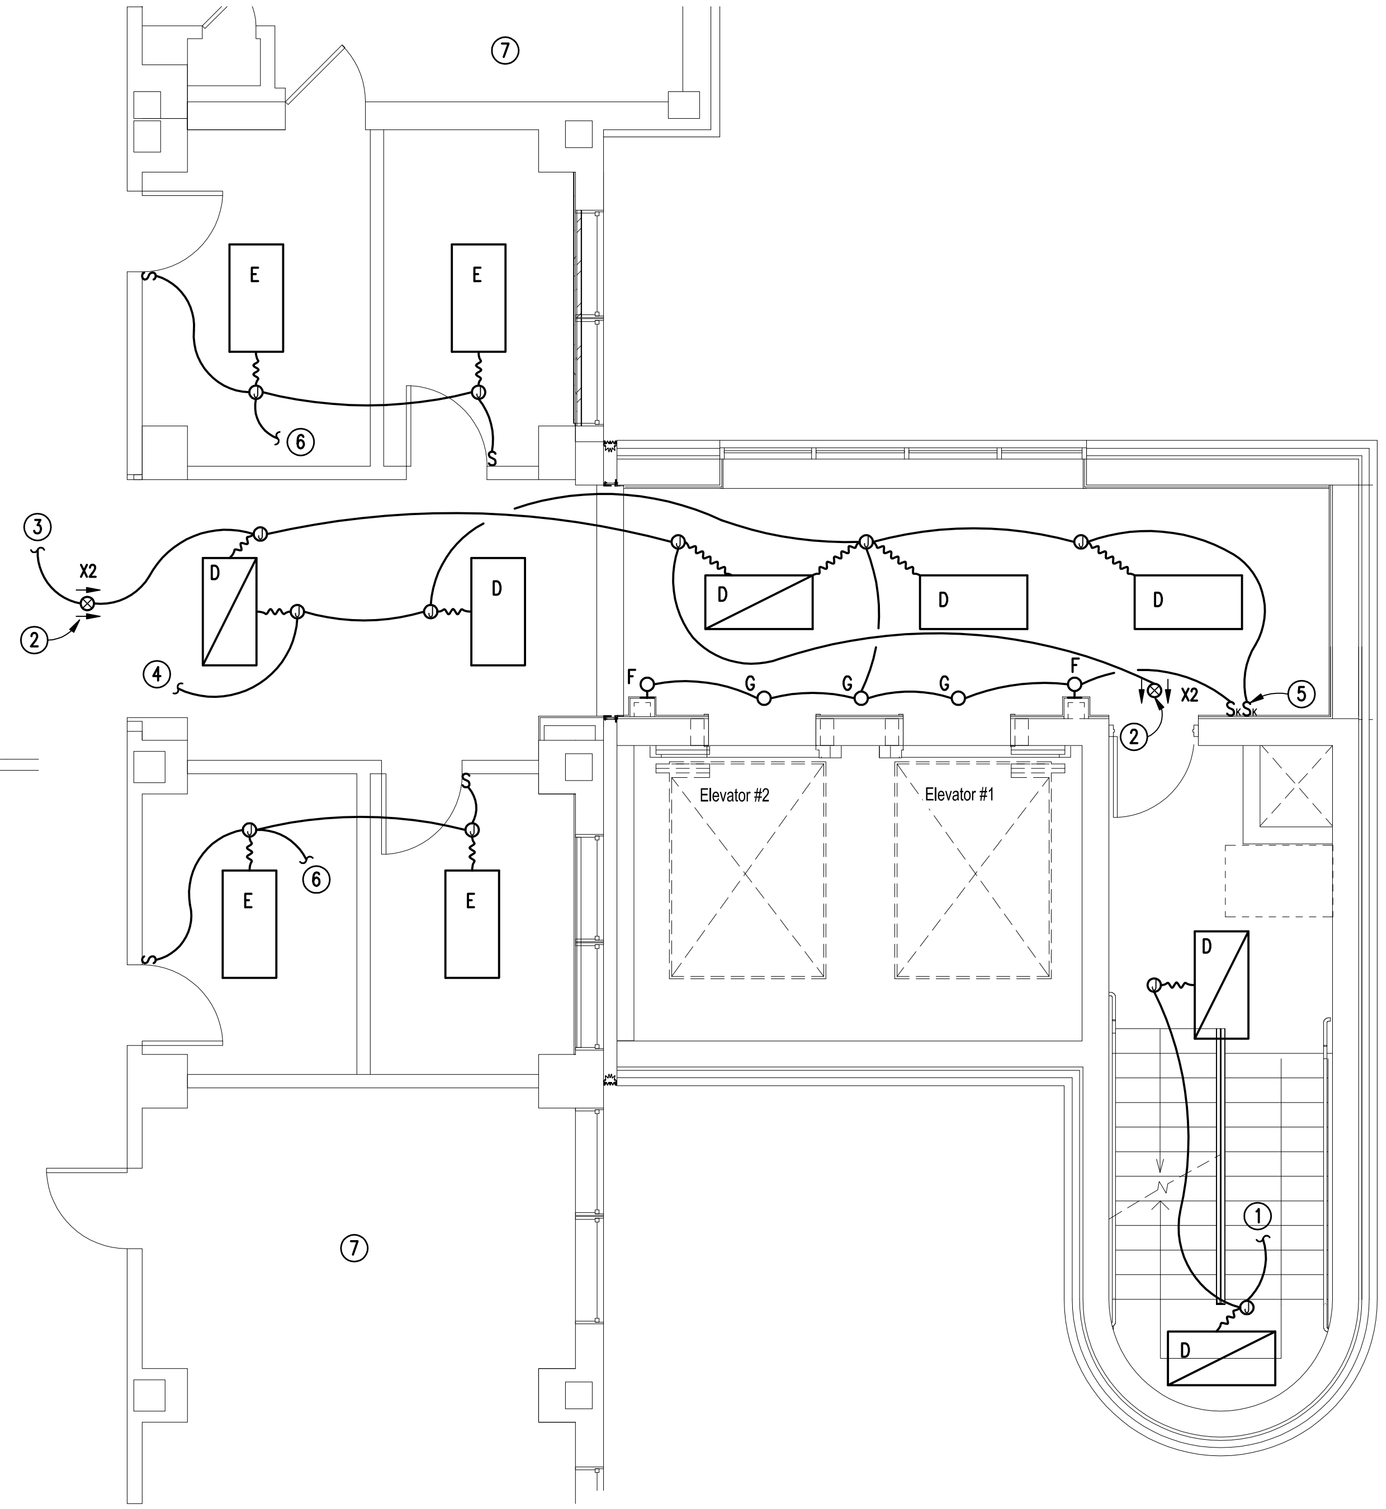

ENLARGED FLOOR PLAN
4TH FLOOR STAIRS – ELECTRICAL LIGHTING
SCALE: 1/4" = 1'-0"

NOTES:
(THIS SHEET ONLY)

1. MAKE CONNECTIONS TO EXISTING LIGHTING CIRCUIT AT STAIRWELL AREA ON FLOORS BELOW.
2. THIS FIXTURE SHALL BE UNSWITCHED.
3. MAKE ALL CONNECTIONS TO EXISTING LIFE SAFETY LIGHTING CIRCUIT IN CORRIDOR.
4. MAKE ALL CONNECTIONS TO EXISTING NORMAL POWER LIGHTING CIRCUIT IN CORRIDOR.
5. COORDINATE EXACT LOCATION OF SWITCHES WITH VA FOR ELEVATOR LOBBY PRIOR TO INSTALLATION.
6. MAKE ALL CONNECTIONS TO EXISTING NORMAL POWER LIGHTING CIRCUIT LEFT ABANDONED IN THIS SPACE.
7. NO NEW WORK REQUIRED IN THIS SPACE.

Revisions	Date

Toland◆Mizell◆Molnar, LLC
590 MEANS STREET NW,
SUITE 200
ATLANTA, GA, 30318
404-214-9774

Drawing Title: THIRD AND FOURTH STAIRS ENLARGED FLOOR PLANS ELECTRICAL LIGHTING

Approved Project Engineer:

Project Title: 2ND FLOOR OUTPATIENT MENTAL HEALTH

Building Number: BLDG 1 SOUTH WING | Checked: | Drawn:

Location: VA MEDICAL CENTER SHREVEPORT, LOUISIANA

NORTH

100% REVIEW SUBMITTAL

Date: 05-25-2011

Project No.: VA256-C-1047

DRAWING NO.: E402

Dwg. Of

Veterans Administration

VA FORM 08-6231A, MAR 1984

U.S. GOVERNMENT PRINTING OFFICE:1984-440-467