

2 FIRE PROTECTION WATER SUPPLY
SCALE: NOT TO SCALE

NOTE
THIS INFORMATION WAS PROVIDED BY MR. JASON RUSH MACHINE SHOP/PIPE SHOP FOREMAN, ENGINEERING SERVICE, AUDIE L. MURPHY MEMORIAL VETERANS HOSPITAL.

THE CONTRACTOR SHALL VERIFY ROUTING AND PIPE SIZES.

SEE SPECIFICATION SECTION 21 13 13 FOR FIRE PUMP TEST RESULTS.

NOTE
NO (N) SPRINKLER PIPING SHALL BE ROUTED ABOVE OR CROSS OVER THE (E) CATWALK.


1 FLOOR PLAN - AREA B
SCALE: 1/4" = 1'-0"

SPRINKLER LEGEND:

- EXISTING FIRE SPRINKLER PIPING TO REMAIN
- (N) NEW
- (E) EXISTING
- ☒ INDICATING CONTROL VALVE WITH SUPERVISORY SWITCH
- ☐ (N) FIRE HOSE VALVE AND RECESSED CABINET
- - - - - LIMITS OF CONSTRUCTION
- ▨ NOT IN PROJECT AREA

DRAWING NOTES:

- THIS DOCUMENT REPRESENTS A CONCEPTUAL FIRE SPRINKLER SYSTEM FOR THE PURPOSE OF BIDDING. A FIRE SPRINKLER CONTRACTOR LICENSED WITH THE TEXAS DEPARTMENT OF INSURANCE SHALL PREPARE A COMPLETE FIRE SPRINKLER DESIGN CONFORMING TO THE REQUIREMENTS OF THE 2013 EDITION OF NFPA 13.
- NO PIPING SHALL BE ABANDONED IN PLACE WITHOUT AUTHORIZATION FROM THE AHJ. PIPING THAT IS ALLOWED TO BE ABANDONED IN PLACE SHALL BE CLEARLY MARKED ON THE UNDERSIDE WITH STICK-ON MARKERS IDENTIFYING THE PIPING AS "ABANDONED FIRE PROTECTION PIPING".
- THE EXISTING FIRE SPRINKLER SYSTEM OUTSIDE OF THE PROJECT AREA SHALL REMAIN IN SERVICE DURING CONSTRUCTION.
- AT THE END OF THE PROJECT, THE AREAS OUTSIDE OF THE PROJECT SHALL REMAIN COMPLIANT AND SUPPLIED FROM THE SAME ZONES AS ORIGINALLY DESIGNED. EACH NEW PROJECT AREA SHALL BE SUPPLIED FROM ONE ZONE, ONLY. THE INTEGRITY OF THE 2 1/2" LOOPS SHALL BE MAINTAINED.
- THE CONTRACTOR SHALL COORDINATE ALL FIRE SPRINKLER SYSTEM OUTAGES WITH THE LOCAL AUTHORITY HAVING JURISDICTION (AHJ). THIS MAY INCLUDE FIRE WATCHES.
- REFER TO SPECIFICATION SECTION 21 13 13 FOR SPECIFIC DESIGN REQUIREMENTS.

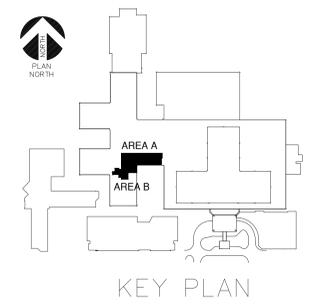

CONSULTANTS: Aon Fire Protection Engineering Corporation 700 East Sonterra Blvd. Suite 1212 San Antonio, TX 78258 t+1 210.495.8048 f+1 210.495.9471 www.aonfpie.com Texas P.E. Firm Reg. No. F-1593 Fire Protection Code Risk Life Safety Security	Approved: Assistant Director Approved: Chief of Staff Approved: Chief, Engineering	100% SUBMITTAL SET OCTOBER 2, 2015	ARCHITECT: WEST EAST DESIGN GROUP 200 E. GRAYSON STREET, SUITE 207, SAN ANTONIO TX. 78215, USA 210.530.0755 FAX: 210.530.9427 <small>These documents can not be copied or reproduced without written consent from WestEast Design Group</small>	Drawing Title FIRE PROTECTION PLAN AREA 'B'	Project Title CONVERT 1F TO MED	Project Number 671-14-109	Office of Facilities Management 	
	Approved: Service Chief Approved: Chief, EMS Approved: Chief, Infection Control Approved: Chief, IT Approved: Chief, M & O Approved: Chief, Police Approved: Chief, Safety Approved: Chief	Approved Project Director Approved: Project Director	Location AUDIE L. MURPHY MEMORIAL VETERANS HOSPITAL, SAN ANTONIO, TEXAS	Building Number 1	Drawing Number FP2.2	Date OCTOBER 05, 2015		Checked JW/WB