


- ### GENERAL NOTES
1. FIELD VERIFY ALL DIMENSIONS PRIOR TO DEMOLITION AND CONSTRUCTION ACTIVITIES.
 2. SCOPE OF WORK INCLUDES ADDING SPRINKLERS IN NEW ELECTRICAL ROOMS, AND RE-ROUTING EXISTING PIPING OUTSIDE OF NEW ELECTRICAL ROOMS, AS SHOWN.
 3. NEW FIRE SPRINKLER PIPING SHALL BE SCHEDULE 40 BLACK WITH STANDARD WEIGHT CAST IRON THREADED FITTINGS..
 4. NEW FIRE SPRINKLER WORK SHALL BE IN COMPLIANCE WITH VA FIRE PROTECTION DESIGN MANUAL AND APPLICABLE CODES.
 5. THERE IS NO SPRINKLER WORK IN BASEMENT OR FIRST FLOOR.

- ### DEMOLITION NOTES
1. REMOVE EXISTING PIPING TO ELL AT TOP OF RISER NIPPLE.
 2. REMOVE EXISTING PIPING TO TEE.

- ### KEY NOTES
1. EXISTING STANDPIPE RISER AND FLOOR CONTROL VALVE ASSEMBLY.
 2. CUT-IN TEE FOR NEW PIPING.
 3. CONNECT NEW PIPING AT EXISTING ELL.
 4. CONNECT NEW PIPING AT EXISTING TEE.
 5. RE-INSTALL EXISTING SPRINKLER.
 6. CONNECT TO EXISTING STANDPIPE RISER ABOVE 1ST FLOOR CEILING AND INSTALL PIPING TO NEW STANDPIPE RISER LOCATION FOR 2ND FLOOR.
 7. CONNECT TO EXISTING STANDPIPE RISER LOCATION AT HIGHEST ELEVATION POSSIBLE ON 2ND FLOOR, AND MODIFY EXISING FLOOR CONTROL VALVE ASSEMBLIES AS NEEDED TO MAINTAIN EXISTING SPRINKLER ZONES.
 8. NEW STANDPIPE LOCATION FROM 1ST FLOOR CEILING TO 2ND FLOOR CEILING.
 9. SIMILAR PIPING ABOVE 1ST FLOOR CEILING AND ON 2ND FLOOR AT HIGHEST ELEVATION POSSIBLE.
 10. REMOVE ELL AT EXISTING SPRINKLER, INSTALL TEE, AND ADD PIPING FOR NEW SPRINKLER IN ELECTRICAL ROOM.

- ### LEGEND
- EXISTING SPRINKLER
 - EXISTING SPRINKLER PIPING
 - NEW SR INTERMEDIATE TEMP UPRIGHT SPRINKLER
 - NEW SPRINKLER PIPING

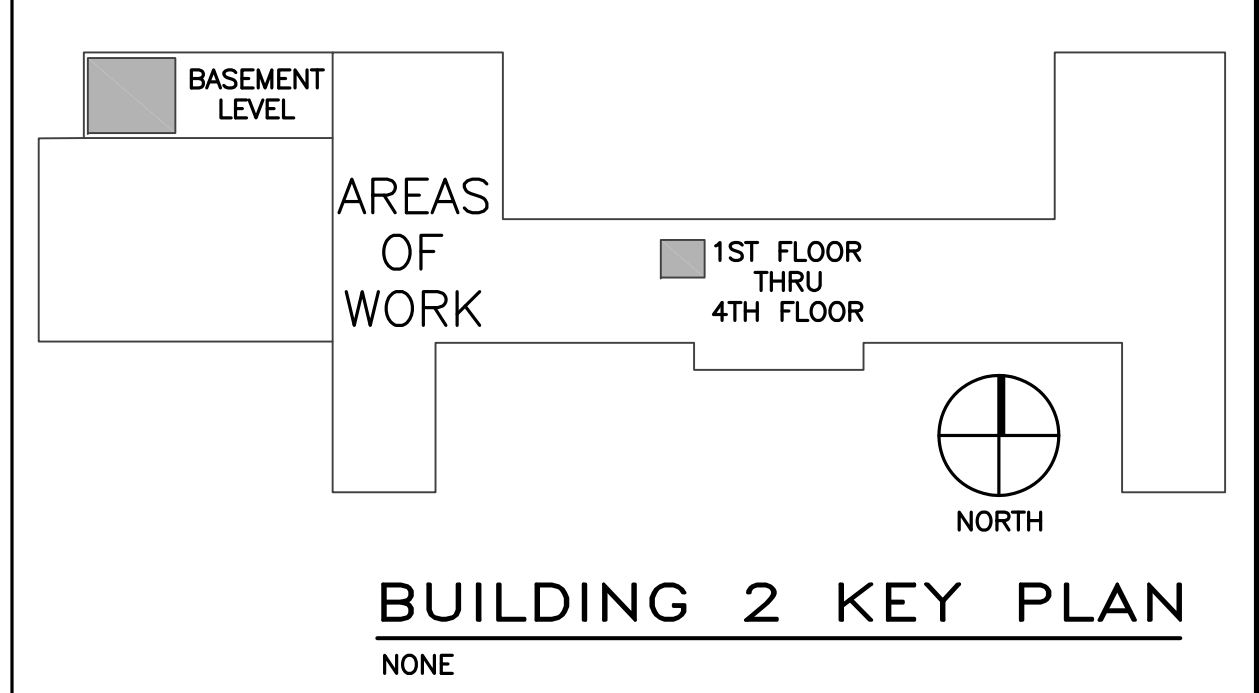

<div>Computer Filename:</div> <div>Revisions</div> <div>Date</div>		<div>COKER ENGINEERING LLC</div> <div>TX REGISTERED ENGR FIRM E-5541</div> <div>1540 KELLER PKWY STE 108 #319</div> <div>KELLER, TX 76248-3685</div> <div>817-742-2409</div> <div>817-742-0047 FAX</div>	<div>FEI ENGINEERING INC</div> <div>2201 N Collins, Suite 205</div> <div>Arlington, Texas 76011-2659</div> <div>(817) 461-0303 Fax: (817) 461-0325</div> <div>MECHANICAL - ELECTRICAL - PLUMBING</div>	<div>MPI Architects</div> <div>Architecture ■ Planning ■ Interior Design</div> <div>4949 Addison Circle ■ Addison, Texas 75001</div>	<div>Seal</div>	<div>Seal</div>	<div>FLOOR PLANS</div> <div>FIRE PROTECTION</div> <div>SECOND THRU FOURTH FLOORS</div> <div>Approved: Area Project Manager</div>	<div>Project Title</div> <div>V.A. BONHAM, TX</div> <div>BUILDING 2</div> <div>ELECTRICAL UPGRADES</div> <div>Building Number</div> <div>2</div> <div>Checked</div> <div>RBC</div> <div>Drawn</div> <div>RBC</div> <div>Location</div> <div>1201 East Ninth Street</div> <div>Bonham, Texas 75418</div>	<div>Date</div> <div>10/27/14</div> <div>Project No.</div> <div>54944-11-102</div> <div>Drawing No.</div> <div>FP101</div> <div>Dwg. of</div>	<div>V.A. NORTH TEXAS HEALTH CARE SYSTEM</div>	<div>VANTHCS</div> <div>Dallas, Texas</div>				
VA FORM 08-6231A, JAN 1990		Project No.: 11019.01		Project No.: 6110402		Project No.: 6110402		Project No.: 6110402		Project No.: 6110402		Project No.: 6110402		Project No.: 6110402	

100% CONSTRUCTION ISSUE