


Test #	Time	Flow (gpm)	Pressure Residual (psi)	Static (psi)	Flow (gpm)	End (pm)	Start (pm)
1	12:49 PM	1	48	39	25	740	740
2	01:02 PM	1	50	37	27	770	770
3	01:42 PM	12	51	40	22	695	695
4	01:47 PM	10	53	47	38	915	915
3	01:54 PM	9	54	37	48	902	902
5	01:54 PM	8	50	39	27	770	770
6	02:00 PM	7	50	38	30	810	810
7	02:05 PM	6	52	47	37	902	902
8	02:10 PM	5	54	47	33	850	850
9	02:21 PM	5	54	40	33	850	850
10	02:28 PM	4	47	38	27	770	770
11	02:34 PM	4	47	39	25	740	740
12	02:45 PM	15	56	44	33	850	850
13	02:51 PM	14	59	46	33	850	850
14	02:59 PM	13	62	40	33	933	933
15	03:13 PM	12	53	39	33	850	850
16	03:13 PM	10	50	41	25	740	740

\*Hydrant #2 was not tested due to construction in the area.

Test Conducted by: Firetech Consulting, Inc.  
 Randy Legler, PE  
 Jason Miller  
 Test Witnessed by: James Greenwell (VAMC)

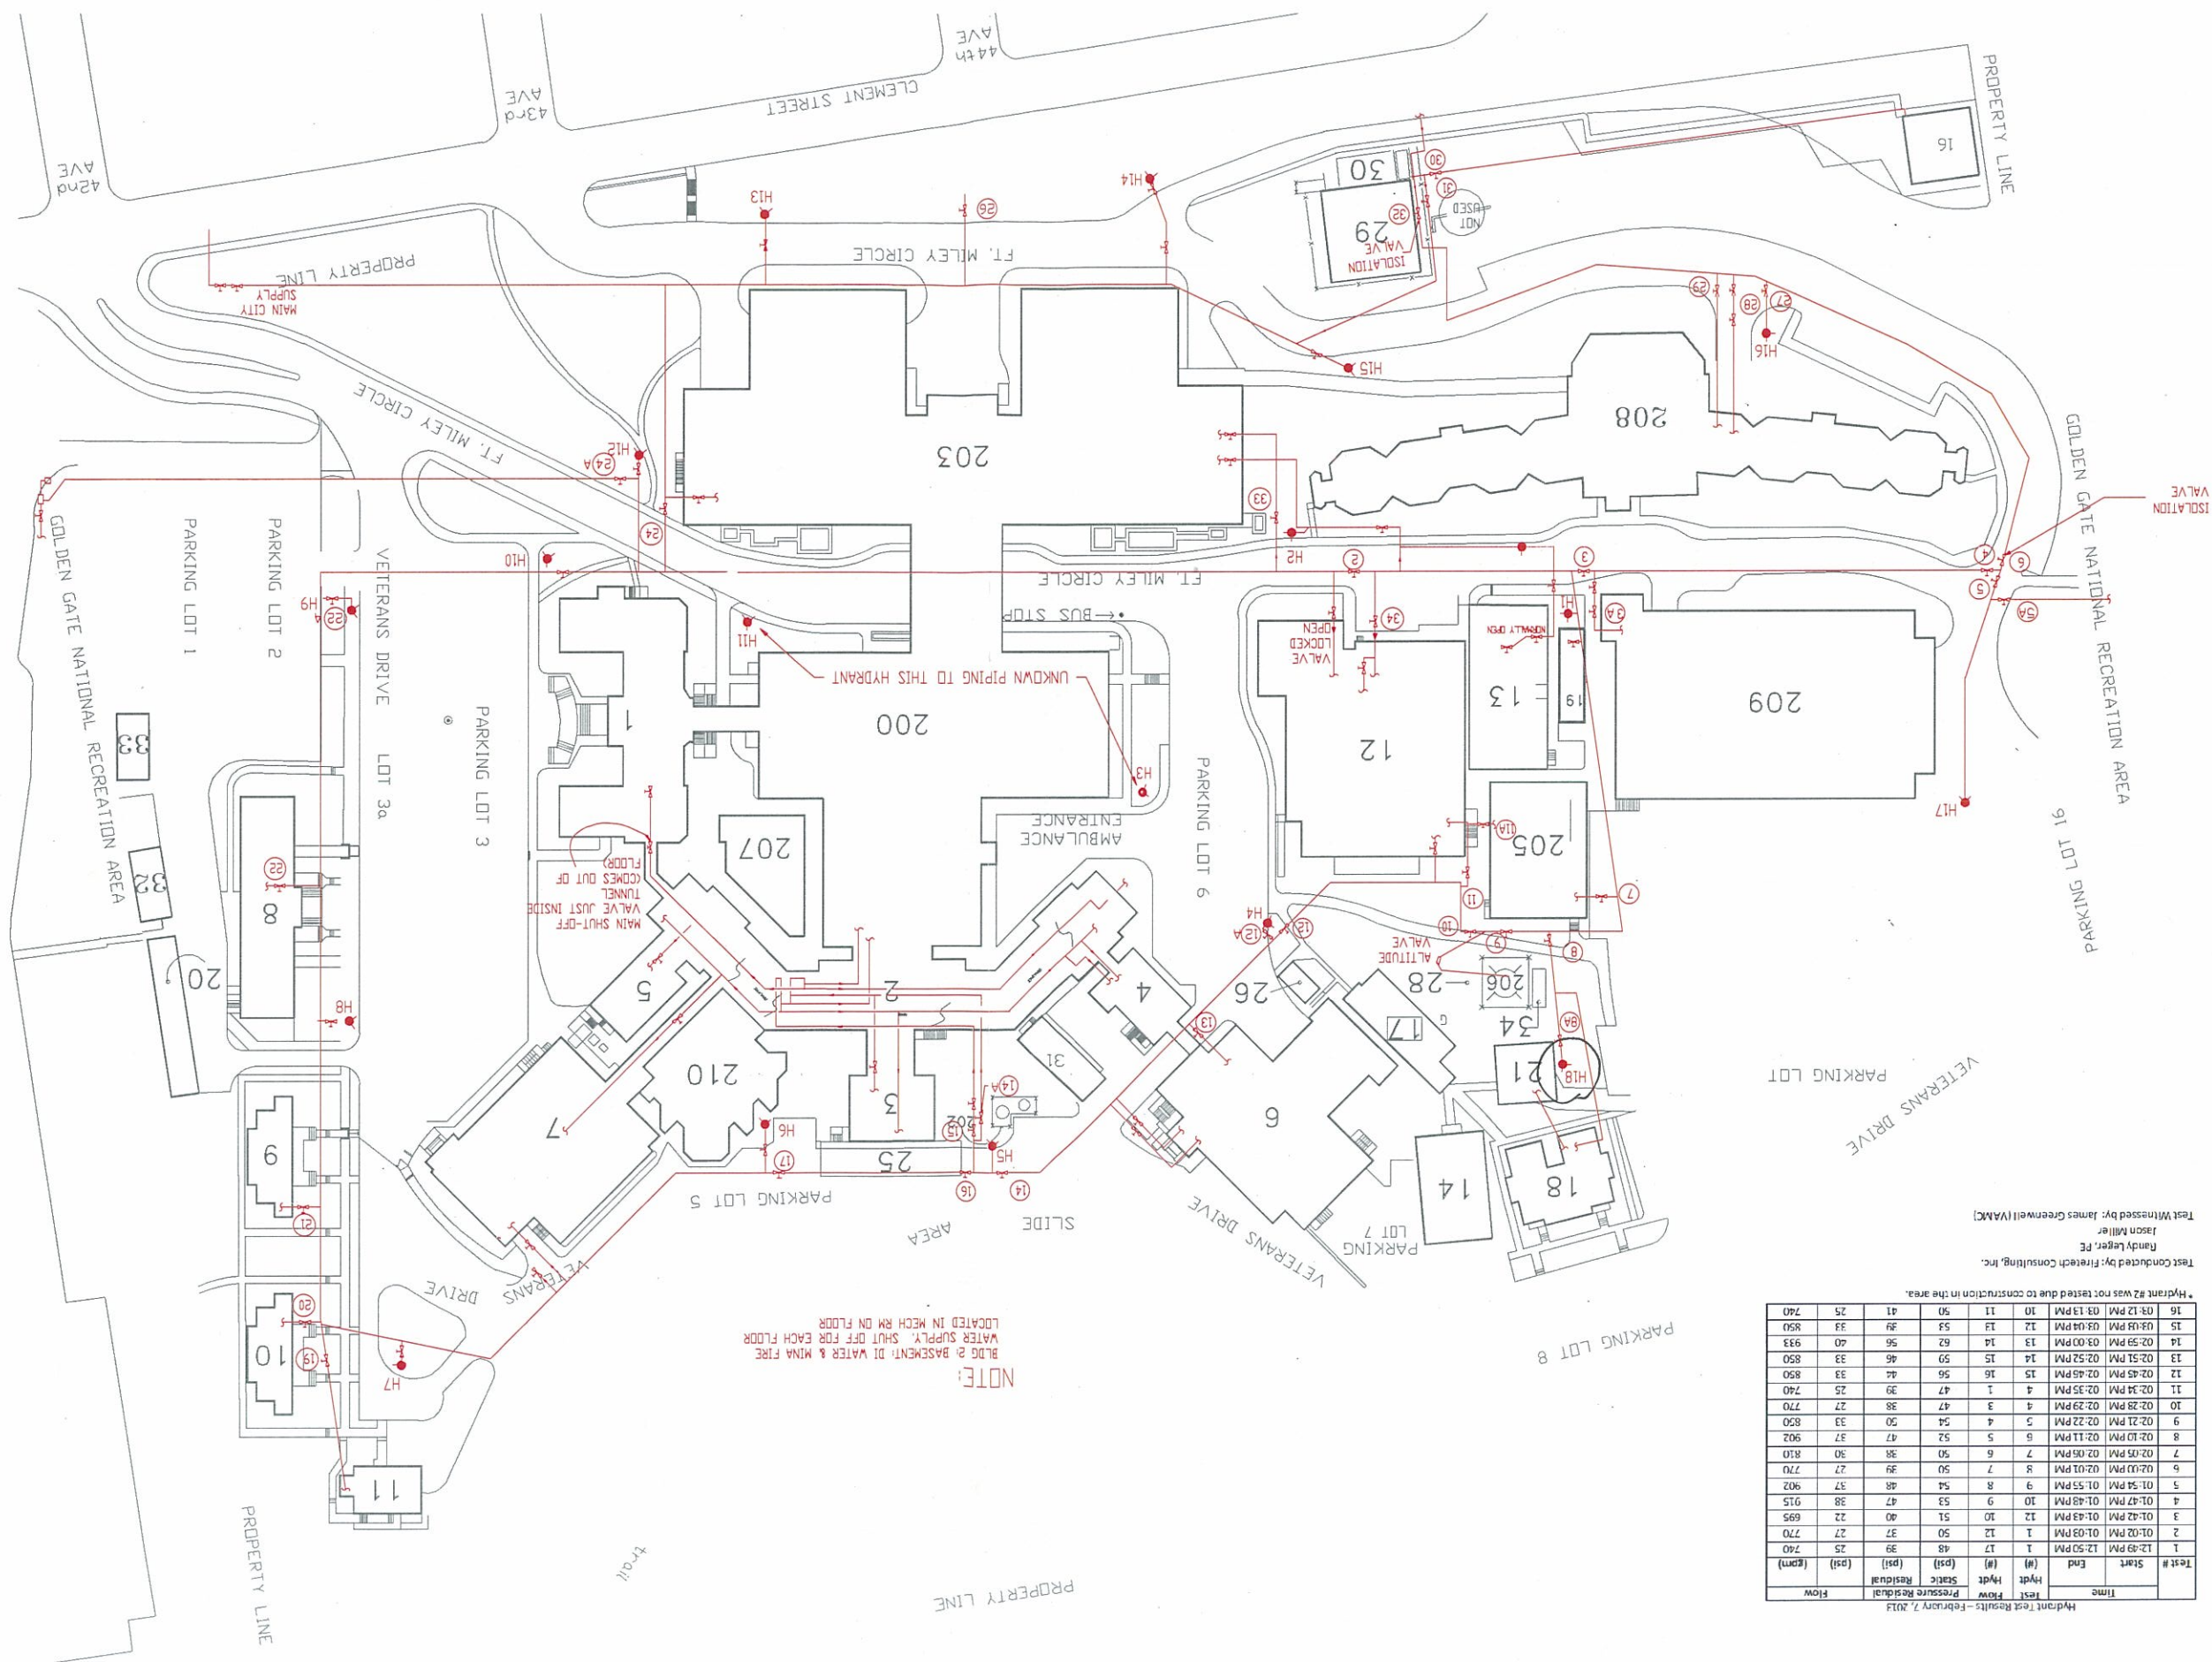

SCALE: DATE: FEBRUARY 2013  
 DRAWN BY: JAM RDL  
 REVISION: CHECKED BY: RDL

FIRE HYDRANT TEST  
 FEBRUARY 2013

VA MEDICAL CENTER  
 4150 Clement Street  
 San Francisco, California

Firetech Consulting  
 8867 W Radcliff Drive  
 Littleton, CO 80123  
 Office 720.981.3413  
 Fax 720.981.3464  
 www.FiretechConsulting.com  
 Veteran-Owned Small Business

HDY - 1.0

