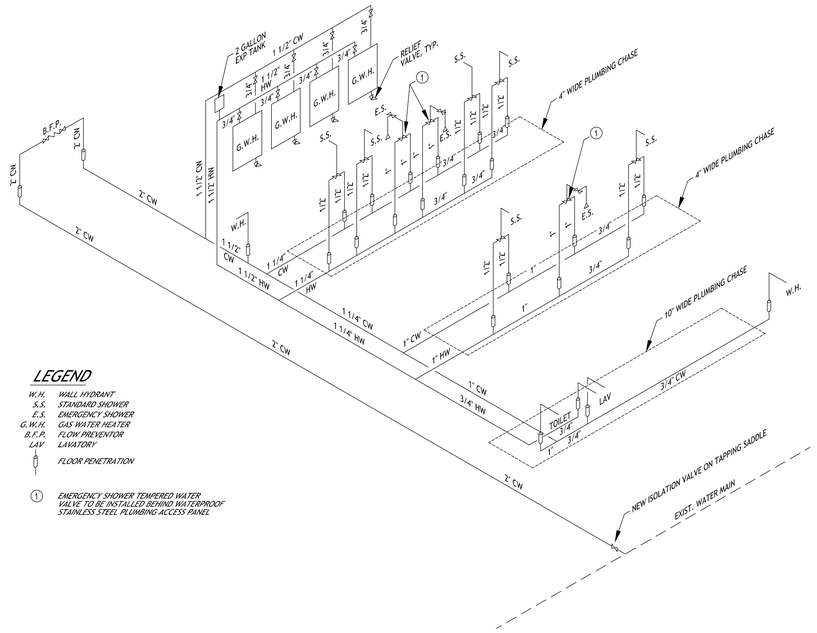

LEGEND

W.H.	WALL HYDRANT
S.S.	STANDARD SHOWER
E.S.	EMERGENCY SHOWER
G.W.H.	GAS WATER HEATER
B.F.P.	FLOW PREVENTOR
LAV	LAVATORY
	FLOOR PENETRATION
(1)	EMERGENCY SHOWER TEMPERED WATER VALVE. TO BE INSTALLED BEHIND WATERPROOF STAINLESS STEEL PLUMBING ACCESS PANEL

1 WATER SERVICE ISOMETRIC
NTS

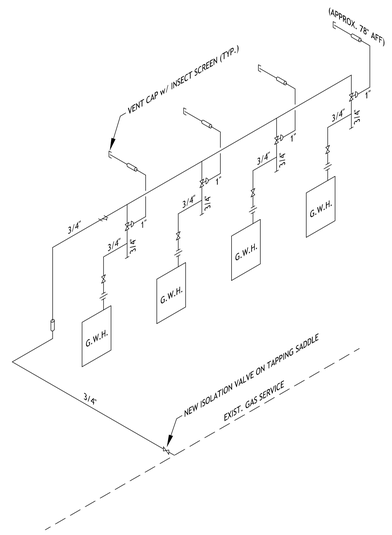

2 WATER HEATER GAS SERVICE ISOMETRIC
NTS

NOTES:

TAPPING SADDLE ISOLATION VALVES SHALL BE INSTALLED VERTICAL, DEPTH PERMITTING, WITH CAST IRON VALVE BOXES.

GAS REGULATOR OUTLET PRESSURE: 5" H20

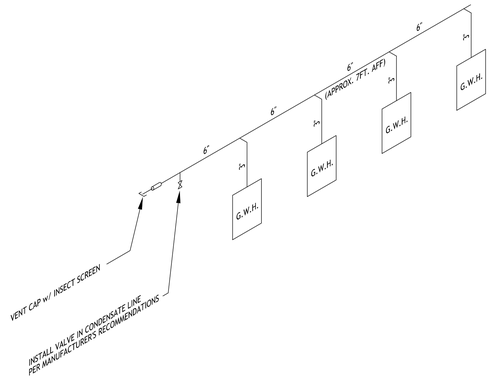

3 WATER HEATER VENT PIPING ISOMETRIC
NTS

FOR CONSTRUCTION

Revisions	Date

Consultants:

BURK-KLEINPETER, INC.
ENGINEERS, ARCHITECTS, PLANNERS, ENVIRONMENTAL SCIENTISTS
4176 CANAL STREET, NEW ORLEANS, LA 70119-5994
PHONE (504)486-595◂ FAX (504)488-1714

Seal: ANTHONY C. MOSCHELLA, LICENSED PROFESSIONAL ENGINEER, 18687, STATE OF MISSISSIPPI, 7/17/15

ROYAL ENGINEERS & CONSULTANTS, LLC
4298 ELYSIAN FIELDS AVENUE
NEW ORLEANS, LOUISIANA 70122
www.royalengineering.net

Approved:

PROGRAM MANAGER, PROJECTS	
SAFETY/INDUSTRIAL HYGIENE	
HEALTH SYSTEM SPECIALIST	
MAINTENANCE SUPERVISOR	
MAINTENANCE FOREMAN	
MAINTENANCE FOREMAN	

MISC PLUMBING DETAILS

Approved: Service Engineer

Approved: Service Director

Project Title: **VA Gulf Coast Decontamination Unit**

Building Number: XX | Checked: MJ | Drawn: ACM

Location: VAMC BILOXI, MS

Date: 7/17/2015

Project No.: 520-13-136

DRAWING NO.: **M303**

Dwg. Of

Office of Facilities — Department of Veterans Affairs

VA FORM 08-6231, DEC 1989