

A

B

C

D

E

F

A


B

C

D


E

F

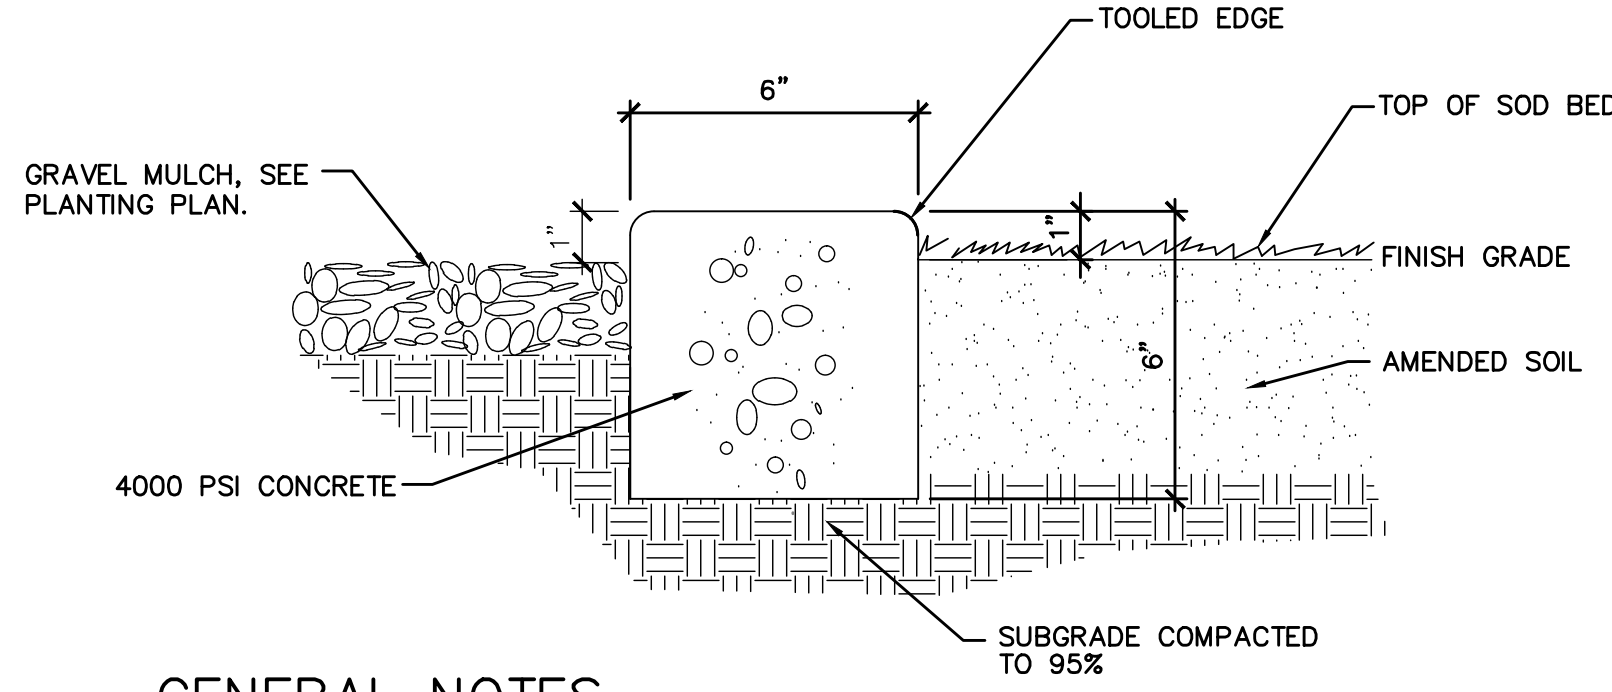

GENERAL NOTES

1. PLACE EXPANSION JOINTS @ 20'-0" O.C. WITH CONTROL JOINTS @ 5'-0" O.C.

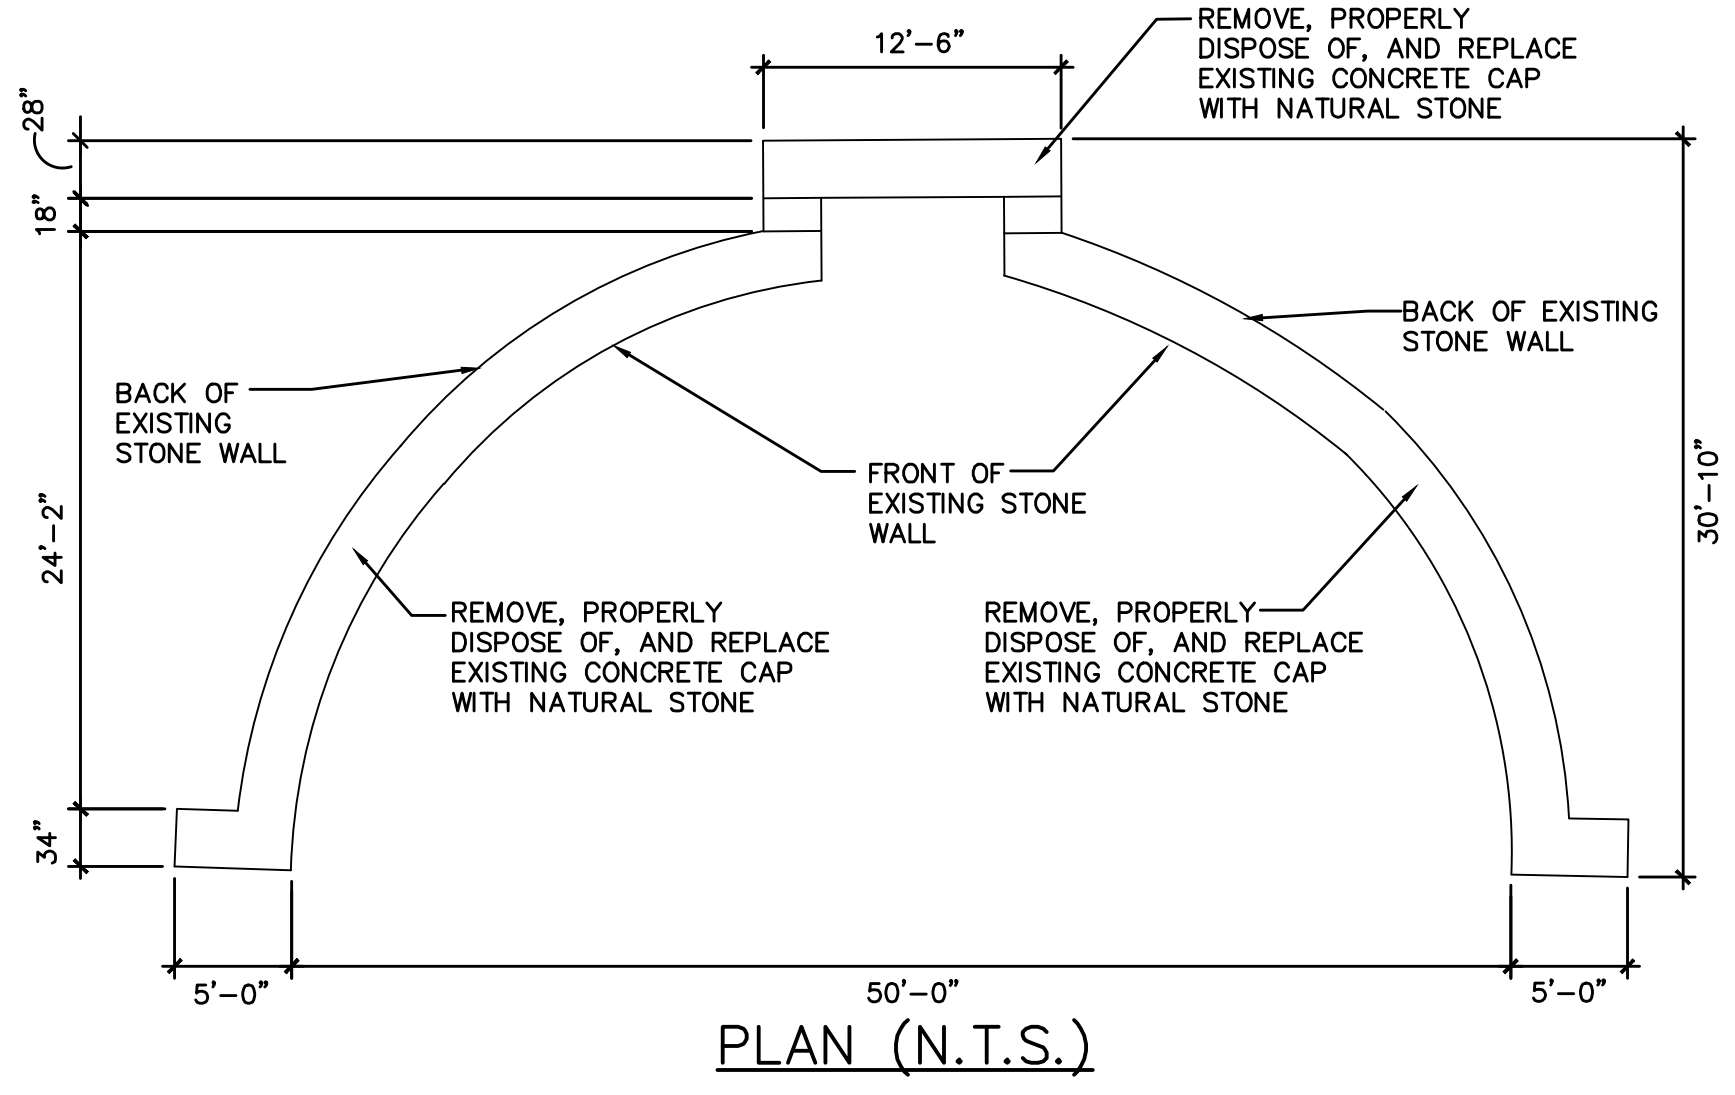

NOTES:

1. DIMENSIONS ARE APPROXIMATE. CONTRACTOR SHALL FIELD VERIFY ACTUAL DIMENSIONS OF CAP NECESSARY TO PROVIDE MIN. 2" OVERHANG ON ALL SIDES OF EXISTING WALL.




2. CONTRACTOR SHALL PRESERVE AND PROTECT EXISTING MEMORIAL THROUGHOUT CONSTRUCTION OPERATIONS.

3. ROSTRUM CAP SHALL SLOPE AWAY FROM CONCRETE PLAZA, DRAINING TOWARD THE LANDSCAPE AREA TO THE NORTH.

4. MORTAR SHALL BE PER SPECIFICATIONS SECTION 04 0513 MASONRY MORTARING.

5. NATURAL STONE CAP SHALL BE 6" THICK "STERLING" LIMESTONE (OR EQUAL) AVAILABLE FROM NEW MEXICO TRAVERTINE, INC. (505-864-6300).

6. NATURAL STONE CAP SECTIONS SHALL BE OF EQUAL LENGTH AND DIVIDE THE TOTAL LENGTH OF EACH CURVE EVENLY.

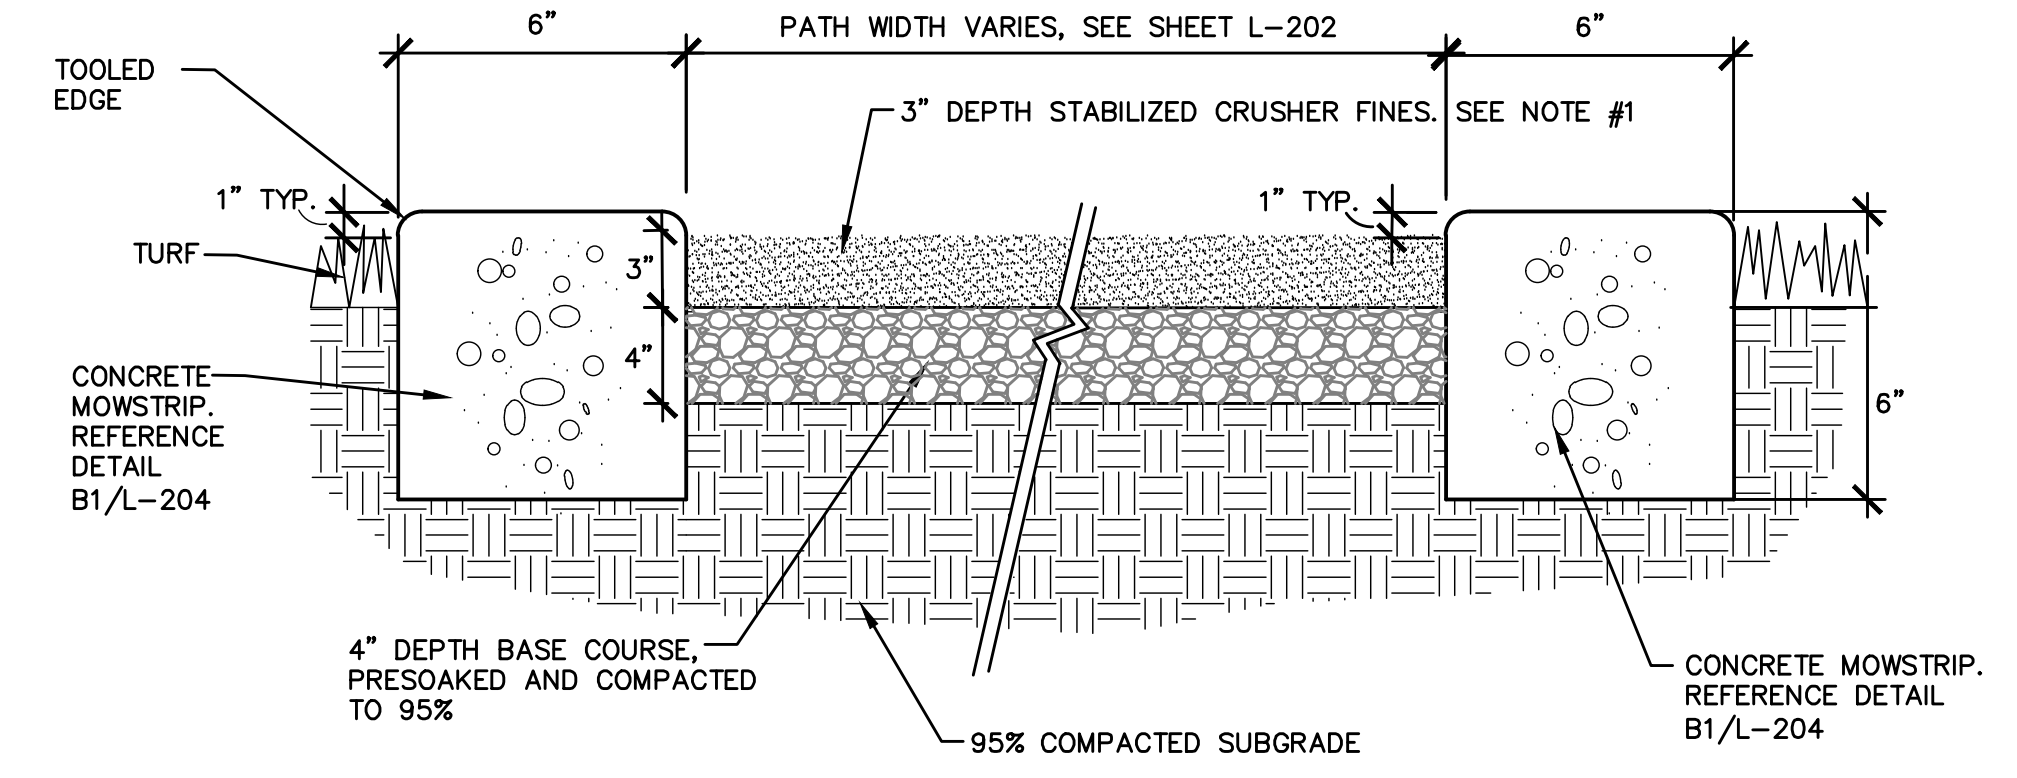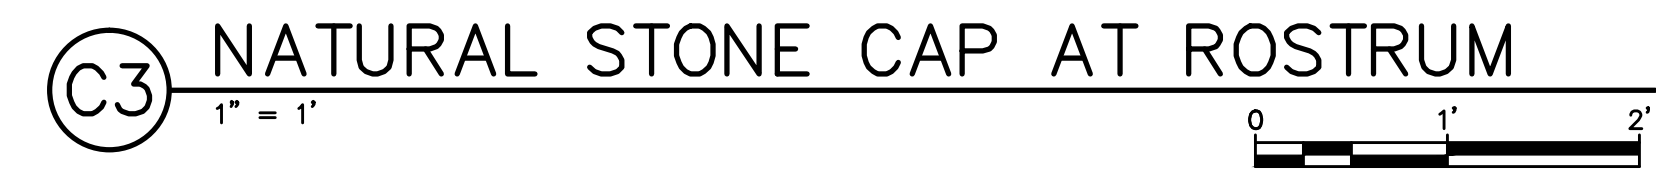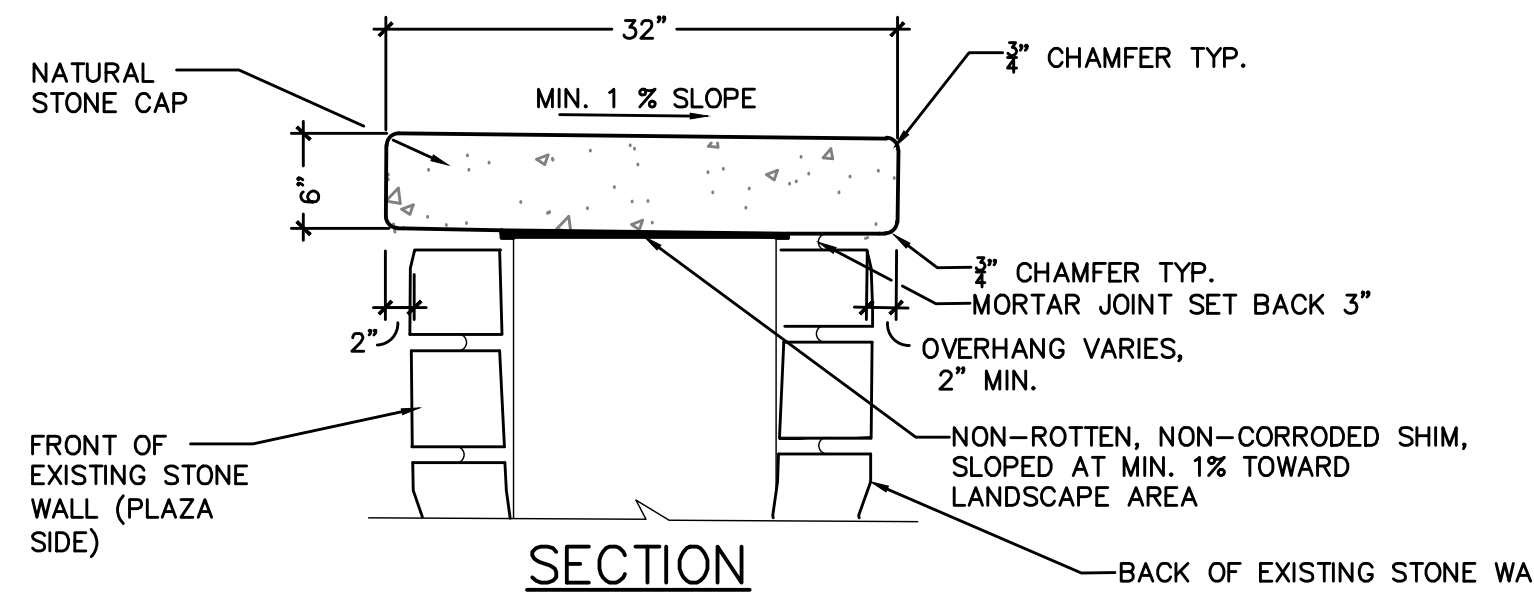


GENERAL NOTES

1. CRUSHER FINES PATH SHALL BE STABILIZED WITH STABILIZER NATURAL BINDER, OR EQUAL. AVAILABLE FROM KAFKA GRANITE (800) 852-7415. INSTALL PER MANUFACTURER'S INSTRUCTIONS.

2. PLACE EXPANSION JOINTS AT 20'-0" O.C. IN CONCRETE MOWSTRIP.


3. PLACE CONTROL JOINTS AT 5'-0" O.C. IN CONCRETE MOWSTRIP.

4. CRUSHER FINES SHALL BE "ROSE ROCK" CRUSHER FINES GRAVEL MULCH (OR APPROVED EQUAL). AVAILABLE FROM SOUTHWEST CONCRETE AND PAVING (575-388-1505).

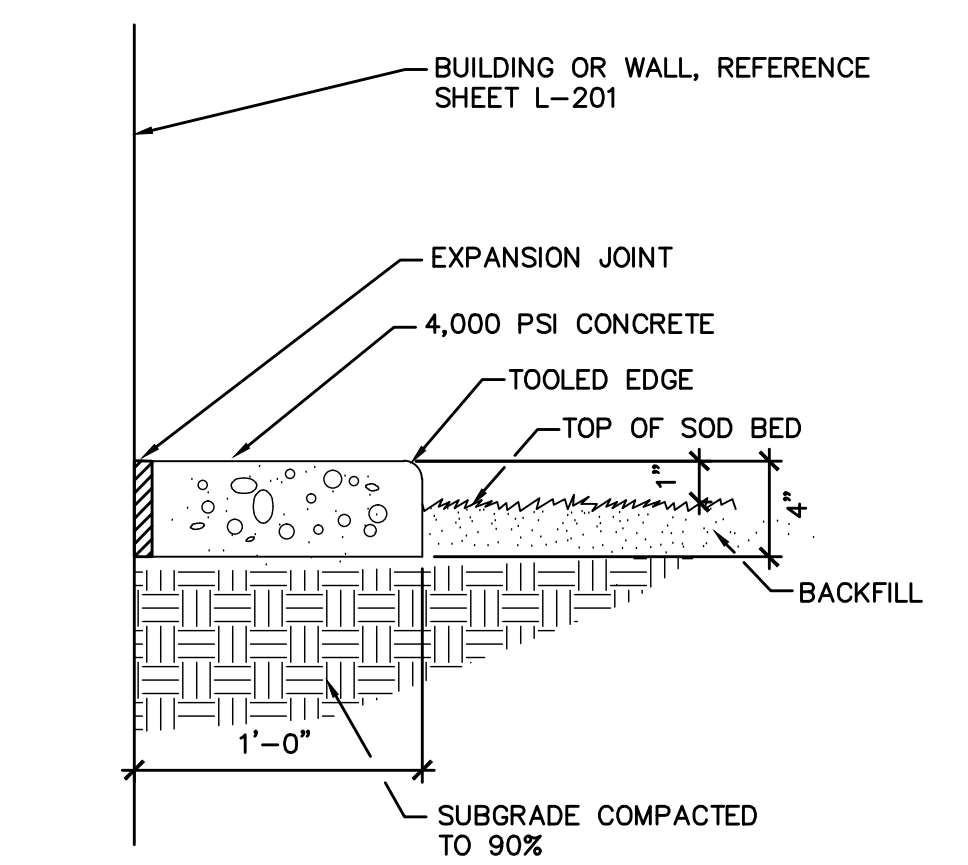

GENERAL NOTES

1. EXPANSION JOINTS SHALL BE SPACED AT 20'-0" O.C. AND CONTROL JOINTS SHALL BE SPACED AT 5'-0" O.C.

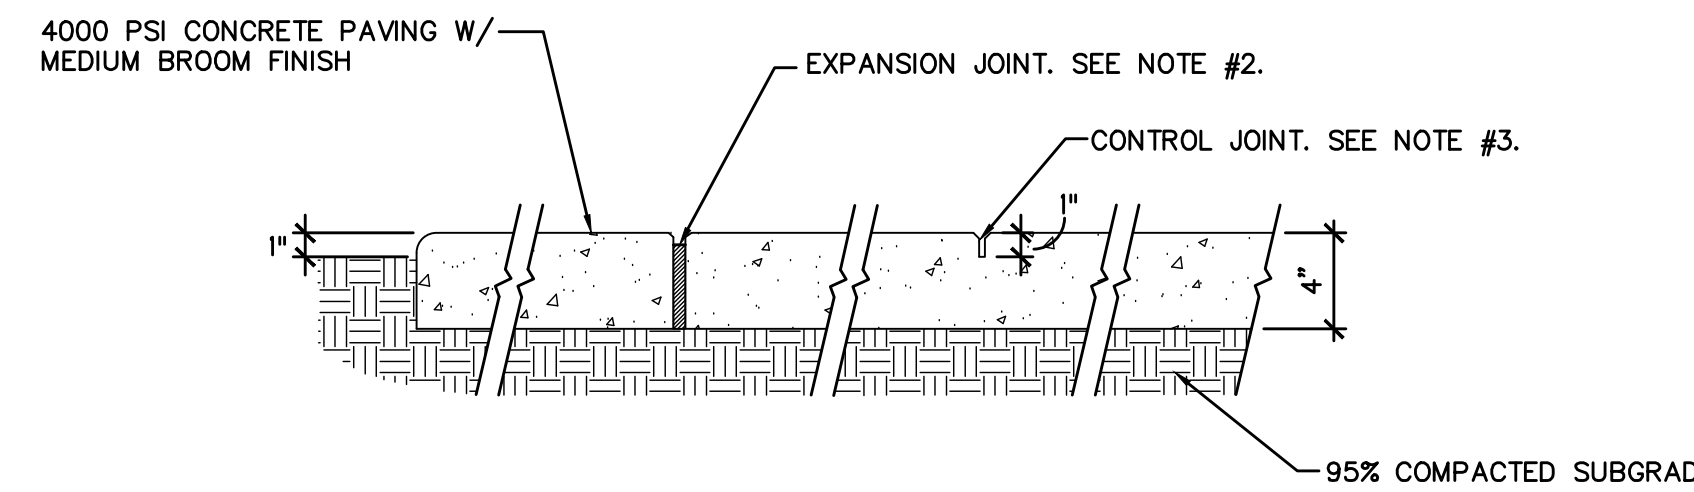

GENERAL NOTES

1. CONTROL JOINTS SHALL BE SPACED AT 5' O.C. AND EXPANSION JOINTS SHALL BE SPACED EVERY 20' O.C. ADDITIONALLY CONTRACTOR SHALL CONSTRUCT EXPANSION JOINTS WHERE SIDEWALK ABUTS EXISTING BUILDINGS, CURBS, SEATING WALLS, WALKS AND OTHER HARD CONSTRUCTION.

2. 1/2" WIDE EXPANSION JOINT. FELT EXPANSION MATERIAL SHALL BE SET WITH "SEALTIGHT SNAP-CAP" EXPANSION JOINT CAP OR EQUAL. TOP OF "SNAP-CAP" SHALL BE FLUSH WITH TOP OF CONCRETE. OPPOSING CONCRETE EDGES OF JOINT SHALL HAVE 1/4" RADIUS TOOLED EDGE. AFTER CONCRETE HAS CURED, TOP OF "SNAP-CAP" SHALL BE REMOVED AND DISCARDED. RESULTING CHANNEL SHALL BE FILLED WITH "SONOLASTIC SLT" ONE-PART ELASTOMERIC SELF-LEVELING POLYURETHANE SEALANT, OR EQUAL. TOP OF SEALANT SHALL BE FLUSH WITH (OR SLIGHTLY BELOW) TOP OF CONCRETE. FINISHED SEALANT SHALL HAVE A SMOOTH STRAIGHT UNIFORM EDGE AND SHALL NOT EXTEND OVER SURFACE OF CONCRETE OR INTO ADJACENT CONTROL JOINTS. SEALANT SHALL BE APPLIED PER MANUFACTURER'S RECOMMENDATIONS. CONTRACTOR SHALL PROTECT JOINT FROM DIRT AND TRAFFIC UNTIL SEALANT HAS CURED. CONTRACTOR SHALL SUBMIT SEALANT COLOR SAMPLES TO ARCHITECT FOR SELECTION PRIOR TO APPLICATION.

3. 1/8" X 1" DEEP TOOLED AND SAW CUT CONTROL JOINT. JOINTS SHALL BE TOOLED FIRST, THEN SAW CUT TO 1" DEPTH. THE SAW CUT JOINTS SHALL BE CUT WITHIN 1-4 HOURS (DEPENDENT UPON WEATHER CONDITIONS) AFTER FINISHING OF CONCRETE. JOINTS SHALL BE CUT WITH AN EARLY ENTRY TYPE DRY CUT SAW. SPALLING OF CONCRETE FINISH AT EDGE OF CUT IS NOT ACCEPTABLE.



KEYED NOTES

1. NOT USED.

2. 3/16" X 5/8" X 40" BLACK COLOR COATED STRETCH BAR.

3. BLACK COLOR COATED POST TOP CAP.

4. 9 GA. BLACK COLOR COATED STEEL TENSION BANDS - 15" O.C. MAX.

5. 9 GAUGE X 2" MESH BLACK VINYL COATED FABRIC.

6. CONCRETE FOOTING, 3,000 PSI.

7. 7 GA. BLACK COLOR COATED TOP & BOTTOM TENSION WIRE W/HOG RINGS.



8. 95% COMPACTED SUBGRADE.

9. BLACK COLOR COATED CORNER / END POST.


10. BLACK COLOR COATED STEEL COMPRESSION BRACE 1 5/8" O.D. TO BE INSTALLED AT CORNERS.

11. BLACK COLOR COATED TRUSS ROD.

LINE POST	LINE POST	TERMINAL/END POST	TERMINAL/END POST
2" O.D. SS20	18" X 18"	2 1/2" O.D. SS40	24" X 12"

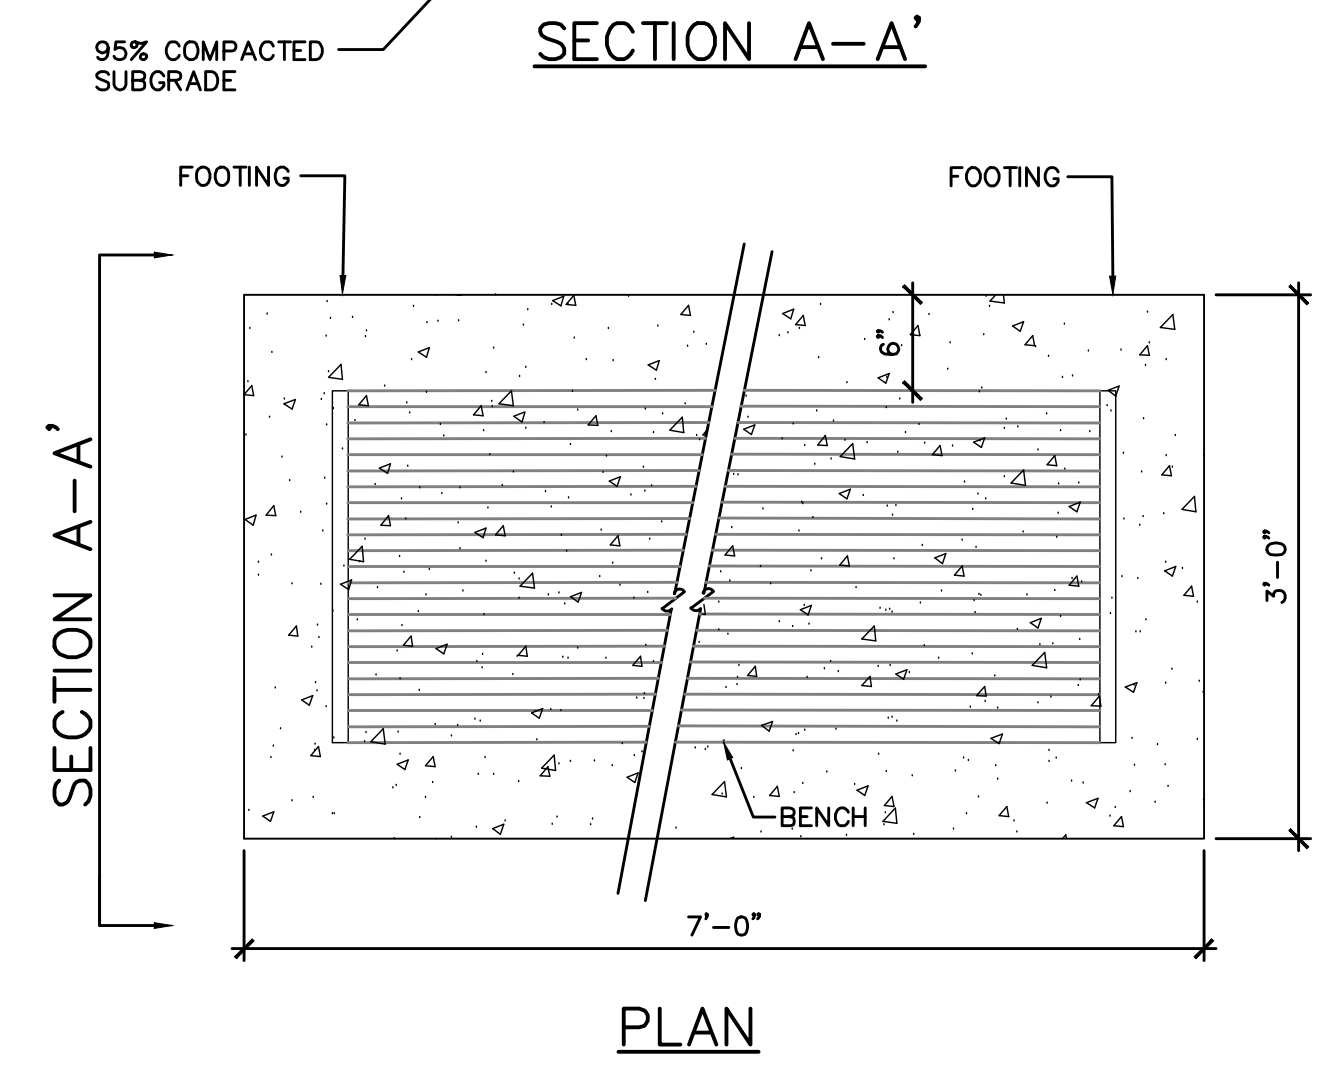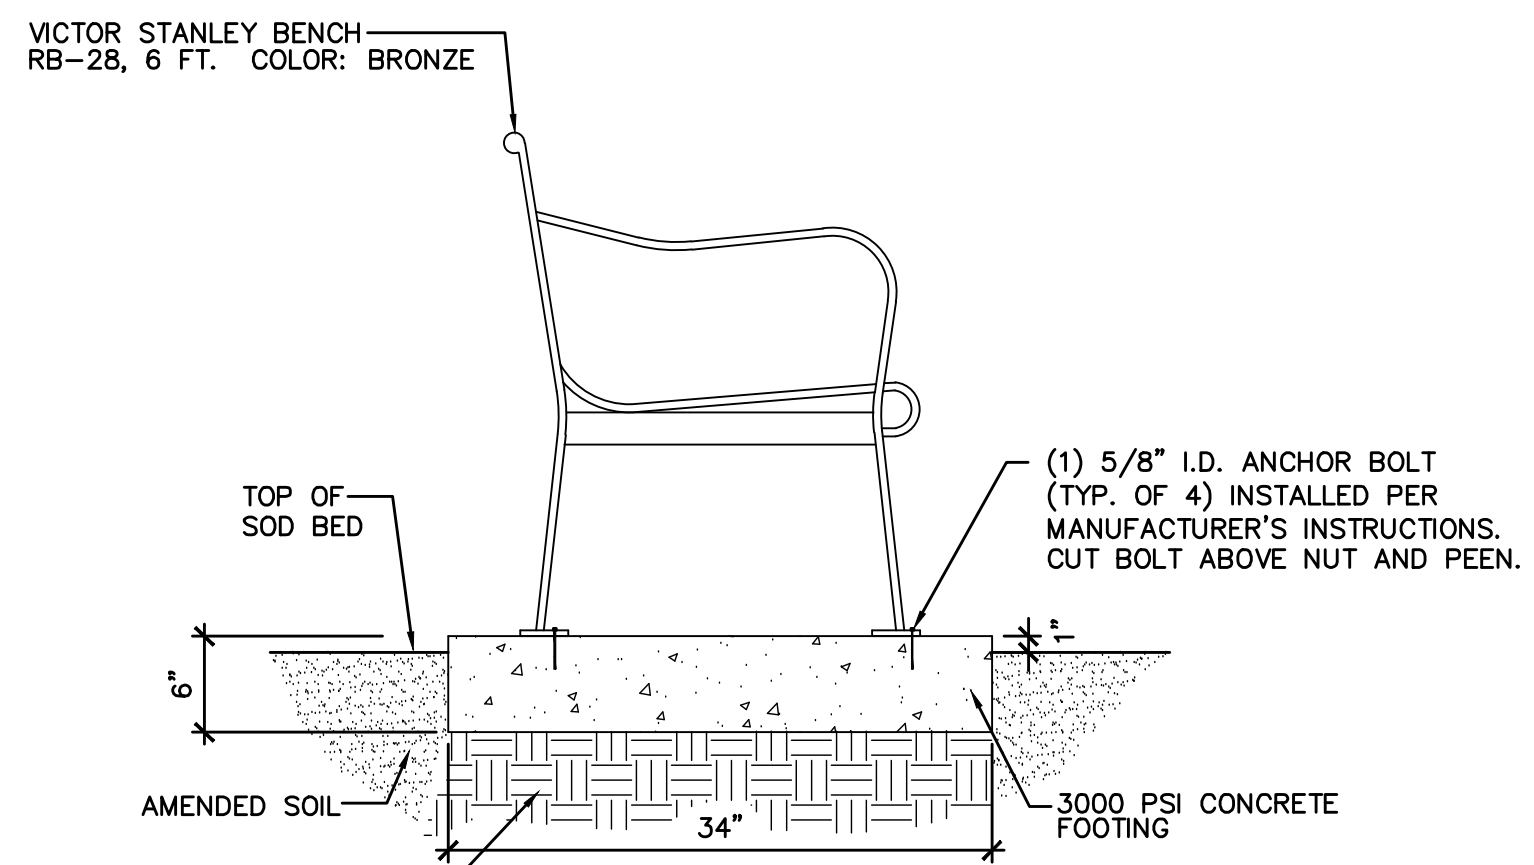

NOTES: FOR BENCHES IN COLUMBARIUM PLAZA, AT COMMITMENT SHELTER, AND AT THE PORCH OF THE PIC BUILDING, OMIT CONCRETE FOOTING. BENCHES AT THESE LOCATIONS SHALL BE ANCHORED TO PAVEMENT AS SHOWN ABOVE.

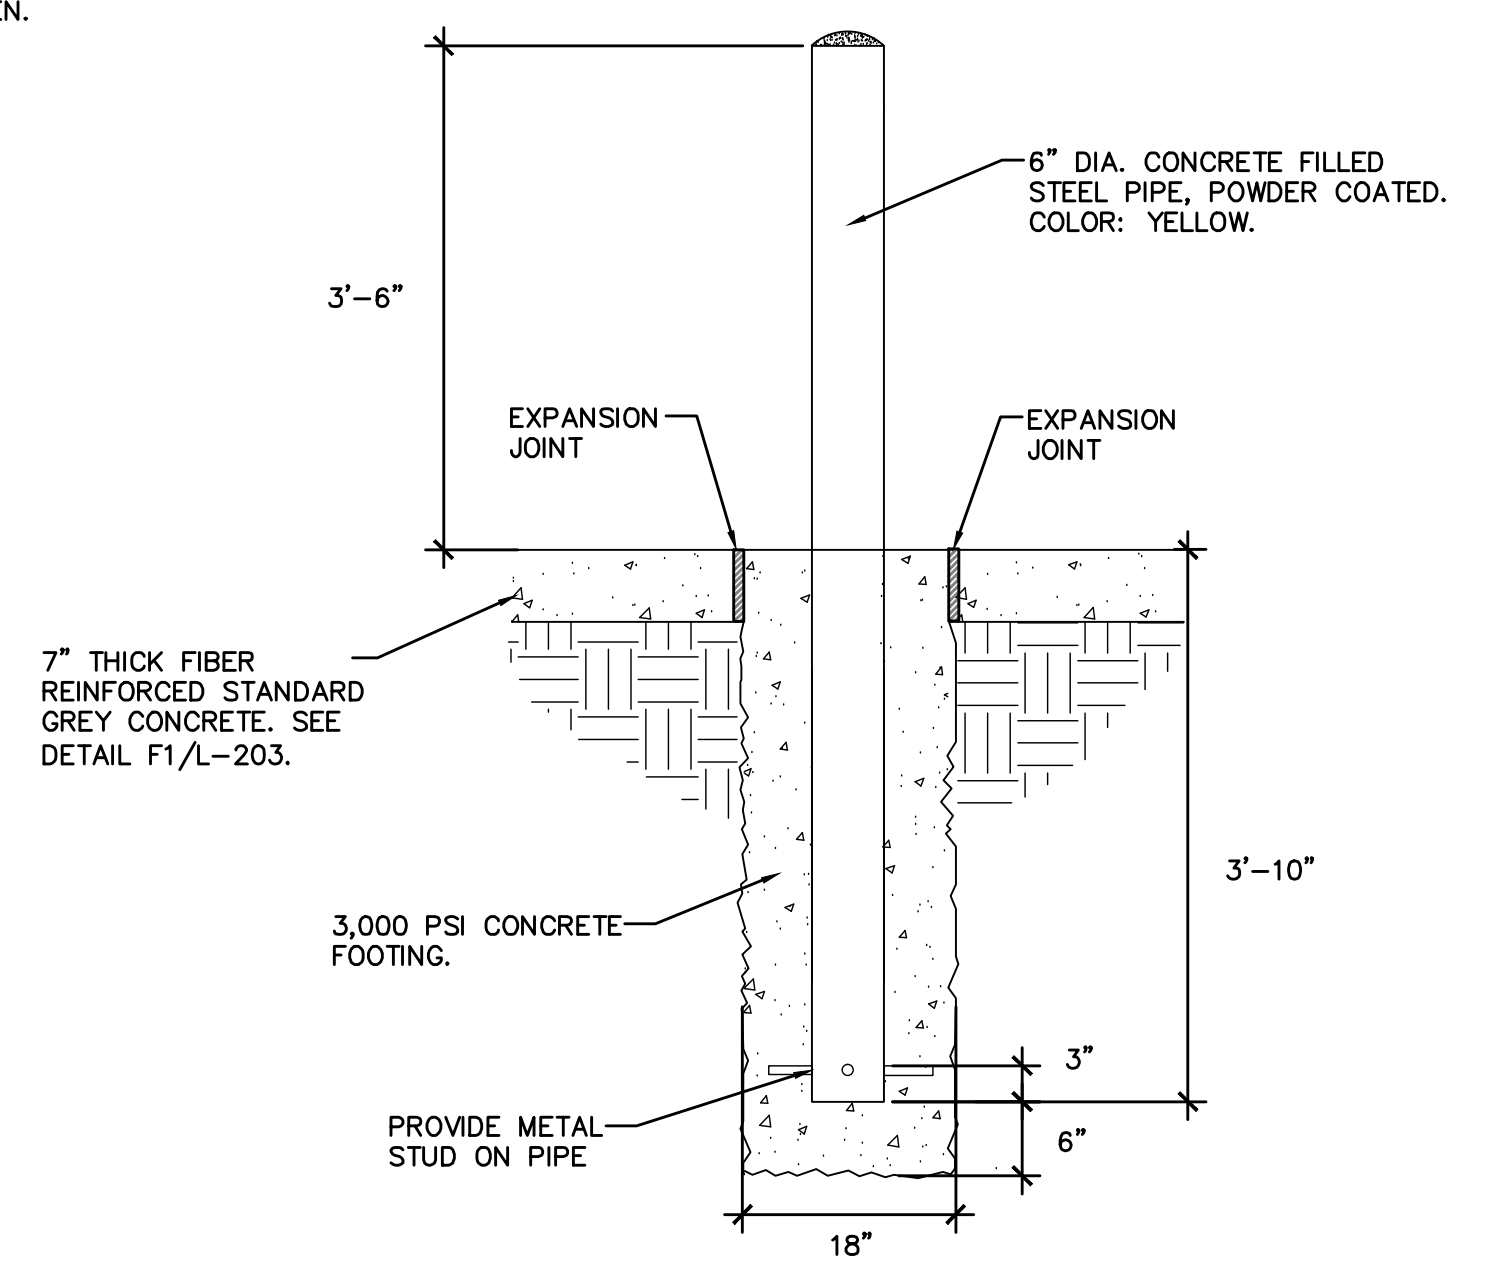

GENERAL NOTES

1. ALL CUT AREAS TO BE CLEANED THOROUGHLY WITH A WIRE BRUSH AND OR SAND BLASTED AND REGALVANIZED.

2. REGALVANIZING SHALL BE WITH SHERWIN WILLIAMS ZINC CLAD 7 PRIMER OR EQUAL.

3. ALL METAL SHALL BE POWDER COATED. COLOR: YELLOW.



100% CONSTRUCTION DRAWINGS

SUB-CONSULTANTS		PRIME CONSULTANT		Drawing Title		Project Title		Project Number		NATIONAL CEMETERY ADMINISTRATION OFFICE OF DESIGN AND CONSTRUCTION		
 MORROW REARDON WILKINSON MILLER, LTD. LANDSCAPE ARCHITECTS 210 La Veta NE, Albuquerque, NM 87108 505.268.2266 FAX 505.265.9697 DLT@MORWILK.COM		 CHERRY/SEE/REAMES ARCHITECTS, LLP 200 802 AVENUE SW, ALBUQUERQUE, NM 87102 505.842-1278 FAX 505.794-0208		 2020 K STREET, SUITE 300 WASHINGTON, DC 20006 TELEPHONE: (202)872-0277 FAX: (202)872-0282.		SITE DEVELOPMENT DETAILS		CEMETERY IMPROVEMENTS AND NEW MAINTENANCE BUILDING		885CM3007		Department of Veterans Affairs
Revisions:				Approved: Director Office of Design and Construction		Location FORT BAYARD, NEW MEXICO		Building Number -		Drawing Number L-204		
Date						Date NOVEMBER 18, 2011		Checked DCW		Drawn AB		

VA FORM 08-6231, OCT 1978