TELIOS
MEP ENGINEERING • ENERGY MODELING
LEED CONSULTATION • COMMISSIONING

3535 Travis Street, Ste. 115
Dallas, Texas 75204
phone: 214.744.6199
fax: 214.744.0770

Texas Registration #F6494

Department of Veterans Affairs

STATE OF TEXAS
SHANNON K. McCALL
82715
REGISTERED PROFESSIONAL ENGINEER

07/15/11

ARCHITECT OF RECORD:

SBBL Architecture + Planning
1001 North Alvernon Way # 105, Tucson, Arizona 85711
t: 520.620.0225 f: 520.620.0555 e: sbbl@sbbl.biz

EMERGENCY DEPARTMENT

AMARILLO VA HEALTH CARE SYSTEM
AMARILLO, TEXAS

Approved: VA Area Proj. Mgr.

V.A. PROJECT NO: VA258-P-0196
SBBL PROJECT NO: 0110.00.0
DRAWN BY: Author
CHECKED BY: Checker
DATE: 07/15/11

△	Date	Revision

Approved: Med. Cter. Director

Approved: Asst. Admin Engineering Service

Approved: Asst. VA Medical Director

Approved: Chief of Facilities

Approved: Chief of Engineering

Approved: Chief of Projects

48-ES3.1

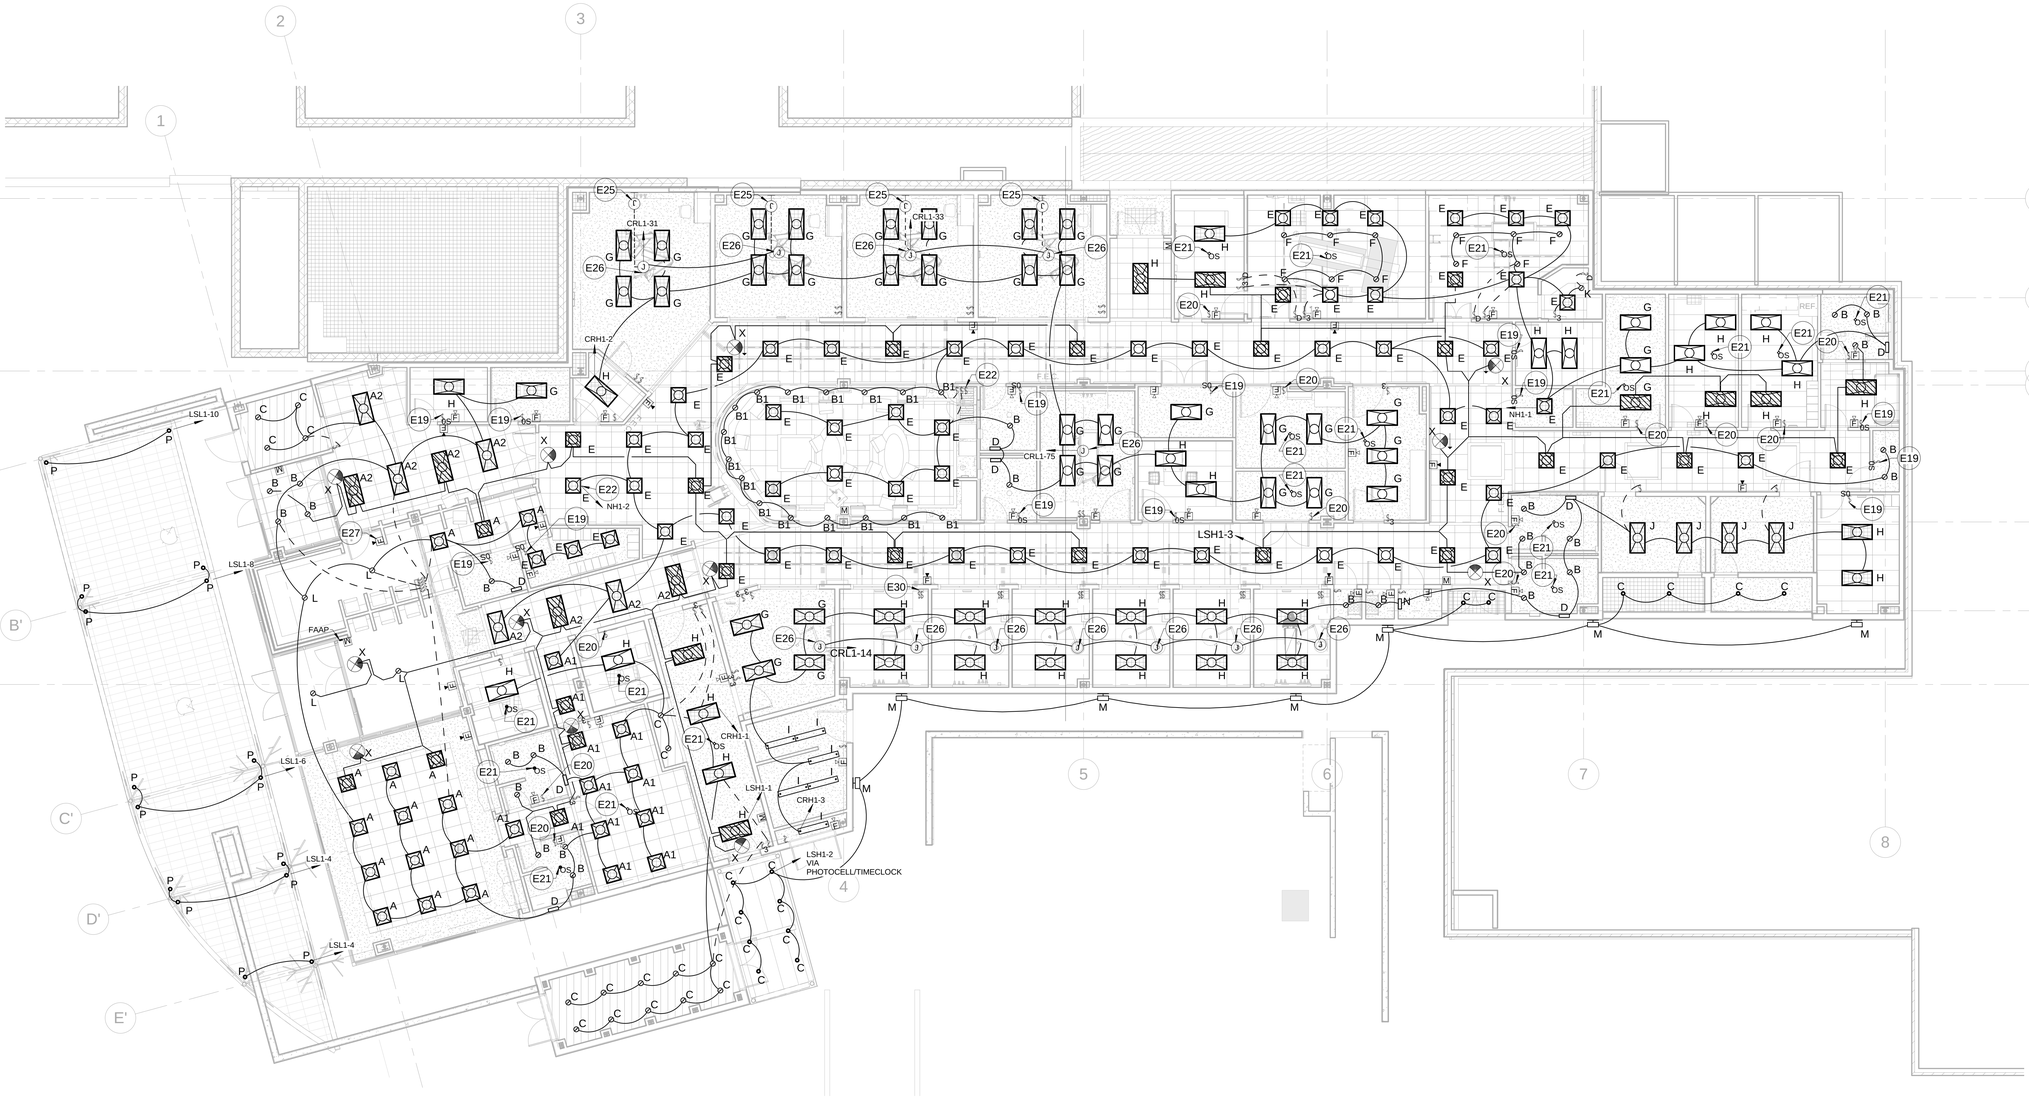

Keynote Legend	
Key Value	Keynote Text
E19	PROVIDE WALL MOUNTED OCCUPANCY SENSOR. SENSOR SHALL BE LEVITON MODEL#OSDS10-1D OR APPROVED EQUAL.
E20	PROVIDE SINGLE POLE/SINGLE THROW WALL SWITCH AS OVERRIDE TO CEILING MOUNTED OCCUPANCY SENSOR. SWITCH SHALL BE WIRED IN SERIES WITH THE OCCUPANCY SENSOR SO THAT WHEN THE SWITCH IS IN THE "OFF" POSITION OCCUPANCY SENSOR IS NOT ACTIVE AND FIXTURES ARE OFF. WHEN SWITCH IS IN THE "ON" POSITION OCCUPANCY SENSOR SHALL CONTROL THE FIXTURES.
E21	PROVIDE CEILING MOUNTED OCCUPANCY SENSOR. SENSOR SHALL BE LEVITON MODEL#ODCOS-11 OR APPROVED EQUAL.
E22	PROVIDE LIGHTING CONTACTOR TO ROUTE CIRCUITS THRU WITH A SINGLE POLE SWITCH AS INDICATED FOR CONTROL OF CORRIDOR LIGHTING.
E25	PROVIDE J-BOX FOR MEDICAL BOOM LIGHT CONTROLS. COORDINATE REQUIREMENTS WITH MANUFACTURER PRIOR TO INSTALLATION.
E26	PROVIDE CEILING MOUNTED JUNCTION BOX FOR POWER TO BOOM LIGHTS.
E27	FIRE ALARM DEVICES SHALL BE CONTROLLED THRU EXISTING LOCAL FACP. PROVIDE POWER SUPPLY AS REQUIRED TO SUPPORT ADDITIONAL DEVICES AS REQUIRED. (TYPICAL)
E30	PROVIDE (2) SINGLE POLE SWITCHES FOR PATIENT ROOM LIGHTING CONTROL DUAL LEVEL CONTROL. ONE SWITCH WILL CONTROL A SINGLE LAMP FROM EACH FIXTURE FOR GENERAL LIGHTING. THE SECOND SWITCH WILL CONTROL THE REMAINING (2) LAMPS PER FIXTURE FOR EXAM LIGHTING. (TYPICAL OF ALL EXAM/TRAUMA AND PROCEDURE ROOMS)

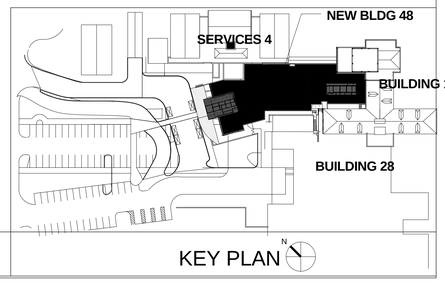

KEY PLAN

LIGHTING LEVEL 1 FLOOR PLAN