

TECHNICAL SPECIFICATIONS

Department of Veterans Affairs
Louis Stokes Cleveland VA Medical Center
WADE PARK

10701 East Boulevard Cleveland, OH 44106

EMERGENCY SEWER REPAIR K-WING
Project No. 541-16-522

PREPARED BY:

Fredrick, Fredrick & Heller Engineers

672 East Royalton Road
Broadview Heights, Ohio 4414
P (440) 546-9696 F (440) 546-9699
Project Director: David Demagall

Perspectus Architecture

13212 Shaker Square, Suite 204
Cleveland, Ohio 44120
P (216) 752-1800 F (216) 752-3833
Project Director: Tim Huffman

Bid Issue Submission:

ISSUE DATE: July 1, 2016

**DEPARTMENT OF VETERANS AFFAIRS
SPECIFICATIONS**

**TABLE OF CONTENTS
Section 00 01 10**

| | DIVISION 00 - SPECIAL SECTIONS | DATE |
|-------------|---|-------------|
| 00 01 15 | List of Drawing Sheets | 07-15 |
| | | |
| | DIVISION 01 - GENERAL REQUIREMENTS | |
| | | |
| 01 00 00 | General Requirements | 11-15 |
| 01 33 23 | Shop Drawings, Product Data, and Samples | 07-15 |
| 01 35 26 | Safety Requirements | 10-14 |
| 01 42 19 | Reference Standards | 05-16 |
| 01 45 29 | Testing Laboratory Services | 06-16 |
| 01 57 19 | Temporary Environmental Controls | 01-11 |
| 01 58 16 | Temporary Interior Signage | 07-15 |
| 01 74 19 | Construction Waste Management | 09-13 |
| | | |
| | DIVISION 02 - EXISTING CONDITIONS | |
| | | |
| 02 41 00 | Demolition | 02-15 |
| | | |
| | DIVISION 03 - CONCRETE | |
| | | |
| 03 30 53 | Miscellaneous Cast-In-Place Concrete | 02-16 |
| | | |
| | DIVISION 09 - FINISHES | |
| | | |
| 09 67 23.60 | Resinous Flooring | 07-14 |
| | | |
| | DIVISION 22 - PLUMBING | |
| | | |
| 22 05 11 | Common Work Results for Plumbing | 09-15 |
| 22 13 00 | Facility Sanitary and Vent Piping | 09-15 |
| | | |
| | DIVISION 31 - EARTHWORK | |
| | | |
| 31 20 00 | Earthwork | 10-12 |
| 31 23 19 | Dewatering | 10-12 |
| 31 23 23.33 | Flowable Fill | 10-12 |
| | | |

Bid Issue
07/01/2016

VAMC WADE PARK
Emergency Sewer Repair K-Wing
Project No. 541-16-522

| | | |
|----------|--------------------------------|-------|
| | | |
| | DIVISION 33 - UTILITIES | |
| | | |
| 33 30 00 | Sanitary Sewer Utilities | 10-11 |

SECTION 00 01 15
LIST OF DRAWINGS

The drawings listed below accompanying this specification form a part of the contract.

| Drawing No. | Title |
|-----------------------------|---|
| <u>GENERAL</u> | |
| 0-X0.0 | COVER SHEET |
| <u>ARCHITECTURAL</u> | |
| 1-A1.1 | PARTIAL BASEMENT EQUIPMENT ACCESS SITE PLAN |
| 1-A1.2 | GENERAL PROJECT NOTES & DETAILS |
| 1-A1.3 | PARTIAL BASEMENT FLOOR PLANS |
| <u>MECHANICAL</u> | |
| 1-P0.1 | PLUMBING LEGEND, GENERAL NOTES AND DETAILS |
| 1-P1.1 | PARTIAL BASEMENT PLUMBING PLANS |

- - - E N D - - -

**SECTION 01 00 00
GENERAL REQUIREMENTS**

PART 1 - GENERAL

1.1 SAFETY REQUIREMENTS

- A. Refer to section 01 35 26, SAFETY REQUIREMENTS for safety and infection control requirements.

1.2 GENERAL INTENTION

Contractor shall completely prepare site for building operations, including demolition and removal of existing structures, and furnish labor and materials and perform work for improvement of site utilities at the Louse Stokes Cleveland VAMC as required by drawings and specifications.

- A. Visits to the site by Bidders may be made only by appointment with the Medical Center Contracting Officer.
- B. Offices of Fredrick, Fredrick, and Heller Engineers, Inc. (FF&H) will render certain technical services during construction. Such services shall be considered as advisory to the Government and shall not be construed as expressing or implying a contractual act of the Government without affirmations by Contracting Officer or his duly authorized representative.
- C. Before placement and installation of work subject to inspections or tests by the design team or the Department of Veterans Affairs, the Contractor shall notify the COR in sufficient time to enable inspection/testing personnel to be present at the site in time for proper taking and testing of specimens and field inspection. Such prior notice shall be not less than three work days unless otherwise designated by the COR.
- D. All employees of general contractor and subcontractors shall comply with VA security management program and obtain permission of the VA police, be identified by project and employer, and restricted from unauthorized access.
 - 1. Contractor shall designate a full time superintendent dedicated to the project who will be on site for the duration of the project.
- E. Prior to commencing work, general contractor shall provide proof that an OSHA certified "competent person" (CP) (29 CFR 1926.20(b)(2)) will maintain a presence at the work site whenever the general or subcontractors are present.
- F. Training:
 - 1. All employees of general contractor or subcontractors shall have the following required hours of OSHA certified Construction Safety course and/or other relevant competency training, as determined by VA CP with input from the ICRA team.
 - a. General Contractor/Superintendent: 30 hours.
 - b. All Other Workers: 10 hours.
 - 2. Submit training records of all such employees for approval before the start of work.

1.3 STATEMENT OF BID ITEM(S)

1. This project will replace a damaged 15" sanitary line below the K-Wing corridor. The contractor shall provide all labor, equipment and materials necessary to complete the work as shown on the drawings. Work includes general construction, alterations, mechanical and electrical work, utility systems, necessary removal of existing structures and construction and certain other items as shown on the drawings.

1.4 SPECIFICATIONS AND DRAWINGS FOR CONTRACTOR

- A. Drawings and contract documents may be obtained digitally from the website where the solicitation is posted. Hard copies will be at Contractor's expense.

1.5 CONSTRUCTION SECURITY REQUIREMENTS

A. Security Plan:

1. The security plan defines both physical and administrative security procedures that will remain effective for the entire duration of the project.
2. The General Contractor is responsible for assuring that all sub-contractors working on the project and their employees also comply with these regulations.

B. Security Procedures:

1. General Contractor's employees shall not enter the project site without appropriate badge. They may also be subject to inspection of their personal effects when entering or leaving the project site.
2. For working outside the "Normal Business Hours" as defined in the contract, the general contractor shall give 3 days notice to the contracting officer so that arrangements can be provided for employees. This notice is separate from any notices required for utility shutdown described later in this section.
3. No photography of VA premises is allowed without written permission of the Contracting Officer.
4. VA reserves the right to close down or shut down the project site and order General Contractor's employees off the premises in the event of a national emergency. The General Contractor may return to the site only with the written approval of the Contracting Officer.

C. Key Control:

1. The General Contractor shall provide duplicate keys and lock combinations to the Contracting officers representative (COR) for the purpose of security inspections of every area of project including tool boxes and parked machines and take any emergency action.

D. Document Control:

1. Before starting any work, the General Contractor/Sub Contractors shall submit an electronic security memorandum describing the approach to following goals and maintaining confidentiality of "sensitive information".
2. The General Contractor is responsible for safekeeping of all drawings, project manual and other project information. This information shall be shared only with those with a specific need to accomplish the project.

3. Certain documents, sketches, videos or photographs and drawings may be marked "Law Enforcement Sensitive" or "Sensitive Unclassified". Secure such information in separate containers and limit the access to only those who will need it for the project. Return the information to the Contracting Officer upon request.
4. These security documents shall not be removed or transmitted from the project site without the written approval of Contracting Officer.
5. All paper waste or electronic media such as CD's and diskettes shall be shredded and destroyed in a manner acceptable to the VA.
6. Notify Contracting Officer and Site Security Officer immediately when there is a loss or compromise of "sensitive information".
7. All electronic information shall be stored in specified location following VA standards and procedures using an Engineering Document Management Software (EDMS).
 - a. Security, access and maintenance of all project drawings, both scanned and electronic shall be performed and tracked through the EDMS system.
 - b. "Sensitive information" including drawings and other documents may be attached to e-mail provided all VA encryption procedures are followed.

E. Motor Vehicle Restrictions

1. Vehicle authorization request shall be required for any vehicle entering the site and such request shall be submitted 24 hours before the date and time of access. Access shall be restricted to picking up and dropping off materials and supplies.
2. Contractor commuter vehicles shall be parked off site. No parking is available at the Medical Center. .

1.6 OPERATIONS AND STORAGE AREAS

- A. The Contractor shall confine all operations (including storage of materials) on Government premises to areas authorized or approved by the Contracting Officer. The Contractor shall hold and save the Government, its officers and agents, free and harmless from liability of any nature occasioned by the Contractor's performance.
- B. Temporary buildings (e.g., storage sheds, shops, offices) and utilities may be erected by the Contractor only with the approval of the Contracting Officer and shall be built with labor and materials furnished by the Contractor without expense to the Government. The temporary buildings and utilities shall remain the property of the Contractor and shall be removed by the Contractor at its expense upon completion of the work. With the written consent of the Contracting Officer, the buildings and utilities may be abandoned and need not be removed.
- C. The Contractor shall, under regulations prescribed by the Contracting Officer, use only established roadways, or use temporary roadways constructed by the Contractor when and as authorized by the Contracting Officer. When materials are transported in prosecuting the work, vehicles shall not be loaded beyond the loading capacity recommended by the manufacturer of the vehicle or prescribed by any Federal, State, or local law or regulation. When it is necessary to cross curbs or sidewalks, the Contractor shall protect them from damage. The Contractor shall repair or pay for the repair of any damaged curbs, sidewalks, or roads.

- D. Working space and space available for storing materials shall be] as determined by the COR.
- E. Workmen are subject to rules of Medical Center applicable to their conduct.
- F. Execute work so as to interfere as little as possible with normal functioning of Medical Center as a whole, including operations of utility services, fire protection systems and any existing equipment, and with work being done by others. Use of equipment and tools that transmit vibrations and noises through the building structure, are not permitted in buildings that are occupied, during construction, jointly by patients or medical personnel, and Contractor's personnel, except as permitted by COR where required by limited working space.
 - 1. Do not store materials and equipment in other than assigned areas.
 - 2. Schedule delivery of materials and equipment to immediate construction working areas within buildings in use by Department of Veterans Affairs in quantities sufficient for not more than two work days. Provide unobstructed access to Medical Center areas required to remain in operation.
 - 3. Where access by Medical Center personnel to vacated portions of buildings is not required, storage of Contractor's materials and equipment will be permitted subject to fire and safety requirements.
- G. Utilities Services: Where necessary to cut existing pipes, electrical wires, conduits, cables, etc., of utility services, or of fire protection systems or communications systems (except telephone), they shall be cut and capped at suitable places where shown; or, in absence of such indication, where directed by COR . All such actions shall be coordinated with the COR or Utility Company involved:
 - 1. Whenever it is required that a connection fee be paid to a public utility provider for new permanent service to the construction project, for such items as water, sewer, electricity, gas or steam, payment of such fee shall be the responsibility of the Government and not the Contractor.
- H. Phasing:
 - 1. The Medical Center must maintain its operation 24 hours a day 7 days a week. Therefore, any interruption in service must be scheduled and coordinated with the COR to ensure that no lapses in operation occur. It is the CONTRACTOR'S responsibility to develop a work plan and schedule detailing, at a minimum, the procedures to be employed, the equipment and materials to be used, the interim life safety measure to be used during the work, and a schedule defining the duration of the work with milestone subtasks.
 - 2. To insure such executions, Contractor shall furnish the **COR** with a schedule of approximate dates on which the Contractor intends to accomplish work in each specific area of site, building or portion thereof. In addition, Contractor shall notify the **COR** two weeks in advance of the proposed date of starting work in each specific area of site, building or portion thereof.
- I. Medical Center (including patient parking structure) will be occupied during performance of work; but immediate areas of alterations will be vacated where possible.
 - 1. All work in public corridors, including walkways between buildings shall be performed "off hours" unless otherwise approved by the COR.

2. Contractor shall take all measures and provide all material necessary for protecting existing equipment and property in affected areas of construction against dust and debris, so that equipment and affected areas to be used in the Medical Centers operations will not be hindered. Contractor shall permit access to Department of Veterans Affairs personnel and patients through other construction areas which serve as routes of access to such affected areas and equipment. These routes whether access or egress shall be isolated from the construction area by temporary partitions and have walking surfaces, lighting etc. to facilitate patient and staff access. Coordinate alteration work in areas occupied by Department of Veterans Affairs so that Medical Center operations will continue during the construction period.
- J. Construction Fence: Before construction operations begin, Contractor shall provide a chain link construction fence, 2.1m (seven feet) minimum height, around the construction area indicated on the drawings. Provide gates as required for access with necessary hardware, including hasps and padlocks. Fasten fence fabric to terminal posts with tension bands and to line posts and top and bottom rails with tie wires spaced at maximum 375mm (15 inches). Bottom of fences shall extend to 25mm (one inch) above grade. Remove the fence when directed by COR.
- K. When a construction site is turned over to Contractor, Contractor shall accept entire responsibility including upkeep and maintenance therefore:
 1. Contractor shall maintain a minimum temperature of 4 degrees C (40 degrees F) at all times, except as otherwise specified.
 2. Contractor shall maintain in operating condition existing fire protection and alarm equipment. In connection with fire alarm equipment, Contractor shall make arrangements for pre-inspection of site with Fire Department or Company (Department of Veterans Affairs or municipal) whichever will be required to respond to an alarm from Contractor's employee or watchman.
- L. Utilities Services: Maintain existing utility services for Medical Center at all times. Provide temporary facilities, labor, materials, equipment, connections, and utilities to assure uninterrupted services. Where necessary to cut existing water, steam, gases, sewer or air pipes, or conduits, wires, cables, etc. of utility services or of fire protection systems and communications systems (including telephone), they shall be cut and capped at suitable places where shown; or, in absence of such indication, where directed by COR.
 1. No utility service such as water, gas, steam, sewers or electricity, or fire protection systems and communications systems may be interrupted without prior approval of COR. Electrical work shall be accomplished with all affected circuits or equipment de-energized. When an electrical outage cannot be accomplished, work on any energized circuits or equipment shall not commence without a detailed work plan, the Medical Center Director's prior knowledge and written approval.
 2. Contractor shall submit a request to interrupt any such services to the COR, in writing, 7 days in advance of proposed interruption. Request shall state reason, date, exact time of, and approximate duration of such interruption.
 3. Contractor will be advised (in writing) of approval of request, or of which other date and/or time such interruption will cause least inconvenience to operations of Medical Center. Interruption time approved by Medical Center may occur at other than Contractor's normal working hours.

4. Major interruptions of any system must be requested, in writing, at least 15 calendar days prior to the desired time and shall be performed as directed by the COR.
 5. In case of a contract construction emergency, service will be interrupted on approval of COR. Such approval will be confirmed in writing as soon as practical.
 6. Whenever it is required that a connection fee be paid to a public utility provider for new permanent service to the construction project, for such items as water, sewer, electricity, gas or steam, payment of such fee shall be the responsibility of the Government and not the Contractor.
- M. Abandoned Lines: All service lines such as wires, cables, conduits, ducts, pipes and the like, and their hangers or supports, which are to be abandoned but are not required to be entirely removed, shall be sealed, capped or plugged at the main, branch or panel they originate from. The lines shall not be capped in finished areas, but shall be removed and sealed, capped or plugged in ceilings, within furred spaces, in unfinished areas, or within walls or partitions; so that they are completely behind the finished surfaces.
- N. To minimize interference of construction activities with flow of Medical Center traffic, comply with the following:
1. Keep roads, walks and entrances to grounds, to parking and to occupied areas of buildings clear of construction materials, debris and standing construction equipment and vehicles. Wherever excavation for new utility lines cross existing roads, at least one lane must be open to traffic at all times with approval.
 2. Method and scheduling of required cutting, altering and removal of existing roads, walks and entrances must be approved by the **COR**.
- O. Coordinate the work for this contract with other construction operations as directed by COR. This includes the scheduling of traffic and the use of roadways, as specified in Article, USE OF ROADWAYS.

1.7 ALTERATIONS

- A. Survey: Before any work is started, the Contractor shall make a thorough survey with the COR and a representative of VA Supply Service, of areas of buildings and the site in which alterations occur and areas which are anticipated routes of access, and furnish a report, signed by both, to the Contracting Officer. This report shall list by rooms and spaces:
1. Existing condition and types of resilient flooring, doors, windows, walls and other surfaces not required to be altered throughout affected areas of building.
 2. Existence and conditions of items such as plumbing fixtures and accessories, electrical fixtures, equipment, venetian blinds, shades, etc., required by drawings to be either reused or relocated, or both.
 3. Shall note any discrepancies between drawings and existing conditions at site.
 4. Shall designate areas for working space, materials storage and routes of access to areas within buildings where alterations occur and which have been agreed upon by Contractor and COR.

- B. Any items required by drawings to be either reused or relocated or both, found during this survey to be nonexistent, or in opinion of COR, to be in such condition that their use is impossible or impractical, shall be furnished and/or replaced by Contractor with new items in accordance with specifications which will be furnished by Government. Provided the contract work is changed by reason of this subparagraph B, the contract will be modified accordingly, under provisions of clause entitled "DIFFERING SITE CONDITIONS" (FAR 52.236-2) and "CHANGES" (FAR 52.243-4 and VAAR 852.236-88).
- C. Re-Survey: Thirty days before expected partial or final inspection date, the Contractor and COR together shall make a thorough re-survey of the areas of buildings involved. They shall furnish a report on conditions then existing, of resilient flooring, doors, windows, walls and other surfaces as compared with conditions of same as noted in first condition survey report:
 - 1. Re-survey report shall also list any damage caused by Contractor to such flooring and other surfaces, despite protection measures; and, will form basis for determining extent of repair work required of Contractor to restore damage caused by Contractor's workmen in executing work of this contract.
- D. Protection: Provide the following protective measures:
 - 1. Wherever existing roof surfaces are disturbed they shall be protected against water infiltration. In case of leaks, they shall be repaired immediately upon discovery.
 - 2. Temporary protection against damage for portions of existing structures and grounds where work is to be done, materials handled and equipment moved and/or relocated.
 - 3. Protection of interior of existing structures at all times, from damage, dust and weather inclemency. Wherever work is performed, floor surfaces that are to remain in place shall be adequately protected prior to starting work, and this protection shall be maintained intact until all work in the area is completed.

1.8 DISPOSAL AND RETENTION

- A. Materials and equipment accruing from work removed and from demolition of buildings or structures, or parts thereof, shall be disposed of as follows:
 - 1. Reserved items which are to remain property of the Government are noted on drawings or in specifications as items to be stored. Items that remain property of the Government shall be removed or dislodged from present locations in such a manner as to prevent damage which would be detrimental to re-installation and reuse. Store such items where directed by **COR**.
 - 2. Items not reserved shall become property of the Contractor and be removed by Contractor from Medical Center.
 - 3. Items of portable equipment and furnishings located in rooms and spaces in which work is to be done under this contract shall remain the property of the Government. When rooms and spaces are vacated by the Department of Veterans Affairs during the alteration period, such items which are NOT required by drawings and specifications to be either relocated or reused will be removed by the Government in advance of work to avoid interfering with Contractor's operation.
 - a. Copies of the following listed CFR titles may be obtained from the Government Printing Office:

- 1) 40 CFR 261 Identification and Listing of Hazardous Waste
- 2) 40 CFR 262 Standards Applicable to Generators of Hazardous Waste
- 3) 40 CFR 263 Standards Applicable to Transporters of Hazardous Waste
- 4) 40 CFR 761 PCB Manufacturing, Processing, Distribution in Commerce, and use Prohibitions
- 5) 49 CFR 172 Hazardous Material tables and Hazardous Material Communications Regulations
- 6) 49 CFR 173 Shippers - General Requirements for Shipments and Packaging
- 7) 49 CRR 173 Subpart A General
- 8) 49 CFR 173 Subpart B Preparation of Hazardous Material for Transportation
- 9) 49 CFR 173 Subpart J Other Regulated Material; Definitions and Preparation
- 10) TSCA Compliance Program Policy Nos. 6-PCB-6 and 6-PCB-7

1.9 PROTECTION OF EXISTING VEGETATION, STRUCTURES, EQUIPMENT, UTILITIES, AND IMPROVEMENTS

- A. The Contractor shall preserve and protect all structures, equipment, and vegetation (such as trees, shrubs, and grass) on or adjacent to the work site, which are not to be removed and which do not unreasonably interfere with the work required under this contract. The Contractor shall only remove trees when specifically authorized to do so, and shall avoid damaging vegetation that will remain in place. If any limbs or branches of trees are broken during contract performance, or by the careless operation of equipment, or by workmen, the Contractor shall trim those limbs or branches with a clean cut and paint the cut with a tree-pruning compound as directed by the Contracting Officer.
- B. The Contractor shall protect from damage all existing improvements and utilities at or near the work site and on adjacent property of a third party, the locations of which are made known to or should be known by the Contractor. The Contractor shall repair any damage to those facilities, including those that are the property of a third party, resulting from failure to comply with the requirements of this contract or failure to exercise reasonable care in performing the work. If the Contractor fails or refuses to repair the damage promptly, the Contracting Officer may have the necessary work performed and charge the cost to the Contractor.
- C. Refer to Section 01 57 19, TEMPORARY ENVIRONMENTAL CONTROLS, for additional requirements on protecting vegetation, soils and the environment. Refer to Articles, "Alterations", "Restoration", and "Operations and Storage Areas" for additional instructions concerning repair of damage to structures and site improvements.

D. Refer to FAR clause 52.236-7, "Permits and Responsibilities," which is included in General Conditions. A National Pollutant Discharge Elimination System (NPDES) permit is required for this project. The Contractor is considered an "operator" under the permit and has extensive responsibility for compliance with permit requirements. VA will make the permit application available at the (appropriate medical center) office. The apparent low bidder, contractor and affected subcontractors shall furnish all information and certifications that are required to comply with the permit process and permit requirements. Many of the permit requirements will be satisfied by completing construction as shown and specified. Some requirements involve the Contractor's method of operations and operations planning and the Contractor is responsible for employing best management practices. The affected activities often include, but are not limited to the following:

1. Designating areas for equipment maintenance and repair;
2. Providing waste receptacles at convenient locations and provide regular collection of wastes;
3. Locating equipment wash down areas on site, and provide appropriate control of wash-waters;
4. Providing protected storage areas for chemicals, paints, solvents, fertilizers, and other potentially toxic materials; and
5. Providing adequately maintained sanitary facilities.

1.10 RESTORATION

- A. Remove, cut, alter, replace, patch and repair existing work as necessary to install new work. Except as otherwise shown or specified, do not cut, alter or remove any structural work, and do not disturb any ducts, plumbing, steam, gas, or electric work without approval of the COR. Existing work to be altered or extended and that is found to be defective in any way, shall be reported to the COR before it is disturbed. Materials and workmanship used in restoring work, shall conform in type and quality to that of original existing construction, except as otherwise shown or specified.
- B. Upon completion of contract, deliver work complete and undamaged. Existing work (walls, ceilings, partitions, floors, mechanical and electrical work, lawns, paving, roads, walks, etc.) disturbed or removed as a result of performing required new work, shall be patched, repaired, reinstalled, or replaced with new work, and refinished and left in as good condition as existed before commencing work.
- C. At Contractor's own expense, Contractor shall immediately restore to service and repair any damage caused by Contractor's workmen to existing piping and conduits, wires, cables, etc., of utility services or of fire protection systems and communications systems (including telephone) which are not scheduled for discontinuance or abandonment.
- D. Expense of repairs to such utilities and systems not shown on drawings or locations of which are unknown will be covered by adjustment to contract time and price in accordance with clause entitled "CHANGES" (FAR 52.243-4 and VAAR 852.236-88) and "DIFFERING SITE CONDITIONS" (FAR 52.236-2).

1.11 PHYSICAL DATA

- A. Data and information furnished or referred to below is for the Contractor's information. The Government shall not be responsible for any interpretation of or conclusion drawn from the data or information by the Contractor.

1. The indications of physical conditions on the drawings and in the specifications are based on existing site reports.
- B. A copy of the existing soil report will be made available for inspection by bidders upon request to the COR at the VA Medical Center and shall be considered part of the contract documents.
- C. Government does not guarantee that other materials will not be encountered nor that proportions, conditions or character of several materials will not vary from those indicated by explorations. Bidders are expected to examine site of work and logs of borings; and, after investigation, decide for themselves character of materials and make their bids accordingly. Upon proper application to Department of Veterans Affairs, bidders will be permitted to make subsurface explorations of their own at site.

1.12 LAYOUT OF WORK

- A. The Contractor shall lay out the work from Government established base lines and bench marks, indicated on the drawings, and shall be responsible for all measurements in connection with the layout. The Contractor shall furnish, at Contractor's own expense, all stakes, templates, platforms, equipment, tools, materials, and labor required to lay out any part of the work. The Contractor shall be responsible for executing the work to the lines and grades that may be established or indicated by the Contracting Officer. The Contractor shall also be responsible for maintaining and preserving all stakes and other marks established by the Contracting Officer until authorized to remove them. If such marks are destroyed by the Contractor or through Contractor's negligence before their removal is authorized, the Contracting Officer may replace them and deduct the expense of the replacement from any amounts due or to become due to the Contractor.
- B. Following completion of general mass excavation and before any other permanent work is performed, establish and plainly mark (through use of appropriate batter boards or other means) sufficient additional survey control points or system of points as may be necessary to assure proper alignment, orientation, and grade of all major features of work. Survey shall include, but not be limited to, location of lines and grades of footings, exterior walls, center lines of columns in both directions, major utilities and elevations of floor slabs:
 1. Such additional survey control points or system of points thus established shall be checked and certified by a registered land surveyor or registered civil engineer. Furnish such certification to the COR before any work (such as footings, floor slabs, columns, walls, utilities and other major controlling features) is placed.
- C. Whenever changes from contract drawings are made in line or grading requiring certificates, record such changes on a reproducible drawing bearing the registered land surveyor or registered civil engineer seal, and forward these drawings upon completion of work to COR .
- D. Upon completion of the work, the Contractor shall furnish the COR one electronic copy and reproducible drawings at the scale of the contract drawings, showing the finished grade on the grid developed for constructing the work, including burial monuments and fifty foot stationing along new road centerlines. These drawings shall bear the seal of the registered land surveyor or registered civil engineer.

- E. The Contractor shall perform the surveying and layout work of this and other articles and specifications in accordance with the provisions of Article "Professional Surveying Services".

1.13 AS-BUILT DRAWINGS

- A. The contractor shall maintain two full size sets of as-built drawings which will be kept current during construction of the project, to include all contract changes, modifications and clarifications.
- B. All variations shall be shown in the same general detail as used in the contract drawings. To insure compliance, as-built drawings shall be made available for the COR review, as often as requested.
- C. Contractor shall deliver two approved completed sets of as-built drawings to the COR within 15 calendar days after the acceptance of the project by the COR.
- D. Paragraphs A, B, & C shall also apply to all shop drawings.

1.14 USE OF ROADWAYS

- A. For hauling, use only established public roads and roads on Medical Center property and, when authorized by the COR, such temporary roads which are necessary in the performance of contract work. Temporary roads shall be constructed and restoration performed by the Contractor at Contractor's expense. When necessary to cross curbing, sidewalks, or similar construction, they must be protected by well-constructed bridges.

1.15 TEMPORARY USE OF EXISTING ELEVATORS

- A. Contractor shall use facility service elevators only.

1.16 TEMPORARY TOILETS

- A. Provide where directed, (for use of all Contractor's workmen) ample temporary sanitary toilet accommodations with suitable sewer and water connections; or, when approved by COR, provide suitable dry closets where directed. Keep such places clean and free from flies, and all connections and appliances connected therewith are to be removed prior to completion of contract, and premises left perfectly clean.

1.17 AVAILABILITY AND USE OF UTILITY SERVICES

- A. The Government shall make all reasonably required amounts of utilities available to the Contractor from existing outlets and supplies, as specified in the contract. The amount to be paid by the Contractor for chargeable electrical services shall be the prevailing rates charged to the Government. The Contractor shall carefully conserve any utilities furnished without charge.
- B. The Contractor, at Contractor's expense and in a workmanlike manner, in compliance with code and as satisfactory to the Contracting Officer, shall install and maintain all necessary temporary connections and distribution lines, and all meters required to measure the amount of electricity used for the purpose of determining charges. Before final acceptance of the work by the Government, the Contractor shall remove all the temporary connections, distribution lines, meters, and associated paraphernalia and repair restore the infrastructure as required.

- C. Heat: Furnish temporary heat necessary to prevent injury to work and materials through dampness and cold. Use of open salamanders or any temporary heating devices which may be fire hazards or may smoke and damage finished work, will not be permitted. Maintain minimum temperatures as specified for various materials:
 - 1. Obtain heat by connecting to Medical Center heating distribution system.
 - a. Steam is available at no cost to Contractor.
- D. Electricity (for Construction and Testing): Furnish all temporary electric services.
 - 1. Obtain electricity by connecting to the Medical Center electrical distribution system. The Contractor shall meter and pay for electricity required for electric cranes and hoisting devices, electrical welding devices and any electrical heating devices providing temporary heat. Electricity for all other uses is available at no cost to the Contractor.
- E. Water (for Construction and Testing): Furnish temporary water service.
 - 1. Obtain water by connecting to the Medical Center water distribution system. Provide reduced pressure backflow preventer at each connection as per code. Water is available at no cost to the Contractor.
 - 2. Maintain connections, pipe, fittings and fixtures and conserve water-use so none is wasted. Failure to stop leakage or other wastes will be cause for revocation (at COR discretion) of use of water from Medical Center's system.
- F. Fuel: Natural and LP gas and burner fuel oil required for boiler cleaning, normal initial boiler-burner setup and adjusting, and for performing the specified boiler tests will be furnished by the Government. Fuel required for prolonged boiler-burner setup, adjustments, or modifications due to improper design or operation of boiler, burner, or control devices shall be furnished and paid by the Contractor at Contractor's expense.

1.18 TESTS

- A. The contractor shall provide a written testing plan complete with component level, equipment level and system level breakdowns. The plan will provide a schedule and a written sequence of what will be tested, how and what the expected outcome will be. This document will be submitted for approval prior to commencing work. The contractor shall document the results of the approved plan and submit for approval with the as-built documentation.
- B. Pre-test mechanical and electrical equipment and systems and make corrections required for proper operation of such systems before requesting final tests. Final test will not be conducted unless pre-tested.
- C. Conduct final tests required in various sections of specifications in presence of an authorized representative of the Contracting Officer. Contractor shall furnish all labor, materials, equipment, instruments, and forms, to conduct and record such tests.

- D. Mechanical and electrical systems shall be balanced, controlled and coordinated. A system is defined as the entire system which must be coordinated to work together during normal operation to produce results for which the system is designed. For example, air conditioning supply air is only one part of entire system which provides comfort conditions for a building. Other related components are return air, exhaust air, steam, chilled water, refrigerant, hot water, controls and electricity, etc. Another example of a system which involves several components of different disciplines is a boiler installation. Efficient and acceptable boiler operation depends upon the coordination and proper operation of fuel, combustion air, controls, steam, feedwater, condensate and other related components.
- E. All related components as defined above shall be functioning when any system component is tested. Tests shall be completed within a reasonable period of time during which operating and environmental conditions remain reasonably constant and are typical of the design conditions.
- F. Individual test result of any component, where required, will only be accepted when submitted with the test results of related components and of the entire system.

1.19 INSTRUCTIONS

- A. Contractor shall furnish Maintenance and Operating manuals (hard copies and electronic) and verbal instructions when required by the various sections of the specifications and as hereinafter specified.
- B. Manuals: Maintenance and operating manuals and one compact disc (four hard copies and one electronic copy each) for each separate piece of equipment shall be delivered to the COR coincidental with the delivery of the equipment to the job site. Manuals shall be complete, detailed guides for the maintenance and operation of equipment. They shall include complete information necessary for starting, adjusting, maintaining in continuous operation for long periods of time and dismantling and reassembling of the complete units and sub-assembly components. Manuals shall include an index covering all component parts clearly cross-referenced to diagrams and illustrations. Illustrations shall include "exploded" views showing and identifying each separate item. Emphasis shall be placed on the use of special tools and instruments. The function of each piece of equipment, component, accessory and control shall be clearly and thoroughly explained. All necessary precautions for the operation of the equipment and the reason for each precaution shall be clearly set forth. Manuals must reference the exact model, style and size of the piece of equipment and system being furnished. Manuals referencing equipment similar to but of a different model, style, and size than that furnished will not be accepted.

C. Instructions: Contractor shall provide qualified, factory-trained manufacturers' representatives to give detailed training to assigned Department of Veterans Affairs personnel in the operation and complete maintenance for each piece of equipment. All such training will be at the job site. These requirements are more specifically detailed in the various technical sections. Instructions for different items of equipment that are component parts of a complete system, shall be given in an integrated, progressive manner. All instructors for every piece of component equipment in a system shall be available until instructions for all items included in the system have been completed. This is to assure proper instruction in the operation of inter-related systems. All instruction periods shall be at such times as scheduled by the COR and shall be considered concluded only when the COR is satisfied in regard to complete and thorough coverage. The contractor shall submit a course outline with associated material to the COR for review and approval prior to scheduling training to ensure the subject matter covers the expectations of the VA and the contractual requirements. The Department of Veterans Affairs reserves the right to request the removal of, and substitution for, any instructor who, in the opinion of the COR, does not demonstrate sufficient qualifications in accordance with requirements for instructors above.

1.20 RELOCATED ITEMS

- A. Contractor shall disconnect, dismantle as necessary, remove and reinstall in new location, all existing equipment indicated by symbol "R" or otherwise shown to be relocated by the Contractor.
- B. Perform relocation of such equipment or items at such times and in such a manner as directed by the COR.
- C. Suitably cap existing service lines, such as steam, condensate return, water, drain, gas, air, vacuum and/or electrical, at the main whenever such lines are disconnected from equipment to be relocated. Remove abandoned lines in finished areas and cap as specified herein before under paragraph "Abandoned Lines".
- D. Provide all mechanical and electrical service connections, fittings, fastenings and any other materials necessary for assembly and installation of relocated equipment; and leave such equipment in proper operating condition.
- E. All service lines such as noted above for relocated equipment shall be in place at point of relocation ready for use before any existing equipment is disconnected. Make relocated existing equipment ready for operation or use immediately after reinstallation.

1.21 VA TRIRIGA CPMS

- A. VA contractors, selected by award to perform work, are required to get access to the VA TRIRIGA CPMS. The TRIRIGA CPMS is the management and collaborative environment that the VA uses for all Major, Minor and Non-Recurring Maintenance (NRM) projects within the Office of Construction & Facilities Management (CFM), Veterans Health Administration (VHA), National Cemetery Administration (NCA), and the Veterans Benefits Administration (VBA).
- B. The contractor is solely responsible for acquiring access to the VA TRIRIGA CPMS.

- C. To gain access to the VA TRIRIGA CPMS the contractor is encouraged to follow the licensing process outline as specified below:
1. Requirement: TRIRIGA is the management and collaborative environment that VA uses for all construction projects. VA requires its contractors to procure TRIRIGA access as part of the cost of performance for a VA construction related contract.
 2. Access Request and Payment can be made through the following URL
<https://valicensing.oncfi.com/>
 3. Inquiries or to request additional services, contact the following:
 4. Craig Alsheimer, Federal Account Manager
 5. Computerized Facility Integrations, LLC
 6. 18000 West Nine Mile Road
 7. Suite 700
 8. Southfield, MI 48075
 9. Email: calsheimer@gocfi.com
 10. Phone: 248-557-4234 Extension 6010; 410-292-7006
 11. Process:
 - a. Once the contractor has been notified by VA of the award and a unique contract number, the contractor can enter a request for access to TRIRIGA at URL <https://valicensing.oncfi.com/>
 - b. CFI will process the request for access and payment. CFI will create the USER ID and a password. Security provisions required to align the contractor to the Contract Number will be entered and an email will be generated and submitted to the requestor.
 - c. CFI will also provide standard terms and conditions related to the transaction and use agreement.

---E N D---

OSHA Requirements and Safety and Health Regulations

PART 1 - OSHA Requirements

1.1 General

- A. Contractors are required to comply with the Occupational Safety and Health Act of 1970. This will include the safety and health standard found in Code of Federal Regulations (CFR) 1910 and 1926. Copies of those standards can be obtained from the Superintendent of Documents, U.S. Government Printing Office, Washington, D.C., 20420.
- B. In addition, Contractor will be required to comply with other applicable Medical Center policies and safety regulations. These policies and regulations will be presented to the Contractor at the pre-construction meeting. Each of the Contractor's employees will be required to read the statement of policies and regulations, and sign an acknowledgment that such policies and regulations are understood. Signed acknowledgment will be returned to the Contract Officer Technical Representative.
- C. Contractors involved with the removal, alteration or disturbance of asbestos-type insulation or materials or lead paint will be required to comply strictly with the regulations found in CFR 1910.1001 and the appropriate Environmental Protection Agency (EPA) lead regulations regarding disposal of asbestos or lead paint. Assistance in identifying asbestos or lead can be requested from the Medical Center's Industrial Hygienist and the COR.
- D. Contractors entering locations of asbestos contamination or lead paint residue (i.e., pipe, basements, walls, windows) shall be responsible for providing respiratory protection to their employees and ensuring respirators are worn in accordance with the Occupational Safety and Health Administration (OSHA) [CFR 1910.1001(g)]. Asbestos-or lead paint-contaminated areas shall be defined on project drawings. The minimum equipment requirements will be a half-mask air-purifying respirator equipped with high efficiency filters and disposable coveralls, or as determined by air monitoring results.
- E. Contractor, along with other submittals and at least two weeks prior to bringing any materials on-site, must submit a complete list of chemicals the Contractor will use and Material Safety Data Sheets (MEDS) for all hazardous materials as defined in OSHA 1910.1200(d), Hazard Determination. Contracting Officer shall have final approval of all materials brought on site.
- F. The Contractor will be held solely responsible for the safety and health of their employees. The contractor will also be held responsible for protecting the health and safety of the VA Community (patients, staff, and visitors) from the unwanted effects of construction. VA staff will monitor the Contractor's performance in complying with all safety and health aspects of the project. Severe or constant violations may result in an immediate work stoppage or request for a Compliance Officer from the Occupational Safety and Health Administration.
- G. During all phases of demolition, construction and alterations, Contractors are required to understand and strictly follow National Fire Protection Association (NFPA) 241, Standard for Safeguarding Construction, Alteration and Demolition Operations. The Medical Center's

Safety and Occupational Health Specialist or Industrial Hygienist will closely monitor the work area for compliance. Appropriate action will be taken for non-compliance.

PART 2 - Specific VA Medical Center Fire and Safety Policies, Procedures and Regulations

2.1 Introduction.

- A. The safety and fire protection of patients, employees, members of the public and government is one of continuous concern to this Medical Center.
- B. Contractors, their supervisors and employees are required to comply with Medical Center policies to ensure the occupational safety and health of all. Failure to comply may result in work stoppage.
- C. While working at this Medical Center, contractors are responsible for the occupational safety and health of their employees. Contractors are required to comply with the applicable OSHA standards found in 29 CFR 1910 for general industry and 29 CFR 1926 for construction. Failure to comply with these standards may result in work stoppage and a request to the Area Director of OSHA for a Compliance Officer to inspect your work site.
- D. Contractors are to comply with the requirements found in the National Fire Protection Association (NFPA) 241, Building Construction and Demolition Operation, and NFPA 51B, Fire Prevention in Use of Cutting and Welding Processes.
- E. Questions regarding occupational safety and health issues can be addressed to the Medical Center Safety and Occupational Health Specialist (ext. 4172) or Industrial Hygienist (ext. 4628).
- F. Smoking is not permitted in any interior areas of the Medical Center, including all interior stairwells, tunnels, construction and/or service/maintenance sites. Compliance with this policy by your direct and subcontracted labor force is required.

2.2 Hazard Communication

- A. Contractors shall comply with OSHA Standard 29 CFR 1926.59, Hazard Communication.
- B. Contractors shall submit to the VA Safety Officer, copies of MSDS covering all hazardous materials to which the Contractor and VA employees are exposed.
- C. Contractors shall inform the Safety Officer of the hazards to which VA personnel and patients may be exposed.
- D. Contractors shall have a written Hazard Communication Program available at the construction site, which details how the Contractor will comply with 29 CFR 1926.59.

2.3 Fires

- A. All fires must be reported. In the event of a fire in your work area, use the nearest pull box station, and also notify Medical Center staff in the immediate area. Emergency notification can also be accomplished by dialing ext. 2222.
- B. Be sure to give the exact location from where you are calling and the nature of the emergency. If a Contractor experiences a fire that was rapidly extinguished by your staff, you still must notify the Construction Safety Officer (ext. 4172) within an hour of the event so that an investigation of the fire can be accomplished.

2.4 Fire Alarms, Smoke Detection and Sprinkler System

If the nature of your work requires the deactivation of the fire alarm, smoke detection or sprinkler system, you must notify the Safety Office. Notification must be made well in advance so that ample time can be allowed to deactivate the system and provide alternative measures for fire protection. Under no circumstance is a Contractor allowed to deactivate any of the fire protection systems in this Medical Center.

2.5 Smoke Detectors

False alarms will not be tolerated. You are required to be familiar with the location of the smoke detectors in your work area. When performing cutting, burning or welding or any other operations that may cause smoke or dust, you must take steps to temporarily cover smoke detectors in order to prevent false alarms. Failure to take the appropriate action

will result in the Contracting Officer assessing actual costs for government response for each false alarm that is preventable. Prior to covering the smoke detectors, the Contractor will notify the Safety Officer, who will also be notified when the covers are removed.

2.6 Hot Work Permit

- A. Hot work is defined as operations including, but not limited to, cutting, welding, thermal welding, brazing, soldering, grinding, thermal spraying, thawing pipes or any similar situation. If such work is required, whenever possible the Contractor must notify the COR no less than one day in advance of such work. The Competent Hot Work Supervisor (CHWS) will inspect the work area and issue a Hot Work Permit, authorizing the performance of such work.
- B. All hot work will be performed in compliance with the Engineering Service Policy 138-047 regarding Hot Work Permits and NFPA 241, Safeguarding Construction, Alternation and Demolition Operations; and NFPA 51B, Fire Prevention in Use of Cutting and Welding Processes; and applicable OSHA standard. A hot work permit will only be issued to individuals familiar with these regulations.
- C. A Hot Work Permit will be issued only for the period necessary to perform such work. In the event the time necessary will exceed one day, a Hot Work Permit may be issued for the period needed; however, the CHWS will inspect the area daily. Hot Work Permit will apply only to the location identified on the permit. If additional areas involve hot work, then additional permits must be requested.

- D. Contractors will not be allowed to perform hot work processes without the appropriate permit.
- E. Any work involving the Medical Center's fire protection system will require advance notification. Under no circumstance will the Contractor or employee attempt to alter or tamper with the existing fire protection system.
- F. Thirty minutes following completion of the hot work, the Fire Watch will perform an inspection of the area to confirm that sparks or drops of hot metal are not present.

2.7 Temporary Enclosures

Only non-combustible materials will be used to construct temporary enclosures or barriers at this Medical Center. Plastic materials and fabrics used to construct dust barriers must conform to NFPA 701, Standard Methods of Fire Tests for Flame-Resistant Textiles and Films.

2.8 Flammable Liquids

All flammable liquids will be kept in approved safety containers. Only the amount necessary for your immediate work will be allowed in the building. Flammable liquids must be removed from the building at the end of each day.

2.9 Compressed Gas Cylinders

Compressed gas shall be secured in an upright position at all times. A suitable cylinder cart will be used to transport compressed gas cylinders. Only those compressed gas cylinders necessary for immediate work will be allowed in occupied buildings. All other compressed gas cylinders will be stored outside of buildings in a designated area. Contractors will comply with applicable standards compressed gas cylinders found in 29 CFR 1910 and 1926 (OSHA).

2.10 Internal Combustion Engine-Powered Equipment

Equipment powered by an internal combustion engine (such as saws, compressors, generators, etc.) will not be used in an occupied building. Special consideration may be given for unoccupied buildings only if the OSHA and NFPA requirements have been met.

2.11 Powder-Activated Tools

The operator of powder-activated tools must be trained and certified to use them. Powder-activated tools will be kept secured at all times. When not in use, the tools will be locked up. When in use, the operator will have the tool under his immediate control.

2.12 Tools

- A. Under no circumstances will equipment, tools and other items of work to be left unattended for any reason. All tools, equipment and items of work must be under the immediate control of your employee.
- B. If for some reason a work area must be left unattended, then tools and other equipment must be placed in an appropriate box or container and locked. All tool boxes, containers or any

other device used for the storage of tools and equipment will be provided with a latch and padlock, and will be kept locked at all times, except for putting in and removing tools.

- C. All doors to work areas will be closed and locked when rooms are left unattended. Failure to comply with this policy will be considered a violation of VA Regulations 1.218(b), Failure to comply with signs of a directive and restrictive nature posted for safety purposes, and subject to a \$50.00 fine. Subsequent similar violations may result in both imposition of such a fine as well as the Contracting Officer taking

action under the contract's Accident Prevention Clause [Federal Acquisition Regulation (FAR) 52.236-13] to suspend all contract work until violations may be satisfactorily resolved, or under FAR 52.236-5, Material and Workmanship Clause, to remove from the worksite any personnel deemed by the Contracting Officer to be careless to the point of jeopardizing the welfare of facility patients or staff.

- D. You must report any tools or equipment that are missing to the VA Police Department.

- E. Tools and equipment found unattended will be confiscated and removed from the work area.

2.13 Ladders

Ladders must not be left unattended in an upright position. Ladders must be attended at all times or taken down, and chained securely to a stationary object.

2.14 Scaffolds

All scaffolds will be attended at all times. When not in use, an effective barricade (fence) will be erected around the scaffold to prevent use by unauthorized personnel (Reference OSHA 1926, Subpart L).

2.15 Excavations

The contractor shall comply with OSHA 1926, Subpart P. An OSHA Competent Person must be on site during the excavation. The contractor shall coordinate with the COR and utility companies prior to the excavation to identify underground utilities tanks, etc. All excavations left unattended will be provided with a barricade suitable to prevent entry by unauthorized persons.

2.16 Storage

You must make prior arrangements with the COR for the storage of building materials. Storage will not be allowed to accumulate in the Medical Center buildings.

2.17 Trash and Debris

You must remove all trash and debris from the work area on a daily basis. Trash and debris will not be allowed to accumulate inside or outside of the buildings. You are responsible for making arrangements for removal of trash from the Medical Center facility.

2.18 Protection of Floors

It may be necessary at times to take steps to protect floors from dirt, debris, paint, etc. A tarp or other protective covering may be used. However, you must maintain a certain amount of floor space for the safe passage of pedestrian traffic. Common sense must be used in this matter.

2.19 Signs

Signs must be placed at the entrance to work areas warning people of your work. Signs must be suitable for the condition of the work. Small pieces of paper with printing or writing are not acceptable. The VA Medical Center (VAMC) Safety Officer or COR can be consulted in this matter.

2.20 Accidents and Injuries

Contractors must report all accidents and injuries involving their employees.

2.21 Infection Control

Contractors must control the generation of dust and the contamination of patient care surfaces, supplies and equipment. During demolition phases of the construction:

- A. The construction area shall be under negative pressure, ensuring there is an appreciable flow of clean air from the VA-occupied portion of the facility into the construction area. The airflow shall be sufficiently strong enough to draw in the plastic door flaps commonly located at the construction entrance or at the specific site within the construction area.
- B. Construction debris being transported through the VA-occupied portion of the facility shall be covered and/or whetted.
- C. Construction employees shall remove dust-laden clothing before entering the VA-occupied portion of the facility.
- D. Carpet/sticky mats shall be placed at all construction entrances, and be satisfactorily maintained so as to minimize the tracking of dust into the VA-occupied portion of the facility.
- E. Dry sweeping of dust and debris is not to be performed.

(Control measures B - E above must be practiced during the construction phase.)

2.22 Confined Space Entry

- A. Contractor will be informed that the workplace contains permit-required confined space, and that permit-space entry is allowed only through compliance with a permit space program meeting the requirements of 29 CFR 1910.146 and 1926.21(b)(6).
- B. Contractor will be apprised of the elements including the hazards identified and the Medical Center's (last employer) experience with the space that makes the space in question a permit space.

- C. Contractor will be apprised of any precautions or procedures that the Medical Center has implemented for the protection of employees in or near permit space where Contractor personnel will be working.
- D. Medical Center and Contractor will coordinate entry operations when both Medical Center personnel and Contractor personnel will be working in or near permit spaces as required by 29 CFR 1910.146(d)(ii) and 1926.21(b)(6).
- E. Contractor will obtain any available information regarding permit space hazards and entry operation from the Medical Center.
- F. At the conclusion of the entry operations, the Medical Center and Contractor will discuss any hazards confronted or created in permit spaces.
- G. The Contractor is responsible for complying with 29 CFR 1910.246(d) through (g) and 1926.21(b)(6). The Medical Center, does not provide rescue and emergency services required by 29 CFR 1910.246(k) and 1926.21(b)(6).

2.23 Contractor Parking and Material Delivery

There is no Contractor parking on Medical Center property unless the contract drawings show a designated staging area that is under the Contractor's control. Contractor's delivery of building materials tools, etc., must be pre-arranged with the Project Manager.

Pre Construction Risk Assessment (PCRA)

Project: _____ Project/Contract #: _____

This form may be used for projects or activities to determine if a Site Specific Safety Plan (SSSP) is necessary. If the contractor or vendor is not working independently (VAMC Supervisor is present and in control of the contractor) and the job is short duration (less than five working days) and the hazard analysis does not include any high risk activities, then Occupational Health and Safety may allow work without submitting a SSSP.

| Activity | Yes | High Risk |
|--|-----|-----------------------|
| 1. Respiratory protection is required for the work being conducted List specifics: (activity being preformed, PPE Being used, Training, Fit testing). | | |
| 2. Hearing protection is required for the work being conducted List specifics: (Type of noise; impact, constant, start up). | | |
| 3. Other personal protective equipment is required for the work being conducted, what activity? _____ List specifics: (Gloves, safety Glasses, hard hat, steel toes, overalls). | | |
| 4. Are there overhead hazards associated with the activity being conducted? Wires, power, communication, grounding, location(s), signage. List specifics: | | Yes |
| 5. Work is being conducted in a confined space. Permit required? Training? List specifics: Tanks, sewer, tunnels, Rescue Team notification. | | PRCS Only |
| 6. Ladders will be necessary for the work being conducted. | | |
| 7. Scaffolding will be necessary for the work being conducted. List specifics: | | Greater than six feet |
| 8. Other work platforms will be necessary for the work being conducted. List specifics: Rails, toe boards, netting | | Greater than six feet |
| 9. Fall protection is required for the work being conducted. List specifics: | | Yes |

| | | |
|--|------------|--|
| <p>10. ASBESTOS Abatement Exposure to asbestos may be associated with the work being conducted. List specifics: Renovation, Demolition, Emergency Response <u>29 CFR 1910.1001.</u></p> | | <p>Yes unless approved by the Asbestos Manager</p> |
| <p>Activity</p> | <p>Yes</p> | <p>High Risk</p> |
| <p>11. Hazardous materials will be used. MSDSs will be provided for known substances List specifics: 29 CFR 1910.1200.</p> | | |
| <p>12. Hot work (Cutting, Welding, Brazing, etc). Use of VAMC Cleveland Hot Work Policy (ECP 138-047) is required.</p> | | |
| <p>13. Additional ventilation will be necessary for the work being conducted. List specifics: Reason for need of ventilation, confined space, foul odor, excessive heat.</p> | | |
| <p>14. Operation and maintenance of electric power generation, control, transformation, transmission, and distribution lines and equipment are necessary for the work being conducted. List specifics:</p> | | <p>Yes</p> |
| <p>15. Work will be conducted on energized equipment. Use of VAMC Cleveland Working on Energized Equipment policy (138-034) is required. List specifics: list voltages in area, emergency procedures.</p> | | <p>Yes</p> |
| <p>16. Other electrical work will be conducted. List specifics:</p> | | |
| <p>17. Lock Out/Tag Out will be necessary for the work being conducted. List specifics:</p> | | |
| <p>18. Cranes, derricks, or slings will be necessary for the work being conducted. List specifics:</p> | | <p>Yes</p> |
| <p>19. Excavating will be necessary for work being conducted. List site specifics:</p> | | <p>Yes</p> |

| Activity | Yes | High Risk |
|--|-----|-----------|
| 20. Excavating or earthmoving equipment will be used. List specifics: | | |
| 21. Industrial trucks will be used. List specifics: | | |
| 22. Other motorized vehicles will be used. List specifics: | | |
| 23. Concrete and masonry construction operations will be necessary for work being conducted. List specifics: % of recycled components | | |
| 24. Steel erection activities will be necessary for the work being conducted. List specifics: New Steel % of recycled material, | | Yes |
| 25. Alteration, conversion, or improvement of existing electric transmission and distribution lines and equipment will be necessary for the work being conducted. List specifics: | | Yes |
| 26. Hand and portable powered tools or other hand-held equipment will be used. | | |
| 27. Compressed gas or compressed air equipment is necessary for work being conducted. | | |
| 28. List all other hazardous activities that will be conducted or potentially hazardous equipment that will be used including vibration hazards. | | |

| Activity | Yes | High Risk |
|---|-----|---------------------------|
| 29. Infection Control Risks identified. Infection Control Risk Assessment (ICRA) required- refer to Enclosure (1). | | Yes unless approved by IC |
| 30. Life Safety Risks identified. Interim Life Safety Risk Assessment Form -Attachment (4) - must be completed and submitted. | | |
| 31. Emergency Procedures Identified. Fire, severe weather, utility failure, etc. | | |
| 32. Demolition will be necessary for the work being conducted. | | Yes |
| 33. <i>New Construction:</i> Minimum ___%___ of total project waste shall be diverted from landfill. Recycled aggregate, Concrete, Steel. | | |
| 34. <i>Interior Remodeling:</i> Minimum ___%___ of total project waste shall be diverted from landfill. a) Ceiling tile b) Steel c) Carpet | | |

Submitted by (Contractor) _____ Date: _____

Reviewed by (COR) _____ Date: _____

Reviewed by (CSM) _____ Date: _____

SSSP Required Yes No

**Construction Safety Poster – Cleveland VA
Project:**

Project #:

VAMC Emergency Number – 2222

Infection Control Category:

Fire Extinguisher Locations:

Fire Alarm Location:

Safe Area of Refuge Location:

Evacuation Assembly Location:

MSDS Location:

COR: _____

Phone: _____

Interim Life Safety Risk Assessment Form

Project: _____ **Date:** _____

Location: _____

Estimated completion Date _____ **Actual Completion Date** _____

Life Safety Risk Assessment

| Guidelines: | Yes/ No | Comments | ILSM |
|--|------------|----------|------|
| 1. Will exit egress routes from occupied areas remain unchanged? | | | |
| 2. Will exit stairs remain unobstructed and fire separated? | | | |
| 3. Will fire and smoke compartments remain intact and unchanged? | | | |
| 4. Will fire alarm detection systems remain functional and unimpaired? | | | |
| 5. Will fire suppression systems remain function and unimpaired? | | | |
| 6. Will construction area be separated by noncombustible smoke tight partitions? | | | |
| 7. Will emergency access by fire department remain unobstructed? | | | |
| 8. Will normal distances to exits be maintained? | | | |
| 9. Will all hazardous areas be protected? | | | |

Interim Life Safety Measures (ISLM)

- | | |
|---|---|
| A. Ensure Egress | H. Conduct 2 Fire Drills Per Shift in All Areas |
| B. Emergency Forces Access | I. Conduct 2 Fire Drills Per Shift in Local Area |
| C. Fire Department Notification | J. Increase Hazard Surveillance |
| D. Ensuring Operational Life Safety Systems | K. Compartmentation Training of Personnel |
| E. Temporary Construction | L. Conduct Organizational Training on Life Safety |
| F. Additional Fire Fighting Equipment | M. Conduct Additional Training on Incident Response |
| G. Control Combustible Loading | N. Institute a Fire Watch |

GENERAL REQUIREMENTS

ATTACHMENT 4 - INTERIM LIFE SAFETY RISK ASSESSMENT FORM

Life Safety Narrative:

Assessment Performed By: _____

Contracting Officer's Representative

Assessment Reviewed By: _____

VAMC Cleveland Occupational Health and Safety

Contractor Safety and Security Orientation

In order to promote safety in construction activities at VAMC Cleveland, all contract employees will receive orientation to communicate facility-specific safety concerns. This document provides examples of discussion points used to give contractors the necessary site-specific safety and procedural information. Refer to the Infection Control During Construction program for Infection Control Orientation discussion points.

Check all that apply:

| | |
|--|--|
| | Specific Items on the Hazardous Work Activity Checklist (Attachment 2) |
| | Stop Work Authority |
| | Confined Space Entry Requirements |
| | Obtaining and Updating Hot Work Permits |
| | Interim Life Safety Measures (Attachment 4) |
| | Job Site Security |
| | Contractor ID Badge Requirements |
| | Contractor Key Requirements |
| | Contractor Parking Requirements |
| | Process for Working Before or After Normal Hours |
| | VA Daily Log |
| | Request for Information |
| | Other Not Previously Mentioned |

Job Safety Check Sheet

Project ID: _____ COR: _____ Date: _____

Location: _____

| A. Personal Protective Equipment: | No. | Grade | N/A | COMMENTS –Note Improvements Needed: |
|---|------------|--------------|------------|--|
| 1. Hard hats in use by all personnel. | A1 | 1 2 3 4 | 5 N/A | |
| 2. Eye protection in use by all personnel. | A2 | 1 2 3 4 | 5 N/A | |
| 3. Hearing protection (engineering controls, double protection for high noise areas, rotation of employees). | A3 | 1 2 3 4 | 5 N/A | |
| 4. Proper footgear and protective clothing. | A4 | 1 2 3 4 | 5 N/A | |
| 5. Fall protection in use. | A5 | 1 2 3 4 | 5 N/A | |
| 6. Respirators/face masks in good condition and used as required (medical evaluation and fit test). | A6 | 1 2 3 4 | 5 N/A | |
| B. Tools and Equipment: | No. | Grade | N/A | COMMENTS –Note Improvements Needed: |
| 1. Tools and equipment in good condition. | B1 | 1 2 3 4 | 5 N/A | |
| 2. All equipment properly guarded. | B2 | 1 2 3 4 | 5 N/A | |
| 3. Electrical equipment connected properly, grounded and in good condition; GFCI; automatic magnetic cut-off for woodworking tools. | B3 | 1 2 3 4 | 5 N/A | |
| 4. Air/sandblast hoses in good condition and properly wired. | B4 | 1 2 3 4 | 5 N/A | |
| 5. Compressors equipped with automatic shut-off. | B5 | 1 2 3 4 | 5 N/A | |
| 6. Ladders in good condition; tied back; extended 3 ft. beyond landing. | B6 | 1 2 3 4 | 5 N/A | |
| C. Scaffolding: <input type="checkbox"/> Suspended <input type="checkbox"/> Tubular <input type="checkbox"/> Other (<i>Rope Falls Not Permitted</i>) | No. | Grade | N/A | COMMENTS –Note Improvements Needed: |
| 1. Scaffold in good repair; guardrails; toe boards and wire mesh in place. | C1 | 1 2 3 4 | 5 N/A | |
| 2. Counterweights marked with weight and in proper ratio. | C2 | 1 2 3 4 | 5 N/A | |
| 3. Scaffold tied back and tied in. | C3 | 1 2 3 4 | 5 N/A | |
| 4. Passageways under scaffold blocked. | C4 | 1 2 3 4 | 5 N/A | |
| D. Hazardous Chemicals/Air Contaminants: | No. | Grade | N/A | COMMENTS –Note Improvements Needed: |
| 1. Hazard Communication Right-To-Know poster / written program on job. | D1 | Y N | N/A | |
| 2. List of hazardous materials on job. | D2 | Y N | N/A | |
| 3. Material Safety Data Sheets available. | D3 | Y N | N/A | |
| 4. Employees are familiar with program. | D4 | 1 2 3 4 | 5 N/A | |
| 5. Proper containers in use with correct labels. | D5 | 1 2 3 4 | 5 N/A | |

| E. General: | No. | Y | N | N/A | COMMENTS –Note Improvements Needed: |
|---|------------|----------|----------|------------|--|
| 1. Safe access to work area. | E1 | Y | N | N/A | |
| 2. Contractors wearing ID Badges. | E2 | Y | N | N/A | |
| 3. Job site security maintained | E2 | Y | N | N/A | |
| 4. Good housekeeping and material storage. | E2 | Y | N | N/A | |
| 5. Barricades/debris protection/warning signs in place. | E3 | Y | N | N/A | |
| 6. Floor and wall openings properly protected. | E4 | Y | N | N/A | |
| 7. Shoring properly installed | E5 | Y | N | N/A | |
| 8. Eye wash available. | E6 | Y | N | N/A | |
| 9. First aid: Kit and certified employees. | E8 | Y | N | N/A | |
| 10. Trucks: Safe/good condition; D.O.T. regulation compliance. | E9 | Y | N | N/A | |
| F. Fire Safety (ILSM) | No. | Y | N | N/A | COMMENTS –Note Improvements Needed: |
| 1. Exits & pathways clearly marked and unobstructed. | F1 | Y | N | N/A | |
| 2. Emergency services pathway is free and unobstructed. | F2 | Y | N | N/A | |
| 3. Fire extinguishers are in place and inspected. | F3 | Y | N | N/A | |
| 4. Smoke and fire alarms operational or ILSM taken | F4 | Y | N | N/A | |
| 5. Sprinkler system operational or ILSM taken. | F5 | Y | N | N/A | |
| 6. Hot Work Permits posted. | F3 | Y | N | N/A | |
| 7. Hot work sites inspected after hot work. | F4 | Y | N | N/A | |
| 8. Smoking Policy is followed. | F5 | Y | N | N/A | |
| G. Paperwork and Other Postings: | No. | Y | N | N/A | COMMENTS –Note Improvements Needed: |
| 1. OSHA poster/log. | G1 | Y | N | N/A | |
| 2. Emergency phone number card. | G2 | Y | N | N/A | |
| 3. Drug-Free Workplace Policy Summary and poster (if applicable). | G3 | Y | N | N/A | |
| 4. Job logs and Job Safety Check Sheets. | G4 | Y | N | N/A | |
| 5. Site-Specific Safety Plan (if applicable). | G5 | Y | N | N/A | |

Additional Comments:

SECTION 01 33 23
SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES

PART 1 - GENERAL

1.1 Refer to Articles titled SPECIFICATIONS AND DRAWINGS FOR CONSTRUCTION (FAR52.236-21) and, SPECIAL NOTES (VAAR 852.236-91), in GENERAL CONDITIONS.

1.2 For the purposes of this contract, samples, test reports, certificates, and manufacturers' literature and data shall also be subject to the previously referenced requirements. The following text refers to all items collectively as SUBMITTALS.

1.3 Submit for approval, all of the items specifically mentioned under the separate sections of the specification, with information sufficient to evidence full compliance with contract requirements. Materials, fabricated articles and the like to be installed in permanent work shall equal those of approved submittals. After an item has been approved, no change in brand or make will be permitted unless:

- A. Satisfactory written evidence is presented to, and approved by Contracting Officer, that manufacturer cannot make scheduled delivery of approved item or;
- B. Item delivered has been rejected and substitution of a suitable item is an urgent necessity or;
- C. Other conditions become apparent which indicates approval of such substitute item to be in best interest of the Government.

1.4 Forward submittals in sufficient time to permit proper consideration and approval action by Government. Time submission to assure adequate lead time for procurement of contract - required items. Delays attributable to untimely and rejected submittals. Upon receipt of submittals, Architect-Engineer will assign a file number thereto. Contractor, in contract time for completion.

1.5 Submittals will be reviewed for compliance with contract requirements by Architect-Engineer, and action thereon will be taken by COR on behalf of the Contracting Officer.

1.6 Upon receipt of submittals, Architect-Engineer will assign a file number thereto. Contractor, in any subsequent correspondence, shall refer to this file and identification number to expedite replies relative to previously approved or disapproved submittals.

1.7 The Government reserves the right to require additional submittals, whether or not particularly mentioned in this contract. If additional submittals beyond those required by the contract are furnished pursuant to request therefor by Contracting Officer, adjustment in contract price and time will be made in accordance with Articles titled CHANGES (FAR 52.243-4) and CHANGES - SUPPLEMENT (VAAR 852.236-88) of the GENERAL CONDITIONS.

1.8 Schedules called for in specifications and shown on shop drawings shall be submitted for use and information of Department of Veterans Affairs and Architect-Engineer. However, the Contractor shall assume responsibility for coordinating and verifying schedules. The Contracting Officer and Architect-Engineer assumes no responsibility for checking schedules or layout

Bid Issue
07/01/2016

VAMC WADE PARK
Emergency Sewer Repair K-Wing
Project No. 541-16-522

drawings for exact sizes, exact numbers and detailed positioning of items.

1.9 Samples, shop drawings, test reports, certificates and manufacturers' literature and data, shall be submitted for approval to:

Fredrick, Fredrick and Heller Engineers Inc.
672 Royalton Rd., Broadview Heights 44147
ddemagall@ffhengineers.com

1.10 At the time of transmittal to the Architect-Engineer, the Contractor shall also send a copy of the complete submittal directly to the COR.

1.11 Samples, for approval shall be sent to Architect-Engineer, in care of COR, VA Medical Center,

Fredrick, Fredrick and Heller Engineers Inc.
672 Royalton Rd., Broadview Heights 44147

PART 2 - PRODUCTS (Not used)

PART 3 - EXECUTION (Not used)

- - - E N D - - -

**SECTION 01 35 26
SAFETY REQUIREMENTS**

1.1 APPLICABLE PUBLICATIONS:

A. Latest publications listed below form part of this Article to extent referenced. Publications are referenced in text by basic designations only.

B. American Society of Safety Engineers (ASSE):

A10.1-2011.....Pre-Project & Pre-Task Safety and Health
Planning

A10.34-2012.....Protection of the Public on or Adjacent to
Construction Sites

A10.38-2013.....Basic Elements of an Employer's Program to
Provide a Safe and Healthful Work Environment
American National Standard Construction and
Demolition Operations

C. American Society for Testing and Materials (ASTM):

E84-2013.....Surface Burning Characteristics of Building
Materials

D. The Facilities Guidelines Institute (FGI):

FGI Guidelines-2010Guidelines for Design and Construction of
Healthcare Facilities

E. National Fire Protection Association (NFPA):

10-2013.....Standard for Portable Fire Extinguishers

30-2012.....Flammable and Combustible Liquids Code

51B-2014.....Standard for Fire Prevention During Welding,
Cutting and Other Hot Work

70-2014.....National Electrical Code

70B-2013.....Recommended Practice for Electrical Equipment
Maintenance

70E-2012Standard for Electrical Safety in the Workplace

99-2012.....Health Care Facilities Code

241-2013.....Standard for Safeguarding Construction,
Alteration, and Demolition Operations

F. The Joint Commission (TJC)

TJC ManualComprehensive Accreditation and Certification
Manual

G. U.S. Nuclear Regulatory Commission

10 CFR 20Standards for Protection Against Radiation

H. U.S. Occupational Safety and Health Administration (OSHA):

29 CFR 1904Reporting and Recording Injuries & Illnesses

29 CFR 1910Safety and Health Regulations for General
Industry

29 CFR 1926Safety and Health Regulations for Construction
Industry

CPL 2-0.124.....Multi-Employer Citation Policy

I. VHA Directive 2005-007

1.2 DEFINITIONS:

A. OSHA "Competent Person" (CP). One who is capable of identifying existing and predictable hazards in the surroundings and working conditions which are unsanitary, hazardous or dangerous to employees, and who has the authorization to take prompt corrective measures to eliminate them (see 29 CFR 1926.32(f)).

B. "Qualified Person" means one who, by possession of a recognized degree, certificate, or professional standing, or who by extensive knowledge, training and experience, has successfully demonstrated his ability to solve or resolve problems relating to the subject matter, the work, or the project.

- C. High Visibility Accident. Any mishap which may generate publicity or high visibility.
- D. Medical Treatment. Treatment administered by a physician or by registered professional personnel under the standing orders of a physician. Medical treatment does not include first aid treatment even through provided by a physician or registered personnel.
- E. Recordable Injuries or Illnesses. Any work-related injury or illness that results in:
 - 1. Death, regardless of the time between the injury and death, or the length of the illness;
 - 2. Days away from work (any time lost after day of injury/illness onset);
 - 3. Restricted work;
 - 4. Transfer to another job;
 - 5. Medical treatment beyond first aid;
 - 6. Loss of consciousness; or
 - 7. A significant injury or illness diagnosed by a physician or other licensed health care professional, even if it did not result in (1) through (6) above.

1.3 REGULATORY REQUIREMENTS:

- A. In addition to the detailed requirements included in the provisions of this contract, comply with 29 CFR 1926, comply with 29 CFR 1910 as incorporated by reference within 29 CFR 1926, comply with ASSE A10.34, and all applicable federal, state, and local laws, ordinances, criteria, rules and regulations. Submit matters of interpretation of standards for resolution before starting work. Where the requirements of this specification, applicable laws, criteria, ordinances, regulations, and referenced documents vary, the most stringent requirements govern except with specific written approval and acceptance by the Contracting Officer Representative (COR).

1.4 ACCIDENT PREVENTION PLAN (APP) :

- A. The APP (aka Construction Safety & Health Plan) shall interface with the Contractor's overall safety and health program. Include any portions of the Contractor's overall safety and health program referenced in the APP in the applicable APP element and ensure it is site-specific. The Government considers the Prime Contractor to be the "controlling authority" for all worksite safety and health of each subcontractor(s). Contractors are responsible for informing their subcontractors of the safety provisions under the terms of the contract and the penalties for noncompliance, coordinating the work to prevent one craft from interfering with or creating hazardous working conditions for other crafts, and inspecting subcontractor operations to ensure that accident prevention responsibilities are being carried out.
- B. The APP shall be prepared as follows:
1. Written in English by a qualified person who is employed by the Prime Contractor articulating the specific work and hazards pertaining to the contract (model language can be found in ASSE A10.33). Specifically articulating the safety requirements found within these VA contract safety specifications.
 2. Address both the Prime Contractors and the subcontractors work operations.
 3. State measures to be taken to control hazards associated with materials, services, or equipment provided by suppliers.
 4. Address all the elements/sub-elements and in order as follows:
 - a. **SIGNATURE SHEET.** Title, signature, and phone number of the following:
 - 1) Plan preparer (Qualified Person such as corporate safety staff person or contracted Certified Safety Professional with construction safety experience);
 - 2) Plan approver (company/corporate officers authorized to obligate the company);

- 3) Plan concurrence (e.g., Chief of Operations, Corporate Chief of Safety, Corporate Industrial Hygienist, project manager or superintendent, project safety professional). Provide concurrence of other applicable corporate and project personnel (Contractor).
- b. **BACKGROUND INFORMATION.** List the following:
- 1) Contractor;
 - 2) Contract number;
 - 3) Project name;
 - 4) Brief project description, description of work to be performed, and location; phases of work anticipated (these will require an AHA).
- c. **STATEMENT OF SAFETY AND HEALTH POLICY.** Provide a copy of current corporate/company Safety and Health Policy Statement, detailing commitment to providing a safe and healthful workplace for all employees. The Contractor's written safety program goals, objectives, and accident experience goals for this contract should be provided.
- d. **RESPONSIBILITIES AND LINES OF AUTHORITIES.** Provide the following:
- 1) A statement of the employer's ultimate responsibility for the implementation of his SOH program;
 - 2) Identification and accountability of personnel responsible for safety at both corporate and project level. Contracts specifically requiring safety or industrial hygiene personnel shall include a copy of their resumes.
 - 3) The names of Competent and/or Qualified Person(s) and proof of competency/qualification to meet specific OSHA Competent/Qualified Person(s) requirements must be attached.;
 - 4) Requirements that no work shall be performed unless a designated competent person is present on the job site;

- 5) Requirements for pre-task Activity Hazard Analysis (AHAs);
 - 6) Lines of authority;
 - 7) Policies and procedures regarding noncompliance with safety requirements (to include disciplinary actions for violation of safety requirements) should be identified;
- e. SUBCONTRACTORS AND SUPPLIERS.** If applicable, provide procedures for coordinating SOH activities with other employers on the job site:
- 1) Identification of subcontractors and suppliers (if known);
 - 2) Safety responsibilities of subcontractors and suppliers.
- f. TRAINING.**
- 1) Site-specific SOH orientation training at the time of initial hire or assignment to the project for every employee before working on the project site is required.
 - 2) Mandatory training and certifications that are applicable to this project (e.g., explosive actuated tools, crane operator, rigger, crane signal person, fall protection, electrical lockout/NFPA 70E, machine/equipment lockout, confined space, etc...) and any requirements for periodic retraining/recertification are required.
 - 3) Procedures for ongoing safety and health training for supervisors and employees shall be established to address changes in site hazards/conditions.
 - 4) OSHA 10-hour training is required for all workers on site and the OSHA 30-hour training is required for Trade Competent Persons (CPs)
- g. SAFETY AND HEALTH INSPECTIONS.**
- 1) Specific assignment of responsibilities for a minimum daily job site safety and health inspection during periods of work activity: Who will conduct (e.g., "Site Safety and Health

CP"), proof of inspector's training/qualifications, when inspections will be conducted, procedures for documentation, deficiency tracking system, and follow-up procedures.

- 2) Any external inspections/certifications that may be required (e.g., contracted CSP or CSHT)

h. ACCIDENT INVESTIGATION & REPORTING. The Contractor shall conduct mishap investigations of all OSHA Recordable Incidents. The APP shall include accident/incident investigation procedure & identify person(s) responsible to provide the following to the COR or Government Designated Authority:

- 1) Exposure data (man-hours worked);
- 2) Accident investigations, reports, and logs.

i. PLANS (PROGRAMS, PROCEDURES) REQUIRED. Based on a risk assessment of contracted activities and on mandatory OSHA compliance programs, the Contractor shall address all applicable occupational risks in site-specific compliance and accident prevention plans. These Plans shall include but are not be limited to procedures for addressing the risks associates with the following:

- 1) Emergency response;
- 2) Contingency for severe weather;
- 3) Fire Prevention;
- 4) Medical Support;
- 5) Posting of emergency telephone numbers;
- 6) Prevention of alcohol and drug abuse;
- 7) Site sanitation (housekeeping, drinking water, toilets);
- 8) Night operations and lighting;
- 9) Hazard communication program;
- 10) Welding/Cutting "Hot" work;

- 11) Electrical Safe Work Practices (Electrical LOTO/NFPA 70E);
- 12) General Electrical Safety
- 13) Hazardous energy control (Machine LOTO);
- 14) Site-Specific Fall Protection & Prevention;
- 15) Excavation/trenching;
- 16) Asbestos abatement;
- 17) Lead abatement;
- 18) Crane critical lift;
- 19) Respiratory protection;
- 20) Health hazard control program;
- 21) Radiation Safety Program;
- 22) Abrasive blasting;
- 23) Heat/Cold Stress Monitoring;
- 24) Crystalline Silica Monitoring (Assessment);
- 25) Demolition plan (to include engineering survey);
- 26) Formwork and shoring erection and removal;
- 27) PreCast Concrete.

C. Submit the APP to the COR for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES within 14 calendar days of the receipt of the Notice to Proceed. Work cannot proceed without an accepted APP.

D. Once accepted by the COR, the APP and attachments will be enforced as part of the contract. Disregarding the provisions of this contract or the accepted APP will be cause for stopping of work, at the discretion of the Contracting Officer, until the matter has been rectified.

E. Once work begins, changes to the accepted APP shall be made with the knowledge and concurrence of the COR, project superintendent, project

overall designated OSHA Competent Person, and the facility Safety Officer. Should any severe hazard exposure, i.e. imminent danger, become evident, stop work in the area, secure the area, and develop a plan to remove the exposure and control the hazard. Notify the Contracting Officer within 24 hours of discovery. Eliminate/remove the hazard. In the interim, take all necessary action to restore and maintain safe working conditions in order to safeguard onsite personnel, visitors, the public (as defined by ASSE/SAFE A10.34) and the environment.

F. Reference sample AAP at the conclusion of this Section.

1.5 ACTIVITY HAZARD ANALYSES (AHAS) :

- A. AHAs are also known as Job Hazard Analyses, Job Safety Analyses, and Activity Safety Analyses. Before beginning each work activity involving a type of work presenting hazards not experienced in previous project operations or where a new work crew or sub-contractor is to perform the work, the Contractor(s) performing that work activity shall prepare an AHA (Example electronic AHA forms can be found on the US Army Corps of Engineers web site)
- B. AHAs shall define the activities being performed and identify the work sequences, the specific anticipated hazards, site conditions, equipment, materials, and the control measures to be implemented to eliminate or reduce each hazard to an acceptable level of risk.
- C. Work shall not begin until the AHA for the work activity has been accepted by the COR and discussed with all engaged in the activity, including the Contractor, subcontractor(s), and Government on-site representatives at preparatory and initial control phase meetings.
 - 1. The names of the Competent/Qualified Person(s) required for a particular activity (for example, excavations, scaffolding, fall protection, other activities as specified by OSHA and/or other State and Local agencies) shall be identified and included in the AHA. Certification of their competency/qualification shall be submitted to the Government Designated Authority (GDA) for acceptance prior to the start of that work activity.

2. The AHA shall be reviewed and modified as necessary to address changing site conditions, operations, or change of competent/qualified person(s).
 - a. If more than one Competent/Qualified Person is used on the AHA activity, a list of names shall be submitted as an attachment to the AHA. Those listed must be Competent/Qualified for the type of work involved in the AHA and familiar with current site safety issues.
 - b. If a new Competent/Qualified Person (not on the original list) is added, the list shall be updated (an administrative action not requiring an updated AHA). The new person shall acknowledge in writing that he or she has reviewed the AHA and is familiar with current site safety issues.
3. Submit AHAs to the COR for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES for review within 14 calendar days of the receipt of the Notice to Proceed and at least 14 calendar days prior to the start of each phase after the first phase. Subsequent AHAs shall be formatted as amendments to the APP. The analysis should be used during daily inspections to ensure the implementation and effectiveness of the activity's safety and health controls.
4. The AHA list will be reviewed periodically (at least monthly) at the Contractor supervisory safety meeting and updated as necessary when procedures, scheduling, or hazards change.
5. Develop the activity hazard analyses using the project schedule as the basis for the activities performed. All activities listed on the project schedule will require an AHA. The AHAs will be developed by the contractor, supplier, or subcontractor and provided to the prime contractor for review and approval and then submitted to the COR.

1.6 PRECONSTRUCTION CONFERENCE:

- A. Contractor representatives who have a responsibility or significant role in implementation of the accident prevention program, as required by 29 CFR 1926.20(b)(1), on the project shall attend the

preconstruction conference to gain a mutual understanding of its implementation. This includes the project superintendent, subcontractor superintendents, and any other assigned safety and health professionals.

- B. Discuss the details of the submitted APP to include incorporated plans, programs, procedures and a listing of anticipated AHAs that will be developed and implemented during the performance of the contract. This list of proposed AHAs will be reviewed at the conference and an agreement will be reached between the Contractor and the Contracting Officer's representative as to which phases will require an analysis. In addition, establish a schedule for the preparation, submittal, review, and acceptance of AHAs to preclude project delays.
- C. Deficiencies in the submitted APP will be brought to the attention of the Contractor, and the Contractor shall revise the plan to correct deficiencies and re-submit it for acceptance. Do not begin work until there is an accepted APP.

1.7 "SITE SAFETY AND HEALTH OFFICER" (SSHO) AND "COMPETENT PERSON" (CP):

- A. The Prime Contractor shall designate a minimum of one SSHO at each project site that will be identified as the SSHO to administer the Contractor's safety program and government-accepted Accident Prevention Plan. Each subcontractor shall designate a minimum of one CP in compliance with 29 CFR 1926.20 (b)(2) that will be identified as a CP to administer their individual safety programs.
- B. Further, all specialized Competent Persons for the work crews will be supplied by the respective contractor as required by 29 CFR 1926 (i.e. Asbestos, Electrical, Cranes, & Derricks, Demolition, Fall Protection, Fire Safety/Life Safety, Ladder, Rigging, Scaffolds, and Trenches/Excavations).
- C. These Competent Persons can have collateral duties as the subcontractor's superintendent and/or work crew lead persons as well as fill more than one specialized CP role (i.e. Asbestos, Electrical, Cranes, & Derricks, Demolition, Fall Protection, Fire Safety/Life Safety, Ladder, Rigging, Scaffolds, and Trenches/Excavations).

- D. The SSHO or an equally-qualified Designated Representative/alternate will maintain a presence on the site during construction operations in accordance with FAR Clause 52.236-6: *Superintendence by the Contractor*. CPs will maintain presence during their construction activities in accordance with above mentioned clause. A listing of the designated SSHO and all known CPs shall be submitted prior to the start of work as part of the APP with the training documentation and/or AHA as listed in Section 1.8 below.
- E. The repeated presence of uncontrolled hazards during a contractor's work operations will result in the designated CP as being deemed incompetent and result in the required removal of the employee in accordance with FAR Clause 52.236-5: Material and Workmanship, Paragraph (c).

1.8 TRAINING:

- A. The designated Prime Contractor SSHO must meet the requirements of all applicable OSHA standards and be capable (through training, experience, and qualifications) of ensuring that the requirements of 29 CFR 1926.16 and other appropriate Federal, State and local requirements are met for the project. As a minimum the SSHO must have completed the OSHA 30-hour Construction Safety class and have five (5) years of construction industry safety experience or three (3) years if he/she possesses a Certified Safety Professional (CSP) or certified Construction Safety and Health Technician (CSHT) certification or have a safety and health degree from an accredited university or college.
- B. All designated CPs shall have completed the OSHA 30-hour Construction Safety course within the past 5 years.
- C. In addition to the OSHA 30 Hour Construction Safety Course, all CPs with high hazard work operations such as operations involving asbestos, electrical, cranes, demolition, work at heights/fall protection, fire safety/life safety, ladder, rigging, scaffolds, and trenches/excavations shall have a specialized formal course in the hazard recognition & control associated with those high hazard work operations. Documented "repeat" deficiencies in the execution of safety requirements will require retaking the requisite formal course.

- D. All other construction workers shall have the OSHA 10-hour Construction Safety Outreach course and any necessary safety training to be able to identify hazards within their work environment.
- E. Submit training records associated with the above training requirements to the COR for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES 14 calendar days prior to the date of the preconstruction conference for acceptance.
- F. Prior to any worker for the contractor or subcontractors beginning work, they shall undergo a safety briefing provided by the SSHO or his/her designated representative. As a minimum, this briefing shall include information on the site-specific hazards, construction limits, VAMC safety guidelines, means of egress, break areas, work hours, locations of restrooms, use of VAMC equipment, emergency procedures, accident reporting etc... Documentation shall be provided to the COR that individuals have undergone contractor's safety briefing.
- G. Ongoing safety training will be accomplished in the form of weekly documented safety meeting.

1.9 INSPECTIONS:

- A. The SSHO shall conduct frequent and regular safety inspections (daily) of the site and each of the subcontractors CPs shall conduct frequent and regular safety inspections (daily) of the their work operations as required by 29 CFR 1926.20(b)(2). Each week, the SSHO shall conduct a formal documented inspection of the entire construction areas with the subcontractors' "Trade Safety and Health CPs" present in their work areas. Coordinate with, and report findings and corrective actions weekly to COR.
- B. A Certified Safety Professional (CSP) with specialized knowledge in construction safety or a certified Construction Safety and Health Technician (CSHT) shall randomly conduct a monthly site safety inspection. The CSP or CSHT can be a corporate safety professional or independently contracted. The CSP or CSHT will provide their certificate number on the required report for verification as necessary.

1. Results of the inspection will be documented with tracking of the identified hazards to abatement.
2. The COR will be notified immediately prior to start of the inspection and invited to accompany the inspection.
3. Identified hazard and controls will be discussed to come to a mutual understanding to ensure abatement and prevent future reoccurrence.
4. A report of the inspection findings with status of abatement will be provided to the COR within one week of the onsite inspection.

1.10 ACCIDENTS, OSHA 300 LOGS, AND MAN-HOURS:

- A. Notify the COR as soon as practical, but no more than four hours after any accident meeting the definition of OSHA Recordable Injuries or Illnesses or High Visibility Accidents, property damage equal to or greater than \$5,000, or any weight handling equipment accident. Within notification include contractor name; contract title; type of contract; name of activity, installation or location where accident occurred; date and time of accident; names of personnel injured; extent of property damage, if any; extent of injury, if known, and brief description of accident (to include type of construction equipment used, PPE used, etc.). Preserve the conditions and evidence on the accident site until the COR determines whether a government investigation will be conducted.
- B. Conduct an accident investigation for recordable injuries and illnesses, for Medical Treatment defined in paragraph DEFINITIONS, and property damage accidents resulting in at least \$20,000 in damages, to establish the root cause(s) of the accident. Complete the VA Form 2162, and provide the report to the COR within 7 calendar days of the accident. The COR will provide copies of any required or special forms.
- C. A summation of all man-hours worked by the contractor and associated sub-contractors for each month will be reported to the COR monthly.
- D. A summation of all OSHA recordable accidents experienced on site by the contractor and associated sub-contractors for each month will be provided to the COR monthly. The contractor and associated sub-

contractors' OSHA 300 logs will be made available to the COR as requested.

1.11 PERSONAL PROTECTIVE EQUIPMENT (PPE) :

A. PPE is governed in all areas by the nature of the work the employee is performing. For example, specific PPE required for performing work on electrical equipment is identified in NFPA 70E, Standard for Electrical Safety in the Workplace.

B. Mandatory PPE includes:

1. Hard Hats - unless written authorization is given by the COR, except in circumstances of work operations that have limited potential for falling object hazards such as during finishing work or minor remodeling. With authorization to relax the requirement of hard hats, if a worker becomes exposed to an overhead falling object hazard, then hard hats would be required in accordance with the OSHA regulations.
2. Safety glasses - unless written authorization is given by the COR, appropriate safety glasses meeting the ANSI Z.87.1 standard must be worn by each person on site.
3. Appropriate Safety Shoes - based on the hazards present, safety shoes meeting the requirements of ASTM F2413-11 shall be worn by each person on site unless written authorization is given by the COR.
4. Hearing protection -Use personal hearing protection at all times in designated noise hazardous areas or when performing noise hazardous tasks.

1.12 INFECTION CONTROL

- A. Infection Control is critical in all medical center facilities. Interior construction activities causing disturbance of existing dust, or creating new dust, must be conducted within ventilation-controlled areas that minimize the flow of airborne particles into patient areas.
- B. An AHA associated with infection control will be performed by VA personnel in accordance with FGI Guidelines (i.e. Infection Control

Risk Assessment (ICRA)). The ICRA procedure found on the American Society for Healthcare Engineering (ASHE) website will be utilized. Risk classifications of Class II or lower will require approval by the COR before beginning any construction work. Risk classifications of Class III or higher will require a permit before beginning any construction work. Infection Control permits will be issued by the COR. The Infection Control Permits will be posted outside the appropriate construction area. More than one permit may be issued for a construction project if the work is located in separate areas requiring separate classes. The primary project scope area for this project will be determined by the Infection Control Risk Assessment Team, however, work outside the primary project scope area may vary. The required infection control precautions with each class are as follows:

1. Class I requirements:

a. During Construction Work:

- 1) Notify the COR.
- 2) Execute work by methods to minimize raising dust from construction operations.
- 3) Ceiling tiles: Immediately replace a ceiling tiles displaced for visual inspection.

b. Upon Completion:

- 1) Clean work area upon completion of task.
- 2) Notify the COR.

2. Class II requirements:

a. During Construction Work:

- 1) Notify the COR.
- 2) Provide active means to prevent airborne dust from dispersing into atmosphere such as wet methods or tool mounted dust collectors where possible.
- 3) Water mist work surfaces to control dust while cutting.

- 4) Seal unused doors with duct tape.
 - 5) Block off and seal air vents.
 - 6) Remove or isolate HVAC system in areas where work is being performed.
- b. Upon Completion:
- 1) Wipe work surfaces with cleaner/disinfectant.
 - 2) Contain construction waste before transport in tightly covered containers.
 - 3) Wet mop and/or vacuum with HEPA filtered vacuum before leaving work area.
 - 4) Upon completion, restore HVAC system where work was performed
 - 5) Notify the COR.
3. Class III requirements:
- a. During Construction Work:
- 1) Obtain permit from the COR.
 - 2) Remove or Isolate HVAC system in area where work is being done to prevent contamination of duct system.
 - 3) Complete all critical barriers i.e. sheetrock, plywood, plastic, to seal area from non work area or implement control cube method (cart with plastic covering and sealed connection to work site with HEPA vacuum for vacuuming prior to exit) before construction begins. Install construction barriers and ceiling protection carefully, outside of normal work hours.
 - 4) Maintain negative air pressure, 0.01 inches of water gauge, within work site utilizing HEPA equipped air filtration units and continuously monitored with a digital display, recording and alarm instrument, which must be calibrated on installation, maintained with periodic calibration and monitored by the contractor.

- 5) Contain construction waste before transport in tightly covered containers.
- 6) Cover transport receptacles or carts. Tape covering unless solid lid.

b. Upon Completion:

- 1) Do not remove barriers from work area until completed project is inspected by the COR and thoroughly cleaned by the VA Environmental Services Department.
- 2) Remove construction barriers and ceiling protection carefully to minimize spreading of dirt and debris associated with construction, outside of normal work hours.
- 3) Vacuum work area with HEPA filtered vacuums.
- 4) Wet mop area with cleaner/disinfectant.
- 5) Upon completion, restore HVAC system where work was performed.
- 6) Return permit to the COR.

4. Class IV requirements:

a. During Construction Work:

- 1) Obtain permit from the COR.
- 2) Isolate HVAC system in area where work is being done to prevent contamination of duct system.
- 3) Complete all critical barriers i.e. sheetrock, plywood, plastic, to seal area from non work area or implement control cube method (cart with plastic covering and sealed connection to work site with HEPA vacuum for vacuuming prior to exit) before construction begins. Install construction barriers and ceiling protection carefully, outside of normal work hours.
- 4) Maintain negative air pressure within work site utilizing HEPA equipped air filtration units.
- 5) Seal holes, pipes, conduits, and punctures.

- 6) Construct anteroom and require all personnel to pass through this room so they can be vacuumed using a HEPA vacuum cleaner before leaving work site or they can wear cloth or paper coveralls that are removed each time they leave work site.
- 7) All personnel entering work site are required to wear shoe covers. Shoe covers must be changed each time the worker exits the work area.

b. Upon Completion:

- 1) Do not remove barriers from work area until completed project is inspected by the COR with thorough cleaning by the VA Environmental Services Dept.
- 2) Remove construction barriers and ceiling protection carefully to minimize spreading of dirt and debris associated with construction, outside of normal work hours.
- 3) Contain construction waste before transport in tightly covered containers.
- 4) Cover transport receptacles or carts. Tape covering unless solid lid.
- 5) Vacuum work area with HEPA filtered vacuums.
- 6) Wet mop area with cleaner/disinfectant.
- 7) Upon completion, restore HVAC system where work was performed.
- 8) Return permit to the COR

C. Barriers shall be erected as required based upon classification (Class III & IV requires barriers) and shall be constructed as follows:

1. Class III and IV - closed door with masking tape applied over the frame and door is acceptable for projects that can be contained in a single room.
2. Construction, demolition or reconstruction not capable of containment within a single room must have the following barriers erected and made presentable on hospital occupied side:

- a. Class III & IV (where dust control is the only hazard, and an agreement is reached with the COR and Medical Center) - Airtight plastic barrier that extends from the floor to ceiling. Seams must be sealed with duct tape to prevent dust and debris from escaping.
 - b. Class III & IV - Drywall barrier erected with joints covered or sealed to prevent dust and debris from escaping.
 - c. Class III & IV - Seal all penetrations in existing barrier airtight.
 - d. Class III & IV - Barriers at penetration of ceiling envelopes, chases and ceiling spaces to stop movement air and debris.
 - e. Class IV only - Anteroom or double entrance openings that allow workers to remove protective clothing or vacuum off existing clothing.
 - f. Class III & IV - At elevators shafts or stairways within the field of construction, overlapping flap minimum of two feet wide of polyethylene enclosures for personnel access.
- D. Products and Materials:
1. Sheet Plastic: Fire retardant polystyrene, 6-mil thickness meeting local fire codes.
 2. Barrier Doors: Self Closing solid core wood in steel frame, painted.
 3. Dust proof fire-rated drywall.
 4. High Efficiency Particulate Air-Equipped filtration machine rated at 95% capture of 0.3 microns including pollen, mold spores and dust particles. HEPA filters should have ASHRAE 85 or other prefilter to extend the useful life of the HEPA. Provide both primary and secondary filtrations units. Maintenance of equipment and replacement of the HEPA filters and other filters will be in accordance with manufacturer's instructions.
 5. Exhaust Hoses: Heavy duty, flexible steel reinforced; Ventilation Blower Hose.

6. Adhesive Walk-off Mats: Provide minimum size mats of 24 inches x 36 inches.
 7. Disinfectant: Hospital-approved disinfectant or equivalent product.
 8. Portable Ceiling Access Module.
- E. Before any construction on site begins, all contractor personnel involved in the construction or renovation activity shall be educated and trained in infection prevention measures established by the medical center.
- F. A dust control program will be establish and maintained as part of the contractor's infection preventive measures in accordance with the FGI Guidelines for Design and Construction of Healthcare Facilities. Prior to start of work, prepare a plan detailing project-specific dust protection measures with associated product data, including periodic status reports, and submit to COR for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.
- G. Medical Center Infection Control personnel will monitor for airborne disease (e.g. aspergillosis) during construction. A baseline of conditions will be established by the medical center prior to the start of work and periodically during the construction stage to determine impact of construction activities on indoor air quality with safe thresholds established.
- H. In general, the following preventive measures shall be adopted during construction to keep down dust and prevent mold.
1. Contractor shall verify that construction exhaust to exterior is not reintroduced to the medical center through intake vents, or building openings. HEPA filtration is required where the exhaust dust may reenter the medical center.
 2. Exhaust hoses shall be exhausted so that dust is not reintroduced to the medical center.
 3. Adhesive Walk-off/Carpet Walk-off Mats shall be used at all interior transitions from the construction area to occupied medical center

area. These mats shall be changed as often as required to maintain clean work areas directly outside construction area at all times.

4. Vacuum and wet mop all transition areas from construction to the occupied medical center at the end of each workday. Vacuum shall utilize HEPA filtration. Maintain surrounding area frequently. Remove debris as it is created. Transport these outside the construction area in containers with tightly fitting lids.
5. The contractor shall not haul debris through patient-care areas without prior approval of the COR and the Medical Center. When, approved, debris shall be hauled in enclosed dust proof containers or wrapped in plastic and sealed with duct tape. No sharp objects should be allowed to cut through the plastic. Wipe down the exterior of the containers with a damp rag to remove dust. All equipment, tools, material, etc. transported through occupied areas shall be made free from dust and moisture by vacuuming and wipe down.
6. There shall be no standing water during construction. This includes water in equipment drip pans and open containers within the construction areas. All accidental spills must be cleaned up and dried within 12 hours. Remove and dispose of porous materials that remain damp for more than 72 hours.
7. At completion, remove construction barriers and ceiling protection carefully, outside of normal work hours. Vacuum and clean all surfaces free of dust after the removal.

I. Final Cleanup:

1. Upon completion of project, or as work progresses, remove all construction debris from above ceiling, vertical shafts and utility chases that have been part of the construction.
2. Perform HEPA vacuum cleaning of all surfaces in the construction area. This includes walls, ceilings, cabinets, furniture (built-in or free standing), partitions, flooring, etc.
3. All new air ducts shall be cleaned prior to final inspection.

J. Exterior Construction

1. Contractor shall verify that dust will not be introduced into the medical center through intake vents, or building openings. HEPA filtration on intake vents is required where dust may be introduced.
2. Dust created from disturbance of soil such as from vehicle movement will be wetted with use of a water truck as necessary
3. All cutting, drilling, grinding, sanding, or disturbance of materials shall be accomplished with tools equipped with either local exhaust ventilation (i.e. vacuum systems) or wet suppression controls.

1.13 TUBERCULOSIS SCREENING

- A. Contractor shall provide written certification that contract employees assigned to the work site that are determined to be at risk for transmission of TB have had a pre-placement tuberculin screening within 90 days prior to assignment to the worksite and been found to have negative TB screening reactions. Contractors shall be required to show documentation of negative TB screening reactions for any additional workers who are added after the 90-day requirement before they will be allowed to work on the work site. NOTE: This can be the Center for Disease Control (CDC) and Prevention and two-step skin testing or a Food and Drug Administration (FDA)-approved blood test.
 1. Contract employees manifesting positive screening reactions to the tuberculin shall be examined according to current CDC guidelines prior to working on VHA property.
 2. Subsequently, if the employee is found without evidence of active (infectious) pulmonary TB, a statement documenting examination by a physician shall be on file with the employer (construction contractor), noting that the employee with a positive tuberculin screening test is without evidence of active (infectious) pulmonary TB.
 3. If the employee is found with evidence of active (infectious) pulmonary TB, the employee shall require treatment with a subsequent statement to the fact on file with the employer before being allowed to return to work on VHA property.

1.14 FIRE SAFETY

- A. Fire Safety Plan: Establish and maintain a site-specific fire protection program in accordance with 29 CFR 1926. Prior to start of work, prepare a plan detailing project-specific fire safety measures, including periodic status reports, and submit to COR and Facility Safety Manager for review for compliance with contract requirements in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES. This plan may be an element of the Accident Prevention Plan.
- B. Site and Building Access: Maintain free and unobstructed access to facility emergency services and for fire, police and other emergency response forces in accordance with NFPA 241.
- C. Separate temporary facilities, such as trailers, storage sheds, and dumpsters, from existing buildings and new construction by distances in accordance with NFPA 241. For small facilities with less than 6 m (20 feet) exposing overall length, separate by 3m (10 feet).
- D. Temporary Construction Partitions:
 - 1. Install and maintain temporary construction partitions to provide smoke-tight separations between construction areas and adjoining areas. Construct partitions of gypsum board on the public side and gypsum board or treated plywood (flame spread rating of 25 or less in accordance with ASTM E84) on the construction side of fire retardant treated wood or metal steel studs. Gypsum board joints on the public side of the temporary partition shall be taped and finished. The public side of temporary partitions shall be painted. Extend the partitions through suspended ceilings to floor slab deck or roof. At door openings, install Class C, ¾ hour fire/smoke rated doors with self-closing devices and VA locking system (storeroom type lock always locked from the corridor side). Refer to Drawings for additional requirements.
 - 2. Install temporary construction partitions to maintain integrity of existing exit stair enclosures, exit passageways, fire-rated enclosures of hazardous areas, horizontal exits, smoke barriers, vertical shafts and openings enclosures.

3. Close openings in smoke barriers and fire-rated construction to maintain fire ratings. Seal penetrations with listed through-penetration firestop materials.
- E. Temporary Heating and Electrical: Install, use and maintain installations in accordance with 29 CFR 1926, NFPA 241 and NFPA 70.
- F. Means of Egress: Do not block exiting for occupied buildings, including paths from exits to roads. Minimize disruptions and coordinate with COR.
- G. Egress Routes for Construction Workers: Maintain free and unobstructed egress. Inspect daily. Report findings and corrective actions weekly to COR.
- H. Fire Extinguishers: Provide and maintain extinguishers in construction areas and temporary storage areas in accordance with 29 CFR 1926, NFPA 241 and NFPA 10.
- I. Flammable and Combustible Liquids: Store, dispense and use liquids in accordance with 29 CFR 1926, NFPA 241 and NFPA 30.
- J. Sprinklers: Install, test and activate new automatic sprinklers prior to removing existing sprinklers.
- K. Existing Fire Protection: Do not impair automatic sprinklers, smoke and heat detection, and fire alarm systems, except for portions immediately under construction, and temporarily for connections. Provide fire watch for impairments more than 4 hours in a 24-hour period. Request interruptions in accordance with Article, OPERATIONS AND STORAGE AREAS, and coordinate with COR. All existing or temporary fire protection systems (fire alarms, sprinklers) located in construction areas shall be tested as coordinated with the medical center. Parameters for the testing and results of any tests performed shall be recorded by the medical center and copies provided to the COR.
- L. Smoke Detectors: Prevent accidental operation. Remove temporary covers at end of work operations each day. Coordinate with COR.

- M. Hot Work: Perform and safeguard hot work operations in accordance with NFPA 241 and NFPA 51B. Coordinate with COR. Obtain permits from COR at least 48 hours in advance.
- N. Fire Hazard Prevention and Safety Inspections: Inspect entire construction areas weekly. Coordinate with, and report findings and corrective actions weekly to COR.
- O. Smoking: Smoking is prohibited in and adjacent to construction areas inside existing buildings and additions under construction.
- P. Dispose of waste and debris in accordance with NFPA 241. Remove from buildings daily. (Refer to Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT for GEMS Policy Requirements.)
- Q. Perform other construction, alteration and demolition operations in accordance with 29 CFR 1926.
- R. If required, submit documentation to the COR that personnel have been trained in the fire safety aspects of working in areas with impaired structural or compartmentalization features.
- S. See Section 01 00 00, GENERAL REQUIREMENTS for additional OSHA Requirements and Safety and Health Regulations.

1.15 ELECTRICAL

- A. All electrical work shall comply with NFPA 70 (NEC), NFPA 70B, NFPA 70E, 29 CFR Part 1910 Subpart J - General Environmental Controls, 29 CFR Part 1910 Subpart S - Electrical, and 29 CFR 1926 Subpart K in addition to other references required by contract.
- B. All qualified persons performing electrical work under this contract shall be licensed journeyman or master electricians. All apprentice electricians performing under this contract shall be deemed unqualified persons unless they are working under the immediate supervision of a licensed electrician or master electrician.
- C. All electrical work will be accomplished de-energized and in the Electrically Safe Work Condition (refer to NFPA 70E for Work Involving Electrical Hazards, including Exemptions to Work Permit). Any Contractor, subcontractor or temporary worker who fails to fully comply

with this requirement is subject to immediate termination in accordance with FAR clause 52.236-5(c). Only in rare circumstance where achieving an electrically safe work condition prior to beginning work would increase or cause additional hazards, or is infeasible due to equipment design or operational limitations is energized work permitted. The COR with approval of the Medical Center Director will make the determination if the circumstances would meet the exception outlined above. An AHA specific to energized work activities will be developed, reviewed, and accepted prior to the start of that work.

1. Development of a Hazardous Electrical Energy Control Procedure is required prior to de-energization. A single Simple Lockout/Tagout Procedure for multiple work operations can only be used for work involving qualified person(s) de-energizing one set of conductors or circuit part source. Task specific Complex Lockout/Tagout Procedures are required at all other times.
 2. Verification of the absence of voltage after de-energization and lockout/tagout is considered "energized electrical work" (live work) under NFPA 70E, and shall only be performed by qualified persons wearing appropriate shock protective (voltage rated) gloves and arc rate personal protective clothing and equipment, using Underwriters Laboratories (UL) tested and appropriately rated contact electrical testing instruments or equipment appropriate for the environment in which they will be used.
 3. Personal Protective Equipment (PPE) and electrical testing instruments will be readily available for inspection by the the COR.
- D. Before beginning any electrical work, an Activity Hazard Analysis (AHA) will be conducted to include Shock Hazard and Arc Flash Hazard analyses (NFPA Tables can be used only as a last alternative and it is strongly suggested a full Arc Flash Hazard Analyses be conducted). Work shall not begin until the AHA for the work activity has been accepted by the COR and discussed with all engaged in the activity, including the Contractor, subcontractor(s), and Government on-site representatives at preparatory and initial control phase meetings.

- E. Ground-fault circuit interrupters. All 120-volt, single-phase 15- and 20-ampere receptacle outlets on construction sites shall have approved ground-fault circuit interrupters for personnel protection. "Assured Equipment Grounding Conductor Program" only is not allowed.

1.16 FALL PROTECTION

- A. The fall protection (FP) threshold height requirement is 6 ft (1.8 m) for ALL WORK, unless specified differently or the OSHA 29 CFR 1926 requirements are more stringent, to include steel erection activities, systems-engineered activities (prefabricated) metal buildings, residential (wood) construction and scaffolding work.
 - 1. The use of a Safety Monitoring System (SMS) as a fall protection method is prohibited.
 - 2. The use of Controlled Access Zone (CAZ) as a fall protection method is prohibited.
 - 3. A Warning Line System (WLS) may ONLY be used on floors or flat or low-sloped roofs (between 0 - 18.4 degrees or 4:12 slope) and shall be erected around all sides of the work area (See 29 CFR 1926.502(f) for construction of WLS requirements). Working within the WLS does not require FP. No worker shall be allowed in the area between the roof or floor edge and the WLS without FP. FP is required when working outside the WLS.
 - 4. Fall protection while using a ladder will be governed by the OSHA requirements.

1.17 SCAFFOLDS AND OTHER WORK PLATFORMS

- A. All scaffolds and other work platforms construction activities shall comply with 29 CFR 1926 Subpart L.
- B. The fall protection (FP) threshold height requirement is 6 ft (1.8 m) as stated in Section 1.16.
- C. The following hierarchy and prohibitions shall be followed in selecting appropriate work platforms.

1. Scaffolds, platforms, or temporary floors shall be provided for all work except that can be performed safely from the ground or similar footing.
 2. Ladders less than 20 feet may be used as work platforms only when use of small hand tools or handling of light material is involved.
 3. Ladder jacks, lean-to, and prop-scaffolds are prohibited.
 4. Emergency descent devices shall not be used as working platforms.
- D. Contractors shall use a scaffold tagging system in which all scaffolds are tagged by the Competent Person. Tags shall be color-coded: green indicates the scaffold has been inspected and is safe to use; red indicates the scaffold is unsafe to use. Tags shall be readily visible, made of materials that will withstand the environment in which they are used, be legible and shall include:
1. The Competent Person's name and signature;
 2. Dates of initial and last inspections.
- E. Mast Climbing work platforms: When access ladders, including masts designed as ladders, exceed 20 ft (6 m) in height, positive fall protection shall be used.

1.18 CRANES

- A. All crane work shall comply with 29 CFR 1926 Subpart CC.
- B. Prior to operating a crane, the operator must be licensed, qualified or certified to operate the crane. Thus, all the provisions contained with Subpart CC are effective and there is no "Phase In" date of November 10, 2014.
- C. A detailed lift permit shall be submitted 14 days prior to the scheduled lift complete with route for truck carrying load, crane load analysis, siting of crane and path of swing. The lift will not be allowed without approval of this document.
- D. Crane operators shall not carry loads
 1. over the general public or VAMC personnel

2. over any occupied building unless
 - a. the top two floors are vacated
 - b. or overhead protection with a design live load of 300 psf is provided

1.19 CONTROL OF HAZARDOUS ENERGY (LOCKOUT/TAGOUT)

- A. All installation, maintenance, and servicing of equipment or machinery shall comply with 29 CFR 1910.147 except for specifically referenced operations in 29 CFR 1926 such as concrete & masonry equipment [1926.702(j)], heavy machinery & equipment [1926.600(a)(3)(i)], and process safety management of highly hazardous chemicals (1926.64). Control of hazardous electrical energy during the installation, maintenance, or servicing of electrical equipment shall comply with Section 1.15 to include NFPA 70E and other VA specific requirements discussed in the section.

1.20 CONFINED SPACE ENTRY

- A. All confined space entry shall comply with 29 CFR 1910.146 except for specifically referenced operations in 29 CFR 1926 such as excavations/trenches [1926.651(g)].
- B. A site-specific Confined Space Entry Plan (including permitting process) shall be developed and submitted to the COR.

1.21 WELDING AND CUTTING

As specified in section 1.14, Hot Work: Perform and safeguard hot work operations in accordance with NFPA 241 and NFPA 51B. Coordinate with COR. Obtain permits from COR at least 48 hours in advance.

1.22 LADDERS

- A. All Ladder use shall comply with 29 CFR 1926 Subpart X.
- B. All portable ladders shall be of sufficient length and shall be placed so that workers will not stretch or assume a hazardous position.
- C. Manufacturer safety labels shall be in place on ladders.
- D. Step Ladders shall not be used in the closed position.
- E. Top steps or cap of step ladders shall not be used as a step.

F. Portable ladders, used as temporary access, shall extend at least 3 ft (0.9 m) above the upper landing surface.

1. When a 3 ft (0.9-m) extension is not possible, a grasping device (such as a grab rail) shall be provided to assist workers in mounting and dismounting the ladder.
2. In no case shall the length of the ladder be such that ladder deflection under a load would, by itself, cause the ladder to slip from its support.

G. Ladders shall be inspected for visible defects on a daily basis and after any occurrence that could affect their safe use. Broken or damaged ladders shall be immediately tagged "DO NOT USE," or with similar wording, and withdrawn from service until restored to a condition meeting their original design.

1.23 FLOOR & WALL OPENINGS

A. All floor and wall openings shall comply with 29 CFR 1926 Subpart M.

B. Floor and roof holes/openings are any that measure over 2 in (51 mm) in any direction of a walking/working surface which persons may trip or fall into or where objects may fall to the level below. See 21.F for covering and labeling requirements. Skylights located in floors or roofs are considered floor or roof hole/openings.

C. All floor, roof openings or hole into which a person can accidentally walk or fall through shall be guarded either by a railing system with toeboards along all exposed sides or a load-bearing cover. When the cover is not in place, the opening or hole shall be protected by a removable guardrail system or shall be attended when the guarding system has been removed, or other fall protection system.

1. Covers shall be capable of supporting, without failure, at least twice the weight of the worker, equipment and material combined.
2. Covers shall be secured when installed, clearly marked with the word "HOLE", "COVER" or "Danger, Roof Opening-Do Not Remove" or color-coded or equivalent methods (e.g., red or orange "X"). Workers must

be made aware of the meaning for color coding and equivalent methods.

3. Roofing material, such as roofing membrane, insulation or felts, covering or partly covering openings or holes, shall be immediately cut out. No hole or opening shall be left unattended unless covered.
4. Non-load-bearing skylights shall be guarded by a load-bearing skylight screen, cover, or railing system along all exposed sides.
5. Workers are prohibited from standing/walking on skylights.

- - - E N D - - -

(Name) CONSTRUCTION COMPANY

**SITE SPECIFIC
ACCIDENT PREVENTION
PLAN**

+

CONSTRUCTION HEALTH AND SAFETY PROGRAM

FOR

SCI Outpatient Clinic Addition

**Veterans Affairs Medical Center – Wade Park
Cleveland, Ohio**

Project number given by contracting avoid confusion

PROJECT # 541-CSI-102

CONTRACT # VA541-<A-XYZ>

Bid Issue
07/01/2016

VAMC WADE PARK
Emergency Sewer Repair K-Wing
Project No. 541-16-522

RESPONSIBILITIES AND LINES OF AUTHORITY OF <NAME> CONSTRUCTION COMPANY

The following people have responsibilities and authority for corporate safety:

BACKGROUND INFORMATION (Prime)

- I. Contractor: **<Name>**
<Address>
<City, State Zip>
- II. Project Name: **Wade Park - <Name>**
- III. Project Description: **<Brief Description (541-xx-xxx)>**
- IV. Contractor Accident Record: **<Contractor provide OSHA Log information>**

A. RESPONSIBILITIES

1. Chief Corporate Safety Officer: **<Contact Name (Contact telephone #)>**
<Name> Construction Company
<Title>
2. Site Safety Responsibilities: **<Contact Name (Contact telephone #)>**
<Name> Construction Company
<Title>
3. Project Safety Consulting: **<Contact Name (Contact telephone #)>**
<Name> Construction Company
<Title>

BACKGROUND INFORMATION (SUBCONTRACTOR)

A Site Safety and Health Officer will be provided at the work site at all times to perform safety and occupational health management, surveillance, inspections, and safety enforcement for the Contractor and subcontractors. The SSHO will be employed by the prime. SSHO qualifications with education certificates will be listed in Appendix B.

The competent person for Health Hazard Control and Respiratory Protection Program will conduct and document a hazard assessment in accordance with Section 06 to identify and evaluate. (What form of documentation).

Site Safety and Health Officer (SSHO) shall conduct daily safety and health inspections and maintain a written log which includes area/operation inspected, date of inspection, identified hazards, recommended corrective actions, estimated and actual dates of corrections. Safety inspection logs shall be attached to the Contractors daily quality control report. Current "Safety Logs" shall be readily available upon request.

SIGNATURE SHEET

The following persons are responsible for preparing and approving this plan:

Preparer:

<Contact Name (Phone #)>

<Contact Title>

<Name> Construction Company

Date _____

SCOPE OF WORK SUMMARY

Summary

This job consists of **<Basic Description>** Please include the scope of work submitted for the project

Pre-demolition:

<Describe the activity in sufficient detail to determine the safety program elements that will be required to be addressed in the body of the procedure – Section 6. Use the PCRA (Pre-Construction Risk Assessment) along with the Scope of Work to determine which elements need to be addressed for the pre-demolition phase.>

Demolition:

<Describe the activity in sufficient detail to determine the safety program elements that will be required to be addressed in the body of the procedure – Section 6. PCRA (Pre-Construction Risk Assessment) along with the Scope of Work to determine which elements need to be addressed for each of the demolition phase.>

Construction:

<Describe the activity in sufficient detail to determine the safety program elements that will be required to be addressed in the body of the procedure Section - 6. PCRA (Pre-Construction Risk Assessment) along with the Scope of Work to determine which elements need to be addressed for the construction phase.>

1. SITE ACCESS:

- a) Parking onsite is not provided by the VAMC Cleveland at the Wade Park Facility

- b) Access into the facility will be through entrances located close to the work area to avoid patient care areas. The following entrance that will be used by <Name> Construction Company employees will be submitted in writing or on the drawings:

<Enter the specific building access to be used>

2. WORK AREA SECURITY:

- a) All <Name> Construction Company employees will wear company identification badges or those provided by VAMC Cleveland Police Service.

- b) Patients, visitors and unauthorized VAMC Cleveland employees will be kept out of work areas using locked doors, barricades and safety postings as appropriate.

3. PLAN FOR PREVENTION OF ALCOHOL AND DRUG ABUSE

<Review – replace with your own company policy if this doesn't work for you>

- a) Due to the nature of our work, it is critical that all employees are free from the adverse effects of drugs and/or alcohol. The company is committed to providing a safe workplace for all its employees. The goal of this policy is to maintain a safe and secure work environment that is free from the effects of alcohol and drug abuse.

- b) The intent of this policy is to be responsive to the employees health needs by the early recognition and treatment of chemical dependency problems and behavioral/medical disorder, and to support the rights of the company and its employees to work within an alcohol / drug free environment.

c) This policy is not applicable to physician prescribed drugs. Employees on such medication(s), which may adversely affect their job performance, should promptly discuss the matter with their supervisor.

- Failure of the employee to so notify their supervisor can result in disciplinary action including discharge.
- It should be noted that while legal, prescribed drugs could adversely affect the safety of the employee and other employees on the site.
- All <Name> Construction employees are drug tested before hiring, periodically, and annually.

4. SITE SAFETY AUDITS (Inspections):

a) INTERNAL INSPECTIONS

The site supervisor, who is the <Name> Construction competent person, will conduct the Site Safety and Health inspections. The competent person's certifications are located in Appendix B. <Put the Certifications in the Appendix B.> There will two types of safety inspections that will be performed on this job site.

(1) A weekly Safety and Health inspection and report will be conducted by the site supervisor. The inspection forms will document and track the following information:

- Any Violations
- Date of violation
- Nature of violation
- Needed corrective action
- Date of correction
- Name of responsible person(s)

(a) In addition to the above items he will also notify any employee and/or subcontractor in writing of any violations.

- (b) This information will be followed up on by the COR or Construction Safety Group, as needed and/or requires immediate attention to the violations. (Should he notify VA of findings?)
- (c) All safety inspection forms are reviewed to ensure that all noted corrective actions are within the applicable OSHA and Veterans Affairs Safety and Health Manual guidelines.
- (d) This documentation will be kept (readily available?) at the project field office, and will aid in the audits of the Accident Prevention Plan.

(2) The second type of Safety and Health Inspection will be a daily checklist.

(a) This too, will be performed each workday onsite, by the site supervisor.

(b) This documentation will be kept at the project field office, and will aid in the audits of the Accident Prevention Plan. (this too Should be made readily available?)

b) EXTERNAL INSPECTORS/CONSTRUCTION ROUNDS

(1) At various times there may be announced and unannounced visits to the work area of any of the Contracted Construction Projects. They may be visited by

some or all of the members of the Construction Safety Inspection Group.

(2) Prior to the activity of cutting and/or welding, the COR for the Veterans Affairs will be contacted to assist in scheduling a site inspection and submission for a burn permit.

(3) Prior to any activity including digging and/or excavating, the COR for the Veterans Affairs will be contacted to assist in scheduling a site inspection and submission for a permit.

(4) Prior to any activity including the renovation and/or penetration of rated walls, the COR for the Veterans Affairs will be contacted to assist in

scheduling a site inspection and submission for a permit.

(5) Prior to any activity including the removal or repair of Asbestos

Containing Building Material, the COR for the Veterans Affairs will be contacted to assist in scheduling a site inspection and submission for a permit.

c) INSPECTIONS BY OUTSIDE PARTIES i.e., OSHA, EPA, etc.

(1) Presentation of Credentials - Upon arrival at the work site or facility, the Compliance Officer must display his or her credentials and will ask to meet with the appropriate employer representative.

(2) The contractor must notify the projects COR immediately upon the initial contact of the Compliance Officer's contact.

(3) Opening Conference – During an opening conference, the compliance officer will explain the purpose of the inspection. The contractor's management representative must be prepared to discuss actions that have been taken to demonstrate their company's commitment to the health and safety of employees (e.g. work practices, safety and industrial hygiene standards, safety manuals, training conducted, internal inspections, etc).

(4) An authorized employee representative will be given the opportunity to attend the opening conference and to accompany the compliance officer during the inspection. Employees may also be consulted during the conduct of the inspection. Employees who participate in the inspection, or are consulted by the compliance officer, are protected from discrimination for exercising their safety and health rights under the "Whistle Blowers Act".

(5) A contractor management representative and a VAMC Cleveland Safety representative must accompany the compliance officer during the inspection and keep accurate notes of any actual or possible violations found by the compliance officer. Obvious violations detected by the compliance officer should be corrected on the spot where possible.

- (6) It is imperative that existing operations, reports, logs, etc. not be misrepresented to the compliance officer. The penalty for making false statements or representation to OSHA or its compliance officers is a maximum of \$10,000 and 6 months imprisonment. In addition, the offending party can be subject to discipline by the company up to and including discharge.
- (7) Closing Conference - After the inspection has been conducted, a closing conference will be held between the compliance officer, the employer and employee representatives and VAMC Cleveland. This is the best time, before possible issuance of a citation, to explain the company's position. It is imperative that we question any proposed findings or abatement periods that are unreasonable. Request that any citations be sent to the company with a copy to the VAMC Cleveland safety office.

5. SAFETY TRAINING /EDUCATION:

a) Site orientation training:

All employees on site will be required to attend a Safety Training Orientation at the start of the project, or before they begin work at the job site. The site supervisor, competent person, will conduct the training. Training on the applicable requirements of this Site Specific Training Plan is mandatory and must be documented.

b) Supervisor and employee safety meetings:

The primary site supervisor, who is the competent person (certifications located in Appendix B), will conduct the initial employee site safety orientation. Mandatory safety meetings will be held on a weekly basis. Safety and health topics will vary from week to week on subject matter, utilizing the 29 CFR 1910 and 29 CFR 1926 standards, along with the Veterans Affairs Safety and Health Program and issues raised during construction.

<Place documentation of training sign-in sheets and agenda in Appendix B>

c) Employee training:

<Name> Construction Company employees will be trained, at the site safety orientation on the following topics:

- When PPE is necessary.
- What PPE is necessary and which PPE has been selected for each process the employee operates.
- How to properly put on, take off, adjust, and wear PPE.

6. ACCIDENT REPORTING:

All <Name> Construction employees on site will be required to attend an “Accident and Event Reporting” Orientation class at the start of the project, or before they begin work at the job site. The site supervisor, competent person, will conduct the above mentioned training.

a) Accident investigations, reports, and logs:

The project manager and site supervisor will conduct all accident and near miss investigations. The site supervisor will maintain the OSHA 300 log. All documentation will be kept on the job site. Certifications for competent person(s) are located in Appendix B.

b) Immediate notification of major accidents:

Should a major accident occur, the following notifications will take place as soon as any injured person(s) are cared for:

<Contact Name, Title>

<Contact Name, Title>

<Contact Name, Title>

VA Safety Representative: Frank Wunderle

Local Emergency Services:

For Wade Park

Hospital VA Wade Park Medical Facility
 10701 East Blvd.
 Cleveland, Ohio 44106
 Dial 2222 from any VA Phone

Hospital University Hospitals
 11100 Euclid Avenue
 Cleveland, Ohio 44106
 911 / (216) 844-1000

Fire Department 911 / 216-664-6813

Security Dial 4207 from any VA Phone

For Brecksville

Hospital VA Brecksville Medical Facility
 10000 Brecksville Rd..
 Brecksville, Ohio 44141
 Dial 2222 from any VA Phone

Hospital Marymount medical Center
 2001 East Royalton Rd.

Broadview Hts., Ohio 44147

440.717.5800

Fire Department 911 / 440-526-2640

Security Dial 4207 from any VA Phone

This listing will be posted in the field office.

c) Accident response plan:

<Name> Construction Company intends to make certain all emergency incidents are handled in a proper and safe manner giving priority to the following:

- Life Safety
- Property Conservation
- Emergency Situation Investigation
- Return to Normal Operations

d) Exposure data / man hours worked:

- (1) This section covers the following operations <Fill in operation/s requiring additional training> unless the employer can demonstrate that the operation does not involve employee exposure or the reasonable possibility for employee exposure to safety or health hazards. Example; (a negative impact statement or asbestos abatement)
- (2) This information will be maintained by the site supervisor and verified by <Contact Name>. A daily log will be maintained of all man hours worked. This information will also be used to determine the final TIR for the project. Any data collected will be submitted to the COR for their report.

7. EMERGENCY RESPONSE PLAN:

This plan covers the actions of all <Name> Construction employees. All subcontractors on site will be required to submit for approval, to <Name> Construction Company, their own site specific Emergency Response Plan. If not adequate, the subcontractor and their employees must be orientated to the <Name> Construction Company's "SITE SPECIFIC EMERGENCY RESPONSE PLAN", before they can begin work at this site.

a) Chemical Safety:

As part of this program, <Name> Construction Company will inform subcontractors, or their representatives of the site emergency response procedures and any potential fire, explosion, health, safety, or other hazards.

The following procedures address emergency response as follows:

- Pre-emergency planning and coordination with outside parties:
VAMC (COR) will receive notification of date to start work, along with MSDS's of all substances brought onto the facility.
- Personal roles, lines of authority, training, and communication:

The personnel utilizing chemicals will contain the substances brought onto the facility. Plumbers will contain and handle all compressed gas cylinders, providing they have been trained and documented.

In the case where a situation occurs that they cannot handle, all employees will be trained on evacuating the area, notifying the on-site supervisor, and workers in the immediate worksite.

- Emergency recognition and prevention:

All workers will, at the safety orientation, be informed of this site-specific emergency response plan and procedures.

All workers will be responsible to recognize hazards and their prevention, practice this at all times on the worksite.

All workers will be responsible to answer question from surveyors about general safety, health, and emergency procedures wherever they are on site.

b) Emergency plan for severe weather:

For the site-specific severe weather conditions that employees may encounter during the project, <Name> Construction Company has developed the following procedures. First, <Name> Construction Company employees will adhere to all NWS warnings and advisories. For snowfall, the policy for workers is that a Level Three emergency, which is predicted heavy snow fall, or other dangerous weather conditions.

- Safe distances and places of refuge:

All workers at this site will be informed of the designated location of the safe zone. This will also be posted in the field office for all to be reminded of. In the event of an emergency occurrence, and the Local Fire Department, or any other entity is summoned, all workers will report to this zone to be accounted for.

- Site security and control:

In the event of an emergency, workers will notify the site supervisor or project manager of the situation, at that time, workers will report to the safe zone. The site supervisor and/or project manager will notify security and any other applicable authorities. Staying away from the immediate situation and not allowing any unauthorized personnel to enter until proper authorities arrive.

- Evacuation routes and procedures:

Any work will be performed on the interior of the building. Evacuation plans are posted in various locations throughout work area by the VA.

- Decontamination:

This would be required if there is a possibility of a large spill of hazardous material with the potential of contaminating contractor employees. Small spills and personnel contaminations are expected to be cleaned up using the contractors Hazard Communication program and associated MSDS requirements.

c) Medical support:

It will be the duty of all workers onsite, including subcontractors, to immediately report to the site supervisor and/or project manager, COR's any and all emergencies.

The following are items of concern regarding the handling of all medical support requirements:

(1) On site:

- For incidents occurring on site at Wade Park Veterans Affairs Medical Center or Brecksville Veterans Affairs Medical Center; the victim(s) will be stabilized prior to be relocated to another institution.
- For non-emergency support first aid supplies will be kept at the <Name> Construction Company field office. All subcontractors will be required to supply properly trained personnel as well as their own first aid supplies.
- All supplies will be subject to our safety inspections. No one will perform first aid or CPR unless properly trained, and verification of certification is on file at the jobsite.
-

(2) Off site:

- For the Wade Park location, University Hospital Medical Center is located at 11100 Euclid Avenue (216) 844-1000. For the Brecksville location, Marymount medical Center is located on 2001 East Royalton Rd., Broadview Hts., OH 44147.
- Maps are posted and available for all contractors on site (See Appendix A).
- Emergency medical treatment and first aid:
- Emergency alerting and response procedures:
- It will be the duty of all workers onsite, including subcontractors, to immediately respond to the COR's, Construction Safety Team or Outside Inspectors from governmental agencies or agencies approving accreditation regarding their function during an emergency.

(3) Posting of emergency telephone numbers:

The posting of these Emergency Telephone Numbers will be in the job field office, where all workers will have access to them. All employees and subcontractors will be made aware of these and the location at the safety orientation. The numbers are as follows:

| | |
|-----------------|--|
| Hospital | Wade Park Veterans Affairs Medical Center Dial 2222 from any VA Phone |
| | University Hospital 911 / (216) 844-1000 |
| Fire Department | 911 / (216) 664-6813 |

Security

Dial 4207 from any VA Phone

d) Hazard communication program:

This site specific Hazard Communication Plan has been implemented in accordance with 29 CFR 1910.1200.

All areas in which hazardous chemicals will be stored shall have the proper label and/or signs. The MSDS for all chemicals on site will be located in a book labeled MSDS, in the project field office.

The training of employees and subcontractors will be as follows:

- Where to find this program
- What is in this program
- All chemicals on this jobsite
- What is an MSDS
- How to find specific information on an MSDS
- Labeling system
- What area these chemicals are stored in, map indicating
- The proper handling procedures for these chemicals
- Spill/release clean up protocol

Should there be an immediate threat to life or property, the emergency response plan for the installation, which is to be on file at the field office.

It is mandatory that all subcontractors submit, before a new chemical is introduced to the worksite, that the proper MSDS is submitted to the site supervisor/project manager. It will be the responsibility of the site supervisor to inform all employees and subcontractors of the new chemical(s), introduce the MSDS, and the potential hazards of that chemical. The site

supervisor and/or project manager will have the responsibility to notify the Contracting Officer / COR of any and all new chemicals brought onto the facility.

Chemical storage areas, if needed, to be located per VA designated location.

- e) CORRECTIVE ACTIONS INVOLVING CLEAN-UP OPERATIONS AT SITES COVERED BY THE RESOURCE CONSERVATION AND RECOVERY ACT OF 1976 (RCRA) AS AMENDED (42 W.S.C. 6901 ET SEQ).

Clean-up operations required by a governmental body, whether Federal, state, local or other involving hazardous substance that are conducted at uncontrolled hazardous waste sites (including, but not limited to, the EPA's National Priority Site List (NPL), state priority site lists, sites recommended for the EPA, NPL, and initial investigations of government identified sites which area conducted before the presence or absence of hazardous substances has been ascertained;

Voluntary clean-up operations at sites recognized by Federal, state, local or other governmental bodies as uncontrolled hazardous waste sites;

Operations involving hazardous waste that area conducted at treatment, storage, disposal (TSD) facilities regulated by 40 CFR Parts 264 and 265 pursuant to RCRA; or by agencies under agreement with U.S.E.P.A. to implement RCRA regulations; and Emergency response operations for releases of, or substantial threats of releases of, hazardous substances with regard to the location of the hazard.

8. FIRE PREVENTION PLAN:

We at <Name> Construction Company limit our employees participation to the use of portable fire extinguishers. The site supervisor at safety orientation will cover this Plan. The following topics will include:

- a) All areas controlled by the primary contractor are required to maintain fire protection during their occupancy. As a minimum smoke detectors and heat sensors shall be in place whenever the areas original fire protection has been compromised.

- b) All fire extinguishers must be checked and tagged every thirty day

- c) The general principles of fire extinguisher use and the hazards involved with incipient stage firefighting.

- d) Actions to be taken by authorized person(s)
 - (1) Evacuate area.
 - (2) Notify site supervisor and/or project manager.
 - (3) Determine if fire is incipient
 - (4) Utilize fire extinguisher.
 - (5) If fire or smoke is too great, report to safe zone.
 - (6) Make call to Fire Department if instructed by supervisor and/or project manager.

- e) Actions to be taken by unauthorized person(s)
 - (1) Evacuate area
 - (2) Notify supervisor and/or project manager.
 - (3) Report to safe zone.
 - (4) Make call to Fire Department if instructed by site supervisor and/or project manager.

- f) Only approved fire extinguishers will be onsite and checked on a daily basis by the site supervisor. These will be located in the following areas, but not limited to:
 - (1) Portable Fire Extinguishers
 - (2) Individual Roles and Responsibilities
 - (3) Fire Watch

- (4) Response Plans
- (5) Safe Zone
- (6) Notification
- (7) Site Mapping
- (8) Inside field office.
- (9) In any area where cutting or welding is taking place

g) The following sections listed below are all part of this Accident Prevention Plan. The information below contains additional requirements that are part of this Fire Prevention Plan:

- Safety and Health Inspections
- Firefighting Plan
- Posting of Emergency Numbers
- Hazard Communication Program
- Site Sanitation Plan

- (1) The risk of a job site fire can be avoided through; safety and health inspections, housekeeping, proper maintenance, proper storage and handling, ensuring all employees and subcontractors are performing their designated work duties properly, the handling of supplies and equipment as directed, following all guidelines set forth through operating manuals, instructions, and training,
- (2) All employees and subcontractors require the proper storage of combustibles. Combustible liquids must be stored and covered in approved containers.
- (3) All chemical spills including, of course, combustible liquids, must be cleaned up immediately.
- (4) All chemical and chemical products will be handled and stored in accordance with the procedures noted on their individual MSDS

Note: Care must be taken when cleaning up chemical spills. Information on appropriate personal protective equipment, proper disposal, proper cleanup procedures, required ventilation, etc is found on the products MSDS.

- (5) Cleanup materials and damaged containers must be properly disposed.
 - (6) Combustible liquids and trash must be segregated and stored away from ignition sources.
 - (7) Approved portable fire extinguishers will be checked on daily basis, ensuring they are charged and ready for use.
 - (8) Smoking is not permitted inside the facility. Only designated areas by the VA will be permitted (outside), with smoking debris discarded in designated areas..
 - (9) Debris will not be allowed to accumulate on the job site and will be maintained daily.
- h) Submission of a Burn Permit. **<Name>** Construction will submit a Burn Permit to the COR to perform acetylene oxygen welding, brazing and cutting, the following precautionary measures will be required as part of this permit along with any additional requirements by the VA Medical Center Policy 138-012 (Hot Work):
- (1) Inspect all surroundings and equipment to insure that combustible substances are not present in any area where contact of metal at a temperature above the flashpoint of any compound is possible.
 - (2) Ensure that no open containers or spills of combustible substances are present.
 - (3) Ensure that ignition is not possible by conduction, convection, radiation, or

dispersion of molten metal.

(4) Proper protection equipment and practices will be used, i.e., fireproof blankets, removal of combustible materials where practicable, and portable fire extinguishers of proper type on hand.

(5) When the above operations are in use a continuous Fire Watch will be performed while equipment is being used.

(6) Training in fire protection will occur at the site safety orientation. This training shall include the following topics, but not limited to:

a. <List of Topics>

9. SITE SAFETY RULES:

<Name> Construction Company has developed a comprehensive safety and health program that addresses our specific safety and health concerns and provides guidance for the performance of our individual job tasks within the framework of appropriate Occupational Safety and Health Administration (OSHA) standards.

Safety requires not only that each person understand and perform individual tasks in a safe manner, but also that each individual is aware of his/her surroundings and is actively involved in the safety and health of others.

- a) No Smoking: Smoking is not permitted inside the facility. Only designated areas by the VA will be permitted (outside), with smoking debris discarded in designated areas.

- b) Accidents: In the event of an emergency, workers will notify the site supervisor or project manager of the situation, at that time, workers will report to the safe zone. The site supervisor and/or project manager will notify security and any other applicable authorities.

The goals for all projects are as follows:

SAFETY REQUIREMENTS
SITE SPECIFIC ACCIDENT PREVENTION PLAN - SAMPLE

- (1) Zero accident rate
- (2) Zero injury/illness rate
- (3) Compliance with all applicable Local, State, OSHA standards and Veterans Affairs Safety Directives

c) Hard Hats: Head Protection will be as follows:

- All workers on this site will be required to wear approved hard hats when working in the close proximity of heavy equipment and where structural steel is being hoisted

- In the area where another workers activities may exposing them to injury.

d) Hazard Reporting: Each employee is encouraged to contact their Supervisor immediately should a safety or health risk exist so that corrective action may be taken immediately.

e) Controlled Substances: Therefore, the following actions are strictly prohibited and will prompt disciplinary action up to and including consideration for immediate discharge:

- (1) The illegal use, sale, arranging for sale, possession or manufacturing of narcotics, drugs or controlled substances while on the job or on VA property.
- (2) The use of alcohol or illegal drugs while on the job or VA property.

f) Safety Devices: <Name> Construction Company has fulfilled all required Safety and Health Plans and Programs according to regulation, and has installed all required safety device for the equipment being used for the tasks. Failure to use or to disable the mentioned safety device relating to CFR 1910 and 1926 standards to ensure 100% safety will be grounds for review .

The goal is to provide the company and its workers protection against those individuals who refuse to act in a consistently safe manner.

Without proper enforcement, the policy will not be able to deliver the intended results. Therefore, it is essential that all employees be held accountable to these guidelines for disciplinary actions up to and including discharge.

g) Personnel Protective Equipment: Procedures for implementing an effective PPE policy in accordance with 29 CFR 1910.132, will be as follows:

- (1) During a pre-construction walk through, **<Contact Name>**, the Project Manager, will perform a job site hazard assessment.
 - (b) HAZARD ASSESSMENT: The purpose of the survey is to identify sources of hazards to workers and co-workers. The documentation of this hazard assessment is located in PCRA (Pre-Construction Risk Assessment)
 - (c) POTENTIAL HAZARD SOURCES **<Adjust based on scope of work>**
 - **<Surfaces that could become slick, uneven walking and working surfaces>**
 - **<Welding / Brazing Hazards>**
 - **<Quality Air Control>**
 - **<Electrical Hazards>**
 - **<Potential Overhead Obstructions (above ceiling)>**
 - **<Fall Protection>**
 - **<Rolling or pinching objects>**
 - **<Sharp objects that might pierce feet or cut hands>**
 - **<Motion that includes tool movement, moving machinery, or machine parts, or movement of**

personnel that could result in collision with stationary objects.>

(d) EMPLOYEE TRAINING: <Name> Construction Company employees will be trained, at the site safety orientation on the following topics:

- When PPE is necessary.
- What PPE is necessary and which PPE has been selected for each process the employee operates.
- How to properly put on, take off, adjust and wear PPE.

(2) Each of the basic hazards has been reviewed and a determination made as to the type, level of risk, and seriousness of potential injury.

- When exposure to hazards cannot be engineered completely out of normal operations or maintenance work.
- When safe work practices cannot provide sufficient additional protection.
- A Final method of control is through the use of protective clothing or equipment. These include eye protection, steel-toed shoes, hard hats, hearing protection, gloves, and fall protection

(3) Consideration has been given to the possibility of exposure to several hazards at once. The general procedure for determining appropriate protective equipment is to:

- Identify the potential hazards and the type of protective equipment that is available, and what protection it provides.
- Compare the capabilities of various types of PPE with the hazards associated with the environment.
- Select the PPE, which provides a level of protection greater than the minimum required to protect employees from the hazards.
- Select PPE that will fit each employee properly and provides protection from the hazard.

- The Hazard Assessment Worksheet is located in Appendix D.

h) Horseplay: Safety training needs will be identified by continual reassessment of our work methods, equipment and job sites as well as employee and management input. Observation of unsafe acts will be addressed immediately.

i) Reporting Under the Influence:

(1) Arriving at work or working under the influence of alcohol or illegal drugs, narcotics or controlled substances.

(2) Any illegal substance confiscated pursuant to this policy will be turned over to the proper authorities.

j) Flammable Liquid Storage: It is mandatory that all subcontractors submit, before a new chemical is introduced to the worksite, that the proper MSDS is submitted to the site supervisor/project manager. It will be the responsibility of the site supervisor to inform all employees and subcontractors of the new chemical(s), introduce the MSDS, and the potential hazards of that chemical. The site supervisor and/or project manager will have the responsibility to notify the Contracting Officer / COR of any and all new chemicals brought onto the facility.

k) Heavy Equipment Operation

10. WEEKLY CONTRACTOR REVIEWS:

a) The primary site supervisor, who is the competent person (certifications in Appendix will conduct the initial employee site safety orientation.

b) Mandatory safety meetings will be held on a weekly basis. Safety and health topics will vary from week to week on subject matter, utilizing the 29 CFR 1910 and 29 CFR 1926 standards, along with the Veterans Affairs Safety and Health Program and issues

raised during construction.(Place documentation of training sign-in sheets and agenda in Appendix B)

c) Safety takes a commitment from all personnel within our organization. Weekly Training will be interactive with an opportunity for all to actively participate, ask questions, make suggestions, and refer to our written policies and procedures.

11. COMPETENT PERSON:

a) A Site Safety and Health Officer (SSHO) will be provided at the work site at all times to perform safety and occupational health management, surveillance, inspections, and safety enforcement for the Contractor and subcontractors.

b) The SSHO will be employed by the prime. SSHO qualifications with education certificates will be listed in Appendix B.

d) There will be a competent person for maintaining a Health Hazard Control and Respiratory Protection Program. They will conduct and document a hazard assessment in accordance with Section 06 to identify and evaluate the need and level of protection required for the activities being scheduled. (What form of documentation).

d) Conduct daily safety and health inspections and maintain a written log which includes area/operation inspected, date of inspection, identified hazards, recommended corrective actions, estimated and actual dates of corrections. Safety inspection logs shall be attached to the Contractors daily quality control report. Current "Safety Logs" shall be readily available upon request.

12. WRITTEN PROTOCOLS FOR OUTSIDE INSPECTIONS:

a) Presentation of Credentials - Upon arrival at the work site or facility, the OSHA compliance officer must display his or her credentials and will ask to meet with the appropriate employer representative.

b) The contractor must notify the COR immediately upon the initial OSHA Contact.

- (1) Opening Conference – During an opening conference, the compliance officer will explain the purpose of the inspection. Contractor Management representatives must be prepared to discuss actions that have been taken to demonstrate their company's commitment to the health and safety of employees (e.g. work practices, safety and industrial hygiene standards, safety manuals, training conducted, internal inspections, etc).
- (2) An authorized employee representative will be given the opportunity to attend the opening conference and to accompany the compliance officer during the inspection. Employees may also be consulted during the conduct of the inspection. Employees who participate in the inspection, or are consulted by the compliance officer, are protected under the OSHA act from discrimination for exercising their safety and health rights.
- (3) A contractor management representative and a VAMC Cleveland Safety representative must accompany the compliance officer during the inspection and keep accurate notes of any actual or possible violations found by the compliance officer. Obvious violations detected by the compliance officer should be corrected on the spot where possible.
- (4) It is imperative that existing operations, reports, logs, etc. not be misrepresented to the compliance officer. The penalty for making false statements or representation to OSHA or its compliance officers is a maximum of \$10,000 and 6 months imprisonment. In addition, the offending party can be subject to discipline by the company up to and including discharge
- (5) Closing Conference - After the inspection has been conducted, a closing conference will be held between the compliance officer, the employer and employee representatives and VAMC Cleveland. This is the best time, before possible issuance of a citation, to explain the company's position. It is imperative that we question any proposed findings or abatement periods that are unreasonable. Request that any citations be sent to the company with a copy to the VAMC Cleveland safety office.

13. SUBCONTRACTOR SITE SPECIFIC SAFETY PLAN:

As part of employment with <Name> Construction Company, **employees** are required to comply with all aspects **of their** corporate level "Safety and Health Plan".

- Supervisors are expected and required to comply with all aspects of the corporate level "Safety and Health Plan" as well as to enforce all applicable requirements at the jobsite.
- Supervisors are expected and required to complete all necessary site safety documentation in a complete and timely manner.
- Supervisors are required to report all safety incidents to the main office as soon as possible. The projects COR is to be notified ASAP. The above items represent the method used to ensure our goals are met.

14. REQUIRED POSTERS:

This Policy Statement will be conspicuously posted in the job site office along with all other required postings including the OSHA Form 300, Log and Summary of Occupational Injuries and Illnesses.

15. SUBCONTRACTOR/SUPPLIERS ORIENTATION PROGRAM:

a) Identification of subcontractors:

<Name of Subcontractor> (List all subcontractors expected to be on site)

b) Controlling and coordination of subcontractors and suppliers:

Suppliers will be under close supervision during material delivery and pick-up. Communication with suppliers will be important to ensure loads are put in designated areas, and supplier is made aware of any immediate hazards in the area he/she will be

in. A project schedule has been coordinated and submitted for approval for the coordination of the scope of work being performed.

c) SAFETY RESPONSIBILITIES OF SUBCONTRACTORS AND SUPPLIERS:

All subcontractors will be responsible to Submit and implement their corporate level Safety and Health Plan as appropriate for the project. Subcontractor shall submit these documents to <Name> Construction Company for approval prior to the start of their activities on the work site. In addition, they will be responsible for adhering to all applicable OSHA and the Veterans Affairs Safety and Health Program requirements. These documents will be verified through our own site safety inspections and meetings.

In the event that a subcontractor does not have the required safety and health programs, their employees will receive training utilizing <Name> Construction Company's safety and health programs prior to accessing the work site. This training will be documented and compliance with the provisions of <Name> Construction Company's Safety and Health programs will be mandatory as well as being readily accessible.

16. REPORTING OF CATASTROPHIC EVENTS:

It is the policy of <Name> Construction Company to provide a work environment that is inherently safe. The safety and health of our employees is of primary importance as they are our most important resource

- Pre-emergency planning and coordination with outside parties:

VAMC (COR) will receive notification of date to start work, along with MSDS's of all substances brought onto the facility.

- Personal roles, lines of authority, training, and communication:

The personnel utilizing chemicals will contain the substances brought onto the facility. Plumbers will contain and handle all compressed gas cylinders, providing they have been trained and documented.

In the case where a situation occurs that they cannot handle, all employees will be trained on evacuating the area, notifying the on-site supervisor, and workers in the immediate worksite.

- Emergency recognition and prevention:

All workers will, at the safety orientation, be informed of this site-specific emergency response plan and procedures.

All workers will be responsible to recognize hazards and their prevention, practice this at all times on the worksite.

All workers will be responsible to answer question from surveyors about general safety, health, and emergency procedures wherever they are on site.

- Safe distances and places of refuge:

All workers at this site will be informed of the designated location of the safe zone. This will also be posted in the field office for all to be reminded of. In the event of an emergency occurrence, and the Local Fire Department, or any other entity is summoned, all workers will report to this zone to be accounted for.

- Site security and control:

In the event of an emergency, workers will notify the site supervisor or project manager of the situation, at that time, workers will report to the safe zone. The site supervisor and/or project manager will notify security and any other applicable authorities. Staying away from the immediate situation and not allowing any unauthorized personnel to enter until proper authorities arrive.

- Evacuation routes and procedures:

Any work will be performed on the interior of the building. Evacuation plans are posted in various locations throughout work area by the VA.

- Decontamination:

This would be required if there is a possibility of a large spill of hazardous material with the potential of contaminating contractor employees. Small spills and personnel contaminations are expected to be cleaned up using the contractors Hazard Communication program and associated MSDS requirements.

- Emergency medical treatment and first aid:
- Emergency alerting and response procedures:

It will be the duty of all workers onsite, including subcontractors, to immediately report to the site supervisor and/or project manager, COR's any and all emergencies

17. Site specific plans to address PCRA:

- a. Only those hazards identified as "yes" on the PCRA need to be addressed.
- b. Modify the description of the safety precautions as needed to address the specific concern. You may refer to a company policy or company rule book to describe the safety precautions or safety plan; however, we will need to have a copy of your plan or policy on file.
- c. To place a check in the box
 - right click on the box
 - Click "Properties"
 - Click "Checked"
 - Click "OK"

Pre Construction Risk Assessment (PCRA)

| | Description of safety precautions or reference to contractor Safety Procedures |
|--------------------------|--|
| <input type="checkbox"/> | <p>(1) Respiratory Protection Plan</p> <ul style="list-style-type: none"> ○ Describe of ACTIVITY requiring respiratory protection if applicable ○ NEED documentation of training. ○ Need documentation of fit test. |
| <input type="checkbox"/> | <p>(2) Hearing: Protection Plan Any area with noise levels at or above 85dba will be required to wear hearing protection. When workers are utilizing loud equipment, or being exposed to such levels, hearing protection shall be provided.</p> |
| <input type="checkbox"/> | <p>(3) PPE other: Personal protective equipment (PPE) includes hard hats, gloves, safety glasses, steel-toed shoes/boots, hearing protection, and personal fall protection.</p> <p style="margin-left: 40px;">Eye protection will be as follows:</p> <ul style="list-style-type: none"> ○ Safety glasses used for any worker performing, observing tasks that may result in flying objects, dust, or in the area where another workers activities may exposing them to eye injury. ○ During welding/cutting operations, the required filter lenses will be utilized according to the operation, electrode size and arc current. <p style="margin-left: 40px;">Foot Protection:</p> <ul style="list-style-type: none"> ○ All workers will be required to wear the appropriate foot protection. ○ Steel-toed shoes/boots are mandatory. <p style="margin-left: 40px;">Hand Protection:</p> <ul style="list-style-type: none"> ○ Workers may be exposed to hand injuries from; <ul style="list-style-type: none"> ▪ sharp objects, |

| | |
|--------------------------|--|
| | <ul style="list-style-type: none"> ▪ abrasive materials ▪ and weather. ○ Gloves designed to protect against the specific hazard encountered are an effective means of reducing such risks and will be used on this project. |
| <input type="checkbox"/> | <p>(4) Overhead hazards: <(Example)There will be X critical lifts required on this project. A crane will be utilized to load new materials onto Xth floor roof and remove demolished material from the roof. A plan will be submitted and approved prior to this work being performed.></p> |
| <input type="checkbox"/> | <p>(5) Confined space: Procedures for entering a confined space depend on the type of confined space and the scope of work associated with the entry.</p> <ul style="list-style-type: none"> a) The VAMC Cleveland Confined Space Entry Program provides the detailed information necessary for regulatory compliance. The contractor may use the VAMC Program or their own providing that it meets regulatory compliance and is reviewed and approved before entry is made. b) Under no circumstances should a person enter into a posted confined space without notifying the COR. A “Shutdown Request” reviewed by Occupational Health and Safety and approved by the COR will be used for this notification. c) Sub-basements are considered non-permit required confined spaces unless welding is performed or other hazards introduced that may create a hazardous atmosphere. When atmospheric hazards are identified then the sub-basements will be worked under the alternate procedure provisions provided that continuous ventilation is used to control the atmospheric hazard. d) Areas posted as “Permit Required” confined spaces will not be entered unless the hazards are eliminated and the space is reclassified. All tanks, voids, ventilation ducts and sewers are considered “Permit Required” confined spaces unless a hazard assessment is conducted and the space is reclassified. e) Employees entering confined spaces will be trained. Training will be based on the Confined Space Entry Program, ANSI National Standard “Safety Requirements for working in Tanks and other Confined Spaces” (ANSI Z117.1), or equivalent training |
| <input type="checkbox"/> | <p>(6) Ladders: Workers that may be performing work on ladders are instructed to adhere to the following:</p> |

| | |
|--------------------------|---|
| | <ul style="list-style-type: none"> ▪ Inspect before using ▪ Place ladder using 4 to 1 rule ▪ Never place base of ladder on objects ▪ Never place ladder in front of door unless ▪ Door is blocked in open position ▪ Door is demarcated off ▪ Door is locked |
| <input type="checkbox"/> | <p>(7) Scaffolding: For work that requires scaffolding use for employees and subcontractors, personal fall protection shall be mandatory, unless working less than 6 ft. The following topics listed will be conveyed to workers prior to scaffolding use</p> <ul style="list-style-type: none"> ▪ Review scaffolding supplier pamphlet for proper construction ▪ Inspect scaffolding structure before initial use/and daily ▪ Report any defects immediately / do not use / tag out of service ▪ Placement of structure ▪ When fall protection is required ▪ What you can tie off to |
| <input type="checkbox"/> | <p>(8) Work platforms: Describe type of platform required and specific requirements for its use.</p> |
| <input type="checkbox"/> | <p>(9) Fall protection: Personal Fall Protection <Name> Construction Company requires all employees working at or above 6' to wear personal fall protection, unless the personal fall protection creates a safety hazard by utilizing it. In that case, other means of fall protection shall be provided.</p> |
| <input type="checkbox"/> | <p>(10) Asbestos: As part of the Asbestos program, <Name> Construction Company will inform subcontractors, or their representatives of the site emergency response procedures and any potential fire, explosion, health, safety, or other hazards. The substances listed in Section 13, paragraph c, under MSDS, have the potential to be released or spilled. Section 13.c, Hazard Communication, lists some potential hazards that contractors and/or subcontractors may encounter. Also listed are the</p> |

| | |
|--------------------------|---|
| | response actions to be taken and the proper notification. |
| <input type="checkbox"/> | (11) Hazardous materials: The substances listed in Section 13 paragraph c, under MSDS, have the potential to be released or spilled. Section 13 c, Hazard Communication, lists some potential hazards that contractors and/or subcontractors may encounter. Also listed are the response actions to be taken and the proper notification. MSDS sheets must be made available for review by the VAMC and contracted employees. |
| <input type="checkbox"/> | (12) Hot work: The <Name> Construction Company will follow VAMC Cleveland's Hot work Policy (MCP 138-012), <Name> Construction will submit a Hot Work Permit to the COR to perform acetylene oxygen welding, brazing and cutting, the following precautionary measures will be required. <ul style="list-style-type: none"> ▪ Inspect all surroundings and equipment to insure that combustible substances are not present in any area where contact of metal at a temperature above the flashpoint of any compound is possible. ▪ Ensure that no open containers or spills of combustible substances are present. ▪ Ensure that ignition is not possible by conduction, convection, radiation, or dispersion of molten metal. ▪ Proper protection equipment and practices will be used, i.e., fireproof blankets, removal of combustible materials where practicable, and portable fire extinguishers of proper type on hand. ▪ When the above operations are in use a continuous Fire Watch will be performed while equipment is being used. ▪ Training in fire protection will occur at the site safety orientation. |
| <input type="checkbox"/> | (13) Ventilation: <Describe the type of forced ventilation that will be used and the reason it is required. Example: A 500 CFM Red Devil blower will be set up for welding operations in the sub-basement. The exhaust of this blower will be directed to the outside.> |
| <input type="checkbox"/> | (14) Power distribution: Describe the circumstances that would make it necessary for disruption of power from the main power lines or associated transformers entering the facility. |

| | |
|--------------------------|---|
| | |
| <input type="checkbox"/> | <p>(15) Work being done on energized equipment: Any work to be done on Energized Equipment must be done in accordance with Medical Center Policy (MCP) 138 – 03 (Working on Energized Equipment). The Medical Centers Directors permission is required to work any circuit energized. A Energized Circuit Work permit must be approved before starting work.</p> |
| <input type="checkbox"/> | <p>(16) Other electric: List Specifics</p> |
| <input type="checkbox"/> | <p>(17) Loto:</p> <ul style="list-style-type: none"> ▪ Only VA Employees will manipulate breakers or valves to perform a Lock Out Tag unless specific permission (in writing) is obtained by the Assistant Chief Engineering, M&O. ▪ The VA will hang Locks or tags on valves or breakers as requested by the project manager. ▪ After the VA places their lock on the device, then <Name> Construction Company will be allowed to place their lock on the device. ▪ When clearing the Lock Out Tag Out, <Name> Construction. ▪ Company will remove <Name> Construction's locks and notify the COR. ▪ The VA will then remove the VA locks and reposition the valve or breaker at the request of <Name> Construction Company. |
| <input type="checkbox"/> | <p>(18) Crane operation: <(Example) There will be X critical lifts required on this project. A crane will be utilized to load new materials onto Xth floor roof and remove demolished material from the roof. A plan will be submitted and approved prior to this work being performed.></p> |
| <input type="checkbox"/> | <p>(19) Excavating; Trenches, ditches – Describe the type, name of competent person, trench boxes required and if necessary air sampling requirements.</p> |
| <input type="checkbox"/> | <p>(20) Earthmoving: (Example) The use of this equipment will be required on this project for moving of earth. Safety will be the responsibility of the company performing the work.</p> |

| | |
|--------------------------|---|
| | |
| <input type="checkbox"/> | <p>(21) Industrial trucks: (Example) The use of this equipment will be required on this project for loading materials onto the Xth floor roof. Industrial truck safety will be the responsibility of the company performing the work.</p> |
| <input type="checkbox"/> | <p>(22) Other motorized equipment: List type and specific use. Only qualified operators will be allowed to operate motorized equipment. Diesel powered equipment will not be used near medical Center Ventilation Intakes.</p> |
| <input type="checkbox"/> | <p>(23) Concrete, Masonry operations: Describe the work to be performed and what fall protection will be provided for workers on forms that are higher than six feet.</p> |
| <input type="checkbox"/> | <p>(24) Steel Erection: Describe the type of steel erection, fire protection coatings used and fall protection requirements if not already addressed in (10) Fall Protection.</p> |
| <input type="checkbox"/> | <p>(25) Alteration or Improvement of existing Electrical transmission and distribution lines and equipment. – Describe the scope of work and provisions made to ensure that the facility does not lose power during the work.</p> |
| <input type="checkbox"/> | <p>(26) Hand & portable tools</p> <p>a) Hand Tools</p> <ol style="list-style-type: none"> .1 For your own protection, do not misuse your tools. Use tools only for the purpose for which they were designed. .2 Your job will be easier and much safer if tools are in good condition. Take care in handling and storing tools. .3 You and the person in charge must be satisfied that all the tools you use on the job, whether they are Company- or personally-owned, are in safe condition. .4 Tools with mushroomed heads, loose, split or broken handles, broken screw drivers, defective pliers, wrenches with spread jaws, defective cords, ground wires and plugs, etc., must not be used. .5 Never use a defective tool. Defective tools are to be removed from |

service and marked defective.

- .6 For your own protection, do not misuse your tools.
- .7 Cover sharp-edged and pointed tools with scabbards and guards. Always use the guards when the tools are not in use.
- .8 Never strike the hardened part of one tool against the hardened part of another tool or against any hardened surface.
- .9 Never use a file with a tang unless it is equipped with a handle.
- .10 Never throw tools from one person to another or from one level to another.
- .11 Hot tools, equipment or materials on tables or benches, even if they are metal covered, shall be properly identified.
- .12 Never use improper handles when you work with jacks. Always remove handles when they are not being used.
- .13 Never use metal-shielded spotlights or flashlights around exposed electrical equipment.

b) Extension Cords

- .1 Use only approved extension cords and lamp guards. Extension cord lamps used in explosion-hazard atmospheres, such as oil vapor or flammable gases, must be equipped with guards and vapor-proof globes. Do not use a lamp with a switch.
- .2 When you use an extension cord around switchboards, switch structures or electrical equipment, it must have a non-metallic socket and guard.
- .3 Use only specially approved low voltage (6 or 12 Volt) extension cords or ground fault circuit interrupter (GFCI) when you need portable lighting in wet locations. This type of cord should be used when you work outdoors, in tanks or in other areas where moisture or condensation may be a hazard.
- .4 Use GFCI protected circuits where required by the electric code. If there is a question about the requirements, contact Engineering Service for resolution.

c) Tool Containers

- .1 Cover any grating to prevent your tools or material from falling. When you are working on scaffolds or platforms, use a suitable container for any of your tools that are not actually being used.

d) Power Tools

- .1 Always wear the proper personal protective equipment including but not limited to eye protection.
- .2 Before you use any power tool, check to make sure:
 - .it is properly tested;
 - all guards are in place;
 - all material is properly secured;
 - you disconnect the tool electrically before inserting or removing any attachments; and
 - you use GFCI protected circuits when required.
- .3 While a machine is in operation:
 - never remove chips with your hand; always use a suitable brush, hook or stick;
 - do not let the machine run unattended;
 - do not place tools or materials on machines where they can be jarred or pushed off;
 - never try to stop a machine using your hands or any other part of your body as a brake; and
 - both hands shall be used when working with portable tools.
- .4 You must unplug power tools when they are left unattended. You must shut off and de-pressurize (bleed down) pneumatic- or hydraulic-operated tools when they are left unattended.
- .5 Keep the floor around machines clean and free from oil. If you spill any oil, wipe it up immediately or use an oil absorbent. Slipping is one of the most common causes of accidents.
- .6 Carefully inspect grinding machines before you use them. Be sure that:

| | |
|--------------------------|--|
| | <ul style="list-style-type: none"> • you perform a ring test prior to installing a new wheel; • the wheel is secure on the driving shaft; • the wheel is in good condition; dress or replace the wheel as necessary; • the work rest is adjusted properly; and • the safety guard is in place and allows proper visibility to do the work. • Do not use the side of the wheel for grinding, unless it is specifically designed for side grinding. • Many wheels cannot stand up under side grinding. • Never drive a grinding wheel at speeds above that specified by the manufacturer. • When you grind small objects, hold them firmly in place with a suitable tool, not with your fingers. • Do not grind soft metals such as aluminum |
| <input type="checkbox"/> | <p>(27) Compressed Gasses: Compressed gas cylinders may be used at this worksite. These cylinders and gases present an injury hazard in the event that a regulator or cylinder is damaged and/or broken. The particular gases used will be <Name Gas>. These hazards will be reduced by routine inspections and maintenance of compressed gas cylinders and by assuring all the units are secured from tipping. Safety caps will be installed on all cylinders that are not in use.</p> <p>Compressed gas cylinder will be kept away from excessive heat, will not be stored where they might be damaged or knocked over by passing or falling objects. The storage of oxygen and fuel gas compressed cylinders will be separated by at least 20 ft.</p> |
| <input type="checkbox"/> | <p>(28) Other hazardous activities <(Name and describe safety precautions)></p> |
| <input type="checkbox"/> | <p>(29) Infection Control : Infection Control (216-791-3800 Ext 4791) has been contacted for work in patient care or high risk areas to conduct an Infection Control Risk Assessment (ICRA). Provisions of the ICRA will be followed unless changed by Infection Control.</p> |
| <input type="checkbox"/> | <p>(30) Life Safety: Occupational Health and Safety 216-791-3800 Ext 4172 has been contacted to conduct a Life Safety Risk Assessment. Interim Life Safety measures</p> |

| | |
|--------------------------|---|
| | <p>have been determined and will be posted outside of the construction area. Fire extinguishers will be provided inside the construction area and they will be inspected at a minimum of 30 day intervals. Provisions of the Interim Life Safety measures will be followed unless modified by Occupational Health and Safety. If penetrations are made in smoke/fire barriers the COR will verify that they have been appropriately sealed before project completion.</p> |
| <input type="checkbox"/> | <p>(31) Emergency Procedures: Standard Emergency Response Plan is described in section 7. Additional provisions required for rescuing employees working at heights or working in Permit Required Confined Spaces will be as follows: <Describe Specifics></p> |
| <input type="checkbox"/> | <p>(32) Demolition: Demolition is described in the Scope of Work Summary. Collection of demolition debris for recycling will minimize dust generation. All containers will be covered and employees will use appropriate methods for controlling the spread of dust outside the construction zone.</p> |
| <input type="checkbox"/> | <p>(33) New Construction Recycling: A minimum of <X%> of total project waste will be diverted to a landfill.</p> <p>a) Concrete b) Steel</p> |
| <input type="checkbox"/> | <p>(34) Interior Remodeling Recycling: A minimum of <X%> of total project waste will be diverted to a landfill.</p> <p>a) Ceiling Tile b) Steel c) Carpet</p> |
| <input type="checkbox"/> | <p>(35) General Recycling: The following categories of waste shall be diverted from a landfill (Check all that apply):</p> |
| <input type="checkbox"/> | Green Waste (Biodegradable landscaping material) |
| <input type="checkbox"/> | Soil |
| <input type="checkbox"/> | Inserts (concrete, asphalt, masonry) |
| <input type="checkbox"/> | Clean dimensional wood, palette wood |
| <input type="checkbox"/> | Engineered wood products, plywood, particle board, I joints, etc. |


| | |
|--------------------------|---------------------------|
| <input type="checkbox"/> | Cardboard Paper packaging |
| <input type="checkbox"/> | Asphalt Roofing materials |
| <input type="checkbox"/> | Insulation |
| <input type="checkbox"/> | Gypsum board |
| <input type="checkbox"/> | Carpet and pad |
| <input type="checkbox"/> | Paint |
| <input type="checkbox"/> | Plastics: ABX, PVC |
| <input type="checkbox"/> | Beverage containers |

APPENDIX A

Evacuation Routes Work Zone Layouts and Maps to Emergency Services

Contractor and subcontractors working in the Medical Center will follow the posted exit signs and maps to evacuate the medical Center. To ensure all employees have been evacuated, they will meet at **<Location>**.

Map from VAMC Cleveland (Wade Park Division) to University Hospital

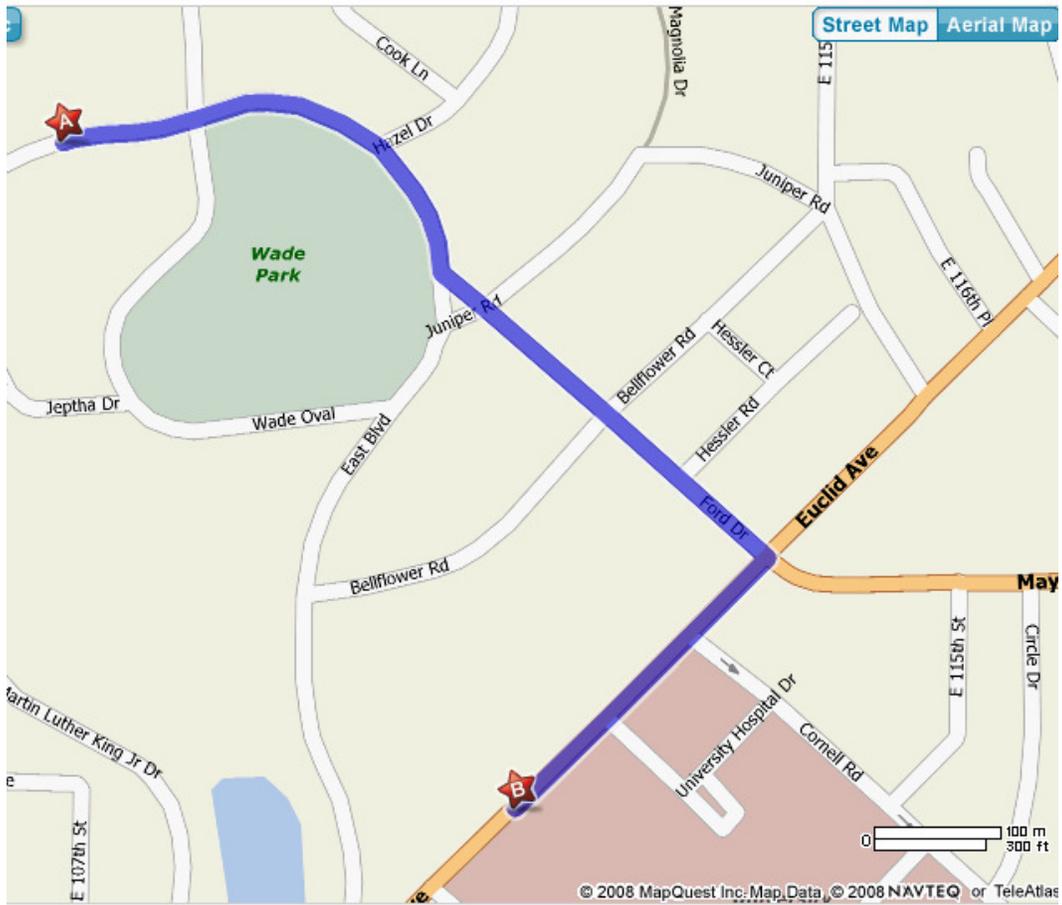

APPENDIX B

CERTIFICATIONS & JOBSITE DOCUMENTATION PROGRAM

<List all individuals including their titles, who have completed

1. **OSHA 30 Hour Construction Safety Course**
2. **OSHA 10 Hour construction Safety Course**
3. **Competent Person Certifications for Respiratory Protection, Fall Protection, Trenching and Shoring, etc. as required by the Scope of Work and applicable regulations.>**

APPENDIX C

CONTRACTOR ACCIDENT RECORD

OSHA 300 FORM

<To be updated and maintained in the on site construction office or the
service company if an office is not located on station.>

**SECTION 01 42 19
REFERENCE STANDARDS**

PART 1 - GENERAL

1.1 DESCRIPTION

This section specifies the availability and source of references and standards specified in the project manual under paragraphs APPLICABLE PUBLICATIONS and/or shown on the drawings.

1.2 AVAILABILITY OF SPECIFICATIONS LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS FPMR PART 101-29 (FAR 52.211-1) (AUG 1998)

- A. The GSA Index of Federal Specifications, Standards and Commercial Item Descriptions, FPMR Part 101-29 and copies of specifications, standards, and commercial item descriptions cited in the solicitation may be obtained for a fee by submitting a request to - GSA Federal Supply Service, Specifications Section, Suite 8100, 470 East L'Enfant Plaza, SW, Washington, DC 20407, Telephone (202) 619-8925, Facsimile (202) 619-8978.
- B. If the General Services Administration, Department of Agriculture, or Department of Veterans Affairs issued this solicitation, a single copy of specifications, standards, and commercial item descriptions cited in this solicitation may be obtained free of charge by submitting a request to the addressee in paragraph (a) of this provision. Additional copies will be issued for a fee.

1.3 AVAILABILITY FOR EXAMINATION OF SPECIFICATIONS NOT LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS (FAR 52.211-4) (JUN 1988)

The specifications and standards cited in this solicitation can be examined at the following location:

DEPARTMENT OF VETERANS AFFAIRS
Office of Construction & Facilities Management
Facilities Quality Service (00CFM1A)
425 Eye Street N.W, (sixth floor)
Washington, DC 20001
Telephone Numbers: (202) 632-5249 or (202) 632-5178
Between 9:00 AM - 3:00 PM

1.4 AVAILABILITY OF SPECIFICATIONS NOT LISTED IN THE GSA INDEX OF FEDERAL SPECIFICATIONS, STANDARDS AND COMMERCIAL ITEM DESCRIPTIONS (FAR 52.211-3) (JUN 1988)

The specifications cited in this solicitation may be obtained from the associations or organizations listed below.

| | |
|--------|---|
| AA | Aluminum Association Inc. http://www.aluminum.org |
| AABC | Associated Air Balance Council http://www.aabchq.com |
| AAMA | American Architectural Manufacturer's Association http://www.aamanet.org |
| AAN | American Nursery and Landscape Association http://www.anla.org |
| AASHTO | American Association of State Highway and Transportation Officials http://www.aashto.org |
| AATCC | American Association of Textile Chemists and Colorists http://www.aatcc.org |
| ACGIH | American Conference of Governmental Industrial Hygienists http://www.acgih.org |
| ACI | American Concrete Institute http://www.aci-int.net |
| ACPA | American Concrete Pipe Association http://www.concrete-pipe.org |
| ACPPA | American Concrete Pressure Pipe Association http://www.acppa.org |
| ADC | Air Diffusion Council http://flexibleduct.org |
| AGA | American Gas Association http://www.aga.org |

| | |
|--------|--|
| AGC | Associated General Contractors of America http://www.agc.org |
| AGMA | American Gear Manufacturers Association, Inc. http://www.agma.org |
| AHAM | Association of Home Appliance Manufacturers http://www.aham.org |
| AISC | American Institute of Steel Construction http://www.aisc.org |
| AISI | American Iron and Steel Institute http://www.steel.org |
| AITC | American Institute of Timber Construction http://www.aitc-glulam.org |
| AMCA | Air Movement and Control Association, Inc. http://www.amca.org |
| ANLA | American Nursery & Landscape Association http://www.anla.org |
| ANSI | American National Standards Institute, Inc. http://www.ansi.org |
| APA | The Engineered Wood Association http://www.apawood.org |
| ARI | Air-Conditioning and Refrigeration Institute http://www.ari.org |
| ASAE | American Society of Agricultural Engineers http://www.asae.org |
| ASCE | American Society of Civil Engineers http://www.asce.org |
| ASHRAE | American Society of Heating, Refrigerating, and Air-Conditioning Engineers http://www.ashrae.org |

| | |
|-------|--|
| ASME | American Society of Mechanical Engineers http://www.asme.org |
| ASSE | American Society of Sanitary Engineering http://www.asse-plumbing.org |
| ASTM | American Society for Testing and Materials http://www.astm.org |
| AWI | Architectural Woodwork Institute http://www.awinet.org |
| AWS | American Welding Society http://www.aws.org |
| AWWA | American Water Works Association http://www.awwa.org |
| BHMA | Builders Hardware Manufacturers Association http://www.buildershardware.com |
| BIA | Brick Institute of America http://www.bia.org |
| CAGI | Compressed Air and Gas Institute http://www.cagi.org |
| CGA | Compressed Gas Association, Inc. http://www.cganet.com |
| CI | The Chlorine Institute, Inc. http://www.chlorineinstitute.org |
| CISCA | Ceilings and Interior Systems Construction Association http://www.cisca.org |
| CISPI | Cast Iron Soil Pipe Institute http://www.cispi.org |
| CLFMI | Chain Link Fence Manufacturers Institute http://www.chainlinkinfo.org |

CPMB Concrete Plant Manufacturers Bureau
<http://www.cpmb.org>

CRA California Redwood Association
<http://www.calredwood.org>

CRSI Concrete Reinforcing Steel Institute
<http://www.crsi.org>

CTI Cooling Technology Institute
<http://www.cti.org>

DHI Door and Hardware Institute
<http://www.dhi.org>

EGSA Electrical Generating Systems Association
<http://www.egsa.org>

EEI Edison Electric Institute
<http://www.eei.org>

EPA Environmental Protection Agency
<http://www.epa.gov>

ETL ETL Testing Laboratories, Inc.
<http://www.etl.com>

FAA Federal Aviation Administration
<http://www.faa.gov>

FCC Federal Communications Commission
<http://www.fcc.gov>

FPS The Forest Products Society
<http://www.forestprod.org>

GANA Glass Association of North America
<http://www.cssinfo.com/info/gana.html/>

FM Factory Mutual Insurance
<http://www.fmglobal.com>

GA Gypsum Association
<http://www.gypsum.org>

GSA General Services Administration
<http://www.gsa.gov>

HI Hydraulic Institute
<http://www.pumps.org>

HPVA Hardwood Plywood & Veneer Association
<http://www.hpva.org>

ICBO International Conference of Building Officials
<http://www.icbo.org>

ICEA Insulated Cable Engineers Association Inc.
<http://www.icea.net>

\ICAC Institute of Clean Air Companies
<http://www.icac.com>

IEEE Institute of Electrical and Electronics Engineers
<http://www.ieee.org>

IMSA International Municipal Signal Association
<http://www.imsasafety.org>

IPCEA Insulated Power Cable Engineers Association

NBMA Metal Buildings Manufacturers Association
<http://www.mbma.com>

MSS Manufacturers Standardization Society of the Valve and Fittings
Industry Inc.
<http://www.mss-hq.com>

NAAMM National Association of Architectural Metal Manufacturers
<http://www.naamm.org>

NAPHCC Plumbing-Heating-Cooling Contractors Association
<http://www.phccweb.org.org>

NBS National Bureau of Standards
See - NIST

NBBPVI National Board of Boiler and Pressure Vessel Inspectors
<http://www.nationboard.org>

NEC National Electric Code
See - NFPA National Fire Protection Association

NEMA National Electrical Manufacturers Association
<http://www.nema.org>

NFPA National Fire Protection Association
<http://www.nfpa.org>

NHLA National Hardwood Lumber Association
<http://www.natlhardwood.org>

NIH National Institute of Health
<http://www.nih.gov>

NIST National Institute of Standards and Technology
<http://www.nist.gov>

NLMA Northeastern Lumber Manufacturers Association, Inc.
<http://www.nelma.org>

NPA National Particleboard Association
18928 Premiere Court
Gaithersburg, MD 20879
(301) 670-0604

NSF National Sanitation Foundation
<http://www.nsf.org>

NWWDA Window and Door Manufacturers Association
<http://www.nwwda.org>

OSHA Occupational Safety and Health Administration
Department of Labor
<http://www.osha.gov>

| | |
|--------|---|
| PCA | Portland Cement Association http://www.portcement.org |
| PCI | Precast Prestressed Concrete Institute http://www.pci.org |
| PPI | The Plastic Pipe Institute http://www.plasticpipe.org |
| PEI | Porcelain Enamel Institute, Inc. http://www.porcelainenamel.com |
| PTI | Post-Tensioning Institute http://www.post-tensioning.org |
| RFCI | The Resilient Floor Covering Institute http://www.rfci.com |
| RIS | Redwood Inspection Service See - CRA |
| RMA | Rubber Manufacturers Association, Inc. http://www.rma.org |
| SCMA | Southern Cypress Manufacturers Association http://www.cypressinfo.org |
| SDI | Steel Door Institute http://www.steeldoor.org |
| IGMA | Insulating Glass Manufacturers Alliance http://www.igmaonline.org |
| SJI | Steel Joist Institute http://www.steeljoist.org |
| SMACNA | Sheet Metal and Air-Conditioning Contractors National Association, Inc. http://www.smacna.org |
| SSPC | The Society for Protective Coatings http://www.sspc.org |

STI Steel Tank Institute
<http://www.steeltank.com>

SWI Steel Window Institute
<http://www.steelwindows.com>

TCA Tile Council of America, Inc.
<http://www.tileusa.com>

TEMA Tubular Exchange Manufacturers Association
<http://www.tema.org>

TPI Truss Plate Institute, Inc.
583 D'Onofrio Drive; Suite 200
Madison, WI 53719
(608) 833-5900

UBC The Uniform Building Code
See ICBO

UL Underwriters' Laboratories Incorporated
<http://www.ul.com>

ULC Underwriters' Laboratories of Canada
<http://www.ulc.ca>

WCLIB West Coast Lumber Inspection Bureau
6980 SW Varns Road, P.O. Box 23145
Portland, OR 97223
(503) 639-0651

WRCLA Western Red Cedar Lumber Association
P.O. Box 120786
New Brighton, MN 55112
(612) 633-4334

WWPA Western Wood Products Association
<http://www.wwpa.org>

- - - E N D - - -

SECTION 01 45 29
TESTING LABORATORY SERVICES

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies materials testing activities and inspection services required during project construction to be provided by the General Contractor.

1.2 APPLICABLE PUBLICATIONS:

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referred to in the text by the basic designation only.
- B. American Association of State Highway and Transportation Officials (AASHTO):
 - T27-11.....Standard Method of Test for Sieve Analysis of Fine and Coarse Aggregates
 - T96-02 (R2006).....Standard Method of Test for Resistance to Degradation of Small-Size Coarse Aggregate by Abrasion and Impact in the Los Angeles Machine
 - T99-10.....Standard Method of Test for Moisture-Density Relations of Soils Using a 2.5 Kg (5.5 lb.) Rammer and a 305 mm (12 in.) Drop
 - T104-99 (R2007).....Standard Method of Test for Soundness of Aggregate by Use of Sodium Sulfate or Magnesium Sulfate
 - T180-10.....Standard Method of Test for Moisture-Density Relations of Soils using a 4.54 kg (10 lb.) Rammer and a 457 mm (18 in.) Drop
 - T191-02(R2006).....Standard Method of Test for Density of Soil In-Place by the Sand-Cone Method
- C. American Concrete Institute (ACI):
 - 506.4R-94 (R2004).....Guide for the Evaluation of Shotcrete
- D. American Society for Testing and Materials (ASTM):
 - A325-10.....Standard Specification for Structural Bolts, Steel, Heat Treated, 120/105 ksi Minimum Tensile Strength
 - A370-12.....Standard Test Methods and Definitions for Mechanical Testing of Steel Products

- A490-12.....Standard Specification for Heat Treated Steel
Structural Bolts, 150 ksi Minimum Tensile
Strength
- C31/C31M-10.....Standard Practice for Making and Curing
Concrete Test Specimens in the Field
- C33/C33M-11a.....Standard Specification for Concrete Aggregates
- C39/C39M-12.....Standard Test Method for Compressive Strength
of Cylindrical Concrete Specimens
- C109/C109M-11b.....Standard Test Method for Compressive Strength
of Hydraulic Cement Mortars
- C136-06.....Standard Test Method for Sieve Analysis of Fine
and Coarse Aggregates
- C138/C138M-10b.....Standard Test Method for Density (Unit Weight),
Yield, and Air Content (Gravimetric) of
Concrete
- C140-12.....Standard Test Methods for Sampling and Testing
Concrete Masonry Units and Related Units
- C143/C143M-10a.....Standard Test Method for Slump of Hydraulic
Cement Concrete
- C172/C172M-10.....Standard Practice for Sampling Freshly Mixed
Concrete
- C173/C173M-10b.....Standard Test Method for Air Content of freshly
Mixed Concrete by the Volumetric Method
- C330/C330M-09.....Standard Specification for Lightweight
Aggregates for Structural Concrete
- C567/C567M-11.....Standard Test Method for Density Structural
Lightweight Concrete
- C780-11.....Standard Test Method for Pre-construction and
Construction Evaluation of Mortars for Plain
and Reinforced Unit Masonry
- C1019-11.....Standard Test Method for Sampling and Testing
Grout
- C1064/C1064M-11.....Standard Test Method for Temperature of Freshly
Mixed Portland Cement Concrete
- C1077-11c.....Standard Practice for Agencies Testing Concrete
and Concrete Aggregates for Use in Construction
and Criteria for Testing Agency Evaluation

- C1314-11a.....Standard Test Method for Compressive Strength
of Masonry Prisms
- D1188-07e1.....Standard Test Method for Bulk Specific Gravity
and Density of Compacted Bituminous Mixtures
Using Coated Samples
- E164-08.....Standard Practice for Contact Ultrasonic
Testing of Weldments
- E329-11c.....Standard Specification for Agencies Engaged in
Construction Inspection, Testing, or Special
Inspection
- E543-09.....Standard Specification for Agencies Performing
Non-Destructive Testing
- E605-93(R2011).....Standard Test Methods for Thickness and Density
of Sprayed Fire Resistive Material (SFRM)
Applied to Structural Members
- E1155-96(R2008).....Determining FF Floor Flatness and FL Floor
Levelness Numbers

E. American Welding Society (AWS):

- D1.D1.1M-10.....Structural Welding Code-Steel

1.3 REQUIREMENTS:

- A. Accreditation Requirements: Construction materials testing laboratories must be accredited by a laboratory accreditation authority and will be required to submit a copy of the Certificate of Accreditation and Scope of Accreditation. The laboratory's scope of accreditation must include the appropriate ASTM standards (i.e.; E329, C1077, D3666, D3740, A880, E543) listed in the technical sections of the specifications. Laboratories engaged in Hazardous Materials Testing shall meet the requirements of OSHA and EPA. The policy applies to the specific laboratory performing the actual testing, not just the "Corporate Office."
- B. Inspection and Testing: Testing laboratory shall inspect materials and workmanship and perform tests described herein and additional tests requested by COR. When it appears materials furnished, or work performed by Contractor fail to meet construction contract requirements, Testing Laboratory shall direct attention of COR to such failure.

- C. Written Reports: Testing laboratory shall submit test reports to COR, Contractor, unless other arrangements are agreed to in writing by the COR. Submit reports of tests that fail to meet construction contract requirements on colored paper.
- D. Verbal Reports: Give verbal notification to COR immediately of any irregularity.

PART 2 - PRODUCTS (NOT USED)

PART 3 - EXECUTION

3.1 CONCRETE:

- A. Batch Plant Inspection and Materials Testing:
 - 1. Perform continuous batch plant inspection until concrete quality is established to satisfaction of COR with concurrence of Contracting Officer and perform periodic inspections thereafter as determined by COR.
 - 2. Periodically inspect and test batch proportioning equipment for accuracy and report deficiencies to COR.
 - 3. Sample and test mix ingredients as necessary to insure compliance with specifications.
 - 4. Sample and test aggregates daily and as necessary for moisture content. Test the dry rodded weight of the coarse aggregate whenever a sieve analysis is made, and when it appears there has been a change in the aggregate.
 - 5. Certify, in duplicate, ingredients and proportions and amounts of ingredients in concrete conform to approved trial mixes. When concrete is batched or mixed off immediate building site, certify (by signing, initialing or stamping thereon) on delivery slips (duplicate) that ingredients in truck-load mixes conform to proportions of aggregate weight, cement factor, and water-cement ratio of approved trial mixes.
- B. Field Inspection and Materials Testing:
 - 1. Provide a technician at site of placement at all times to perform concrete sampling and testing.
 - 2. Review the delivery tickets of the ready-mix concrete trucks arriving on-site. Notify the Contractor if the concrete cannot be placed within the specified time limits or if the type of concrete delivered is incorrect. Reject any loads that do not comply with the Specification requirements. Rejected loads are to be removed from

- the site at the Contractor's expense. Any rejected concrete that is placed will be subject to removal.
3. Take concrete samples at point of placement in accordance with ASTM C172. Mold and cure compression test cylinders in accordance with ASTM C31. Make at least three cylinders for each 40 m³ (50 cubic yards) or less of each concrete type, and at least three cylinders for any one day's pour for each concrete type. After good concrete quality control has been established and maintained as determined by COR make three cylinders for each 80 m³ (100 cubic yards) or less of each concrete type, and at least three cylinders from any one day's pour for each concrete type. Label each cylinder with an identification number. COR may require additional cylinders to be molded and cured under job conditions.
 4. Perform slump tests in accordance with ASTM C143. Test the first truck each day, and every time test cylinders are made. Test pumped concrete at the hopper and at the discharge end of the hose at the beginning of each day's pumping operations to determine change in slump.
 5. Determine the air content of concrete per ASTM C173. For concrete required to be air-entrained, test the first truck and every 20 m³ (25 cubic yards) thereafter each day. For concrete not required to be air-entrained, test every 80 m³ (100 cubic yards) at random. For pumped concrete, initially test concrete at both the hopper and the discharge end of the hose to determine change in air content.
 6. If slump or air content fall outside specified limits, make another test immediately from another portion of same batch.
 7. Perform unit weight tests in compliance with ASTM C138 for normal weight concrete and ASTM C567 for lightweight concrete. Test the first truck and each time cylinders are made.
 8. Notify laboratory technician at batch plant of mix irregularities and request materials and proportioning check.
 9. Verify that specified mixing has been accomplished.
 10. Environmental Conditions: Determine the temperature per ASTM C1064 for each truckload of concrete during hot weather and cold weather concreting operations:
 - a. When ambient air temperature falls below 4.4 degrees C (40 degrees F), record maximum and minimum air temperatures in each

- 24 hour period; record air temperature inside protective enclosure; record minimum temperature of surface of hardened concrete.
- b. When ambient air temperature rises above 29.4 degrees C (85 degrees F), record maximum and minimum air temperature in each 24 hour period; record minimum relative humidity; record maximum wind velocity; record maximum temperature of surface of hardened concrete.
11. Observe conveying, placement, and consolidation of concrete for conformance to specifications.
12. Observe condition of formed surfaces upon removal of formwork prior to repair of surface defects and observe repair of surface defects.
13. Observe curing procedures for conformance with specifications, record dates of concrete placement, start of preliminary curing, start of final curing, end of curing period.
14. Observe preparations for placement of concrete:
- a. Inspect handling, conveying, and placing equipment, inspect vibrating and compaction equipment.
- b. Inspect preparation of construction, expansion, and isolation joints.
15. Observe preparations for protection from hot weather, cold weather, sun, and rain, and preparations for curing.
16. Observe concrete mixing:
- a. Monitor and record amount of water added at project site.
- b. Observe minimum and maximum mixing times.
17. Measure concrete flatwork for levelness and flatness as follows:
- a. Perform Floor Tolerance Measurements F_F and F_L in accordance with ASTM E1155. Calculate the actual overall F- numbers using the inferior/superior area method.
- b. Perform all floor tolerance measurements within 48 hours after slab installation and prior to removal of shoring and formwork.
- c. Provide the Contractor and the COR with the results of all profile tests, including a running tabulation of the overall F_F and F_L values for all slabs installed to date, within 72 hours after each slab installation.
18. Other inspections:
- a. Grouting under base plates.

- b. Grouting anchor bolts and reinforcing steel in hardened concrete.
- C. Laboratory Tests of Field Samples:

1. Test compression test cylinders for strength in accordance with ASTM C39. For each test series, test one cylinder at 7 days and one cylinder at 28 days. Use remaining cylinder as a spare tested as directed by COR. Compile laboratory test reports as follows:
Compressive strength test shall be result of one cylinder, except when one cylinder shows evidence of improper sampling, molding or testing, in which case it shall be discarded and strength of spare cylinder shall be used.
2. Make weight tests of hardened lightweight structural concrete in accordance with ASTM C567.
3. Furnish certified compression test reports (duplicate) to COR. In test report, indicate the following information:
 - a. Cylinder identification number and date cast.
 - b. Specific location at which test samples were taken.
 - c. Type of concrete, slump, and percent air.
 - d. Compressive strength of concrete in MPa (psi).
 - e. Weight of lightweight structural concrete in kg/m³ (pounds per cubic feet).
 - f. Weather conditions during placing.
 - g. Temperature of concrete in each test cylinder when test cylinder was molded.
 - h. Maximum and minimum ambient temperature during placing.
 - i. Ambient temperature when concrete sample in test cylinder was taken.
 - j. Date delivered to laboratory and date tested.

3.2 MASONRY:

- A. Mortar Tests:
1. Laboratory compressive strength test:
 - a. Comply with ASTM C780.
 - b. Obtain samples during or immediately after discharge from batch mixer.
 - c. Furnish molds with 50 mm (2 inch), 3 compartment gang cube.
 - d. Test one sample at 7 days and 2 samples at 28 days.
 2. Two tests during first week of operation; one test per week after initial test until masonry completion.

B. Grout Tests:

1. Laboratory compressive strength test:
 - a. Comply with ASTM C1019.
 - b. Test one sample at 7 days and 2 samples at 28 days.
 - c. Perform test for each 230 m² (2500 square feet) of masonry.

C. Masonry Unit Tests:

1. Laboratory Compressive Strength Test:
 - a. Comply with ASTM C140.
 - b. Test 3 samples for each 460 m² (5000 square feet) of wall area.

- D. Prism Tests: For each type of wall construction indicated, test masonry prisms per ASTM C1314 for each 460 m² (5000 square feet) of wall area. Prepare one set of prisms for testing at 7 days and one set for testing at 28 days.

3.3 STRUCTURAL STEEL:

- A. General: Provide shop and field inspection and testing services to certify structural steel work is done in accordance with contract documents. Welding shall conform to AWS D1.1 Structural Welding Code.

B. Prefabrication Inspection:

1. Review design and shop detail drawings for size, length, type and location of all welds to be made.
2. Approve welding procedure qualifications either by pre-qualification or by witnessing qualifications tests.
3. Approve welder qualifications by certification or retesting.
4. Approve procedure for control of distortion and shrinkage stresses.
5. Approve procedures for welding in accordance with applicable sections of AWS D1.1.

C. Fabrication and Erection:

1. Weld Inspection:
 - a. Inspect welding equipment for capacity, maintenance and working condition.
 - b. Verify specified electrodes and handling and storage of electrodes in accordance with AWS D1.1.
 - c. Inspect preparation and assembly of materials to be welded for conformance with AWS D1.1.
 - d. Inspect preheating and interpass temperatures for conformance with AWS D1.1.
 - e. Measure 25 percent of fillet welds.

- f. Welding Magnetic Particle Testing: Test in accordance with ASTM E709 for a minimum of:
 - 1) 20 percent of all shear plate fillet welds at random, final pass only.
 - 2) 20 percent of all continuity plate and bracing gusset plate fillet welds, at random, final pass only.
 - 3) 100 percent of tension member fillet welds (i.e., hanger connection plates and other similar connections) for root and final passes.
 - 4) 20 percent of length of built-up column member partial penetration and fillet welds at random for root and final passes.
 - 5) 100 percent of length of built-up girder member partial penetration and fillet welds for root and final passes.
 - g. Welding Ultrasonic Testing: Test in accordance with ASTM E164 and AWS D1.1 for 100 percent of all full penetration welds, braced and moment frame column splices, and a minimum of 20 percent of all other partial penetration column splices, at random.
 - h. Verify that correction of rejected welds are made in accordance with AWS D1.1.
 - i. Testing and inspection do not relieve the Contractor of the responsibility for providing materials and fabrication procedures in compliance with the specified requirements.
2. Bolt Inspection:
- a. Inspect high-strength bolted connections in accordance AISC Specifications for Structural Joints Using ASTM A325 or A490 Bolts.
 - b. Slip-Critical Connections: Inspect 10 percent of bolts, but not less than 2 bolts, selected at random in each connection in accordance with AISC Specifications for Structural Joints Using ASTM A325 or A490 Bolts. Inspect all bolts in connection when one or more are rejected.
 - c. Fully Pre-tensioned Connections: Inspect 10 percent of bolts, but not less than 2 bolts, selected at random in 25 percent of connections in accordance with AISC Specification for Structural Joints Using ASTM A325 or A490 Bolts. Inspect all bolts in connection when one or more are rejected.

- d. Bolts installed by turn-of-nut tightening may be inspected with calibrated wrench when visual inspection was not performed during tightening.
 - e. Snug Tight Connections: Inspect 10 percent of connections verifying that plies of connected elements have been brought into snug contact.
 - f. Inspect field erected assemblies; verify locations of structural steel for plumbness, level, and alignment.
- D. Submit inspection reports, record of welders and their certification, and identification, and instances of noncompliance to COR.

3.4 STEEL DECKING:

- A. Provide field inspection of welds of metal deck to the supporting steel, and testing services to insure steel decking has been installed in accordance with contract documents and manufacturer's requirements.
- B. Qualification of Field Welding: Qualify welding processes and welding operators in accordance with "Welder Qualification" procedures of AWS D1.1. Refer to the "Plug Weld Qualification Procedure" in Part 3 "Field Quality Control."
- C. Submit inspection reports, certification, and instances of noncompliance to COR.

3.5 SHEAR CONNECTOR STUDS:

- A. Provide field inspection and testing services required by AWS D.1 to insure shear connector studs have been installed in accordance with contract documents.
- B. Tests: Test 20 percent of headed studs for fastening strength in accordance with AWS D1.1.
- C. Submit inspection reports, certification, and instances of noncompliance to COR.

3.6 SPRAYED-ON FIREPROOFING:

- A. Provide field inspection and testing services to certify sprayed-on fireproofing has been applied in accordance with contract documents.
- B. Obtain a copy of approved submittals from COR.
- C. Use approved installation in test areas as criteria for inspection of work.
- D. Test sprayed-on fireproofing for thickness and density in accordance with ASTM E605.

1. Thickness gauge specified in ASTM E605 may be modified for pole extension so that overhead sprayed material can be reached from floor.

E. Location of test areas for field tests as follows:

1. Thickness: Select one bay per floor, or one bay for each 930 m² (10,000 square feet) of floor area, whichever provides for greater number of tests. Take thickness determinations from each of following locations: Metal deck, beam, and column.

2. Density: Take density determinations from each floor, or one test from each 930 m² (10,000 square feet) of floor area, whichever provides for greater number of tests, from each of the following areas: Underside of metal deck, beam flanges, and beam web.

F. Submit inspection reports, certification, and instances of noncompliance to COR.

- - - E N D - - -

SECTION 01 57 19
TEMPORARY ENVIRONMENTAL CONTROLS

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the control of environmental pollution and damage that the Contractor must consider for air, water, and land resources. It includes management of visual aesthetics, noise, solid waste, radiant energy, and radioactive materials, as well as other pollutants and resources encountered or generated by the Contractor. The Contractor is obligated to consider specified control measures with the costs included within the various contract items of work.
- B. Environmental pollution and damage is defined as the presence of chemical, physical, or biological elements or agents which:
1. Adversely effect human health or welfare,
 2. Unfavorably alter ecological balances of importance to human life,
 3. Effect other species of importance to humankind, or;
 4. Degrade the utility of the environment for aesthetic, cultural, and historical purposes.
- C. Definitions of Pollutants:
1. Chemical Waste: Petroleum products, bituminous materials, salts, acids, alkalis, herbicides, pesticides, organic chemicals, and inorganic wastes.
 2. Debris: Combustible and noncombustible wastes, such as leaves, tree trimmings, ashes, and waste materials resulting from construction or maintenance and repair work.
 3. Sediment: Soil and other debris that has been eroded and transported by runoff water.
 4. Solid Waste: Rubbish, debris, garbage, and other discarded solid materials resulting from industrial, commercial, and agricultural operations and from community activities.
 5. Surface Discharge: The term "Surface Discharge" implies that the water is discharged with possible sheeting action and subsequent soil erosion may occur. Waters that are surface discharged may terminate in drainage ditches, storm sewers, creeks, and/or "water of the United States" and would require a permit to discharge water from the governing agency.

6. Rubbish: Combustible and noncombustible wastes such as paper, boxes, glass and crockery, metal and lumber scrap, tin cans, and bones.
7. Sanitary Wastes:
 - a. Sewage: Domestic sanitary sewage and human and animal waste.
 - b. Garbage: Refuse and scraps resulting from preparation, cooking, dispensing, and consumption of food.

1.2 QUALITY CONTROL

- A. Establish and maintain quality control for the environmental protection of all items set forth herein.
- B. Record on daily reports any problems in complying with laws, regulations, and ordinances. Note any corrective action taken.

1.3 REFERENCES

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referred to in the text by basic designation only.
- B. U.S. National Archives and Records Administration (NARA):
33 CFR 328.....Definitions

1.4 SUBMITTALS

- A. In accordance with Section, 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES, furnish the following:
 1. Environmental Protection Plan: After the contract is awarded and prior to the commencement of the work, the Contractor shall meet with the COR to discuss the proposed Environmental Protection Plan and to develop mutual understanding relative to details of environmental protection. Not more than 20 days after the meeting, the Contractor shall prepare and submit to the COR and the Contracting Officer for approval, a written and/or graphic Environmental Protection Plan including, but not limited to, the following:
 - a. Name(s) of person(s) within the Contractor's organization who is (are) responsible for ensuring adherence to the Environmental Protection Plan.
 - b. Name(s) and qualifications of person(s) responsible for manifesting hazardous waste to be removed from the site.
 - c. Name(s) and qualifications of person(s) responsible for training the Contractor's environmental protection personnel.

- d. Description of the Contractor's environmental protection personnel training program.
 - e. A list of Federal, State, and local laws, regulations, and permits concerning environmental protection, pollution control, noise control and abatement that are applicable to the Contractor's proposed operations and the requirements imposed by those laws, regulations, and permits.
 - f. Methods for protection of features to be preserved within authorized work areas including trees, shrubs, vines, grasses, ground cover, landscape features, air and water quality, fish and wildlife, soil, historical, and archeological and cultural resources.
 - g. Procedures to provide the environmental protection that comply with the applicable laws and regulations. Describe the procedures to correct pollution of the environment due to accident, natural causes, or failure to follow the procedures as described in the Environmental Protection Plan.
 - h. Permits, licenses, and the location of the solid waste disposal area.
 - i. Drawings showing locations of any proposed temporary excavations or embankments for haul roads, material storage areas, structures, sanitary facilities, and stockpiles of excess or spoil materials. Include as part of an Erosion Control Plan approved by the District Office of the U.S. Soil Conservation Service and the Department of Veterans Affairs.
 - j. Environmental Monitoring Plans for the job site including land, water, air, and noise.
 - k. Work Area Plan showing the proposed activity in each portion of the area and identifying the areas of limited use or nonuse. Plan should include measures for marking the limits of use areas. This plan may be incorporated within the Erosion Control Plan.
- B. Approval of the Contractor's Environmental Protection Plan will not relieve the Contractor of responsibility for adequate and continued control of pollutants and other environmental protection measures.

1.5 PROTECTION OF ENVIRONMENTAL RESOURCES

- A. Protect environmental resources within the project boundaries and those affected outside the limits of permanent work during the entire period

of this contract. Confine activities to areas defined by the specifications and drawings.

- B. Protection of Land Resources: Prior to construction, identify all land resources to be preserved within the work area. Do not remove, cut, deface, injure, or destroy land resources including trees, shrubs, vines, grasses, top soil, and land forms without permission from the COR. Do not fasten or attach ropes, cables, or guys to trees for anchorage unless specifically authorized, or where special emergency use is permitted.
1. Work Area Limits: Prior to any construction, mark the areas that require work to be performed under this contract. Mark or fence isolated areas within the general work area that are to be saved and protected. Protect monuments, works of art, and markers before construction operations begin. Convey to all personnel the purpose of marking and protecting all necessary objects.
 2. Protection of Landscape: Protect trees, shrubs, vines, grasses, land forms, and other landscape features shown on the drawings to be preserved by marking, fencing, or using any other approved techniques.
- C. Protection of Air Resources: Keep construction activities under surveillance, management, and control to minimize pollution of air resources. Burning is not permitted on the job site. Keep activities, equipment, processes, and work operated or performed, in strict accordance with the State of Ohio and title of State Air Pollution Statue, Rule, or Regulation and Federal emission and performance laws and standards. Maintain ambient air quality standards set by the Environmental Protection Agency, for those construction operations and activities specified.
1. Particulates: Control dust particles, aerosols, and gaseous by-products from all construction activities, processing, and preparation of materials (such as from asphaltic batch plants) at all times, including weekends, holidays, and hours when work is not in progress.
 2. Particulates Control: Maintain all excavations, stockpiles, haul roads, permanent and temporary access roads, plant sites, spoil areas, borrow areas, and all other work areas within or outside the project boundaries free from particulates which would cause a hazard

- or a nuisance. Sprinklering, chemical treatment of an approved type, light bituminous treatment, baghouse, scrubbers, electrostatic precipitators, or other methods are permitted to control particulates in the work area.
3. Hydrocarbons and Carbon Monoxide: Control monoxide emissions from equipment to Federal and State allowable limits.
 4. Odors: Control odors of construction activities and prevent obnoxious odors from occurring.
- D. Reduction of Noise: Minimize noise using every action possible. Perform noise-producing work in less sensitive hours of the day or week as directed by the COR. Maintain noise-produced work at or below the decibel levels and within the time periods specified.
1. Perform construction activities involving repetitive, high-level impact noise only between 8:00 a.m. and 6:00p.m unless otherwise permitted by local ordinance or the COR. Repetitive impact noise on the property shall not exceed the following dB limitations:

| Time Duration of Impact Noise | Sound Level in dB |
|-------------------------------------|-------------------|
| More than 12 minutes in any hour | 70 |
| Less than 30 seconds of any hour | 85 |
| Less than three minutes of any hour | 80 |
| Less than 12 minutes of any hour | 75 |

2. Provide sound-deadening devices on equipment and take noise abatement measures that are necessary to comply with the requirements of this contract, consisting of, but not limited to, the following:
 - a. Maintain maximum permissible construction equipment noise levels at 15 m (50 feet) (dBA):

| EARTHMOVING | | MATERIALS HANDLING | |
|---------------|----|--------------------|----|
| FRONT LOADERS | 75 | CONCRETE MIXERS | 75 |
| BACKHOES | 75 | CONCRETE PUMPS | 75 |
| DOZERS | 75 | CRANES | 75 |
| TRACTORS | 75 | DERRICKS IMPACT | 75 |
| SCAPERS | 80 | PILE DRIVERS | 95 |
| GRADERS | 75 | JACK HAMMERS | 75 |
| TRUCKS | 75 | ROCK DRILLS | 80 |

| | | | |
|-----------------------|----|-----------------|----|
| PAVERS, STATIONARY | 80 | PNEUMATIC TOOLS | 80 |
| PUMPS | 75 | BLASTING | NA |
| GENERATORS | 75 | SAWS | 75 |
| COMPRESSORS | 75 | VIBRATORS | 75 |

- b. Use shields or other physical barriers to restrict noise transmission.
 - c. Provide soundproof housings or enclosures for noise-producing machinery.
 - d. Use efficient silencers on equipment air intakes.
 - e. Use efficient intake and exhaust mufflers on internal combustion engines that are maintained so equipment performs below noise levels specified.
 - f. Line hoppers and storage bins with sound deadening material.
 - g. Conduct truck loading, unloading, and hauling operations so that noise is kept to a minimum.
3. Measure sound level for noise exposure due to the construction at least once every five successive working days while work is being performed above 55 dB(A) noise level. Measure noise exposure at the property line or 15 m (50 feet) from the noise source, whichever is greater. Measure the sound levels on the A weighing network of a General Purpose sound level meter at slow response. To minimize the effect of reflective sound waves at buildings, take measurements at 900 to 1800 mm (three to six feet) in front of any building face. Submit the recorded information to the COR noting any problems and the alternatives for mitigating actions.
- E. Restoration of Damaged Property: If any direct or indirect damage is done to public or private property resulting from any act, omission, neglect, or misconduct, the Contractor shall restore the damaged property to a condition equal to that existing before the damage at no additional cost to the Government. Repair, rebuild, or restore property as directed or make good such damage in an acceptable manner.
- F. Final Clean-up: On completion of project and after removal of all debris, rubbish, and temporary construction, Contractor shall leave the construction area in a clean condition satisfactory to the COR. Cleaning shall include off the station disposal of all items and

Bid Issue
07/01/2016

VAMC WADE PARK
Emergency Sewer Repair K-Wing
Project No. 541-16-522

materials not required to be salvaged, as well as all debris and
rubbish resulting from demolition and new work operations.

- - - E N D - - -

SECTION 01 58 16
TEMPORARY INTERIOR SIGNAGE

PART 1 GENERAL

DESCRIPTION

This section specifies temporary interior signs.

PART 2 PRODUCTS

2.1 TEMPORARY SIGNS

- A. Fabricate from 50 Kg (110 pound) mat finish white paper.
- B. Cut to 100 mm (4-inch) wide by 300 mm (12 inch) long size tag.
- C. Punch 3 mm (1/8-inch) diameter hole centered on 100 mm (4-inch) dimension of tag. Edge of Hole spaced approximately 13 mm (1/2-inch) from one end on tag.
- D. Reinforce hole on both sides with gummed cloth washer or other suitable material capable of preventing tie pulling through paper edge.
- E. Ties: Steel wire 0.3 mm (0.0120-inch) thick, attach to tag with twist tie, leaving 150 mm (6-inch) long free ends.

PART 3 EXECUTION

3.1 INSTALLATION

- A. Install temporary signs attached to room door frame or room door knob, lever, or pull for doors on corridor openings.
- B. Mark on signs with felt tip marker having approximately 3 mm (1/8-inch) wide stroke for clearly legible numbers or letters.
- C. Identify room with numbers as designated on floor plans.

3.2 LOCATION

- A. Install on doors that have room, corridor, and space numbers shown.
- B. Doors that do not require signs are as follows:
 - 1. Corridor barrier doors (cross-corridor) in corridor with same number.
 - 2. Folding doors or partitions.
 - 3. Toilet or bathroom doors within and between rooms.
 - 4. Communicating doors in partitions between rooms with corridor entrance doors.
 - 5. Closet doors within rooms.
- C. Replace missing, damaged, or illegible signs.

- - - E N D - - -

SECTION 01 74 19
CONSTRUCTION WASTE MANAGEMENT

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section specifies the requirements for the management of non-hazardous building construction and demolition waste.
- B. Waste disposal in landfills shall be minimized to the greatest extent possible. Of the inevitable waste that is generated, as much of the waste material as economically feasible shall be salvaged, recycled or reused.
- C. Contractor shall use all reasonable means to divert construction and demolition waste from landfills and incinerators, and facilitate their salvage and recycle not limited to the following:
 - 1. Waste Management Plan development and implementation.
 - 2. Techniques to minimize waste generation.
 - 3. Sorting and separating of waste materials.
 - 4. Salvage of existing materials and items for reuse or resale.
 - 5. Recycling of materials that cannot be reused or sold.
- D. At a minimum the following waste categories shall be diverted from landfills:
 - 1. Soil.
 - 2. Inerts (eg, concrete, masonry and asphalt).
 - 3. Clean dimensional wood and palette wood.
 - 4. Green waste (biodegradable landscaping materials).
 - 5. Engineered wood products (plywood, particle board and I-joists, etc).
 - 6. Metal products (eg, steel, wire, beverage containers, copper, etc).
 - 7. Cardboard, paper and packaging.
 - 8. Bitumen roofing materials.
 - 9. Plastics (eg, ABS, PVC).
 - 10. Carpet and/or pad.
 - 11. Gypsum board.
 - 12. Insulation.
 - 13. Paint.
 - 14. Fluorescent lamps.

1.2 RELATED WORK

- A. Section 02 41 00, DEMOLITION.

B. Section 01 00 00, GENERAL REQUIREMENTS.

1.3 QUALITY ASSURANCE

- A. Contractor shall practice efficient waste management when sizing, cutting and installing building products. Processes shall be employed to ensure the generation of as little waste as possible. Construction /Demolition waste includes products of the following:
1. Excess or unusable construction materials.
 2. Packaging used for construction products.
 3. Poor planning and/or layout.
 4. Construction error.
 5. Over ordering.
 6. Weather damage.
 7. Contamination.
 8. Mishandling.
 9. Breakage.
- B. Establish and maintain the management of non-hazardous building construction and demolition waste set forth herein. Conduct a site assessment to estimate the types of materials that will be generated by demolition and construction.
- C. Contractor shall develop and implement procedures to recycle construction and demolition waste to a minimum of 50 percent.
- D. Contractor shall be responsible for implementation of any special programs involving rebates or similar incentives related to recycling. Any revenues or savings obtained from salvage or recycling shall accrue to the contractor.
- E. Contractor shall provide all demolition, removal and legal disposal of materials. Contractor shall ensure that facilities used for recycling, reuse and disposal shall be permitted for the intended use to the extent required by local, state, federal regulations. The Whole Building Design Guide website <http://www.wbdg.org/tools/cwm.php> provides a Construction Waste Management Database that contains information on companies that haul, collect, and process recyclable debris from construction projects.
- F. Contractor shall assign a specific area to facilitate separation of materials for reuse, salvage, recycling, and return. Such areas are to be kept neat and clean and clearly marked in order to avoid contamination or mixing of materials.

- G. Contractor shall provide on-site instructions and supervision of separation, handling, salvaging, recycling, reuse and return methods to be used by all parties during waste generating stages.
- H. Record on daily reports any problems in complying with laws, regulations and ordinances with corrective action taken.

1.4 TERMINOLOGY

- A. Class III Landfill: A landfill that accepts non-hazardous resources such as household, commercial and industrial waste resulting from construction, remodeling, repair and demolition operations.
- B. Clean: Untreated and unpainted; uncontaminated with adhesives, oils, solvents, mastics and like products.
- C. Construction and Demolition Waste: Includes all non-hazardous resources resulting from construction, remodeling, alterations, repair and demolition operations.
- D. Dismantle: The process of parting out a building in such a way as to preserve the usefulness of its materials and components.
- E. Disposal: Acceptance of solid wastes at a legally operating facility for the purpose of land filling (includes Class III landfills and inert fills).
- F. Inert Backfill Site: A location, other than inert fill or other disposal facility, to which inert materials are taken for the purpose of filling an excavation, shoring or other soil engineering operation.
- G. Inert Fill: A facility that can legally accept inert waste, such as asphalt and concrete exclusively for the purpose of disposal.
- H. Inert Solids/Inert Waste: Non-liquid solid resources including, but not limited to, soil and concrete that does not contain hazardous waste or soluble pollutants at concentrations in excess of water-quality objectives established by a regional water board, and does not contain significant quantities of decomposable solid resources.
- I. Mixed Debris: Loads that include commingled recyclable and non-recyclable materials generated at the construction site.
- J. Mixed Debris Recycling Facility: A solid resource processing facility that accepts loads of mixed construction and demolition debris for the purpose of recovering re-usable and recyclable materials and disposing non-recyclable materials.

- K. Permitted Waste Hauler: A company that holds a valid permit to collect and transport solid wastes from individuals or businesses for the purpose of recycling or disposal.
- L. Recycling: The process of sorting, cleansing, treating, and reconstituting materials for the purpose of using the altered form in the manufacture of a new product. Recycling does not include burning, incinerating or thermally destroying solid waste.
1. On-site Recycling - Materials that are sorted and processed on site for use in an altered state in the work, i.e. concrete crushed for use as a sub-base in paving.
 2. Off-site Recycling - Materials hauled to a location and used in an altered form in the manufacture of new products.
- M. Recycling Facility: An operation that can legally accept materials for the purpose of processing the materials into an altered form for the manufacture of new products. Depending on the types of materials accepted and operating procedures, a recycling facility may or may not be required to have a solid waste facilities permit or be regulated by the local enforcement agency.
- N. Reuse: Materials that are recovered for use in the same form, on-site or off-site.
- O. Return: To give back reusable items or unused products to vendors for credit.
- P. Salvage: To remove waste materials from the site for resale or re-use by a third party.
- Q. Source-Separated Materials: Materials that are sorted by type at the site for the purpose of reuse and recycling.
- R. Solid Waste: Materials that have been designated as non-recyclable and are discarded for the purposes of disposal.
- S. Transfer Station: A facility that can legally accept solid waste for the purpose of temporarily storing the materials for re-loading onto other trucks and transporting them to a landfill for disposal, or recovering some materials for re-use or recycling.

1.5 SUBMITTALS

- A. In accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES, furnish the following:

- B. Prepare and submit to the COR a written demolition debris management plan. The plan shall include, but not be limited to, the following information:
1. Procedures to be used for debris management.
 2. Techniques to be used to minimize waste generation.
 3. Analysis of the estimated job site waste to be generated:
 - a. List of each material and quantity to be salvaged, reused, recycled.
 - b. List of each material and quantity proposed to be taken to a landfill.
 4. Detailed description of the Means/Methods to be used for material handling.
 - a. On site: Material separation, storage, protection where applicable.
 - b. Off site: Transportation means and destination. Include list of materials.
 - 1) Description of materials to be site-separated and self-hauled to designated facilities.
 - 2) Description of mixed materials to be collected by designated waste haulers and removed from the site.
 - c. The names and locations of mixed debris reuse and recycling facilities or sites.
 - d. The names and locations of trash disposal landfill facilities or sites.
 - e. Documentation that the facilities or sites are approved to receive the materials.
- C. Designated Manager responsible for instructing personnel, supervising, documenting and administer over meetings relevant to the Waste Management Plan.
- D. Monthly summary of construction and demolition debris diversion and disposal, quantifying all materials generated at the work site and disposed of or diverted from disposal through recycling.

1.6 APPLICABLE PUBLICATIONS

- A Publications listed below form a part of this specification to the extent referenced. Publications are referenced by the basic designation only. In the event that criteria requirements conflict, the most stringent requirements shall be met.

B. U.S. Green Building Council (USGBC):

LEED Green Building Rating System for New Construction

1.7 RECORDS

Maintain records to document the quantity of waste generated; the quantity of waste diverted through sale, reuse, or recycling; and the quantity of waste disposed by landfill or incineration. Records shall be kept in accordance with the LEED Reference Guide and LEED Template.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. List of each material and quantity to be salvaged, recycled, reused.
- B. List of each material and quantity proposed to be taken to a landfill.
- C. Material tracking data: Receiving parties, dates removed, transportation costs, weight tickets, tipping fees, manifests, invoices, net total costs or savings.

PART 3 - EXECUTION

3.1 COLLECTION

- A. Provide all necessary containers, bins and storage areas to facilitate effective waste management.
- B. Clearly identify containers, bins and storage areas so that recyclable materials are separated from trash and can be transported to respective recycling facility for processing.
- C. Hazardous wastes shall be separated, stored, disposed of according to local, state, federal regulations.

3.2 DISPOSAL

- A. Contractor shall be responsible for transporting and disposing of materials that cannot be delivered to a source-separated or mixed materials recycling facility to a transfer station or disposal facility that can accept the materials in accordance with state and federal regulations.
- B. Construction or demolition materials with no practical reuse or that cannot be salvaged or recycled shall be disposed of at a landfill or incinerator.

3.3 REPORT

- A. With each application for progress payment, submit a summary of construction and demolition debris diversion and disposal including beginning and ending dates of period covered.

- B. Quantify all materials diverted from landfill disposal through salvage or recycling during the period with the receiving parties, dates removed, transportation costs, weight tickets, manifests, invoices. Include the net total costs or savings for each salvaged or recycled material.
- C. Quantify all materials disposed of during the period with the receiving parties, dates removed, transportation costs, weight tickets, tipping fees, manifests, invoices. Include the net total costs for each disposal.

- - - E N D - - -

SECTION 02 41 00
DEMOLITION

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies demolition and removal of portions of buildings, utilities, other structures.

1.2 RELATED WORK:

- A. Safety Requirements, including ACCIDENT PREVENTION PLAN (APP): Section 01 35 26, SAFETY REQUIREMENTS.
- B. Disconnecting utility services prior to demolition: Section 01 00 00, GENERAL REQUIREMENTS.
- C. Reserved items that are to remain the property of the Government: Section 01 00 00, GENERAL REQUIREMENTS.
- D. Temporary Construction Barriers and Infectious Control: Section 01 35 26, SAFETY REQUIREMENTS.
- E. Construction Waste Management: Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT.

1.3 PROTECTION:

- A. Perform demolition in such manner as to eliminate hazards to persons and property; to minimize interference with use of adjacent areas, utilities and structures or interruption of use of such utilities; and to provide free passage to and from such adjacent areas of structures. Comply with requirements of ACCIDENT PREVENTION PLAN.
- B. Provide safeguards, including warning signs, barricades, temporary fences, warning lights, and other similar items that are required for protection of all personnel during demolition and removal operations.
- C. Prevent spread of flying particles and dust. Sprinkle rubbish and debris with water to keep dust to a minimum. Do not use water if it results in hazardous or objectionable condition such as, but not limited to; ice, flooding, or pollution. Vacuum and dust the work area daily.
- D. In addition to previously listed fire and safety rules to be observed in performance of work, include following:
 - 1. No wall or part of wall shall be permitted to fall outwardly from structures.
 - 2. Wherever a cutting torch or other equipment that might cause a fire is used, provide and maintain fire extinguishers nearby ready for immediate use. Instruct all possible users in use of fire extinguishers. Comply with all requirements of the "Hot Work Permit".
 - 3. Keep hydrants clear and accessible at all times. Prohibit debris from accumulating within a radius of 4500 mm (15 feet) of fire hydrants.

4. Keep fire extinguishers clear and accessible at all times.
- E. Before beginning any demolition work, the Contractor shall survey the site and examine the drawings and specifications to determine the extent of the work. The contractor shall take necessary precautions to avoid damages to existing items to remain in place, to be reused, or to remain the property of the Medical Center; any damaged items shall be repaired or replaced as approved by the COR. The Contractor shall coordinate the work of this section with all other work and shall construct and maintain shoring, bracing, and supports as required. The Contractor shall ensure that structural elements are not overloaded and shall be responsible for increasing structural supports or adding new supports as may be required as a result of any cutting, removal, or demolition work performed under this contract. Do not overload structural elements. Provide new supports and reinforcement for existing construction weakened by demolition or removal works. Repairs, reinforcement, or structural replacement must have COR's approval.
- F. The work shall comply with the requirements of Section 01 35 26, SAFETY REQUIREMENTS.

PART 2 - PRODUCTS (NOT USED)

PART 3 - EXECUTION

3.1 DEMOLITION:

- A. Debris, including brick, concrete, stone, metals and similar materials shall become property of Contractor and shall be disposed of by him daily, off the Medical Center Property to avoid accumulation at the demolition site. Materials that cannot be removed daily shall be stored in areas specified by the COR. Contractor shall dispose debris in compliance with applicable federal, state or local permits, rules and/or regulations.
- B. Remove and legally dispose of all materials. Materials removed shall become property of contractor and shall be disposed of in compliance with applicable federal, state or local permits, rules and/or regulations.
- C. Remove existing utilities as indicated or uncovered by work and terminate in a manner conforming to the nationally recognized code covering the specific utility and approved by the COR. When Utility lines are encountered that are not indicated on the drawings, the COR shall be notified prior to further work in that area.
- D. Remove abandoned utility lines uncovered during the work in a manner conforming to the nationally recognized code covering the specific utility.

1. Abandoned utilities that extend beyond the boundaries of the project area, shall be removed to a point 6" beyond the project perimeter.

3.2 CLEAN-UP:

- A. On completion of work of this section and after removal of all debris, leave site in clean condition satisfactory to COR. Clean-up shall include disposal of all items and materials not required to remain property of the Government as well as all debris and rubbish resulting from demolition operations.

- - - E N D - - -

SECTION 03 30 53
MISCELLANEOUS CAST-IN-PLACE CONCRETE

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies cast-in-place structural concrete and material and mixes for other concrete.

1.2 RELATED WORK:

A. Materials testing and inspection during construction: Section 01 45 29, TESTING LABORATORY SERVICES.

1.3 TOLERANCES:

A. ACI 117.
B. Slab Finishes: ACI 117, F-number method in accordance with ASTM E1155.

1.4 REGULATORY REQUIREMENTS:

A. ACI 315 - Manual of Standard Practice for Detailing Reinforced Concrete Structures.
B. ACI 318 - Building Code Requirements for Reinforced Concrete.

1.5 SUBMITTALS:

A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
B. Concrete Mix Design.
C. Shop Drawings: Reinforcing steel: Complete shop drawings.
D. Manufacturer's Certificates: Air-entraining admixture, chemical admixtures, curing compounds.

1.6 APPLICABLE PUBLICATIONS:

A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.
B. American Concrete Institute (ACI):
117-90.....Standard Tolerances for Concrete Construction and Materials
301-99.....Specification for Structural Concrete for Buildings
315-99.....Details and Detailing of Concrete Reinforcement
318/318R-2002.....Building Code Requirements for Reinforced Concrete
347R-94 (R1999).....Guide to Formwork for Concrete
C. American Society For Testing And Materials (ASTM):
A185-2002.....Steel Welded Wire, Fabric, Plain for Concrete Reinforcement

A615/A615M(REV. A)-2003..Deformed and Plain Billet-Steel Bars for
Concrete Reinforcement
C31/C31M-2003.....Making and Curing Concrete Test Specimens in the
Field
C33-2003.....Concrete Aggregates
C39/C39M-2001.....Compressive Strength of Cylindrical Concrete
Specimens
C94/C94M-2003.....Ready-Mixed Concrete
C143/C143M-2003.....Slump of Portland Cement Concrete
C150 (REV. A)-2002.....Portland Cement
C171-2003.....Sheet Material for Curing Concrete
C172-99.....Sampling Freshly Mixed Concrete
C192/C192M-2002.....Making and Curing Concrete Test Specimens in the
Laboratory
C494/C494M(REV. A)-99(E2001) Chemical Admixtures for Concrete
D1751-99.....Preformed Expansion Joint Fillers for Concrete
Paving and Structural Construction (Non-
extruding and Resilient Bituminous Types)
D4397-2002.....Polyethylene Sheeting for Construction,
Industrial and Agricultural Applications
E1155-96(R2001).....Standard Test Method for Determining Floor
Flatness and Levelness Using the F Number System

PART 2 - PRODUCTS

2.1 FORMS:

Wood, plywood, metal, or other materials, approved by COTR, of grade or type suitable to obtain type of finish specified.

2.2 MATERIALS:

- A. Portland Cement: ASTM C150, Type I or II.
- B. Fly Ash: ASTM C618, Class C or F including supplementary optional requirements relating to reactive aggregates and alkalis, and loss on ignition (LOI) not to exceed 5 percent.
- C. Coarse Aggregate: ASTM C33, Size 67. Size 467 may be used for footings and walls over 300 mm (12 inches) thick. Coarse aggregate for applied topping and metal pan stair fill shall be Size 7.
- D. Fine Aggregate: ASTM C33.
- E. Mixing Water: Fresh, clean, and potable.
- F. Chemical Admixtures: ASTM C494.
 - 1. Provide admixtures certified by manufacturer to be compatible with other admixtures and that will not contribute water-soluble chloride

- ions exceeding those permitted in hardened concrete. Do not use calcium chloride or admixtures containing calcium chloride.
- 2. Water-Reducing Admixture: ASTM C 494/C 494M, Type A.
 - 3. Water-Reducing and Retarding Admixture: ASTM C 494/C 494M, Type D.
 - G. Vapor Barrier: ASTM D4397, 0.15 mm (6 mil).
 - H. Reinforcing Steel: ASTM A615 or ASTM A996, deformed, grade 60.
 - I. Welded Wire Reinforcement: ASTM A185.
 - J. Expansion Joint Filler: ASTM D1751.
 - K. Sheet Materials for Curing Concrete: ASTM C171.

2.3 MIXES:

- A. Design of concrete mixes using materials specified shall be the responsibility of the Contractor as set forth under Option C of ASTM C94.
- B. Compressive strength at 28 days shall be not less than 30 Mpa (4000 psi).
- C. Establish strength of concrete by testing prior to beginning concreting operation. Test consists of average of three cylinders made and cured in accordance with ASTM C192 and tested in accordance with ASTM C39.
- D. Maximum slump for vibrated concrete is 100 mm (4 inches) tested in accordance with ASTM C143.
- E. Cement and water factor (See Table I):

TABLE I - CEMENT AND WATER FACTORS FOR CONCRETE

| Concrete: Strength Min. 28 Day Comp. Str. MPa (psi) | Non-Air-Entrained | | Air-Entrained | |
|---|--|----------------------------|---|----------------------------|
| | Min. Cement kg/m ³ (lbs/c. yd) | Max. Water Cement Ratio | Min. Cement kg/m ³ (lbs/c. yd) | Max. Water Cement Ratio |
| 30 (4000) ^{1,3} | 325 (550) | 0.55 | 340 (570) | 0.50 |

**TABLE I - TOTAL AIR CONTENT
FOR VARIOUS SIZES OF COARSE AGGREGATES (NORMAL CONCRETE)**

| Nominal Maximum Size of Coarse Aggregate | Total Air Content Percentage by Volume |
|---|---|
| 10 mm (3/8 in) | 6 to 10 |
| 13 mm (1/2 in) | 5 to 9 |
| 19 mm (3/4 in) | 4 to 8 |
| 25 mm (1 in) | 3 1/2 to 6 1/2 |
| 40 mm (1 1/2 in) | 3 to 6 |

2.4 MIXING:

- A. Store, batch, and mix materials as specified in ASTM C94.
 - 1. Job-Mixed: Concrete mixed at job site shall be mixed in a batch mixer in manner specified for stationary mixers in ASTM C94.
 - 2. Ready-Mixed: Ready-mixed concrete comply with ASTM C94, except use of non-agitating equipment for transporting concrete to the site will not be permitted. With each load of concrete delivered to project, ready-mixed concrete producer shall furnish, in duplicate, certification as required by ASTM C94.

PART 3 - EXECUTION

3.1 FORMWORK:

- A. Installation conform to ACI 347. Sufficiently tight to hold concrete without leakage, sufficiently braced to withstand vibration of concrete, and to carry, without appreciable deflection, all dead and live loads to which they may be subjected.
- B. Treating and Wetting: Treat or wet contact forms as follows:
 - 1. Coat plywood and board forms with non-staining form sealer. In hot weather cool forms by wetting with cool water just before concrete is placed.
 - 2. Clean and coat removable metal forms with light form oil before reinforcement is placed. In hot weather cool metal forms by thoroughly wetting with water just before placing concrete.
 - 3. Use sealer on reused plywood forms as specified for new material.
- C. Inserts, sleeves, and similar items: Anchors, inserts, wires, sleeves, boxes for floor hinges and other items specified as furnished under this and other sections of specifications and required to be in their final position at time concrete is placed shall be properly located, accurately positioned and built into construction, and maintained securely in place.
- D. Construction Tolerances:
 - 1. Contractor is responsible for setting and maintaining concrete formwork to assure erection of completed work within tolerances specified to accommodate installation or other rough and finish materials. Remedial work necessary for correcting excessive tolerances is the responsibility of the Contractor. Erected work that exceeds specified tolerance limits shall be remedied or removed and replaced, at no additional cost to the Government.
 - 2. Permissible surface irregularities for various classes of materials are defined as "finishes" in specification sections covering individual materials. They are to be distinguished from tolerances

specified which are applicable to surface irregularities of structural elements.

3.2 REINFORCEMENT:

Details of concrete reinforcement, unless otherwise shown, in accordance with ACI 318 and 315. Support and securely tie reinforcing steel to prevent displacement during placing of concrete.

3.3 VAPOR BARRIER:

Except where membrane waterproofing is required, place interior concrete slabs on a continuous vapor barrier.

- A. Lap joints 150 mm (6 inches) and seal with a compatible pressure-sensitive tape.
- B. Patch punctures and tears.

3.4 PLACING CONCRETE:

- A. Remove water from excavations before concrete is placed. Remove hardened concrete, debris and other foreign materials from interior of forms, and from inside of mixing and conveying equipment. Obtain approval of COTR before placing concrete. Provide screeds at required elevations for concrete slabs.
- B. Before placing new concrete on or against concrete which has set, existing surfaces shall be roughened and cleaned free from all laitance, foreign matter, and loose particles.
- C. Convey concrete from mixer to final place of deposit by method which will prevent segregation or loss of ingredients. Do not deposit in work concrete that has attained its initial set or has contained its water or cement more than 1 1/2 hours. Do not allow concrete to drop freely more than 1500 mm (5 feet) in unexposed work nor more than 900 mm (3 feet) in exposed work. Place and consolidate concrete in horizontal layers not exceeding 300 mm (12 inches) in thickness. Consolidate concrete by spading, rodding, and mechanical vibrator. Do not secure vibrator to forms or reinforcement. Vibration shall be carried on continuously with placing of concrete.

3.5 PROTECTION AND CURING:

Protect exposed surfaces of concrete from premature drying, wash by running water, mechanical injury, and excessively hot or cold temperature. Curing method shall be subject to approval by COTR.

3.6 FORM REMOVAL:

Forms remain in place until concrete has a sufficient strength to carry its own weight and loads supported. Removal of forms at any time is the Contractor's sole responsibility.

3.7 SURFACE PREPARATION:

Immediately after forms have been removed and work has been examined and approved by COTR, remove loose materials, and patch all stone pockets, surface honeycomb, or similar deficiencies with cement mortar made with 1 part portland cement and 2 to 3 parts sand.

3.8 FINISHES:

A. Slab Finishes:

1. Scratch Finish: Slab surfaces to receive a bonded applied cementitious application shall all be thoroughly raked or wire broomed after partial setting (within 2 hours after placing) to roughen surface to insure a permanent bond between base slab and applied cementitious materials.
2. Floating: Allow water brought to surface by float used for rough finishing to evaporate before surface is again floated or troweled. Do not sprinkle dry cement on surface to absorb water.
3. Float Finish: Ramps, stair treads, and platforms, equipment pads, and slabs to receive non-cementitious materials, except as specified, shall be screened and floated to a smooth dense finish. After first floating, while surface is still soft, surfaces shall be checked for alignment using a straightedge or template. Correct high spots by cutting down with a trowel or similar tool and correct low spots by filling in with material of same composition as floor finish. Remove any surface projections on floated finish by rubbing or dry grinding. Refloat the slab to a uniform sandy texture.
4. Steel Trowel Finish: Applied toppings, concrete surfaces to receive resilient floor covering or carpet, future floor roof and all monolithic concrete floor slabs exposed in finished work and for which no other finish is shown or specified shall be steel troweled. Final steel troweling to secure a smooth, dense surface shall be delayed as long as possible, generally when the surface can no longer be dented with finger. During final troweling, tilt steel trowel at a slight angle and exert heavy pressure on trowel to compact cement paste and form a dense, smooth surface. Finished surface shall be free of trowel marks, uniform in texture and appearance.
5. Finished slab flatness (FF) and levelness (FL) values comply with the following minimum requirements:

| | |
|-------------------------|-------------------------------------|
| Slab on grade: | |
| Specified overall value | F _F 25/F _L 20 |
| Minimum local value | F _F 17/F _L 15 |

3.9 SURFACE TREATMENTS:

- A. Surface treatments shall be mixed and applied in accordance with manufacturer's printed instructions.
- B. Liquid Densifier/Sealer: Use on all exposed concrete floors and concrete floors to receive carpeting.

3.10 APPLIED TOPPING:

- A. Separate concrete topping with thickness and strength shown with only enough water to insure a stiff, workable, plastic mix.
- B. Continuously place applied topping until entire section is complete, struck off with straightedge, compact by rolling or tamping, float and steel trowel to a hard smooth finish.

3.11 RESURFACING FLOORS:

Remove existing flooring, in areas to receive resurfacing, to expose existing structural slab and to extend not less than 25 mm (1 inch) below new finished floor level. Prepare exposed structural slab surface by roughening, broom cleaning, wetting, and grouting. Apply topping as specified.

- - - E N D - - -

SECTION 09 67 23.60
RESINOUS FLOORING

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section specifies Resinous (Resinous urethane and epoxy mortars) flooring with integral cove base:

1. High Abuse Climatic Troweled and Sealed Urethane Mortar Flooring System.
2. High Abuse Non-Climatic Troweled and Sealed Epoxy Mortar Flooring System.

1.2 RELATED WORK

Color and location of each type of resinous (urethane and epoxy mortar) flooring: As indicated in drawing set.

1.3 SUBMITTALS

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Manufacturer's Literature and Data:
 1. Description of each product to be provided.
 2. Application and installation instructions.
 3. Maintenance Instructions: Submit manufacturer's written instructions for recommended maintenance practices.
- C. Qualification Data: For Installer.
- D. Sustainable Submittal:
 1. Product data for products having recycled content, submit documentation indicating percentages by weight of postconsumer and pre consumer recycled content.
 - a. Include statements indicating costs for each product having recycled content, and low emitting materials.
 2. Product data for Environmental Quality Credit EQ 4.2 low emitting materials, include printed statement of VOC content indicating compliance with environmental requirements.
 3. Product data for Material Resource Credit MR 4.1, 12%-35% post-consumer recycled glass content.
 4. Product data for Material Resource Credit MR 6, renewable resin.
 5. Product data for field applied, interior, paints, coatings, and primers, include printed statement of VOC content indicating compliance with environmental requirements.
- E. Samples:
 1. Each color and texture specified in drawing set, FINISH LEGEND AND SCHEDULE.

2. Samples for verification: For each (color and texture) resinous flooring system required, 6 inches (152 mm) square, applied to a rigid backing by installer for this project.
 3. Sample showing construction from substrate to finish surface in thickness specified and color and texture of finished surfaces. Finished flooring must match the approved samples in color and texture.
- F. Shop Drawings: Include plans, sections, component details, and attachment to other trades. Indicate layout of the following:
1. Patterns.
 2. Edge configurations.
- G. Certifications and Approvals:
1. Manufacturer's certification of material and substrate compliance with specification.
 2. Manufacturer's approval of installer.
 3. Contractor's certificate of compliance with Quality Assurance requirements.
- H. Warranty: As specified in this section.

1.4 QUALITY ASSURANCE

- A. Manufacture Certificate: Manufacture shall certify that a particular resinous flooring system has been manufactured and in use for a minimum of five (5) years.
- B. Installer Qualifications: Engage an experienced installer (applicator) who is experienced in applying resinous flooring systems similar in material, design, and extent to those indicated for this project for a minimum period of five (5) years, whose work has resulted in applications with a record of successful in-service performance, and who is acceptable to resinous flooring manufacturer.
1. Engage an installer who is certified in writing by resinous flooring manufacturer as qualified to apply resinous flooring systems indicated.
 2. Contractor shall have completed at least five (5) projects of similar size and complexity. Include list of at least five (5) projects. List must include owner (purchaser); address of installation, contact information at installation project site; and date of installation.
 3. Installer's Personnel: Employ persons trained for application of specified product.
- C. Source Limitations:

1. Obtain primary resinous flooring materials including primers, resins, hardening agents, grouting coats and finish or sealing coats from a single manufacturer.
 2. Provide secondary materials, including patching and fill material, joint sealant, and repair material of type and from source recommended by manufacturer of primary materials.
- D. Pre-Installation Conference:
1. Convene a meeting not less than thirty days prior to starting work.
 2. Attendance:
 - a. Contractor
 - b. VA COR
 - c. Manufacturer and Installer's Representative
 3. Review the following:
 - a. Environmental requirements
 - 1) Air and surface temperature
 - 2) Relative humidity
 - 3) Ventilation
 - 4) Dust and contaminants
 - b. Protection of surfaces not scheduled to be coated
 - c. Inspect and discuss condition of substrate and other preparatory work performed
 - d. Review and verify availability of material; installer's personnel, equipment needed
 - e. Design and edge conditions.
 - f. Performance of the coating with chemicals anticipated in the area receiving the resinous (urethane and epoxy mortar/cement) flooring system
 - g. Application and repair
 - h. Field quality control
 - i. Cleaning
 - j. Protection of coating systems
 - k. One-year inspection and maintenance
 - l. Coordination with other work
- E. Manufacturer's Field Services: Manufacturer's representative shall provide technical assistance and guidance for surface preparation and application of resinous flooring systems.
- F. Contractor Job Site Log: Contractor shall document daily; the work accomplished environmental conditions and any other condition event significant to the long term performance of the urethane and epoxy

mortar/cement flooring materials installation. The Contractor shall maintain these records for one year after Substantial Completion.

G. Volatile Organic Compound content to remain under 100g/liter.

1.5 MATERIAL PACKAGING DELIVERY AND STORAGE

- A. Deliver materials to the site in original sealed packages or containers, clearly marked with the manufacturer's name or brand, type and color, production run number and date of manufacture.
- B. Protect materials from damage and contamination in storage or delivery, including moisture, heat, cold, direct sunlight, etc.
- C. Maintain temperature of storage area between 60 and 80 degrees F (15 and 26 degrees C).
- D. Keep containers sealed until ready for use.
- E. Do not use materials beyond manufacturer's shelf life limits.
- F. Package materials in factory pre-weighed and in single, easy to manage batches sized for ease of handling and mixing proportions from entire package or packages. No On site weighing or volumetric measurements are allowed.

1.6 PROJECT CONDITIONS

- A. Environmental Limitations: Comply with resinous flooring manufacturer's written instructions for substrate temperature, ambient temperature, moisture, ventilation, and other conditions affecting resinous flooring applications.
 - 1. Maintain material and substrate temperature between 65 and 85 degrees F (18 and 30 degrees C) during resinous flooring application and for not less than 24 hours after application.
- B. Lighting: Provide permanent lighting or, if permanent lighting is not in place, simulate permanent lighting conditions during resinous flooring application.
- C. Close spaces to traffic during resinous flooring application and for not less than 24 hours after application, unless manufacturer recommends a longer period.
- D. Concrete substrate shall be properly cured for a minimum of 30 days. A vapor barrier must be present for concrete subfloors on or below grade. Otherwise, an osmotic pressure resistant grout must be installed prior to the resinous flooring.

1.7 WARRANTY

- A. Work subject to the terms of the Article "Warranty of Construction" FAR clause 52.246-21.
- B. Warranty: Manufacture shall furnish a single, written warranty covering the full assembly (including substrata) for both material and

workmanship for a extended period of three (3) full years from date of installation, or provide a joint and several warranty signed on a single document by manufacturer and applicator jointly and severally warranting the materials and workmanship for a period of three (3) full years from date of installation. A sample warranty letter must be included with bid package or bid may be disqualified.

1.8 APPLICABLE PUBLICATIONS

- A. The publication listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society for Testing and Materials (ASTM):
 - B221-08.....Standard Specification for Aluminum and Aluminum-Alloy Extruded Bars, Rods, Wire, Profiles, and Tubes
 - C307-03 (2008).....Standard Test Method for Tensile Strength of Chemical-Resistant Mortar, Grouts, and Monolithic Surfacing
 - C413-01(2006).....Standard Test Method for Absorption of Chemical-Resistant Mortars, Grouts, Monolithic Surfacing and Polymer Concretes
 - C531-00(2005).....Standard Test Method for Linear Shrinkage and Coefficient of Thermal Expansion of Chemical-Resistant Mortars, Grouts, Monolithic Surfacing, and Polymer Concretes
 - C579-01(2006).....Standard Test Method for Compressive Strength of Chemical-Resistant Mortars, Grouts, Monolithic Surfacing, and Polymer Concretes
 - C580-02(2008).....Standard Test Method for Flexural Strength and Modulus of Elasticity of Chemical-Resistant Mortars, Grouts, Monolithic Surfacing, and Polymer Concretes
 - C811-98(2008).....Standard Practice for Surface Preparation of Concrete for Application of Chemical-Resistant Resin Monolithic Surfacing
 - D1308-02(2007).....Standard Test Method for Effect of Household Chemicals on Clear and Pigmented Organic Finishes
 - D2047-04Standard Test Method for Static Coefficient of Friction of Polish-Coated Flooring Surfaces as Measured by the James Machine

- D2240-05.....Standard Test Method for Rubber Property –
Durometer Hardness
- D4060-07.....Standard Test Method for Abrasion Resistance of
Organic Coatings by the Taber Abraser
- D4226-09.....Standard Test Methods for Impact Resistance of
Rigid Poly(Vinyl Chloride) (PVC) Building
Products
- D7234-05.....Standard Test Methods for Pull-Off Adhesion
Strength of Coatings on Concrete Using Portable
Pull-Off Adhesion Testers
- F1869-09.....Standard Test Method for Measuring Moisture
Vapor Emission Rate of Concrete Subfloor Using
Anhydrous Calcium Chloride
- F2170-09.....Standard Test Method for Determining Relative
Humidity in Concrete Floor Slabs Using in situ
Probes
- C. National Association of Architectural Metal Manufacturers (NAAMM):
AMP 501.....Finishes for Aluminum

PART 2 – PRODUCTS

2.1 SYSTEM DESCRIPTION FOR RES-6A (HEAVY DUTY CLIMATIC)

- A. System Descriptions:
 - 1. Monolithic, multi-component urethane chemistry resinous flooring system, screed and steel finish trowel applied, chemical and thermal cycling and shock resistant. Self priming multiple component polyurethane mortar, quartz aggregates for texture and associated high performance urethane sealer. Temperature resistance to 250 degrees F (121 degrees C) where required.
- B. Products: Subject to compliance with applicable fire, health, environmental, and safety requirements for storage, handling, installation, and clean up.
- C. System Components: Verify specific requirements as systems vary by manufacturer. Verify mortar base product, build up layers of broadcast systems will not be accepted. Verify compatibility with substrate. Use manufacturer's standard components, compatible with each other and as follows:
 - 1. Mortar (Body coat):
 - a. Resin: Urethane with rapidly renewable resin components.
 - b. Formulation Description: Multiple component high solids.
 - c. Application Method: Screed and steel finish trowel.

- d. Thickness of coat(s): Verify thickness as systems vary by manufacturer; Nominal thickness 3/16 to 1/4 inch (4.76 to 6.35mm).
 - e. Number of Coats: One.
 - f. Aggregates: Quartz texture broadcast into wet urethane mortar base.
2. Seal Coat(s):
- a. Resin: Urethane.
 - b. Formulation Description: Pigmented Two-component, high solids.
 - c. Application Method: Squeegee and Back roll.
 - d. Number of Coats: One.
- D. Physical Properties:
- 1. Physical Properties of flooring system when tested as follows:

| Property | Test | Value |
|--|--------------|----------------------------------|
| Compressive Strength | ASTM C579 | 5,000 psi after 7 days |
| Tensile Strength | ASTM C307 | 1,000 psi |
| Flexural Strength | ASTM C580 | 2,400 psi |
| Water Absorption | ASTM C413 | 0.056% |
| Coefficient of friction dry/slip index wet | ASTM D2047 | >1.0 dry >1.0 wet |
| Impact Resistance | ASTM D4226 | > 160 in. lbs |
| Abrasion Resistance | ASTM D4060 | 0.05 gm maximum weight loss |
| Thermal Coefficient of Linear Expansion | ASTM C531 | 1.1 x 10 ⁻⁵ mm/ °C mm |
| Hardness Shore D | ASTM D2240 | 80 to 84 |
| Bond Strength | ASTM D7234 | >300 psi 100% concrete failure |
| Chemical Resistance of the following: | ASTM D1308 | No Effect |
| Acetic acid | 5 percent | |
| Ammonium hydroxide | 10 percent | |
| Citric Acid | 50 percent | |
| Fatty acid Motor Oil, 20W | | |
| Hydrochloric acid | 10 percent | |
| Salt water | | |
| Sodium Hydroxide | 10 percent | |
| Sulfuric acid | 10 percent | |
| Trisodium phosphate | 5 percent | |
| Urine | | |
| Feces | | |
| Hydrogen peroxide | 28 percent | |
| Distilled Water | | |
| Sodium Hypochloride | 5.28 percent | |

2.2 SYSTEM DESCRIPTION FOR RES-6B (HEAVY DUTY - NON CLIMATIC)

A. System Description:

1. Epoxy resinous Troweled mortar includes: concrete epoxy primers, three component, 100% solids resin, amine and quartz aggregate mortar, and associated 100% solids general service epoxy sealer. Optional: aliphatic polyurethane sealer finish coat for higher UV stability, and chemical resistance. Texture dependant on use of areas.

B. Products: Subject to compliance with applicable fire, health, environmental, and safety requirements for storage, handling, installation, and clean up.

C. System Components: Verify specific requirements as systems vary by manufacturer. Verify mortar base product, build up layers of broadcast systems will not be accepted. Verify compatibility with substrate. Use manufacturer's standard components, compatible with each other and as follows:

1. Primer (Bond Coat): Verify inclusion of primer in manufacturer's system.

a. Resin: Epoxy.

b. Formulation Description: 100 percent solids.

c. Application Method: Apply by Squeegee and back roller.

1) Coats: Single (one).

2. Mortar:

a. Resin: Epoxy with rapidly renewable resin components.

b. Formulation Description: 100 percent solids.

c. Application Method: Verify specific requirements as systems vary by manufacturer.

1) Trowel application only:

a) Thickness of coats: Nominal 3/16 to 1/4 inch (4.76 to 6.35 mm).

b) Number of coats: One.

2) Slurry application: Not accepted for non-climatic finish.

d. Aggregates: Quartz/silica blend with 25% Recycled Glass

3. Topcoat:

a. Resin: Epoxy.

b. Formulation Description: 100 percent solids.

c. Application Method: Squeegee and finish roll.

1) Thickness of coats: 3 mils.

2) Number of Coats: one (aggressive texture profiles may require more than one coat)

- d. Aggregates: For added slip resistance dependant on area.
 - 1) Dry silica sand (30 Mesh or larger).
 - 2) Aluminum oxide.
- D. System Characteristics:
 - 1. Color and Pattern: As selected by Architect from manufacturer's standard colors.
 - 2. Integral cove base: 1 inch (25.4 mm) radius epoxy mortar cove keyed into concrete substrate and or resinous flooring mortar system. No fillers integral cove base must be troweled in place with specified resinous mortar base.
 - 3. Overall System Thickness: Nominal 3/16 to 1/4 inches (4.76 to 6.35 mm).
 - 4. Finish: standard.
 - 5. Temperature Range: Systems vary by manufacturer; approximate range from a minimum of 45 to 150 degrees F.
- E. Physical Properties:
 - 1. Physical Properties of flooring system when tested as follows:

| Property | Test | Value |
|---|---------------------------------------|--------------------------------|
| Compressive Strength | ASTM C579 | 10,000 psi after 7 days |
| Tensile Strength | ASTM C307 | 1,750 psi |
| Flexural Strength | ASTM C580 | 4,000 psi |
| Water Absorption | ASTM C413 | 0.2% |
| Slip Resistance Index | ASTM D2047 | 0.83 dry 0.66 wet |
| Impact Resistance | ASTM D4226 | > 160 in. lbs |
| Abrasion Resistance | ASTM D4060 CS-17 1000g 1000 cycles | 0.1 gm maximum weight loss |
| Thermal Coefficient of Linear Expansion | ASTM C531 | 1.5×10^{-5} mm/ °C mm |
| Hardness Shore D | ASTM D2240 | > 70 |
| Bond Strength | ASTM D7234 | >300 psi 100% concrete failure |
| Chemical Resistance of the following: | ASTM D1308 | No Effect |
| Acetic acid | 5 percent | |
| Ammonium hydroxide | 10 percent | |
| Citric Acid | 50 percent | |
| Fatty acid Motor Oil, 20W | | |
| Hydrochloric acid | 10 percent | |
| Salt water | | |
| Sodium Hydroxide | 10 percent | |
| Sulfuric acid | 10 percent | |
| Trisodium phosphate | 5 percent | |
| Urine | | |
| Feces | | |
| Hydrogen peroxide | 28 percent | |
| Distilled Water | | |
| Sodium Hypochloride | 5.28 percent | |

2.5 TROWELED COVE BASE

Same physical properties as specified resinous mortar system.

2.6 BASE CAP STRIP

- A. Aluminum, Extruded: ASTM B221, Alloy 6063-T6.
- B. Shape for 3/16 inch (4.76 mm) depth of base material, "J" configuration.
- C. Finish:
 1. Finish exposed surfaces in accordance with NAAMM Metal Finishes Manual.
 2. Aluminum: NAAMM Amp 501:
 - a. Clear anodic coating, AA-C22A41 chemically etched medium matte, with Architectural Class 1, 0.7 mils (0.018 mm) or thicker.

PART 3 - EXECUTION

3.1 INSPECTION

- A. Examine the areas and conditions where monolithic resinous (urethane and epoxy mortar) flooring system with integral base is to be installed with the VA COR.
- B. Moisture Vapor Emission Testing: Perform moisture vapor transmission testing in accordance with ASTM F1869 to determine the MVER of the substrate prior to commencement of the work. See section 3.4, 3.

3.2 PROJECT CONDITIONS

- A. Maintain temperature of rooms (air and surface) where work occurs, between 70 and 90 degrees F (21 and 32 degrees C) for at least 48 hours, before, during, and 24 hours after installation. Maintain temperature at least 70 degrees F (21 degrees C) during cure period.
- B. Maintain relative humidity less than 75 percent.
- C. Do not install materials until building is permanently enclosed and wet construction is complete, dry, and cured.
- D. Maintain proper ventilation of the area during application and curing time period.
 - 1. Comply with infection control measures of the VA Medical Center.

3.3 INSTALLATION REQUIREMENTS

- A. The manufacturer's instructions for application and installation shall be reviewed with the VA COR for the seamless resinous (urethane and epoxy mortar) flooring system with integral cove base.
- B. Substrate shall be approved by manufacture technical representative.

3.4 PREPARATION

- A. General: Prepare and clean substrates according to resinous flooring manufacturer's written instructions for substrate indicated. Provide clean, dry, and neutral Ph substrate for resinous flooring application.
- B. Concrete Substrates: Provide sound concrete surfaces free of laitance, glaze, efflorescence, curing compounds, form-release agents, dust, dirt, grease, oil, and other contaminants incompatible with resinous flooring.
 - 1. Prepare concrete substrates as follows:
 - a. Shot-blast surfaces with an apparatus that abrades the concrete surface, contains the dispensed shot within the apparatus, and recirculates the shot by vacuum pickup.
 - b. Comply with ASTM C 811 requirements, unless manufacturer's written instructions are more stringent. Use of acids is never allowed.
 - 2. Repair damaged and deteriorated concrete according to resinous flooring manufacturer's written recommendations.
 - 3. Verify that concrete substrates are dry.

- a. Perform anhydrous calcium chloride test, ASTM F 1869. Proceed with application only after substrates have maximum moisture-vapor-emission rate of **[5 lb of water/1000 sq. ft. (1.36 kg of water/92.9 sq. m)]** in 24 hours.
 - b. MVT threshold for monolithic resinous Non - climatic flooring shall not exceed 5 lbs/1000 square feet (0.0001437 kPa) in a 24 hour period. MVT threshold for monolithic resinous climatic flooring shall not exceed 6 lbs/1000 square feet (0.0002155 kPa) over a 24 hour period.
 - c. When MVT emission exceeds this limit, apply manufacturer's recommended vapor control primer or other corrective measures as recommended by manufacturer prior to application of flooring or membrane systems.
 - d. Perform in situ probe test, ASTM F2170. Proceed with application only after substrates do not exceed a maximum potential equilibrium relative humidity of 75-80 percent.
 - a. Provide a written report showing test placement and results.
4. Verify that concrete substrates have neutral Ph and that resinous flooring will adhere to them. Perform tests recommended by manufacturer. Proceed with application only after substrates pass testing.
- C. Resinous Materials: Mix components and prepare materials according to resinous flooring manufacturer's written instructions.
- D. Use patching and fill material to fill holes and depressions in substrates according to manufacturer's written instructions.
- E. Treat control joints and other nonmoving substrate cracks to prevent cracks from reflecting through resinous flooring according to manufacturer's written recommendations. Allowances should be included for flooring manufacturer recommended joint fill material, and concrete crack treatment.
- F. Prepare wall to receive integral cove base:
1. Verify wall material is acceptable for resinous flooring application, if not, install material (e.g. cement board) to receive base.
 2. Fill voids in wall surface to receive base, install undercoats (e.g. water proofing membrane, and/or crack isolation membrane) as recommended by resinous flooring manufacturer.
 3. Install base prior to flooring if required by resinous flooring manufacturer.
 4. Grind, cut or sand protrusions to receive base application.

3.5 APPLICATION

- A. **General:** Apply components of resinous flooring system according to manufacturer's written instructions to produce a uniform, monolithic wearing surface of thickness indicated.
 - 1. Coordinate application of components to provide optimum adhesion of resinous flooring system to substrate, and optimum intercoat adhesion.
 - 2. Cure resinous flooring components according to manufacturer's written instructions. Prevent contamination during application and curing processes.
- B. Apply Primer: over prepared substrate at manufacturer's recommended spreading rate.
- C. Apply cove base: Trowel to wall surfaces at a 1 inch radius, before applying flooring. Apply according to manufacturer's written instructions and details including those for taping, mixing, priming, and troweling, sanding, and top coating of cove base. Round internal and external corners.
- D. Trowel mortar base: Mix mortar material according to manufacturer's recommended procedures. Climatic and non-climatic resinous flooring systems may vary slightly on mode of application. Application should be based upon the following: Uniformly spread mortar over substrate using a specially designed screed box adjusted to manufacturer's recommended height. Metal trowel (hand or power) single mortar coat in thickness indicated for flooring system, grout to fill substrate voids. When cured, sand to remove trowel marks and roughness
- E. Topcoat: Mix and roller apply the topcoat(s) with strict adherence to manufacturer's installation procedures and coverage rates.

3.6 TOLERANCE

- A. From line of plane: Maximum 1/8 inch (3.18 mm) in total distance of flooring and base.
- B. From radius of cove: Maximum of 1/8 inch (3.18 mm) plus or 1/16-inch (1.59 mm) minus.

3.7 CURING, PROTECTION AND CLEANING

- A. Cure resinous flooring materials in compliance with manufacturer's directions, taking care to prevent contamination during stages of application and prior to completion of curing process.
- B. Close area of application for a minimum of 24 hours.
- C. Protect resinous flooring materials from damage and wear during construction operation.
 - 1. Cover flooring with kraft type paper.

2. Optional 6 mm (1/4 inch) thick hardboard, plywood, or particle board where area is in foot or vehicle traffic pattern, rolling or fixed scaffolding and overhead work occurs.
- D. Remove temporary covering and clean resinous flooring just prior to final inspection. Use cleaning materials and procedures recommended by resinous flooring manufacturer.

- - - E N D - - -

SECTION 22 05 11
COMMON WORK RESULTS FOR PLUMBING

PART 1 - GENERAL

1.1 DESCRIPTION

- A. The requirements of this Section shall apply to all sections of Division 22.
- B. Definitions:
 - 1. Exposed: Piping and equipment exposed to view in finished rooms.
- C. Abbreviations/Acronyms:
 - 1. ABS: Acrylonitrile Butadiene Styrene
 - 2. AC: Alternating Current
 - 3. AISI: American Iron and Steel Institute
 - 4. AWG: American Wire Gauge
 - 5. BACnet: Building Automation and Control Network
 - 6. BAg: Silver-Copper-Zinc Brazing Alloy
 - 7. BAS: Building Automation System
 - 8. BCuP: Silver-Copper-Phosphorus Brazing Alloy
 - 9. BSG: Borosilicate Glass Pipe
 - 10. CDA: Copper Development Association
 - 11. C: Celsius
 - 12. CLR: Color
 - 13. CO: Carbon Monoxide
 - 14. COR: Contracting Officer's Representative
 - 15. CPVC: Chlorinated Polyvinyl Chloride
 - 16. CR: Chloroprene
 - 17. CRS: Corrosion Resistant Steel
 - 18. CWP: Cold Working Pressure
 - 19. CxA: Commissioning Agent
 - 20. db(A): Decibels (A weighted)
 - 21. DDC: Direct Digital Control
 - 22. DISS: Diameter Index Safety System
 - 23. DN: Diameter Nominal
 - 24. DWV: Drainage, Waste and Vent
 - 25. ECC: Engineering Control Center
 - 26. EPDM: Ethylene Propylene Diene Monomer
 - 27. EPT: Ethylene Propylene Terpolymer
 - 28. ETO: Ethylene Oxide

- 29. F: Fahrenheit
- 30. FAR: Federal Acquisition Regulations
- 31. FD: Floor Drain
- 32. FED: Federal
- 33. FG: Fiberglass
- 34. FNPT: Female National Pipe Thread
- 35. FPM: Fluoroelastomer Polymer
- 36. GPM: Gallons Per Minute
- 37. HDPE: High Density Polyethylene
- 38. Hg: Mercury
- 39. HOA: Hands-Off-Automatic
- 40. HP: Horsepower
- 41. HVE: High Volume Evacuation
- 42. ID: Inside Diameter
- 43. IPS: Iron Pipe Size
- 44. Kg: Kilogram
- 45. kPa: Kilopascal
- 46. lb: Pound
- 47. L/s: Liters Per Second
- 48. L/min: Liters Per Minute
- 49. MAWP: Maximum Allowable Working Pressure
- 50. MAX: Maximum
- 51. MED: Medical
- 52. m: Meter
- 53. MFG: Manufacturer
- 54. mg: Milligram
- 55. mg/L: Milligrams per Liter
- 56. ml: Milliliter
- 57. mm: Millimeter
- 58. MIN: Minimum
- 59. NF: Oil Free Dry (Nitrogen)
- 60. NPTF: National Pipe Thread Female
- 61. NPS: Nominal Pipe Size
- 62. NPT: Nominal Pipe Thread
- 63. OD: Outside Diameter
- 64. OSD: Open Sight Drain
- 65. OXY: Oxygen

- 66. PBP: Prefabricated Bedside Patient Units
- 67. PP: Polypropylene
- 68. PPM: Parts per Million
- 69. PSIG: Pounds per Square Inch
- 70. PTFE: Polytetrafluoroethylene
- 71. PVC: Polyvinyl Chloride
- 72. PVDF: Polyvinylidene Fluoride
- 73. RAD: Radians
- 74. RPM: Revolutions Per Minute
- 75. RTRP: Reinforced Thermosetting Resin Pipe
- 76. SCFM: Standard Cubic Feet Per Minute
- 77. SDI: Silt Density Index
- 78. SPEC: Specification
- 79. SPS: Sterile Processing Services
- 80. STD: Standard
- 81. SUS: Saybolt Universal Second
- 82. SWP: Steam Working Pressure
- 83. TEFC: Totally Enclosed Fan-Cooled
- 84. TFE: Tetrafluoroethylene
- 85. THHN: Thermoplastic High-Heat Resistant Nylon Coated Wire
- 86. THWN: Thermoplastic Heat & Water Resistant Nylon Coated Wire
- 87. T/P: Temperature and Pressure
- 88. USDA: U.S. Department of Agriculture
- 89. VAC: Vacuum
- 90. VA: Veterans Administration
- 91. VAMC: Veterans Administration Medical Center
- 92. WOG: Water, Oil, Gas

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT.
- D. Section 03 30 00, CAST-IN-PLACE CONCRETE: Concrete and Grout.

1.3 APPLICABLE PUBLICATIONS

- A. The publications listed below shall form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):
 - ASME Boiler and Pressure Vessel Code -
 - BPVC Section IX-2013....Welding, Brazing, and Fusing Qualifications
 - B31.1-2012.....Power Piping
- C. American Society for Testing and Materials (ASTM):
 - A36/A36M-2012.....Standard Specification for Carbon Structural Steel
 - A575-96 (R2013)e1.....Standard Specification for Steel Bars, Carbon, Merchant Quality, M-Grades
 - E84-2013a.....Standard Test Method for Surface Burning Characteristics of Building Materials
 - E119-2012a.....Standard Test Methods for Fire Tests of Building Construction and Materials
 - F1760-01 (R2011).....Standard Specification for Coextruded Poly(Vinyl Chloride) (PVC) Non-Pressure Plastic Pipe Having Reprocessed-Recycled Content
- D. International Code Council, (ICC):
 - IBC-2012.....International Building Code
 - IPC-2012.....International Plumbing Code
- E. Manufacturers Standardization Society (MSS) of the Valve and Fittings Industry, Inc:
 - SP-58-2009.....Pipe Hangers and Supports - Materials, Design, Manufacture, Selection, Application and Installation
 - SP-69-2003.....Pipe Hangers and Supports - Selection and Application
- F. Military Specifications (MIL):
 - P-21035B.....Paint High Zinc Dust Content, Galvanizing Repair (Metric)
- G. National Electrical Manufacturers Association (NEMA):
 - MG 1-2011.....Motors and Generators

- H. National Fire Protection Association (NFPA):
 - 51B-2014.....Standard for Fire Prevention During Welding,
Cutting and Other Hot Work
 - 54-2012.....National Fuel Gas Code
 - 70-2014.....National Electrical Code (NEC)
- I. NSF International (NSF):
 - 5-2012.....Water Heaters, Hot Water Supply Boilers, and
Heat Recovery Equipment
 - 14-2012.....Plastic Piping System Components and Related
Materials
 - 61-2012.....Drinking Water System Components - Health
Effects
 - 372-2011.....Drinking Water System Components - Lead Content
- J. Department of Veterans Affairs (VA):
 - PG-18-10.....Plumbing Design Manual
 - PG-18-13-2011.....Barrier Free Design Guide

1.4 SUBMITTALS

- A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 05 11, COMMON WORK RESULTS FOR PLUMBING", with applicable paragraph identification.
- C. Contractor shall make all necessary field measurements and investigations to assure that the equipment and assemblies will meet contract requirements and will fit the space available.
- D. If equipment is submitted which differs in arrangement from that shown, provide drawings that show the rearrangement of all associated systems. Approval will be given only if all features of the equipment and associated systems, including accessibility, are equivalent to that required by the contract.
- E. Prior to submitting shop drawings for approval, contractor shall certify in writing that manufacturers of all major items of equipment have each reviewed drawings and specifications, and have jointly coordinated and properly integrated their equipment and controls to provide a complete and efficient installation.

- F. Installing Contractor shall provide lists of previous installations for selected items of equipment. Contact persons who will serve as references, with telephone numbers and e-mail addresses shall be submitted with the references.
- G. Manufacturer's Literature and Data: Manufacturer's literature shall be submitted under the pertinent section rather than under this section.
1. Electric motor data and variable speed drive data shall be submitted with the driven equipment.
 2. Equipment and materials identification.
 3. Firestopping materials.
 4. Hangers, inserts, supports and bracing. Provide load calculations for variable spring and constant support hangers.
 5. Wall, floor, and ceiling plates.
- H. Submittals and shop drawings for interdependent items, containing applicable descriptive information, shall be furnished together and complete in a group. Coordinate and properly integrate materials and equipment in each group to provide a completely compatible and efficient installation. Final review and approvals will be made only by groups.
- I. Coordination Drawings: Complete consolidated and coordinated layout drawings shall be submitted for all new systems, and for existing systems that are in the same areas. The drawings shall include plan views, elevations and sections of all systems and shall be on a scale of not less than 1:32 (3/8 inch equal to one foot). Clearly identify and dimension the proposed locations of the principal items of equipment. The drawings shall clearly show the proposed location and adequate clearance for all equipment, controls, piping, pumps, valves and other items. All valves, trap primer valves, water hammer arrestors, strainers, and equipment requiring service shall be provided with an access door sized for the complete removal of plumbing device, component, or equipment. Equipment foundations shall not be installed until equipment or piping layout drawings have been approved. Detailed layout drawings shall be provided for all piping systems. In addition, details of the following shall be provided.
1. Mechanical equipment rooms.
 2. Interstitial space.
 3. Hangers, inserts, supports, and bracing.

4. Pipe sleeves.
5. Equipment penetrations of floors, walls, ceilings, or roofs.

J. Maintenance Data and Operating Instructions:

1. Maintenance and operating manuals in accordance with Section 01 00 00, GENERAL REQUIREMENTS, Article, INSTRUCTIONS, for systems and equipment. Include complete list indicating all components of the systems with diagrams of the internal wiring for each item of equipment.
2. Include listing of recommended replacement parts for keeping in stock supply, including sources of supply, for equipment shall be provided. The listing shall include belts for equipment: Belt manufacturer, model number, size and style, and distinguished whether of multiple belt sets.

1.5 QUALITY ASSURANCE

A. Products Criteria:

1. Standard Products: Material and equipment shall be the standard products of a manufacturer regularly engaged in the manufacture, supply and servicing of the specified products for at least 5 years. However, digital electronics devices, software and systems such as controls, instruments, computer work station, shall be the current generation of technology and basic design that has a proven satisfactory service record of at least 5 years.
2. Equipment Service: There shall be permanent service organizations, authorized and trained by manufacturers of the equipment supplied, located within 160 km (100 miles) of the project. These organizations shall come to the site and provide acceptable service to restore operations within four hours of receipt of notification by phone, e-mail or fax in event of an emergency, such as the shut-down of equipment; or within 24 hours in a non-emergency. Names, mail and e-mail addresses and phone numbers of service organizations providing service under these conditions for (as applicable to the project): pumps, compressors, water heaters, critical instrumentation, computer workstation and programming shall be submitted for project record and inserted into the operations and maintenance manual.

3. All items furnished shall be free from defects that would adversely affect the performance, maintainability and appearance of individual components and overall assembly.
 4. The products and execution of work specified in Division 22 shall conform to the referenced codes and standards as required by the specifications. Local codes and amendments enforced by the local code official shall be enforced, if required by local authorities such as the natural gas supplier. If the local codes are more stringent, then the local code shall apply. Any conflicts shall be brought to the attention of the Contracting Officers Representative (COR).
 5. Multiple Units: When two or more units of materials or equipment of the same type or class are required, these units shall be products of one manufacturer.
 6. Assembled Units: Manufacturers of equipment assemblies, which use components made by others, assume complete responsibility for the final assembled product.
 7. Nameplates: Nameplate bearing manufacturer's name or identifiable trademark shall be securely affixed in a conspicuous place on equipment, or name or trademark cast integrally with equipment, stamped or otherwise permanently marked on each item of equipment.
 8. Asbestos products or equipment or materials containing asbestos shall not be used.
 9. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit <http://www.biopreferred.gov>.
- B. Welding: Before any welding is performed, contractor shall submit a certificate certifying that welders comply with the following requirements:
1. Qualify welding processes and operators for piping according to ASME "Boiler and Pressure Vessel Code", Section IX, "Welding and Brazing Qualifications".
 2. Comply with provisions of ASME B31 series "Code for Pressure Piping".

3. Certify that each welder and welding operator has passed American Welding Society (AWS) qualification tests for the welding processes involved, and that certification is current.
 4. All welds shall be stamped according to the provisions of the American Welding Society.
- C. Manufacturer's Recommendations: Where installation procedures or any part thereof are required to be in accordance with the recommendations of the manufacturer of the material being installed, printed copies of these recommendations shall be furnished to the COR prior to installation. Installation of the item will not be allowed to proceed until the recommendations are received. Failure to furnish these recommendations can be cause for rejection of the material.
- D. Execution (Installation, Construction) Quality:
1. All items shall be applied and installed in accordance with manufacturer's written instructions. Conflicts between the manufacturer's instructions and the contract documents shall be referred to the COR for resolution. Printed copies or electronic files of manufacturer's installation instructions shall be provided to the COR at least 10 working days prior to commencing installation of any item.
 2. All items that require access, such as for operating, cleaning, servicing, maintenance, and calibration, shall be easily and safely accessible by persons standing at floor level, or standing on permanent platforms, without the use of portable ladders. Examples of these items include, but are not limited to: all types of valves, filters and strainers, transmitters, and control devices. Prior to commencing installation work, refer conflicts between this requirement and contract documents to COR for resolution.
 3. Complete layout drawings shall be required by Paragraph, SUBMITTALS. Construction work shall not start on any system until the layout drawings have been approved by VA.
 4. Installer Qualifications: Installer shall be licensed and shall provide evidence of the successful completion of at least five projects of equal or greater size and complexity. Provide tradesmen skilled in the appropriate trade.

5. If an installation is unsatisfactory to the COR, the Contractor shall correct the installation at no additional cost or additional time to the Government.
- E. Guaranty: Warranty of Construction, FAR clause 52.246-21.
- F. Plumbing Systems: IPC, International Plumbing Code. Unless otherwise required herein, perform plumbing work in accordance with the latest version of the IPC. For IPC codes referenced in the contract documents, advisory provisions shall be considered mandatory, the word "should" shall be interpreted as "shall". Reference to the "code official" or "owner" shall be interpreted to mean the COR.
- G. Cleanliness of Piping and Equipment Systems:
 1. Care shall be exercised in the storage and handling of equipment and piping material to be incorporated in the work. Debris arising from cutting, threading and welding of piping shall be removed.
 2. Piping systems shall be flushed, blown or pigged as necessary to deliver clean systems.
 3. The interior of all tanks shall be cleaned prior to delivery and beneficial use by the Government. All piping shall be tested in accordance with the specifications and the International Plumbing Code (IPC). All filters, strainers, fixture faucets shall be flushed of debris prior to final acceptance.
 4. Contractor shall be fully responsible for all costs, damage, and delay arising from failure to provide clean systems.

1.6 DELIVERY, STORAGE AND HANDLING

- A. Protection of Equipment:
 1. Equipment and material placed on the job site shall remain in the custody of the Contractor until phased acceptance, whether or not the Government has reimbursed the Contractor for the equipment and material. The Contractor is solely responsible for the protection of such equipment and material against any damage.
 2. Damaged equipment shall be replaced with an identical unit as determined and directed by the COR. Such replacement shall be at no additional cost or additional time to the Government.
 3. Interiors of new equipment and piping systems shall be protected against entry of foreign matter. Both inside and outside shall be cleaned before painting or placing equipment in operation.

4. Existing equipment and piping being worked on by the Contractor shall be under the custody and responsibility of the Contractor and shall be protected as required for new work.

1.7 AS-BUILT DOCUMENTATION

- A. Submit manufacturer's literature and data updated to include submittal review comments and any equipment substitutions.
- B. Submit operation and maintenance data updated to include submittal review comments, substitutions and construction revisions shall be inserted into a three ring binder. All aspects of system operation and maintenance procedures, including piping isometrics, wiring diagrams of all circuits, a written description of system design, control logic, and sequence of operation shall be included in the operation and maintenance manual. The operations and maintenance manual shall include troubleshooting techniques and procedures for emergency situations. Notes on all special systems or devices such as damper and door closure interlocks shall be included. A List of recommended spare parts (manufacturer, model number, and quantity) shall be furnished. Information explaining any special knowledge or tools the owner will be required to employ shall be inserted into the As-Built documentation.
- C. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. As-built drawings are to be provided, and a copy of them on Auto-Cad version 2013 provided on compact disk or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.
- D. Certification documentation shall be provided prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and a certification that all results of tests were within limits specified.

PART 2 - PRODUCTS

2.1 MATERIALS FOR VARIOUS SERVICES

- A. Material or equipment containing a weighted average of greater than 0.25 percent lead shall not be used in any potable water system intended for human consumption, and shall be certified in accordance with NSF 61 or NSF 372.

2.2 FACTORY-ASSEMBLED PRODUCTS

- A. Standardization of components shall be maximized to reduce spare part requirements.
- B. Manufacturers of equipment assemblies that include components made by others shall assume complete responsibility for final assembled unit.
 - 1. All components of an assembled unit need not be products of same manufacturer.
 - 2. Constituent parts that are alike shall be products of a single manufacturer.
 - 3. Components shall be compatible with each other and with the total assembly for intended service.
 - 4. Contractor shall guarantee performance of assemblies of components, and shall repair or replace elements of the assemblies as required to deliver specified performance of the complete assembly at no additional cost or time to the Government.
- C. Components of equipment shall bear manufacturer's name and trademark, model number, serial number and performance data on a name plate securely affixed in a conspicuous place, or cast integral with, stamped or otherwise permanently marked upon the components of the equipment.
- D. Major items of equipment, which serve the same function, shall be the same make and model.

2.3 COMPATIBILITY OF RELATED EQUIPMENT

- A. Equipment and materials installed shall be compatible in all respects with other items being furnished and with existing items so that the result will be a complete and fully operational system that conforms to contract requirements.

2.4 SAFETY GUARDS

- A. All Equipment shall have moving parts protected from personal injury.

2.6 GALVANIZED REPAIR COMPOUND

- A. Mil. Spec. MIL-P-21035B, paint.

2.7 PIPE PENETRATIONS

- A. Pipe penetration sleeves shall be installed for all pipe other than rectangular blocked out floor openings for risers in mechanical bays.
- B. Pipe penetration sleeve materials shall comply with all firestopping requirements for each penetration.
- C. To prevent accidental liquid spills from passing to a lower level, provide the following:
 - 1. For sleeves: Extend sleeve 25 mm (1 inch) above finished floor and provide sealant for watertight joint.
 - 2. For blocked out floor openings: Provide 40 mm (1-1/2 inch) angle set in silicone adhesive around opening.
 - 3. For drilled penetrations: Provide 40 mm (1-1/2 inch) angle ring or square set in silicone adhesive around penetration.
- D. Penetrations are not allowed through beams or ribs, but may be installed in concrete beam flanges, with structural engineer prior approval. Any deviation from these requirements must receive prior approval of COR.
- E. Sheet metal, plastic, or moisture resistant fiber sleeves shall be provided for pipe passing through floors, interior walls, and partitions, unless brass or steel pipe sleeves are specifically called for below.
- F. Cast iron or zinc coated pipe sleeves shall be provided for pipe passing through exterior walls below grade. The space between the sleeve and pipe shall be made watertight with a modular or link rubber seal. The link seal shall be applied at both ends of the sleeve.
- G. Galvanized steel or an alternate black iron pipe with asphalt coating sleeves shall be for pipe passing through concrete beam flanges, except where brass pipe sleeves are called for. A galvanized steel sleeve shall be provided for pipe passing through floor of mechanical rooms, laundry work rooms, and animal rooms above basement. Except in mechanical rooms, sleeves shall be connected with a floor plate.
- H. Sleeve clearance through floors, walls, partitions, and beam flanges shall be 25 mm (1 inch) greater in diameter than external diameter of pipe. Sleeve for pipe with insulation shall be large enough to accommodate the insulation plus 25 mm (1 inch) in diameter. Interior openings shall be caulked tight with firestopping material and sealant to prevent the spread of fire, smoke, water and gases.

2.8 TOOLS AND LUBRICANTS

- A. Furnish, and turn over to the COR, special tools not readily available commercially, that are required for disassembly or adjustment of equipment and machinery furnished.
- B. Grease Guns with Attachments for Applicable Fittings: One for each type of grease required for each motor or other equipment.
- C. Tool Containers: metal, permanently identified for intended service and mounted, or located, where directed by the COR.
- D. Lubricants: A minimum of 0.95 L (1 quart) of oil, and 0.45 kg (1 pound) of grease, of equipment manufacturer's recommended grade and type, in unopened containers and properly identified as to use for each different application. Bio-based materials shall be utilized when possible.

2.9 ASBESTOS

- A. Materials containing asbestos are not permitted.

PART 3 - EXECUTION

3.1 ARRANGEMENT AND INSTALLATION OF EQUIPMENT AND PIPING

- A. Location of piping, sleeves, inserts, hangers, and equipment, access provisions shall be coordinated with the work of all trades. Piping, sleeves, inserts, hangers, and equipment shall be located clear of windows, doors, openings, light outlets, and other services and utilities. Equipment layout drawings shall be prepared to coordinate proper location and personnel access of all facilities. The drawings shall be submitted for review.
- B. Manufacturer's published recommendations shall be followed for installation methods not otherwise specified.
- C. Operating Personnel Access and Observation Provisions: All equipment and systems shall be arranged to provide clear view and easy access, without use of portable ladders, for maintenance, testing and operation of all devices including, but not limited to: all equipment items, valves, backflow preventers, filters, strainers, transmitters, sensors, meters and control devices. All gages and indicators shall be clearly visible by personnel standing on the floor or on permanent platforms. Maintenance and operating space and access provisions that are shown on the drawings shall not be changed nor reduced.
- D. Structural systems necessary for pipe and equipment support shall be coordinated to permit proper installation.

- E. Location of pipe sleeves, trenches and chases shall be accurately coordinated with equipment and piping locations.
- F. Cutting Holes:
1. Holes shall be located to avoid interference with structural members such as beams or grade beams. Holes shall be laid out in advance and drilling done only after approval by COR. If the Contractor considers it necessary to drill through structural members, this matter shall be referred to COR for approval.
 2. Waterproof membrane shall not be penetrated. Pipe floor penetration block outs shall be provided outside the extents of the waterproof membrane.
 3. Holes through concrete and masonry shall be cut by rotary core drill. Pneumatic hammer, impact electric, and hand or manual hammer type drill will not be allowed, except as permitted by COR where working area space is limited.
- G. Minor Piping: Generally, small diameter pipe runs from drips and drains, water cooling, and other services are not shown but must be provided.
- H. Minor Piping: Generally, small diameter pipe runs from drips and drains, water cooling, and other service are not shown but must be provided.
- I. Protection and Cleaning:
1. Equipment and materials shall be carefully handled, properly stored, and adequately protected to prevent damage before and during installation, in accordance with the manufacturer's recommendations and as approved by the COR. Damaged or defective items in the opinion of the COR, shall be replaced at no additional cost or time to the Government.
 2. Protect all finished parts of equipment, such as shafts and bearings where accessible, from rust prior to operation by means of protective grease coating and wrapping. Close pipe openings with caps or plugs during installation. Pipe openings, equipment, and plumbing fixtures shall be tightly covered against dirt or mechanical injury. At completion of all work thoroughly clean fixtures, exposed materials and equipment.
- J. Concrete and Grout: Concrete and shrink compensating grout 25 MPa (3000 psig) minimum shall be used for all pad or floor mounted equipment.

K. Work in Existing Building:

1. Perform as specified in Article, OPERATIONS AND STORAGE AREAS, Article, ALTERATIONS, and Article, RESTORATION of the Section 01 00 00, GENERAL REQUIREMENTS for relocation of existing equipment, alterations and restoration of existing building(s).
2. As specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, OPERATIONS AND STORAGE AREAS, make alterations to existing service piping at times that will cause the least interfere with normal operation of the facility.

L. Work in Animal Research Areas: Seal all pipe penetrations with silicone sealant to prevent entrance of insects.

M. Work in bathrooms, restrooms, housekeeping closets: All pipe penetrations behind escutcheons shall be sealed with plumber's putty.

N. Switchgear Drip Protection: Every effort shall be made to eliminate the installation of pipe above data equipment, and electrical and telephone switchgear. If this is not possible, encase pipe in a second pipe with a minimum of joints. Drain valve shall be provided in low point of casement pipe.

O. Inaccessible Equipment:

1. Where the Government determines that the Contractor has installed equipment not conveniently accessible for operation and maintenance, equipment shall be removed and reinstalled or remedial action performed as directed at no additional cost or additional time to the Government.
2. The term "conveniently accessible" is defined as capable of being reached without the use of ladders, or without climbing or crawling under or over obstacles such as electrical conduit, motors, fans, pumps, belt guards, transformers, high voltage lines, piping, and ductwork.

3.2 TEMPORARY PIPING AND EQUIPMENT

- A. Continuity of operation of existing facilities may require temporary installation or relocation of equipment and piping. Temporary equipment or pipe installation or relocation shall be provided to maintain continuity of operation of existing facilities.
- B. The Contractor shall provide all required facilities in accordance with the requirements of phased construction and maintenance of service. All piping and equipment shall be properly supported, sloped to drain,

operate without excessive stress, and shall be insulated where injury can occur to personnel by contact with operating facilities. The requirements of paragraph 3.1 shall apply.

- C. Temporary facilities and piping shall be completely removed back to the nearest active distribution branch or main pipe line and any openings in structures sealed. Dead legs are not allowed in potable water systems. Necessary blind flanges and caps shall be provided to seal open piping remaining in service.

3.3 RIGGING

- A. Openings in building structures shall be planned to accommodate design scheme.
- B. Alternative methods of equipment delivery may be offered and will be considered by Government under specified restrictions of phasing and service requirements as well as structural integrity of the building.
- C. All openings in the building shall be closed when not required for rigging operations to maintain proper environment in the facility for Government operation and maintenance of service.
- D. Contractor shall provide all facilities required to deliver specified equipment and place on foundations. Attachments to structures for rigging purposes and support of equipment on structures shall be Contractor's full responsibility.
- E. Contractor shall check all clearances, weight limitations and shall provide a rigging plan designed by a Registered Professional Engineer. All modifications to structures, including reinforcement thereof, shall be at Contractor's cost, time and responsibility.
- F. Rigging plan and methods shall be referred to COR for evaluation prior to actual work.

3.4 PIPE AND EQUIPMENT SUPPORTS

- A. Where hanger spacing does not correspond with joist or rib spacing, use structural steel channels secured directly to joist and rib structure that will correspond to the required hanger spacing, and then suspend the equipment and piping from the channels. Holes shall be drilled or burned in structural steel ONLY with the prior written approval of the COR.
- B. The use of chain pipe supports, wire or strap hangers; wood for blocking, stays and bracing, or hangers suspended from piping above shall not be permitted. Rusty products shall be replaced.

- C. For horizontal and vertical plumbing pipe supports, refer to the International Plumbing Code (IPC) and these specifications.
- D. Overhead Supports:
1. The basic structural system of the building is designed to sustain the loads imposed by equipment and piping to be supported overhead.
 2. Provide steel structural members, in addition to those shown, of adequate capability to support the imposed loads, located in accordance with the final approved layout of equipment and piping.
 3. Tubing and capillary systems shall be supported in channel troughs.
- E. Floor Supports:
1. Provide concrete bases, concrete anchor blocks and pedestals, and structural steel systems for support of equipment and piping. Concrete bases and structural systems shall be anchored and doweled to resist forces under operating and seismic conditions (if applicable) without excessive displacement or structural failure.
 2. Bases and supports shall not be located and installed until equipment mounted thereon has been approved. Bases shall be sized to match equipment mounted thereon plus 50 mm (2 inch) excess on all edges. Structural drawings shall be reviewed for additional requirements. Bases shall be neatly finished and smoothed, shall have chamfered edges at the top, and shall be suitable for painting.
 3. All equipment shall be shimmed, leveled, firmly anchored, and grouted with epoxy grout. Anchor bolts shall be placed in sleeves, anchored to the bases. Fill the annular space between sleeves and bolts with a grout material to permit alignment and realignment.

3.5 LUBRICATION

- A. All equipment and devices requiring lubrication shall be lubricated prior to initial operation. All devices and equipment shall be field checked for proper lubrication.
- B. All devices and equipment shall be equipped with required lubrication fittings. A minimum of one liter (one quart) of oil and 0.45 kg (1 pound) of grease of manufacturer's recommended grade and type for each different application shall be provided. All materials shall be delivered to COR in unopened containers that are properly identified as to application.
- C. A separate grease gun with attachments for applicable fittings shall be provided for each type of grease applied.

- D. All lubrication points shall be accessible without disassembling equipment, except to remove access plates.
- E. All lubrication points shall be extended to one side of the equipment.

3.6 PLUMBING SYSTEMS DEMOLITION

- A. Rigging access, other than indicated on the drawings, shall be provided after approval for structural integrity by the COR. Such access shall be provided without additional cost or time to the Government. Where work is in an operating plant, approved protection from dust and debris shall be provided at all times for the safety of plant personnel and maintenance of plant operation and environment of the plant.
- B. In an operating plant, cleanliness and safety shall be maintained. The plant shall be kept in an operating condition. Government personnel will be carrying on their normal duties of operating, cleaning and maintaining equipment and plant operation. Work shall be confined to the immediate area concerned; maintain cleanliness and wet down demolished materials to eliminate dust. Dust and debris shall not be permitted to accumulate in the area to the detriment of plant operation. All flame cutting shall be performed to maintain the fire safety integrity of this plant. Adequate fire extinguishing facilities shall be available at all times. All work shall be performed in accordance with recognized fire protection standards including NFPA 51B. Inspections will be made by personnel of the VA Medical Center, and the Contractor shall follow all directives of the COR with regard to rigging, safety, fire safety, and maintenance of operations.
- C. Unless specified otherwise, all piping, wiring, conduit, and other devices associated with the equipment not re-used in the new work shall be completely removed from Government property per Section 01 74 19, CONSTRUCTION WASTE MANAGEMENT. This includes all concrete equipment pads, pipe, valves, fittings, insulation, and all hangers including the top connection and any fastenings to building structural systems. All openings shall be sealed after removal of equipment, pipes, ducts, and other penetrations in roof, walls, floors, in an approved manner and in accordance with plans and specifications where specifically covered. Structural integrity of the building system shall be maintained. Reference shall also be made to the drawings and specifications of the other disciplines in the project for additional facilities to be demolished or handled.

- D. All valves including gate, globe, ball, butterfly and check, all pressure gages and thermometers with wells shall remain Government property and shall be removed and delivered to COR and stored as directed. The Contractor shall remove all other material and equipment, devices and demolition debris under these plans and specifications. Such material shall be removed from Government property expeditiously and shall not be allowed to accumulate. Coordinate with the COR and Infection Control.

3.7 OPERATING AND PERFORMANCE TESTS

- A. Prior to the final inspection, all required tests shall be performed as specified in Section 01 00 00, GENERAL REQUIREMENTS, Article, TESTS and submit the test reports and records to the COR.
- B. Should evidence of malfunction in any tested system, or piece of equipment or component part thereof, occur during or as a result of tests, make proper corrections, repairs or replacements, and repeat tests at no additional cost to the Government.
- C. When completion of certain work or systems occurs at a time when final control settings and adjustments cannot be properly made to make performance tests, then conduct such performance tests and finalize control settings during the first actual seasonal use of the respective systems following completion of work. Rescheduling of these tests shall be requested in writing to COR for approval.

3.8 OPERATION AND MAINTENANCE MANUALS

- A. All new and temporary equipment and all elements of each assembly shall be included.
- B. Data sheet on each device listing model, size, capacity, pressure, speed, horsepower, impeller size, and other information shall be included.
- C. Manufacturer's installation, maintenance, repair, and operation instructions for each device shall be included. Assembly drawings and parts lists shall also be included. A summary of operating precautions and reasons for precautions shall be included in the Operations and Maintenance Manual.
- D. Lubrication instructions, type and quantity of lubricant shall be included.
- E. Schematic diagrams and wiring diagrams of all control systems corrected to include all field modifications shall be included.

- F. Set points of all interlock devices shall be listed.
- G. Trouble-shooting guide for the control system troubleshooting shall be inserted into the Operations and Maintenance Manual.
- H. The control system sequence of operation corrected with submittal review comments shall be inserted into the Operations and Maintenance Manual.
- I. Emergency procedures for shutdown and startup of equipment and systems.

- - - E N D - - -

**SECTION 22 13 00
FACILITY SANITARY AND VENT PIPING**

PART 1 - GENERAL

1.1 DESCRIPTION

- A. This section pertains to sanitary sewer and vent systems, including piping, equipment and all necessary accessories as designated in this section.
- B. A complete listing of all acronyms and abbreviations are included in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.

1.2 RELATED WORK

- A. Section 01 00 00, GENERAL REQUIREMENTS.
- B. Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING: Pipe Hangers and Supports, Materials Identification.

1.3 APPLICABLE PUBLICATIONS

- A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.
- B. American Society of Mechanical Engineers (ASME):
 - A13.1-2007.....Scheme for the Identification of Piping Systems
 - A112.36.2M-1991(R 2012).Cleanouts
 - A112.6.3-2001 (R2007)...Standard for Floor and Trench Drains
- C. American Society for Testing and Materials (ASTM):
 - A53/A53M-2012.....Standard Specification for Pipe, Steel, Black
And Hot-Dipped, Zinc-coated, Welded and
Seamless
 - A74-2013a.....Standard Specification for Cast Iron Soil Pipe
and Fittings
 - A888-2013a.....Standard Specification for Hubless Cast Iron
Soil Pipe and Fittings for Sanitary and Storm
Drain, Waste, and Vent Piping Applications
 - C564-2012.....Standard Specification for Rubber Gaskets for
Cast Iron Soil Pipe and Fittings
- D. Cast Iron Soil Pipe Institute (CISPI):
 - 2006.....Cast Iron Soil Pipe and Fittings Handbook

- 301-2012.....Standard Specification for Hubless Cast Iron
Soil Pipe and Fittings for Sanitary and Storm
Drain, Waste, and Vent Piping Applications
- 310-2012.....Specification for Coupling for Use in
Connection with Hubless Cast Iron Soil Pipe and
Fittings for Sanitary and Storm Drain, Waste,
and Vent Piping Applications

- E. Copper Development Association, Inc. (CDA):
A4015.....Copper Tube Handbook
- F. International Code Council (ICC):
IPC-2012.....International Plumbing Code
- G. Manufacturers Standardization Society (MSS):
SP-123-2013.....Non-Ferrous Threaded and Solder-Joint Unions
for Use With Copper Water Tube
- H. National Fire Protection Association (NFPA):
70-2014.....National Electrical Code (NEC)
- I. Plumbing and Drainage Institute (PDI):
WH-201 (R 2010).....Water Hammer Arrestors Standard
- J. Underwriters' Laboratories, Inc. (UL):
508-99 (R2013).....Standard For Industrial Control Equipment

1.4 SUBMITTALS

- A. Submittals, including number of required copies, shall be submitted in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, and SAMPLES.
- B. Information and material submitted under this section shall be marked "SUBMITTED UNDER SECTION 22 13 00, FACILITY SANITARY AND VENT PIPING", with applicable paragraph identification.
- C. Manufacturer's Literature and Data including: Full item description and optional features and accessories. Include dimensions, weights, materials, applications, standard compliance, model numbers, size, and capacity.
 - 1. Piping.
 - 2. Floor Drains.
 - 3. Grease Removal Unit.
 - 4. Cleanouts.
 - 5. Trap Seal Protection.
 - 6. Penetration Sleeves.

7. Pipe Fittings.
8. Traps.
9. Exposed Piping and Fittings.
- D. Detailed shop drawing of clamping device and extensions when required in connection with the waterproofing membrane or the floor drain.

1.5 QUALITY ASSURANCE

- A. Bio-Based Materials: For products designated by the USDA's Bio-Preferred Program, provide products that meet or exceed USDA recommendations for bio-based content, so long as products meet all performance requirements in this specifications section. For more information regarding the product categories covered by the Bio-Preferred Program, visit <http://www.biopREFERRED.gov>.

1.6 AS-BUILT DOCUMENTATION

- A. The installing contractor shall maintain as-built drawings of each completed phase for verification; and, shall provide the complete set at the time of final systems certification testing. As-built drawings are to be provided, and a copy of them on Auto-Cad version 2013 provided on compact disk or DVD. Should the installing contractor engage the testing company to provide as-built or any portion thereof, it shall not be deemed a conflict of interest or breach of the 'third party testing company' requirement.
- B. Certification documentation shall be provided prior to submitting the request for final inspection. The documentation shall include all test results, the names of individuals performing work for the testing agency on this project, detailed procedures followed for all tests, and a certification that all results of tests were within limits specified.

PART 2 - PRODUCTS

2.1 SANITARY WASTE, DRAIN, AND VENT PIPING

- A. Cast iron waste, drain, and vent pipe and fittings.
 1. Cast iron waste, drain, and vent pipe and fittings shall be used for the following applications:
 - a. Pipe buried in or in contact with earth.
 - b. Sanitary pipe extensions to a distance of approximately 1500 mm (5 feet) outside of the building.
 - c. Interior waste and vent piping above grade.
 2. Cast iron Pipe shall be bell and spigot or hubless (plain end or no-hub or hubless).

3. The material for all pipe and fittings shall be cast iron soil pipe and fittings and shall conform to the requirements of CISPI 301, ASTM A888, or ASTM A74.
4. Cast iron pipe and fittings shall be made from a minimum of 95 percent post-consumer recycled material.
5. Joints for hubless pipe and fittings shall conform to the manufacturer's installation instructions. Couplings for hubless joints shall conform to CISPI 310. Joints for hub and spigot pipe shall be installed with compression gaskets conforming to the requirements of ASTM C564.

2.3 SPECIALTY PIPE FITTINGS

- A. Transition pipe couplings shall join piping with small differences in outside diameters or different materials. End connections shall be of the same size and compatible with the pipes being joined. The transition coupling shall be elastomeric, sleeve type reducing or transition pattern and include shear and corrosion resistant metal, tension band and tightening mechanism on each end. The transition coupling sleeve coupling shall be of the following material:
 1. For cast iron soil pipes, the sleeve material shall be elastomeric seal conforming to ASTM D5926.

2.4 CLEANOUTS

- A. Cleanouts shall be the same size as the pipe, up to 100 mm (4 inches); and not less than 100 mm (4 inches) for larger pipe. Cleanouts shall be easily accessible and shall be gastight and watertight. Minimum clearance of 600 mm (24 inches) shall be provided for clearing a clogged sanitary line.
- B. Floor cleanouts shall be gray iron housing with clamping device and round, secured, scoriated, gray iron cover conforming to ASME A112.36.2M. A gray iron ferrule with hubless, socket, inside calk or spigot connection and counter sunk, taper-thread, brass or bronze closure plug shall be included. The frame and cover material and finish shall be nickel-bronze copper alloy with a square shape. The cleanout shall be vertically adjustable for a minimum of 50 mm (2 inches). When a waterproof membrane is used in the floor system, clamping collars shall be provided on the cleanouts. Cleanouts shall consist of wye fittings and eighth bends with brass or bronze screw plugs. Cleanouts in the resilient tile floors, quarry tile and ceramic tile floors shall

be provided with square top covers recessed for tile insertion. In the carpeted areas, carpet cleanout markers shall be provided. Two way cleanouts shall be provided where indicated on drawings and at every building exit. The loading classification for cleanouts in sidewalk areas or subject to vehicular traffic shall be heavy duty type.

- C. Cleanouts shall be provided at or near the base of the vertical stacks with the cleanout plug located approximately 600 mm (24 inches) above the floor. If there are no fixtures installed on the lowest floor, the cleanout shall be installed at the base of the stack. The cleanouts shall be extended to the wall access cover. Cleanout shall consist of sanitary tees. Nickel-bronze square frame and stainless steel cover with minimum opening of 150 by 150 mm (6 by 6 inches) shall be furnished at each wall cleanout. Where the piping is concealed, a fixture trap or a fixture with integral trap, readily removable without disturbing concealed pipe, shall be accepted as a cleanout equivalent providing the opening to be used as a cleanout opening is the size required.
- D. In horizontal runs above grade, cleanouts shall consist of cast brass tapered screw plug in fitting or caulked/hubless cast iron ferrule. Plain end (hubless) piping in interstitial space or above ceiling may use plain end (hubless) blind plug and clamp.

2.5 PENETRATION SLEEVES

- A. A sleeve flashing device shall be provided at points where pipes pass through membrane waterproofed floors or walls. The sleeve flashing device shall be manufactured, cast iron fitting with clamping device that forms a sleeve for the pipe floor penetration of the floor membrane. A galvanized steel pipe extension shall be included in the top of the fitting that will extend 50 mm (2 inches) above finished floor and galvanized steel pipe extension in the bottom of the fitting that will extend through the floor slab. A waterproof caulked joint shall be provided at the top hub.

PART 3 - EXECUTION

3.1 PIPE INSTALLATION

- A. The pipe installation shall comply with the requirements of the International Plumbing Code (IPC) and these specifications.
- B. Branch piping shall be installed for waste from the respective piping systems and connect to all fixtures, valves, cocks, outlets, casework,

cabinets and equipment, including those furnished by the Government or specified in other sections.

- C. Pipe shall be round and straight. Cutting shall be done with proper tools. Pipe shall be reamed to full size after cutting.
- D. All pipe runs shall be laid out to avoid interference with other work.
- E. The piping shall be installed above accessible ceilings where possible.
- F. The piping shall be installed to permit valve servicing or operation.
- G. The piping shall be installed free of sags and bends.
- H. Seismic restraint shall be installed where required by code.
- I. Changes in direction for soil and waste drainage and vent piping shall be made using appropriate branches, bends and long sweep bends.

Sanitary tees and short sweep quarter bends may be used on vertical stacks if change in direction of flow is from horizontal to vertical. Long turn double wye branch and eighth bend fittings shall be used if two fixtures are installed back to back or side by side with common drain pipe. Straight tees, elbows, and crosses may be used on vent lines. Do not change direction of flow more than 90 degrees. Proper size of standard increaser and reducers shall be used if pipes of different sizes are connected. Reducing size of drainage piping in direction of flow is prohibited.

- J. Buried soil and waste drainage and vent piping shall be laid beginning at the low point of each system. Piping shall be installed true to grades and alignment indicated with unbroken continuity of invert. Hub ends shall be placed upstream. Required gaskets shall be installed according to manufacturer's written instruction for use of lubricants, cements, and other installation requirements.
- K. Cast iron piping shall be installed according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook," Chapter IV, "Installation of Cast Iron Soil Pipe and Fittings"
- L. If an installation is unsatisfactory to the COR, the Contractor shall correct the installation at no cost to the Government.

3.2 JOINT CONSTRUCTION

- A. Hub and spigot, cast iron piping with gasket joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for compression joints.

- B. Hub and spigot, cast iron piping with calked joints shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for lead and oakum calked joints.
- C. Hubless or No-hub, cast iron piping shall be joined in accordance with CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for hubless piping coupling joints.

3.3 SPECIALTY PIPE FITTINGS

- A. Transition coupling shall be installed at pipe joints with small differences in pipe outside diameters.

3.4 PIPE HANGERS, SUPPORTS AND ACCESSORIES

- A. All piping shall be supported according to the International Plumbing Code (IPC), Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, and these specifications. Where conflicts arise between these the code and Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING the most restrictive or the requirement that specifies supports with highest loading or shortest spacing shall apply.
- B. Horizontal piping and tubing shall be supported within 300 mm (12 inches) of each fitting or coupling.
- C. Vertical piping and tubing shall be supported at the base, at each floor, and at intervals no greater than 4.6 m (15 feet).
- D. In addition to the requirements in Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, Floor, Wall and Ceiling Plates, Supports, Hangers shall have the following characteristics:
 - 1. Solid or split unplated cast iron.
 - 2. All plates shall be provided with set screws.
 - 3. Height adjustable clevis type pipe hangers.
 - 4. Adjustable floor rests and base flanges shall be steel.
 - 5. Hanger rods shall be low carbon steel, fully threaded or threaded at each end with two removable nuts at each end for positioning rod and hanger and locking each in place.
 - 6. Riser clamps shall be malleable iron or steel.
 - 7. Rollers shall be cast iron.
 - 8. See Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING, for requirements on insulated pipe protective shields at hanger supports.
- E. Miscellaneous materials shall be provided as specified, required, directed or as noted on the drawings for proper installation of

hangers, supports and accessories. If the vertical distance exceeds 6.1 m (20 feet) for cast iron pipe additional support shall be provided in the center of that span. All necessary auxiliary steel shall be provided to provide that support.

F. Cast escutcheon with set screw shall be provided at each wall, floor and ceiling penetration in exposed finished locations and within cabinets and millwork.

G. Penetrations:

1. Fire Stopping: Where pipes pass through fire partitions, fire walls, smoke partitions, or floors, a fire stop shall be installed that provides an effective barrier against the spread of fire, smoke and gases. Clearances between raceways and openings shall be completely filled and sealed with the fire stopping materials.

3.5 TESTS

A. Sanitary waste and drain systems shall be tested either in its entirety or in sections.

B. Waste System tests shall be conducted before trenches are backfilled or fixtures are connected. A water test or air test shall be conducted, as directed.

1. If entire system is tested for a water test, tightly close all openings in pipes except highest opening, and fill system with water to point of overflow. If the waste system is tested in sections, tightly plug each opening except highest opening of section under test, fill each section with water and test with at least a 3 m (10 foot) head of water. In testing successive sections, test at least upper 3 m (10 feet) of next preceding section so that each joint or pipe except upper most 3 m (10 feet) of system has been submitted to a test of at least a 3 m (10 foot) head of water. Water shall be kept in the system, or in portion under test, for at least 15 minutes before inspection starts. System shall then be tight at all joints.

2. For an air test, an air pressure of 34 kPa (5 psig) gage shall be maintained for at least 15 minutes without leakage. A force pump and mercury column gage shall be used for the air test.

3. After installing all fixtures and equipment, open water supply so that all p-traps can be observed. For 15 minutes of operation, all

p-traps shall be inspected for leaks and any leaks found shall be corrected.

4. Final Tests: Either one of the following tests may be used.
 - a. Smoke Test: After fixtures are permanently connected and traps are filled with water, fill entire drainage and vent systems with smoke under pressure of .25 kPa (1 inch of water) with a smoke machine. Chemical smoke is prohibited.
 - b. Peppermint Test: Introduce 60 ml (2 ounces) of peppermint into each line or stack.

- - - E N D - - -

SECTION 31 20 00
EARTHWORK

PART 1 - GENERAL

1.1 DESCRIPTION OF WORK:

- A. This section specifies the requirements for furnishing all equipment, materials, labor, tools, and techniques for earthwork including, but not limited to, the following:
1. Site preparation.
 2. Excavation.
 3. Underpinning.
 4. Filling and backfilling.
 5. Grading.
 6. Soil Disposal.
 7. Clean Up.

1.2 DEFINITIONS:

- A. Unsuitable Materials:
1. Fills: Topsoil; frozen materials; construction materials and materials subject to decomposition; clods of clay and stones larger than 75 mm (3 inches); organic material, including silts, which are unstable; and inorganic materials, including silts, too wet to be stable and any material with a liquid limit and plasticity index exceeding 40 and 15 respectively. Unsatisfactory soils also include satisfactory soils not maintained within 2 percent of optimum moisture content at time of compaction, as defined by ASTM 1557 and AASHTO T99.
 2. Existing Subgrade (Except Footing Subgrade): Same materials as 1.2.A.1, that are not capable of direct support of slabs, pavement, and similar items with possible exception of improvement by compaction, proof-rolling, or similar methods.
- B. Building Earthwork: Earthwork operations required in area enclosed by a line located 1500 mm (5 feet) outside of principal building perimeter. It also includes earthwork required for auxiliary structures and buildings.
- C. Site Earthwork: Earthwork operations required in area outside of a line located 1500 mm (5 feet) outside of principal building perimeter and within new construction area with exceptions noted above.
- D. Degree of compaction: Degree of compaction is expressed as a percentage of maximum density obtained by laboratory test procedure. This percentage of maximum density is obtained through use of data provided

from results of field test procedures presented in ASTM D1556, ASTM D2167, and ASTM D6938.

- E. Fill: Satisfactory soil materials used to raise existing grades. In the Construction Documents, the term "fill" means fill or backfill as appropriate.
- F. Backfill: Soil materials or controlled low strength material used to fill an excavation.
- G. Unauthorized excavation: Removal of materials beyond indicated sub-grade elevations or indicated lines and dimensions without written authorization by the COR. No payment will be made for unauthorized excavation or remedial work required to correct unauthorized excavation.
- H. Authorized additional excavation: Removal of additional material authorized by the COR based on the determination by the Government's soils testing agency that unsuitable bearing materials are encountered at required sub-grade elevations. Removal of unsuitable material and its replacement as directed will be paid on basis of Conditions of the Contract relative to changes in work.
- I. Subgrade: The undisturbed earth or the compacted soil layer immediately below granular sub-base, drainage fill, or topsoil materials.
- J. Structure: Buildings, foundations, slabs, tanks, curbs, mechanical and electrical appurtenances, or other man-made stationary features constructed above or below the ground surface.
- K. Borrow: Satisfactory soil imported from off-site for use as fill or backfill.
- L. Drainage course: Layer supporting slab-on-grade used to minimize capillary flow of pore water.
- M. Bedding course: Layer placed over the excavated sub-grade in a trench before laying pipe. Bedding course shall extend up to the springline of the pipe.
- N. Sub-base Course: Layer placed between the sub-grade and base course for asphalt paving or layer placed between the sub-grade and a concrete pavement or walk.
- O. Utilities include on-site underground pipes, conduits, ducts, and cables as well as underground services within buildings.
- P. Debris: Debris includes all materials located within the designated work area not covered in the other definitions and shall include but not be limited to items like vehicles, equipment, appliances, building materials or remains thereof, tires, any solid or liquid chemicals or products stored or found in containers or spilled on the ground.

Q. Contaminated soils: Soil that contains contaminants as defined and determined by the COR or the Government's testing agency.

1.3 RELATED WORK:

- A. Materials testing and inspection during construction: Section 01 45 29, TESTING LABORATORY SERVICES.
- B. Safety requirements: Article, ACCIDENT PREVENTION.
- C. Protection of existing utilities, fire protection services, existing equipment, roads, and pavements: Section 01 00 00, GENERAL REQUIREMENTS.
- D. Subsurface Investigation: Section 01 00 00, GENERAL REQUIREMENTS, Article, PHYSICAL DATA.
- E. Site preparation: Section 31 23 19, DEWATERING, and Section 02 41 00, DEMOLITION.

1.4 CLASSIFICATION OF EXCAVATION:

- A. Classified Excavation: Removal and disposal of all material except that material not defined as Rock.

1.5 MEASUREMENT AND PAYMENT FOR EXCAVATION:

- A. Measurement: The unit of measurement for excavation and borrow will be the cubic yard, computed by the average end area method from cross sections taken before and after the excavation and borrow operations, including the excavation for ditches, gutters, and channel changes, when the material is acceptably utilized or disposed of as herein specified. Quantities should be computed by a Registered Professional Land Surveyor or Registered Civil Engineer, specified in Section 01 00 00, GENERAL REQUIREMENTS. The measurement will not include the volume of subgrade material or other material used for purposes other than directed. The volume of overburden stripped from borrow pits and the volume of excavation for ditches to drain borrow pits, unless used as borrow material, will not be measured for payment. The measurement will not include the volume of any excavation performed prior to taking of elevations and measurements of the undisturbed grade.

1.6 MEASUREMENT AND PAYMENT FOR ROCK EXCAVATION:

- A. Measurement: Cross section and measure uncovered and separated materials, and compute quantities by Registered Professional Land Surveyor or Registered Civil Engineer, specified in Section 01 00 00, GENERAL REQUIREMENTS. Do not measure quantities beyond the following limits:

1. 600 mm (24 inches) from outside face of concrete work for which forms are required, except for footings.
 2. 300 mm (12 inches) from outside of perimeter of formed footings.
 3. 150 mm (6 inches) below bottom of pipe and not more than pipe diameter plus 600 mm (24 inches) in width for pipe trenches.
 4. From outside dimensions of concrete work for which no forms are required (trenches, conduits, and similar items not requiring forms).
- B. Payment: No separate payment shall be made for rock excavation quantities shown. Contract price and time will be adjusted for overruns or underruns in accordance with Articles, DIFFERING SITE CONDITIONS, CHANGES and CHANGES-SUPPLEMENT of the GENERAL CONDITIONS as applicable.

1.7 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Rock Excavation Report:
1. Certification of rock quantities excavated.
 2. Excavation method.
 3. Labor.
 4. Equipment.
 5. Land Surveyor's or Civil Engineer's name and official registration stamp.
 6. Plot plan showing elevation.
- C. Furnish to COR:
1. Contactor shall furnish resumes with all personnel involved in the project including Project Manager, Superintendent, and on-site Engineer. Project Manager and Superintendent should have at least 3 years of experience on projects of similar size.
 2. Contractor shall submit procedure and location for disposal of unused satisfactory material. Proposed source of borrow material. Notification of encountering rock in the project. Advance notice on the opening of excavation or borrow areas. Advance notice on shoulder construction for rigid pavements.

1.8 APPLICABLE PUBLICATIONS:

- A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.

- B. American Association of State Highway and Transportation Officials (AASHTO):
 - T99-10.....Standard Method of Test for Moisture-Density Relations of Soils Using a 2.5 kg (5.5 lb) Rammer and a 305 mm (12 inch) Drop
 - T180-10.....Standard Method of Test for Moisture-Density Relations of Soils using a 4.54 kg (10 lb) Rammer and a 457 mm (18 inch) Drop
- C. American Society for Testing and Materials (ASTM):
 - C33-03.....Concrete Aggregate
 - D448-08.....Standard Classification for Sizes of Aggregate for Road and Bridge Construction
 - D698-07e1.....Standard Test Method for Laboratory Compaction Characteristics of Soil Using Standard Effort (12,400 ft. lbf/ft³ (600 kN m/m³))
 - D1140-00.....Amount of Material in Soils Finer than the No. 200 (75-micrometer) Sieve
 - D1556-07.....Standard Test Method for Density and Unit Weight of Soil in Place by the Sand Cone Method
 - D1557-09.....Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Modified Effort (56,000 ft-lbf/ft³ (2700 kN m/m³))
 - D2167-08.....Standard Test Method for Density and Unit Weight of Soil in Place by the Rubber Balloon Method
 - D2487-11.....Standard Classification of Soils for Engineering Purposes (Unified Soil Classification System)
 - D2940-09.....Standard Specifications for Graded Aggregate Material for Bases or Subbases for Highways or Airports
 - D6938-10.....Standard Test Method for In-Place Density and Water Content of Soil and Soil-Aggregate by Nuclear Methods (Shallow Depth)
- D. Society of Automotive Engineers (SAE):
 - J732-07.....Specification Definitions - Loaders
 - J1179-08.....Hydraulic Excavator and Backhoe Digging Forces

PART 2 - PRODUCTS

2.1 MATERIALS:

- A. General: Provide borrow soil material when sufficient satisfactory soil materials are not available from excavations.

- B. Fills: Material in compliance with ASTM D2487 Soil Classification Groups GW, GP, GM, SW, SP, SM, SC, and ML, or any combination of these groups; free of rock or gravel larger than 75 mm (3 inches) in any dimension, debris, waste, frozen materials, vegetation, and other deleterious matter. Material approved from on site or off site sources having a minimum dry density of 1760 kg/m³ (110 pcf), a maximum Plasticity Index of 15, and a maximum Liquid Limit of 40.
- C. Engineered Fill: Naturally or artificially graded mixture of compliance with ASTM D2487 Soil Classification Groups GW, GP, GM, SW, SP, SM, SC, and ML, or any combination of these groups, or as approved by the Engineer or material with at least 90 percent passing a 37.5-mm (1 1/2-inch) sieve and not more than 12 percent passing a 75- μ m (No. 200) sieve, per ASTM D2940;.
- D. Bedding: Naturally or artificially graded mixture of natural or crushed gravel, crushed stone, and natural or crushed sand; ASTM D2940; except with 100 percent passing a 25 mm (1 inch) sieve and not more than 8 percent passing a 75- μ m (No. 200) sieve.
- E. Drainage Fill: Washed, narrowly graded mixture of crushed stone, or crushed or uncrushed gravel; ASTM D448; coarse-aggregate grading Size 57; with 100 percent passing a 37.5 mm (1 1/2-inch) sieve and 0 to 5 percent passing a 2.36 mm (No. 8) sieve.
- F. Granular Fill:
1. Under concrete slab, - granular fill shall consist of clean, poorly graded crushed rock, crushed gravel, or uncrushed gravel placed beneath a building slab with or without a vapor barrier to cut off the capillary flow of pore water to the area immediately below. Fine aggregate grading shall conform to ASTM C 33 with a maximum of 3 percent by weight passing ASTM D 1140, 75 micrometers (No. 200) sieve and no more than 2 percent by weight passing the or coarse aggregate Size 57, 67, or 77.
 2. Bedding for sanitary and storm sewer pipe, crushed stone or gravel graded from 13 mm (1/2 inch) to 4.75 mm (No 4), per ASTM D2940.
- G. Requirements for Offsite Soils: Offsite soils brought in for use as backfill shall be tested for TPH, BTEX and full TCLP including ignitability, corrosivity and reactivity. Backfill shall contain less than 100 parts per million (ppm) of total hydrocarbons (TPH) and less than 10 ppm of the sum of Benzene, Toluene, Ethyl Benzene, and Xylene (BTEX) and shall not fail the TCLP test. TPH concentrations shall be determined by using EPA 600/4-79/020 Method 418.1. BTEX concentrations shall be determined by using EPA SW-846.3-3a Method 5030/8020. TCLP

shall be performed in accordance with EPA SW-846.3-3a Method 1311.

Provide Borrow Site Testing for TPH, BTEX and TCLP from a composite sample of material from the borrow site, with at least one test from each borrow site.

- H. Buried Warning and Identification Tape: alkali-resistant polyethylene plastic warning tape manufactured specifically for warning and identification of buried utility lines. Provide tape on rolls, 3 inch minimum width, color coded as specific below for the intended utility with warning and identification imprinted in bold black letters continuously over the entire tape length. Warning and identification to read, "CAUTION, BURIED (intended service) LINE BELOW" or similar wording. Color and printing shall be permanent, Unaffected by moisture or soil. Warning tape color codes:

Green: Sewer Systems

- I. Warning Tape for Metallic Piping: Acid and alkali-resistant polyethylene plastic tape conforming to the width, color, and printing requirements specified above. Minimum thickness of tape shall be 0.076 mm (0.003 inch). Tape shall have a minimum strength of 10.3 MPa (1500 psi) lengthwise, and 8.6 MPa (1250 psi) crosswise, with a maximum 350 percent elongation.
- J. Detectable Warning Tape for Non-Metallic Piping: Polyethylene plastic tape conforming to the width, color, and printing requirements specified above. Minimum thickness of the tape shall be 0.102 mm (0.004 inch). Tape shall have a minimum strength of 10.3 MPa (1500 psi) lengthwise and 8.6 MPa (1250 psi) crosswise. Tape shall be manufactured with integral wires, foil backing, or other means of enabling detection by a metal detector when tape is buried up to 0.9 m (3 feet) deep. Encase metallic element of the tape in a protective jacket or provide with other means of corrosion protection.
- K. Detection Wire For Non-Metallic Piping: Detection wire shall be Insulated single strand, solid copper with a minimum of 12 AWG.

PART 3 - EXECUTION

3.1 SITE PREPARATION:

- A. Clearing: Clear within limits of earthwork operations as shown. Work includes removal of foundations, incidental structures, paving, debris, trash, and other obstructions. Remove materials from Medical Center.
- B. Concrete Slabs and Paving: Score deeply or saw cut to insure a neat, straight cut, sections of existing concrete slabs and paving to be

removed where excavation or trenching occurs. Extend pavement section to be removed a minimum of 300 mm (12 inches) on each side of widest part of trench excavation and insure final score lines are approximately parallel unless otherwise indicated. Remove material from Medical Center.

F. Lines and Grades: Registered Professional Land Surveyor or Registered Civil Engineer, specified in Section 01 00 00, GENERAL REQUIREMENTS, shall establish lines and grades.

1. Grades shall conform to elevations indicated on plans within the tolerances herein specified. Generally grades shall be established to provide a smooth surface, free from irregular surface changes. Grading shall comply with compaction requirements and grade cross sections, lines, and elevations indicated. Where spot grades are indicated the grade shall be established based on interpolation of the elevations between the spot grades while maintaining appropriate transition at structures and paving and uninterrupted drainage flow into inlets.
2. Locations of existing elevations indicated on plans , except spot elevations, are approximate. Proposed spot elevations and contour lines have been developed utilizing the existing conditions survey and developed contour lines and may be approximate. Contractor is responsible to notify COR of any differences between existing elevations shown on plans and those encountered on site by Surveyor/Engineer described above. Notify COR of any differences between existing or constructed grades, as compared to those shown on the plans.
3. Subsequent to establishment of lines and grades, Contractor will be responsible for any additional cut and/or fill required to ensure that site is graded to conform to elevations indicated on plans.

G. Disposal: All materials removed from the property shall be disposed of at a legally approved site, for the specific materials, and all removals shall be in accordance with all applicable Federal, State and local regulations. No burning of materials is permitted onsite.

3.2 EXCAVATION:

A. Shoring, Sheeting and Bracing: Shore, brace, or slope, its angle of repose or to an angle considered acceptable by the COR, banks of excavations to protect workmen, banks, adjacent paving, structures, and utilities.

1. Design of the temporary support of excavation system is the responsibility of the Contractor. The Contractor shall submit a Shoring and Sheet piling plan for approval 15 days prior to starting work. Submit drawings and calculations, certified by a registered professional engineer, describing the methods for shoring and sheet piling of excavations. Shoring, including sheet piling, shall be furnished and installed as necessary to protect workmen, banks, adjacent paving, structures, and utilities. Shoring, bracing, and sheet piling shall be removed as excavations are backfilled, in a manner to prevent caving.
 2. Construction of the support of excavation system shall not interfere with the permanent structure and may begin only after a review by the COR.
 3. Extend shoring and bracing to a minimum of 1500 mm (5 feet) below the bottom of excavation. Shore excavations that are carried below elevations of adjacent existing foundations.
 4. If bearing material of any foundation is disturbed by excavating, improper shoring or removal of existing or temporary shoring, placing of backfill, and similar operations, the Contractor shall underpin the existing foundation, per Section 3.3 provide a concrete fill support in compliance with specifications Section 31 23 23.33, FLOWABLE FILL, under disturbed foundations, as directed by COR, at no additional cost to the Government. Do not remove shoring until permanent work in excavation has been inspected and approved by COR.
 5. The Contractor is required to hire a Professional Geotechnical Engineer to provide inspection of excavations and soil/groundwater conditions throughout construction. The Geotechnical Engineer shall be responsible for performing pre-construction and periodic site visits throughout construction to assess site conditions. The Geotechnical Engineer shall update the excavation, sheet piling and dewatering plans as construction progresses to reflect changing conditions and shall submit an updated plan if necessary. A written report shall be submitted, at least monthly, informing the Contractor and COR of the status of the plan and an accounting of the Contractor's adherence to the plan addressing any present or potential problems. The Geotechnical Engineer shall be available to meet with the COR at any time throughout the contract duration.
- B. Excavation Drainage: Operate pumping equipment , and/or provide other materials, means and equipment as required to keep excavation free of water and subgrade dry, firm, and undisturbed until approval of

permanent work has been received from COR. Approval by the COR is also required before placement of the permanent work on all subgrades. Groundwater flowing toward or into excavations shall be controlled to prevent sloughing of excavation slopes and walls, boils, uplift and heave in the excavation and to eliminate interference with orderly progress of construction. French drains, sumps, ditches or trenches will not be permitted within 0.9 m (3 feet) of the foundation of any structure, except with specific written approval, and after specific contractual provisions for restoration of the foundation area have been made. Control measures shall be taken by the time the excavation reaches the water level in order to maintain the integrity of the in situ material. While the excavation is open, the water level shall be maintained continuously, below the working level. Operate dewatering system continuously until construction work below existing water levels is complete. Submit performance records weekly. Measure and record performance of dewatering system at same time each day by use of observation wells or piezometers installed in conjunction with the dewatering system. Relieve hydrostatic head in pervious zones below subgrade elevation in layered soils to prevent uplift.

C. Subgrade Protection: Protect subgrades from softening, undermining, washout, or damage by rain or water accumulation. Reroute surface water runoff from excavated areas and not allow water to accumulate in excavations. Do not use excavated trenches as temporary drainage ditches. When subgrade for foundations has been disturbed by water, remove disturbed material to firm undisturbed material after water is brought under control. Replace disturbed subgrade in trenches with concrete or material approved by the COR.

E. Proofrolling:

1. After rough grade has been established in cut areas and prior to placement of fill in fill areas under building and pavements, proofroll exposed subgrade with a fully loaded dump truck to check for pockets of soft material.

F. Building Earthwork:

1. Excavation shall be accomplished as required by drawings and specifications.
2. Excavate foundation excavations to solid undisturbed subgrade.
3. Remove loose or soft materials to a solid bottom.
4. Fill excess cut under footings or foundations with 25 MPa (3000 psi) concrete poured separately from the footings.

5. Do not tamp earth for backfilling in footing bottoms, except as specified.
 6. Slope grades to direct water away from excavations and to prevent ponding.
 7. Capillary water barrier (granular fill) under concrete floor and area-way slabs on grade shall be placed directly on the subgrade and shall be compacted with a minimum of two passes of a hand-operated plate-type vibratory compactor.
 8. Ensure that footing subgrades have been inspected and approved by the COR prior to concrete placement. Excavate to bottom of pile cap prior to placing or driving piles, unless authorized otherwise by the COR. Backfill and compact over excavations and changes in grade due to pile driving operations to 95 percent of ASTM D698 maximum density.
2. Sanitary and storm sewer trenches:
- a. Trench width below a point 150 mm (6 inches) above top of pipe shall be 600 mm (24 inches) maximum for pipe up to and including 300 mm (12 inches) diameter, and four-thirds diameter of pipe plus 200 mm (8 inches) for pipe larger than 300 mm (12 inches). Width of trench above that level shall be as necessary for sheeting and bracing and proper performance of the work.
 - 1) Bed bottom quadrant of pipe on suitable undisturbed soil or granular fill. Unstable material removed from the bottom of the trench or excavation shall be replaced with select granular material placed in layers not exceeding 150 mm (6 inches) loose thickness.1) Undisturbed: Bell holes shall be no larger than necessary for jointing. Backfill up to a point 300 mm (12 inches) above top of pipe shall be clean earth placed and tamped by hand.
 - 2) Granular Fill: Depth of fill shall be a minimum of 75 mm (3 inches) plus one sixth of pipe diameter below pipe to 300 mm (12 inches) above top of pipe. Place and tamp fill material by hand.
 - c. Place and compact as specified remainder of backfill using acceptable excavated materials. Do not use unsuitable materials.
 - d. Use granular fill for bedding where rock or rocky materials are excavated.
 - e. Provide buried utility lines with utility identification tape. Bury tape 300 mm (12 inches) below finished grade; under pavements and slabs, bury tape 150 mm (6 inches) below top of subgrade

- f. Bury detection wire directly above non-metallic piping at a distance not to exceed 300 mm (12 inches) above the top of pipe. The wire shall extend continuously and unbroken, from manhole to manhole. The ends of the wire shall terminate inside the manholes at each end of the pipe, with a minimum of 0.9 m (3 feet) of wire, coiled, remaining accessible in each manhole. The wire shall remain insulated over its entire length. The wire shall enter manholes between the top of the corbel and the frame, and extend up through the chimney seal between the frame and the chimney seal. For force mains, the wire shall terminate in the valve pit at the pump station end of the pipe.
- g. Bedding shall be of the type and thickness shown. Initial backfill material shall be placed and compacted with approved tampers to a height of at least one foot above the utility pipe or conduit. The backfill shall be brought up evenly on both sides of the pipe for the full length of the pipe. Care shall be taken to ensure thorough compaction of the fill under the haunches of the pipe. Except as specified otherwise in the individual piping section, provide bedding for buried piping in accordance with AWWA C600, Type 4, except as specified herein. Backfill to top of pipe shall be compacted to 95 percent of ASTM D698 maximum density. Plastic piping shall have bedding to spring line of pipe. Provide materials as follows:
- 1) Class I: Angular, 6 to 40 mm (0.25 to 1.5 inches), graded stone, including a number of fill materials that have regional significance such as coral, slag, cinders, crushed stone, and crushed shells.
 - 2) Class II: Coarse sands and gravels with maximum particle size of 40 mm (1.5 inches), including various graded sands and gravels containing small percentages of fines, generally granular and noncohesive, either wet or dry. Soil Types GW, GP, SW, and SP are included in this class as specified in ASTM D2487.
- H. Site Earthwork: Earth excavation includes excavating pavements and obstructions visible on surface; underground structures, utilities, and other items indicated to be removed; together with soil, boulders, and other materials not classified as rock or unauthorized excavation. Excavation shall be accomplished as required by drawings and specifications. Excavate to indicated elevations and dimensions within a tolerance of plus or minus 25 mm (1 inch). Extend excavations a

sufficient distance from structures for placing and removing concrete formwork, for installing services and other construction, complying with OSHA requirements, and for inspections. Remove subgrade materials that are determined by COR as unsuitable, and replace with acceptable material. If there is a question as to whether material is unsuitable or not, the contractor shall obtain samples of the material, under the direction of the COR, and the materials shall be examined by an independent testing laboratory for soil classification to determine whether it is unsuitable or not. Testing of the soil shall be performed by the VA Testing Laboratory. When unsuitable material is encountered and removed, contract price and time will be adjusted in accordance with Articles, DIFFERING SITE CONDITIONS, CHANGES and CHANGES-SUPPLEMENT of the GENERAL CONDITIONS as applicable. Adjustments to be based on volume in cut section only.

1. Site Grading:

- a. Provide a smooth transition between adjacent existing grades and new grades.
- b. Cut out soft spots, fill low spots, and trim high spots to comply with required surface tolerances.
- c. Slope grades to direct water away from buildings and to prevent ponds from forming where not designed. Finish subgrades to required elevations within the following tolerances:
- d. Grading Inside Building Lines: Finish subgrade to a tolerance of 13 mm (1/2 inch) when tested with a 3000 mm (10 foot) straightedge.

3.3 UNDERPINNING:

A. Design of the underpinning system is the responsibility of the Contractor and should be designed by a registered professional engineer and is subject to review and approval by the COR. Underpinning of existing building foundations, as indicated on structural drawings, or where excavation undermines existing foundations, shall be accomplished in the following manner:

1. Make general excavation for new construction, where new foundations are to be below existing foundations, to elevation of new foundations (or sized stone subbase), maintaining a 45 degree sloped berm.
2. For underpinning pits, underpin existing wall foundations by excavating 1200 mm (4 feet) wide pits to depth shown on drawings skipping 3 sections at any one time so as to maintain support for wall at all times.

3. Underpin intervening sections one at a time; no adjacent sections shall be underpinned until concrete in adjacent sections shall have reached 20 MPa (2500 psi) strength and have been dry packed with non-shrink grout to obtain positive bearing. Sheet and brace underpinning pits if soil will not stand on a vertical cut during this operation, or as required for safety of workmen. Repack any voids behind sheeting to prevent sloughing which could cause settlement of existing foundations. Contractor performing this portion of work shall have been prequalified by COR as having previously performed successfully this type of work or will demonstrate his capability for successfully performing this work. It shall be sole responsibility of the Contractor to guard against objectionable movement or settlement and to preserve integrity of existing structures.
4. The tip elevation of the underpinning pits shall be a minimum of 900 mm (3 feet) below the adjacent excavation elevation.
5. Subgrades at the tip of the underpinning pit shall be clean, dry, and free of debris and shall be observed by the COR prior to concrete placement.
6. Concrete shall not be free fall greater than 3000 mm (10 feet) into the pit.

3.4 FILLING AND BACKFILLING:

- A. General: Do not fill or backfill until all debris, water, unsatisfactory soil materials, obstructions, and deleterious materials have been removed from excavation. For fill and backfill, use excavated materials and borrow meeting the criteria specified herein, as applicable. Borrow will be supplied at no additional cost to the Government. Do not use unsuitable excavated materials. Do not backfill until foundation walls have been completed above grade and adequately braced, waterproofing or dampproofing applied, foundation drainage, and pipes coming in contact with backfill have been installed and work inspected and approved by COR.
- B. Placing: Place materials in horizontal layers not exceeding 200 mm (8 inches) in loose depth for material compacted by heavy compaction equipment, and not more than 100 mm (4 inches) in loose depth for material compacted by hand-operated tampers and then compacted. Place backfill and fill materials evenly on all sides of structures to required elevations, and uniformly along the full length of each structure. Place no material on surfaces that are muddy, frozen, or contain frost.

C. Compaction: Compact with approved tamping rollers, sheepsfoot rollers, pneumatic tired rollers, steel wheeled rollers, vibrator compactors, or other approved equipment (hand or mechanized) well suited to soil being compacted. Do not operate mechanized vibratory compaction equipment within 3000 mm (10 feet) of new or existing building walls without prior approval of COR. Moisten or aerate material as necessary to provide moisture content that will readily facilitate obtaining specified compaction with equipment used. Backfill adjacent to any and all types of structures shall be placed and compacted to at least 90 percent laboratory maximum density for cohesive materials or 95 percent laboratory maximum density for cohesionless materials to prevent wedging action or eccentric loading upon or against the structure. Compact soil to not less than the following percentages of maximum dry density, according to ASTM D698 or ASTM D1557 as specified below:

1. Fills, Embankments, and Backfill

- a. Under proposed structures, building slabs, steps, and paved areas, scarify and recompact top 300 mm (12 inches) of existing subgrade and each layer of backfill or fill material in accordance with AASHTO T180.

D. Borrow Material: Borrow material shall be selected to meet the requirements and conditions of the particular fill or embankment for which it is to be used. Borrow material shall be obtained from the borrow areas within the limits of the project site. Unless otherwise provided in the contract, the Contractor shall obtain from the owners the right to procure material, pay royalties and other charges involved, and bear the expense of developing the sources, including rights-of-way for hauling. Borrow material from approved sources on Government-controlled land may be obtained without payment of royalties. Unless specifically provided, no borrow shall be obtained within the limits of the project site without prior written approval. Necessary clearing, grubbing, and satisfactory drainage of borrow pits and the disposal of debris thereon shall be considered related operations to the borrow excavation.

E. Opening and Drainage of Excavation and Borrow Pits: The Contractor shall notify the COR sufficiently in advance of the opening of any excavation or borrow pit to permit elevations and measurements of the undisturbed ground surface to be taken. Except as otherwise permitted, borrow pits and other excavation areas shall be excavated providing adequate drainage. Overburden and other spoil material shall be transported to designated spoil areas or otherwise disposed of as directed. Borrow

pits shall be neatly trimmed and drained after the excavation is completed. The Contractor shall ensure that excavation of any area, operation of borrow pits, or dumping of spoil material results in minimum detrimental effects on natural environmental conditions.

3.5 GRADING:

- A. General: Uniformly grade the areas within the limits of this section, including adjacent transition areas. Smooth the finished surface within specified tolerance. Provide uniform levels or slopes between points where elevations are indicated, or between such points and existing finished grades. Provide a smooth transition between abrupt changes in slope.
- B. Cut rough or sloping rock to level beds for foundations. In pipe spaces or other unfinished areas, fill low spots and level off with coarse sand or fine gravel.
- C. Slope backfill outside building away from building walls for a minimum distance of 1800 mm (6 feet).
- D. Finish grade earth floors in pipe basements as shown to a level, uniform slope and leave clean.
- E. Finished grade shall be at least 150 mm (6 inches) below bottom line of window or other building wall openings unless greater depth is shown.
- F. Place crushed stone or gravel fill under concrete slabs on grade, tamped, and leveled. Thickness of fill shall be 150 mm (6 inches) unless otherwise shown.
- G. Finish subgrade in a condition acceptable to COR at least one day in advance of paving operations. Maintain finished subgrade in a smooth and compacted condition until succeeding operation has been accomplished. Scarify, compact, and grade subgrade prior to further construction when approved compacted subgrade is disturbed by Contractor's subsequent operations or adverse weather.
- H. Grading for Paved Areas: Provide final grades for both subgrade and base course to +/- 6 mm (0.25 inches) of indicated grades.

3.6 DISPOSAL OF UNSUITABLE AND EXCESS EXCAVATED MATERIAL:

- A. Disposal: Remove surplus satisfactory soil and waste material, including unsatisfactory soil, trash, and debris, and legally dispose of it off Medical Center property.
- C. Place excess excavated materials suitable for fill and/or backfill on site where directed.
- D. Remove from site and dispose of any excess excavated materials after all fill and backfill operations have been completed.

E. Segregate all excavated contaminated soil designated by the COR from all other excavated soils, and stockpile on site on two 0.15 mm (6 mil) polyethylene sheets with a polyethylene cover. A designated area shall be selected for this purpose. Dispose of excavated contaminated material in accordance with State and Local requirements.

3.7 CLEAN UP:

Upon completion of earthwork operations, clean areas within contract limits, remove tools, and equipment. Provide site clear, clean, free of debris, and suitable for subsequent construction operations. Remove all debris, rubbish, and excess material from Medical Center.

----- E N D -----

SECTION 31 23 19
DEWATERING

PART 1 - GENERAL

1.1 DESCRIPTION:

This section specifies performance of dewatering required to lower and control ground water table levels and hydrostatic pressures to permit excavation, backfill, and construction to be performed in the dry. Control of surface water shall be considered as part of the work under this specification.

1.2 SUMMARY:

- A. The work to be completed by the Contractor includes, but is not necessarily limited to the following:
 - 1. Implementation of the Erosion and Sedimentation Control Plan.
 - 2. Dewater excavations, including seepage and precipitation.
- B. The Contractor shall be responsible for providing all materials, equipment, labor, and services necessary for care of water and erosion control. Excavation work shall not begin before the Erosion and Sedimentation Control Plan is in place.

1.3 REQUIREMENT:

- A. Dewatering system shall be of sufficient size and capacity necessary to lower and maintain ground water table to an elevation at least 300 mm (1 foot) below lowest foundation subgrade or bottom of pipe trench and to allow material to be excavated, piles to be driven, and concrete placed, in a reasonably dry condition. Materials to be removed shall be sufficiently dry to permit excavation to grades shown and to stabilize excavation slopes where sheeting is not required. Operate dewatering system continuously until backfill work has been completed.
- B. Reduce hydrostatic head below any excavation to the extent that water level in the construction area is a minimum of 300 mm (1 foot) below prevailing excavation surface.
- C. Prevent loss of fines, seepage, boils, quick conditions or softening of foundation strata.
- D. Maintain stability of sides and bottom of excavation.
- E. Construction operations are performed in the dry.
- F. Permitting Requirements: The contractor shall comply with and obtain the required State and County permits where the work is performed.

1.4 RELATED WORK:

- A. Materials testing and inspection during construction: Section 01 45 29, TESTING LABORATORY SERVICES.

- B. Submittal requirements as specified in Section 01 33 23 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- C. Protection of existing utilities, fire protection services, existing equipment, roads, and pavements: Section 01 00 00, GENERAL REQUIREMENTS.
- D. Subsurface Investigation: Section 01 00 00, GENERAL REQUIREMENTS, Article 1.11, PHYSICAL DATA.
- E. Excavation, backfilling, site grade and utilities: Section 31 20 00, EARTHWORK.

1.5 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Drawings and Design Data:
 - 1. Submit drawings and data showing the method to be employed in dewatering excavated areas 14 days before commencement of excavation.
 - 2. Material shall include: location, depth and size of wellpoints, headers, sumps, ditches, size and location of discharge lines, capacities of pumps and standby units, and detailed description of dewatering methods to be employed to convey the water from site to adequate disposal.
 - 3. Include a written report outlining control procedures to be adopted if dewatering problem arises.
 - 4. Capacities of pumps, prime movers, and standby equipment.
 - 5. Design calculations proving adequacy of system and selected equipment. The dewatering system shall be designed using accepted and professional methods of design and engineering consistent with the best modern practice. The dewatering system shall include the deep wells, wellpoints, and other equipment, appurtenances, and related earthwork necessary to perform the function.
 - 6. Detailed description of dewatering procedure and maintenance method.
 - 7. Materials submitted shall be in a format acceptable for inclusion in required permit applications to any and all regulatory agencies for which permits for discharge water from the dewatering system are required due to the discharge reaching regulated bodies of water.
- C. Inspection Reports.
- D. All required permits.

PART 3 - EXECUTION

3.1 INSTALLATION:

- A. Install a dewatering system to lower and control ground surface water in order to permit excavation, construction of structure, and placement of backfill materials to be performed under dry conditions. Make the

dewatering system adequate to pre-drain the water-bearing strata above and below the bottom of structure foundations, utilities and other excavations.

- B. In addition, reduce hydrostatic pressure head in water-bearing strata below structure foundations, utility lines, and other excavations, to extent that water levels in construction area are a minimum of 300 mm (1 foot) below prevailing excavation surface at all times.

3.2 OPERATION:

- A. Prior to any excavation below the ground water table, place system into operation to lower water table as required and operate it continuously 24 hours a day, 7 days a week until utilities and structures have been satisfactorily constructed, which includes the placement of backfill materials and dewatering is no longer required.
- B. Place an adequate weight of backfill material to prevent buoyancy prior to discontinuing operation of the system.

3.3 WATER DISPOSAL:

- A. Dispose of water removed from the excavations in such a manner as:
 - 1. Will not endanger portions of work under construction or completed.
 - 2. Will cause no inconvenience to Government or to others working near site.
 - 3. Will comply with the stipulations of required permits for disposal of water.
 - 4. Will Control Runoff: The Contractor shall be responsible for control of runoff in all work areas including but not limited to: excavations, access roads, parking areas, laydown, and staging areas. The Contractor shall provide, operate, and maintain all ditches, basins, sumps, culverts, site grading, and pumping facilities to divert, collect, and remove all water from the work areas. All water shall be removed from the immediate work areas and shall be disposed of in accordance with applicable permits.
- B. Excavation Dewatering:
 - 1. The Contractor shall be responsible for providing all facilities required to divert, collect, control, and remove water from all construction work areas and excavations.
 - 2. Drainage features shall have sufficient capacity to avoid flooding of work areas.
 - 3. Drainage features shall be so arranged and altered as required to avoid degradation of the final excavated surface(s).

4. The Contractor shall utilize all necessary erosion and sediment control measures as described herein to avoid construction related degradation of the natural water quality.

C. Dewatering equipment shall be provided to remove and dispose of all surface and ground water entering excavations, trenches, or other parts of the work during construction. Each excavation shall be kept dry during subgrade preparation and continually thereafter until the structure to be built, or the pipe to be installed therein, is completed to the extent that no damage from hydrostatic pressure, flotation, or other cause will result.

3.4 STANDBY EQUIPMENT:

Provide complete standby equipment, installed and available for immediate operation, as may be required to adequately maintain dewatering on a continuous basis and in the event that all or any part of the system may become inadequate or fail.

3.5 CORRECTIVE ACTION:

If dewatering requirements are not satisfied due to inadequacy or failure of the dewatering system (loosening of the foundation strata, or instability of slopes, or damage to foundations or structures), perform work necessary for reinstatement of foundation soil and damaged structure or damages to work in place resulting from such inadequacy or failure by Contractor, at no additional cost to Government.

3.6 DAMAGES:

Immediately repair damages to adjacent facilities caused by dewatering operations.

3.7 REMOVAL:

Insure compliance with all conditions of regulating permits and provide such information to the Resident Engineer. Obtain written approval from Resident Engineer before discontinuing operation of dewatering system.

----- E N D -----

SECTION 31 23 23.33
FLOWABLE FILL

PART 1 - GENERAL

1.1 INTRODUCTION:

- A. Flowable fill refers to a cementitious slurry consisting of a mixture of fine aggregate or filler, water, and cementitious material(s), which is used as a fill or backfill in lieu of compacted earth. This mixture is capable of filling all voids in irregular excavations and hard to reach places (such as under undercuts of existing slabs), is self-leveling, and hardens in a matter of a few hours without the need for compaction in layers. Flowable fill is sometimes referred to as controlled density fill (CDF), controlled low strength material (CLSM), lean concrete slurry, and unshrinkable fill.
- B. Flowable fill materials will be used as only as a structural fill replacement on VA projects. Unless otherwise noted, flowable fill installed as a substitution for structural earth fill, shall be designed to be removed by the use of hand tools.

1.2 DESCRIPTION:

Furnish and place flowable fill in a fluid condition, that sets within the required time and, after curing, obtains the desired strength properties as evidenced by the laboratory testing of the specific mix design, at locations shown on the plans or as directed by the COR, in writing. This section specifies flowable fill for use as structural fill to remain excavatable using hand tools.

1.3 RELATED WORK:

- A. Materials testing and inspection during construction: Section 01 45 29, TESTING LABORATORY SERVICES.
- B. Earthwork, excavation and backfill and compaction requirements: Section 31 20 00, EARTHWORK.

1.4 DEFINITIONS:

- A. Flowable fill - Ready-mix Controlled Low Strength Material used as an alternative to compacted soil, and is also known as controlled density fill, and several other names, some of which are trademark names of material suppliers. Flowable fill (Controlled Low Strength Material) differs from portland cement concrete as it contains a low cementitious content to reduce strength development for possible future removal. Unless specifically approved otherwise, by the COR, flowable fill shall

be designed as a permanent material, not designed for future removal. Design strength for this permanent type flowable fill shall be a compressive strength of 2.1 MPa (300 psi) minimum at 28 days. Chemical admixtures may also be used in flowable fill to modify performance properties of strength, flow, set and permeability.

- B. Excavatable Flowable fill - flowable fill designed with a compressive strength that will be hand tool excavatable at compressive strength of 0.7 MPa (100 psi) maximum at 1 year.

1.5 SUBMITTALS:

- A. Submit in accordance with Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES.
- B. Flowable fill Mix Design: Provide flowable fill mix design containing cement and water. At the contractor's option, it may also contain fly ash, aggregate, or chemical admixtures in any proportions such that the final product meets the strength and flow consistency, and shrinkage requirements included in this specifications. The mix design should state the sources and proportions of each of the flowable fill constituents. The coefficient of permeability of flowable fill shall be that of uniform fine sand, 4.0×10^{-1} cm/sec (0.16 in/sec) or as indicated to provide a backfill material with permeability equal to or greater than that of the surrounding soil.
 - 1. Test and Performance - Submit the following data:
 - a. Flowable fill shall have a minimum strength of 2.1 MPa (300 psi) according to ASTM C 39 at 28 days after placement.
 - b. Flowable fill shall have minimal subsidence and bleed water shrinkage. Evaporation of bleed water shall not result in shrinkage of more than 10.4 mm per m (1/8 inch per ft.) of flowable fill depth (for mixes containing high fly ash content). Measurement of a Final Bleeding shall be as measured in Section 10 of ASTM C 940 "Standard Test Method for Expansion and Bleeding of Freshly Mixed Grouts for Preplaced-Aggregate Concrete in the Laboratory.
 - c. Flowable fill shall have a unit weight of 320 - 1300 kg/m³ (20 - 80 lb/feet³) measured at the point of placement after a 60 minute ready-mix truck ride.
- C. Provide documentation that the admixture supplier has experience of at least one year, with the products being provided and any equipment required to obtain desired performance of the product.

D. Manufacturer's Certificates: Provide COR with documentation issued by the State Agency responsible for approving materials for burial, indicating conformance with applicable rules and regulations

1.6 APPLICABLE PUBLICATIONS:

A. Publications listed below form a part of this specification to extent referenced. Publications are referenced in text by basic designation only.

B. American Society for Testing and Materials (ASTM):

D4832-10.....Standard Test Method for Preparation and Testing of Controlled Low Strength Material (CLSM) Test Cylinders.

C618-12.....Standard Specifications for Coal Fly Ash and Raw or Calcined Natural Pozzolan for use in Concrete. (Use Fly Ash conforming to the chemical and physical requirements for mineral admixture, Class F listed, including Table 2 (except for Footnote A). Waive the loss on ignition requirement.)

C403/C403M-08.....Standard Test Method for Time of Setting of Concrete Mixtures by Penetration Resistance.

C150/C150M-11.....Standard Specification for Portland Cement

C33/C33M-11a.....Standard Specification for Concrete Aggregates

C94/C94M-12.....Standard Specification for Ready-Mixed Concrete

C494/C494M-11.....Standard Specification for Chemical Admixtures for Concrete

C685/C685M-11.....Standard Specification for Concrete Made by Volumetric Batching and Continuous Mixing

C940-10a.....Standard Specification for Expansion and Bleeding of Freshly Mixed Grouts for Preplaced - Aggregate Concrete in the Laboratory

D5971.....Sampling Freshly Mixed Controlled Low Strength Material

D6103.....Flow Consistency of Controlled Low Strength Material

D6023.....Unit Weight, Yield, Cement Content and Air Content (Gravimetric) of Controlled Low Strength Material

C. American Concrete Institute (ACI):

SP-150-94.....Controlled Low-Strength Materials

1.7 QUALITY ASSURANCE:

- A. **Manufacturer:** Flowable fill shall be manufactured by a ready-mix concrete producer with a minimum of 1 year experience in the production of similar products.
- B. **Materials:** For each type of material required for the work of this Section, provide primary materials that are the products of one manufacturer. If not otherwise specified here, materials shall comply with recommendations of ACI 229, "Controlled Low Strength Materials."
- C. **Pre-Approval Procedures:** The use of flowable fill during any part of the project shall be restricted to those incidences where, due to field conditions, the Contractor has made the COR aware of the conditions for which he recommends the use of the flowable, and the COR has confirmed those conditions and approved the use of the flowable fill, in advance. During the submittal process, the contractor shall prepare and submit various flowable fill mix designs corresponding to required conditions or if the contractor desires to use flowable fill due to economics. Approval for the strength of the flowable fill shall be obtained from the COR when the contractor desires, or is required, to use flowable fill at specific location(s) within the project. Prior to commencement of field operations the contractor shall establish procedures to maintain optimum working conditions and to coordinate this work with related and adjacent work.
- D. **Sampling and Acceptance:** Flowable fill shall be samples and testing in the field in conformance with either ASTM C 94 or C 685. Samples for tests shall be taken for every 115 cubic meters (150 cubic yards) of material, or fraction thereof, for each day's placement. Tests shall include temperature reading and four compressive strength cylinders. Compressive strength sampling and testing shall conform to ASTM D 4832 with one specimen tested at 7 days, two at 28 days, and one held for each batch of four specimens. Sampling and testing shall be performed by a qualified, independent commercial testing laboratory. Test results should be submitted within 48 hours of completion of testing.

1.8 DELIVERY, STORAGE, AND HANDLING:

Deliver and handle all products and equipment required, in strict compliance with manufacturer's recommendations. Protect from damage due to weather, excessive temperatures, and construction operations.

1.9 PROJECT CONDITIONS:

Perform installation of flowable fill only when approved by the COR, and when existing and forecasted weather conditions are within the limits established by the manufacturer of the materials and products used.

PART 2 - PRODUCTS

2.1 MATERIALS:

- A. Provide flowable fill containing, at a minimum, cementitious materials and water. Cementitious materials shall be portland cement, pozzolanic materials, or other self-cementing materials, or combinations thereof, at the contractor's option and following approval by the COR. The flowable fill mix design may also contain, fine aggregate or filler, and/or chemical admixtures in any proportions such that the final product meets the strength, flow consistency and shrinkage requirements included in this specification, as approved by the COR.
- B. Portland Cement: ASTM C150, Type 1 or Type 2. Meeting Ohio State DOT standards.
- C. Mixing Water: Fresh, clean, and potable. Meeting Ohio State DOT standards for use as mix-water for cast-in-place concrete.
- D. Air-Entraining Admixture: ASTM C260.
- E. Chemical Admixtures: ASTM C494.
- F. Aggregate: ASTM C33.

2.2 FLOWABLE FILL MIXTURE:

- A. Mix design shall produce a consistency that will result in a flowable product at the time of placement which does not require manual means to move it into place.
- B. Flowable fill shall have a minimum strength of 2.1 MPa (300 psi) according to ASTM C39 at 28 days after placement.
- C. Flowable fill shall have minimal subsidence and bleed water shrinkage. Evaporation of bleed water shall not result in shrinkage of more than 10.4 mm per m (1/8 inch per foot) of flowable fill depth (for mixes containing high fly ash content). Measurement of a Final Bleeding shall be as measured in Section 10 of ASTM C 940 "Standard Test Method for Expansion and Bleeding of Freshly Mixed Grouts for Preplaced-Aggregate Concrete in the Laboratory.
- D. Flowable fill shall have a unit weight of 320 - 1300 kg/m³ (20 - 80 lbs/feet³) measured at the point of placement after a 60 minute ready-mix truck ride. In the absence of strength data the cementitious content shall be a maximum of 90 kg/m³ (150 lbs/cy).
- E. Flowable fill shall have an in-place yield of at least 98% of design yield for permanent type a maximum of 110% of design yield for removable types at 1 year.
- F. Provide equipment as recommended by the Manufacturer and comply with manufacturer's recommendations for the addition of additives, whether at the production plant or prior to placement at the site.

PART 3 - EXECUTION

3.1 EXAMINATION:

Examine conditions of substrates and other conditions under which work is to be performed and notify COR, in writing, of circumstances detrimental to the proper completion of the work. Do not proceed until unsatisfactory conditions are corrected.

3.2 APPLICATION OF FLOWABLE FILL:

Secure tanks, pipes and other members to be encased in flowable fill. Insure that there are no exposed metallic pipes, conduits, or other items that will be in contact with the flowable fill after placement. If so, replace with non-metallic materials or apply manufacturers recommended coating to protect metallic objects before placing the flowable fill. Replacement or protection of metallic objects is subject to the approval of the COR.

3.3 PROTECTION AND CURING:

Protect exposed surfaces of flowable fill from premature drying, wash by rain or running water, wind, mechanical injury, and excessively hot or cold temperature. Curing method shall be subject to approval by COR.

- - - E N D - - -

SECTION 33 30 00

SANITARY SEWER UTILITIES

PART 1 - GENERAL

1.1 DESCRIPTION

A. This section specifies materials and procedures for construction of outside, underground sanitary sewer systems that are complete and ready for operation. This includes piping, structures and all other incidentals.

1.2 RELATED WORK

- A. Excavation, Trench Widths, Pipe Bedding, Backfill, Shoring, Sheeting, Bracing: Section 31 20 00, EARTHWORK.
- B. General plumbing, protection of Materials and Equipment, and quality assurance: Section 22 05 11, COMMON WORK RESULTS FOR PLUMBING.
- C. Submittals: Section 01 33 23, SHOP DRAWINGS, PRODUCT DATA AND SAMPLES.

1.3 ABBREVIATIONS

- A. PVC: Polyvinyl chloride plastic
- B. DI: Ductile iron pipe

1.4 DELIVERY, STORAGE AND HANDLING

- A. Store plastic piping protected from direct sunlight and support to prevent sagging and bending. Protect stored piping from moisture and dirt by elevating above grade. Protect flanges, fittings, and specialties from moisture and dirt.
- B. Handle manholes according to manufacturer's written rigging instructions.

1.5 QUALITY ASSURANCE:

- A. Products Criteria:
 - 1. When two or more units of the same type or class of materials or equipment are required, these units shall be products of one manufacturer.
 - 2. A nameplate bearing manufacturer's name or trademark, including model number, shall be securely affixed in a conspicuous place on equipment. In addition, the model number shall be either cast integrally with equipment, stamped, or otherwise permanently marked on each item of equipment.

B. Comply with the rules and regulations of the Public Utility having jurisdiction over the connection to Public Sanitary Sewer lines and the extension, and/or modifications to Public Utility Systems.

1.6 SUBMITTALS:

A. Manufacturers' Literature and Data shall be submitted for the following as one package:

1. Pipe, Fittings, and, Appurtenances.
2. Jointing Material.
3. Manhole and Structure Material.
4. Frames and Covers.
5. Steps and Ladders.

1.7 APPLICABLE PUBLICATIONS

A. The publications listed below form a part of this specification to the extent referenced. The publications are referenced in the text by the basic designation only.

B. American Society for Testing and Materials (ASTM):

- A74-09.....Cast Iron Soil Pipe and Fittings
- A185/A185M-07.....Steel Welded Wire Reinforcement, Plain, for
Concrete
- A615/A615M-09b.....Deformed and Plain Carbon-Steel Bars for
Concrete Reinforcement
- A746-99.....Ductile-Iron Gravity Sewer Pipe
- C478-09.....Precast Reinforced Concrete Manhole Sections
- C857-11.....Minimum Structural Design Loading for
Underground Precast Concrete Utility Structures
- C890-11.....Minimum Structural Design Loading for
Monolithic or Sectional Precast Concrete Water
and Wastewater Structures
- C913-08.....Precast Concrete Water and Wastewater
Structures
- C923-08.....Resilient Connectors Between Reinforced
Concrete Manhole Structures, Pipes, and
Laterals

- C924-02(2009).....Testing Concrete Pipe Sewer Lines by Low-
Pressure Air Test Method
- C990-09.....Joints for Concrete Pipe, Manholes, and precast
Box Sections using Preformed Flexible Joint
Sealants
- C1173-10.....Flexible Transition Couplings for Underground
Piping Systems
- C1440-08.....Thermoplastic Elastomeric (TPE) Gasket
Materials for Drain, Waste and Vent (DWV),
Sewer, Sanitary and Storm Plumbing Systems
- C1460-08.....Shielded Transition Couplings for Use With
Dissimilar DWV Pipe and Fittings Above Ground
- C1461-08.....Mechanical Couplings Using Thermoplastic
Elastomeric (TPE) Gaskets for Joining Drain,
Waste and Vent (DWV), Sewer, Sanitary and Storm
Plumbing systems for Above and below Ground Use
- D2321-11.....Underground Installation of Thermoplastic Pipe
for Sewers and Other Gravity-Flow Applications
- D3034-08.....Type PSM Poly(Vinyl Chloride) (PVC) Sewer Pipe
and Fittings
- F477-10.....Elastomeric Seals (Gaskets) for Joining Plastic
Pipe
- F679-08.....Poly(Vinyl Chloride) (PVC) Large-Diameter
Plastic Gravity Sewer Pipe and Fittings
- F891-10.....Coextruded Poly(vinyl Chloride) (PVC) Plastic
Pipe With a Cellular Core
- F949-10.....Poly(Vinyl Chloride) (PVC) Corrugated Sewer
Pipe With a Smooth Interior and Fittings
- F1417-11.....Standard Test Method for Installation
Acceptance of Plastic Gravity Sewer Lines Using
Low-Pressure Air
- F1668-08.....Construction Procedures for Buried Plastic Pipe

C. American Water Works Association (AWWA):

- C105/A21.5-10.....Polyethylene Encasement for Ductile-Iron Pipe Systems
- C110-08.....Ductile-Iron and Gray-Iron Fittings
- C111/A21.11-06.....Rubber Gasket Joints for Ductile Iron Pressure Pipe and Fittings
- C151/A21.51-09.....Ductile Iron Pipe, Centrifugally Cast
- C153/A21.53-06.....Ductile Iron Compact Fittings for Water Service
- C219-11.....Bolted, Sleeve-Type Couplings for Plain-End Pipe
- C512-07.....Air Release, Air/Vacuum and Combination Air Valves for Water Works Service
- C600-10.....Installation of Ductile-Iron Mains and Their Appurtenances
- C900-07.....Polyvinyl Chloride (PVC) Pressure Pipe and Fabricated Fittings, 4 In. Through 12 In. (100 mm Through 300 mm), for Water Transmission and Distribution

D. American Society of Mechanical Engineers:

- A112.14.1-2003.....Backwater Valves
- A112.36.2M-1991.....Cleanouts

1.8 WARRANTY

A. The Contractor shall remedy any defect due to faulty material or workmanship and pay for any damage to other work resulting therefrom within a period of one year from final acceptance. Further, the Contractor will provide all manufacturers' and supplier's written guarantees and warranties covering materials and equipment furnished under this Contract.

PART 2 - PRODUCTS

2.1 FACTORY-ASSEMBLED PRODUCTS

- A. Standardization of components shall be maximized to reduce spare part requirements.
- B. All pipe and fittings used in the construction of force mains shall be rated to meet the system maximum operating pressure with a minimum of 150 psi (1035 kPa).
- C. The Contractor shall guarantee performance of assemblies of components, and shall repair or replace elements of the assemblies as required to deliver specified performance of the complete assembly.

2.2 DUCTILE-IRON PIPE AND FITTINGS

- A. Mechanical Joint Piping
 - 1. Pipe and Fittings: AWWA C151, thickness service weight unless otherwise shown or specified.
 - 2. Compact Fittings: AWWA C153.
 - 3. Gaskets: AWWA C111.
 - 4. Exterior coating: AWWA C151.
 - 5. Interior lining shall be as per ASTM A746.
 - 6. Pipe and fittings shall be polyethylene encased as per AWWA C105.
- B. Push-on-Joint Piping:
 - 1. Pipe: AWWA C151, thickness service weight , with bolt holes in bell.
 - 2. Standard Fittings: AWWA C110.
 - 3. Compact Fittings: AWWA C153.
 - 4. Gaskets: AWWA C111.
 - 5. Exterior coating: AWWA C151.
 - 6. Interior lining: AWWA C151.
 - 7. Pipe and fittings shall be polyethylene encased as per AWWA C105.

2.3 NONPRESSURE-TYPE TRANSITION COUPLINGS

- A. Comply with ASTM C1173, elastomeric, sleeve type, reducing or transition coupling, for joining underground nonpressure piping. Include ends to match same sizes of main line piping and install corrosion-resistant metal tension bands and tightening mechanism on each end.
- B. Sleeve Materials:
 - 1. For Plastic Pipes: ASTM F477, elastomeric seal.
 - 2. For Dissimilar Pipes: PVC or other material compatible with pipe materials being joined.

C. Unshielded, Flexible Couplings:

1. Couplings shall be elastomeric sleeve with stainless steel shear ring and corrosion-resistant-metal tension band and tightening mechanism on each end.

D. Shielded, Flexible Couplings:

1. Couplings shall meet ASTM C1460 with elastomeric with full-length, corrosion-resistant outer shield with corrosion-resistant-metal tension band and tightening mechanism on each end.

E. Ring-Type, Flexible Couplings:

1. Couplings shall be elastomeric compression seal with dimensions to fit inside bell of larger mainline pipe and for spigot of smaller main line pipe to fit inside ring.

F. Nonpressure-Type, Rigid Couplings:

1. Coupling shall be ASTM C1461, sleeve-type, reducing, molded from ASTM C1440, TPE material; with corrosion-resistant-metal tension band and tightening mechanism on each end.

2.4 CLEANOUTS

A. Cast-Iron Cleanouts:

1. Cleanouts shall be as per ASME A112.36.2M, round, gray-iron housing with clamping device and round, secured, scoriated, gray-iron cover. Include gray-iron ferrule with inside calk or spigot connection and countersunk, tapered-thread, brass closure plug.
2. Top-Loading Classification(s): Valve loadings shall be designed for Medium Duty.
3. Cleanout Riser: Sewer pipe fitting on main line pipe and riser shall be as per ASTM A74, service class.

2.5 CONCRETE

A. Cast-in-place concrete shall be 4000 psi (27.6 MPa) minimum, with 0.45 maximum water/cementitious materials ratio.

B. Reinforcement

1. Reinforcing fabric shall be ASTM A185, steel, welded wire fabric, plain.
2. Reinforcing bars shall be ASTM A615, Grade 60 (420 MPa) deformed steel.

C. Benches shall be concrete, sloped to drain into the channel. Provide 6 inches (150 mm) from the cut section of top of pipe to edge of manhole.

- D. Ballast and Pipe Supports shall be Portland cement design mix, 3000 psi (20.7 MPa) minimum, with 0.58 maximum water/cementitious materials ratio.

2.6 WARNING TAPE

- A. Warning tape shall be standard, 4 mil (0.1 mm) polyethylene 3 inch (76 mm) wide tape detectable type, green with black letters and imprinted with "CAUTION BURIED SEWER LINE BELOW".

PART 3 - EXECUTION

3.1 PIPING INSTALLATION

- A. Drawing plans and details indicate the general location and arrangement of underground sanitary sewer piping. Install piping as indicated, to extent practical. Where specific installation is not indicated, follow piping manufacturer's written instructions.
- B. Install piping beginning at the low point, true to grades and alignment indicated on the drawings, with unbroken continuity of invert. Place bell ends of piping facing upstream. Install gaskets, seals, sleeves, and couplings according to manufacturer's written instructions for using lubricants, cements, and other installation requirements.
- C. Do not lay pipe on unstable material, in wet trench or when trench and weather conditions are unsuitable for the work.
- D. Support pipe on compacted bedding material. Excavate bell holes only large enough to properly make the joint.
- E. Inspect pipes and fittings for defects before installation. Defective materials shall be plainly marked and removed from the site. Cut pipe shall have smooth regular ends at right angles to axis of pipe.
- F. Lower pipe into trench carefully and bring to proper line, grade, and joint. After jointing, interior of each pipe shall be thoroughly wiped or swabbed to remove any dirt, trash or excess jointing materials.
- G. Do not walk on pipe in trenches until covered by layers of bedding or backfill material to a depth of 12 inches (300 mm) over the crown of the pipe.
- H. Warning tape shall be continuously placed 12 inches (300 mm) above sewer pipe

- I. Install manholes for changes in direction unless fittings are indicated. Use fittings for branch connections unless direct tap into existing sewer is indicated.
- J. Install proper size increasers, reducers, and couplings where different sizes or materials of pipes and fittings are connected. Reducing size of piping in direction of flow is prohibited.
- K. When installing pipe under streets or other obstructions that cannot be disturbed, use pipe-jacking process or microtunneling.
- L. Install gravity-flow, non-pressure, drainage piping according to the following:
 - 1. Install piping pitched down in direction of flow, at minimum slope of 1 percent unless otherwise indicated.
 - 2. Install piping with an approximate minimum cover of 144 inches as shown on Drawings.
 - 3. Install ductile iron, gravity sewer piping according to AWWA C600.
- M. Install force-main, pressure piping according to the following:
 - 1. Install piping with restrained joints at tee fittings and at horizontal and vertical changes in direction. Use corrosion-resistant rods, pipe or fittings, or cast-in-place-concrete supports or anchors. Pressure (force) mains shall have the bells facing the direction of flow.
 - 2. Sections of piping listed on the drawings shall be fully restrained. For devices with twist off nuts, the twist off nuts shall be placed on top of the fitting for the COR's inspection. The Contractor shall torque test all bolts, set screws, identified by the COR.
 - 3. Thrust blocks shall not be permitted.
- N. Clear interior of piping and manholes of dirt and superfluous material as work progresses. Maintain swab or drag in piping, and pull past each joint as it is completed. Place plug in end of incomplete piping at end of day and when work stops.
- O. Gravity Flow Lines with Secondary Containment (Encasement Pipe):
 - 1. Install per manufacturer's recommendations. Install all pipe centering devices to maintain an interstitial space below the invert of the carrier pipe. Both the carrier and containment pipe shall be tested for leaks.

3.2 PIPE JOINT CONSTRUCTION

- A. Join gravity-flow, non-pressure, drainage piping according to the following:
 - 1. Join ductile iron, gravity sewer piping according to AWWA C600 for push-on joints.
 - 2. Join PVC piping according to ASTM D2321.
 - 3. Join dissimilar pipe materials with nonpressure-type, flexible couplings.
- B. Join force-main, pressure piping according to the following:
 - 1. Join ductile iron pressure piping according to AWWA C600 for push-on joints.
 - 2. Join dissimilar pipe materials with pressure-type couplings.
- C. Pipe couplings, expansion joints, and deflection fittings with pressure ratings at least equal to piping rating may be used in applications below unless otherwise indicated.
 - 1. Use non-pressure flexible couplings where required to join gravity-flow, non-pressure sewer piping unless otherwise indicated.
 - a. Flexible couplings for pipes of same or slightly different OD.
 - b. Unshielded, increaser/reducer-pattern, flexible couplings for pipes with different OD.
 - c. Ring-type flexible couplings for piping of different sizes where annular space between smaller piping's OD and larger piping's ID permits installation.
 - 2. Use pressure pipe couplings for force-main joints.

3.3 SEWER AND MANHOLE SUPPORTS, CONCRETE CRADLES WITHIN VAULTS

- A. Install reinforced concrete as detailed on the drawings. The concrete shall not restrict access for future maintenance of the joints within the piping system.

3.4 BUILDING SERVICE LINES

- A. Install sanitary sewer service lines to point of connection within approximately 5 feet (1500 mm) outside of building(s) where service is required and make connections. Coordinate the invert and location of the service line with the Contractor installing the building lines.

3.5 CLEANOUT INSTALLATION

- A. Install cleanouts and riser extensions from sewer pipes to cleanouts at grade. Cleanouts should be 6 inches (150 mm) in diameter and consist of a ductile iron 45 degree fitting on end of run, or combination Y fitting

and 1/8 bend in the run with ductile iron pipe extension, water tight plug or cap and cast frame and cover flush with finished grade. Install piping so cleanouts open in direction of flow in sewer pipe.

1. Use Light-Duty, top-loading classification cleanouts in earth or unpaved foot-traffic areas.
 2. Use Medium-Duty, top-loading classification cleanouts in paved foot-traffic areas.
 3. Use Heavy-Duty, top-loading classification cleanouts in vehicle-traffic service areas.
 4. Use Extra-Heavy-Duty, top-loading classification cleanouts in roads.
- B. Set cleanout frames and covers in earth in cast-in-place-concrete, 18 by 18 by 12 inches (450 by 450 by 300 mm) 1 inch (25 mm) above surrounding grade.
- C. Where cleanout is in force main, provide a blind flange top connection. The center of the flange shall be equipped with a 2 inches (50 mm) base valve to allow the pressure in the line to be relieved prior to removal of the blind flange. Frames and covers for pressure (force) mains shall be 24 inches (600 mm) in diameter.
- D. Set cleanout frames and covers in concrete pavement and roads with tops flush with pavement surface.
- E. The top of the cleanout assembly shall be 2 inches (50 mm) below the bottom of the cover to prevent loads being transferred from the frame and cover to the piping.

3.6 CONNECTIONS

- A. Make connections to existing piping and underground manholes by coring and installing the pipe at the design invert. Install an elastomeric gasket around the pipe, and grout the interstitial space between the pipe and the core.
- B. Connection to an existing manhole: The bench of the manhole shall be cleaned and reshaped to provide a smooth flowline for all new pipes connected to the manhole.
- C. Use commercially manufactured wye fittings for piping branch connections. Encase entire wye fitting plus 6-inch (150-mm) overlap with not less than 6 inches (150 mm) of concrete with 28-day compressive strength of 3000 psi (20.7 MPa).

1. Make branch connections from the side into existing piping, NPS 4 to NPS 20 (DN 100 to DN 500), by removing a section of the existing pipe.
2. Make branch connections from the side into existing piping, NPS 21 (DN 525) or larger, or to underground manholes by cutting an opening into existing unit large enough to allow 3 inches (76 mm) of concrete to be packed around entering connection. Cut end of connection pipe passing through pipe or structure wall to conform to shape of and be flush with inside wall unless otherwise indicated. On outside of pipe or manhole wall, encase entering connection in concrete to provide additional support of collar from connection to undisturbed ground.
3. Protect existing piping and manholes to prevent concrete or debris from entering while making tap connections. Remove debris or other extraneous material that may accumulate.

3.7 REGRADING

- A. Raise or lower existing manholes and structures frames and covers, cleanout frames and covers and valve boxes in regraded areas to finish grade. Carefully remove, clean and salvage cast iron frames and covers. Adjust the elevation of the top of the manhole or structure as detailed on the drawings. Adjust the elevation of the cleanout pipe riser, and reinstall the cap or plug. Reset cast iron frame and cover, grouting below and around the frame. Install concrete collar around reset frame and cover as specified for new construction.
- B. During periods when work is progressing on adjusting manholes or structures cover elevations, the Contractor shall install a temporary cover above the bench of the structure or manhole. The temporary cover shall be installed above the high flow elevation within the structure, and shall prevent debris from entering the wastewater stream.

3.8 CLOSING ABANDONED SANITARY SEWER SYSTEMS

- A. Close open ends of abandoned underground piping indicated to remain in place. Include closures strong enough to withstand hydrostatic and earth pressures that may result after ends of abandoned piping have been closed.
 1. Piping under and within 5 feet (1500 mm) of building areas shall be completely removed.
 2. Piping outside of building areas shall be completely removed.
- B. Backfill to grade according to Division 31 Section 31 20 00, EARTHWORK.

3.9 IDENTIFICATION

- A. Install green warning tape directly over piping and at outside edges of underground manholes.

3.10 FIELD QUALITY CONTROL

- A. All systems shall be inspected and obtain the COR's approval. Prior to final acceptance, provide a video record of all piping from the building to the municipal connection to show the lines are free from obstructions, properly sloped and joined.
- B. To inspect, thoroughly flush out the lines and manholes before inspection. Lamp test between structures and show full bore indicating sewer is true to line and grade. Lips at joints on the inside of gravity sewer lines are not acceptable.
 - 1. Submit separate report for each system inspection.
 - 2. Defects requiring correction include the following:
 - a. Alignment: Less than full diameter of inside of pipe is visible between structures.
 - b. Deflection: Flexible piping with deflection that prevents passage of ball or cylinder of size not less than 92.5 percent of piping diameter.
 - c. Damage: Crushed, broken, cracked, or otherwise damaged piping.
 - d. Infiltration: Water leakage into piping.
 - e. Exfiltration: Water leakage from or around piping.
 - 3. Replace defective piping using new materials, and repeat inspections until defects are within allowances specified.
 - 4. Re-inspect and repeat procedure until results are satisfactory.
- C. Air Tests: Test sanitary sewerage according to requirements of authorities having jurisdiction and the following:
 - 1. Test plastic gravity sewer piping according to ASTM F1417.
 - 2. Test concrete gravity sewer piping according to ASTM C924.
 - 3. Clean and isolate the section of sewer line to be tested. Plug or cap the ends of all branches, laterals, tees, wyes, and stubs to be included in the test to prevent air leakage. The line shall be pressurized to 4 psi (28 kPa) and allowed to stabilize. After pressure stabilization, the pressure shall be dropped to 3.5 psi (24 kPa) greater than the average back-pressure of any groundwater above the sewer.

4. For force mains, perform testing after supports and anchors are installed. Test at pressure not less than 1-1/2 times the maximum system operating pressure, but not less than 150 psi (1035 kPa).
5. Testing of Fiberglass Sewage Holding Tanks shall show no leakage during a 5 psi (35 kPa) air pressure test with 5:1 safety factor.
6. Testing of Concrete Wet Well shall show no leakage with the wet well completely filled with water for a duration of 4 hours.

3.11 CLEANING

- A. Clean dirt and superfluous material from interior of piping.

--- E N D ---