DRAWINGS ARE DIAGRAMMATIC. THEY ARE NOT INTENDED TO BE ABSOLUTELY PRECISE. THEY ARE NOT INTENDED TO SPECIFY OR TO SHOW EVERY OFFSET FITTING AND COMPONENT. THE PURPOSE OF THE DRAWINGS IS TO INDICATE A SYSTEMS CONCEPT, THE MAIN COMPONENTS OF THE SYSTEMS, AND THE APPROXIMATE GEOMETRICAL RELATIONSHIPS, BASED ON THE SYSTEM CONCEPT. THE MAIN COMPONENTS, AND THE APPROXIMATE GEOMETRICAL RELATIONSHIPS. THE CONTRACTOR SHALL PROVIDE ALL OTHER COMPONENTS AND MATERIALS NECESSARY TO MAKE THE SYSTEMS FULLY COMPLETE AND OPERATIONAL.

NOTE:
PARKING LOT LIGHTING IS DIRECT BURIED. CONTRACTOR SHALL IDENTIFY THE LOCATION AND DEPTH OF CABLE BEFORE EXCAVATION. ANY DIRECT BURIED CABLES DAMAGED DURING CONSTRUCTION SHALL BE REPLACED.

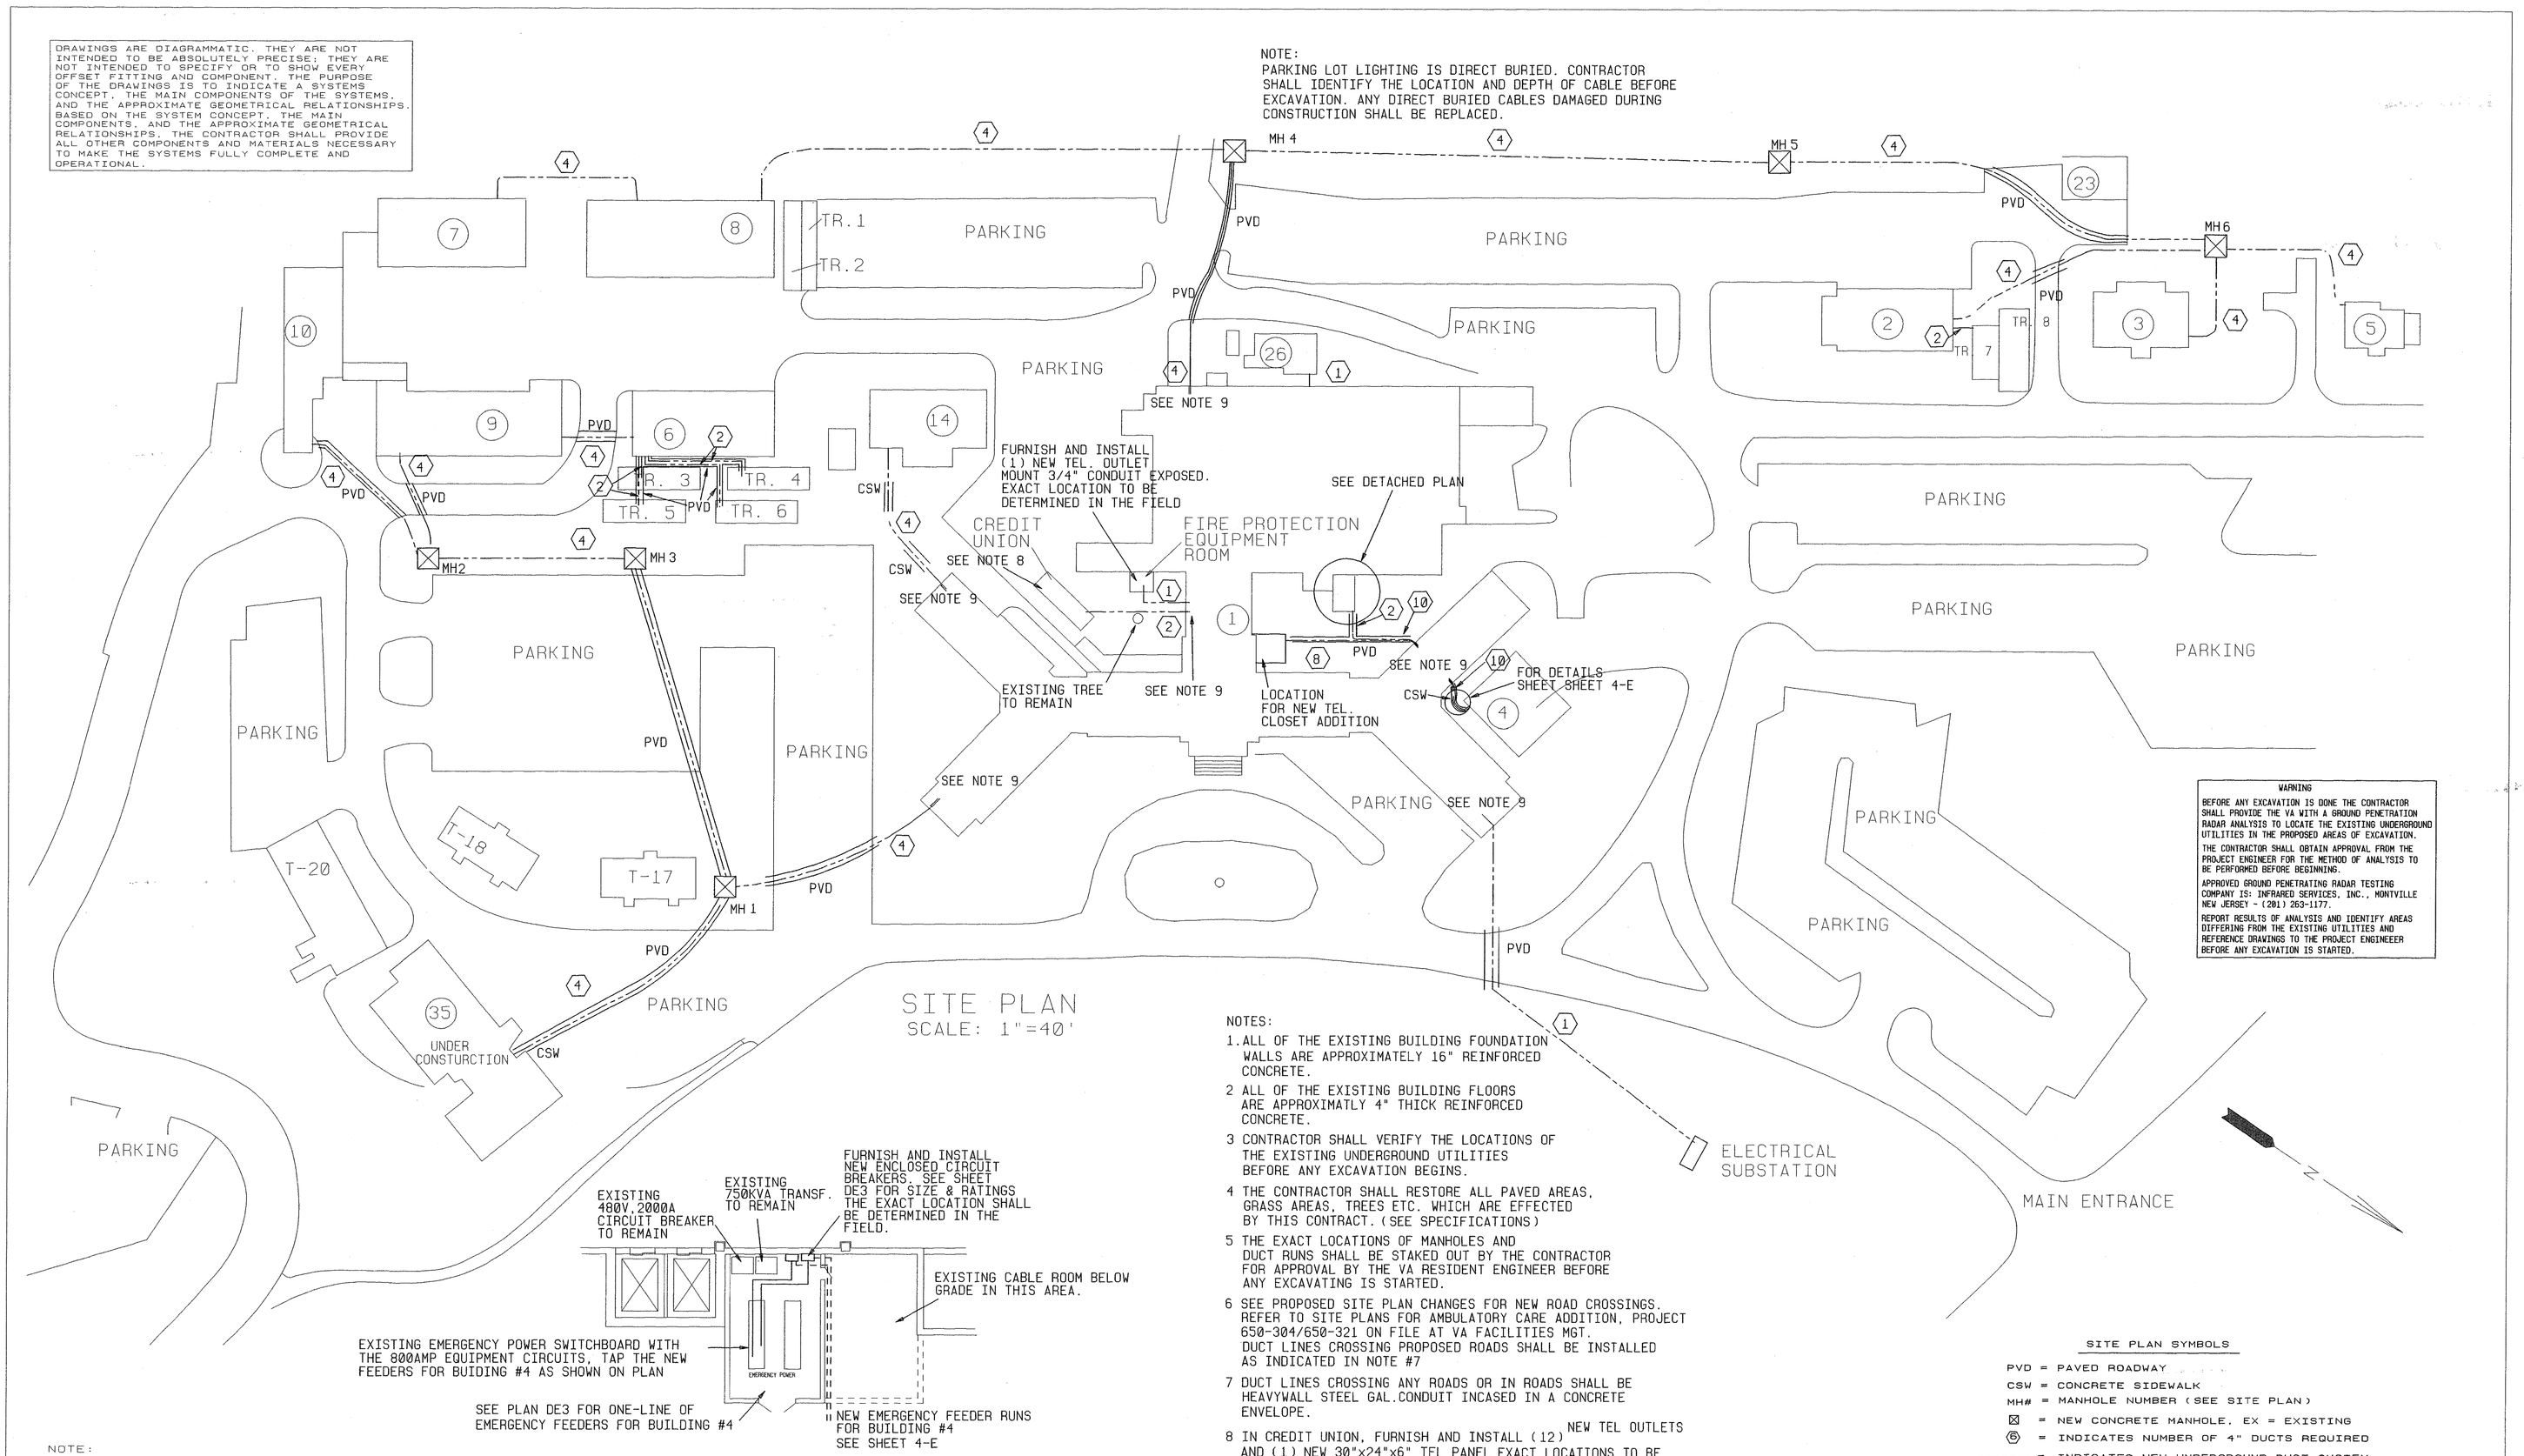


SITE PLAN
SCALE: 1"=40'

WARNING

BEFORE ANY EXCAVATION IS DONE THE CONTRACTOR SHALL PROVIDE THE VA WITH A GROUND PENETRATION RADAR ANALYSIS TO LOCATE THE EXISTING UNDERGROUND UTILITIES IN THE PROPOSED AREAS OF EXCAVATION.

THE CONTRACTOR SHALL OBTAIN APPROVAL FROM THE PROJECT ENGINEER FOR THE METHOD OF ANALYSIS TO BE PERFORMED BEFORE BEGINNING.

APPROVED GROUND PENETRATING RADAR TESTING COMPANY IS: INFRARED SERVICES, INC., MONTVILLE NEW JERSEY - (201) 263-1177.

REPORT RESULTS OF ANALYSIS AND IDENIFY AREAS DIFFERING FROM THE EXISTING UTILITIES AND REFERENCE DRAWINGS TO THE PROJECT ENGINEEER BEFORE ANY EXCAVATION IS STARTED.

NOTES:

1. ALL OF THE EXISTING BUILDING FOUNDATION WALLS ARE APPROXIMATELY 16" REINFORCED CONCRETE.
2. ALL OF THE EXISTING BUILDING FLOORS ARE APPROXIMATLY 4" THICK REINFORCED CONCRETE.
3. CONTRACTOR SHALL VERIFY THE LOCATIONS OF THE EXISTING UNDERGROUND UTILITIES BEFORE ANY EXCAVATION BEGINS.
4. THE CONTRACTOR SHALL RESTORE ALL PAVED AREAS, GRASS AREAS, TREES ETC. WHICH ARE EFFECTED BY THIS CONTRACT. (SEE SPECIFICATIONS)
5. THE EXACT LOCATIONS OF MANHOLES AND DUCT RUNS SHALL BE STAKED OUT BY THE CONTRACTOR FOR APPROVAL BY THE VA RESIDENT ENGINEER BEFORE ANY EXCAVATING IS STARTED.
6. SEE PROPOSED SITE PLAN CHANGES FOR NEW ROAD CROSSINGS. REFER TO SITE PLANS FOR AMBULATORY CARE ADDITION, PROJECT 650-304/650-321 ON FILE AT VA FACILITIES MGT. DUCT LINES CROSSING PROPOSED ROADS SHALL BE INSTALLED AS INDICATED IN NOTE #7
7. DUCT LINES CROSSING ANY ROADS OR IN ROADS SHALL BE HEAVYWALL STEEL GAL.CONDUIT INCASED IN A CONCRETE ENVELOPE.
8. IN CREDIT UNION, FURNISH AND INSTALL (12) NEW TEL OUTLETS AND (1) NEW 30"x24"x6" TEL PANEL EXACT LOCATIONS TO BE DETERMINED IN THE FIELD. RUN 3/4" CONDUIT FROM EACH OUTLET TO NEW 6"x6" WP WIREWAY LOCATED UNDER TRAILER FLOOR. PATCH FLOORS TO MATCH EXISTING AND RE-INSULATE AREAS AFFECTED BY INSTALLATION.
9. FOR CONTINUATION, SEE PIPE BASEMENT PLANS SHEETS 1-E1,1-E2,1-E3
10. SEE SHEET L2 AND REFERENCE DRAWINGS FOR EXISTING SITE UTILITIES AND PROPOSED SITE PLAN CHANGES.




DETACHED PLAN - EMERGENCY POWER
BUILDING 1 "C" WING
SCALE: 1"=10'-0"

NOTE:
#1 ALL WIRING SHALL BE INSTALLED AND GROUNDING SHALL BE IN ACCORDANCE WITH THE LATEST RULES OF THE NATIONAL ELECTRICAL CODE,LOCAL RULES, AND REGULATIONS.
#2 THE EXACT LOCATION OF EQUIPMENT AND THE METHOD OF SUPPORT OF THE WIRING AND EQUIPMENT TO BE DETERMINED IN THE FIELD.

SITE PLAN SYMBOLS

PVD = PAVED ROADWAY
CSW = CONCRETE SIDEWALK
MH# = MANHOLE NUMBER (SEE SITE PLAN)
⊠ = NEW CONCRETE MANHOLE, EX = EXISTING
⑥ = INDICATES NUMBER OF 4" DUCTS REQUIRED
- - - - = INDICATES NEW UNDERGROUND DUCT SYSTEM CONCRETE ENCASED.
——— = NEW 12" CABLE TRAY

| REVISIONS | DATE |
|---|---|
| | |

| | | | |
|---|---|---|---|
| DRAWING TITLE SITE PLAN OUTSIDE PLANT | PROJECT TITLE TELEPHONE SITE PREP | | DATE JUN 13 1997 |
| APPROVED: SAFETY MANAGER JWS | | | PROJECT NUMBER 650-96-600 |
| APPROVED: PROJECT ENGINEER Peter Accardi 6/20/97 | BUILDING NUMBER ALL | CHECKED JES / DRAWN WDL | DRAWING NO. L1 |
| APPROVED: CHIEF FACILITIES MANAGEMENT 6/25/97 | LOCATION PROVIDENCE, RI 02908 | | DWG 2 OF 24 |

OFFICE OF FACILITIES
DEPARTMENT OF VETERANS AFFAIRS

96-5