



NOTES:

1. LINTEL REINFORCING SHALL EXTEND 2'-0" BEYOND THE FACE OF WALL OPENING, TYPICAL.
2. MASONRY LINTEL JAMBS SHALL BE GROUTED SOLID & REINFORCED WITH 1-#5 VERTICAL (MINIMUM) FULL HEIGHT OF WALL.

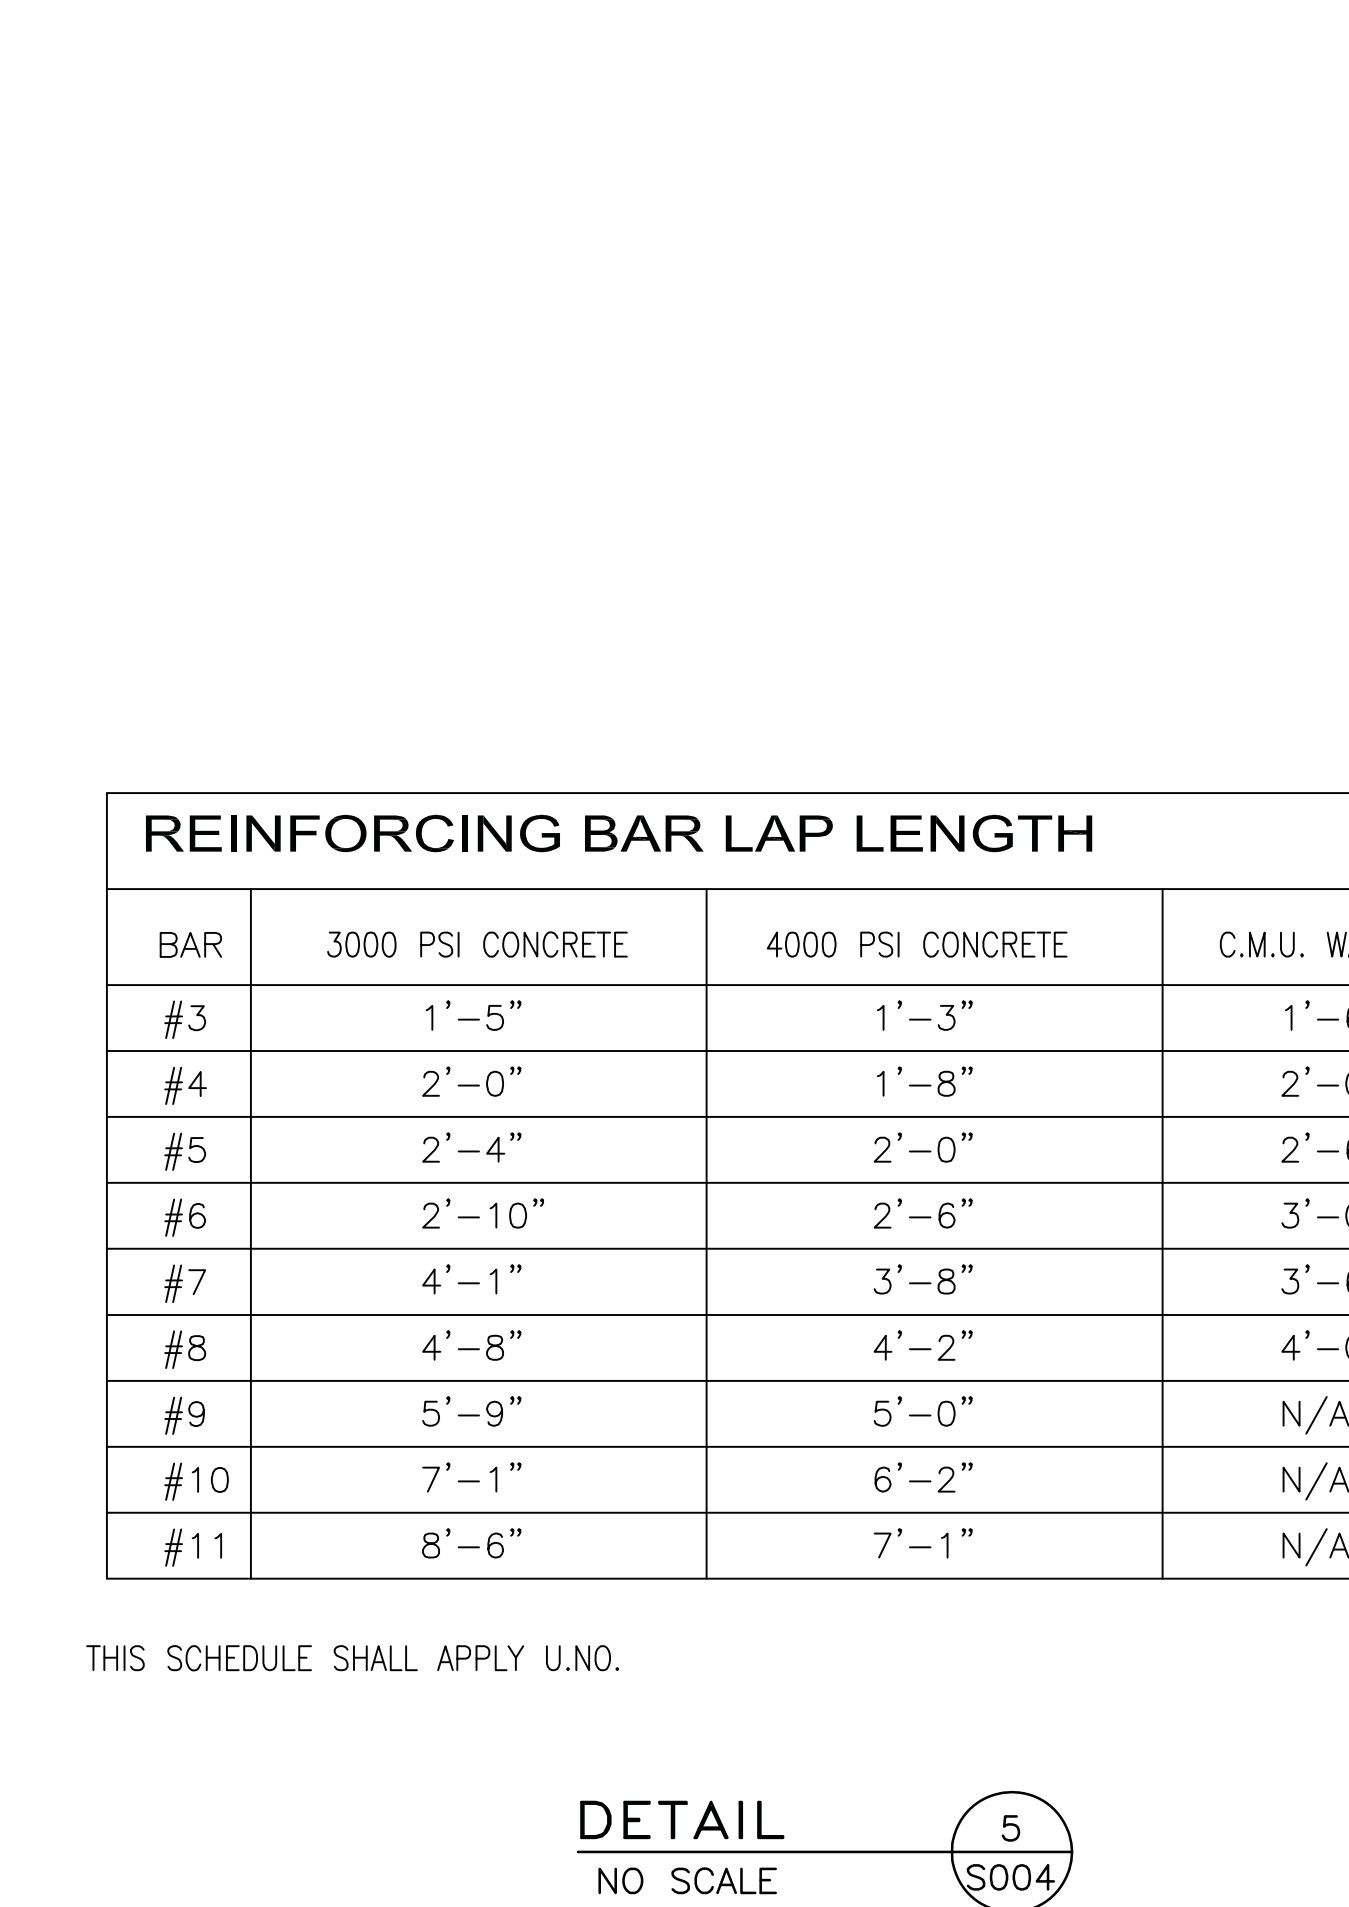

THIS SCHEDULE SHALL APPLY U.NO.

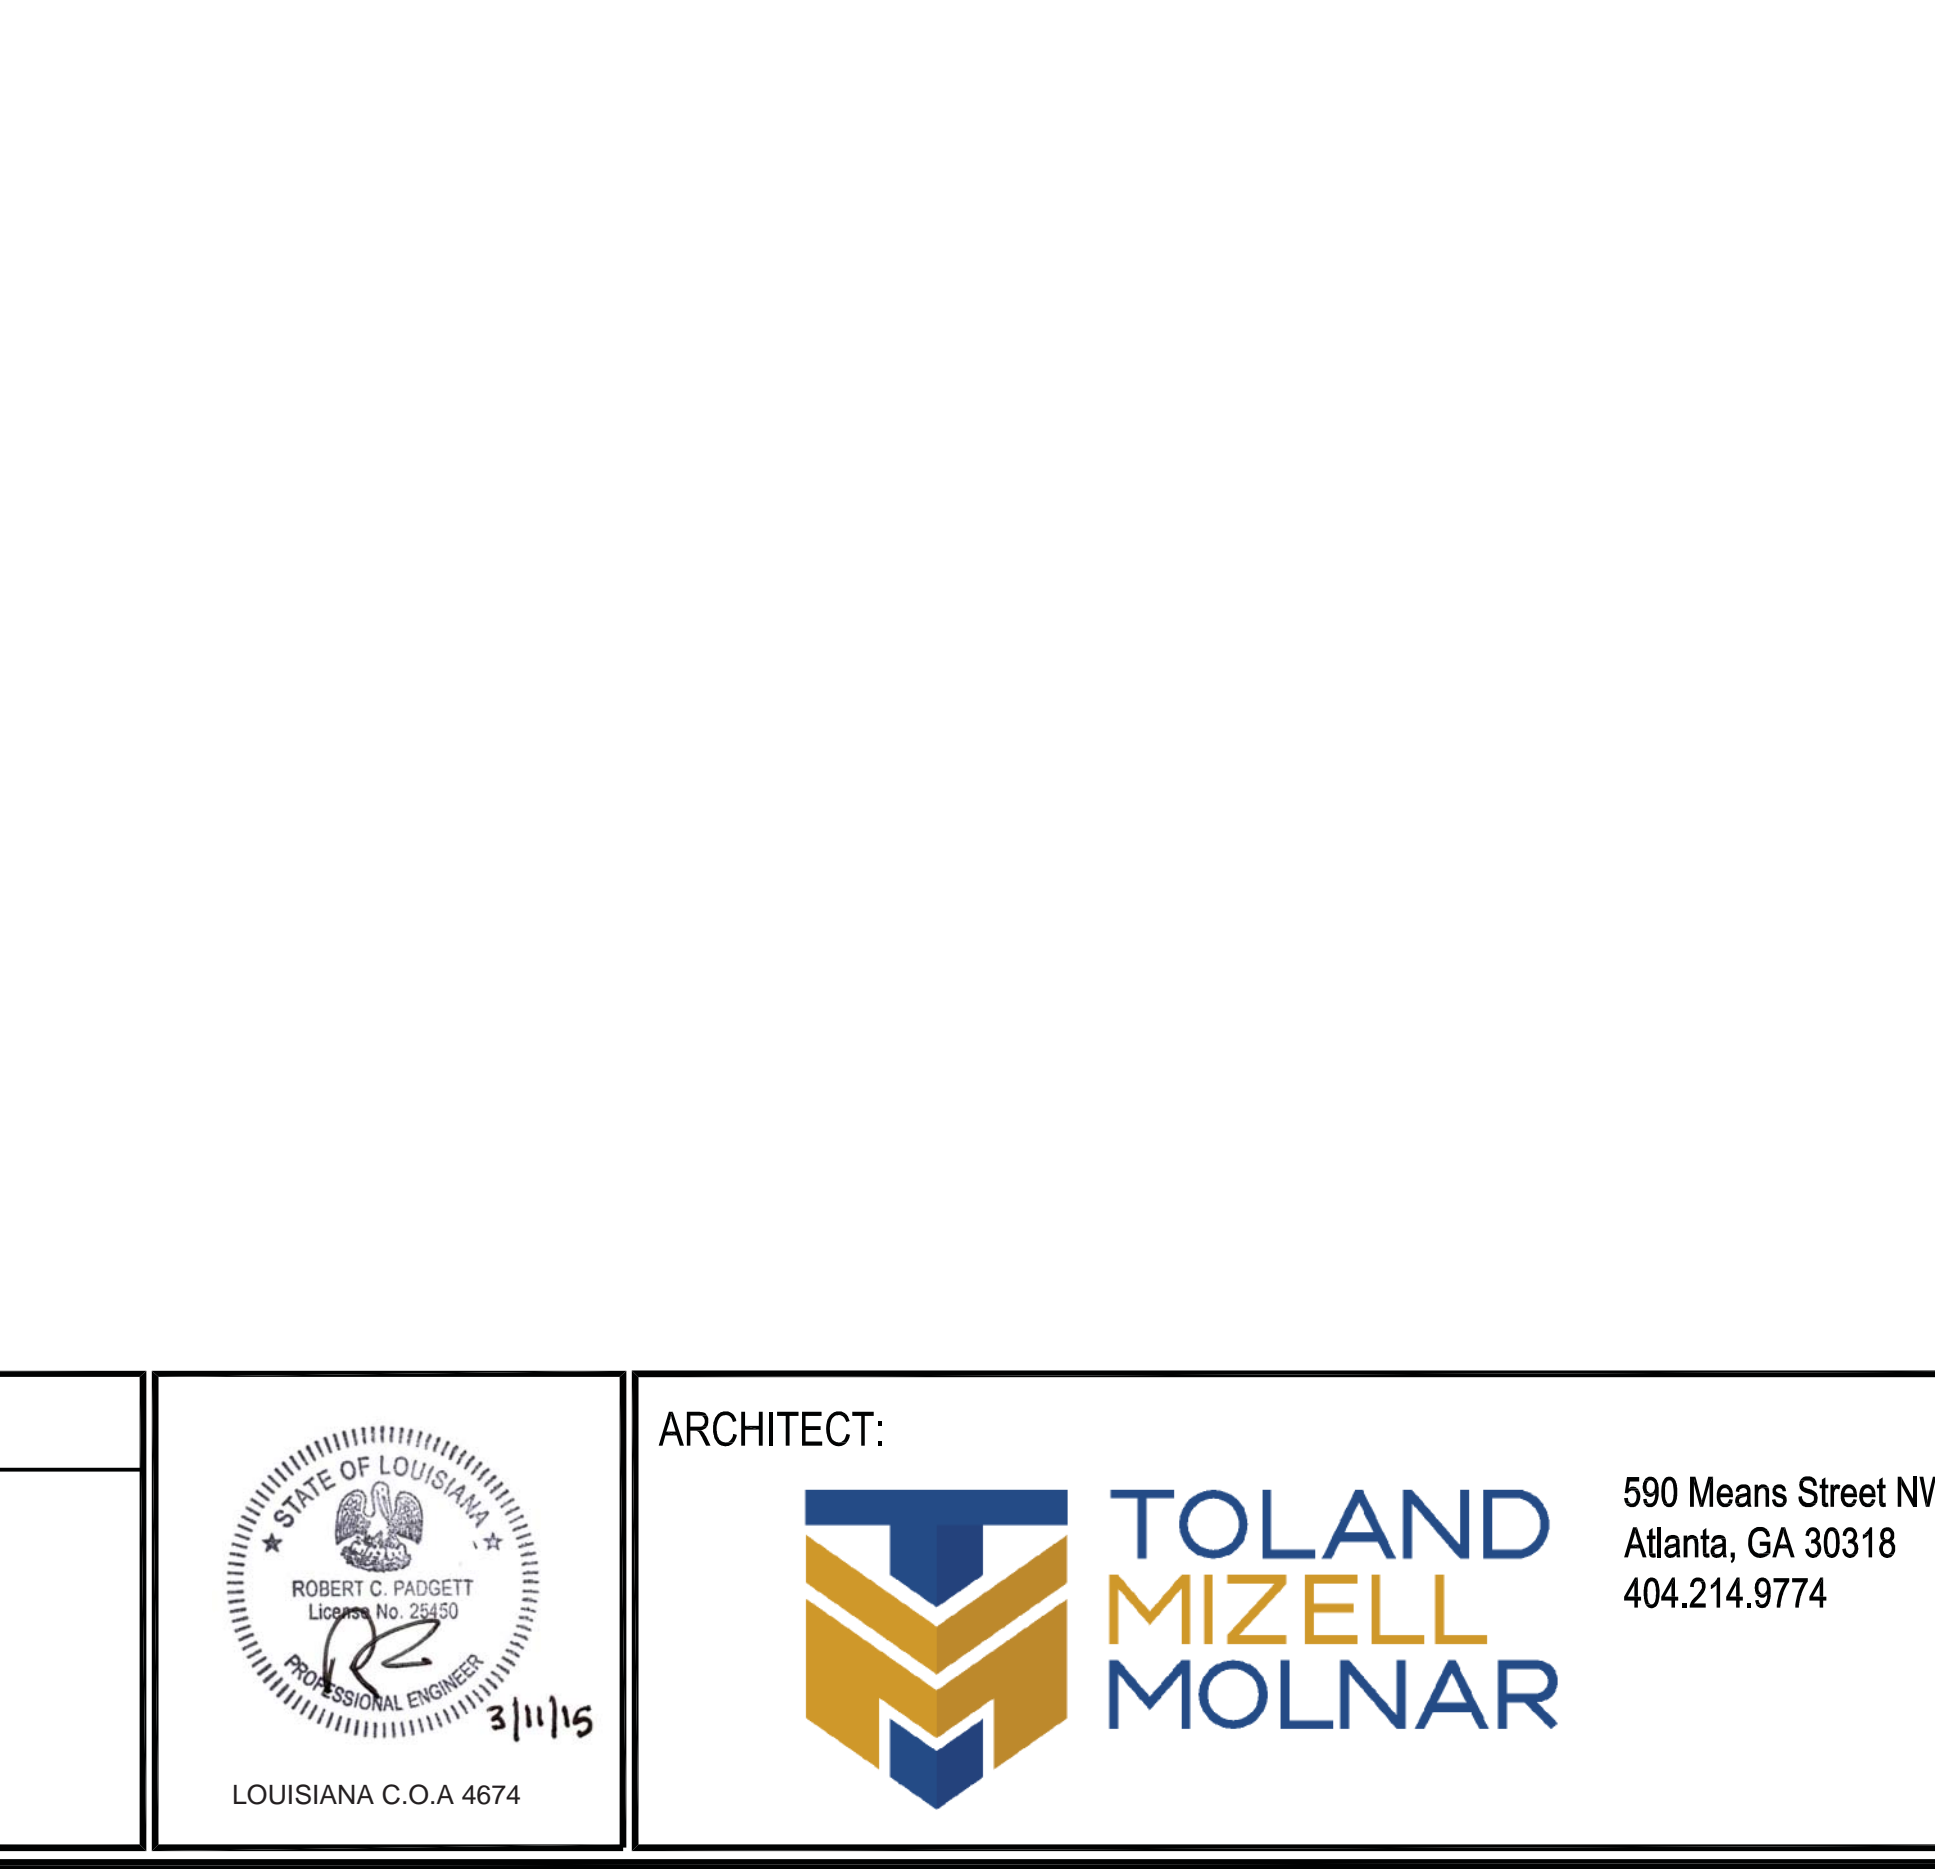

| 7 | 8 | 9 |