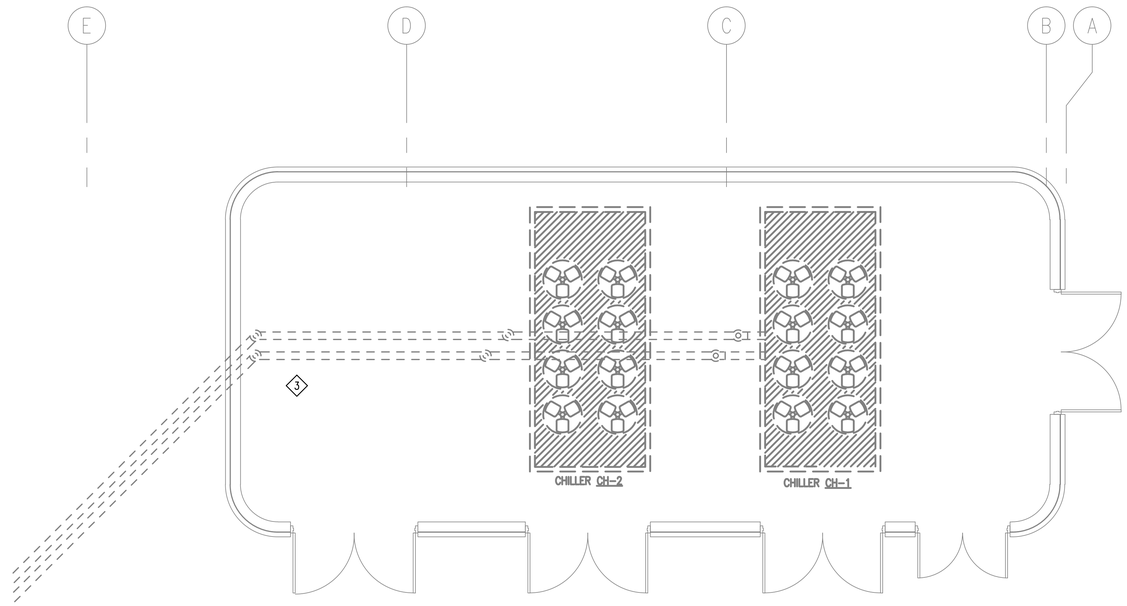

DEMOLITION NOTES:
(THIS SHEET ONLY)

1. SCHEDULE SHUTDOWN AND REPLACE CHP-01 AS DETAILED AND SCHEDULED. NEW PUMP SHALL BE SUPPORTED FROM BELOW. AFTER CHP-01 IS REPLACED, REPLACE CHP-02 AS DETAILED AND SCHEDULED.
2. EXISTING CHILLED WATER SYSTEM CHEMICAL FEEDER TO REMAIN IN PLACE AT THIS APPROXIMATE LOCATION. DISCONNECT AND RECONNECT DURING REPLACEMENT OF PUMPS.
3. PREPARE EXISTING PIPING FOR CONNECTION OF NEW CHILLER.

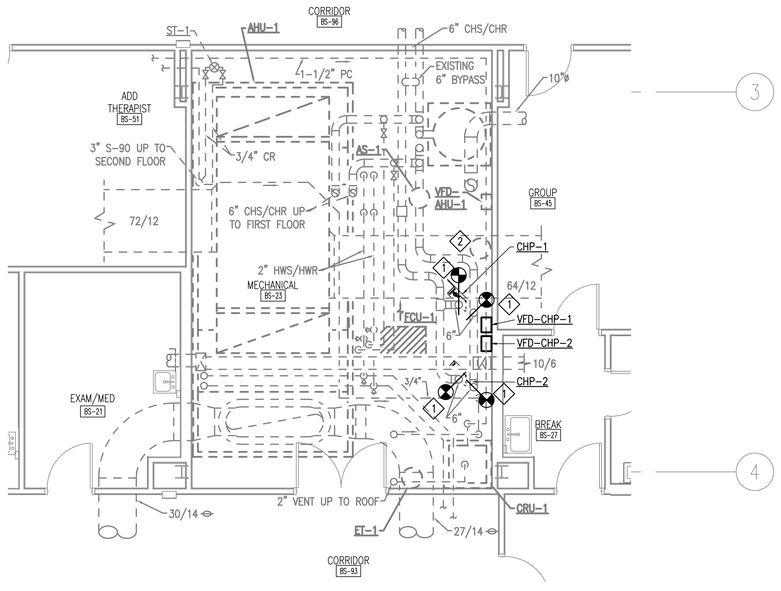

ENLARGED BASEMENT MECHANICAL ROOM
DEMOLITION FLOOR PLAN – MECHANICAL
SCALE: 1/4" = 1'-0"

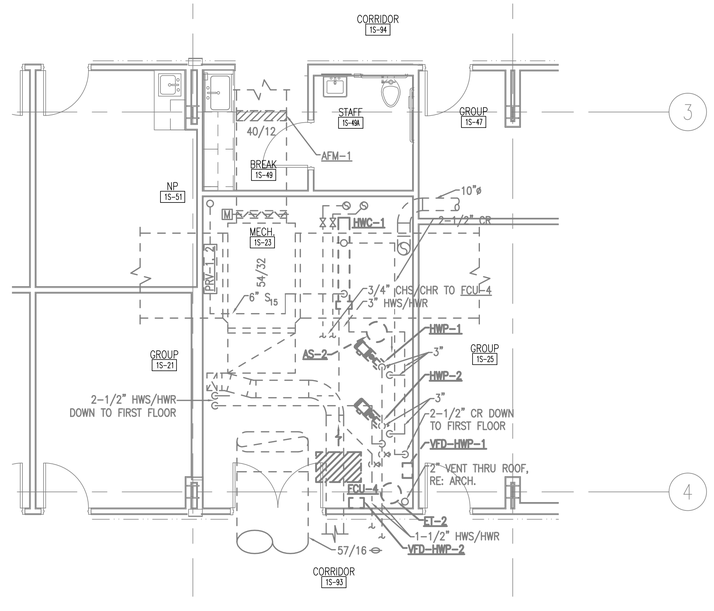

ENLARGED FIRST FLOOR MECHANICAL ROOM
DEMOLITION FLOOR PLAN – MECHANICAL
SCALE: 1/4" = 1'-0"

FINAL SUBMITTAL

Revisions:	Date

CONSULTANTS:

APPLIED ENGINEERING SOLUTIONS
440 Martin Luther King, Jr. Blvd., Suite 401
Macon, Georgia 31201
Phone: (478) 314-1270 – Fax: (478) 314-1271
www.aes-pe.com

ARCHITECT/ENGINEERS:

TOLAND MIZELL MOLNAR
590 Means Street NW, Suite 200
Atlanta, GA 30318
404.214.9774

Drawing Title: FIRST FLOOR PIPING DEMOLITION FLOOR PLAN - MECHANICAL

Approved: Project Director

Project Title: EXPAND RADIOLOGY AND SPS OVERTON BROOKS VAMC

Location: SHREVEPORT, LA

Date: 04-17-2015 | Checked: PJC | Drawn: JSW

Project Number: 667-083

Building Number: 1

Drawing Number: MD401

Dwg. 103 of 160

OFFICE OF CONSTRUCTION AND FACILITIES MANAGEMENT

VA | U.S. Department of Veterans Affairs

VA FORM 08-6231