
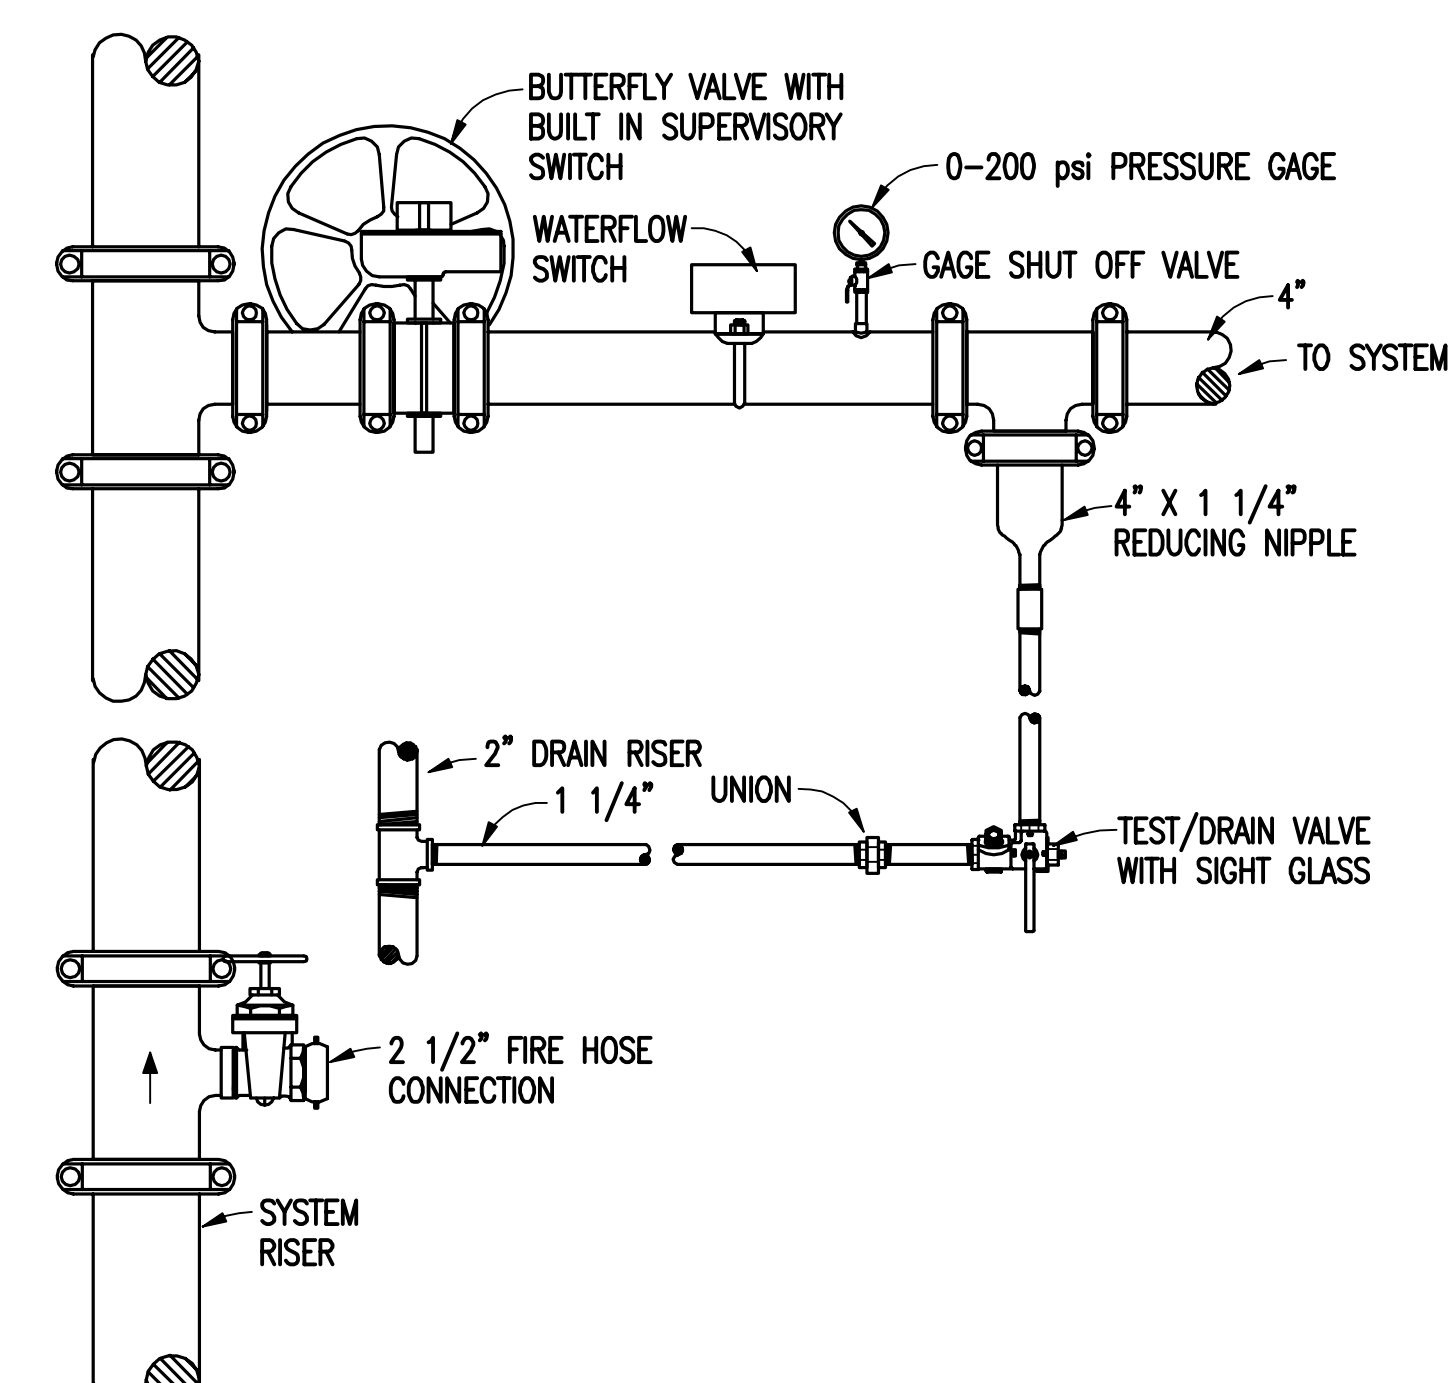


Drawing File: H:\2013\5123-VA Shreveport 3rd and 4th Floors\Drawings\5123 FP 001.dwg
Plotted By: gilliland
Plotted Date: Apr 24, 2015 10:11am

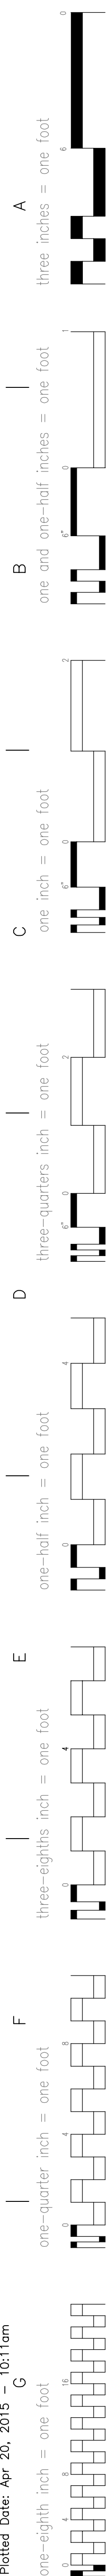


GENERAL NOTES:
(STANDPIPE RISER DETAIL ONLY)

(A) THIS FLOOR CONTROL VALVE DETAIL IS USED IN THOSE AREAS DESIGNED FOR SPRINKLED ZONE CONTROL WHERE TEST STATION IS CONNECTED TO DRAIN RISER.

STANDPIPE RISER AND SPRINKLER ZONE CONTROL VALVE DETAIL
SCALE: NONE

FIRE PROTECTION LEGEND	
	NEW PIPING/EQUIPMENT
	DRAIN PIPE
	UPRIGHT TYPE FIRE SPRINKLER HEAD
	PENDENT TYPE FIRE SPRINKLER HEAD
	DRY SIDEWALL TYPE SPRINKLER HEAD
	STRAINER
	CAPPED PIPE
	CHECK VALVE
	UNION
	GATE VALVE
	PIPING REDUCER
	PIPING RISER
	VALVE IN PIPING RISER
	PIPING DROP
	VALVE IN PIPING DROP
	PIPING TEE FROM TOP OF MAIN
	PIPING TEE FROM BOTTOM OF MAIN
	GAGE

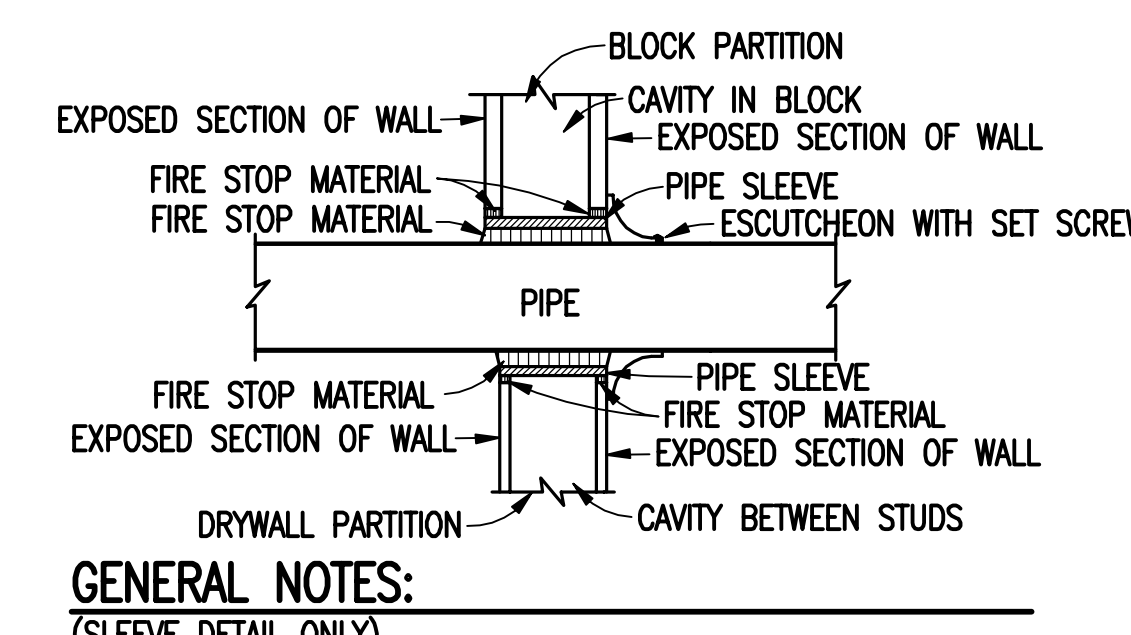


GENERAL NOTES:
(SLEEVE DETAIL ONLY)


(A) APPLICABLE TO PENETRATIONS OF ALL WALLS AND FIRE RATED MEMBRANES, IN ACCORDANCE WITH IBC 2003.

(B) FIRE STOP MATERIAL ON EXPOSED SECTION OF WALLS SHALL BE FINISHED UNIFORMED, SMOOTH AND PAINTED TO MATCH SURROUNDING AREA.


WALL PENETRATION AND SLEEVE DETAIL
SCALE: NONE

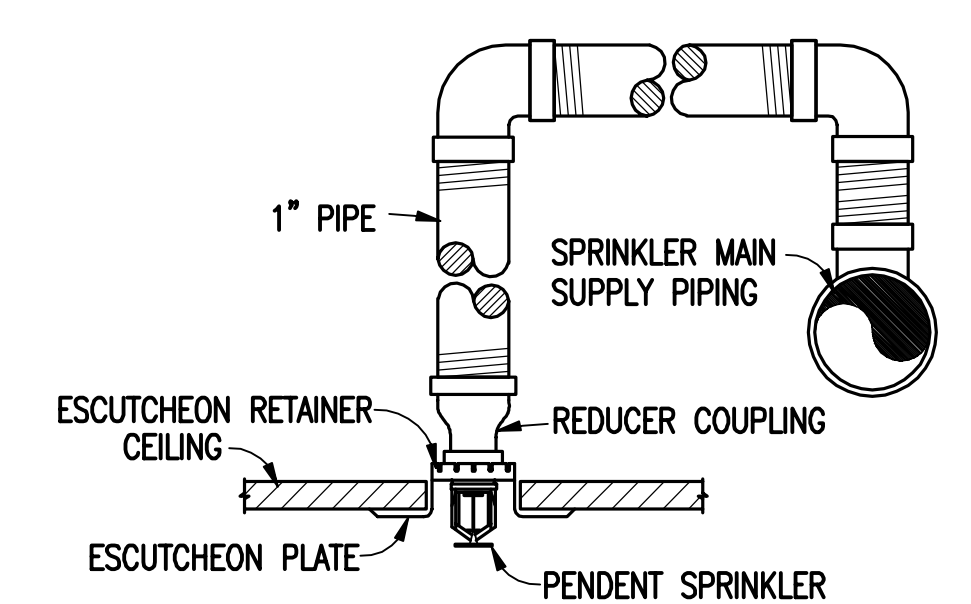

DROP TO PENDENT SPRINKLER HEAD DETAIL
SCALE: NONE

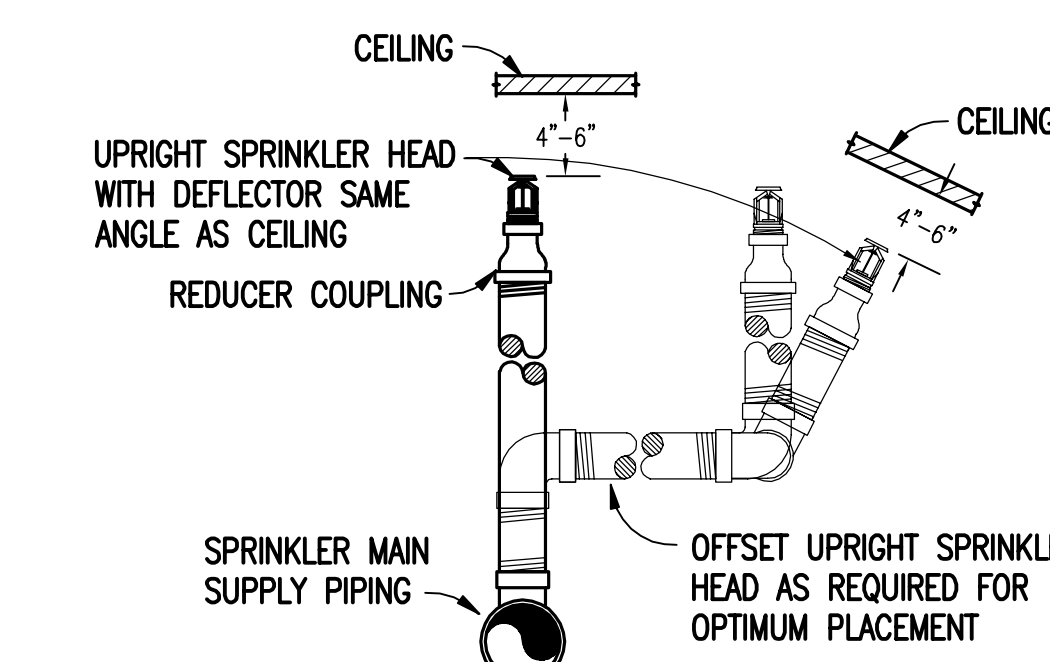


UPRIGHT SPRINKLER HEAD DETAIL
SCALE: NONE

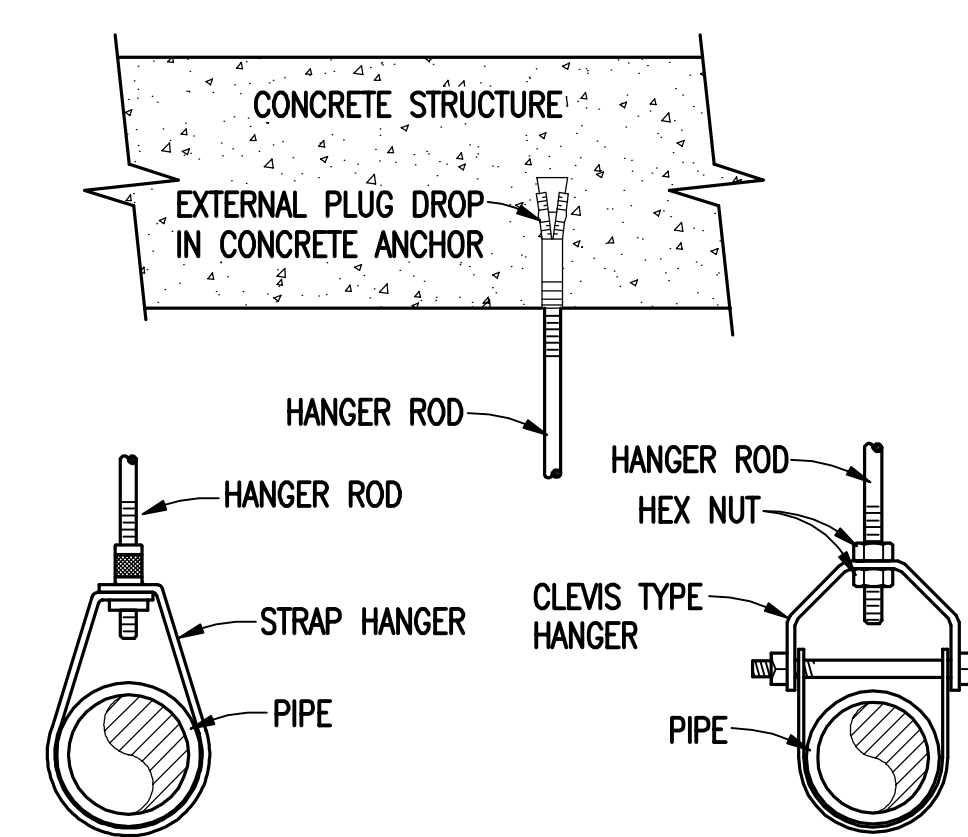

GENERAL NOTES:
(HANGER DETAIL ONLY)

(A) ALL HANGERS SHALL BE SPACED IN ACCORDANCE WITH PIPE MANUFACTURERS REQUIREMENTS.

PIPE HANGER DETAIL
SCALE: NONE

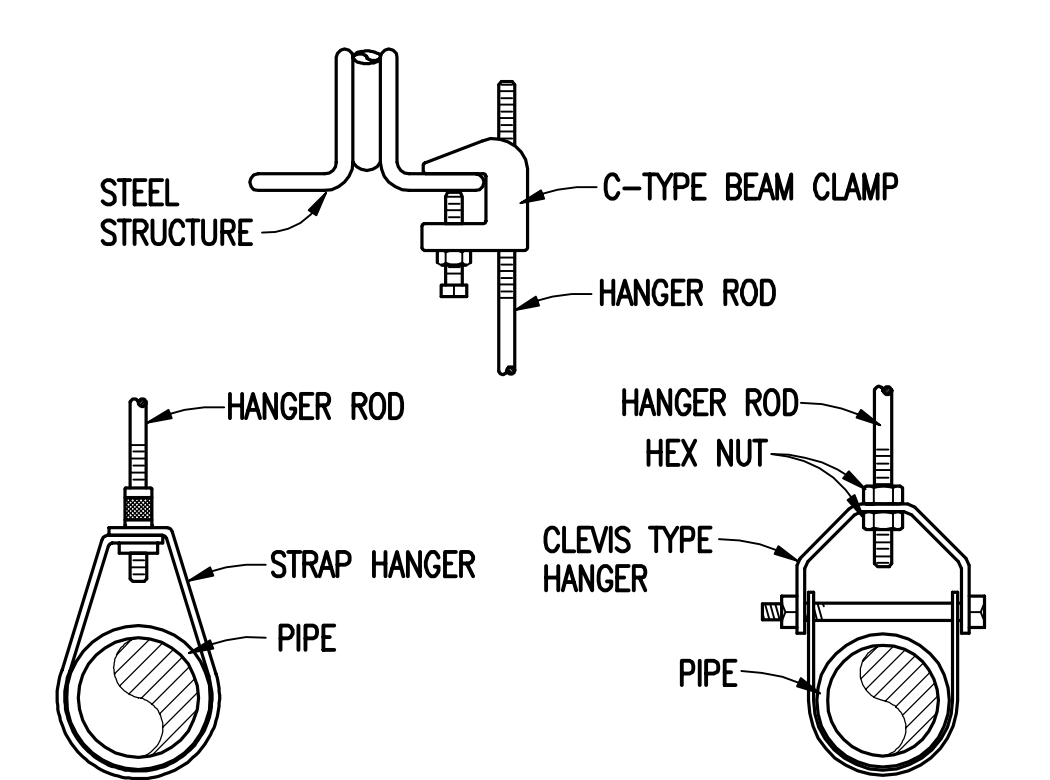

GENERAL NOTES:
(HANGER DETAIL ONLY)

(A) ALL HANGERS SHALL BE SPACED IN ACCORDANCE WITH PIPE MANUFACTURERS REQUIREMENTS.

PIPE HANGER DETAIL
SCALE: NONE

Revisions:		Date:		CONSULTANTS:		ARCHITECT:		Drawing Title:		Project Title:		Project Number:		Office of Construction and Facilities Management	
				CLARK•NEXSEN		TOLAND MIZELL MOLNAR		LEGEND AND DETAILS		EXPAND RADIOLOGY AND SPS OVERTON BROOKS VAMC		667-083		OFFICE OF CONSTRUCTION AND FACILITIES MANAGEMENT	
				440 MARTIN LUTHER KING, JR. BLVD. MACON, GA 31201 478-743-8415 FAX 478-743-8239 WWW.CLARKNEXSEN.COM		590 Means Street NW, Suite 200 Atlanta, GA 30318 404.214.9774		Approved: Project Director		Location: SHREVEPORT, LA		Building Number: 1		U.S. Department of Veterans Affairs	
										Date: 04-17-2015		Checked: RC		Dwg. 143 of 160	
												Drawing Number: FP 001			