


GENERAL NOTE:
(DEMOLITION 3RD AND 4TH FLOOR PLANS ONLY)


THIS PLAN SHOWS GENERALLY THE EXTENT OF DEMOLITION TO BE PERFORMED. CONTRACTOR SHALL DISCONNECT, REMOVE, AND HAUL OFF ALL ACCESSIBLE ELECTRICAL, LIGHTING, DEVICES, DATA OUTLETS, NURSE CALL, CABLE TELEVISION, ETC. IN THE RENOVATED SPACES UNLESS NOTED OTHERWISE BACK TO CLOSEST JUNCTION BOX OR TERMINATION POINT, AND LEAVE ALL NON-DEMOLISHED CIRCUITS, DEVICES, EQUIPMENT, ETC. IN PROPER WORKING ORDER. EXISTING ELECTRICAL CIRCUITS, DATA, CABLE TELEVISION, ETC. MAY BE REROUTED AND REINSTALLED IN NEW LOCATIONS IN RENOVATED AREAS. COORDINATE WITH NEW WORK PLANS FOR NEW LOCATIONS. CONTRACTOR SHALL COORDINATE SO THAT ALL EXISTING TO REMAIN CIRCUITS IN NON-RENOVATED SPACES REMAIN ACTIVE AND IN PROPER WORKING ORDER, DURING AND AFTER WORK IS TO BE PERFORMED. ANY DOWNTIME FOR RENOVATION OF SPACES THAT WILL AFFECT NON-RENOVATED SPACES SHALL BE COORDINATED WITH VA AT LEAST 2 WEEKS PRIOR TO BEGINNING WORK. DOWNTIME SHALL BE LIMITED TO WEEKENDS AND AFTER 7:00 P.M. ON WEEKDAYS UNLESS APPROVED BY THE VA.

- DEMOLITION KEYED NOTES:**
(THIS SHEET ONLY)
- 1 NO ELECTRICAL DEMOLITION REQUIRED THIS SPACE.
 - 2 CONTRACTOR SHALL DISCONNECT AND RELOCATE ELECTRICAL POWER CONNECTIONS TO HVAC, FAN COIL UNIT. SEE NEW WORK PLAN E405 FOR EXACT LOCATION.
 - 3 DISCONNECT AND REMOVE ALL POWER REQUIREMENTS TO HVAC FAN COIL UNIT.


- NEW WORK KEYED NOTES:**
(THIS SHEET ONLY)
- 1 CONTRACTOR SHALL RELOCATE EXISTING ELECTRICAL CONNECTION TO VAV AS REQUIRED. ROUTE 2#12;#12G;1/2" AND REINSTALL MOTOR RATED SWITCH. MAKE ALL CONNECTIONS AS REQUIRED.
 - 2 PROVIDE NEW MOTOR RATED SWITCH FOR POWER CONNECTION TO NEW VAV-28. MAKE ALL CONNECTIONS AS REQUIRED. ROUTE 2#12;#12G;1/2".
 - 3 CONTRACTOR SHALL EXTEND POWER FROM NEAREST VAV CIRCUIT FOR NEW POWER TO VAV-28. COORDINATE EXACT LOCATION AND MAKE ALL CONNECTIONS AS REQUIRED.
 - 4 EXISTING IT/TELECOMMUNICATIONS CLOSET ON SECOND FLOOR.
 - 5 APPROXIMATE LOCATION OF CONDUIT STUB UPS FROM PANEL HDP1 IN BASEMENT. CONTRACTOR TO USE THESE FOR FEEDERS OF NEW PANELS BEING INSTALLED.

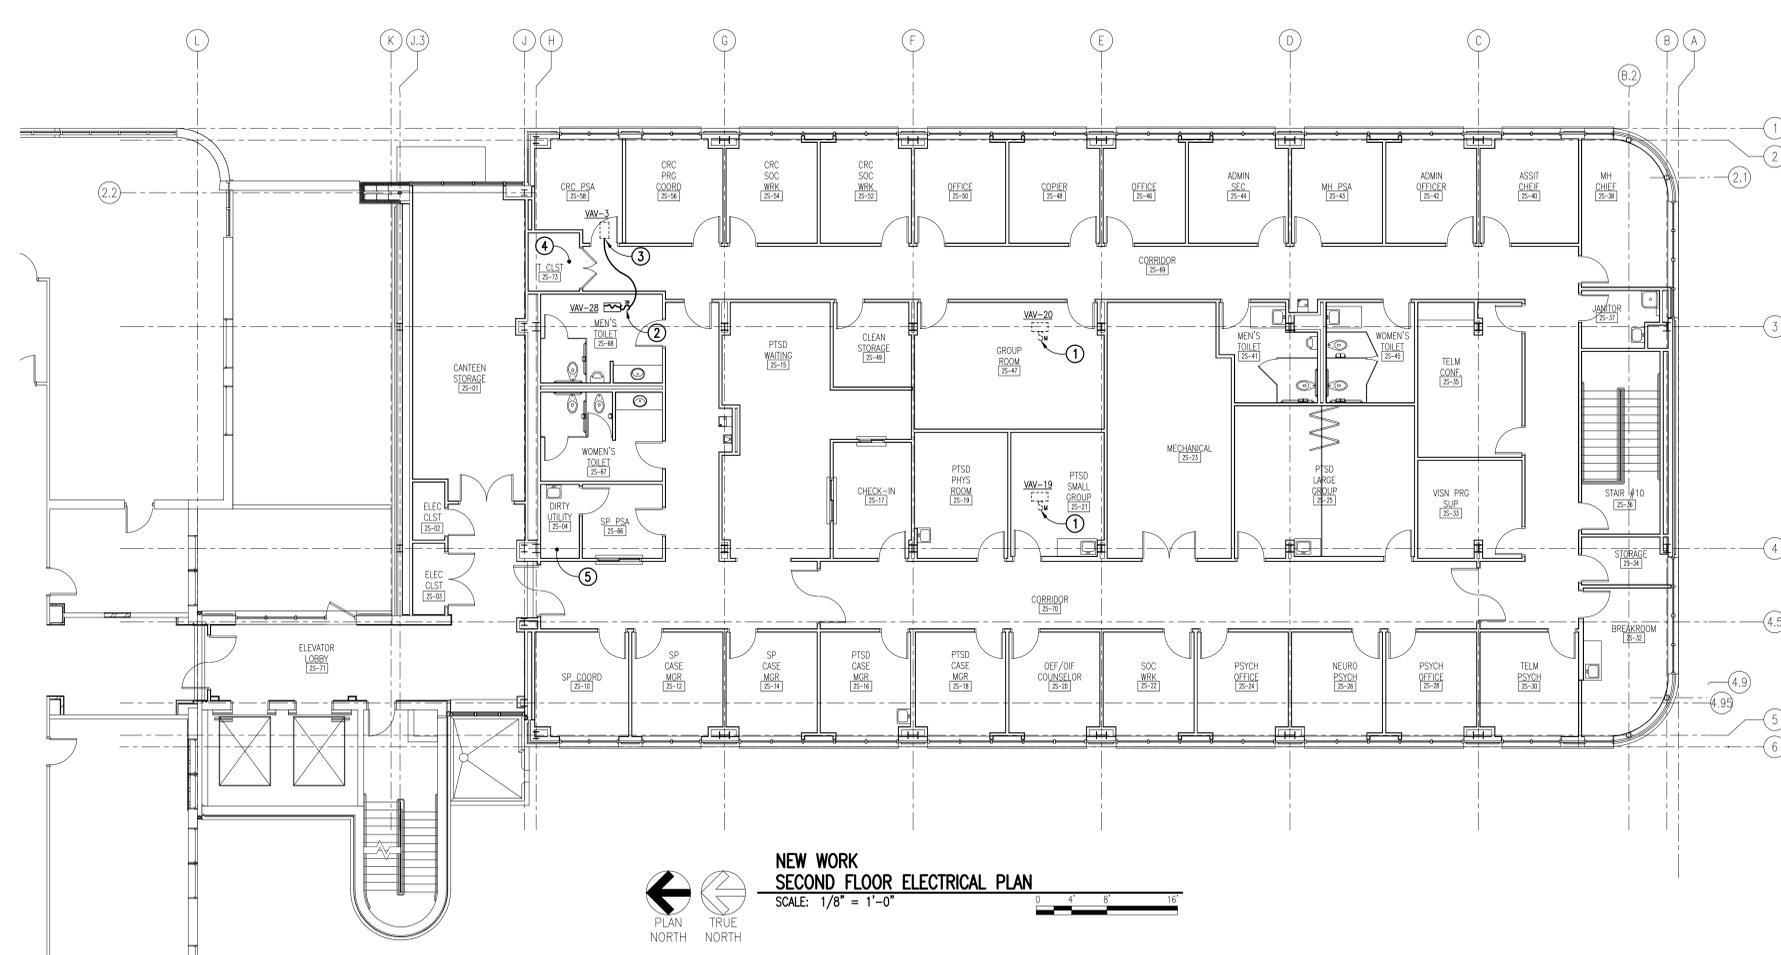

**NEW WORK
SECOND FLOOR ELECTRICAL PLAN**
SCALE: 1/8" = 1'-0"

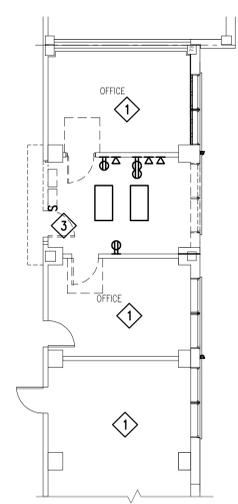

**DEMOLITION
THIRD FLOOR ELECTRICAL PLAN**
SCALE: 1/8" = 1'-0"

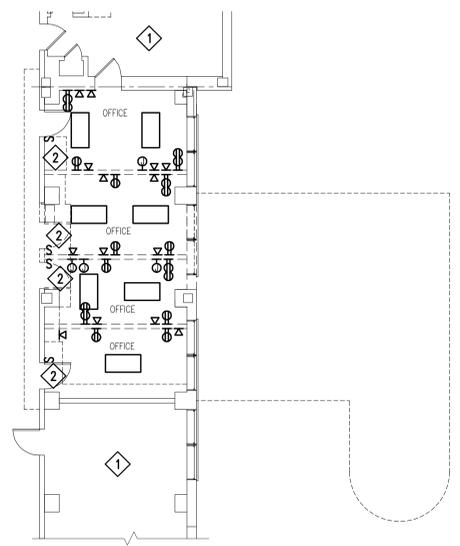

**DEMOLITION
FOURTH FLOOR ELECTRICAL PLAN**
SCALE: 1/8" = 1'-0"

Drawing File: H:\2013\13123-VA Shreveport 3rd and 4th Floors\Drawings\13123 EP 104_2ND Floor.dwg
 Plotted By: igleland
 Plotted Date: Apr 20, 2015 - 10:09am
 one-eighth inch = one foot

Revisions:	Date:

CONSULTANTS:

CLARK•NEXSEN
 440 MARTIN LUTHER KING, JR. BLVD.
 MACON, GA 31201
 478-743-8415 FAX 478-743-8239
 WWW.CLARKNEXSEN.COM



ARCHITECT:

TOLAND MIZELL MOLNAR
 590 Means Street NW, Suite 200
 Atlanta, GA 30318
 404.214.9774

Drawing Title: **NEW WORK 2ND FLOOR
DEMOLITION 3RD AND 4TH FLOOR
ELECTRICAL PLANS**

Approved: Project Director

Project Title: **EXPAND RADIOLOGY AND SPS
OVERTON BROOKS VAMC**

Location: **SHREVEPORT, LA**

Date: 04-17-2015

Checked: CBC

Drawn: SJB

Project Number: **667-083**

Building Number: **1**

Drawing Number: **EP104**

Dwg. 152 of 160

FINAL SUBMITTAL

**OFFICE OF
CONSTRUCTION
AND FACILITIES
MANAGEMENT**

VA U.S. Department of Veterans Affairs