








REFLECTED CEILING PLAN LEGEND



	Recessed downlight fixture		Re-work existing supply air diffuser into new 2' x 2' acoustical tile ceiling
	2' x 2' fluorescent fixture Match Hospital Standards		Re-work existing return air grille into new 2' x 2' acoustical tile ceiling
	2' x 2' acoustical tile ceiling		Area of limited Architectural work. See PME Drawings for additional information.
	Gypsum board / portland cement plaster ceiling / soffit - painted		

GENERAL NOTES

- A. All wood blocking shall be fire retardant.
- B. Light fixtures, sprinkler heads, speakers, and HVAC devices shall be located as close as possible to the center of acoustical ceiling panels. Confirm any deviation from this with the COR.
- C. For additional information regarding final information and quantities of fixtures/devices to be installed in ceiling.
- D. Ceiling height to be 8'-0" AFF, unless noted otherwise.

PLAN NOTES

1.07 Cubicle curtain track.

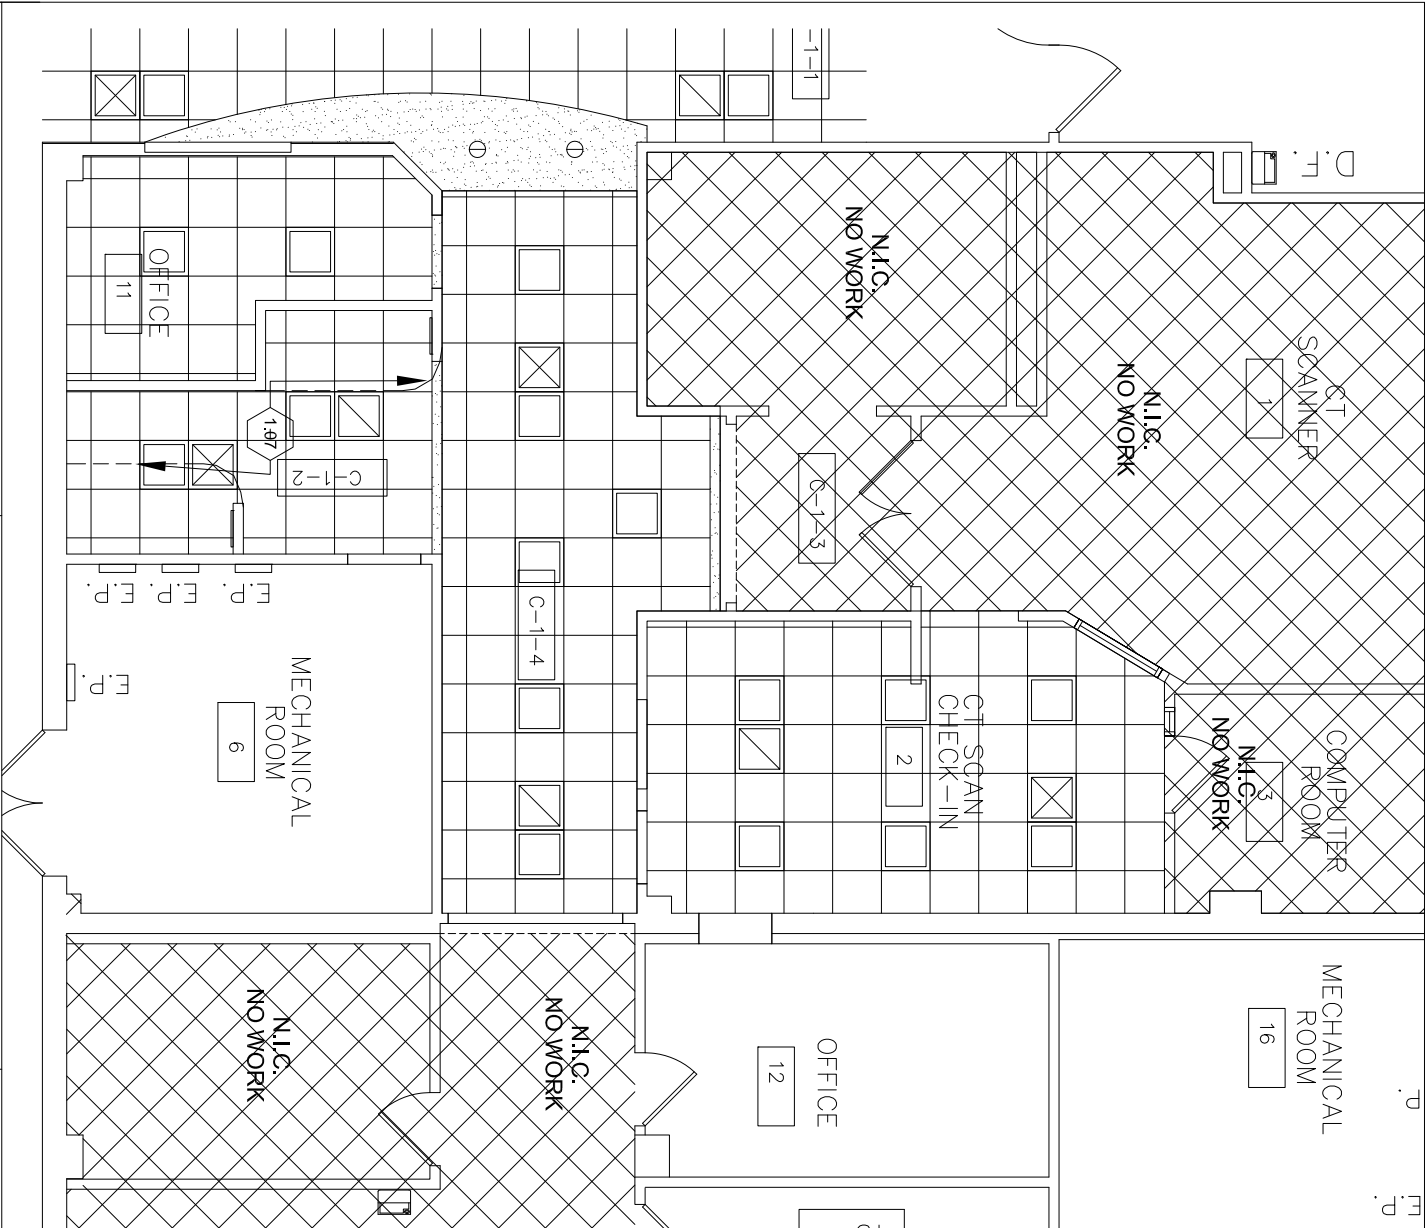

LOCATION
DEPARTMENT OF VETERANS AFFAIRS
VA MEDICAL CENTER DAYTON, OHIO

PROJECT TITLE
16-504 Renovate B322 for Patient Access

SHEET TITLE
B-322 FLOOR PLAN
REFLECTIVE CEILING PLAN

DRAWN BY
MCW

DATE
07/27/2016

SHEET
1 of 1